



November 21, 2023

Pat Cochran Concrete

Re: 2147 NW Killarney Lane
Permit #: PRRES20234858
Lee's Summit, Mo

Apex Engineers, Inc. observed the deck pier holes for the house under construction at the above referenced address.

Three 24" diameter piers were drilled a minimum of 3'0" in depth to competent soil bearing and found to be in general compliance with the approved foundation print.

Our firm recommends approval of the deck pier holes for the placement of concrete. This report does not constitute approval by the enforcing jurisdiction.

LIMITATIONS


The recommendations and conclusions given in this report are based on the observed conditions at the time of this site visit. The scope of our services was only to observe the drilled conditions and pier bearing verification. These conditions may be altered over time and/or with changes in the weather, of which could require further excavation and/or re-drilling to provide adequate support at the base of the piers. Therefore, if changes occur that could affect any of the recommendations given in this report, Apex Engineers, Inc. shall be called back and allowed to re-evaluate our previous recommendations and/or conclusions. If changes in the condition of the site occur and Apex Engineers, Inc. is not allowed the opportunity to re-evaluate the site to respond to any of these changes, our firm cannot be responsible for the effect of any of the conditions that differed from those reported herein.

Please call if Apex Engineers, Inc. can be of further assistance.

Best Regards,
Apex Engineers, Inc.

A handwritten signature in blue ink, appearing to read 'C' or 'Christopher'.

Christopher Veith
Senior Engineering Technician

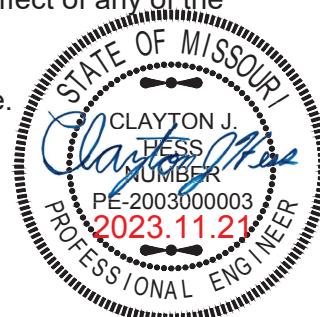

Clayton J. Hess, P.E.
Principal