

RE: P230810 - Roof - Osage Lot 76

Site Information:

Project Customer: Clover & Hive Project Name: Twin Honeydew - Farmhouse

Lot/Block: 76 Subdivision: Osage

Model: Twin Honeydew - Farmhouse Address: 2116 / 2118 Holdbrooks Drive

City: Lee's Summit State: MO

General Truss Engineering Criteria & Design Loads (Individual Truss Design

Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014

Wind Code: ASCE 7-16 Wind Speed: 115 mph

Roof Load: 45.0 psf

Mean Roof Height (feet): 35

Design Program: MiTek 20/20 8.6

Design Method: MWFRS (Envelope)/C-C hybrid Wind ASCE 7-16

MiTek, Inc.

314.434.1200

16023 Swingley Ridge Rd.

Chesterfield, MO 63017

Floor Load: N/A psf

Exposure Category: C

No. 123456789101123145617	Seal# 161755127 161755128 161755130 161755131 161755133 161755134 161755135 161755138 161755138 161755138 161755140 161755142 161755142	Truss Name A1 A2 A3 A4 A5 A6 B1 B2 C1 C2 C3 C4 D1 D2 PB1 PB2 V1	Date 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23 11/1/23
15	l61755141	PB1	11/1/23
16	l61755142	PB2	11/1/23

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Premier Building Supply (Springhill, KS)20300 W 207th Street.

Truss Design Engineer's Name: Sevier, Scott

My license renewal date for the state of Missouri is December 31, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



November 1,2023


1 of 1

Sevier, Scott

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	A1	Piggyback Base Structural Gable	2	1	Job Reference (optional)	161755127

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:36 ID:EmCXOiXYCML5IKd?OVTvI7yGxE5-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

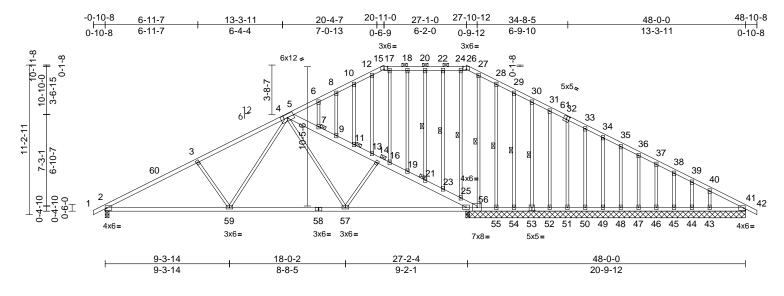

Scale = 1:86.4

WEBS

JOINTS

Plate Offsets (X, Y):	[15:0-3-0,Edge], [26:0-3-0,Edge], [32:0-2-8,0-3-0], [53:0-2-8,0-3-0]
-----------------------	--

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.20	2-59	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.95	Vert(CT)	-0.43	2-59	>771	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.07	56	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 312 lb	FT = 20%

LUMBER		
TOP CHORD	2x4 SP No.2 *Except* 56-5:2x6 SPF No.2	
BOT CHORD	2x4 SP No.2	
WEBS	2x3 SPF No.2	
OTHERS	2x3 SPF No.2	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or	
	2-2-0 oc purlins, except	
	2-0-0 oc purlins (10-0-0 max.): 15-26, 5-56.	FORCES
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc	

Rigid ceiling directly applied or 6-0-0 oc bracing, Except:

8-11-14 oc bracing: 2-59
10-0-0 oc bracing: 57-59
2-2-0 oc bracing: 56-57.

1 Row at midpt 20-21, 22-23, 24-25, 27-56, 28-55, 29-54, 30-53

1 Brace at Jt(s): 14, 21, 11, 7
size) 2-0-3-8, 41=20-11-8, 43=20-11-8,

REACTIONS (size) 2=0-3-8, 41=20-11-8, 43=20-11-8, 44=20-11-8, 45=20-11-8, 46=20-11-8, 47=20-11-8, 48=20-11-8, 49=20-11-8, 50=20-11-8, 51=20-11-8, 52=20-11-8, 53=20-11-8, 54=20-11-8, 55=20-11-8, 56=20-11-8

Max Horiz 2=204 (LC 12)

Max Uplift 2=-225 (LC 12), 41=-29 (LC 25), 43=-91 (LC 13), 46=-41 (IC 13), 45=-42 (IC 13), 46=-41 (IC 13),

lax Uplift 2=204 (LC 12) 43=-91 (LC 13), 44=-29 (LC 25), 43=-91 (LC 13), 46=-41 (LC 13), 45=-42 (LC 13), 46=-41 (LC 13), 47=-41 (LC 13), 48=-41 (LC 13), 49=-41 (LC 13), 50=-42 (LC 13), 51=-41 (LC 13), 52=-39 (LC 13), 53=-46 (LC 13), 54=-23 (LC 13), 55=-509 (LC 25), 56=-162 (LC 12) Max Grav 2=1249 (LC 1), 41=166 (LC 26), 43=232 (LC 1), 44=81 (LC 1), 45=128 (LC 26), 46=119 (LC 1), 47=120 (LC 1), 48=120 (LC 1), 49=120 (LC 26), 50=123 (LC 1), 51=118 (LC 26), 52=128 (LC 1), 53=96 (LC 26), 54=234 (LC 1), 55=33 (LC 9), 56=1945 (LC 1) (lb) - Maximum Compression/Maximum

1-2=0/17, 2-3=-1983/353, 3-5=-1735/359, 5-6=-43/246, 6-8=-12/263, 8-10=0/277, 10-12=0/296, 12-15=-17/249, 15-17=-15/234, 17-18=-13/242, 18-20=-13/242, 20-22=-13/242, 22-24=-13/242, 20-26-27-20

24-26=-10/244, 26-27=-47/223, 27-28=0/312, 28-29=-6/254, 29-30=-9/233, 30-31=-7/227, 31-33=-27/219, 33-34=-46/203, 34-35=-64/198, 35-36=-83/198, 36-37=-101/198, 37-38=-120/198, 38-39=-144/200, 39-40=-170/189,

40-41=-240/230, 41-42=0/17, 5-7=-1799/395, 7-9=-1829/416, 9-11=-1862/436, 11-13=-1892/457, 13-14=-1977/479, 14-16=-2050/498, 16-19=-2125/504, 19-21=-2155/510, 21-23=-2187/516, 23-25=-2216/523, 25-56=-2226/522 2-59=-415/1683, 57-59=-190/1108, 56-57=-274/1789, 55-56=-193/244, 54-55=-193/244, 50-51=-194/244, 51-52=-193/244, 50-51=-194/244,

23-25=-2216/523, 25-50=-2226/522 2-59=-415/1683, 57-59=-190/1108, 56-57=-274/1789, 55-56=-193/244, 54-55=-193/244, 52-54=-193/244, 51-52=-193/244, 50-51=-194/244, 49-50=-194/244, 48-49=-194/244, 47-48=-194/244, 46-47=-194/244, 43-44=-194/244, 41-43=-194/244, WEBS 3-59=-411/269, 5-59=-138/643, 5-57=-9/737, 14-57=-551/143, 20-21=-74/35, 22-23=-67/38, 24-25=-49/21, 27-56=-367/24, 28-55=-12/84, 29-54=-87/60, 30-53=-98/56, 31-52=-92/56, 32-51=-93/56, 33-50=-95/58, 34-49=-93/57, 35-48=-93/57, 36-47=-93/57, 37-46=-93/57, 38-45=-97/59, 39-44=-69/41, 40-43=-174/115, 18-19=-73/40, 16-17=-169/20, 12-13=-190/48, 10-11=-67/47, 8-9=-73/46, 6-7=-60/41

NOTES

- Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 20-11-0, Exterior(2E) 20-11-0 to 27-1-0, Exterior(2R) 27-1-0 to 34-1-14, Interior (1) 34-1-14 to 48-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60



November 1,2023

Continued on page 2

BOT CHORD



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	A1	Piggyback Base Structural Gable	2	1	Job Reference (optional)	161755127

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:36 ID: EmCXOiXYCML5IKd?OVTvI7yGxE5-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?ff Page: 2

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 225 lb uplift at joint 2, 162 lb uplift at joint 56, 29 lb uplift at joint 41, 509 lb uplift at joint 55, 23 lb uplift at joint 54, 46 lb uplift at joint 53, 39 lb uplift at joint 52, 41 lb uplift at joint 51, 42 Ib uplift at joint 50, 41 lb uplift at joint 49, 41 lb uplift at joint 48, 41 lb uplift at joint 47, 41 lb uplift at joint 46, 42 lb uplift at joint 45, 28 lb uplift at joint 44 and 91 lb uplift at joint 43.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.


LOAD CASE(S) Standard



Job	Truss	Truss Type	Qty Ply Roof - Osage Lot 76		Roof - Osage Lot 76	
P230810	A2	Piggyback Base	6	1	Job Reference (optional)	l61755128

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:38

Page: 1

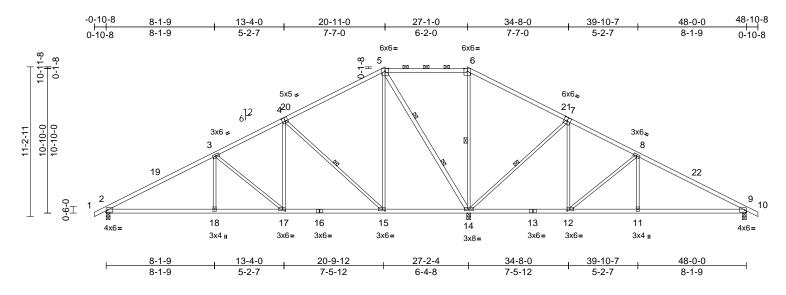

Scale = 1:86.4

Plate Offsets (X, Y): [4:0-2-8,0-3-4], [7:0-3-0,0-3-4], [12:0-2-8,0-1-8], [15:0-2-8,0-1-8], [17:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.94	Vert(LL)	-0.13	2-18	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.30	2-18	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.04	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 232 lb	FT = 20%

LUMBER

2x4 SP No.2 *Except* 1-4,7-10:2x4 SP TOP CHORD

1650F 1.5E 2x4 SP No.2

2x3 SPF No.2 *Except* 14-5:2x4 SP No.2 WFBS

BRACING

BOT CHORD

TOP CHORD Structural wood sheathing directly applied or

2-2-0 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 5-6.

Rigid ceiling directly applied or 6-0-0 oc

4-15, 6-14, 7-14

BOT CHORD

bracing. WEBS 1 Row at midpt

2 Rows at 1/3 pts 5-14

WEBS

REACTIONS (size) 2=0-3-8, 9=0-3-8, 14=0-3-8

Max Horiz 2=204 (LC 12)

Max Uplift 2=-198 (LC 12), 9=-184 (LC 13),

14=-303 (LC 12)

Max Grav 2=1034 (LC 25), 9=689 (LC 26),

14=2925 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=0/17, 2-3=-1514/257, 3-5=-926/229,

5-6=0/834, 6-8=-184/1051, 8-9=-783/228

9-10=0/17

BOT CHORD 2-18=-312/1230, 17-18=-312/1230,

15-17=-143/748, 14-15=-152/328, 12-14=-340/183, 11-12=-102/585,

9-11=-102/585

WEBS 3-18=0/297, 3-17=-623/218, 4-17=-60/504,

4-15=-911/325, 5-15=-137/756, 5-14=-1467/285, 6-14=-882/186,

7-14=-927/326, 7-12=-60/514,

8-12=-651/219, 8-11=0/300

NOTES

1) Unbalanced roof live loads have been considered for

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 20-11-0, Exterior(2E) 20-11-0 to 27-1-0, Exterior(2R) 27-1-0 to 34-1-14, Interior (1) 34-1-14 to 48-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 198 lb uplift at joint 2, 303 lb uplift at joint 14 and 184 lb uplift at joint 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 1,2023



MARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Type Qty Ply		Roof - Osage Lot 76	
P230810	A3	Piggyback Base	2	1	Job Reference (optional)	l61755129

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:39 ID:_BaRCVCQw9?42CIXuEbokKyGxNZ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f Page: 1

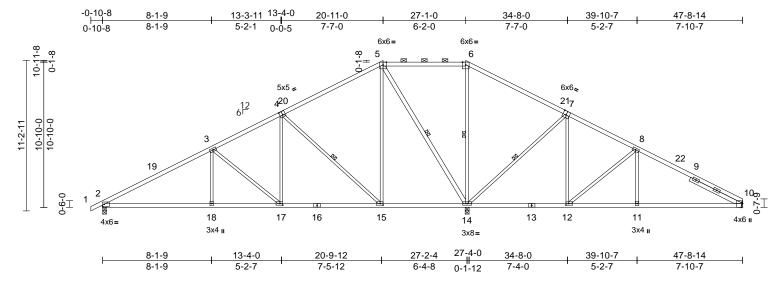


Plate Offsets (X, Y): [4:0-2-8,0-3-4], [7:0-3-0,Edge], [10:0-3-10,Edge], [12:0-2-8,0-1-8], [15:0-2-8,0-1-8], [17:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.13	2-18	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.31	2-18	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.96	Horz(CT)	0.05	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 236 lb	FT = 20%

LUMBER

2x4 SP No.2 *Except* 4-1,7-10:2x4 SP TOP CHORD

1650F 1.5E 2x4 SP No.2

2x3 SPF No.2 *Except* 14-5:2x4 SP No.2 WFBS

SLIDER Right 2x4 SP No.2 -- 4-4-0

BRACING

BOT CHORD

TOP CHORD Structural wood sheathing directly applied or

2-2-0 oc purlins, except

2-0-0 oc purlins (10-0-0 max.): 5-6. **BOT CHORD** Rigid ceiling directly applied or 6-0-0 oc

bracing

WEBS 1 Row at midpt 6-14, 5-14, 7-14, 4-15

REACTIONS (size) 2=0-3-8, 10= Mechanical, 14=0-3-8 Max Horiz 2=209 (LC 12)

Max Uplift 2=-212 (LC 12), 10=-202 (LC 13),

14=-270 (LC 12)

Max Grav 2=1056 (LC 25), 10=696 (LC 26),

14=2770 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension TOP CHORD

5-6=0/665, 1-2=0/17, 2-3=-1560/287, 3-5=-973/270, 6-8=-364/860, 8-10=-913/318

BOT CHORD 2-18=-344/1270, 17-18=-344/1270,

15-17=-176/790, 14-15=-70/250,

12-14=-285/252, 11-12=-167/718

10-11=-167/718

WEBS 3-18=0/297, 5-15=-136/754, 6-14=-796/153,

8-11=0/287, 5-14=-1391/268, 4-17=-59/501,

3-17=-619/217, 7-12=-51/500, 7-14=-925/324, 8-12=-615/201

4-15=-908/324

NOTES

Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 20-11-0, Exterior(2E) 20-11-0 to 27-1-0, Exterior(2R) 27-1-0 to 34-1-14, Interior (1) 34-1-14 to 47-8-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi, Joint 14 SP No.2 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 202 lb uplift at joint 10, 212 lb uplift at joint 2 and 270 lb uplift at joint
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	A4	Piggyback Base	2	1	Job Reference (optional)	l61755130

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:39 ID:SN8pPrD2hT7xgLsjSx71GYyGxNY-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

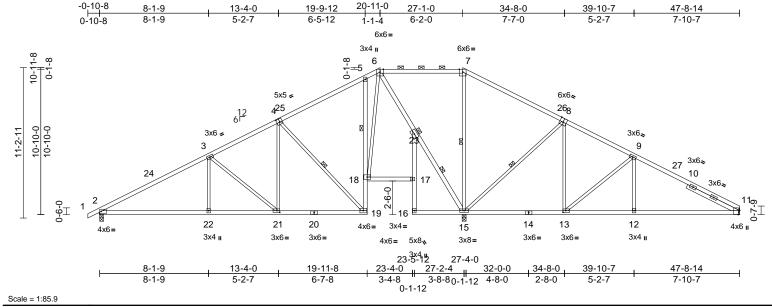


Plate Offsets (X, Y): [4:0-2-8,0-3-0], [8:0-3-0,Edge], [11:0-3-10,Edge], [13:0-2-8,0-1-8], [21:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	csı		DEFL	in	(loc)	I/defI	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.13	2-22	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.30	2-22	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.08	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 257 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 *Except* 4-1,8-11:2x4 SP 1650F

1.5E

BOT CHORD 2x4 SP No.2

2x3 SPF No.2 *Except* 15-6:2x4 SP No.2 WFBS **SLIDER**

Right 2x4 SP No.2 -- 4-4-0

BRACING

TOP CHORD Structural wood sheathing directly applied or

2-2-0 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 6-7.

BOT CHORD Rigid ceiling directly applied or 6-0-0 oc

bracing. Except:

1 Row at midpt 5-18

WEBS 1 Row at midpt 7-15, 15-23, 8-15, 4-19

JOINTS 1 Brace at Jt(s): 23

REACTIONS (size) 2=0-3-8, 11= Mechanical, 15=0-3-8

Max Horiz 2=208 (LC 12)

2=-233 (LC 12), 11=-358 (LC 13), Max Uplift

15=-221 (LC 12)

Max Grav 2=967 (LC 25), 11=682 (LC 26),

15=2891 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=0/17, 2-3=-1376/391, 3-5=-774/467, 5-6=-217/494, 6-7=0/903, 7-9=-333/1060,

9-11=-884/640

BOT CHORD 2-22=-385/1109, 21-22=-385/1109,

19-21=-205/604, 18-19=-168/668,

5-18=-288/208, 17-18=-98/31, 16-17=-15/11,

17-23=0/55, 15-16=-69/26, 13-15=-509/225, 12-13=-450/694, 11-12=-450/694

WEBS 3-22=0/301, 7-15=-878/77, 9-12=0/290,

6-23=-1393/238, 15-23=-1432/230,

4-21=-68/507, 3-21=-650/232, 8-13=-42/497,

8-15=-922/318, 9-13=-625/182,

4-19=-822/275, 6-18=-336/995

1) Unbalanced roof live loads have been considered for this design

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 20-11-0, Exterior(2E) 20-11-0 to 27-1-0, Exterior(2R) 27-1-0 to 34-1-14, Interior (1) 34-1-14 to 47-8-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi, Joint 15 SP No.2 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 358 lb uplift at joint 11, 221 lb uplift at joint 15 and 233 lb uplift at joint
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord

LOAD CASE(S) Standard



November 1,2023




NOTES



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	A5	Piggyback Base	10	1	Job Reference (optional)	l61755131

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:40 ID:waiCdBDgSnFoHVRv0eeGplyGxNX-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

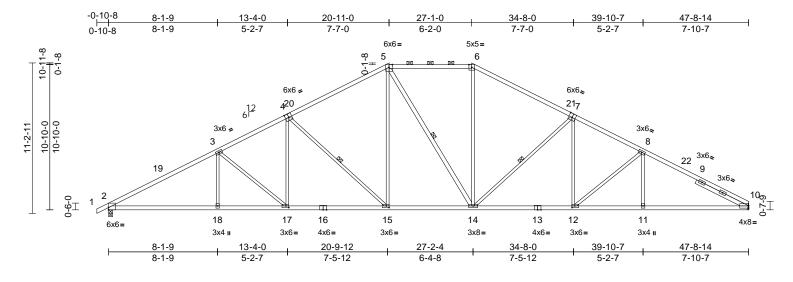

Scale = 1:85.9

Plate Offsets (X, Y): [2:Edge,0-2-1], [4:0-3-0,0-3-4], [7:0-3-0,Edge], [10:Edge,0-2-2], [12:0-2-8,0-1-8], [15:0-2-8,0-1-8], [17:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	-0.26	15-17	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.82	Vert(CT)	-0.53	15-17	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.81	Horz(CT)	0.23	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 236 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP 1650F 1.5E *Except* 5-6:2x4 SP

No.2, 4-1:2x4 SP 2400F 2.0E

BOT CHORD 2x4 SP 1650F 1.5E

2x3 SPF No.2 *Except* 14-5:2x4 SP No.2 WFBS

SLIDER Right 2x4 SP No.2 -- 4-4-0

BRACING

TOP CHORD

TOP CHORD Structural wood sheathing directly applied,

except 2-0-0 oc purlins (2-2-0 max.): 5-6.

BOT CHORD Rigid ceiling directly applied or 9-5-7 oc

bracing

WEBS 1 Row at midpt 5-14, 7-14, 4-15

REACTIONS 2=0-3-8, 10= Mechanical (size)

Max Horiz 2=209 (LC 16)

Max Uplift 2=-329 (LC 12), 10=-301 (LC 13)

Max Grav 2=2214 (LC 1), 10=2141 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

1-2=0/17, 2-3=-4010/580, 3-5=-3462/598.

5-6=-2386/554, 6-8=-3430/590,

8-10=-3898/580

BOT CHORD 2-18=-561/3433, 17-18=-561/3433,

15-17=-401/3019, 14-15=-175/2388,

12-14=-330/3010, 11-12=-404/3340, 10-11=-404/3340

WEBS 3-18=0/291, 5-15=-134/725, 6-14=-80/718,

8-11=0/270, 5-14=-282/275, 4-17=-53/466,

3-17=-547/206, 7-12=-44/425,

7-14=-851/319, 8-12=-452/190,

4-15=-860/321

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 20-11-0, Exterior(2E) 20-11-0 to 27-1-0, Exterior(2R) 27-1-0 to 34-1-14, Interior (1) 34-1-14 to 47-8-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP 1650F 1.5E
- crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 301 lb uplift at joint 10 and 329 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	A6	Piggyback Base Supported Gable	2	1	Job Reference (optional)	161755132

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:40 ID:JbPUB4NmDf0vUSJtFFIELayGxJT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

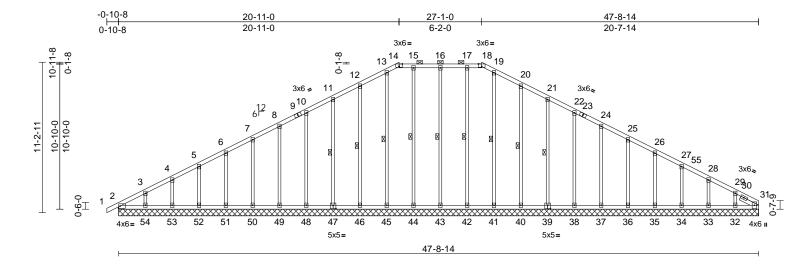

Scale = 1:85.9

LUMBER

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.02	31	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 267 lb	FT = 20%

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2
SLIDER	Right 2x4 SP No.2 1-5-12
BRACING	
TOP CHORD	Structural wood sheathing d

sheathing directly applied or

6-0-0 oc purlins, except

2-0-0 oc purlins (6-0-0 max.): 14-18.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

WFBS 1 Row at midpt 16-43, 17-42, 19-41, 20-40, 21-39, 15-44,

13-45, 12-46, 11-47

REACTIONS	(size)	2=47-8-14, 31=47-8-14,
		32=47-8-14, 33=47-8-14,
		34=47-8-14, 35=47-8-14,
		36=47-8-14, 37=47-8-14,
		38=47-8-14, 39=47-8-14,
		40=47-8-14, 41=47-8-14,
		42=47-8-14, 43=47-8-14,
		44=47-8-14, 45=47-8-14,
		46=47-8-14, 47=47-8-14,
		48=47-8-14, 49=47-8-14,
		50=47-8-14, 51=47-8-14,
		52=47-8-14, 53=47-8-14,
		E4 47 0 44

54=47-8-14 Max Horiz 2=209 (LC 16)

Max Uplift 2=-26 (LC 8), 32=-103 (LC 13), 33=-59 (LC 13), 34=-62 (LC 13), 35=-61 (LC 13), 36=-61 (LC 13), 37=-61 (LC 13), 38=-61 (LC 13), 39=-60 (LC 13), 40=-74 (LC 13), 42=-9 (LC 9), 43=-58 (LC 8), 44=-12 (LC 9), 46=-71 (LC 12), 47=-61 (LC 12), 48=-61 (LC 12), 49=-61 (LC 12), 50=-61 (LC 12),

> 51=-61 (LC 12), 52=-61 (LC 12), 53=-61 (LC 12), 54=-87 (LC 12)

Max Grav 2=178 (LC 21), 31=119 (LC 22), 32=179 (LC 26), 33=182 (LC 1), 34=180 (LC 26), 35=180 (LC 1), 36=180 (LC 26), 37=180 (LC 1), 38=180 (LC 26), 39=180 (LC 26), 40=180 (LC 1), 41=174 (LC 26), 42=177 (LC 26), 43=183 (LC 26), 44=177 (LC 25), 45=176 (LC 22), 46=180 (LC 1), 47=180 (LC 25), 48=180 (LC 25), 49=180 (LC 1), 50=180 (LC 1), 51=180 (LC 25), 52=180 (LC 1), 53=179 (LC 25), 54=181 (LC 25)

(lb) - Maximum Compression/Maximum Tension TOP CHORD

1-2=0/17, 2-3=-295/92, 3-4=-229/87, 4-5=-181/97, 5-6=-136/110, 6-7=-110/135, 7-8=-84/162, 8-10=-71/190, 10-11=-88/234, 11-12=-106/287, 12-13=-127/347, 13-14=-126/341, 14-15=-119/341, 15-16=-118/342, 16-17=-118/342, 17-18=-119/341, 18-19=-126/341, 19-20=-127/347. 20-21=-106/287. 21-22=-88/234, 22-24=-69/180, 24-25=-56/126, 25-26=-56/72, 26-27=-74/27, 27-28=-100/27. 28-29=-146/43. 29-31=-232/67

2-54=-59/225, 53-54=-59/225, 52-53=-59/225, 51-52=-59/225, 50-51=-59/225, 49-50=-59/225, 48-49=-59/225, 46-48=-59/225,

45-46=-59/225, 44-45=-59/225, 43-44=-59/225, 42-43=-59/225, 41-42=-59/225, 40-41=-59/225, 38-40=-59/225, 37-38=-59/225, 36-37=-59/225, 35-36=-59/225,

34-35=-59/225, 33-34=-59/225, 32-33=-59/225, 31-32=-59/225

WEBS 16-43=-143/107, 17-42=-137/33, 19-41=-134/0, 20-40=-140/112,

21-39=-140/96, 22-38=-140/96, 24-37=-140/96, 25-36=-140/97, 26-35=-140/96, 27-34=-139/106, 28-33=-142/147, 29-32=-137/191,

15-44=-137/36, 13-45=-136/8, 12-46=-140/112, 11-47=-140/96, 10-48=-140/96, 8-49=-140/96, 7-50=-140/96,

6-51=-140/97, 5-52=-140/97, 4-53=-140/123, 3-54=-138/171

NOTES

Unbalanced roof live loads have been considered for 1) this design.



November 1,2023

ontinued on page 2

- Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not

FORCES

BOT CHORD



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	A6	Piggyback Base Supported Gable	2	1	I6 ⁻ Job Reference (optional)	1755132

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:40 ID:JbPUB4NmDf0vUSJtFFIELayGxJT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Wind: ASCF 7-16: Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-0-0, Exterior(2N) 4-0-0 to 20-11-0, Corner(3R) 20-11-0 to 26-0-0, Exterior(2N) 26-0-0 to 27-1-0, Corner(3R) 27-1-0 to 32-0-0, Exterior(2N) 32-0-0 to 47-8-14 zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip

- DOL=1.60 Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing. 6)
- 7) Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 2, 58 lb uplift at joint 43, 9 lb uplift at joint 42, 74 lb uplift at joint 40, 60 lb uplift at joint 39, 61 lb uplift at joint 38, 61 lb uplift at joint 37, 61 lb uplift at joint 36, 61 lb uplift at joint 35, 62 lb uplift at joint 34, 59 lb uplift at joint 33, 103 lb uplift at joint 32, 12 lb uplift at joint 44, 71 lb uplift at joint 46, 61 lb uplift at joint 47, 61 lb uplift at joint 48, 61 lb uplift at joint 49, 61 lb uplift at joint 50, 61 lb uplift at joint 51, 61 lb uplift at joint 52, 61 lb uplift at joint 53 and 87 lb uplift at joint 54.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord


LOAD CASE(S) Standard

Page: 2

Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	B1	Common Supported Gable	2	1	Job Reference (optional)	161755133

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:41 ID:UdTxDbh?e9q_8iTwPnntXZyGxKM-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



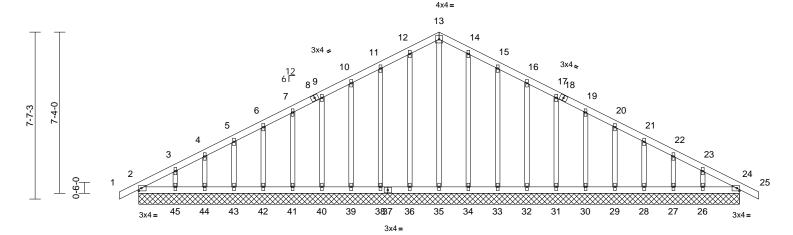

Scale = 1:52.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.01	24	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 145 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 **BOT CHORD** 2x4 SP No.2 2x3 SPF No.2 **OTHERS**

BRACING

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 2=27-4-0, 24=27-4-0, 26=27-4-0, 27=27-4-0, 28=27-4-0, 29=27-4-0, 30=27-4-0, 31=27-4-0, 32=27-4-0,

33=27-4-0, 34=27-4-0, 35=27-4-0, 36=27-4-0, 38=27-4-0, 39=27-4-0, 40=27-4-0, 41=27-4-0, 42=27-4-0, 43=27-4-0, 44=27-4-0, 45=27-4-0

Max Horiz 2=-137 (LC 13)

Max Uplift 2=-26 (LC 8), 24=-4 (LC 9), 26=-57

(LC 13), 27=-40 (LC 13), 28=-41 (LC 13), 29=-41 (LC 13), 30=-41 (LC 13), 31=-41 (LC 13), 32=-41 (LC 13), 33=-48 (LC 13), 34=-21 (LC 13), 36=-27 (LC 12), 38=-46

(LC 12), 39=-41 (LC 12), 40=-41 (LC 12), 41=-41 (LC 12), 42=-41 (LC 12), 43=-41 (LC 12), 44=-40 (LC 12), 45=-63 (LC 12)

Max Grav 2=150 (LC 1), 24=150 (LC 1),

26=130 (LC 26), 27=117 (LC 26), 28=121 (LC 1), 29=120 (LC 26), 30=120 (LC 26), 31=120 (LC 1), 32=120 (LC 1), 33=121 (LC 26), 34=123 (LC 26), 35=145 (LC 22), 36=123 (LC 25), 38=121 (LC 25), 39=120 (LC 1), 40=120 (LC 1), 41=120 (LC 25), 42=120 (LC 25),

43=121 (LC 1), 44=117 (LC 25),

45=130 (LC 25) (lb) - Maximum Compression/Maximum TOP CHORD 13-14=-89/255, 14-15=-80/230,

BOT CHORD

15-16=-66/191, 16-17=-53/155, 17-19=-41/119, 19-20=-34/83, 20-21=-35/48, 21-22=-51/20, 22-23=-74/22, 23-24=-123/45, 24-25=0/17, 1-2=0/17, 2-3=-181/64

27-4-0

3-4=-131/67, 4-5=-99/76, 5-6=-76/89 6-7=-59/107, 7-9=-50/126, 9-10=-53/155,

10-11=-66/191, 11-12=-80/230, 12-13=-89/255

2-45=-40/160, 44-45=-40/160,

43-44=-40/160, 42-43=-40/160, 41-42=-40/160, 40-41=-40/160, 39-40=-40/160, 38-39=-40/160, 36-38=-40/160, 35-36=-40/160,

34-35=-40/160, 33-34=-40/160, 32-33=-40/160, 31-32=-40/160, 30-31=-40/160, 29-30=-40/160, 28-29=-40/160, 27-28=-40/160

26-27=-40/160, 24-26=-40/160 13-35=-148/26. 12-36=-96/43. 11-38=-95/74.

10-39=-93/64, 9-40=-93/64, 7-41=-93/64, 6-42=-93/64, 5-43=-94/82, 4-44=-92/99 3-45=-99/122, 14-34=-96/40, 15-33=-95/74, 16-32=-93/64, 17-31=-93/64, 19-30=-93/64, 20-29=-93/64, 21-28=-94/82, 22-27=-92/99,

23-26=-99/119

NOTES

WFBS

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-4-0, Exterior(2N) 4-4-0 to 13-8-0, Corner(3R) 13-8-0 to 18-8-0, Exterior(2N) 18-8-0 to 28-2-8 zone; cantilever left and right exposed; end vertical left and right exposed:C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1. All plates are 1.5x4 MT20 unless otherwise indicated.

Page: 1

- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 2, 27 lb uplift at joint 36, 46 lb uplift at joint 38, 41 lb uplift at joint 39, 41 lb uplift at joint 40, 41 lb uplift at joint 41, 41 lb uplift at joint 42, 41 lb uplift at joint 43, 40 lb uplift at joint 44, 63 lb uplift at joint 45, 21 lb uplift at joint 34, 48 lb uplift at joint 33, 41 lb uplift at joint 32, 41 lb uplift at joint 31, 41 lb uplift at joint 30, 41 lb uplift at joint 29, 41 lb uplift at joint 28, 40 lb uplift at joint 27, 57 lb uplift at joint 26 and 4 lb uplift at joint 24
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



November 1,2023

Continued on page 2

Tension

FORCES

· Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not




Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	B1	Common Supported Gable	2	1	Job Reference (optional)	161755133

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:41 $ID: UdTxDbh?e9q_8iTwPnntXZyGxKM-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?ff$

Page: 2

LOAD CASE(S) Standard



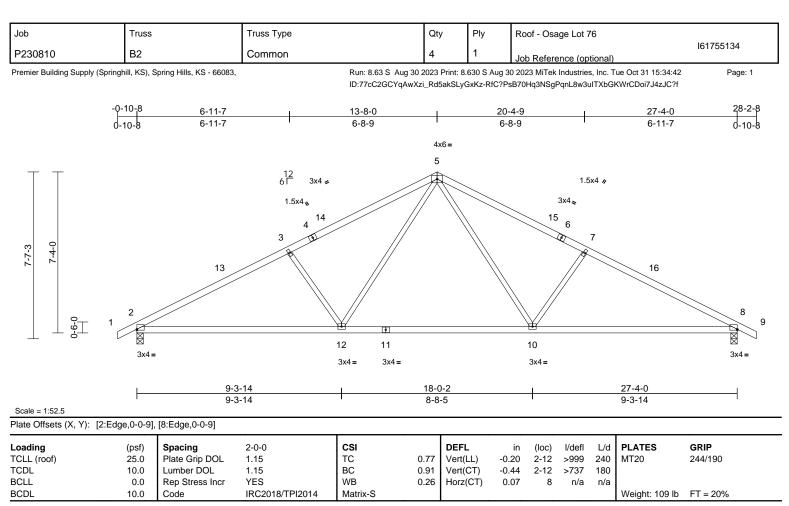

LUMBER

TOP CHORD 2x4 SP No.2 BOT CHORD 2x4 SP No.2 WEBS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or

2-6-11 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 2=0-3-8, 8=0-3-8

Max Horiz 2=-137 (LC 13)

Max Uplift 2=-211 (LC 12), 8=-211 (LC 13) Max Grav 2=1288 (LC 1), 8=1288 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=0/17, 2-3=-2072/392, 3-5=-1821/403, 5-7=-1821/403, 7-8=-2072/392, 8-9=0/17

BOT CHORD 2-12=-328/1763, 10-12=-86/1180,

8-10=-263/1763

WEBS 5-10=-154/672, 7-10=-451/287, 5-12=-153/672, 3-12=-451/287

NOTES

- Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 13-8-0, Exterior(2R) 13-8-0 to 18-8-0, Interior (1) 18-8-0 to 28-2-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.

- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 211 lb uplift at joint 2 and 211 lb uplift at joint 8.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023





Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	C1	Common Supported Gable	1	1	Job Reference (optional)	161755135

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:42 ID:pEeiREjqUZILYPLYj_L6IhyGxLc-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?fd

Page: 1



4x4 =

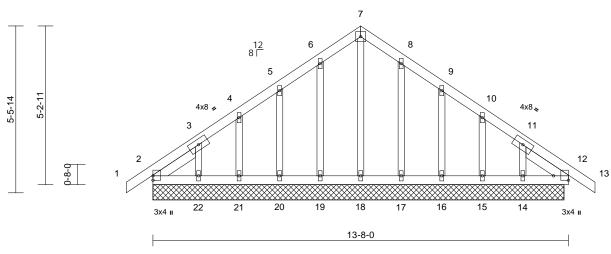


Plate Offsets (X, Y): [12:Edge,0-5-14]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 73 lb	FT = 20%

LUMBER TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2 2x3 SPF No.2 **OTHERS**

SLIDER Left 2x4 SP No.2 -- 1-8-5, Right 2x4 SP No.2 -- 1-8-5

BRACING

TOP CHORD

Scale = 1:37.9

Structural wood sheathing directly applied or

6-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size)

2=13-6-4, 12=13-6-4, 14=13-6-4, 15=13-6-4, 16=13-6-4, 17=13-6-4, 18=13-6-4, 19=13-6-4, 20=13-6-4,

21=13-6-4, 22=13-6-4 Max Horiz 2=-144 (LC 10)

Max Uplift 2=-39 (LC 8), 12=-2 (LC 9), 14=-73

(LC 13), 15=-52 (LC 13), 16=-57 (LC 13), 17=-42 (LC 13), 19=-45

(LC 12), 20=-56 (LC 12), 21=-52 (LC 12), 22=-80 (LC 12)

Max Grav 2=159 (LC 20), 12=154 (LC 1),

14=132 (LC 20), 15=125 (LC 20), 16=128 (LC 20), 17=127 (LC 20),

18=119 (LC 22), 19=131 (LC 19), 20=126 (LC 19), 21=126 (LC 19),

22=139 (LC 19)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 7-8=-91/176, 8-9=-66/126, 9-10=-49/59

10-11=-58/29, 11-12=-112/57, 12-13=0/16, 1-2=0/16. 2-3=-140/112. 3-4=-96/80. 4-5=-87/72, 5-6=-77/126, 6-7=-91/176

BOT CHORD 2-22=-52/150, 21-22=-52/150,

20-21=-52/150, 19-20=-52/150, 18-19=-52/150, 17-18=-52/150,

16-17=-52/150, 15-16=-52/150, 14-15=-52/150, 12-14=-52/150

WEBS

7-18=-119/26, 8-17=-100/74, 9-16=-101/107, 10-15=-100/111, 11-14=-102/129,

6-19=-104/73, 5-20=-99/106, 4-21=-100/111,

3-22=-109/131

NOTES

Unbalanced roof live loads have been considered for 1) this design.

2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-2-0, Exterior(2N) 4-2-0 to 6-10-0, Corner(3R) 6-10-0 to 11-10-0, Exterior(2N) 11-10-0 to 14-6-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOI = 1.60

Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2 lb uplift at joint 12, 39 lb uplift at joint 2, 42 lb uplift at joint 17, 57 lb uplift at joint 16, 52 lb uplift at joint 15, 73 lb uplift at joint 14, 45 lb uplift at joint 19, 56 lb uplift at joint 20, 52 lb uplift at joint 21 and 80 lb uplift at joint 22.
- N/A
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	C2	Monopitch	1	1	Job Reference (optional)	l61755136

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:42 ID:Ho1WEiUTGX1gwu78IG1QiOyGxNB-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f Page: 1

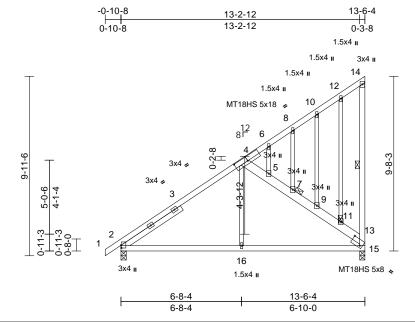


Plate Offsets (X, Y): [2:0-1-13,0-0-4], [4:0-9-0,0-3-0], [15:0-6-6,0-3-11]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.65	Vert(LL)	-0.04	15-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.44	Vert(CT)	-0.09	2-16	>999	180	MT18HS	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.26	Horz(CT)	0.01	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 97 lb	FT = 20%

LUMBER

2x4 SP No.2 *Except* 4-13:2x6 SPF No.2 TOP CHORD

BOT CHORD 2x4 SP No.2 WEBS

2x4 SP No.2 *Except* 4-16:2x3 SPF No.2

OTHERS 2x3 SPF No 2 SLIDER Left 2x4 SP No.2 -- 3-11-10

BRACING

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 9-10-14 oc

bracing.

WFBS 1 Row at midpt 14-15

JOINTS 1 Brace at Jt(s): 11,

REACTIONS (size) 2=0-3-8, 15=0-3-8

Max Horiz 2=399 (LC 9)

Max Uplift 2=-83 (LC 12), 15=-202 (LC 12)

Max Grav 2=665 (LC 1), 15=658 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/16, 2-6=-708/227, 6-8=-276/239,

8-10=-236/218, 10-12=-204/204, 12-14=-95/98, 13-15=-600/366,

13-14=-89/85, 4-5=-538/231, 5-7=-560/246,

7-9=-606/280, 9-11=-648/313,

11-13=-725/370

BOT CHORD 2-16=-333/580, 15-16=-338/572

WEBS 4-16=0/305, 11-12=-214/183, 9-10=-77/64,

7-8=-84/61, 5-6=-12/6

NOTES

1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 13-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- 5) All plates are 3x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 202 lb uplift at joint 15 and 83 lb uplift at joint 2.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



November 1,2023




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	C3	Monopitch Girder	2	2	Job Reference (optional)	161755137

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:43 ID:HXV5guHpHJt4OGKtoCERWpyGxNS-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f Page: 1



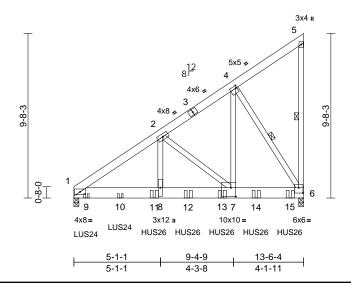


Plate Offsets (X, Y): [4:0-0-12,0-1-12], [6:0-3-0,0-3-12], [7:0-3-8,0-6-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	-0.07	7-8	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.36	Vert(CT)	-0.12	7-8	>999	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.02	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 230 lb	FT = 20%

LUMBER

TOP CHORD 2x6 SPF No.2 2x8 SP 2400F 2.0E **BOT CHORD** 2x4 SP No.2 WEBS

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-5-9 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

WEBS 1 Row at midnt 5-6. 4-6 **REACTIONS** (size) 1=0-3-8, 6=0-3-8

Max Horiz 1=384 (LC 11)

Max Uplift 1=-1112 (LC 12), 6=-1295 (LC 12)

Max Grav 1=5503 (LC 1), 6=7639 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-7647/1389. 2-4=-4084/764. 4-5=-202/180, 5-6=-144/122

BOT CHORD 1-8=-1372/6184, 7-8=-1372/6184

6-7=-721/3362

WFBS 2-8=-765/4127. 2-7=-3634/843.

4-7=-1201/7202, 4-6=-6287/1143

NOTES

1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:

Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc. Bottom chords connected as follows: 2x8 - 4 rows staggered at 0-9-0 oc.

Web connected as follows: 2x4 - 1 row at 0-9-0 oc. All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 5-1-1, Interior (1) 5-1-1 to 13-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP 2400F 2.0E crushing capacity of 805 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1295 lb uplift at joint 6 and 1112 lb uplift at joint 1.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 0-8-12 from the left end to 2-8-12 to connect truss(es) to back face of bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 4-8-12 from the left end to 12-8-12 to connect truss(es) to back face of bottom chord.
- 10) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (lb/ft)

Vert: 1-5=-70, 1-6=-20

Concentrated Loads (lb)

Vert: 9=-680 (B), 10=-662 (B), 11=-2121 (B),

12=-2121 (B), 13=-2121 (B), 14=-2121 (B),

15=-2124 (B)



November 1,2023




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	C4	Monopitch Supported Gable	1	1	Job Reference (optional)	l61755138

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:43 ID:GjwpzSgpHeSKmRw4J_pUy2yGxOF-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f Page: 1

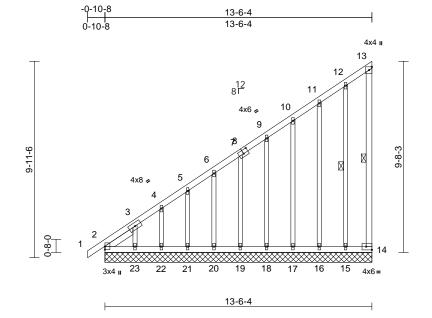

Scale = 1:58.3

Plate Offsets (X, Y): [8:0	0-3-0,0-2-4], [14:Edge,0-2-0]
----------------------------	-------------------------------

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.77	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.37	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.00	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 96 lb	FT = 20%

2-23=-178/230, 22-23=-178/230,

21-22=-178/230, 20-21=-178/230,

19-20=-178/230, 18-19=-178/230,

17-18=-178/230, 16-17=-178/230,

15-16=-178/230, 14-15=-178/230

12-15=-221/207, 11-16=-103/114,

3-23=-179/231

Lumber DOL=1.60 plate grip DOL=1.60

Gable studs spaced at 1-4-0 oc.

Wind: ASCE 7-16; Vult=115mph (3-second gust)

Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;

exterior zone and C-C Corner(3E) -0-10-8 to 4-2-4,

Exterior(2N) 4-2-4 to 13-4-8 zone; cantilever left and

right exposed; end vertical left and right exposed; C-C

for members and forces & MWFRS for reactions shown;

Truss designed for wind loads in the plane of the truss

see Standard Industry Gable End Details as applicable,

or consult qualified building designer as per ANSI/TPI 1.

only. For studs exposed to wind (normal to the face),

All plates are 1.5x4 MT20 unless otherwise indicated.

Gable requires continuous bottom chord bearing.

This truss has been designed for a 10.0 psf bottom

All bearings are assumed to be SP No.2 crushing

chord live load nonconcurrent with any other live loads.

Ib uplift at joint 16, 63 lb uplift at joint 17, 50 lb uplift at

joint 18, 53 lb uplift at joint 19, 52 lb uplift at joint 20, 51

Ib uplift at joint 21, 54 lb uplift at joint 22 and 118 lb uplift

Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)

10-17=-98/107, 9-18=-99/101, 7-19=-99/90,

6-20=-99/90, 5-21=-99/99, 4-22=-101/114,

LUMBER TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x4 SP No.2 WEBS OTHERS 2x3 SPF No 2 **SLIDER** Left 2x4 SP No.2 -- 1-8-10

BRACING

BOT CHORD

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins, except end verticals. Rigid ceiling directly applied or 10-0-0 oc

bracing.

WFBS 1 Row at midpt 13-14, 12-15 **REACTIONS** (size)

2=13-6-4, 14=13-6-4, 15=13-6-4, 16=13-6-4, 17=13-6-4, 18=13-6-4, 19=13-6-4, 20=13-6-4, 21=13-6-4,

22=13-6-4, 23=13-6-4

Max Horiz 2=399 (LC 9)

Max Uplift 2=-101 (LC 8), 14=-108 (LC 11), 15=-83 (LC 12), 16=-41 (LC 9),

17=-63 (LC 12), 18=-50 (LC 12), 19=-53 (LC 12), 20=-52 (LC 12), 21=-51 (LC 12), 22=-54 (LC 12),

23=-118 (LC 12)

Max Grav 2=258 (LC 20), 14=105 (LC 8), 15=124 (LC 20), 16=140 (LC 19),

17=122 (LC 19), 18=127 (LC 19), 19=126 (LC 19), 20=126 (LC 19), 21=126 (LC 19), 22=126 (LC 19),

23=160 (LC 19)

FORCES (lb) - Maximum Compression/Maximum

Tension TOP CHORD

1-2=0/16, 2-3=-841/547, 3-4=-686/452,

4-5=-624/422, 5-6=-566/394, 6-7=-508/365, 7-9=-449/337, 9-10=-384/308, 10-11=-316/282, 11-12=-244/253,

12-13=-127/149, 13-14=-60/74

Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 108 lb uplift at joint 14, 101 lb uplift at joint 2, 83 lb uplift at joint 15, 41

capacity of 565 psi.

7)

BOT CHORD

WEBS

NOTES

at joint 23. Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.

10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard




November 1,2023




Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	D1	Monopitch	4	1	Job Reference (optional)	161755139

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:43 ID: J9uoFkXWrWxKhW?zklsl4bzDH1v-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?ff

Page: 1



5-0-0

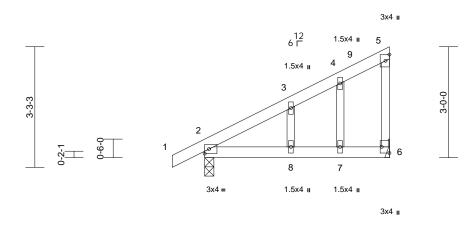

Scale = 1:31.2

Plate Offsets (X, Y): [6:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	0.04	7-8	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.28	Vert(CT)	-0.05	7-8	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 22 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or

5-0-0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 2=0-3-0, 6= Mechanical

Max Horiz 2=123 (LC 9)

Max Uplift 2=-59 (LC 12), 6=-60 (LC 12) Max Grav 2=292 (LC 1), 6=207 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=0/17, 2-3=-169/71, 3-4=-102/61,

4-5=-65/57, 5-6=-106/113 BOT CHORD 2-8=-67/74, 7-8=-67/74, 6-7=-67/74

WEBS 4-7=-36/69, 3-8=-48/105

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 4-10-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi.

- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 6 and 59 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not




Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	D2	Monopitch	10	1	Job Reference (optional)	161755140

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:44 ID:yf123P231X1sVXWTy3fc?NzDH2W-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1



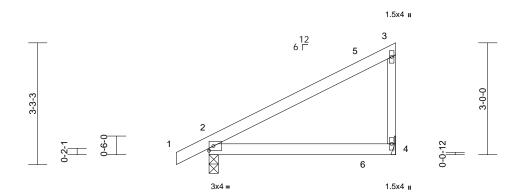

5-0-0

Scale = $1:30.9$	Scal	le =	: 1:	30	.9
------------------	------	------	------	----	----

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.48	Vert(LL)	0.09	2-4	>603	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	0.08	2-4	>751	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 19 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 2=0-3-0, 4= Mechanical

Max Horiz 2=123 (LC 9)

Max Uplift 2=-59 (LC 12), 4=-87 (LC 9) Max Grav 2=292 (LC 1), 4=207 (LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=0/17, 2-3=-167/114, 3-4=-167/225

BOT CHORD 2-4=-54/59

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) 1) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 4-10-12 zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 4 and 59 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not





Job	Truss	Trus	iss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	PB1	Pigg	ggyback	2	1	Job Reference (optional)	161755141

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:44 ID:9wUnxfypw9GahpSGfCwjgdzczGe-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

6-0-0		i	1
	5-5-9	3-0-0	
0.6.7	2-5-9	3-0-0	



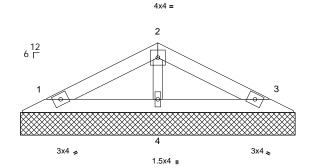

6-0-0

Scale = 1:25.5

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 18 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=6-1-0, 3=6-1-0, 4=6-1-0

1=23 (LC 12) Max Horiz Max Uplift

1=-30 (LC 12), 3=-34 (LC 13), 4=-7 (LC 12)

1=115 (LC 1), 3=115 (LC 1), 4=211 Max Grav

(LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-55/46, 2-3=-55/52 **BOT CHORD** 1-4=-1/25, 3-4=-1/25 2-4=-150/135 WEBS

NOTES

- 1) Unbalanced roof live loads have been considered for this design
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 1, 34 lb uplift at joint 3 and 7 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

OF MISS SCOTT M. SEVIER NUMBER PE-2001018807 SSIONAL


November 1,2023




Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	PB2	Piggyback	22	1	Job Reference (optional)	l61755142

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:44 ID:9wUnxfypw9GahpSGfCwjgdzczGe-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f





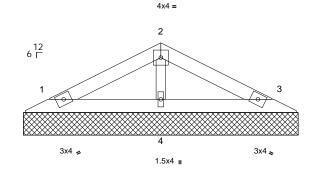

6-0-0

Scale = 1:25.5

													_
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20	244/190	
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(TL)	n/a	-	n/a	999			
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	3	n/a	n/a			
BCDI	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 18 lb	FT = 20%	

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=6-1-0, 3=6-1-0, 4=6-1-0

1=23 (LC 12) Max Horiz

Max Uplift 1=-30 (LC 12), 3=-34 (LC 13), 4=-7 (LC 12)

1=115 (LC 1), 3=115 (LC 1), 4=211 Max Grav

(LC 1)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-55/46, 2-3=-55/52 **BOT CHORD** 1-4=-1/25, 3-4=-1/25 2-4=-150/135 WEBS

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 1, 34 lb uplift at joint 3 and 7 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

OF MISS SCOTT M. SEVIER NUMBER PE-2001018807 SSIONAL

Page: 1


November 1,2023



Job)	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P2	30810	V1	Valley	2	1	Job Reference (optional)	161755143

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:44 ID:3dyyPIGdvpWQ0?o0jPG2wlyGxRL-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

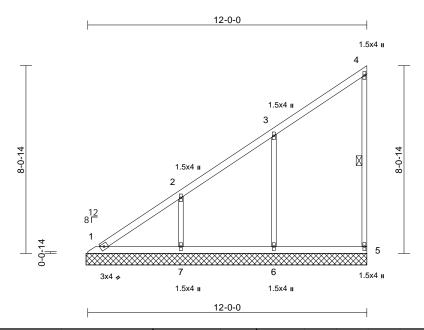

Scale = 1:49.5

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.25	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.20	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 50 lb	FT = 20%

LUMBER

2x4 SP No.2 TOP CHORD 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins, except end verticals. Rigid ceiling directly applied or 10-0-0 oc

BOT CHORD bracing.

WEBS 4-5 1 Row at midpt

REACTIONS (size) 1=12-0-15, 5=12-0-15, 6=12-0-15,

7=12-0-15

Max Horiz 1=335 (LC 12)

Max Uplift 5=-62 (LC 12), 6=-169 (LC 12),

7=-171 (LC 12)

1=183 (LC 21), 5=149 (LC 19), Max Grav

6=412 (LC 19), 7=388 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-377/251, 2-3=-228/156, 3-4=-104/51,

4-5=-116/84

BOT CHORD 1-7=-1/2, 6-7=-1/2, 5-6=-1/2 3-6=-327/235, 2-7=-299/221

WEBS

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-7-13 to 5-7-13, Interior (1) 5-7-13 to 12-0-1 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 5, 169 lb uplift at joint 6 and 171 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	V2	Valley	2	1	Job Reference (optional)	l61755144

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:45 ID:XHTUUTtwhgM5ZxmgHzAJ4LyGxRs-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f Page: 1

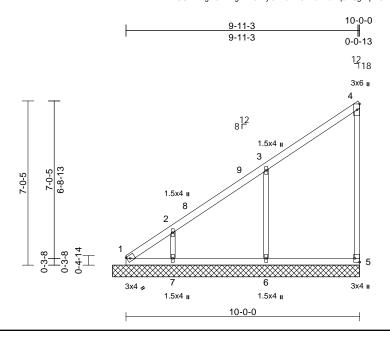

Scale = 1:49.3

Plate Offsets (X, Y): [5:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.60	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.20	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.14	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 42 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS 2x3 SPF No.2 **OTHERS**

BRACING

TOP CHORD Structural wood sheathing directly applied or

6-0-0 oc purlins, except end verticals. **BOT CHORD** Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=10-6-15, 5=10-6-15, 6=10-6-15,

7=10-6-15

Max Horiz 1=285 (LC 9)

Max Uplift 1=-77 (LC 10), 5=-59 (LC 9), 6=-176 (LC 12), 7=-148 (LC 12)

Max Grav 1=164 (LC 9), 5=164 (LC 19), 6=426 (LC 19), 7=317 (LC 19)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-503/322, 2-3=-372/260, 3-4=-177/152,

4-5=-129/138

BOT CHORD 1-7=-133/145, 6-7=-133/145, 5-6=-133/145

WEBS 3-6=-344/303, 2-7=-249/215

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-9-1 to 5-9-1, Interior (1) 5-9-1 to 10-6-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 77 lb uplift at joint 1, 59 lb uplift at joint 5, 176 lb uplift at joint 6 and 148 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



	Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
١	P230810	V3	Valley	2	1	Job Reference (optional)	161755145

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:45 ID:7inLsRr1OlzWhT15crccTiyGxRv-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

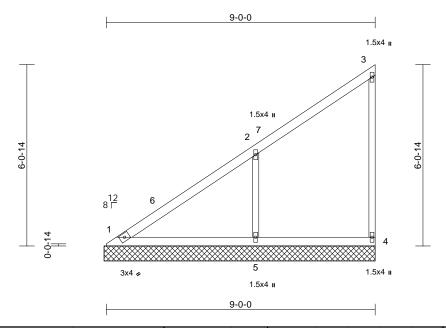

Scale = 1:38.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.70	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 36 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

(size) REACTIONS 1=9-0-15, 4=9-0-15, 5=9-0-15

Max Horiz 1=242 (LC 9)

Max Uplift 1=-4 (LC 8), 4=-50 (LC 9), 5=-209

(LC 12)

1=194 (LC 20), 4=143 (LC 19), Max Grav

5=506 (LC 19)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-388/267, 2-3=-172/145, 3-4=-134/142

BOT CHORD 1-5=-116/126, 4-5=-116/126 **WEBS** 2-5=-399/340

NOTES

- 1) Wind: ASCE 7-16: Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-5-12 to 5-5-12, Interior (1) 5-5-12 to 9-0-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 1, 50 lb uplift at joint 4 and 209 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	V4	Valley	2	1	Job Reference (optional)	l61755146

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:45 ID:i76DDQo95qbyq0JWxj3vr4yGxRy-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

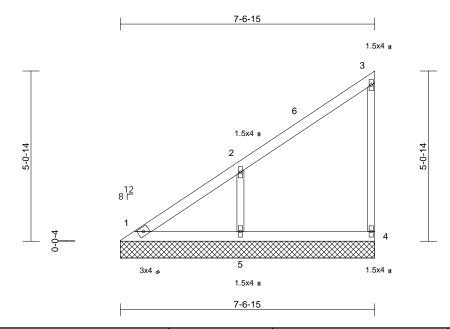

Scale = 1:34.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 29 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=7-6-15, 4=7-6-15, 5=7-6-15

Max Horiz 1=199 (LC 9)

Max Uplift 1=-16 (LC 8), 4=-46 (LC 9), 5=-172

(LC 12)

1=132 (LC 20), 4=158 (LC 19), Max Grav

5=418 (LC 19)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-353/236, 2-3=-165/135, 3-4=-138/151

BOT CHORD 1-5=-96/105, 4-5=-96/105 **WEBS** 2-5=-330/305

NOTES

- 1) Wind: ASCE 7-16: Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-5-12 to 5-5-12, Interior (1) 5-5-12 to 7-6-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 1, 46 lb uplift at joint 4 and 172 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	V5	Valley	2	1	Job Reference (optional)	l61755147

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:45 ID:mk_SpknvZDLEbi98pI1RmfyGxS_-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

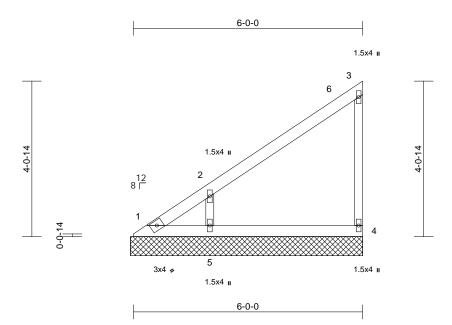

Scale = 1:30.2

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 22 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 2x4 SP No.2 **BOT CHORD** 2x3 SPF No.2 WEBS 2x3 SPF No.2 OTHERS

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=6-0-15, 4=6-0-15, 5=6-0-15

Max Horiz 1=157 (LC 9)

1=-56 (LC 10), 4=-41 (LC 9), Max Uplift 5=-156 (LC 12)

1=83 (LC 9), 4=159 (LC 19), 5=378 Max Grav

(LC 19)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-331/216, 2-3=-155/120, 3-4=-135/154

BOT CHORD 1-5=-76/82, 4-5=-76/82

WEBS 2-5=-298/299

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) 1) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-5-12 to 5-5-12, Interior (1) 5-5-12 to 6-0-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 1, 41 lb uplift at joint 4 and 156 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not



Job	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P230810	V6	Valley	2	1	Job Reference (optional)	I61755148

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:46 ID:MAIKAik0HIzfkFQZ89Tk80yGxS1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

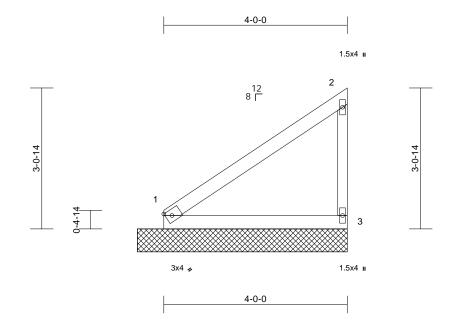

Scale = 1:25.1

Loading	(psf)	Spacing	2-0-0	csı		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 15 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 **BOT CHORD** 2x4 SP No.2 2x3 SPF No.2 WEBS

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-7-5 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=4-6-15, 3=4-6-15

Max Horiz 1=114 (LC 9)

Max Uplift 1=-15 (LC 12), 3=-58 (LC 12) Max Grav 1=169 (LC 1), 3=186 (LC 19) (lb) - Maximum Compression/Maximum

FORCES Tension

TOP CHORD 1-2=-163/120, 2-3=-154/185

BOT CHORD 1-3=-55/60

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) 1) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 1 and 58 lb uplift at joint 3.

This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023




Truss Type Ply Job Truss Qty Roof - Osage Lot 76 161755149 Valley P230810 V7 2 Job Reference (optional)


Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,


Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:46

Page: 1



1.5x4 II







3-0-0

Scale = 1:21.2

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 10 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 **BOT CHORD** 2x4 SP No.2 2x3 SPF No.2 WEBS

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-1-5 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=3-0-15, 3=3-0-15, 4=3-0-15

Max Horiz 4=72 (LC 9)

Max Uplift 3=-39 (LC 12), 4=-47 (LC 3) 1=143 (LC 3), 3=110 (LC 19), Max Grav

4=-14 (LC 8)

FORCES (lb) - Maximum Compression/Maximum

Tension

TOP CHORD 1-2=-105/77, 2-3=-99/121 BOT CHORD 1-4=-160/107, 1-3=-35/38

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) 1) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 3 and 47 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard




November 1,2023




Job	1	Truss	Truss Type	Qty	Ply	Roof - Osage Lot 76	
P23	30810	V8	Valley	2	1	Job Reference (optional)	161755150


Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 31 15:34:46 ID:3pNgiJfdw84fOAODEBr5MYyGxS8-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1



1.5x4 II







1.5x4 II

1-6-15

Scale = 1:19.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.02	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.01	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 5 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 **BOT CHORD** 2x4 SP No.2 2x3 SPF No.2 WEBS

BRACING

TOP CHORD Structural wood sheathing directly applied or 1-7-5 oc purlins, except end verticals. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc

bracing.

REACTIONS (size) 1=1-6-15, 3=1-6-15

Max Horiz 1=29 (LC 9)

Max Uplift 1=-5 (LC 12), 3=-15 (LC 12) Max Grav 1=46 (LC 1), 3=50 (LC 19) (lb) - Maximum Compression/Maximum

FORCES Tension

1-2=-42/32, 2-3=-44/50

TOP CHORD BOT CHORD 1-3=-14/15

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) 1) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 1 and 15 lb uplift at joint 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



November 1,2023




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated.
Dimensions are in ft-in-sixteenths.
Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- ¹/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MiTek software or upon request.

PLATE SIZE

4 × 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

National Design Specification for Metal Plate Connected Wood Truss Construction Design Standard for Bracing.

Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

ANSI/TPI1: DSB-22:

Numbering System

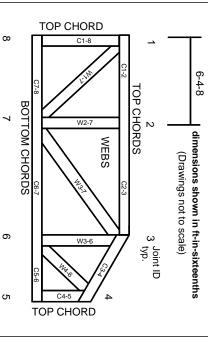

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282 ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2023 MiTek® All Rights Reserved

MiTek Engineering Reference Sheet: MII-7473 rev. 1/2/2023



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

- Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI
- Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.

Ņ

Never exceed the design loading shown and never stack materials on inadequately braced trusses.

ω

- Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
- Cut members to bear tightly against each other.

'n

- Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
- Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
- Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.

œ

- Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
- Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
- Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
- Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
- Top chords must be sheathed or purlins provided at spacing indicated on design.
- Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- 15. Connections not shown are the responsibility of others.
- Do not cut or alter truss member or plate without prior approval of an engineer.
- Install and load vertically unless indicated otherwise.
- Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
- Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
- Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
- The design does not take into account any dynamic or other loads other than those expressly stated.