## **ABBREVIATIONS**

- AFF ABOVE FINISH FLOOR **BOTTOM OF**
- CONTROL JOINT
- CENTER LINE CLG CEILING
- CO CASED OPENING DIAMETER
- DN DOWN DW DISHWASHER EJ **EXPANSION JOINT**

FLOOR DRAIN

- VERIFY IN FIELD **GAUGE OR GAGE**
- GROUND FAULT CIRCUIT INTERRUPTER
- HB HOSE BIB HT

**EQUAL** 

- HEIGHT KS KNEE SPACE
- LB (#) POUND LAMINATED VENEER LUMBER
- LVL MAX MAXIMUM


EQ


FD

- MINIMUM MIN
- ON CENTER OCC OCCUPANT
- OH PR OPPOSITE HAND
- REF REFRIGERATOR
- ROOM
- RO ROUGH OPENING
- SF SQUARE FEET SIM SIMILAR
- SQ SQUARE
- TYP **TYPICAL**

## 1) GENERAL NOTES:

- A. ALL WORK SHALL COMPLY WITH FEDERAL STATE AND LOCAL BUILDING CODES.
- B. CONTRACTOR SHALL COORDINATE AND OBTAIN ALL PERMITS REQUIRED FOR CONSTRUCTION AND CERTIFICATE OF OCCUPANCY.
- C. CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNIQUES, AND PROCEDURES.
- D. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ASPECTS OF SAFETY DURING BUILDING CONSTRUCTION. E. ALL DIMENSIONS AND SITE CONDITIONS ARE TO BE FIELD VERIFIED AND ARE THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR SHALL NOTIFY THE ARCHITECT OF DISCREPANCIES PRIOR TO PERFORMING WORK. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UTILITIES AND PROTECT THEM FROM
- G. ANY CONCRETE SURFACES THAT ARE EXPOSED TO THE ELEMENTS SHALL BE NO LESS THAN 4000 PSI CONCRETE. PLACE CONTROL JOINTS AND CONSTRUCTION JOINTS WHERE INDICATED ON PLANS. IF JOINTS ARE NOT LOCATED ON PLANS,
- CONSTRUCTION JOINTS SHALL BE NO MORE THAN 20'-0". CONTROL JOINTS SHALL BE NO MORE THAN 12'-0". . REINFORCING STEEL TO BE GRADE 60 KSI. REBAR IN SUSPENDED PORTION OF SLAB TO BE EPOXY-COATED.
- FORMDECK TO BE 1" CORDECK 22 GAUGE GALVANIZED OR APPROVED EQUAL. SURFACE DRAINAGE SHALL BE DIVERTED TO A STORM SEWER OR OTHER APPROVED POINT OF COLLECTION.
- K. LOTS SHALL BE GRADED TO DIRECT WATER AWAY FROM FOUNDATION WALLS. GRADE SHALL BE NO LESS THAN 6" BELOW FINISHED FLOOR LEVEL. GRADE SHALL FALL AT LEAST 6" WITHIN THE FIRST 10'-0".
- EXTENTS AND DESCRIPTION OF REQUIRED REPAIRS IN THESE DOCUMENTS ARE BASED THE STRUCTURAL REPORT PROVIDED
- BY SCHROEDER ENGINEERING, LLC ON 7/18/2023. NO PORTIONS OF THE EXISTING BUILDING HAVE BEEN EVALUATED OTHER THAN THOSE DESCRIBED IN THESE DOCUMENTS, AND IN THE STRUCTURAL REPORT.

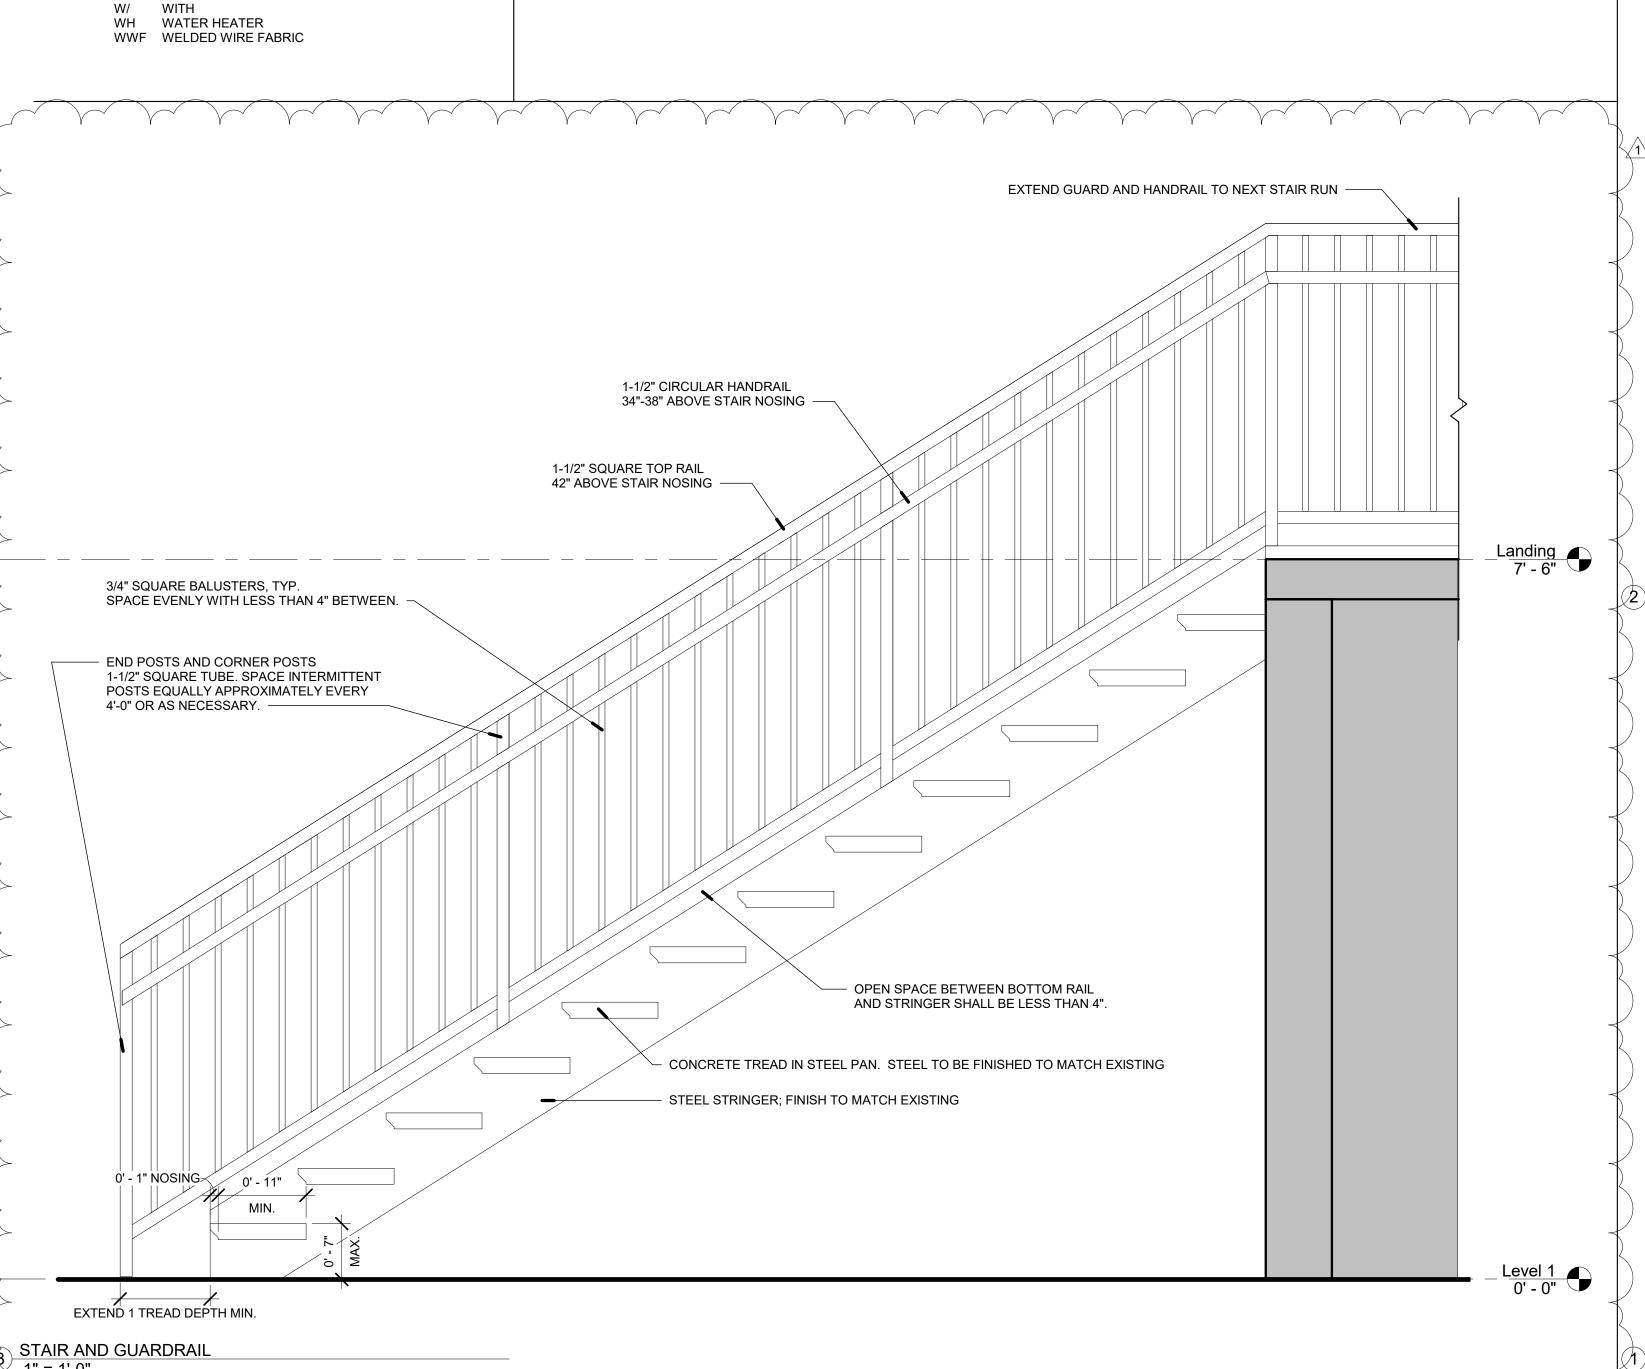

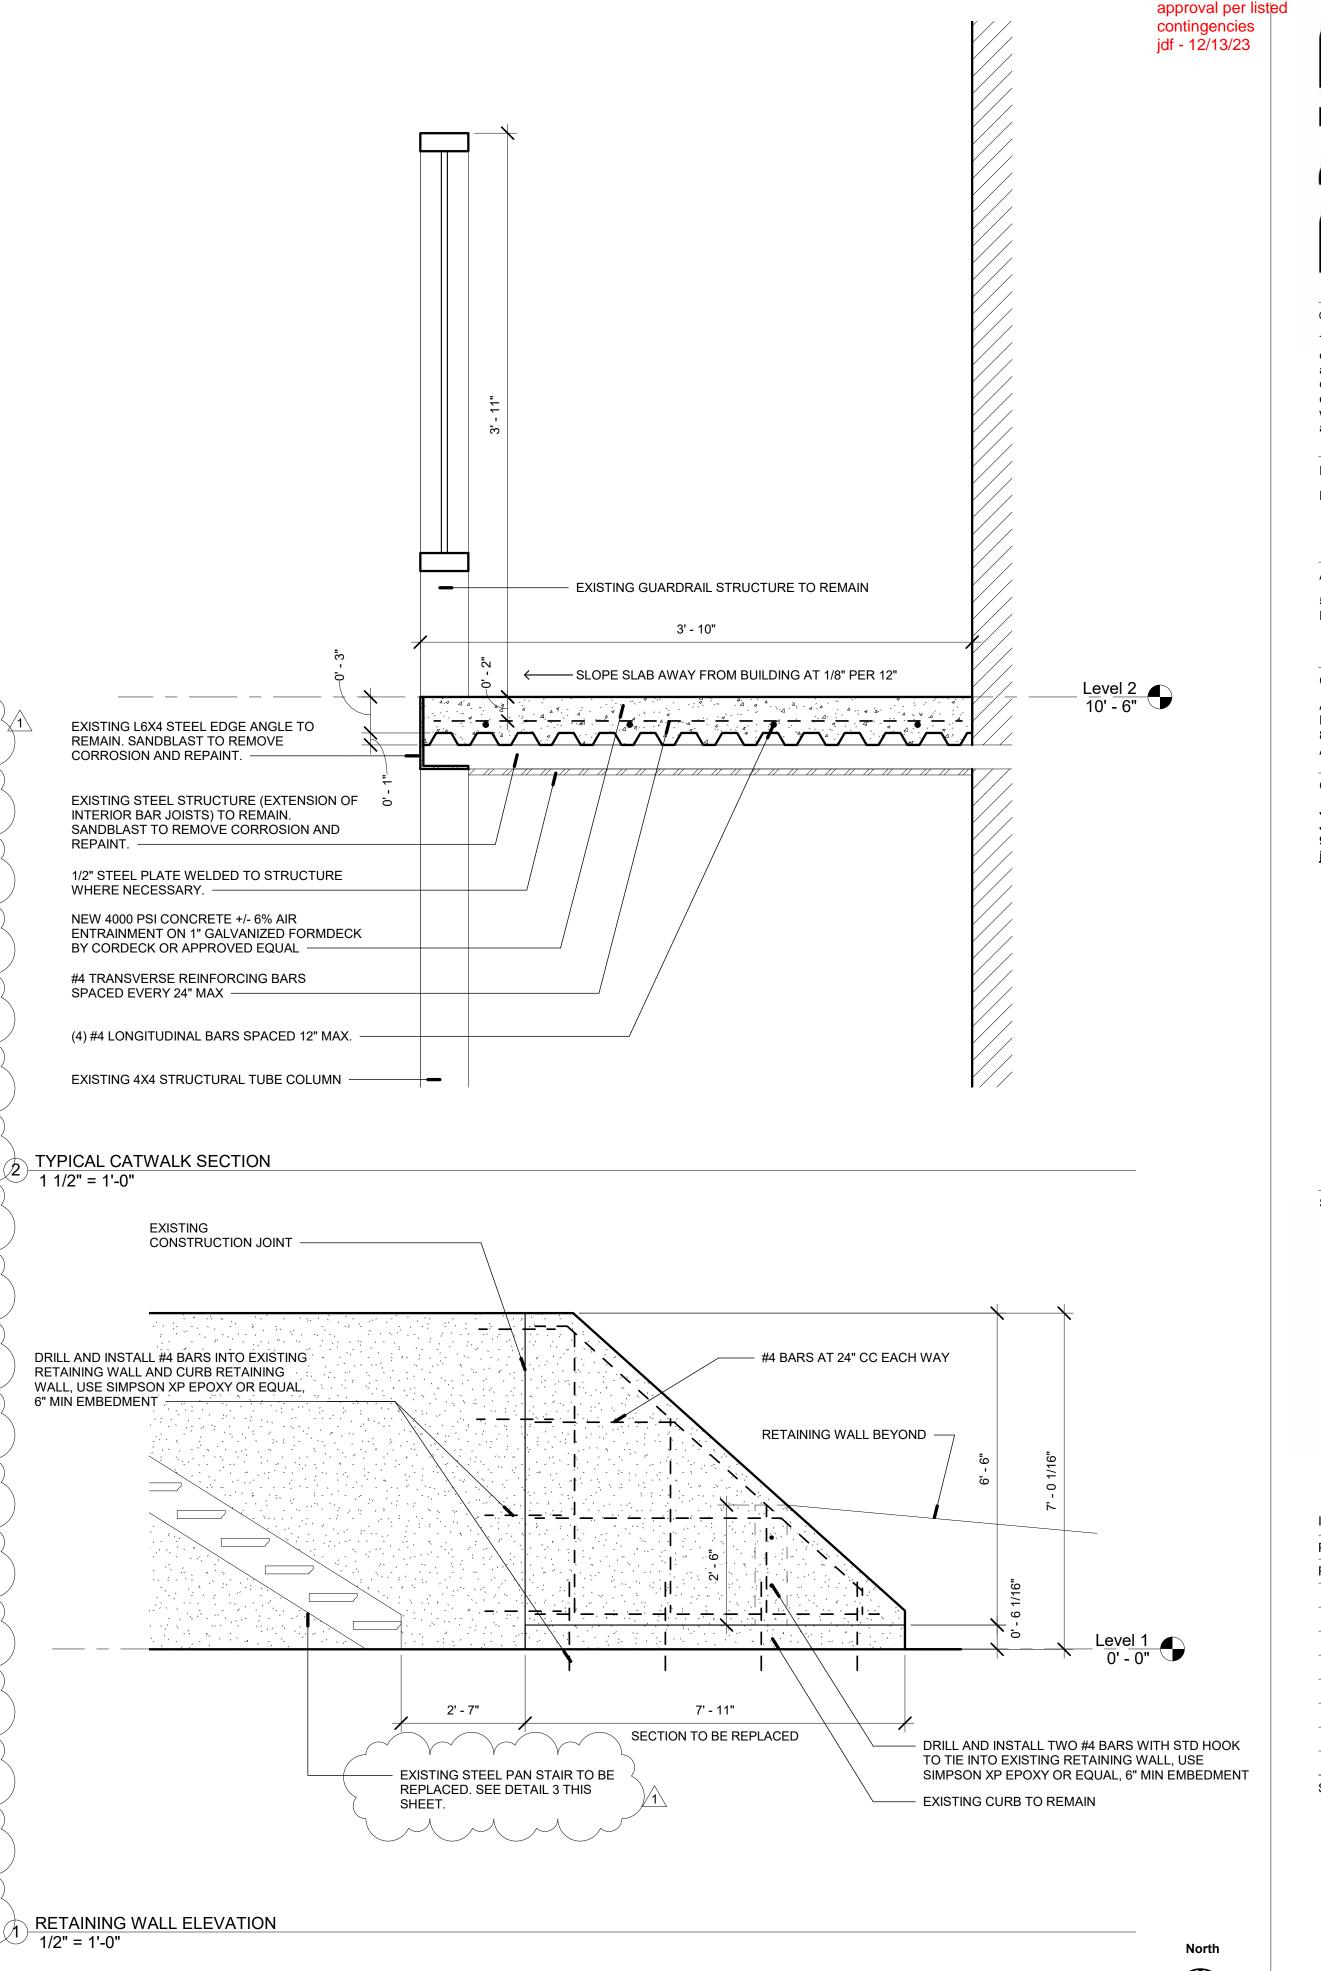

CONSTRUCTION As Noted on Plans Review Lee's Summit, Missouri

© 2023

The drawings and written material herein constitute original work of the architect, and as intellectual property, are subject to copyright and may not be reproduced, distributed, published or used in any way without the express written consent of the architect.

Project

**Exterior Catwalk and Stair Repairs** 

Address


519 Southwest 3rd Street Lee's Summit, MO 64063

Client

Adam Mundy **Bradlech Construction** 816-301-0356 AMundy@bradlech.com

Consultants


John B. Nagle, LLC John B. Nagle, P.E. 913.314.5737 jack@schroederkc.com



09/01/2023

Permit Set 09/01/2023 Permit Review Comments /1 11/29/2023

**GENERAL NOTES / DETAILS** 

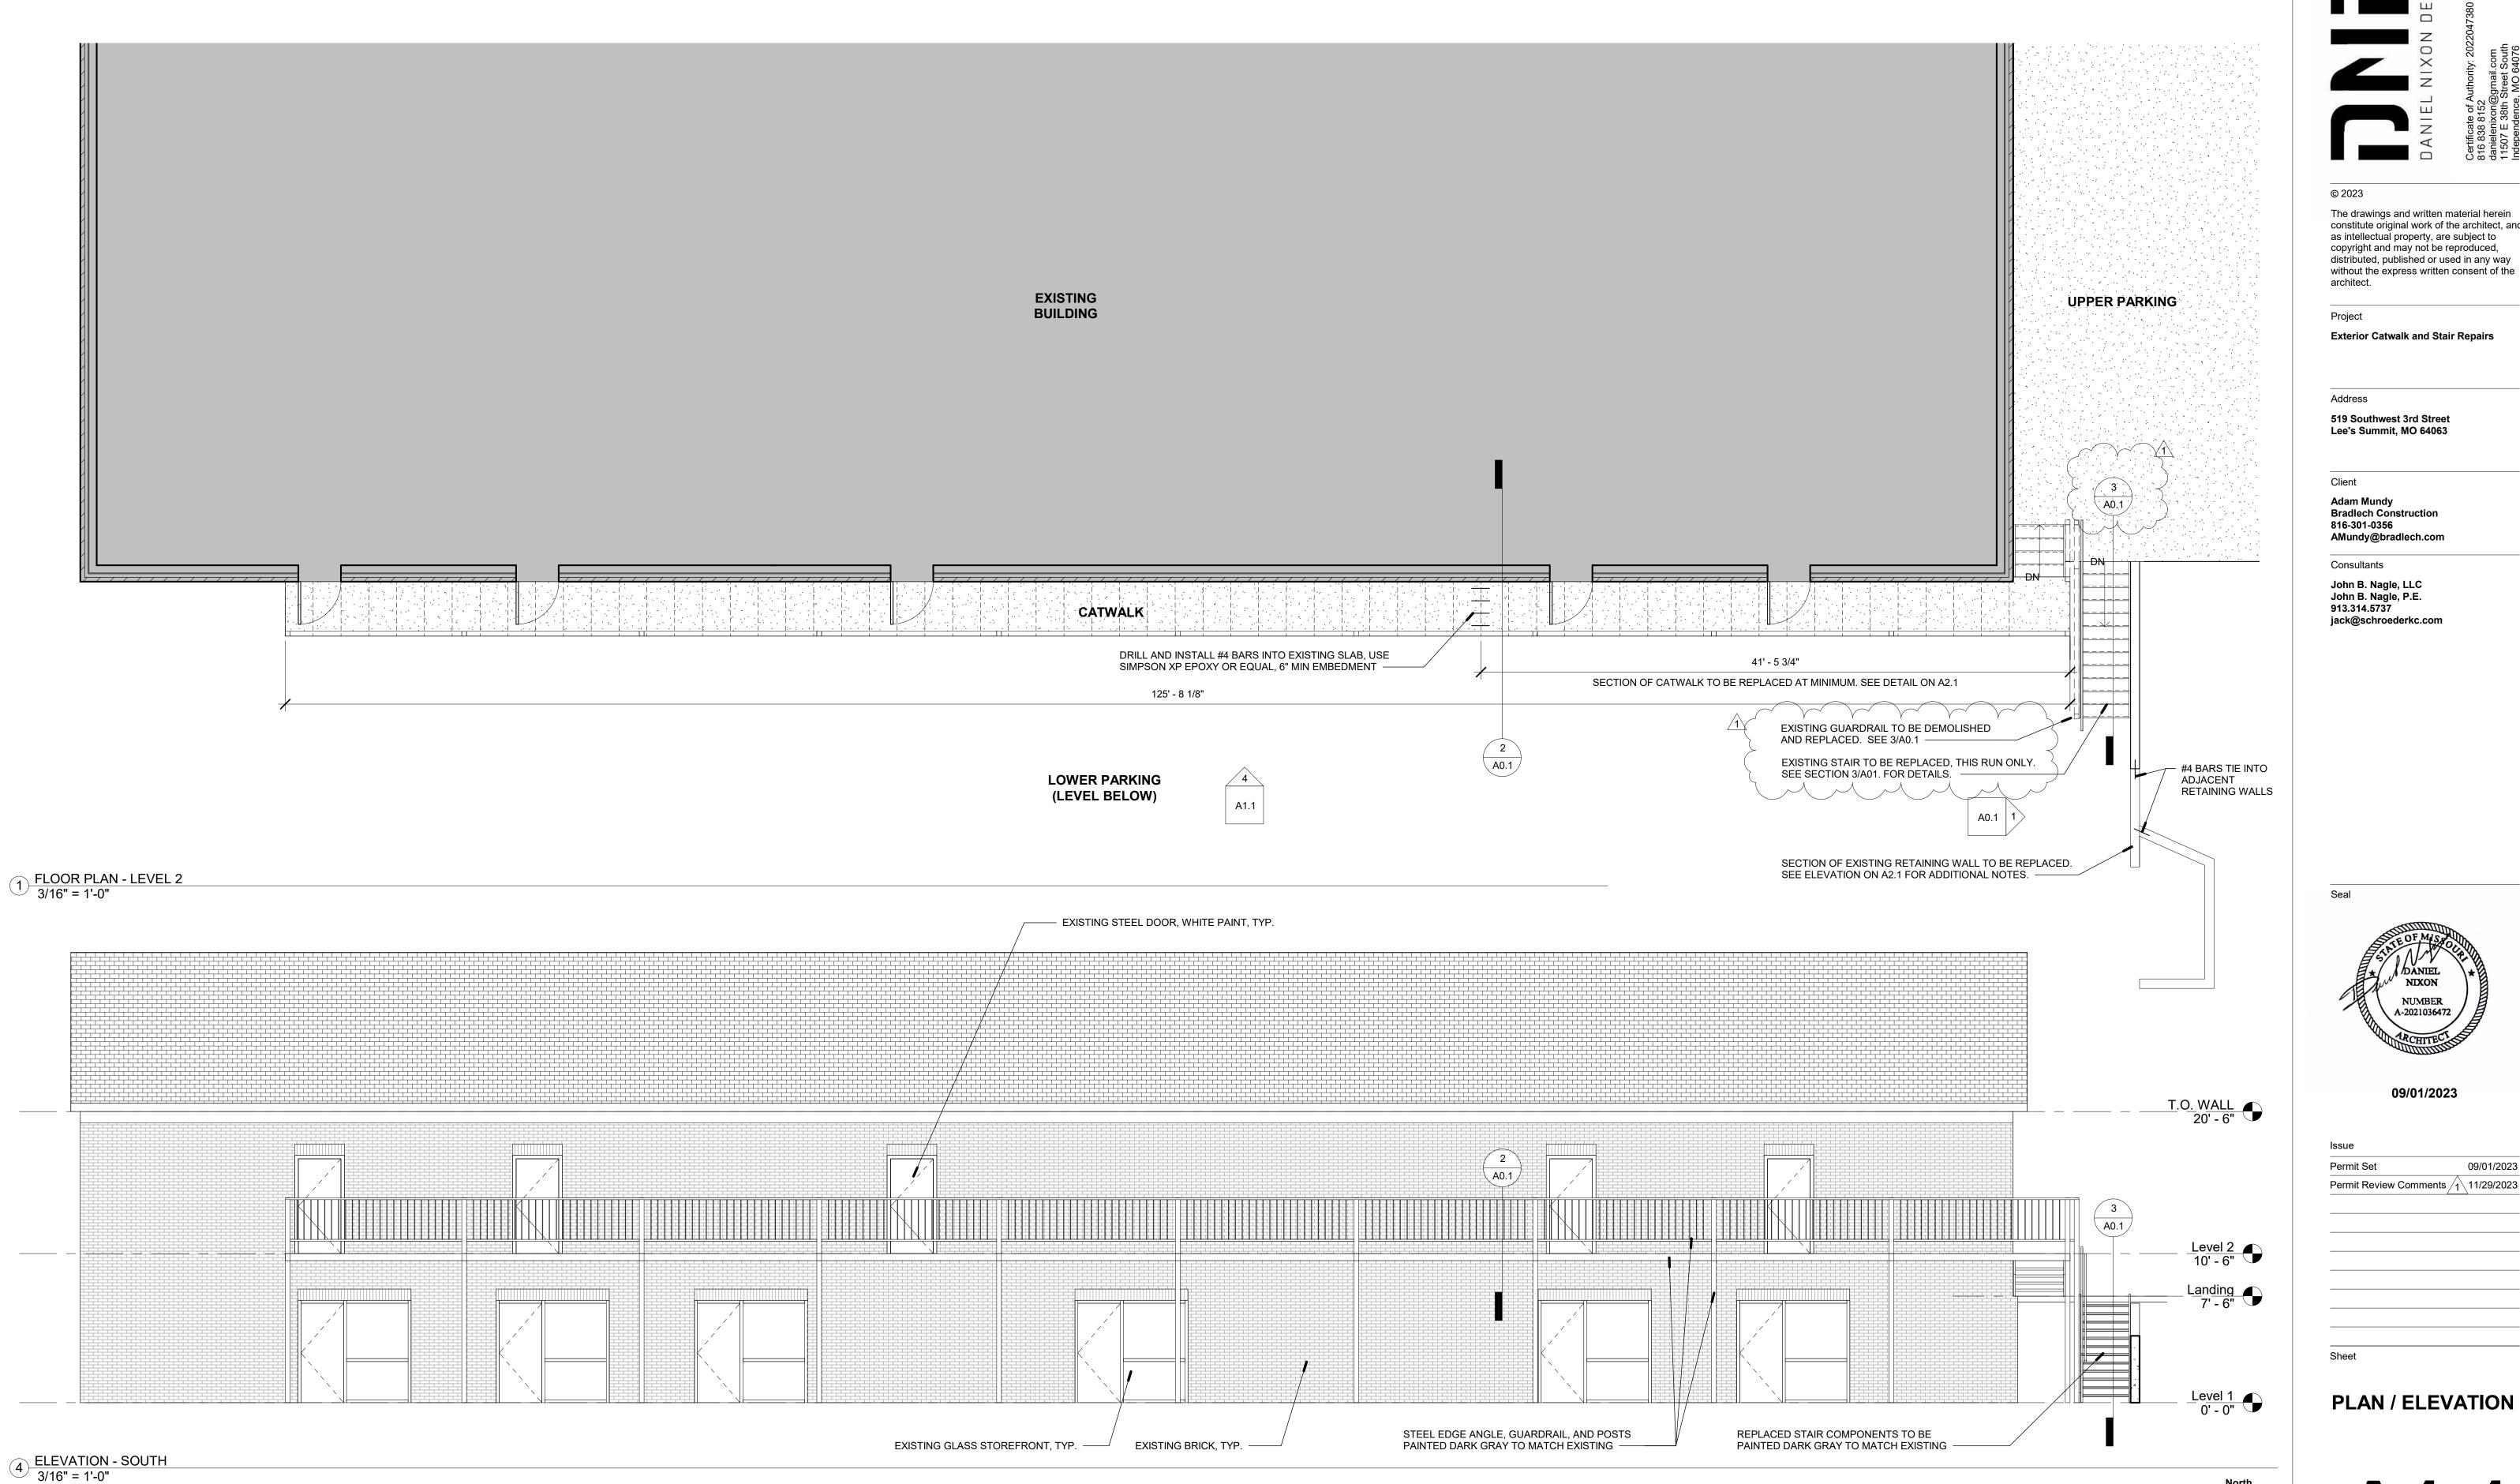


CONSTRUCTION
As Noted on Plans Review Development Services Department
Lee's Summit, Missouri
12/13/2023

The drawings and written material herein constitute original work of the architect, and as intellectual property, are subject to copyright and may not be reproduced, distributed, published or used in any way without the express written consent of the

**Exterior Catwalk and Stair Repairs** 

**Bradlech Construction** AMundy@bradlech.com



09/01/2023 Permit Review Comments /1\11/29/2023