



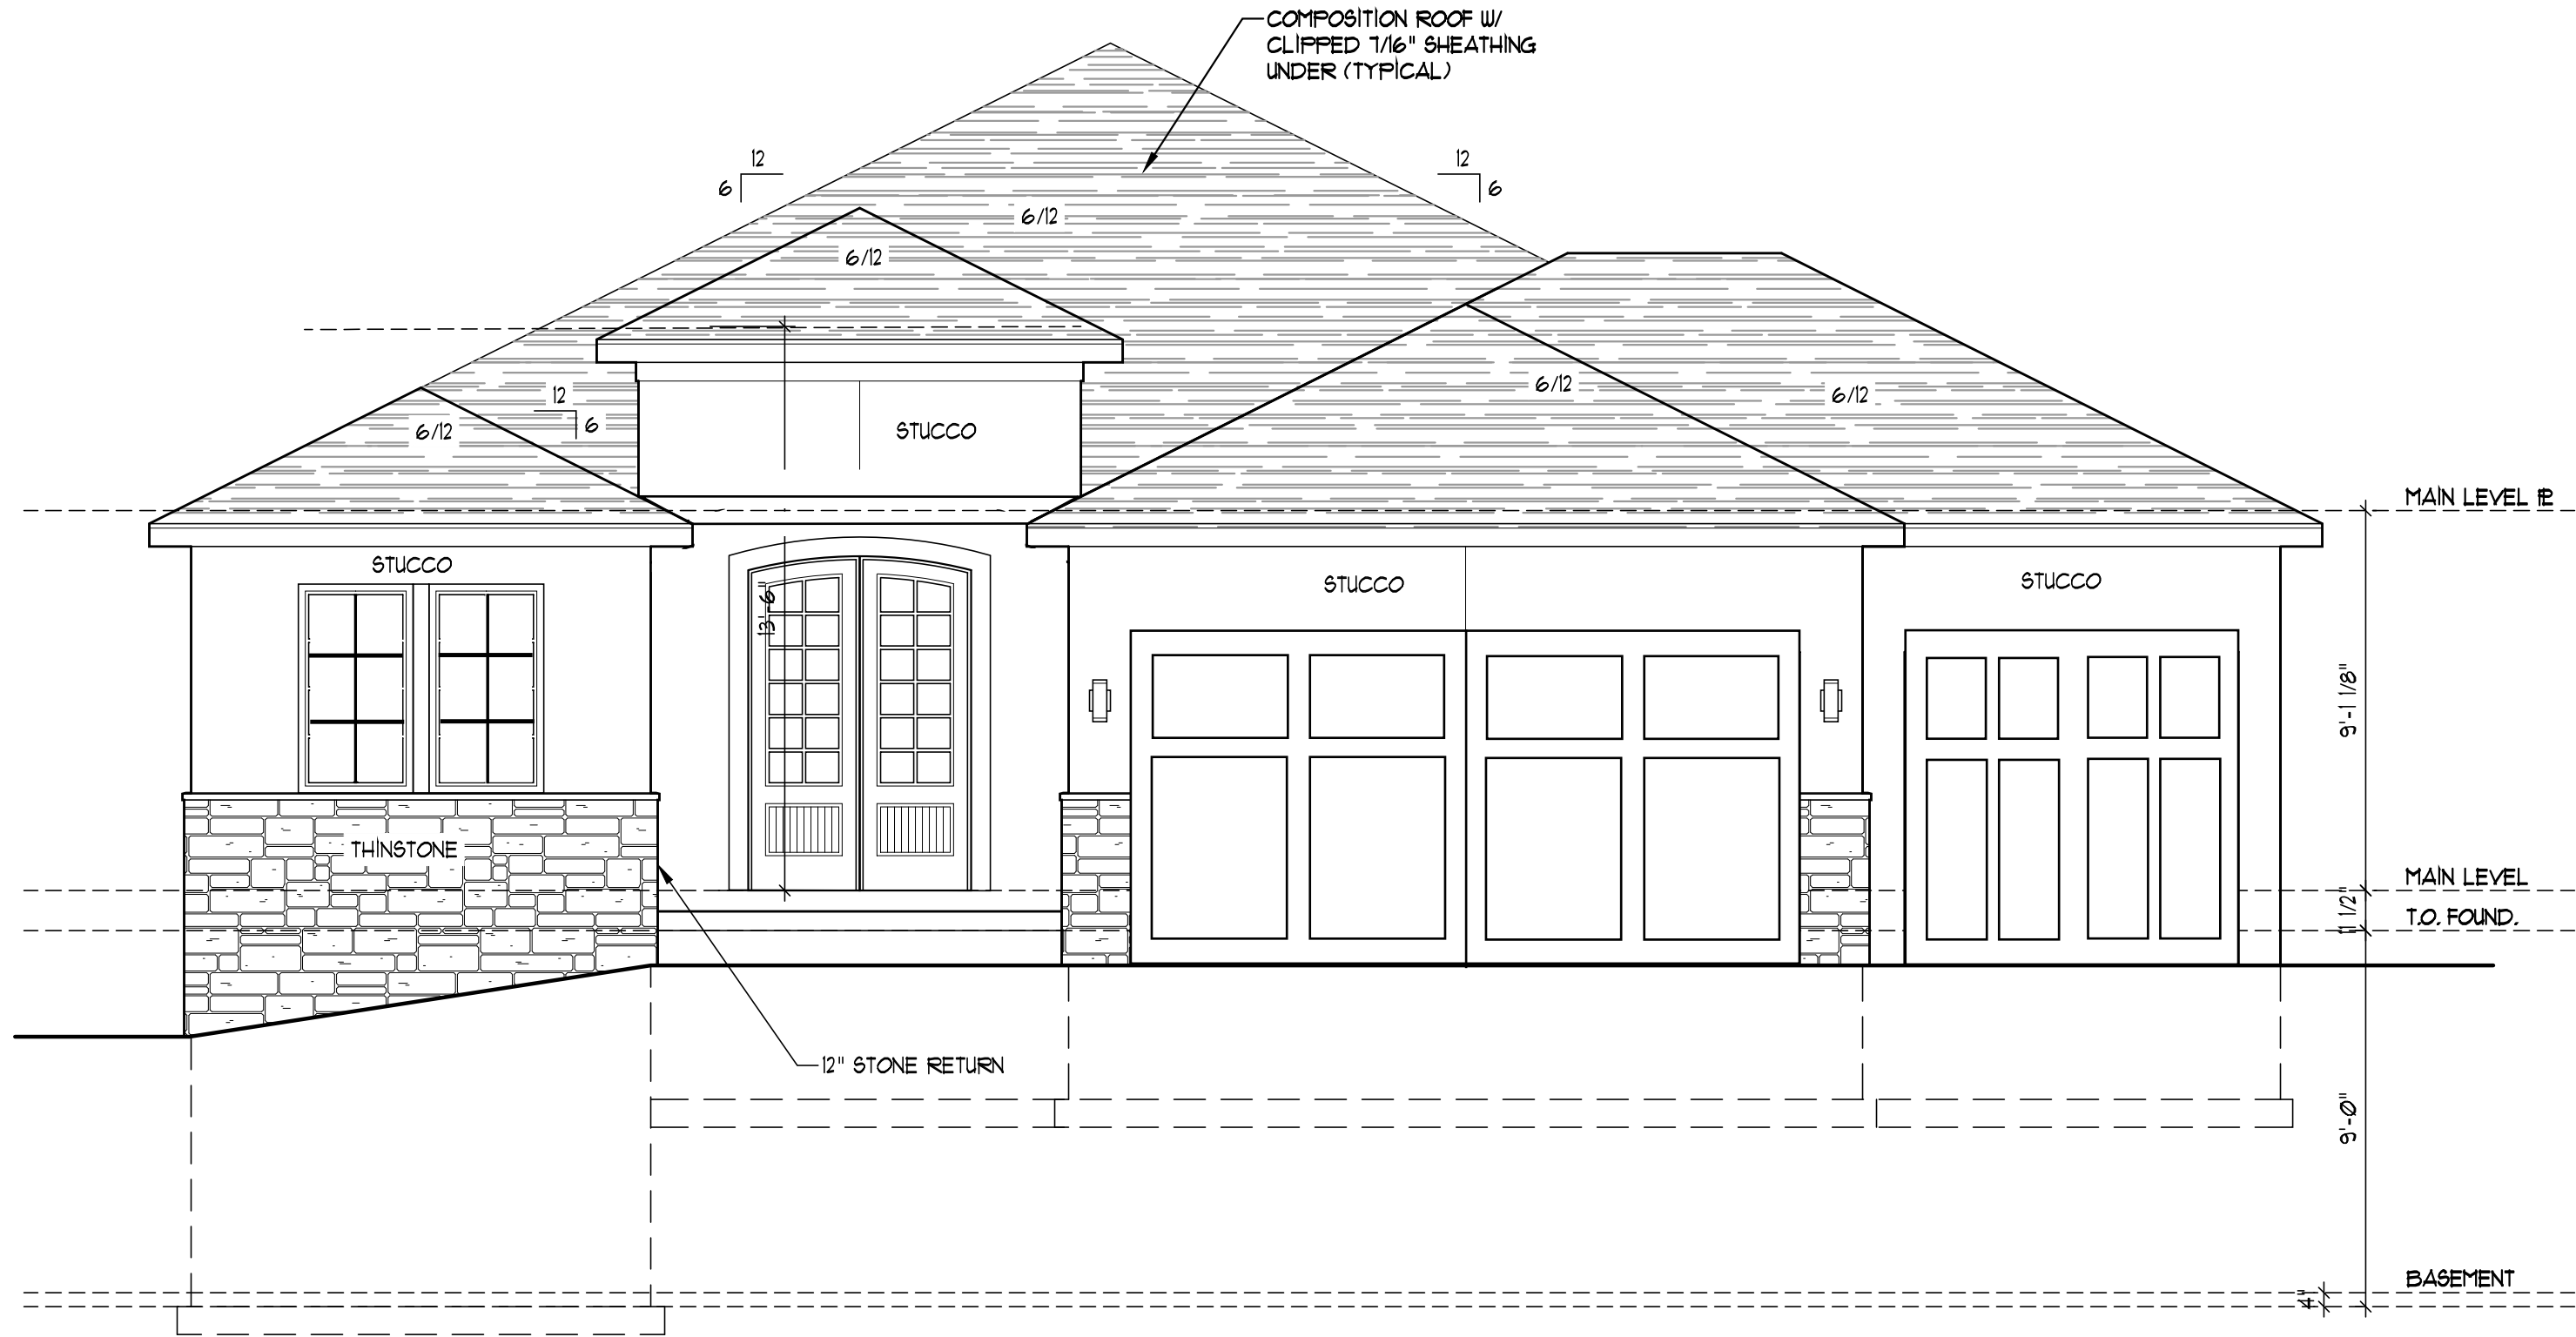

FRONT ELEVATION
SCALE: 1/4" = 1'-0"

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
12/14/2023

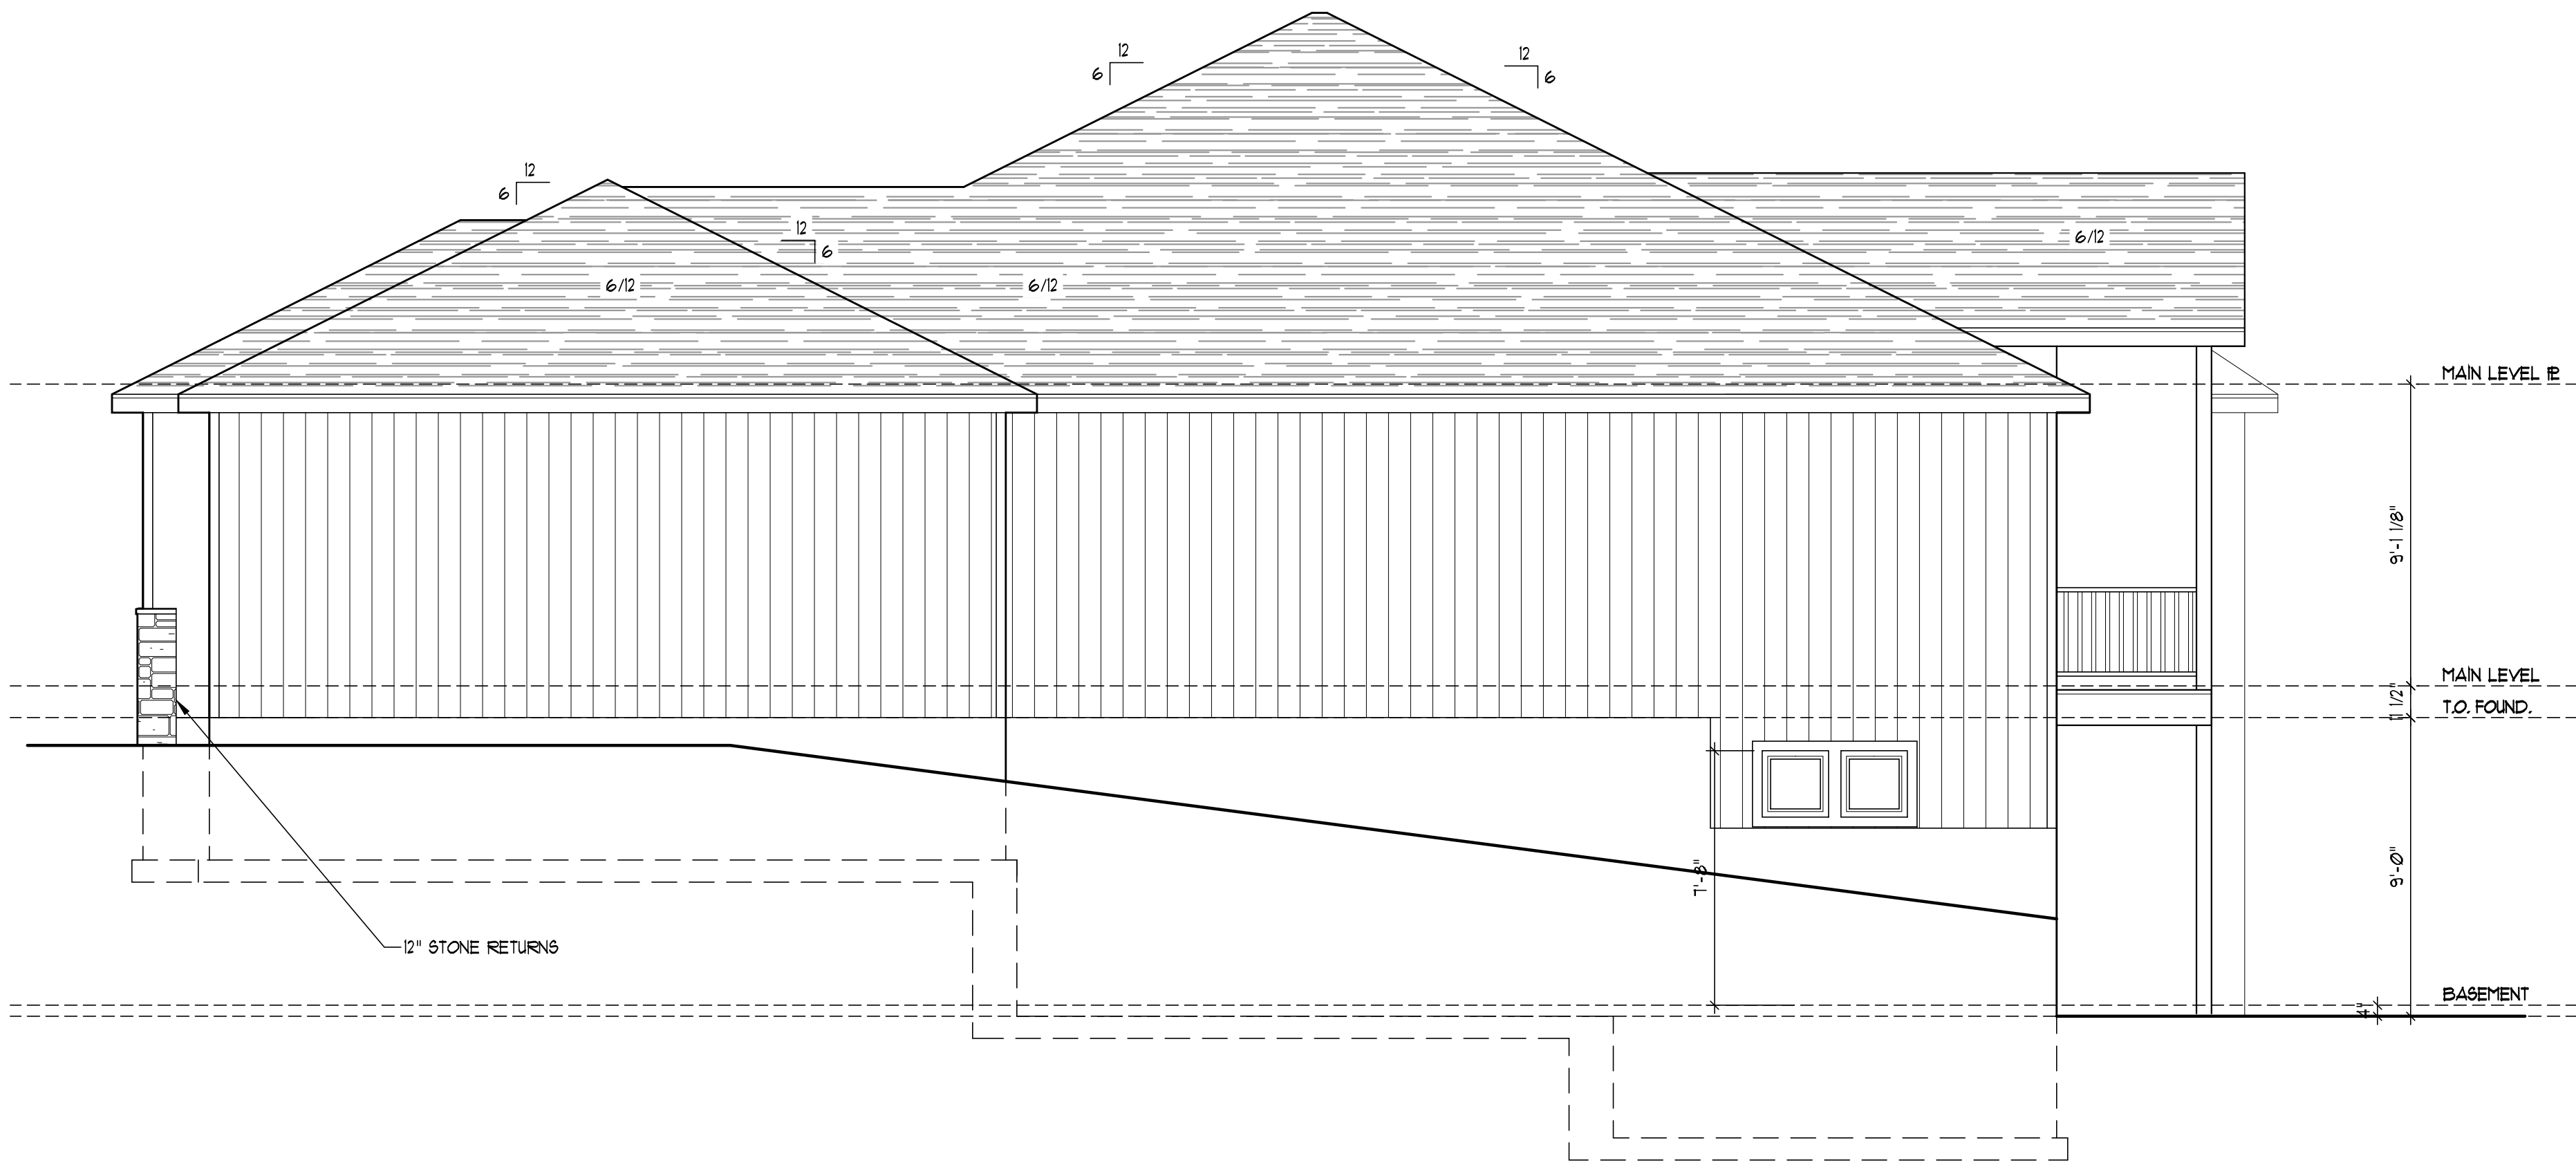

RIGHT ELEVATION
SCALE: 1/4" = 1'-0"




© COPYRIGHT 2023

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v. 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2023

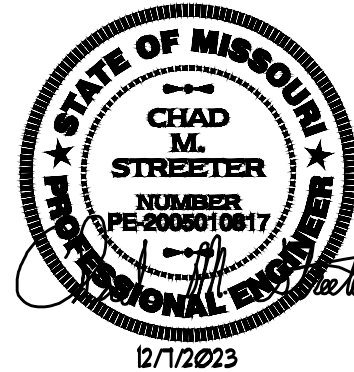

Project #: 8083-XXXX


DATE:

Permit: 12/7/2023

ELEVATIONS FOR:

THE BAYBERRY
Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge


GA1

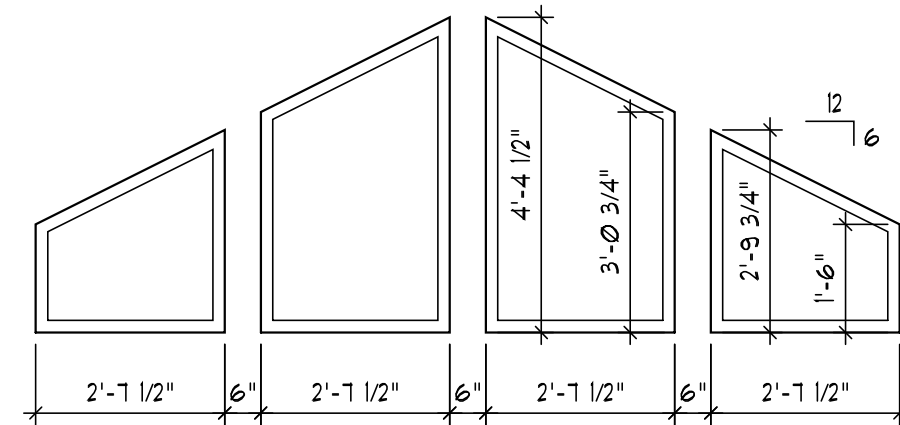

WINDOW MEASUREMENTS
(NOT TO SCALE)



REAR ELEVATION
SCALE: 1/4" = 1'-0"

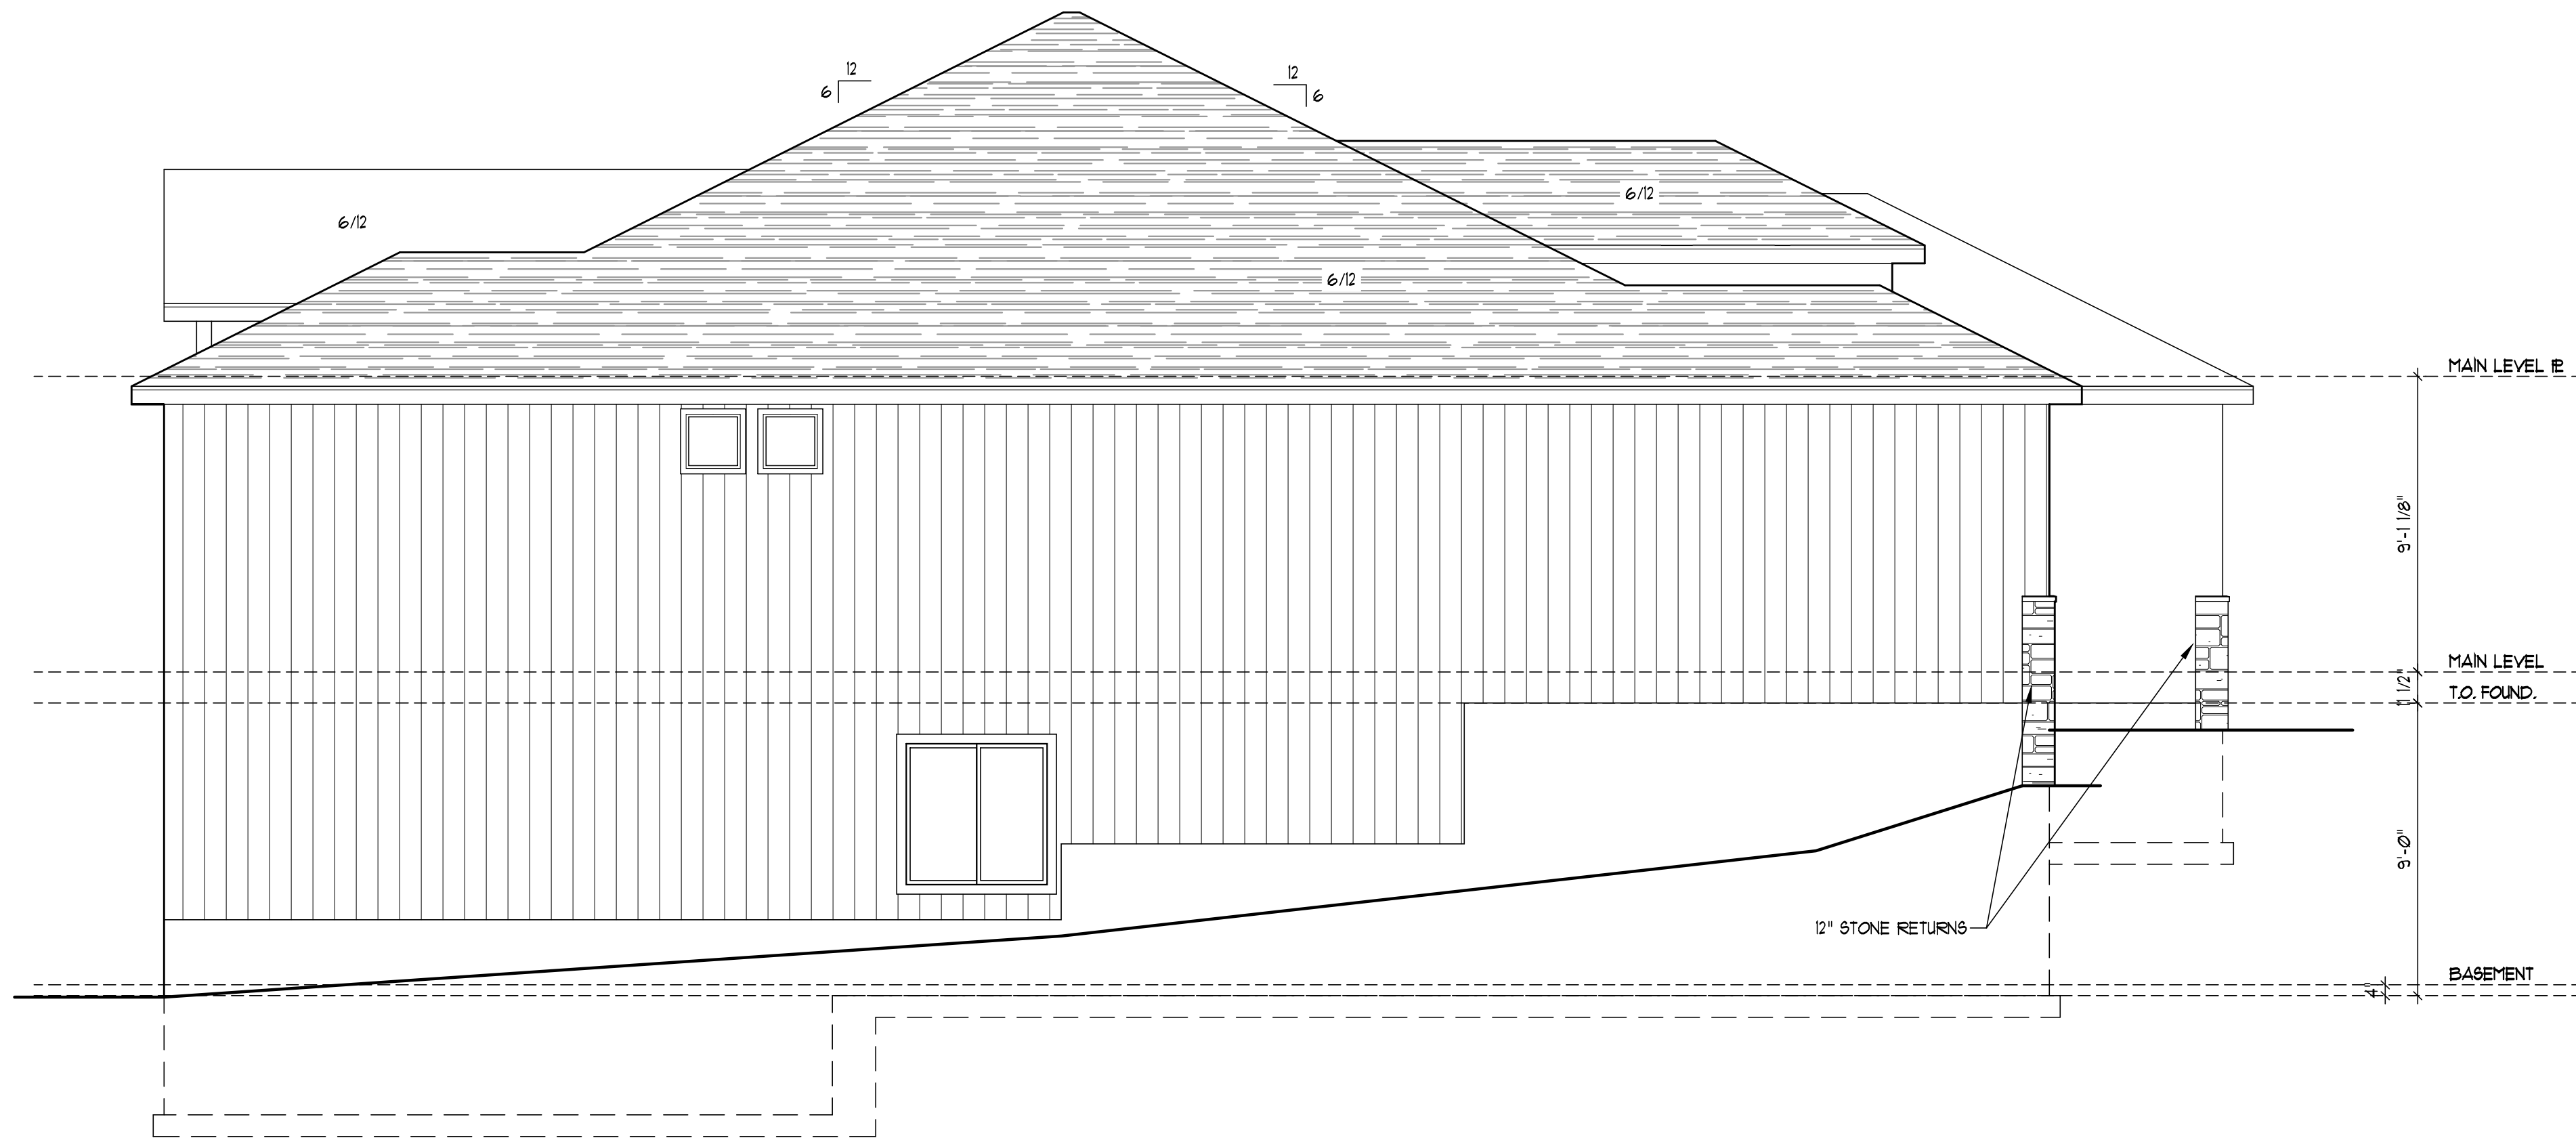

LEFT ELEVATION
SCALE: 1/4" = 1'-0"



© COPYRIGHT 2023

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v. 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2023



Project #: 8083-XXXX

DATE:

Permit: 12/7/2023


ELEVATIONS FOR:

THE BAYBERRY

Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge

GA2

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
12/14/2023

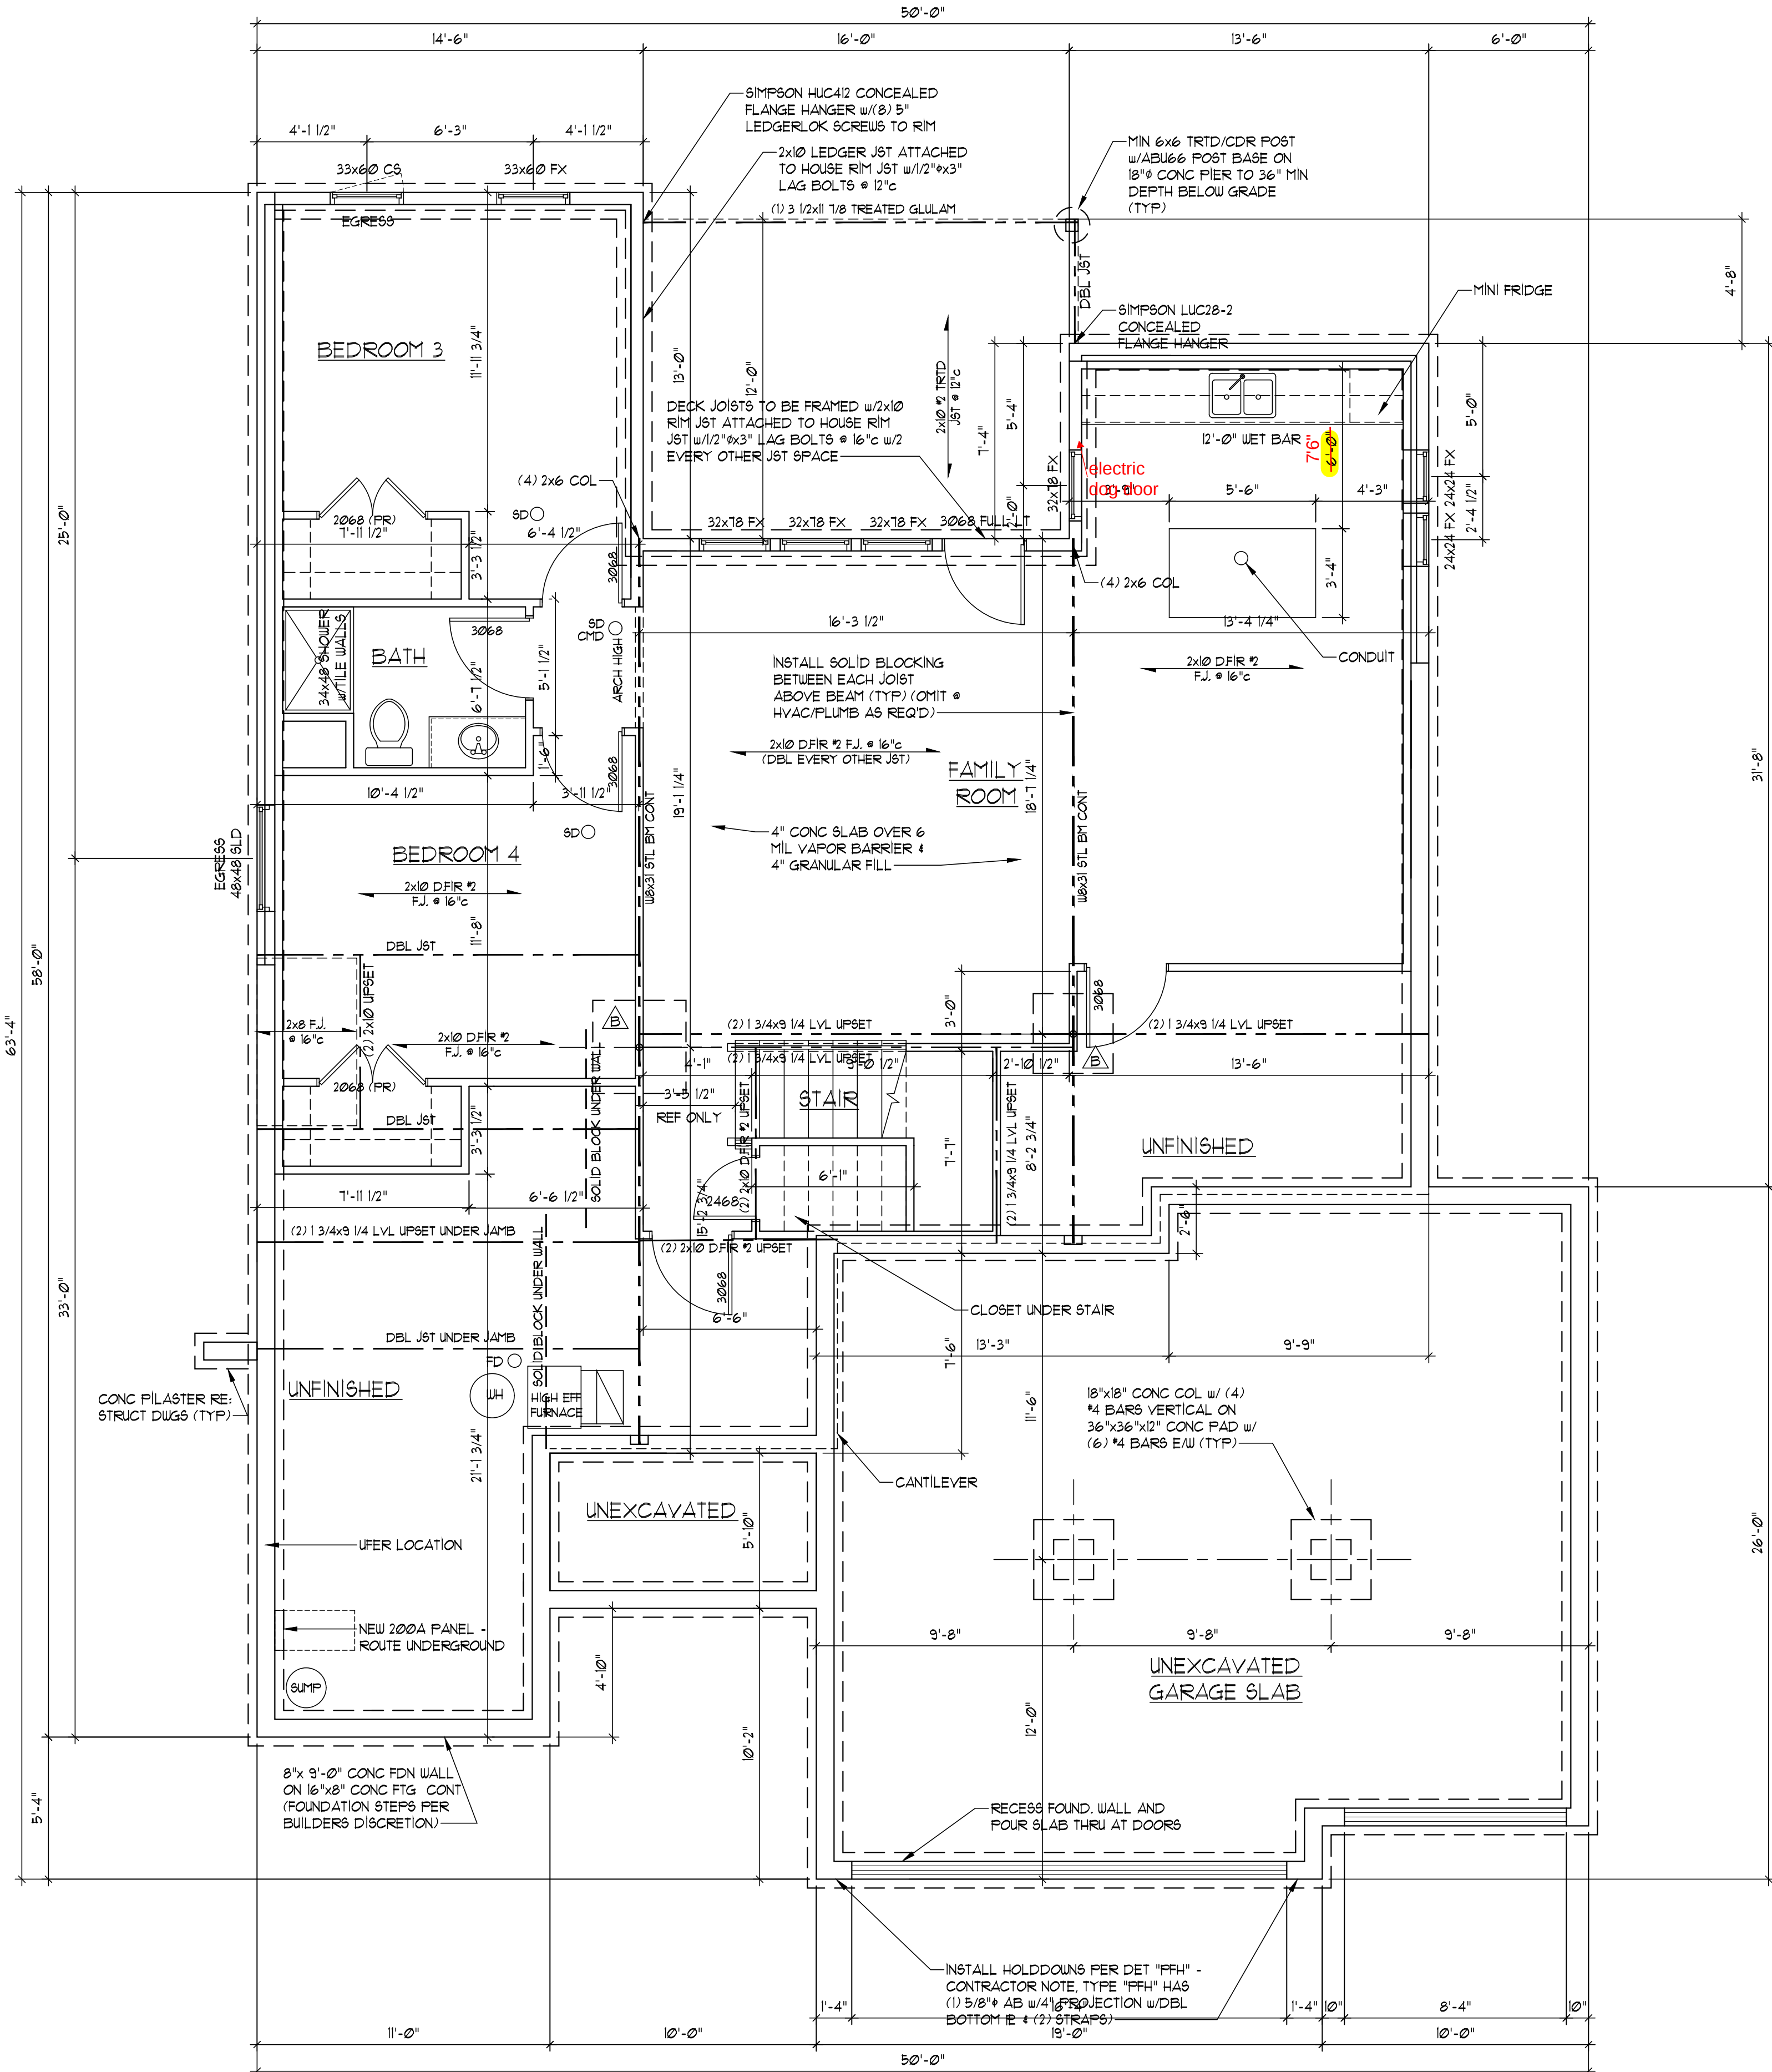

FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

LOWER LEVEL	FINISHED AREA: 1093 SF
UNFINISHED:	504 SF

GENERAL NOTES

- BUILDING PERMIT WILL BE REQUIRED FOR THE PROJECT. THIS SET OF DOCUMENTS TO BE SUBMITTED AS A PERMIT SET OF DRAWINGS.
- ALL CONTRACTORS SHALL VISIT THE JOB SITE AND SHALL REVIEW THE PERMIT DRAWINGS TO FAMILIARIZE HIMSELF WITH THE REQUIREMENTS AND INTENT OF THE SCOPE OF WORK. ANY DEFICIENCIES OR DISCREPANCIES DISCOVERED SHALL BE REPORTED FOR REVIEW AND CLARIFICATION PRIOR TO COMMENCING ANY WORK.
- ALL NEW CONSTRUCTION SHALL MEET LATEST EDITIONS OF ALL APPLICABLE NATIONAL, STATE, AND LOCAL BUILDING CODES - INTERNATIONAL RESIDENTIAL CODE.
- WORKMANSHIP SHALL BE OF THE HIGHEST QUALITY. QUALITY MATERIALS SHALL BE USED THROUGHOUT. ALL WORK SHALL BE DONE IN A MANNER SO AS TO MATCH ADJACENT WORK AND FINISHES AND APPROVED BY OWNER.
- CONTRACTORS SHALL REMOVE ALL CONSTRUCTION DEBRIS. ALL CONSTRUCTION DEBRIS SHALL BE CONTAINED PER CITY REQUIREMENTS. AREAS FOR MATERIAL STORAGE, TRASH DISPOSAL, WORKMEN'S PARKING, ETC, SHALL BE COORDINATED WITH THE CITY.
- ALL DIMENSIONS TO BE VERIFIED BY CONTRACTOR.
- IT IS THE RESPONSIBILITY OF THE CONTRACTORS TO COORDINATE WITH THE OWNER THE QUANTITY AND LOCATION FOR ALL LIGHTING, ELECTRICAL OUTLETS, TELEPHONE OUTLETS, AND MECHANICAL AND PLUMBING SYSTEMS AS REQUIRED.
- THE CONTRACTORS SHALL ADHERE TO THE STATE OF KANSAS ONE CALL SYSTEM, 1-800-344-7233 (MISSOURI ONE CALL SYSTEM, 1-800-344-7483). THE PERSON OR FIRM DOING EXCAVATION ON PUBLIC RIGHT OF WAY MUST GIVE NOTICE TO, AND OBTAIN INFORMATION FROM, UTILITY COMPANIES. THE CONTRACTORS SHALL NOTIFY THOSE COMPANIES WHICH HAVE FACILITIES IN THE NEAR VICINITY OF THE CONSTRUCTION TO BE PERFORMED WHEN WORK COMMENCES.

GENERAL FOUNDATION REQUIREMENTS

- ALL FOOTINGS ARE TO BE EXTENDED TO MIN 36" BELOW FINISHED GRADE.
- ALL INTERIOR FOOTINGS FOR LOAD BEARING WALLS AND COLUMNS SHALL BE ISOLATED FROM THE BASEMENT FLOOR SLAB.
- FOR ALL CONC WALL OPENINGS, FOOTING & WALL STEPS, PROVIDE ONE #4 BAR 48" LONG DIAGONALLY AS CLOSE AS PRACTICAL TO CORNER.
- ALL REINFORCEMENT SHALL BE LAPPED A MIN OF 24" AT ENDS & PLACES AND AROUND CORNERS.
- ANCHOR BOLTS ARE TO BE SPACED @ 36" WITH 1" MIN EMBED. A BOLT SHALL BE PLACED WITHIN 12" OF THE END OF EACH PLATE SECTION.
- FASTEN JOISTS TO SILL PLATES WITH (3) 8d CORN NAILS.
- WHERE JOIST IS PARALLEL TO FOUNDATION, PROVIDE SOLID BLOCKING @ 32" FOR (3) JOIST SPACES. FASTEN TO SILL PLATE PER NOTE 6.
- VAPOR BARRIER: 6 MIL PE VAPOR RETARDER WITH JOINTS LAPPED A MIN OF 6" BETWEEN SLAB & BASE.
- DAMP PROOFING: ONE COAT (MIN) OF DAMP PROOFING OR EQUIVALENT FOUNDATION MEMBRANE SHALL BE APPLIED TO EXTERIOR WALL SURFACES BELOW GRADE. SEAL TIE HOLES, VOIDS BEFORE APPLICATION.
- FOUNDATION DRAIN: INSTALL CONT 4" PERFORATED PVC DRAIN TILE. DRAIN TILE TO BE EXTENDED TO SQUARE SUMP PIT WHICH EXTENDS A MIN 24" BELOW BASEMENT FLOOR.
- ALL FRAMING MEMBERS IN CONTACT WITH CONCRETE SHALL BE ACQ TREATED LUMBER.
- ALL STEEL FASTENERS (INCLUDING FOUND. ANCHOR BOLTS) ON ACQ TO BE (DOUBLE HOT-DIPPED) GALVANIZED.
- PROVIDE A "UPER" GROUND PER IRC 3608.1
- EGRESS WELL REQUIREMENTS:
 - IF THE VERTICAL DISTANCE FROM THE WINDOW SILL TO ADJACENT GRADE IS GREATER THAN 44", PROVIDE A LADDER.
 - ADD DRAIN TO DAYLIGHT OR SUMP PUMP.RECESS FOUNDATION WALLS AND POUR SLAB THRU AT ALL GARAGE DOORS TO MEET 15 MPH REQUIREMENTS (MIN 8" STEM WALL)

COLUMN & PIER PAD SCHEDULE			
COLUMN MARK	PAD SIZE	REINFORCEMENT	COLUMN SIZE
A	36" x 36" x 12"	(6) #4 BAR E/W	3" SCHED 40
B	42" x 42" x 14"	(7) #4 BAR E/W	3" SCHED 40
C	48" x 48" x 16"	(8) #4 BAR E/W	3" SCHED 40
D	54" x 54" x 18"	(9) #4 BAR E/W	3 1/2" SCHED 40
E	60" x 60" x 18"	(10) #4 BAR E/W	3 1/2" SCHED 40

- COLUMN & PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED MINIMUM ALLOWABLE SOIL BEARING CAPACITY OF 1500 psf.
- GARAGE FOOTINGS PER DETAIL, COLUMN NOT REQUIRED UNLESS NOTED ON PLANS




© COPYRIGHT 2023

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com

VAN DEURZEN & ASSOCIATES P.A.
11011 KING STREET SUITE 130
OVERLAND PARK, KS 66210
(913) 451-6305 FAX (913) 451-1021
WEB PAGE WWW.VANDEURZENANDASSOC.COM
E-MAIL: VJ@VANDEURZENANDASSOC.COM

Van Deurzen and Associates, P.A. © 2023

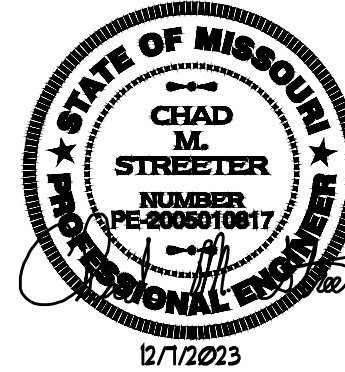

Project #: 8083-XXXX

DATE:

Permit: 12/7/2023


FOUNDATION PLAN FOR:

THE BAYBERRY

Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge

GA3

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
12/14/2023

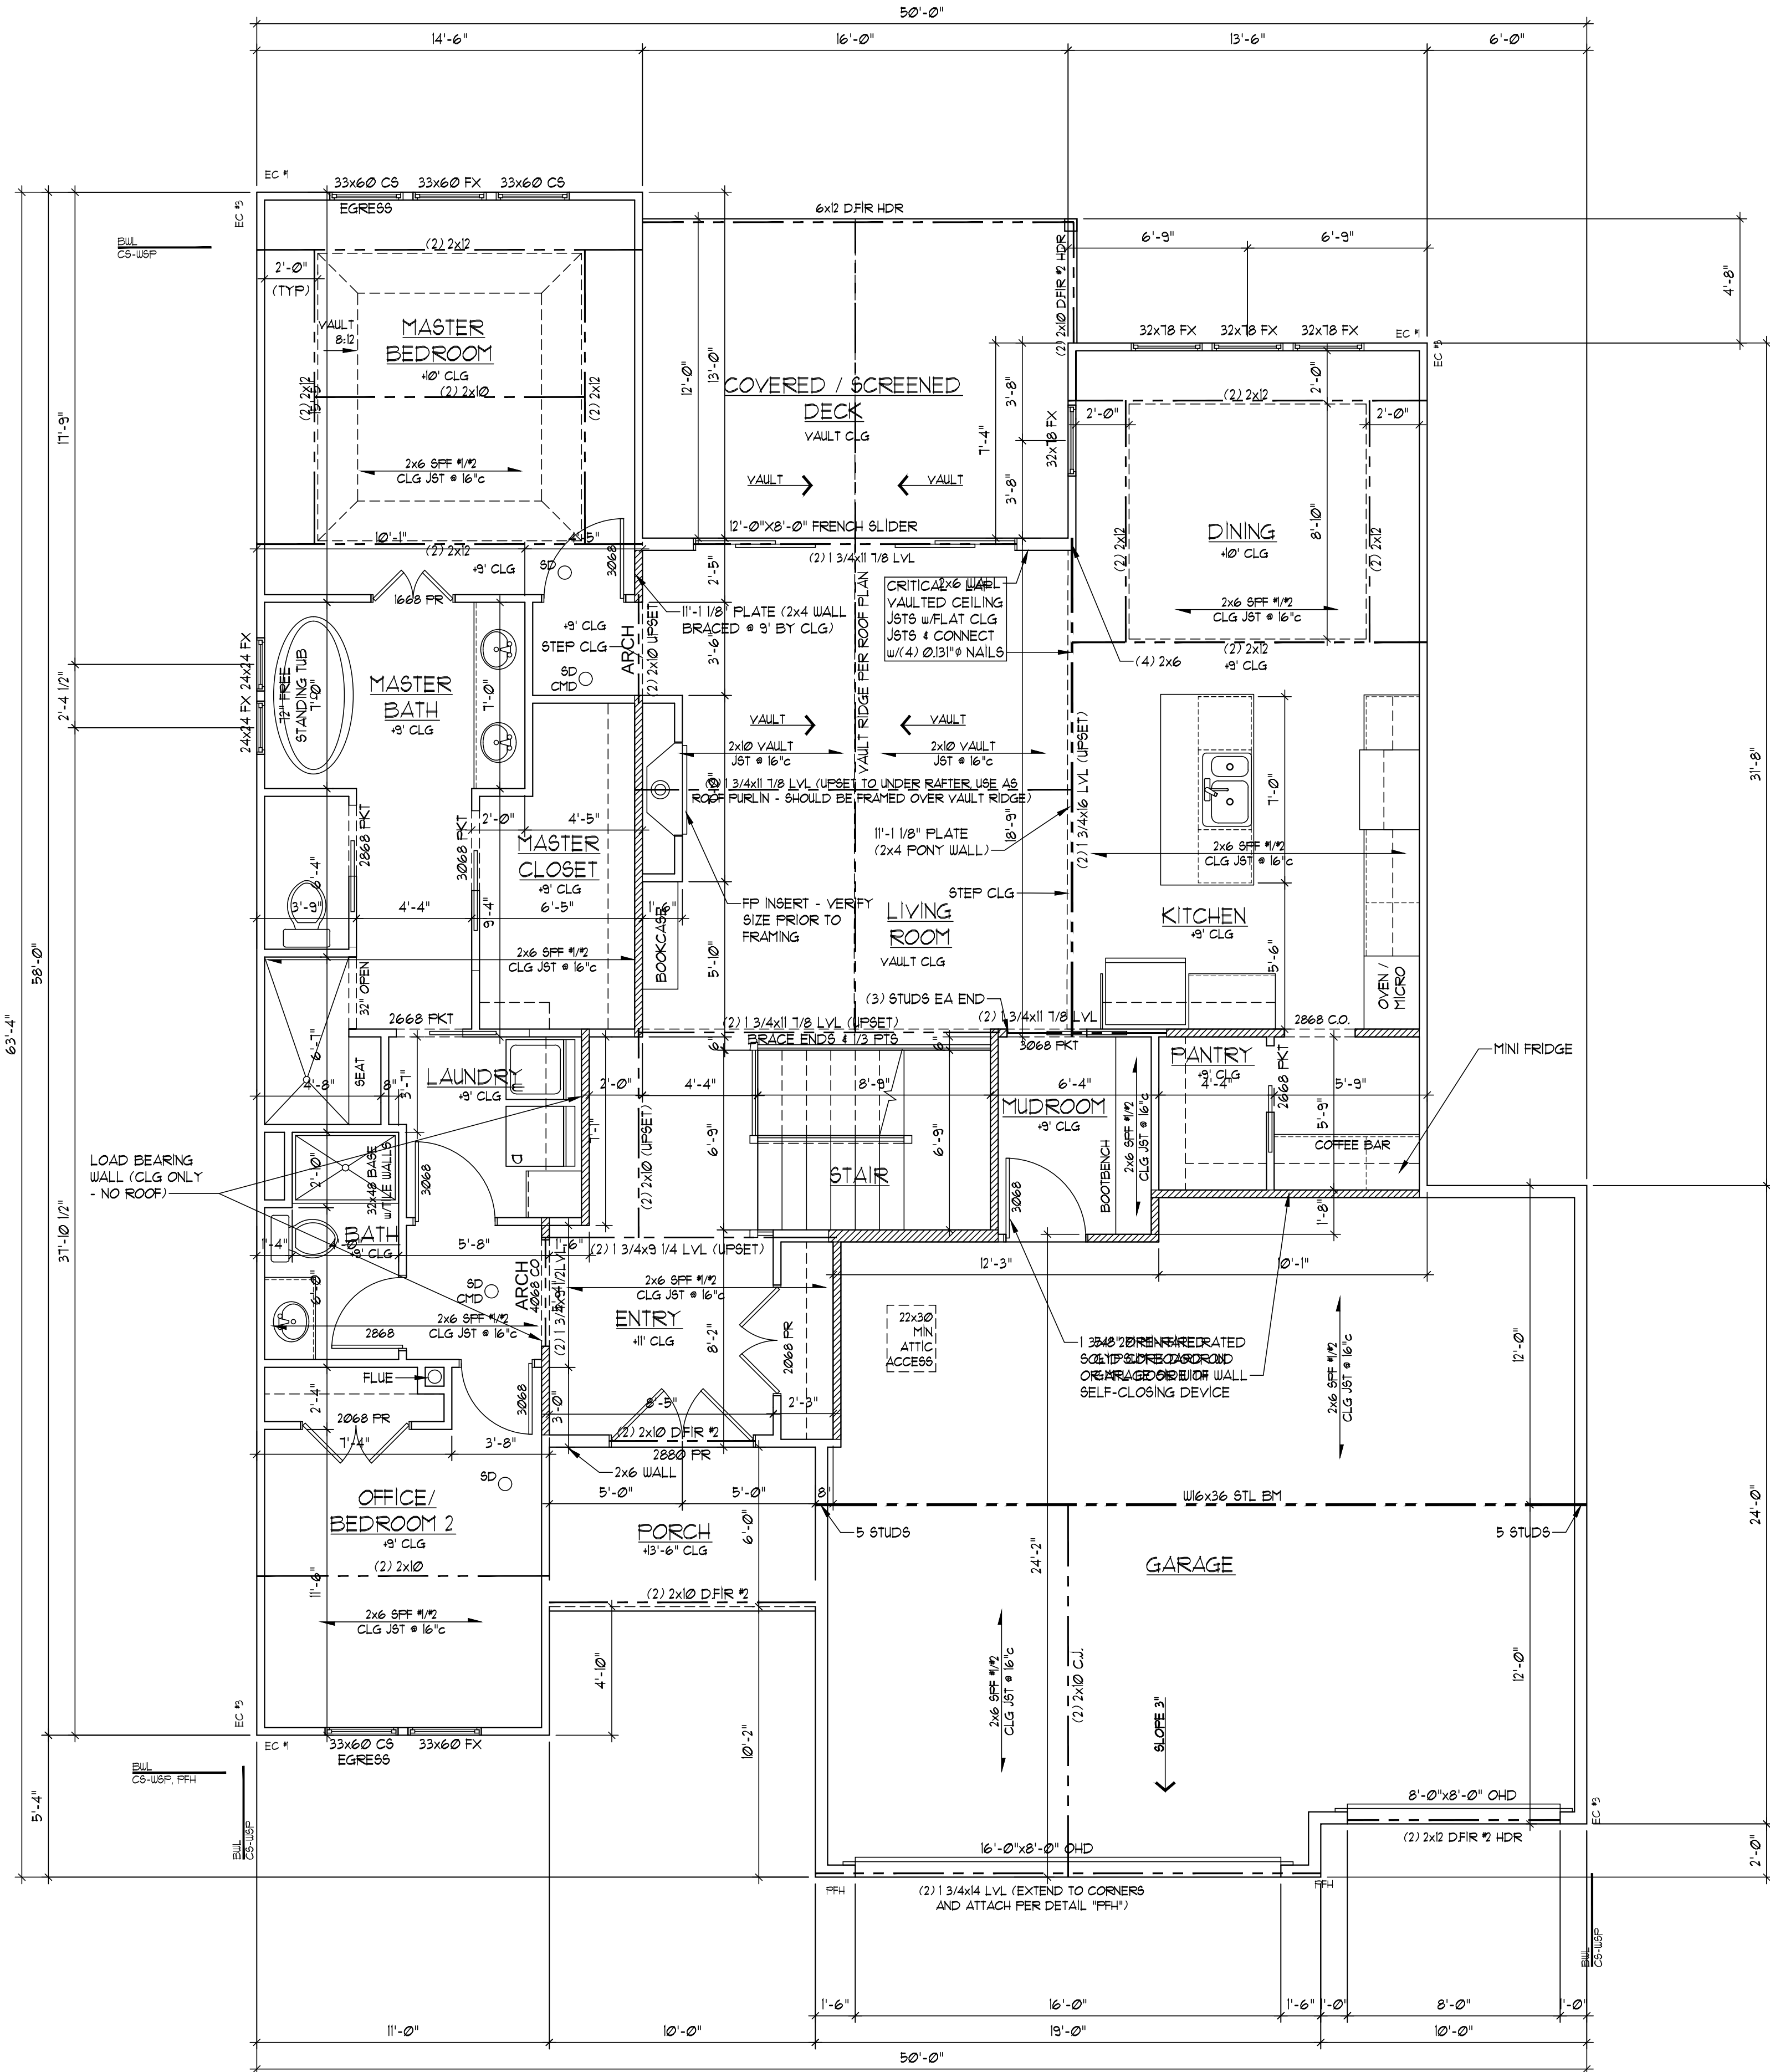

MAIN FLOOR PLAN
SCALE: 1/4" = 1'-0"

MAIN LEVEL	1720 SF
FINISH:	
GARAGE:	636 SF
COVERED DECK:	192 SF

GENERAL PLAN REQUIREMENTS

- ALL STUD WALL FRAMING SHALL BE CONTINUOUS FROM THE FLOOR TO ROOF OR CEILING DIAPHRAGM, UNO. ALL WALLS OVER 10'-0" ARE TO BE 2x6 @ 16" C UNO. PROVIDE WATER-RESISTANT EXTERIOR WALL COVERING ON ALL FRAMED WALLS TO COMPLY WITH IRC SECTION 103.2.
- PROVIDE GFCI ELECTRICAL OUTLETS ON EXTERIOR, IN UNFINISHED BASEMENT, IN BATHROOMS, ABOVE KITCHEN COUNTERS, IN GARAGE, AND WITHIN 6'-0" OF ANY SINK.
- ALL EXTERIOR DOORS SERVED BY LANDING.
- INSTALL CARBON MONOXIDE DETECTORS PER IRC SECTION 315 OUTSIDE OF EACH SLEEPING AREA.
- INSTALL SMOKE DETECTORS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA, WITH A MINIMUM OF ONE ON EACH FLOOR PER IRC SECTION 314. PROVIDE A "UFER" GROUND PER IRC 360.8.
- REFER TO SHEET S3 FOR ALL WALL BRACING DETAILS AND/OR CALCULATIONS.
- INSTALL BLOCKERS FOR TP HOLDERS, TOILET BARS, AND TRIM BEAMS.
- GARAGE DOOR H-FRAME, THE H-FRAME FOR ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHED WITH 3 1/4"x120 NAILS @ 1' C STAGGERED WITH (1) 3 1/4"x120 NAILS THRU JAMB INTO HEADER, MINIMUM 2x8 OVERHEAD GARAGE DOORS TO MEET 15 PSF WIND LOAD RESISTANCE REQUIREMENTS OF DASHA 108-11 AND ASTM E 330-02.
- MAXIMUM RISER HEIGHT OF STAIRWAYS SHALL NOT EXCEED 1 3/4" AND THE TREADS SHALL PROVIDE A MINIMUM TREAD DEPTH OF 10".
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 DFR #2 UNLESS NOTED OTHERWISE ON PLANS.
- ALL HEADER BEARINGS (OTHER THAN WINDOWS) TO BE (2) 2x4 STUDS UNLESS NOTED OTHERWISE. WINDOW HEADER BEARING TO BE (1) 2x4 EA END UNLESS NOTED OTHERWISE.
- SLOPING VAULTS SHALL BE FURRED DOWN WITH 2x MATERIAL & AFFIXED WITH 1/2" OSB FLITCH PLATE TO PROVIDE REQUIRED DEPTH FOR INSULATION (RE: ENERGY REQUIREMENTS and/or FRAMING DETAILS)

////////// DENOTES LOAD BEARING STUD WALL

WINDOW AND DOOR NOTES

- ALL WINDOWS ARE SHOWN IN INCHES (I.E. 30x60 IS A 30"x60" WINDOW). ALL DOORS SHOWN IN FEET AND INCHES (I.E. 28x8 DOOR IS A 2'-8"x8'-8" DOOR). CONTRACTOR/INSTALLER TO VERIFY R.O. DIMENSIONS WITH BUILDER SUPPLIED CUT SHEET PRIOR TO FRAMING.
- ALL WINDOWS TO BE LOW-E GLASS TO MEET ALL LOCAL ENERGY CODE REQUIREMENTS.
- PROVIDE EGRESS WINDOW IN ALL SLEEPING ROOMS. WINDOWS SHALL COMPLY WITH THE FOLLOWING:
 - MINIMUM OPEN AREA: 5.7 SF
 - MINIMUM OPENING HEIGHT: 24 INCHES
 - MINIMUM OPENING WIDTH: 20 INCHES
 - SILL HEIGHT 44" MAX ABOVE FLOOR
- ALL WINDOW SILLS ARE TO BE 24" MIN ABOVE FINISH FLOOR, OR SHALL BE FIXED/INOPERABLE.
- ALL WINDOWS AND GLAZED DOORS SHALL COMPLY WITH IRC SECTION R308. IRC SECTION R308.4: GLAZING IN HAZARDOUS LOCATIONS SHALL BE OF APPROVED SAFETY GLAZING MATERIALS. GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF STAIR ENCLOSURES FOR GLAZING SHOWERS AND WHIRLPOOLS. GLAZING IN FIXED OR OPERABLE PANELS EXCEEDING 9 SF AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36".
- ALL OPERABLE WINDOW SHALL HAVE FALL PROTECTION PER IRC R312.2.
- ALL GLAZING IN WINDOWS AND DOORS SHALL COMPLY WITH THE TEST CRITERIA FOR CATEGORY II IN ACCORDANCE WITH CPSC 16 CFR 1201.
- WINDOW MANUFACTURER TO CONFIRM EXACT SAFETY AND EGRESS WINDOW LOCATIONS PER LOCAL CODES.

ENERGY REQUIREMENTS

CONTRACTOR TO PROVIDE ENERGY AUDIT USING THE HERS ENERGY RATING SYSTEM. THE PROJECTED ENERGY RATING INDEX SCORE IS 65. THE ENERGY RATING INDEX SCORE SHALL MEET OR EXCEED THE MINIMUM SCORE OF 68 AS ADOPTED BY THE CITY OF OVERLAND PARK.

INSULATION TO COMPLY WITH PROJECTED HERS RATING REPORT:

- | | |
|-------------------|------------------------------|
| ABOVE GRADE WALLS | R-13 MIN |
| CEILING (FLAT) | R-45 |
| CEILING (VAULTED) | R-30 |
| EXPOSED FLOOR | R-30 |
| BASEMENT WALLS | R-13 |
| SLABS | R-00 EDGE
R-00 UNDER SLAB |
| DUCTWORK | |
| WINDOWS | U 0.27 |
| DOOR | U 0.34 |
- ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES TO BE SEALED PER 2018 IRC SECTION N103.3.2.
 - THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED PER 2018 IRC SECTION N102.4.1 AND TABLE N102.4.1.1.
 - HEATING AND COOLING SHALL BE SIZED IN ACCORDANCE WITH ACCA MANUAL S BASED ON BUILDING LOADS CALCULATED IN ACCORDANCE WITH ACCA MANUAL J OR OTHER APPROVED HEATING AND COOLING CALCULATION METHODOLOGIES PER IRC SECTION N103.1.
 - CONTRACTOR TO SUBMIT "MANUAL S" AND "MANUAL J" CALCULATIONS FOR THE HVAC SYSTEM.
 - THE ENERGY AUDIT SHALL COMPLY WITH THE PROVISIONS OF N106.
 - MINIMUM EQUIPMENT EFFICIENCY RATINGS ARE AS FOLLOWS:
FURNACE: 96.4 AFUE
AIR CONDITIONER: 14.0 SEER
WATER HEATER (48 GALLON): 0.63 EF

WALL BRACING NOTES:

- ALL WALLS ARE TYPE "CS-WSP" AND ARE CONTINUOUSLY SHEATHED UNLESS NOTED OTHERWISE. THE BRACED WALL NOTATIONS (IF SHOWN) REFLECT THE MINIMUM SHEATHING REQUIREMENTS PER CODE.
 - IF NO NOTATIONS ARE SHOWN FOR WALLS TYPE "CS-WSP" ON PLAN, WALL IS FULLY SHEATHED AND MEETS ALL REQUIREMENTS WITH END CONDITION # 1, 3, OR #4.
 - EC # - END CONDITION PER IRC FIGURE R602.10.1. (FOR CONDITIONS #1, #3, & #4 NO HOLDDOWN REQUIRED)
 - INTERIOR WALL BRACING NOT REQUIRED
- XXXXXXXXXX DENOTES EXTERIOR BRACED WALL WOOD
XX" PANEL STRUCTURAL PANEL (WSP or CS-WSP)
ATTACHED PER DETAILS AND GENERAL NOTES



© COPYRIGHT 2023

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deuren and Associates, P.A. © 2023



Project #: 8083-XXXX

DATE:

Permit: 12/7/2023

MAIN FLOOR PLAN FOR:

THE BAYBERRY
Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge

GA4



- ALL ROOF RAFTERS NOT CALLED OUT ARE TO BE 2x6 SFD 1/12 @ 16" C.
- ALL CEILING JOISTS NOT CALLED OUT ARE TO BE 2x6 SFD 1/12 @ 16" C.
- ALL VAULTS TO BE FURRED DOWN w/2x4 MATERIAL TO PROVIDE FOR R-38 INSULATION.
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 DFD 1/2 UNLESS NOTED OTHERWISE ON PLANS.
- ALL RIDGES, HIPs, AND VALLEYS NOT MARKED SHALL BE (1) NOMINAL SIZE LARGER THAN THE INTERSECTING RAFTERS.
- CEILING JOISTS AND RAFTERS SHALL BE NAILED TO EACH OTHER WITH (3) 16d COMMON (3/12 @ 6'2") NAILS. THE RAFTER SHALL BE NAILED TO THE TOP WALL PLATE WITH (3) 8d COMMON (2/12 @ 3'2") NAILS. CEILING JOISTS SHALL BE CONTINUOUS OR SECURELY JOINED WITH (3) 16d COMMON (3/12 @ 6'2") NAILS WHERE THEY MEET OVER INTERIOR PARTITIONS AND ARE NAILED TO ADJACENT RAFTERS TO PROVIDE A CONTINUOUS TIE ACROSS THE BUILDING WHEN SUCH JOINTS ARE PARALLEL TO THE RAFTERS.
- WHERE CEILING JOISTS ARE NOT CONNECTED TO THE RAFTERS AT THE TOP WALL PLATE (OR AT LOCATIONS WHERE C.J. ARE PERPENDICULAR TO RAFTERS), INSTALL 2x4 RAFTER TIES @ 16" c/w/ (3) 16d COMMON (3/12 @ 6'2") NAILS EA END.
- ADDITIONAL NOTE: ROOFS WITH SLOPE OF 4:12 OR SHALLower SHALL HAVE (5) 16d COMMON NAILS THE CONNECTIONS LISTED IN NOTE #4 AND #7.
- ALL CONNECTIONS DESIGNED TO RESIST 150 PSF WINDS PER IBC TABLE 602.11. ROOF HEADERS DO NOT HAVE NEEDED UPLIFT TO REQUIRE HOLD DOWNS. REFER TO STRUCTURAL DETAIL SHEET 51 CONNECTION TABLE FOR FASTENERS.
- INSTALL 2x4 COLLAR TIES @ 48" IN UPPER 1/3rd OF ROOF RAFTER.
- IF COLLAR TIES CANNOT BE INSTALLED (AND FOR VAULTED/ CATHEDRAL ROOFS) INSTALL 1/4"x2x8 ridge STRAP (5/16"X16 L2x12 OR EQUIV.) PER FASTENER SCHEDULE.
- PROVIDE METAL FLASHING OR CLOSED CUT CORNER VALLEY w/ICE & WATER SHIELD AT ALL ROOF VAULTS.
- ROOF FLASHING AT ALL LOCAL COOKS, WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF. BATH VENTS TO VENT DIRECTLY TO THE OUTSIDE.
- PER IRC SECTION 802.3 - FOR ROOF PITCHES 3/12 OR GREATER, STRUCTURAL MEMBERS THAT SUPPORT RAFTERS AND CEILING JOISTS SUCH AS RIDGE BEAMS, HIPS AND VALLEYS SHALL BE SUPPORTED BY BRACES AND/OR FURLING AT THE JOINTS AND ARE REQUIRED TO BE DESIGNED AS BEAMS AND ARE TO BE FRAMED USING LUMBER THAT IS NOMINALLY 2" WIDE BY ONE SIZE GREATER THAN ATTACHING MEMBER (NOTE #5). THERE IS NO STRUCTURAL LINE LOADING ON THE MEMBER.
- ALL HIPs AND HIPS TO RIDGE CONNECTIONS SHALL BE INSTALLED AND TIED PER ATTACHING MEMBER DETAIL OF SHEET 52. THIS INCLUDES ADDITIONAL 2x8 CEILING JOISTS AND COLLAR TIES.
- EXACT GUTTER AND DOWNSPOUT LOCATION BY GUTTER INSTALLER.

1. ROOF FURLIN TO BE PLACED APPROXIMATELY WHERE SHOWN ON PLANS, USE 2x4 STUD GRADE FURLIN PLACED PERPENDICULAR TO RAFTERS (UNLESS NOTED OTHERWISE ON PLANS)
2. RIDGE, HIP, VALLEY, AND FURLIN BRACE STRUTS TO BE PLACED AS SHOWN ON PLANS. STRUTS TO BE 2x4 STUD GRADE w/ MAXIMUM UNBRACED LENGTH OF 8'-0" AND AT A 45° ANGLE w/ HORIZONTAL OR GREATER (VERTICAL WHERE POSSIBLE)
3. BRACES LONGER THAN 8'-0" SHALL BE 2x4 STRONG BACK BRACES


	CEILING HEADERS AND BEAMS
	2x6 ROOF FURLING (UNLESS NOTED OTHERWISE ON PLANS)
	2x4 FURLING/RIDGE BRACING @ 4'-0" C (STRONG BACK IF OVER 8'-0" LONG)
	2x4 STRONGBACK HIP, VALLEY, OR RIDGE RAFTER SUPPORT
	LOAD BEARING STUD WALLS



JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2023

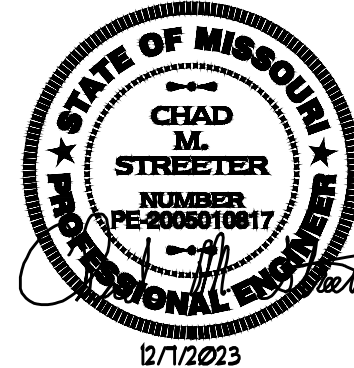

Project #: 8083-XXXX

DATE:


Permit: 12/7/2023

ROOF PLAN FOR:


THE BAYBERRY
Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge

GA5


RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
12/14/2023

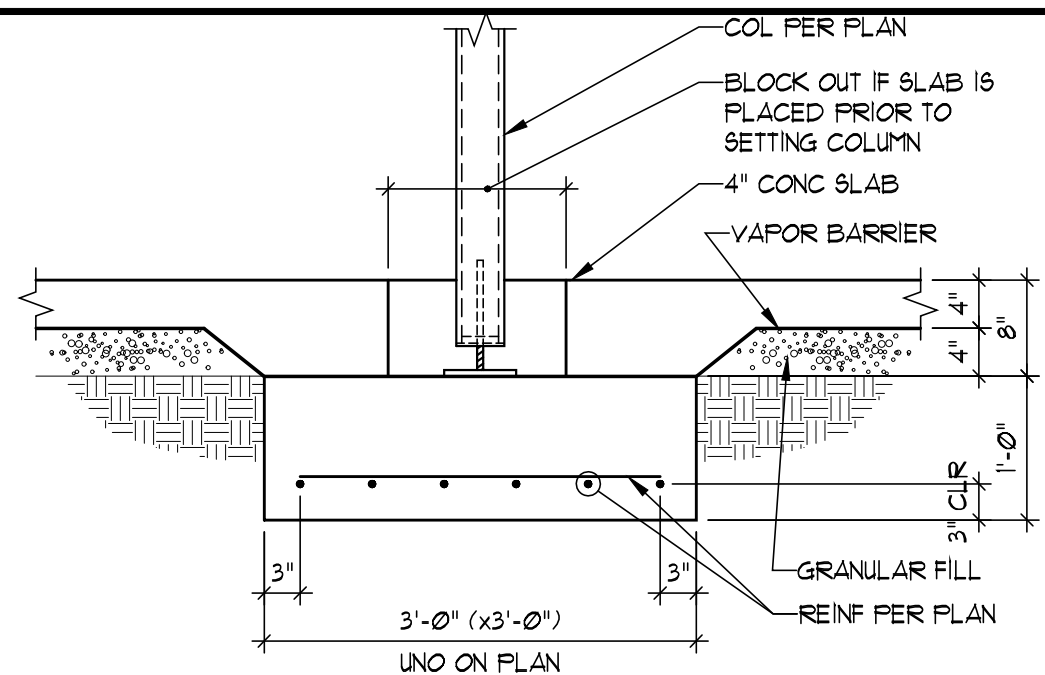


TYPICAL INTERIOR COLUMN
SCALE: 3/4" = 1'-0"

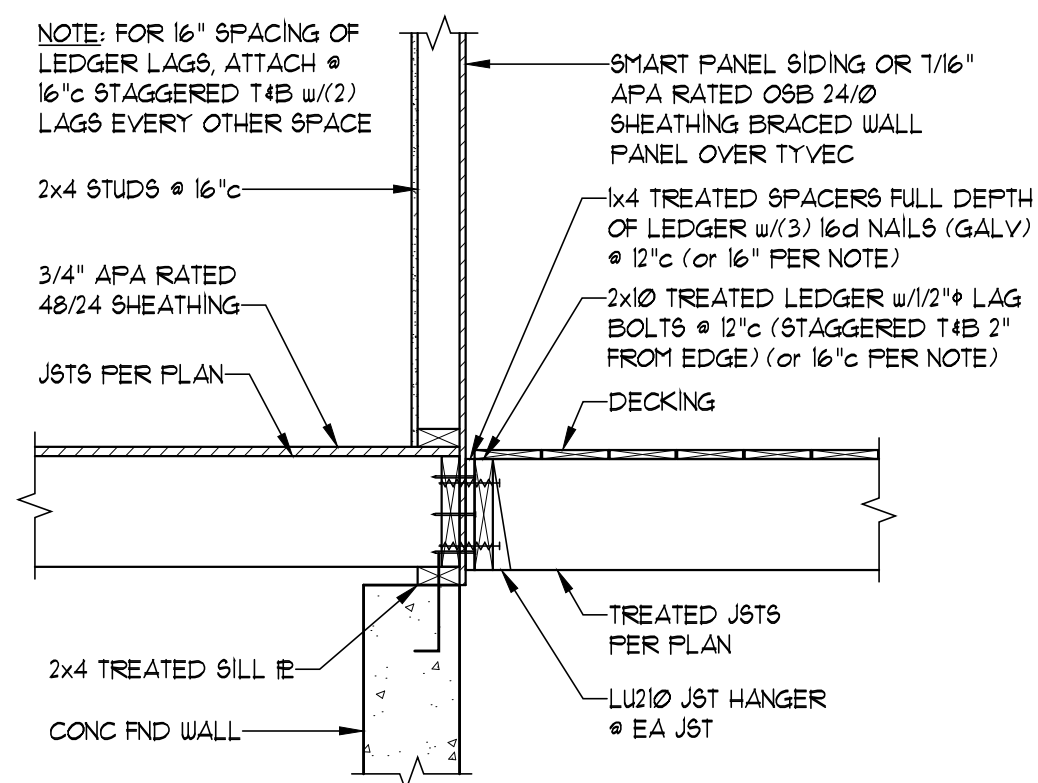


DECK ATTACHMENT
SCALE: 3/4" = 1'-0"

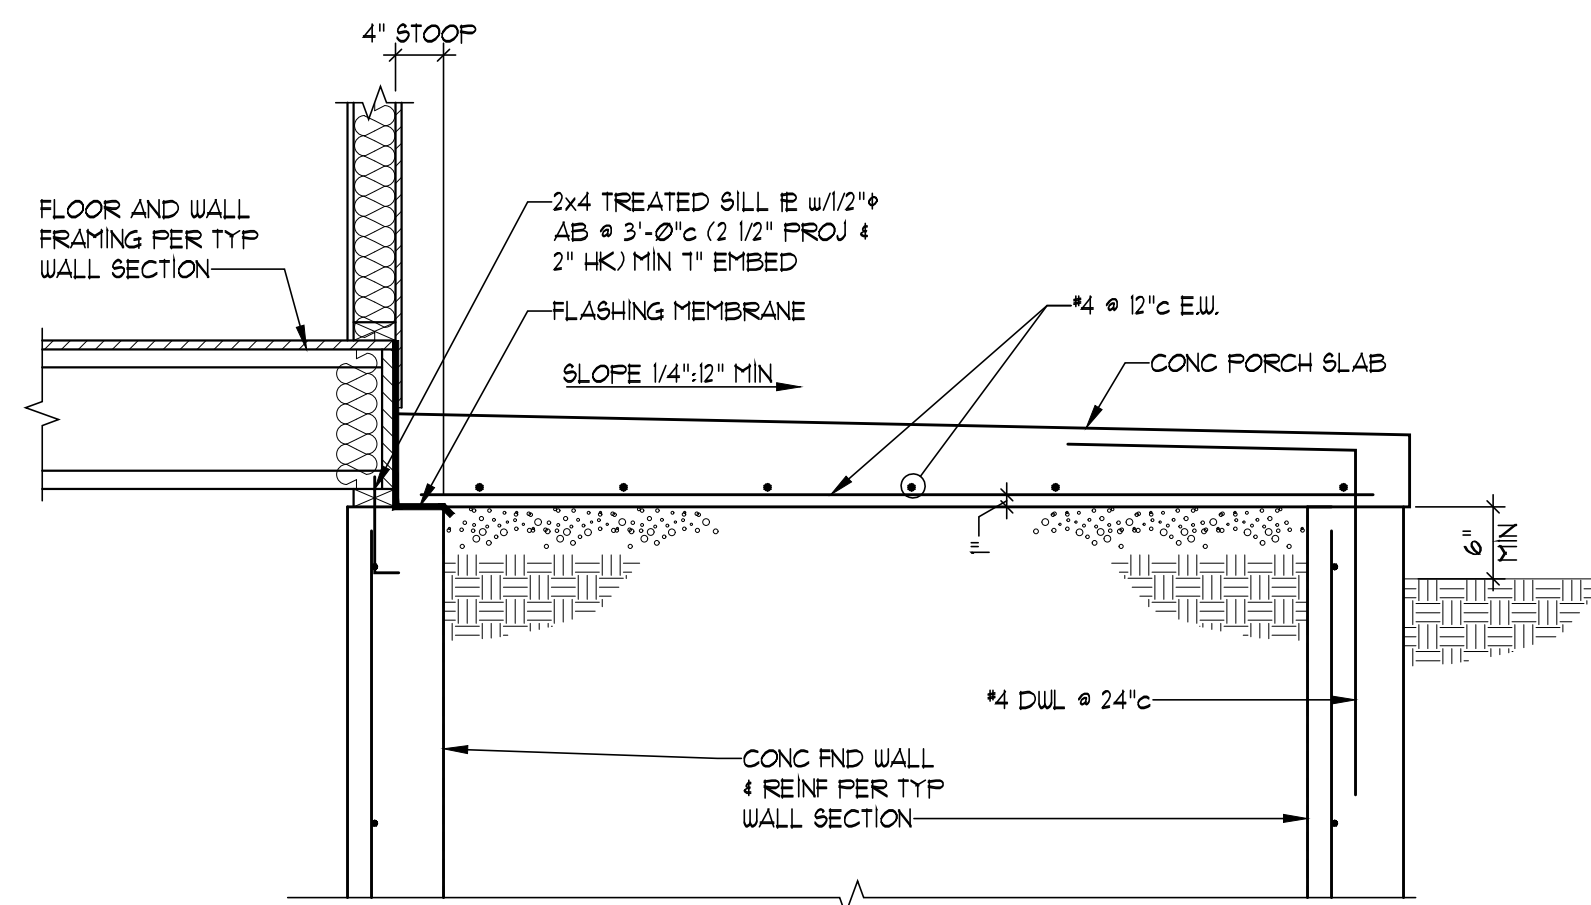


TYPICAL SECTION THRU PORCH
SCALE: 3/4" = 1'-0"

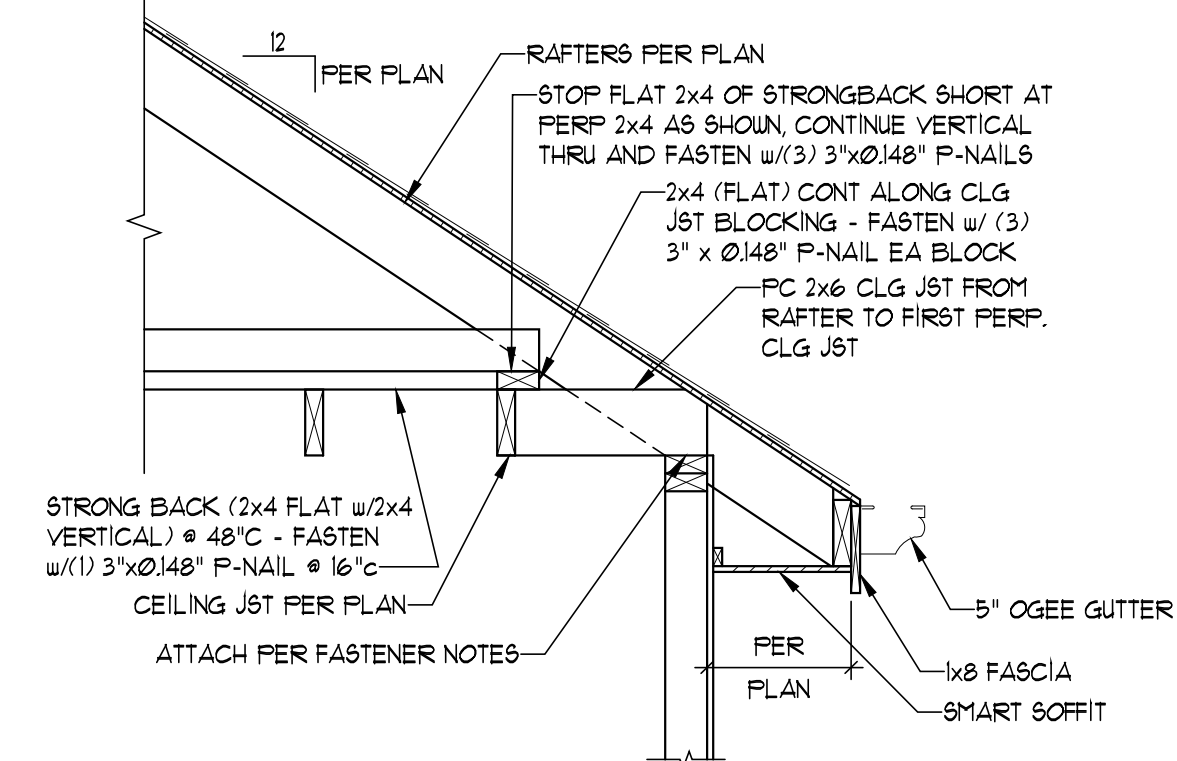


RAFTER ATTACHMENT AT PERPENDICULAR CONDITIONS
SCALE: 3/4" = 1'-0"

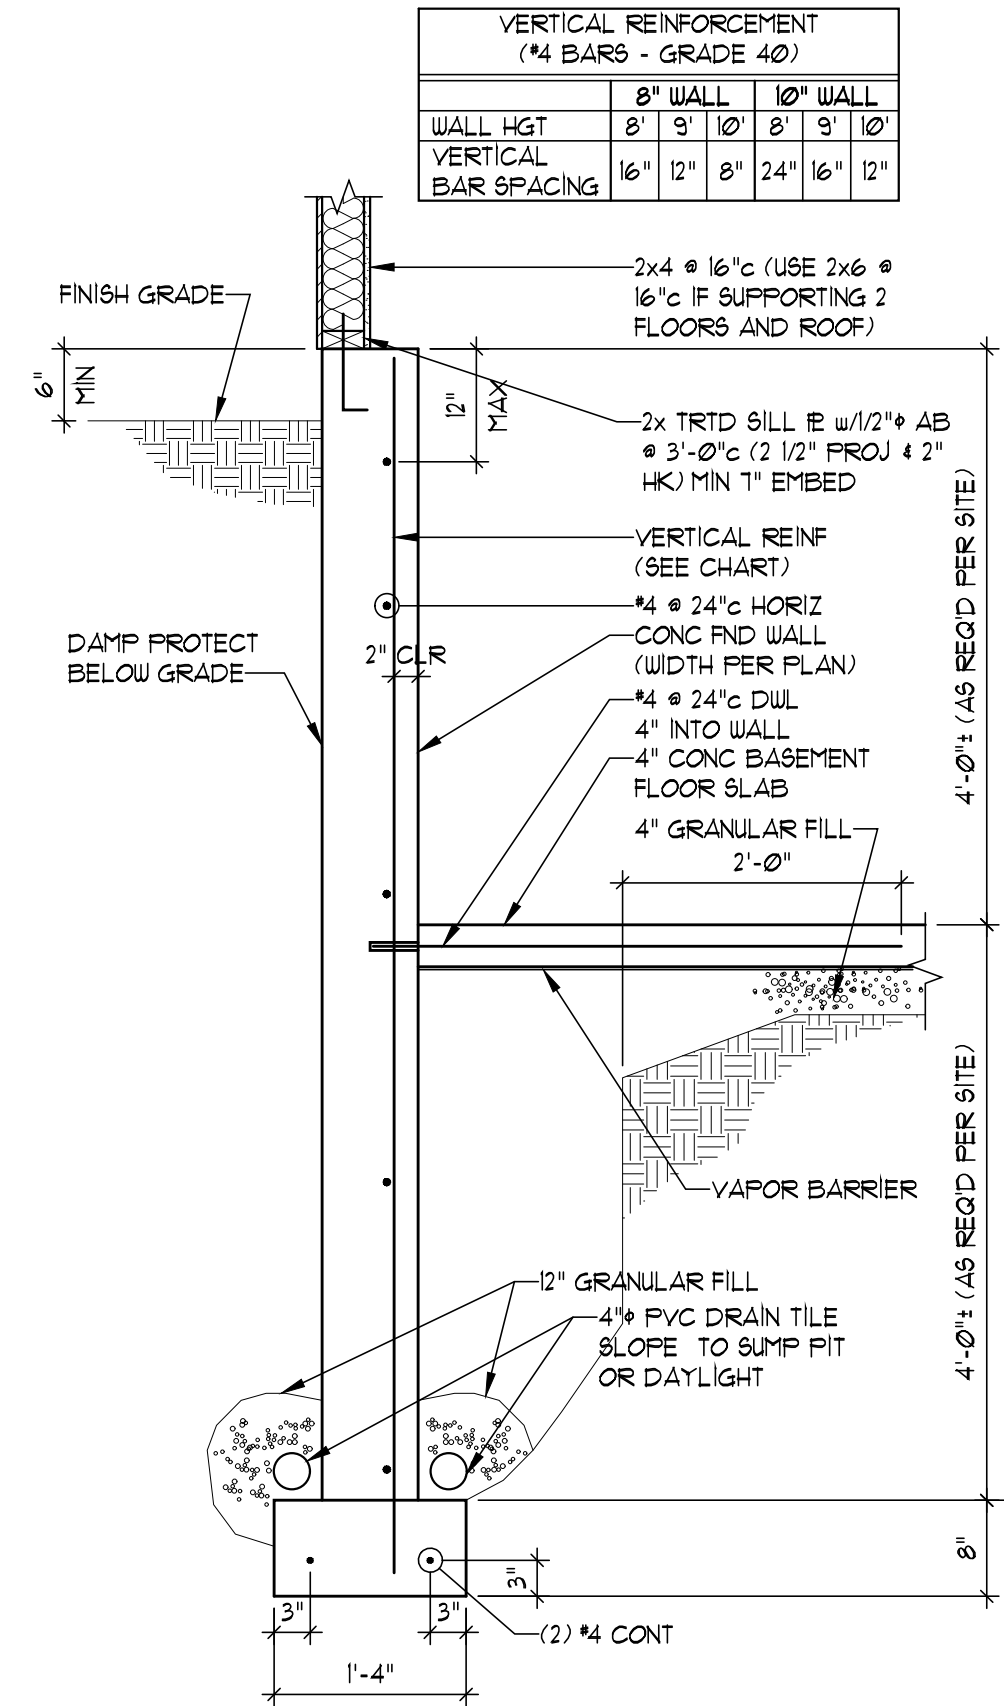


TYPICAL DAYLIGHT SECTION
SCALE: 3/4" = 1'-0"

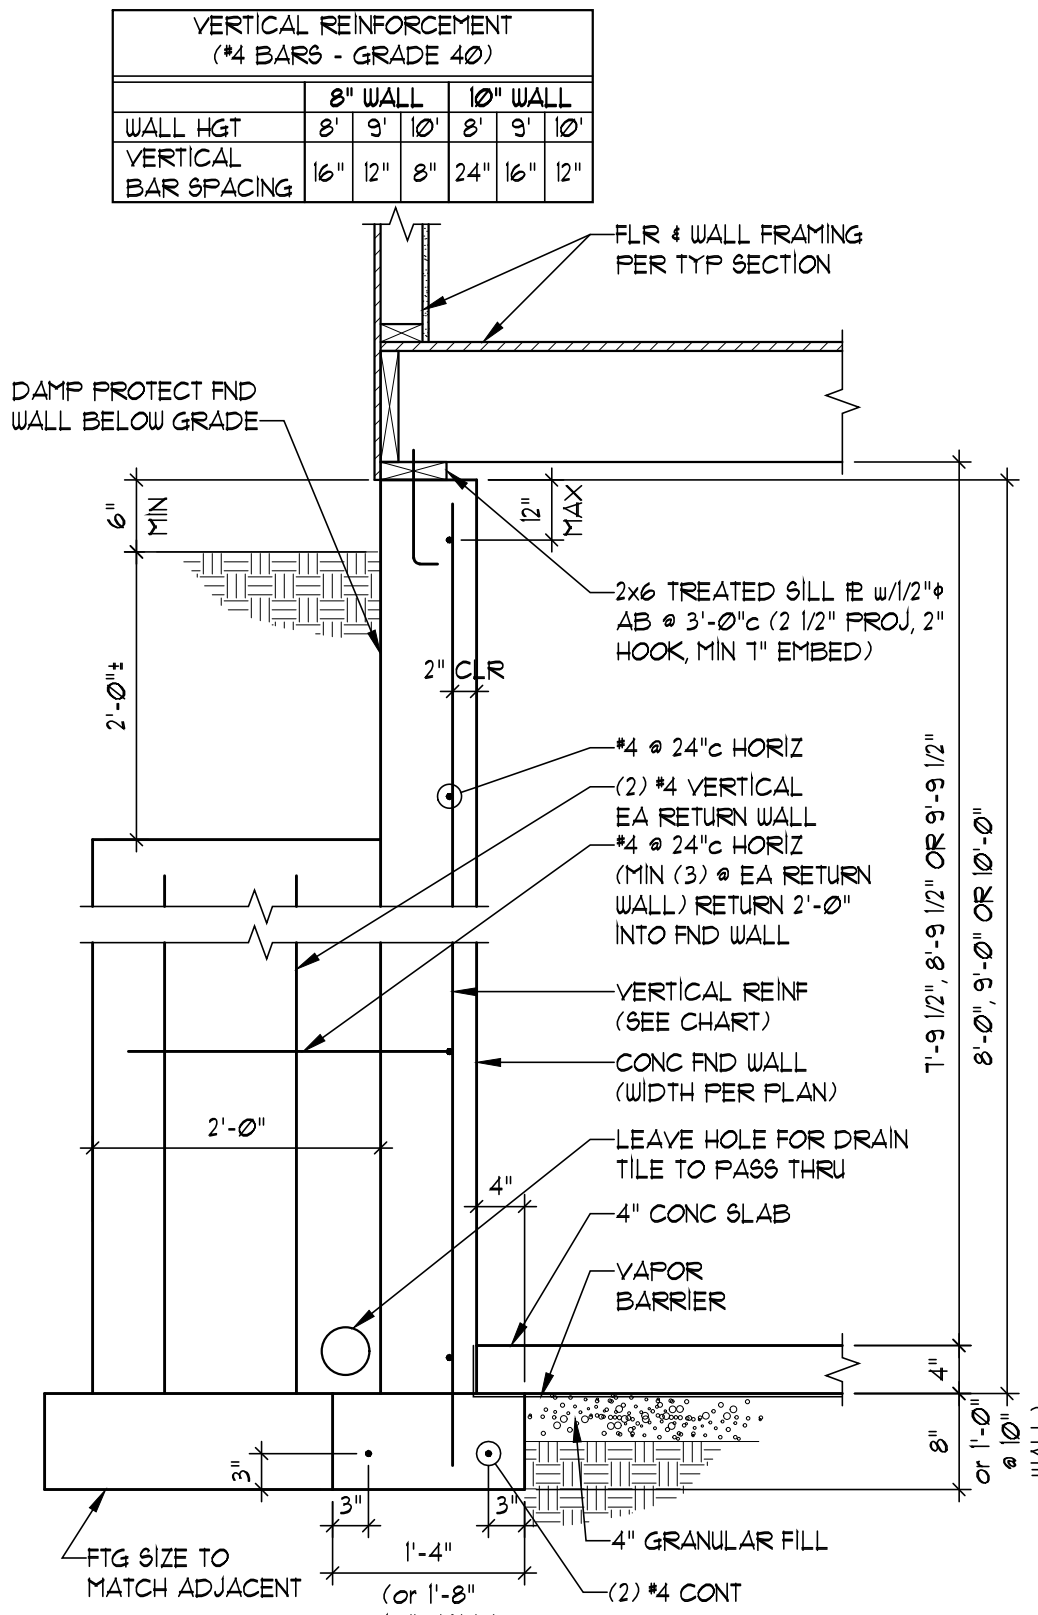


TYPICAL PILASTER SECTION
SCALE: 3/4" = 1'-0"

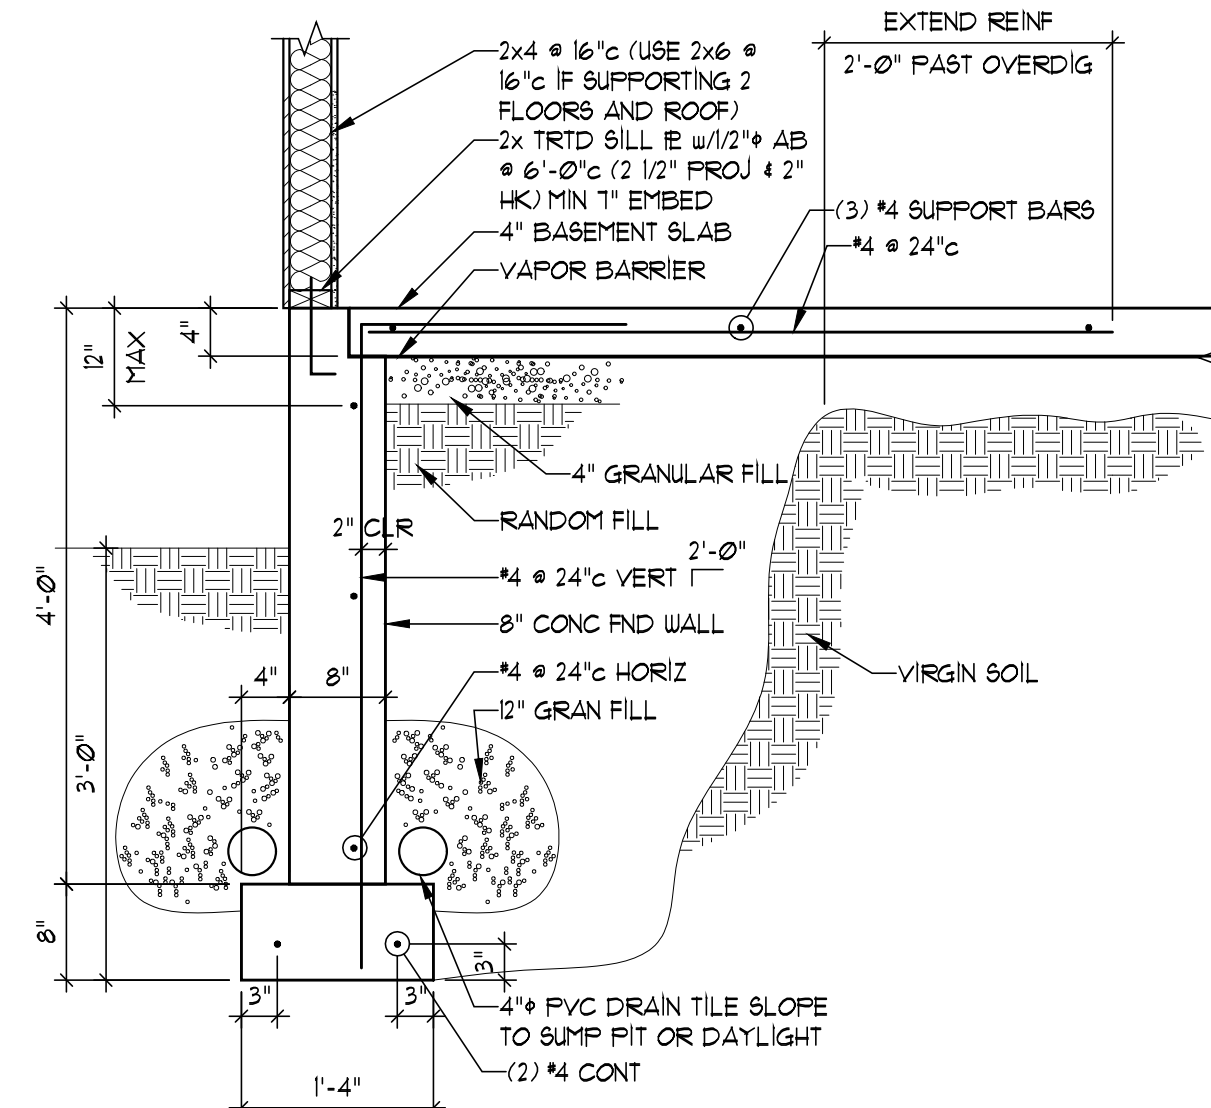


TYPICAL WALKOUT SECTION
SCALE: 3/4" = 1'-0"

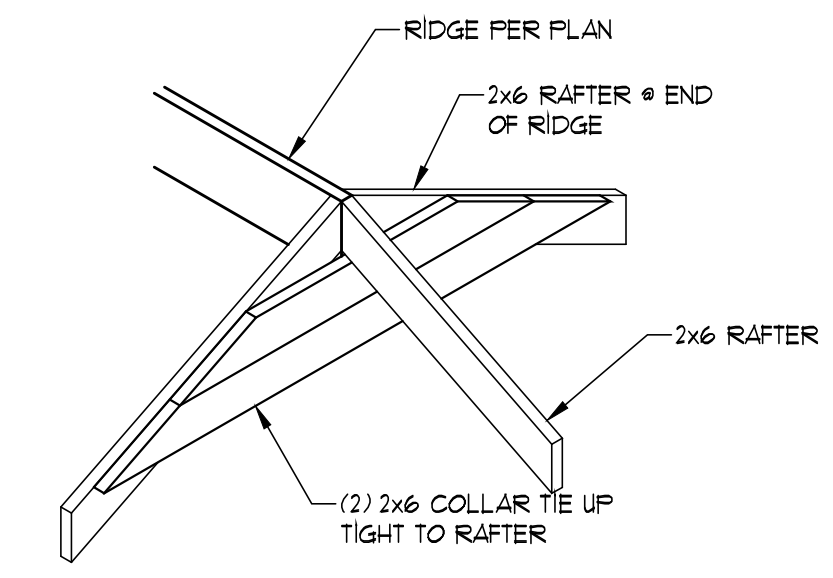


HIP RIDGE SUPPORT
SCALE: 1/2" = 1'-0"

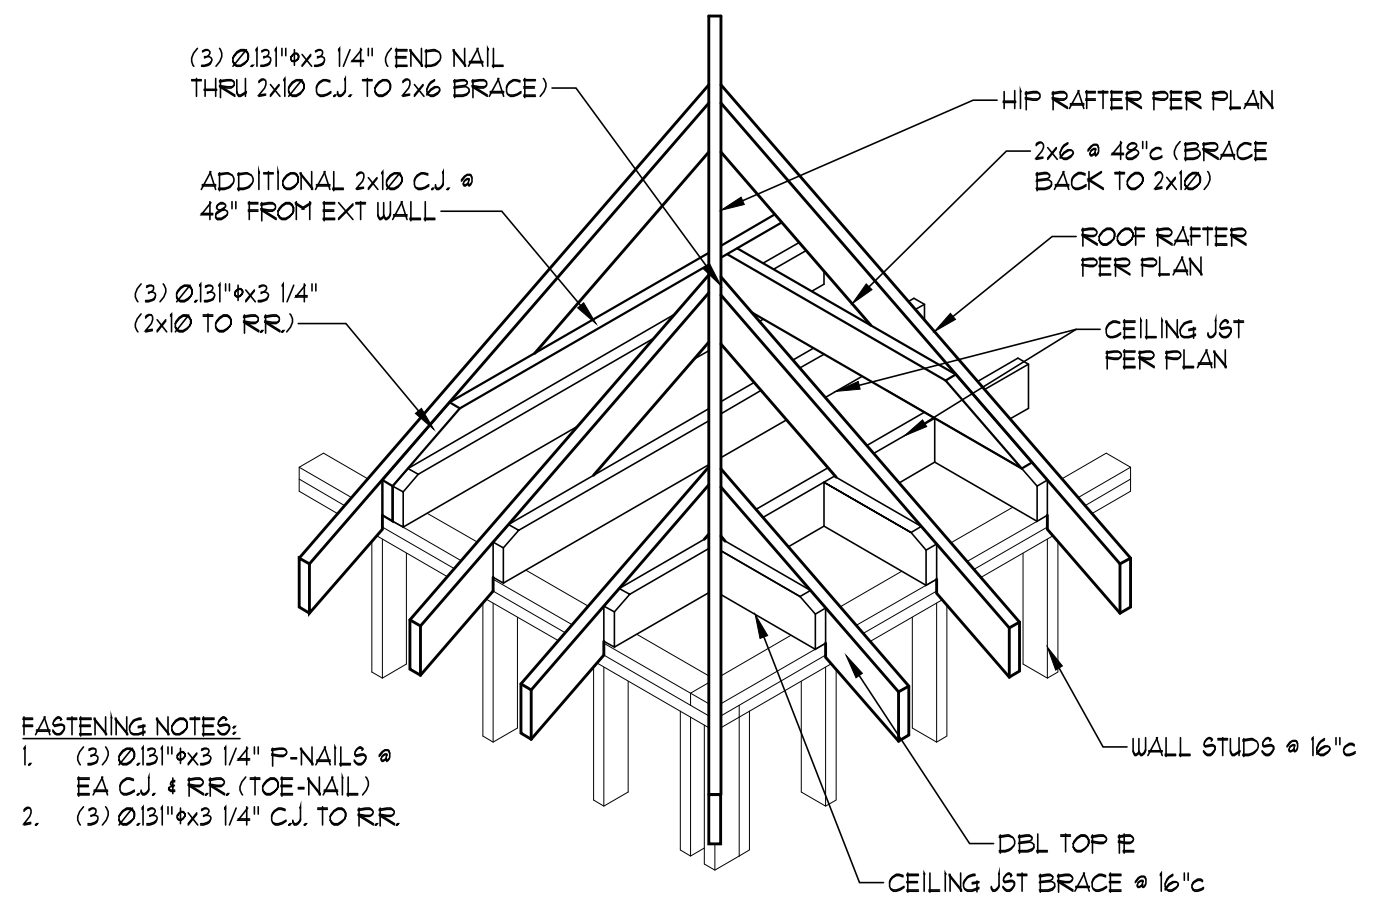

CEILING JOIST AND ROOF RAFTER CONNECTION @ HIP
SCALE: 1/2" = 1'-0"

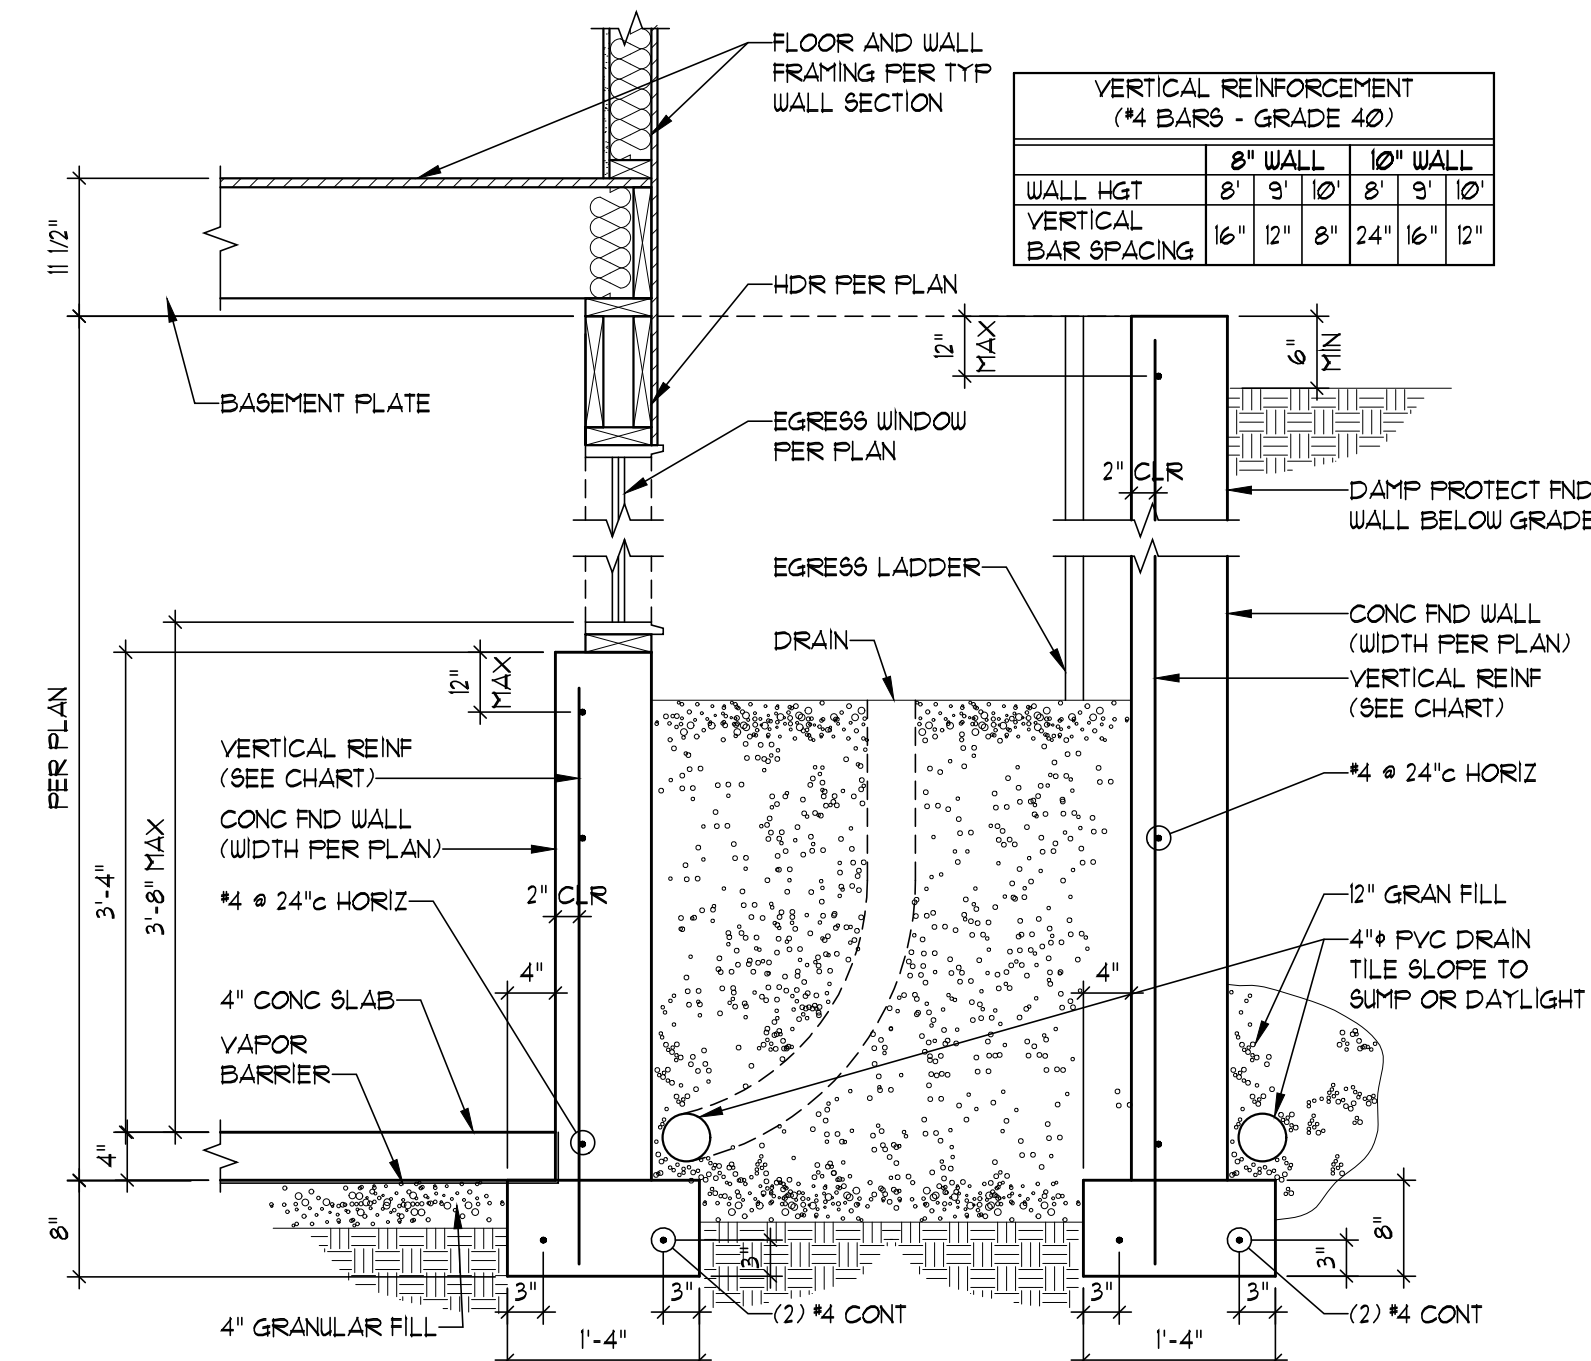

TYPICAL WINDOW WELL
SCALE: 3/4" = 1'-0"

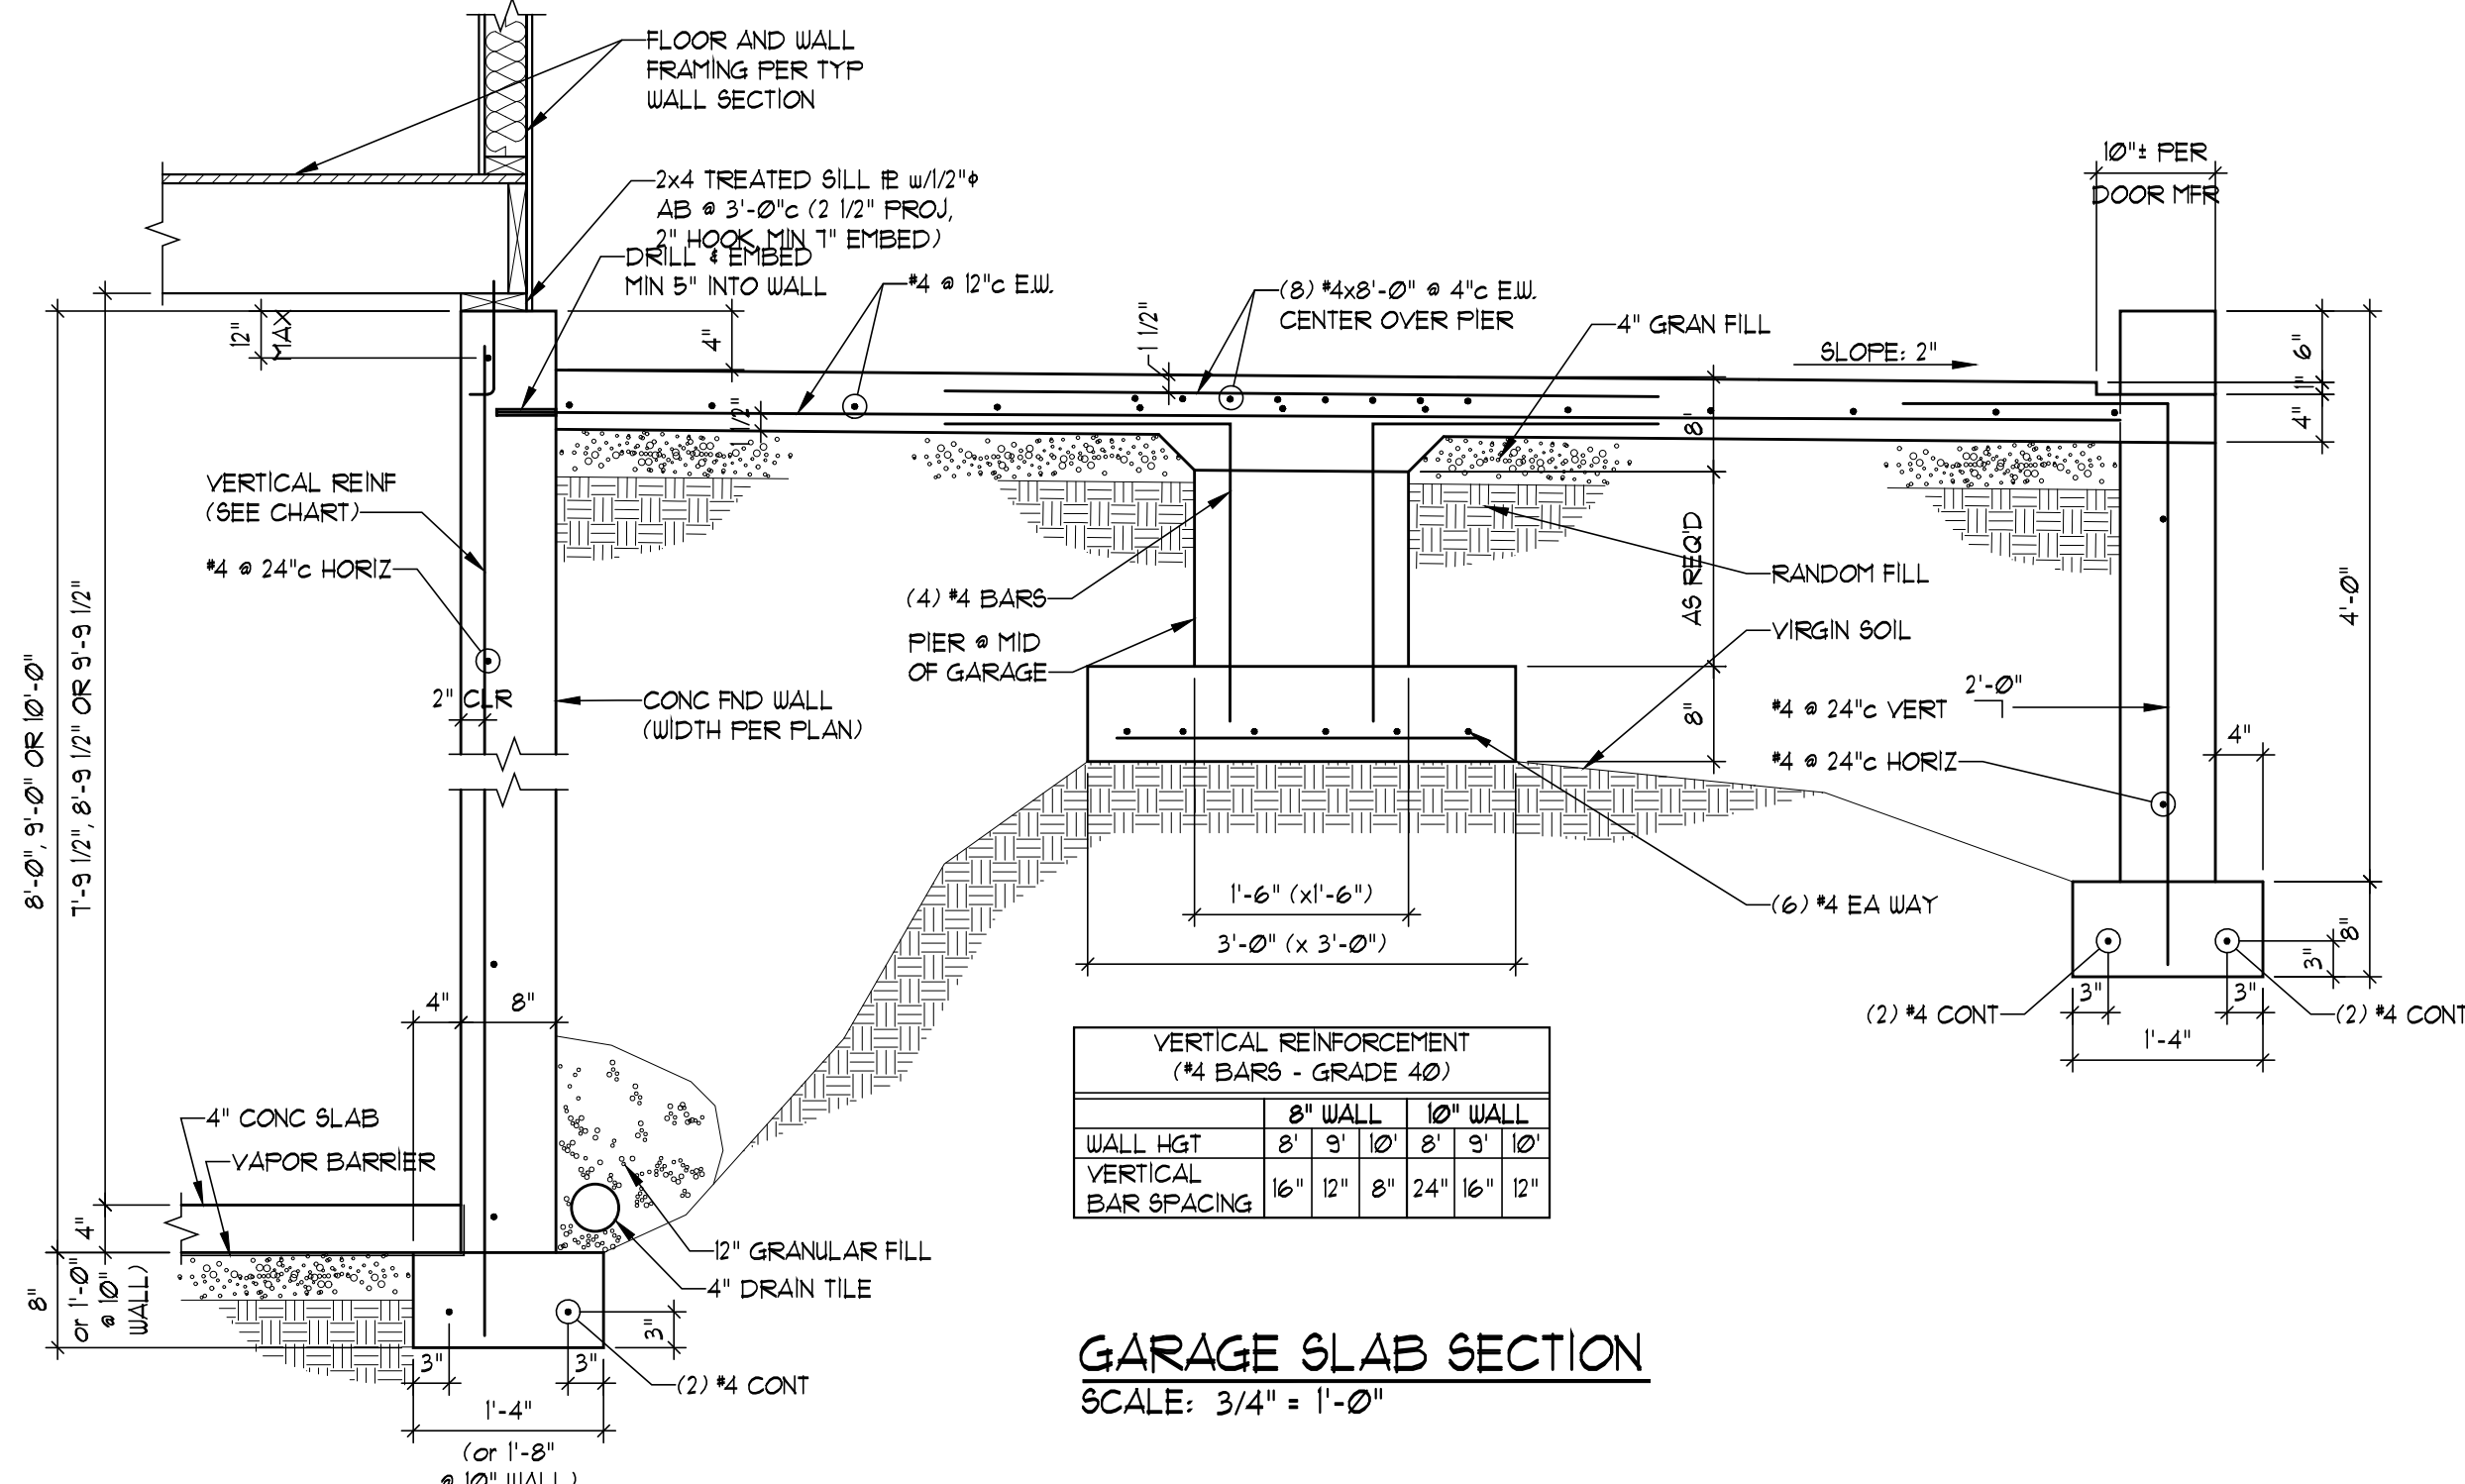

GARAGE SLAB SECTION
SCALE: 3/4" = 1'-0"




© COPYRIGHT 2023

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v. 816.786.4008
jfeconstruction.com



Van Deurzen and Associates, P.A. © 2023

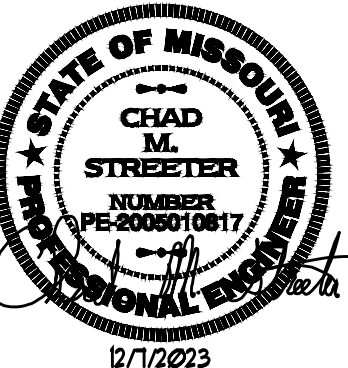

Project #: 8083-XXXX


DATE: 12/7/2023

Permit: 12/7/2023


STRUCTURAL DETAILS FOR:
THE BAYBERRY
Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge

S2

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
12/14/2023

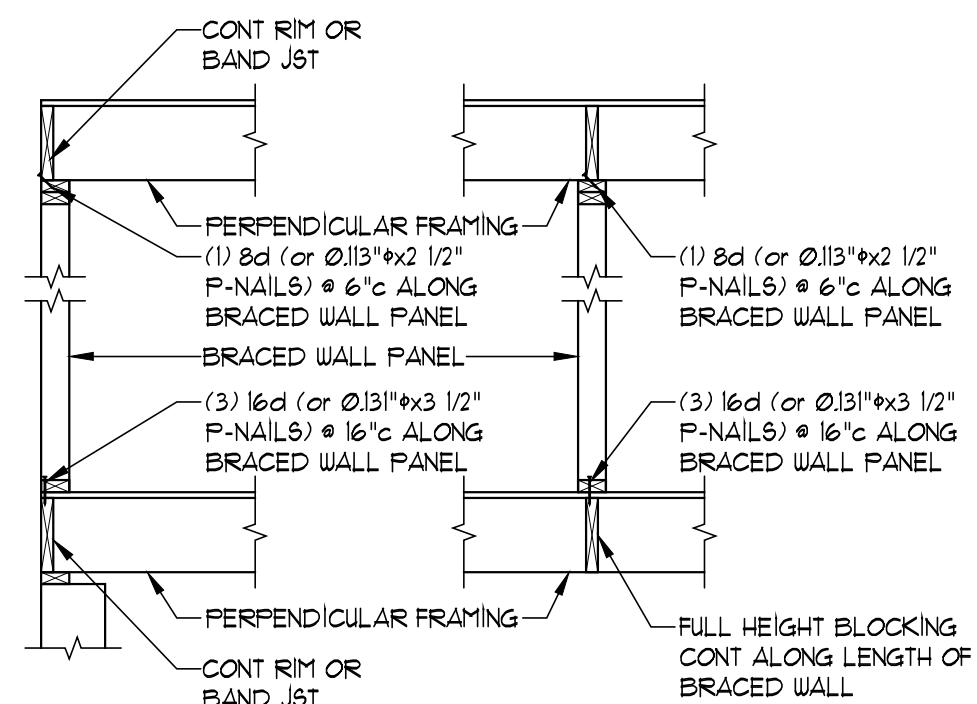

IRC FIGURE R602.10.8(1)
BRACED WALL PANEL CONNECTION WHEN
PERPENDICULAR TO FLOOR/CEILING FRAMING

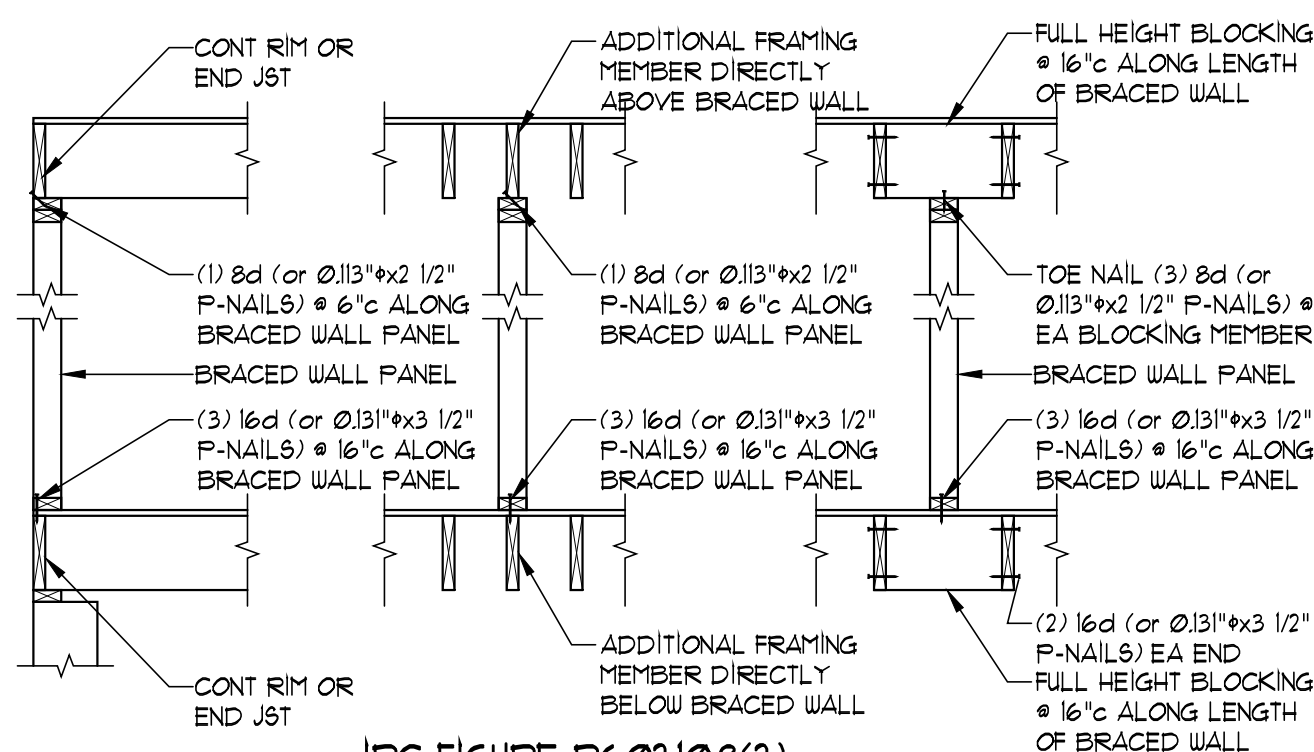

IRC FIGURE R602.10.8(2)
BRACED WALL PANEL CONNECTION WHEN
PARALLEL TO FLOOR/CEILING FRAMING


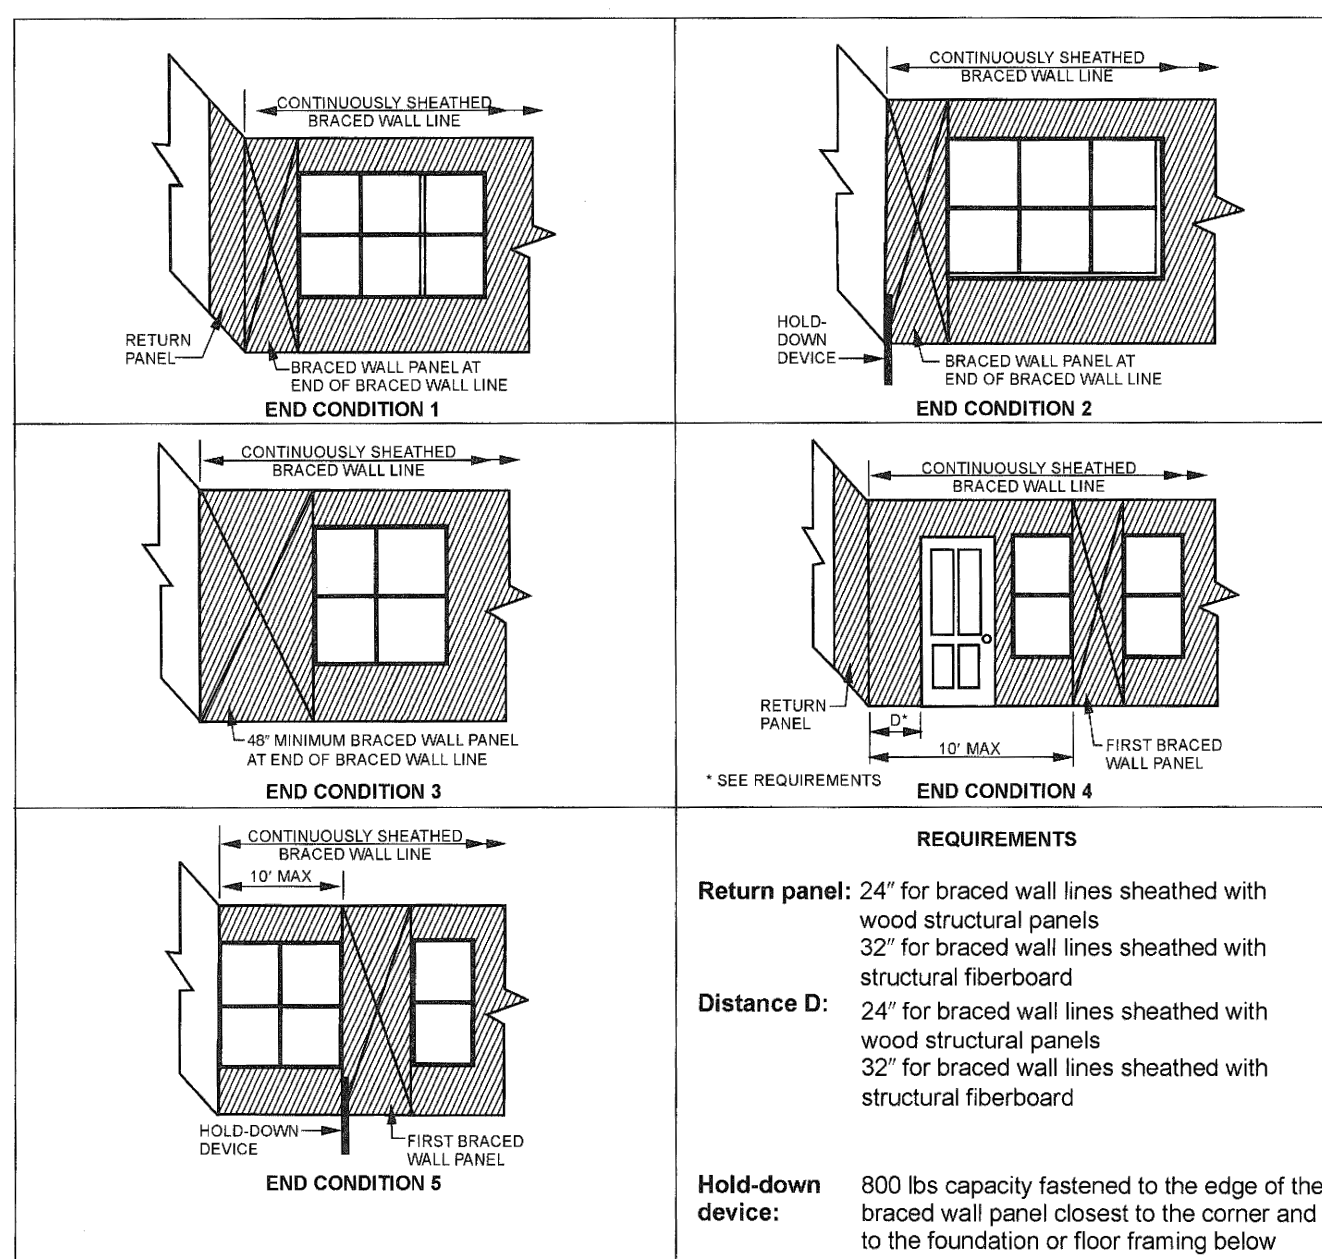



FIGURE R602.10.7
END CONDITIONS FOR BRACED WALL LINES WITH CONTINUOUS SHEATHING

TABLE R602.10.6.4
TENSION STRAP CAPACITY REQUIRE FOR RESISTING WIND PRESSURES
PERPENDICULAR TO METHOD PFH, FTG, AND CS-PF BRACED WALL PANELS


MINIMUM WALL STUD FRAMING NOMINAL SIZE AND GAGE	MAXIMUM PONY WALL HEIGHT (FEET)	MAXIMUM TOTAL WALL HEIGHT (FEET)	MAXIMUM OPENING WIDTH (FEET)	TENSION STRAP CAPACITY REQUIRED (LBS) FOR $V_{ult} = 15$ mph	
				EXPOSURE B	EXPOSURE C
2x4 1/2 GRADE	0	10	10	1000	1000
	1	10	9	1000	1000
			10	1025	2500
			11	1215	2850
			9	1000	1875
	2	10	16	2175	4125
			18	2500	
			9	1500	3175
	2	12	16	3375	DESIGN
			18	3975	DESIGN
	4	12	9	2150	DESIGN
			12	3175	DESIGN
2x6 STUD GRADE	2	12	9	1000	2025
			16	2500	3675
			9	2550	DESIGN
			11	1750	
	4	12	9	2400	DESIGN
			18	3800	DESIGN

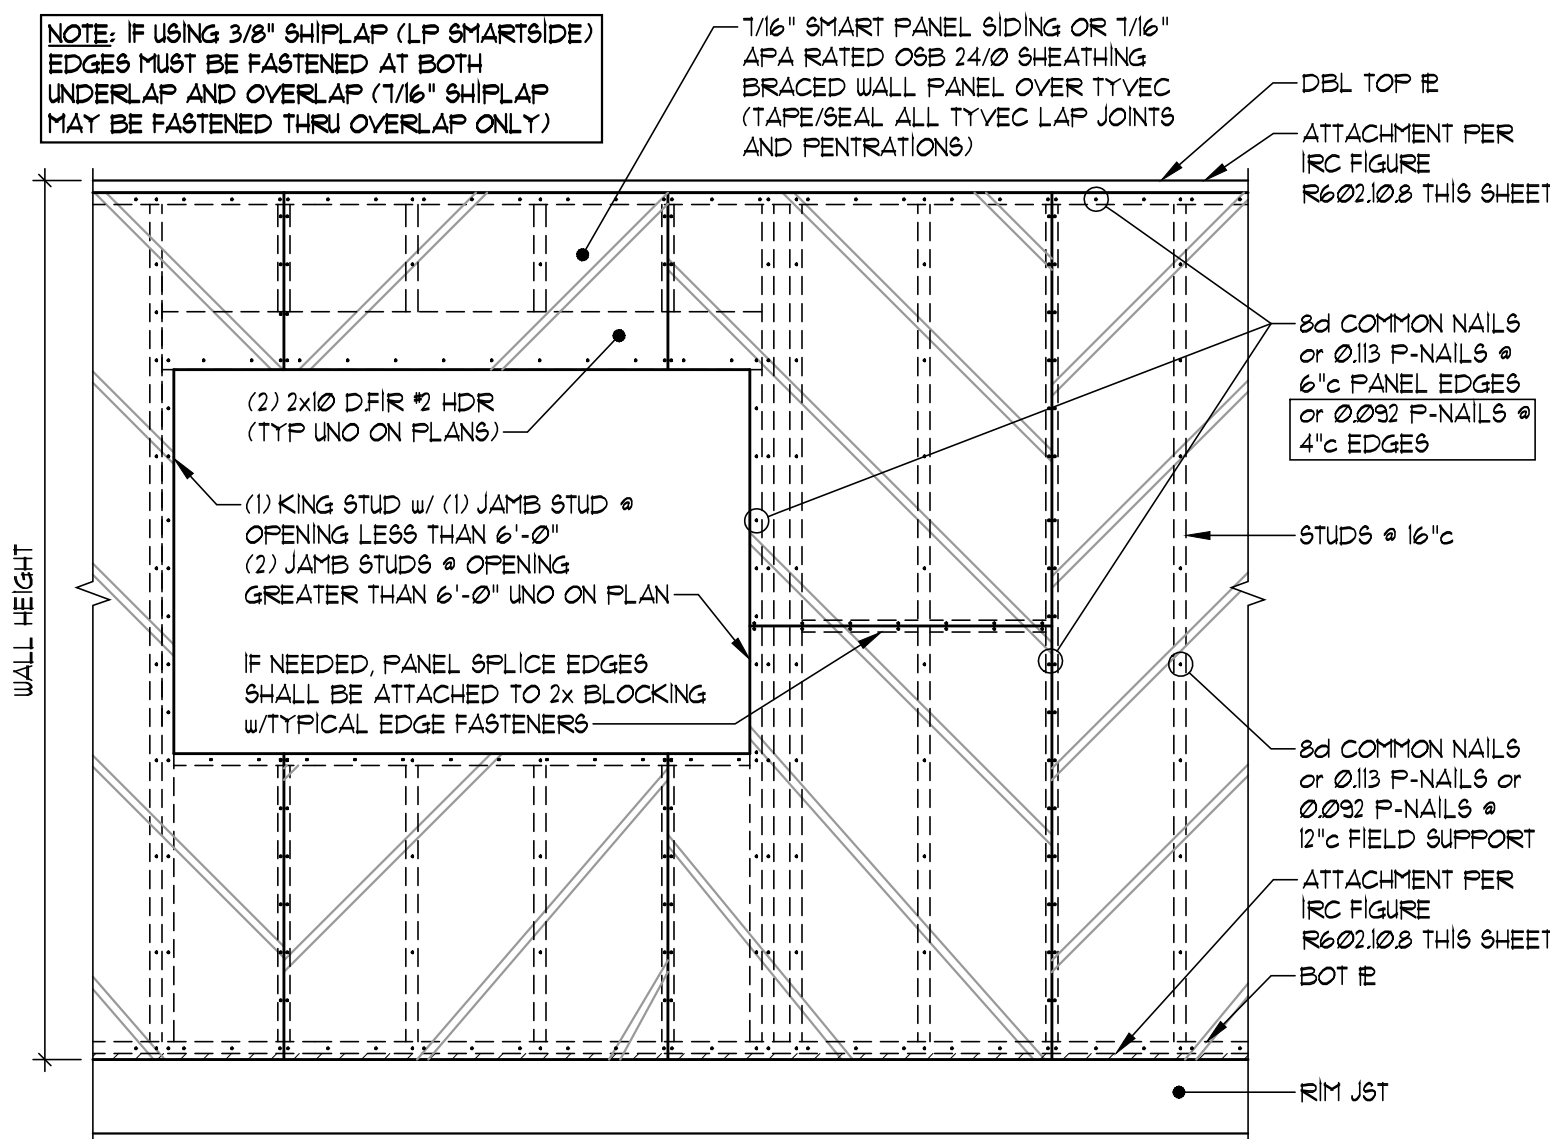


TYPICAL EXTERIOR SHEATHING
INSTALLATION (METHOD WSP & CS-WSP)
SCALE: 1/2" = 1'-0"

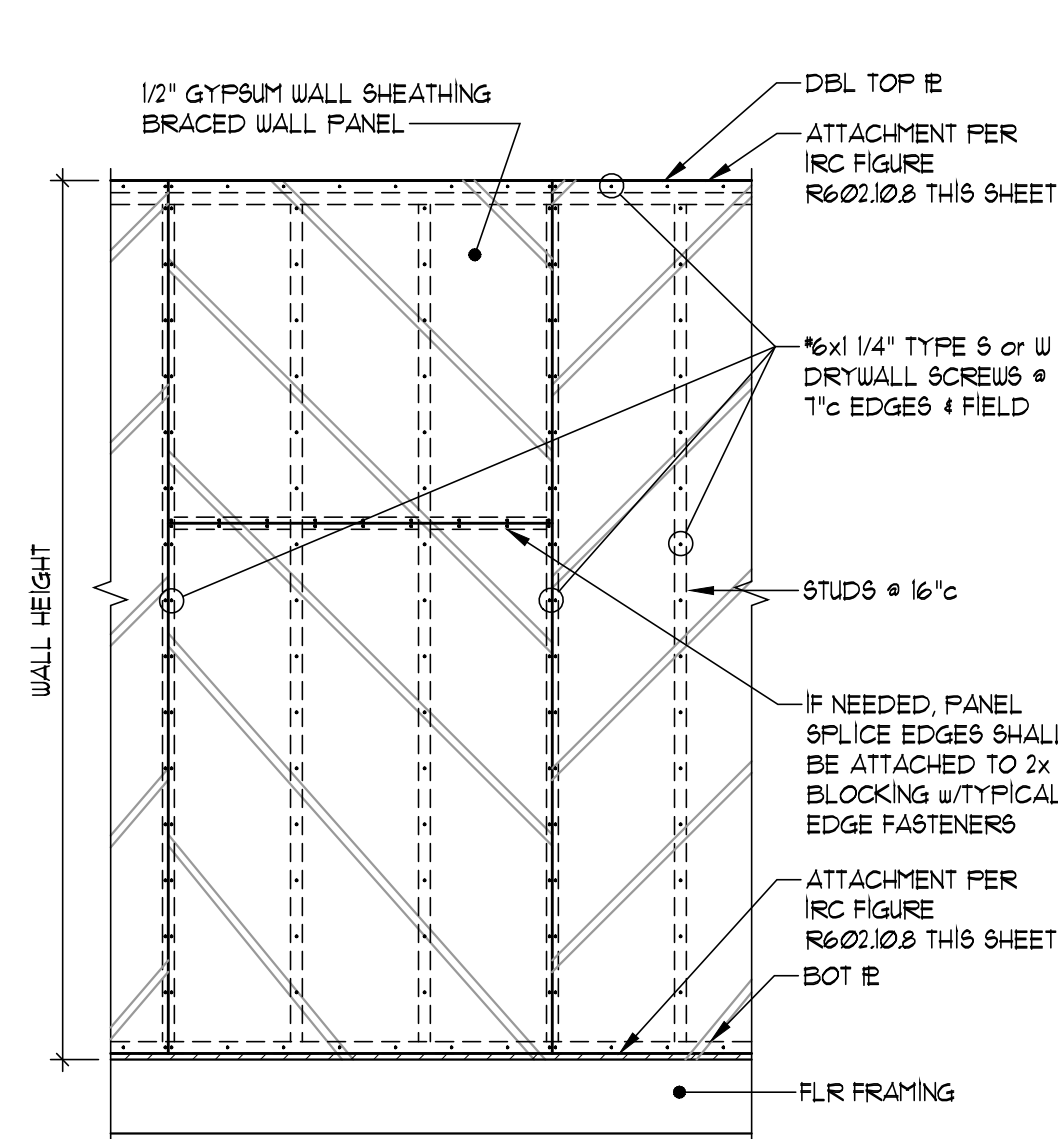


TYPICAL INTERIOR SHEATHING
INSTALLATION (METHOD GB)
SCALE: 1/2" = 1'-0"

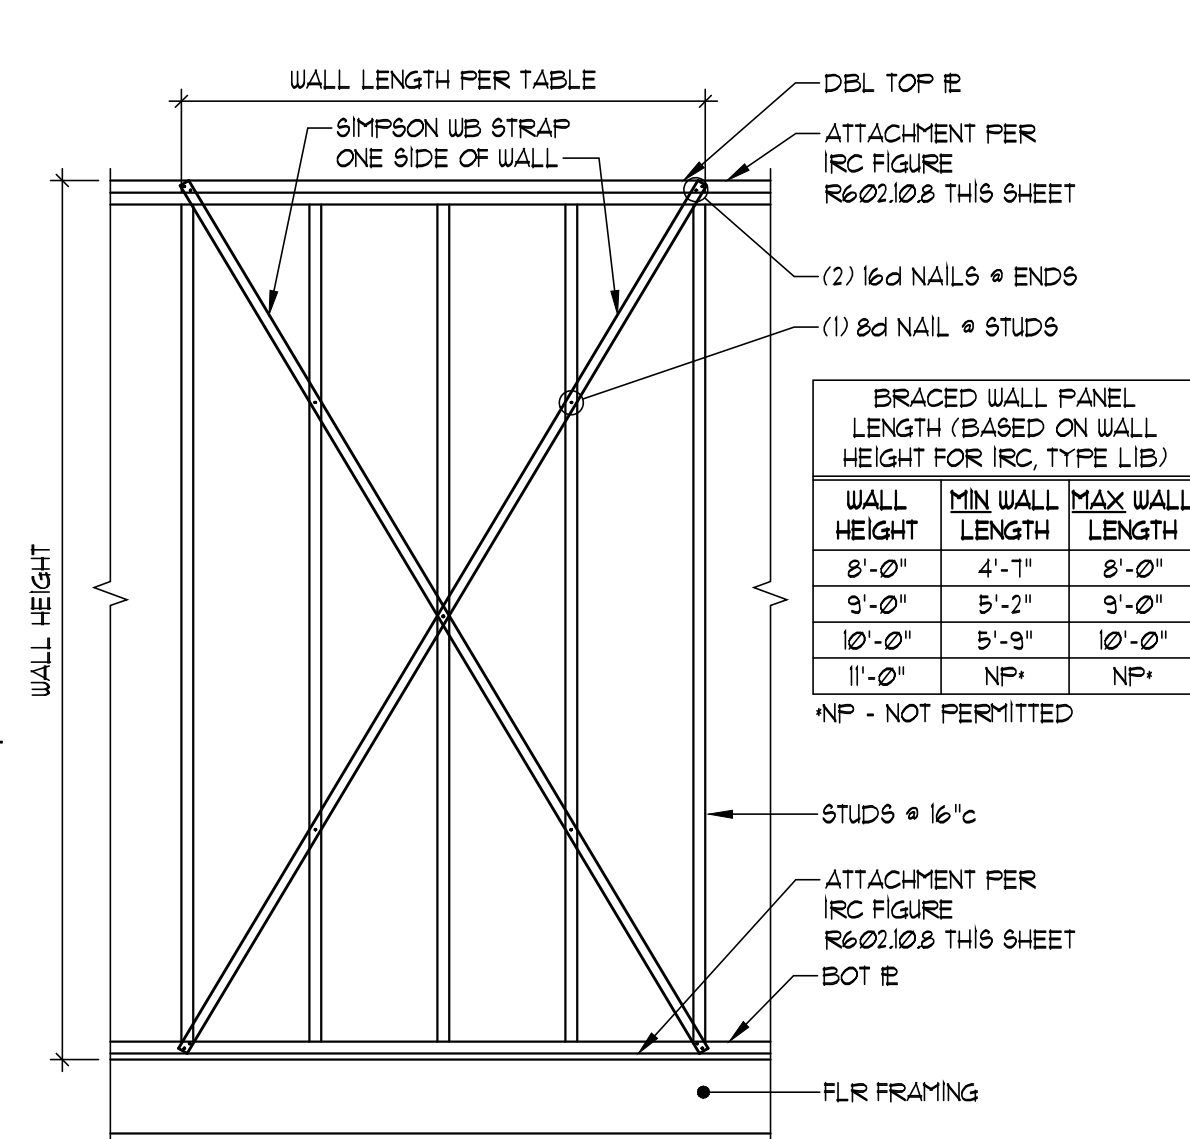


INTERIOR SHEATHING
INSTALLATION (METHOD LIB)
SCALE: 1/2" = 1'-0"

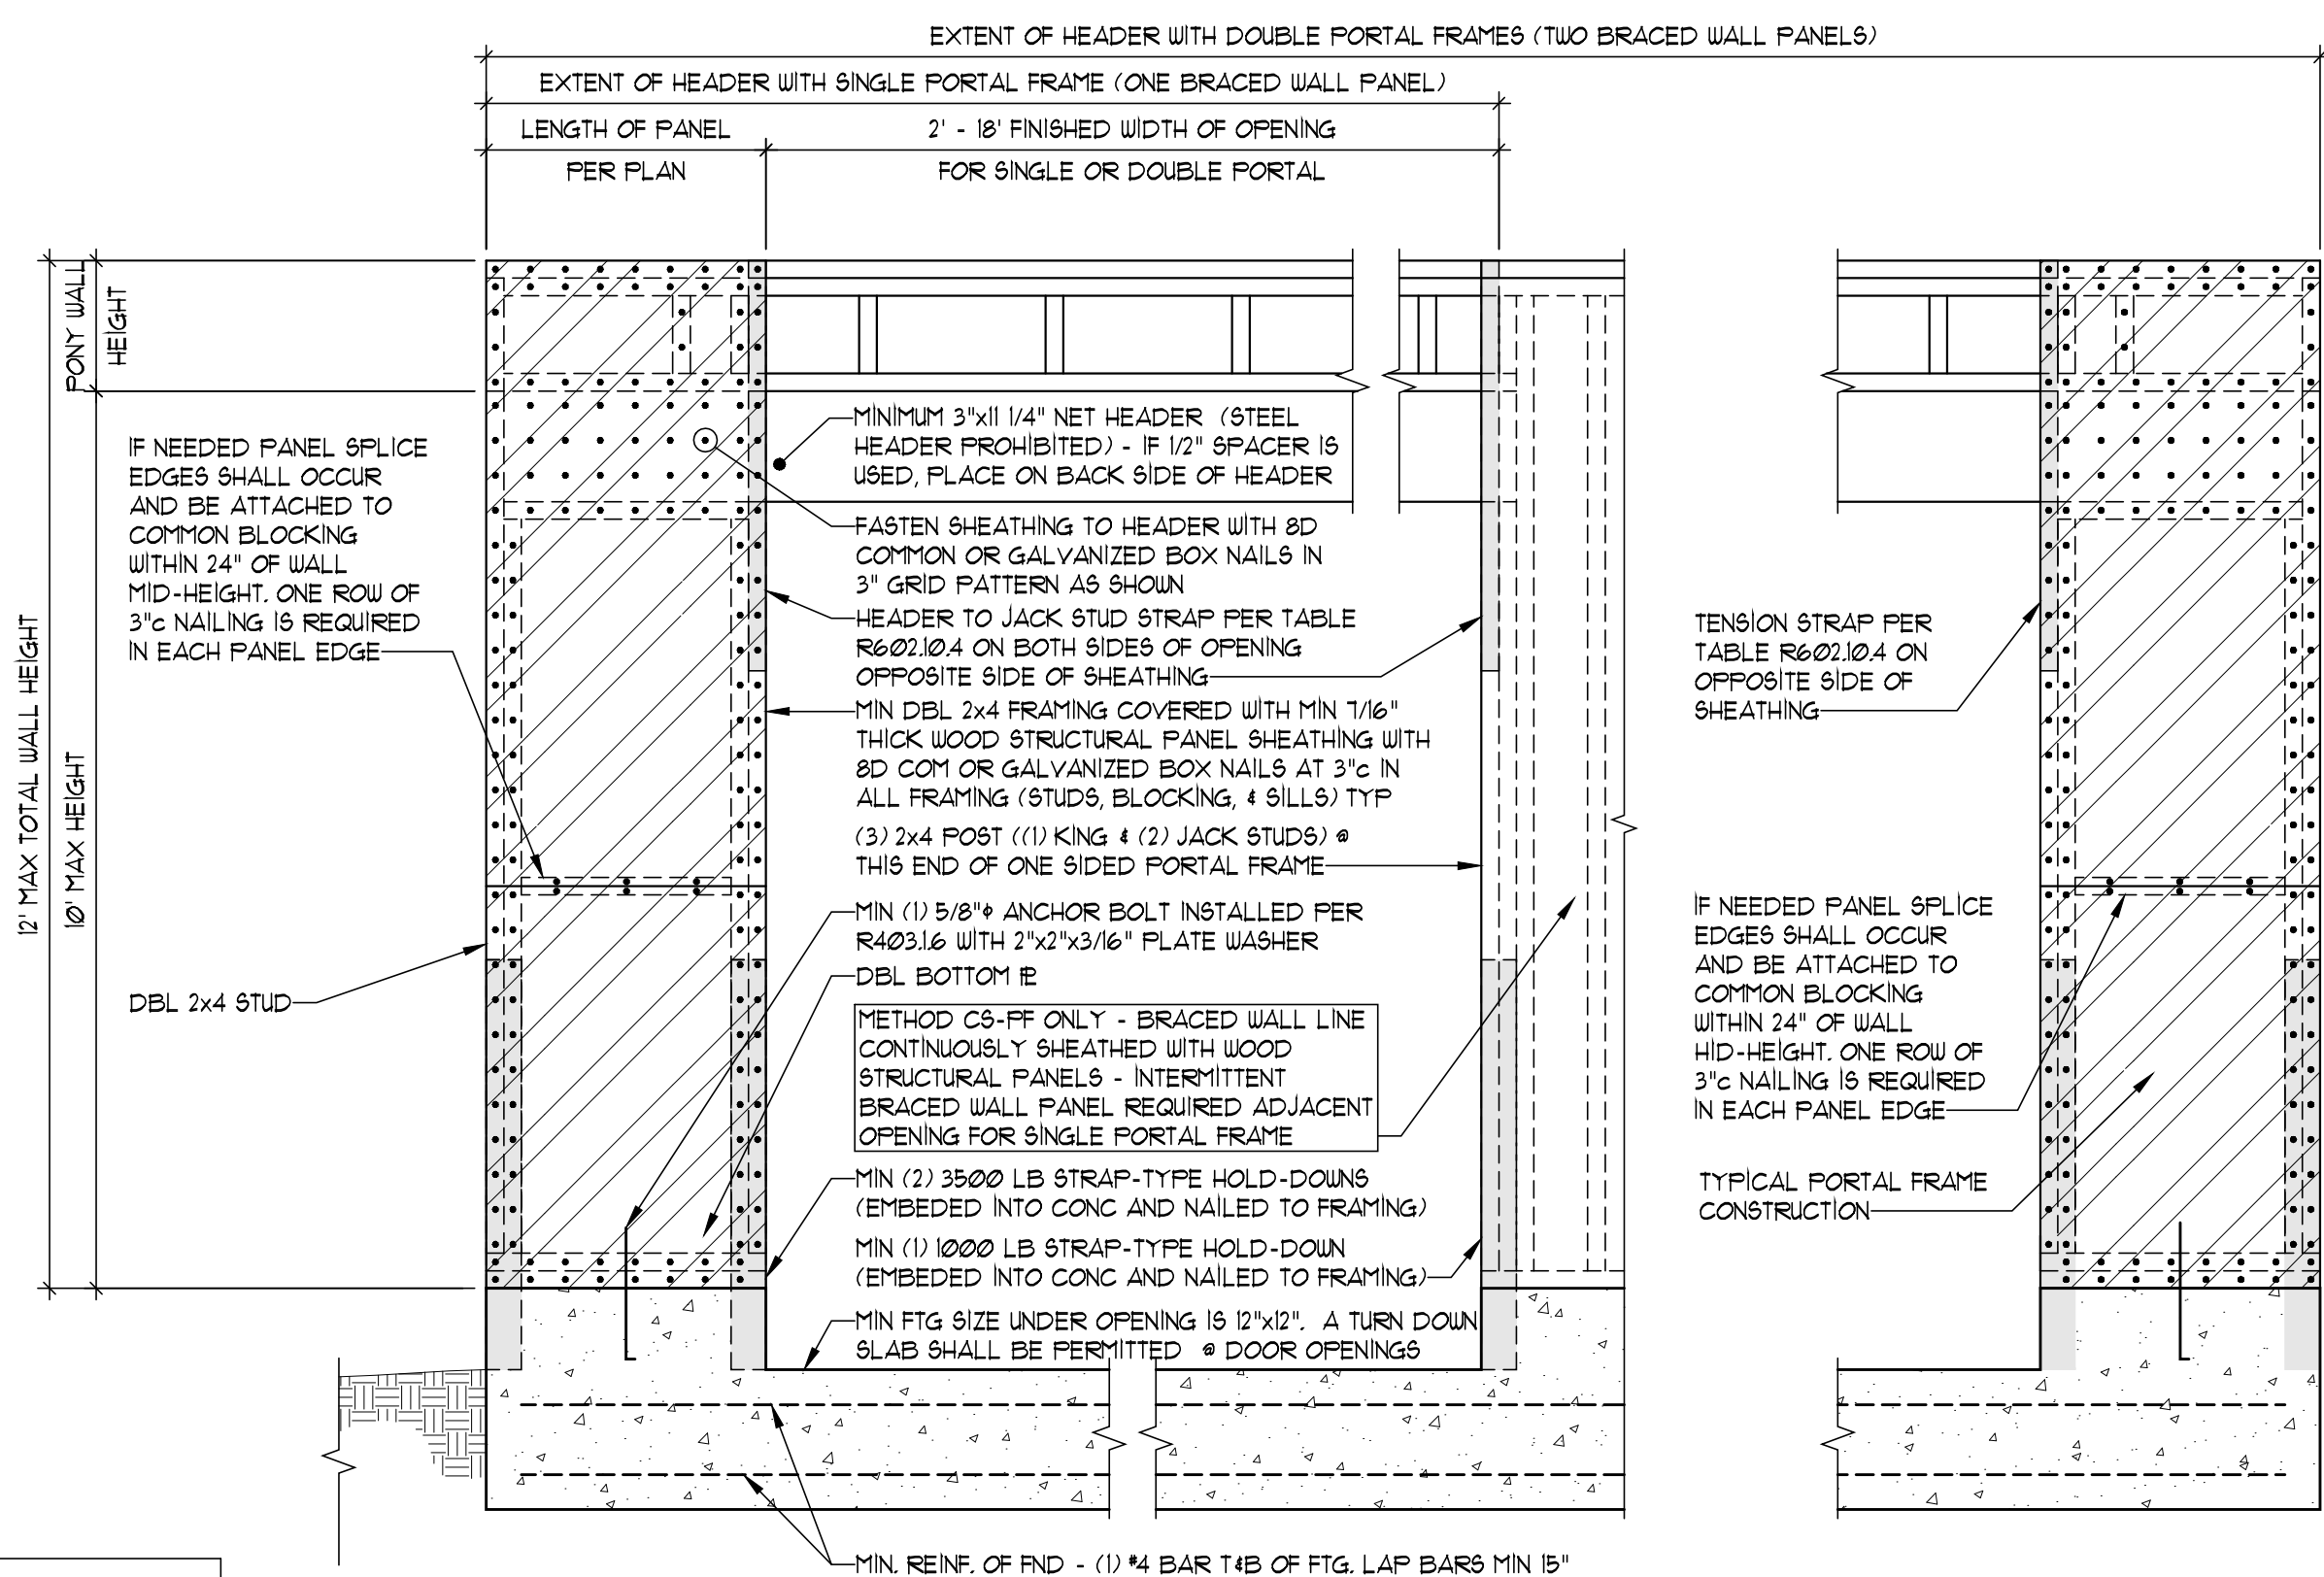


BRACED WALL METHOD "PFH" (also HEADER ATTACHMENT FOR CS-PF)
SCALE: 3/4" = 1'-0"

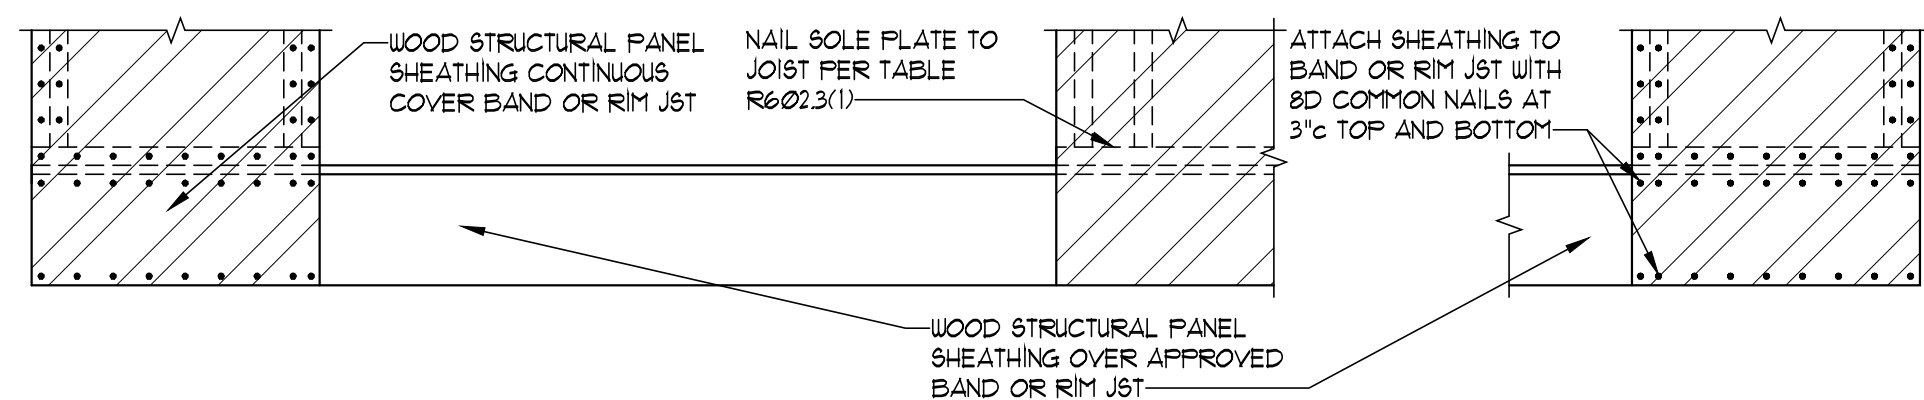

BRACED WALL METHOD "CS-PF" (ATTACHMENT TO WOOD FLOOR)
(REFER TO BRACED WALL METHOD "PFH" FOR HEADER ATTACH)
SCALE: 3/4" = 1'-0"

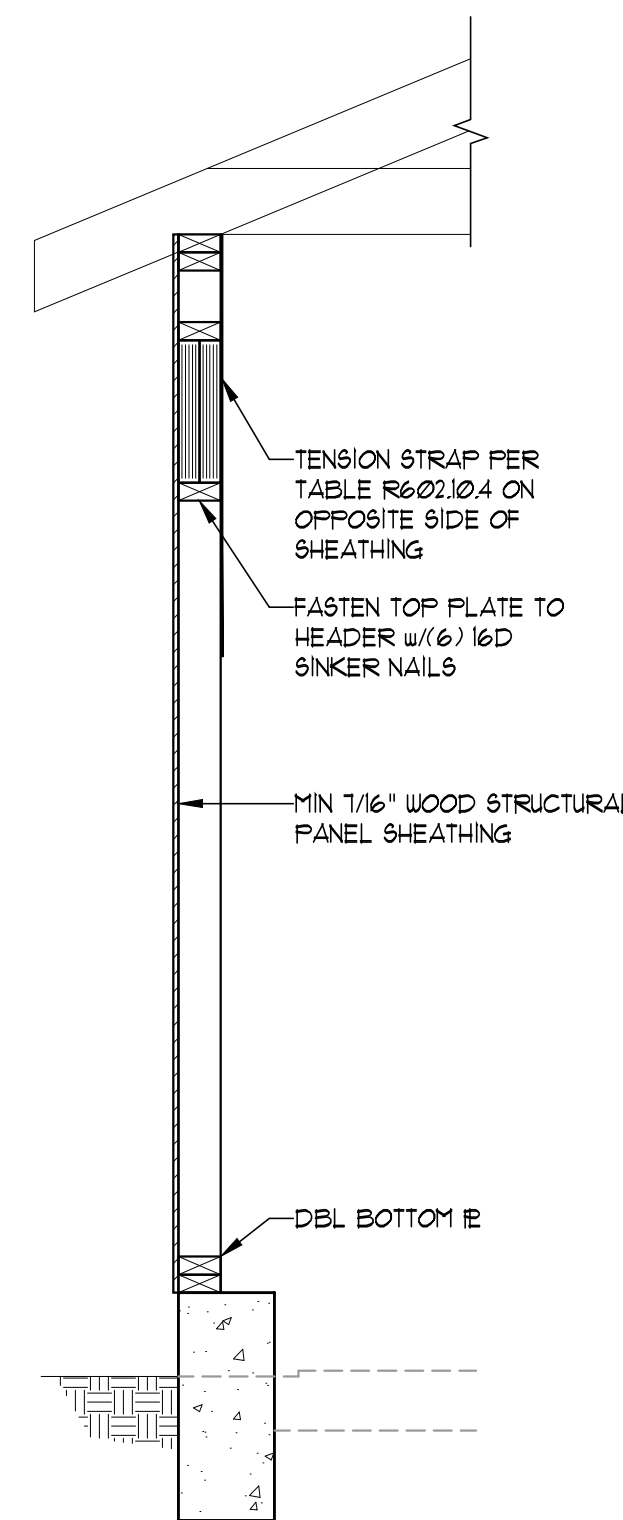

SECTION

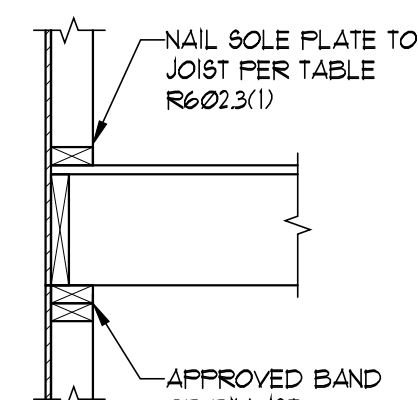

SECTION



© COPYRIGHT 2023

JFE CONSTRUCTION INC.
1314 SW Market Street
Lee's Summit, MO 64081
v: 816.786.4008
jfeconstruction.com



Van Deuren and Associates, P.A. © 2023



Project #: 8083-XXXX

DATE:

Permit: 12/7/2023

STRUCTURAL DETAILS FOR:
THE BAYBERRY
Anita Cox Family
2210 NW Killarney Ln, Lee's Summit, MO
Lot 185 - Woodside Ridge

S3