

1 DEMOLITION PLAN
1/4"=1'-0"

DEMOLITION GENERAL NOTES

- THROUGHOUT AREA OF WORK WHERE NEW FLOOR FINISHES ARE INDICATED ON THE INTERIOR FINISH SCHEDULE, REMOVE AND DISCARD EXISTING FLOORING AND WALL BASE. REMOVAL IS TO INCLUDE THE REMOVAL OF FLOORING ADHESIVES AND MASTICS AS REQUIRED TO MEET THE INSTALLATION REQUIREMENTS FOR THE NEW FLOORING TO BE PLACED.
- THROUGHOUT AREA OF WORK WHERE CEILING IS NOT INDICATED AS EXISTING TO REMAIN PER DEMOLITION PLAN NOTE D07, REMOVE AND DISCARD ANY REMAINING EXPOSED T-GRID, ACOUSTICAL CEILING TILES.
- THROUGHOUT AREA OF WORK REMOVE AND DISCARD ALL UNUSED ELECTRICAL OUTLETS AND SIMILAR DEVICES EXCEPT AT EXISTING TO REMAIN WALL LOCATIONS. REMOVE AND DISCARD ALL LIGHT FIXTURES. REMOVE AND DISCARD ALL UNUSED CONDUIT AND WIRE BACK TO ELECTRICAL SERVICE.
- THROUGHOUT AREA OF WORK REMOVE AND DISCARD ALL UNUSED GAS LINES AND EQUIPMENT.

DEMOLITION PLAN NOTES

- D01 REMOVE AND DISCARD GYPSUM BOARD PARTITION AND WALL FRAMING.
- D02 REMOVE AND DISCARD MASONRY WALL. PRIOR TO REMOVE CONFIRM WITH STRUCTURAL ENGINEER IF WALL IS USED IN RESISTING ANY BUILDING LOADS, INCLUDING BUT NOT LIMITED TO LOAD BEARING AND LATERAL RESISTANCE.
- D03 REMOVE AND DISCARD DOOR FRAME AND HARDWARE
- D04 EXISTING ELECTRICAL TO BE UPDATED. REFER TO ELECTRICAL DRAWINGS FOR MORE INFORMATION. REMOVE AND DISCARD ANY UNUSED EQUIPMENT.
- D05 REMOVE AND DISCARD PLUMBING FIXTURES. REMOVE AND DISCARD UNUSED SUPPLY LINES BACK TO MAIN LINE AND CAP. REMOVE AND DISCARD UNUSED WASTE LINES BEYOND FINISHED SURFACES AND CAP. PATCH AND REPAIR EXISTING SURFACES TO MATCH EXISTING.
- D06 REMOVE AND DISCARD BULKHEAD STRUCTURE. REMOVE AND DISCARD UNUSED SUPPLY LINES BACK TO BELOW FINISHED SURFACES AND CAP. REMOVE AND DISCARD UNUSED WASTE LINES BEYOND FINISHED SURFACES AND CAP. PATCH AND REPAIR EXISTING SURFACES TO MATCH EXISTING.
- D07 EXISTING TO REMAIN ACOUSTICAL CEILING SYSTEM AND DIFFUSERS IN THIS ROOM OR AREA.
- D08 EXISTING TO REMAIN PLUMBING FIXTURES.
- D09 REMOVE AND SALVAGE WATER HEATER.
- D10 EXISTING WATER SERVICE TO BE RELOCATED. REFER TO PLUMBING DRAWINGS FOR MORE INFORMATION. REMOVE UNUSED LINES BELOW FINISH SURFACES AND CAP. PATCH AND REPAIR EXISTING SURFACES TO MATCH EXISTING.



01/11/2024

GUY GRONBERG
ARCHITECTS, P.C.
113 SE 24th St.
Lee's Summit, MO 64063
Phone: 816.524.0970
Fax: 816.524.0570

SOUTHSIDE PLAZA
404 Southwest
Nichols Street
Lee's Summit
Missouri, 64063

Snappy Clean
LAUNDRY LLC

This drawing has been provided as an instrument of service by the architect, or its duly authorized representative, and its use on this project only. It is not to be used for any other project, in whole or in part, without the written consent of the architect. The architect assumes no responsibility for the accuracy or completeness of the information provided herein, or for the results of the construction of the project, or for the safety of the project, or for the performance of the project, or for the results of the construction of the project, or for the safety of the project, or for the performance of the project.

© COPYRIGHT 2024 GUY GRONBERG ARCHITECTS, P.C.

REV#	DATE	DESCRIPTION

Issue Date: 01-11-24
Project #: 23033

**GUY GRONBERG
ARCHITECTS, P.C.**

113 SE 3rd St.
Lee's Summit, MO 64063
Phone 816.524.0970
Fax 816.524.9970

G²

--

Snappy Clean

LAUNDRY LLC

REV#	DATE		DESCRIPTION
Issue Date:			01-11-24
Project #:			23033

CEILING PLAN

A4



8'-0"

ELEVATION OF CEILING ABOVE FINISHED FLOOR.

EXISTING TO REMAIN EXPOSED T' GRID CEILING AND ACOUSTICAL CEILING TILES. REMOVE AND REPLACE ANY DAMAGED OR STAINED CEILING TILES WITH NEW TO MATCH EXISTING.

24"x48" FIGURED TEGULAR TILE ON 15/16" EXPOSED T' GRID

PANT EXPOSED WOOD JOISTS, BEAMS, CONDUITS, DUCTWORK ETC.

SOFFIT OR CEILING OF ONE LAYER OF 5/8" GYP. BD. ON EXPOSED SIDES METAL OR WOOD STUD FRAMING. FINISH AND PAINT GYPSUM BOARD

EXPOSED TO STRUCTURE ABOVE - NO WORK

C01 WRAP AND FINISH GYPSUM BOARD ON BOTTOM OF FRAMING FROM LAUNDROMAT SIDE, ACROSS BOTTOM AND EXTEND UP 6" MINIMUM ON SERVICE SIDE. BOTTOM OF GYPSUM BOARD TO BE 1/2" ABOVE TOP OF DRYER UNITS - ELEVATION VARIES.

MECHANICAL SPECIFICATIONS (CONTINUED)

- SANITARY SEWER AND VENTING**
(ABOVE GROUND, INTERIOR TO THE BUILDING)

 - 1) ABS PIPE AND FITTINGS, ABS PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS" FOR PLASTIC PIPING COMPONENTS. INCLUDE MARKING WITH "NSF DNV" FOR PLASTIC DRAIN, WASTE, AND VENT PIPING AND "NSF-SEWER" FOR PLASTIC SEWER PIPING. SOLID-WALL ABS PIPE ASTM D 2661, SCHEDULE 40; CELLULAR-CORE ABS PIPE ASTM F 628, SCHEDULE 40/ABS COCKSOT FITTINGS ASTM D 2661, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS, SOLVENT CEMENT, ASTM D 2225.
 - NOT FOR USE IN A RETURN AIR PLenum
 - 2) PVC PIPE AND FITTINGS, PVC PIPE AND FITTINGS SHALL COMPLY WITH NSF 14, "PLASTICS PIPING SYSTEMS COMPONENTS AND RELATED MATERIALS" FOR PLASTIC PIPING COMPONENTS. INCLUDE MARKING WITH "NSF DNV" FOR PLASTIC DRAIN, WASTE, AND VENT PIPING AND "NSF-SEWER" FOR PLASTIC SEWER PIPING. SOLID-WALL PVC PIPE ASTM D 2665, DRAIN, CELLULAR-CORE PVC PIPE, ASTM F 891, SCHEDULE 40, WASTE, AND VENT PVC COCKSOT FITTINGS, ASTM D 2665, MADE TO ASTM D 3311, DRAIN, WASTE, AND VENT PATTERNS AND TO FIT SCHEDULE 40 PVC PIPE. ADHESIVE PRIMER, ASTM F 666, SOLVENT CEMENT, ASTM D 2664, NOT FOR USE IN A RETURN AIR PLenum
 - 3) HUBLESS CAST IRON SOIL PIPE AND FITTINGS: HUBLESS CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON SHALL CONFORM TO ARI 188 AND ARI 301 TYPE STANDARD 301. HUBLESS COUPLINGS SHALL CONFORM TO CIP 1 STANDARD 310 AND BE CERTIFIED BY NSF INTERNATIONAL.
 - 4) HUB AND SPOCKET CAST IRON SOIL PIPE AND FITTINGS: HUB AND SPOCKET CAST IRON PIPE AND FITTINGS SHALL BE MANUFACTURED FROM GRAY CAST IRON AND SHALL CONFORM TO ASTM A 174.

F. INDIRECT WASTE (ABOVEGROUND)

 - 1) POLYVINYLCHLORIDE (PVC) DWN PIPE, SCHEDULE 40, SOLVENT JOINT (INDIRECT WASTE).
 - 2) DWN, WROUGHT COPPER, ANSI B-16.29 (WATER HEATER T&P)

G. NATURAL GAS

 - 1) BLACK STEEL PIPE, SCHEDULE 40, ASTM A53.
 - a) PIPE 3" & SMALLER, 150 LB. MALLEABLE IRON, THREADED FITTINGS.
 - b) PIPE 4" AND SMALLER, VESGA MEGAPRESS D50 FOR WATER AND GAS, CSA LCA, TSSA/MSSE B31 FOR USE WITH ASTM A53 SCHEDULE 40 BLACK IRON PIPE.
 - c) PIPE 2-1/2" AND LARGER, WELDED.
 - 2) PLUG VALVE, ROCKWELL NORSTROM FIGURE NO. 1420R 143.
 - 3) BALL VALVE, JOMAR 1-TONE, APPROVALS-UB&G, FM, CSA, NSF B-61, MSS SP-110.

2) GAS PIPING PAINTING:

 - a) ALL BLACK STEEL GAS PIPING LOCATED EXTERIOR TO THE BUILDING SHALL BE PRIMED AND PAINTED TO EITHER MATCH ADJACENT EXTERIOR WHERE LOCATED OR ON NEAR EXTERIOR WALL AND PAINTED SPACING YELLOW WHERE LOCATED ON THE ROOF.

H. ALL PIPE HANGERS AND SUPPORTS SHALL BE STANDARD PRODUCTS OF GRANNEL, FEE AND MASON, OR ELDEX. HANGER SPACING SHALL BE IN ACCORDANCE WITH MSS-SP-69.

I. SLEEVES

 - 1) PROVIDE, SET, AND PROPERLY LOCATE PIPE SLEEVES AS REQUIRED FOR THIS WORK. ALL SLEEVES SHALL BE OF SUFFICIENT SIZE TO PERMIT PIPE MOVEMENT DUE TO EXPANSION AND CONTRACTION AND TO ACCOMMODATE PIPE INSULATION.
 - 2) INTERIOR PARTITIONS: 16 GAGE GALVANIZED STEEL, PACK BETWEEN PIPE AND SLEEVE WITH FIRE SAVING AND CAULK AT EACH END WITH FIRE RESISTANT SEALANT.
 - 3) ROOF, INSET OR EQUAL, MANUFACTURED PVC SCHEDULE 40 PIPE SLEEVE WITH WATERPROOF SEAL COORDINATING WITH ROOFING CONTRACTOR AND FLASH AS REQUIRED TO MAINTAIN ROOF WARRANTY.
 - 4) PROTECTION AGAINST CONTACT: METALLIC PIPING, EXCEPT FOR CAST IRON, DUCTILE IRON AND GALVANIZED STEEL, SHALL NOT BE PLACED IN DIRECT CONTACT WITH STEEL FRAMING MEMBERS, CONCRETE, OR CONCRETE WALLS OR OTHER MATERIALS. METALLIC PIPING SHALL NOT BE PLACED IN DIRECT CONTACT WITH CORROSION SALT SHEATHING USED TO PREVENT DIRECT CONTACT. SHALL HAVE A THICKNESS OF GREATER THAN .008. AND THE SLEEVING SHALL BE MADE OF PLASTIC, ANY PIPE THAT PASSES THROUGH A FOUNDATION WALL OR FOOTING SHALL BE PROVIDED WITH A RELAYING ARCH OR A PIPE SLEEVE SHALL BE BUILT INTO THE FOUNDATION WALL. THE SLEEVE SHALL BE TWO TIMES GREATER THAN THE PIPE PASSING THROUGH THE WALL OR FOOTING.
 - 5) PLUMBING VENTS: FLASH ROOF UP TO ROOFING SYSTEM AS REQUIRED BY THE ROOFING CONTRACTOR TO MAINTAIN EXISTING ROOF WARRANTY. ALL PLUMBING VENT TERMINALS SHALL BE TERMINATE A MINIMUM OF 17" ABOVE ROOF OR EQUAL TO HEIGHT OF PARAPET, WHICHEVER IS GREATER.

J. PROVIDE CHROME PLATED DISC/SCRECHONS ON ALL PIPE ENTERING FINISHED AREAS.

8. WATER HEATERS

 - A. COMMERCIAL, HIGH EFFICIENCY, DIRECT-VENT, GAS-FIRED, STORAGE, DOMESTIC-WATER HEATERS:
 - 1. STANDARD: ANSI Z21.1 10.3C5A.3.
 - 2. DESCRIPTION: MANUFACTURER'S PROPRIETARY DESIGN TO PROVIDE AT LEAST 95 PERCENT COMBUSTION EFFICIENCY AT OPTIMUM OPERATING CONDITIONS STORAGE TANK CONSTRUCTION: STEEL.
 - a. PRESSURE RATING: 150 PSIG
 - b. INTERIOR FINISH: COMPLY WITH NSF 61 AND NSF 372 BARRIER MATERIALS FOR POTABLE-WATER TANK LININGS, INCLUDING EXTENDING LINING MATERIAL INTO TAPINGS.
 3. FACTORY-INSTALLED STORAGE-TANK APPURTENANCES:
 - a. ANODE ROD: REPLACEABLE MAGNESIUM.
 - b. DIP TUBE: REQUIRED UNLESS COLD-WATER INLET IS NEAR BOTTOM OF TANK.
 - c. DRAIN VALVE: CORROSION-RESISTANT METAL WITH HOSE-END CONNECTION.
 - d. INSULATION: COMPLY WITH ASHRAES 90.1.
 - e. JACKET: STEEL WITH ENAMELED FINISH.
 - f. HEAT-TRAP FITTINGS: INLET TYPE T-COLD-WATER INLET AND OUTLET TYPE T-HOT-WATER OUTLET.
 - g. BURNER: FOR USE WITH DIRECT-VENT, GAS-FIRED, DOMESTIC-WATER HEATERS AND NATURAL-GAS FUEL.
 - h. IGNITION: STANDING PILOT OR ANSI Z21.20/CSA C22.2 NO. 60730-2.5, ELECTRIC, AUTOMATIC, GAS-IGNITION SYSTEM.
 - i. TEMPERATURE CONTROL: ADJUSTABLE THERMOSTAT.
 4. COMBINATION TEMPERATURE AND PRESSURE RELIEF VALVE: ANSI RELIEF CAPACITY AT LEAST AS GREAT AS HEAT INPUT, AND INCLUDE PRESSURE SETTING LESS THAN WORKING-PRESSURE RATING OF DOMESTIC-WATER HEATER. SELECT RELIEF VALVE WITH SENSING ELEMENT THAT EXTENDS INTO STORAGE TANK.
 5. DIRECT-VENT SYSTEM: THROUGH-ROOF OR WALL, COAXIAL, OR DOUBLE-CHANNEL VENT ASSEMBLY WITH DOMESTIC-WATER HEATER MANUFACTURERS' OUTSIDE INTAKE/EXHAUST SCREEN.

B. DOMESTIC-WATER EXPANSION TANKS:

 1. DESCRIPTION: STEEL, PRESSURE-RATED TANK CONSTRUCTED WITH WELDED JOINTS AND FACTORY-INSTALLED, BUTYL-RUBBER DIAPHRAGM. INCLUDE AIR-PRE-CHARGE TO MINIMUM SYSTEM-OPERATING PRESSURE AT TANK.
 2. CONSTRUCTION:
 - a. TAPINGS: FACTORY-FABRICATED STEEL, WELDED TO TANK BEFORE TESTING AND LABELING. INCLUDE ASME B 1.20.1 PIPE THREAD.
 - b. INTERIOR FINISH: COMPLY WITH NSF 61 AND NSF 372 BARRIER MATERIALS FOR POTABLE-WATER TANK LININGS, INCLUDING EXTENDING FINISH INTO AND THROUGH TANK FITTINGS AND OUTLETS.
 - c. AIR-CHARGING VALVE: FACTORY INSTALLED.
 3. CAPACITY AND CHARACTERISTICS:
 - a. WORKING PRESSURE RATING: 150 PSIG.

9. INSULATION AND DUCT LINING:

 - A. ALL INSULATIONS AND ACCESSORIES SHALL HAVE A FIRE HAZARD CLASSIFICATION WITH A FLAME SPREAD RATING OF NOT OVER 25, A FUEL CONTRIBUTION RATING OF NOT OVER 50, AND A SMOKE DEVELOPMENT RATING OF NOT OVER 50, IN ACCORDANCE WITH NFPA.
 - B. PIPE INSULATION - ABOVE GRADE:
 - 1) THE PIPING INSULATION USED SHALL HAVE A THERMAL CONDUCTIVITY OF 0.27 Bu Per (in*in*sqft°F) OR LESS.
 - 2) FIBERGLASS INSULATION WITH FACTORY APPLIED VAPOR BARRIER, AS JACKET, FACTORY APPLIED PRESSURE SEALING LONGITUDE LAP JOINT, NO STAPLES, ZESTON PREMOULDED PFC FITTING COVERS. INSTALLATION SHALL BE IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
 - 3) FLEXIBLE CLOSED CELL ELASTOMERIC THERMAL INSULATION UNITS OR RESULT WITH PRESURE SENSITIVE ADHESIVE SYSTEM FOR CLOSURE AND VAPOR SEALING, EQUEL, WATER EXEL-TUBE OR EQUEL, RATED FOR UNDERGROUND INSTALLATION ABOVE THE WATER TABLE. COVER PIPING WITH A CLEAN FLAT, SUCH AS SAND, 2" LAYERS TO PROTECT INSULATION FROM COMPACTION.
 - 3) PRE INSULATED PIPE SYSTEMS WITH CLOSED CELL, PEX-FORM INSULATION AND COVERED BY A WATERPROOF CORRUGATED HDPE JACKET, UPONOR EXCEL OR EQUEL, ASTM F837, F838, CSA B137.3.
 - C. INSULATION SCHEDULE:
 - a) DOMESTIC COLD WATER 1-1/2"
 - b) DOMESTIC HOT WATER 1"
 - c) HOT WATER RECIRCULATING 1"
 - D. PIPE INSULATION - BELOW GRADE:
 - 1) THE PIPING INSULATION USED SHALL HAVE A THERMAL CONDUCTIVITY OF 0.27 Bu Per (in*in*sqft°F) OR LESS.
 - 2) FLEXIBLE CLOSED CELL ELASTOMERIC THERMAL INSULATION UNITS OR RESULT WITH PRESURE SENSITIVE ADHESIVE SYSTEM FOR CLOSURE AND VAPOR SEALING, EQUEL, WATER EXEL-TUBE OR EQUEL, RATED FOR UNDERGROUND INSTALLATION ABOVE THE WATER TABLE. COVER PIPING WITH A CLEAN FLAT, SUCH AS SAND, 2" LAYERS TO PROTECT INSULATION FROM COMPACTION.
 - 3) PRE INSULATED PIPE SYSTEMS WITH CLOSED CELL, PEX-FORM INSULATION AND COVERED BY A WATERPROOF CORRUGATED HDPE JACKET, UPONOR EXCEL OR EQUEL, ASTM F837, F838, CSA B137.3.
 - E. INSULATION SCHEDULE:
 - a) DOMESTIC HOT WATER 1-1/2"

D. EQUIPMENT INSULATION:

 - 1) FLEXIBLE FIBERGLASS, GLASS FIBER INSULATION, ASTM C 552, TYPE 1, CLASS B-4, SEMI-RIGID BOARD, WITH FACTORY LAMINATED DRAFT ALUMINUM FOIL, ALL SERVICE JACKET, VAPOR BARRIER, OVENSCORNER PIPE AND TANK INSULATION.

E. DUCTWORK: ACOUSTICAL INSULATION

 - 1) DUCT LINING: 2 LB/CF THICKNESS AS SCHEDULED, AIR STREAM SIDE CEATED, INSTALL PER SMACNA STANDARDS.
 - a) DUCT LINING SCHEDULE:
 - (1) RECTANGULAR SUPPLY DUCT 12" - THROUGHOUT THE FIRST 10 FEET OF DUCT.
 - (2) RETURN AIR DUCT 12" - THROUGHOUT THE FIRST 10 FEET OF DUCT.

F. DUCTWORK: THERMAL INSULATION

 - 1) DUCT COVERING: 34 LB/CF, FIBERGLASS BLANKET WITH FACTORY APPLIED VAPOR BARRIER AND FLASH, THICKNESS AS SCHEDULED, INSTALLATION IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
 - a) DUCT COVERING SCHEDULE: MINIMUM R-6
 - (1) ROUND SUPPLY DUCT Z" (WHERE CONCEALED BY CEILING)
 - (2) RECTANGULAR SUPPLY DUCT Z" (WHERE CONCEALED BY CEILING)
 - (3) OUTDOOR AIR Z"

- REMODELING WORK
- A. DEMOLITION: DISCONNECT, DEMOLISH, AND REMOVE ABANDONED MECHANICAL MATERIALS AND EQUIPMENT INDICATED TO BE REMOVED AND NOT INDICATED TO BE SALVAGED OR REMAIN.
- B. EQUIPMENT TO BE SALVAGED:
- 1) DISCONNECT AND REMOVE, EXISTING MECHANICAL EQUIPMENT INDICATED TO BE REMOVED AND SALVAGED. DELIVER EQUIPMENT TO THE LOCATION DESIGNATED BY THE OWNER FOR STORAGE.
- 2) ALL MATERIALS AND EQUIPMENT DESIGNATED TO BE REUSED OR RELOCATED SHALL BE CAREFULLY REMOVED, AND STORED UNTIL NEEDED FOR REMODELING WORK. ALL ITEMS SHALL BE RESTORED TO "LIKE NEW" CONDITION WITH RUST OR CORROSION REMOVED, SURFACE PAINT TOUCHED UP OR REPAINTED AS REQUIRED TO MATCH NEW CONSTRUCTION, AND THOROUGHLY CLEANED AND INSPECTED. ANY ITEMS WHICH BECOME DAMAGED BEYOND REPAIR AS A RESULT OF CONSTRUCTION OR DEMOLITION ACTIVITY SHALL BE REPLACED WITH NEW MATERIAL EQUIVALENT IN EVERY RESPECT.
- C. DISPOSAL AND CLEANUP: REMOVE FROM THE SITE AND LEGALLY DISPOSE OF DEMOLISHED MATERIALS AND EQUIPMENT NOT INDICATED TO BE SALVAGED.
- D. PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE BARRIERS TO KEEP DIRT, DUST, AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER REMODELING OPERATIONS ARE COMPLETE.
- E. LOCATE, IDENTIFY, AND PROTECT MECHANICAL SERVICES PASSING THROUGH REMODELING AREA AND SERVING OTHER AREAS OUTSIDE THE REMODELING LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE REMODELING LIMITS. WHERE MECHANICAL SERVICES ARE LOCATED IN A WALL, ETC. TO BE DEMOLISHED, REROUTE PIPING TO NEW OR EXISTING CONSTRUCTION TO MAINTAIN CONTINUITY OF THE SYSTEM. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
- F. REMOVE ALL PIPING TO BE DEMOLISHED BACK TO PIPE MAIN OR EDGE OF PROJECT AREA, AND CAP PIPE.
- G. PIPING AND DUCTS EMBEDDED IN FLOORS, WALLS, AND CEILINGS MAY REMAIN IF SUCH MATERIALS DO NOT INTERFERE WITH NEW INSTALLATIONS. PIPING AND DUCTS TO REMAIN SHALL BE APPROVED BY THE ARCHITECT. REMOVE MATERIALS ABOVE ACCESSIBLE CEILINGS. DRAIN AND CAP PIPING AND DUCTS ALLOWED TO REMAIN ABOVE CEILING OR BELOW FLOOR, CONCEALED FROM VIEW, EXCEPT AS OTHERWISE NOTED. PATCH FLOOR TO MATCH EXISTING.
- H. PIPE AND DUCT SHALL BE CONCEALED WITH NEW OR EXISTING CONSTRUCTION WHENEVER POSSIBLE, UNLESS INDICATED OTHERWISE.
- DRAWN BY: 10

MP1



**GUY GRONBERG
ARCHITECTS, P.C.**


113 SE 7th St.
Lee's Summit, MO 64063
Phone 816.524.0078
Fax 816.524.0678

BC **ENGINEERS**
INCORPORATED

5720 Reeder Shawnee, KS 66203 (913)262-1772

**SOUTHSIDE
PLAZA
404 Southwest
Nichols Street
Lees Summit
Missouri, 64063**

Snappy Clean



REV#	DATE	DESCRIPTION
Issue Date:		01-11-24
Project #:		23033



























WASTE & VENT FLOOR PLAN


P1

PLUMBING GENERAL NOTES:

1. INSTALL ALL PIPE, ETC. AS HIGH AS POSSIBLE.
2. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACES AVAILABLE, AND WITHOUT INTERFERENCES.
3. REFER TO ARCHITECTURAL & STRUCTURAL DRAWINGS FOR REQUIREMENTS FOR SUPPORTING PIPING, EQUIPMENT, ETC. FROM THE STRUCTURE. PROVIDE ADDITIONAL STEEL AS REQUIRED TO PROPERLY SUPPORT SYSTEMS FROM THE STRUCTURE.
4. SAWCUT EXISTING FLOOR AS REQUIRED FOR INSTALLATION OF UNDERFLOOR PIPING. PATCH FLOOR TO MATCH EXISTING.
5. NO PIPING SHALL BE ROUTED OVER THE TOP OF ELECTRICAL PANELS.
6. ALL MATERIALS WITHIN PLENUMS SHALL BE NONCOMBUSTIBLE OR SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 50 WHEN TESTED IN ACCORDANCE WITH ASTM E 84.
7. CONTRACTOR TO TEST WATER PRESSURE ON SITE AND PROVIDE PRESSURE REDUCING VALVE ON WATER SERVICE IF PRESSURE IS OVER 80 PSI.

PLUMBING SYMBOLS

	SOIL AND WASTE PIPING BELOW FLOOR/GRADE
	SOIL AND WASTE PIPING ABOVE FLOOR/GRADE
	SANITARY VENT PIPING ABOVE GRADE
	SANITARY VENT PIPING BELOW GRADE
	DOMESTIC COLD WATER PIPING
	DOMESTIC COLD WATER PIPING BELOW FLOOR
	DOMESTIC HOT WATER PIPING
	DOMESTIC HOT WATER PIPING BELOW FLOOR
	DOMESTIC HOT WATER RECIRCULATION PIPING
	GAS PIPING
	PIPING TURNING DOWN
	PIPING TURNING UP
	TEE TOP CONNECTION
	UNION
	BACKFLOW PREVENTER
	FLOOR DRAIN
	FLOOR CLEAN OUT
	WALL CLEAN OUT
	VALVE
	BALANCING VALVE
	SOLENOID VALVE
	PRESSURE REGULATOR
	CHECK VALVE
	CONNECT TO EXISTING
	INVERT ELEVATION OF PIPE
	MATCH MARKS ON PLUMBING RISER DIAGRAM

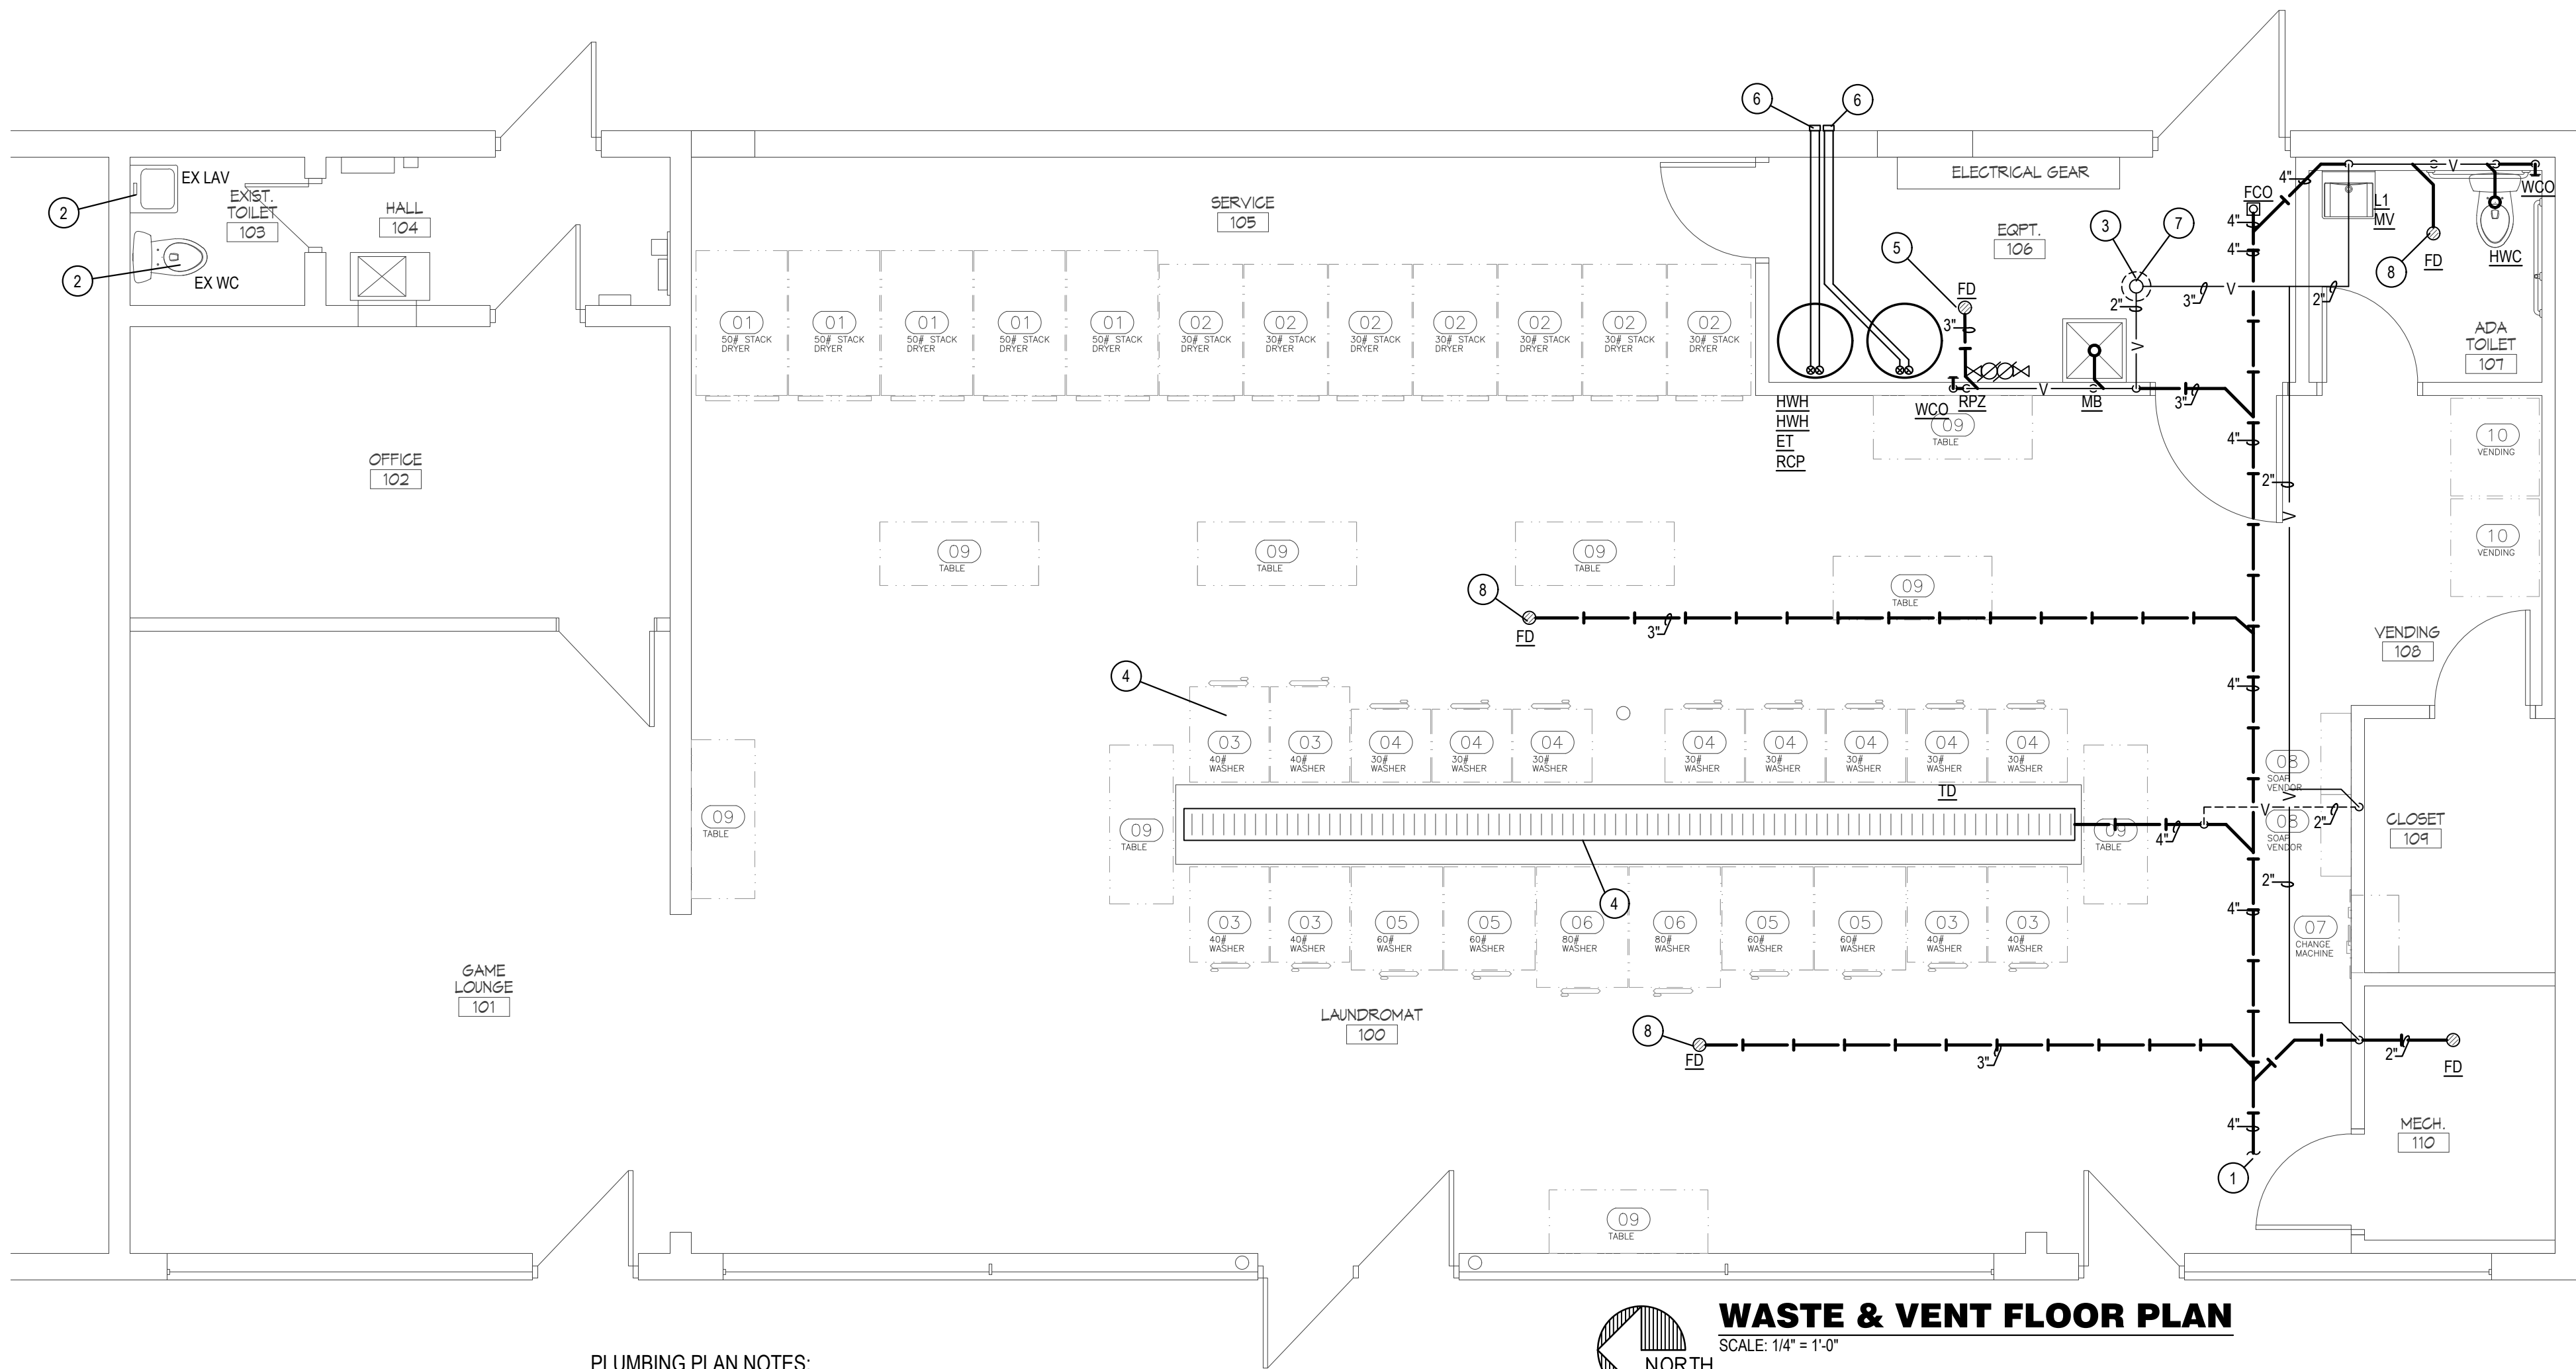

PLUMBING PLAN NOTES:

1. CONNECT SANITARY LINE TO EXISTING SANITARY LINE. PLUMBING CONTRACTOR SHALL VERIFY EXACT LOCATION AND ELEVATION OF EXISTING SANITARY LINE IN FIELD PRIOR TO INSTALLATION OF NEW PIPING. VERIFY CONDITION OF EXISTING PIPE AND PROVIDE ALTERNATE PRICE FOR REPAIR.
2. EXISTING PLUMBING FIXTURE TO REMAIN.
3. LOCATION OF 4" VTR. MAINTAIN MIN. 10'-0" CLEARANCE FROM ALL OUTDOOR AIR INTAKES. INSTALLED MINIMUM 24" FROM ROOF EDGE.
4. WASHING MACHINES DRAIN TO DISCHARGE INTO TRENCH DRAIN PER MANUFACTURER'S REQUIREMENT.
5. ROUTE WATER HEATER T & P DRAIN PIPE AND FLUE CONDENSATE DRAIN PIPE DOWN AND DISCHARGE TO FLOOR DRAIN WITH AIR GAP.
6. 3"Ø CPVC FLUE & COMBUSTION AIR INTAKE THROUGH WALL TO MANUFACTURER'S VENT TERMINATION AS REQUIRED. OFFSET AS REQUIRED TO MAINTAIN 10" CLEARANCE FROM ALL OUTDOOR AIR INTAKES. SEAL PENETRATION WEATHER TIGHT.
7. CUT EXISTING ROOF AND FLASH INTO ROOF AS REQUIRED. ALL ROOFING WORK SHALL BE PERFORMED BY BUILDING OWNER'S ROOFING CONTRACTOR (AT THIS CONTRACTOR'S EXPENSE) TO MAINTAIN EXISTING ROOF WARRANTY. VERIFY APPROVED ROOFING CONTRACTOR WITH BUILDING OWNER PRIOR TO PERFORMING WORK.
8. PROVIDE TRAP SEAL ON FLOOR DRAINS SUSCEPTIBLE TO DRYING OUT.

DRAWN BY:	MA/DS
BC PROJECT #:	23888
MISSOURI	PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. It is not to be used for any other purpose without the written consent of the Designer/Engineer. The Designer/Engineer shall not be responsible for errors or omissions in this drawing, nor shall he be responsible for any consequences arising from the use of this drawing. The Designer/Engineer shall not be responsible for any claims, damages, losses, or expenses, including reasonable attorneys' fees, incurred by third parties in connection with the use of this drawing. The Designer/Engineer shall not be responsible for any claims, damages, losses, or expenses, including reasonable attorneys' fees, incurred by third parties in connection with the use of this drawing. The Designer/Engineer shall not be responsible for any claims, damages, losses, or expenses, including reasonable attorneys' fees, incurred by third parties in connection with the use of this drawing.

REV#	DATE	DESCRIPTION	
Issue Date:			01-11-24
Project #:			23033




- 1 CONNECT 1-1/2" CW TO EXISTING 1-1/2" DOMESTIC CW BELOW FLOOR AS REQUIRED. VERIFY EXACT LOCATION PRIOR TO INSTALLATION OF ANY PIPING.
- 2 CONNECT 3/4" GAS TO EACH DRYER AS REQUIRED AND AS DETAILED.
- 3 ALL APPLIANCE CONNECTIONS SHALL BE MADE WITH UL LISTED FLEXIBLE APPLIANCE CONNECTOR. FLEX CONNECTORS SHALL BE PROVIDED BY TENANT. CONTRACTOR SHALL PROVIDE SAFETY LOCK AND CHAIN AT ALL GAS APPLIANCES ON WHEELS. PROVIDE PIPING REDUCERS AND INCREASERS AS REQUIRED TO MATE HARD PIPING WITH FLEX CONNECTORS.
- 4 COORDINATE WITH GAS COMPANY FOR EXISTING METER TO HAVE CAPACITY FOR 2,929 CFH @ 7" W.C.
- 5 CONNECT 1" GAS PIPE TO WATER HEATER AS REQUIRED AND AS DETAILED.
- 6 PROVIDE 1/2" RPZ BACKFLOW PREVENTER AND INSTALL 24" A.F.F. & 6" FROM WALL. ROUTE DRAIN FROM RPZ BFP TO FLOOR DRAIN WITH AN AIR GAP.
- 7 CONNECT HOT WATER RECIRC. PIPING BACK TO WATER HEATER AS REQUIRED. REFER TO RISER DIAGRAM FOR DETAILS.
- 8 1-1/2" HOT AND COLD WATER ROUTED DOWN TO UNDER FLOOR WITH SHUT OFF VALVES.
- 9 CONNECT 3/4" CW & HW TO WASHERS AS REQUIRED BY MANUFACTURER. REFER TO DOMESTIC WATER RISER DIAGRAM FOR MORE INFORMATION.
- 10 CAP GAS PIPE FOR FUTURE CONNECTION BY TENANT AS REQUIRED.

DRAWN BY:	MA/DS
BC PROJECT #:	23888
MISSOURI	PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Engineer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Engineer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2024 BC Engineers, Inc.



GUY GRONBERG
ARCHITECTS, P.C.
113 SE 3rd St.
Lees Summit, MO 64083
Phone: 816.324.0876
Fax: 816.324.6576



BC ENGINEERS
INCORPORATED
5720 Reeder Shawnee, KS 66203 (913)602-1772


SOUTHSIDE
PLAZA
404 Southwest
Nichols Street
Lees Summit
Missouri, 64063

Snappy
Clean
LANDROMAT

REV#	DATE	DESCRIPTION			
Issue Date:			01-11-24		
Project #:			23033		

PLUMBING SCHEDULES
& DETAILS

P3

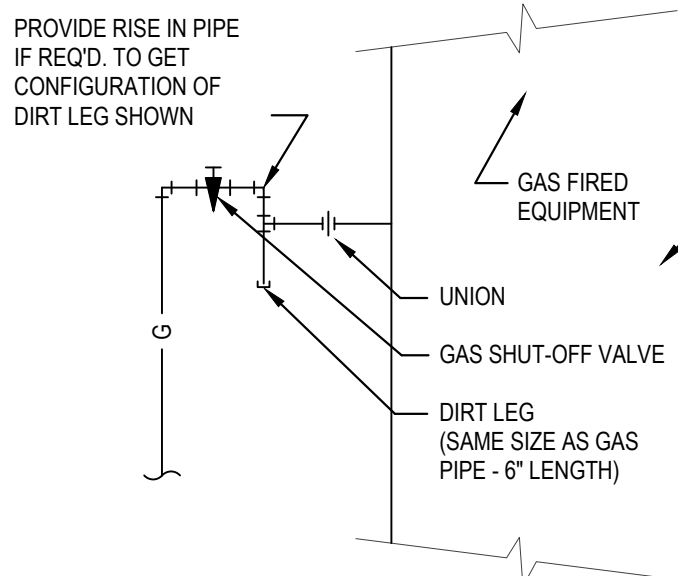

GAS CONNECTION DETAIL
SCALE: NONE

PEX PIPING REQUIREMENTS

PIPE SIZES GIVEN ON THE DRAWINGS ARE NOMINAL COPPER PIPE SIZE. IF PEX PIPING IS USED, INCREASE PEX PIPING ONE SIZE ABOVE LISTED SIZES AS REQUIRED TO EQUAL OR EXCEED COPPER PIPE INSIDE DIAMETER.



PLUMBING FIXTURE BRANCH PIPING SCHEDULE				
FIXTURE	WASTE	VENT	CW	HW
WATER CLOSET (FLUSH VALVE)	4"	2"	1"	--
LAVATORY	1-1/4"	1-1/4"	1/2"	1/2"
FLOOR DRAIN	2"3"	2"	--	--
MOP BASIN	2"	2"	1/2"	1/2"

NOTE: INDIVIDUAL VENTS FOR FIXTURES ON PLANS AND RISER DIAGRAMS HAVE BEEN INCREASED WHERE HORIZONTAL VENT LENGTH IS IN EXCESS OF THE MAXIMUM DISTANCE INDICATED BY THE CODE.

PIPE HANGER SCHEDULE		
PIPE MATERIAL	MAXIMUM HANGER SPACING	HANGER ROD DIAMETER
ABS (All sizes)	4'	3/8"
PVC (All Sizes)	4'	3/8"
CPVC, 1 inch and smaller	3'	1/2"
CPVC, 1-1/4 inches and larger	4'	1/2"
Cast Iron (All Sizes)	5'	5/8"
Cast Iron (All Sizes) with 10 foot length of pipe	10'	5/8"
Copper Tube, 1-1/4 inches and smaller	6'	1/2"
Copper Tube, 1-1/2 inches and larger	10'	1/2"
Steel, 3 inches and smaller	12'	1/2"
Steel, 4 inches and larger	12'	5/8"
Pex, 1" and below without support channel	32"	3/8"
Pex, 1-1/4" and above without support channel	48"	3/8"
Pex 3/4" and below with support channel	6'	3/8"
Pex 1" and above with support channel	8'	3/8"

PLUMBING FIXTURE SCHEDULE: (OR EQUAL)

- MB** MOP BASIN: FIAT, #MSB-2424, MOLDED STONE MOP BASIN, 2" DRAIN, 24"x 24" BASIN, VINYL BUMPER GUARD, STERN WILLIAMS #T-10-VB FAUCET, SPRING CHECKS, VACUUM BREAKER, INTEGRAL STOPS, WALL BRACE & PAIL HOOK, WALL BRACKET WITH 30' HOSE.
- FD** FLOOR DRAIN: SIOUX CHIEF, #842, PVC FLOOR DRAIN WITH ADJUSTABLE TOP AND CAST BRASS STRAINER.
- TD** TRENCH DRAIN: ZURN #Z-886-CG-GL, HEAVY DUTY, .75% PRE-SLOPED FIBERGLASS TRENCH DRAIN, 10 FOOT LENGTH, 12" WIDE.
- MV1** MIXING VALVE: WATTS, #LFMV THERMOSTATIC CONTROLLED MIXING VALVE, LEAD FREE BRONZE BODY, LOCKED TEMPERATURE ADJUSTMENT CAP (VANDAL RESISTANT), SOLID WAX HYDRAULIC PRINCIPLE THERMOSTAT, INTEGRAL FILTER WASHERS AND CHECK VALVES ON HOT AND COLD INLETS. (SET TO 110°F) ASSE #1017, #1069, #1070
- HHW** HOT WATER HEATER: AO SMITH, #BTH-199, GAS FIRED, CONDENSING TYPE, 100 GALLON STORAGE, 199 MBTUH INPUT, 234 GPH RECOVERY AT 100 DEGREES F RISE, MAIN & PILOT AUTOMATIC GAS VALVES, 120 VOLT, TEMPERATURE AND PRESSURE RELIEF VALVE, SET TEMPERATURE TO 130°F.
- ET** HOT WATER EXPANSION TANK: AMTROL, #ST-12, 4.4 GALLON EXPANSION TANK WITH DIAPHRAGM.
- RCP** HOT WATER RE-CIRCULATING PUMP: BELL & GOSSETT, #SERIES NBF-22, BRONZE FITTINGS, 5 GPM @ 10 FT. HEAD, 1 1/2 HP, 120 VOLT, 120 DEG. F TEMP., WITH HONEYWELL 16006C AQUASTAT AND TC-1 TIMER KIT, 3/4" PIPE, 120"-125" F.
- WHA** WATER HAMMER ARRESTOR: JR SMITH 'HYDROTROL', #5000 LEAD-FREE WATER HAMMER ARRESTOR, SIZED AS PER MANUFACTURER'S RECOMMENDATIONS.
- W** WASHER: PROVIDED BY OWNER, INSTALLED BY GC. PROVIDE VALVE, HOT WATER, COLD WATER AND WASTE PIPE FOR COMPLETE INSTALLATION.
- D** DRYER: PROVIDED BY OWNER, INSTALLED BY GC. PROVIDE VALVE & PIPING FOR COMPLETE INSTALLATION.
- FCO/WCO** VINYL TILE FLOOR: JR SMITH #140, OR EQUAL. QUARRY TILE FLOOR: JR SMITH #4200, OR EQUAL. CARPETED FLOOR: JR SMITH #4020-Y, OR EQUAL. UNFINISHED FLOOR: JR SMITH #4020, OR EQUAL. WALL: JR SMITH #4472, OR EQUAL, 24" ABOVE THE FLOOR.
- HWC** WATER CLOSET (HANDICAPPED): TOTO, #CT705ULNX, VITREOUS CHINA, FLOOR MOUNTED, FLOOR OUTLET, 17-1/2" HIGH ELONGATED BOWL, SIPHON JET ACTION, #TMT1LN32CP FLUSH VALVE, 1.28 GAL/FLUSH, #SC534 WHITE OPEN FRONT ELONGATED SEAT WITH CHECK HINGE. HANDLE ON WIDE SIDE OF FIXTURE.
- L1** HANDICAP LAVATORY, WALL HUNG: TOTO #LT307, 20"x 18", VITREOUS CHINA, FRONT OVERFLOW, DELTA #501 FAUCET WITH SINGLE METAL LEVER FAUCET, OFFSET GRID ELBOW DRAIN AND 1-1/4" TAILPIECE, CHROME PLATED CAST BRASS P-TRAP WITH CLEANOUT (MOUNTED PARALLEL WITH WALL), CHROME PLATED LOOSE KEY ANGLE STOPS AND RISERS, FLOOR MOUNTED CONCEALED ARM LAVATORY SUPPORT, INSULATE EXPOSED DRAIN, WATER SUPPLIES, AND VALVES WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL INSULATION.

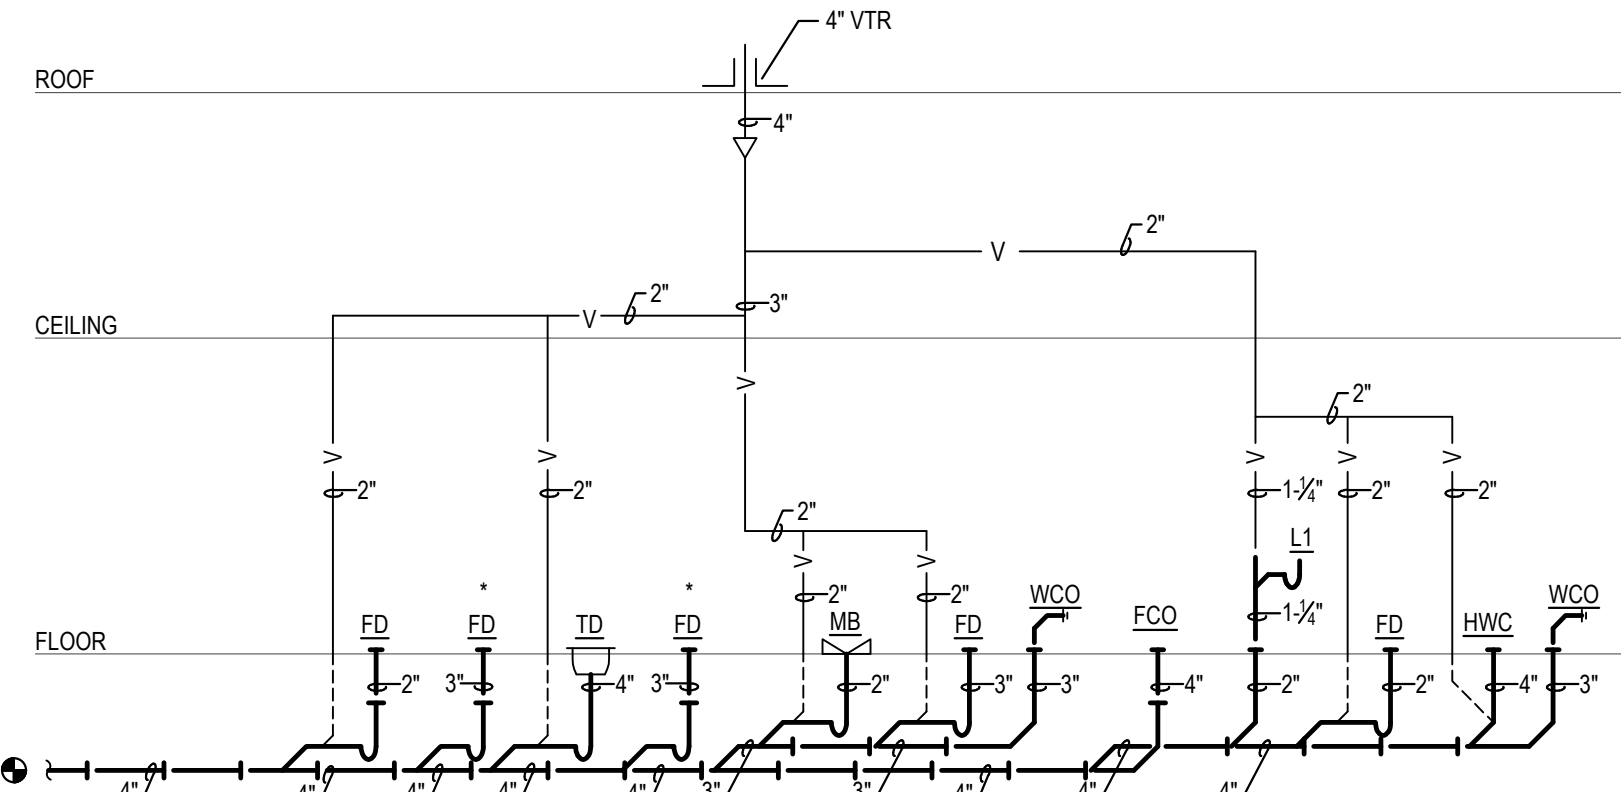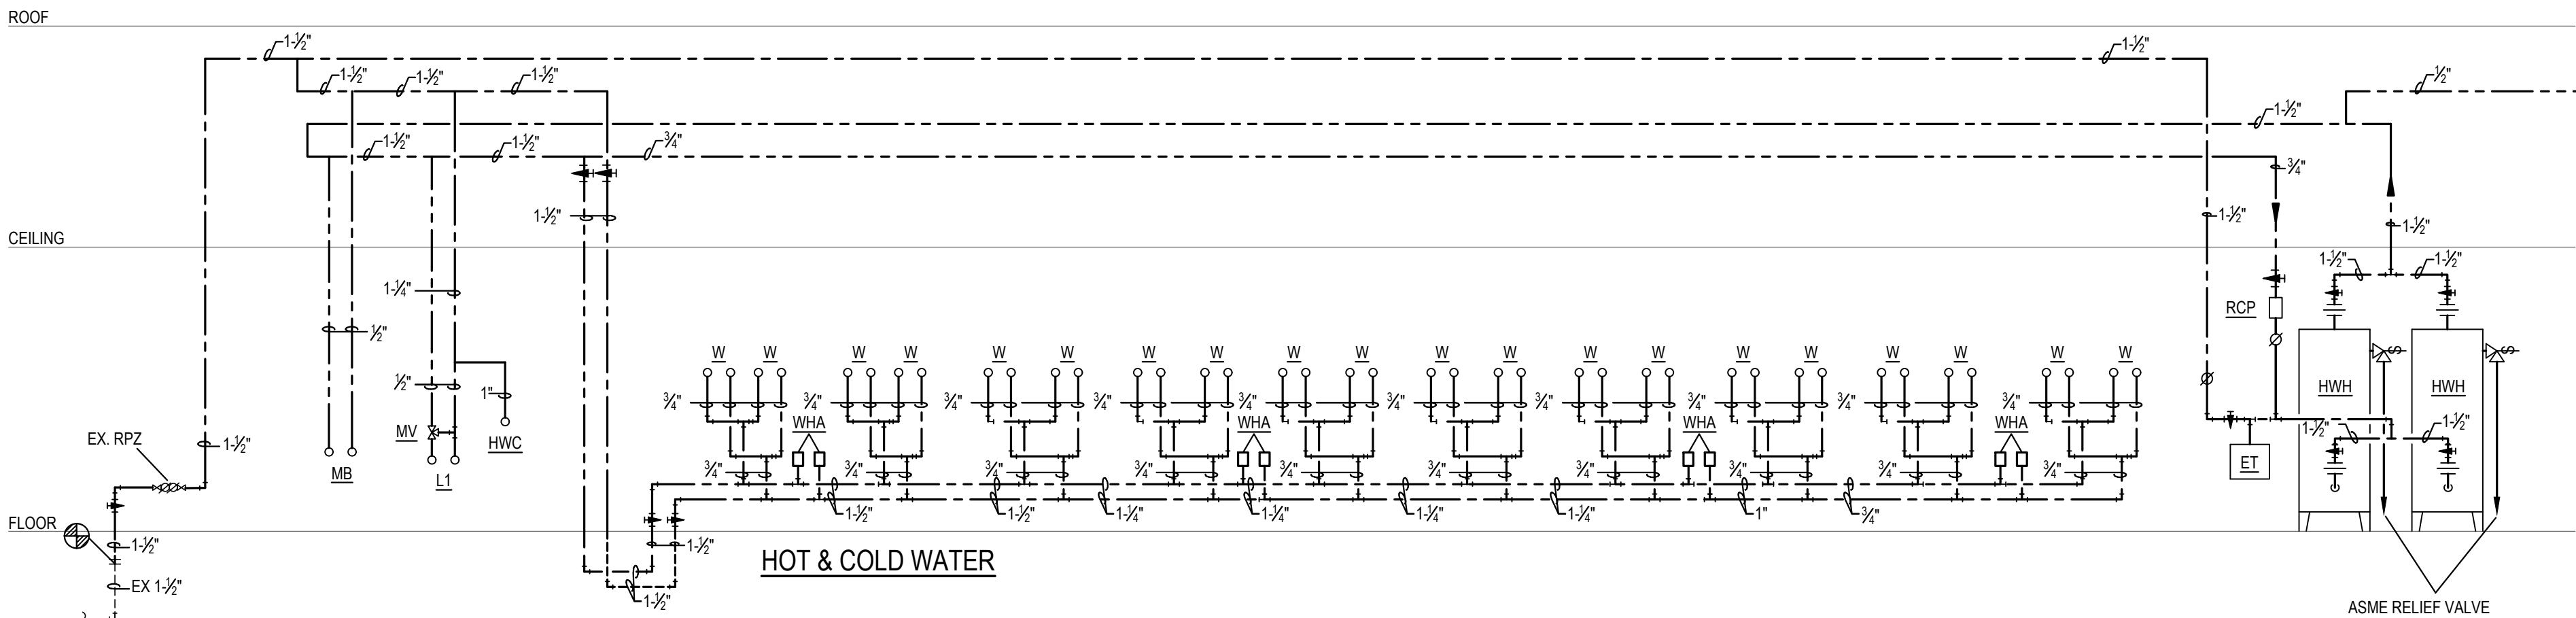

* = COMBINATION WASTE & VENT DRAIN

WASTE & VENT

PLUMBING RISER DIAGRAMS

SCALE: NONE

DRAWN BY: MA/DS
BC PROJECT #: 23888
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2024 BC Engineers, Inc.

SCALE: 1/4" = 1'-0"

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2014 BC Engineers, Inc.



AIR HANDLING UNIT SCHEDULE													
MARK	MFR	MODEL NO.	CFM	E.S.P. IN. WG.	COOLING			HEATING (ELECTRIC) (RESISTANCE)		ELECTRICAL		OUTSIDE AIR (CFM)	NOTES
					TOTAL BTUH	AMB.	EVAP. EAT DB/WB	KW	STAGES	VOLT/Ø/HZ	HP		
AHU-1	DAIKIN	DAX090	3,000	0.8	90,000	95	80/67	30	2	208/3/60	2	500	1

NOTES: 1. UNIT IS EXISTING TO REMAIN. VERIFY PROPER WORKING ORDER

ALL EXISTING HVAC UNITS SHOULD HAVE A PREVENTATIVE MAINTENANCE CHECK-UP TO INCLUDE THE FOLLOWING CRITERIA

1. CHANGE ALL FILTERS.
2. CLEAN ALL CONDENSATE DRAIN PANS AND FLUSH ALL CONDENSATE DRAIN LINES.
3. CLEAN ALL EVAPORATOR AND CONDENSER COILS WITH A NON-ACID CLEANSER.
4. CHECK REFRIGERANT CHARGE (GAUGES OR RETURN/SUPPLY TEMPERATURE VARIANCE).
5. PROVIDE COMPLETE LUBRICATION OF ALL SHAFTS AND BEARINGS THAT HAVE LUBRICATION ZERKS.
6. THE REPLACEMENT OF ALL BELTS, HOSES AND FABRIC/RUBBER COATED ITEMS THAT ARE SUBJECT TO WEAR.
7. CHECK AMPS OF THE INDOOR, OUTDOOR MOTORS, AND COMPRESSORS.
8. TURN UNIT POWER OFF - TIGHTEN ALL ELECTRICAL CONNECTIONS, CONTACTORS, ETC.
9. EXAMINE AND REPAIR ALL ELECTRICAL WIRING, CONTROLS, STARTERS, RELAYS, CAPACITORS AND LIKE ITEMS THAT TEND TO DETERIORATE OVER TIME OR BECOME NON-OPERATIONAL. THIS INCLUDES SMOKE DETECTORS.
10. GREASE ALL FITTINGS
11. CHECK DUCTWORK CONNECTIONS AND REPAIR AS NEEDED.
12. NOTIFY GENERAL CONTRACTOR OF ANY REQUIRED PARTS OR REPAIRS NOT INCLUDED IN THIS LIST. ALL UNITS SHALL BE FUNCTIONING AND COOLING PROPERLY AT THE END OF THE SERVICE VISIT.
13. CHECK THE ECONOMIZER FOR PROPER FUNCTION AND CORRECT OPERATION OF THE SYSTEM WHEN A CALL FOR COOLING COMES FROM THE THERMOSTAT. REPAIR AND ADJUST AS NEEDED.
14. VERIFY ANY WORK REQUIRED BY THE LANDLORD PRIOR TO BID.
15. ALL FINDINGS AND VALUES TO BE NOTED AND PROVIDED TO TENANT'S CONSTRUCTION MANAGER & OR TENANT'S MAINTENANCE DIRECTOR.

DIFFUSER SCHEDULE									
MARK	MFGR	MODEL	BORDER TYPE	NECK SIZE	FACE SIZE	FINISH	DAMPER	ACCESSORIES	NOTES
SD-1	TITUS	TMS	3	8"Ø	24"x24"	WHITE	-		-
SD-2		↓		6"Ø	12"x12"		-		-
SR-1		300FS		10"x6"	-		OB DAMPER		-
RG-1		PAR	↓	12"x12"	24"x24"		-		-
RG-2		350FL	1	28"x28"	-		-		-
TG-1	↓	350FL	↓	12"x12"	-	↓	-		-


EXHAUST FAN SCHEDULE										
MARK	MFG	MODEL	CFM	EXTERNAL STATIC P. IN. WG.	RPM	ELECTRICAL		FAN TYPE	CONTROLS	NOTES
						VOLTS/PH	W			
EF-1	COOK	GC-128	75	0.1	750	120/1/60	29 W	CEILING EXH.	SWITCH	1

NOTES: 1. PROVIDE CEILING GRILLE, INTEGRAL BACK DRAFT DAMPER, VARI-SPEED CONTROLLER (NEAR FAN AND ABOVE CEILING), FACTORY MEANS OF DISCONNECT AND WALL CAP

ELECTRIC UNIT HEATER SCHEDULE						
MARK	MFGR	MODEL NO.	BTUH	ELECTRICAL		NOTES
				VOLT/0HZ	WATTS	
WH-1	RAYWALL	F2F5105N	17,060	208/3/60	5 KW	1.2

NOTES:

1. SUPPORT UNIT FROM STRUCTURE.
2. PROVIDE INTEGRAL DISCONNECT & REMOTE THERMOSTAT FOR EACH UNIT

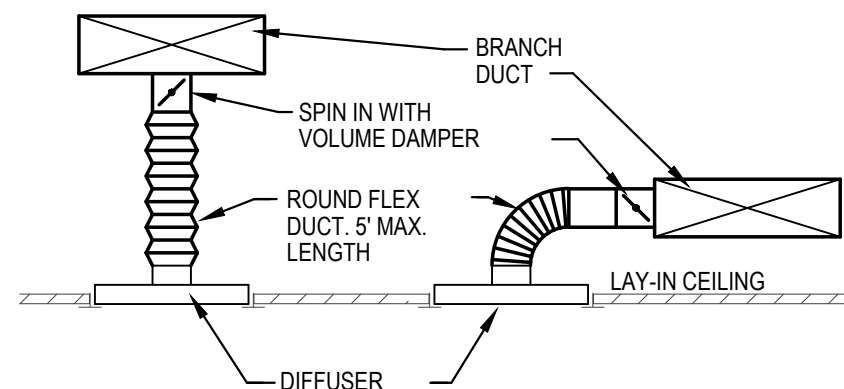

DIFFUSER DETAIL

OUTDOOR AIR CALCULATIONS									
UNIT	Area (sqft)	OCCUPANCY CLASSIFICATION	Occupant Density #/1000 sqft	People outdoor airflow rate in breathing zone, (Rp) cfm/person	Area outdoor airflow rate in breathing zone, (Ra) cfm/sqft	Exhaust airflow rate cfm/sqft	Breathing zone outdoor airflow (Vbz)	Zone air distribution effectivene ss (Ez)	Zone outdoor airflow (cfm)
EX AHU	1521	Commercial laundry	10	25	0		380	0.8	475
	101	Storage rooms	0	0	0.12		12	0.8	15
Total									490

OUTDOOR AIR CALCULATIONS									
UNIT	Area (sqft)	OCCUPANCY CLASSIFICATION	Occupant Density #/1000 sqft	People outdoor airflow rate in breathing zone, (Rp) cfm/person	Area outdoor airflow rate in breathing zone, (Ra) cfm/sqft	Exhaust airflow rate cfm/sqft	Breathing zone outdoor airflow (Vbz)	Zone air distribution effectiveness (Ez)	Zone outdoor airflow (cfm)
EX FURNACE	1521	Commercial laundry	10	25	0		380	0.8	475
	156	Office spaces	5	5	0.06		13	0.8	17
Total									492

LOUVER SCHEDULE					
MARK	MFGR	MODEL	FRAME	SIZE	NOTES
L-1	RUSKIN	ELF6375DX	STD	40"x64"	1,2

NOTES:

1. PROVIDE WITH BIRD SCREEN.
2. ARCHITECT TO SELECT COLOR, PRIMED FOR FIELD PAINT.

DRAWN BY:	MA/DS
BC PROJECT #:	23888
MISSOURI	PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2004 BC Engineers, Inc.

REV#	DATE	DESCRIPTION	Issue Date:
			01-11-24
			Project #:
			23033

MECHANICAL SCHEDULES
& DETAILS

M2

ELECTRICAL SPECIFICATIONS

1. GENERAL PROVISIONS:
- A. PROVIDE ALL LABOR, MATERIALS, EQUIPMENT, NECESSARY FOR THE COMPLETE INSTALLATION OF THE ELECTRICAL SYSTEMS OUTLINED.
- B. OBTAIN ALL PERMITS, FEES, LICENSES, INSPECTIONS, AND CERTIFICATES OF COMPLIANCE OR APPROVAL AS REQUIRED BY THE AUTHORITIES.
- C. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST APPROVED EDITION OF THE NATIONAL ELECTRIC CODE (NEC), AND ALL APPLICABLE LAWS, CODES AND REGULATIONS OF THE GOVERNMENTAL BODIES HAVING JURISDICTION OVER THE SITE.
- D. ALL TESTING REQUIRED BY AUTHORITIES SHALL BE CONSIDERED PART OF THIS WORK.
- E. DURING CONSTRUCTION, ALL FIXTURES, EQUIPMENT, CONDUIT, ETC. SHALL BE COVERED, PLUGGED, OR CAPPED AS REQUIRED TO KEEP CLEAN AND UNDAIMAGED. ALL DAMAGED ITEMS SHALL BE RESTORED TO ORIGINAL CONDITION OR REPLACED. ALL PROTECTIVE COVERING SHALL BE REMOVED BEFORE FINAL ACCEPTANCE.
- F. PROVIDE ALL NECESSARY CUTTING AND PATCHING OF WALLS, FLOORS, CEILINGS, AND ROOFS AS NECESSARY. PATCH AROUND ALL OPENINGS SHALL MATCH ADJACENT AREA. COORDINATE ALL ROOFING WORK WITH OWNER OR RESPONSIBLE PARTY, SO THAT THE EXISTING ROOFING WARRANTY WILL BE MAINTAINED.
- G. CONTRACTOR SHALL GUARANTEE ALL WORK AND MATERIALS AGAINST DEFECTS FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE.
- H. CONTRACTOR SHALL PROVIDE ACCESS PANELS WHERE NECESSARY FOR CONCEALED ELECTRICAL COMPONENTS.
- I. CONTRACTOR SHALL PROMPTLY CALL ENGINEERS ATTENTION TO ANY APPARENT CONTRADICTIONS, AMBIGUITIES, ERRORS, DISCREPANCIES, OR OMISSIONS IN THE PLANS OR SPECIFICATIONS.
2. OPERATION AND MAINTENANCE MANUALS:
- A. DURING THE COURSE OF CONSTRUCTION, COLLECT AND COMPILE OPERATING INSTRUCTIONS, WIRING DIAGRAMS, CATALOG CUTS, LUBRICATION AND PREVENTIVE MAINTENANCE INSTRUCTIONS, PARTS LISTS, ETC. FOR ALL EQUIPMENT FURNISHED UNDER THIS CONTRACT.
- B. ALL LITERATURE AND INSTRUCTIONS SHIPPED WITH THE EQUIPMENT SHALL BE SAVED FOR INCLUSION IN THE OPERATION AND MAINTENANCE MANUALS.
- C. ALL OPERATIONS LISTED ABOVE AND ALL PAPERS LISTING WARRANTIES, ETC. SHALL BE COLLATED AND LABELED WITH THE PROJECT NAME, ADDRESS, ARCHITECT, ENGINEER, CONTRACTORS, ETC. CONTRACTORS, ETC. DOCUMENTS SHALL BE COMPILED AND BOUND IN DIGITAL FILE OR 3 RING BINDER.
3. MANUFACTURERS:
- A. MANUFACTURERS, MODEL NUMBERS, ETC. INDICATED OR SCHEDULED ON THE DRAWINGS SHALL BE INTERPRETED AS HAVING ESTABLISHED A STANDARD OF QUALITY AND SHALL NOT BE CONSTRUED AS LIMITING COMPETITION. ARTICLES, FIXTURES, ETC. OF EQUAL QUALITY BY MANUFACTURERS SHALL BE ACCEPTABLE, SUBJECT TO STRUCTURAL AND ELECTRICAL CONSTRAINTS OF THE PROJECT DESIGN, UNLESS NOTED OTHERWISE.
4. TESTING, AND BALANCING:
- A. ALL CIRCUITS SHALL BE TESTED FOR CONTINUITY, SHORTS, AND GROUNDS BEFORE CONNECTING TO THE PROPER PHASE AS DESIGNED TO BALANCE THE LOADING BETWEEN PHASES.
- B. POWER AND LIGHTING PANELS SHALL BE PROPERLY PHASED TO DISTRIBUTE THE LOAD AND SHALL BE CONNECTED AND ADJUSTED TO OPERATE AS SPECIFIED.
- C. ALL MOTORS AND SIMILAR EQUIPMENT SHALL BE CHECKED FOR PROPER PHASE ROTATION AND OPERATION.
5. RACEWAYS:
- A. CONDUIT INSIDE THE BUILDING SHALL BE METALLIC TUBING (EMT), BEARING THE UL LABEL, WITH COMPRESSION TYPE FITTINGS OR SCREW SET FITTINGS.
- B. CONDUIT EXPOSED TO THE WEATHER, INSTALLED UNDERGROUND, IN CONCRETE, OR USED FOR SERVICE ENTRANCE SHALL BE STANDARD RIGID CONDUIT (GALVANIZED) WITH THREADED FITTINGS.
- C. UNDERGROUND CONDUIT MAY BE POLY(VINYL CHLORIDE WITH A DEFLECTION TEMPERATURE, UNDER LOAD AT 264 PSI, OF 78 DEGREES C, AND A TENSILE STRENGTH OF 5,200 PSI. JOINTS SHALL BE FLUSH SOLVENT WELDED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. CONDUIT SHALL BE EQUAL TO CARLON POWER AND COMMUNICATIONS DUCT TYPE 99 (DIRECT BURIAL). CONDUIT AND FITTINGS SHALL BE PRODUCED BY THE SAME MANUFACTURER.
- D. FLEXIBLE METAL CONDUIT SHALL ONLY BE USED FOR CONNECTIONS TO MOTORS, TRANSFORMERS, AND LIGHT FIXTURES. MAXIMUM LENGTH SHALL BE 6'-0".
6. CONDUCTORS:
- A. WIRES SHALL BE CONTINUOUS WITHOUT SPLICES OR TAPS IN CONDUIT RUNS. ALL SPLICES SHALL BE MADE IN JUNCTION, PULL, OR OUTLET BOXES. ALL WIRES SHALL BE INSTALLED IN CONDUIT, WIREWAYS, OR OTHER PROTECTIVE COVER SANCTIONED BY CODES.
- B. CONDUCTORS FOR LIGHTING AND POWER SHALL BE COPPER, MINIMUM NO. 12 A.W.G., 600 VOLT.
- C. NO. 10 GAUGE AND SMALLER CONDUCTORS SHALL BE TYPE THHN (WET LOCATIONS) OR THHN (DRY LOCATIONS), SOLID CONDUCTOR, UNLESS OTHERWISE INDICATED.
- D. NO. 8 GAUGE AND LARGER CONDUCTORS SHALL BE TYPE THHN (WET LOCATIONS) OR THHN (DRY LOCATIONS), STRANDED, UNLESS OTHERWISE INDICATED.
- E. SERVICE ENTRANCE AND PANEL FEEDER CONDUCTORS, NO. 3 GAUGE AND LARGER SHALL BE TYPE XHHW-2 (WET LOCATIONS) OR THHN (DRY LOCATIONS), STRANDED COPPER, UNLESS OTHERWISE INDICATED.
- F. ALUMINUM SERVICE WIRE MAY BE USED FOR SERVICE ENTRANCE CONDUCTORS AND/OR PANEL FEEDERS ONLY. ALL OTHER WIRING SHALL BE COPPER CONDUCTORS AS HEREBEFORE SPECIFIED.
- G. ALUMINUM CONDUCTORS SHALL BE TYPE "XHHW-2" ALCAN, "STABILLOY" TYPE ALLOY CONDUCTORS UTILIZING "AA-8039" ALUMINUM ALLOY. CONDUCTORS SHALL BE UL LISTED.
- H. ALL ALUMINUM CONDUCTORS SHALL BE TERMINATED IN CONNECTIONS OR LUGS WHICH ARE DUAL RATED (AL/CU OR AL/AL) AND ARE LISTED BY UL FOR USE WITH ALUMINUM OR COPPER CONDUCTORS AND SHALL BE SIZED TO ACCEPT ALUMINUM CONDUCTORS OF THE AMPACITY SPECIFIED.
7. MC CABLE:
- A. MC CABLE SHALL CONSIST OF INTERLOCK ARMORED CABLE MADE OF THREE OR FOUR TYPE THHN SOLID (8 AWG AND LARGER MAY BE STRANDED) COPPER CONDUCTORS RATED 90°C FOR DRY LOCATIONS, WITH NYLON OR EQUIVALENT UL LISTED JACKET, PER UL STANDARD 83. THE THREE CONDUCTORS SHALL BE TWISTED TOGETHER WITH THE COPPER GROUNDING CONDUCTOR, SUITABLE FILLERS, AND WRAPPED IN BINDER TAPE. THE ASSEMBLY SHALL BE ARMORED WITH SPIRALLY WRAPPED INTERLOCKED ARMOR OF ALUMINUM OR GALVANIZED STEEL.
- B. CABLES SHALL BE TESTED IN ACCORDANCE WITH UL STANDARD 1569 FOR TYPE MC CABLE AND RATED AT 800 VOLTS, 90 DEG. C FOR DRY LOCATIONS AND 75 DEG. C FOR WET LOCATIONS.
8. WIRING DEVICES:
- A. WALL SWITCHES SHALL BE SPECIFICATION GRADE, QUET TYPE, FLUSH TOGGLE SWITCH, RATED FOR 20 AMPS, WITH THERMOPLASTIC COVER PLATES.
- 1) SINGLE POLE: HUBBELL #CS1212-X, OR EQUAL.
- 2) THREE WAY: HUBBELL #CS1223-X, OR EQUAL.
- 3) AS SPECIFIED ON PLANS.
- B. RECEPTACLES SHALL BE SPECIFICATION GRADE, DUPLEX, GROUNDING, THREE-WIRE TYPE, RATED FOR 20 AMPS, WITH THERMOPLASTIC COVER PLATES, HUBBELL #CR3333-X, OR EQUAL.
- C. GROUND FAULT INTERRUPTER RECEPTACLES (GFI) SHALL BE HUBBELL #GF20-XL. DEVICE COVER PLATES SHALL BE AS HEREBEFORE SPECIFIED.
- D. ISOLATED GROUND RECEPTACLES (IG) SHALL BE HUBBELL #CR3333-20, ORANGE COLOR. DEVICE COVER PLATES SHALL BE AS HEREBEFORE SPECIFIED.
- E. RECEPTACLES OUTSIDE BUILDING AND WHERE NOTED AS WEATHERPROOF, SHALL BE LISTED "WEATHER-RESISTANT" HUBBELL #GF7202-X, OR EQUAL, AND SHALL BE INSTALLED IN A WEATHERPROOF ENCLOSURE WHICH SHALL BE INTERMATIC #WP1100MD OR #WP1010MD DECATAL METAL WEATHERPROOF RECEPTACLE COVER. COVER SHALL BE WEATHER PROOF RATED WHILE IN USE.
- F. VERIFY DEVICES AND DEVICE COVERPLATES COLOR AND STYLE WITH ARCHITECT.
9. BOXES:
- A. HOT DIPPED GALVANIZED STEEL BOXES. PROVIDE TYPE TO SUIT CONDITIONS FOR INSTALLATION.
- B. ALL BOXES SHALL BE FLUSH MOUNTED, UNLESS INDICATED OTHERWISE.

ELECTRICAL SPECIFICATIONS (CONTINUED)

11. PANELBOARDS:
- A. FURNISH AND INSTALL CIRCUIT BREAKER PANELBOARDS AS SHOWN ON THE DRAWINGS. PANELBOARDS SHALL BE LISTED BY UL AND SO LABELED AND SHALL BE FULLY RATED FOR THE VOLTAGE AND CURRENT CAPACITY INDICATED ON THE PANEL SCHEDULE. PANELBOARDS SHALL BE EQUAL TO SQUARE D TYPE NO OR NF WITH BOLT IN TYPE BREAKERS. PANELBOARD LUGS SHALL BE RATED AT 75°C.
- 1) CIRCUIT BREAKER INTERRUPTING CAPACITIES SHALL MEET OR EXCEED THE AVAILABLE RMS SYMMETRICAL FAULT CURRENTS INDICATED AND AS REQUIRED TO MEET OR EXCEED THE AVAILABLE FAULT CURRENT FROM LOCAL UTILITY.
- B. CIRCUIT BREAKERS SHALL MEET APPLICABLE PORTIONS OF UL STANDARD 489 AND NEMA AB-1. CIRCUIT BREAKERS SHALL BE BOLT-ON, GROUP MOUNTED, AMBIENT MAGNETIC, WITH COMMON TRIP, UL RATED TO CARRY 80% OF NAMEPLATE RATING CONTINUOUSLY IN FREE AIR AT 40° C. CIRCUIT BREAKERS SHALL BE TRIP INDICATING AND FULLY INTERCHANGEABLE WITHOUT DISTURBING ADJACENT UNITS. WIRE TERMINALS SHALL BE RATED TO DEGREE C. THE OPERATING MECHANISM SHALL BE TRIP-FREE SO THAT CONTACTS CANNOT BE HELD CLOSED AGAINST ANY ABNORMAL OVERCURRENT OR SHORT CIRCUIT CONDITION.
- a) BREAKERS SHALL MEET APPLICABLE NEMA AND/OR UL SPECIFICATIONS.
- C. PANELBOARD BOXES SHALL BE GALVANIZED SHEET STEEL WITH AMPLE WIRING GUTTER SPACE IN ACCORDANCE WITH NEC. FRONTS SHALL BE OF SHEET STEEL PAINTED LIGHT GREY OVER A SUITABLE RUST INHIBITOR PRIMER. PANELBOARDS SHALL BE EQUIPPED WITH ONE PIECE DOOR, CYLINDER TUMBLER TYPE LOCK, DIRECTORY CARD-HOLDER AND QUARTER-TURN ADJUSTABLE TRIM CLAMPS.
- D. PANELBOARD INTERIORS SHALL CONSIST OF REINFORCED GALVANIZED SHEET STEEL FRAMES WITH ALUMINUM BUS BARS AND CIRCUIT BREAKERS, PROPERLY SUPPORTED TO PREVENT VIBRATIONS AND BREAKAGE IN HANDLING. BUS BARS SHALL BE SEQUENCE PHASED. PANELBOARD SHALL HAVE A FULL SIZED SOLID ALUMINUM NEUTRAL AND GROUND BUS.
- E. BUS BAR BRACING SHALL BE UL LISTED AS INDICATED ON DRAWINGS. ADDITIONAL BRACING SHALL BE PROVIDED AS REQUIRED TO MEET OR EXCEED INDICATED AVAILABLE FAULT CURRENTS.
- F. DIRECTORY CARDS SHALL BE COMPLETELY FILLED IN BY TYPEWRITER, LISTING CIRCUIT NUMBERS AND LOAD SERVED, INCLUDING EXISTING CIRCUITS. CIRCUIT BREAKERS SHALL BE IDENTIFIED BY CIRCUIT NUMBER LABELS AS HEREBEFORE SPECIFIED.
12. LIGHT FIXTURES:
- A. WHERE LIGHT FIXTURES ARE MOUNTED IN A LAY-IN CEILING, PROVIDE A MINIMUM OF 2 SUPPORT WIRES ATTACHED DIRECTLY BETWEEN EACH LIGHT FIXTURE AND THE BUILDING STRUCTURE. SUPPORT WIRES SHALL BE A MINIMUM OF 12 GAUGE GALVANIZED STEEL WIRE, SOFT ANNEALED.
- B. FIXTURES ARE REQUIRED AT ALL LIGHTING OUTLETS SHOWN ON THE DRAWINGS. APPROVED LIGHTING FIXTURE WIRE IS REQUIRED IN ALL FIXTURES AND FIXTURE RACKINGS. WEATHERPROOF WIRING IS REQUIRED FOR EXTERIOR FIXTURES. ALL PARTS OF FIXTURES AND WIRING SHALL BE IN ACCORDANCE WITH NEC REQUIREMENTS.
- C. ALL FIXTURES SHALL CARRY UL AND ETL LABELS.
13. SLEEVES:
- A. PROVIDE, SET, AND PROPERLY LOCATE PIPE SLEEVES AS REQUIRED FOR THIS WORK.
- B. INTERIOR PARTITIONS: 18 GAUGE GALVANIZED STEEL, PACK BETWEEN CONDUIT AND SLEEVE WITH FIRE SAFING AND CAULK AT EACH END WITH FIRE RESISTANT SEALANT.
- C. ROOF: PROSECT OR EQUAL, MANUFACTURED PVC SCHEDULE 40 PIPE SLEEVE WITH WEATHERPROOF SEAL, COORDINATE WITH ROOFING CONTRACTOR AND FLASH AS REQUIRED TO MAINTAIN ROOF WARRANTY.
14. GROUNDING:
- A. GROUND ALL ELECTRICAL APPARATUS IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC) 250, AND ANY LOCAL REQUIREMENTS. INSURE CONTINUOUS BOND WHERE FLEXIBLE CONDUIT IS USED. PROVIDE BONDING JUMPER INSIDE ALL FLEXIBLE CONDUIT.
- B. BOND METAL PIPING SYSTEMS IN COMPLIANCE WITH NEC 250.4(A)(4).
15. REMODELING WORK:
- A. DEMOLITION, DISCONNECT, DEMOLISH AND REMOVE ABANDONED ELECTRICAL MATERIALS AND EQUIPMENT INDICATED TO BE REMOVED AND NOT INDICATED TO BE SALVAGED OR REMAIN.
- B. EQUIPMENT TO BE SALVAGED:
- 1) DISCONNECT AND REMOVE EXISTING ELECTRICAL EQUIPMENT INDICATED TO BE REMOVED AND SALVAGED. DELIVER EQUIPMENT TO THE LOCATION DESIGNATED BY THE OWNER FOR STORAGE.
- 2) ALL MATERIALS AND EQUIPMENT DESIGNATED TO BE REUSED OR RELOCATED SHALL BE CAREFULLY REMOVED, AND STORED UNTIL NEEDED FOR REMODELING WORK. ALL ITEMS SHALL BE RESTORED TO "LIKE NEW" CONDITION WITH RUST OR CORROSION REMOVED, SURFACE PAINT TOUCHED UP OR REPAINTED AS REQUIRED TO MATCH NEW CONSTRUCTION, AND THOROUGHLY CLEANED AND INSPECTED. ANY ITEMS WHICH BECOME DAMAGED BEYOND REPAIR AS A RESULT OF CONSTRUCTION OR DEMOLITION ACTIVITY SHALL BE REPLACED WITH NEW MATERIAL, EQUIVALENT IN EVERY RESPECT.
- C. DISPOSAL AND CLEANUP: REMOVE FROM THE SITE AND LEGALLY DISPOSE OF DEMOLISHED MATERIALS AND EQUIPMENT NOT INDICATED TO BE SALVAGED.
- D. PROTECT ADJACENT MATERIALS INDICATED TO REMAIN. INSTALL AND MAINTAIN DUST AND NOISE BARRIERS TO KEEP DIRT, DUST, AND NOISE FROM BEING TRANSMITTED TO ADJACENT AREAS. REMOVE PROTECTION AND BARRIERS AFTER REMODELING OPERATIONS ARE COMPLETE.
- E. PROVIDE ALL ALTERATIONS AND REWORK INDICATED AND/OR REQUIRED FOR THE PROPER INSTALLATION AND OPERATION OF ALL EXISTING ELECTRICAL SYSTEMS, INTEGRATING THE NEW AND EXISTING AREAS. LOCATE, IDENTIFY, AND PROTECT ELECTRICAL SERVICES PASSING THROUGH REMODELING AREA AND SERVING OTHER AREAS OUTSIDE THE REMODELING LIMITS. MAINTAIN SERVICES TO AREAS OUTSIDE REMODELING LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
- 1) ABANDONED CONDUIT SHALL HAVE WIRE REMOVED AND SHALL BE CAPPED. ABANDONED OUTLETS IN WALLS OR PARTITIONS SHALL HAVE DEVICES AND WIRE REMOVED, AND SHALL BE COVERED.
- 2) WHERE EXISTING CONDUITS TERMINATE AT AN EXISTING OUTLET IN A WALL, CEILING, OR FLOOR TO BE REMOVED, DISCONNECT AND REMOVE DEVICE AND WIRE FROM CONDUIT. CONDUIT SHALL BE CUT BACK AND CAPPED (BELOW THE FLOOR OR ABOVE THE CEILING) SO NOT TO CREATE AN OBSTRUCTION. PATCH FLOOR TO MATCH EXISTING.
- 3) WHERE EXISTING CIRCUITS EXTEND BEYOND THE OUTLET IN THE EXISTING WALL, CEILING, OR FLOOR TO BE REMOVED, FURNISH AND INSTALL NEW CONDUIT AND WIRE TO EITHER RESROUTE THE CIRCUIT OR FEED THE REMAINING OUTLET(S) FROM ANOTHER ELECTRICAL SOURCE, BUT IN SUCH A MANNER AS NOT TO REVISE THE CIRCUIT. ALL RESROUTED CONDUIT SHALL BE APPROVED BY THE ARCHITECT.
- 4) WHERE EXISTING OUTLETS IN A WALL, CEILING, OR FLOOR TO BE REMOVED ARE ESSENTIAL TO MAINTAIN OPERATION OF OTHER REMAINING OUTLETS, RELOCATE THE OUTLET TO A NEW CONVENIENT LOCATION. EXISTING WIRING DEVICES SHALL NOT BE REUSED, UNLESS OTHERWISE INDICATED.
- 5) WHERE LIGHTING FIXTURES ARE INDICATED TO BE DEMOLISHED, REMOVE ALL WIRE AND MODIFY THE EXISTING CONDUIT (IF APPLICABLE) FOR THE NEW LIGHTING. ALL UNUSED CONDUIT SHALL BE REMOVED.
- 6) WHERE A TELEPHONE CIRCUIT EXTENDS BEYOND AN OUTLET IN AN EXISTING WALL, CEILING, OR FLOOR TO BE REMOVED, PROVIDE NECESSARY EMPTY CONDUIT AND NOTIFY THE OWNER WHO WILL REQUEST THE OWNER TO ARRANGE WITH THE TELEPHONE COMPANY FOR NEW WIRING TO OUTLETS THAT REMAIN.
- 7) WHERE EXISTING CONDUIT AND WIRE RUNS ARE LOCATED IN OR ATTACHED TO AN EXISTING WALL, CEILING OR FLOOR TO BE REMOVED, THEY SHALL BE RESROUTED IN EITHER NEW OR EXISTING CONSTRUCTION TO MAINTAIN CONTINUITY OF CIRCUITS UNLESS OTHERWISE INDICATED.
- 8) CONDUIT SHALL BE CONCEALED WITHIN THE EXISTING BUILDING CONSTRUCTION WHEREVER POSSIBLE, EXCEPT WHERE OTHERWISE INDICATED.
- 9) EXISTING WIRE SHALL BE DISCONNECTED AND REMOVED WHEREVER EXISTING CIRCUITS ARE ABANDONED.

ELECTRICAL SYMBOLS LIST

CIRCUITING & NOTES

+46"	SPECIAL MOUNTING HEIGHT FOR ASSOCIATED DEVICE (CENTERLINE OF DEVICE)
GFI	GROUND FAULT CIRCUIT INTERRUPTER DEVICE
WP	WEATHERPROOF ENCLOSURE ON DEVICE
IG	ISOLATED GROUND DEVICE
EM	EMERGENCY BATTERY BACKUP
(TIE)	PARTIAL HOMERUN. REFER TO PLANS FOR ADDITIONAL DEVICES CONNECTED TO THIS CIRCUIT.
X	ELECTRICAL FLOOR PLAN NOTE WITH DESIGNATION
LP	CONDUIT CONCEALED WHERE POSSIBLE OR AS NOTED, ARROWS INDICATE HOME RUN TO PANEL. CIRCUIT NUMBERS INDICATED
⚡	#12 WIRE IN CONDUIT, UNLESS NOTED OTHERWISE ON DRAWINGS OR SPECIFICATION
⚡	GROUNDING CONDUCTOR, #12 WIRE UNLESS NOTED OTHERWISE ON DRAWINGS OR SPECIFICATION
⚡	CONDUIT ROUTED UNDER FLOOR/GRADE

LIGHTING

⚡	EMERGENCY TWIN HEAD LIGHT FIXTURE
⚡	EXIT LIGHT WITH DIRECTIONAL ARROWS INDICATED
A	STRIP FIXTURE WITH TYPE DESIGNATION
A	RECESSED OR SURFACE MOUNTED FIXTURE WITH TYPE DESIGNATION
A	NIGHT LIGHT, CONNECT TO UNSWITCHED CIRCUIT
A	CEILING OR RECESSED FIXTURE WITH TYPE DESIGNATION
A	WALL MOUNTED FIXTURE WITH TYPE DESIGNATION

POWER DEVICES

⚡	DUPLEX RECEPTACLE, BOTTOM OF BOX AT 16" AFF, UNLESS NOTED OTHERWISE
⚡	HEAVY DUTY OUTLET - NEMA CONFIGURATION SIZE PER EQUIPMENT MANUFACTURER'S RECOMMENDATION
⚡	PANEL BOARD, TOP OF BOX 6'-0" AFF
⚡	JUNCTION BOX
⚡	NON-FUSED DISCONNECT SWITCH
⚡	FUSED DISCONNECT SWITCH
⚡	MOTOR WITH DESIGNATION
⚡	FLOOR BOX

CONTROLS

S	SINGLE POLE WALL SWITCH, TOP OF BOX AT 48" AFF
---	--

OCCUPANCY SENSORS
1. DUAL TECHNOLOGY ULTRASONIC CEILING SENSORS SHALL BE MOUNTED 6' FROM SUPPLY/EXHAUST AIR DIFFUSERS.
2. LOW VOLTAGE CEILING SENSORS SHALL BE PROVIDED WITH 6' SLACK CONDUCTOR COILED AT SENSOR.

S	WALL MOUNTED DUAL-TECHNOLOGY OCCUPANCY SENSOR, WATT STOPPER #DW-100, TOP OF BOX AT 48" AFF
DS	DUAL TECHNOLOGY CEILING MOUNT OCCUPANCY SENSORS, WATTSTOPPER DT-300
SP	OCCUPANCY SENSOR POWER PACK, WATTSTOPPER BZ-150 OR EQUAL, PROVIDE LOW VOLTAGE WIRING TO OCCUPANCY SENSORS AND MOMENTARY SWITCHES
S	MOMENTARY SWITCH, TOP OF BOX AT 48" AFF

COMMUNICATIONS

▼	DATA/TELEPHONE OUTLET WITH MINIMUM ¾" CONDUIT STUBBED UP TO ABOVE ACCESSIBLE CEILING, BOTTOM OF BOX AT 16", UNLESS NOTED OTHERWISE. PROVIDE WITH PULL STRING
---	--

ELECTRICAL GENERAL NOTES:

1. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACES AVAILABLE, AND WITHOUT INTERFERENCES.
2. IT IS THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO PROPERLY BALANCE ALL BRANCH CIRCUITS BETWEEN THE PHASES OF THE SYSTEM REGARDLESS OF CIRCUITING INDICATED.
3. ELECTRICAL CONTRACTOR SHALL REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, FIXTURES, SYSTEMS, CONDUIT AND WIRE, ETC. NOT BEING REUSED, DO NOT JUST ABANDON.
4. ELECTRICAL CONTRACTOR TO COORDINATE MANUFACTURER ELECTRICAL REQUIREMENTS FOR HVAC EQUIPMENT BEING FURNISHED WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. EQUIPMENT DISCONNECTS TO BE PROVIDED BY ELECTRICAL CONTRACTOR UNLESS NOTED OTHERWISE IN MECHANICAL SCHEDULES.
5. ALL MATERIALS EXPOSED WITHIN PLENUMS SHALL BE NONCOMBUSTIBLE OR SHALL HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A SMOKE-DEVELOPED INDEX OF NOT MORE THAN 50 WHEN TESTED IN ACCORDANCE WITH ASTM E 84.
6. ALL BRANCH CIRCUITS SHALL BE SIZED TO ALLOW FOR A MAXIMUM OF 3% VOLTAGE DROP. ALL FEEDERS SHALL BE SIZED TO ALLOW FOR A MAXIMUM OF 2% VOLTAGE DROP. ELECTRICAL CONTRACTOR SHALL VERIFY WIRING INDICATED IS SUFFICIENT AND INCREASE CONDUCTOR SIZE AS REQUIRED BASED OFF ACTUAL INSTALLED LENGTH OF CONDUCTORS.

PANEL: P		VOLTS: 120/208V		PH: 3Ø	WIRE: 4W	LOCATION:			EQPT 106			MOUNTING: SURFACE			
BUS: 400A		MAIN: 400A MLO		IC: 22,000	RMS SYM AMPS						FEEDER: SEE RISER DIAGRAM				
CHT	DESCRIPTION	AMPS	POLE	WIRE	ØA	ØB	ØC	ØA	ØB	ØC	WIRE	POLE	AMPS	DESCRIPTION	CHT NO
1	40LB WASHER	15	2	12	645			645			12	2	15	30LB WASHER	2
3						645			645					30LB WASHER	4
5	40LB WASHER	15	2	12			645			645	12	2	15	30LB WASHER	6
7					645			645						30LB WASHER	8
9	60LB WASHER	20	2	12		874			645		12	2	15	30LB WASHER	10
11							874			645				30LB WASHER	12
13	60LB WASHER	20	2	12	874			645			12	2	15	30LB WASHER	14
15						874			645					30LB WASHER	16
17	80LB WASHER	20	2	12			874			645	12	2	15	30LB WASHER	18
19					874			645						30LB WASHER	20
21	80LB WASHER	20	2	12		874			645		12	2	15	30LB WASHER	22
23							874			645				30LB WASHER	24
25	60LB WASHER	20	2	12	874			645			12	2	15	30LB WASHER	26
27						874			645					30LB WASHER	28
29	60LB WASHER	20	2	12			874			645	12	2	15	30LB WASHER	30
31					874			645						30LB WASHER	32
33	40LB WASHER	15	2	12		645			645		12	2	15	40LB WASHER	34
35							645			645				40LB WASHER	36
37	40LB WASHER	15	2	12	645			645			12	2	15	40LB WASHER	38
39						645			645					40LB WASHER	40
41	WATER HEATERS	20	1	12			900			960	12	1	20	30LB DRYER STACK	42


SECTION 2															
43	50LB DRYER STACK	30	1	10	2,400			960			12	1	20	30LB DRYER STACK	44
45	50LB DRYER STACK	30	1	10		2,400			960		12	1	20	30LB DRYER STACK	46
47	50LB DRYER STACK	30	1	10			2,400			960	12	1	20	30LB DRYER STACK	48
49	50LB DRYER STACK	30	1	10	2,400			960			12	1	20	30LB DRYER STACK	50
51	50LB DRYER STACK	30	1	10		2,400			960		12	1	20	30LB DRYER STACK	52
53	CHANGE MACHINE	20	1	12			150			960	12	1	20	30LB DRYER STACK	54
55	SOAP VENDING	20	1	12	150			540			12	1	20	DISPLAY WINDOW RECEPES	56
57	VENDING MACHINE [GF]	20	1	12		1,200			1,250		12	1	20	VIDEOGAME MACHINES	58
59	VENDING MACHINE [GF]	20	1	12			1,200			1,250	12	1	20	VIDEOGAME MACHINES	60
61	RECEPTACLES	20	1	12	1,260			1,250			12	1	20	VIDEOGAME MACHINES	62
63	LAUNDROMAT LIGHTS	20	1	12		1,252			1,250		12	1	20	VIDEOGAME MACHINES	64
65	OFFICE/SERVICE LIGHTS	20	1	12			337			1,200	12	1	20	BUILDING SIGNAGE	66
67	SPARE	20	1					1,667							68
69	SPARE	20	1						1,667		12	3	20	EUH-1	70
71	SPARE	20	1						1,667						72
73	SPARE	20	1					3,250							74
75	SPARE	20	1						3,250		8	3	40	EXISTING CONDENSING UNIT	76
77	EXISTING FURNACE	20	1	12			1,200			3,250					78
79					3,250			10,000							80
81	EXISTING CONDENSING UNIT	40	3	8		3,250			10,000		3	3	100	EXISTING AHU	82
83						3,250				10,000					84

NOTES:	14,891	15,933	14,223	23,142	23,852	24,117
(GF)-GFCI BRKR 50mA	38,033	39,785	38,340			
TOTAL CONNECTED LOAD:						116,158 VA
NEC DEMAND LOAD:						96,380 VA
DEMAND AMPS @ 208 VOLT / 3Ø:						267.52 A

DRAWN BY: MA/DS
BC PROJECT #: 23888
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on the project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2024 BC Engineers, Inc.

GUY GRONBERG
ARCHITECTS, P.C.
113 SE 3rd St.
Lees Summit, MO 64063
Phone: 816.324.0876
Fax: 816.324.6576




BC ENGINEERS
INCORPORATED
5720 Reeder Shawnee, KS 66203 (913)622-1772

SOUTHSIDE
PLAZA
404 Southwest
Nichols Street
Lees Summit
Missouri, 64063

Snappy
Clean
LANDROMAT

REV.#	DATE</
-------	--------

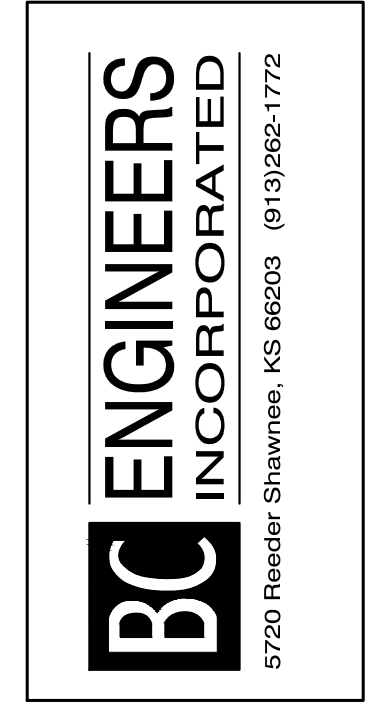


SOUTHSIDE
PLAZA
404 Southwest
Nichols Street
Lees Summit
Missouri, 64063

Snappy
Clean
LANDROMAT



REV/#	DATE	DESCRIPTION	
Issue Date:		01-11-24	
Project #:		23033	

ELECTRICAL LIGHTING
PLAN
E1

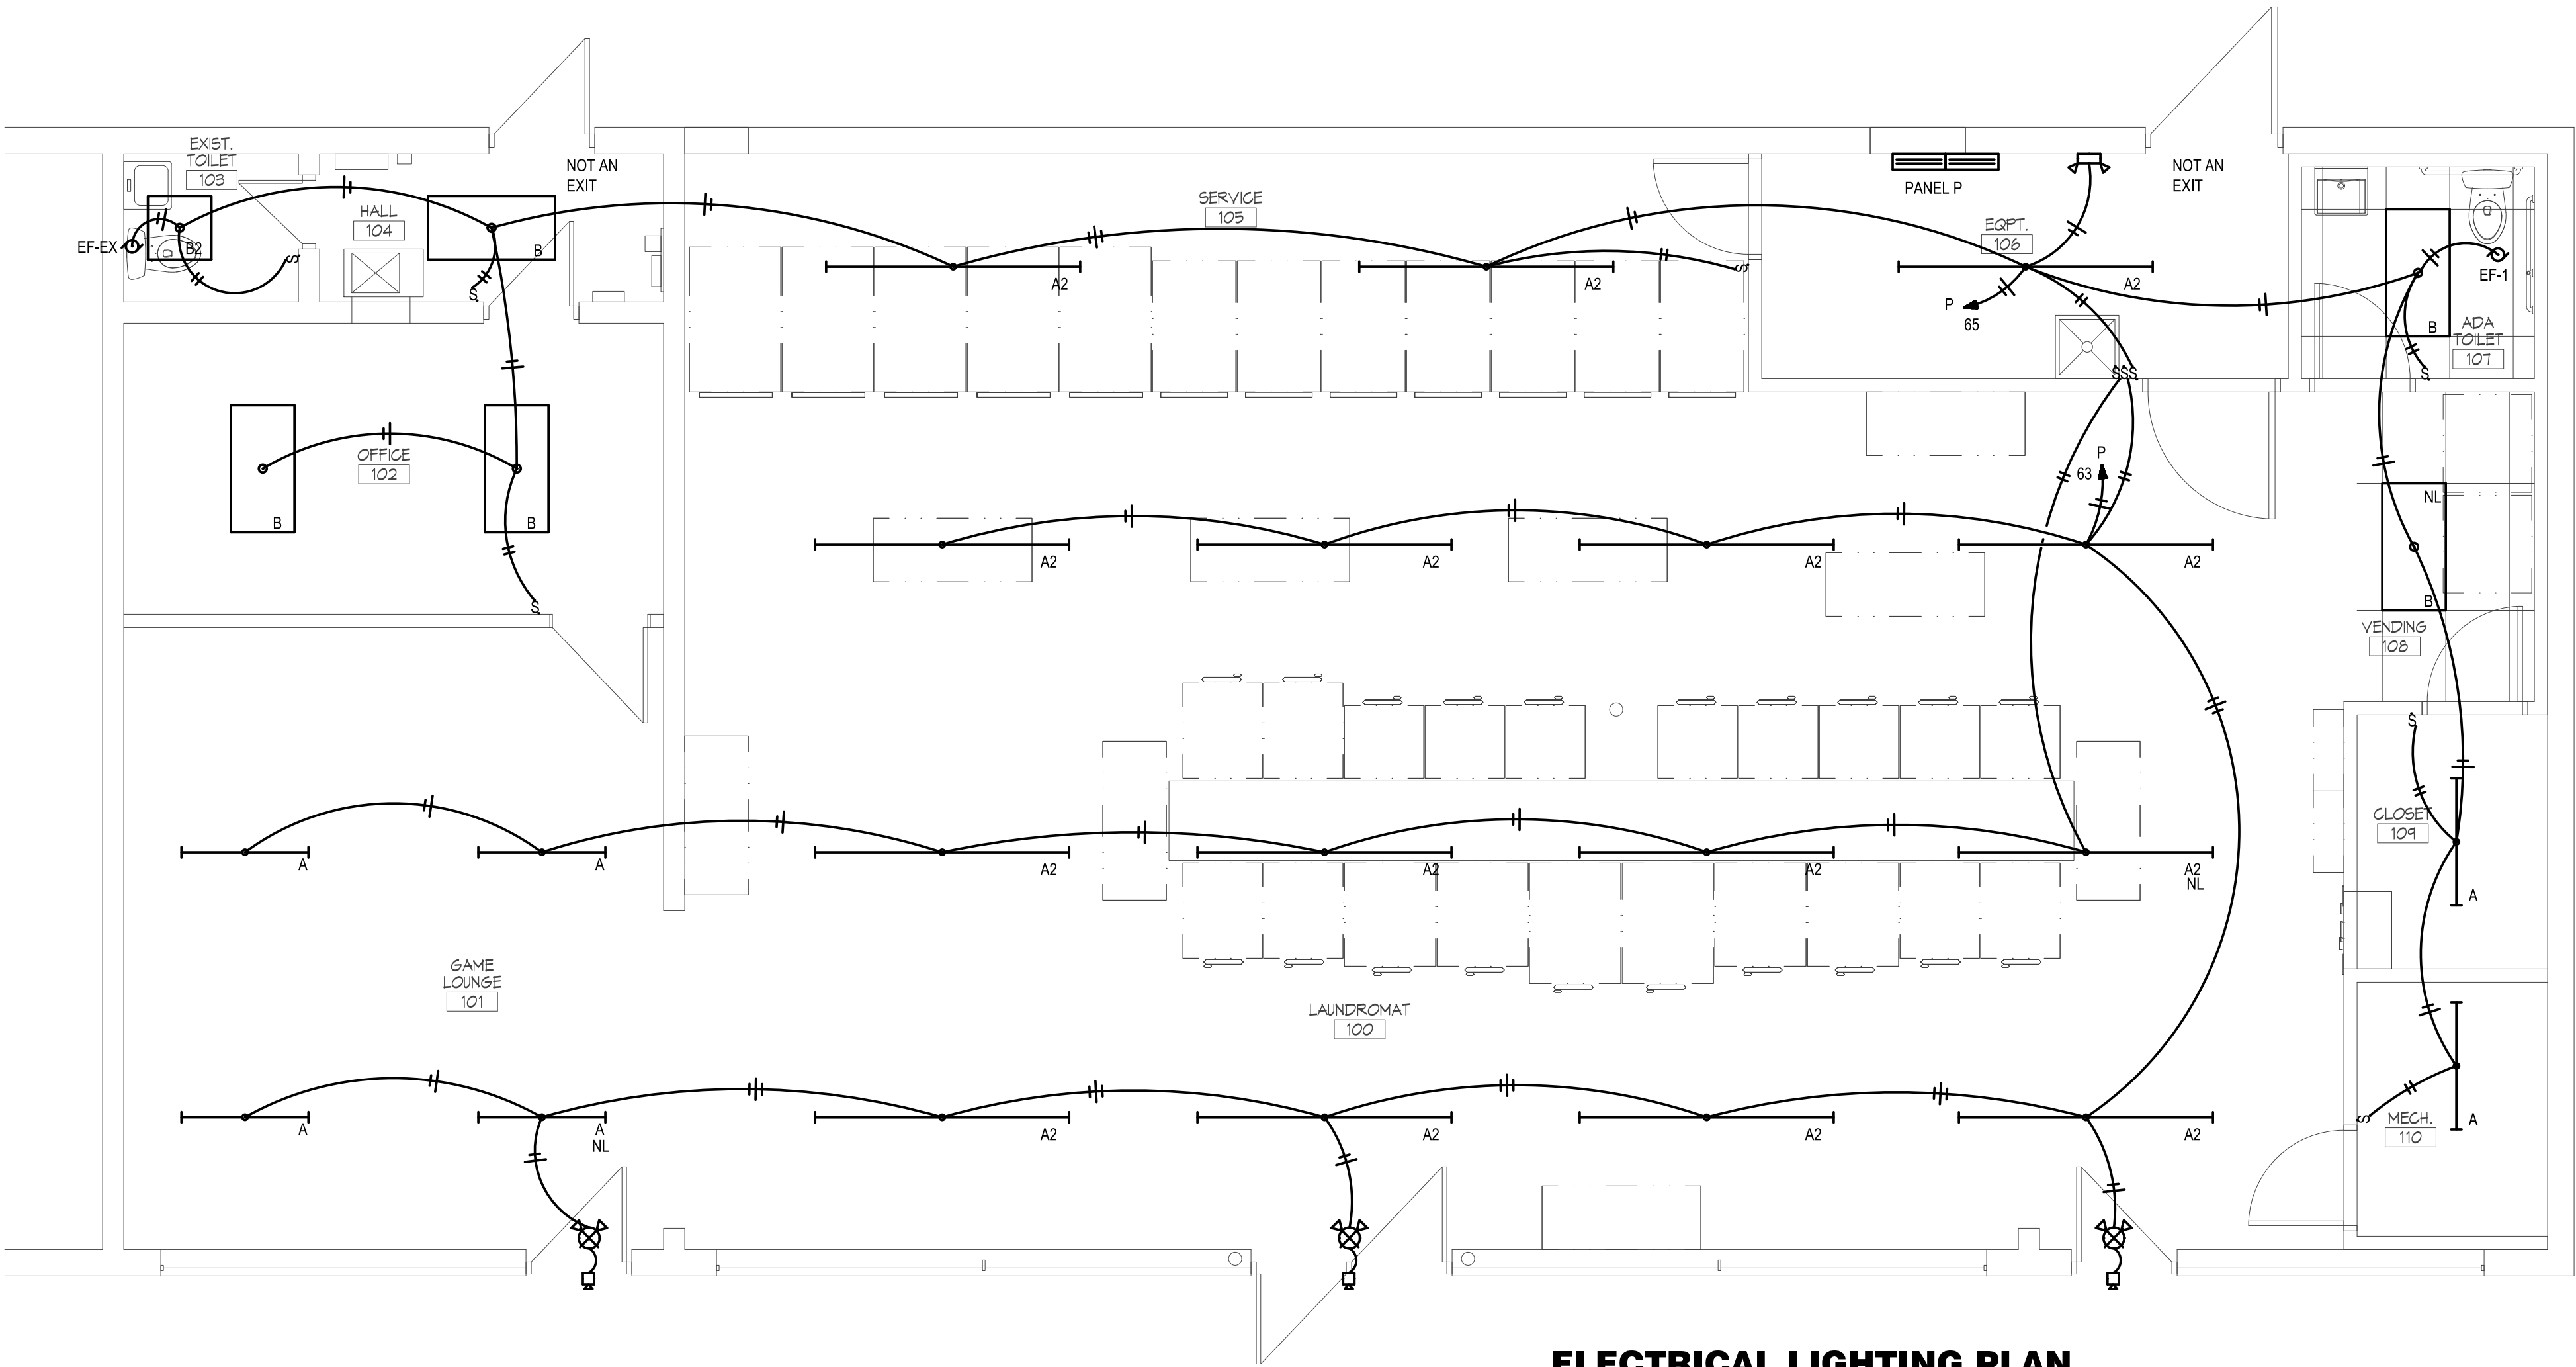

ELECTRICAL LIGHTING PLAN
SCALE: 1/4" = 1'-0"

LIGHT FIXTURE SCHEDULE					
MARK NO.	MANUFACTURER & CATALOG NUMBER	VOLTS WATTS	LIGHT SOURCE	DESCRIPTION	EQUIVALENT MANUFACTURERS
A	LTHONIA CSS-L48-AL03-MVOLT-SWW3-80CRI	120 44	LED 5150LUM 4000K	4' LED STRIP LIGHT WITH FIELD SELECTABLE COLOR TEMPERATURE AND OUTPUT	WILLIAMS COLUMBIA OR EQUAL
A2	LTHONIA CSS-L96-AL04-MVOLT-SWW3-80CRI	120 90	LED 10000LUM 4000K	8' LED STRIP LIGHT WITH FIELD SELECTABLE COLOR TEMPERATURE AND OUTPUT	WILLIAMS COLUMBIA OR EQUAL
B	LTHONIA CPANL-2X4-AL06-SWW7-M2	120 41	LED 6000LUM 4000K	2X4 LED FLAT PANEL WITH FIELD SELECTABLE COLOR TEMPERATURE AND OUTPUT	WILLIAMS COLUMBIA OR EQUAL
B2	LTHONIA CPANL-2X2-AL01-SWW7-M2	120 31	LED 3300LUM 4000K	2X2 LED FLAT PANEL WITH FIELD SELECTABLE COLOR TEMPERATURE AND OUTPUT	WILLIAMS COLUMBIA OR EQUAL
⌘	LTHONIA ELM-LT-W-LP06VS-LTP	120 1	INCL	EMERGENCY LIGHT WITH TWIN ADJUSTABLE LED HEADS AND LITHIUM IRON PHOSPHATE BATTERY, MOUNT AT 7'-6"±, TO CLEAR OBSTACLES, (PROVIDES 1 FC AVG. ON 54" CENTER FIXTURE SPACING), WHITE FINISH	SURE-LITES DUAL-LITE OR EQUAL
⌘	LTHONIA LHQML-LED-R-HO-SD WITH ELA-TQWP-L0309	120 5	INCL	COMBINATION EMERGENCY/EXIT LIGHT WITH LED LAMPS, RED LETTERS ON WHITE BACKGROUND, TWIN 6W EMERGENCY LIGHT HEADS, UNIVERSAL MOUNT, HIGH CAPACITY BATTERY BACKUP AND REMOTE TWIN HEAD OUTDOOR RATED FIXTURE	SURE-LITES LITHONIA OR EQUAL

DRAWN BY: MA/DS
BC PROJECT #: 23888
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2024 BC Engineers, Inc.



**GUY GRONBERG
ARCHITECTS, P.C.**
113 SE 3rd St.
Lees Summit, MO 64083
Phone: 816.284.1086
Fax: 816.284.6076


G²

**BC ENGINEERS
INCORPORATED**
5720 Reeder Shawnee, KS 66203 (913)692-1772

BC

**SOUTHSIDE
PLAZA**
404 Southwest
Nichols Street
Lees Summit
Missouri, 64063


**Snappy
Clean**
LANDROMAT



REV/#	DATE	DESCRIPTION
Issue Date:		01-11-24
Project #:		23033

**ELECTRICAL POWER
PLAN**

E2

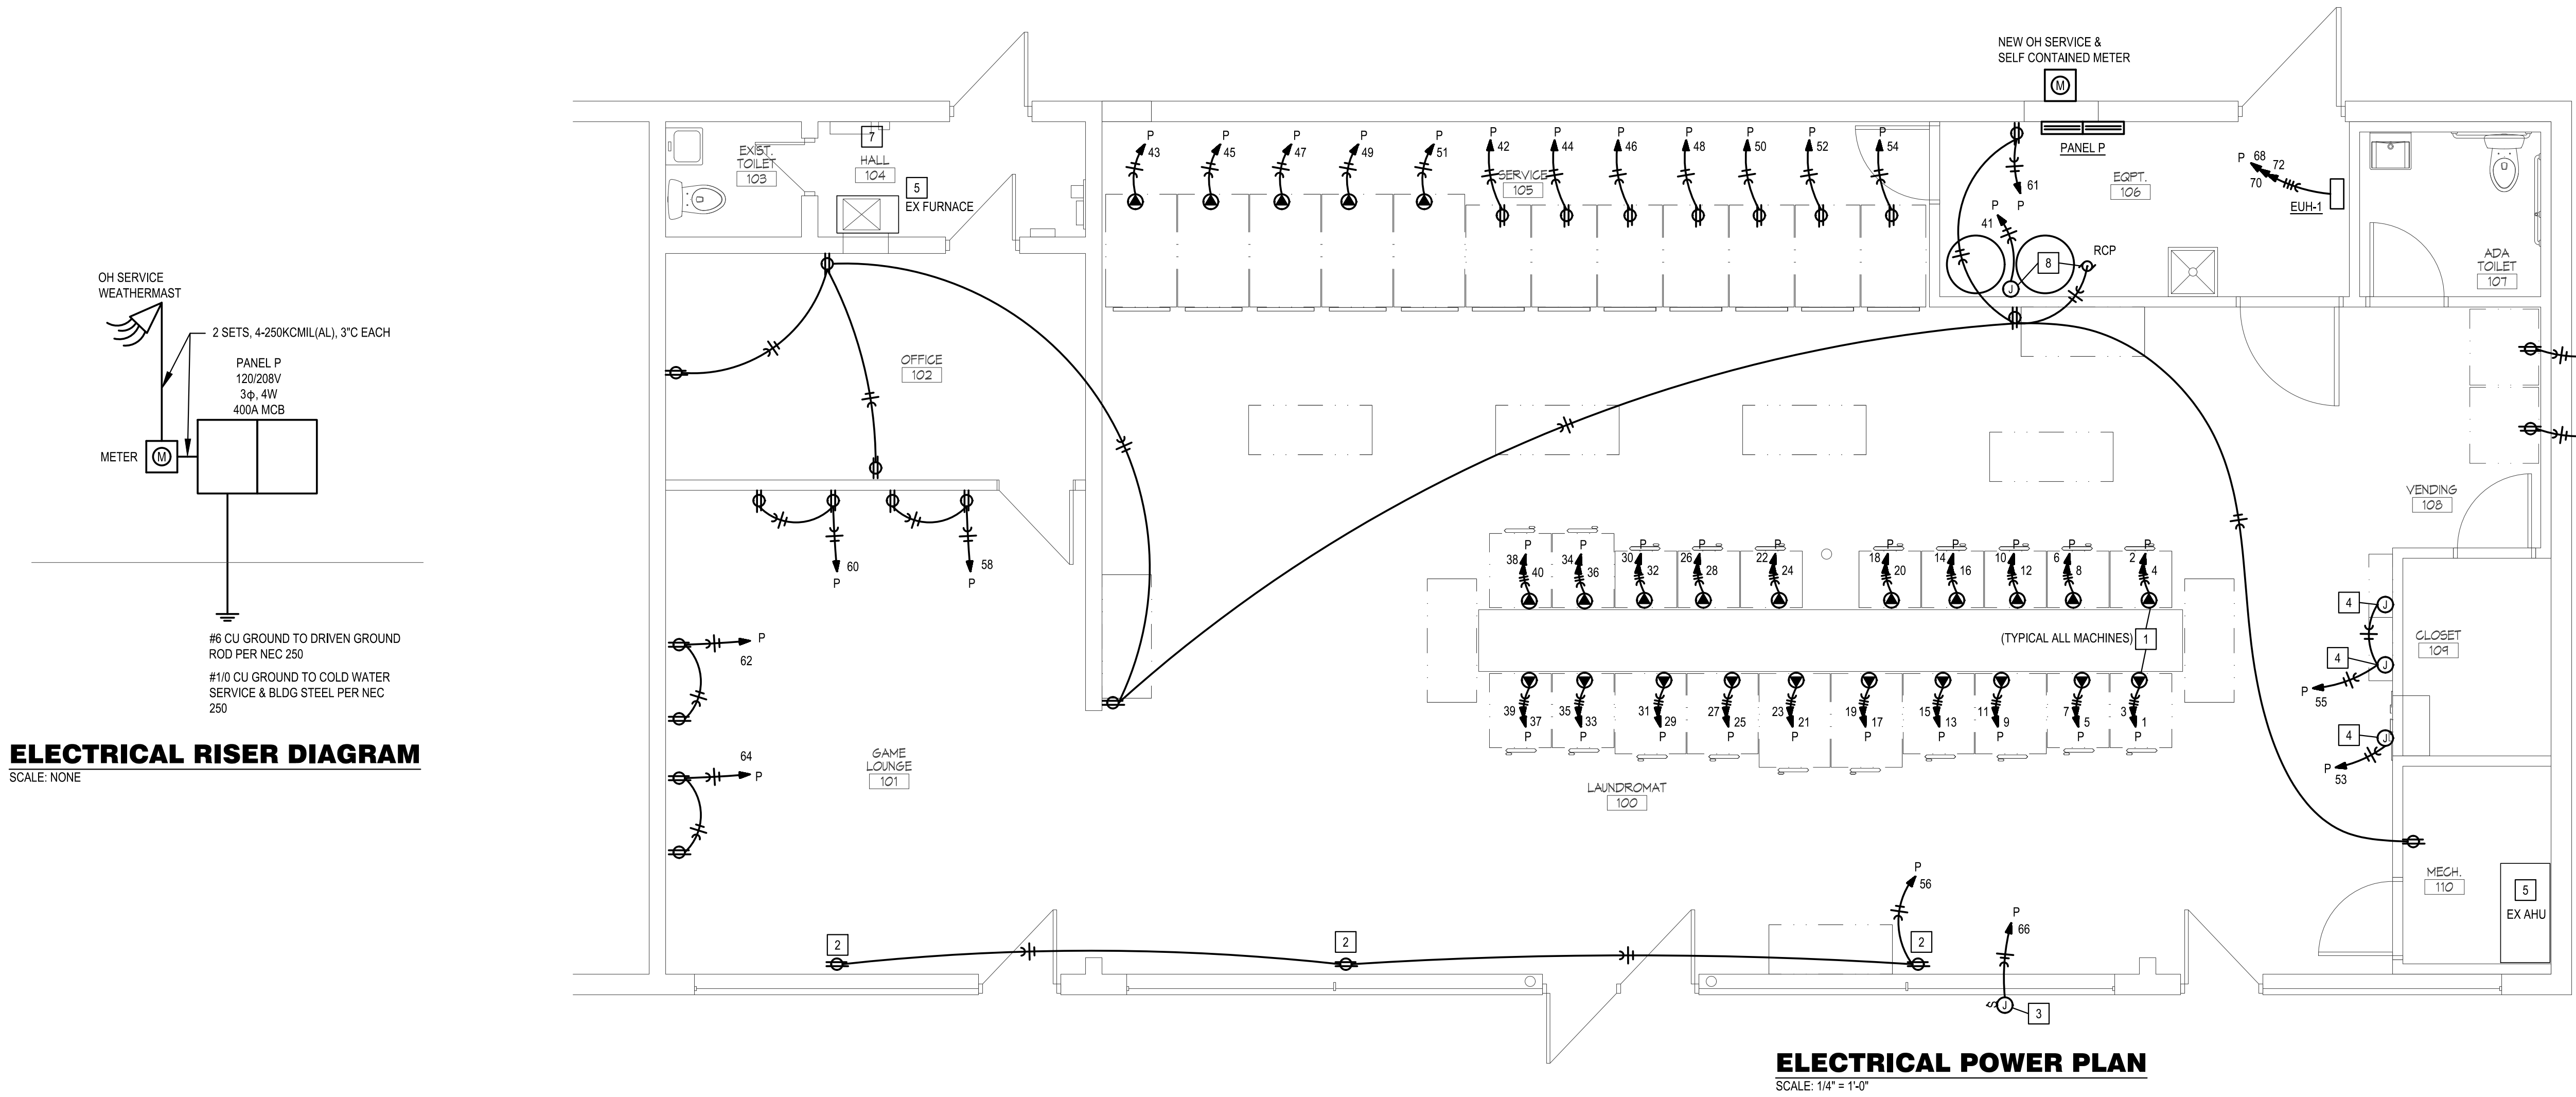

ELECTRICAL RISER DIAGRAM
SCALE: NONE

ELECTRICAL POWER PLAN
SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN NOTES:

- 1 PROVIDE CORD & PLUG PER MANUFACTURER'S REQUIREMENTS AND CONNECT TO OWNER'S EQUIPMENT AS REQUIRED FOR PROPER OPERATION.
- 2 DUPLEX RECEPTACLE MOUNTED ABOVE STOREFRONT GLASS FOR DISPLAY WINDOW SIGNAGE PER NEC.
- 3 JUCTION BOX FOR CONNECTION TO BUILDING SIGNAGE. VERIFY EXACT LOCATION & REQUIREMENTS WITH SIGNAGE VENDOR. ROUTE CIRCUIT TO PANEL VIA EXTERIOR LIGHTING TIMECLOCK, INTERMATIC NET225C OR EQUAL TIMECLOCK LOCATED ADJACENT TO PANEL. PROGRAM TIMECLOCK TO AUTOMATICALLY CONTROL SIGNAGE AS DIRECTED BY OWNER.
- 4 CONNECT TO CHANGE MACHINE & SOAP VENDING MACHINE PER MANUFACTURER'S INSTRUCTIONS. VERIFY EXACT LOCATION & REQUIREMENTS.
- 5 INTERCEPT EXISTING CIRCUIT AND RE-ROUTE TO NEW BREAKER IN PANEL P. REFER TO PANEL SCHEDULE.
- 6 CONNECT TO GAS WATER HEATERS AND RE-CIRC PUMP PER MANUFACTURER'S INSTRUCTIONS.
- 7 REMOVE EXISTING ELECTRICAL SERVICE

DRAWN BY: MA/DS
BC PROJECT #: 23888
MISSOURI PE COA #2009003629

This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2024 BC Engineers, Inc.