



RE: B240019 - Lot 170 HT

Site Information:

Project Customer: Summit Homes Project Name:
Lot/Block: 170 Subdivision: Hawthorne Ridge
Model: Riverside - Farmhouse
Address: 3208 SW Arbor Sound Dr
City: Lee's Summit State: MO

MiTek, Inc.

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.7
Wind Code: ASCE 7-16 [Wind Speed: 115 mph] Design Method: MWFRS (Envelope) ASCE 7-16 [Low Rise]
Roof Load: 45.0 psf Floor Load: N/A psf
Mean Roof Height (feet): 25 Exposure Category: C

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I63818340	A1	2/23/24	35	I63818374	V6	2/23/24
2	I63818341	A2	2/23/24	36	I63818375	V7	2/23/24
3	I63818342	A3	2/23/24	37	I63818376	V8	2/23/24
4	I63818343	B1	2/23/24	38	I63818377	V9	2/23/24
5	I63818344	B2	2/23/24	39	I63818378	V10	2/23/24
6	I63818345	C1	2/23/24	40	I63818379	V11	2/23/24
7	I63818346	C2	2/23/24	41	I63818380	V12	2/23/24
8	I63818347	D1	2/23/24	42	I63818381	V13	2/23/24
9	I63818348	D2	2/23/24				
10	I63818349	E1	2/23/24				
11	I63818350	E2	2/23/24				
12	I63818351	E3	2/23/24				
13	I63818352	G1	2/23/24				
14	I63818353	G2	2/23/24				
15	I63818354	G3	2/23/24				
16	I63818355	H1	2/23/24				
17	I63818356	H2	2/23/24				
18	I63818357	H3	2/23/24				
19	I63818358	H4	2/23/24				
20	I63818359	H5	2/23/24				
21	I63818360	H6	2/23/24				
22	I63818361	H7	2/23/24				
23	I63818362	H8	2/23/24				
24	I63818363	H9	2/23/24				
25	I63818364	J1	2/23/24				
26	I63818365	J2	2/23/24				
27	I63818366	J3	2/23/24				
28	I63818367	LAY1	2/23/24				
29	I63818368	R1	2/23/24				
30	I63818369	V1	2/23/24				
31	I63818370	V2	2/23/24				
32	I63818371	V3	2/23/24				
33	I63818372	V4	2/23/24				
34	I63818373	V5	2/23/24				

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision based on the parameters
provided by Wheeler - Waverly.

Truss Design Engineer's Name: Sevier, Scott

My license renewal date for the state of Missouri is December 31, 2025.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



February 23, 2024


Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	A1	Hip Girder	1	1	Job Reference (optional)	I63818340

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:46

Page: 1

ID:XpMCmw72opF9?k_wkjEbUFziJg-JrFC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?i

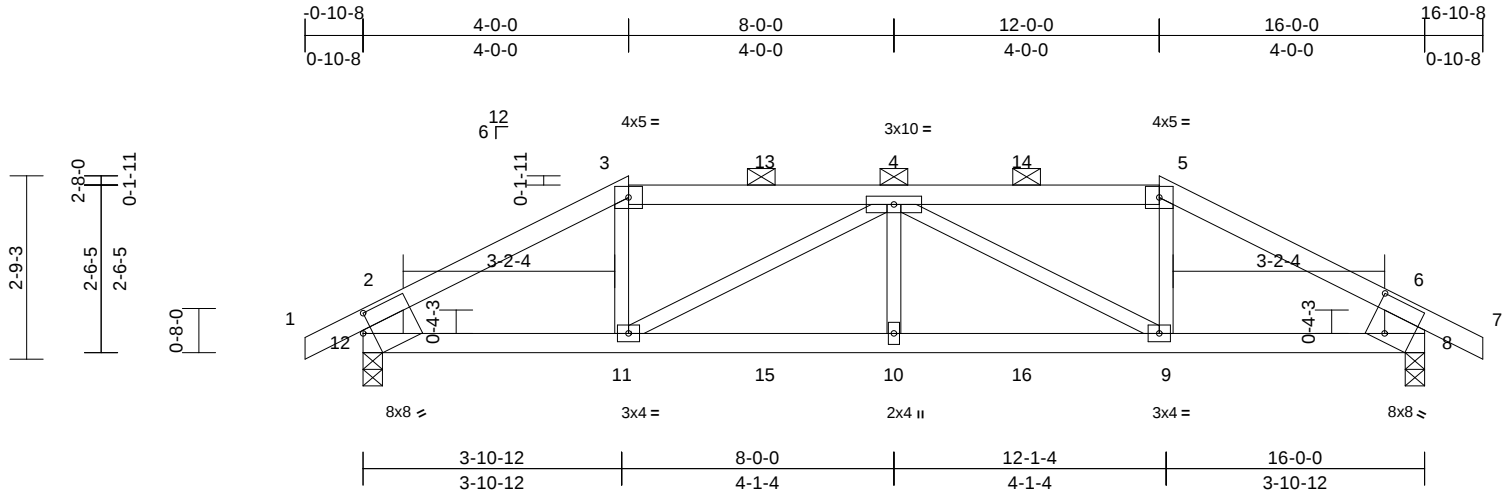

Scale = 1:34.7

Plate Offsets (X, Y): [8:0-3-2,0-6-8], [12:0-1-10,0-3-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.10	10-11	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.88	Vert(CT)	-0.19	10-11	>964	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.41	Horz(CT)	0.04	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.09	9-10	>999	240	Weight: 54 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 12-2,8-6:2x8 SP
2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or
2-10-13 oc purlins, except end verticals, and
2-0-0 oc purlins (4-11-14 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 9-1-10 oc
bracing.

REACTIONS (size) 8=0-3-8, 12=0-3-8
Max Horiz 12=-50 (LC 6)
Max Uplift 8=-218 (LC 9), 12=-218 (LC 8)
Max Grav 8=1051 (LC 1), 12=1051 (LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-2=0/37, 2-3=-1468/313, 3-4=-1210/287,
4-5=-1210/287, 5-6=-1468/313, 6-7=0/37,
2-12=-926/224, 6-8=-926/224

BOT CHORD 11-12=-259/1223, 10-11=-412/1854,
9-10=-412/1854, 8-9=-236/1223

WEBS 3-11=0/396, 5-9=0/396, 4-10=0/283,
4-11=-761/200, 4-9=-761/200

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) All bearings are assumed to be SPF No.2 .
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 218 lb uplift at joint 12 and 218 lb uplift at joint 8.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 184 lb down and 147 lb up at 4-0-0, 86 lb down and 65 lb up at 6-0-12, 86 lb down and 65 lb up at 8-0-0, and 86 lb down and 65 lb up at 9-11-4, and 184 lb down and 147 lb up at 12-0-0 on top chord, and 74 lb down at 4-0-0, 31 lb down at 6-0-12, 31 lb down at 8-0-0, and 31 lb down at 9-11-4, and 74 lb down at 11-11-4 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-6=-70, 6-7=-70, 8-12=-20
Concentrated Loads (lb)
Vert: 3=-111 (B), 5=-111 (B), 11=-58 (B), 9=-58 (B), 10=-25 (B), 4=-46 (B), 13=-46 (B), 14=-46 (B), 15=-25 (B), 16=-25 (B)



February 23,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818341
B240019	A2	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:48
ID:tE6EH?nsducH0HGLX7Dop8ziJgm-RfC?PsB70Hq3NSgPqnl8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

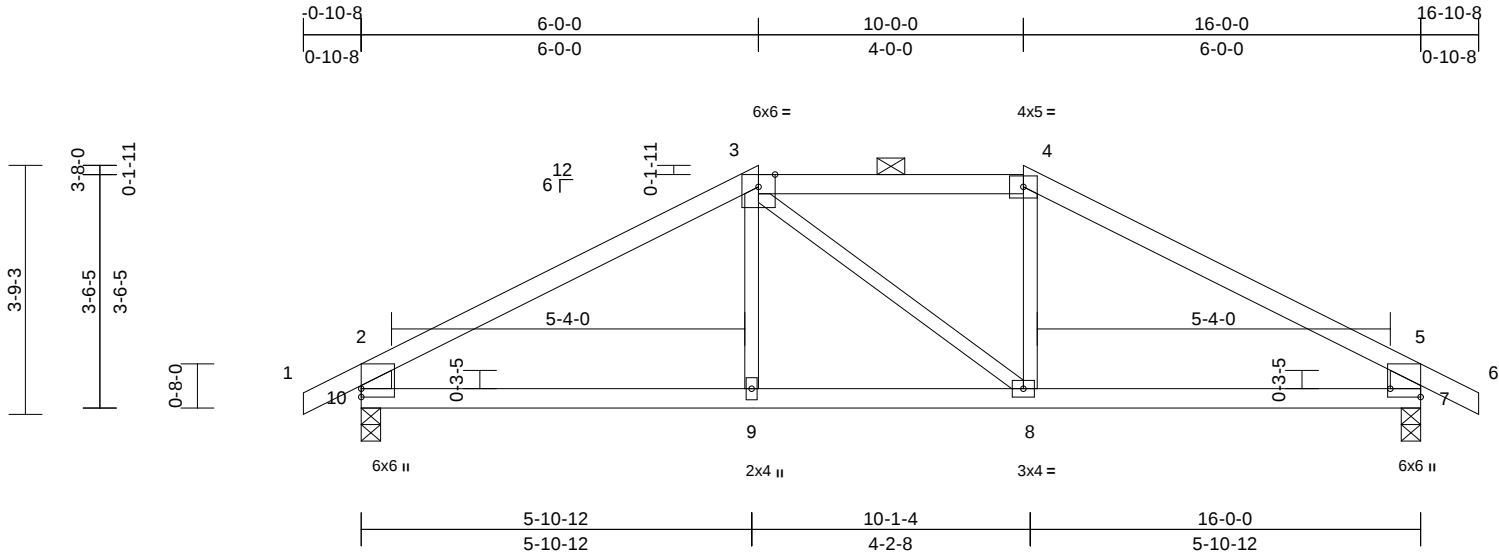

Scale = 1:34.8

Plate Offsets (X, Y): [7:Edge,0-5-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	-0.04	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.35	Vert(CT)	-0.08	8-9	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.02	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.02	8-9	>999	240	Weight: 51 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 10-2,7-5:2x6 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-1-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)

7=0-3-8, 10=0-3-8
Max Horiz 10=-61 (LC 6)
Max Uplift 7=-97 (LC 9), 10=-97 (LC 8)
Max Grav 7=777 (LC 1), 10=777 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/35, 2-3=-980/79, 3-4=-780/115, 4-5=-980/78, 5-6=0/35, 2-10=-708/140, 5-7=-708/140
BOT CHORD 9-10=-34/782, 8-9=-36/780, 7-8=0/783
WEBS 3-9=0/189, 3-8=-114/115, 4-8=0/189

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 97 lb uplift at joint 10 and 97 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



February 23,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	A3	Common	3	1	Job Reference (optional)	I63818342

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:48
ID:vBszku21ozNPT?RizYIJMSyXqDiRfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

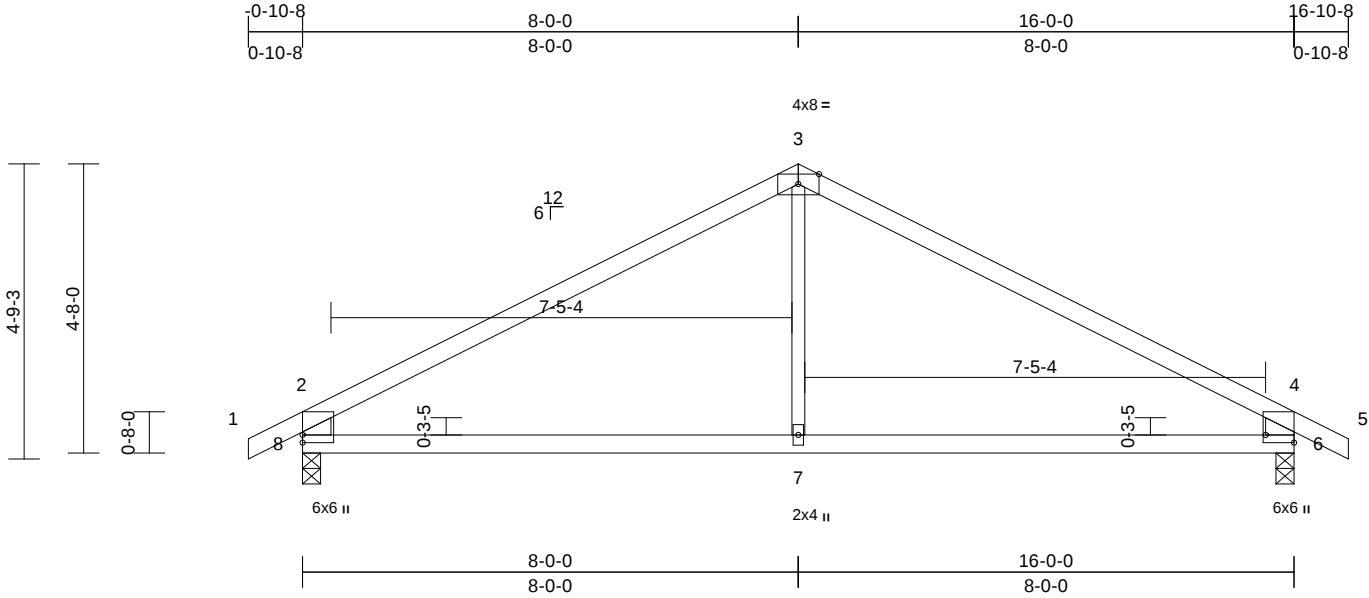

Scale = 1:37.2

Plate Offsets (X, Y): [6:Edge,0-5-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.07	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.15	7-8	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.02	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.05	7-8	>999	240	Weight: 46 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x6 SPF No.2 *Except* 7-3:2x3 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 6=0-3-8, 8=0-3-8

Max Horiz 8=75 (LC 6)
Max Uplift 6=-112 (LC 9), 8=-112 (LC 8)
Max Grav 6=777 (LC 1), 8=777 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/35, 2-3=-905/121, 3-4=-905/121, 4-5=0/35, 2-8=-717/168, 4-6=-717/168
BOT CHORD 7-8=-27/693, 6-7=-27/693
WEBS 3-7=0/345

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 112 lb uplift at joint 8 and 112 lb uplift at joint 6.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818343
B240019	B1	Monopitch	7	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:48
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

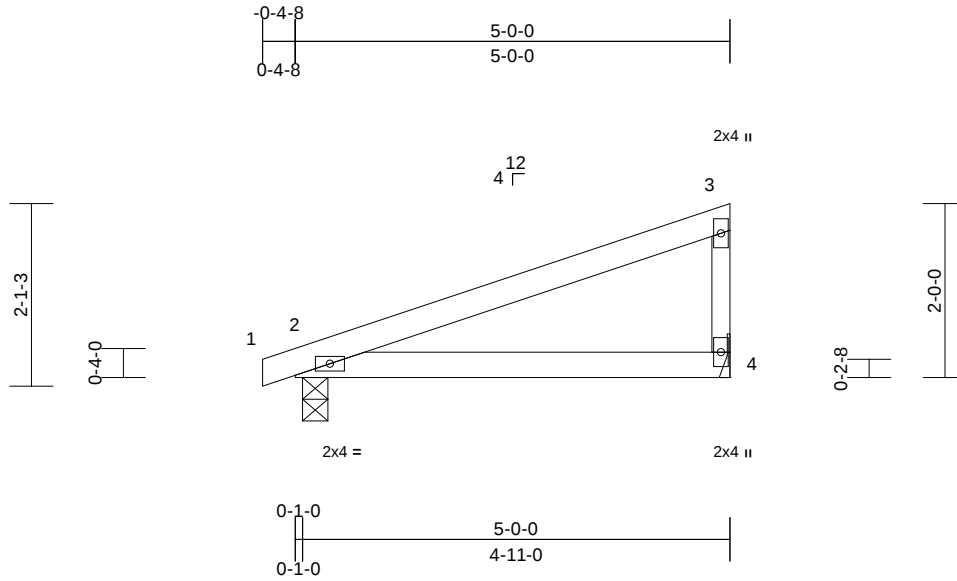

Scale = 1:26.5

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	-0.03	2-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.06	2-4	>933	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 13 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4= Mechanical
Max Horiz 2=76 (LC 5)
Max Uplift 2=-58 (LC 4), 4=-45 (LC 8)
Max Grav 2=252 (LC 1), 4=212 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/6, 2-3=-66/43, 3-4=-164/74
BOT CHORD 2-4=-24/18

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 4 and 58 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818344
B240019	B2	Monopitch	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:49
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

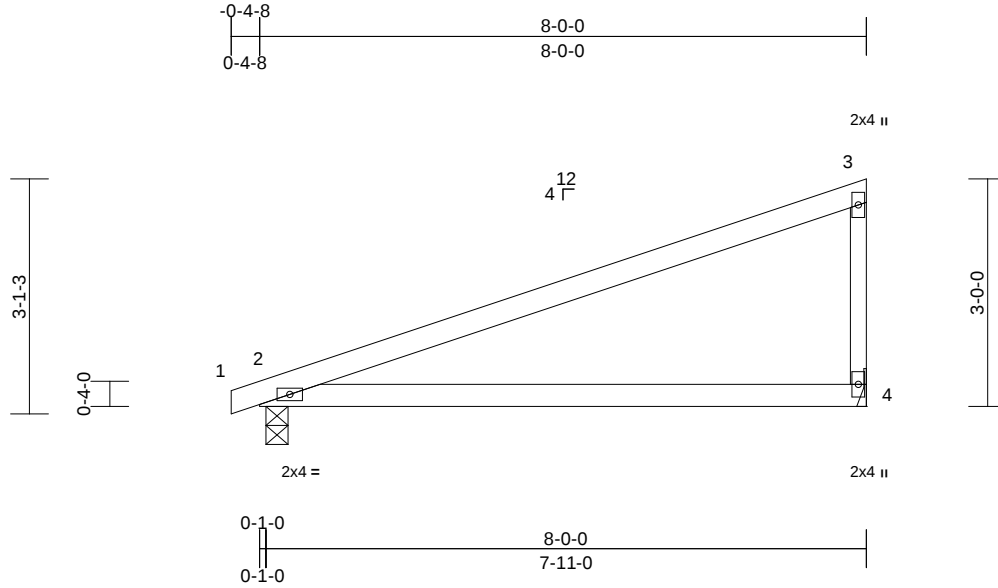

Scale = 1:30.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.77	Vert(LL)	-0.17	2-4	>553	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.34	2-4	>276	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 21 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
6'-0" oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc
bracing.

REACTIONS (size) 2=0-3-8, 4= Mechanical
Max Horiz 2=121 (LC 5)
Max Uplift 2=-79 (LC 4), 4=-74 (LC 8)
Max Grav 2=386 (LC 1), 4=348 (LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-2=0/6, 2-3=-105/70, 3-4=-270/121
BOT CHORD 2-4=-38/29

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat.
II; Exp C; Enclosed; MWFRS (envelope) exterior zone;
cantilever left and right exposed; end vertical left and
right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3'-0" tall by 2'-0" wide will fit between the bottom
chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 74 lb uplift at joint
4 and 79 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018
International Residential Code sections R502.11.1 and
R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818345
B240019	C1	GABLE	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:49
ID:vBszku21ozNPT?RlZyYjMSyXqDiRfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

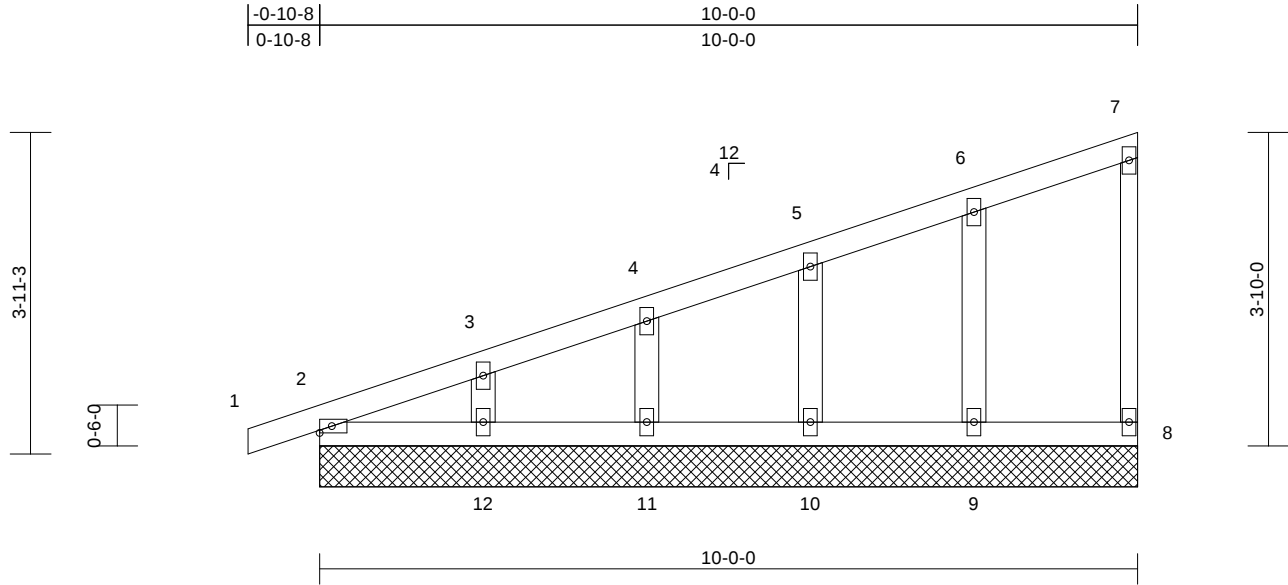

Scale = 1:28.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	8	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 35 lb FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=10-0-0, 8=10-0-0, 9=10-0-0, 10=10-0-0, 11=10-0-0, 12=10-0-0
Max Horiz	2=158 (LC 7)
Max Uplift	2=-22 (LC 4), 8=-16 (LC 5), 9=-46 (LC 4), 10=-42 (LC 8), 11=-44 (LC 4), 12=-52 (LC 8)
Max Grav	2=150 (LC 1), 8=69 (LC 1), 9=194 (LC 1), 10=177 (LC 1), 11=180 (LC 1), 12=182 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/6, 2-3=-129/27, 3-4=-102/21, 4-5=-86/21, 5-6=-76/22, 6-7=-61/29, 7-8=-53/22
BOT CHORD	2-12=-50/37, 11-12=-50/37, 10-11=-50/37, 9-10=-50/37, 8-9=-50/37
WEBS	3-12=-140/77, 4-11=-141/67, 5-10=-138/68, 6-9=-151/62

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.

- 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) All bearings are assumed to be SPF No.2 .
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 8, 22 lb uplift at joint 2, 52 lb uplift at joint 12, 44 lb uplift at joint 11, 42 lb uplift at joint 10 and 46 lb uplift at joint 9.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job B240019	Truss C2	Truss Type Monopitch	Qty 10	Ply 1	Lot 170 HT Job Reference (optional)	I63818346
----------------	-------------	-------------------------	-----------	----------	--	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:49
ID:vBszku21ozNPT?RizYIJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

Page: 1

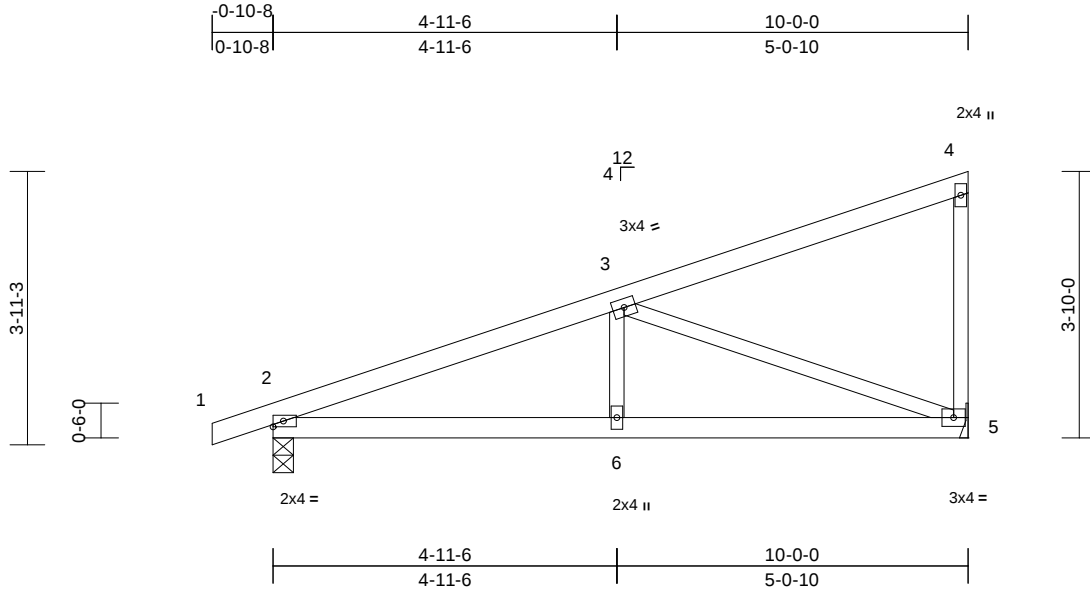

Scale = 1:33.2

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	-0.02	2-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.04	5-6	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.50	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.02	2-6	>999	240	Weight: 33 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 5= Mechanical
Max Horiz 2=158 (LC 5)
Max Uplift 2=-115 (LC 4), 5=-94 (LC 8)
Max Grav 2=514 (LC 1), 5=435 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/6, 2-3=-782/113, 3-4=-109/21, 4-5=-141/57

BOT CHORD 2-6=-134/682, 5-6=-134/682
WEBS 3-6=0/228, 3-5=-714/178

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 5 and 115 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818347
B240019	D1	Common Supported Gable	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:49
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f

Page: 1

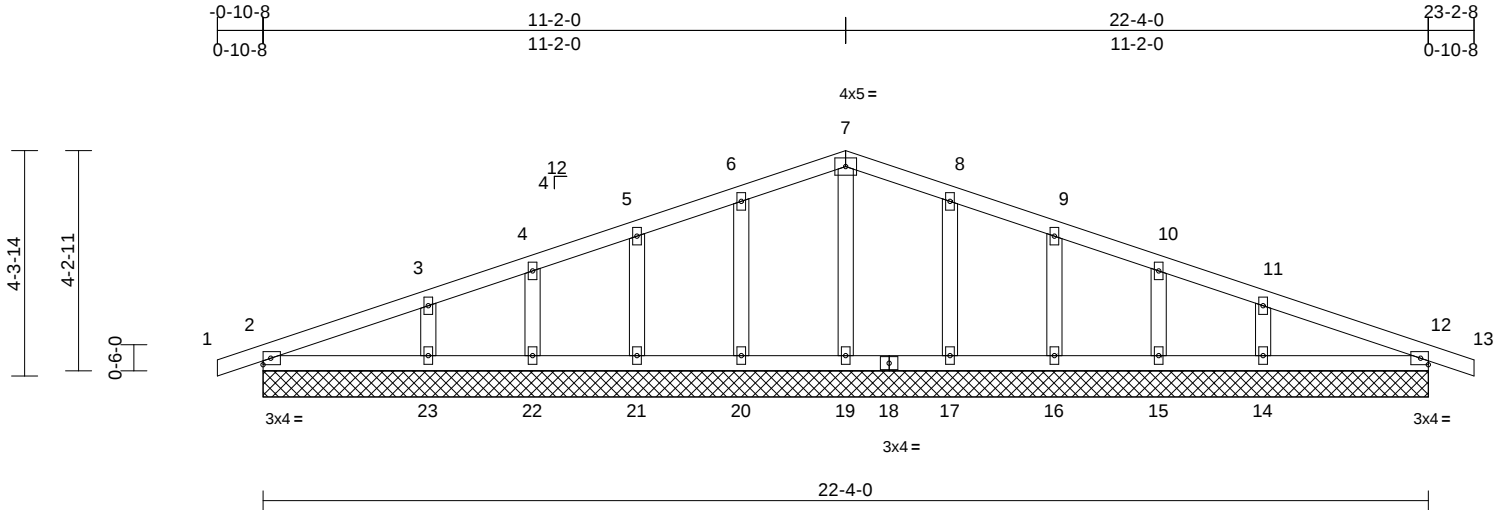

Scale = 1:44.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	n/a	-	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	12	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S						Weight: 77 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=22-4-0, 12=22-4-0, 14=22-4-0, 15=22-4-0, 16=22-4-0, 17=22-4-0, 19=22-4-0, 20=22-4-0, 21=22-4-0, 22=22-4-0, 23=22-4-0
Max Horiz	2=71 (LC 8)
Max Uplift	2=-45 (LC 4), 12=-54 (LC 5), 14=-68 (LC 9), 15=-36 (LC 5), 16=-44 (LC 9), 17=-46 (LC 9), 20=-46 (LC 8), 21=-44 (LC 8), 22=-36 (LC 4), 23=-70 (LC 8)
Max Grav	2=191 (LC 1), 12=191 (LC 1), 14=275 (LC 22), 15=145 (LC 22), 16=187 (LC 1), 17=189 (LC 22), 19=163 (LC 1), 20=189 (LC 21), 21=187 (LC 1), 22=145 (LC 21), 23=275 (LC 21)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/6, 2-3=-81/59, 3-4=-47/60, 4-5=-28/75, 5-6=-29/92, 6-7=-31/110, 7-8=-31/106, 8-9=-29/77, 9-10=-28/47, 10-11=-35/28, 11-12=-56/38, 12-13=0/6
BOT CHORD	2-23=-3/57, 22-23=-3/57, 21-22=-3/57, 20-21=-3/57, 19-20=-3/57, 17-19=-3/57, 16-17=-3/57, 15-16=-3/57, 14-15=-3/57, 12-14=-3/57
WEBS	7-19=-123/0, 6-20=-150/70, 5-21=-144/69, 4-22=-117/57, 3-23=-205/101, 8-17=-150/69, 9-16=-144/69, 10-15=-117/57, 11-14=-205/99

NOTES

- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SPF No.2 .
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 2, 46 lb uplift at joint 20, 44 lb uplift at joint 21, 36 lb uplift at joint 22, 70 lb uplift at joint 23, 46 lb uplift at joint 17, 44 lb uplift at joint 16, 36 lb uplift at joint 15, 68 lb uplift at joint 14 and 54 lb uplift at joint 12.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 12.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818348
B240019	D2	Common	5	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:50
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

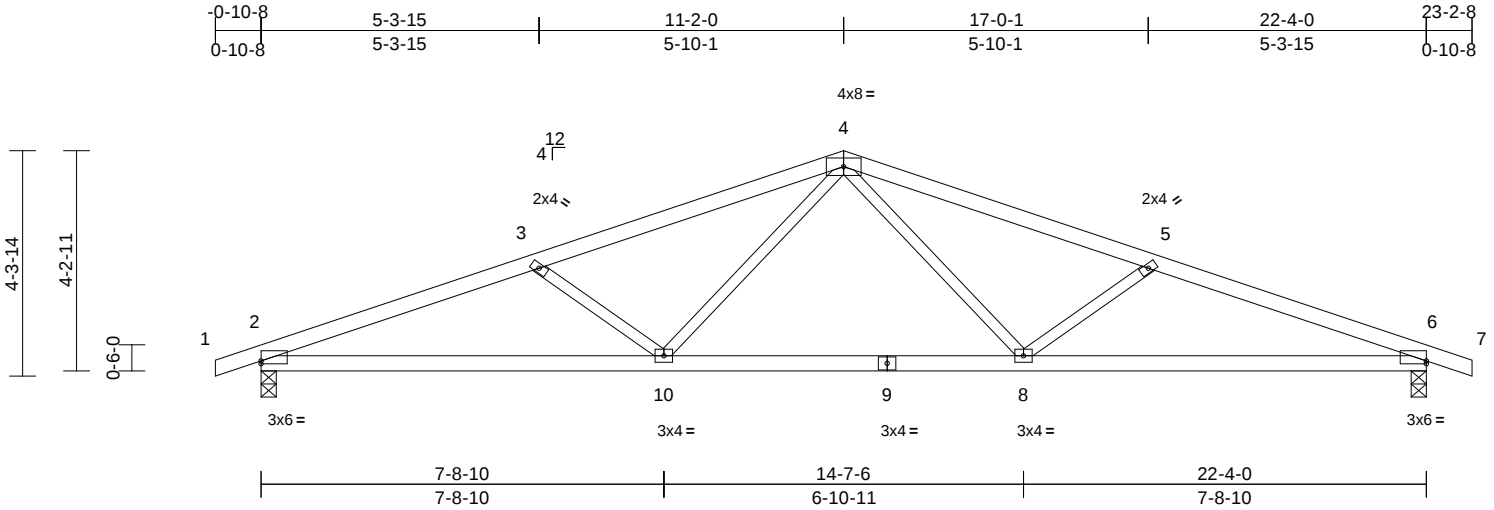

Scale = 1:44.2									
Plate Offsets (X, Y): [2:Edge,0-0-10], [6:Edge,0-0-10]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.47	Vert(LL)	-0.12 8-10	>999	360
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.25 6-8	>999	240
BCLL	0.0*	Rep Stress Incr	YES	WB	0.19	Horz(CT)	0.07 6	n/a	n/a
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08 8-10	>999	240
							Weight: 68 lb	FT = 10%	

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-7-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 6=0-3-8
Max Horiz 2=71 (LC 8)
Max Uplift 2=-189 (LC 4), 6=-189 (LC 5)
Max Grav 2=1063 (LC 1), 6=1063 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/6, 2-3=-2232/355, 3-4=-1909/259, 4-5=-1909/260, 5-6=-2232/355, 6-7=0/6
BOT CHORD 2-10=-333/2049, 8-10=-127/1406, 6-8=-280/2049
WEBS 4-8=-59/541, 5-8=-418/221, 4-10=-58/541, 3-10=-418/221

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 189 lb uplift at joint 2 and 189 lb uplift at joint 6.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SPF No.2 .



February 23,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818349
B240019	E1	GABLE	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:50
ID:vBsZku21ozNPT?RlZYtJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

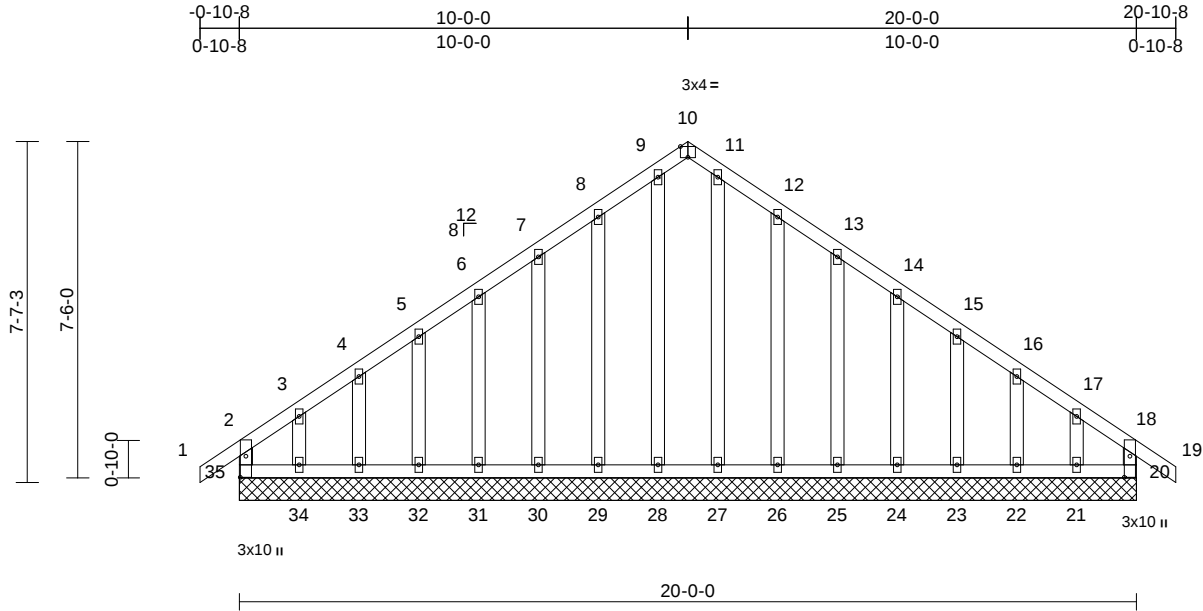

Scale = 1:51.4												
Plate Offsets (X, Y): [10:0-2-0,Edge], [20:0-5-10,0-1-8], [35:0-5-10,0-1-8]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.00	20	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 115 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size)
20=20-0-0, 21=20-0-0, 22=20-0-0, 23=20-0-0, 24=20-0-0, 25=20-0-0, 26=20-0-0, 27=20-0-0, 28=20-0-0, 29=20-0-0, 30=20-0-0, 31=20-0-0, 32=20-0-0, 33=20-0-0, 34=20-0-0, 35=20-0-0
Max Horiz 35=213 (LC 7)
Max Uplift 20=53 (LC 5), 21=120 (LC 9), 22=31 (LC 9), 23=50 (LC 9), 24=45 (LC 9), 25=47 (LC 9), 26=66 (LC 9), 29=64 (LC 8), 30=47 (LC 8), 31=45 (LC 8), 32=51 (LC 8), 33=28 (LC 8), 34=133 (LC 8), 35=96 (LC 4)
Max Grav 20=166 (LC 15), 21=137 (LC 16), 22=127 (LC 22), 23=125 (LC 16), 24=124 (LC 16), 25=125 (LC 16), 26=128 (LC 16), 27=135 (LC 17), 28=146 (LC 18), 29=125 (LC 15), 30=125 (LC 15), 31=124 (LC 15), 32=126 (LC 15), 33=127 (LC 21), 34=158 (LC 15), 35=201 (LC 16)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-35=-162/77, 1-2=0/40, 2-3=-161/143, 3-4=-110/109, 4-5=-102/100, 5-6=-89/100, 6-7=-76/125, 7-8=-64/150, 8-9=-54/184, 9-10=-39/137, 10-11=-35/133, 11-12=-34/165, 12-13=-31/128, 13-14=-40/103, 14-15=-49/79, 15-16=-59/60, 16-17=-71/69, 17-18=-129/94, 18-19=0/40, 18-20=-136/43
BOT CHORD 34-35=-93/121, 33-34=-93/121, 32-33=-93/121, 31-32=-93/121, 30-31=-93/121, 29-30=-93/121, 28-29=-93/121, 27-28=-93/121, 26-27=-93/121, 25-26=-93/121, 24-25=-93/121, 23-24=-93/121, 22-23=-93/121, 21-22=-93/121, 20-21=-93/121
WEBS 3-34=-104/103, 4-33=-99/55, 5-32=-98/64, 6-31=-98/62, 7-30=-98/63, 8-29=-98/80, 9-28=-119/9, 11-27=-108/0, 12-26=-101/82, 13-25=-98/63, 14-24=-98/62, 15-23=-98/64, 16-22=-99/57, 17-21=-94/95

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
4) All plates are 2x4 MT20 unless otherwise indicated.
5) Gable requires continuous bottom chord bearing.
6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
7) Gable studs spaced at 1-4-0 oc.

8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
10) All bearings are assumed to be SPF No.2 .
11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 96 lb uplift at joint 35, 53 lb uplift at joint 20, 133 lb uplift at joint 34, 28 lb uplift at joint 33, 51 lb uplift at joint 32, 45 lb uplift at joint 31, 47 lb uplift at joint 30, 64 lb uplift at joint 29, 66 lb uplift at joint 26, 47 lb uplift at joint 25, 45 lb uplift at joint 24, 50 lb uplift at joint 23, 31 lb uplift at joint 22 and 120 lb uplift at joint 21.
12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	E2	Common	3	1	Job Reference (optional)	I63818350

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:50

Page: 1

ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

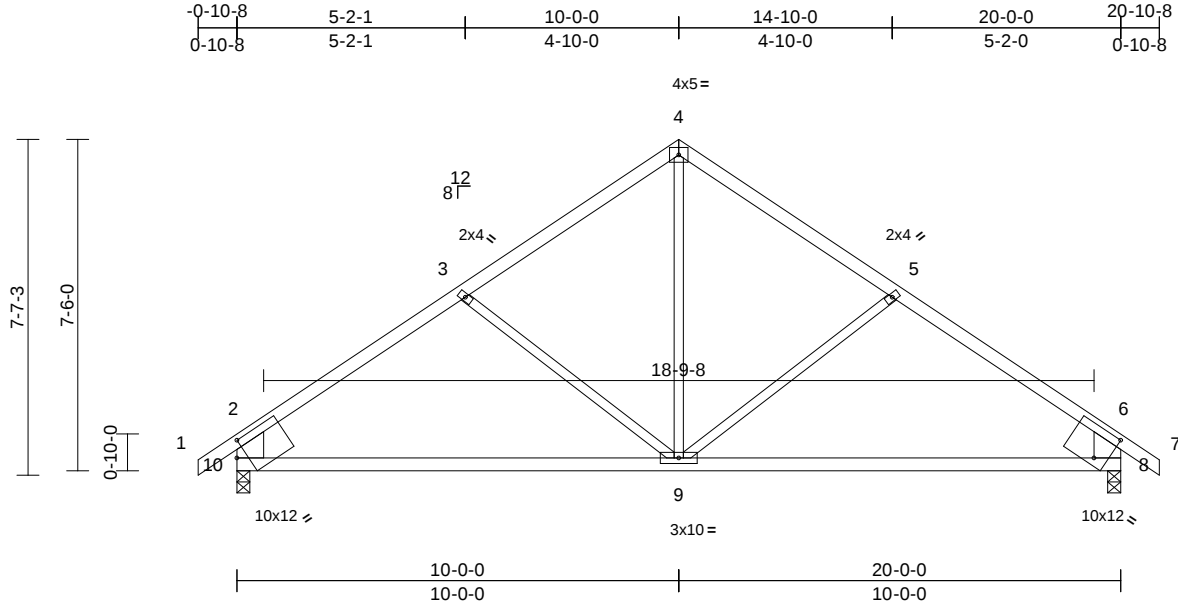

Scale = 1:52.1

Plate Offsets (X, Y): [8:0-3-6,0-8-1], [10:0-2-11,0-4-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.77	Vert(LL)	-0.17	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.34	9-10	>677	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.24	Horz(CT)	0.02	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	9-10	>999	240	Weight: 72 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 10-2,8-6:2x8 SP
	2400F 2.0E

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-2-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size) 8=0-3-8, 10=0-3-8
	Max Horiz 10=217 (LC 7)
	Max Uplift 8=-125 (LC 9), 10=-125 (LC 8)
	Max Grav 8=955 (LC 1), 10=955 (LC 1)

FORCES	(lb) - Maximum Compression/Maximum Tension
--------	--

TOP CHORD	1-2=0/46, 2-3=-1079/161, 3-4=-828/155, 4-5=-828/154, 5-6=-1079/161, 6-7=0/46, 2-10=-853/175, 6-8=-853/175
-----------	---

BOT CHORD	9-10=-143/819, 8-9=-40/783
WEBS	4-9=-46/479, 5-9=-255/212, 3-9=-254/211

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 125 lb uplift at joint 10 and 125 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	E3	Roof Special Girder	1	3	Job Reference (optional)	I63818351

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:51
ID:vBSzku21ozNPT?RizYtJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

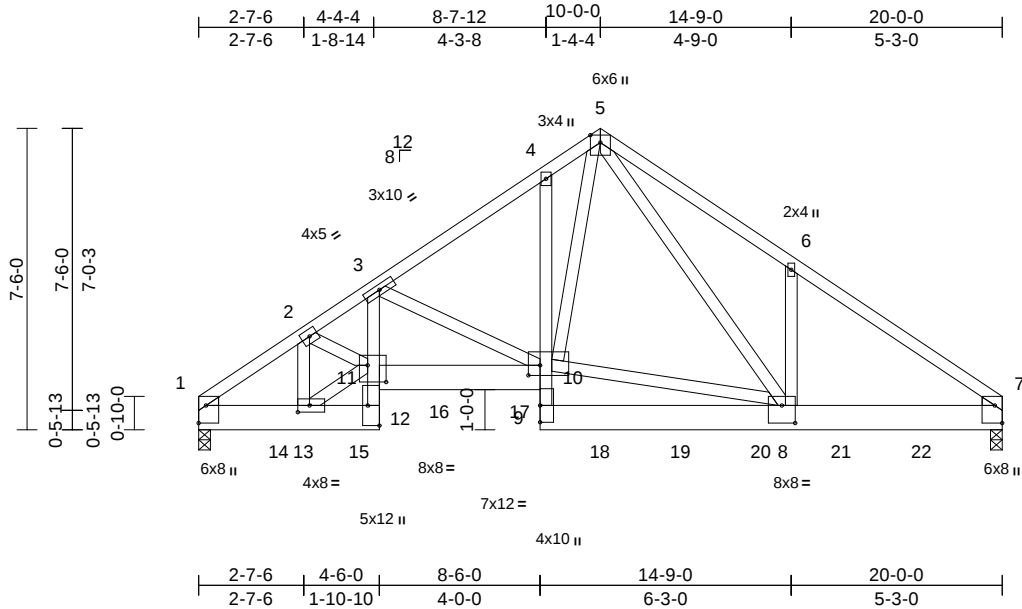

Scale = 1:57.3

Plate Offsets (X, Y): [1:Edge,0-2-3], [7:Edge,0-2-3], [8:0-4-0,0-5-4], [10:0-3-8,0-3-0], [11:0-5-8,0-5-0], [12:Edge,0-3-8], [13:0-3-8,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.67	Vert(LL)	-0.11	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.20	8-9	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.59	Horz(CT)	0.08	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	8-9	>999	240	Weight: 410 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x8 SP 2400F 2.0E *Except* 12-3,4-9:2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE Left: 2x3 SPF No.2
Right: 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-11-1 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-3-8, 7=0-3-8
Max Horiz 1=183 (LC 7)
Max Uplift 1=-675 (LC 8), 7=-730 (LC 9)
Max Grav 1=6998 (LC 1), 7=6990 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-9573/901, 2-3=-12949/1261, 3-4=-8592/845, 4-5=-8312/914, 5-6=-9344/1062, 6-7=-9716/925
BOT CHORD 1-13=-758/7239, 12-13=-104/1036, 11-12=-84/1825, 3-11=-381/4198, 10-11=-1091/10900, 9-10=-10/1684, 4-10=-87/294, 8-9=-52/1161, 7-8=-674/7688
WEBS 3-10=-4328/529, 8-10=-416/4527, 5-10=-688/6279, 5-8=-577/3885, 6-8=-133/590, 2-13=-3313/360, 11-13=-754/7155, 2-11=-364/4181

NOTES
1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-6-0 oc.
Bottom chords connected as follows: 2x8 - 3 rows staggered at 0-4-0 oc, 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP 2400F 2.0E .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 675 lb uplift at joint 1 and 730 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1353 lb down and 182 lb up at 2-0-0, 1358 lb down and 28 lb up at 4-0-0, 1363 lb down and 195 lb up at 6-0-0, 1363 lb down and 195 lb up at 8-0-0, 1361 lb down and 28 lb up at 10-0-0, 1358 lb down and 28 lb up at 12-0-0, 1353 lb down and 182 lb up at 14-0-0, and 1353 lb down and 182 lb up at 16-0-0, and 1353 lb down and 182 lb up at 18-0-0 on bottom chord. The design/ selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (lb/ft)
Vert: 1-5=-70, 5-7=-70, 1-12=-20, 10-11=-20, 7-9=-20
Concentrated Loads (lb)
Vert: 14=-1353 (F), 15=-1358 (F), 16=-1363 (F), 17=-1363 (F), 18=-1361 (F), 19=-1358 (F), 20=-1353 (F), 21=-1353 (F), 22=-1353 (F)



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	G1	Roof Special Structural Gable	1	1	Job Reference (optional)	I63818352

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:51
ID:vBszku21ozNPT?RlZYJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

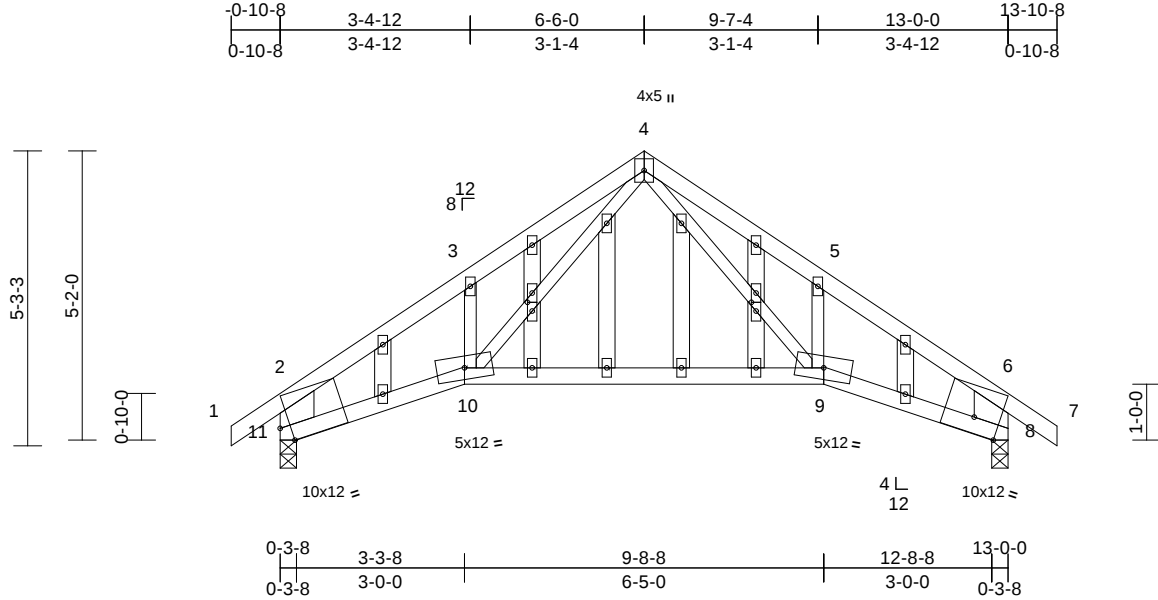

Scale = 1:41.2

Plate Offsets (X, Y): [8:0-5-7,Edge], [11:0-2-3,Edge], [14:0-1-14,0-1-0], [23:0-1-14,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	-0.10	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.23	9-10	>641	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horz(CT)	0.09	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	9-10	>999	240	Weight: 64 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 11-2,8-6:2x8 SP
	2400F 2.0E
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-5-15 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)

8=0-3-8, 11=0-3-8
Max Horiz 11=155 (LC 7)
Max Uplift 8=-89 (LC 9), 11=-89 (LC 8)
Max Grav 8=640 (LC 1), 11=640 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/46, 2-3=-934/109, 3-4=-816/224, 4-5=-816/188, 5-6=-934/67, 6-7=0/46, 2-11=-773/127, 6-8=-773/99
BOT CHORD	10-11=-91/750, 9-10=0/443, 8-9=0/687
WEBS	5-9=-74/167, 4-9=-133/395, 3-10=-67/157, 4-10=-155/437

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).

- 6) Gable studs spaced at 1-4-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) All bearings are assumed to be SPF No.2 .
- 10) Bearing at joint(s) 11, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 89 lb uplift at joint 11 and 89 lb uplift at joint 8.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818353
B240019	G2	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:51
ID:vBszku21ozNPT?RlZYJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

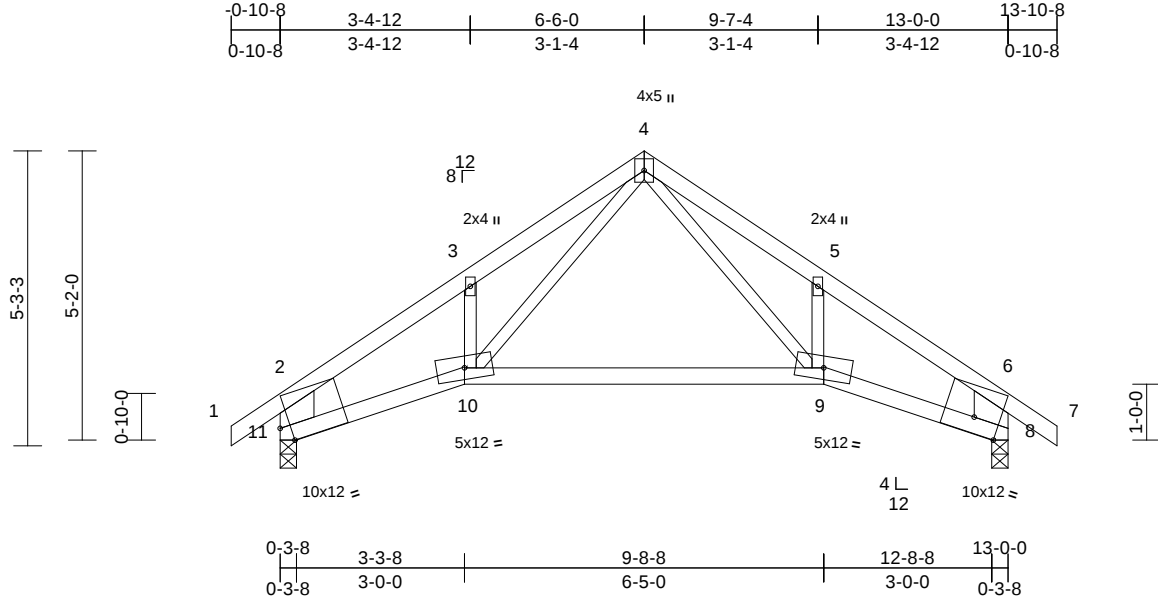

Scale = 1:41.2

Plate Offsets (X, Y): [8:0-5-7,Edge], [11:0-2-3,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	-0.10	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.23	9-10	>641	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horz(CT)	0.09	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	9-10	>999	240	Weight: 50 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 11-2,8-6:2x8 SP
2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or
4-5-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS

(size) 8=0-3-8, 11=0-3-8
Max Horiz 11=155 (LC 7)
Max Uplift 8=-89 (LC 9), 11=-89 (LC 8)
Max Grav 8=640 (LC 1), 11=640 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-2=0/46, 2-3=-934/109, 3-4=-816/224,
4-5=-816/188, 5-6=-934/67, 6-7=0/46,
2-11=-773/127, 6-8=-773/99
BOT CHORD 10-11=-91/750, 9-10=0/443, 8-9=0/687
WEBS 4-9=-133/395, 5-9=-74/167, 4-10=-155/437,
3-10=-67/157

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) All bearings are assumed to be SPF No.2 .

- 6) Bearing at joint(s) 11, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 89 lb uplift at joint 11 and 89 lb uplift at joint 8.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	G3	Roof Special	4	1	Job Reference (optional)	I63818354

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:52
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

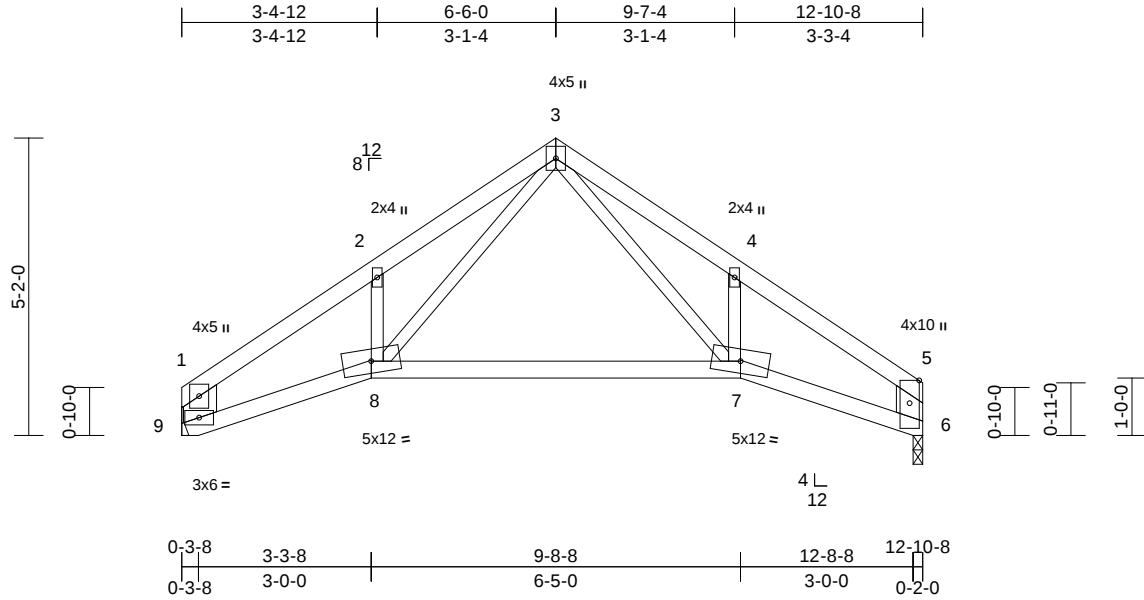

Scale = 1:40

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.52	Vert(LL)	-0.11	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.64	Vert(CT)	-0.27	7-8	>548	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.11	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	7-8	>999	240	Weight: 47 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 9-1:2x8 SP 2400F 2.0E, 6-5:2x6 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-2-13 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	6=0-2-0, 9= Mechanical
Max Horiz	9=135 (LC 5)
Max Uplift	6=-61 (LC 9), 9=-61 (LC 8)
Max Grav	6=555 (LC 1), 9=555 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-938/118, 2-3=-842/235, 3-4=-826/206, 4-5=-925/85, 1-9=-670/103, 5-6=-663/81
BOT CHORD	8-9=-115/744, 7-8=-12/436, 6-7=-38/688
WEBS	3-7=-144/401, 4-7=-99/165, 3-8=-164/454, 2-8=-101/159

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Refer to girder(s) for truss to truss connections.

- Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 6 and 61 lb uplift at joint 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	H1	Common Supported Gable	2	1	Job Reference (optional)	I63818355

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:52
ID:vBsZku21ozNPT?RlZYlJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

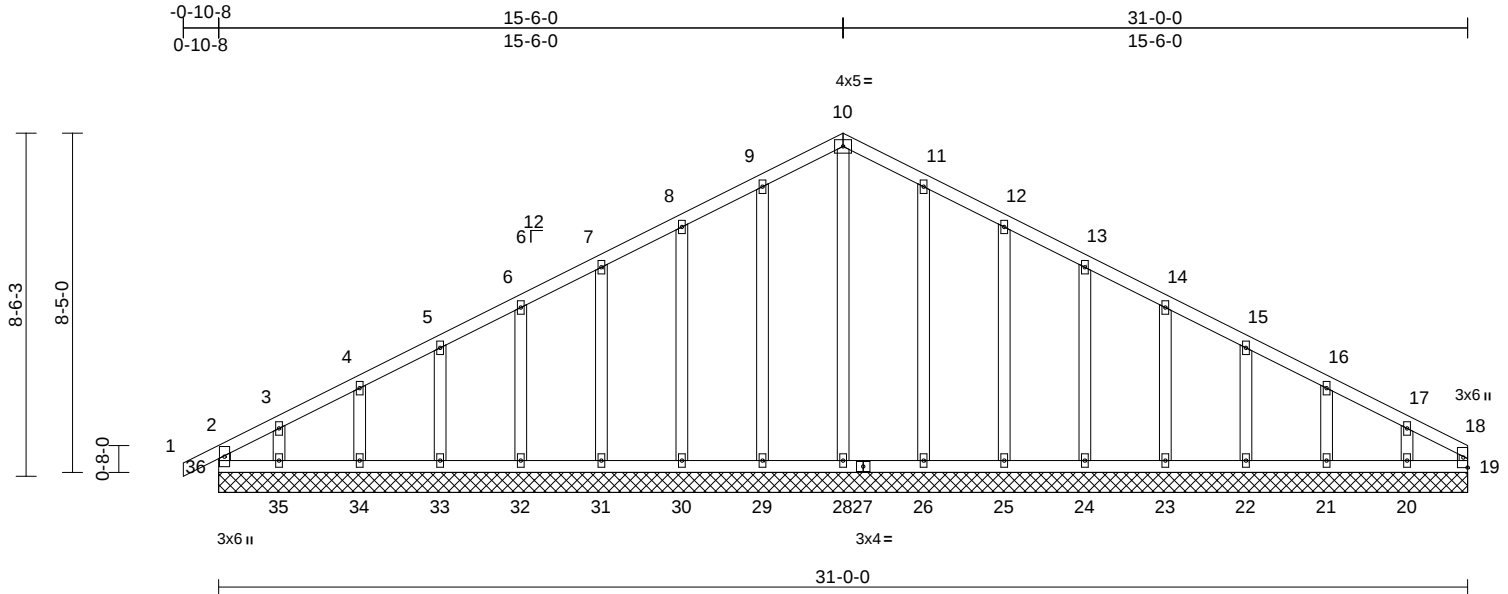

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.05	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.19	Horz(CT)	0.01	19	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							
Weight: 147 lb FT = 10%											

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except* 18-19:2x3 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)
19=31-0-0, 20=31-0-0, 21=31-0-0, 22=31-0-0, 23=31-0-0, 24=31-0-0, 25=31-0-0, 26=31-0-0, 28=31-0-0, 29=31-0-0, 30=31-0-0, 31=31-0-0, 32=31-0-0, 33=31-0-0, 34=31-0-0, 35=31-0-0, 36=31-0-0
Max Horiz 36=138 (LC 8)
Max Uplift 20=94 (LC 9), 21=48 (LC 9), 22=56 (LC 9), 23=54 (LC 9), 24=54 (LC 9), 25=57 (LC 9), 26=51 (LC 9), 29=52 (LC 8), 30=56 (LC 8), 31=54 (LC 8), 32=54 (LC 8), 33=56 (LC 8), 34=46 (LC 8), 35=106 (LC 8), 36=43 (LC 4)
Max Grav 19=84 (LC 18), 20=167 (LC 22), 21=183 (LC 1), 22=179 (LC 22), 23=180 (LC 22), 24=180 (LC 1), 25=179 (LC 1), 26=190 (LC 22), 28=201 (LC 18), 29=190 (LC 21), 30=179 (LC 1), 31=180 (LC 21), 32=181 (LC 1), 33=178 (LC 21), 34=190 (LC 1), 35=133 (LC 15), 36=161 (LC 17)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-36=-134/43, 1-2=0/32, 2-3=-171/69, 3-4=-119/75, 4-5=-88/92, 5-6=-66/118, 6-7=-56/144, 7-8=-45/170, 8-9=-38/196, 9-10=-41/219, 10-11=-42/211, 11-12=-38/167, 12-13=-39/122, 13-14=-38/97, 14-15=-38/71, 15-16=-52/45, 16-17=-75/37, 17-18=-121/31, 18-19=-62/0
BOT CHORD 35-36=-25/103, 34-35=-25/103, 33-34=-25/103, 32-33=-25/103, 31-32=-25/103, 30-31=-25/103, 29-30=-25/103, 28-29=-25/103, 26-28=-25/103, 25-26=-25/103, 24-25=-25/103, 23-24=-25/103, 22-23=-25/103, 21-22=-25/103, 20-21=-25/103, 19-20=-25/103
WEBS 10-28=-161/0, 9-29=-150/76, 8-30=-139/80, 7-31=-140/78, 6-32=-140/78, 5-33=-138/79, 4-34=-147/75, 3-35=-100/100, 11-26=-150/75, 12-25=-139/81, 13-24=-140/77, 14-23=-140/78, 15-22=-139/78, 16-21=-143/76, 17-20=-129/93

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SPF No.2 .
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 36, 52 lb uplift at joint 29, 56 lb uplift at joint 30, 54 lb uplift at joint 31, 54 lb uplift at joint 32, 56 lb uplift at joint 33, 46 lb uplift at joint 34, 106 lb uplift at joint 35, 51 lb uplift at joint 26, 57 lb uplift at joint 25, 54 lb uplift at joint 24, 54 lb uplift at joint 23, 56 lb uplift at joint 22, 48 lb uplift at joint 21 and 94 lb uplift at joint 20.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818356
B240019	H2	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:52
ID:vBsZku21ozNPT?RlZYtJMSyXqDiRfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

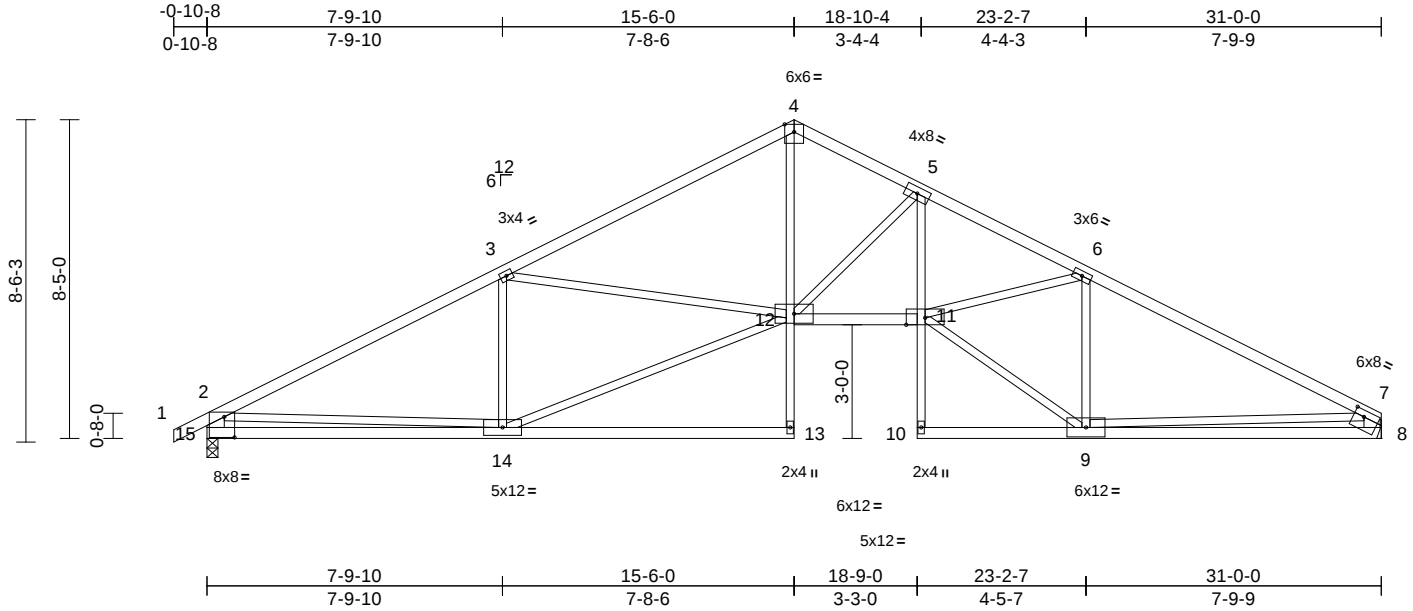

Scale = 1:60.8

Plate Offsets (X, Y): [7:0-3-4,0-2-0], [15:0-3-4,0-6-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	-0.21	11-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.39	13-14	>932	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.80	Horz(CT)	0.22	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.13	11-12	>999	240	Weight: 131 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF 2100F 1.8E
BOT CHORD	2x4 SPF No.2 *Except* 13-4-5-10:2x3 SPF No.2
WEBS	2x3 SPF No.2 *Except* 15-2,8-7:2x6 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 3-10-5 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size) 8= Mechanical, 15=0-3-8
	Max Horiz 15=138 (LC 12)
	Max Uplift 8=170 (LC 9), 15=196 (LC 8)
	Max Grav 8=1373 (LC 1), 15=1453 (LC 1)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/35, 2-3=-2285/274, 3-4=-2473/271, 4-5=-2321/300, 5-6=-3447/307, 6-7=-2258/269, 2-15=-1381/236, 7-8=-1293/213
BOT CHORD	14-15=-325/810, 13-14=0/25, 12-13=0/128, 4-12=-111/1663, 11-12=-136/2998, 10-11=0/52, 5-11=-103/1249, 9-10=-3/17, 8-9=-148/687
WEBS	3-14=-665/214, 12-14=-305/2063, 3-12=-85/305, 5-12=-1318/199, 9-11=-188/2337, 6-11=-45/1113, 6-9=-1314/197, 2-14=0/1130, 7-9=-60/1232

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- The Fabrication Tolerance at joint 2 = 6%

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 196 lb uplift at joint 15 and 170 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	H3	Roof Special	2	1	Job Reference (optional)	I63818357

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 E Jan 4 2024 Print: 8.730 E Jan 4 2024 MiTek Industries, Inc. Fri Feb 23 15:15:55
ID:vBsZku21ozNPT?RlZyYJMSyXqDi-gYeYgfrBMNM_EbCVGcRN2?8p0QJ8DjjSteXXRziDjQ

Page: 1

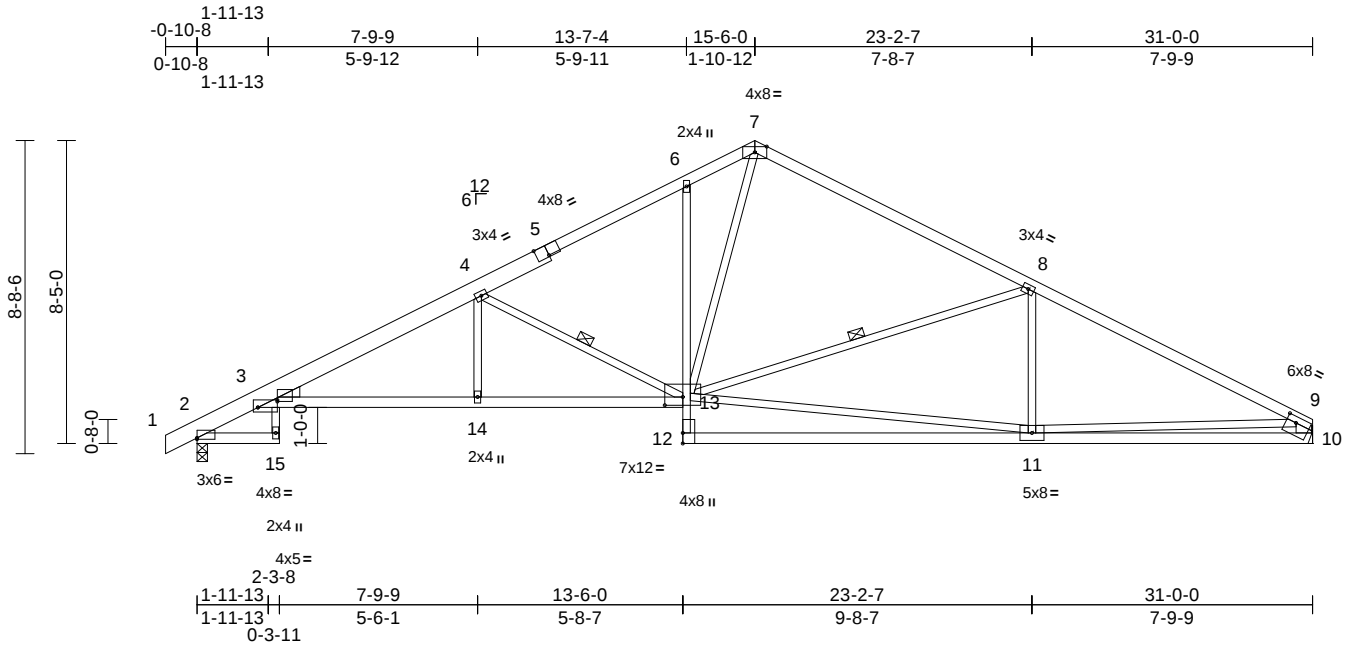

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.29	11-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.65	11-12	>565	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.34	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.15	3-14	>999	240	Weight: 137 lb	FT = 10%

LUMBER		
TOP CHORD	2x4 SPF No.2 *Except* 5-1:2x6 SP 2400F 2.0E	
BOT CHORD	2x4 SPF No.2 *Except* 3-13:2x4 SPF 2100F 1.8E, 6-12:2x3 SPF No.2	
WEBS	2x3 SPF No.2 *Except* 10-9:2x6 SPF No.2	
WEDGE	Left: 2x4 SP No.3	
BRACING		
TOP CHORD	Structural wood sheathing directly applied, except end verticals.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 2-15.	
WEBS	1 Row at midpt 4-13, 8-13	
REACTIONS (lb/size)		
	2=1462/0-3-8, 10=1378/ Mechanical	
	Max Horiz 2=105 (LC 5)	
	Max Uplift 2=-21 (LC 8), 10=-16 (LC 9)	
FORCES (lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-2=0/12, 2-3=-806/49, 3-4=-2965/54, 4-5=-2027/30, 5-6=-1957/58, 6-7=-1842/103, 7-8=-1667/83, 8-9=-2306/32, 9-10=-1308/51	
BOT CHORD	2-15=-35/0, 3-14=-56/2705, 13-14=-56/2705, 12-13=0/176, 6-13=-124/113, 11-12=0/194, 10-11=-54/592	
WEBS	3-15=0/70, 4-14=0/307, 4-13=-1174/115, 11-13=0/1793, 7-13=-43/1141, 8-11=-91/209, 9-11=0/1378, 8-13=-703/116	

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 2 and 16 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Wheeler Lumber, Waverly, KS - 66871, Run: 8.73 E Jan 4 2024 Print: 8.730 E Jan 4 2024 MiTek Industries, Inc. Fri Feb 23 15:17:04 Page: 1
ID:vBsZku21ozNPT?RlZyYtJMSyXqDi-5nROZwZNTAJH?8XrAhO5i0SFHec?GHQAnOLXqziDIj




LUMBER 3) Provide adequate drainage to prevent water ponding.

FORCES	(lb) - Maximum Compression/Maximum Tension	LOAD CASE(S)	Standard
TOP CHORD	1-2=0/12, 2-3=-817/19, 3-4=-2989/412, 4-5=-1877/201, 5-6=-1806/238, 6-7=-1845/257, 7-8=-2796/293, 8-9=-66/28, 9-10=-228/91		
BOT CHORD	2-15=-30/0, 3-15=0/73, 3-14=-465/2732, 13-14=-464/2732, 12-13=-342/2582, 11-12=-342/2582, 10-11=-343/2684		
WEBS	4-14=0/312, 4-13=-1298/395, 7-13=-1141/269, 8-10=-2842/341, 7-11=-19/461, 8-11=-263/132, 6-13=-81/1095		



- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 183 lb uplift at joint 10 and 188 lb uplift at joint 2.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



WARNING – verify design parameters and related notes on this and included sister REFERENCE PAGE MP-7473 rev. 12/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek[®]
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	163818359
B240019	H5	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:53

Page: 1

ID:vBszku21ozNPT?RlZYtJMSyXqDiRfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

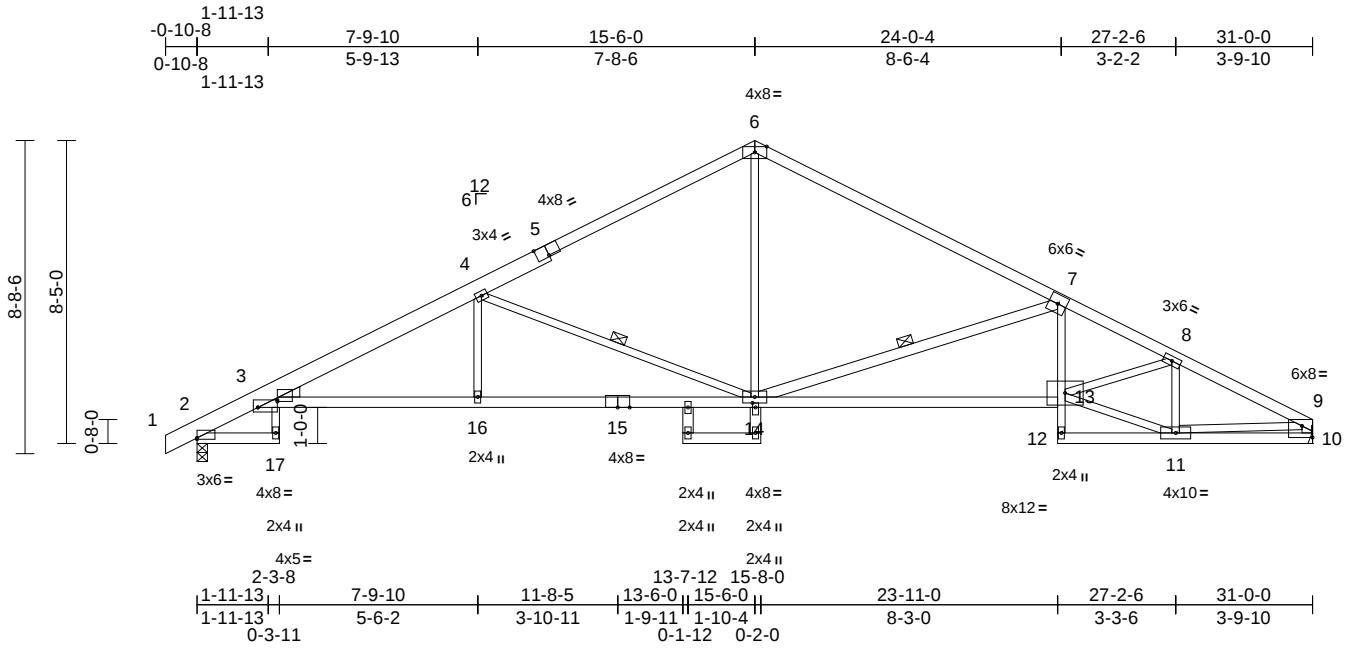


Plate Offsets (X, Y): [2:Edge,0-0-7], [3:0-6-8,0-2-8], [3:0-6-8,0-2-0], [5:0-4-0,Edge], [9:Edge,0-3-13], [14:0-1-8,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.80	Vert(LL)	-0.28	3-16	>999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.92	Vert(CT)	-0.54	13-14	>688	240	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.83	Horz(CT)	0.41	10	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.16	3-16	>999	240	Weight: 134 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2 *Except* 6-9:2x4 SPF 2100F 1.8E, 5-1:2x6 SP 2400F 2.0E
 BOT CHORD 2x4 SPF No.2 *Except* 3-15:2x4 SPF 2100F 1.8E, 7-12:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 14-7,10-9,18-20,19-14:2x4 SPF No.2
 WEDGE Left: 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 4-14, 7-14

REACTIONS

(size) 2=0-3-8, 10= Mechanical
 Max Horiz 2=104 (LC 5)
 Max Uplift 2=-20 (LC 8), 10=-16 (LC 9)
 Max Grav 2=1466 (LC 1), 10=1381 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/12, 2-3=-808/50, 3-4=-2976/73, 4-6=-1878/48, 6-7=-1861/56, 7-8=-3196/49, 8-9=-2246/22, 9-10=-1320/36
 BOT CHORD 2-17=-35/0, 3-16=-79/2719, 14-16=-78/2719, 13-14=0/2918, 12-13=0/63, 7-13=0/569, 11-12=-27/62, 10-11=-24/442
 WEBS 3-17=0/70, 4-16=0/298, 4-14=-1281/169, 6-14=0/1065, 7-14=-1456/152, 11-13=0/2003, 8-13=0/973, 8-11=-848/30, 9-11=0/1508

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 20 lb uplift at joint 2 and 16 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818360
B240019	H6	Common	4	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:54
ID:vBszku21ozNPT?RizYIJMSyXqDiRfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

Page: 1

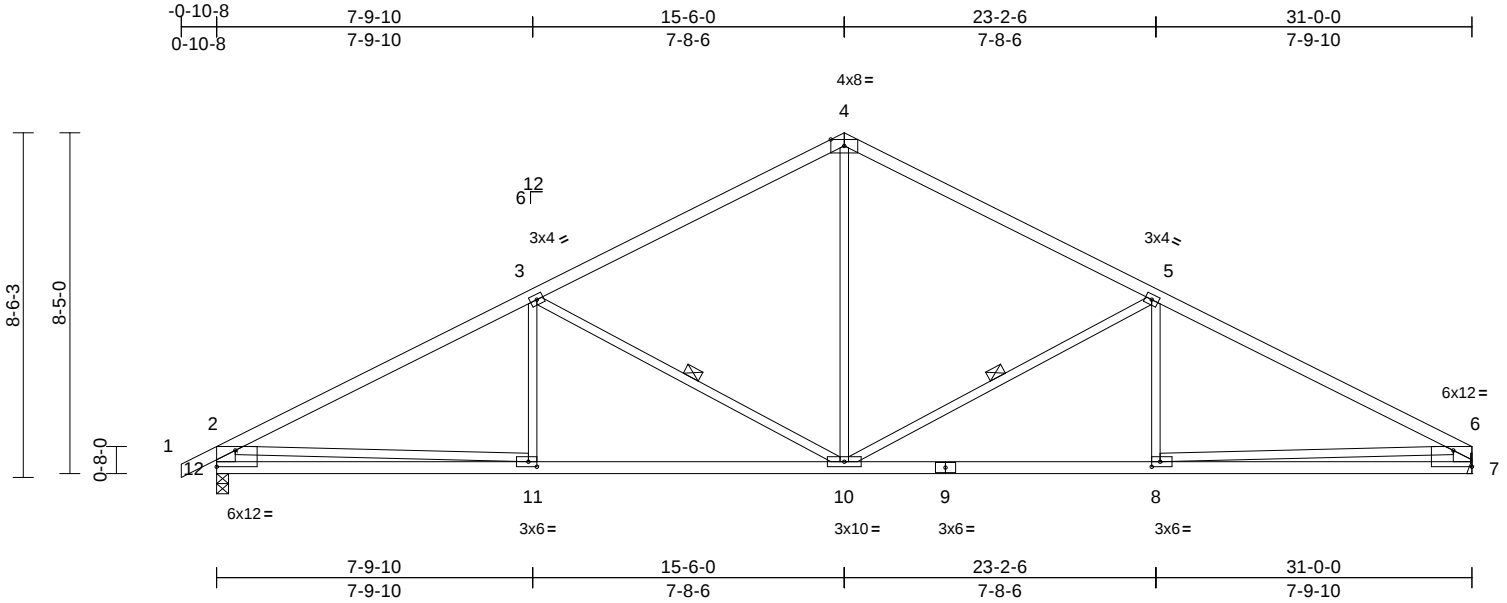

Scale = 1:56.9

Plate Offsets (X, Y): [6:Edge,0-4-13], [8:0-2-8,0-1-8], [11:0-2-8,0-1-8], [12:Edge,0-4-13]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.12	8-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.63	Vert(CT)	-0.25	8-10	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.07	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	8-10	>999	240	Weight: 116 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 12-2,7-6:2x6 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 5-10, 3-10

REACTIONS	(size) 7= Mechanical, 12=0-3-8
	Max Horiz 12=138 (LC 12)
	Max Uplift 7=-170 (LC 9), 12=-196 (LC 8)
	Max Grav 7=1373 (LC 1), 12=1453 (LC 1)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/35, 2-3=-2280/278, 3-4=-1615/247, 4-5=-1617/247, 5-6=-2283/278, 2-12=-1378/238, 6-7=-1295/211
BOT CHORD	11-12=-328/805, 10-11=-282/1934, 8-10=-168/1946, 7-8=-125/616
WEBS	4-10=-55/838, 5-10=-747/260, 5-8=0/260, 3-10=-733/255, 3-11=0/266, 2-11=0/1131, 6-8=-65/1333

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 196 lb uplift at joint 12 and 170 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	H7	Common	3	1	Job Reference (optional)	I63818361

Wheeler Lumber, Waverly, KS - 66871.

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:54
ID:vBszku21ozNPT?RlZyYjMSyXqDiRfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

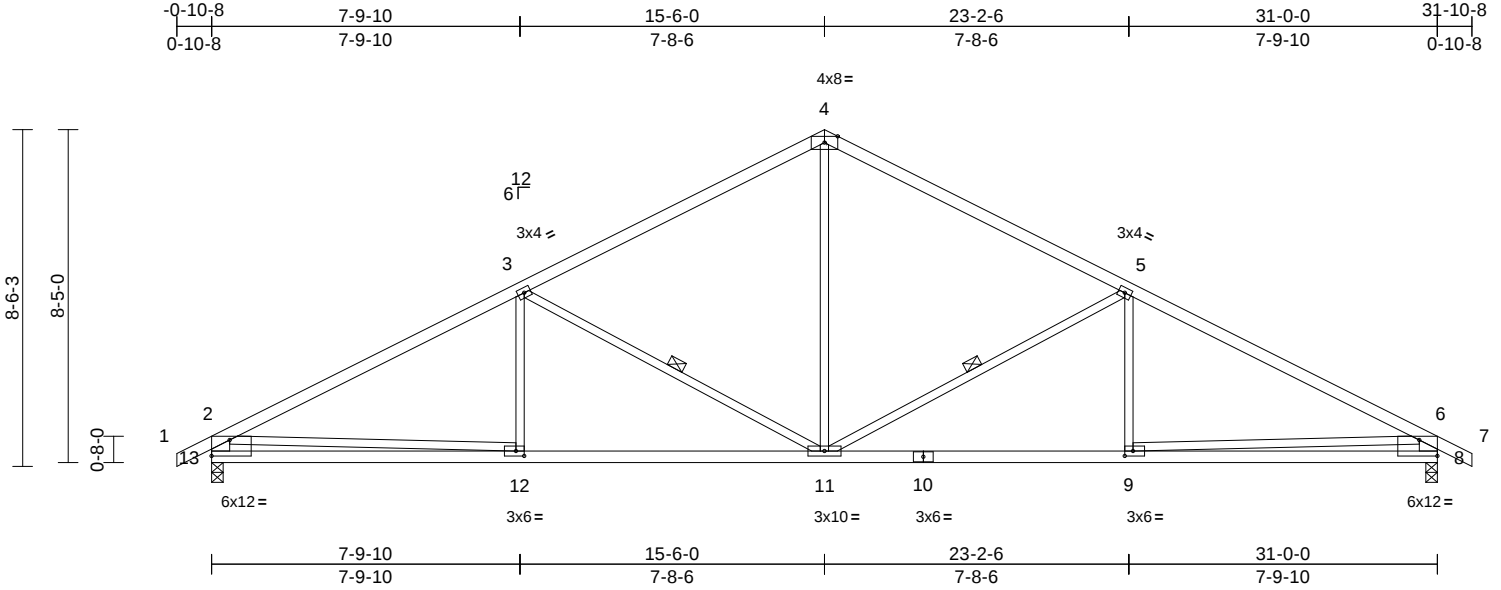

Scale = 1:58.3

Plate Offsets (X, Y): [8:Edge,0-4-13], [9:0-2-8,0-1-8], [12:0-2-8,0-1-8], [13:Edge,0-4-13]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.11	9-11	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.62	Vert(CT)	-0.24	9-11	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.53	Horz(CT)	0.07	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	11-12	>999	240	Weight: 117 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 13-2,8-6:2x6 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 5-11, 3-11

REACTIONS	(size) 8=0-3-8, 13=0-3-8
	Max Horiz 13=-128 (LC 9)
	Max Uplift 8=-196 (LC 9), 13=-196 (LC 8)
	Max Grav 8=1452 (LC 1), 13=1452 (LC 1)

FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension
	1-2=0/35, 2-3=-2277/277, 3-4=-1612/246, 4-5=-1612/246, 5-6=-2277/277, 6-7=0/35, 2-13=-1376/238, 6-8=-1376/238
BOT CHORD	12-13=-319/806, 11-12=-273/1931, 9-11=-144/1931, 8-9=-205/806
WEBS	4-11=-52/829, 5-11=-733/254, 5-9=0/266, 3-11=-733/255, 3-12=0/266, 2-12=0/1127, 6-9=-8/1127

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 196 lb uplift at joint 13 and 196 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	H8	Common Girder	1	2	Job Reference (optional)	I63818362

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:54
ID:vBszku21ozNPT?RizYIJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

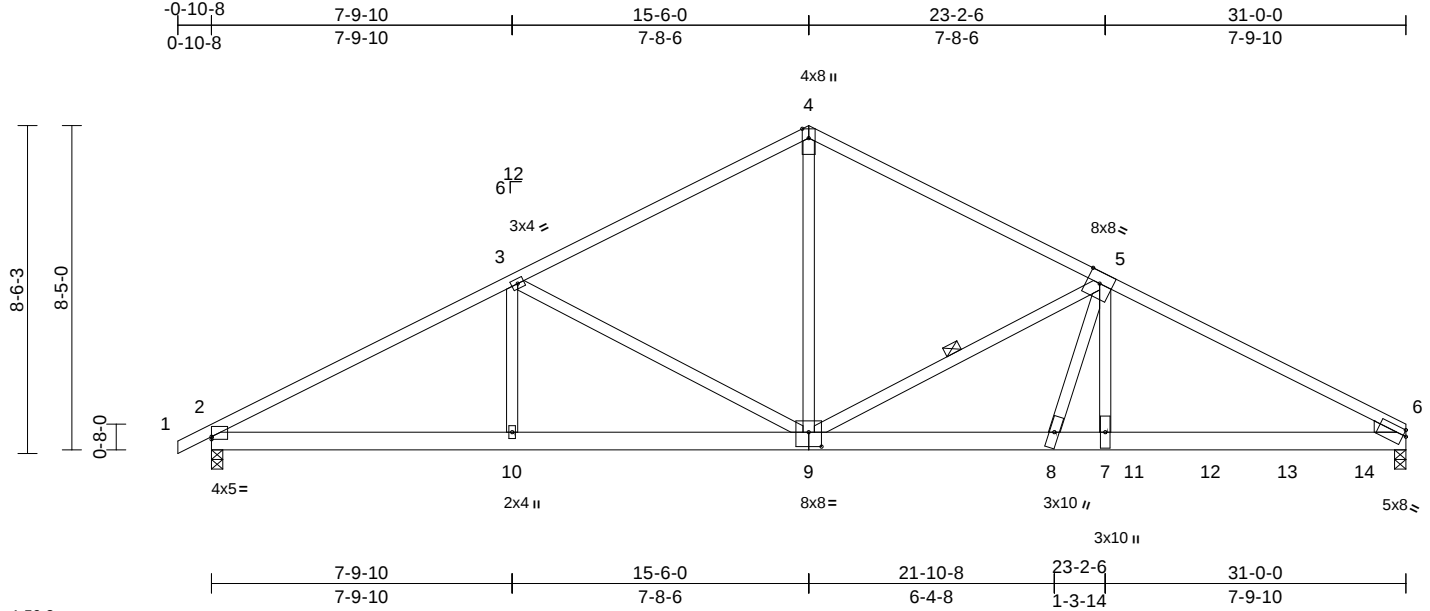

Scale = 1:59.8

Plate Offsets (X, Y): [2:Edge,0-0-13], [6:Edge,0-1-14], [9:0-4-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.17	6-7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.30	6-7	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.83	Horz(CT)	0.07	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.12	6-7	>999	240	Weight: 311 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2 *Except* 4-6:2x4 SPF 2400F 2.0E
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SPF No.2
WEDGE	Right: 2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS	1 Row at midpt	5-9
REACTIONS	(size)	2=0-3-8, 6=0-3-8

Max Horiz	2=147 (LC 27)
Max Uplift	2=-397 (LC 8), 6=-819 (LC 9)
Max Grav	2=2760 (LC 1), 6=5720 (LC 1)

FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension
1-2=0/11, 2-3=-5101/703, 3-4=-4466/684,	
4-5=-4467/683, 5-6=-9639/1399	
BOT CHORD	2-10=-659/4373, 8-10=-1246/9142,
7-8=-1141/8446, 6-7=-1135/8394	
WEBS	4-9=-446/3385, 5-9=-5999/1062,
5-7=-320/2880, 3-9=-599/363, 3-10=0/306,	
5-8=-345/2115	

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-3-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP 2400F 2.0E .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 819 lb uplift at joint 6 and 397 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 3502 lb down and 556 lb up at 21-10-7, 535 lb down and 73 lb up at 23-11-4, 535 lb down and 73 lb up at 25-11-4, and 535 lb down and 73 lb up at 27-11-4, and 536 lb down and 73 lb up at 29-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-4=-70, 4-6=-70, 2-6=-20
Concentrated Loads (lb)
Vert: 8=-3502 (F), 11=-535 (F), 12=-535 (F), 13=-535 (F), 14=-536 (F)



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	H9	Common	6	1	Job Reference (optional)	I63818363

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:55
ID:vBSku21ozNPT?RlZYlJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

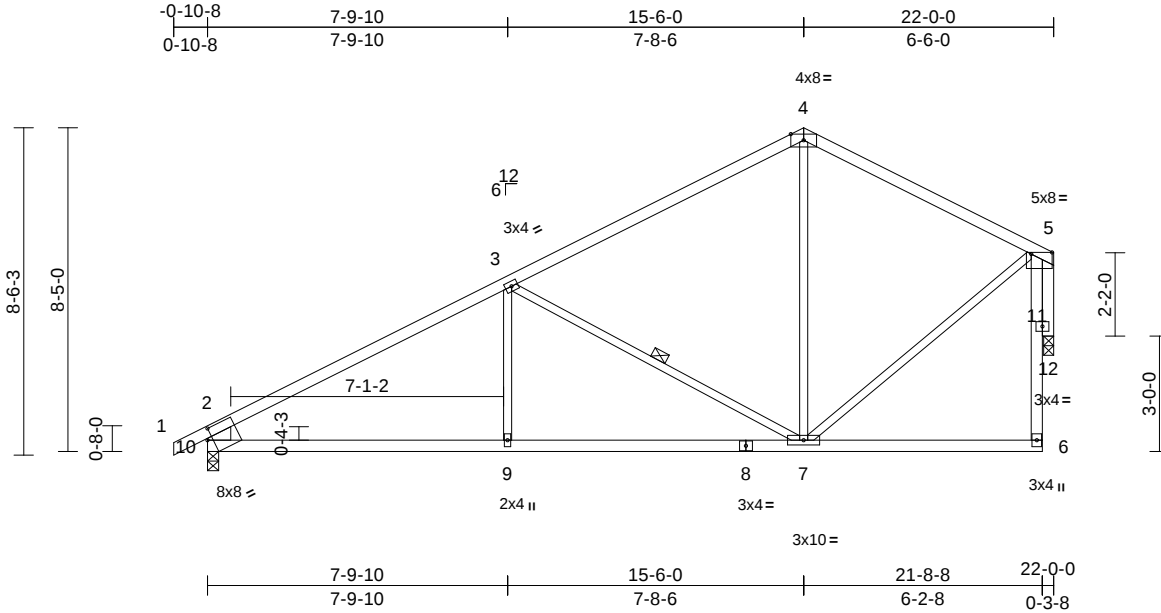

Scale = 1:59.9

Plate Offsets (X, Y): [5:0-6-8,0-0-8], [10:0-1-10,0-3-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.88	Vert(LL)	-0.09	7-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.57	Vert(CT)	-0.20	7-9	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.53	Horz(CT)	0.09	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	7-9	>999	240	Weight: 86 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2 *Except* 6-5:2x4 SPF No.2, 10-2:2x8 SP 2400F 2.0E
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 3-7

REACTIONS

(size)	10=0-3-8, 12=0-3-2
Max Horiz	10=223 (LC 5)
Max Uplift	10=-156 (LC 8), 12=-122 (LC 8)
Max Grav	10=1055 (LC 1), 12=941 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/37, 2-3=-1463/195, 3-4=-765/129, 4-5=-723/160, 6-11=0/100, 5-11=0/100, 2-10=-965/200
BOT CHORD	9-10=-269/1194, 7-9=-269/1194, 6-7=-46/83
WEBS	4-7=0/242, 5-7=-94/635, 3-7=-733/262, 3-9=0/302, 5-12=-954/124

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- All bearings are assumed to be SPF No.2 .
- Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 156 lb uplift at joint 10 and 122 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	J1	Diagonal Hip Girder	2	1	Job Reference (optional)	I63818364

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:55
ID:YsOUNzphuXNGFYh7BjxGp5ziJsK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

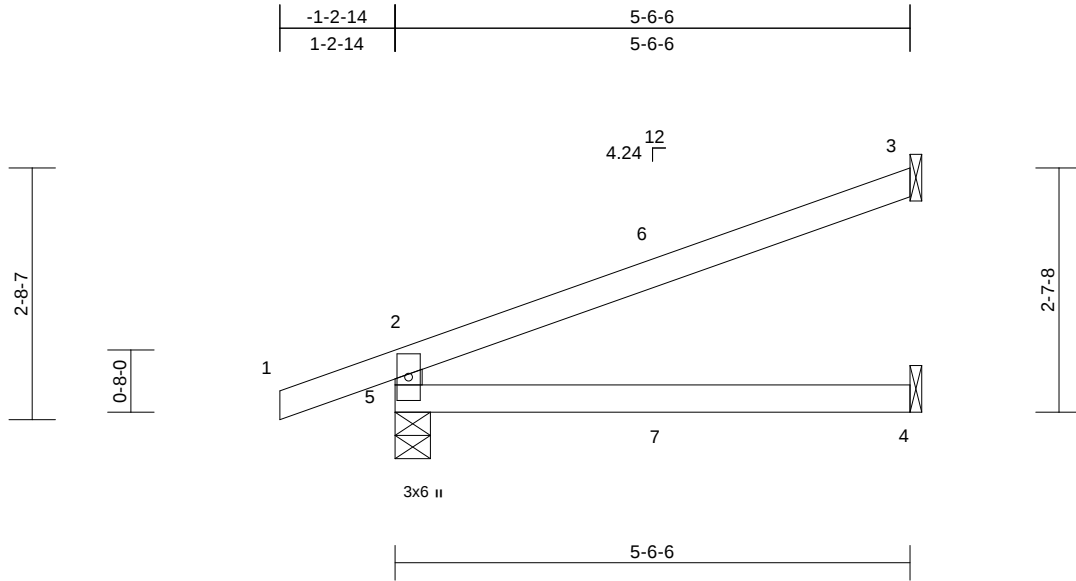

Scale = 1:24.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	-0.04	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.08	4-5	>783	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.02	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.03	4-5	>999	240	Weight: 15 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-4-9
Max Horiz 5=96 (LC 4)
Max Uplift 3=-77 (LC 8), 5=-91 (LC 4)
Max Grav 3=164 (LC 1), 4=100 (LC 3), 5=347 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-306/137, 1-2=0/32, 2-3=-92/42
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 91 lb uplift at joint 5 and 77 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 69 lb down and 36 lb up at 2-9-8, and 69 lb down and 36 lb up at 2-9-8 on top chord, and 3 lb down and 2 lb up at 2-9-8, and 3 lb down and 2 lb up at 2-9-8 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 7=3 (F=2, B=2)



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818365
B240019	J2	Jack-Open	5	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:55

Page: 1

ID:YnHn5j?1veow56V2CRjJ3IziTO-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?I

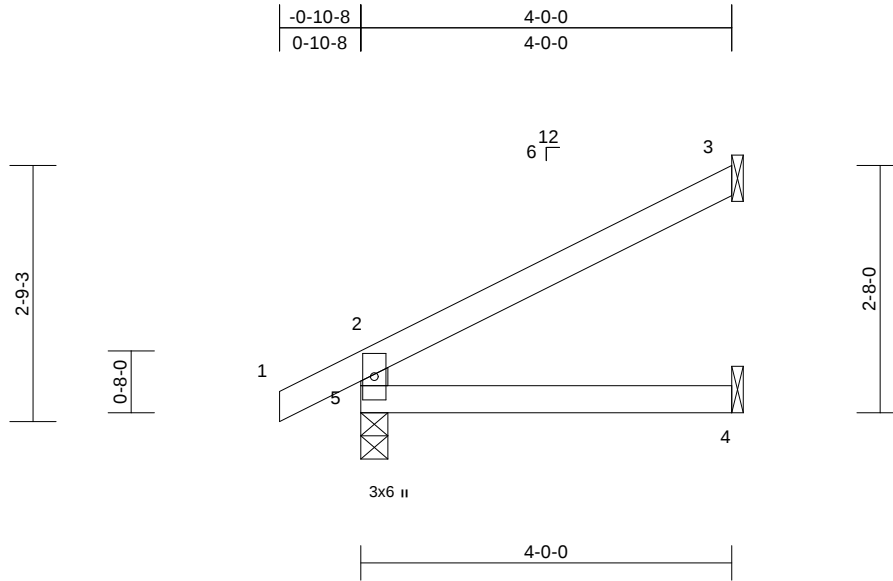

Scale = 1:24.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	-0.02	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4'-0" oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=89 (LC 8)
Max Uplift 3=-66 (LC 8), 5=-30 (LC 8)
Max Grav 3=116 (LC 1), 4=71 (LC 3), 5=252 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-221/67, 1-2=0/32, 2-3=-75/40
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 5 and 66 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	J3	Jack-Open	4	1	Job Reference (optional)	I63818366


Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:55

Page: 1

ID:?iJkFo?gjnBAeG_G4RZQNziTe-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

-0-10-8	1-10-15
0-10-8	1-10-15

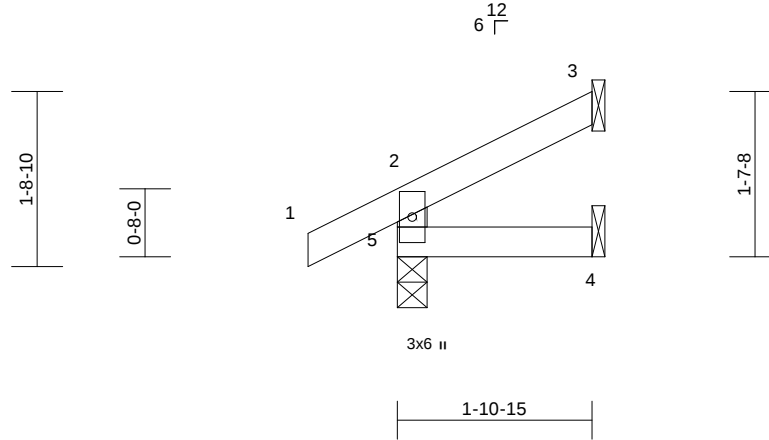

Scale = 1:22.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 6 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or
1-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical,
5=0-3-8
Max Horiz 5=48 (LC 8)
Max Uplift 3=-30 (LC 8), 5=-26 (LC 8)
Max Grav 3=44 (LC 1), 4=31 (LC 3), 5=171
(LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 2-5=-150/44, 1-2=0/32, 2-3=-37/14
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat.
II; Exp C; Enclosed; MWFRS (envelope) exterior zone;
cantilever left and right exposed; end vertical left and
right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 26 lb uplift at joint
5 and 30 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018
International Residential Code sections R502.11.1 and
R802.10.2 and referenced standard ANSI/TPI 1.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	LAY1	Lay-In Gable	1	1	Job Reference (optional)	I63818367

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:55
ID:ipLE8EJHK7d0lLe5MzByFkziJuH-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

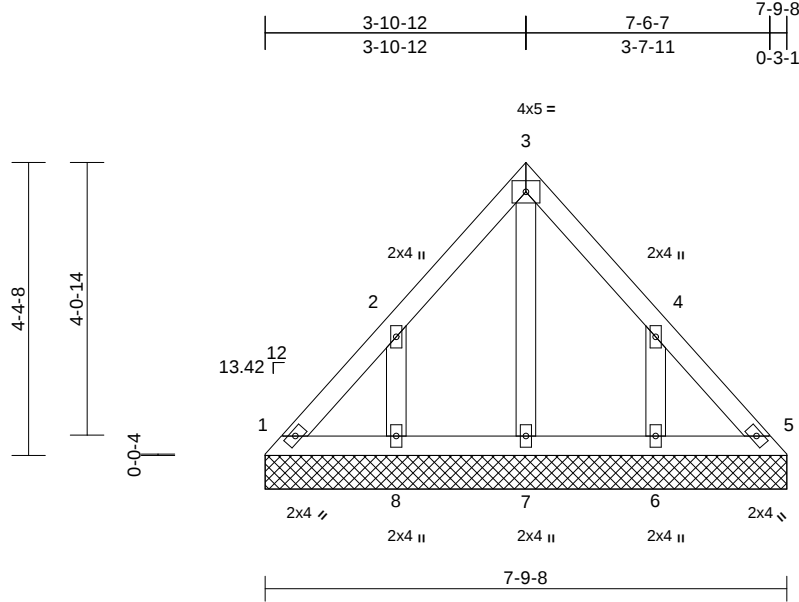

Scale = 1:34.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(TL)	n/a	-	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	5	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P						Weight: 29 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=7-9-8, 5=7-9-8, 6=7-9-8, 7=7-9-8, 8=7-9-8
	Max Horiz	1=-108 (LC 4)
	Max Uplift	1=-25 (LC 4), 5=-8 (LC 5), 6=-153 (LC 9), 8=-153 (LC 8)
	Max Grav	1=100 (LC 16), 5=92 (LC 18), 6=228 (LC 16), 7=119 (LC 18), 8=228 (LC 15)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-120/91, 2-3=-98/79, 3-4=-89/64, 4-5=-105/68
BOT CHORD	1-8=-45/94, 7-8=-45/94, 6-7=-45/94, 5-6=-45/94
WEBS	2-8=-188/177, 3-7=-81/1, 4-6=-188/177

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 0-0-0 oc.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SPF No.2 .
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 8 lb uplift at joint 5, 153 lb uplift at joint 8 and 153 lb uplift at joint 6.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	R1	Flat Girder	1	2	Job Reference (optional)	I63818368

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:56
ID:vBsZku21ozNPT?RlZyYlJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

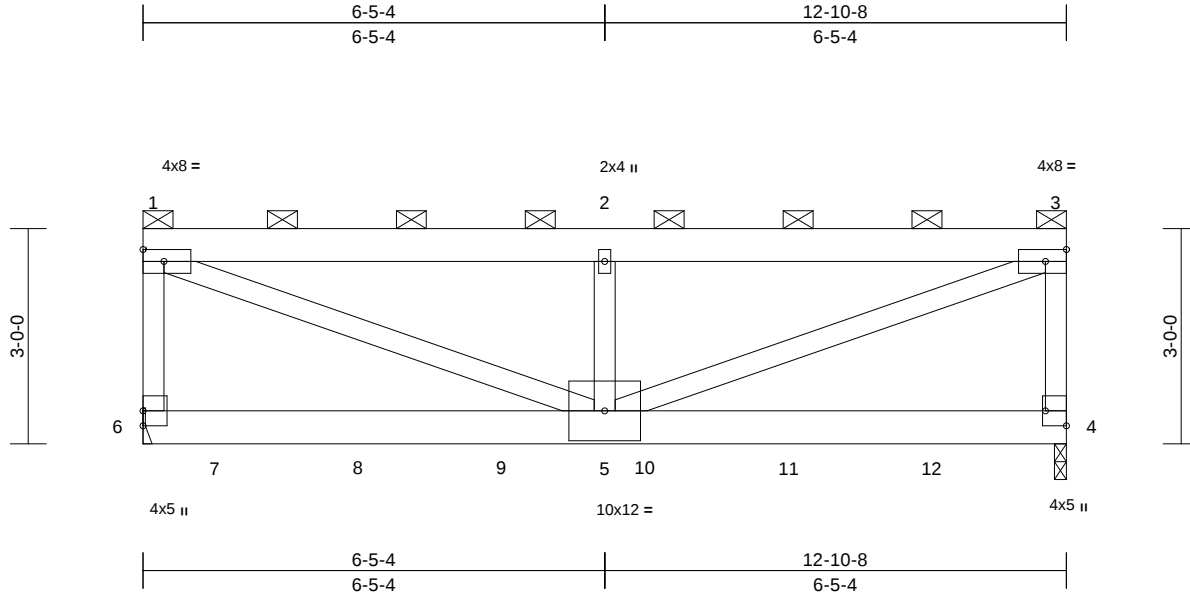

Scale = 1:32.1

Plate Offsets (X, Y): [4:Edge,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	-0.09	5-6	>999	360	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.16	5-6	>942	240	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.63	Horz(CT)	0.00	4	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.06	5-6	>999	240	Weight: 150 lb FT = 10%

LUMBER

TOP CHORD 2x6 SPF No.2
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SPF No.2

BRACING

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-3, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 4=0-2-0, 6= Mechanical
Max Horiz 6=-97 (LC 4)
Max Uplift 4=-489 (LC 5), 6=-544 (LC 4)
Max Grav 4=3137 (LC 1), 6=3522 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-6=-2177/384, 1-2=-4969/758,
2-3=-4969/758, 3-4=-2181/385

BOT CHORD 5-6=-103/235, 4-5=-54/207

WEBS 1-5=-802/5124, 2-5=-367/288, 3-5=-804/5136

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearings are assumed to be: Joint 6 SPF No.2, Joint 4 SP 2400F 2.0E.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 544 lb uplift at joint 6 and 489 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 922 lb down and 133 lb up at 1-0-0, 921 lb down and 134 lb up at 3-0-0, 921 lb down and 134 lb up at 5-0-0, 921 lb down and 134 lb up at 7-0-0, and 921 lb down and 134 lb up at 9-0-0, and 921 lb down and 134 lb up at 11-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-70, 4-6=-20
Concentrated Loads (lb)
Vert: 7=-922, 8=-921, 9=-921, 10=-921, 11=-921, 12=-921



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818369
B240019	V1	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:56
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

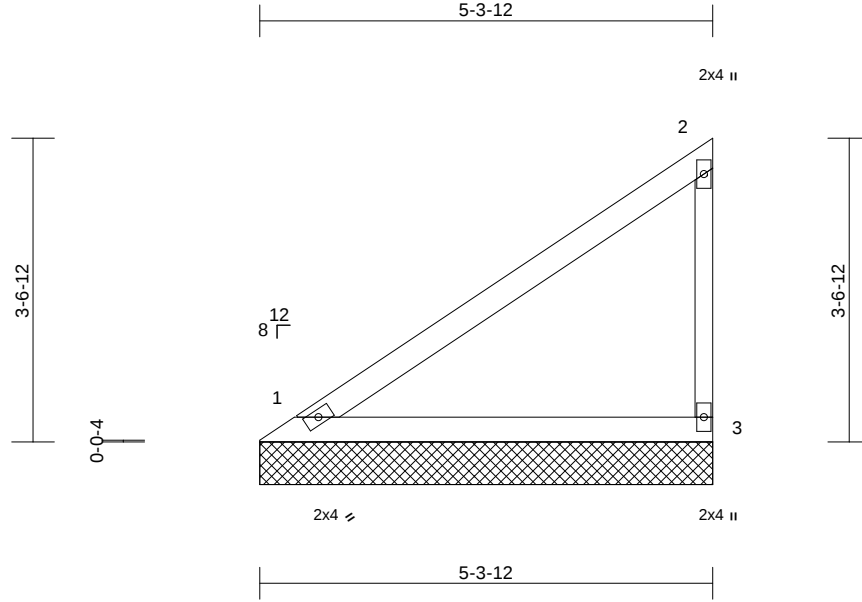

Scale = 1:27

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.44	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 15 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-4-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=5-3-12, 3=5-3-12

Max Horiz 1=126 (LC 5)
Max Uplift 1=-18 (LC 8), 3=-62 (LC 8)
Max Grav 1=214 (LC 1), 3=230 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-118/96, 2-3=-182/91
BOT CHORD 1-3=-45/34

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1 and 62 lb uplift at joint 3.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818370
B240019	V2	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:56
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

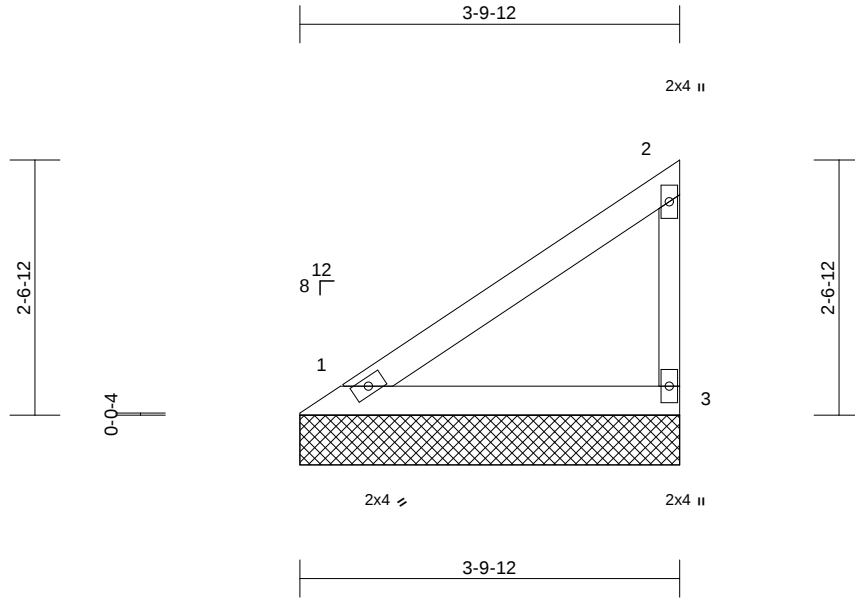

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-10-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=3-9-12, 3=3-9-12

Max Horiz 1=86 (LC 5)

Max Uplift 1=-12 (LC 8), 3=-42 (LC 8)

Max Grav 1=147 (LC 1), 3=157 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-81/66, 2-3=-125/62

BOT CHORD 1-3=-31/23

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 12 lb uplift at joint 1 and 42 lb uplift at joint 3.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	V3	Valley	1	1	Job Reference (optional)	I63818371

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:56
ID:vBsZku21ozNPT?RizYIJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

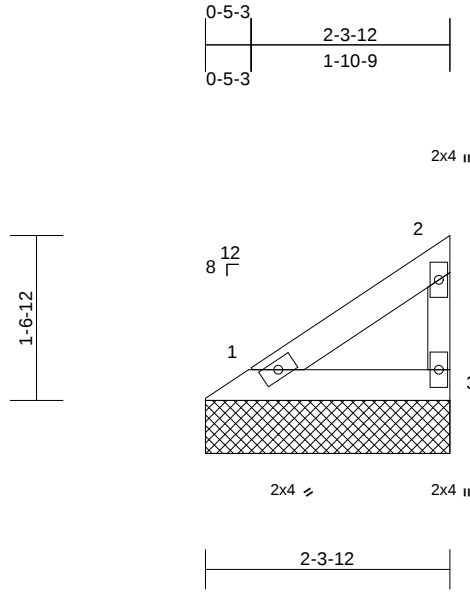

Scale = 1:21.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.05	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P						Weight: 6 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-4-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=2-3-12, 3=2-3-12

Max Horiz 1=47 (LC 5)
Max Uplift 1=-7 (LC 8), 3=-23 (LC 8)
Max Grav 1=79 (LC 1), 3=85 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-43/35, 2-3=-67/33
BOT CHORD 1-3=-17/13

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 1 and 23 lb uplift at joint 3.



February 23, 2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Wheeler Lumber, Waverly, KS - 66871, Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:57 Page: 1
ID:vBszku21ozNPT?RlzYtJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCdoi7J4zJC?i



LUMBER			
TOP CHORD	2x4 SPF No.2		5) Gable studs spaced at 4-0-0 oc.
BOT CHORD	2x4 SPF No.2 *Except* 2-6:2x3 SPF No.2		6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
WEBS	2x3 SPF No.2		7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
OTHERS	2x3 SPF No.2		8) All bearings are assumed to be SPF No.2 .
BRACING			
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.		9) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.		10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 145 lb uplift at joint 8, 64 lb uplift at joint 4, 23 lb uplift at joint 7 and 191 lb uplift at joint 5.
REACTIONS			
(size)	4=13-5-4, 5=13-5-4, 6=13-5-4, 7=13-5-4, 8=13-5-4		11) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.
Max Horiz	8=-171 (LC 9)		12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
Max Uplift	4=-64 (LC 9), 5=-191 (LC 9), 7=-23 (LC 5), 8=-145 (LC 9)		
Max Grav	4=203 (LC 16), 5=615 (LC 16), 6=90 (LC 14), 7=376 (LC 18), 8=222 (LC 16)		
FORCES			
	(lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-8=-150/158, 1-2=-164/245, 2-3=-142/243, 3-4=-84/120		
BOT CHORD	7-8=-11/36, 6-7=0/0, 2-7=-292/42, 5-6=-5/7, 4-5=-5/7		
WEBS	3-5=-390/243		
		LOAD CASE(S)	Standard

- NOTES**

 - 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCFL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.




February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®
 16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Wheeler Lumber, Waverly, KS - 66871, Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:57 Page: 1
ID:vBsZku21ozNPT?RlZyYtJMSyXaDi-RfC?PsB70Hq3NSaPanL8w3u1tXBGKWrCDoi7J4zJC?f



LUMBER		5) Gable studs spaced at 4-0-0 oc.
TOP CHORD	2x4 SPF No.2	6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
BOT CHORD	2x4 SPF No.2 *Except* 2-6:2x3 SPF No.2	7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
WEBS	2x3 SPF No.2	8) All bearings are assumed to be SPF No.2 .
OTHERS	2x3 SPF No.2	9) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
BRACING		10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 106 lb uplift at joint 8, 34 lb uplift at joint 4, 5 lb uplift at joint 7 and 156 lb uplift at joint 5.
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	11) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
REACTIONS		LOAD CASE(S) Standard
(size)	4=11-11-4, 5=11-11-4, 6=11-11-4, 7=11-11-4, 8=11-11-4	
Max Horiz	8=-131 (LC 4)	
Max Uplift	4=-34 (LC 9), 5=-156 (LC 9), 7=-5 (LC 5), 8=-106 (LC 9)	
Max Grav	4=120 (LC 1), 5=413 (LC 16), 6=365 (LC 3), 7=313 (LC 15), 8=185 (LC 21)	
FORCES		
	(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-8=-151/123, 1-2=-145/189, 2-3=-118/180, 3-4=-50/79	
BOT CHORD	7-8=-17/42, 6-7=0/0, 2-7=-262/23, 5-6=-10/18, 4-5=-10/18	
WEBS	3-5=-317/201	

- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SPF No.2 .
- 9) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 106 lb uplift at joint 8, 34 lb uplift at joint 4, 5 lb uplift at joint 7 and 156 lb uplift at joint 5.
- 11) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard





February 23, 2024

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Wheeler Lumber, Waverly, KS - 66871, Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:57 Page: 1
ID:vBsZku21ozNPT?RlZyYtJMSyXaDi-RfC?PsB70Hq3NSaPanL8w3uItXBGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute (www.tpinstitute.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Wheeler Lumber, Waverly, KS - 66871, Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:57 Page: 1
ID:vBsZku21ozNPT?RlZyYtJMSyXaDi-RfC?PsB70Hq3NSaPanL8w3uIXtBGKWrCDoi7J4zJC?f




LUMBER	
TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x3 SPF No.2
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	
(size)	1=9-9-0, 3=9-9-0, 4=9-9-0
Max Horiz	1=-77 (LC 4)
Max Uplift	1=-39 (LC 8), 3=-48 (LC 9), 4=-15 (LC 8)
Max Grav	1=205 (LC 1), 3=205 (LC 1), 4=387 (LC 1)
FORCES	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-153/73, 2-3=-152/55
BOT CHORD	1-4=-15/71, 3-4=-15/71
WFRS	2-4=-252/64

LOAD CASE(S) Standard

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDF=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/ITPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



WARNING – verify design parameters and READ NOTES on this and INCLUDED MITER REFERENCE PAGE MIT-7475 REV. 12/2023 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-USA.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818376
B240019	V8	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:58
ID:vBszku21ozNPT?RizYIJMSyXqDiRfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

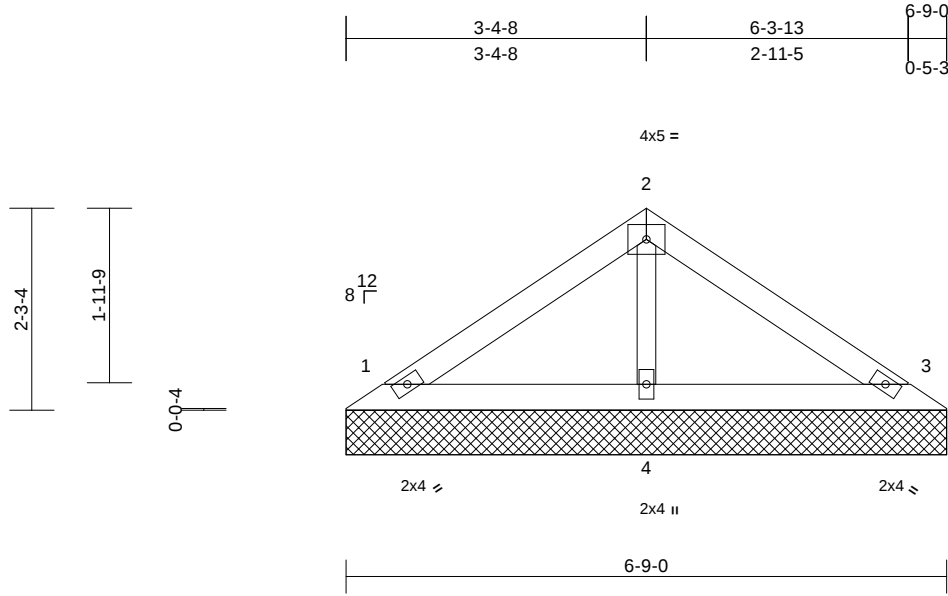

Scale = 1:25.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.15	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	n/a	-	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	3	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P						Weight: 17 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=6-9-0, 3=6-9-0, 4=6-9-0
Max Horiz	1=51 (LC 5)
Max Uplift	1=-33 (LC 8), 3=-39 (LC 9)
Max Grav	1=148 (LC 1), 3=148 (LC 1), 4=230 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-92/47, 2-3=-88/35
BOT CHORD	1-4=-10/43, 3-4=-10/43
WEBS	2-4=-157/40

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 1 and 39 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	V9	Valley	1	1	Job Reference (optional)	I63818377

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:58
ID:vBsZku21ozNPT?RlZyYlJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

Page: 1

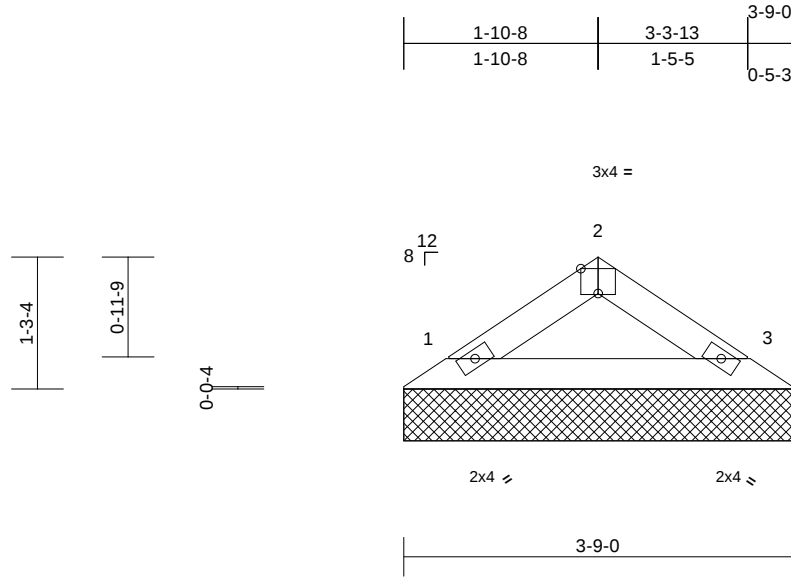

Scale = 1:22.2

Plate Offsets (X, Y): [2:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.03	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 8 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=3-9-0, 3=3-9-0
Max Horiz 1=-25 (LC 4)
Max Uplift 1=-15 (LC 8), 3=-15 (LC 9)
Max Grav 1=128 (LC 1), 3=128 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-112/34, 2-3=-112/34
BOT CHORD 1-3=-15/75

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 1 and 15 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818378
B240019	V10	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:58
ID:vBszku21ozNPT?RizYIJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

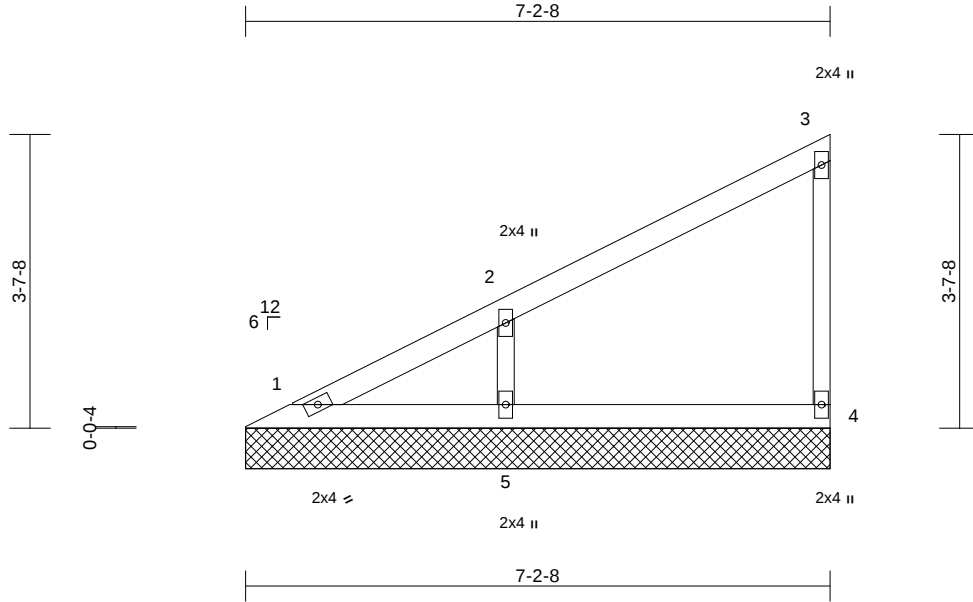

Scale = 1:28.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	4	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							
										Weight: 20 lb	FT = 10%

LUMBER

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=7-2-8, 4=7-2-8, 5=7-2-8
Max Horiz	1=136 (LC 5)
Max Uplift	4=-26 (LC 8), 5=-113 (LC 8)
Max Grav	1=82 (LC 16), 4=141 (LC 1), 5=378 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-114/61, 2-3=-107/44, 3-4=-110/45
BOT CHORD	1-5=-46/35, 4-5=-46/35
WEBS	2-5=-294/164

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2 .

- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 4 and 113 lb uplift at joint 5.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	
B240019	V11	Valley	1	1	Job Reference (optional)	I63818379

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:58
ID:vBszku21ozNPT?RizYIJMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

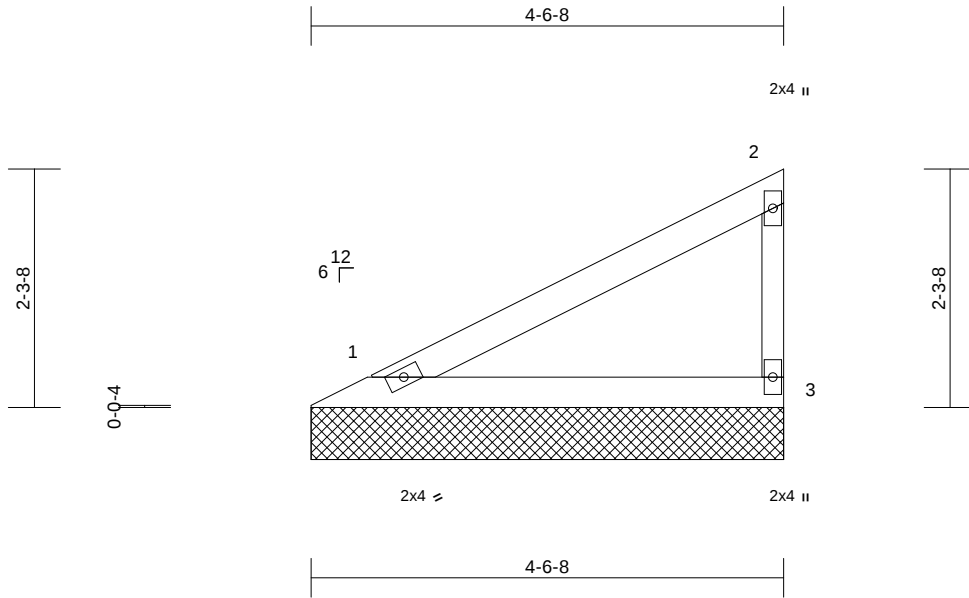

Scale = 1:22.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 12 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-7-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=4-6-8, 3=4-6-8

Max Horiz 1=80 (LC 5)
Max Uplift 1=-22 (LC 8), 3=-42 (LC 8)
Max Grav 1=173 (LC 1), 3=173 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-73/48, 2-3=-135/66
BOT CHORD 1-3=-27/21

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 1 and 42 lb uplift at joint 3.



February 23, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 170 HT	I63818380
B240019	V12	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:58
ID:vBszku21ozNPT?RlZyYjMSyXqDi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

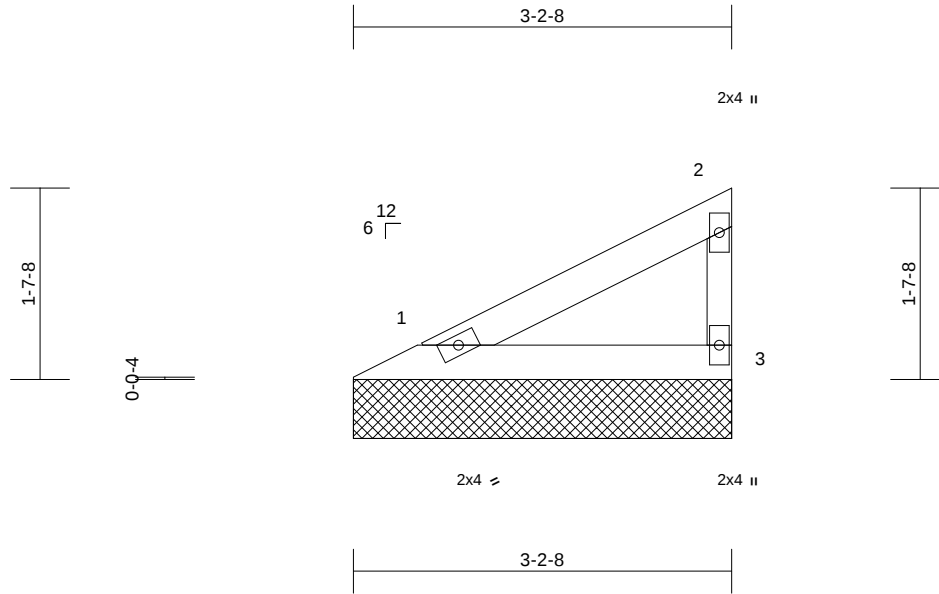

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 8 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-3-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=3-2-8, 3=3-2-8

Max Horiz 1=53 (LC 5)
Max Uplift 1=-15 (LC 8), 3=-28 (LC 8)
Max Grav 1=113 (LC 1), 3=113 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-48/32, 2-3=-88/43
BOT CHORD 1-3=-18/14

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2 .
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 1 and 28 lb uplift at joint 3.



February 23, 2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Wheeler Lumber, Waverly, KS - 66871, Run: 9 S 8.73 Feb 6 2024 Print: 8.730 S Feb 6 2024 MiTek Industries, Inc. Fri Feb 23 08:12:59 Page: 1
ID:vBsZku21ozNPT?RlZyYtJMSyXaDi-RfC?PsB70Hq3NSaPanL8w3uItXBGKWrCDoi7J4zJC?f



LUMBER

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


BRACING

REACTIONS	(size)	1=5-10-8, 3=5-10-8
	Max Horiz	1=108 (LC 5)
	Max Uplift	1=-30 (LC 8), 3=-57 (LC 8)
	Max Grav	1=233 (LC 1), 3=233 (LC 1)

FORCES

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2 .
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 1 and 57 lb uplift at joint 3.




WARNING - verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MIT-1473 Rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek[®]
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

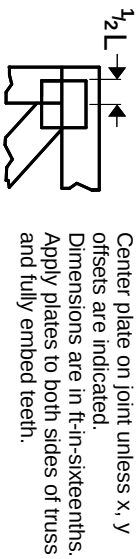

0- $\frac{1}{16}$ "

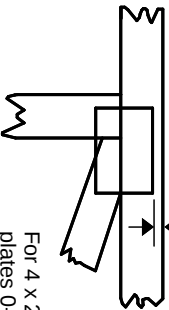

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

—
This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

1 2 3 Joint ID typ.

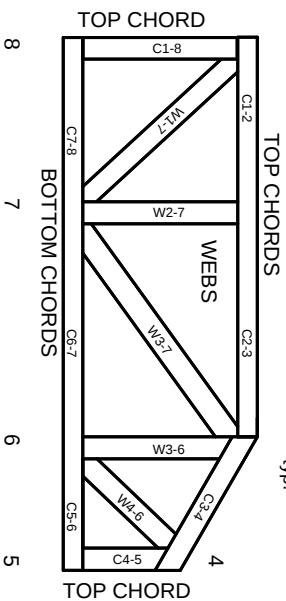

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/12/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.