

RE: B240039 - Lot 173 HT

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**

Project Customer: Summit Homes    Project Name:  
Lot/Block: 173    Subdivision: Hawthorn Ridge  
Model: Charleston - Tuscan  
Address: 3220 SW Arbor Sound Dr  
City: Lee's Summit    State: MO

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2018/TPI2014    Design Program: MiTek 20/20 8.7  
Wind Code: ASCE 7-16 [Wind Speed: 115 mph]    Design Method: MWFRS (Envelope) ASCE 7-16 [Low Rise]  
Roof Load: 45.0 psf    Floor Load: N/A psf  
Mean Roof Height (feet): 25    Exposure Category: C

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I64207692	A1	3/14/24	35	I64207726	J12	3/14/24
2	I64207693	A2	3/14/24	36	I64207727	J13	3/14/24
3	I64207694	A3	3/14/24	37	I64207728	LAY1	3/14/24
4	I64207695	A4	3/14/24	38	I64207729	V1	3/14/24
5	I64207696	A5	3/14/24	39	I64207730	V2	3/14/24
6	I64207697	A6	3/14/24	40	I64207731	V3	3/14/24
7	I64207698	A7	3/14/24	41	I64207732	V4	3/14/24
8	I64207699	B1	3/14/24	42	I64207733	V5	3/14/24
9	I64207700	B2	3/14/24				
10	I64207701	C1	3/14/24				
11	I64207702	C2	3/14/24				
12	I64207703	C3	3/14/24				
13	I64207704	C4	3/14/24				
14	I64207705	C5	3/14/24				
15	I64207706	C6	3/14/24				
16	I64207707	C7	3/14/24				
17	I64207708	C8	3/14/24				
18	I64207709	C9	3/14/24				
19	I64207710	D1	3/14/24				
20	I64207711	D2	3/14/24				
21	I64207712	D3	3/14/24				
22	I64207713	G1	3/14/24				
23	I64207714	G2	3/14/24				
24	I64207715	J1	3/14/24				
25	I64207716	J2	3/14/24				
26	I64207717	J3	3/14/24				
27	I64207718	J4	3/14/24				
28	I64207719	J5	3/14/24				
29	I64207720	J6	3/14/24				
30	I64207721	J7	3/14/24				
31	I64207722	J8	3/14/24				
32	I64207723	J9	3/14/24				
33	I64207724	J10	3/14/24				
34	I64207725	J11	3/14/24				

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Wheeler - Waverly.

Truss Design Engineer's Name: Sevier, Scott  
My license renewal date for the state of Missouri is December 31, 2025.

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



March 14, 2024

Job B240039	Truss A1	Truss Type Roof Special Supported Gable	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	--	----------	----------	--


AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207692 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:52 Page: 1

ID:QQEFJPNzKfml7r7BGyZ5zbfWd-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKfVrCDoi7J4JCf1

04/10/2024

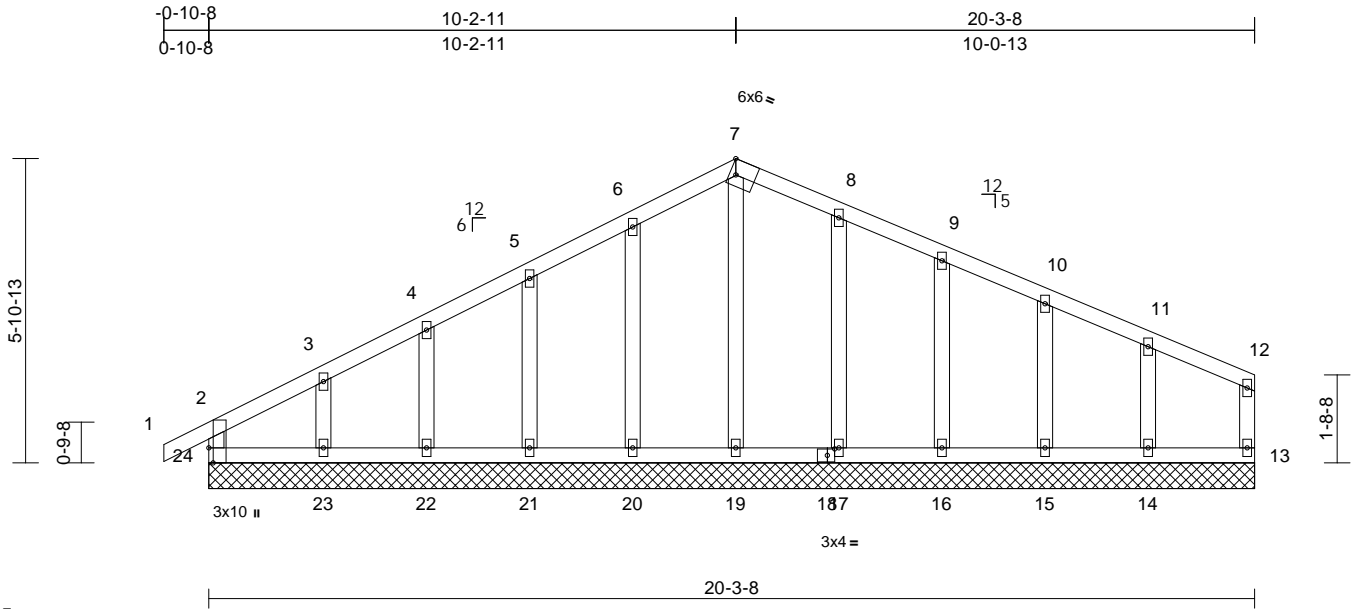

Scale = 1:44.7

Plate Offsets (X, Y): [7:Edge,0-3-8], [18:0-1-11,0-1-8], [24:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 86 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

**WEBS**  
 7-19=-128/0, 6-20=-151/80, 5-21=-138/80,  
 4-22=-141/71, 3-23=-137/103, 8-17=-151/72,  
 9-16=-139/73, 10-15=-139/69, 11-14=-148/83

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) All bearings are assumed to be SPF No.2.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 24, 16 lb uplift at joint 13, 56 lb uplift at joint 20, 57 lb uplift at joint 21, 43 lb uplift at joint 22, 95 lb uplift at joint 23, 48 lb uplift at joint 17, 50 lb uplift at joint 16, 44 lb uplift at joint 15 and 64 lb uplift at joint 14.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size)  
 13=20-3-8, 14=20-3-8, 15=20-3-8,  
 16=20-3-8, 17=20-3-8, 19=20-3-8,  
 20=20-3-8, 21=20-3-8, 22=20-3-8,  
 23=20-3-8, 24=20-3-8  
 Max Horiz 24=91 (LC 8)  
 Max Uplift 13=-16 (LC 8), 14=-64 (LC 9),  
 15=-44 (LC 9), 16=-50 (LC 9),  
 17=-48 (LC 9), 20=-56 (LC 8),  
 21=-57 (LC 8), 22=-43 (LC 8),  
 23=-95 (LC 8), 24=-56 (LC 4)  
 Max Grav 13=77 (LC 22), 14=191 (LC 1),  
 15=178 (LC 22), 16=179 (LC 1),  
 17=190 (LC 22), 19=168 (LC 18),  
 20=191 (LC 21), 21=178 (LC 1),  
 22=181 (LC 1), 23=179 (LC 21),  
 24=173 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-24=-153/58, 1-2=0/32, 2-3=-99/79,  
 3-4=-65/85, 4-5=-43/107, 5-6=-38/133,  
 6-7=-42/158, 7-8=-37/148, 8-9=-33/111,  
 9-10=-34/77, 10-11=-35/56, 11-12=-39/36,  
 12-13=-60/24  
 BOT CHORD 23-24=-18/28, 22-23=-18/28, 21-22=-18/28,  
 20-21=-18/28, 19-20=-18/28, 17-19=-18/28,  
 16-17=-18/28, 15-16=-18/28, 14-15=-18/28,  
 13-14=-18/28

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss A2	Truss Type Roof Special	Qty 1	Ply 1	Lot 173 HT
----------------	-------------	----------------------------	----------	----------	------------


AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207693 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:53 Page: 1

ID:yy9SXF9gZ7cK8MTg7UdLMVzbfWv-RfC?PsB70Hq3NSgPqnl8w3uITXbcKWrCD0rJ4zUC?f

04/10/2024

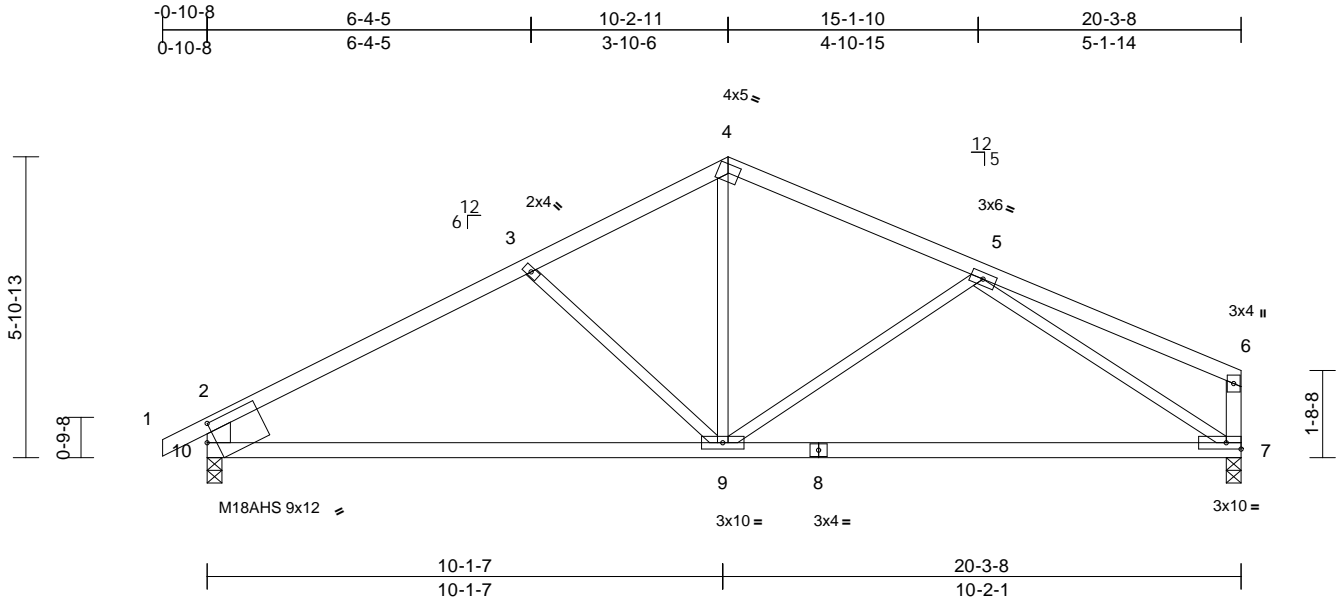

Scale = 1:45.2

Plate Offsets (X, Y): [4:0-0-0,Edge], [10:0-2-1,0-4-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.88	Vert(LL)	-0.22	7-9	>999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.82	Vert(CT)	-0.45	7-9	>529	240	M18AHS 142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.95	Horz(CT)	0.03	7	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	7-9	>999	240	Weight: 70 lb FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 7-6:2x4 SPF No.2,  
 10-2:2x6 SP 2400F 2.0E

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 136 lb uplift at joint 10 and 112 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**LOAD CASE(S)** Standard

**REACTIONS** (size) 7=0-3-8, 10=0-3-8  
 Max Horiz 10=90 (LC 8)  
 Max Uplift 7=-112 (LC 9), 10=-136 (LC 8)  
 Max Grav 7=894 (LC 1), 10=976 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/35, 2-3=-1280/181, 3-4=-1001/137, 4-5=-977/138, 5-6=-180/31, 6-7=-199/65, 2-10=-877/188  
 BOT CHORD 9-10=-164/1031, 7-9=-137/953  
 WEBS 3-9=-297/203, 4-9=-37/464, 5-9=-206/181, 5-7=-1034/169

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - All bearings are assumed to be SPF No.2.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)




Job B240039	Truss A3	Truss Type Roof Special Girder	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)	<b>RELEASE FOR CONSTRUCTION</b> <b>AS NOTED FOR PLAN REVIEW</b> <b>DEVELOPMENT SERVICES</b> 164207694 <b>LEE'S SUMMIT, MISSOURI</b>
----------------	-------------	-----------------------------------	----------	----------	--	---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54 Page: 1

ID:bnB?4gsYmF7Wpwn6MWCfXzbfYa-RIC?PsB70Hq3NSgPqnL8w3uITXJGKWRCDu7J4ZC?i

04/10/2024

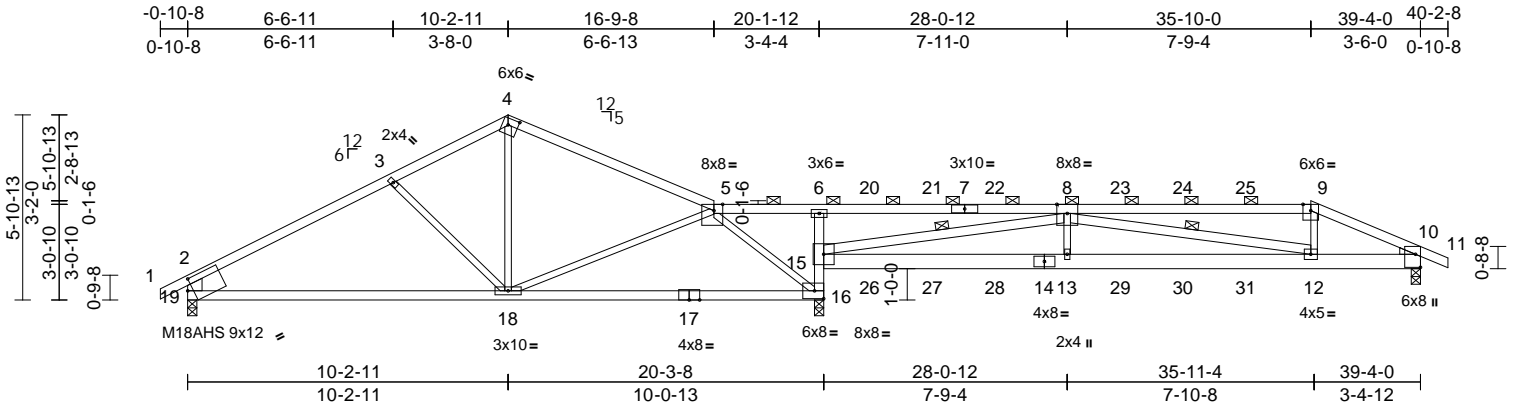

Scale = 1:73.5

Plate Offsets (X, Y): [4:0-3-12,0-2-8], [5:0-3-5,Edge], [10:Edge,0-1-14], [19:0-2-1,0-4-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.21	16-18	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.91	Vert(CT)	-0.44	16-18	>544	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	NO	WB	0.99	Horz(CT)	0.03	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.15	12-13	>999	240		Weight: 149 lb FT = 10%

**LUMBER**

**TOP CHORD** 2x4 SPF No.2 \*Except\* 7-9:2x4 SPF 2100F 1.8E  
**BOT CHORD** 2x4 SPF No.2 \*Except\* 15-14,14-10:2x6 SPF No.2  
**WEBS** 2x3 SPF No.2 \*Except\* 15-8,12-8:2x4 SPF No.2, 19-2:2x6 SP 2400F 2.0E  
**WEDGE** Right: 2x3 SPF No.2

**BRACING**

**TOP CHORD** Structural wood sheathing directly applied or 3-9-12 oc purlins, except end verticals, and 2-0-0 oc purlins (4-6-8 max.): 5-9.  
**BOT CHORD** Rigid ceiling directly applied or 9-3-9 oc bracing.  
**WEBS** 1 Row at midpt 8-15, 8-12

**REACTIONS**

(size) 10=0-3-8, 16=0-3-8, 19=0-3-8  
 Max Horiz 19=110 (LC 8)  
 Max Uplift 10=244 (LC 9), 16=370 (LC 9), 19=149 (LC 27)  
 Max Grav 10=1097 (LC 22), 16=2084 (LC 1), 19=917 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
**TOP CHORD** 1-2=0/35, 2-3=-1164/203, 3-4=-886/162, 4-5=-900/159, 5-6=-25/303, 6-8=0/256, 8-9=-1817/417, 9-10=-2108/429, 10-11=0/3, 2-19=-822/201  
**BOT CHORD** 18-19=-200/929, 16-18=-176/537, 15-16=-1295/313, 6-15=-485/212, 13-15=-607/2860, 12-13=-607/2860, 10-12=-343/1842  
**WEBS** 3-18=-307/202, 4-18=-46/393, 5-18=0/306, 5-16=-1096/200, 8-15=-3148/671, 8-13=0/377, 8-12=-1069/270, 9-12=0/518

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) Bearings are assumed to be: Joint 19 SPF No.2, Joint 16 SPF No.2, Joint 10 SPF No.2.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 149 lb uplift at joint 19, 370 lb uplift at joint 16 and 244 lb uplift at joint 10.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 80 lb down and 54 lb up at 21-9-4, 80 lb down and 54 lb up at 23-9-4, 80 lb down and 54 lb up at 25-9-4, 80 lb down and 54 lb up at 27-9-4, 80 lb down and 54 lb up at 29-9-4, 80 lb down and 54 lb up at 31-9-4, and 80 lb down and 54 lb up at 33-9-4, and 191 lb down and 125 lb up at 35-10-0 on top chord, and 23 lb down at 21-9-4, 23 lb down at 23-9-4, 23 lb down at 25-9-4, 23 lb down at 27-9-4, 23 lb down at 29-9-4, 23 lb down at 31-9-4, and 23 lb down at 33-9-4, and 56 lb down at 35-9-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

- 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-2=-70, 2-4=-70, 4-5=-70, 5-9=-70, 9-11=-70, 16-19=-20, 10-15=-20  
 Concentrated Loads (lb)  
 Vert: 8=-30 (F), 13=-17 (F), 12=-39 (F), 9=-71 (F), 20=-30 (F), 21=-30 (F), 22=-30 (F), 23=-30 (F), 24=-30 (F), 25=-30 (F), 26=-17 (F), 27=-17 (F), 28=-17 (F), 29=-17 (F), 30=-17 (F), 31=-17 (F)



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss A4	Truss Type Roof Special	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54 Page: 1  
 ID:aCzbX9DFnT?pU0OzOymMOfzbfai-RfC?PsB70Hq3NSgPqnL8w3ulTXbCKWRCDof4zJCf

04/10/2024

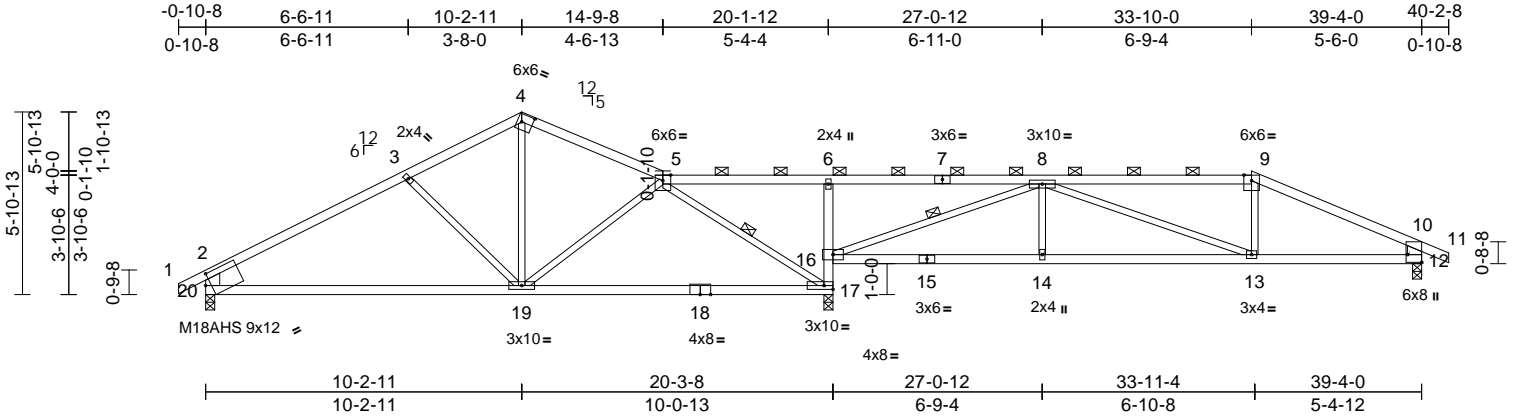

Scale = 1:74.5

Plate Offsets (X, Y): [4:0-4-4,0-3-0], [12:Edge,0-5-8], [20:0-2-1,0-4-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.79	Vert(LL)	-0.21	17-19	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.45	17-19	>533	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.90	Horz(CT)	0.03	17	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.09	13-14	>999	240		Weight: 133 lb FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 20-2,12-10:2x6 SP 2400F 2.0E

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 3-8-13 oc purlins, except end verticals, and 2-0-0 oc purlins (4-5-0 max.): 5-9.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 5-17, 8-16

**REACTIONS** (size)  
 12=0-3-8, 17=0-3-8, 20=0-3-8  
 Max Horiz 20=102 (LC 8)  
 Max Uplift 12=-175 (LC 9), 17=-291 (LC 9), 20=-136 (LC 8)  
 Max Grav 12=870 (LC 22), 17=1882 (LC 1), 20=909 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/35, 2-3=-1151/179, 3-4=-866/133, 4-5=-847/138, 5-6=0/277, 6-8=-6/369, 8-9=-1120/260, 9-10=-1306/248, 10-11=0/30, 2-20=-813/189, 10-12=-784/199  
 BOT CHORD 19-20=-173/918, 17-19=-70/678, 16-17=-1150/259, 6-16=-467/187, 14-16=-203/1300, 13-14=-203/1300, 12-13=-162/1123  
 WEBS 3-19=-310/205, 4-19=-44/415, 5-19=-17/137, 5-17=-1153/148, 8-16=-1744/308, 8-14=0/295, 8-13=-195/71, 9-13=0/261

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2 .
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 136 lb uplift at joint 20, 291 lb uplift at joint 17 and 175 lb uplift at joint 12.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 173 HT
B240039	A5	Roof Special	1	1	Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54  
ID:GzMy44hCTI7hNfIIUUVpvhzbcfg-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWCD0i7J4z3C7f

04/10/2024

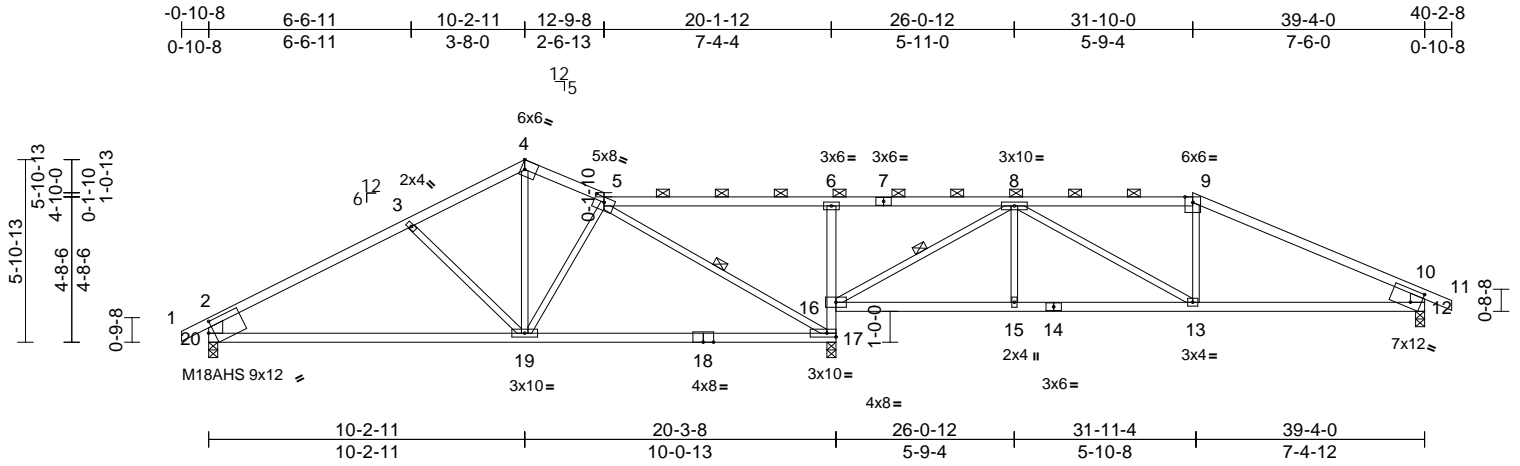

Scale = 1:74.5

Plate Offsets (X, Y): [4:Edge,0-3-8], [5:0-4-0,0-2-0], [12:0-3-15,0-4-14], [20:0-2-1,0-4-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.21	17-19	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.45	17-19	>531	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.78	Horz(CT)	0.03	17	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	17-19	>999	240		Weight: 136 lb FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 20-2,12-10:2x6 SP 2400F 2.0E

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 4-0-1 oc purlins, except end verticals, and 2-0-0 oc purlins (5-3-13 max.): 5-9.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 5-17, 8-16

**REACTIONS**

(size) 12=0-3-8, 17=0-3-8, 20=0-3-8  
 Max Horiz 20=102 (LC 8)  
 Max Uplift 12=-178 (LC 9), 17=-285 (LC 9), 20=-138 (LC 8)  
 Max Grav 12=866 (LC 22), 17=1892 (LC 1), 20=904 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/35, 2-3=-1143/184, 3-4=-854/137, 4-5=-818/149, 5-6=0/223, 6-8=0/307, 8-9=-1010/269, 9-10=-1202/243, 10-11=0/30, 2-20=-808/191, 10-12=-789/224  
 BOT CHORD 19-20=-177/912, 17-19=-64/742, 16-17=-1221/286, 6-16=-520/212, 15-16=-110/827, 13-15=-110/827, 12-13=-137/1008  
 WEBS 3-19=-312/207, 4-19=-70/485, 5-19=-131/163, 5-17=-1127/99, 8-16=-1270/210, 8-15=0/230, 8-13=-33/227, 9-13=0/197

**NOTES**

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 138 lb uplift at joint 20, 285 lb uplift at joint 17 and 178 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss A6	Truss Type Roof Special	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------------	----------	----------	--

**RELEASE FOR CONSTRUCTION**  
**AS NOTED FOR PLAN REVIEW**  
**DEVELOPMENT SERVICES**  
 164207697  
**LEE'S SUMMIT, MISSOURI**

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54  
 ID:xq2KgJkX9TFSU?Xg9XcMU0zbfV-RIC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofr4zJCf

04/10/2024

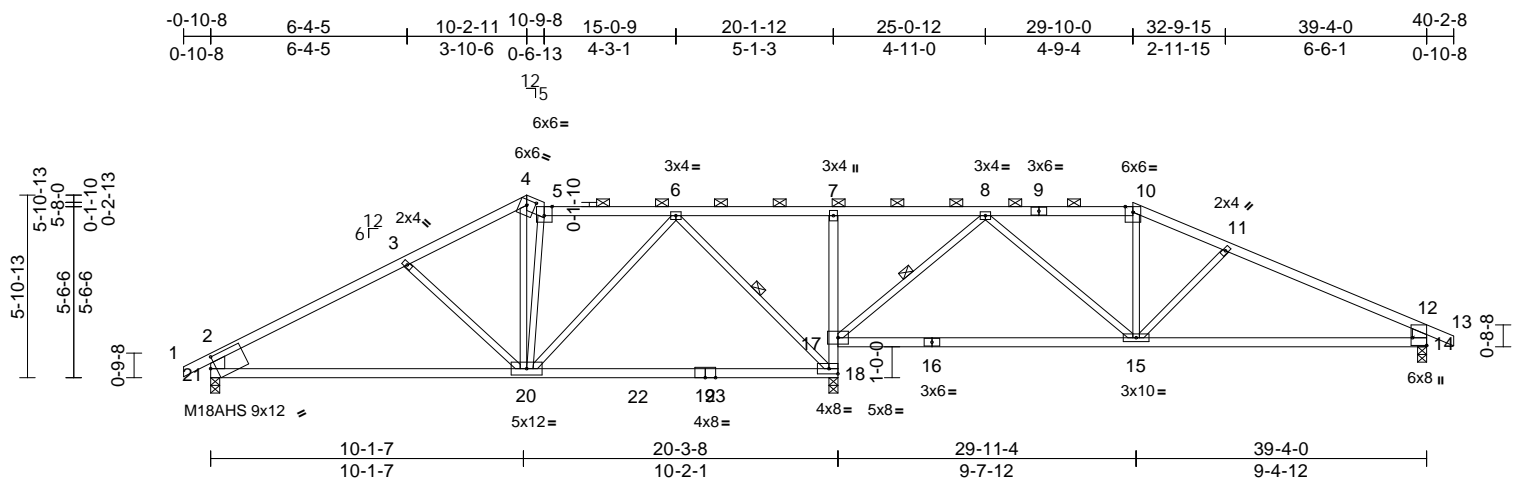

Scale = 1:74.5

Plate Offsets (X, Y): [4:0-3-3,0-2-2], [5:0-3-0,Edge], [14:Edge,0-5-8], [21:0-2-1,0-4-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.27	18-20	>883	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.61	Vert(CT)	-0.47	18-20	>512	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.50	Horz(CT)	-0.03	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	18-20	>999	240		Weight: 143 lb FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2 \*Except\* 4-5:2x6 SPF No.2
  - BOT CHORD 2x4 SPF 2100F 1.8E \*Except\* 18-7,17-16:2x4 SPF No.2
  - WEBS 2x3 SPF No.2 \*Except\* 21-2,14-12:2x6 SP 2400F 2.0E
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 4-3-9 oc purlins, except end verticals, and 2-0-0 oc purlins (5-11-2 max.): 5-10.
  - BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
  - WEBS 1 Row at midpt 6-18, 8-17
- REACTIONS**
- (size) 14=0-3-8, 18=0-3-8, 21=0-3-8
  - Max Horiz 21=101 (LC 8)
  - Max Uplift 14=-183 (LC 9), 18=-275 (LC 9), 21=-142 (LC 8)
  - Max Grav 14=874 (LC 24), 18=1970 (LC 2), 21=924 (LC 2)
- FORCES**
- (lb) - Maximum Compression/Maximum Tension
  - TOP CHORD 1-2=0/35, 2-3=-1157/194, 3-4=-928/142, 4-5=-830/152, 5-6=-833/151, 6-7=0/255, 7-8=0/303, 8-10=-897/231, 10-11=-1002/236, 11-12=-1213/286, 12-13=0/30, 2-21=-800/195, 12-14=-770/228
  - BOT CHORD 20-21=-186/954, 18-20=-42/456, 17-18=-1123/237, 7-17=-360/145, 15-17=-82/512, 14-15=-185/1038
  - WEBS 3-20=-296/199, 4-20=-82/509, 5-20=-375/115, 6-18=-976/141, 8-15=0/520, 10-15=0/178, 6-20=-11/563, 8-17=-1021/217, 11-15=-264/167

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) All bearings are assumed to be SPF 2100F 1.8E.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 142 lb uplift at joint 21, 275 lb uplift at joint 18 and 183 lb uplift at joint 14.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)




Job B240039	Truss A7	Truss Type Roof Special Girder	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54  
 ID:g7CEXHMaJFZGzY?gN5OXhzbjZ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDot4zJcFf

02/10/2024

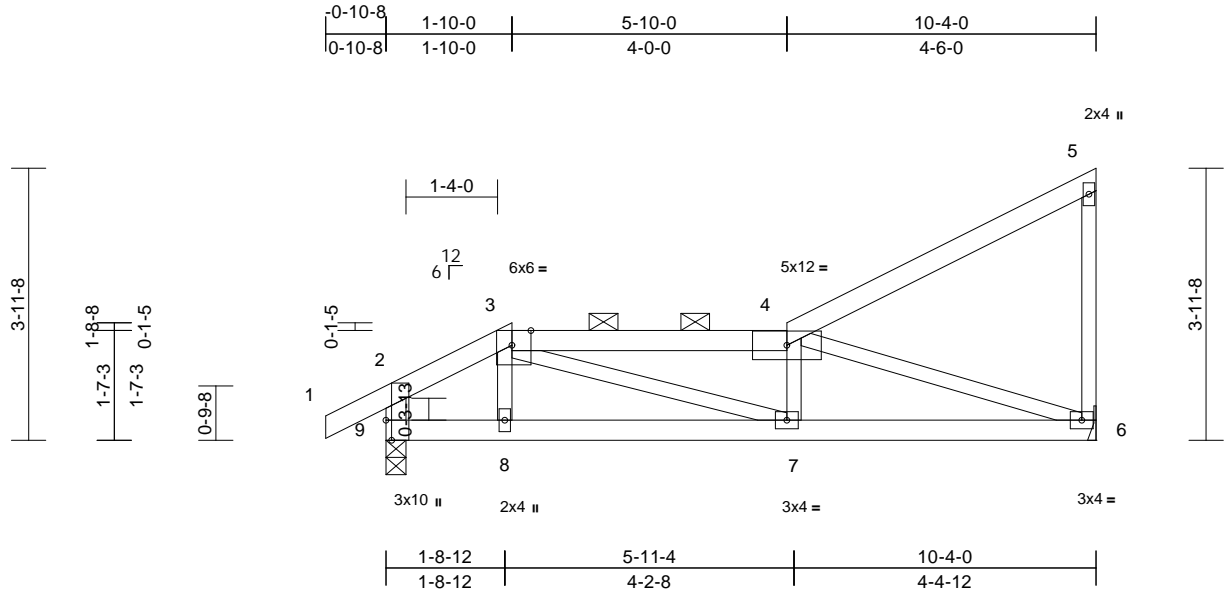

Scale = 1:33.5

Plate Offsets (X, Y): [3:0-3-5,Edge], [9:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	-0.03	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.35	Vert(CT)	-0.07	7-8	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.47	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.03	7-8	>999	240	Weight: 38 lb	FT = 10%

- LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 9-2:2x4 SPF No.2
- BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-5 max.): 3-4.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS**  
 (size) 6= Mechanical, 9=0-3-8  
 Max Horiz 9=158 (LC 5)  
 Max Uplift 6=-97 (LC 8), 9=-97 (LC 8)  
 Max Grav 6=449 (LC 1), 9=525 (LC 1)
- FORCES**  
 (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/32, 2-3=-546/84, 3-4=-885/133, 4-5=-123/52, 5-6=-139/64, 2-9=-424/87  
 BOT CHORD 8-9=-116/438, 7-8=-119/441, 6-7=-148/881  
 WEBS 3-8=-40/61, 3-7=-97/468, 4-7=-53/95, 4-6=-909/188

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 97 lb uplift at joint 6 and 97 lb uplift at joint 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 122 lb down and 70 lb up at 1-10-0 on top chord, and 11 lb down and 5 lb up at 1-10-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard
- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 6-9=-20  
 Concentrated Loads (lb)  
 Vert: 8=5 (F)

- NOTES**
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - All bearings are assumed to be SPF No.2.
  - Refer to girder(s) for truss to truss connections.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com




Job B240039	Truss B1	Truss Type Monopitch	Qty 7	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54 Page: 1  
ID:4?UDOKk9VZXfHaZInszMmPzbfWA-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWrcD07J4ZJC?i

04/10/2024

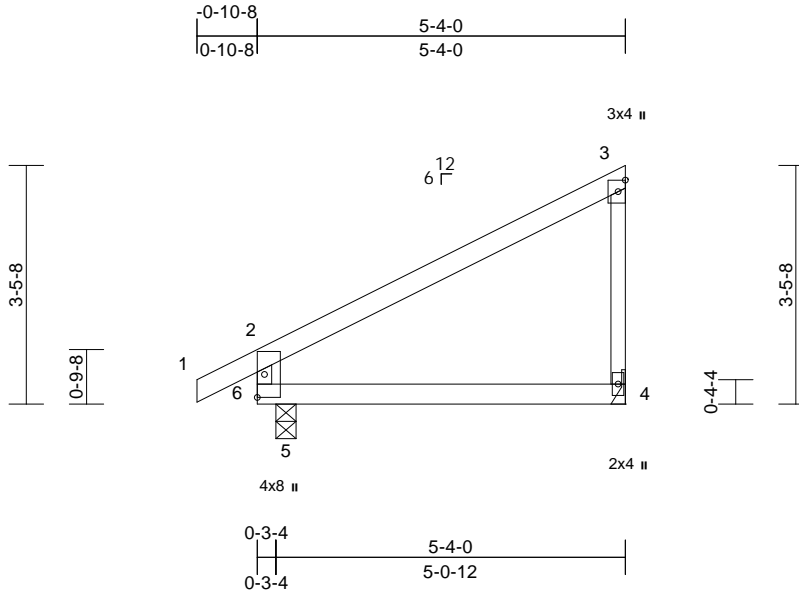

Scale = 1:33.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	-0.02	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	-0.04	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 17 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-4-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 4= Mechanical, 5=0-3-8  
Max Horiz 5=136 (LC 5)  
Max Uplift 4=-57 (LC 8), 5=-52 (LC 8)  
Max Grav 4=204 (LC 1), 5=326 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/31, 2-3=-135/53, 3-4=-157/78, 2-6=-270/92  
BOT CHORD 5-6=-15/104, 4-5=-42/36

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 57 lb uplift at joint 4 and 52 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss B2	Truss Type Monopitch	Qty 6	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207700 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:54 Page: 1  
ID:g9HfCUuCCQ0VtW1sCfcgyBzbfWU-RfC?PsB70Hq3NSgPqnL8w3ulTXbCKWrCDot44zJC7f

04/10/2024

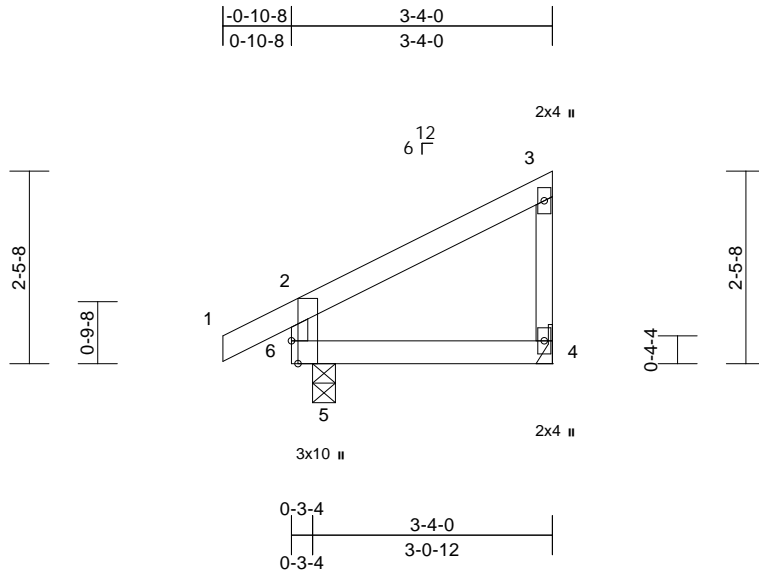

Scale = 1:29.4

Plate Offsets (X, Y): [6:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 11 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 3-4-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 4= Mechanical, 5=0-3-8  
 Max Horiz 5=95 (LC 5)  
 Max Uplift 4=-33 (LC 5), 5=-43 (LC 8)  
 Max Grav 4=105 (LC 1), 5=244 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/31, 2-3=-81/28, 3-4=-92/48, 2-6=-196/65  
 BOT CHORD 5-6=-17/72, 4-5=-31/25

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 4) All bearings are assumed to be SPF No.2 .
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 4 and 43 lb uplift at joint 5.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss C1	Truss Type Common Supported Gable	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	--------------------------------------	----------	----------	--

**RELEASE FOR CONSTRUCTION**  
**AS NOTED FOR PLAN REVIEW**  
**DEVELOPMENT SERVICES**  
 164207701  
**LEE'S SUMMIT, MISSOURI**

02/10/2024

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1  
 ID:XSivFLY7PTnPB\_fMSawS?GzbfuRfC?Pb7S0Hq3NSgPqnlL8w3uITXbGKwRCD0i7JzJC07

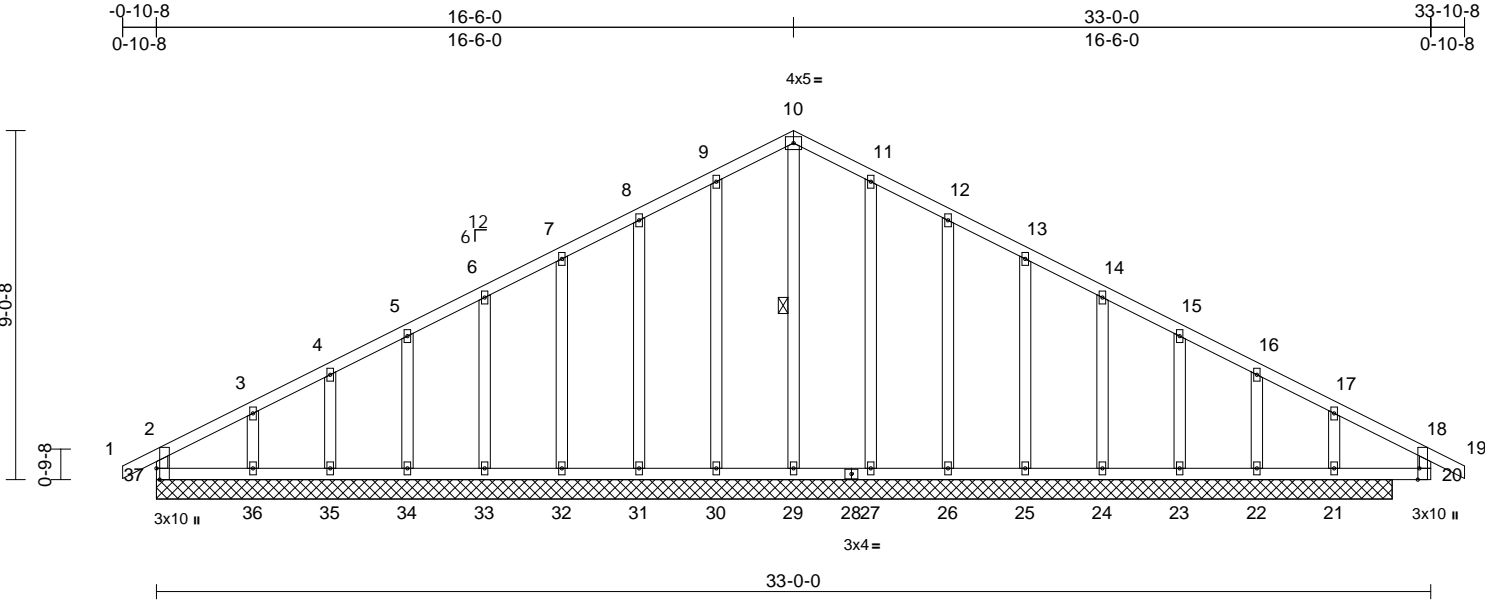

Scale = 1:59.7

Plate Offsets (X, Y): [20:0-3-8,Edge], [37:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.17	Horz(CT)	-0.01	21	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R								

Weight: 164 lb FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
 WEBS 1 Row at midpt 10-29

**REACTIONS** (size)  
 21=32-0-0, 22=32-0-0, 23=32-0-0,  
 24=32-0-0, 25=32-0-0, 26=32-0-0,  
 27=32-0-0, 29=32-0-0, 30=32-0-0,  
 31=32-0-0, 32=32-0-0, 33=32-0-0,  
 34=32-0-0, 35=32-0-0, 36=32-0-0,  
 37=32-0-0  
 Max Horiz 37=134 (LC 8)  
 Max Uplift 21=73 (LC 9), 22=57 (LC 9),  
 23=53 (LC 9), 24=54 (LC 9),  
 25=53 (LC 9), 26=58 (LC 9),  
 27=48 (LC 9), 30=51 (LC 8),  
 31=57 (LC 8), 32=54 (LC 8),  
 33=53 (LC 8), 34=59 (LC 8),  
 35=34 (LC 8), 36=122 (LC 8),  
 37=69 (LC 4)  
 Max Grav 21=391 (LC 1), 22=63 (LC 16),  
 23=211 (LC 1), 24=172 (LC 22),  
 25=183 (LC 1), 26=175 (LC 1),  
 27=197 (LC 22), 29=334 (LC 18),  
 30=195 (LC 1), 31=177 (LC 21),  
 32=181 (LC 1), 33=179 (LC 21),  
 34=186 (LC 1), 35=167 (LC 21),  
 36=264 (LC 1), 37=132 (LC 21)

**FORCES** (lb) - Maximum Compression/Maximum Tension

**TOP CHORD** 2-37=119/71, 1-2=0/32, 2-3=157/239,  
 3-4=91/225, 4-5=55/240, 5-6=26/248,  
 6-7=0/258, 7-8=0/268, 8-9=0/280,  
 9-10=0/277, 18-20=27/20, 10-11=0/271,  
 11-12=0/257, 12-13=0/231, 13-14=0/207,  
 14-15=0/206, 15-16=0/212, 16-17=14/186,  
 17-18=69/234, 18-19=0/32  
**BOT CHORD** 36-37=157/87, 35-36=157/87,  
 34-35=157/87, 33-34=157/87,  
 32-33=157/87, 31-32=157/87,  
 30-31=157/87, 29-30=157/87,  
 27-29=157/87, 26-27=157/87,  
 25-26=157/87, 24-25=157/87,  
 23-24=157/87, 22-23=157/87,  
 21-22=157/87, 20-21=157/87  
**WEBS** 10-29=294/0, 9-30=155/75, 8-31=137/81,  
 7-32=141/78, 6-33=140/77, 5-34=143/81,  
 4-35=133/65, 3-36=189/123,  
 11-27=157/72, 12-26=135/82,  
 13-25=141/77, 14-24=137/78,  
 15-23=154/78, 16-22=83/77, 17-21=248/97

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 9) All bearings are assumed to be SPF No.2 .
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 69 lb uplift at joint 37, 51 lb uplift at joint 30, 57 lb uplift at joint 31, 54 lb uplift at joint 32, 53 lb uplift at joint 33, 59 lb uplift at joint 34, 34 lb uplift at joint 35, 122 lb uplift at joint 36, 48 lb uplift at joint 27, 58 lb uplift at joint 26, 53 lb uplift at joint 25, 54 lb uplift at joint 24, 53 lb uplift at joint 23, 57 lb uplift at joint 22 and 73 lb uplift at joint 21.
  - 11) Non Standard bearing condition. Review required.
  - 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss C2	Truss Type Common	Qty 7	Ply 1	Lot 173 HT
----------------	-------------	----------------------	----------	----------	------------

**RELEASE FOR CONSTRUCTION**  
**AS NOTED FOR PLAN REVIEW**  
**DEVELOPMENT SERVICES**  
 164207702  
**LEE'S SUMMIT, MISSOURI**

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1  
 ID: ?15k3oKmbR3kzTRy1scmPzzbnT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGLWrcDol74zJC7f

04/10/2024

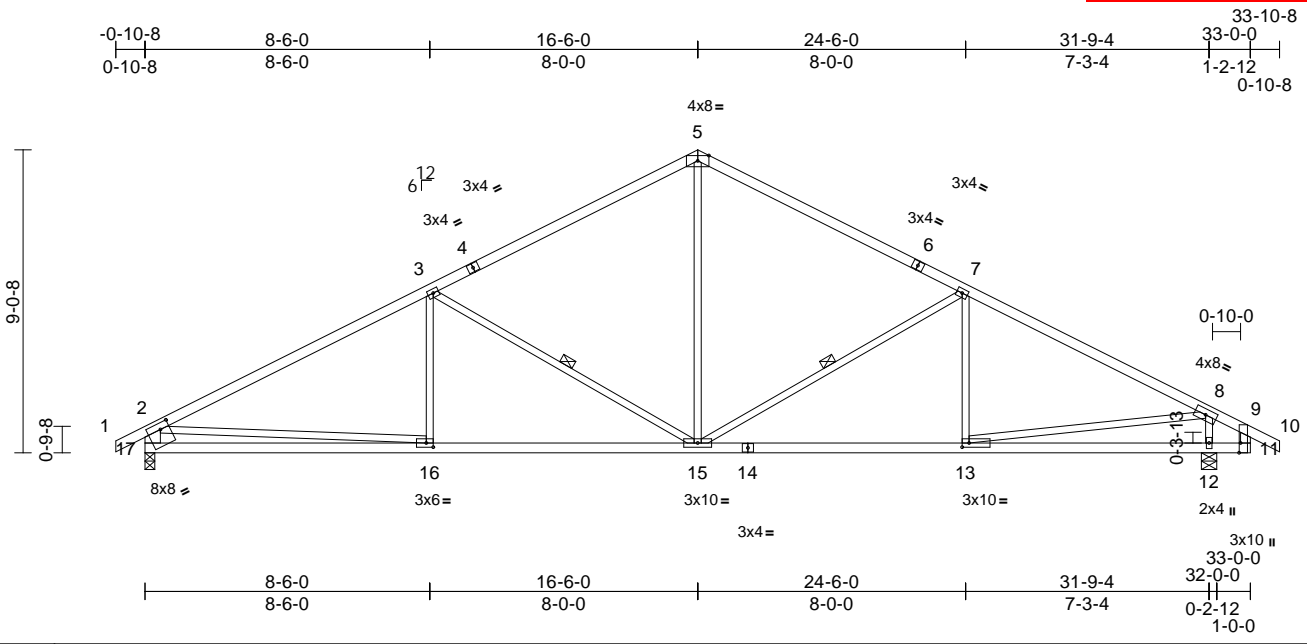

Scale = 1:68.8

Plate Offsets (X, Y): [11:0-3-8,Edge], [13:0-2-8,0-1-8], [16:0-2-8,0-1-8], [17:0-3-4,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.12	16-17	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.26	16-17	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.06	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	15-16	>999	240	Weight: 125 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 17-2:2x6 SPF No.2, 11-9:2x4 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 9-10-12 oc bracing.  
 WEBS 1 Row at midpt 3-15, 7-15

**REACTIONS** (size) 12=0-5-8, 17=0-3-8  
 Max Horiz 17=-134 (LC 6)  
 Max Uplift 12=-213 (LC 9), 17=-204 (LC 8)  
 Max Grav 12=1592 (LC 1), 17=1493 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/35, 2-3=-2277/284, 3-5=-1595/250, 5-7=-1594/257, 7-8=-2057/255, 8-9=-173/0, 9-10=0/32, 2-17=-1411/250, 9-11=-100/0  
 BOT CHORD 16-17=-344/762, 15-16=-276/1921, 13-15=-111/1746, 12-13=-17/169, 11-12=-17/169  
 WEBS 3-16=0/278, 3-15=-758/265, 5-15=-56/792, 7-15=-581/238, 7-13=-94/153, 8-12=-1460/318, 2-16=0/1162, 8-13=-95/1594

- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 5) All bearings are assumed to be SPF No.2 .
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 204 lb uplift at joint 17 and 213 lb uplift at joint 12.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss C3	Truss Type Roof Special	Qty 5	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1  
 ID: Z5nTbjGZwPzDQxi1tO17rPzbfor-RfC?PsB70Hq3NSgPqnL8w3uITXbGKvtrCDoi7J4zJC?

04/10/2024

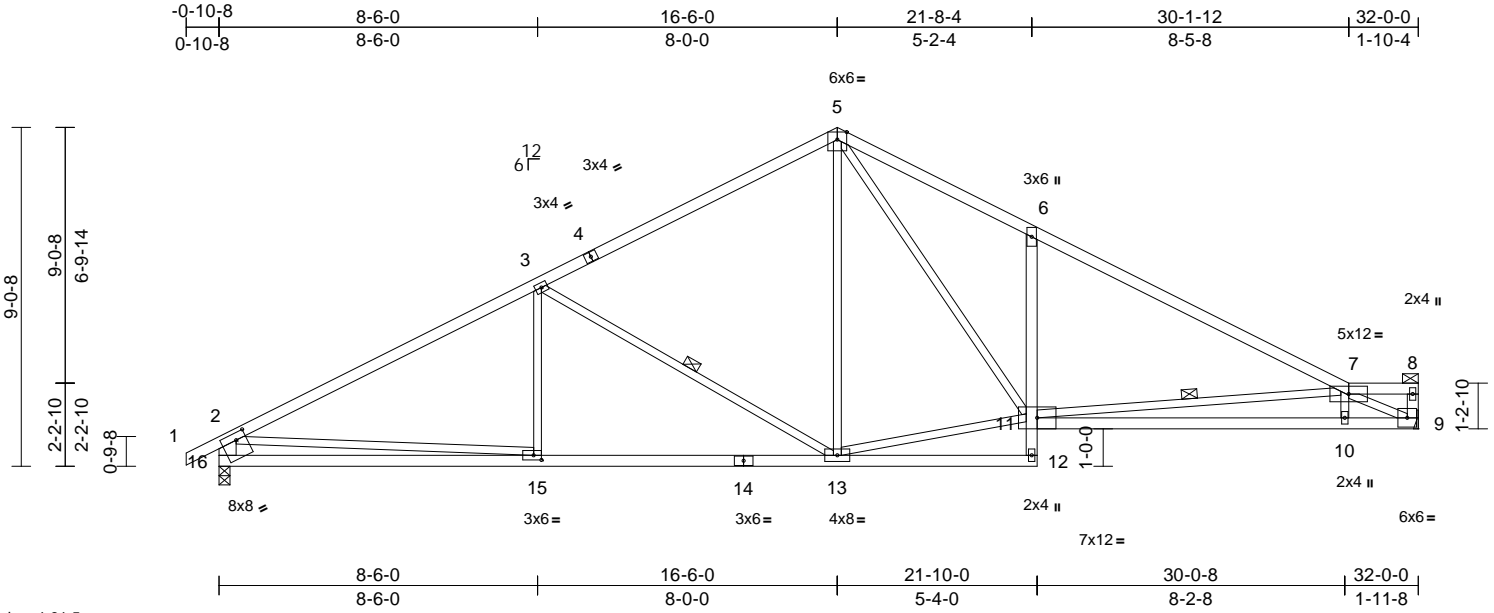

Scale = 1:61.5

Plate Offsets (X, Y): [15:0-2-8,0-1-8], [16:0-3-4,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.18	10-11	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.92	Vert(CT)	-0.43	10-11	>889	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.10	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.12	10-11	>999	240	Weight: 131 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2 \*Except\* 5-7:2x4 SPF 2100F 1.8E  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 8-9:2x4 SPF No.2, 16-2:2x6 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-8.  
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.  
 WEBS 1 Row at midpt 3-13, 7-11

**REACTIONS** (size) 9= Mechanical, 16=0-3-8  
 Max Horiz 16=167 (LC 8)  
 Max Uplift 9=174 (LC 9), 16=204 (LC 8)  
 Max Grav 9=1422 (LC 1), 16=1502 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/35, 2-3=-2299/283, 3-5=-1608/247, 5-6=-2284/424, 6-7=-2359/272, 7-8=-84/20, 8-9=-37/14, 2-16=-1421/250  
 BOT CHORD 15-16=-375/750, 13-15=-308/1942, 12-13=-45/83, 11-12=0/79, 6-11=-550/306, 10-11=-306/2658, 9-10=-321/2649  
 WEBS 3-15=0/286, 3-13=-761/264, 5-13=-42/353, 11-13=-43/1251, 5-11=-293/1159, 7-11=-692/150, 7-10=0/295, 7-9=-2913/343, 2-15=-1/1194

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 174 lb uplift at joint 9 and 204 lb uplift at joint 16.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss C4	Truss Type Common	Qty 2	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207704  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1  
ID:oUBkejLup2P?IGuQQQgJINzbfq1-RfC?PsB70Hq3NSgPqnL8w3uITXbGK?VrCDoi7J4ZJC#

04/10/2024

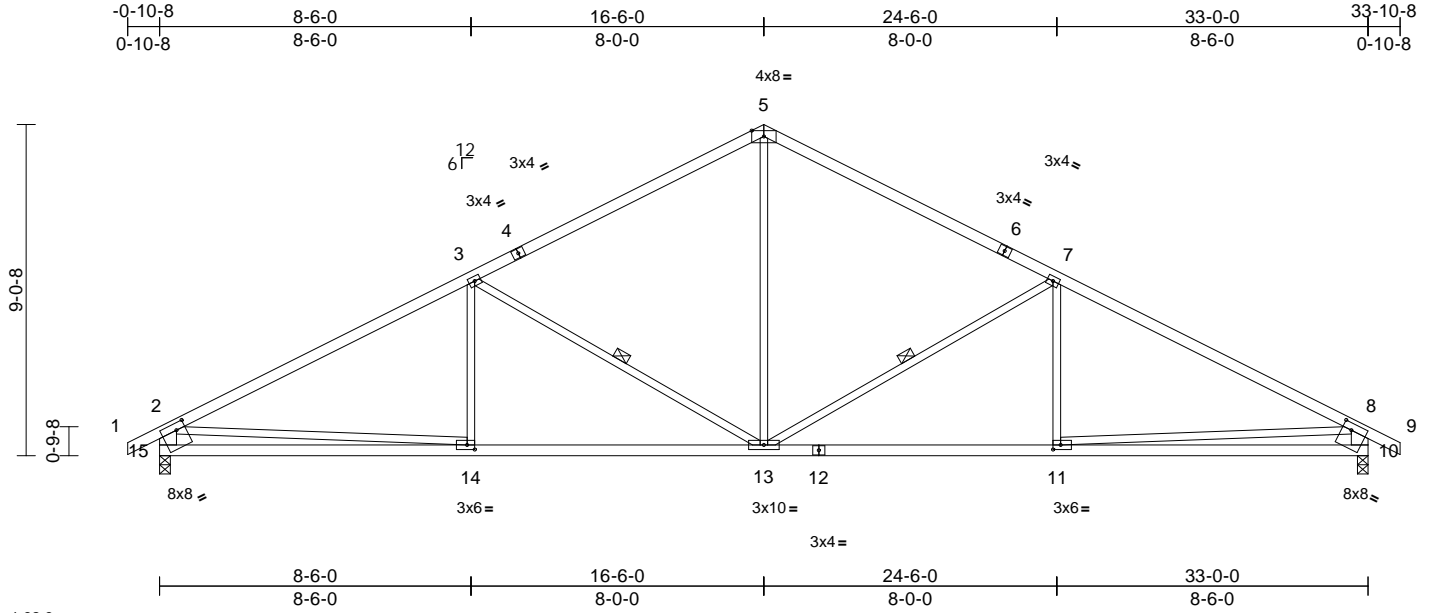

Scale = 1:62.9

Plate Offsets (X, Y): [10:0-3-0,0-2-4], [11:0-2-8,0-1-8], [14:0-2-8,0-1-8], [15:0-3-0,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.12	13-14	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-0.26	13-14	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.07	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	13-14	>999	240	Weight: 125 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 15-2,10-8:2x6 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 9-10-12 oc bracing.  
 WEBS 1 Row at midpt 7-13, 3-13

**REACTIONS** (size) 10=0-3-8, 15=0-3-8  
 Max Horiz 15=-135 (LC 6)  
 Max Uplift 10=-207 (LC 9), 15=-207 (LC 8)  
 Max Grav 10=1542 (LC 1), 15=1542 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/35, 2-3=-2373/289, 3-5=-1696/264, 5-7=-1696/264, 7-8=-2373/289, 8-9=0/35, 2-15=-1460/253, 8-10=-1460/252  
 BOT CHORD 14-15=-344/771, 13-14=-280/2006, 11-13=-147/2006, 10-11=-222/771  
 WEBS 5-13=-62/886, 7-13=-755/264, 7-11=0/276, 3-13=-755/264, 3-14=0/276, 2-14=0/1239, 8-11=-9/1239

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60  
 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) All bearings are assumed to be SPF No.2 .
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 207 lb uplift at joint 15 and 207 lb uplift at joint 10.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1 .

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss C5	Truss Type Common	Qty 2	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--


RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207705  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1  
ID:fGeYE976vqLzr8PFCU0rozbfu-RfC?PsB70Hq3NSgPqnL8w3u1TXbGKw7rCDoi7J4zJC?

04/10/2024

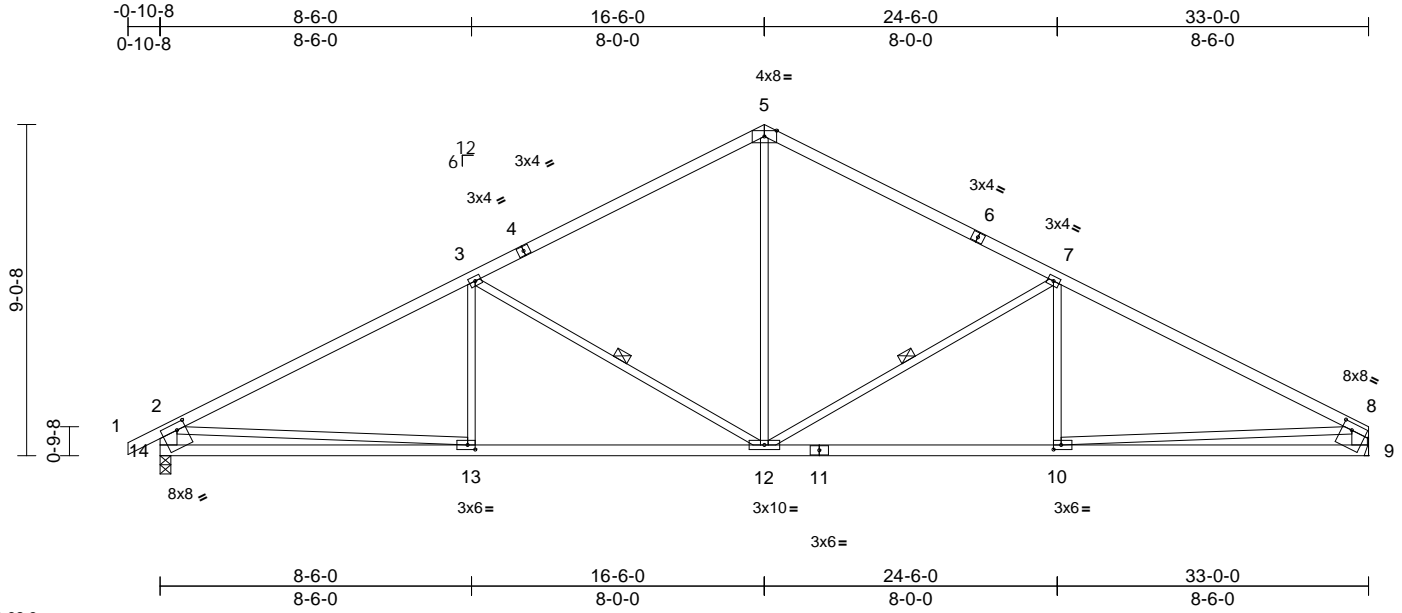

Scale = 1:62.9

Plate Offsets (X, Y): [8:0-3-4,0-2-4], [10:0-2-8,0-1-8], [13:0-2-8,0-1-8], [14:0-3-0,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.12	10-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-0.26	13-14	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.62	Horz(CT)	0.07	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	12-13	>999	240	Weight: 124 lb	FT = 10%

**LUMBER**  
TOP CHORD 2x4 SPF No.2 \*Except\* 6-8:2x4 SPF 2100F 1.8E  
BOT CHORD 2x4 SPF No.2  
WEBS 2x3 SPF No.2 \*Except\* 14-2,9-8:2x6 SPF No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 9-9-6 oc bracing.  
WEBS 1 Row at midpt 7-12, 3-12

**REACTIONS** (size) 9= Mechanical, 14=0-3-8  
Max Horiz 14=142 (LC 8)  
Max Uplift 9=-181 (LC 9), 14=-207 (LC 8)  
Max Grav 9=1463 (LC 1), 14=1543 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/35, 2-3=-2376/289, 3-5=-1699/264, 5-7=-1702/264, 7-8=-2382/291, 2-14=-1461/253, 8-9=-1380/226  
BOT CHORD 13-14=-353/770, 12-13=-289/2009, 10-12=-174/2025, 9-10=-120/565  
WEBS 5-12=-68/897, 7-12=-776/273, 7-10=0/270, 3-12=-756/265, 3-13=0/276, 2-13=-11/1243, 8-10=-73/1464

- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 5) All bearings are assumed to be SPF No.2 .
  - 6) Refer to girder(s) for truss to truss connections.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 207 lb uplift at joint 14 and 181 lb uplift at joint 9.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss C6	Truss Type Roof Special	Qty 4	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------------	----------	----------	--

**RELEASE FOR CONSTRUCTION**  
**AS NOTED FOR PLAN REVIEW**  
**DEVELOPMENT SERVICES**  
 164207706  
**LEE'S SUMMIT, MISSOURI**

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1  
 ID: Sv8G6eXFYmFTY5T6qX\_dSzbwF-RfC?PsB70Hq3NSgPqnL8w3ulTXbCKWwCDd0J4zJC?f

04/10/2024

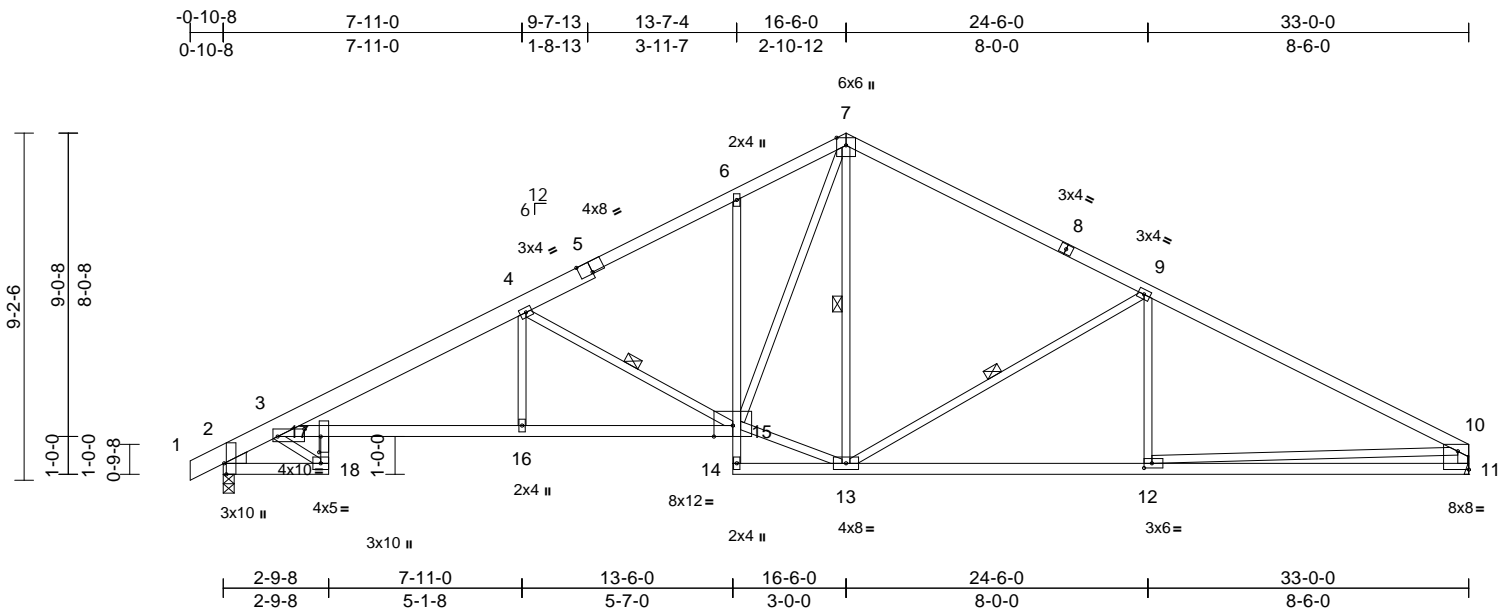

Scale = 1:61  
 Plate Offsets (X, Y): [2:0-3-8,Edge], [3:0-8-8,0-2-6], [5:0-4-0,Edge], [11:Edge,0-5-13], [12:0-2-8,0-1-8], [17:0-5-0,0-0-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.29	16-17	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-0.54	16-17	>723	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.27	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.25	16-17	>999	240	Weight: 140 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2 \*Except\* 1-5:2x6 SPF No.2, 8-10:2x4 SPF 2100F 1.8E  
 BOT CHORD 2x4 SPF No.2 \*Except\* 18-17,6-14:2x3 SPF No.2, 3-15:2x4 SPF 2400F 2.0E  
 WEBS 2x3 SPF No.2 \*Except\* 11-10:2x4 SPF 2100F 1.8E  
 WEDGE Left: 2x4 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:  
 2-2-0 oc bracing: 16-17.  
 WEBS 1 Row at midpt 4-15, 7-13, 9-13

**REACTIONS** (size) 2=0-3-8, 11= Mechanical  
 Max Horiz 2=157 (LC 12)  
 Max Uplift 2=-206 (LC 8), 11=-182 (LC 9)  
 Max Grav 2=1544 (LC 1), 11=1471 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/3, 2-3=-1718/226, 3-4=-3123/411, 4-6=-2205/299, 6-7=-2070/376, 10-11=-1387/227, 7-9=-1714/266, 9-10=-2417/293  
 BOT CHORD 2-18=-264/988, 17-18=-174/713, 3-17=-388/2669, 16-17=-415/2791, 15-16=-415/2791, 14-15=0/3, 6-15=-203/138, 13-14=-31/75, 12-13=-174/2057, 11-12=-128/599  
 WEBS 4-16=0/389, 4-15=-1098/298, 13-15=-30/1406, 7-15=-278/1246, 7-13=-88/195, 9-12=0/287, 10-12=-78/1462, 9-13=-790/273, 3-18=-1070/296

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - All bearings are assumed to be SPF No.2 .
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 206 lb uplift at joint 2 and 182 lb uplift at joint 11.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



March 14, 2024



Job B240039	Truss C7	Truss Type Roof Special	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------------	----------	----------	--

RELEASE FOR CONSTRUCTION  
AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207707  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 AM 2024 Page: 1  
ID:3i0GFA?8mYwZz\_mMRHfzNzbzW-RfC?PsB70Hq3NSgPqnL8w3uTXb0KWrCD07J4zJC?f

04/10/2024

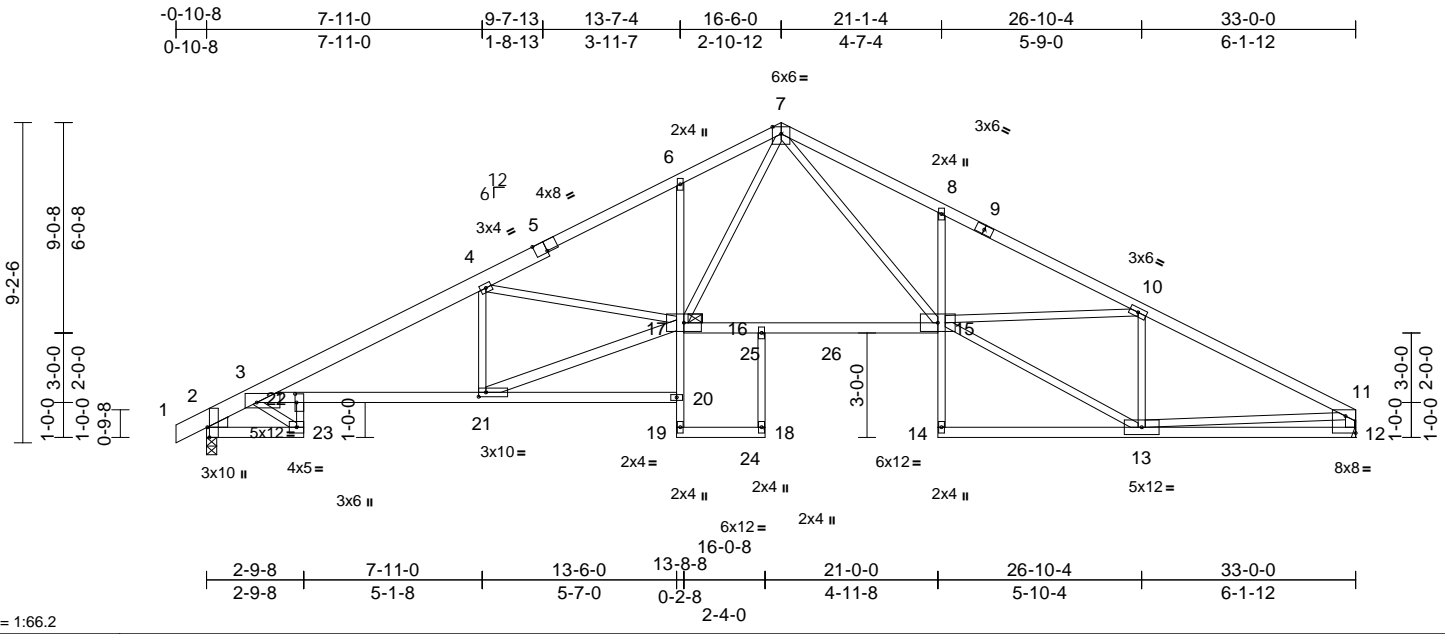


Plate Offsets (X, Y): [2:0-3-8,Edge], [3:0-8-0,0-3-2], [5:0-4-0,Edge], [12:Edge,0-5-13], [21:0-2-8,0-1-8], [22:0-3-0,0-0-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.46	15-16	>847	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.93	Vert(CT)	-0.80	15-16	>490	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.86	Horz(CT)	0.46	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.23	21-22	>999	240	Weight: 157 lb	FT = 10%

**LUMBER**  
TOP CHORD 2x4 SPF No.2 \*Except\* 1-5:2x6 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\* 23-22,6-19,18-16,8-14:2x3 SPF No.2, 3-20:2x4 SPF 2400F 2.0E  
WEBS 2x3 SPF No.2 \*Except\* 17-21,12-11:2x4 SPF No.2  
WEDGE Left: 2x4 SPF No.2  
**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-4-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.  
JOINTS 1 Brace at Jt(s): 17  
**REACTIONS** (size) 2=0-3-8, 12= Mechanical  
Max Horiz 2=157 (LC 12)  
Max Uplift 2=206 (LC 8), 12=182 (LC 9)  
Max Grav 2=1630 (LC 2), 12=1549 (LC 2)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/3, 2-3=-1657/204, 3-4=-3286/408, 4-6=-3423/371, 6-7=-3323/447, 7-8=-3960/454, 8-10=-3958/343, 10-11=-2555/294, 11-12=-1442/212  
BOT CHORD 2-23=-234/849, 22-23=-154/630, 3-22=-391/2836, 21-22=-414/2947, 20-21=-88/0, 19-20=0/88, 17-20=0/166, 6-17=-197/142, 18-19=-26/0, 16-18=0/18, 16-17=-90/2259, 15-16=-100/2242, 14-15=0/97, 8-15=-366/205, 13-14=-4/15, 12-13=-90/424  
WEBS 4-21=-699/180, 17-21=-412/3188, 4-17=-213/196, 7-17=-264/1594, 7-15=-319/1989, 13-15=-221/2493, 10-15=-58/1255, 10-13=-1130/198, 3-23=-908/264, 11-13=-111/1803

- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCCL = 10.0psf.
  - All bearings are assumed to be SPF No.2.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 206 lb uplift at joint 2 and 182 lb uplift at joint 12.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job B240039	Truss C8	Truss Type Common	Qty 1	Ply 1	Lot 173 HT
----------------	-------------	----------------------	----------	----------	------------


AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207708  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:55 Page: 1

ID:sELsBCScXRp2csNWIDBKGbZbgF0-RfC?PsB70Hq3NSgPqnL8w3ulTXb8KWrcD07J4ZJC?r

04/10/2024

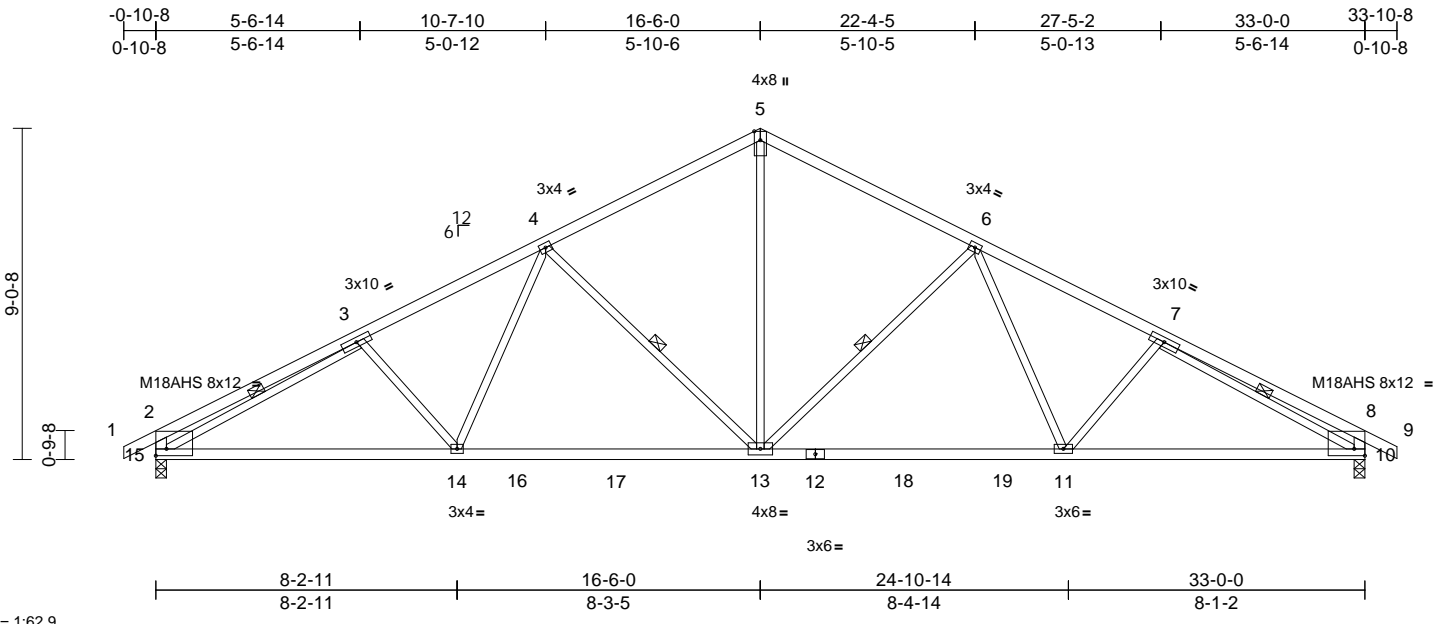

Scale = 1:62.9

Plate Offsets (X, Y): [2:Edge,0-2-4], [8:Edge,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	-0.22	11-13	>999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.88	Vert(CT)	-0.38	11-13	>999	240	M18AHS 142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.71	Horz(CT)	0.11	10	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.09	13-14	>999	240	Weight: 129 lb FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2 \*Except\* 15-2,10-8:2x4 SPF 2100F 1.8E

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 3-6-10 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 6-13, 4-13, 3-15, 7-10

**REACTIONS**  
 (size) 10=0-3-8, 15=0-3-8  
 Max Horiz 15=134 (LC 12)  
 Max Uplift 10=-206 (LC 9), 15=-206 (LC 8)  
 Max Grav 10=1612 (LC 2), 15=1612 (LC 2)

**FORCES**  
 (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/32, 2-3=-755/178, 3-4=-2404/307, 4-5=-1761/267, 5-6=-1761/267, 6-7=-2405/307, 7-8=-755/178, 8-9=0/32, 2-15=-569/175, 8-10=-570/175  
 BOT CHORD 14-15=-337/2155, 13-14=-219/1939, 11-13=-85/1939, 10-11=-203/2153  
 WEBS 5-13=-107/1189, 6-13=-635/238, 6-11=-24/436, 7-11=-183/168, 4-13=-635/238, 4-14=-24/435, 3-14=-182/168, 3-15=-1812/142, 7-10=-1813/143

- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) All bearings are assumed to be SPF No.2 .
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 206 lb uplift at joint 15 and 206 lb uplift at joint 10.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are MT20 plates unless otherwise indicated.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss C9	Truss Type Common Supported Gable	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	--------------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
ID:KqY\_7e5eP2N52VlvSYqC6PzbeJL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRcDoi7JzJC7

02/10/2024

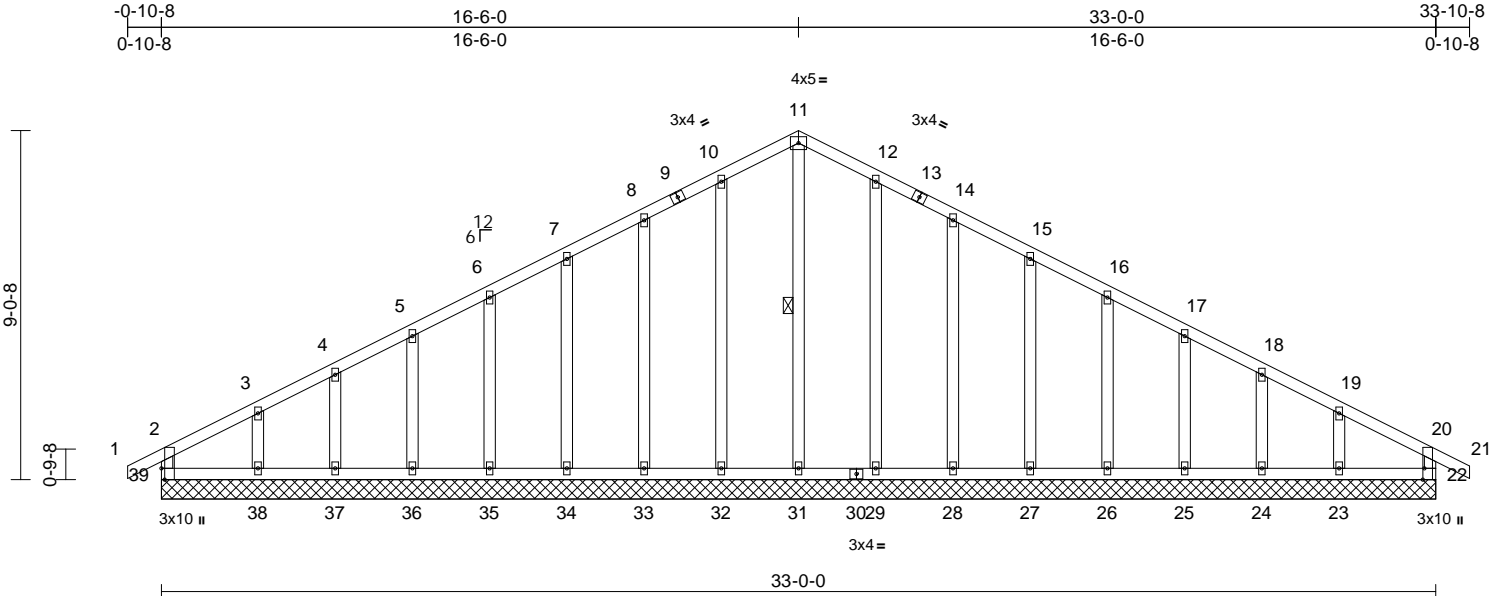

Scale = 1:59.7

Plate Offsets (X, Y): [22:0-3-8,Edge], [39:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.16	Horz(CT)	0.01	22	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R								
											Weight: 164 lb	FT = 10%

**LUMBER**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**WEBS**  
1 Row at midpt 11-31

**REACTIONS** (size)  
22=33-0-0, 23=33-0-0, 24=33-0-0, 25=33-0-0, 26=33-0-0, 27=33-0-0, 28=33-0-0, 29=33-0-0, 31=33-0-0, 32=33-0-0, 33=33-0-0, 34=33-0-0, 35=33-0-0, 36=33-0-0, 37=33-0-0, 38=33-0-0, 39=33-0-0  
Max Horiz 39=134 (LC 9)  
Max Uplift 22=17 (LC 5), 23=103 (LC 9), 24=39 (LC 9), 25=58 (LC 9), 26=53 (LC 9), 27=53 (LC 9), 28=58 (LC 9), 29=49 (LC 9), 32=50 (LC 8), 33=57 (LC 8), 34=54 (LC 8), 35=53 (LC 8), 36=59 (LC 8), 37=35 (LC 8), 38=116 (LC 8), 39=42 (LC 9)  
Max Grav 22=184 (LC 1), 23=199 (LC 22), 24=175 (LC 1), 25=181 (LC 22), 26=180 (LC 1), 27=180 (LC 1), 28=179 (LC 1), 29=190 (LC 22), 31=209 (LC 18), 32=190 (LC 21), 33=179 (LC 1), 34=180 (LC 1), 35=180 (LC 1), 36=181 (LC 21), 37=175 (LC 1), 38=199 (LC 21), 39=184 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension

**TOP CHORD** 2-39=163/51, 1-2=0/32, 2-3=139/81, 3-4=91/95, 4-5=73/121, 5-6=61/147, 6-7=50/173, 7-8=42/198, 8-10=42/225, 10-11=45/248, 11-12=45/240, 12-14=42/196, 14-15=42/163, 15-16=42/138, 16-17=42/112, 17-18=46/86, 18-19=66/60, 19-20=104/49, 20-21=0/32, 20-22=163/30  
**BOT CHORD** 38-39=33/113, 37-38=33/113, 36-37=33/113, 35-36=33/113, 34-35=33/113, 33-34=33/113, 32-33=33/113, 31-32=33/113, 29-31=33/113, 28-29=33/113, 27-28=33/113, 26-27=33/113, 25-26=33/113, 24-25=33/113, 23-24=33/113, 22-23=33/113  
**WEBS** 11-31=169/0, 10-32=150/74, 8-33=139/81, 7-34=140/78, 6-35=140/77, 5-36=141/81, 4-37=137/66, 3-38=151/120, 12-29=150/73, 14-28=139/82, 15-27=140/77, 16-26=140/78, 17-25=141/80, 18-24=137/68, 19-23=151/112

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60  
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.  
4) All plates are 2x4 MT20 unless otherwise indicated.  
5) Gable requires continuous bottom chord bearing.  
6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).

7) Gable studs spaced at 2-0-0 oc.  
8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.  
10) All bearings are assumed to be SPF No.2 .  
11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 39, 17 lb uplift at joint 22, 50 lb uplift at joint 32, 57 lb uplift at joint 33, 54 lb uplift at joint 34, 53 lb uplift at joint 35, 59 lb uplift at joint 36, 35 lb uplift at joint 37, 116 lb uplift at joint 38, 49 lb uplift at joint 29, 58 lb uplift at joint 28, 53 lb uplift at joint 27, 53 lb uplift at joint 26, 58 lb uplift at joint 25, 39 lb uplift at joint 24 and 103 lb uplift at joint 23.  
12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss D1	Truss Type Common Supported Gable	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	--------------------------------------	----------	----------	--

**RELEASE FOR CONSTRUCTION**  
**AS NOTED FOR PLAN REVIEW**  
**DEVELOPMENT SERVICES**  
 164207710  
**LEE'S SUMMIT, MISSOURI**

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56 Page: 1  
 ID:7otXiDfjwSipOMC6jCX9PUzbgld-RfC?PsB70Hq3NSgPqnL8w3uITXbGKVrCDoi7J4zJC?

04/10/2024

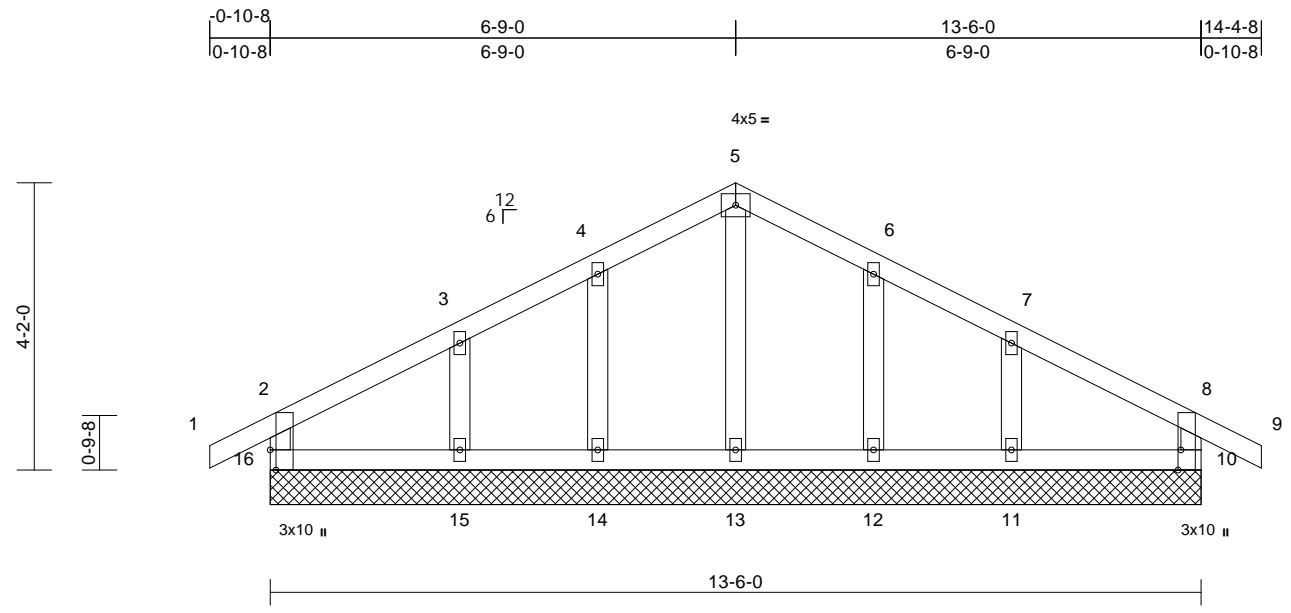

Scale = 1:33.4

Plate Offsets (X, Y): [10:0-3-8,Edge], [16:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 50 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size)  
 10=13-6-0, 11=13-6-0, 12=13-6-0, 13=13-6-0, 14=13-6-0, 15=13-6-0, 16=13-6-0  
 Max Horiz 16=70 (LC 6)  
 Max Uplift 10=36 (LC 9), 11=77 (LC 9), 12=50 (LC 9), 14=50 (LC 8), 15=80 (LC 8), 16=34 (LC 9)  
 Max Grav 10=198 (LC 1), 11=214 (LC 22), 12=180 (LC 22), 13=155 (LC 1), 14=180 (LC 21), 15=214 (LC 21), 16=198 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-16=-175/51, 1-2=0/32, 2-3=-70/61, 3-4=-52/89, 4-5=-53/113, 5-6=-53/106, 6-7=-52/81, 7-8=-61/53, 8-9=0/32, 8-10=-175/55  
 BOT CHORD 15-16=-17/43, 14-15=-17/43, 13-14=-17/43, 12-13=-17/43, 11-12=-17/43, 10-11=-17/43  
 WEBS 5-13=-113/0, 4-14=-144/74, 3-15=-162/103, 6-12=-144/74, 7-11=-162/101

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) All bearings are assumed to be SPF No.2 .
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 16, 36 lb uplift at joint 10, 50 lb uplift at joint 14, 80 lb uplift at joint 15, 50 lb uplift at joint 12 and 77 lb uplift at joint 11.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss D2	Truss Type Common	Qty 4	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207711 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
ID:qRytEqZKaJp2HAmpEvWd?zbgIk-RfC?PsB70Hq3NSgPqnL8w3ulTXbGkWrCDol74zJC7f

03/10/2024

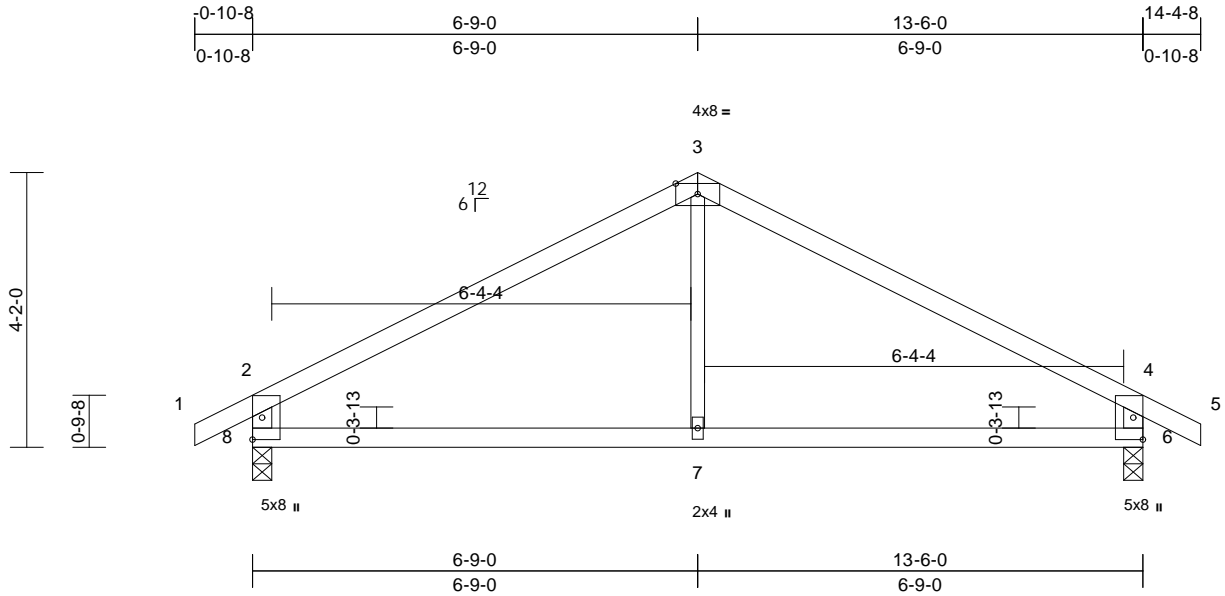

Scale = 1:34.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.53	Vert(LL)	-0.04	6-7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.09	6-7	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	7-8	>999	240	Weight: 39 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF 2100F 1.8E \*Except\* 7-3:2x3 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

**REACTIONS** (size) 6=0-3-8, 8=0-3-8  
 Max Horiz 8=-70 (LC 6)  
 Max Uplift 6=-96 (LC 9), 8=-96 (LC 8)  
 Max Grav 6=666 (LC 1), 8=666 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/32, 2-3=-733/103, 3-4=-733/102, 4-5=0/32, 2-8=-604/143, 4-6=-604/143  
 BOT CHORD 7-8=-19/553, 6-7=-19/553  
 WEBS 3-7=0/282

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members.
  - All bearings are assumed to be SPF No.2.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 96 lb uplift at joint 8 and 96 lb uplift at joint 6.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss D3	Truss Type Common Girder	Qty 1	Ply 2	Lot 173 HT Job Reference (optional)
----------------	-------------	-----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
 ID:kC1dzdw?oB0MeL4Zp5y45zbfk7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCD0i7JzJ0? Page: 1

02/10/2024

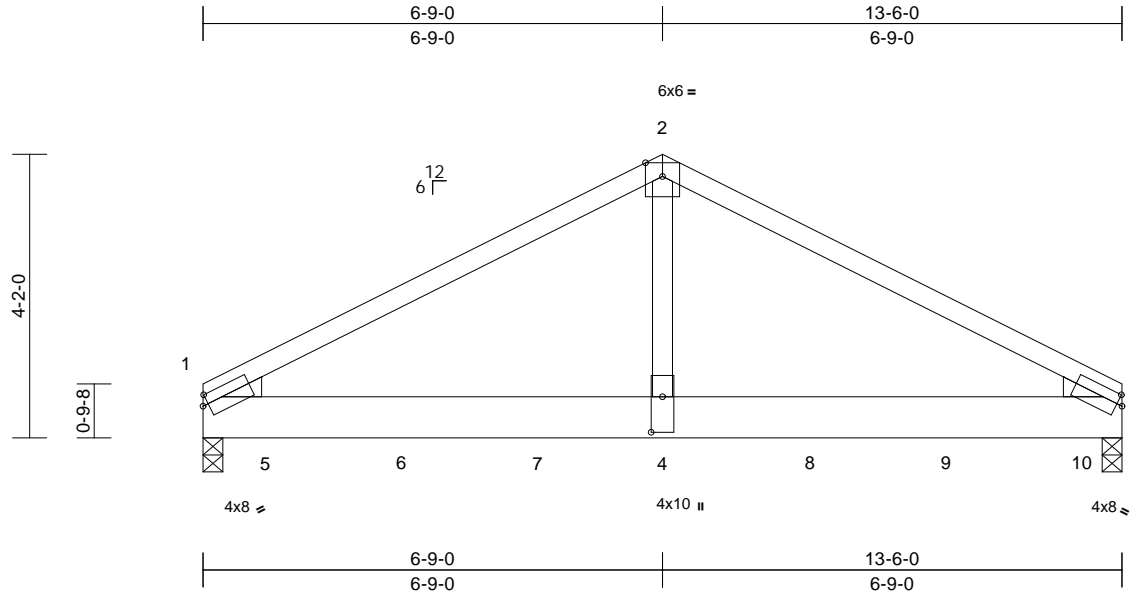

Scale = 1:33.8

Plate Offsets (X, Y): [1:0-1-0,0-1-12], [3:0-1-0,0-1-12], [4:0-6-4,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.08	1-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.14	1-4	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.73	Horz(CT)	0.02	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.06	1-4	>999	240	Weight: 129 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF 2100F 1.8E  
 BOT CHORD 2x8 SP 2400F 2.0E  
 WEBS 2x4 SPF No.2  
 WEDGE Left: 2x4 SP No.3  
 Right: 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-9-9 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 1=0-3-8, 3=0-3-8  
 Max Horiz 1=-65 (LC 13)  
 Max Uplift 1=-735 (LC 8), 3=-764 (LC 9)  
 Max Grav 1=5551 (LC 1), 3=5785 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-6688/892, 2-3=-6689/891  
 BOT CHORD 1-4=-721/5766, 3-4=-721/5766  
 WEBS 2-4=-700/5953

**NOTES**

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc.  
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP 2400F 2.0E .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 735 lb uplift at joint 1 and 764 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1445 lb down and 192 lb up at 0-11-0, 1443 lb down and 193 lb up at 2-11-0, 1451 lb down and 194 lb up at 4-11-0, 1631 lb down and 194 lb up at 6-11-0, 1451 lb down and 194 lb up at 8-11-0, and 1451 lb down and 194 lb up at 10-11-0, and 1456 lb down and 191 lb up at 12-11-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-2=-70, 2-3=-70, 1-3=-20  
 Concentrated Loads (lb)  
 Vert: 4=-1451 (B), 5=-1445 (B), 6=-1443 (B), 7=-1451 (B), 8=-1451 (B), 9=-1451 (B), 10=-1456 (B)



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss G1	Truss Type Common Supported Gable	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	--------------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
 ID:7otXiDfjwSipOMC6jCX9PUzbgld-RfC?PsB70Hq3NSgPqnL8w3uITxbGKVRCDoi7J4zJC? Page: 1

04/10/2024

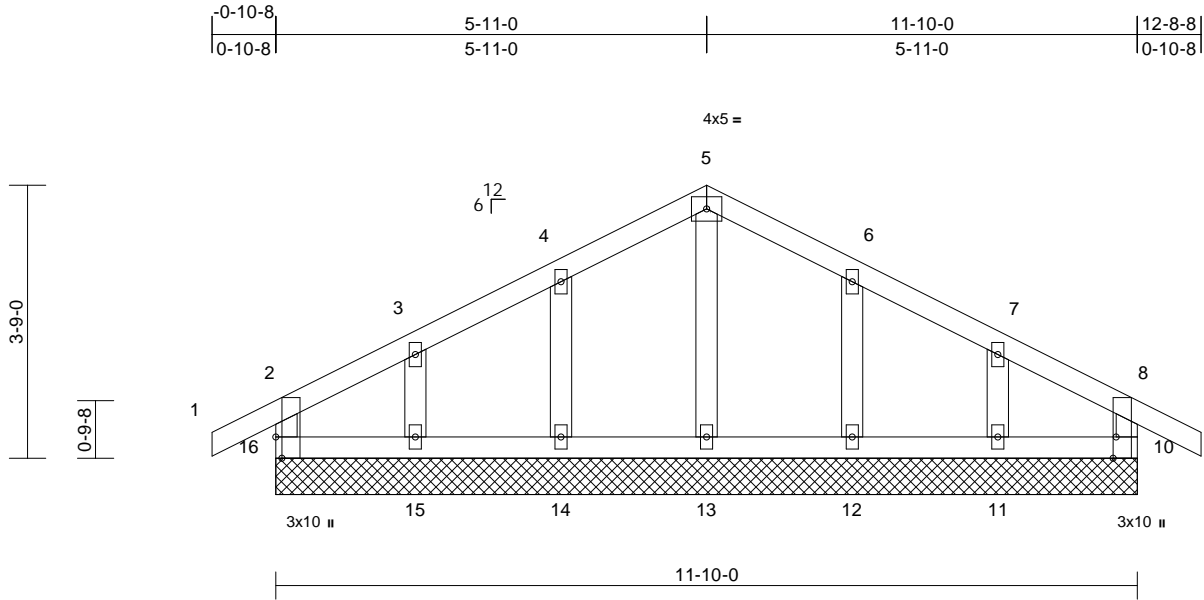

Scale = 1:31.6

Plate Offsets (X, Y): [10:0-3-8,Edge], [16:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 43 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size)  
 10=11-10-0, 11=11-10-0,  
 12=11-10-0, 13=11-10-0,  
 14=11-10-0, 15=11-10-0,  
 16=11-10-0  
 Max Horiz 16=65 (LC 7)  
 Max Uplift 10=-23 (LC 9), 11=-62 (LC 9),  
 12=-56 (LC 9), 14=-56 (LC 8),  
 15=-65 (LC 8), 16=-29 (LC 4)  
 Max Grav 10=156 (LC 22), 11=160 (LC 1),  
 12=196 (LC 22), 13=171 (LC 1),  
 14=196 (LC 21), 15=160 (LC 1),  
 16=156 (LC 21)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-16=-139/34, 1-2=0/32, 2-3=-40/50,  
 3-4=-26/67, 4-5=-32/93, 5-6=-32/86,  
 6-7=-25/60, 7-8=-34/44, 8-9=0/32,  
 8-10=-139/38  
 BOT CHORD 15-16=-22/40, 14-15=-22/40, 13-14=-22/40,  
 12-13=-22/40, 11-12=-22/40, 10-11=-22/40  
 WEBS 5-13=-131/0, 4-14=-156/82, 3-15=-121/81,  
 6-12=-156/82, 7-11=-121/80

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 16, 23 lb uplift at joint 10, 56 lb uplift at joint 14, 65 lb uplift at joint 15, 56 lb uplift at joint 12 and 62 lb uplift at joint 11.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss G2	Truss Type Common Girder	Qty 1	Ply 2	Lot 173 HT Job Reference (optional)
----------------	-------------	-----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
 ID:NziJMSfC\_RFU?z6rHB2oBSzbfkT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRcDoi7JzJ0? Page: 1

04/10/2024

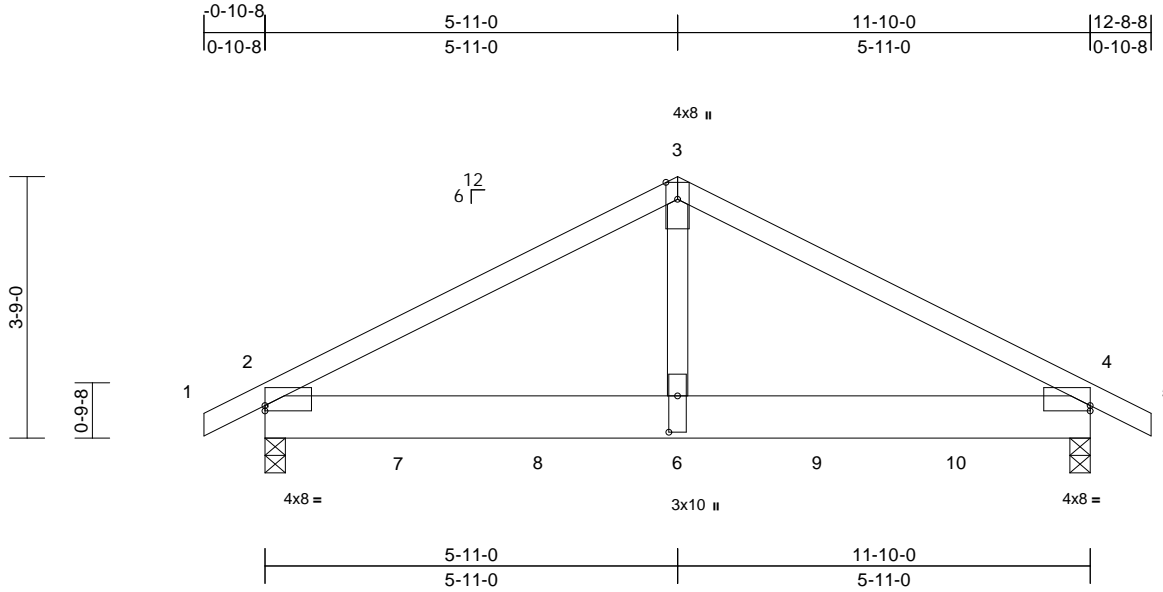

Scale = 1:33

Plate Offsets (X, Y): [2:Edge,0-0-15], [4:Edge,0-0-15], [6:0-6-4,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.06	2-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.41	Vert(CT)	-0.10	2-6	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.60	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	2-6	>999	240	Weight: 115 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x8 SP 2400F 2.0E  
 WEBS 2x4 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 4-8-4 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 2=0-3-8, 4=0-3-8  
 Max Horiz 2=60 (LC 12)  
 Max Uplift 2=-552 (LC 8), 4=-552 (LC 9)  
 Max Grav 2=4095 (LC 1), 4=4095 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/8, 2-3=-5455/722, 3-4=-5455/721, 4-5=0/8  
 BOT CHORD 2-6=-573/4657, 4-6=-573/4657  
 WEBS 3-6=-578/4885

**NOTES**

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-7-0 oc.  
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP 2400F 2.0E .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 552 lb uplift at joint 2 and 552 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1402 lb down and 186 lb up at 1-11-0, 1402 lb down and 186 lb up at 3-11-0, 1402 lb down and 186 lb up at 5-11-0, and 1402 lb down and 186 lb up at 7-11-0, and 1402 lb down and 186 lb up at 9-11-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-3=-70, 3-5=-70, 2-4=-20  
 Concentrated Loads (lb)  
 Vert: 6=-1402 (B), 7=-1402 (B), 8=-1402 (B), 9=-1402 (B), 10=-1402 (B)



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com




Job B240039	Truss J1	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-----------------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207715 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
ID:bhr3gYKfpNFzZGVAfZk7KbzbGvy-RfC?PsB70Hq3NSgPqnL8w3ulTXbGHWrCDoi734zJC? Page: 1

04/10/2024

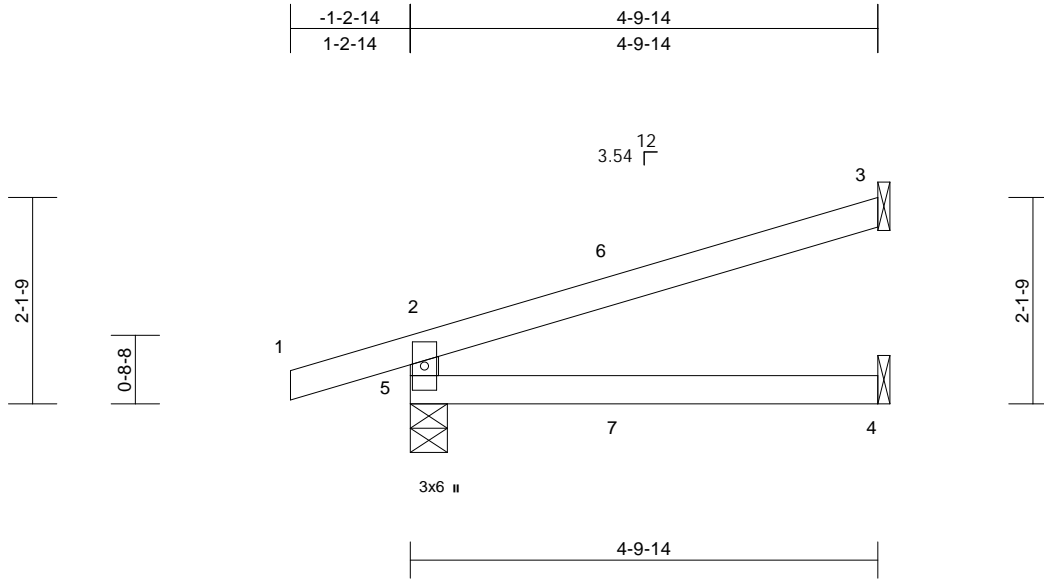

Scale = 1:23.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	-0.02	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.05	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	4-5	>999	240	Weight: 13 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 4-9-14 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 3= Mechanical, 4= Mechanical, 5=0-4-9  
Max Horiz 5=70 (LC 4)  
Max Uplift 3=64 (LC 8), 5=92 (LC 4)  
Max Grav 3=140 (LC 1), 4=86 (LC 3), 5=314 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-280/130, 1-2=0/27, 2-3=-70/30  
BOT CHORD 4-5=0/0

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 92 lb uplift at joint 5 and 64 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 65 lb down and 21 lb up at 2-1-0, and 65 lb down and 21 lb up at 2-1-0 on top chord, and 3 lb down and 5 lb up at 2-1-0, and 3 lb down and 5 lb up at 2-1-0 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-2=-70, 2-3=-70, 4-5=-20  
Concentrated Loads (lb)  
Vert: 7=9 (F=5, B=5)



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss J2	Truss Type Jack-Open	Qty 2	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207716 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
ID:yN6W9RB7ehky7QatY2WJr3zbgW8-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWCD07J4zJC7f Page: 1

04/10/2024

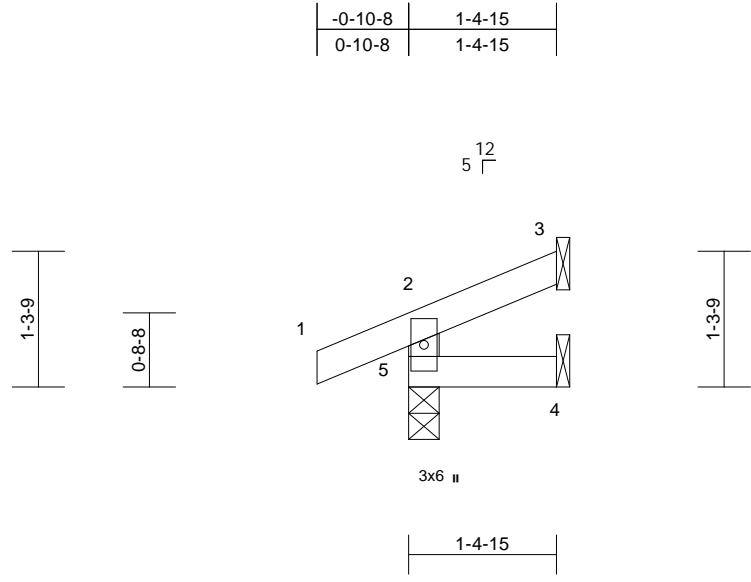

Scale = 1:22

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 5 lb	FT = 10%

**LUMBER** **LOAD CASE(S)** Standard

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 1-4-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 3= Mechanical, 4= Mechanical, 5=0-3-8  
Max Horiz 5=33 (LC 5)  
Max Uplift 3=-18 (LC 8), 5=-37 (LC 4)  
Max Grav 3=22 (LC 1), 4=21 (LC 3), 5=157 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 2-5=-137/46, 1-2=0/27, 2-3=-25/5  
BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 4) All bearings are assumed to be SPF No.2.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 5 and 18 lb uplift at joint 3.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss J3	Truss Type Jack-Open	Qty 8	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207717  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:56  
ID:ILwPC9FGSDMrDBTqLb6UY7zbgW3-RfC?PsB70Hq3NSgPqnL8w3ulTXEgKwRCd7J4ZJC?i

04/10/2024

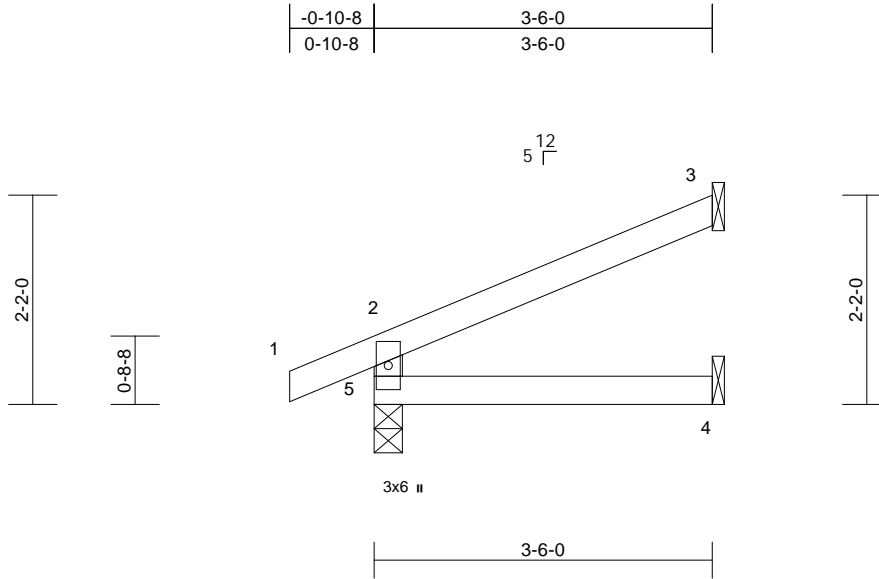

Scale = 1:23.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 10 lb	FT = 10%

**LUMBER** **LOAD CASE(S)** Standard

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 3= Mechanical, 4= Mechanical, 5=0-3-8  
Max Horiz 5=64 (LC 8)  
Max Uplift 3=-53 (LC 8), 5=-34 (LC 8)  
Max Grav 3=100 (LC 1), 4=61 (LC 3), 5=231 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 2-5=-202/65, 1-2=0/27, 2-3=-55/30  
BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 4) All bearings are assumed to be SPF No.2 .
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 5 and 53 lb uplift at joint 3.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss J4	Truss Type Jack-Closed Supported Gable	Qty 2	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	---	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207718 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
ID:d7aunsAdnNW8QnhajB\_?1szbgTZ-RfC?PsB70Hq3NSgPqnL8w3uITXbGLWrcDol74zJC7f

04/10/2024

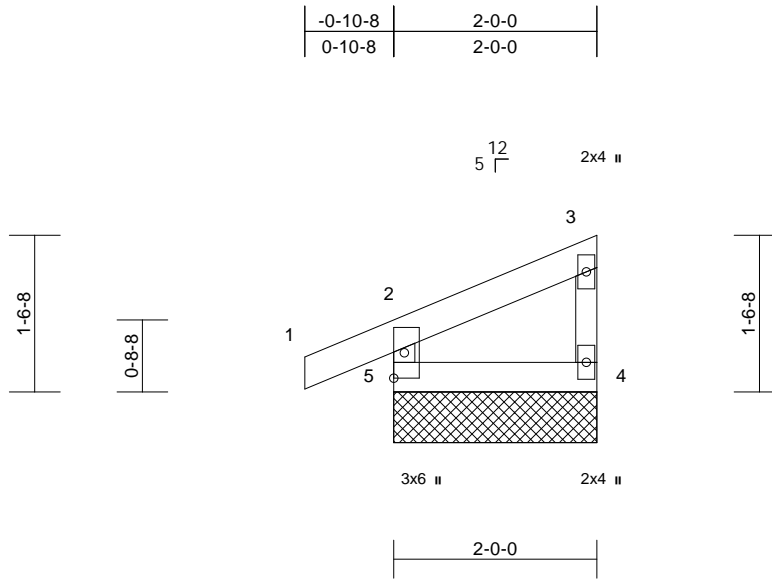

Scale = 1:22.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 7 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 4=2-0-0, 5=2-0-0

Max Horiz 5=58 (LC 5)  
Max Uplift 4=-19 (LC 5), 5=-40 (LC 4)  
Max Grav 4=62 (LC 1), 5=168 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-149/52, 1-2=0/26, 2-3=-43/9, 3-4=-45/24  
BOT CHORD 4-5=-19/12

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SPF No.2 .

- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 40 lb uplift at joint 5 and 19 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job B240039	Truss J5	Truss Type Jack-Closed	Qty 5	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	---------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207719 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
ID:sa6t674cfwWHSY42FWq7iAzbgTh-RfC?PsB70Hq3NSgPqnL8w3uITXbGWrCDoi134zJC?

04/10/2024

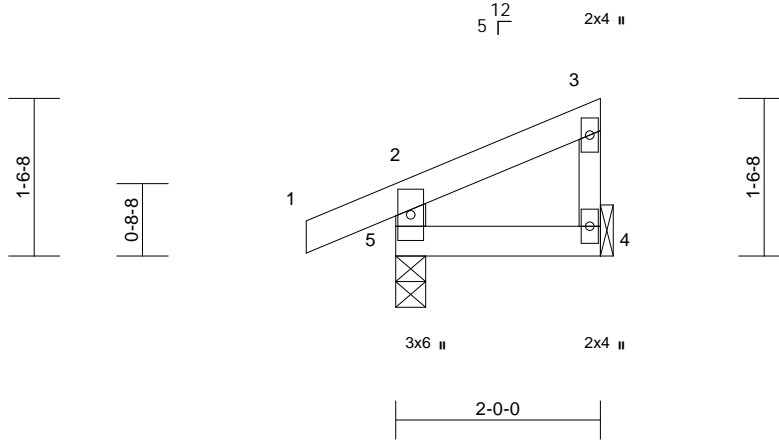

Scale = 1:22.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 7 lb	FT = 10%

**LUMBER**

- TOP CHORD 2x4 SPF No.2
- BOT CHORD 2x4 SPF No.2
- WEBS 2x4 SPF No.2 \*Except\* 3-4:2x3 SPF No.2

**BRACING**

- TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

- (size) 4= Mechanical, 5=0-3-8
- Max Horiz 5=59 (LC 5)
- Max Uplift 4=-19 (LC 5), 5=-43 (LC 4)
- Max Grav 4=58 (LC 1), 5=171 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

- TOP CHORD 2-5=-151/53, 1-2=0/27, 2-3=-43/9, 3-4=-43/23
- BOT CHORD 4-5=-18/13

**NOTES**

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 5 and 19 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 173 HT
B240039	J6	Jack-Closed Supported Gable	2	1	Job Reference (optional)


AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207720  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1

ID:caX2eEmlnxEzKZ52j2N1fhzbgU5-RfC?PsB70Hq3NSgPqnL8w3uITXbGK1VrCDoi7J4zJCff

04/10/2024

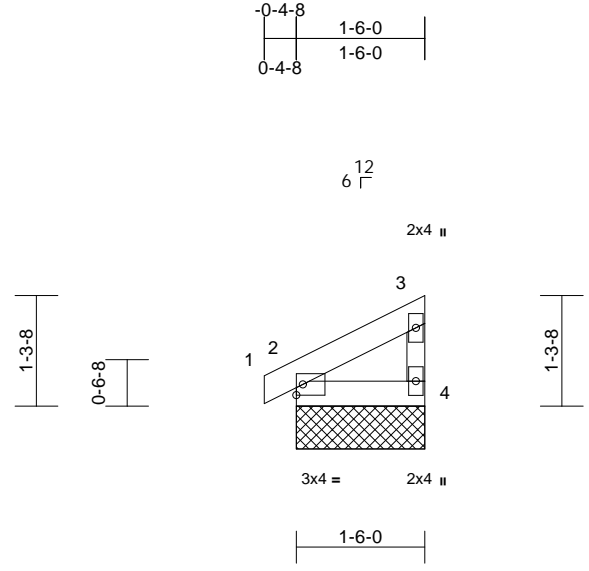

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.03	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 5 lb	FT = 10%

**LUMBER**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
**LOAD CASE(S)** Standard

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 1-6-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=1-6-0, 4=1-6-0  
Max Horiz 2=38 (LC 7)  
Max Uplift 2=-15 (LC 8), 4=-17 (LC 8)  
Max Grav 2=93 (LC 1), 4=59 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-3/0, 2-3=-41/20, 3-4=-45/25  
BOT CHORD 2-4=-13/10

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) Gable requires continuous bottom chord bearing.
  - 4) Gable studs spaced at 2-0-0 oc.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 7) All bearings are assumed to be SPF No.2 .
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 4 and 15 lb uplift at joint 2.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Lot 173 HT
B240039	J7	Jack-Closed	2	1	Job Reference (optional)

AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
164207721
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
 ID:RTMuLTePNZrXWslxaFgSiNzbguUG-RfC?PsB70Hq3NSgPqnL8w3ulTXbCKWvCDot44zJ07f

04/10/2024

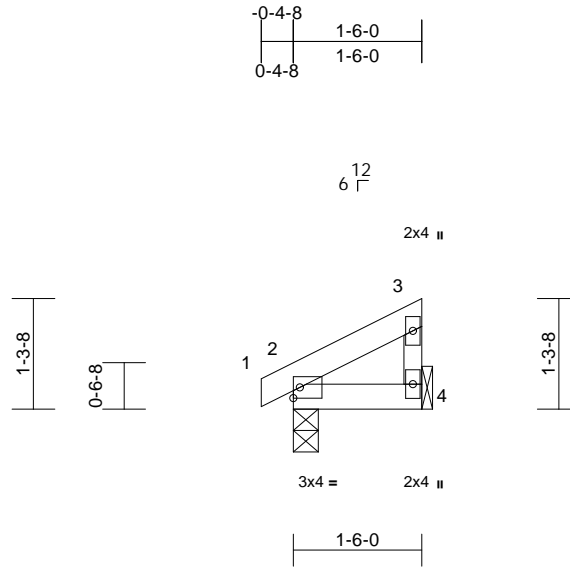

Scale = 1:26.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.02	Vert(LL)	0.00	2-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	0.00	2-4	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 5 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 1-6-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=0-3-8, 4= Mechanical

Max Horiz 2=38 (LC 5)  
 Max Uplift 2=-16 (LC 8), 4=-17 (LC 8)  
 Max Grav 2=94 (LC 1), 4=57 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-3/0, 2-3=-41/20, 3-4=-44/25  
 BOT CHORD 2-4=-13/10

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 4 and 16 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss J8	Truss Type Roof Special Girder	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-----------------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207722 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57  
 ID:60tXbP6ceWccRldNLIkhjPzbOVH-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC#f Page: 1

04/10/2024

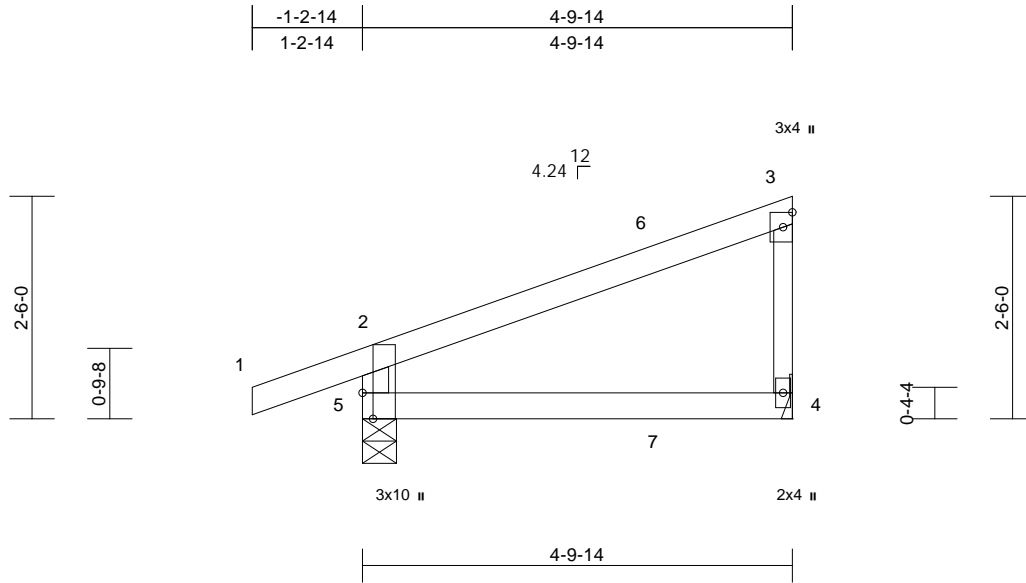

Scale = 1:25.9

Plate Offsets (X, Y): [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	-0.02	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	-0.04	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 15 lb	FT = 10%

**LUMBER**

- TOP CHORD 2x4 SPF No.2
- BOT CHORD 2x4 SPF No.2
- WEBS 2x3 SPF No.2 \*Except\* 5-2:2x4 SPF No.2

**BRACING**

- TOP CHORD Structural wood sheathing directly applied or 4-9-14 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

- (size) 4= Mechanical, 5=0-4-9
- Max Horiz 5=104 (LC 5)
- Max Uplift 4=-44 (LC 8), 5=-96 (LC 4)
- Max Grav 4=191 (LC 1), 5=317 (LC 1)

**FORCES**

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=0/32, 2-3=-117/21, 3-4=-137/64, 2-5=-280/130
- BOT CHORD 4-5=-28/37

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 4 and 96 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 71 lb down and 44 lb up at 3-3-3, and 71 lb down and 44 lb up at 3-3-3 on top chord, and 5 lb down and 0 lb up at 3-3-3, and 5 lb down and 0 lb up at 3-3-3 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-2=-70, 2-3=-70, 4-5=-20  
 Concentrated Loads (lb)  
 Vert: 7=0 (F=0, B=0)



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com





Job B240039	Truss J9	Truss Type Jack-Open	Qty 2	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164207723 LEE'S SUMMIT, MISSOURI
---

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57  
ID:rETkG32lppoKIU4im9pBmFzbgV0-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCD0i7J4zJC07

04/10/2024

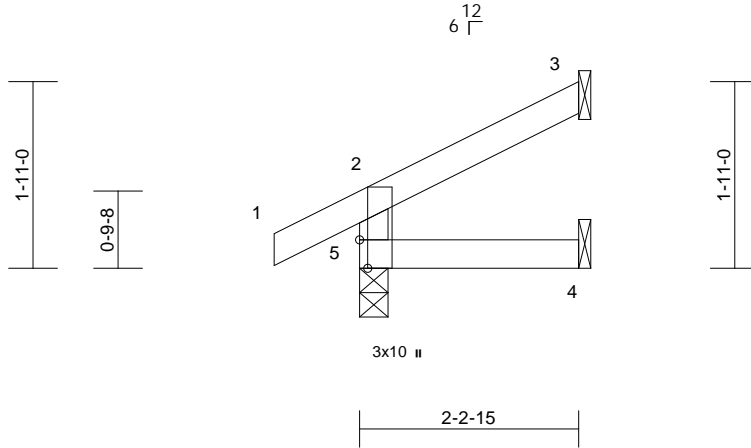

Scale = 1:23.6

Plate Offsets (X, Y): [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 7 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 2-2-15 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 3= Mechanical, 4= Mechanical, 5=0-3-8  
 Max Horiz 5=52 (LC 8)  
 Max Uplift 3=-37 (LC 8), 5=-23 (LC 8)  
 Max Grav 3=55 (LC 1), 4=37 (LC 3), 5=181 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-159/45, 1-2=0/32, 2-3=-43/18  
 BOT CHORD 4-5=0/0

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 5 and 37 lb uplift at joint 3.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Lot 173 HT
B240039	J10	Jack-Closed	2	1	Job Reference (optional)

**RELEASE FOR CONSTRUCTION**  
**AS NOTED FOR PLAN REVIEW**  
**DEVELOPMENT SERVICES**  
 164207724  
**LEE'S SUMMIT, MISSOURI**

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
 ID:cEuvpAk\_opX1eV5jFiL5imzbgVQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGkV/rCDoi7J4ZJC7# 04/10/2024

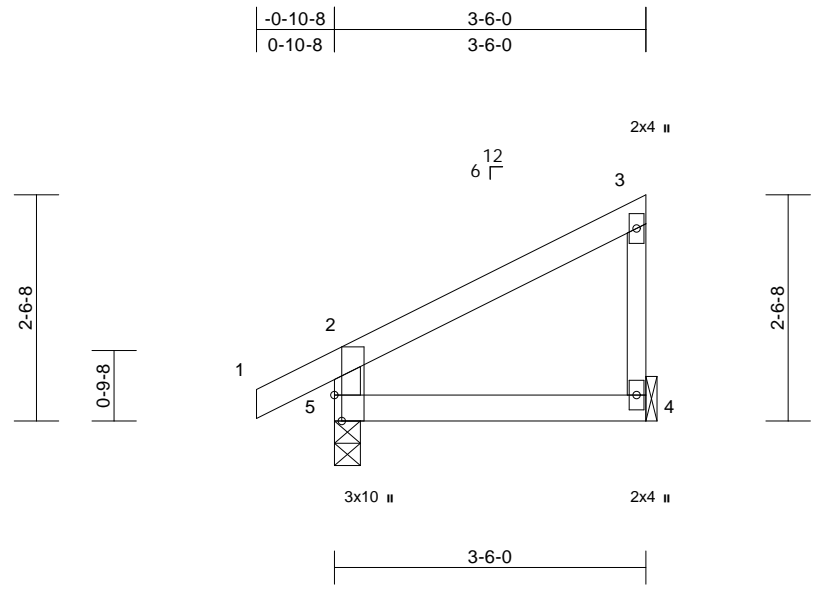

Scale = 1:25.9

Plate Offsets (X, Y): [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 12 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2 \*Except\* 3-4:2x3 SPF No.2

**LOAD CASE(S)** Standard

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 4= Mechanical, 5=0-3-8  
 Max Horiz 5=99 (LC 5)  
 Max Uplift 4=-38 (LC 8), 5=-40 (LC 8)  
 Max Grav 4=135 (LC 1), 5=229 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-5=-202/67, 1-2=0/32, 2-3=-89/34, 3-4=-97/50  
 BOT CHORD 4-5=-30/26

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 4) All bearings are assumed to be SPF No.2 .
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 40 lb uplift at joint 5 and 38 lb uplift at joint 4.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss J11	Truss Type Jack-Closed	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	--------------	---------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207725  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
ID:cEuvpAk\_opX1eV5jFiL5imzbgVQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGkVrCDoi7J4zJC7f

04/10/2024

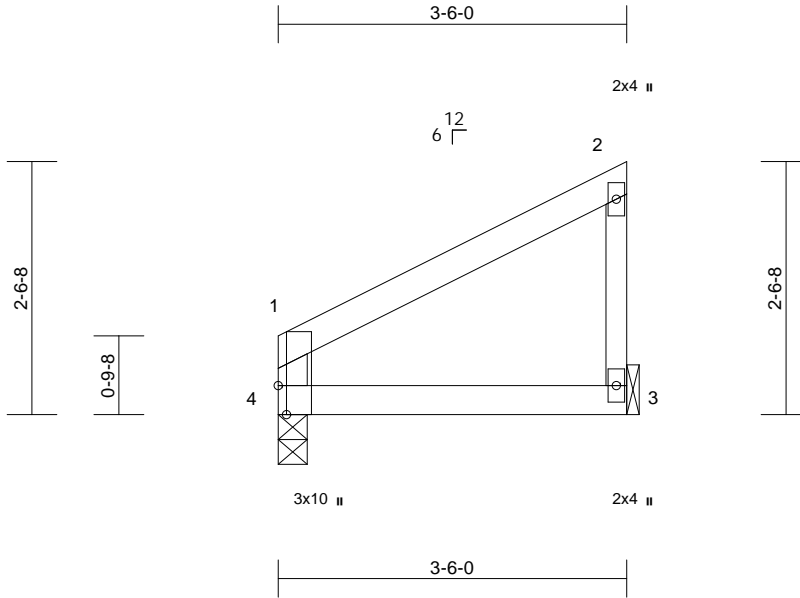

Scale = 1:23.1

Plate Offsets (X, Y): [4:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	0.00	3-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	-0.01	3-4	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	3-4	>999	240	Weight: 11 lb	FT = 10%

**LUMBER**

- TOP CHORD 2x4 SPF No.2
- BOT CHORD 2x4 SPF No.2
- WEBS 2x4 SPF No.2 \*Except\* 2-3:2x3 SPF No.2

**BRACING**

- TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

- (size) 3= Mechanical, 4=0-3-8
- Max Horiz 4=89 (LC 5)
- Max Uplift 3=-40 (LC 8), 4=-15 (LC 8)
- Max Grav 3=146 (LC 1), 4=146 (LC 1)

**FORCES**

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-4=-121/41, 1-2=-87/35, 2-3=-106/52
- BOT CHORD 3-4=-30/26

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 4 and 40 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job B240039	Truss J12	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	--------------	-----------------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
 ID:qQuSZdRlh8Na8fhvHyOEBVzbgVp-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDofr4zJCff

04/10/2024

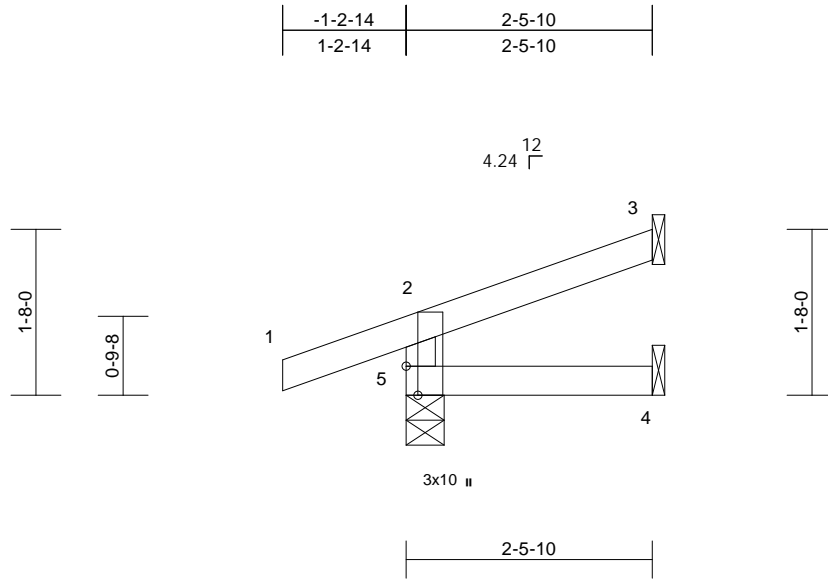

Scale = 1:23.1

Plate Offsets (X, Y): [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 8 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 2-5-10 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 3= Mechanical, 4= Mechanical, 5=0-4-9  
 Max Horiz 5=50 (LC 4)  
 Max Uplift 3=-32 (LC 8), 5=-79 (LC 4)  
 Max Grav 3=55 (LC 1), 4=40 (LC 3), 5=228 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-200/97, 1-2=0/32, 2-3=-35/13  
 BOT CHORD 4-5=0/0

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 79 lb uplift at joint 5 and 32 lb uplift at joint 3.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com


Job B240039	Truss J13	Truss Type Jack-Open	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	--------------	-------------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207727  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1

ID:yfejFOodvt8f1N826K1fzbgVt-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4z0?f 04/10/2024

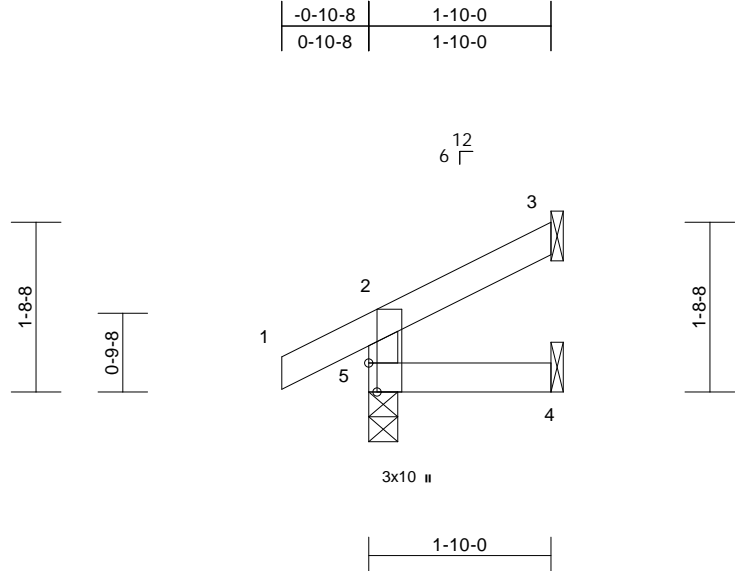

Scale = 1:23.2

Plate Offsets (X, Y): [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5 >999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5 >999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3 n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5 >999	240	Weight: 6 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 1-10-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 3= Mechanical, 4= Mechanical, 5=0-3-8  
 Max Horiz 5=44 (LC 8)  
 Max Uplift 3=-30 (LC 8), 5=-23 (LC 8)  
 Max Grav 3=41 (LC 1), 4=30 (LC 3), 5=169 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 2-5=-148/41, 1-2=0/32, 2-3=-36/13  
 BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 4) All bearings are assumed to be SPF No.2.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 5 and 30 lb uplift at joint 3.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss LAY1	Truss Type Lay-In Gable	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	---------------	----------------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
 ID:CQYmfSzllcA1V8xessbYlzbFH1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwRcDoi7J4JJC7

02/10/2024

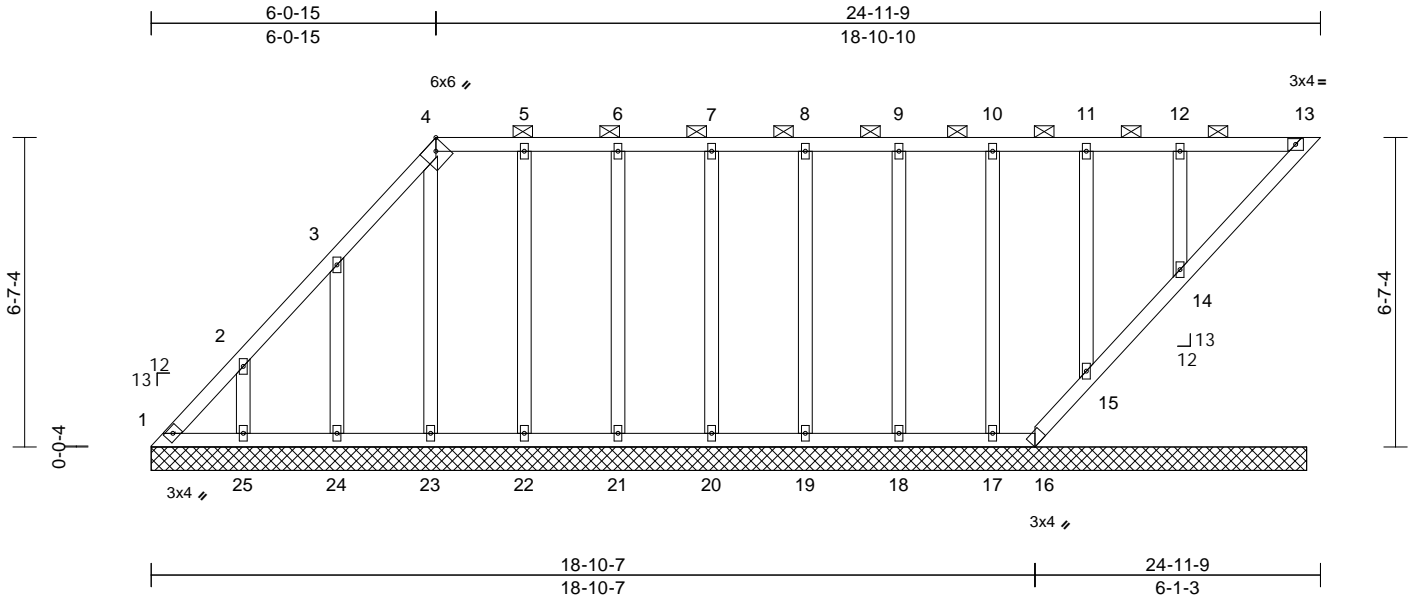

Scale = 1:49.2  
 Plate Offsets (X, Y): [4:0-2-9,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 125 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-13.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 13-14.

**REACTIONS** (size)  
 1=24-8-0, 13=24-8-0, 14=24-8-0, 15=24-8-0, 16=24-8-0, 17=24-8-0, 18=24-8-0, 19=24-8-0, 20=24-8-0, 21=24-8-0, 22=24-8-0, 23=24-8-0, 24=24-8-0, 25=24-8-0  
 Max Horiz 1=257 (LC 8)  
 Max Uplift 1=42 (LC 6), 13=43 (LC 5), 14=46 (LC 5), 15=35 (LC 5), 16=8 (LC 15), 17=39 (LC 4), 18=33 (LC 5), 19=34 (LC 5), 20=34 (LC 4), 21=34 (LC 5), 22=38 (LC 4), 23=26 (LC 8), 24=147 (LC 8), 25=127 (LC 8)  
 Max Grav 1=198 (LC 8), 13=111 (LC 1), 14=252 (LC 1), 15=151 (LC 1), 16=49 (LC 8), 17=176 (LC 22), 18=181 (LC 1), 19=180 (LC 1), 20=180 (LC 22), 21=180 (LC 1), 22=185 (LC 22), 23=157 (LC 1), 24=223 (LC 15), 25=204 (LC 15)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=285/118, 2-3=164/78, 3-4=74/35, 4-5=20/37, 5-6=18/37, 6-7=18/37, 7-8=18/37, 8-9=18/37, 9-10=18/37, 10-11=18/37, 11-12=18/37, 12-13=18/37

**BOT CHORD** 1-25=37/17, 24-25=37/17, 23-24=37/17, 22-23=37/18, 21-22=37/18, 20-21=37/18, 19-20=37/18, 18-19=37/18, 17-18=37/18, 16-17=37/18, 15-16=59/38, 14-15=62/46, 13-14=68/39

**WEBS** 2-25=158/145, 3-24=184/172, 4-23=117/49, 5-22=145/62, 6-21=140/58, 7-20=140/58, 8-19=140/58, 9-18=140/58, 10-17=143/59, 11-15=125/52, 12-14=190/76

**NOTES**  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60  
 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.  
 4) Provide adequate drainage to prevent water ponding.  
 5) All plates are 2x4 MT20 unless otherwise indicated.  
 6) Gable studs spaced at 0-0-0 oc.  
 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.  
 9) All bearings are assumed to be SPF No.2.

10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 1, 43 lb uplift at joint 13, 8 lb uplift at joint 16, 127 lb uplift at joint 25, 147 lb uplift at joint 24, 26 lb uplift at joint 23, 38 lb uplift at joint 22, 34 lb uplift at joint 21, 34 lb uplift at joint 20, 34 lb uplift at joint 19, 33 lb uplift at joint 18, 39 lb uplift at joint 17, 35 lb uplift at joint 15 and 46 lb uplift at joint 14.  
 11) Non Standard bearing condition. Review required.  
 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcscomponents.com)


**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com

Job B240039	Truss V1	Truss Type Valley	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
ID: \_U8DLBU9AeBs910\_i00J2zbGd-RfC?PsB70Hq3NSgPqnL8w3uITXbGHWrCDoi734zJC?

04/10/2024

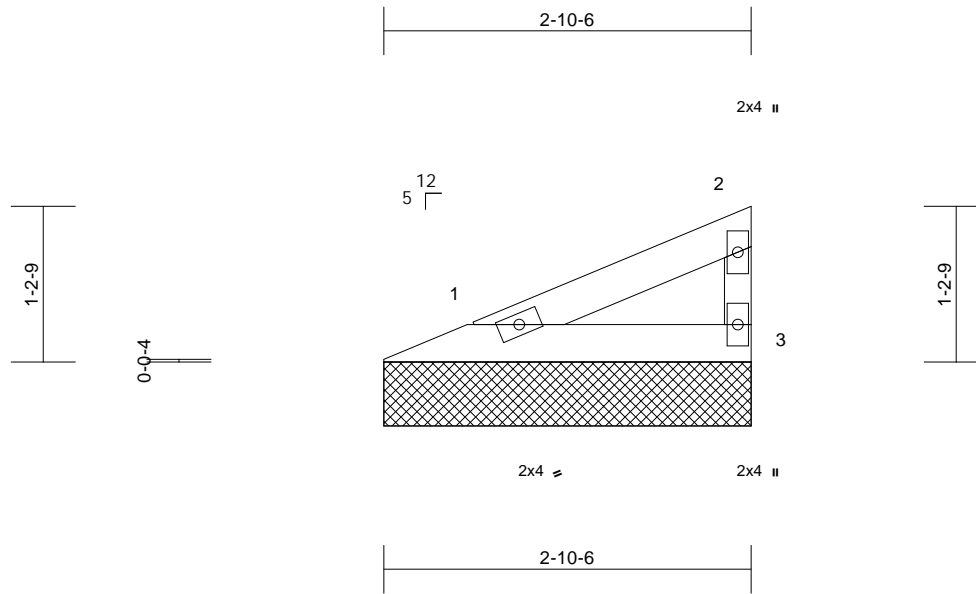

Scale = 1:18

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 6 lb	FT = 10%

**LUMBER**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x3 SPF No.2

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-11-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=2-10-6, 3=2-10-6  
Max Horiz 1=38 (LC 5)  
Max Uplift 1=-13 (LC 8), 3=-21 (LC 8)  
Max Grav 1=93 (LC 1), 3=93 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-34/22, 2-3=-72/33  
BOT CHORD 1-3=-12/9

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) Gable requires continuous bottom chord bearing.
  - 4) Gable studs spaced at 2-0-0 oc.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 7) All bearings are assumed to be SPF No.2 .
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 13 lb uplift at joint 1 and 21 lb uplift at joint 3.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss V2	Truss Type Valley	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207730  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:57 Page: 1  
ID:dzHTAs0nLBjhh9YWC0psDpzbgAE-RfC?PsB70Hq3NSgPqnl8w3uITXbGhWrCD0i134J07

04/10/2024

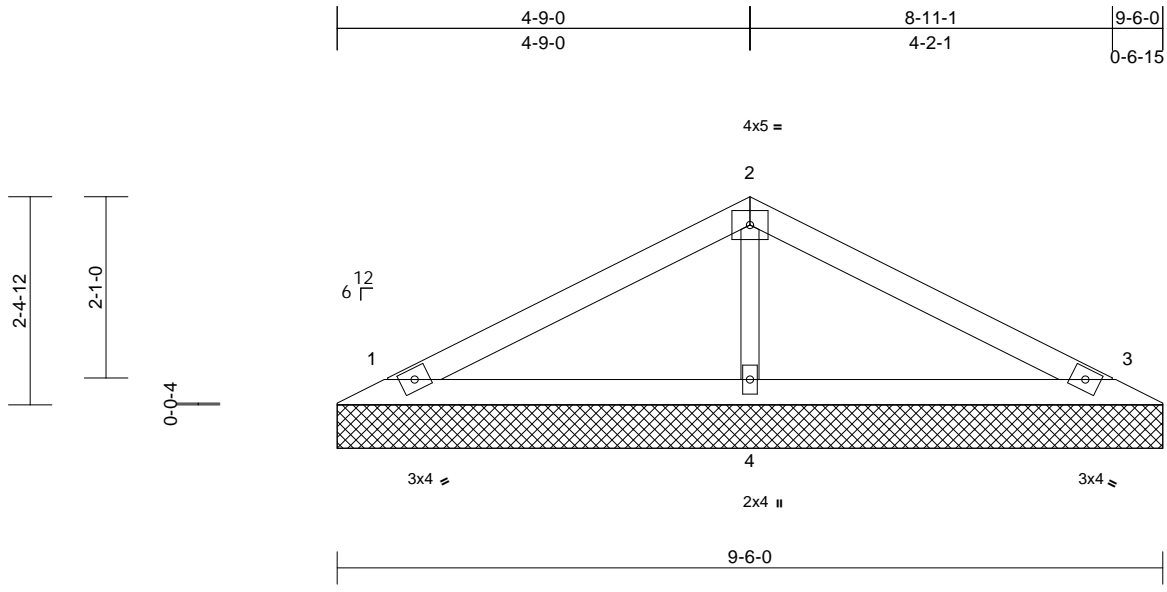

Scale = 1:26.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.24	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 23 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=9-6-0, 3=9-6-0, 4=9-6-0  
 Max Horiz 1=-37 (LC 9)  
 Max Uplift 1=-36 (LC 8), 3=-43 (LC 9), 4=-22 (LC 8)  
 Max Grav 1=177 (LC 21), 3=177 (LC 22), 4=397 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-108/54, 2-3=-108/39  
 BOT CHORD 1-4=-2/45, 3-4=-2/45  
 WEBS 2-4=-271/71

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 8) All bearings are assumed to be SPF No.2 .
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 1, 43 lb uplift at joint 3 and 22 lb uplift at joint 4.
  - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 4-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
 16023 Swingley Ridge Rd.  
 Chesterfield, MO 63017  
 314.434.1200 / MiTek-US.com




Job B240039	Truss V3	Truss Type Valley	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207731  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:58  
ID:VT?ZRPsdPB4ad930xn4pC4zbgAR-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCdof44zJCpf Page: 1

04/10/2024

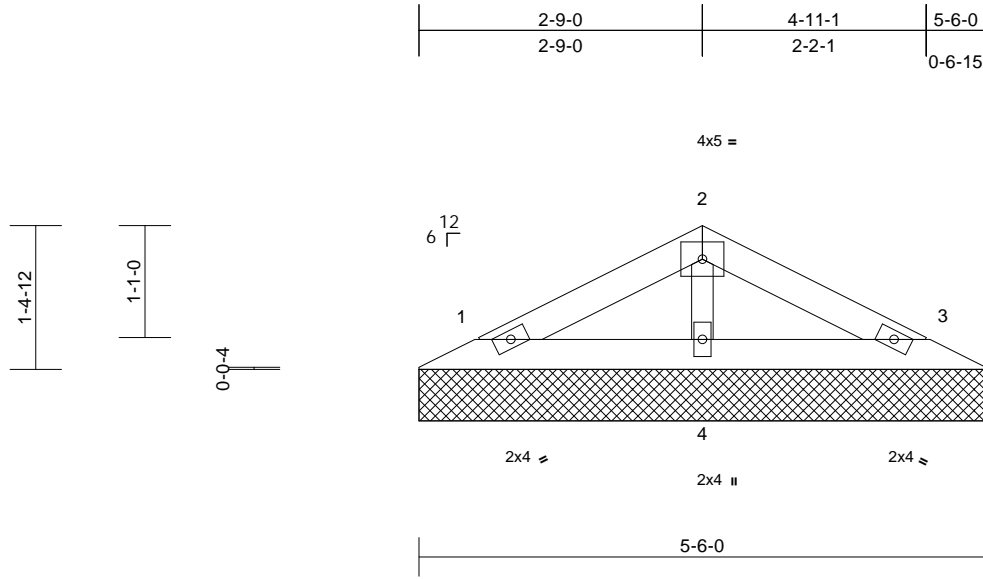

Scale = 1:22.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 12 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-7-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 1=5-6-0, 3=5-6-0, 4=5-6-0  
Max Horiz 1=19 (LC 8)  
Max Uplift 1=-23 (LC 8), 3=-27 (LC 9), 4=-2 (LC 8)  
Max Grav 1=102 (LC 1), 3=102 (LC 1), 4=186 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-49/27, 2-3=-49/19  
BOT CHORD 1-4=-1/22, 3-4=-1/22  
WEBS 2-4=-132/35

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SPF No.2 .
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 1, 27 lb uplift at joint 3 and 2 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job B240039	Truss V4	Truss Type Valley	Qty 1	Ply 1	Lot 173 HT Job Reference (optional)
----------------	-------------	----------------------	----------	----------	--

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207732  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:58 AM 2024 Page: 1

04/10/2024

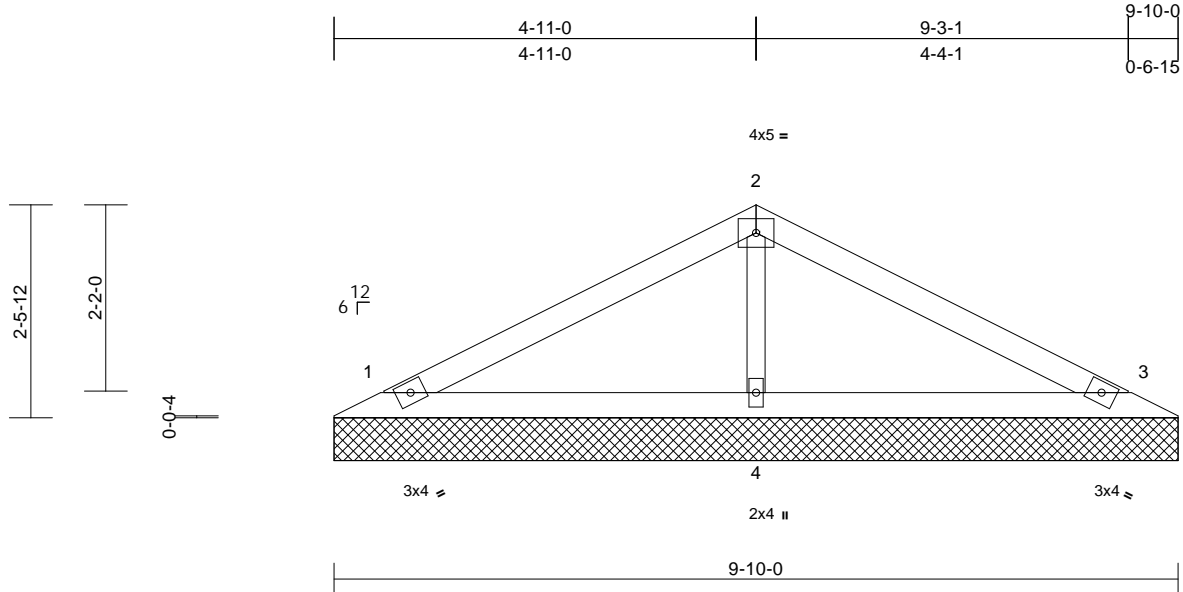

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 24 lb	FT = 10%

**LUMBER**  
 TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 OTHERS 2x3 SPF No.2

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=9-10-0, 3=9-10-0, 4=9-10-0  
 Max Horiz 1=-38 (LC 13)  
 Max Uplift 1=-37 (LC 8), 3=-44 (LC 9), 4=-23 (LC 8)  
 Max Grav 1=184 (LC 21), 3=184 (LC 22), 4=413 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-112/56, 2-3=-112/40  
 BOT CHORD 1-4=-2/46, 3-4=-2/46  
 WEBS 2-4=-282/74

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - 8) All bearings are assumed to be SPF No.2 .
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 1, 44 lb uplift at joint 3 and 23 lb uplift at joint 4.
  - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 4-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



March 14, 2024


Job	Truss	Truss Type	Qty	Ply	Lot 173 HT
B240039	V5	Valley	1	1	Job Reference (optional)

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
164207733  
LEE'S SUMMIT, MISSOURI

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Feb 22 2024 Print: 8.730 S Feb 22 2024 MiTek Industries, Inc. Wed Mar 13 09:25:58  
ID:g26scYaCp7BqNdob5SAQmDzbgao-RfC?PsB70Hq3NSgPqnL8w3uITXb6KWwCD07J4z3C7f Page: 1

04/10/2024

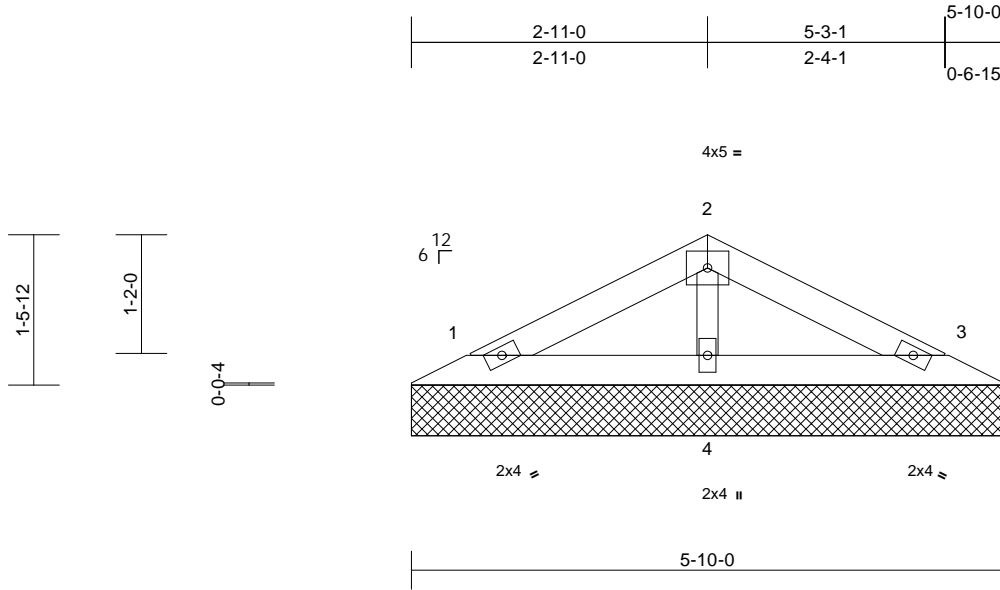

Scale = 1:22.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 13 lb	FT = 10%

**LUMBER**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-11-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 1=5-10-0, 3=5-10-0, 4=5-10-0  
Max Horiz 1=-21 (LC 13)  
Max Uplift 1=-25 (LC 8), 3=-29 (LC 9), 4=-3 (LC 8)  
Max Grav 1=109 (LC 1), 3=109 (LC 1), 4=200 (LC 1)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-53/29, 2-3=-53/21  
BOT CHORD 1-4=-1/23, 3-4=-1/23  
WEBS 2-4=-142/37

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SPF No.2 .
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 29 lb uplift at joint 3 and 3 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 14, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

# Symbols

## PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

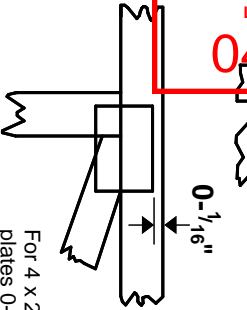

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.


4 X 4

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


## Industry Standards:

- ANSI/TFP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
- DSB-22: Design Standard for Bracing.
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

1 Joint ID

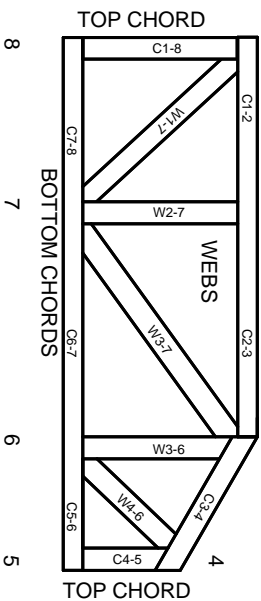

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

# Product Code Approvals

ICC-ES Reports:

- ESR-1-1988, ESR-2-362, ESR-2-685, ESR-3-282
- ESR-4-722, ESL-1-388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

- Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
- Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
- Never exceed the design loading shown and never stack materials on inadequately braced trusses.
- Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
- Cut members to bear tightly against each other.
- Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
- Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
- Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
- Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
- Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
- Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
- Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
- Top chords must be sheathed or purlins provided at spacing indicated on design.
- Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- Connections not shown are the responsibility of others.
- Do not cut or alter truss member or plate without prior approval of an engineer.
- Install and load vertically unless indicated otherwise.
- Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
- Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
- Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
- The design does not take into account any dynamic or other loads other than those expressly stated.

