

RE: P240300  
Roof

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**

Customer: Clover & Hive Project Name: P240300  
Lot/Block: 64 Model:  
Address: 3820 SW Ravensgate Place Subdivision: Osage  
City: Lee's Summit State: MO

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.6  
Wind Code: ASCE 7-16 Wind Speed: 115 mph  
Roof Load: 45.0 psf Floor Load: N/A psf

This package includes 25 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I64525071	B1	3/28/2024	21	I64525091	V6	3/28/2024
2	I64525072	B2	3/28/2024	22	I64525092	V7	3/28/2024
3	I64525073	B3	3/28/2024	23	I64525093	V8	3/28/2024
4	I64525074	C1	3/28/2024	24	I64525094	V9	3/28/2024
5	I64525075	C2	3/28/2024	25	I64525095	V10	3/28/2024
6	I64525076	C3	3/28/2024				
7	I64525077	D1	3/28/2024				
8	I64525078	D2	3/28/2024				
9	I64525079	D3	3/28/2024				
10	I64525080	E1	3/28/2024				
11	I64525081	E4	3/28/2024				
12	I64525082	E5	3/28/2024				
13	I64525083	E6	3/28/2024				
14	I64525084	E7	3/28/2024				
15	I64525085	R1	3/28/2024				
16	I64525086	V1	3/28/2024				
17	I64525087	V2	3/28/2024				
18	I64525088	V3	3/28/2024				
19	I64525089	V4	3/28/2024				
20	I64525090	V5	3/28/2024				

The truss drawing(s) referenced above have been prepared by  
MiTek USA, Inc. under my direct supervision  
based on the parameters provided by .

Truss Design Engineer's Name: Nathan Fox

My license renewal date for the state of Missouri is December 31, 2024.

Missouri COA: 001193

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.




Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	B1	Monopitch Supported Gable	1	1	Job Reference (optional)	I64525071

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:16

Page: 1

ID:rc4sjKzJtfsErm8VGMJRJ\_zwwqN-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

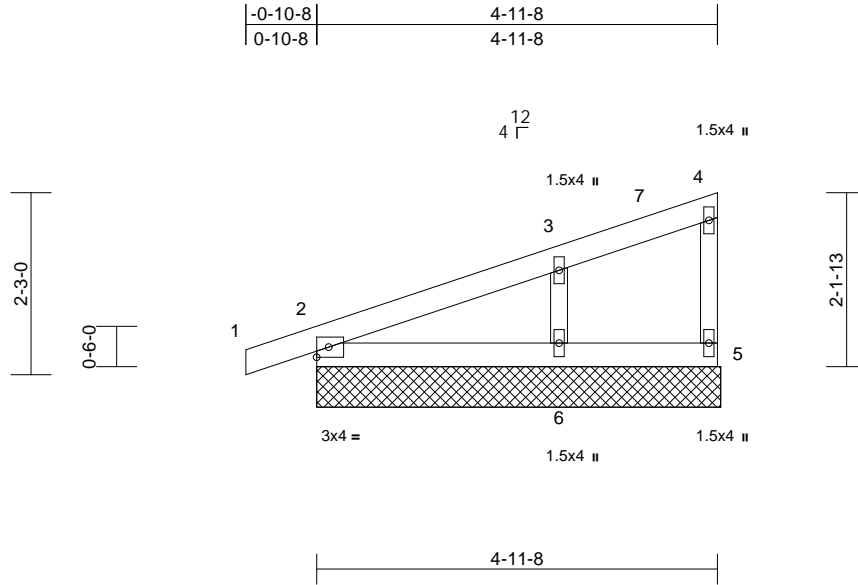

Scale = 1:28.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.12	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.07	n/a	-	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P						Weight: 19 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	2=5-0-0, 5=5-0-0, 6=5-0-0
Max Horiz	2=85 (LC 8)
Max Uplift	2=-49 (LC 8), 5=-14 (LC 8), 6=-78 (LC 12)
Max Grav	2=182 (LC 1), 5=47 (LC 1), 6=269 (LC 1)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/6, 2-3=-141/58, 3-4=-29/8, 4-5=-37/47
BOT CHORD	2-6=0/0, 5-6=0/0
WEBS	3-6=-205/304

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 4-10-4 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 6) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 5, 49 lb uplift at joint 2 and 78 lb uplift at joint 6.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20

Job	Truss	Truss Type	Qty	Ply	Roof
P240300	B2	Monopitch	3	1	Job Reference (optional)


I64525072

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:17

Page: 1

ID:4QEzufucAXMxzh8xWxEVwDzwwpA-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

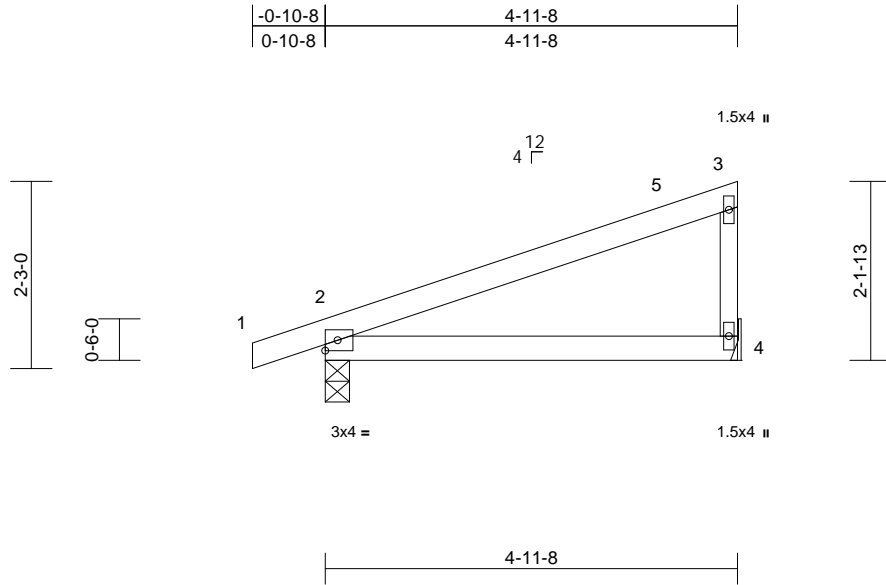

Scale = 1:27.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	-0.03	2-4	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	-0.06	2-4	>958	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 18 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or  
5-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc  
bracing.

**REACTIONS** (size) 2=0-3-8, 4= Mechanical  
Max Horiz 2=85 (LC 8)  
Max Uplift 2=83 (LC 8), 4=59 (LC 12)  
Max Grav 2=291 (LC 1), 4=204 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum  
Tension

TOP CHORD 1-2=0/6, 2-3=-100/45, 3-4=-157/228  
BOT CHORD 2-4=0/0

**NOTES**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8,  
Interior (1) 4-1-8 to 4-10-4 zone; cantilever left and right  
exposed; end vertical left exposed; C-C for members  
and forces & MWFRS for reactions shown; Lumber  
DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- 3) Bearings are assumed to be: Joint 2 SP No.2 crushing  
capacity of 565 psi.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 59 lb uplift at joint  
4 and 83 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20

Job	Truss	Truss Type	Qty	Ply	Roof
P240300	B3	Monopitch	7	1	Job Reference (optional)


I64525073

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:17

Page: 1

ID:k?UxzaFoLR0qy8sWjXGlcLzwwoj-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

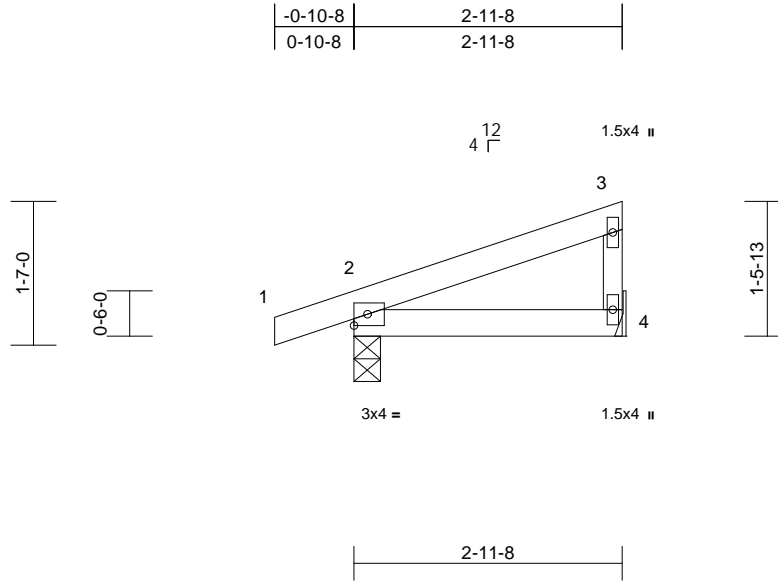

Scale = 1:25.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	0.00	2-4	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	-0.01	2-4	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 11 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x3 SPF No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or  
3-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc  
bracing.

**REACTIONS** (size) 2=0-3-8, 4= Mechanical  
Max Horiz 2=56 (LC 8)  
Max Uplift 2=-72 (LC 8), 4=-32 (LC 12)  
Max Grav 2=207 (LC 1), 4=108 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum  
Tension

TOP CHORD 1-2=0/6, 2-3=-61/28, 3-4=-81/124  
BOT CHORD 2-4=0/0

**NOTES**

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Exterior(2E) zone; cantilever left  
and right exposed; end vertical left exposed; C-C for  
members and forces & MWFRS for reactions shown;  
Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 2 SP No.2 crushing  
capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 32 lb uplift at joint  
4 and 72 lb uplift at joint 2.
- This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	C1	Common Structural Gable	1	1	Job Reference (optional)	I64525074

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:17

Page: 1

ID:EiusZUx23f\_KaFqBj9FMc9zwwIF-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

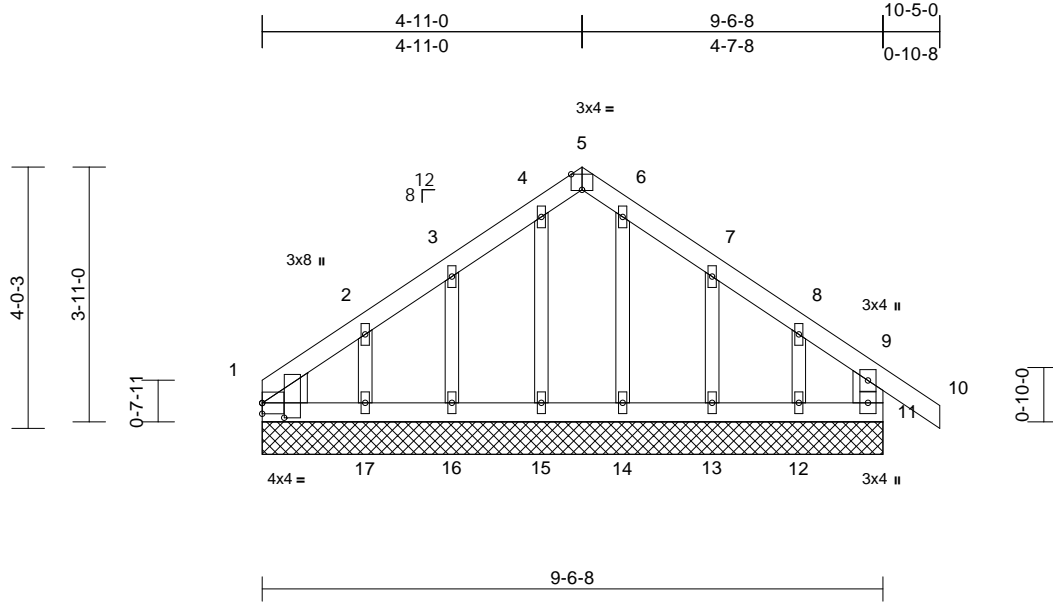

Scale = 1:35.4

Plate Offsets (X, Y): [1:0-2-11,0-4-1], [5:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	11	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							
Weight: 45 lb FT = 20%											

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x6 SPF No.2
OTHERS	2x3 SPF No.2
WEDGE	Left: 2x6 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size)	1=9-6-8, 11=9-6-8, 12=9-6-8, 13=9-6-8, 14=9-6-8, 15=9-6-8, 16=9-6-8, 17=9-6-8
Max Horiz	1=117 (LC 11)
Max Uplift	1=-30 (LC 8), 11=-4 (LC 9), 12=-77 (LC 13), 13=-60 (LC 13), 15=-9 (LC 9), 16=-57 (LC 12), 17=-84 (LC 12)
Max Grav	1=85 (LC 20), 11=160 (LC 1), 12=94 (LC 20), 13=139 (LC 20), 14=116 (LC 1), 15=131 (LC 19), 16=119 (LC 19), 17=170 (LC 19)

#### FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	5-6=-68/99, 6-7=-69/100, 7-8=-29/37, 8-9=-54/30, 9-10=0/43, 1-2=-101/97, 2-3=-67/65, 3-4=-68/99, 4-5=-68/99, 9-11=-138/68
BOT CHORD	1-17=-46/98, 16-17=-46/98, 15-16=-46/98, 14-15=-46/98, 13-14=-46/98, 12-13=-46/98, 11-12=-46/98
WEBS	4-15=-104/24, 6-14=-91/1, 2-17=-131/116, 8-12=-95/89, 3-16=-96/96, 7-13=-110/102

#### NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 4-11-0, Exterior(2R) 4-11-0 to 9-11-0, Interior (1) 9-11-0 to 10-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 1.5x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 11, 30 lb uplift at joint 1, 9 lb uplift at joint 15, 84 lb uplift at joint 17, 77 lb uplift at joint 12, 57 lb uplift at joint 16 and 60 lb uplift at joint 13.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20




Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	C2	Common	1	1	Job Reference (optional)	164525075

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:17

Page: 1

ID:jF5Ncuz?p4p7vTPjIDnW5Hzwwjv-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

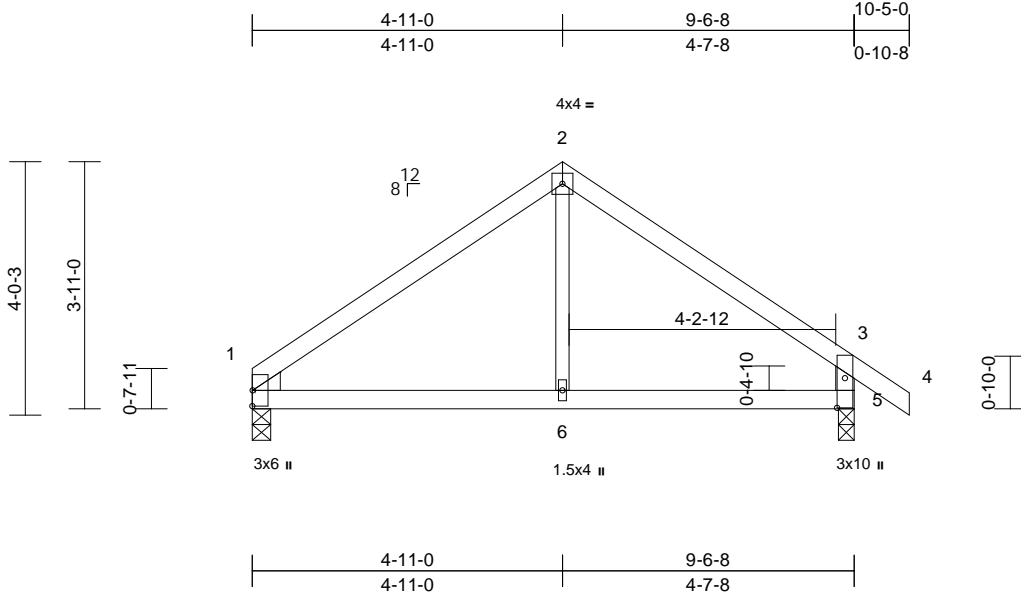

Scale = 1:36.5

Plate Offsets (X, Y): [5:0-5-10,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	0.06	1-6	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.54	Vert(CT)	-0.04	1-6	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 37 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x3 SPF No.2 \*Except\* 5-3:2x4 SP No.2  
WEDGE Left: 2x4 SPF No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=0-3-8, 5=0-3-0  
Max Horiz 1=116 (LC 11)  
Max Uplift 1=-57 (LC 12), 5=-82 (LC 13)  
Max Grav 1=412 (LC 1), 5=492 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-3=-452/479, 3-4=0/40, 1-2=-465/468, 3-5=-445/419  
BOT CHORD 1-6=-266/295, 5-6=-266/295  
WEBS 2-6=-342/207

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 4-11-0, Exterior(2R) 4-11-0 to 9-11-0, Interior (1) 9-11-0 to 10-5-0 zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 82 lb uplift at joint 5 and 57 lb uplift at joint 1.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20


Job	Truss	Truss Type	Qty	Ply	Roof	164525076
P240300	C3	Common	1	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:18

Page: 1

ID:omfbAuONF0YWRSSc6HOyKzwwi4-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?i

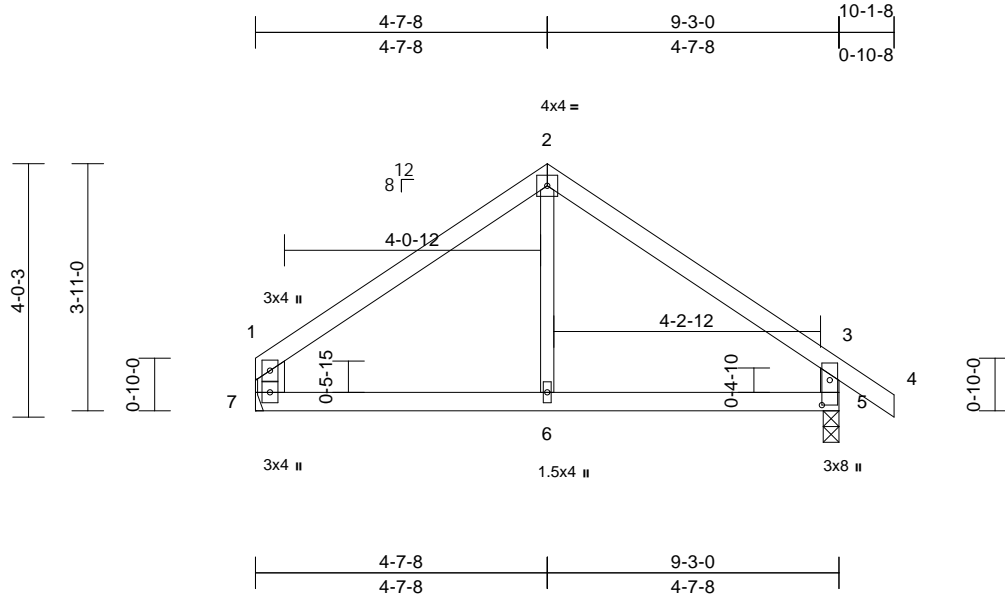

Scale = 1:36.5

Plate Offsets (X, Y): [5'-0" 4'-12" 0'-10"]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.32	Vert(LL)	0.03	5-6	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.03	5-6	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							Weight: 37 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x3 SPF No.2 \*Except\* 7-1:2x6 SPF No.2,  
5-3:2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or  
6'-0" oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10'-0" oc  
bracing.

**REACTIONS** (size) 5=0-3-0, 7= Mechanical  
Max Horiz 7=-122 (LC 8)  
Max Uplift 5=-81 (LC 13), 7=-54 (LC 12)  
Max Grav 5=475 (LC 1), 7=395 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum  
Tension

TOP CHORD 2-3=-411/435, 3-4=0/40, 1-2=-404/434,  
1-7=-339/330, 3-5=-423/401  
BOT CHORD 6-7=-230/259, 5-6=-230/259  
WEBS 2-6=-298/175

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Exterior(2E) 0-2-12 to 4-7-8,  
Exterior(2R) 4-7-8 to 9-7-8, Interior (1) 9-7-8 to 10-1-8  
zone; cantilever left and right exposed; end vertical left  
and right exposed; porch left and right exposed; C-C for  
members and forces & MWFRS for reactions shown;  
Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: , Joint 5 SP No.2 crushing  
capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 81 lb uplift at joint  
5 and 54 lb uplift at joint 7.
- This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	D1	Roof Special Supported Gable	1	1	Job Reference (optional)	164525077

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:18

Page: 1

ID:wijvgVRNMEbdXh3iv6zXHnzww7s-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

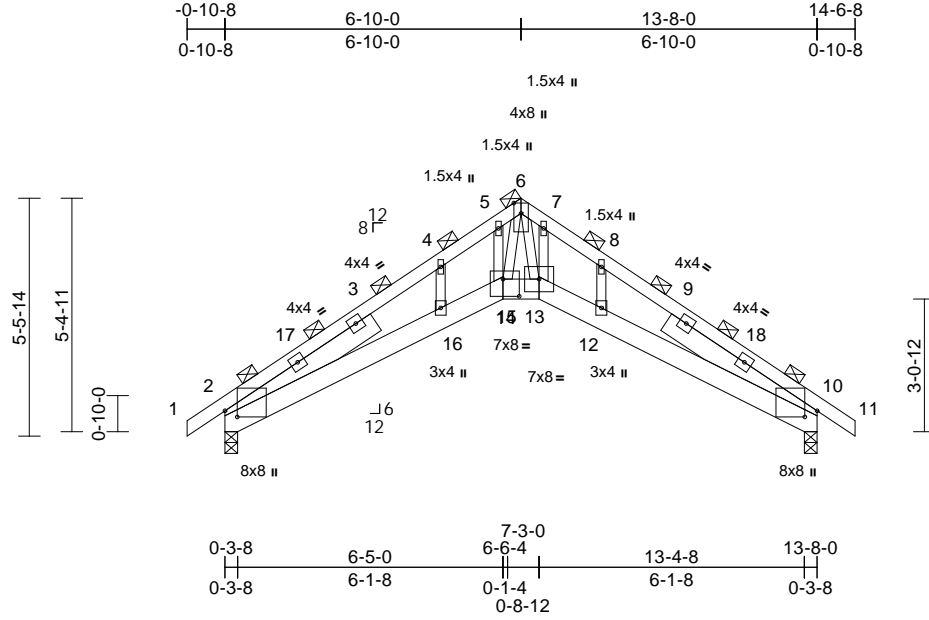




Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	D2	Roof Special Structural Gable	1	1	Job Reference (optional)	I64525078

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:18  
ID:0Un07T0ZcLyQZnshImJUDzwwdO-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCDoi7J4zJC7f

Page: 1

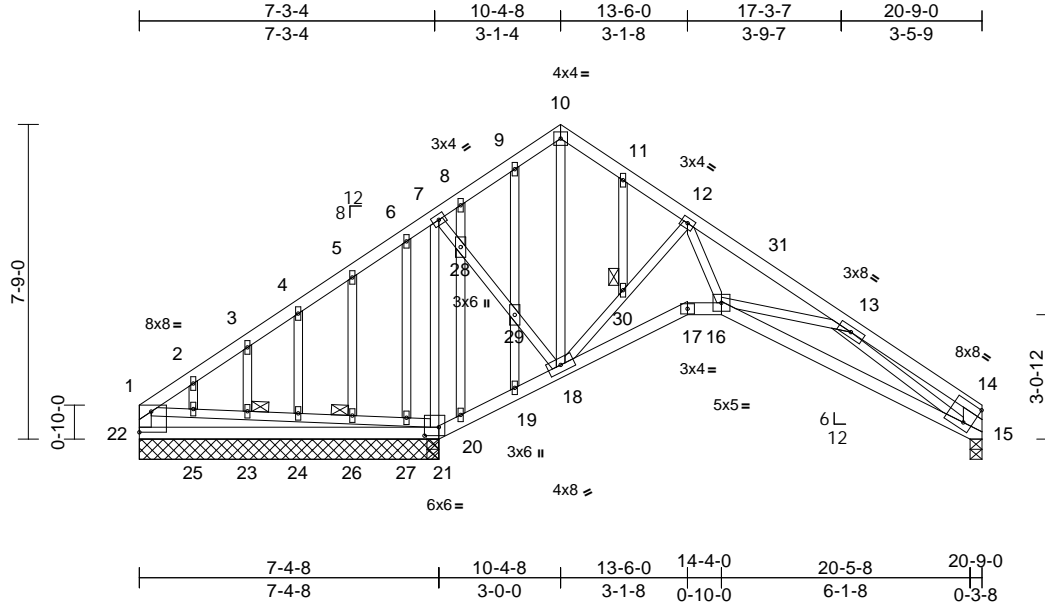

Scale = 1:56.7

Plate Offsets (X, Y): [1:Edge,0-6-2], [14:0-2-8,0-6-0], [21:0-4-4,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.51	Vert(LL)	-0.09	21-22	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.17	21-22	>500	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.07	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 124 lb	FT = 20%

<b>LUMBER</b>	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x3 SPF No.2 *Except* 22-1:2x4 SP No.2, 15-14:2x6 SPF No.2
OTHERS	2x3 SPF No.2

<b>BRACING</b>	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
JOINTS	1 Brace at Jt(s): 23, 26, 30

<b>REACTIONS</b>	(size)	15=0-3-8, 21=7-4-8, 22=7-4-8
	Max Horiz	22=217 (LC 11)
	Max Uplift	15=84 (LC 13), 21=141 (LC 12), 22=242 (LC 26)
	Max Grav	15=367 (LC 1), 21=1549 (LC 1), 22=128 (LC 25)

<b>FORCES</b>	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-73/574, 2-3=-85/606, 3-4=-63/619, 4-5=-50/658, 5-6=-27/698, 6-7=-13/643, 7-8=-46/219, 8-9=-1/183, 9-10=0/192, 10-11=0/231, 11-12=-5/171, 12-13=-482/49, 13-14=-221/49, 1-22=-58/309, 14-15=-193/60
BOT CHORD	21-22=-293/534, 20-21=-658/155, 19-20=-607/182, 18-19=-594/194, 17-18=-19/226, 16-17=-8/203, 15-16=-192/688

<b>WEBS</b>	7-21=-856/219, 12-16=0/461, 1-25=-888/293, 23-25=-883/290, 23-24=-885/292, 24-26=-886/292, 26-27=-888/293, 21-27=-913/293, 13-15=-620/207, 7-28=0/549, 28-29=0/613, 18-29=0/586, 10-18=-304/0, 18-30=-517/132, 12-30=-517/132, 13-16=-309/285, 3-23=-46/33, 4-24=-23/15, 2-25=-48/83, 5-26=-36/30, 6-27=-152/9, 8-28=-115/50, 20-28=-132/0, 9-29=-54/18, 19-29=-21/11, 11-30=0/3
-------------	--

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 5-2-15, Interior (1) 5-2-15 to 10-4-8, Exterior(2R) 10-4-8 to 15-4-8, Interior (1) 15-4-8 to 20-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Bearing at joint(s) 15 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 242 lb uplift at joint 22, 141 lb uplift at joint 21 and 84 lb uplift at joint 15.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard




March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083, Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:18 Page: 1  
ID: pwt0i01hEphDIMFL4rqrrrezwwfY-RfC?PsB70Hg3NSaPanL8w3ulTXbGKWRCDo7J4zJC?f




<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.16	9	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-0.28	9	>865	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.92	Horz(CT)	0.25	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 104 lb	FT = 20%

**NOTES**

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCdL=6.0psf; BCdL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
Exterior zone and C-C Exterior(2E) 0-1-12 to 5-1-12,  
Interior (1) 5-1-12 to 10-4-8, Exterior(2R) 10-4-8 to  
15-4-8, Interior (1) 15-4-8 to 20-6-4 zone; cantilever left  
and right exposed ; end vertical right exposed; C-C for  
members and forces & MWFRS for reactions shown;  
Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- 4) All bearings are assumed to be SP No.2 crushing  
capacity of 565 psi.
- 5) Bearing at joint(s) 7 considers parallel to grain value  
using ANSI/TPI 1 angle to grain formula. Building  
designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 127 lb uplift at  
joint 12 and 127 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



**WARNING – verify design parameters and noted notes on this and included MiTek Reference Tag M-7473 Rev. 1/2/2023 before use.** Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Crestwood, MO 63070  
P: 636.412.0100 | www.mitekusa.com  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20

Job	Truss	Truss Type	Qty	Ply	Roof	I64525080
P240300	E1	Common Supported Gable	1	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:18  
ID:bSBHlwRTVwODq1AP3GREtazww5H-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

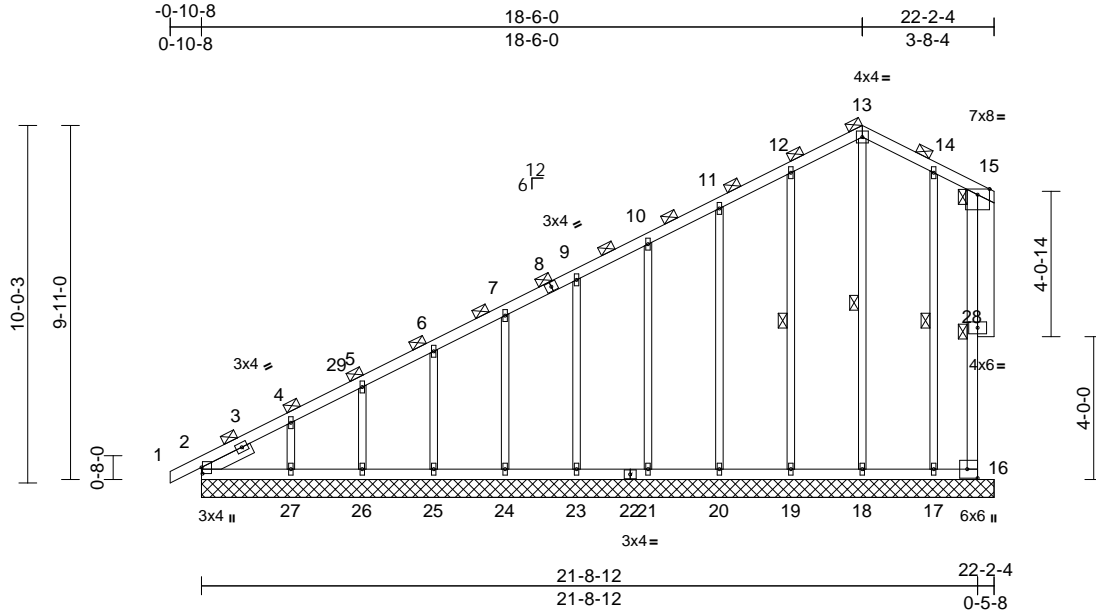

Scale = 1:64.5

Plate Offsets (X, Y): [2:0-2-1,0-0-5], [16:Edge,0-3-8]

Loading	(psf)	Spacing	4-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.87	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0	Rep Stress Incr	NO	WB	0.40	Horz(CT)	0.01	16	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							
Weight: 138 lb FT = 20%											

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP 1650F 1.5E  
OTHERS 2x3 SPF No.2 \*Except\* 28-15:2x6 SPF No.2  
SLIDER Left 2x4 SP No.2 -- 1-6-7

**BRACING**  
TOP CHORD 2-0-0 oc purlins (5-6-9 max.), except end verticals  
(Switched from sheeted: Spacing > 2-8-0).  
BOT CHORD Rigid ceiling directly applied or 9-7-14 oc bracing.  
WEBS 1 Row at midpt 13-18, 12-19, 14-17, 15-16

**REACTIONS** (size) 2=22-2-4, 16=22-2-4, 17=22-2-4, 18=22-2-4, 19=22-2-4, 20=22-2-4, 21=22-2-4, 23=22-2-4, 24=22-2-4, 25=22-2-4, 26=22-2-4, 27=22-2-4  
Max Horiz 2=759 (LC 9)  
Max Uplift 2=-36 (LC 8), 16=-91 (LC 8), 17=-77 (LC 13), 18=-126 (LC 11), 19=-123 (LC 12), 20=-126 (LC 12), 21=-122 (LC 12), 23=-123 (LC 12), 24=-121 (LC 12), 25=-129 (LC 12), 26=-91 (LC 12), 27=-261 (LC 12)  
Max Grav 2=475 (LC 20), 16=144 (LC 20), 17=310 (LC 26), 18=370 (LC 19), 19=377 (LC 25), 20=359 (LC 25), 21=360 (LC 1), 23=360 (LC 25), 24=359 (LC 1), 25=365 (LC 25), 26=341 (LC 1), 27=432 (LC 25)

**FORCES** (lb) - Maximum Compression/Maximum Tension

**TOP CHORD** 1-2=0/11, 2-4=-990/650, 4-5=-779/549, 5-6=-690/525, 6-7=-578/485, 7-9=-471/448, 9-10=-397/410, 10-11=-365/426, 11-12=-365/540, 12-13=-396/635, 13-14=-395/613, 14-15=-450/603, 15-16=-388/528  
**BOT CHORD** 2-27=-305/391, 26-27=-305/391, 25-26=-305/391, 24-25=-305/391, 23-24=-305/391, 21-23=-305/391, 20-21=-305/391, 19-20=-305/391, 18-19=-305/391, 17-18=-305/391, 16-17=-305/391  
**WEBS** 13-18=-377/221, 12-19=-298/197, 11-20=-279/206, 10-21=-280/193, 9-23=-280/193, 7-24=-280/193, 6-25=-282/202, 5-26=-270/202, 4-27=-326/415, 14-17=-332/375

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-1-8, Exterior(2N) 4-1-8 to 18-6-0, Corner(3E) 18-6-0 to 21-8-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 91 lb uplift at joint 16, 126 lb uplift at joint 18, 123 lb uplift at joint 19, 126 lb uplift at joint 20, 122 lb uplift at joint 21, 123 lb uplift at joint 23, 121 lb uplift at joint 24, 129 lb uplift at joint 25, 91 lb uplift at joint 26, 261 lb uplift at joint 27, 77 lb uplift at joint 17 and 36 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20


Job	Truss	Truss Type	Qty	Ply	Roof	I64525081
P240300	E4	Roof Special	8	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:18

Page: 1

ID:X3j9csSdTd?hyQgxh8rn6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

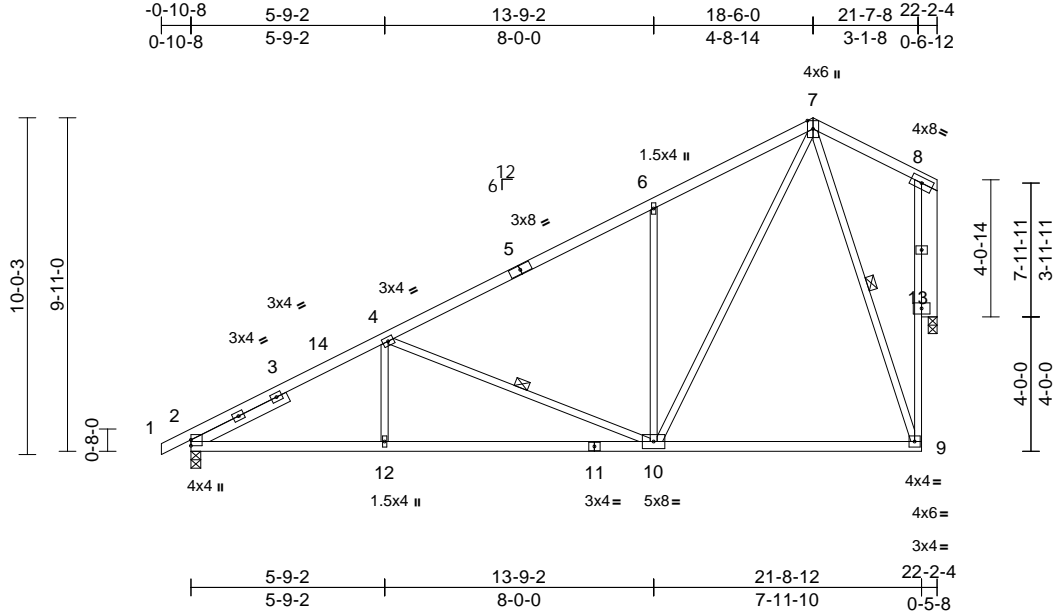

<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.79	Vert(LL)	-0.11	9-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.71	Vert(CT)	-0.23	9-10	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.96	Horz(CT)	-0.03	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 121 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\* 9-8:2x3 SPF No.2  
WEBS 2x3 SPF No.2 \*Except\* 13-8:2x6 SPF No.2  
SLIDER Left 2x4 SP No.2 -- 3-2-3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 3-5-6 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 8-4-8 oc bracing.

WEBS 1 Row at midpt 4-10, 7-9

**REACTIONS** (size) 2=0-3-8, 13=0-3-2  
Max Horiz 2=384 (LC 12)  
Max Uplift 2=-153 (LC 12), 13=-235 (LC 12)  
Max Grav 2=1036 (LC 1), 13=972 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/6, 2-4=-1623/208, 4-6=-943/120, 6-7=-924/276, 7-8=-64/49, 9-13=-212/848, 8-13=-124/66  
BOT CHORD 2-12=-483/1364, 10-12=-483/1364, 9-10=-82/264  
WEBS 6-10=-521/308, 7-10=-338/1066, 4-12=0/277, 4-10=-680/274, 7-9=-822/263

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 18-6-0, Exterior(2E) 18-6-0 to 21-7-8 zone; cantilever left and right exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi, Joint 13 SPF No.2 crushing capacity of 425 psi.
- Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 153 lb uplift at joint 2 and 235 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:20




Job	Truss	Truss Type	Qty	Ply	Roof	I64525082
P240300	E5	Roof Special	2	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:19

Page: 1

ID:X3j9csSdTd7hyQgxh8rm6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

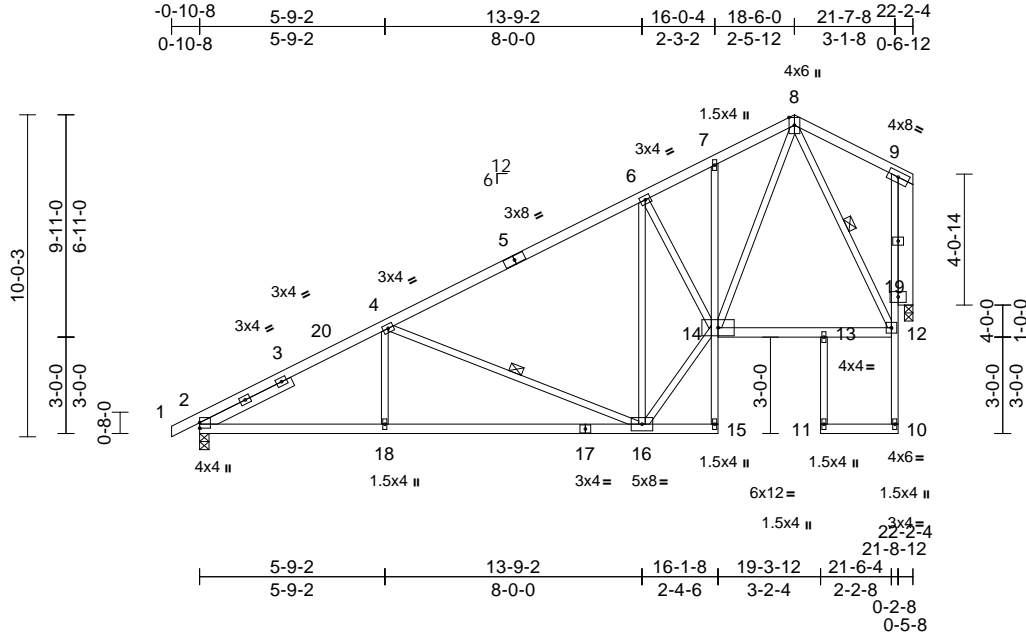




Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	E6	Common	7	1		I64525083
Job Reference (optional)						

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:19

Page: 1

ID:TnZ3x61kRmd3IVZaqXdQQ5zwvtc-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?i

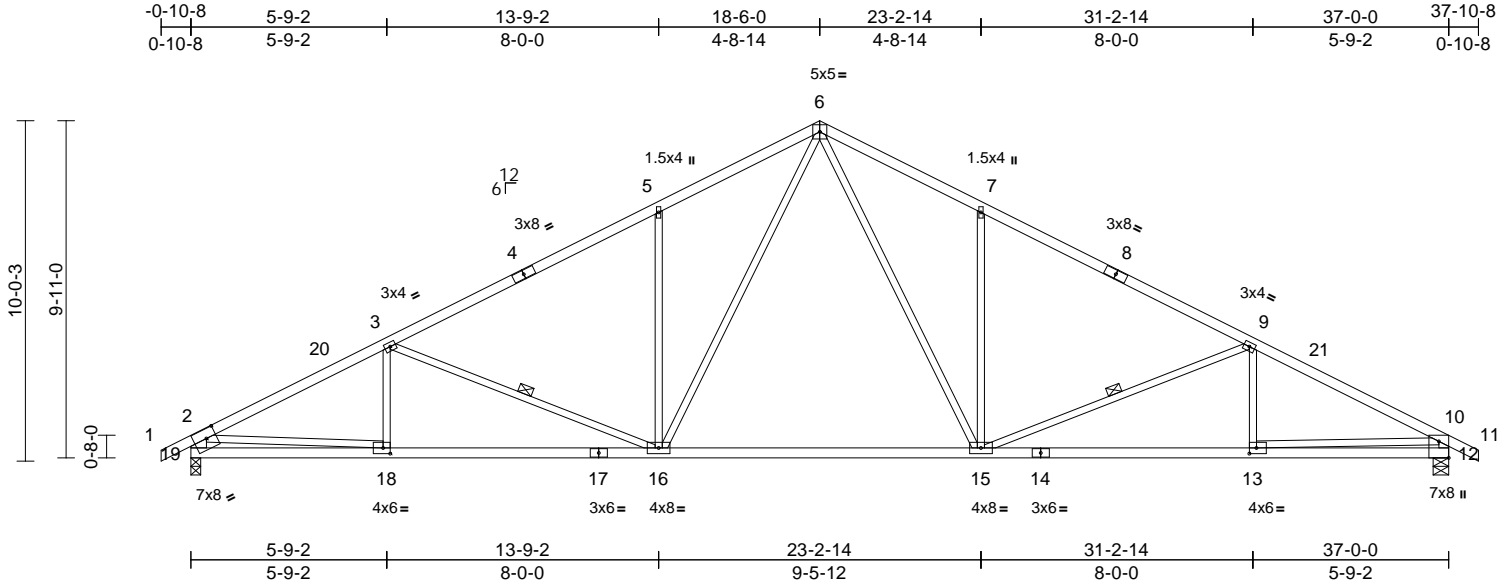

Scale = 1:67.8

Plate Offsets (X, Y): [12:Edge,0-3-8], [13:0-2-8,0-2-0], [18:0-2-8,0-2-0], [19:0-3-8,0-3-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.64	Vert(LL)	-0.19	15-16	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.90	Vert(CT)	-0.44	15-16	>993	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.92	Horz(CT)	0.10	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S								
Weight: 176 lb											FT = 20%	

#### LUMBER

TOP CHORD 2x4 SP 1650F 1.5E  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x3 SPF No.2 \*Except\* 19-2:2x6 SPF No.2,  
 12-10:2x4 SP 1650F 1.5E

#### BRACING

TOP CHORD Structural wood sheathing directly applied or  
 3-4-13 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc  
 bracing. Except:  
 8-5-5 oc bracing: 16-18.  
 WEBS 1 Row at midpt 3-16, 9-15

#### REACTIONS

(size) 12=0-5-8, 19=0-3-8  
 Max Horiz 19=166 (LC 17)  
 Max Uplift 12=276 (LC 13), 19=278 (LC 12)  
 Max Grav 12=1719 (LC 1), 19=1726 (LC 1)

#### FORCES

(lb) - Maximum Compression/Maximum  
 Tension  
 TOP CHORD 1-2=0/35, 2-3=-2848/431, 3-5=-2360/418,  
 5-6=-2337/549, 6-7=-2343/549,  
 7-9=-2365/419, 9-10=-2884/437, 10-11=0/32,  
 2-19=-1661/338, 10-12=-1654/334  
 BOT CHORD 18-19=-249/555, 16-18=-474/2474,  
 15-16=-102/1561, 13-15=-312/2506,  
 12-13=-114/613  
 WEBS 5-16=-512/308, 6-16=-325/1012,  
 9-13=-32/166, 7-15=-511/308, 3-18=-52/151,  
 10-13=-208/1899, 3-16=-556/246,  
 6-15=-327/1021, 2-18=-225/1934,  
 9-15=-581/251

#### NOTES

1) Unbalanced roof live loads have been considered for  
 this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
 Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
 exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8,  
 Interior (1) 4-1-8 to 18-6-0, Exterior(2R) 18-6-0 to  
 23-2-14, Interior (1) 23-2-14 to 37-10-8 zone; cantilever  
 left and right exposed; end vertical left and right  
 exposed; C-C for members and forces & MWFRS for  
 reactions shown; Lumber DOL=1.60 plate grip  
 DOL=1.60
- The Fabrication Tolerance at joint 10 = 16%
- This truss has been designed for a 10.0 psf bottom  
 chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing  
 capacity of 565 psi.
- Provide mechanical connection (by others) of truss to  
 bearing plate capable of withstanding 276 lb uplift at  
 joint 12 and 278 lb uplift at joint 19.
- This truss is designed in accordance with the 2018  
 International Residential Code sections R502.11.1 and  
 R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
 RELEASE FOR CONSTRUCTION  
 AS NOTED ON PLANS REVIEW  
 DEVELOPMENT SERVICES  
 LEE'S SUMMIT, MISSOURI  
 04/19/2024 3:51:20

Job	Truss	Truss Type	Qty	Ply	Roof	164525084
P240300	E7	Common Supported Gable	1	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:19  
ID:30TC0Xcr8WgF3uEpecUgNDzwvss-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

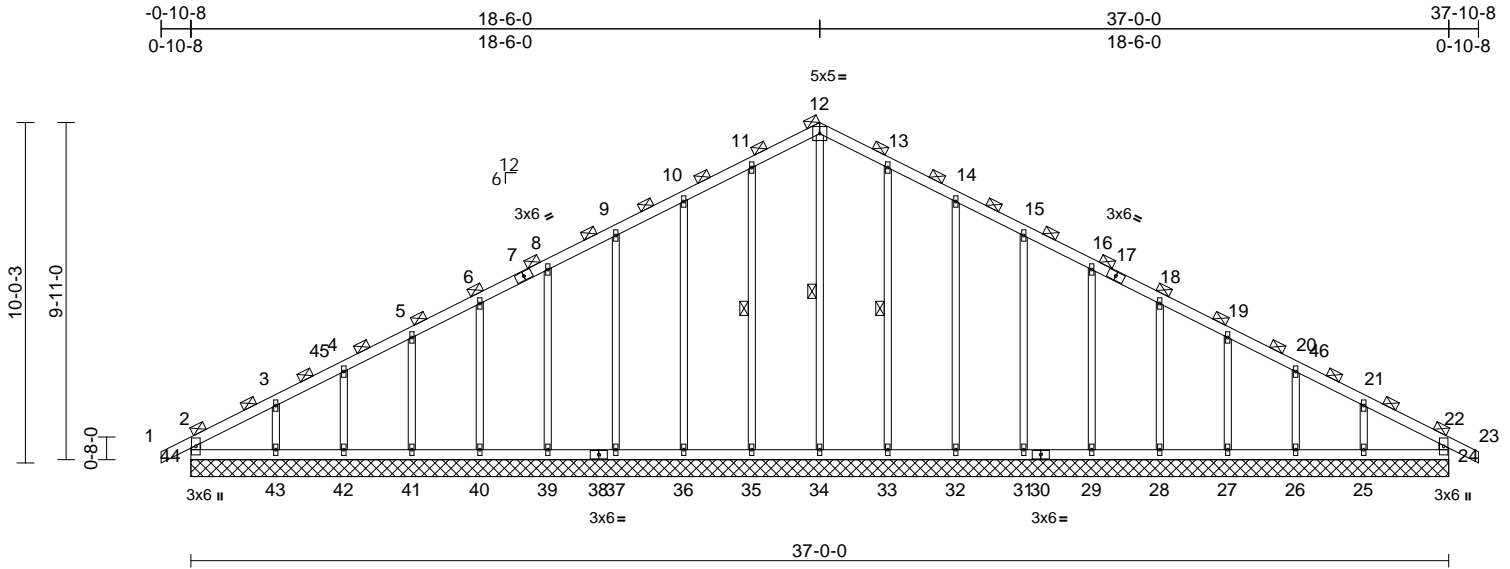

Scale = 1:67.8

Plate Offsets (X, Y): [17:0-0-0,0-0-0]

Loading	(psf)	Spacing	4-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0	Rep Stress Incr	NO	WB	0.40	Horz(CT)	0.02	24	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R							
Weight: 191 lb FT = 20%											

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2  
OTHERS 2x3 SPF No.2

**BRACING**  
TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals  
(Switched from sheeted: Spacing > 2-8-0).  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**WEBS** 1 Row at midpt 12-34, 11-35, 13-33  
**REACTIONS** (size)  
24=37-0-0, 25=37-0-0, 26=37-0-0,  
27=37-0-0, 28=37-0-0, 29=37-0-0,  
31=37-0-0, 32=37-0-0, 33=37-0-0,  
34=37-0-0, 35=37-0-0, 36=37-0-0,  
37=37-0-0, 39=37-0-0, 40=37-0-0,  
41=37-0-0, 42=37-0-0, 43=37-0-0,  
44=37-0-0  
Max Horiz 44=334 (LC 17)  
Max Uplift 24=20 (LC 9), 25=225 (LC 13),  
26=92 (LC 13), 27=129 (LC 13),  
28=121 (LC 13), 29=123 (LC 13),  
31=120 (LC 13), 32=135 (LC 13),  
33=99 (LC 13), 35=105 (LC 12),  
36=132 (LC 12), 37=120 (LC 12),  
39=123 (LC 12), 40=120 (LC 12),  
41=132 (LC 12), 42=83 (LC 12),  
43=254 (LC 12), 44=78 (LC 8)  
Max Grav 24=375 (LC 1), 25=397 (LC 26),  
26=350 (LC 1), 27=363 (LC 26),  
28=359 (LC 1), 29=360 (LC 26),  
31=360 (LC 1), 32=359 (LC 26),  
33=376 (LC 26), 34=431 (LC 22),  
35=376 (LC 25), 36=359 (LC 25),  
37=360 (LC 1), 39=360 (LC 25),  
40=359 (LC 1), 41=363 (LC 25),  
42=350 (LC 1), 43=397 (LC 25),  
44=375 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
**TOP CHORD** 2-44=331/145, 1-2=0/64, 2-3=-395/168,  
3-4=-263/184, 4-5=-207/232, 5-6=-163/287,  
6-8=-139/343, 8-9=-171/424, 9-10=-208/531,  
10-11=-248/646, 11-12=-282/738,  
12-13=-282/738, 13-14=-248/646,  
14-15=-208/531, 15-16=-171/424,  
16-18=-133/316, 18-19=-96/209,  
19-20=-128/127, 20-21=-177/81,  
21-22=-285/79, 22-23=0/64, 22-24=-331/154  
**BOT CHORD** 43-44=-78/318, 42-43=-78/318,  
41-42=-78/318, 40-41=-78/318,  
39-40=-78/318, 37-39=-78/318,  
36-37=-78/318, 35-36=-78/318,  
34-35=-78/318, 33-34=-78/318,  
32-33=-78/318, 31-32=-78/318,  
29-31=-78/318, 28-29=-78/318,  
27-28=-78/318, 26-27=-78/318,  
25-26=-78/318, 24-25=-78/318  
**WEBS** 12-34=-472/99, 11-35=-296/158,  
10-36=-279/210, 9-37=-280/190,  
8-39=-280/193, 6-40=-280/193,  
5-41=-281/197, 4-42=-275/205,  
3-43=-302/378, 13-33=-296/158,  
14-32=-279/210, 15-31=-280/190,  
16-29=-280/193, 18-28=-280/193,  
19-27=-281/197, 20-26=-275/206,  
21-25=-302/375

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Corner(3E) -0-10-8 to 4-1-8,  
Exterior(2N) 4-1-8 to 18-6-0, Corner(3R) 18-6-0 to  
23-6-0, Exterior(2N) 23-6-0 to 37-10-8 zone; cantilever  
left and right exposed; end vertical left and right  
exposed; C-C for members and forces & MWFRS for  
reactions shown; Lumber DOL=1.60 plate grip  
DOL=1.60
- Truss designed for wind loads in the plane of the truss  
only. For studs exposed to wind (normal to the face),  
see Standard Industry Gable End Details as applicable,  
or consult qualified building designer as per ANSI/TPI 1.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely  
braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing  
capacity of 565 psi.



March 28, 2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21

Job	Truss	Truss Type	Qty	Ply	Roof
P240300	E7	Common Supported Gable	1	1	I64525084
Job Reference (optional)					

- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 44, 20 lb uplift at joint 24, 105 lb uplift at joint 35, 132 lb uplift at joint 36, 120 lb uplift at joint 37, 123 lb uplift at joint 39, 120 lb uplift at joint 40, 132 lb uplift at joint 41, 83 lb uplift at joint 42, 254 lb uplift at joint 43, 99 lb uplift at joint 33, 135 lb uplift at joint 32, 120 lb uplift at joint 31, 123 lb uplift at joint 29, 121 lb uplift at joint 28, 129 lb uplift at joint 27, 92 lb uplift at joint 26 and 225 lb uplift at joint 25.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

MiTek®

RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


16023 Swingley Ridge Rd  
Potosi, MO 63003  
816-404-0200 / MiTek-USA.com

Job	Truss	Truss Type	Qty	Ply	Roof	I64525085
P240300	R1	Flat Girder	1	2	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:19  
ID:X3j9csSdTd7hyQgxh8rn6OzwvW-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

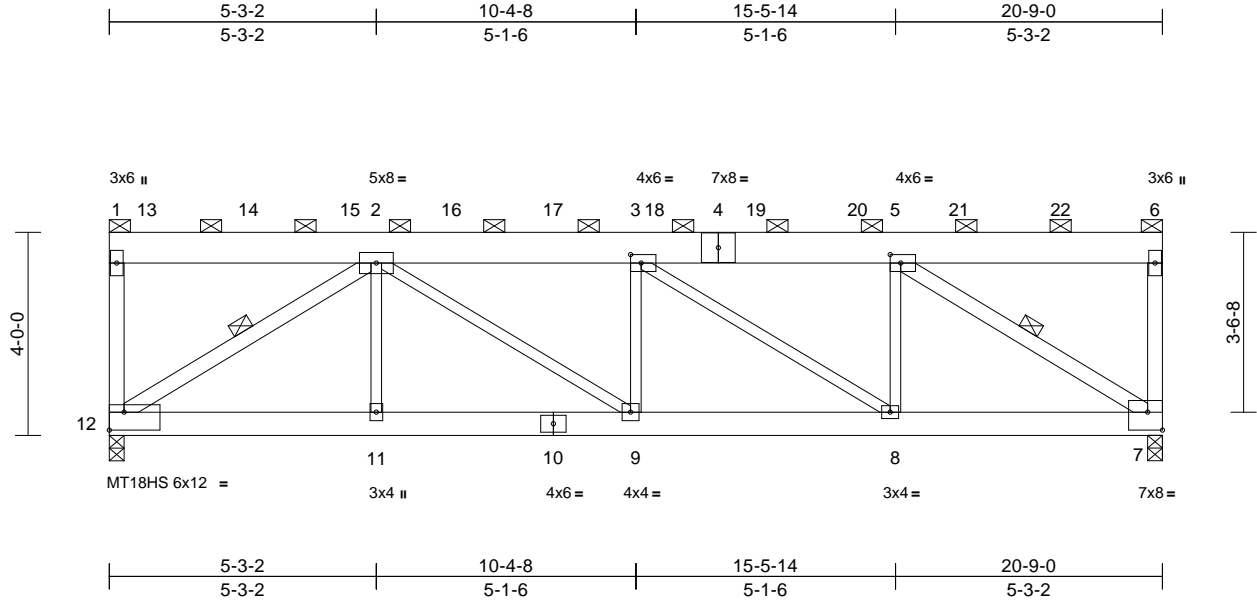

Scale = 1:45.4

Plate Offsets (X, Y): [3:0-2-8,0-2-0], [5:0-2-8,0-2-0], [7:Edge,0-4-4], [12:Edge,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	-0.11	9	>999	240	MT18HS 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.20	9	>999	180	MT20 197/144
BCLL	0.0	Rep Stress Incr	NO	WB	0.62	Horz(CT)	0.07	7	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 257 lb FT = 20%

#### LUMBER

TOP CHORD	2x8 SPF No.2
BOT CHORD	2x6 SPF No.2
WEBS	2x3 SPF No.2 *Except* 12-1,5-7,12-2:2x4 SP No.2
OTHERS	2x4 SP No.2

#### BRACING

TOP CHORD	2-0-0 oc purlins (5-10-6 max.): 1-6, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 5-7, 2-12

REACTIONS	(size) 7=0-3-8, (req. 0-4-1), 12=0-3-8, (req. 0-4-8)
	Max Uplift 7=-1154 (LC 8), 12=-1281 (LC 8)
	Max Grav 7=5155 (LC 1), 12=5719 (LC 1)

#### FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension
	1-12=-1320/361, 1-2=-76/18, 2-3=-8293/2099, 3-5=-6403/1622, 5-6=-72/17, 6-7=-768/252
BOT CHORD	11-12=-1628/6426, 9-11=-1628/6426, 8-9=-2099/8293, 7-8=-1622/6403
WEBS	5-7=-7649/1939, 2-11=0/188, 2-12=-7674/1945, 2-9=-570/2256, 3-9=-1153/373, 3-8=-2284/577, 5-8=-239/1336

#### NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Web connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x3 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner (3) zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- WARNING: Required bearing size at joint(s) 12, 7 greater than input bearing size.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1281 lb uplift at joint 12 and 1154 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 916 lb down and 206 lb up at 0-9-0, 902 lb down and 203 lb up at 2-9-0, 902 lb down and 203 lb up at 4-9-0, 902 lb down and 203 lb up at 6-9-0, 902 lb down and 203 lb up at 8-9-0, 902 lb down and 203 lb up at 10-9-0, 902 lb down and 203 lb up at 12-9-0, 902 lb down and 203 lb up at 14-9-0, and 902 lb down and 203 lb up at 16-9-0, and 902 lb down and 203 lb up at 18-9-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-6=-70, 7-12=-20  
Concentrated Loads (lb)  
Vert: 13=-916, 14=-902, 15=-902, 16=-902, 17=-902, 18=-902, 19=-902, 20=-902, 21=-902, 22=-902



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V1	Valley	1	1	Job Reference (optional)	I64525086

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:9TR7X\_t7mZkbh6rSl1VQ2DzJtkh-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

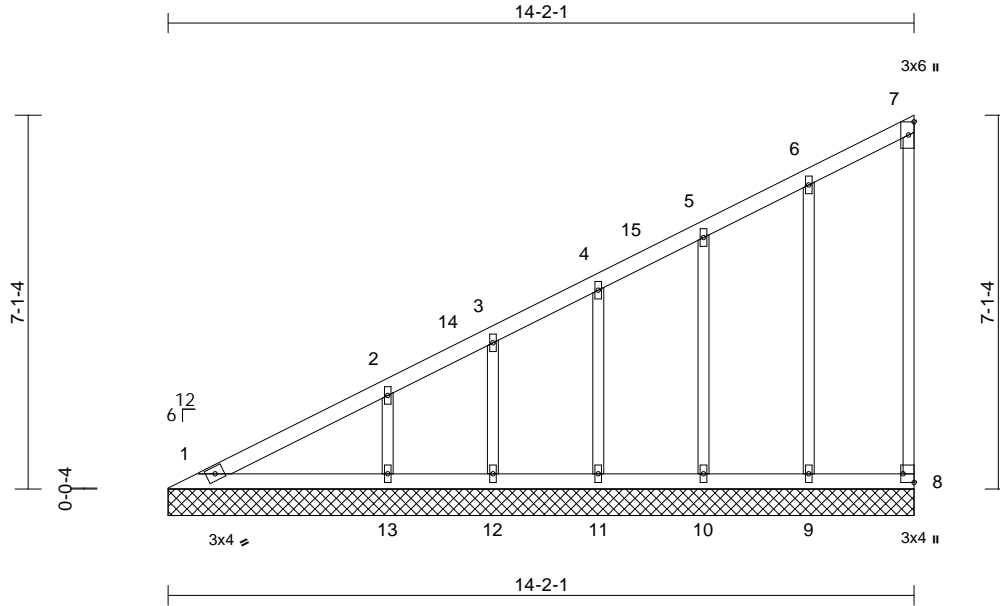

Scale = 1:43.8

Plate Offsets (X, Y): [8:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.12	Horiz(TL)	0.00	8	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							
Weight: 63 lb FT = 20%											

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=14-2-1, 8=14-2-1, 9=14-2-1, 10=14-2-1, 11=14-2-1, 12=14-2-1, 13=14-2-1
Max Horiz	1=300 (LC 9)	
Max Uplift	8=-39 (LC 9), 9=-68 (LC 12), 10=-57 (LC 12), 11=-67 (LC 12), 12=-42 (LC 12), 13=-111 (LC 12)	
Max Grav	1=168 (LC 20), 8=73 (LC 19), 9=193 (LC 1), 10=175 (LC 1), 11=194 (LC 1), 12=121 (LC 1), 13=328 (LC 1)	

#### FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-446/263, 2-3=-354/211, 3-4=-312/201, 4-5=-255/177, 5-6=-200/161, 6-7=-126/118, 7-8=-54/48
BOT CHORD	1-13=-135/147, 12-13=-135/147, 11-12=-135/147, 10-11=-135/147, 9-10=-135/147, 8-9=-135/147
WEBS	6-9=-149/167, 5-10=-138/109, 4-11=-149/105, 3-12=-100/70, 2-13=-244/189

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-7-9 to 5-7-9, Interior (1) 5-7-9 to 14-1-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 1.5x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 8, 68 lb uplift at joint 9, 57 lb uplift at joint 10, 67 lb uplift at joint 11, 42 lb uplift at joint 12 and 111 lb uplift at joint 13.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21




Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V2	Valley	1	1	Job Reference (optional)	I64525087

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:k9HPTm2vTtVcNGw8ZmicAzJtKt-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

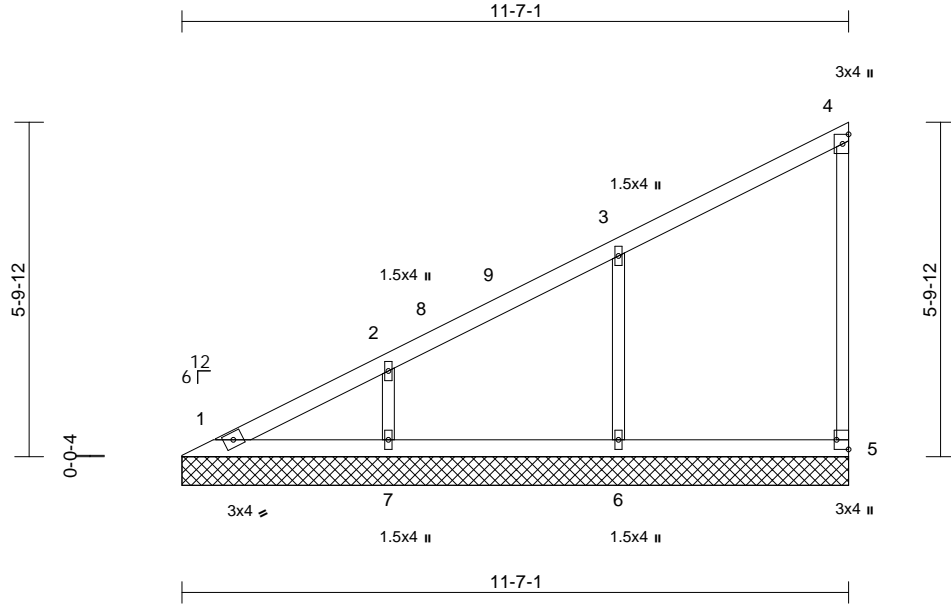

Scale = 1:40.1

Plate Offsets (X, Y): [5:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.39	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	5	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							
										Weight: 43 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=11-7-1, 5=11-7-1, 6=11-7-1, 7=11-7-1
	Max Horiz	1=243 (LC 9)
	Max Uplift	5=-39 (LC 9), 6=-135 (LC 12), 7=-116 (LC 12)
	Max Grav	1=132 (LC 20), 5=141 (LC 1), 6=398 (LC 1), 7=340 (LC 1)

#### FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-385/228, 2-3=-294/188, 3-4=-142/118, 4-5=-109/121
BOT CHORD	1-7=-110/120, 6-7=-110/120, 5-6=-110/120
WEBS	3-6=-311/291, 2-7=-260/229

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-7-9 to 5-7-9, Interior (1) 5-7-9 to 11-6-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.

- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 5, 135 lb uplift at joint 6 and 116 lb uplift at joint 7.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V3	Valley	1	1	Job Reference (optional)	I64525088

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:hYPaUS3A?UIKca3XhOoAhbzJtkR-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?i

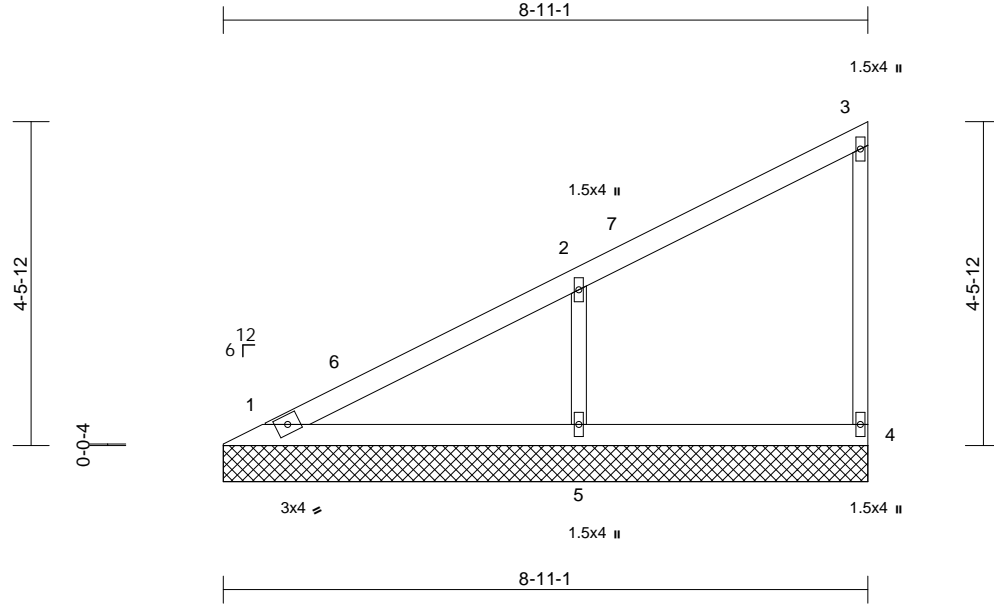


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V4	Valley	1	1	Job Reference (optional)	I64525089

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:9kzY5o4omouBEjeJF6JPEpzJtkQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

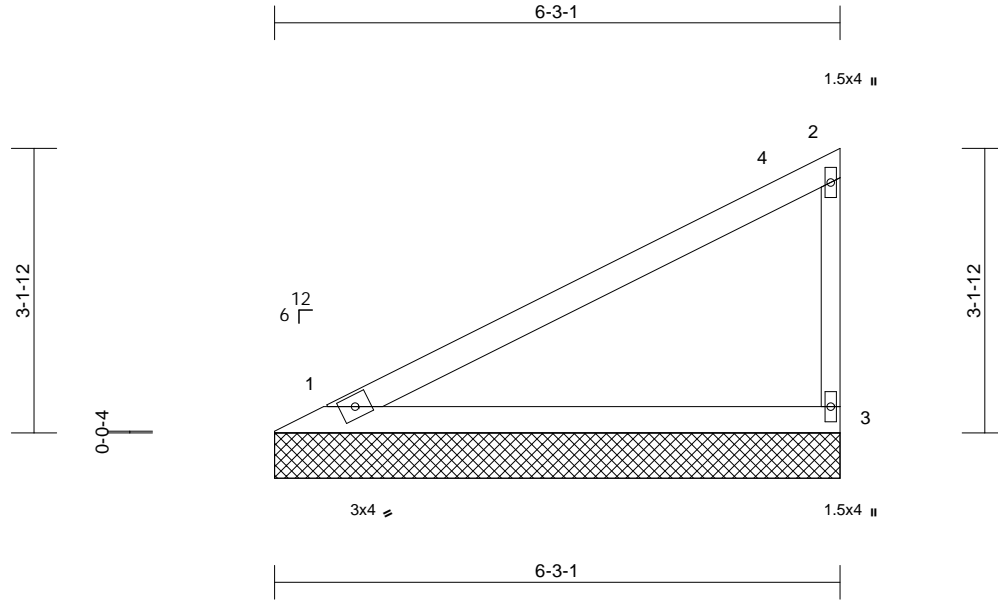

<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 21 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=6-3-1, 3=6-3-1  
Max Horiz 1=124 (LC 9)  
Max Uplift 1=39 (LC 12), 3=70 (LC 12)  
Max Grav 1=250 (LC 1), 3=250 (LC 1)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-170/115, 2-3=-195/241  
BOT CHORD 1-3=-57/62

#### NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Exterior(2E) 0-7-9 to 5-7-9,  
Interior (1) 5-7-9 to 6-2-5 zone; cantilever left and right  
exposed; end vertical left and right exposed; C-C for  
members and forces & MWFRS for reactions shown;  
Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss  
only. For studs exposed to wind (normal to the face),  
see Standard Industry Gable End Details as applicable,  
or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 crushing  
capacity of 565 psi.
- Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 39 lb uplift at joint  
1 and 70 lb uplift at joint 3.



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V5	Valley	1	1	Job Reference (optional)	I64525090

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:X3j9csSdTd?hyQgxh8rn6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?f

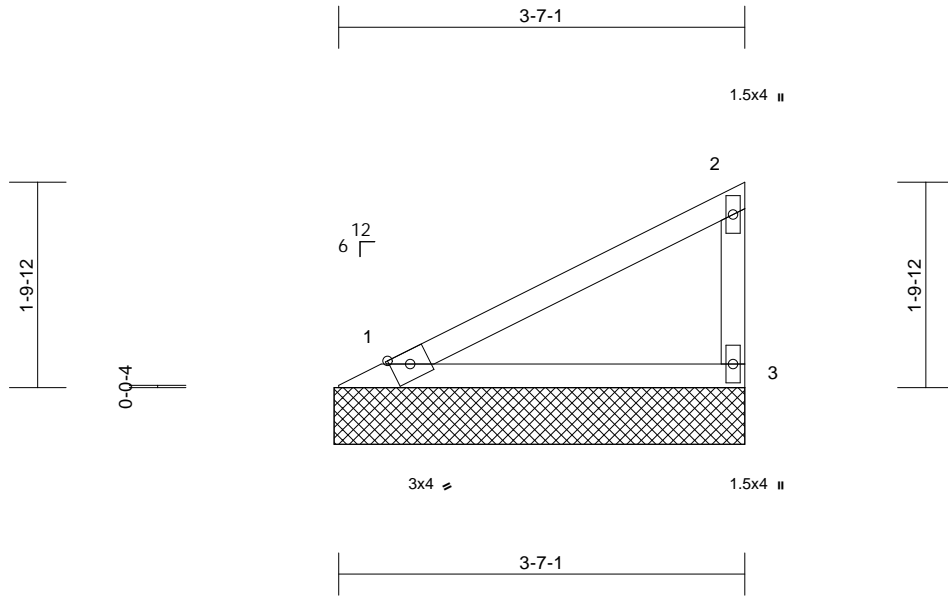

Scale = 1:20.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	n/a	-	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 7 lb
											FT = 20%

#### LUMBER

TOP CHORD 2x3 SPF No.2  
BOT CHORD 2x3 SPF No.2  
WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 3-7-9 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=3-7-9, 3=3-7-9

Max Horiz 1=67 (LC 12)  
Max Uplift 1=-13 (LC 12), 3=-47 (LC 12)  
Max Grav 1=138 (LC 1), 3=138 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-72/39, 2-3=-107/128  
BOT CHORD 1-3=0/0

#### NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 13 lb uplift at joint 1 and 47 lb uplift at joint 3.



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	I64525091
P240300	V6	Valley	1	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:X3j9csSdTd?hyQgxh8rn6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?f

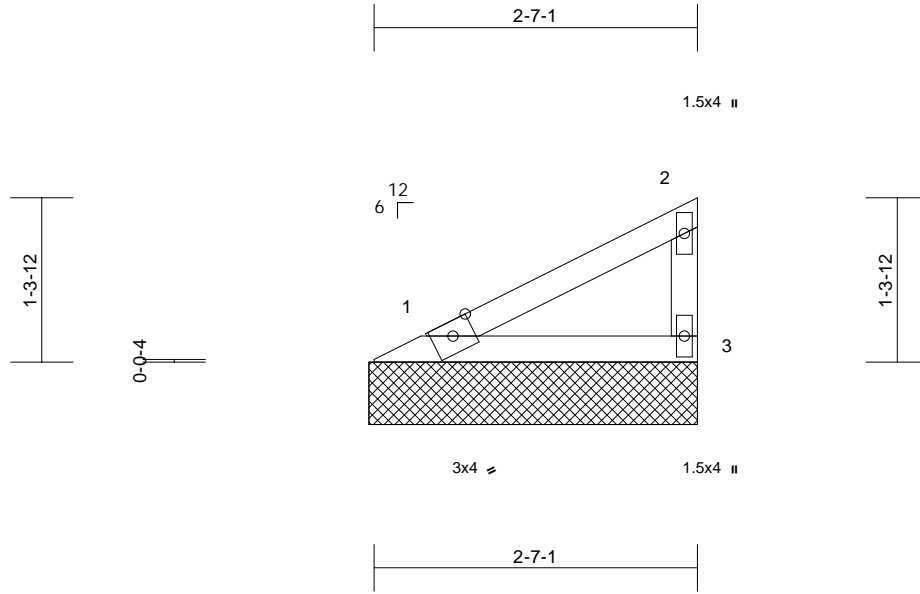

Scale = 1:18.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	n/a	-	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 5 lb
											FT = 20%

#### LUMBER

TOP CHORD 2x3 SPF No.2  
BOT CHORD 2x3 SPF No.2  
WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 2-7-9 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=2-7-9, 3=2-7-9

Max Horiz 1=45 (LC 12)  
Max Uplift 1=-9 (LC 12), 3=-32 (LC 12)  
Max Grav 1=93 (LC 1), 3=93 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-49/26, 2-3=-72/86  
BOT CHORD 1-3=0/0

#### NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Exterior(2E) zone; cantilever left  
and right exposed; end vertical left exposed; C-C for  
members and forces & MWFRS for reactions shown;  
Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss  
only. For studs exposed to wind (normal to the face),  
see Standard Industry Gable End Details as applicable,  
or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SPF No.2 crushing  
capacity of 425 psi.
- Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 9 lb uplift at joint 1  
and 32 lb uplift at joint 3.



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21




Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V7	Valley	1	1	Job Reference (optional)	I64525092

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:X3j9csSdTd?hyQgxh8rn6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?f

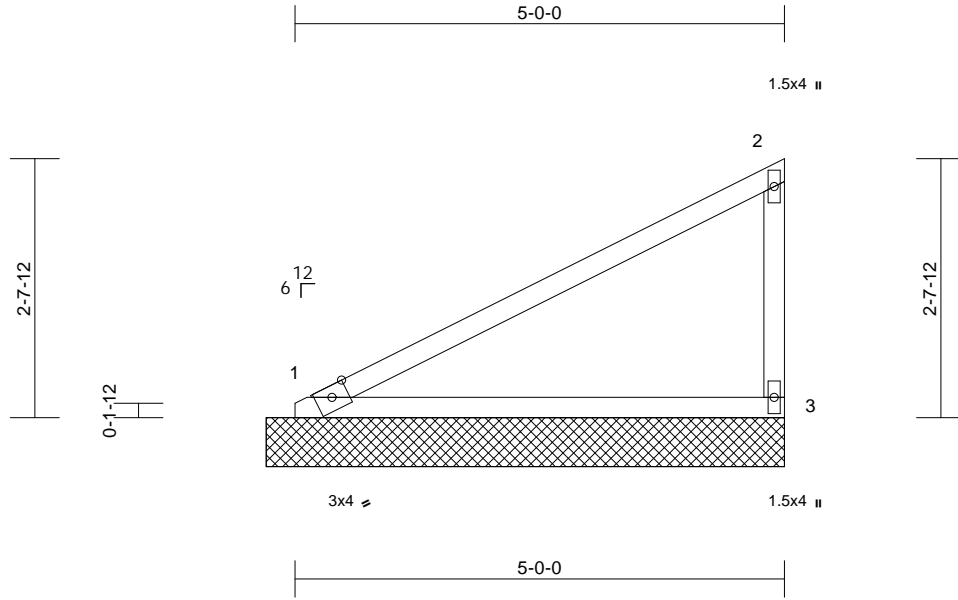

Scale = 1:23.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.48	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	n/a	-	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 10 lb FT = 20%

#### LUMBER

TOP CHORD 2x3 SPF No.2  
BOT CHORD 2x3 SPF No.2  
WEBS 2x3 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

#### BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 1=5-3-9, 3=5-3-9  
Max Horiz 1=104 (LC 12)  
Max Uplift 1=-20 (LC 12), 3=-72 (LC 12)  
Max Grav 1=213 (LC 1), 3=213 (LC 1)

#### FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-111/59, 2-3=-165/197  
BOT CHORD 1-3=0/0

#### NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 20 lb uplift at joint 1 and 72 lb uplift at joint 3.



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V8	Valley	1	1	Job Reference (optional)	I64525093

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:X3j9csSdTd?hyQgxh8rn6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

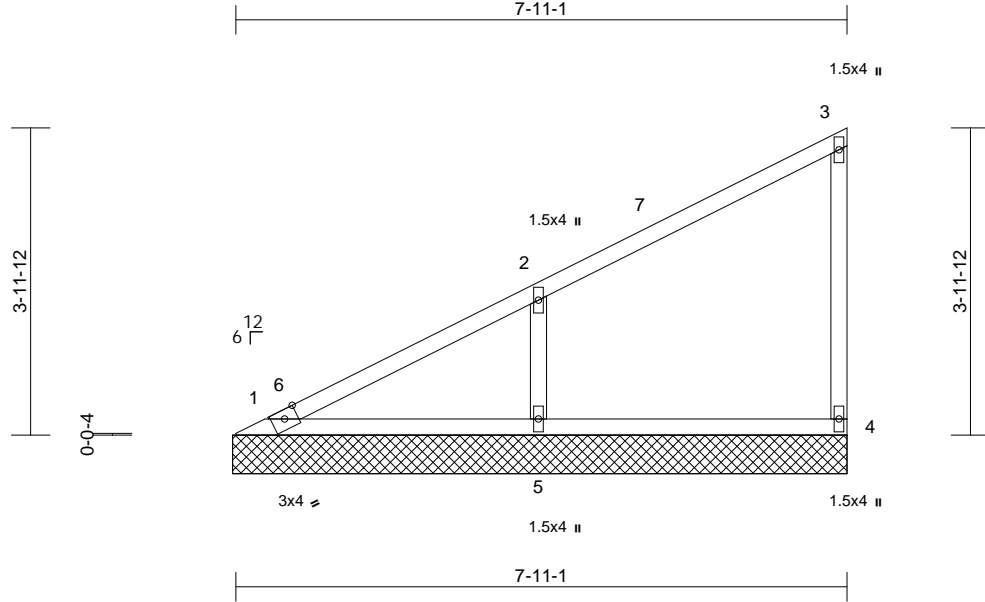

Scale = 1:29.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	n/a	-	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 17 lb	FT = 20%

#### LUMBER

TOP CHORD	2x3 SPF No.2
BOT CHORD	2x3 SPF No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=7-11-9, 4=7-11-9, 5=7-11-9
	Max Horiz	1=162 (LC 12)
	Max Uplift	4=-46 (LC 12), 5=-142 (LC 12)
	Max Grav	1=113 (LC 1), 4=136 (LC 1), 5=417 (LC 1)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-237/110, 2-3=-81/35, 3-4=-105/109
BOT CHORD	1-5=0/0, 4-5=0/0
WEBS	2-5=-324/335

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;  
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)  
exterior zone and C-C Exterior(2E) 0-5-9 to 5-5-9,  
Interior (1) 5-5-9 to 7-10-5 zone; cantilever left and right  
exposed; end vertical left exposed; C-C for members  
and forces & MWFRS for reactions shown; Lumber  
DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss  
only. For studs exposed to wind (normal to the face),  
see Standard Industry Gable End Details as applicable,  
or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- 6) All bearings are assumed to be SPF No.2 crushing  
capacity of 425 psi.

- 7) Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 46 lb uplift at joint  
4 and 142 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	I64525094
P240300	V9	Valley	1	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:X3j9csSdTd?hyQgxh8m6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

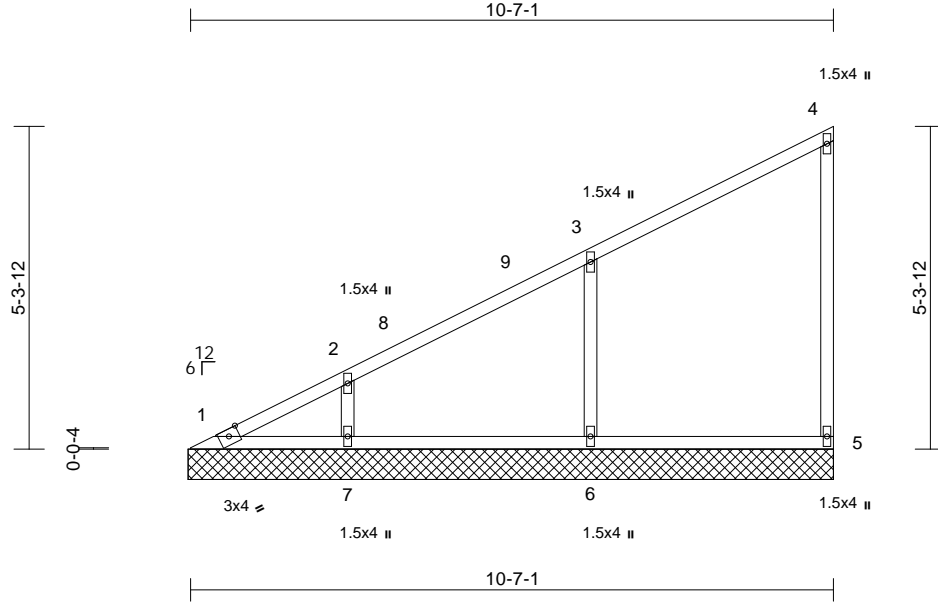

Scale = 1:38

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.41	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.21	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.09	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S						Weight: 25 lb	FT = 20%

#### LUMBER

TOP CHORD	2x3 SPF No.2
BOT CHORD	2x3 SPF No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

<b>REACTIONS</b> (size)	1=10-7-9, 5=10-7-9, 6=10-7-9, 7=10-7-9
Max Horiz	1=220 (LC 12)
Max Uplift	5=-49 (LC 12), 6=-135 (LC 12), 7=-105 (LC 12)
Max Grav	1=91 (LC 21), 5=143 (LC 1), 6=399 (LC 1), 7=304 (LC 1)

#### FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-299/129, 2-3=-212/91, 3-4=-83/44, 4-5=-110/101
BOT CHORD	1-7=-4/6, 6-7=-4/6, 5-6=-4/6
WEBS	3-6=-311/285, 2-7=-235/220

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-5-9 to 5-5-9, Interior (1) 5-5-9 to 10-6-5 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.

- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 49 lb uplift at joint 5, 135 lb uplift at joint 6 and 105 lb uplift at joint 7.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



March 28, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21


Job	Truss	Truss Type	Qty	Ply	Roof	
P240300	V10	Valley	1	1		I64525095
Job Reference (optional)						

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Nov 1 2023 Print: 8.630 S Nov 1 2023 MiTek Industries, Inc. Wed Mar 27 13:59:20

Page: 1

ID:X3j9csSdTd?hyQgxh8rn6OzwvzW-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

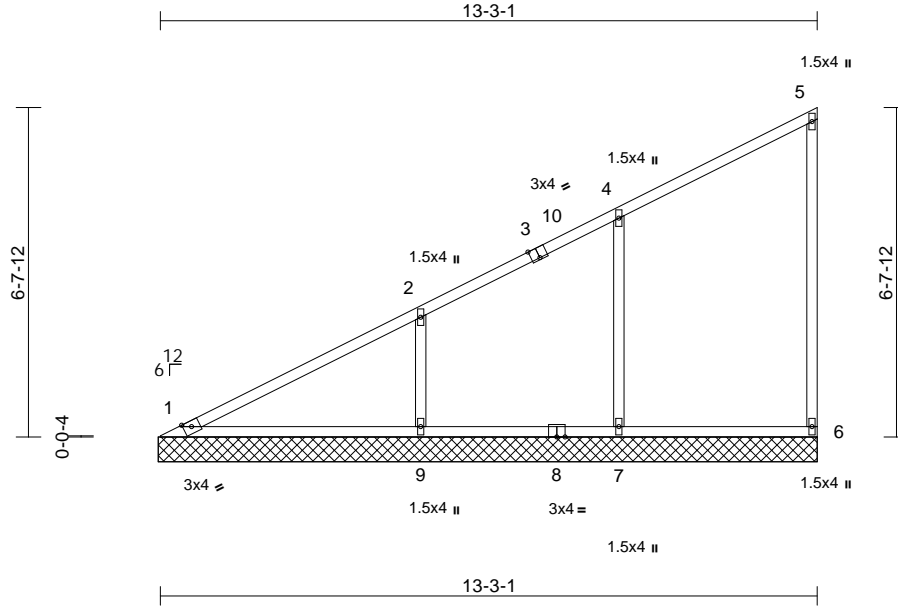

Scale = 1:46.5

Plate Offsets (X, Y): [3:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(TL)	n/a	-	n/a	999	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.14	Horiz(TL)	0.00	6	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 33 lb FT = 20%

#### LUMBER

TOP CHORD	2x3 SPF No.2
BOT CHORD	2x3 SPF No.2
WEBS	2x3 SPF No.2
OTHERS	2x3 SPF No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	1=13-3-9, 6=13-3-9, 7=13-3-9, 9=13-3-9
Max Horiz	1=278 (LC 12)
Max Uplift	6=-52 (LC 12), 7=-121 (LC 12), 9=-157 (LC 12)
Max Grav	1=179 (LC 1), 6=151 (LC 1), 7=357 (LC 1), 9=459 (LC 1)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-317/141, 2-4=-185/76, 4-5=-82/47, 5-6=-115/95
BOT CHORD	1-9=-3/5, 7-9=-3/5, 6-7=-3/5
WEBS	4-7=-282/228, 2-9=-346/264

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-5-9 to 5-3-9, Interior (1) 5-3-9 to 13-2-5 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 4-0-0 oc.

- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 6, 121 lb uplift at joint 7 and 157 lb uplift at joint 9.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



March 28, 2024



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21

# Symbols

## PLATE LOCATION AND ORIENTATION

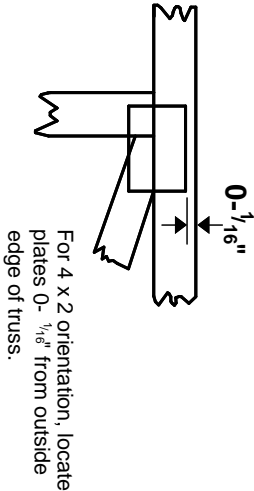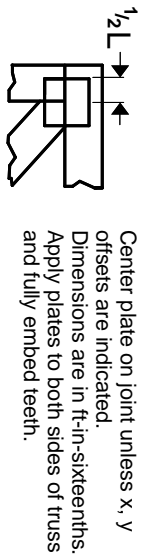

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

## PLATE SIZE


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

**Industry Standards:**  
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

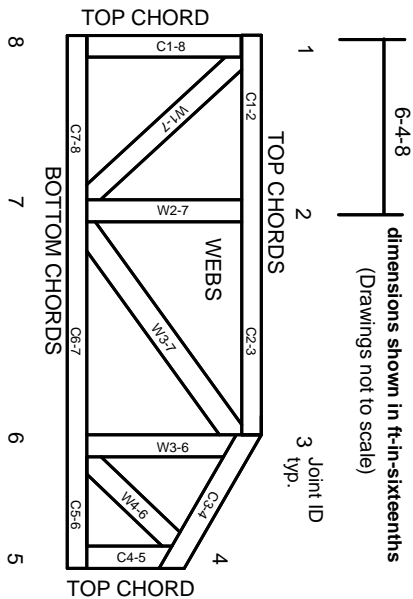

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## Product Code Approvals

ICC-ES Reports:  
ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

## Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
04/19/2024 3:51:21