

ALL FITTINGS CONFORM TO SECTION 2-4 OF NFPA PAMPHLET 13.

VALVES ON CONNECTIONS TO WATER SUPPLIES, SECTIONAL CONTROL VALVES AND OTHER VALVES IN SUPPLY PIPES TO SPRINKLERS SHALL BE SUPERVISED OPEN BY AN APPROVED METHOD.

IT IS THE OWNERS RESPONSIBILITY TO PROVIDE ADEQUATE HEAT TO KEEP THE SPRINKLER SYSTEM FROM FREEZING.

ALL ELECTRICAL WIRING OF ALARM BELLS, FLOW SWITCHES AND TAMPER SWITCHES (IF REQUIRED) TO BE DONE BY OTHERS.

THE SPRINKLER SYSTEM TO BE INSTALLED IN ACCORDANCE WITH NFPA 13.

HANGERS TO BE SPACED TO MEET NFPA REQUIREMENTS

PER NFPA 13, SECTION 8.6.3.2.4, WITHIN SMALL ROOMS AS DEFINED IN SECTION 3.3.20, SPRINKLERS SHALL BE PERMITTED TO BE LOCATED NOT MORE THAN 9 FT. FROM ANY SINGLE WALL, AND SPRINKLER SPACING LIMITATIONS OF SECTION 8.6.3 AND AREA LIMITATIONS OF TABLE 8.6.2.2.1(a) SHALL NOT BE EXCEEDED. JFS MAY MODIFY HEADS SHOWN ON THIS DRAWING TO COMPLY WITH THIS RULE.

CL = CENTER LINE OF PIPE BELOW TOP OF STEEL


EL = CENTER LINE OF PIPE ABOVE FINISHED FLOOR

BUILDING CODE:
IBC-2018
OCCUPANCY GROUP: B
CONSTRUCTION TYPE: II-B


PER NFPA 13, 2016 EDITION:
SYSTEM TYPE: WET
ORDINARY HAZARD GROUP I
MAXIMUM 130 S.F. SPRINKLER SPACING

STEEL BEAM AND BAR JOISTS

1. ALL GROOVED MAIN PIPING IS TO BE SCHED. 10 PIPE
2. ALL GROOVED BRANCHLINE PIPING TO BE SCH. 10 PIPE
3. ALL THREADED PIPING TO BE SCH. 40 PIPE
4. ALL FITTINGS TO BE DUCTILE IRON
5. THIS RENOVATION WILL NOT ALTER THE EXISTING CALCULATIONS
THEREFORE NEW CALCULATIONS WILL NOT BE NEEDED.

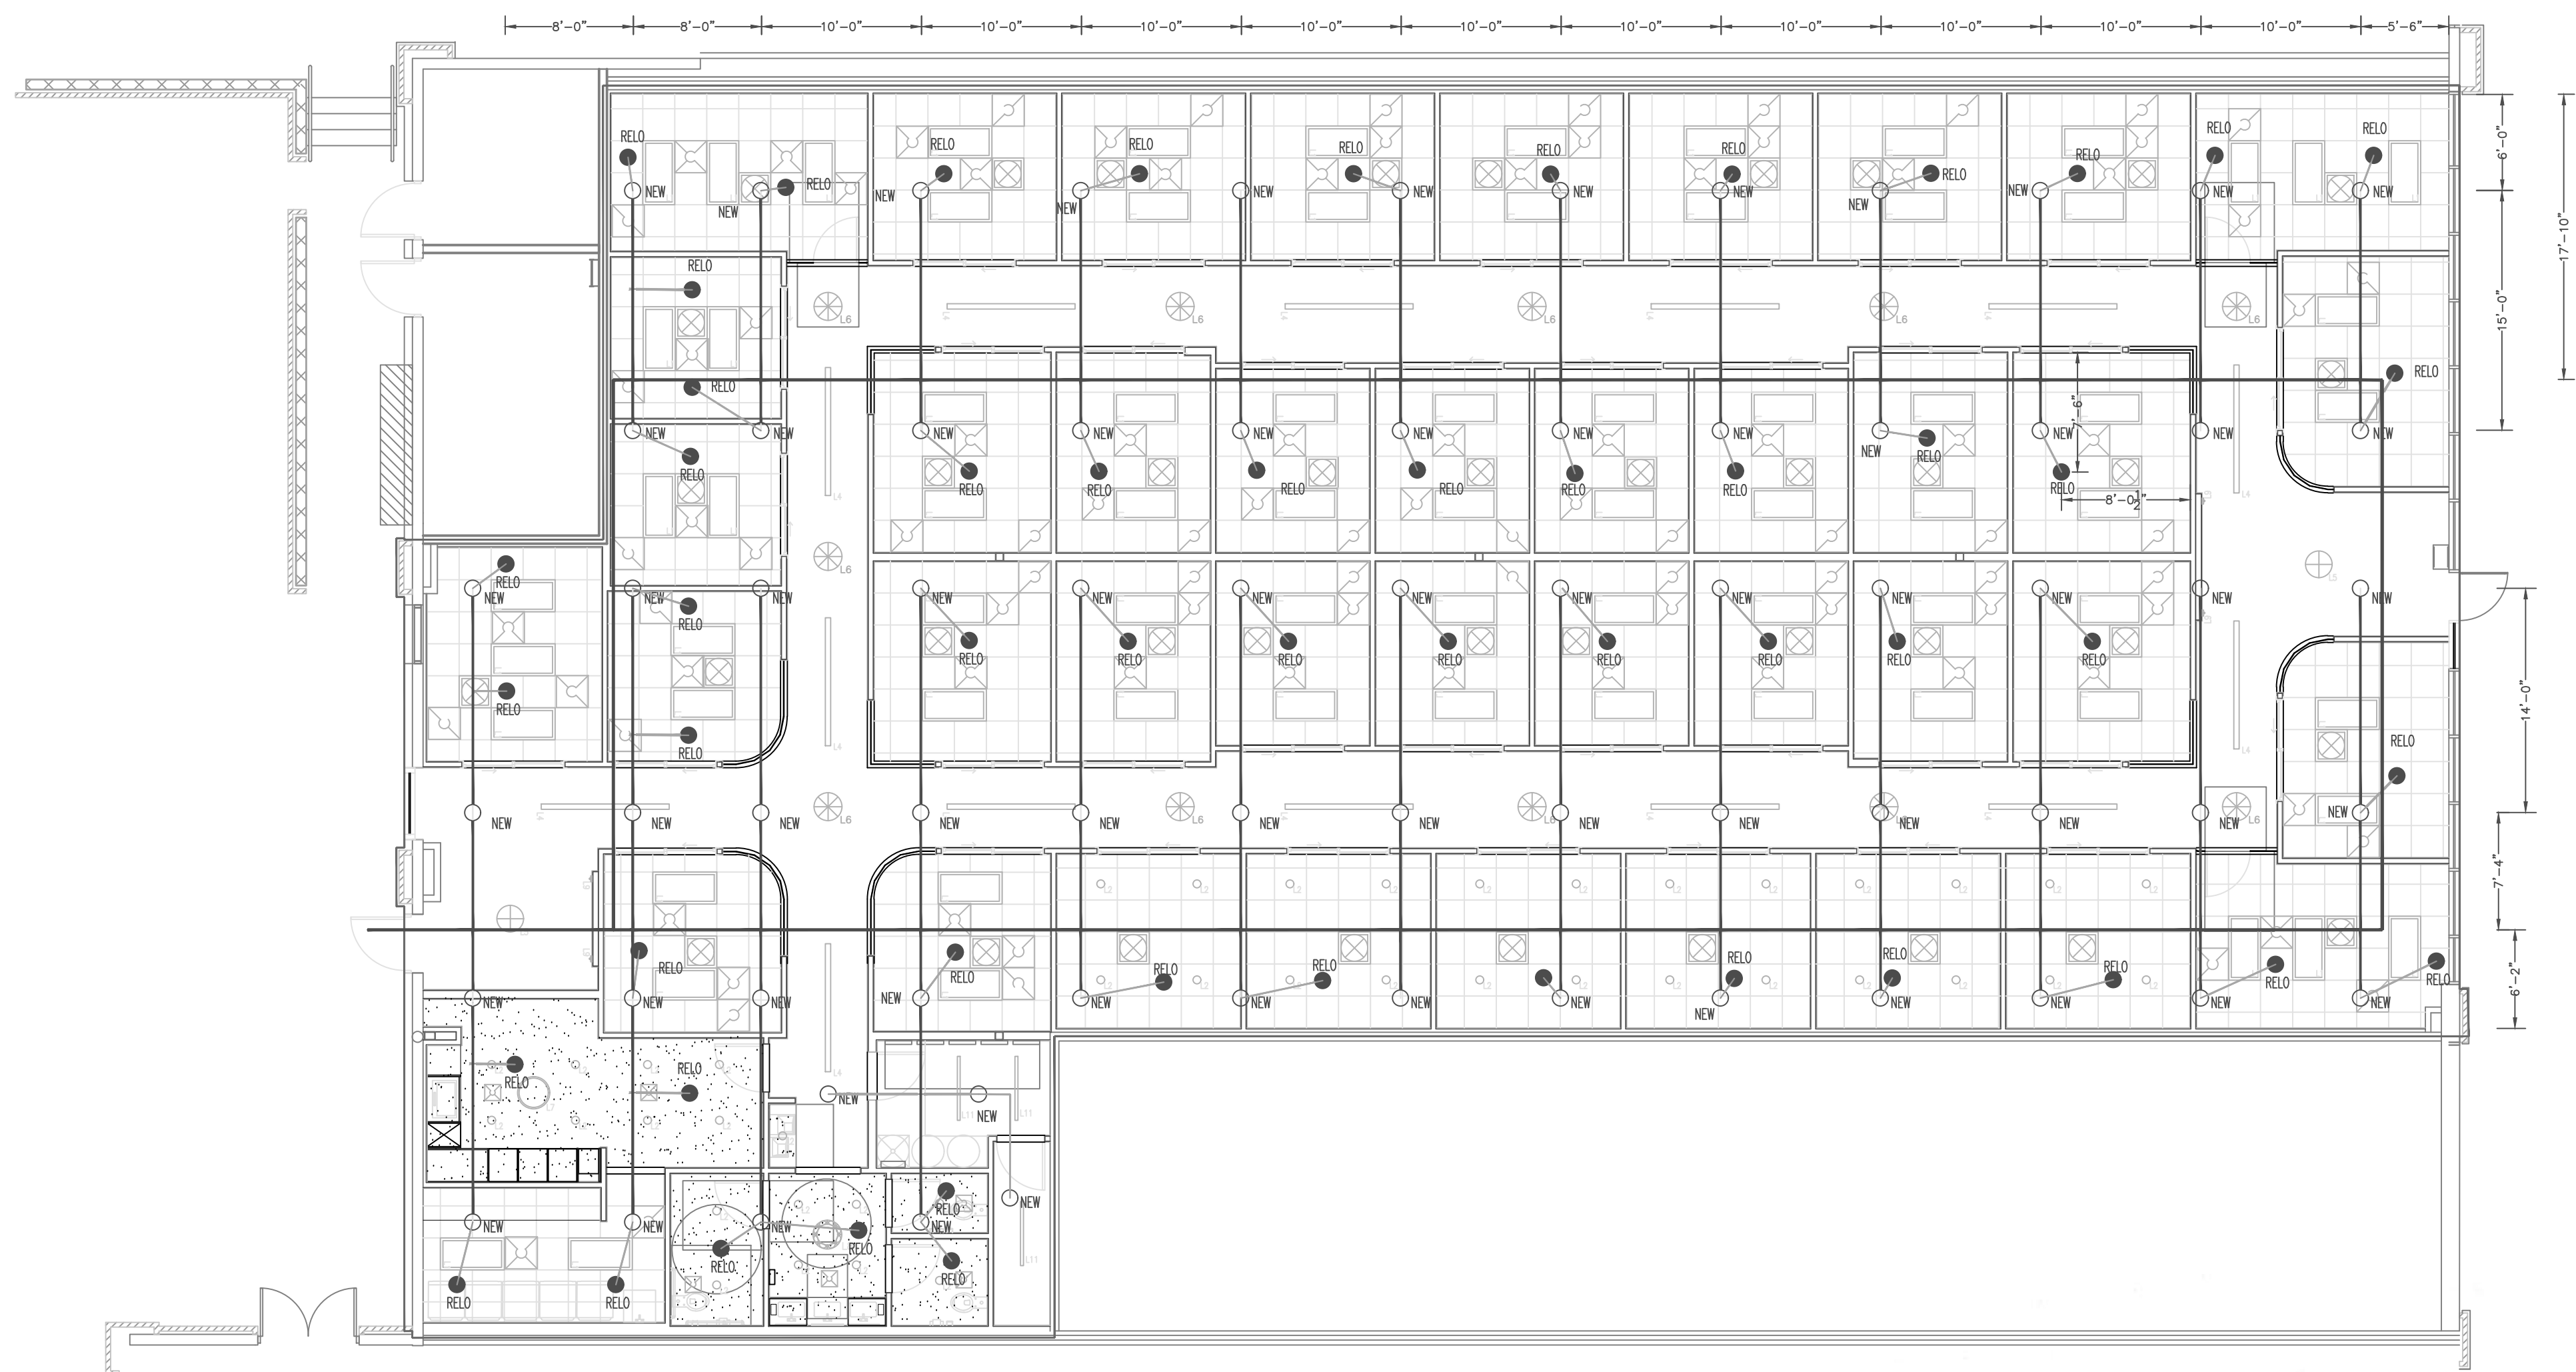

	HANGER SPACING TABLE										
NOMINAL PIPE SIZE	¾"	1"	1½"	2"	2½"	3"	3½"	4"	5"	6"	8"
STEEL PIPE EXCEPT THREADED LIGHTWALL	N/A	12-0	12-0	15-0	15-0	15-0	15-0	15-0	15-0	15-0	15-0
THREADED LIGHTWALL STEEL PIPE	N/A	12-0	12-0	12-0	12-0	12-0	N/A	N/A	N/A	N/A	N/A
COPPER TUBE	8-0	8-0	10-0	10-0	12-0	12-0	12-0	15-0	15-0	15-0	15-0
CPVC	5-6	6-6	6-6	7-0	8-0	9-0	10-0	N/A	N/A	N/A	N/A

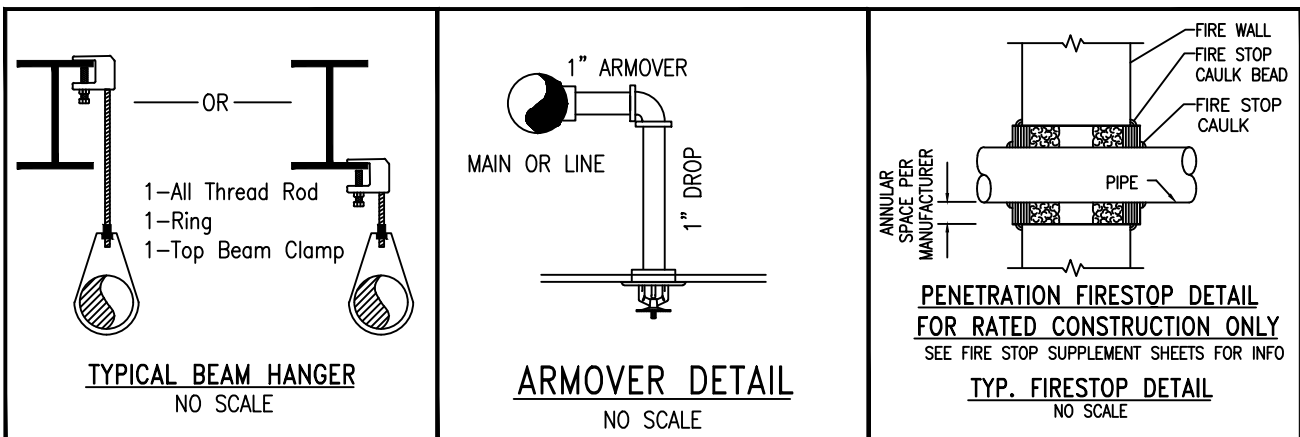

05/09/2024



MEP Engineering Group
Certificate of Authority #2016015108
mepengineeringgroup@gmail.com
(816)778-1195

FLOOR Plan
SCALE: 1/8" = 1'-0"



General Notes

1. All Pipe Locations are to be Field Measured Prior to Fabrication and Installation by Sprinkler Contractor.
2. All Pipe Dimensions Shown are **Center to Center**.
3. High Temperature Heads are to be Field Located Where Required.
4. All Pipes and Hangers are to be Installed per NFPA #13.
5. Hangers are to be U.L. Listed and F.M. Approved.

IMAGE STUDIOS
840-D NW BLUE PARKWAY
LEE'S SUMMIT, MO. 64086

13906 CENTURY LANE
GRANDVIEW, MO 64030
(816) 737-9991

