



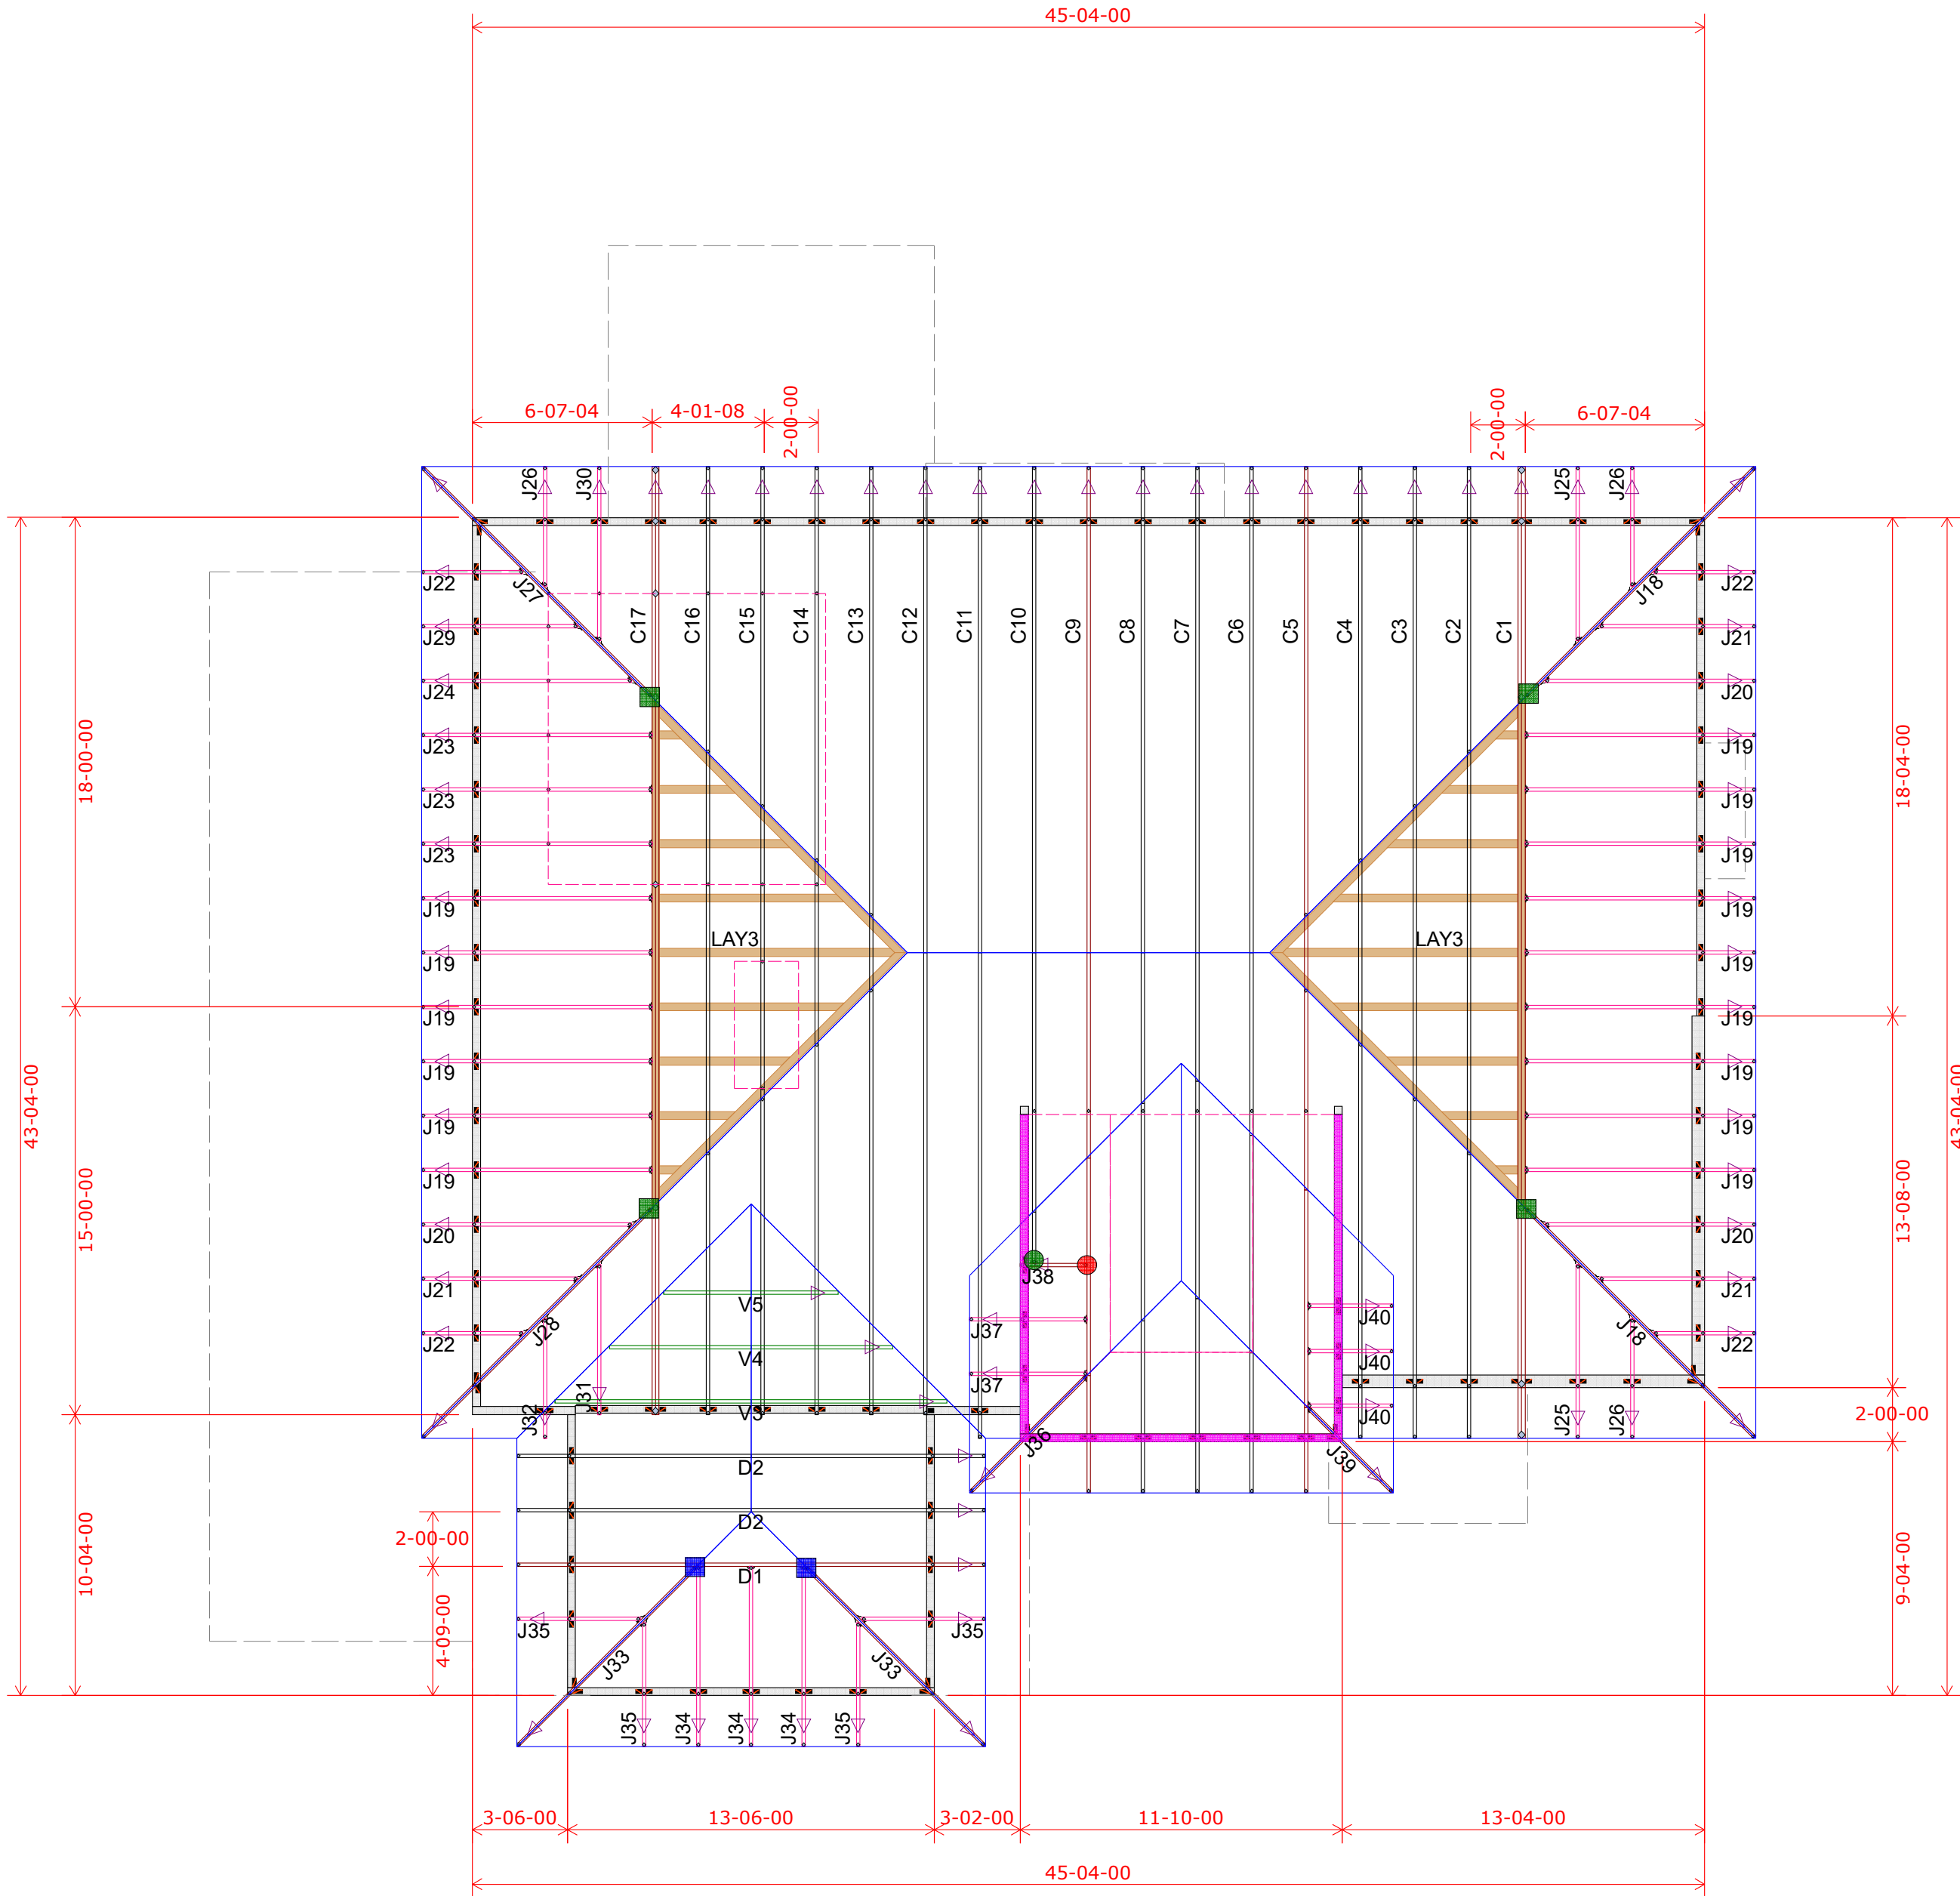

Roof Truss Layout
Scale: 3/16" = 1'

HANGER SCHEDULE	Quantity
● LUS24	2
● LUS26	0
● HUS26	1
▲ HHUS26-2	0
▲ HGUS26-2	0
▲ HGUS28-3	0
■ LTHJA26	0
■ TJC37	5
■ TJC57	4
▲ HTS20	0

Triangle denotes the left end of the Truss as it appears on the Engineered Drawings provided.



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

# of Uplift	Connector
0 - 495:	(1) H2.5A
495 - 990:	(2) H2.5A
990 - 1245:	(1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

Wall Heights:
1st Floor = 9-1-2 U.N.O.
2nd Floor = 8-1-2 U.N.O.

Plate Heights
10-01-02

Customer	Job Name	Job Site Address	City,	State	Designer	Job #
Steven Kempenar	Lot 198 Woodside Ridge	2213 NW Killarney Ln	Lee's Summit	MO	Chuck Haspels	(785) 746-4266

Shop Drawing Approval
THIS IS A TRUSS LAYOUT. THESE TRUSSES ARE DESIGNED AS INDIVIDUAL BUILDING COMPONENTS TO BE INCORPORATED INTO THE BUILDING DESIGN AT THE SPECIFICATION OF THE BUILDING DESIGNER. SEE INDIVIDUAL DESIGN SHEETS FOR EACH TRUSS DESIGN IDENTIFIED ON THE PLACEMENT DRAWING. THE BUILDING DESIGNER IS RESPONSIBLE FOR TEMPORARY AND PERMANENT BRACING OF THE TRUSSES DURING CONSTRUCTION. THE TRUSSES ARE NOT TO BE USED AS BRACING FOR THE BUILDING OR FOR OTHER STRUCTURAL PURPOSES. THE TRUSSES ARE NOT TO BE USED AS BRACING FOR THE BUILDING OR FOR OTHER STRUCTURAL PURPOSES. THE TRUSSES ARE NOT TO BE USED AS BRACING FOR THE BUILDING OR FOR OTHER STRUCTURAL PURPOSES.
THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.
Approved By: _____ Date: _____

Wheeler Lumber
1959 Old Hwy 50 NE
Waverly, KS 66871