

05/16/2024



RE: P240420-01
Roof - HR Lot 116

MiTek, Inc.

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer: Clayton Properties Project Name: P240420-01
Lot/Block: 116 Model:
Address: 3229 SW Arbortree Dr Subdivision: Hawthorn Ridge
City: Lee's Summit State: MO

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.6
Wind Code: ASCE 7-16 Wind Speed: 115 mph
Roof Load: 45.0 psf Floor Load: N/A psf

This package includes 25 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I64930663	A01	4/17/2024	21	I64930683	V01	4/17/2024
2	I64930664	A02	4/17/2024	22	I64930684	V02	4/17/2024
3	I64930665	A03	4/17/2024	23	I64930685	V03	4/17/2024
4	I64930666	A04	4/17/2024	24	I64930686	V04	4/17/2024
5	I64930667	B01	4/17/2024	25	I64930687	V05	4/17/2024
6	I64930668	C01	4/17/2024				
7	I64930669	C02	4/17/2024				
8	I64930670	C03	4/17/2024				
9	I64930671	C04	4/17/2024				
10	I64930672	C05	4/17/2024				
11	I64930673	C06	4/17/2024				
12	I64930674	C07	4/17/2024				
13	I64930675	C08	4/17/2024				
14	I64930676	C09	4/17/2024				
15	I64930677	CJ01	4/17/2024				
16	I64930678	J01	4/17/2024				
17	I64930679	J02	4/17/2024				
18	I64930680	LG01	4/17/2024				
19	I64930681	PB1	4/17/2024				
20	I64930682	PB2	4/17/2024				

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by .

Truss Design Engineer's Name: Johnson, Andrew

My license renewal date for the state of Missouri is December 31, 2025.

Missouri COA: 001193

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



April 17, 2024


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	A01	Hip Girder	1	2	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930663 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:54 Page: 1

ID:b9dePyA7oPj7n2spiefnYhzkXH5-RfC?PsB70Hq3NSgPqnL8w3uITxbGKVrCDoi7J4zJCn

05/16/2024

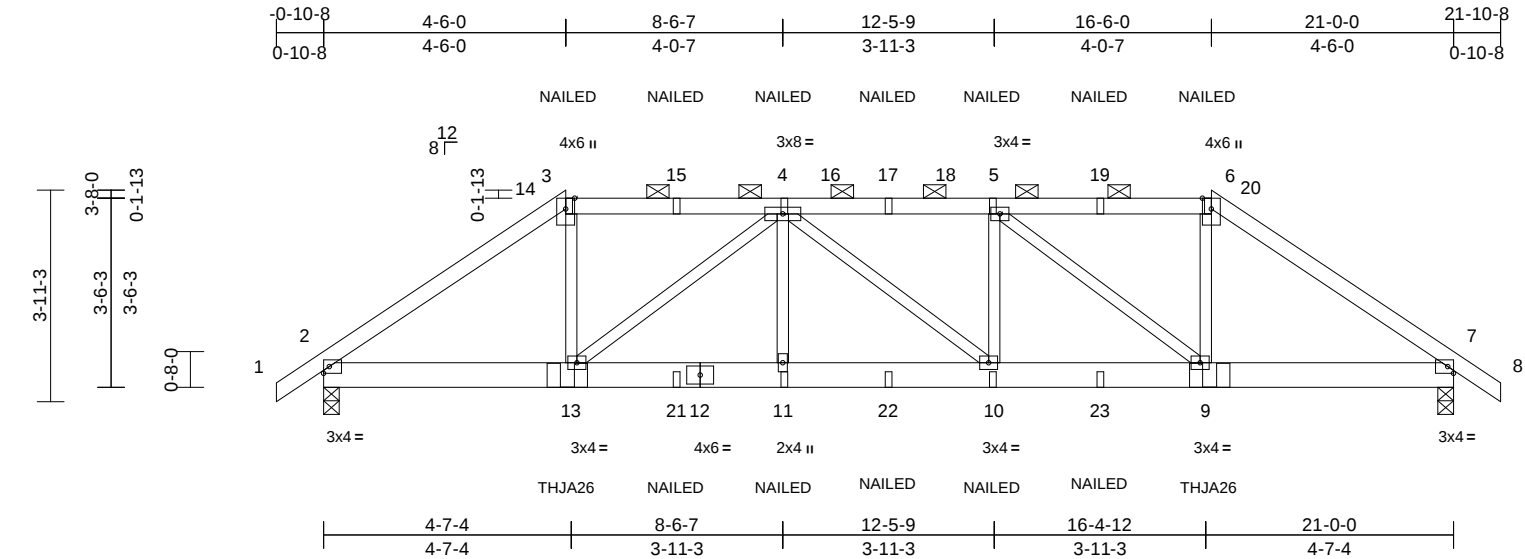

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	0.05	10-11	>999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.08	10-11	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.17	Horz(CT)	0.02	7	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 191 lb FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x6 SPF No.2
WEBS	2x3 SPF No.2
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-6.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS (size) 2=0-3-8, 7=0-3-8	
Max Horiz 2=98 (LC 11)	
Max Uplift 2=-536 (LC 12), 7=-536 (LC 13)	
Max Grav 2=1596 (LC 1), 7=1596 (LC 1)	
FORCES (lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/21, 2-3=-2349/858, 3-4=-1852/750, 4-5=-2598/1040, 5-6=-1852/743, 6-7=-2350/863, 7-8=0/21
BOT CHORD	2-13=-704/1817, 11-13=-1010/2603, 10-11=-1010/2603, 9-10=-990/2598, 7-9=-631/1818
WEBS	3-13=-296/980, 4-13=-1009/452, 4-11=0/251, 4-10=-28/27, 5-10=0/249, 5-9=-1001/446, 6-9=-296/980

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x3 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 4-6-0, Exterior(2R) 4-6-0 to 11-6-14, Interior (1) 11-6-14 to 16-6-0, Exterior(2E) 16-6-0 to 21-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 536 lb uplift at joint 2 and 536 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie THJA26 (THJA26 on 2 ply, Left Hand Hip) or equivalent at 4-6-6 from the left end to connect truss(es) to front face of bottom chord.
- Use Simpson Strong-Tie THJA26 (THJA26 on 2 ply, Right Hand Hip) or equivalent at 16-5-10 from the left end to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-70, 3-6=-70, 6-8=-70, 2-7=-20
Concentrated Loads (lb)
Vert: 3=-79 (F), 6=-79 (F), 13=-254 (F), 4=-79 (F), 11=-24 (F), 10=-24 (F), 5=-79 (F), 9=-254 (F), 15=-79 (F), 17=-79 (F), 19=-79 (F), 21=-24 (F), 22=-24 (F), 23=-24 (F)



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	A02	Hip	1	1	Job Reference (optional)


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
164930664
LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:55 Page: 1

ID: xNyy1URwdAV?QQY2_F2xRKzkXGI-RfC?PsB70Hq3NSgPqnL8w3ulTXb6KWrcD6HJ42JC2?

05/16/2024

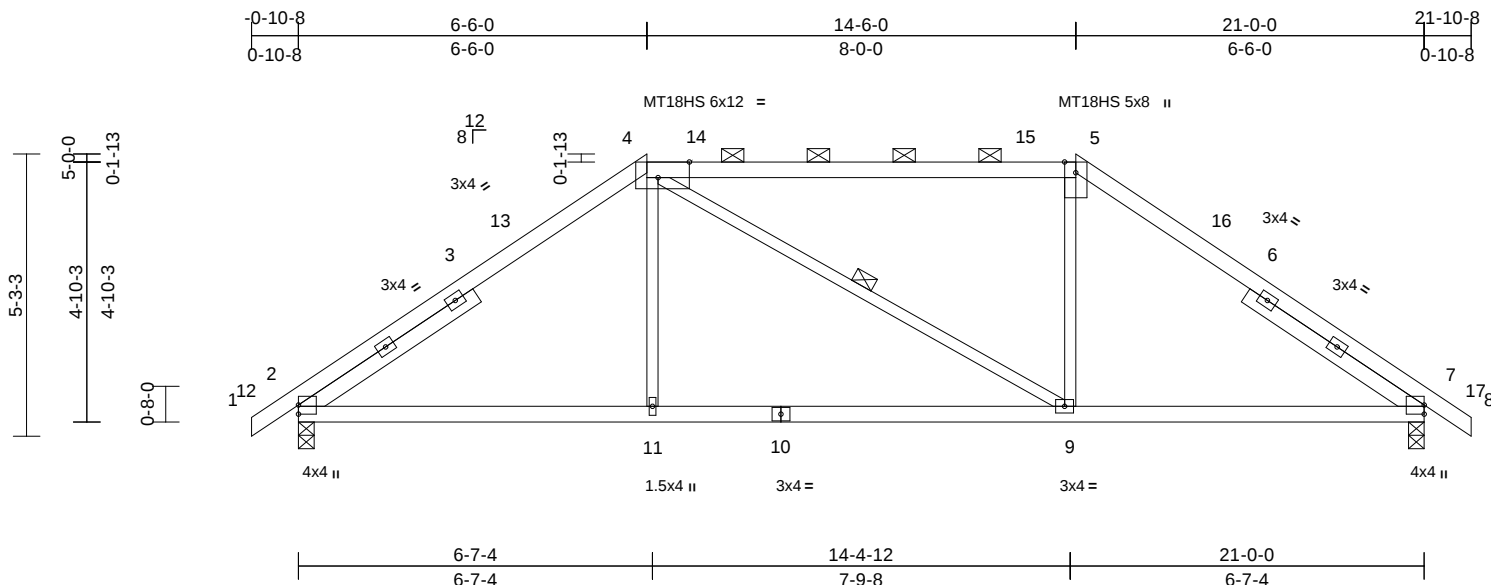

Scale = 1:43

Plate Offsets (X, Y): [4:0-7-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.07	9-11	>999	240	MT18HS	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.53	Vert(CT)	-0.15	9-11	>999	180	MT20	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horz(CT)	0.03	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 96 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 *Except* 4-5:2x4 SP 1650F 1.5E
BOT CHORD 2x4 SP No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 3-11-1, Right 2x4 SP No.2 -- 3-11-1

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-1-1 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 4-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 4-9

REACTIONS (size) 2=0-3-8, 7=0-3-8
Max Horiz 2=-136 (LC 10)
Max Uplift 2=-125 (LC 12), 7=-125 (LC 13)
Max Grav 2=1006 (LC 1), 7=1006 (LC 1)


FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/16, 2-4=-1287/212, 4-5=-975/245, 5-7=-1287/211, 7-8=0/16
BOT CHORD 2-11=-133/971, 9-11=-131/975, 7-9=-57/971
WEBS 4-11=0/307, 4-9=-117/118, 5-9=0/307

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 6-6-0, Exterior(2R) 6-6-0 to 13-6-14, Interior (1) 13-6-14 to 14-6-0, Exterior(2R) 14-6-0 to 21-6-14, Interior (1) 21-6-14 to 21-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 125 lb uplift at joint 2 and 125 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

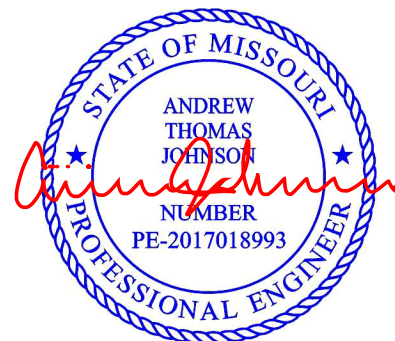LOAD CASE(S) Standard

April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	A03	Hip	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930665 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:56 Page: 1

ID:fJZk7uYBGfIbdyJzaMEHrRzkXGb-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi734z3C?

05/16/2024

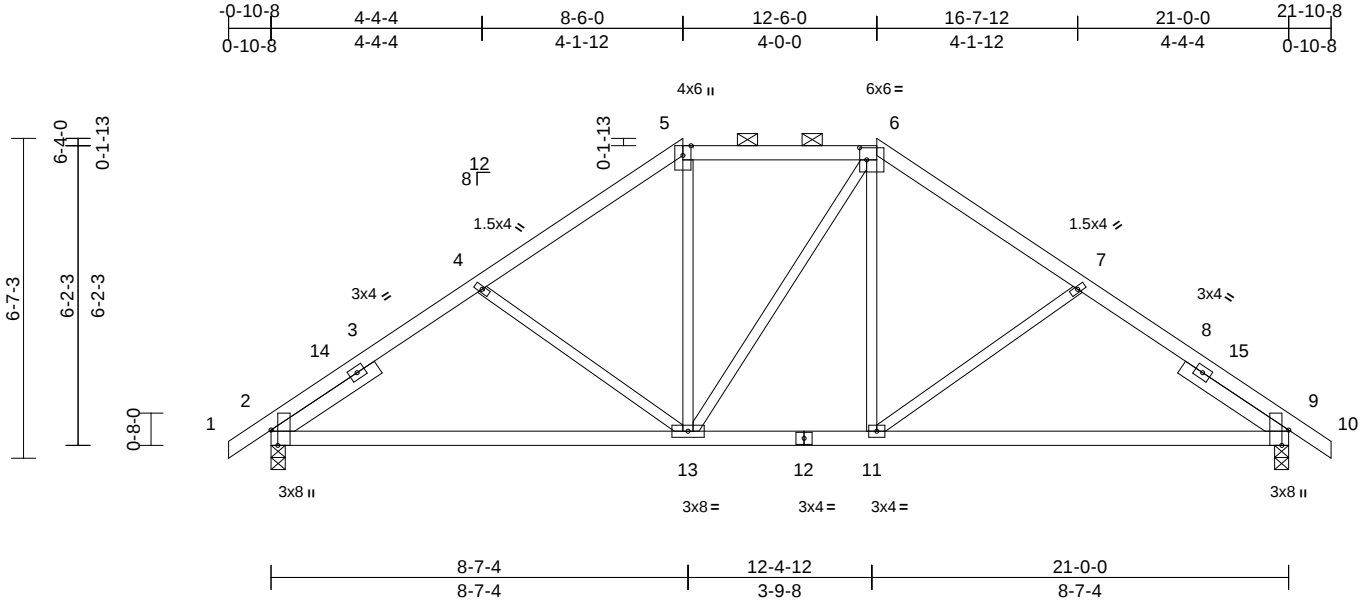

Scale = 1:47.5

Plate Offsets (X, Y): [2:0-3-13,Edge], [6:0-1-12,0-3-0], [9:0-3-13,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.15	9-11	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.31	9-11	>802	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.03	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 102 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x3 SPF No.2
SLIDER	Left 2x4 SP No.2 -- 2-6-14, Right 2x4 SP No.2 -- 2-6-14

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-3-3 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=0-3-8, 9=0-3-8
Max Horiz	2=173 (LC 11)
Max Uplift	2=-143 (LC 12), 9=-143 (LC 13)
Max Grav	2=1006 (LC 1), 9=1006 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/16, 2-4=-1295/252, 4-5=-1064/218, 5-6=-826/225, 6-7=-1064/214, 7-9=-1294/229, 9-10=0/16
BOT CHORD	2-13=-185/991, 11-13=-4/826, 9-11=-112/991
WEBS	4-13=-254/200, 5-13=-24/287, 6-13=-108/110, 6-11=-42/287, 7-11=-255/200

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-2-11, Interior (1) 4-2-11 to 8-6-0, Exterior(2E) 8-6-0 to 12-6-0, Exterior(2R) 12-6-0 to 19-6-14, Interior (1) 19-6-14 to 21-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 143 lb uplift at joint 2 and 143 lb uplift at joint 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	A04	Hip Girder	1	3	Job Reference (optional)


RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
164930666
LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:56 Page: 1

ID:nfQL9Uxqcg1p1xCJTAka3zkX73-RfC?PsB70Hq3NSgPqnL8w3uITXbGK1WrCDoi7J42JC1

05/16/2024

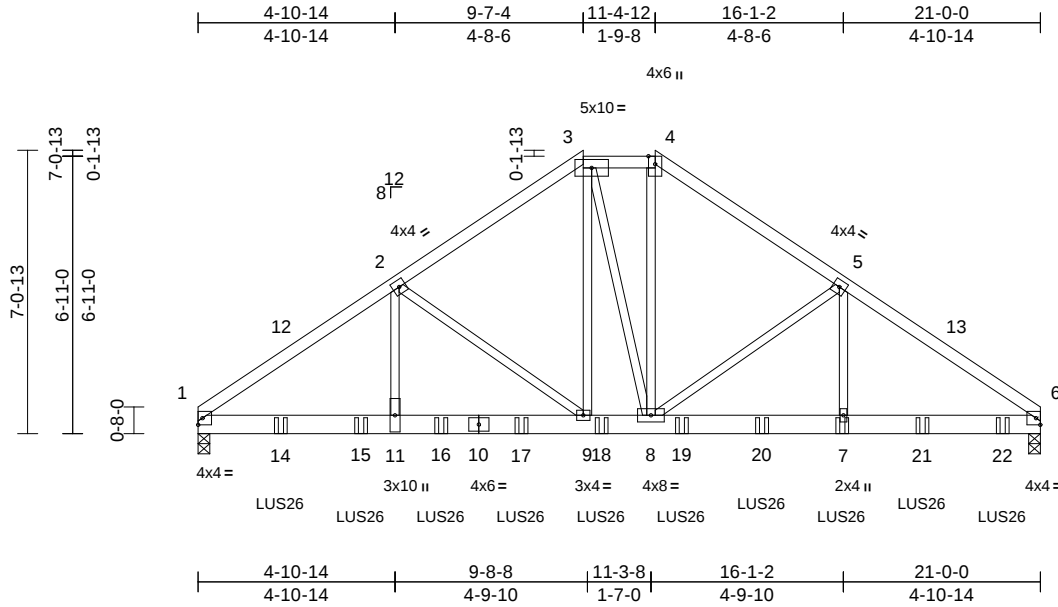

Scale = 1:57.5

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.07	9-11	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.12	9-11	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.27	Horz(CT)	0.04	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 314 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SPF No.2
WEBS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=0-3-8, 6=0-3-8
Max Horiz 1=-184 (LC 8)
Max Uplift 1=-1069 (LC 12), 6=-1208 (LC 13)
Max Grav 1=4948 (LC 19), 6=5373 (LC 20)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-7206/1600, 2-3=-5003/1199,
3-4=-4222/1060, 4-5=-5067/1225,
5-6=-7179/1621

BOT CHORD 1-11=-1312/5869, 9-11=-1312/5869,
8-9=-865/4221, 7-8=-1240/5709,
6-7=-1240/5709

WEBS 2-11=-464/2440, 2-9=-2092/566,
3-9=-555/2350, 3-8=-144/336,
4-8=-610/2576, 5-8=-1993/579,
5-7=-482/2335

NOTES

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.
Web connected as follows: 2x3 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-1-12 to 4-10-14, Interior (1) 4-10-14 to 9-7-4, Exterior(2E) 9-7-4 to 11-4-12, Exterior(2R) 11-4-12 to 18-5-10, Interior (1) 18-5-10 to 20-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 crushing capacity of 425 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1069 lb uplift at joint 1 and 1208 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 20-0-12 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 1-6=-20

Concentrated Loads (lb)

Vert: 7=-767 (B), 14=-805 (B), 15=-805 (B), 16=-767 (B), 17=-767 (B), 18=-767 (B), 19=-767 (B), 20=-767 (B), 21=-767 (B), 22=-769 (B)



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	B01	Common Supported Gable	1	1	Job Reference (optional)

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:56 Page: 1

ID: bzCw6On6o49uPtGdBr3k7RzkXGI-RfC?PsB70Hq3NSgPqnL8w3ulTXbGfWwrCDoi7j4z3C?

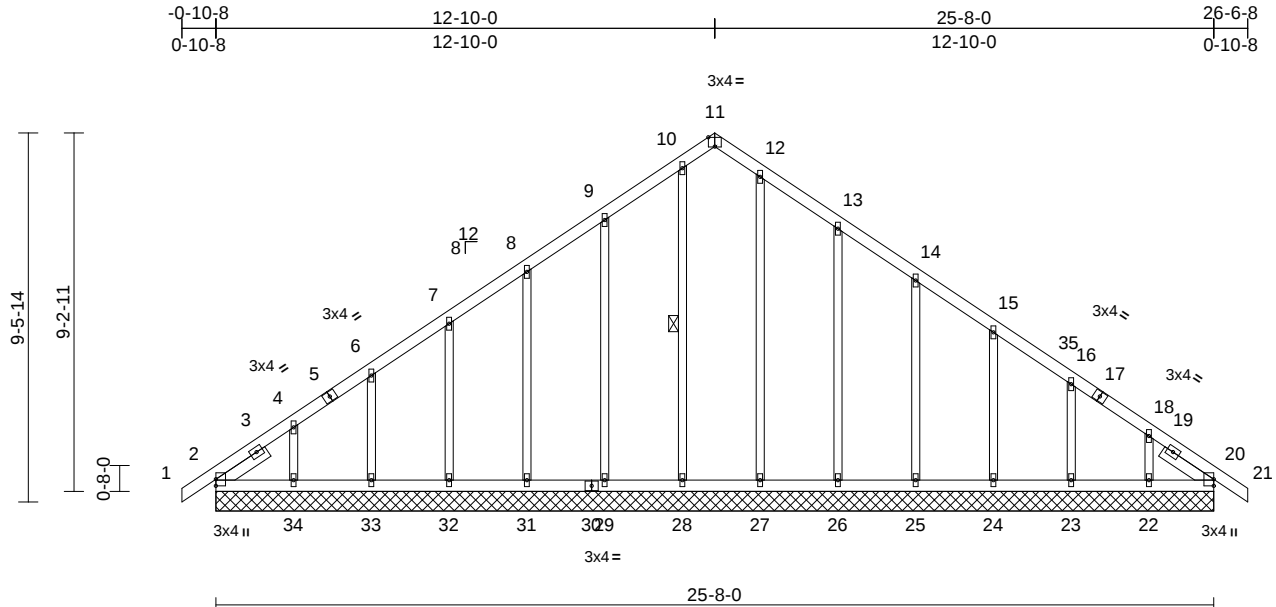

Scale = 1:59.3

Plate Offsets (X, Y): [11:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.20	Horz(CT)	0.01	20	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 138 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 1-6-4, Right 2x4 SP No.2
 -- 1-6-5

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS	1 Row at midpt	10-28
------	----------------	-------

REACTIONS (size) 2=25-8-0, 20=25-8-0, 22=25-8-0,
23=25-8-0, 24=25-8-0, 25=25-8-0,
26=25-8-0, 27=25-8-0, 28=25-8-0,
29=25-8-0, 31=25-8-0, 32=25-8-0,
33=25-8-0, 34=25-8-0

Max Horiz 2=255 (LC 11)

Max Uplift 2=-55 (LC 8), 20=-16 (LC 9),
22=-125 (LC 13), 23=-76 (LC 13),
24=-79 (LC 13), 25=-75 (LC 13),
26=-101 (LC 13), 29=-98 (LC 12),
31=-75 (LC 12), 32=-80 (LC 12),
33=-70 (LC 12), 34=-137 (LC 12)

Max Grav 2=215 (LC 21), 20=189 (LC 22),
22=183 (LC 20), 23=192 (LC 20),
24=188 (LC 20), 25=188 (LC 20),
26=197 (LC 20), 27=163 (LC 1),
28=175 (LC 22), 29=192 (LC 19),
31=189 (LC 19), 32=190 (LC 19),
33=186 (LC 19), 34=213 (LC 19)

FORCES

(Ib) - Maximum Compression/Maximum Tension

TOP CHORD

TOP CHORD 1-2=0/16, 2-4=-316/190, 4-6=-211/148,
6-7=-148/125, 7-8=-131/99, 8-9=-116/109,
9-10=-108/160, 10-11=-92/129,
11-12=-101/144, 12-13=-100/143,
13-14=-71/65, 14-15=-86/39, 15-16=-117/64,
16-18=-182/90, 18-20=-280/134, 20-21=0/16

BOT CHORD

32-33=-113/248, 31-32=-113/248,
29-31=-113/248, 28-29=-113/248,
27-28=-113/248, 26-27=-113/248,
25-26=-113/248, 24-25=-113/248,
23-24=-113/248, 22-23=-113/248,
20-22=-113/248

WEBS

WEBS 4-34=-167/156, 6-33=-148/98,
7-32=-149/104, 8-31=-149/99,
9-29=-152/122, 10-28=-135/22,
12-27=-123/0, 13-26=-157/125,
14-25=-148/99, 15-24=-148/103,
16-23=-152/105, 18-22=-144/144

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDF=6.0psf; BCDL=6.0psf; h=35ft;
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)
exterior zone and C-C Corner(3E) 10-0-8 to 4-0-0,
Exterior(2N) 4-0-0 to 12-10-0, Corner(3R) 12-10-0 to
18-0-0, Exterior(2N) 18-0-0 to 26-6-8 zone; cantilever
left and right exposed ; end vertical left and right
exposed; C-C for members and forces & MWFRS for
reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss
only. For studs exposed to wind (normal to the face),
see Standard Industry Gable End Details as applicable,
or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 1.5x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.

- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 2, 137 lb uplift at joint 34, 70 lb uplift at joint 33, 80 lb uplift at joint 32, 75 lb uplift at joint 31, 98 lb uplift at joint 29, 101 lb uplift at joint 26, 75 lb uplift at joint 25, 79 lb uplift at joint 24, 76 lb uplift at joint 23, 125 lb uplift at joint 22 and 16 lb uplift at joint 20.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024



WARNING – Verify design parameters and READ NOTES on THIS and INCLUDED MEMBER REFERENCE PAGE [MRF-7473 Rev. 12/2023](#) BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see [ANSI/TP1 Quality Criteria](#), and [DSB-22](#) available from Truss Plate Institute ([www.tpinst.org](#)) and [BCSI Building Component Safety Information](#) available from the Structural Building Component Association ([www.sbcsccomponents.com](#))

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-LLS.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C01	Piggyback Base Structural Gable	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930668 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:56 Page: 1

ID: ZPE42GuJG2XQkNP0IKB?1ezkXCH-RfC?PsB70Hq3NSgPqnL8w3uITXbKWrCD0rJ42JC?

05/16/2024

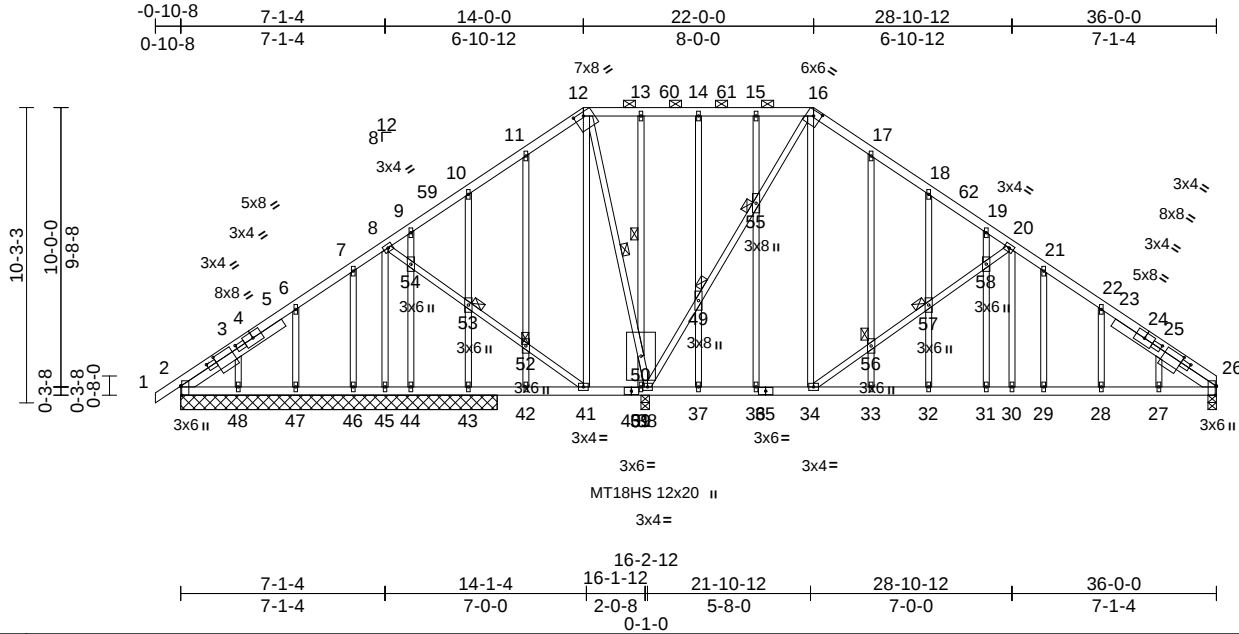

Scale = 1:80.1	[2:0-3-13,Edge], [2:1-1-14,0-1-8], [2:2-4-4,0-1-8], [3:1-5-14,0-2-8], [12:0-4-0,0-1-9], [16:0-3-0,0-2-3], [25:1-5-12,0-2-8], [26:0-3-13,Edge], [26:1-1-12,0-1-8],
Plate Offsets (X, Y):	[26:2-4-1,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	0.09	27-28	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.13	32-33	>999	180	MT18HS	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.02	26	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 252 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x3 SPF No.2
OTHERS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 4-2-10, Right 2x4 SP No.2 -- 4-2-10

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-5-9 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 12-16.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 12-38, 13-50
JOINTS 1 Brace at Jt(s): 49, 52, 53, 55, 56, 57

REACTIONS (size) 2=11-0-0, 26=0-3-8, 38=0-3-8, 39=0-3-8, 43=11-0-0, 44=11-0-0, 45=11-0-0, 46=11-0-0, 47=11-0-0, 48=11-0-0
Max Horiz 2=275 (LC 11)
Max Uplift 2=-82 (LC 8), 26=-165 (LC 13), 38=-195 (LC 9), 39=-462 (LC 25), 43=-150 (LC 12), 44=-10 (LC 12), 45=-10 (LC 9), 46=-49 (LC 12), 47=-96 (LC 12), 48=-89 (LC 12)
Max Grav 2=141 (LC 20), 26=821 (LC 1), 38=1657 (LC 1), 39=214 (LC 9), 43=373 (LC 19), 44=54 (LC 25), 45=133 (LC 25), 46=156 (LC 19), 47=209 (LC 19), 48=194 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/16, 2-3=-237/258, 3-6=-176/239, 6-7=-124/210, 7-8=-91/175, 8-9=-80/147, 9-10=-56/161, 10-11=-62/156, 11-12=-67/193, 12-13=-37/181, 13-14=-38/181, 14-15=-38/181, 15-16=-38/181, 16-17=-353/261, 17-18=-387/209, 18-19=-420/149, 19-20=-476/130, 20-21=-867/284, 21-22=-937/255, 22-25=-967/189, 25-26=-1080/162
BOT CHORD 2-48=-145/176, 47-48=-148/179, 46-47=-148/179, 45-46=-148/179, 44-45=-148/179, 43-44=-148/179, 42-43=-148/179, 41-42=-148/179, 39-41=-155/249, 38-39=-155/249, 37-38=0/312, 36-37=0/312, 34-36=0/312, 33-34=-62/780, 32-33=-62/780, 31-32=-62/780, 30-31=-62/780, 29-30=-62/780, 28-29=-62/780, 27-28=-62/780, 26-27=-62/778
WEBS 8-45=-95/13, 8-54=-30/88, 53-54=-35/88, 52-53=-25/87, 41-52=-36/89, 12-41=-46/102, 12-50=-271/23, 50-51=-462/103, 38-51=-311/27, 38-49=-870/156, 49-55=-836/149, 16-55=-795/145, 16-34=-189/578, 34-56=-656/290, 56-57=-646/284, 57-58=-622/274, 20-58=-668/295, 20-30=-127/316, 14-49=-114/57, 37-49=-90/63, 13-50=-215/94, 39-51=-179/93, 11-52=-80/75, 42-52=-58/65, 10-53=-216/131, 43-53=-239/140, 9-54=-93/56, 44-54=-80/52, 7-46=-126/72, 6-47=-169/120, 3-48=-151/113, 15-55=-69/48, 36-55=-33/51, 17-56=-57/67, 33-56=-39/58, 18-57=-103/85, 32-57=-62/68, 19-58=0/67, 31-58=-35/47, 21-29=-17/39, 22-28=-93/92, 25-27=0/91

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-0-0, Interior (1) 4-0-0 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 27-0-0, Interior (1) 27-0-0 to 36-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
4) Provide adequate drainage to prevent water ponding.
5) All plates are MT20 plates unless otherwise indicated.
6) All plates are 1.5x4 MT20 unless otherwise indicated.
7) Gable studs spaced at 2-0-0 oc.



April 17, 2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C01	Piggyback Base Structural Gable	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930668 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:56 Page: 2
ID:ZPE42GuJG2XQkNP0IKB?1ezkXCH-RfC?PsB70Hq3NSgPqnL8w3ulTXb6KWrcD6HJ42JC?1

05/16/2024

- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 82 lb uplift at joint 2, 10 lb uplift at joint 45, 195 lb uplift at joint 38, 165 lb uplift at joint 26, 462 lb uplift at joint 39, 150 lb uplift at joint 43, 10 lb uplift at joint 44, 49 lb uplift at joint 46, 96 lb uplift at joint 47 and 89 lb uplift at joint 48.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C02	Piggyback Base	2	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930669 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:56 Page: 1

ID:CHDmS3BtTjmRKi7v_C9xqvzkXEU-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWfCDontJ423Cpf

05/16/2024

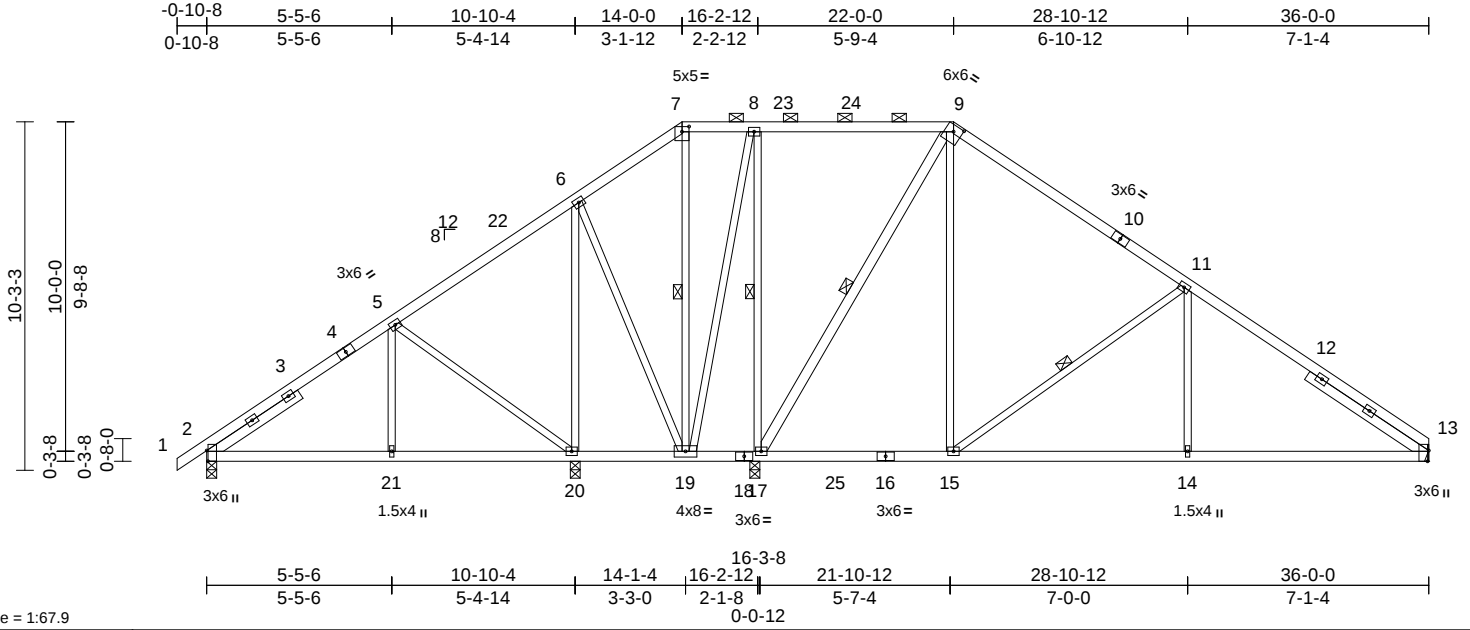

Scale = 1:67.9

Plate Offsets (X, Y): [2:0-3-13,Edge], [7:0-2-8,0-1-13], [9:0-3-0,0-2-3], [13:0-3-13,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	-0.07	13-14	>999	240	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.57	Vert(CT)	-0.14	13-14	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.02	13	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							
Weight: 207 lb FT = 20%											

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x3 SPF No.2 *Except* 17-9:2x4 SP No.2
SLIDER Left 2x4 SP No.2 -- 3-2-11, Right 2x4 SP No.2 -- 4-2-10

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-1-9 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 19-20,17-19.
WEBS 1 Row at midpt 7-19, 9-17, 11-15, 8-17

REACTIONS (size) 2=0-3-8, 13= Mechanical, 17=0-3-8, 20=0-3-8
Max Horiz 2=275 (LC 9)
Max Uplift 2=-89 (LC 12), 13=-176 (LC 13), 17=-63 (LC 13), 20=-198 (LC 12)
Max Grav 2=486 (LC 25), 13=909 (LC 20), 17=1371 (LC 2), 20=881 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/16, 2-5=-450/125, 5-6=-45/322, 6-7=-59/260, 7-8=-44/209, 8-9=-32/231, 9-11=-505/239, 11-13=-1120/246
BOT CHORD 2-21=-161/411, 20-21=-161/411, 19-20=-232/195, 17-19=-245/218, 15-17=-14/354, 14-15=-78/825, 13-14=-78/825
WEBS 7-19=-153/0, 9-17=-929/125, 9-15=-90/691, 11-15=-748/288, 11-14=0/309, 8-17=-451/148, 8-19=-9/149, 6-20=-389/128, 6-19=-23/92, 5-20=-573/214, 5-21=0/237

NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 27-0-0, Interior (1) 27-0-0 to 36-0-0 zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 3x4 MT20 unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi, Joint 20 SP No.2 crushing capacity of 565 psi, Joint 17 SP No.2 crushing capacity of 565 psi.
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 89 lb uplift at joint 2, 63 lb uplift at joint 17, 176 lb uplift at joint 13 and 198 lb uplift at joint 20.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C03	Piggyback Base	8	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930670 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:57 Page: 1

ID:ww5pEcMn41RuWmuWXN86szkXBg-RfC?PsB70Hq3NSgPqnL8w3uITXfGKwRCDm7J42JC?

05/16/2024

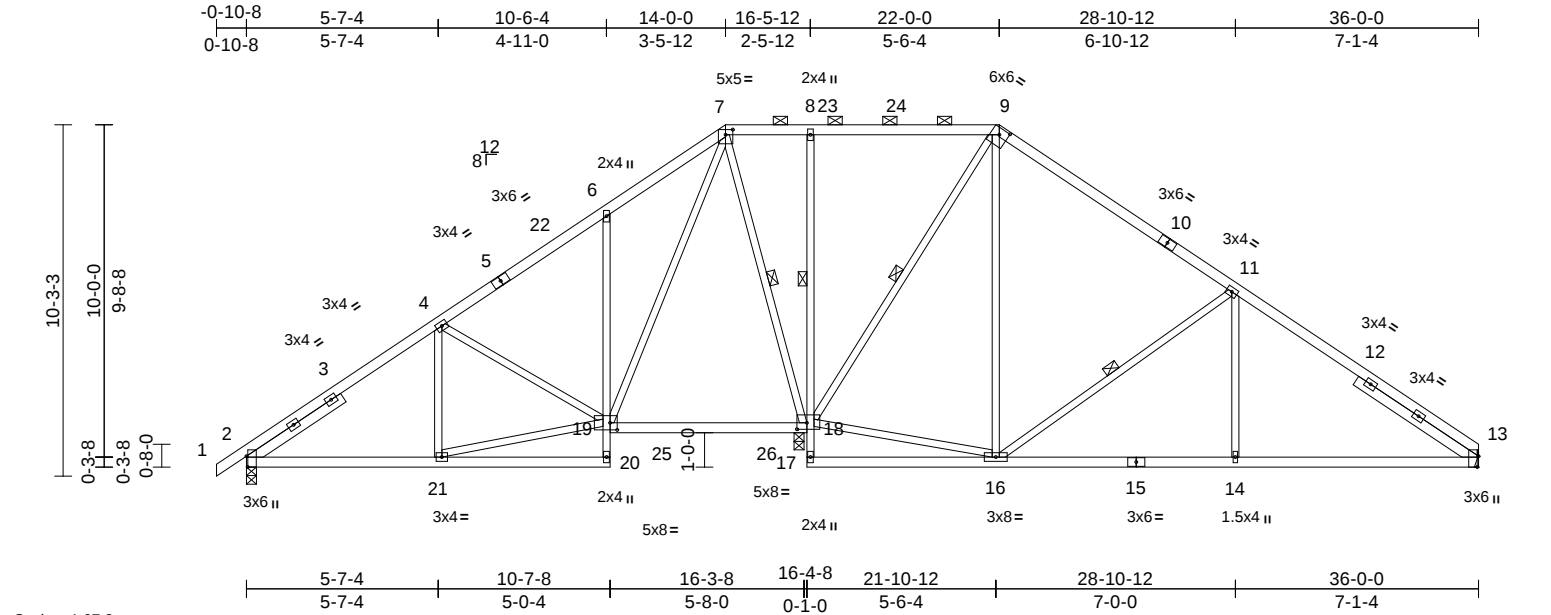

Scale = 1:67.3

Plate Offsets (X, Y): [2:0-3-13,Edge], [7:0-2-8,0-1-13], [9:0-3-0,0-2-3], [13:0-3-13,Edge], [18:0-3-8,0-2-4], [19:0-2-8,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.70	Vert(LL)	-0.08	18-19	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.55	Vert(CT)	-0.14	13-14	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.02	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 199 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* 20-6,8-17:2x3 SPF No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 3-3-13, Right 2x4 SP No.2 -- 4-2-10

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-3-5 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:

1 Row at midpt 8-18

WEBS 1 Row at midpt 7-18, 9-18, 11-16

REACTIONS (size) 2=0-3-8, 13= Mechanical, 18=0-3-8
Max Horiz 2=275 (LC 9)
Max Uplift 2=140 (LC 12), 13=194 (LC 13), 18=157 (LC 12)
Max Grav 2=684 (LC 19), 13=851 (LC 20), 18=2023 (LC 2)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/16, 2-4=-748/160, 4-6=-389/184, 6-7=-370/314, 7-8=0/385, 8-9=0/386, 9-11=-441/272, 11-13=-1023/278
BOT CHORD 2-21=-202/703, 20-21=-42/5, 19-20=0/79, 6-19=-327/218, 18-19=-188/211, 17-18=0/88, 8-18=-369/174, 16-17=-64/0, 14-16=-104/746, 13-14=-104/746
WEBS 4-21=0/174, 19-21=-187/735, 4-19=-434/173, 7-18=-878/184, 16-18=0/284, 9-18=-935/132, 9-16=-112/632, 11-16=-754/287, 11-14=0/308, 7-19=-308/961

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 27-0-0, Interior (1) 27-0-0 to 36-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi, Joint 18 SP No.2 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 140 lb uplift at joint 2, 157 lb uplift at joint 18 and 194 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C04	Piggyback Base	4	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930671 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:57 Page: 1

ID:IK_W3TeCg5LdAv8wNLIYizkXBJ-RfC?PsB70Hq3NSgPqnL8w3uITXbGhWrCDoi734202?

05/16/2024

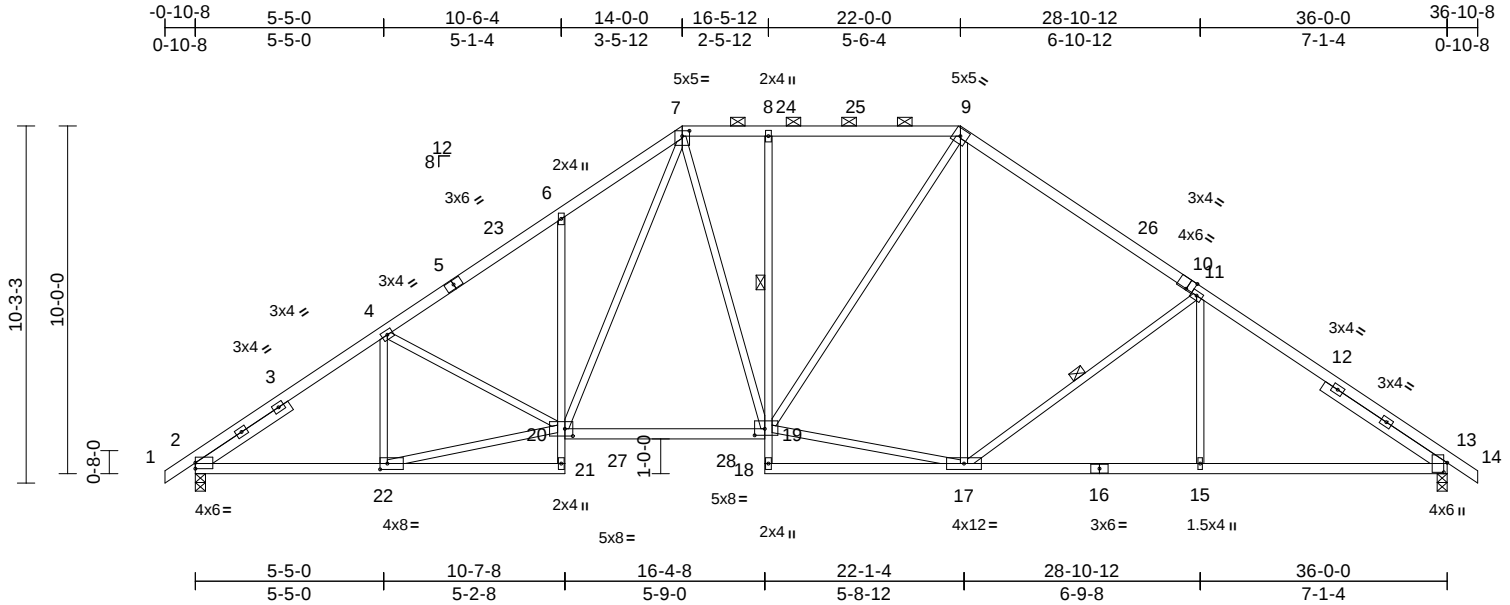

Scale = 1:66.3									
Plate Offsets (X, Y): [2:Edge,0-2-1], [7:0-2-8,0-1-13], [10:0-2-5,Edge], [13:0-3-5,0-1-3], [19:0-3-8,0-2-4], [20:0-2-12,0-2-8], [22:0-2-8,0-2-0]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.20 19-20	>999	240
TCDL	10.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.35 19-20	>999	180
BCLL	0.0*	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.14 13	n/a	n/a
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S					
						PLATES		GRIP	
						MT20		244/190	
						Weight: 201 lb FT = 20%			

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 5-7,9-10:2x4 SP 1650F 1.5E
BOT CHORD 2x4 SP No.2 *Except* 21-6,8-18:2x3 SPF No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 3-2-8, Right 2x4 SP No.2 -- 4-2-10

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-11-6 oc purlins, except 2-0-0 oc purlins (3-11-11 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 17-18.

1 Row at midpt 8-19
WEBS 1 Row at midpt 11-17

REACTIONS (size) 2=0-3-8, 13=0-3-8
Max Horiz 2=277 (LC 11)
Max Uplift 2=-225 (LC 12), 13=-225 (LC 13)
Max Grav 2=1744 (LC 2), 13=1733 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/16, 2-4=-2557/353, 4-6=-2494/412, 6-7=-2497/549, 7-8=-1765/403, 8-9=-1763/404, 9-11=-1947/394, 11-13=-2479/363, 13-14=0/16
BOT CHORD 2-22=-316/2131, 21-22=-21/59, 20-21=0/92, 6-20=-369/230, 19-20=-123/1680, 18-19=0/95, 8-19=-330/173, 17-18=-19/29, 15-17=-187/1953, 13-15=-187/1953
WEBS 4-22=-264/127, 20-22=-301/2131, 4-20=-100/143, 7-19=-180/476, 17-19=-29/1540, 9-19=-187/537, 9-17=-112/393, 11-17=-670/284, 11-15=0/292, 7-20=-321/1093

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 27-0-0, Interior (1) 27-0-0 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 225 lb uplift at joint 2 and 225 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C06	Piggyback Base	6	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930673 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:57 Page: 1

ID:MOwprgwS1U8AI1BD8zUOGHzXUJ-RfC?PsB70Hq3NSgPqnL8w3uITXGKWrCbaf7342zC9

05/16/2024

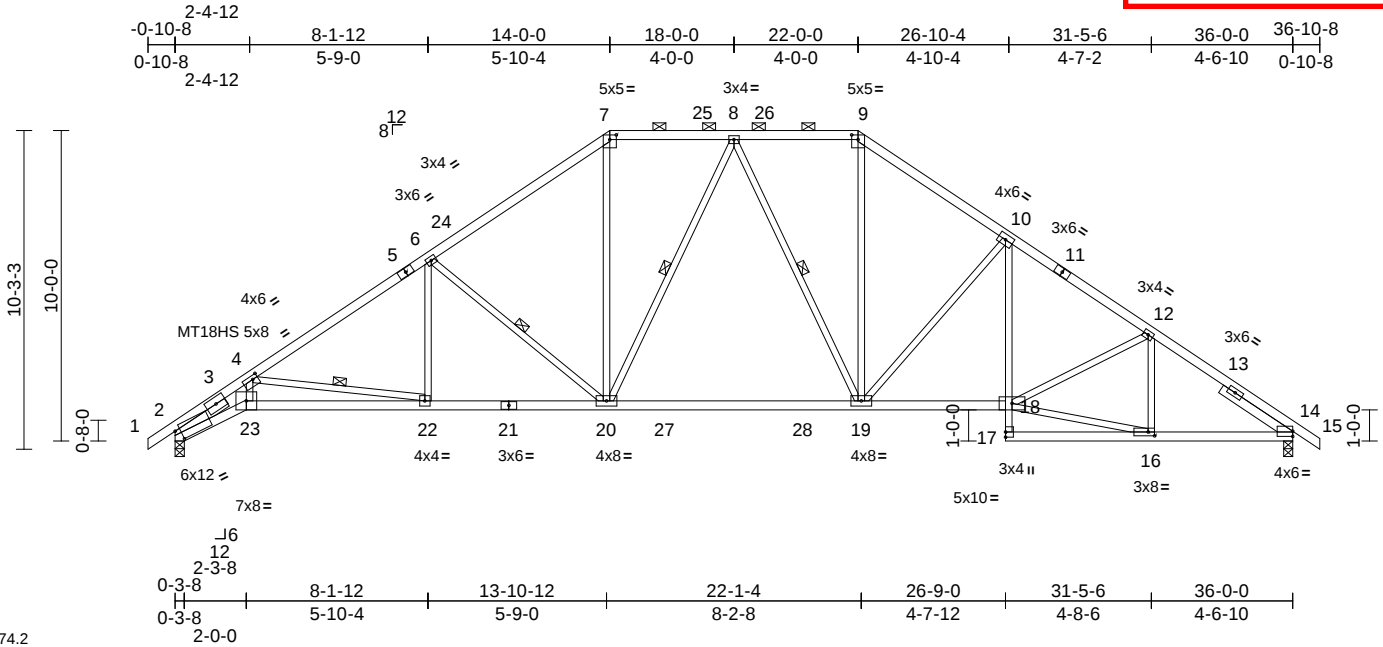


Plate Offsets (X, Y): [2:0-1-15,0-4-3], [4:0-2-0,0-1-8], [7:0-2-8,0-1-13], [9:0-2-8,0-1-13], [14:Edge,0-2-1], [16:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.31	19-20	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-0.53	19-20	>807	180	MT18HS	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.93	Horz(CT)	0.29	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 191 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 1-5,11-15:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.5E *Except* 10-17:2x3 SPF No.2, 17-14,21-18:2x4 SP No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 1-11-11, Right 2x4 SP No.2 -- 2-8-4

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-5-3 oc purlins, except 2-0-0 oc purlins (4-4-5 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 4-22, 6-20, 8-20, 8-19

REACTIONS (size) 2=0-3-8, 14=0-3-8
Max Horiz 2=-278 (LC 10)
Max Uplift 2=-226 (LC 12), 14=-224 (LC 13)
Max Grav 2=1750 (LC 2), 14=1742 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/12, 2-4=-5248/803, 4-6=-2775/409, 6-7=-2169/402, 7-8=-1701/390, 8-9=-1709/386, 9-10=-2155/410, 10-12=-2602/413, 12-14=-2560/346, 14-15=0/16
BOT CHORD 2-23=-820/4519, 22-23=-710/3847, 20-22=-300/2406, 19-20=-98/1756, 18-19=-162/2136, 17-18=0/88, 10-18=-49/460, 16-17=-6/120, 14-16=-200/1993
WEBS 4-23=-290/2047, 4-22=-1460/416, 6-22=-4/449, 6-20=-882/303, 7-20=-93/884, 9-19=-110/905, 10-19=-733/263, 8-20=-322/211, 8-19=-306/211, 12-16=-307/105, 16-18=-198/1915, 12-18=-85/218

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 26-10-4, Interior (1) 26-10-4 to 36-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearings are assumed to be: Joint 2 SP 1650F 1.5E crushing capacity of 565 psi, Joint 14 SP No.2 crushing capacity of 565 psi.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 226 lb uplift at joint 2 and 224 lb uplift at joint 14.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C07	Piggyback Base	2	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930674 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 1

ID:EcfbY3UUQ1rYvWbWk1jrGzKXAE-RfC?PsB70Hq3NSgPqnL8w3uITxbGhWrCDoi134Z0C?

05/16/2024

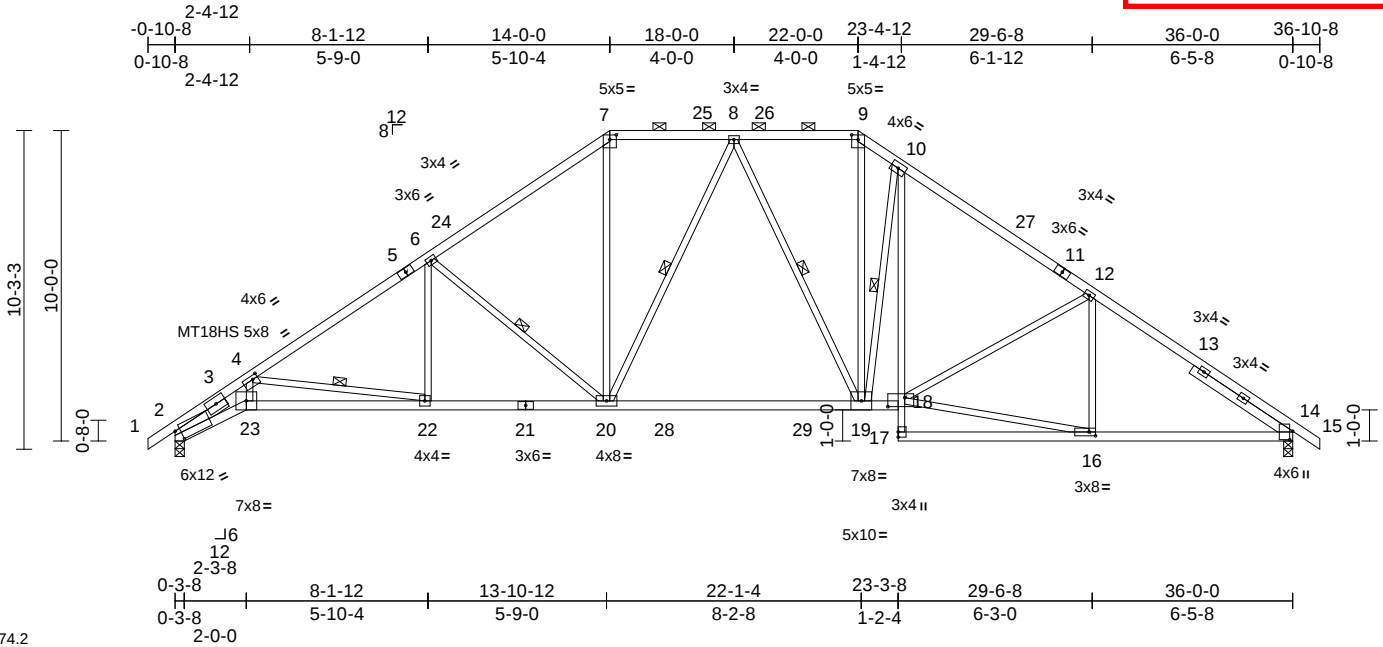

Scale = 1:74.2

Plate Offsets (X, Y): [2:0-1-15,0-4-3], [4:0-2-0,0-1-8], [7:0-2-8,0-1-13], [9:0-2-8,0-1-13], [14:0-3-5,0-1-3], [16:0-2-8,0-1-8], [18:0-6-8,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.28	19-20	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.48	19-20	>899	180	MT18HS	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.64	Horz(CT)	0.28	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 199 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 1-5,11-15:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.5E *Except* 10-17:2x3 SPF No.2, 17-14:2x4 SP No.2
WEBS 2x3 SPF No.2
SLIDER Left 2x4 SP No.2 -- 1-11-11, Right 2x4 SP No.2 -- 3-10-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-5-3 oc purlins, except 2-0-0 oc purlins (4-4-3 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 7-11-5 oc bracing: 2-23 8-6-11 oc bracing: 22-23.
WEBS 1 Row at midpt 4-22, 6-20, 10-19, 8-20, 8-19

REACTIONS (size) 2=0-3-8, 14=0-3-8
Max Horiz 2=-278 (LC 10)
Max Uplift 2=-226 (LC 12), 14=-224 (LC 13)
Max Grav 2=1750 (LC 2), 14=1742 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/12, 2-4=-5246/803, 4-6=-2776/409, 6-7=-2167/402, 7-8=-1699/390, 8-9=-1716/384, 9-10=-2128/474, 10-12=-2307/407, 12-14=-2517/356, 14-15=0/16
BOT CHORD 2-23=-820/4518, 22-23=-710/3846, 20-22=-300/2407, 19-20=-97/1758, 18-19=-82/1814, 17-18=0/109, 10-18=-117/481, 16-17=-2/189, 14-16=-189/1983

WEBS 4-23=-290/2044, 4-22=-1458/416, 6-22=-4/454, 6-20=-886/303, 7-20=-94/883, 9-19=-234/1038, 10-19=-737/323, 16-18=-190/1826, 12-18=-301/230, 12-16=-196/120, 8-20=-329/211, 8-19=-295/207

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 27-0-0, Interior (1) 27-0-0 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearings are assumed to be: Joint 2 SP 1650F 1.5E crushing capacity of 565 psi, Joint 14 SP No.2 crushing capacity of 565 psi.
 - Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 226 lb uplift at joint 2 and 224 lb uplift at joint 14.

- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	C08	Piggyback Base	5	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930675 LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 1

ID: EcfbY3UUQ1rYVwBwK1jrGzkXAE-RfC?PsB70Hq3NSgPqnL8w3uITxbGHWrCD0i734ZOC?36-10-8

05/16/2024

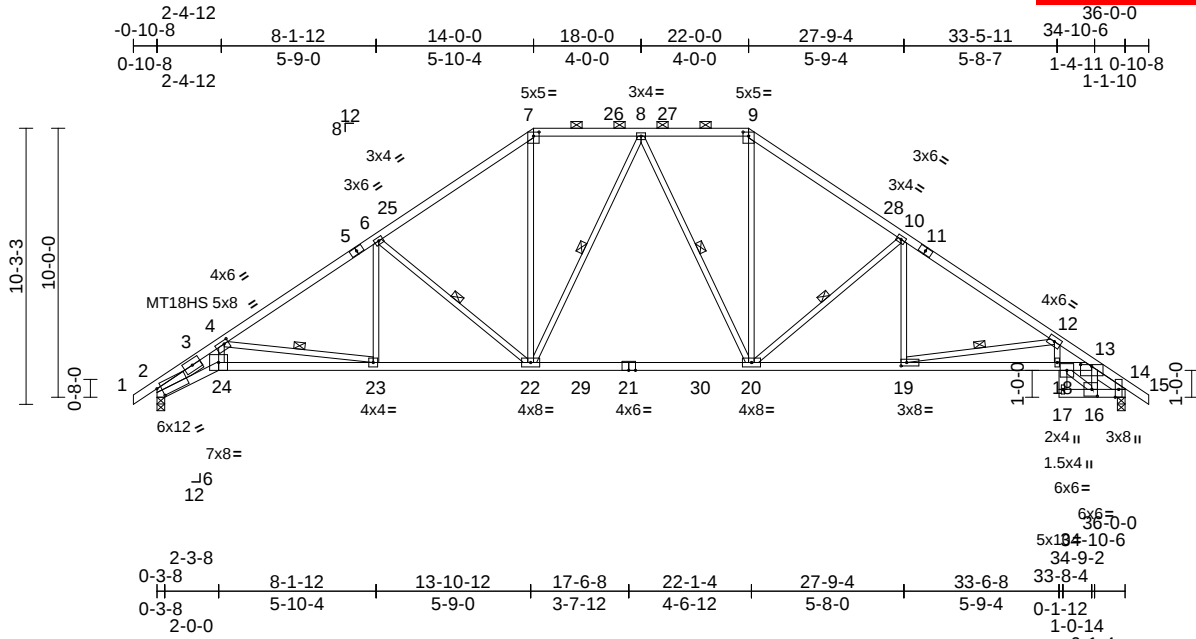

Scale = 1:85.7

Plate Offsets (X, Y): [2:0-1-15,0-4-3], [4:0-2-0,0-1-8], [7:0-2-8,0-1-13], [9:0-2-8,0-1-13], [13:0-5-0,0-0-14], [16:0-2-8,0-3-0], [19:0-2-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.34	20-22	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.82	Vert(CT)	-0.58	20-22	>742	180	MT18HS	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.67	Horz(CT)	0.37	14	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S								
Weight: 187 lb FT = 20%												

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 1-5,11-15:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.5E *Except* 17-14:2x4 SP No.2
WEBS 2x3 SPF No.2
OTHERS 2x4 SP No.2
SLIDER Left 2x4 SP No.2 -- 1-11-11, Right 2x4 SP No.2 -- 1-3-1

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-5-3 oc purlins, except 2-0-0 oc purlins (4-4-10 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 7-11-5 oc bracing: 2-24 8-6-11 oc bracing: 23-24.
WEBS 1 Row at midpt 4-23, 6-22, 10-20, 8-22, 8-20, 12-19

REACTIONS (size) 2=0-3-8, 14=0-3-8
Max Horiz 2=-278 (LC 10)
Max Uplift 2=-226 (LC 12), 14=-224 (LC 13)
Max Grav 2=1751 (LC 2), 14=1759 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/12, 2-4=-5251/803, 4-6=-2776/409, 6-7=-2172/402, 7-8=-1703/390, 8-9=-1710/389, 9-10=-2175/404, 10-12=-2809/411, 12-13=-4814/555, 13-14=-2237/283, 14-15=0/16
BOT CHORD 2-24=-820/4522, 23-24=-710/3849, 22-23=-300/2407, 20-22=-98/1756, 19-20=-193/2294, 18-19=-421/3786, 13-18=-273/2545, 16-17=0/0, 14-16=-161/1496

WEBS 17-18=0/45, 4-24=-290/2048, 4-23=-1461/416, 6-23=-4/448, 6-22=-881/303, 7-22=-92/885, 9-20=-94/883, 10-20=-861/278, 8-22=-319/211, 8-20=-307/212, 13-16=-1275/158, 10-19=0/490, 12-19=-1588/296, 12-18=-20/1194, 16-18=-211/1964

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8, Interior (1) 4-1-8 to 14-0-0, Exterior(2R) 14-0-0 to 19-0-0, Interior (1) 19-0-0 to 22-0-0, Exterior(2R) 22-0-0 to 27-0-0, Interior (1) 27-0-0 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf. Bearings are assumed to be: Joint 2 SP 1650F 1.5E crushing capacity of 565 psi, Joint 14 SP No.2 crushing capacity of 565 psi.
 - 7) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 226 lb uplift at joint 2 and 224 lb uplift at joint 14.

- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	C09	Piggyback Base Supported Gable	1	1	Job Reference (optional)


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
164930676
LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 1

ID:ewrAceOsPybP0GqmZjh3U?zkXV7-RfC?PsB70Hq3NSgPqnL8w3uITXBGKWrCDof7423C#f

05/16/2024

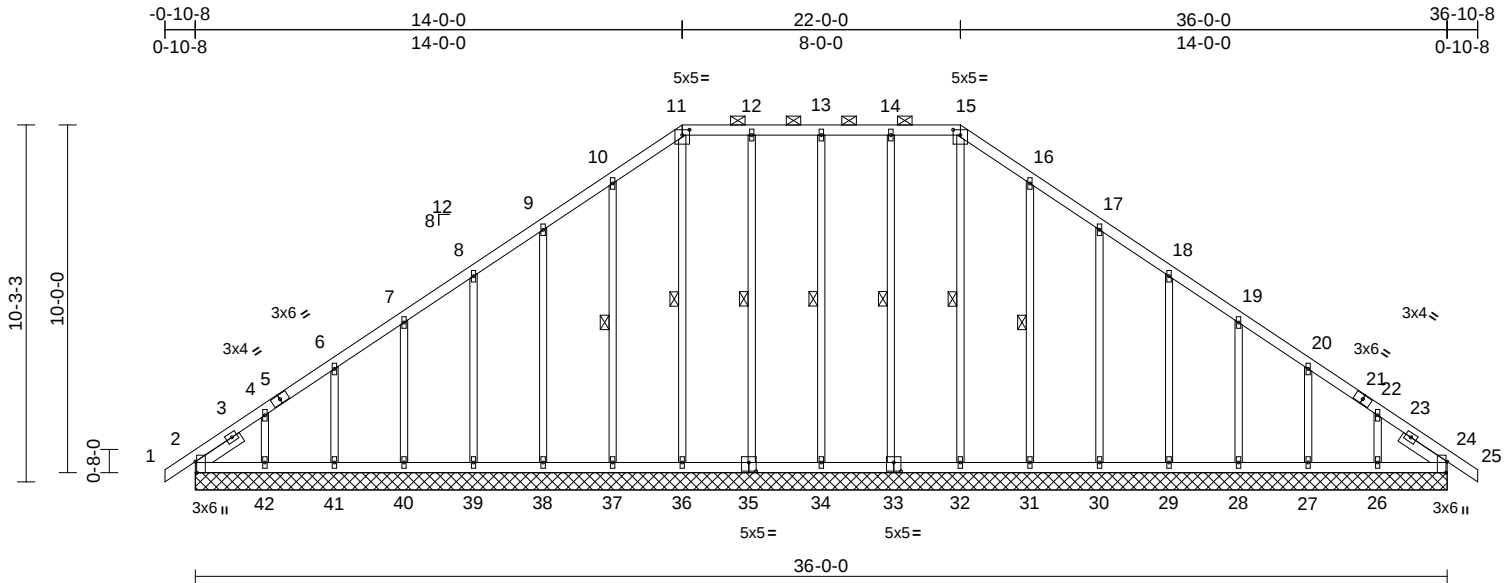

Scale = 1:66.3

Plate Offsets (X, Y): [2:0-3-13,Edge], [11:0-2-8,0-1-13], [15:0-2-8,0-1-13], [24:0-3-13,Edge], [33:0-2-8,0-3-0], [35:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.01	24	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 209 lb FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2
SLIDER	Left 2x4 SP No.2 -- 1-6-4, Right 2x4 SP No.2 -- 1-6-4

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6'-0-0 oc purlins, except 2'-0-0 oc purlins (6'-0-0 max.): 11-15.
BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.
WEBS	1 Row at midpt 15-32, 14-33, 13-34, 12-35, 11-36, 10-37, 16-31

REACTIONS (size)

2=36'-0-0, 24=36'-0-0, 26=36'-0-0, 27=36'-0-0, 28=36'-0-0, 29=36'-0-0, 30=36'-0-0, 31=36'-0-0, 32=36'-0-0, 33=36'-0-0, 34=36'-0-0, 35=36'-0-0, 36=36'-0-0, 37=36'-0-0, 38=36'-0-0, 39=36'-0-0, 40=36'-0-0, 41=36'-0-0, 42=36'-0-0
Max Horiz 2=-277 (LC 10)
Max Uplift 2=-100 (LC 8), 24=-20 (LC 9), 26=-118 (LC 13), 27=-73 (LC 13), 28=-79 (LC 13), 29=-77 (LC 13), 30=-82 (LC 13), 31=-76 (LC 13), 33=-43 (LC 9), 34=-41 (LC 8), 35=-42 (LC 9), 36=-15 (LC 9), 37=-78 (LC 12), 38=-81 (LC 12), 39=-77 (LC 12), 40=-80 (LC 12), 41=-71 (LC 12), 42=-132 (LC 12)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/16, 2-4=-286/237, 4-6=-198/190, 6-7=-172/168, 7-8=-155/162, 8-9=-141/190, 9-10=-138/232, 10-11=-177/273, 11-12=-153/250, 12-13=-154/251, 13-14=-154/251, 14-15=-153/250, 15-16=-177/273, 16-17=-138/209, 17-18=-99/141, 18-19=-69/75, 19-20=-84/54, 20-22=-113/77, 22-24=-202/113, 24-25=0/16
BOT CHORD 2-42=-95/196, 41-42=-95/196, 40-41=-95/196, 39-40=-95/196, 38-39=-95/196, 37-38=-95/196, 36-37=-95/196, 34-36=-95/196, 32-34=-95/196, 31-32=-95/196, 30-31=-95/196, 29-30=-95/196, 28-29=-95/196, 27-28=-95/196, 26-27=-95/196, 24-26=-95/196
WEBS 15-32=-128/7, 14-33=-148/67, 13-34=-139/67, 12-35=-148/65, 11-36=-147/45, 10-37=-158/103, 9-38=-148/104, 8-39=-149/101, 7-40=-149/103, 6-41=-147/96, 4-42=-173/151, 16-31=-156/100, 17-30=-149/106, 18-29=-149/101, 19-28=-149/103, 20-27=-149/98, 22-26=-158/138

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 4-0-0, Exterior(2N) 4-0-0 to 14-0-0, Corner(3R) 14-0-0 to 19-0-0, Exterior(2N) 19-0-0 to 22-0-0, Corner(3R) 22-0-0 to 27-0-0, Exterior(2N) 27-0-0 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



April 17, 2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbscomponents.com)

MiTek®16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	C09	Piggyback Base Supported Gable	1	1	Job Reference (optional)

RELEASE FOR CONSTRUCTION

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

164930676

LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 2

ID:ewrAceOsPybP0GqmZjh3U?zkXV?-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoh74423C#f

- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 2, 20 lb uplift at joint 24, 43 lb uplift at joint 33, 41 lb uplift at joint 34, 42 lb uplift at joint 35, 15 lb uplift at joint 36, 78 lb uplift at joint 37, 81 lb uplift at joint 38, 77 lb uplift at joint 39, 80 lb uplift at joint 40, 71 lb uplift at joint 41, 132 lb uplift at joint 42, 76 lb uplift at joint 31, 82 lb uplift at joint 30, 77 lb uplift at joint 29, 79 lb uplift at joint 28, 73 lb uplift at joint 27 and 118 lb uplift at joint 26.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

05/16/2024

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	CJ01	Diagonal Hip Girder	2	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						164930677
						LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 1

ID:LawX8EJT2pjPgBnQfl3QiXzkXV6-RfC?PsB70Hq3NSgPqnL8w3ulTXbGK1VrCDoi7J42JC21

05/16/2024

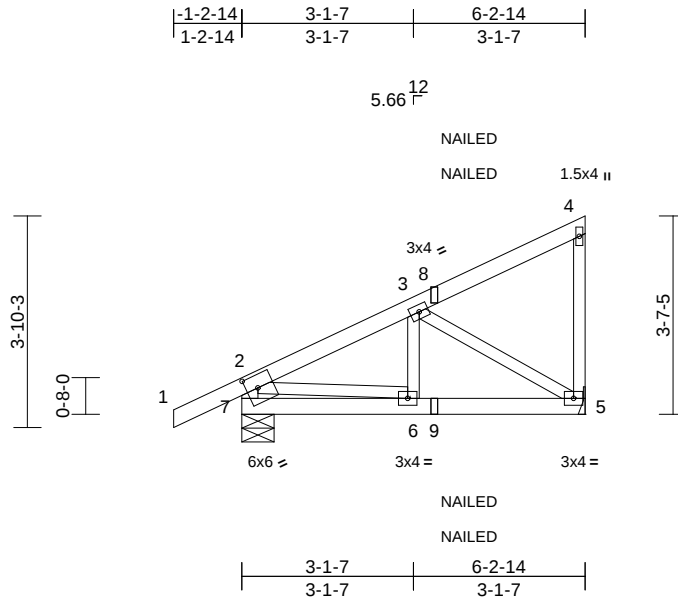

Scale = 1:41.9									
Plate Offsets (X, Y): [7:0-2-8,0-2-12]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	PLATES
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	0.00	6	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	-0.01	5-6	GRIP
BCLL	0.0*	Rep Stress Incr	NO	WB	0.09	Horz(CT)	0.00	5	197/144
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P				n/a	Weight: 31 lb
									FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x3 SPF No.2 *Except* 7-2:2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 9-11-10 oc bracing.

REACTIONS (size) 5= Mechanical, 7=0-7-0
Max Horiz 7=159 (LC 9)
Max Uplift 5=-94 (LC 9), 7=-94 (LC 12)
Max Grav 5=258 (LC 1), 7=378 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-7=-352/278, 1-2=0/41, 2-3=-353/123, 3-4=-214/102, 4-5=-90/117
BOT CHORD 6-7=-353/181, 5-6=-257/300
WEBS 3-6=0/121, 3-5=-290/247, 2-6=-63/329

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 7 and 94 lb uplift at joint 5.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) "NAILED" indicates Girder: 3-10d (0.148" x 3") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-4=-70, 5-7=-20

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)
exterior zone and C-C Corner (3) 1-2-14 to 5-10-0,
Exterior(2R) 5-10-0 to 6-1-10 zone; cantilever left and
right exposed; end vertical left and right exposed; C-C
for members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
 - 4) Bearings are assumed to be: Joint 7 SP No.2 crushing
capacity of 565 psi.
 - 5) Refer to girder(s) for truss to truss connections.



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	J01	Jack-Open	4	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						164930678
						LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 1

ID:2zUS610PiRhoVypFidojTzkXVU-RfC?PsB70Hq3NSgPqnL8w3ulTXbGK1WrCDoi7J42JC41

05/16/2024

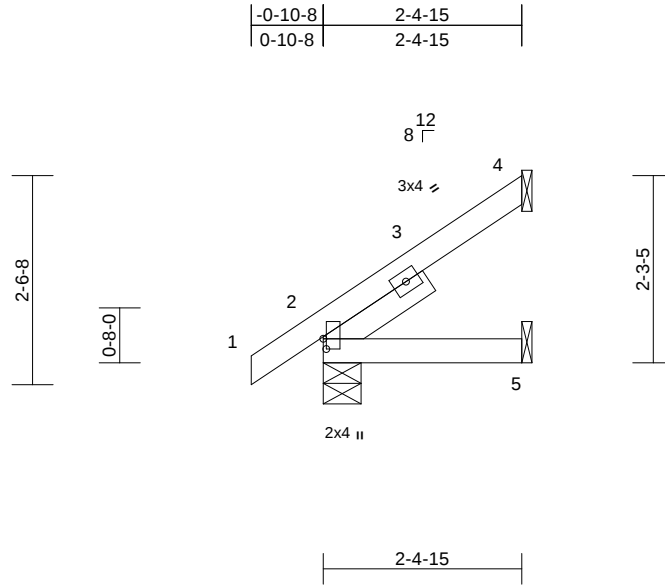

Scale = 1:28

Plate Offsets (X, Y): [2:0-1-8,0-0-7]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	0.00	2-5	>999	240	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	0.00	2-5	>999	180	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 12 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
SLIDER Left 2x4 SP No.2 -- 1-5-9

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-4-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-5-8, 4= Mechanical, 5= Mechanical
Max Horiz 2=92 (LC 12)
Max Uplift 2=-16 (LC 12), 4=-67 (LC 12)
Max Grav 2=178 (LC 1), 4=80 (LC 19), 5=47 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/16, 2-4=-78/47
BOT CHORD 2-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)
exterior zone and C-C Exterior(2E) zone; cantilever left
and right exposed ; end vertical left and right
exposed;C-C for members and forces & MWFRS for
reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 4) Bearings are assumed to be: , Joint 2 SP No.2 crushing
capacity of 565 psi.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 67 lb uplift at joint
4 and 16 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018
International Residential Code sections R502.11.1 and
R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	J02	Jack-Open	7	1	Job Reference (optional)

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:58 Page: 1

ID:TY9bk33l?M3NfzhOwrBVL5zkXVR-RfC?PsB70Hq3NSgPqnL8w3uITXbGfKWrCdoi/3423C?f

Page: 1

05/16/2024

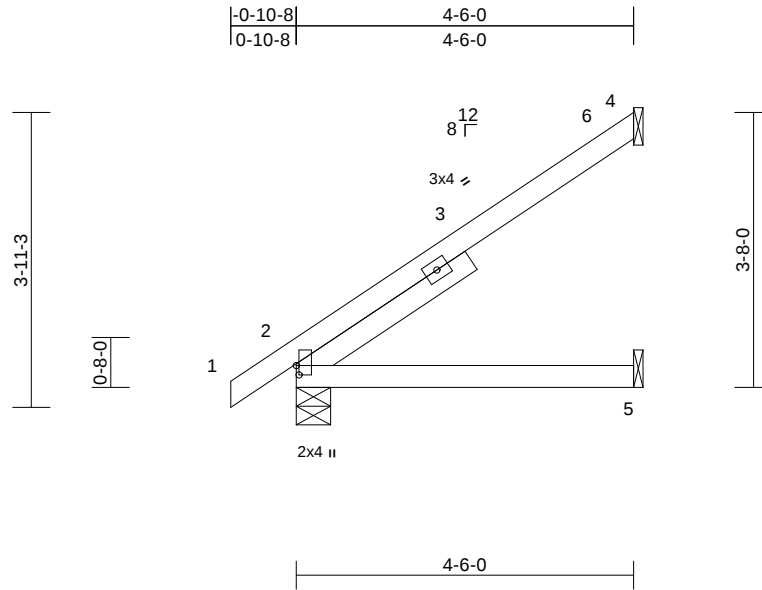


Plate Offsets (X, Y): [2:0-1-8,0-0-7]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	-0.02	2-5	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.05	2-5	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.01	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 21 lb	FT = 20%

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
SLIDER Left 2x4 SP No.2 -- 2-8-10

TOP CHORD	Structural wood sheathing directly applied or 4-6-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

(size) 2=0-5-8, 4= Mechanical, 5= Mechanical

Max Horiz 2=153 (LC 12)

Max Uplift 2=-15 (LC 12), 4=-121 (LC 12)

Max Grav 2=267 (LC 1), 4=163 (LC 19), 5=89 (LC 3)

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/16, 2-4=-131/80
BOT CHORD 2-5=0/0

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCdL=6.0psf; BCDL=6.0psf; h=35ft;
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)
exterior zone and C-C Exterior(2E) -0-10-8 to 4-1-8,
Interior (1) 4-1-8 to 4-5-4 zone; cantilever left and right
exposed ; end vertical left and right exposed; C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 4) Bearings are assumed to be: , Joint 2 SP No.2 crushing
capacity of 565 psi.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 4 and 15 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	LG01	Lay-In Gable	1	1	Job Reference (optional)

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
164930680
LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1
ID:LJP6aQ6o2aap8a_99hFRWxzkXVN-RfC?PsB70Hq3NSgPqnL8w3ulTXbQKWrcDohJ423C?r

05/16/2024

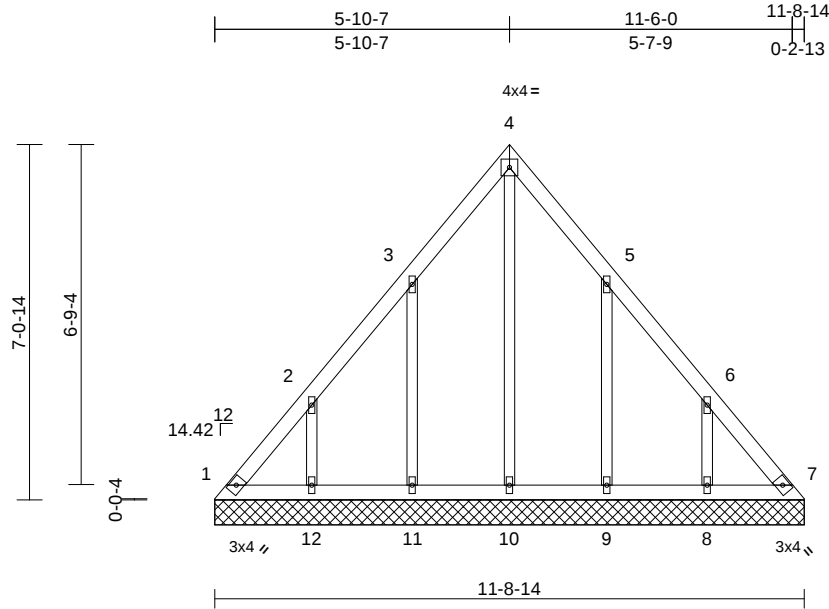

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.12	Horiz(TL)	0.00	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 58 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=11-8-14, 7=11-8-14, 8=11-8-14, 9=11-8-14, 10=11-8-14, 11=11-8-14, 12=11-8-14
Max Horiz		1=197 (LC 9)
Max Uplift		1=-82 (LC 10), 7=-57 (LC 11), 8=-168 (LC 13), 9=-165 (LC 13), 11=-167 (LC 12), 12=-168 (LC 12)
Max Grav		1=190 (LC 12), 7=174 (LC 13), 8=220 (LC 20), 9=225 (LC 20), 10=142 (LC 22), 11=226 (LC 19), 12=219 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-264/171, 2-3=-150/105, 3-4=-135/124, 4-5=-135/119, 5-6=-125/71, 6-7=-243/171
BOT CHORD	1-12=-129/187, 11-12=-130/188, 10-11=-130/188, 9-10=-130/188, 8-9=-130/188, 7-8=-129/187
WEBS	2-12=-218/185, 3-11=-221/192, 4-10=-114/77, 5-9=-221/191, 6-8=-218/185

NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-3-12 to 5-3-12, Interior (1) 5-3-12 to 5-10-10, Exterior(2R) 5-10-10 to 10-10-10, Interior (1) 10-10-10 to 11-5-9 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 1.5x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 0-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 82 lb uplift at joint 1, 57 lb uplift at joint 7, 168 lb uplift at joint 12, 167 lb uplift at joint 11, 165 lb uplift at joint 9 and 168 lb uplift at joint 8.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	PB1	Piggyback	2	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						164930681
						LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1

ID:ISwQuRemZjllLuFdTsap96TzWn6k-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi734z3C?

05/16/2024

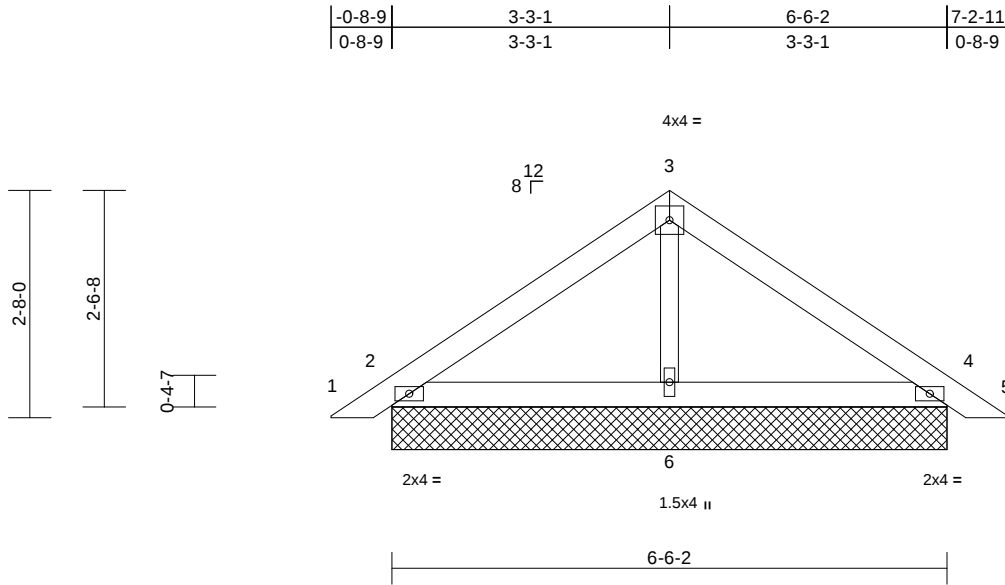

Scale = 1:27

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.22	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.11	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	4	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P						Weight: 25 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=6-6-2, 4=6-6-2, 6=6-6-2
Max Horiz	2=-69 (LC 10)
Max Uplift	2=-55 (LC 12), 4=-64 (LC 13)
Max Grav	2=200 (LC 1), 4=200 (LC 1), 6=251 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/16, 2-3=-106/75, 3-4=-100/76, 4-5=0/16
BOT CHORD	2-6=-13/53, 4-6=-13/53
WEBS	3-6=-170/93

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 2 and 64 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	PB2	Piggyback	28	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						164930682
						LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1

ID: DfUo5nfOK1tCWOCfQIKOfgzWn6j-RfC?PsB70Hq3NSgPqnL8w3uITxbGhWrCDoi734Z0C7

05/16/2024

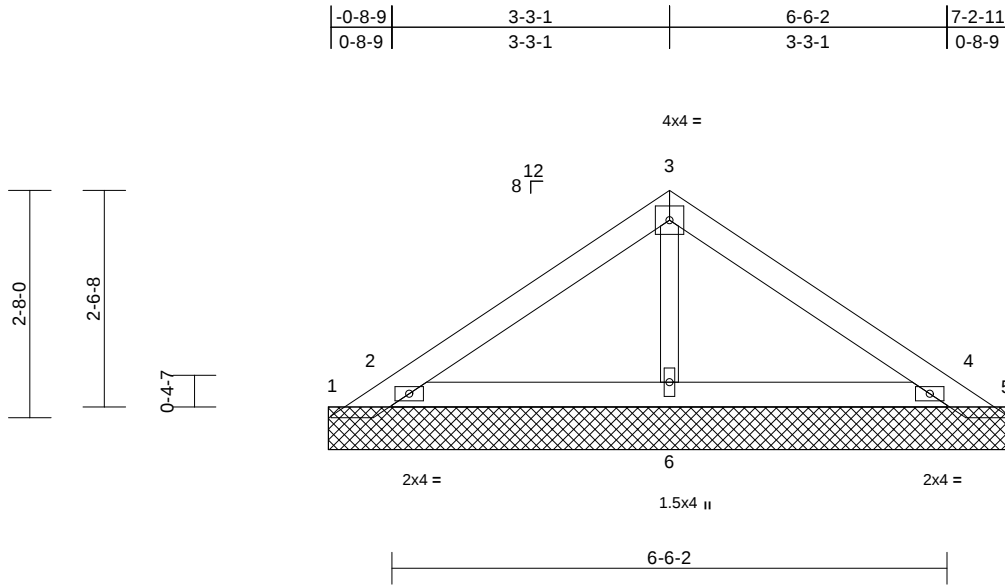

Scale = 1:27

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.19	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.11	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P						Weight: 25 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=8-0-0, 2=8-0-0, 4=8-0-0, 5=8-0-0, 6=8-0-0
	Max Horiz	1=-69 (LC 8)
	Max Uplift	1=-195 (LC 19), 2=-213 (LC 12), 4=-196 (LC 13), 5=-166 (LC 20)
	Max Grav	1=149 (LC 12), 2=404 (LC 19), 4=385 (LC 20), 5=123 (LC 13), 6=223 (LC 1)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-113/159, 2-3=-111/70, 3-4=-110/70, 4-5=-92/99
BOT CHORD	2-6=-19/51, 4-6=-19/51
WEBS	3-6=-142/60

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.

- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 195 lb uplift at joint 1, 166 lb uplift at joint 5, 213 lb uplift at joint 2 and 196 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES 164930683 LEE'S SUMMIT, MISSOURI
P240420-01	V01	Valley	1	1	Job Reference (optional)	

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1

ID:6ru7F9CpA2ag5pbhdMPJqdzkXVF-RfC?PsB70Hq3NSgPqnL8w3uITXbGLWwCDot734Z9C71

05/16/2024

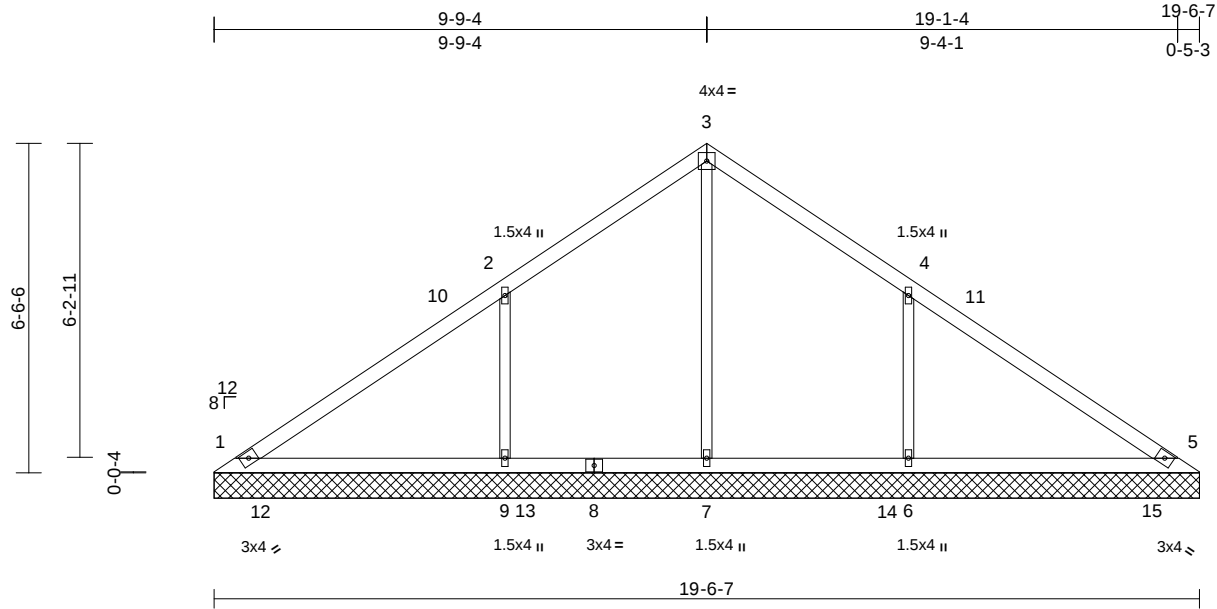

Scale = 1:45.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.26	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.15	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 73 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	1=19-6-7, 5=19-6-7, 6=19-6-7, 7=19-6-7, 9=19-6-7
	Max Horiz	1=-174 (LC 8)
	Max Uplift	1=-21 (LC 13), 6=-229 (LC 13), 9=-229 (LC 12)
	Max Grav	1=234 (LC 20), 5=216 (LC 1), 6=653 (LC 20), 7=331 (LC 22), 9=654 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-169/146, 2-3=-154/156, 3-4=-141/135, 4-5=-130/102
BOT CHORD	1-9=-56/124, 7-9=-56/124, 5-6=-56/124
WEBS	3-7=-160/0, 2-9=-422/281, 4-6=-422/281

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-5-12 to 5-5-12, Interior (1) 5-5-12 to 9-9-10, Exterior(2R) 9-9-10 to 14-9-10, Interior (1) 14-9-10 to 19-1-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 1, 229 lb uplift at joint 9 and 229 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	V02	Valley	1	1	Job Reference (optional)

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1

ID:6ru7F9CpA2ag5pbhdMPJqdzkXVF-RfC?PsB70Hq3NSgPqnL8w3uITXbGfKWrCdoi/3423C?f

05/16/2024

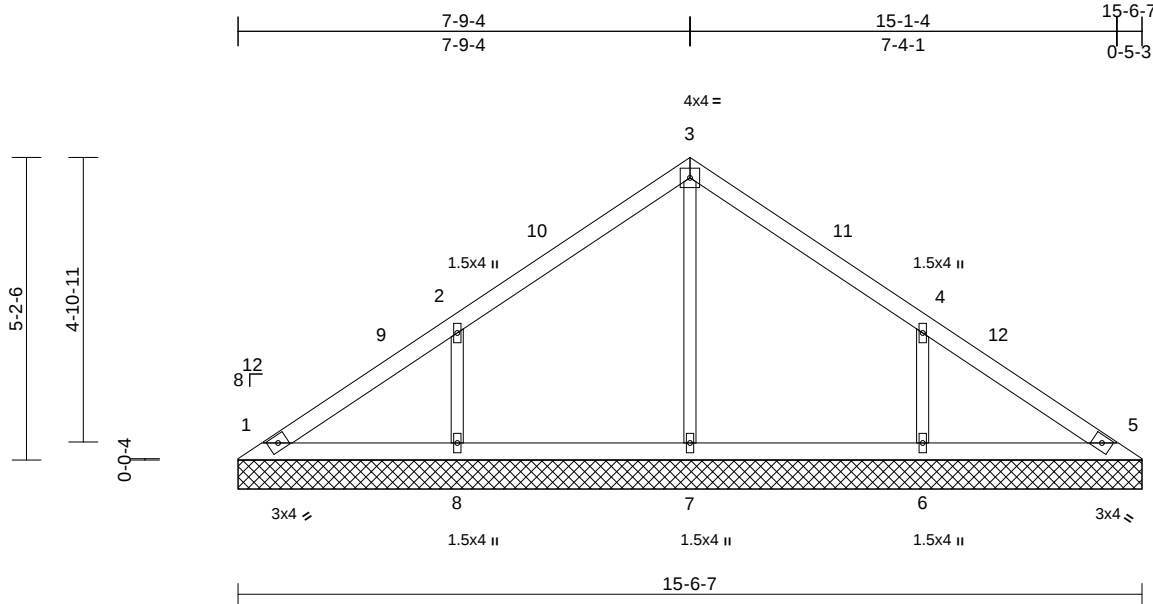

Scale = 1:39.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 56 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x3 SPF No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=15-6-7, 5=15-6-7, 6=15-6-7, 7=15-6-7, 8=15-6-7
Max Horiz	1=-136 (LC 8)
Max Uplift	1=-17 (LC 13), 6=-175 (LC 13), 8=-175 (LC 12)
Max Grav	1=146 (LC 20), 5=139 (LC 1), 6=408 (LC 20), 7=270 (LC 1), 8=408 (LC 19)

FORCES

	1-2=	3-4=	5-6=	7-8=	9-10=	11-12=
TOP CHORD	1-2=-142/100,	2-3=-149/124,	3-4=-140/112,	4-5=-107/56		
BOT CHORD	1-8=-38/88,	7-8=-38/88,	6-7=-38/88,	5-6=-38/88		
WEBS	3-7=-193/5,	2-8=-321/218,	4-6=-321/218			

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDF=6.0psf; BCDL=6.0psf; h=35ft;
Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)
exterior zone and C-C Exterior(2E) 0-5-12 to 5-5-12,
Interior (1) 5-5-12 to 7-9-10, Exterior(2R) 7-9-10 to
12-9-10, Interior (1) 12-9-10 to 15-1-7 zone; cantilever
left and right exposed ; end vertical left and right
exposed; C-C for members and forces & MWFRS for
reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60

- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4'-0" oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06" tall by 2'-00" wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 1, 175 lb uplift at joint 8 and 175 lb uplift at joint 6.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024



WARNING – Verify design parameters and READ NOTES on this and INCLUDED WITH REFERENCE PAGE MP14743 rev. 12/2023 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-UIS.com

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1
ID:6ru7F9CpA2ag5pbhdMPJqdzkXVF-RfC?PsB70Hq3NSgPqnL8w3ulTXbGw:WrcDofJ4ZJC?F

05/16/2024



LUMBER

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 1, 66 lb uplift at joint 3 and 29 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft;
 Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope)
 exterior zone and C-C Exterior(2E) 0-5-12 to 5-5-12,
 Interior (1) 5-5-12 to 5-9-10, Exterior(2R) 5-9-10 to
 10-9-10, Interior (1) 10-9-10 to 11-1-7 zone; cantilever
 left and right exposed ; end vertical left and right
 exposed; C-C for members and forces & MWFRS for
 reactions shown; Lumber DOL=1.60 plate grip
 DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss
 only. For studs exposed to wind (normal to the face),
 see Standard Industry Gable End Details as applicable,
 or consult qualified building designer as per ANSI/TP1 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.



April 17, 2024



WARNING – verify design parameters and READ NOTES on this and INCLUDED WITH REFERENCE PAGE MP1473 (rev. 3/2/2025) BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116
P240420-01	V04	Valley	1	1	Job Reference (optional)


AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
164930686
LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1

ID: 6ru7F9CpA2ag5pbhdMPJqdzkXVF-RfC?PsB70Hq3NSgPqnL8w3uITXbGLWrcDol73423C71

05/16/2024

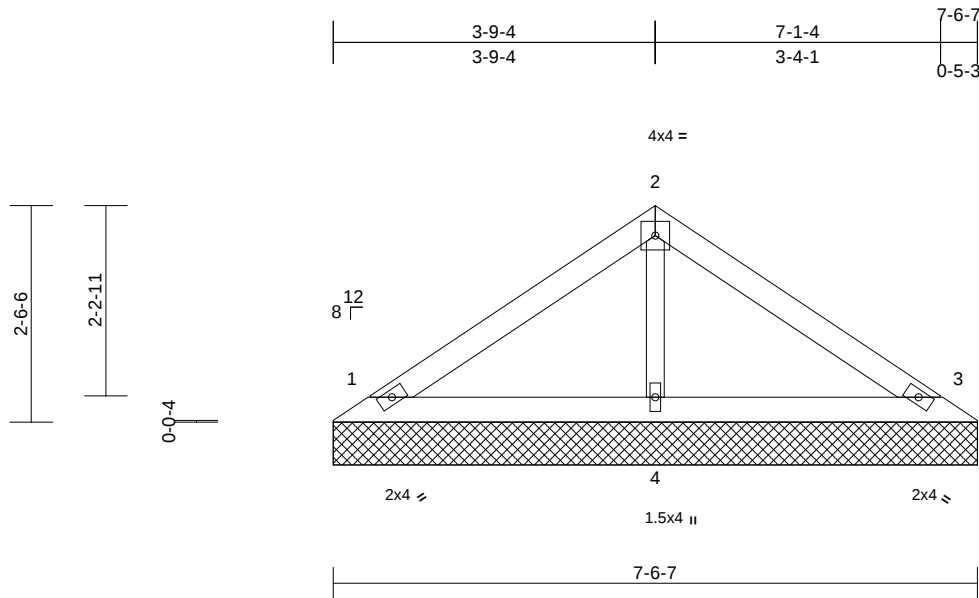

Scale = 1:27

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.24	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 25 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=7-6-7, 3=7-6-7, 4=7-6-7
Max Horiz 1=62 (LC 11)
Max Uplift 1=-42 (LC 12), 3=-50 (LC 13)
Max Grav 1=168 (LC 1), 3=168 (LC 1), 4=261 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-105/64, 2-3=-100/64
BOT CHORD 1-4=-13/50, 3-4=-13/50
WEBS 2-4=-178/96

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 1 and 50 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Roof - HR Lot 116	RELEASE FOR CONSTRUCTION
P240420-01	V05	Valley	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						164930687
						LEE'S SUMMIT, MISSOURI

Premier Building Supply (Springhill, KS), Spring Hills, KS - 66083,

Run: 8.63 S Apr 5 2024 Print: 8.630 S Apr 5 2024 MiTek Industries, Inc. Tue Apr 16 08:35:59 Page: 1

ID:6ru7F9CpA2ag5pbhdMPJqdzkXVF-RfC?PsB70Hq3NSgPqnL8w3uITXbGLWrCDot734Z9C7f

05/16/2024

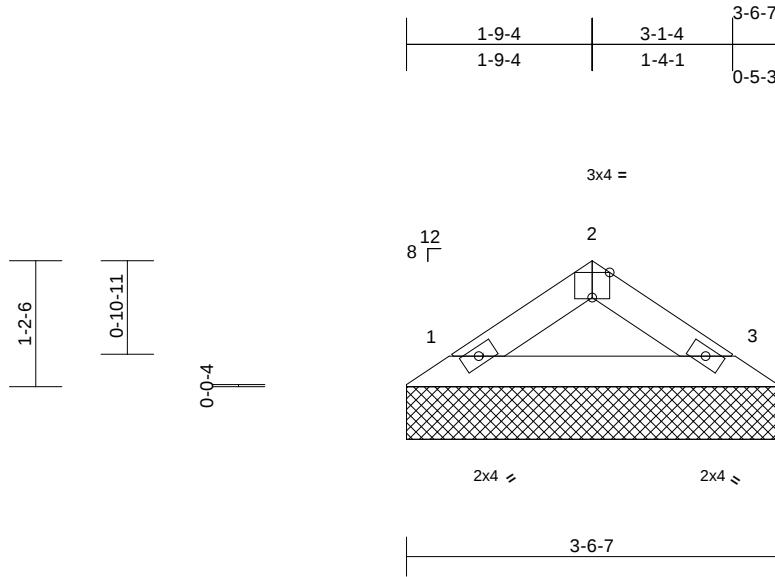

Scale = 1:21.9

Plate Offsets (X, Y): [2:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.04	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 10 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-7-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=3-6-7, 3=3-6-7
Max Horiz 1=25 (LC 11)
Max Uplift 1=-17 (LC 12), 3=-17 (LC 13)
Max Grav 1=119 (LC 1), 3=119 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-104/71, 2-3=-104/71
BOT CHORD 1-3=-26/69

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Ke=1.00; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 4-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 1 and 17 lb uplift at joint 3.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



April 17, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

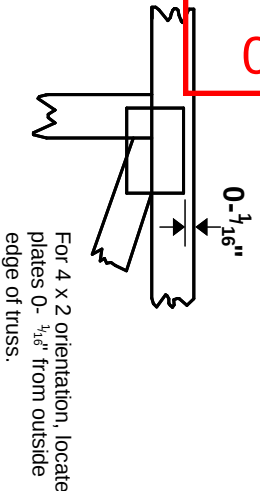

This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE


4 X 4
The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:
ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

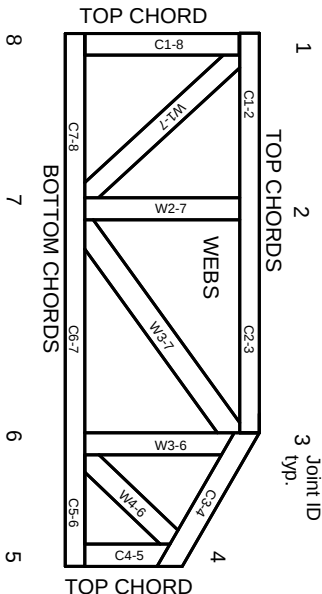

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MIL-7473 rev. 1/12/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.