

LEFT & RIGHT SIDE ELEVATION NOTES

1.12 TOP OF FOOTING DEPTH DETERMINED PER SITE.

1.41 4X4 CEDAR POST

- 1.71 CONCRETE WINDOW WELL FOR EGRESS WITH LADDER.
 PROVED SLEEVE THROUGH WALL FOR FOUNDATION
 DRAIN. TOP OF WINDOW WELL TO BE 3" BELOW TOP
 OF FOUNDATION.
- 5.11 PANEL LAP SIDING WITH 5/4X6 TRIM AROUND DOORS, WINDOWS, AND CORNERS UNLESS NOTED OTHERWISE.
- 3.13 PANEL SIDING WITH 3/4X4 TRIM AROUND DOORS, WINDOWS, AND CORNERS UNLESS NOTED OTHERWISE. BOTTOM OF SIDING SHALL BE A MINIMUM OF 6" ABOVE GRADE.
- 3.38 6X6 CEDAR POST. 1X6 TRIM AT BASE. 1X4 TRIM AT TOP.
- 4.11 MINIMUM ROOFING COMPOSITION— 30 YR COMPOSITE SHINGLES ON 15# FELT ON 1/2" OSB SHEATHING OR AS REQUIRED BY CODE.
- 4.31 BUILD CRICKET VALLEY AWAY FROM INTERSECTION FOR POSITIVE DRAINAGE.



120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

COPYRIGHT 2020

THIS DRAWING HAS BEEN PREPARED BY CLOVER AND HIVE, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, OF DISCLOSURE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE WRITTEN CONSENT FROM CPG, INC D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS STRICTLY PROHIBITED.

ADDRESS: 3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.

WIN HONEYDEW
FARMHOUSE

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> EVERSTEAD 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > DRAWN BY: M.N.S.

ISSUE DATE: 05.10.24

SHEET NUMBER:

A2.0

GENERAL NOTE

PER VENDOR.

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY

RIGHT ELEVATION (1

STRUCTURAL NOTES: ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATION RESIDENTIAL CODE OR

FOUNDATION NOTES:

ALL FOOTINGS MEET OR EXCEED MINIMUM FROST DEPTH OF 36".

ATTACHED ENGINEER SPECIFICATIONS WHERE APLLICABLE.

- SOIL BEARING CAPACITY SHALL BE 1500 PSF. COMPRESSSIVE STRENGTH OF CONCRETE FC COMPRESSIVE STRENGTH SHALL BE DAMPPROOFED. DAMPPROOFING SHALL EXTEND FROM THE EDGE OF THE FOOTING TO THE FINISHED GRADE (R-406.1). METHOD OF DAMPPROOFING OR WATERPROOFING SHALL BE A MINIMUM 6-MIL. THICK MOISTURED BARRIER OVER POROUS GRAVEL BASE UNDER BASEMENT FLOOR SLAB PER R405.2.2. LAP JOINTS SHALL BE MINIMUM 6".
- FOUNDATION WALLS SHALL BE DAMPPROOFED PER IRC SECTION R406.
- FOUNDATION DRAINAGE WILL BVE IN ACCORDANCE WITH IRC SECTION R405. BASEMENT EGRESS OPENINGS SHALL BE IN ACCORDANCE WITH IRC SECTION R310.1. ALL INTERIOR FOOTINGS OF LOAD BEARINGS WALLS AND COLUMNS SHALL BE
- ISOLATED FROM THE BASEMENT FLOOR SLAB. ALL ANCHOR BOLTS SHALL NOT BE SPACED MORE THAN 3' O.C. AND BE EMBEDDED
- INTO THE CONCRETE A MINIMUM OF 7". IF BASEMENT SLAB ELEVATION IS ABOVE GRADE CONSULT ENGINEER.

DEAD MAN SPACING:

- ALL DEAD MAN SHALL BE SPACED NO MORE THAN 16' FROM EGRESS WELL. REAR
- GARAGE WALL, 24" RETURN ON FOUNDATION WALL OR ANOTHER DEAD MAN. DEAD MEN ARE NOT REQUIRED ON EXTERIOR GARAGE WALLS OR FOUNDATION
- WALL TRANSITIONING FROM ELSS THAN 5' TALL TO MORE THAN 5' TALL WITH STEP DOWNS: A DEAD MAN IS REQUIRED WITHIN 8' OF STEP DOWN (tRANSITIONING FROM LESS THAN 5' TALL TO MORE THAN 5' TALL WALL LOCATION) ON WALL 5' TALL OR

BLOCKING NOTE:

SOLID BLOCKING BETWEEN JOISTS AT 48" O.C. EXTEND BLOCKING ONE JOIST BAY PAST EACH

SIDE OF ISLAND ABOVE

CRAWL SPACE NOTES:

- UNDER-FLOOR SPACE SHALL CONFORM TO 2018 IRC SECTION R408
- PER 2018 IRC R408.3 UNDER-FLOOR VENTILATION IS NOT REQUIRED WHERE: EXPOSED EARTH IS COVERED W/ CONTINUOUS CLASS 1 VAPER RETARDER. JOINTS SHALL OVERLAP 6" AND SHALL BE SEALED OR TAPED. EDGES OF VAPER RETARDER SHALL EXTEND 6" UP STEM WALL AND PERIMETER WALL INSULATED ACCORDANCE WITH SECT N1103.3.1 CONTINUOUSLY OPERATED MECHANICAL EXHAUST VENTILATION AT A RATE
- EQUAL TO 1 CUBIC FOOT PER MINUTE (0.47 L/s) FOR EACH 50 SQUARE FEET OF CRAWL SPACE FLOOR AREA. UNDER-FLOOR ACCESS SHALL BE PROVIDED AND SHALL BE A MINIMUM OF
- ALL WALLS OVER 10' SHALL BE DOUGLAS FIR-LARCH #2 2x4 STUDS FULL HEIGHT
- ALL WALLS OVER 12' SHALL BE DOUGLAS FIR-LARCH #2 (M-12) LUMBER 2x6 STUDS FULL HEIGHT CONTINUOUS

	ISO	OLATED	FOOTINGS AND COLUMN PA	ADS
SYM	PIER PAD SIZE	DEPTH	MINIMUM REINFORCEMENT GRADE 40 KSI STEEL	SCHEDULE 40 STEEL COLUM MIN FY = 35 KS
À	30"x30"	1'-0"	(5) #4 BAR E.W.	3" DIAMETER
B	36"x36"	1'-0"	(6) #4 BAR E.W.	3" DIAMETER
c	42"x42"	1'-2"	(7) #4 BAR E.W.	3" DIAMETER
D	48"x48"	1'-4"	(8) #4 BAR E.W.	3" DIAMETER
É	54"x54"	1'-4"	(9) #4 BAR E.W.	3.5" DIAMETEI
\wedge				

(10) #4 BAR E.W.

	ISOLA	ATED FO	OTINGS AND COLUMN PADS
SYM	PIER DIAMETER	DEPTH	MINIMUM REINFORCEMENT GRADE 40 KSI STEEL
G	12"	3'-0"	(4) VERTICAL #4
H	16"	3'-0"	(4) VERTICAL #4
J	18"	3'-0"	(4) VERTICAL #4
K	24"	3'-0"	(4) VERTICAL #4
Ĺ	28"	3'-0"	(4) VERTICAL #4

*DENOTES STEEL COLUMN NOT REQUIRED COLUMN AND PAD SIZES ARE FOR A MAXIMUM COLUMN HEIGHT OF 10'. COLUMNS GREATER THAN 10' REQUIRE A SEPARATE ENGINEERED DESIGN. FOOTINGS A-F SPACING OF 6" O.C. WITH 3" CLEAR COVER.

12'-0" WALL

WALL TYPE	NOMINAL WALL THICKNESS	VERTICAL SPACING AND SIZE	HORIZONTAL SPACING AND SIZE	FOOTING SPECIFICATION U.N.O. ON PLANS
3'-6" TRENCH FOOTING	16"	#4 BARS @18" O.C.	(2) #4 BARS TOP & BOT. CONT.	
< 6'-0" WALL		#4 BARS @36" O.C.		
8'-0" WALL	8"	#4 BARS @16" O.C.		16" x 8" CONC. FTG. W/ (2) #4 BARS CONT.
9'-0" WALL	O	#4 BARS @12" O.C.	#4 BARS @ 24" O.C.	
10'-0" WALL		#4 BARS @8" O.C.		
11'-0" WALL		#4 BARS @6" O.C.		

#4 BARS @4" O.C.

FOUNDATION WALL AND FOOTING TABLE (3000 PSI CONCRETE AND 40 KSI REBAR PLACED 2"

FROM INSIDE TENSION FACE)

3.5" DIAMETER

DIMENSIONS MEASURED FROM CENTERLINE OF PARTY WALL ASSEMBLY.

UNFINISHED **BASEMENT**

GRADE BEAM

lc-----+----

CONC FDN WALL w/

<u>UNEXC'AVAITED</u>

SEE S503 FOR PEDESTAL

** REFER TO PLOT PLAN FOR FOUNDATION ELEVATION HEIGHTS **

26'-0"


#4 at 16" OC VERT AND #4 at 18" OC HORIZ 24"x8" FTG w/ (3) #4 CONT

14'-8 3/4"

19'-4"

SEE BLOCKING NOTE,

THIS SHEET.

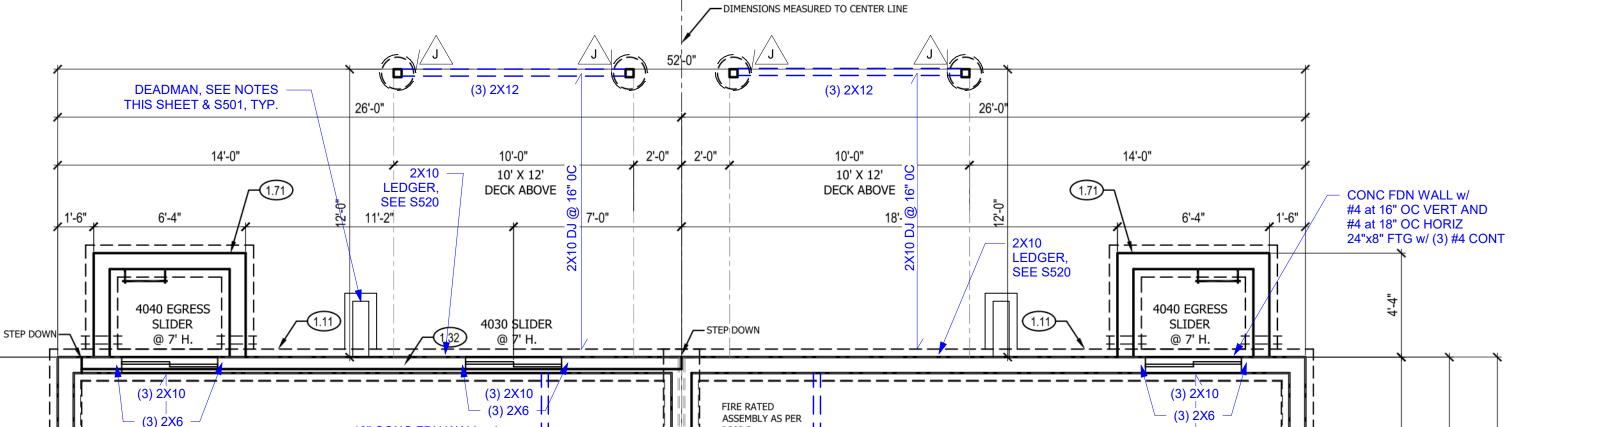

10'-2 1/4"

10" x 4' CONC FDN WALL w/

#4 at 36" OC VERT AND

20"x8" FTG w/ (2) #4 CONT

DIMENSIONS MEASURED TO CENTER LINE 21'-0"

#4 AT 18" OC HORIZ

10" CONC FDN WALL w/

#4 at 18" OC HORIZ

#4 at 16" OC VERT AND

22"x8" FTG w/ (2) #4 CONT

<u>UNFINISHED</u>

16" X 8" CONC.

W/ (2) #4 CONT.

#4 at 16" OC VERT AND #4 at 18" OC HORIZ

UNEXCÁVATED

SEE S503 FOR PEDESTAL

** REFER TO PLOT PLAN FOR FOUNDATION ELEVATION HEIGHTS **

#4 at 36" OC VERT AND

20"x8" FTG w/ (2) #4 CONT

26'-0"

#4 AT 18" OC HORIZ

7.65) 4 24"x8" FTG w/ (3) #4 CONT

GRADE BEAM (S)

#4 at 16" OC VERT AND

24"x8" FTG w/ (3) #4 CONT

ANCHOR PER 4' CONC FDN WALL W/ ANCHOR PER AN

METHOD PFH | METHOD PFH

2'-4"

#4 at 18" OC HORIZ

BASEMENT

14'-8 3/4"

19'-4"

SEE BLOCKING NOTE,

8'-0" FOUNDATION WALLS **EXCEPT AT STEP DOWNS** TO BE LOCATED IN THE FIELD OR NOTED OTHERWISE

UNBALANCED FILL NOT TO EXCEED 4'-0" AT **UNRESTRAINED WALLS**

CONC FDN WALL w/

#4 at 18" OC HORIZ

(2) 2X10 FLUSH

UNEXCAVATED

METHOD PFH

2'-4"

#4 at 16" OC VERT AND

24"x8" FTG w/ (3) #4 CONT

4' CONC FDN WALL w/

#4 AT 18" OC HORIZ 20"x8" FTG w/ (2) #4 CONT

4' CONC FDN WALL w/

#4 AT 18" OC HORIZ

#4 at 36" OC VERT AND

20"x8" FTG w/ (2) #4 CONT

#4 at 36" OC VERT AND

STEP DOWN FOOTING TO BELOW FROST LINE (3'-0") AS REQUIRED PER SITE

- CONTROL DEVICE
- 6.31 SUMP PIT AND PUMP. PROVIDE ELECTRICAL GFCI PROTECTION. PROVIDE SLEEVE THROUGH FOOTING.
- 6.62 UFER GROUND- VERIFY LOCATION WITH PROJECT
- 7.65 LINE OF FLOOR ABOVE

6.41 HVAC CHASE ABOVE

FOUNDATION PLAN NOTES

- I.11 CONTINUOUS CONCRETE FOOTING
- 1.21 RECESS TOP OF FOUNDATION WALL
- 1.31 2X4 STUD WALL WITH TREATED SILL PLATE
- 1.32 2X6 STUD WALL WITH TREATED SILL PLATE
- 1.71 CONCRETE WINDOW WELL FOR EGRESS WITH LADDER PROVED SLEEVE THROUGH WALL FOR FOUNDATION DRAIN. TOP OF WINDOW WELL TO BE 3" BELOW TOP OF FOUNDATION.
- 2.32 INSULATE CANTILEVER AS REQUIRED PRIOR TO BLOCKING
- 2.34 PROVIDE ADDITIONAL BRACING FOR ISLAND ABOVE.
- 2.42 FIRE RATED SHEETROCK UNDER STAIRS 5.51 DRAIN LINE ONLY FOR FUTURE USE. LOCATION TO BE MARKED WITH REBAR AND CUT FLUSH TO FLOOR
- 6.11 DIRECT FURNACE. FUEL BURNING APPLIANCES SHAL BE DIRECT VENTED TO EXTERIOR FOR COMBUSTION
- 6.21 HOT WATER HEATER WITH THERMAL EXPANSION
- 6.61 200 AMP ELECTRICAL PANEL. LOCATION TO BE DETERMINED ON SITE.
- MANAGER.

A CLAYTON COMPANY

CPG DBA'Z'/Z

120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

COPYRIGHT 2020 DRAWING HAS BEEN PREPARED BY CLOVER AN HIVE, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE SPECIFICATIONS. AND DESIGNS. INCLUDING OVERALL LAYOUT, FORM, AND COMPOSITION (SPACES ARE PROTECTED BY COPYRIGHT REGISTER CPG. INC. ANY REPRODUCTION. USE. DISCLOSURE OF THE INFORMATION CONTAINED HERE WITHOUT THE WRITTEN CONSENT FROM CPG, IN D/B/A SUMMIT HOMES EXCEPT AS REQUIRED F BIDDING AND CONSTRUCTION OF THIS PROJECT

STRICTLY PROHIBITED.

ADDRESS: 3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.

PROFESSIONAL SEAL



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > DRAWN BY: M.N.S.

ISSUE DATE:

05.10.24

SHEET NUMBER:

REQUIREMENTS.

SCALE: 1/4" = 1'-0"

BACK WATER VALVES REQUIRED ON ALL BASEMENT PLUMBING FIXTURES. PROVIDE MEANS OF CONTROLLING PRESSURE CAUSED BY THERMAL EXPANSION.

ALL SILLS & SLEEPERS SUPPORTED ON CONCRETE OR MASONRY

SHALL BE OF DECAY-RESISTANT MATERIALS. DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD

ALL INTERIOR NON-LOAD BEARING, NON-BRACED, NON-CABINET WALLS ARE ALLOWED AT 24" O.C.

PLACEMENT IS TO BE DETERMINED BY MUNICIPAL

SMOKE AND CARBON MONOXIDE DETECTORS SHOW ON PLAN ARE TO BE CONSIDERED RECOMMENDATIONS ONLY. FINAL

TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY

#4 BARS @ 10" O.C. PER PLAN

CONC FDN WALL w

#4 at 18" OC HORIZ

(2) 2X10 FLUSH -

4' CONC FDN WALL w/ -

#4 AT 18" OC HORIZ

#4 at 36" OC VERT AND

20"x8" FTG w/ (2) #4 CONT

UNEXCAVATED'

6" CONC. SLAB W #4 @ 12" OC EW

| L _ _ _ _

METHOD PFH

4-----


#4 at 16" OC VERT AND

24"x8" FTG w/ (3) #4 CON1

4' CONC FDN WALL w/ #4 at 36" OC VERT AND

#4 AT 18" OC HORIZ

20"x8" FTG w/ (2) #4 CONT

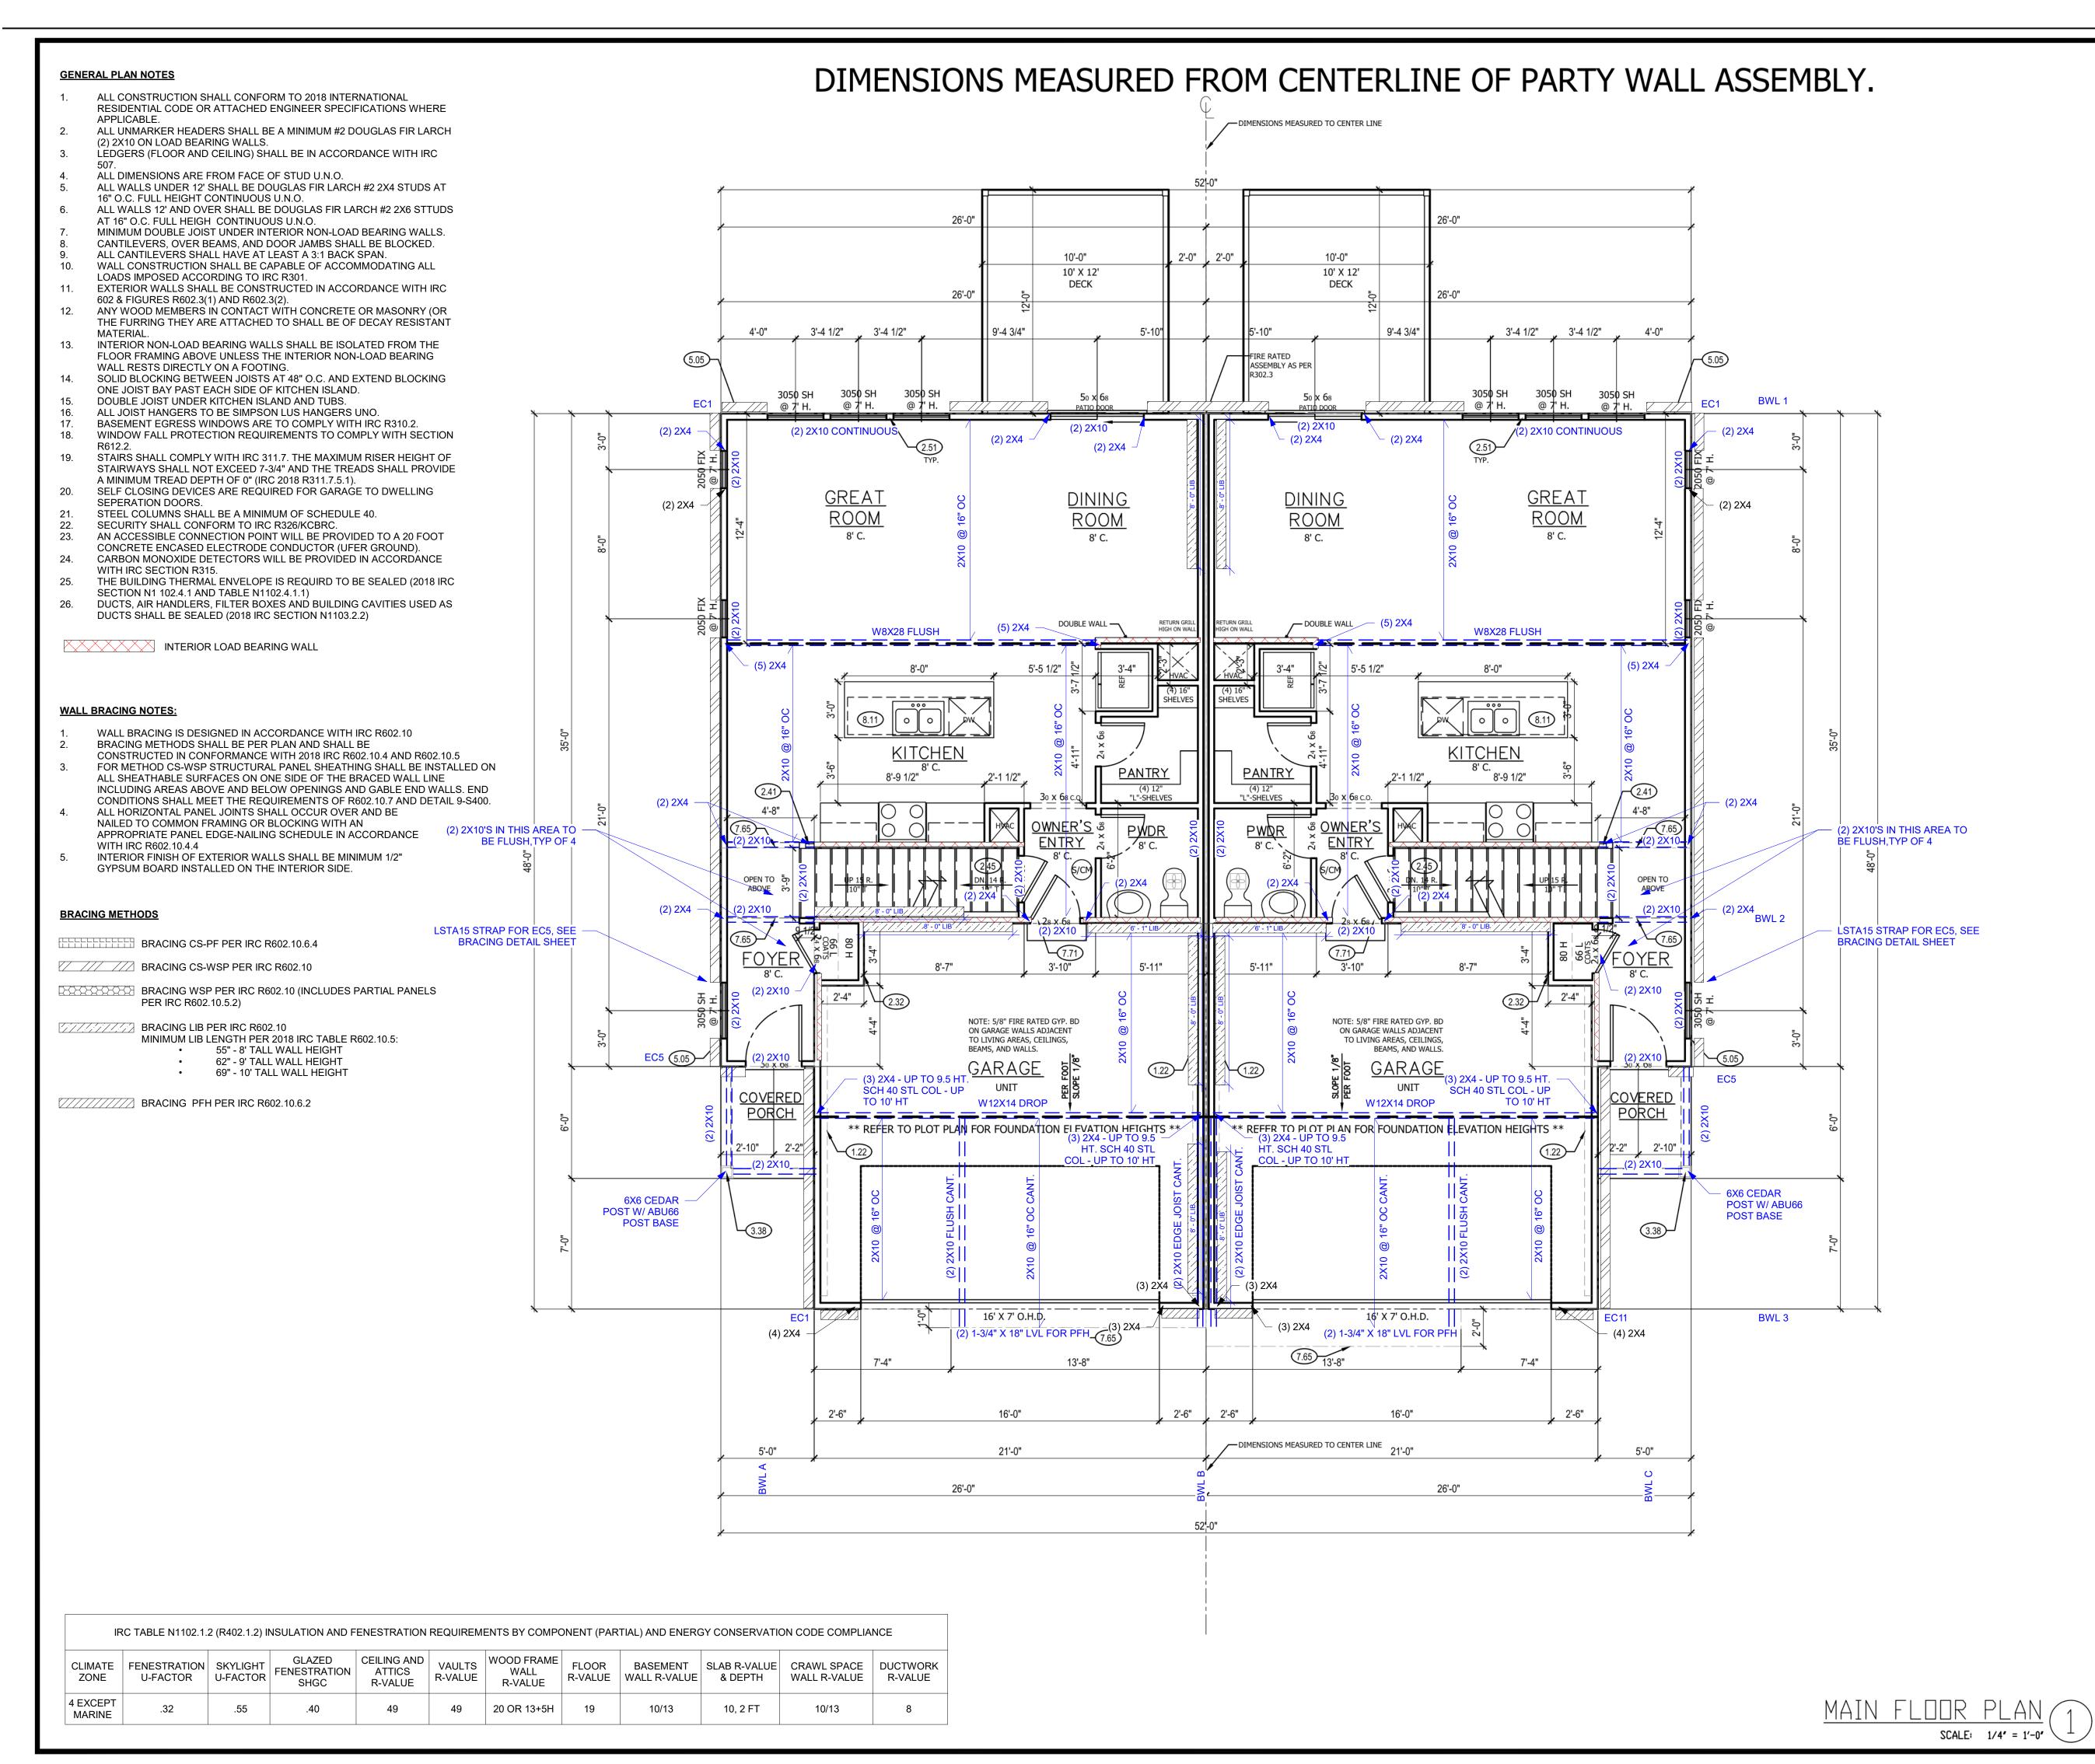

MAIN FLOOR PLAN NOTES

1.22 EXPOSED TOP OF FOUNDATION WALL.

2.32 INSULATE CANTILEVER AS REQUIRED PRIOR TO

2 A1 CURR STAIR SYSTEM WITH OPEN HANDRAIL

2.41 CURB STAIR SYSTEM WITH OPEN HANDRAIL

2.45 STAIRS TO LOWER LEVEL UNFINISHED

2.51 3 STUDS BETWEEN WINDOW UNITS3.38 6X6 CEDAR POST. 1X6 TRIM AT BASE. 1X4 TRIM AT

5.05 HOSE BIBB

GENERAL NOTES

PROTECTION.

OTHERWISE.

REQUIREMENTS.

WINDOWS TO COMPLY WITH IRC R312.2 FOR FALL

ALL INTERIOR NON-LOAD BEARING, NON-BRACED,

NON-CABINET WALLS ARE ALLOWED AT 24" O.C.

TRUSSES UNLESS NOTED OTHERWISE.

ALL EXTERIOR WALLS, INTERIOR BEARING WALLS, AND INTERIOR BRACED WALLS ARE AT 16" O.C. UNLESS NOTED

ROOF AND CEILING FRAMING ARE PRE-ENGINEERED WOOD

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD

TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY

PROVIDE BLOCKING AT ALL CEILING JUMPS FOR INSULATION.

SMOKE AND CARBON MONOXIDE DETECTORS SHOW ON PLANS ARE TO BE CONSIDERED RECOMMENDATIONS ONLY. FINAL

2X6 EXTERIOR WALL OVER 12' SHALL BE DOUGLAS FIR #2.

PLACEMENT IS TO BE DETERMINED BY MUNICIPAL

HUNG, 3066 FIX = 3'-0" X 6'-6" FIXED.

WINDOW SIZES ARE WRITTEN IN FEET AND INCHES PER

INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE

7.65 LINE OF FLOOR ABOVE

7.71 20 MINUTE FIRE RATED SOLID CORE WITH

SELF-CLOSING HINGES

8.11 24" CABINET + 12" OVERHANG FLAT ISLAND. VERIFY LOCATION WITH PERSONAL BUILDER.

summit

CPG DB/6/27/2

120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

A CLAYTON COMPANY

COPYRIGHT 2020

THIS DRAWING HAS BEEN PREPARED BY CLOVER AND HIVE, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, OR DISCLOSURE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE WRITTEN CONSENT FROM CPG, INC. D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS STRICTLY PROHIBITED.

ADDRESS: 3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.

FARMHOUSE PSAGE #86

PROFESSIONAL SEAL:

OF MISSOPHER PAUL DAVIS NUMBER PE-2015016986 05/30/2024

EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> EVERSTEAD 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > DRAWN BY: M.N.S.

ISSUE DATE:

05.10.24

SHEET NUMBER:

A4.0

DIMENSIONS MEASURED FROM CENTERLINE OF PARTY WALL ASSEMBLY. **GENERAL PLAN NOTES**

ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATIONAL

(2) 2X10 ON LOAD BEARING WALLS.

ALL DIMENSIONS ARE FROM FACE OF STUD U.N.O.

16" O.C. FULL HEIGHT CONTINUOUS U.N.O.

LOADS IMPOSED ACCORDING TO IRC R301.

602 & FIGURES R602.3(1) AND R602.3(2).

WALL RESTS DIRECTLY ON A FOOTING.

ONE JOIST BAY PAST EACH SIDE OF KITCHEN ISLAND.

A MINIMUM TREAD DEPTH OF 0" (IRC 2018 R311.7.5.1).

SECURITY SHALL CONFORM TO IRC R326/KCBRC.

SECTION N1 102.4.1 AND TABLE N1102.4.1.1)

INTERIOR LOAD BEARING WALL

WALL BRACING NOTES:

BRACING METHODS

WITH IRC R602.10.4.4

STEEL COLUMNS SHALL BE A MINIMUM OF SCHEDULE 40.

DUCTS SHALL BE SEALED (2018 IRC SECTION N1103.2.2)

WALL BRACING IS DESIGNED IN ACCORDANCE WITH IRC R602.10

ALL HORIZONTAL PANEL JOINTS SHALL OCCUR OVER AND BE NAILED TO COMMON FRAMING OR BLOCKING WITH AN

INTERIOR FINISH OF EXTERIOR WALLS SHALL BE MINIMUM 1/2"

BRACING WSP PER IRC R602.10 (INCLUDES PARTIAL PANELS

MINIMUM LIB LENGTH PER 2018 IRC TABLE R602.10.5: 55" - 8' TALL WALL HEIGHT

U-FACTOR U-FACTOR FENESTRATION ATTICS

SHGC

R-VALUE

CLIMATE | FENESTRATION | SKYLIGHT |

4 EXCEPT

MARINE

62" - 9' TALL WALL HEIGHT 69" - 10' TALL WALL HEIGHT

GYPSUM BOARD INSTALLED ON THE INTERIOR SIDE.

BRACING CS-PF PER IRC R602.10.6.4

PER IRC R602.10.5.2)

BRACING CS-WSP PER IRC R602.10

BRACING LIB PER IRC R602.10

BRACING PFH PER IRC R602.10.6.2

APPROPRIATE PANEL EDGE-NAILING SCHEDULE IN ACCORDANCE

CONSTRUCTED IN CONFORMANCE WITH 2018 IRC R602.10.4 AND R602.10.5

ALL SHEATHABLE SURFACES ON ONE SIDE OF THE BRACED WALL LINE

BRACING METHODS SHALL BE PER PLAN AND SHALL BE

ALL JOIST HANGERS TO BE SIMPSON LUS HANGERS UNO.

DOUBLE JOIST UNDER KITCHEN ISLAND AND TUBS.

AT 16" O.C. FULL HEIGH CONTINUOUS U.N.O.

RESIDENTIAL CODE OR ATTACHED ENGINEER SPECIFICATIONS WHERE

ALL UNMARKER HEADERS SHALL BE A MINIMUM #2 DOUGLAS FIR LARCH

LEDGERS (FLOOR AND CEILING) SHALL BE IN ACCORDANCE WITH IRC

ALL WALLS UNDER 12' SHALL BE DOUGLAS FIR LARCH #2 2X4 STUDS AT

ALL WALLS 12' AND OVER SHALL BE DOUGLAS FIR LARCH #2 2X6 STTUDS

MINIMUM DOUBLE JOIST UNDER INTERIOR NON-LOAD BEARING WALLS.

CANTILEVERS, OVER BEAMS, AND DOOR JAMBS SHALL BE BLOCKED.

WALL CONSTRUCTION SHALL BE CAPABLE OF ACCOMMODATING ALL

EXTERIOR WALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH IRC

ANY WOOD MEMBERS IN CONTACT WITH CONCRETE OR MASONRY (OR

INTERIOR NON-LOAD BEARING WALLS SHALL BE ISOLATED FROM THE

FLOOR FRAMING ABOVE UNLESS THE INTERIOR NON-LOAD BEARING

SOLID BLOCKING BETWEEN JOISTS AT 48" O.C. AND EXTEND BLOCKING

WINDOW FALL PROTECTION REQUIREMENTS TO COMPLY WITH SECTION

STAIRS SHALL COMPLY WITH IRC 311.7. THE MAXIMUM RISER HEIGHT OF STAIRWAYS SHALL NOT EXCEED 7-3/4" AND THE TREADS SHALL PROVIDE

SELF CLOSING DEVICES ARE REQUIRED FOR GARAGE TO DWELLING

AN ACCESSIBLE CONNECTION POINT WILL BE PROVIDED TO A 20 FOOT CONCRETE ENCASED ELECTRODE CONDUCTOR (UFER GROUND).

CARBON MONOXIDE DETECTORS WILL BE PROVIDED IN ACCORDANCE


THE BUILDING THERMAL ENVELOPE IS REQUIRD TO BE SEALED (2018 IRC

DUCTS, AIR HANDLERS, FILTER BOXES AND BUILDING CAVITIES USED AS

BASEMENT EGRESS WINDOWS ARE TO COMPLY WITH IRC R310.2.

THE FURRING THEY ARE ATTACHED TO SHALL BE OF DECAY RESISTANT

ALL CANTILEVERS SHALL HAVE AT LEAST A 3:1 BACK SPAN.

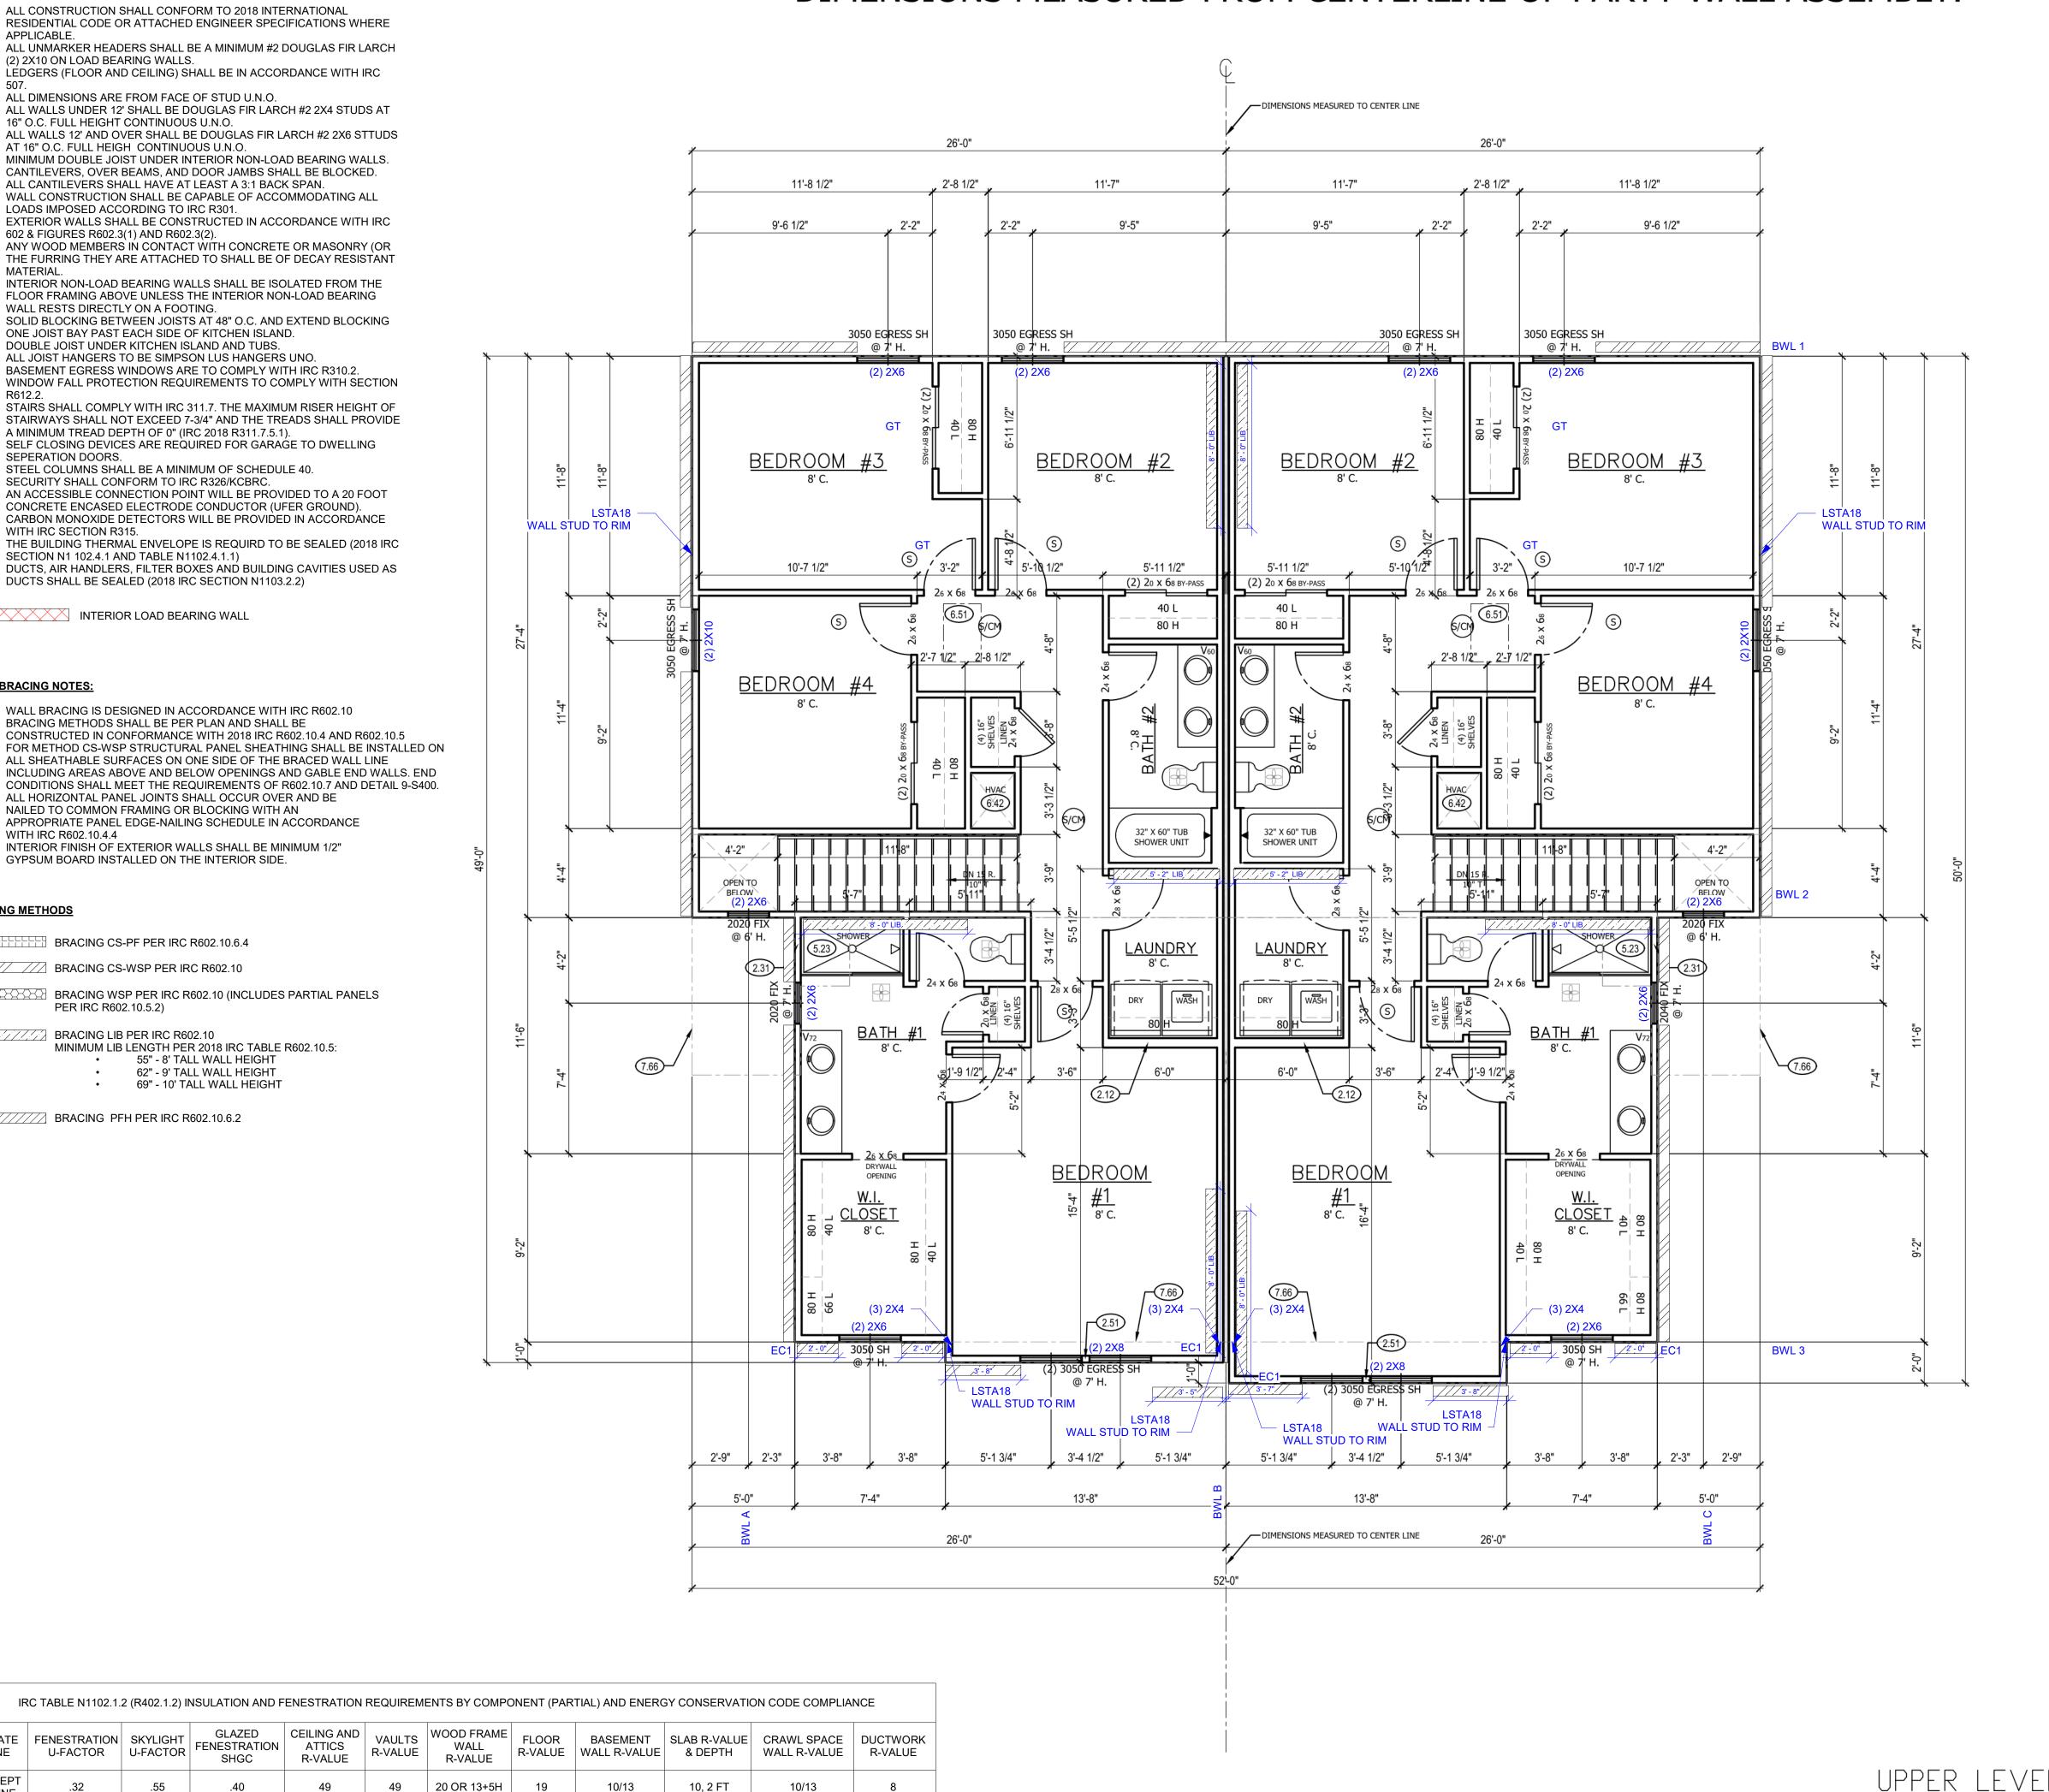

JPPER FLOOR PLAN NOTES

2.12 2X6 STUD WALL

2.31 SIX SIDED TUB ASSEMBLY INCLUDING THERMOPLY ON EXTERIOR WALL TO 2" ABOVE TOP OF TUB DECK OR TUB/SHOWER UNIT

5.23 FIBERGLASS SHOWER UNIT. SEE PRICE SUMMARY FOR DETAILS.

2.51 3 STUDS BETWEEN WINDOW UNITS

6.42 HVAC - BUMP TRUSSES AS NECESSARY FOR HVAC

6.51 1'-10"X3'-0" MINIMUM ATTIC ACCESS WITH 3/4" BACKER BOARD AND 2 LATCHES. BUMP TRUSSES FOR ATTIC ACCESS.

7.66 LINE OF FLOOR BELOW

GENERAL NOTES

PROTECTION.

PER VENDOR.

REQUIREMENTS.

WINDOWS TO COMPLY WITH IRC R312.2 FOR FALL

ALL INTERIOR NON-LOAD BEARING, NON-BRACED,

NON-CABINET WALLS ARE ALLOWED AT 24" O.C.

TRUSSES UNLESS NOTED OTHERWISE.

ALL EXTERIOR WALLS, INTERIOR BEARING WALLS, AND

INTERIOR BRACED WALLS ARE AT 16" O.C. UNLESS NOTED

ROOF AND CEILING FRAMING ARE PRE-ENGINEERED WOOD

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD

TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY

PROVIDE BLOCKING AT ALL CEILING JUMPS FOR INSULATION.

ARE TO BE CONSIDERED RECOMMENDATIONS ONLY. FINAL

WINDOW SIZES ARE WRITTEN IN FEET AND INCHES PER

INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE

PLACEMENT IS TO BE DETERMINED BY MUNICIPAL

HUNG, 3066 FIX = 3'-0" X 6'-6" FIXED.

SMOKE AND CARBON MONOXIDE DETECTORS SHOW ON PLANS

2X6 EXTERIOR WALL OVER 12' SHALL BE DOUGLAS FIR #2.

CPGLDBA/27/2

A CLAYTON COMPANY

120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

COPYRIGHT 2020 IS DRAWING HAS BEEN PREPARED BY CLOVER AND HIVE. OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS. AND DESIGNS. INCLUDING TH OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED CPG. INC. ANY REPRODUCTION. USE. WITHOUT THE WRITTEN CONSENT FROM CPG, INC D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS TRICTLY PROHIBITED.

ADDRESS: 3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

EVERSTEAD 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> DRAWN BY: M.N.S.

ISSUE DATE:

05.10.24

SHEET NUMBER:

(2) H2.5A -

13'-8"

(2) H2.5A -

7'-4"

26'-0"

(1) H2.5A EACH |

TRUSS, THIS

WALL

(2) H2.5A

13'-8"

- (2) H2.5A

7'-4"

26'-0"

(1) H2.5A EACH

5'-0"

TRUSS, THIS

WALL



AS NOTED FOR PLAN REVIEW

120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

A CLAYTON COMPANY

COPYRIGHT 2020

THIS DRAWING HAS BEEN PREPARED BY CLOVER AND HIVE, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, OR DISCLOSURE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE WRITTEN CONSENT FROM CPG, INC. D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS STRICTLY PROHIBITED.

ADDRESS: 3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.

FARMHOUSE OSAGE #86

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> EVERSTEAD 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > DRAWN BY: M.N.S.

05.10.24

SHEET NUMBER:

A6.0

GENERAL NOTES

CONNECT TRUSS TO WALL STUDS OR

STUDS WITH MIN (4) 10D COMMON NAILS

SCALE: 1/4" = 1'-0"

BLOCKING. FASTEN BLOCKING TO

ROOF AND CEILING FRAMING ARE PRE-ENGINEERED ROOF TRUSSES.

ASPHALT SHINGLES MIN 2/12. FLASH ALL PENETRATIONS AND INTERSECTIONS.

VENTILATION

ENCLOSED ATTICS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATING OPENINGS SHALL BE PROVIDED WITH CORROSION-RESISTANT WIRE MESH, WITH 1/8" TO 1/4" OPENINGS. THE TOTAL FREE VENTILATING AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF SPACE VENTILATED, EXCEPT WHERE THE VENTILATORS AREA LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED THE REQUIRED AREA MAY BE REDUCED TO 1/300.

BUILD CRICKET VALLEY AWAY FROM INTERSECTION FOR POSITIVE DRAINAGE. SEE FRAMING SPECIFICATIONS FOR

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER VENDOR.

PROVIDE BLOCKING AT ALL CEILING JUMPS FOR INSULATION.

PROVIDE FOAM INSULATION AT EXTERIOR WHERE MAIN LEVEL ROOF LINE MEETS UPPER LEVEL WALLS.

CONNECT TRUSS TO WALL STUDS OR
BLOCKING. FASTEN BLOCKING TO
STUDS WITH MIN (4) 10D COMMON NAILS

ONE LAYER 1/2" THICK GYPSUM BOARD (USG SHEETROCK BRAND GYPSUM PANELS) GYPSUM BOARD:

WOOD STUDS: 2x4 WOOD STUDS, 24" O.C.

INSULATION: MIN. 3" GLASS FIBER BATT INSULATION IN CAVITY

AIR SPACE: 3/4" AIR SPACE STEEL STUDS: 2" H-STUD, 24" O.C.

GYPSUM BOARD: TWO LAYER 1" THICK BY NOM. 2' WIDE GYPSUM LINER PANELS FRICTION FIT (UL TYPE SLX)

AIR SPACE: 3/4" AIR SPACE


WOOD STUDS: 2x4 WOOD STUDS, 24" O.C.

INSULATION: MIN. 3" GLASS FIBER BATT INSULATION IN CAVITY

GYPSUM BOARD: ONE LAYER 1/2" THICK GYPSUM BOARD (USG SHEETROCK BRAND GYPSUM PANELS)

2' - 0" 2'-0" [610 mm] [610 mm] 2' - 0"

[610 mm]

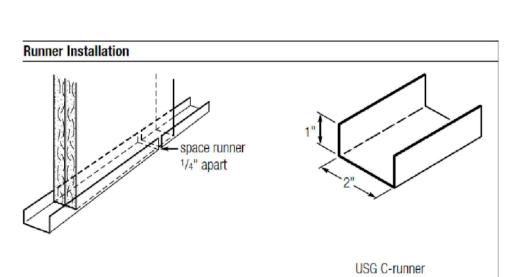

UL DESIGN NO. U336 B

2 HOUR


11 1/2"


RAL-TL88-350


FIRE RATING:


SOUND TEST:


SYSTEM THICKNESS:

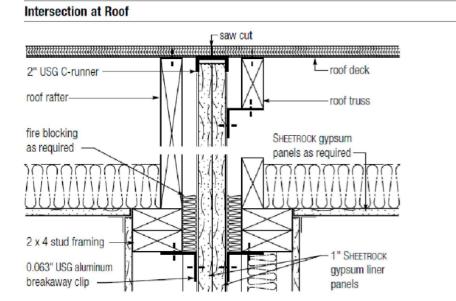


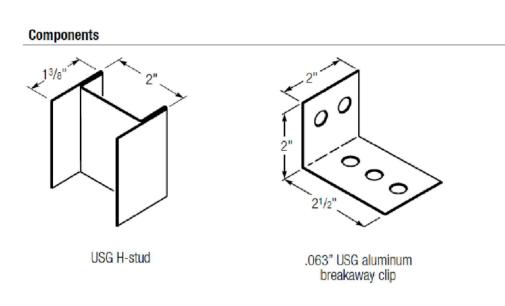

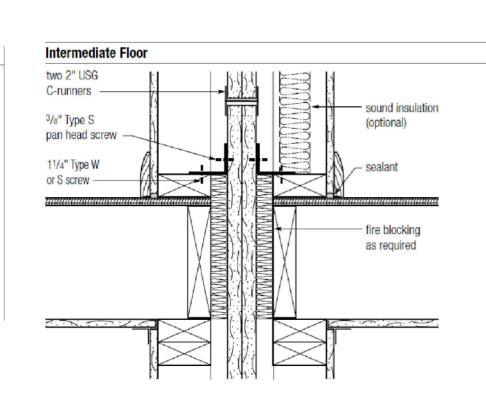

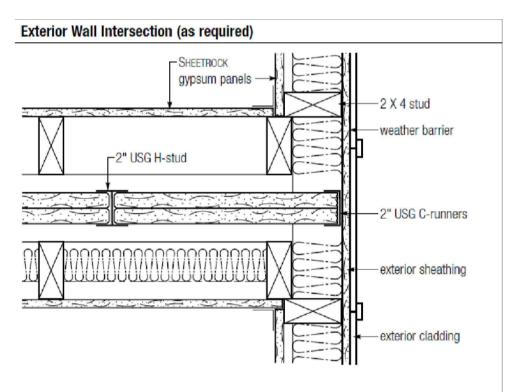

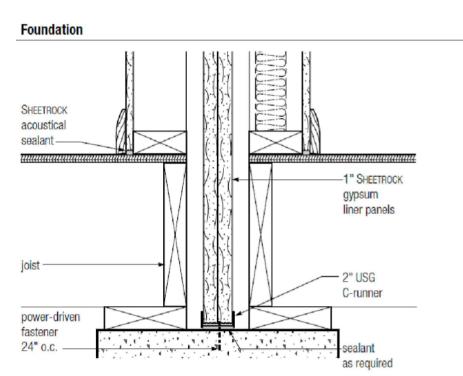

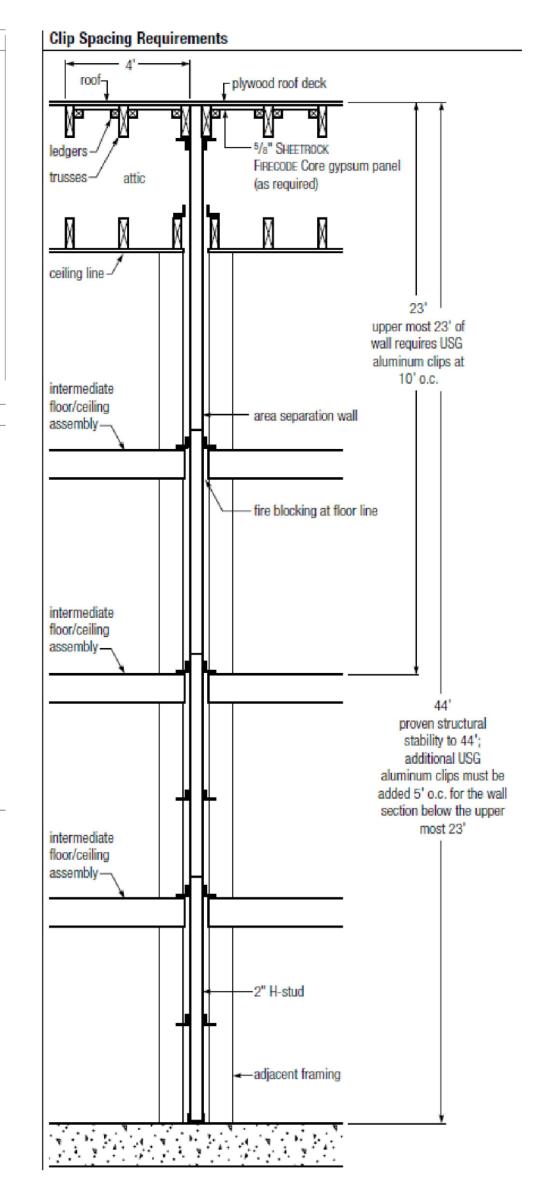

Typical Area **Separation Wall** 2 x 4 stud framing SHEETROCK® brand gypsum panels (as required) 1" Sheetrock® brand gypsum liner panels, or SHEETROCK® brand Mold Tough® liner panels or Sheetrock® brand glass-mat liner panels sound batts min. 3/4" airspace between 2" area separation wall and wood framing 2" H-studs 24" o.c. 2" USG C-runners USG aluminum breakaway clip fire blocking as required

fire blocking as required

PROFESSIONAL SEAL

DAVIS NUMBER PE-2015016986 05/30/2024

STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS ROOF AND CEILING FRAMING ARE PRE-ENGINEERED ROOF WERE PROVIDED BY OTHERS.

ASPHALT SHINGLES MIN 2/12. FLASH ALL PENETRATIONS AND INTERSECTIONS.

VENTILATION:

GENERAL NOTES

ENCLOSED ATTICS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATING OPENINGS SHALL BE PROVIDED WITH CORROSION-RESISTANT WIRE MESH, WITH 1/8" TO 1/4" OPENINGS. THE TOTAL FREE VENTILATING AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF SPACE VENTILATED, EXCEPT WHERE THE VENTILATORS AREA LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED THE REQUIRED AREA MAY BE REDUCED TO 1/300.

BUILD CRICKET VALLEY AWAY FROM INTERSECTION FOR POSITIVE DRAINAGE. SEE FRAMING SPECIFICATIONS FOR DETAILS.

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER VENDOR.

PROVIDE BLOCKING AT ALL CEILING JUMPS FOR INSULATION.

PROVIDE FOAM INSULATION AT EXTERIOR WHERE MAIN LEVEL ROOF LINE MEETS UPPER LEVEL WALLS.

HOMES A CLAYTON COMPANY

120 SE 30TH ST.

COPYRIGHT 2020 THIS DRAWING HAS BEEN PREPARED BY CLOVER AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, O DISCLOSURE OF THE INFORMATION CONTAINED HEREI WITHOUT THE WRITTEN CONSENT FROM CPG, INC. D/B/A SUMMIT HOMES EXCEPT AS REQUIRED BIDDING AND CONSTRUCTION OF THIS PROJECT STRICTLY PROHIBITED.

LEE'S SUMMIT, MO 64082

816-246-6700

ADDRESS: 3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.

> I HONEYDEW FARMHOUSE OSAGE #86 NIWT

EVERSTEAD IS RESPONSIBLE FOR

DRAWN BY: M.N.S.

3741 NE TROON DR.

LEES SUMMIT, MO 64064

816-399-4901

ISSUE DATE: 05.10.24

CPG DBA/2

summi

A CLAYTON COMPANY

120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

STRUMENT OF SERVICE AND IS INTENDED FOR

3717 SW KNOXVILLE CT. 3719 SW KNOXVILLE CT.


WIN HONEYDEW
FARMHOUSE

METAL PIPE THROUGH GYPSUM WALL ASSEMBLY

F-RATING = 2-HR. T-RATING = 0-HR.

L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT L-RATING AT 400°F = LESS THAN 4 CFM / SQ FT

FRONT VIEW A <>─

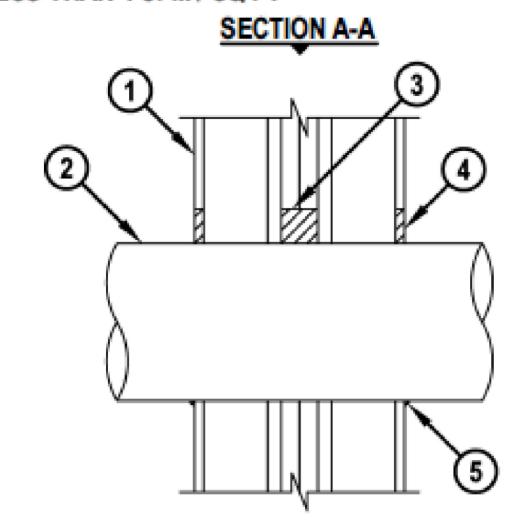

- 1. GYPSUM WALL ASSEMBLY (UL/cUL CLASSIFIED U300 SERIES) (2-HR. FIRE-RATING) CONSISTING OF THE FOLLOWING:
 - A. NOMINAL 2 x 4 STUDS SPACED MAXIMUM 24" OC.
 - B. STEEL "H" SHAPED STUDS SPACED MAXIMUM 24" OC.
 - C. TWO LAYERS 1" GYPSUM SHAFT LINER PANELS.
 - D. MINIMUM 1/2" THICK GYPSUM WALLBOARD.
- 2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 - A. MAXIMUM 8" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 5 OR HEAVIER).
 - B. MAXIMUM 8" NOMINAL DIAMETER CAST OR DUCTILE IRON PIPE.
 - C. MAXIMUM 4" NOMINAL DIAMETER COPPER PIPE OR TUBING.
 - D. MAXIMUM 6" NOMINAL DIAMETER STEEL CONDUIT.
 - E. MAXIMUM 4" NOMINAL DIAMETER EMT.
- 3. MINIMUM 2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED WITHIN GYPSUM SHAFT LINER PANELS.
- 4. MINIMUM 1/2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED FLUSH WITH OUTER SURFACES OF GYPSUM WALLBOARD.
- 5. MINIMUM 1/4" BEAD FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT AT OUTER SURFACE OF GYPSUM WALLBOARD.


NOTES: 1. MAXIMUM DIAMETER OF OPENING = 10-1/2".

ANNULAR SPACE = MINIMUM 0", MAXIMUM 1-7/8".

UL SYSTEM NO. W-L-2472

PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY

F-RATING = 2-HR. T-RATING = 2-HR.

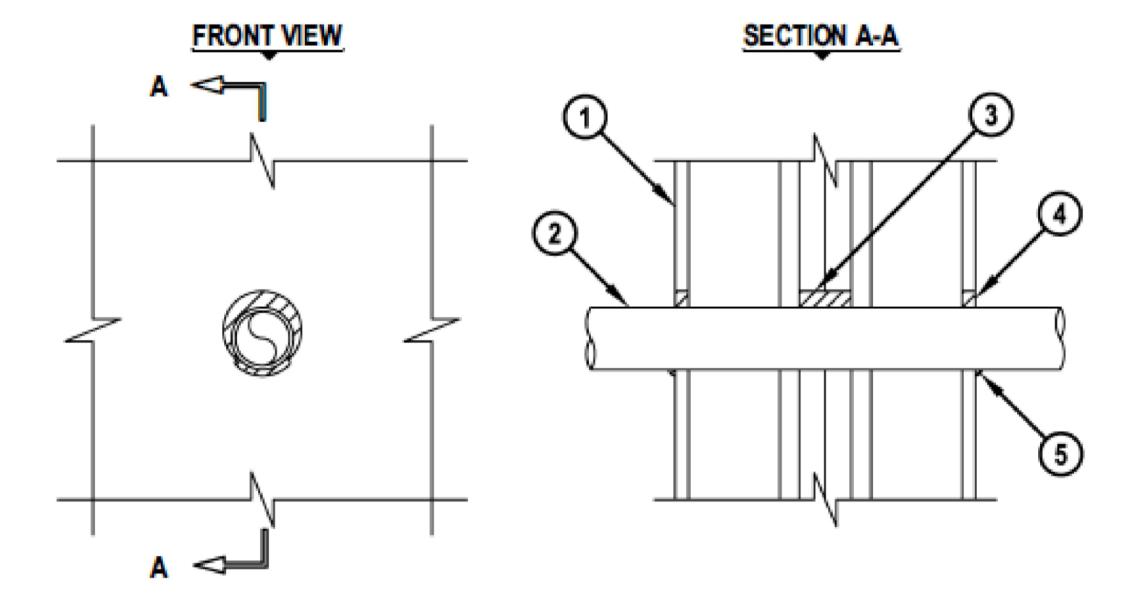

- 1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 SERIES) (2-HR. FIRE-RATING) CONSISTING OF THE FOLLOWING:
 - A. NOMINAL 2 x 4 STUDS SPACED MAXIMUM 24" OC.
 - B. STEEL "H" SHAPED STUDS SPACED MAXIMUM 24" OC.
 - C. TWO LAYERS 1" GYPSUM SHAFT LINER PANELS.
 - D. MINIMUM 1/2" THICK GYPSUM WALLBOARD.
- 2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
 - A. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (CELLULAR OR SOLID CORE).
 - B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (CLOSED PIPING SYSTEM ONLY).
 - C. MAXIMUM 2" NOMINAL DIAMETER RNC-PVC CONDUIT.
- 3. MINIMUM 2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED WITHIN GYPSUM SHAFT LINER PANELS.
- 4. MINIMUM 1/2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED FLUSH WITH OUTER SURFACES OF GYPSUM WALLBOARD.
- 5. MINIMUM 1/4" BEAD FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT AT OUTER SURFACE OF GYPSUM WALLBOARD.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".

- ANNULAR SPACE = MINIMUM 0", MAXIMUM 5/8".
- CLOSED OR VENTED PIPING SYSTEM (PVC, RNC = SCHEDULE 40; CPVC = SDR 13.5).

NSG

GENERAL NOTES

ROOF AND CEILING FRAMING ARE PRE-ENGINEERED ROOF

ASPHALT SHINGLES MIN 2/12. FLASH ALL PENETRATIONS AND

ENCLOSED ATTICS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF RAIN OR SNOW. VENTILATING OPENINGS SHALL BE PROVIDED WITH CORROSION-RESISTANT WIRE MESH, WITH 1/8" TO 1/4" OPENINGS. THE TOTAL FREE VENTILATING AREA SHALL NOT BE LESS THAN 1/150 OF THE AREA OF SPACE VENTILATED, EXCEPT WHERE THE VENTILATORS AREA LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED THE REQUIRED AREA MAY BE REDUCED TO 1/300.

BUILD CRICKET VALLEY AWAY FROM INTERSECTION FOR POSITIVE DRAINAGE. SEE FRAMING SPECIFICATIONS FOR

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY

PROVIDE BLOCKING AT ALL CEILING JUMPS FOR INSULATION

PROVIDE FOAM INSULATION AT EXTERIOR WHERE MAIN LEVEL ROOF LINE MEETS UPPER LEVEL WALLS.

EVERSTEAD IS RESPONSIBLE FOR

DAVIS NUMBER

PE-2015016986 05/30/2024

PROFESSIONAL SEAL

WERE PROVIDED BY OTHERS. 3741 NE TROON DR. LEES SUMMIT, MO 64064

816-399-4901

M.N.S.

STRUCTURAL SPECIFICATIONS

ONLY. ARCHITECTURAL PLANS

DRAWN BY:

ISSUE DATE:

SHEET NUMBER:

05.10.24

A.2 LOADING ASSUMPTIONS

ROOF + CEILING (NO STORAGE) 15 PSF ROOF + CEILING (STORAGE) 20 PSF 10 PSF CEILING JOISTS (STORAGE) EXTERIOR BALCONY / DECK 10 PSF INTERIOR FLOOR (MAIN FLOOR) 15 PSF INTERIOR FLOOR (UPPER FLOORS) 10 PSF 8" THICK MASONRY WALL 96 PSF 6" THICK MASONRY WALL 72 PSF 15 PSF EXTERIOR LIGHT FRAMED WOOD WALLS INTERIOR LIGHT FRAMED WOOD WALLS 10 PSF (INTERIOR WALLS INCLUDED IN 15 PSF DEAD LOAD)

ROOF LIVE LOAD

FLOOR LIVE LOAD 40 PSF (HABITABLE) GARAGE 50 PSF WITH 2000 LB POINT LOAD STORAGE 20 PSF (UNINHABITABLE) GUARDRAIL

CONTINUOUS LINEAR MAXIMUM POINT 200 LBS

GROUND SNOW LOAD 20 PSF

VELOCITY 115 MPH **EXPOSURE CATEGORY**

SOIL AND SITE ASSUMPTIONS

- FOUNDATION DESIGN ASSUMES MINIMUM SOIL BEARING FOR THE SITE OF 1,500 PSF (2,000 PSF FOR KANSAS CITY, MO) UNLESS OTHERWISE NOTED. CONTRACTOR TO VISUALLY INSPECT THE SITE OR PROVIDE GEOTECHNICAL INVESTIGATION TO VERIFY MINIMUM ACCEPTABLE SOIL CONDITIONS FOR CL (SILTY CLAY) AS DEFINED BY 2018 IRC. THE CONTRACTOR IS RESPONSIBLE FOR ANY SOIL CONDITION THAT DOES NOT MEET THE MINIMUM REQUIREMENTS AND FOR CONTACTING THE ENGINEER OF
- ACCESSORY STRUCTURES WITH AN EAVE HEIGHT LESS THAN 10'-0" AND AN AREA LESS THAN 600 FT MAT PROVIDE A MINIMUM SOIL COVER OF 12 INCHES MEASURED FROM THE BOTTOM OF CONCRETE.
- LATERAL SOIL PRESSURES UNLESS OTHERWISE NOTED

ACTIVE AT REST 100 PSF

SITE GRADING SHALL PROVIDE POSITIVE DRAINAGE AWAY FROM THE STRUCTURE AT A MINIMUM OF 0.5% (6" IN THE FIRST 10'-0"). ALTERNATE APPROACHES MAY BE APPROVED IF THE ALTERNATE DESIGN IS EQUIVALENT IN EFFECTIVENESS AND PERFORMANCE, AND PROVIDES FOR POSITIVE SITE DRAINAGE.

FOUNDATION NOTES

FOUNDATION ANCHORAGE (IRC R403.1.6)

- SILL PLATES SHALL BE BOLTED TO THE FOUNDATION WALL WITH A MINIMUM 1/2" DIAMETER ANCHOR BOLTS EMBEDDED AT LEAST 7" INTO THE CONCRETE.
- BOLTS SHALL BE SPACED NO GREATER THAN 6'-0" O.C.
- THERE SHALL BE A MINIMUM OF TWO BOLTS PER PLATE SECTION, WITH A BOLT PLACED WITHIN 12" AND NOT CLOSER THAN 7 BOLT DIAMETERS OF THE END OF EACH PLATE SECTION
- A PROPERLY SIZED NUT AND WASHER SHALL BE TIGHTENED ON EACH BOLT TO THE PLATE, (NOTE: 7" EMBEDMENT + 1-1/2" SILL PLATE + 3/4" FOR NUT AND WASHER EQUALS A 9-1/4" LONG
- WALL BRACING METHODS (IRC R602) MAY REQUIRE ADDITIONAL ANCHORAGE.

C.2 CONCRETE SLABS

- CONCRETE SLABS PLACED ON FILL MATERIAL WHICH SHALL BE COMPARED TO ENSURE UNIFORM SUPPORT OF THE SLAB AND SHALL NOT EXCEED 24" OF COMPACTED GRANULATED MATERIAL (SAND OR GRAVEL) OR 8" OF EARTH:
 - THIS MAY OCCUR AT GARAGE FLOOR FILLS, OR OVER EXCAVATED AREAS UNDER FLOOR SLABS.
 - THE DESIGN AND INSTALLATION DETAILS IN THIS DOCUMENT (WHERE APPLICABLE BASED ON SIZE AND SPACING LIMITATIONS) MAY BE USED IN LIEU OF PROVIDING A SEPARATE DESIGN.
 - STRUCTURAL SLABS EXCEEDING THE SPANS AND CONDITIONS OF THE APPROVED DETAILS SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER.
- SLABS AT MAX 4'-0" OVER-DIG ADJACENT TO FOUNDATION WALL:
 - WHERE SOIL IS EXCAVATED FOR A MAXIMUM DIMENSION OF 4'-0" HORIZONTALLY ADJACENT TO A FOUNDATION WALL. THE STANDARD OVER-DIG DETAIL MAY BE USED IN LIEU OF A COMPLETE STRUCTURAL SLAB.
 - SEE "TYPICAL FOOTING/FOUNDATION WALL/STANDARD SLAB AT MAX 4'-0" OVER-DIG" DETAIL.

VAPOR RETARDER / BARRIER (IRC R506.2.3)

A 6 MILLIMETER POLYETHYLENE OR APPROVED VAPOR RETARDER WITH JOINTS LAPPED A MINIMUM OF 6" IS REQUIRED BETWEEN THE CONCRETE FLOOR SLAB AND THE BASE COURSE OR PREPARED SUBGRADE, (NOT REQUIRED FOR GARAGE SLABS OR DETACHED UNHEATED ACCESSORY BUILDINGS).

C.4 FOOTINGS

- THE BOTTOM OF ALL FOOTINGS SHALL EXTEND NOT LESS THAN 36" BELOW GRADE FOR FROST PROTECTION (IRC R403.1.4).
- FOOTINGS FOR FREESTANDING ACCESSORY STRUCTURES WITH AN AREA OF 600 SQ. FT. OR LESS AND AN EAVE HEIGHT OF 10'-0" OR LESS SHALL EXTEND BELOW GRADE A MINIMUM OF
- EXTERIOR WALLS, BEARING WALLS, COLUMNS AND PIERS SHALL BE SUPPORTED ON CONTINUOUS SOLID MASONRY OR CONCRETE FOOTINGS, OR APPROVED STRUCTURAL SYSTEM TO SAFELY SUPPORT THE IMPOSED LOADS AND SHALL BE SIZED AND REINFORCED IN ACCORDANCE WITH THIS STANDARD OR SHALL BE ENGINEERED DESIGN.
- FOOTINGS UNDER FOUNDATION WALLS SHALL BE CONTINUOUS AROUND THE STRUCTURE AND FROM ONE LEVEL TO THE NEXT.
- THE CONTINUOUS TRANSITIONS BETWEEN FOOTINGS AT DIFFERENT LEVELS ENCLOSING USABLE SPACE SHALL BE MADE BY APPROVED SOLID JUMPS OR SUPPORT SYSTEMS TO PROVIDE SAFE SUPPORT OF THE STRUCTURE.
- SEE "TYPICAL FOOTING/FOUNDATION WALLS/STANDARD SLAB AT MAXIMUM 4" OVER-DIG" AND "FOOTING JUMP" DETAILS.

C.5 CONCRETE

- ALL CONCRETE CONSTRUCTION SHOULD CONFORM TO ACI 318-14 (OR ACI 332) OR 2018 IRC.
- THE MINIMUM CONCRETE 28 DAY COMPRESSIVE STRENGTH SHALL BE AS SPECIFIED IN IRC TABLE R402.2.

C.5 CONCRETE (CONT.)

- CONCRETE MIX TO UTILIZE A MAXIMUM WATER-CEMENT MATERIALS RATIO OF 0.45 FOR ALL APPLICATIONS. ADMIXTURES SHALL NOT CONTAIN ANY CHLORIDES.
- CONCRETE POURED AGAINST AN EXISTING SURFACE SHOULD BE ROUGHENED TO A MINIMUM
- REBAR PLACEMENT SHALL BE AS FOLLOWS:

BEAMS, COLUMNS

- CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3.0 IN CLR CONCRETE EXPOSED TO EARTH OR WEATHER 1.5 IN CLR NOT EXPOSED TO WEATHER OR GROUND SLABS, WALLS, JOISTS 3/4 IN CLR
- CONCRETE MIX DESIGN SHALL BE 6% (±1%) AIR-ENTRAINED FOR GARAGE SLABS, FOOTINGS, WALLS, OR FLATWORK EXPOSED TO WEATHER
- SHORING AND SUPPORTING FORMWORK SHALL NOT BE REMOVED FROM HORIZONTAL MEMBERS BEFORE CONCRETE STRENGTH REACHES 70% OF STRENGTH DETERMINED BY CYLINDERS OR 28 DAYS.
- ALL FOUNDATION WALLS ENCLOSING BELOW GRADE SPACE SHALL BE DAMPPROOFED. THE DAMPPROOFING SHALL EXTEND FROM THE EDGE OF THE FOOTING TO THE FINISHED GRADE. (IRC R406.1)

C.6 CONCRETE WALLS WITH REINFORCEMENT STEEL

- REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 40.
- SMOOTH BARS OR WELDED WIRE FABRIC SHALL CONFORM TO ASTM 185.
- 90 DEG. HOOK SHOWN IN DRAWINGS SHALL BE STANDARD PER ACI 318-14.
 - STRAIGHT EXTENSION LENGTH = 12X BAR DIA BEND DIAMETER = 12X BAR DIA.

HOOKED DOWELS:

- HOOKED DOWELS FROM FOUNDATIONS TO WALL SHALL BE PROVIDED TO MATCH VERTICAL WALL REINFORCING AND EXTENDED TO 3" CLEAR FROM BOTTOM OF
- HOOKED DOWELS MATCH SLAB REINFORCING FROM SLAB TO WALLS OR SLAB TO
- PROVIDE (2) #5 BARS AROUND PERIMETER OF ALL SUSPENDED SLABS.
- WHERE SPLICES ARE NECESSARY IN REINFORCEMENT, THE LENGTH OF LAP SPLICE SHALL BE IN ACCORDANCE WITH TABLE R608.5.4(1) AND FIGURE R608.5.4(1). THE MAXIMUM GAP BETWEEN NONCONTACT PARALLEL BARS AT A LAP SPLICE SHALL NOT EXCEED THE SMALLER OF ONE-FIFTH THE REQUIRED LAP LENGTH AND 6 INCHES (152MM) [SEE FIGURE R608.5.4.(1)].
- TOP HORIZONTAL REINFORCEMENT SHALL BE PLACED WITHIN 12" FROM THE TOP OF THE
- HORIZONTAL WALL REINFORCEMENT SHALL TERMINATE AT THE END OF THE WALL WITH A STANDARD HOOK

C.7 COLD WEATHER CONCRETE

- COLD WEATHER IS DEFINED AS THREE CONSECUTIVE DAYS WHERE THE AVERAGE DAILY TEMPERATURE DROPS BELOW 40 DEGREES FAHRENHEIT AND NOT ABOVE 50 DEGREES FAHRENHEIT FOR MORE THAN HALF OF ANY ONE OF THOSE THREE DAYS.
- COLD WEATHER CONCRETE WORK SHALL CONFORM TO ACI 306.
- ALL MATERIALS AND EQUIPMENT REQUIRED FOR PROTECTION SHALL BE AVAILABLE AT THE PROJECT SITE BEFORE COLD WEATHER CONCRETING BEGINS.
- THE CONCRETE MIX DESIGN PROVIDED BY THE SUPPLIER SHALL AT A MINIMUM REACH THE AVERAGE 28 DAY MIX DESIGN COMPRESSIVE STRENGTH IN MINIMUM 72 HOURS OR 2000 PSI -WHICHEVER IS GREATER.
- THE TEMPERATURE OF CONCRETE AT PLACEMENT SHALL BE A MINIMUM OF 55 DEGREES
- THE MINIMUM CONCRETE TEMPERATURE AT THE TIME OF MIXING SHALL NOT BE BELOW 65
- ALL SNOW, ICE AND FROST MUST BE REMOVED PRIOR TO PLACING CONCRETE.
- THE CONTRACTOR SHALL PROVIDE ADEQUATE PROTECTION FOR CONCRETE AGAINST FREEZING AND MAINTAIN A CONCRETE TEMPERATURE OF 55 DEGREES FAHRENHEIT FOR A 72 HOUR PERIOD AFTER CONCRETE PLACEMENT. THIS MAY BE ACHIEVED WITH THE USE OF INSULATING BLANKETS AND/OR THE USE OF TEMPORARY HEATERS.
- GROUND TEMPERATURE AT THE TIME OF PLACEMENT OF SLAB OR FOOTINGS SHALL NOT BE LESS THAN 35 DEGREES FAHRENHEIT.
- INSULATION, FORMS AND HEATERS MAY BE REMOVED AFTER 72 HOURS.
- MAINTAIN ADEQUATE PROTECTION OF SUB GRADE AND ADEQUATE DRAINAGE AWAY FROM EXPOSED CONCRETE ELEMENT TO PREVENT FREEZING.

C.8 FOOTNOTES

- VERTICAL REINFORCEMENT FOR CONCRETE WALLS THAT ARE NOT FULL HEIGHT AND FOR REINFORCEMENT SPACED 24" O.C. MAY BE PLACED IN THE MIDDLE OF THE WALL. OTHER WALLS SHALL HAVE VERTICAL REINFORCEMENT PLACED AS FOLLOWS:
 - 8" WALL MINIMUM 2" FROM TENSION FACE
- 10" WALL MINIMUM 6-3/4" FROM THE OUTSIDE FACE EXTEND BARS TO WITHIN 8" OF THE TOP OF THE WALL

HORIZONTAL REINFORCEMENT:

PORCHES, CARPORT SLABS AND STEPS EXPOSED TO THE WEATHER, AND GARAGE

FLOOR SLABS

SUSPENDED SLABS

- ONE BAR SHALL BE PLACED WITHIN 12" OF THE TOP OF THE WALL
- OTHER BARS SHALL BE EQUALLY SPACED WITH SPACING NOT TO EXCEED 24" O.C. HORIZONTAL BARS SHOULD BE AS CLOSE TO THE TENSION FACE AS POSSIBLE
- (INTERIOR); AND BEHIND THE VERTICAL REINFORCEMENT (I.E. 2" FROM INSIDE FACE) SUPPLEMENTAL REINFORCEMENT AT CORNERS - PLACE 1 #4 REBAR 48" LONG AT 45 DEGREE ANGLE AT CORNERS OF OPENINGS. PLACE REINFORCEMENT WITHIN 6" OF THE EDGE OF INSIDE CORNERS.
- AT MASONRY LEDGES THE MINIMUM WALL THICKNESS SHALL BE 3-1/2". LEDGES SHALL NOT EXCEED A DEPTH OF MORE THAN 24" BELOW THE TOP OF THE WALL FOR WALL THICKNESS LESS THAN 4". PROVIDE #4 BARS AT MAXIMUM 24" O.C. TO WITHIN 8" OF THE TOP OF THE WALL.

MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF CONCRETE

STRAIGHT WALLS MORE THAN 5'-0" TALL AND MORE THAN 16-0" LONG SHALL BE PROVIDED WITH EXTERIOR BRACED RETURN WALLS. WALL LENGTH SHALL BE MEASURED USING INSIDE THE SHORTEST DIMENSION BETWEEN INTERSECTING WALLS (SEE TYPICAL DEAD MAN SECTION).

PER TABLE R402.2 MINIMUM SPECIFIED COMPRESSIVE STRENGTH (f'c) TYPE OR LOCATION OF CONCRETE FOR SEVER WEATHERING POTENTIAL CONSTRUCTION BASEMENT WALLS, FOUNDATIONS AND OTHER CONCRETE NOT 2,500 EXPOSED TO THE WEATHER BASEMENT SLABS AND INTERIOR SLABS ON 2,500 GRADE, EXCEPT GARAGE FLOOR SLABS BASEMENT WALLS, FOUNDATION WALLS, EXTERIOR WALLS AND OTHER VERTICAL CONCRETE WORK 3,000 EXPOSED TO THE WEATHER

3,500

4,000

D. FRAMING/STRUCTURE

D.1 FRAMING NOTES

1.5 IN CLR

- ALL TREATED LUMBER SIZES ARE DOUGLAS FIR-LARCH #2 UNLESS OTHERWISE NOTED
- ALL NON TREATED LUMBER OR ROT RESISTANT SIZES ARE #2 TREATED SOUTHERN YELLOW PINE UNLESS OTHERWISE NOTED.
- ALL UNMARKED HEADERS SHALL BE A MINIMUM #2 DOUGLAS FIR-LARCH (2) 2X10 ON LOAD
- ALL HEADERS/BEAMS TO BEAR ON A MINIMUM OF (2) 2X4 JACK STUDS UNO. KING STUDS
- SHALL BE PROVIDED AT ALL HEADERS IN ACCORDANCE WITH IRC TABLE R602.7.5.
- DOUBLE JOIST UNDER PARALLEL INTERIOR NON-LOAD BEARING WALLS.

CANTILEVERS, OVER BEAMS AND DOOR JAMBS SHALL BE BLOCKED.

- ANY WOOD MEMBER IN CONTACT WITH CONCRETE OR MASONRY (OR THE FURRING THEY ARE ATTACHED TO) SHALL BE OF DECAY RESISTANT MATERIAL.
- IN BEARING WALLS, STUDS WHICH ARE NOT MORE THAN 10'-0" FEET IN LENGTH SHALL BE SPACED NOT MORE THAN IS SPECIFIED IN IRC TABLE R602.3(5) FOR THE CORRESPONDING STUD SIZE. THOSE STUDS GREATER THAN 10'-0" FEET IN LENGTH SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT.
- ALL WOOD STRUCTUAL PANELS SHALL CONFORM TO THE MOST CURRENT APPLICABLE SPECIFICATION AND SUPPLEMENTS OF THE APA OR EQUIVALENT. ALL PANEL END JOINTS SHALL OCCUR OVER SUPPORTS AND SHALL BE STAGGERED ONE HALF PANEL LENGTH FROM ADJACENT PANELS. PROVIDE 1/8" INCH SPACE AT PANEL ENDS. WOOD STRUCTURAL PANEL MOISTURE CONTENT SHALL BE LESS THEN OR EQUAL TO 16%.
- ALL STRUCTURAL FRAMING MEMBERS SHALL BE AS FOLLOWS UNO:
- 2X4 OR 2X6 EXTERIOR WALLS AS PERMITTED BY CODE: DOUGLAS FIR-LARCH #2 (DF-L #2) EXTERIOR WALLS TO BE CONTINUOUSLY SHEATHED WITH MIN. 7/16" OSB
- EXTERIOR OSB SHEATHING TO BE FASTENED WITH 8D COMMON NAILS; 6" O. C. AT PANEL EDGES, 12" O. C. IN THE FIELD.
- 2X4 OR 2X6 INTERIOR LOAD BEARING WALLS DF-L #2 OR BETTER. LOAD BEARING, BRACED, AND SHEAR WALLS, REQUIRE A DOUBLE TOP PLATE. THE TOP PLY BEING FIELD APPLIED WITH A MIN. 24" LAP SPLICE
- FIELD APPLIED LAP SPLICED TOP PLATE: DF-L #2 OR BETTER LOAD BEARING HEADERS PER HEADER SCHEDULE OR AS SHOWN ON FRAMING PLANS.
- LOAD BEARING HEADERS TO BE FABRICATED WITH THE HEADER AT THE UNDER SIDE OF THE TOP PLATE WITH CRIPPLE FRAMING BELOW AS NEEDED UNO.
- INTERIOR NON LOAD BEARING WALLS: DF-L #2 STUD GRADE OR BETTER DOUBLE TOP PLATE IS NOT REQUIRED FOR INTERIOR NON LOAD BEARING WALLS HEADER CRIPPLE SPACING CAN BE 24" O. C. REGARDLESS OF WALL STUD SPACING FOR
- NON LOAD BEARING WALLS CRIPPLE FRAMING NOT REQUIRED ABOVE OR BELOW OPENINGS WHERE THE VERTICAL CLEAR HEIGHT IS 22" OR LESS FOR NON-LOAD BEARING WALLS.
- ALL LUMBER IN CONTACT WITH MASONRY OR OTHERWISE EXPOSED TO WEATHERING TO BE PRESSURE TREATED (PT).
- FIELD APPLIED SILL PLATE: PT DF-L #2 BOTTOM (SOLE) PLATE IN CONTACT WITH MASONRY: PT DF-L #2
- ALL PRESSURE TREATED WOOD SHALL BE PRESSURE TREATED WITH WATER-BORNE PRESERVATIVES. PRESSURE TREATMENT SHALL COMPLY WITH THE REQUIREMENTS OF AWPB, C2, LP-22, AND IRC SECTION R317. ALL LUMBER < 8" ABOVE THE FINISHED GRADE SHALL BE PRESSURE TREATED.
- FASTENERS, INCLUDING NUTS AND WASHERS, FOR PRESSURE TREATED WOOD SHALL BE HOT-DIPPED, ZINC-COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER. COATING TYPES AND WEIGHTS FOR CONNECTORS IN CONTACT WITH PRESSURE TREATED WOOD SHALL BE IN ACCORDANCE WITH THE CONNECTOR MANUFACTURER'S RECOMMENDATIONS. IN THE ABSENCE OF MANUFACTURER'S RECOMMENDATIONS, A MIN. OF ASTM A653 TYPE G185 ZINC-COATED GALVANIZED STEEL, OR EQUIVALENT, SHALL BE USED. FOR EXCEPTIONS, REFER TO R317.3.1.

ENGINE	ERED LUMBER MIIMUM [DESIGN REQUIREMENTS	
	F _b (PSI)	E (PSI)	F _v (PSI)
LVL	3100	1.9X10 ⁶	285
DOUGLAS FIR-LARCH	900	1.6X10 ⁶	180
GLU-LAM	2400	1.8X10 ⁶	230

D.2 STRUCTURAL STEEL

- STEEL DESIGN, FABRICATION, AND ERECTION SHALL CONFORM WITH AMERICAN INSTITUTE OF STEEL CONSTRUCTION.
- STEEL PIPE COLUMNS SHALL BE A MINIMUM OF SCHEDULE 40.
- STEEL GRADE AND SPECIFICATION SHALL BE AS FOLLOWS **HOLLOW STRUCTURAL SECTIONS:** CHANNELS, PLATES, ANGLES, AND COLUMNS:
 - WIDE FLANGES: STEEL PIPE COLUMN

IF ERECTION CAN STILL BE EXECUTED.

SAFETY GLAZING MATERIALS.

ASTM A992 ($F_Y = 50 \text{ KSI}$) ASTM A53 GR.B ($F_Y = 35$ KSI) ASTM F1554 (F_Y = 36 KSI) ANCHOR RODS: BOLTS SHALL CONFORM TO ASTM A307

ASTM A500 ($F_Y = 46 \text{ KSI}$)

ASTM A36 (F_Y = 36 KSI)

- BE PERFORMED IN ACCORDANCE TO WELDING PROCEDURE SPECIFICATIONS (WPS) AS REQUIRED IN AWS D1.1. THE WPS VARIABLES SHALL BE WITHIN THE PARAMETERS ESTABLISHED BY THE FILLER-METAL MANUFACTURER.
- ALL WELDS SPECIFIED AS FIELD WELDS MAY BE SHOP WELDED AT THE CONTRACTOR'S OPTION

WELDS SHALL USE E70XX ELECTRODES AND A MINIMUM OF 3/16" SIZE UNLESS NOTED

WELDING SHALL CONFORM TO THE AWS CODES FOR BUILDING CONSTRUCTION, WELDING SHALL

E. <u>GLAZING</u>

- GLAZING IN HAZARDOUS LOCATIONS AS IDENTIFIED IN IRC R308.4 SHALL BE OF APPROVED
- GLASS IN STORM DOORS: INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE OF THE GLAZING IS WITHIN A 24" ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 60" ABOVE THE FLOOR.
- GLAZING ADJACENT TO THE LANDING AT THE BOTTOM OF THE STAIRWAY WHERE THE GLAZING IS LESS THAN 36 INCHES ABOVE THE LANDING AND WITHIN A 60 IN HORIZONTAL ARC LESS THAN 180 DEGREES FROM THE BOTTOM TREAD NOSING SHALL BE CONSIDERED A HAZARDOUS LOCATION.
- GLAZING IN WALLS, ENCLOSURES OR FENCES CONTAINING OR FACING HOT TUBS, SPAS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS, AND INDOOR OR OUTDOOR SWIMMING POOLS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS LESS THAN 60" MEASURED VERTICALLY ABOVE ANY STANDING OR WALKING SURFACE.
- WINDOW FALL PROTECTION SHALL BE PROVIDED IN ACCORDANCE WITH IRC R312.2.

F. <u>STAIRWAYS</u>

STAIRWAYS SHALL PROVIDE A MAXIMUM 7-3/4" RISE AND A MINIMUM 10" RUN.

EDGES OF THE TREADS.

- REQUIRED GUARD RAILS AT OPEN-SIDED WALKING SURFACES, INCLUDING STAIRS, PORCHES, BALCONIES, OR LANDINGS, SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE.
 - EXCEPTION (1): GUARD RAILS ON THE OPEN SIDES OF STAIRS SHALL HAVE A HEIGHT NOT LESS THAN 34" MEASURED VERTICALLY FROM A LINE CONNECTING THE LEADING
 - EXCEPTION (2): WHERE THE TOP OF THE GUARD ALSO SERVES AS A HANDRAIL ON THE OPEN SIDES OF STAIRS, THE TOP OF THE GUARD SHALL NOT BE LESS THAN 34" AND NOT MORE THAN 38" MEASURED VERTICALLY FROM A LINE CONNECTING THE LEADING EDGES OF THE TREADS.
- GUARD RAIL ENCLOSURES SHALL HAVE INTERMEDIATE RAILS OF ORNAMENTAL PATTERNS THAT DO NOT ALLOW PASSAGE OF A SPHERE 4" IN DIAMETER.
- EACH STAIRWAY OF FOUR OR MORE RISERS SHALL PROVIDE A CONTINUOUS HANDRAIL ON AT LEAST ONE SIDE BETWEEN 34" AND 38" ABOVE THE NOSING OF THE TREADS.
- HANDRAILS SHALL HAVE A CIRCULAR CROSS SECTION OF 1-1/4" TO 2" OR OTHER APPROVED GRASPABLE SHAPE PER IRC R311.7.8.5.
- ENCLOSED ACCESSIBLE SPACE UNDER STAIRWAYS SHALL HAVE WALLS AND THE UNDERSIDE OF THE STAIR AND LANDING PROTECTED WITH 1/2" GYPSUM BOARD ON ENCLOSURE PER IRC

GARAGES

THE GARAGE FLOOR SHALL SLOPE 1/8" PER 12" TO DRAIN OR VEHICLE ENTRY DOORWAYS.

MINIMUM 6'-8" OF HEADROOM CLEARANCE IS REQUIRED IN STAIRWAYS.

- DOORS BETWEEN THE GARAGE AND THE DWELLING TO BE: SELF CLOSING, MINIMUM 1-3/8" SOLID CORE OR HONEYCOMBED STEEL DOOR, AND AT LEAST 20 MINUTE FIRE RATED.
- THE GARAGE SHALL BE SEPARATED FROM THE DWELLING AND ITS ATTIC AREAS BY A MINIMUM 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE WHERE A FLOOR/CEILING SPACE IS
- THE GARAGE COLUMNS AND BEAMS SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED WITH 1/2" GYPSUM BOARD OR EQUIVALENT.
- WHERE HABITABLE SPACE OCCURS ABOVE THE GARAGE FLOOR/CEILING ASSEMBLY SHALL BE PROTECTED WITH A MINIMUM 5/8" TYPE "X" GYPSUM BOARD ON THE GARAGE CEILING.
- GARAGE DOOR AND FRAME THE "H" FRAME FOR THE ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2X6 VERTICAL JAMBS RUNNING FROM THE FLOOR TO CEILINGS, ATTACHED WITH 1-3/4" X 0.120" NAILS AT 7" O.C. STAGGERED WITH (7) 3-1/4" X 0.120" NAILS THROUGH THE JAMB INTO THE HEADER, 2X8 HEADER (MINIMUM) FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
- GARAGE VEHICLE DOORS AND FRAMES SHALL BE DESIGNED AND INSTALLED TO MEET THE 115 MPH WIND LOAD REQUIREMENT OF DASMA 108 AND ASTM E330-96 (IRC R301.2.1).

THE ROOF IS DESIGNED FOR 20 PSF GROUND SNOW LOAD (MINIMUM)

SHALL NOT INTERFERE WITH THE ABILITY OF THE SHINGLES TO SEAL."

- PROVIDE 2X SOLID BLOCKING SUPPORT BELOW ALL POINT LOADS CONTINUOUS TO BEARING STRUCTURE AND/OR FOUNDATION BELOW.
- ROOF IS ENGINEERED TO COMPLY WITH IRC R802.
- ROOF TO BE ASPHALT SHINGLES UNO AND SHALL COMPLY WITH IRC 2018 SECT. R905.2
- MINIMUM ROOF SLOPE FOR ASPHALT SHINGLES SHALL BE 2:12.
- ROOF SLOPES IN BETWEEN 2:12 AND 4:12 SHALL REQUIRE DOUBLE UNDERLAYMENT IN ACCORDANCE WITH IRC 2018 SECTION R905.2.2: "APPLY A 19-INCH (483MM) STRIP OF UNDERLAYMENT FELT PARALLEL TO AND STARTING AT THE EAVES, FASTENED SUFFICIENTLY TO HOLD IN PLACE. STARTING AT THE EAVE, APPLY 36-INCH-WIDE (914 MM) SHEETS OF UNDERLAYMENT, OVERLAPPING SUCCESSIVE SHEETS 19

INCHES (483MM), AND FASTENED SUFFICIENTLY TO HOLD IN PLACE. END LAPS SHALL BE 4-INCH

(102MM) AND SHALL BE OFFSET BY 6 FEET (1829 MM). DISTORTIONS IN THE UNDERLAYMENT

SAFETY REQUIREMENTS

I.1 EMERGENCY EGRESS AND RESCUE

- PROVIDE ONE WINDOW FROM EACH BEDROOM THAT HAS A MINIMUM OPENABLE AREA OF 5.7 SQ. FT. WITH A MINIMUM OPENABLE HEIGHT OF 24" AND WIDTH OF 20".
- BASEMENT EGRESS TO MEET THE REQUIREMENTS OF IRC R310.

I.2 SMOKE AND CARBON MONOXIDE SAFETY (PER IRC R314)

- PROVIDE SMOKE ALARMS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA AND ON EACH FLOOR INCLUDING BASEMENTS.
- SMOKE ALARMS SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE DWELLING.
- CARBON MONOXIDE DETECTORS SHALL BE INSTALLED AS REQUIRED PER IRC R315.

J. <u>ENERGY REQUIREMENTS</u>

- LIGHTING FIXTURES PENETRATING THE THERMAL ENVELOPE SHALL BE IC-RATED, LEAKAGE RATED AND SEALED TO THE GYPSUM WALLBOARD AS REQUIRED PER IRC N1102.4.5.
- PROGRAMMABLE THERMOSTATS SHALL BE INSTALLED AS REQUIRED PER IRC N1103.1.1.
- AIR HANDLERS SHALL BE RATED FOR MAXIMUM 2% AIR LEAKAGE RATE PER IRC N1103.3.2.1.
- BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS. HOT WATER PIPES SHALL BE INSULATED AS REQUIRED PER IRC N1103.4.
- MAKEUP AIR SYSTEMS SHALL BE INSTALLED FOR KITCHEN EXHAUST HOODS THAT EXCEED 400

ALL EXHAUST FANS SHALL TERMINATE TO THE BUILDING EXTERIOR AS REQUIRED PER IRC

AN AIR HANDLING SYSTEM SHALL NOT SERVE BOTH THE LIVING SPACE AND THE GARAGE PER IRC M1601.6 ENERGY CONSERVATION.

- **ABBREVIATIONS** AFF: ABOVE FINISHED FLOOR
- EFF: EFFECTIVE **EFP: EQUIV FLUID PRESSURE**

CLR: CLEAR

- **EQUIV: EQUIVALENT** MAX: MAXIMUM MIN: MINIMUM
- NTS: NOT TO SCALE O.C.: ON CENTER

EOR: ENGINEER OF RECORD

CFM AS REQUIRED PER IRC M1503.6.

- PCF: POUNDS PER CUBIC FOOT PLF: POUNDS PER LINER FOOT PSF: POUNDS PER SQUARE FOOT
- PSI: POUNDS PER SQUARE INCH UNO: UNLESS NOTED OTHERWISE FV: FIELD VERIFY



AS NOTED FOR PLAN REVIEW



EVERSTEAD 3741 NE TROON DRIVE, SUITE 200 LEE'S SUMMIT, MO 64064 everstead.com (816)399-490°

 \propto

0 #


REVISIONS


STRUCTURAL


GENERAL NOTES

10/10/2023 11:03:15 AM SCALE

1/4" = 1'-0"

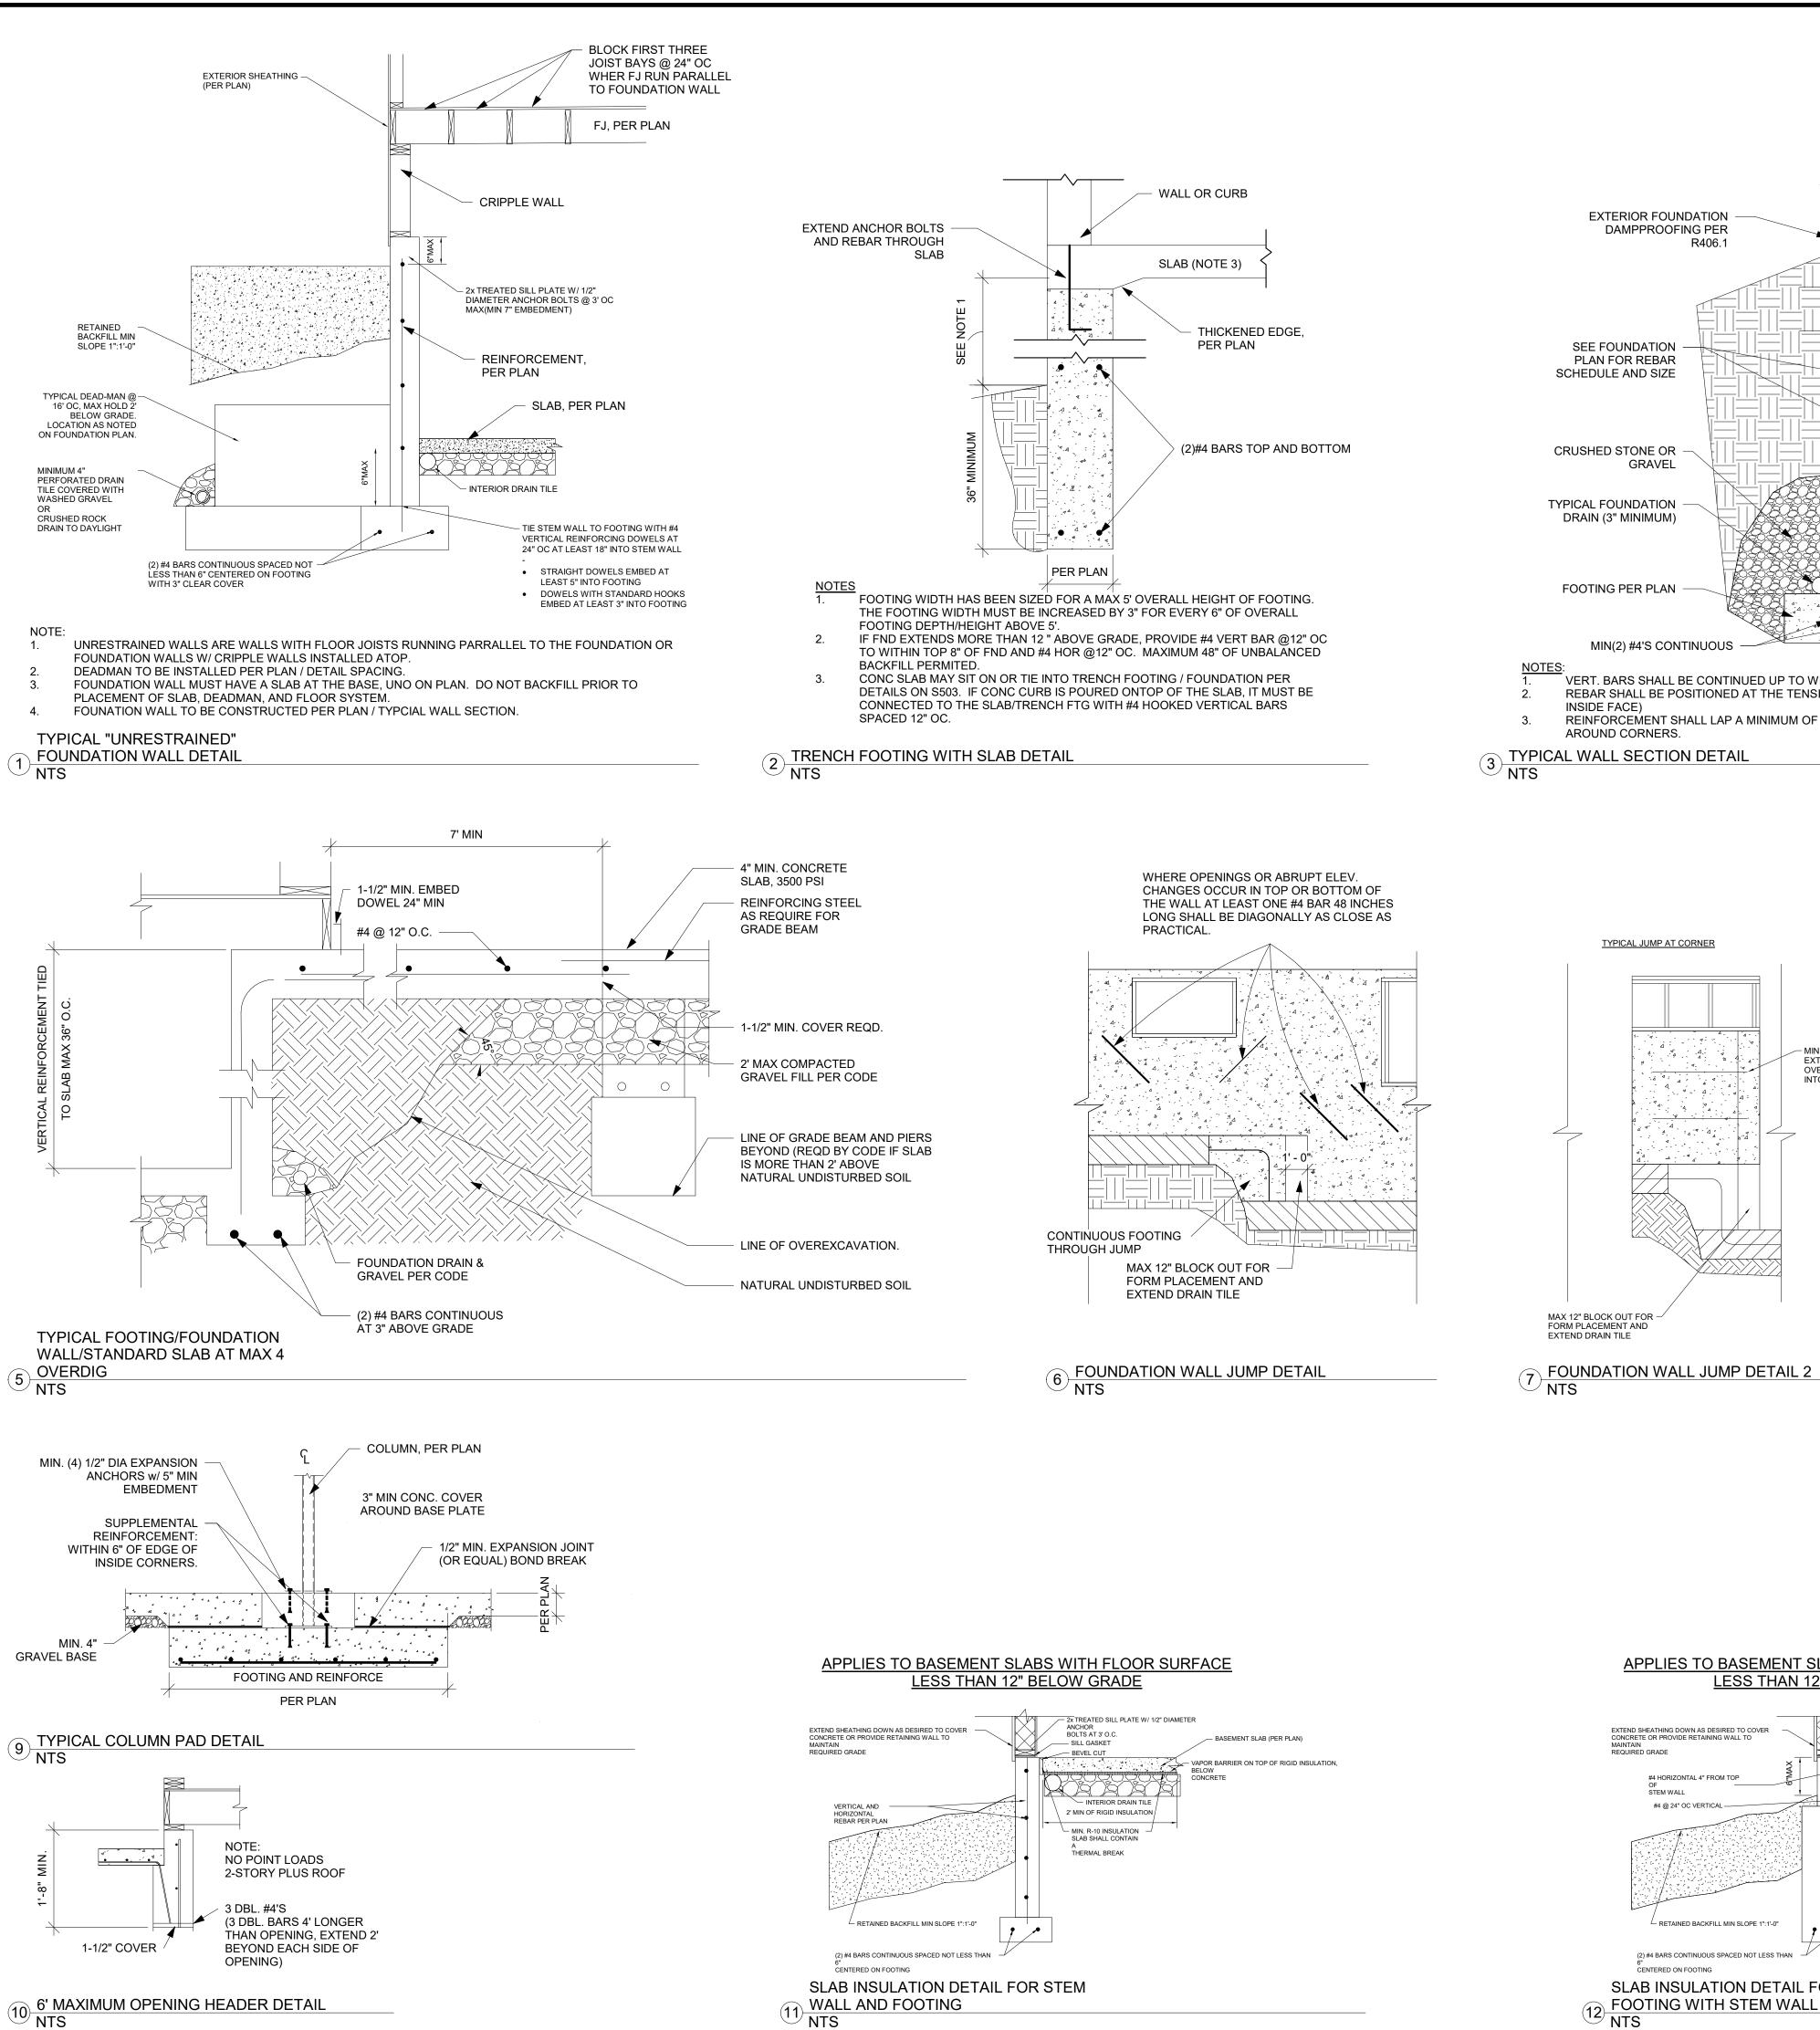

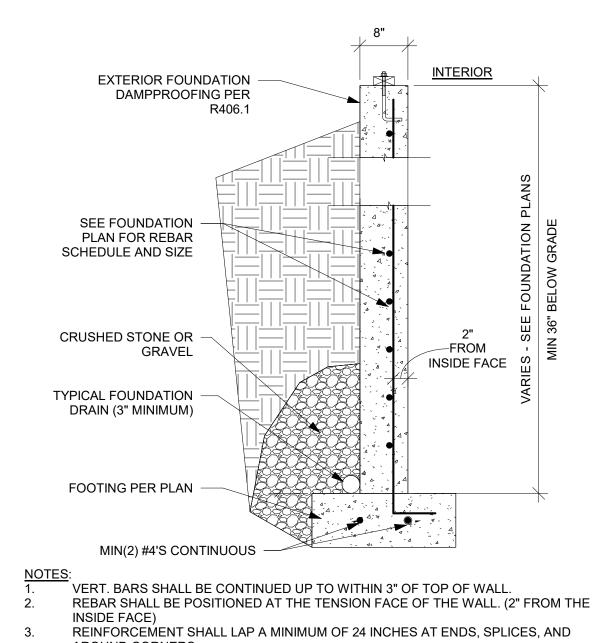

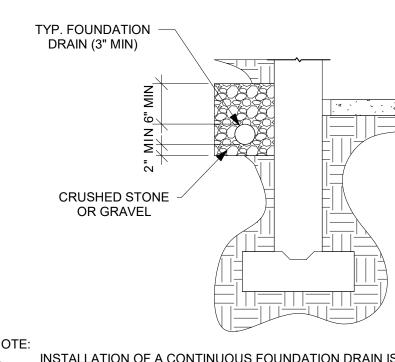


INSTALLATION OF A CONTINUOUS FOUNDATION DRAIN IS REQUIRED WHERE HABITABLE OR USABLE SPACE FOR ANY PORTION OF THE STRUCTURE IS LOCATED BELOW GRADE.

THE FOUNDATION DRAIN SHALL BE AT OR BELOW THE AREA BEING PROTECTED. DRAINAGE TILE SHALL BE PLACED WITH POSITIVE OR NEUTRAL SLOPE TO MINIMIZE THE ACCUMULATION OF DEPOSITS IN THE DRAINAGE PIPE.

PLACEMENT OF DRAIN TILE DIRECTLY ON TOP OF THE FOOTING IS ACCEPTABLE. [IRC R405], SEE "TYPICAL FOOTING/FOUNDATION WALL/STANDARD SLAB AT MAXIMUM 4' OVERDIG" AND "FOUNDATION DRAIN DETAIL AT RAISED SLAB" DIAGRAMS FOR DETAILS.

FOUNDATION DRAIN AND RAISED SLAB DETAIL


TYPICAL JUMP AT CORNER WHERE FLOOR JOISTS RUN PARALLEL TO FOUNDATION WALL, SOLID BLOCKING OUTSIDE 3 JOIST SPACE @ 36", ALIGN MIN (2) #4 BARS EXTENDING 24" PAST

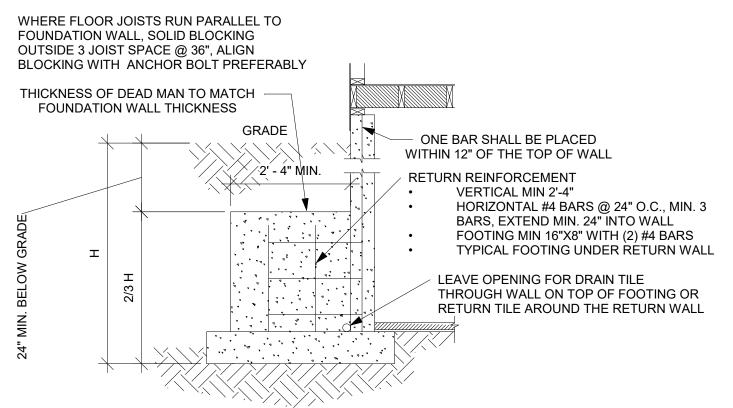

8 TYPICAL DEAD MAN DETAIL

APPLIES TO BASEMENT SLABS WITH FLOOR SURFACE LESS THAN 12" BELOW GRADE

INTO INTERSECTING WALL

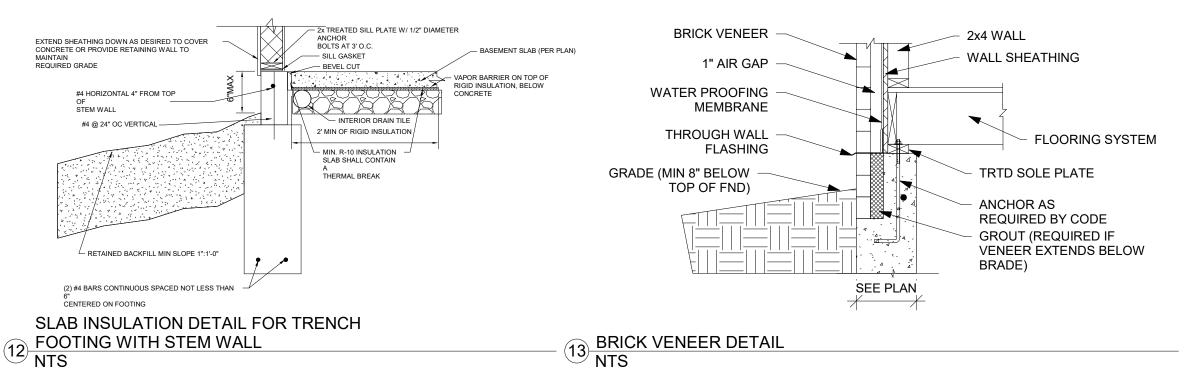

RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW

DAVIS NUMBER

PE-2015016986

EVERSTEAD

3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901

05/30/2024


REVISIONS

FOUNDATION DETAILS

S501

SCALE

10/10/2023 10:21:52 AM As indicated

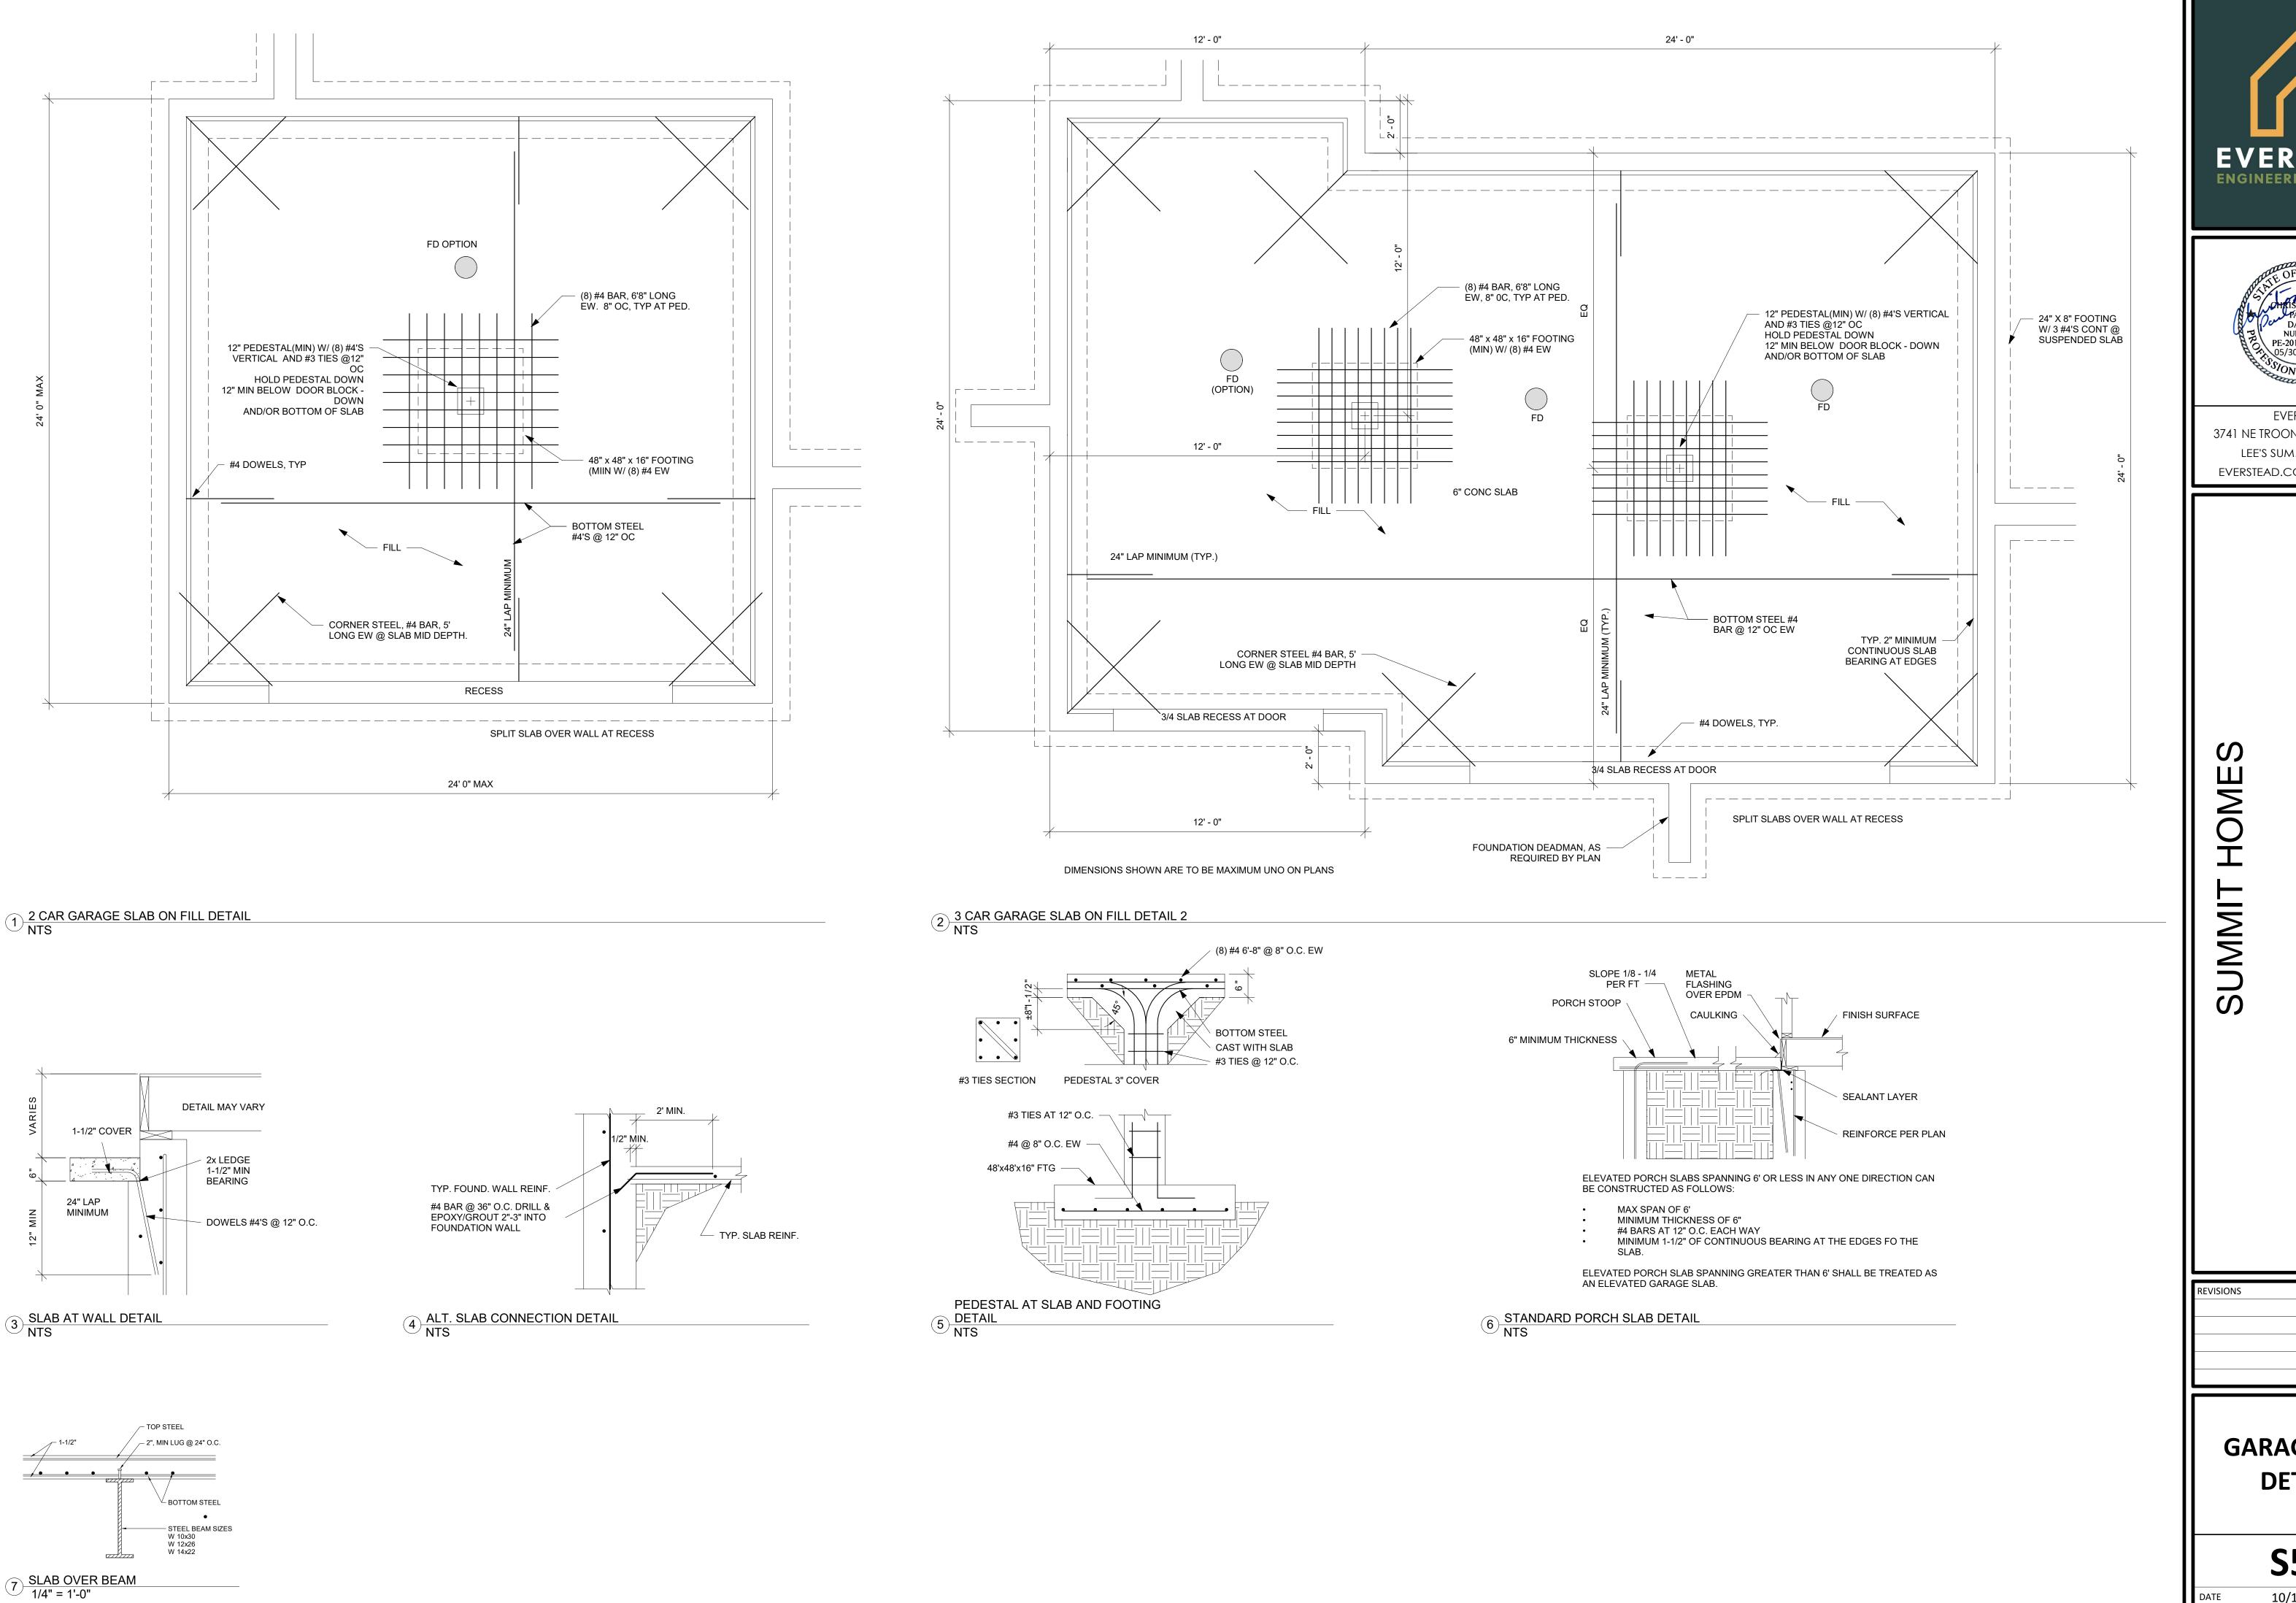

EVERSTEAD ENGINEERING & DESIGN

AS NOTED FOR PLAN REVIEW



EVERSTEAD

3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901


OSAGE #86 - TWIN HONEYDEV

GARAGE/SLAB DETAILS

S503

DATE 10/10/2023 10:21:56 AM

SCALE As indicated

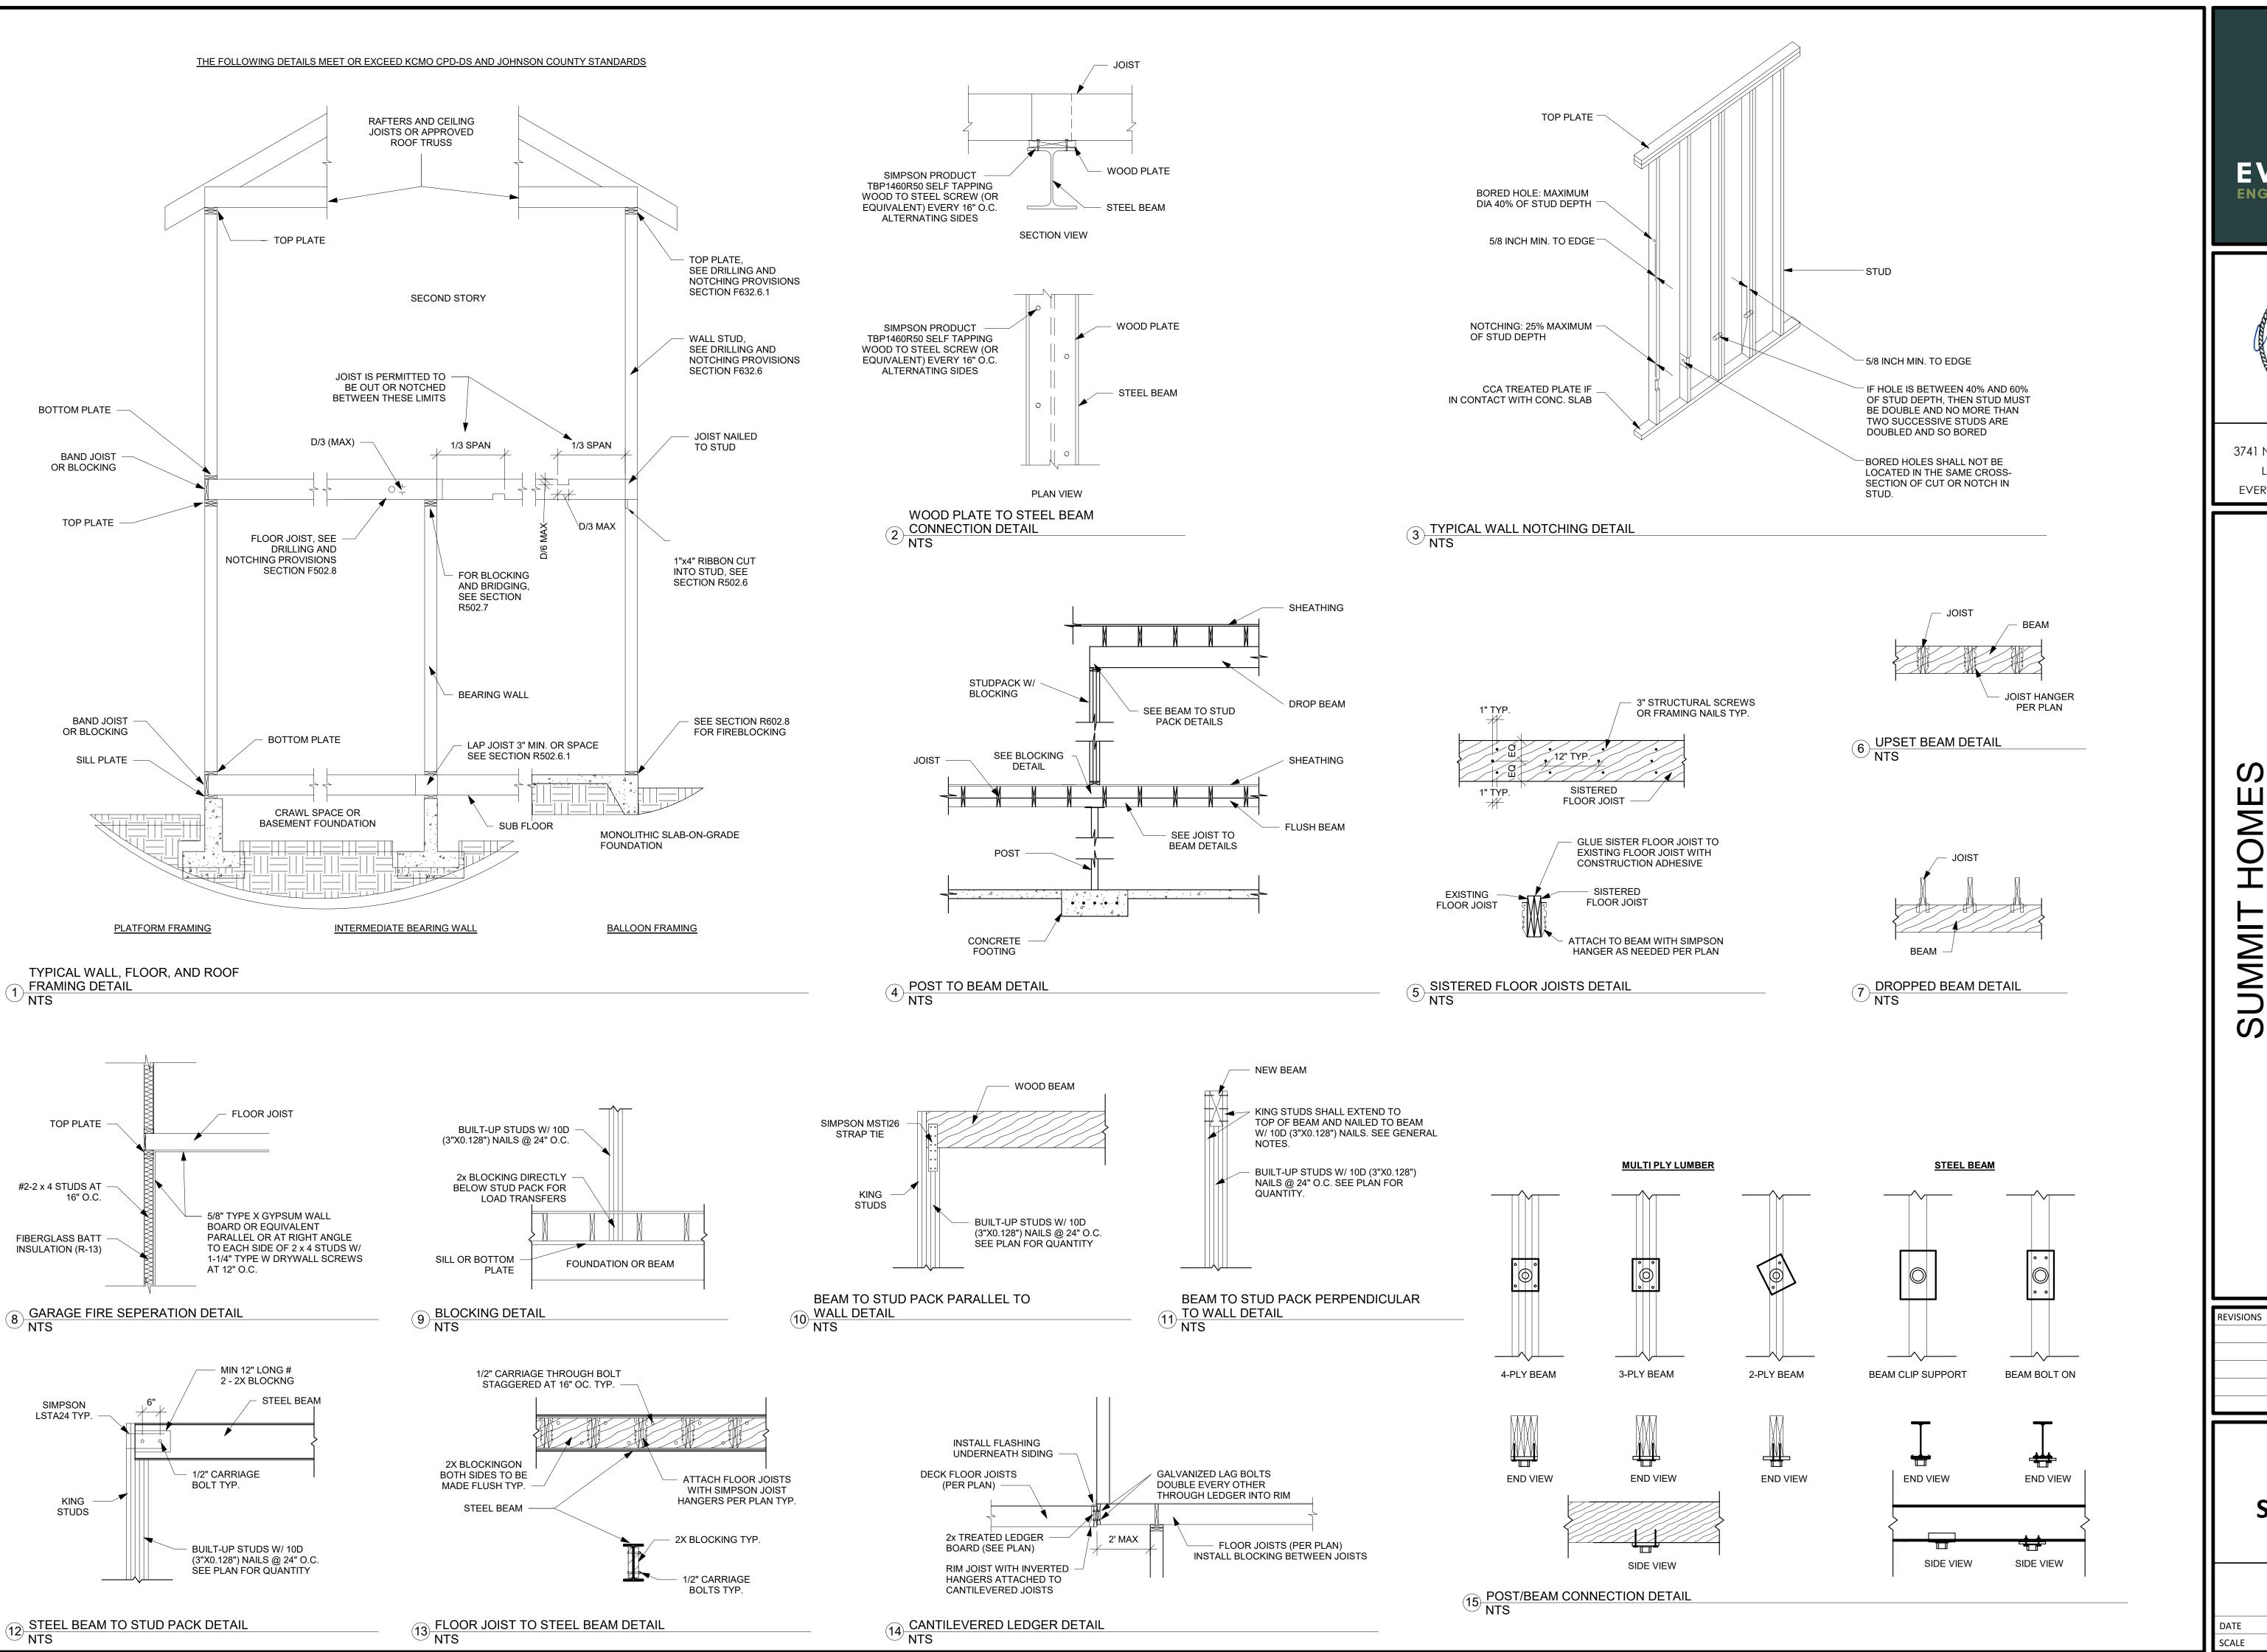



AS NOTED FOR PLAN REVIEW



EVERSTEAD 3741 NE TROON DRIVE, SUITE 200 LEE'S SUMMIT, MO 64064 EVERSTEAD.COM (816)399-4901


ARMHOUSE

FRAMING STANDARDS

S510

10/10/2023 10:22:00 AM As indicated

EXTERIOR SHEATHING REMOVE SIDING AT LEDGER PRIOR TO INSTALLATION EXIST. STUD WALL LEDGER AND JOIST FLUSH ON CONTINUOUS FLASHING EXIST. 2X BAND JOIST OR 1" MINIMUM EWP RIM JOIST EXTENDING PAST JOIST HANGER DECK JOIST 1/2" DIA. LAG SCREWS OR THROUGH-BOLTS WITH WASHERS 2X FLOOR JOIST OR I-JOIST JOIST HANGER EXIST. FOUNDATION WALL 2X LEDGER BOARD EQUAL TO OR GREATER THAN DEPTH OF DECK JOIST AND NO GREATER THAN DEPTH OF HOUSE BAND OR RIM JOIST. LEDGER BOARD TO BAND BOARD

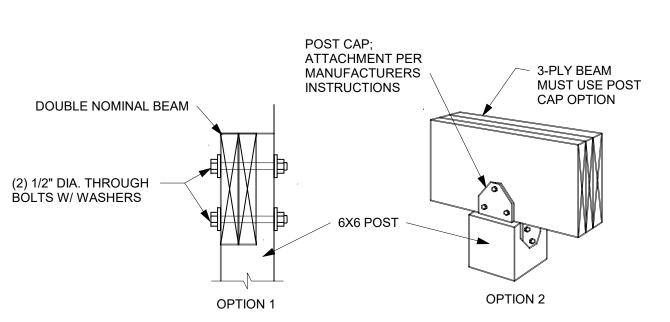

ACCEPTABLE POST BASE IF NOT CALLED

SIMPSON ABA##Z SIMPSON ABU##Z

MITEK PA## MITEK PAU##

OUT ON PLAN:

CONCRETE PIER, PER PLAN

- UNEXCAVATED SOIL

TYPICAL POST TO BEAM ATTACHMENT

POST BASE

5 POST BASE DETAIL NTS

3 DETAIL NTS

EVERSTEAD 3741 NE TROON DRIVE, SUITE 200 LEE'S SUMMIT, MO 64064 EVERSTEAD.COM (816)399-4901

DAVIS NUMBER PE-2015016986

05/30/2024

RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW

64082

ARMHOUSE

HONEY

98#


REVISIONS

DECK DETAILS

S520

10/10/2023 10:22:03 AM SCALE As indicated

DECK RAILING DETAIL DRAWN TO MEET THE INTENT OF R312 OF THE 2018 IRC AND A CONCENTRATED LOAD OF 200 LBS PER 1607.8.1 OF THE 2018 IBC.

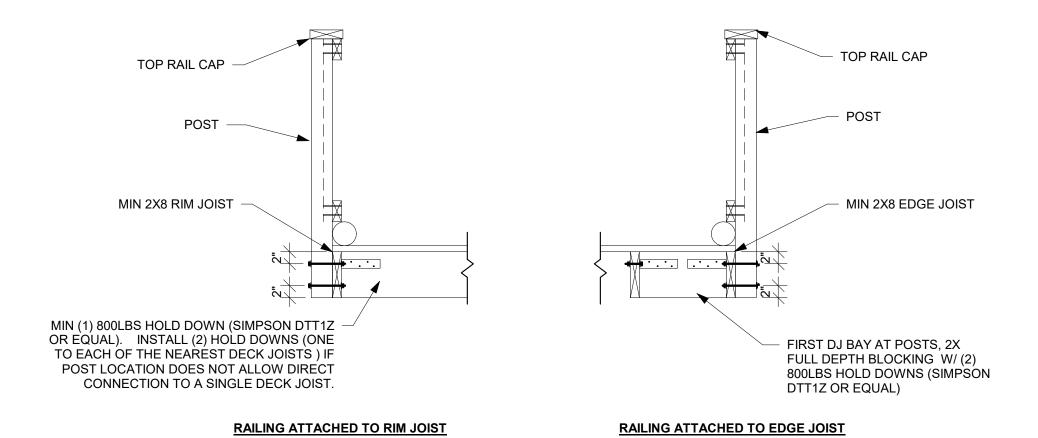

DECK RAILING

NTS

- STAGGER FASTENERS IN TWO ROWS LEDGER LAG SCREW OR BOLT D = 5.5" MIN. FOR 2x8* D = 6.5" MIN. FOR 2x10 D = 7.5" MIN. FOR 2X12 *DISTANCE SHALL BE PERMITTED TO BE REDUCED TO 4.5" IF LAG SCREWS ARE USED OR BOLT SPACING IS REDUCED TO THAT OF LAG SCREWS TO ATTACH 2x8 LEDGERS TO 2X8 BAND JOISTS

4 DECK LEDGER DIMENSION DETAIL NTS

2 DETAIL NTS


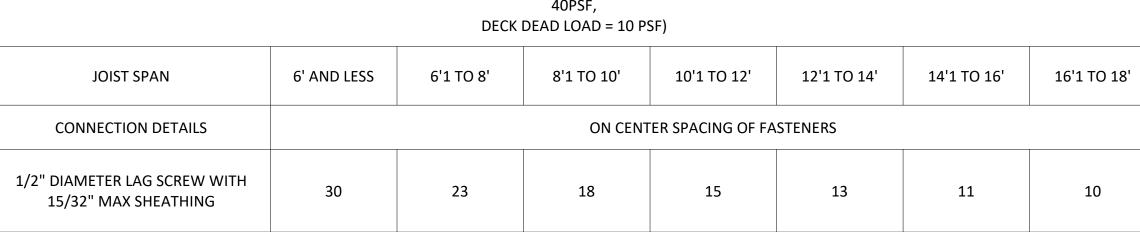


TABLE R507/2 FASTENER SPACING FOR A SOUTHERN PINE OR HEM-FIR DECK LEDGER 2" NOMINAL SOLID SAWN SPRUCE-PINE-FIR BAND JOIST (DECK LIVE LOAD =

1/2" DIAMETER BOLT WITH 15/32" 36 36 34 21 29 24 19 MAX SHEATHING 1/2" DIAMETER BOLT WITH 15/32" MAX SHEATHING AND 1/2" STACKED 16 29 24 21 18 WASHERS

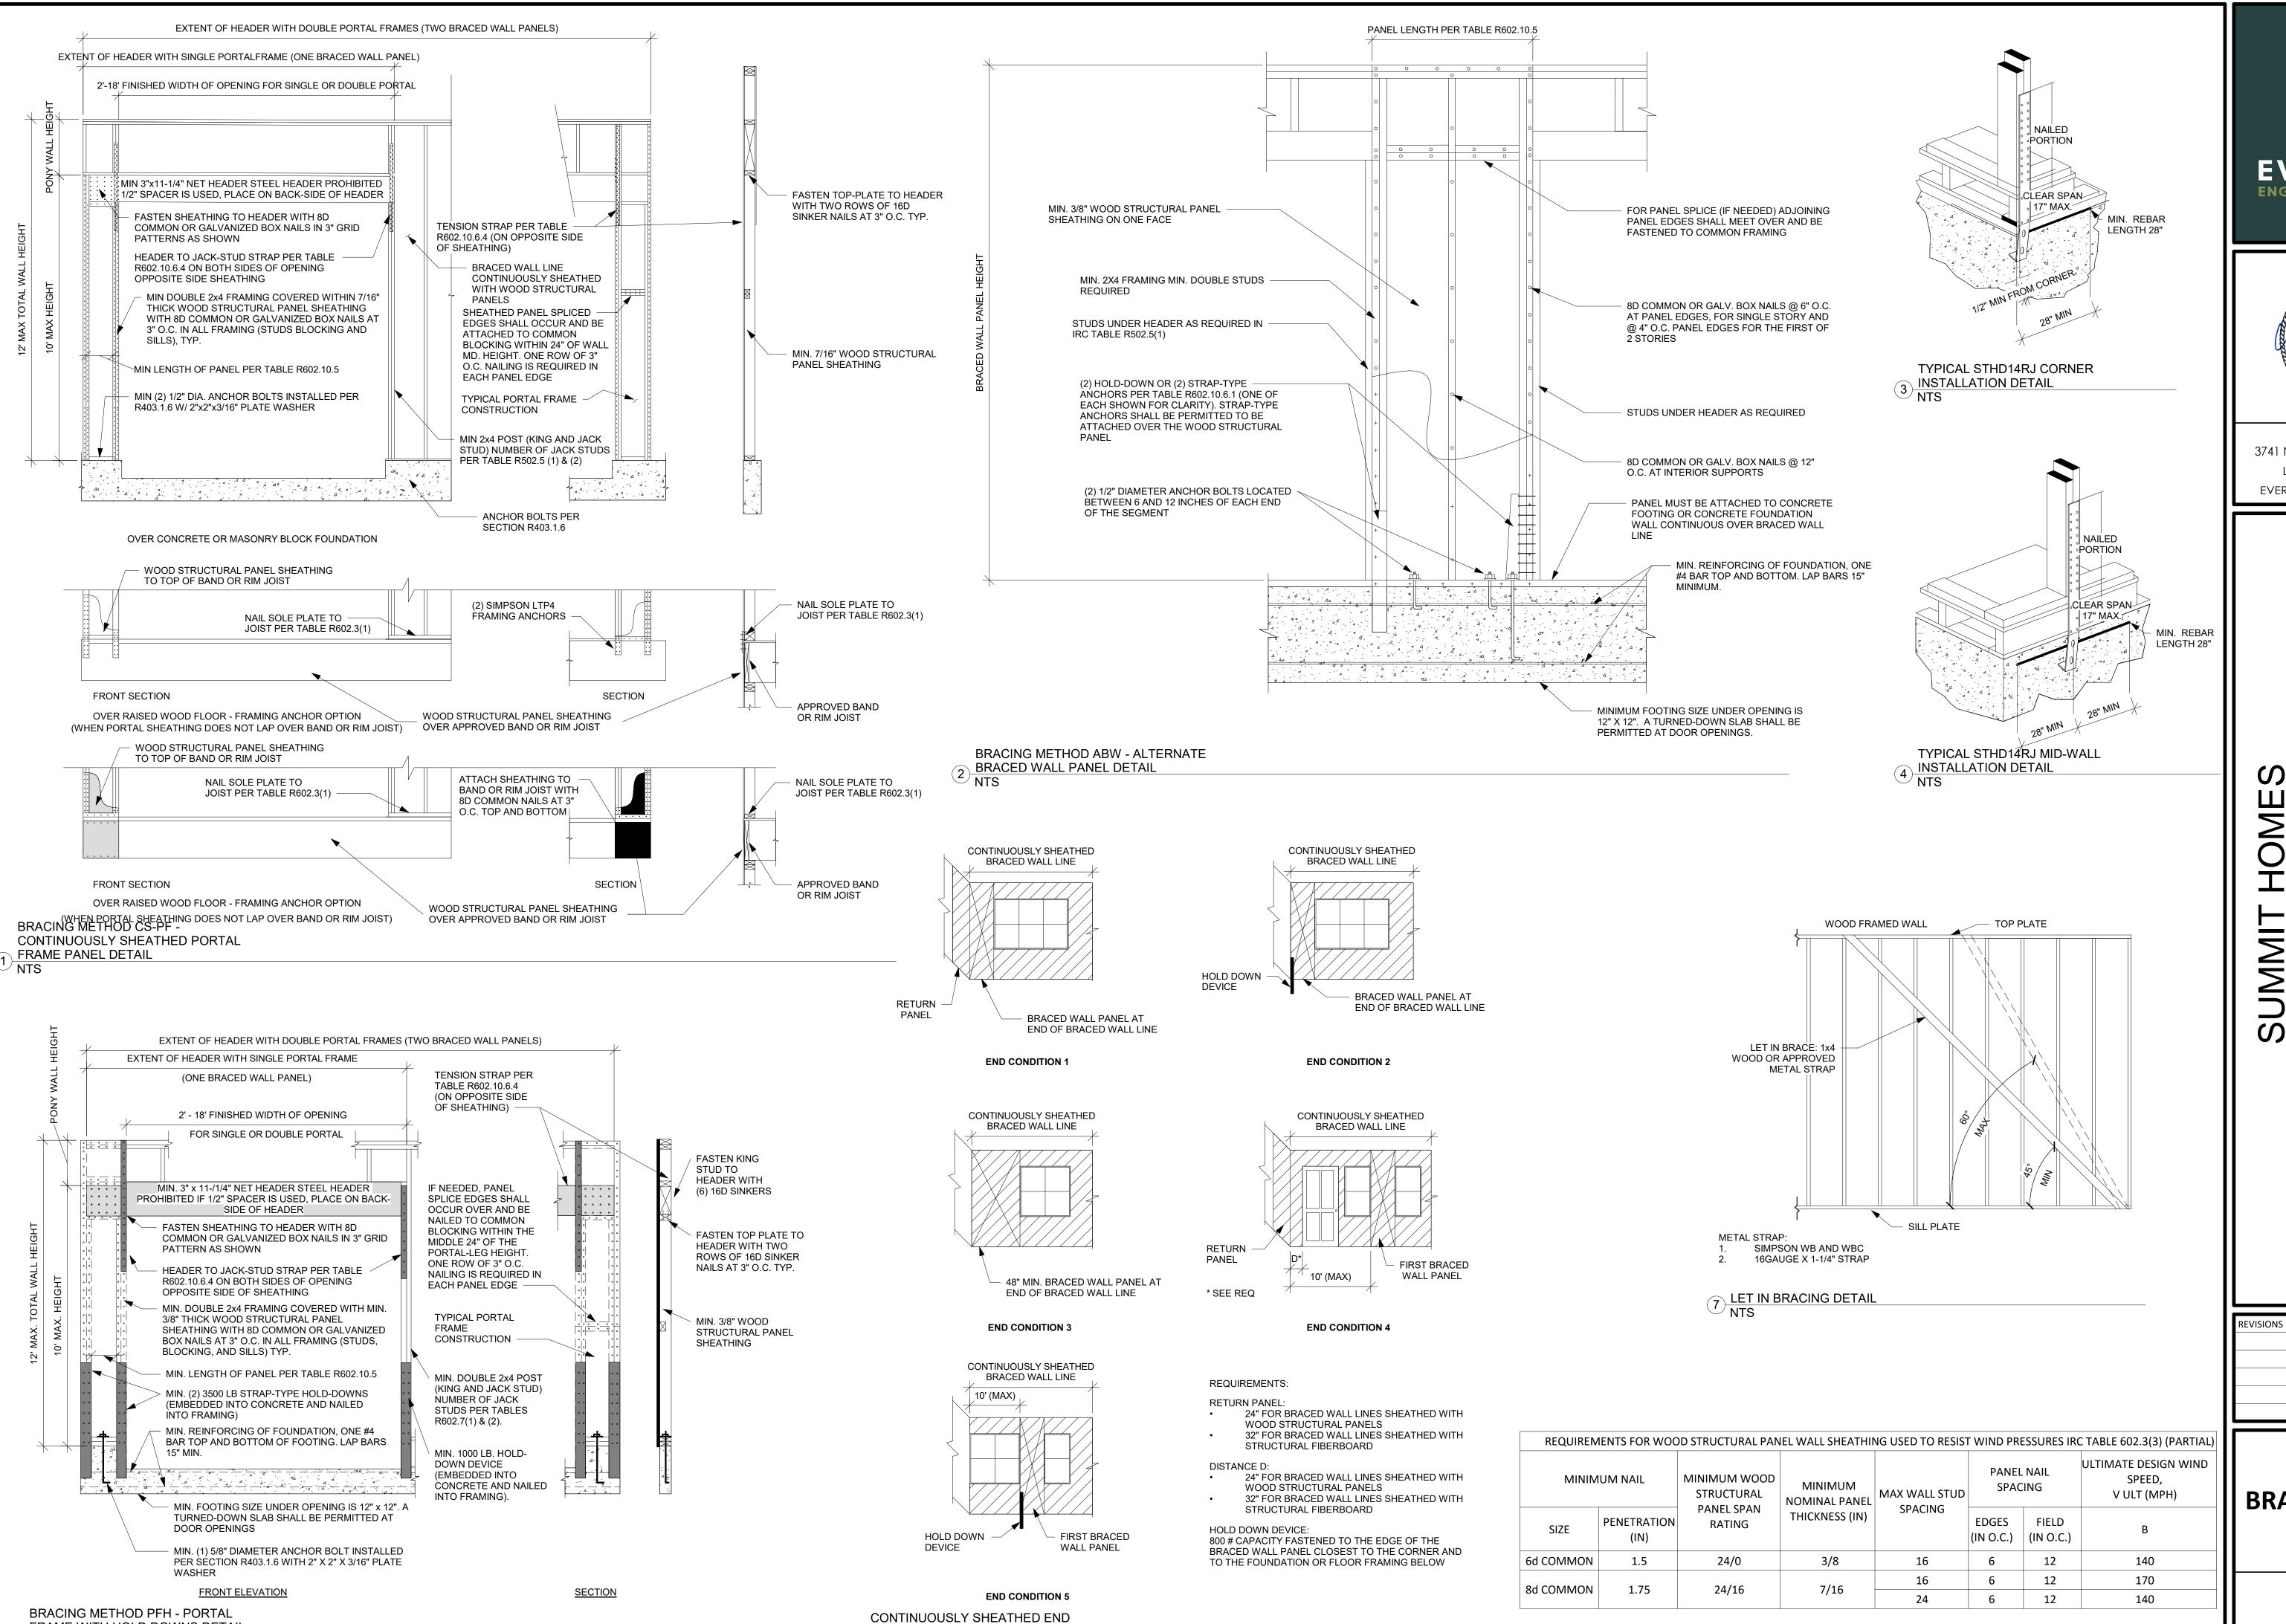


6 CONDITIONS NTS

FRAME WITH HOLD DOWNS DETAIL



RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW



EVERSTEAD LEE'S SUMMIT, MO 64064

3741 NE TROON DRIVE, SUITE 200 everstead.com (816)399-4901

BRACING DETAILS

10/10/2023 10:22:06 AM **SCALE** As indicated

	BRACING METHODS TABLE R602.	· · · · · · · · · · · · · · · · · · ·	TEDIA	
METHODS, MATERIAL	MINIMUM THICKNESS	CONNECTION CRI	SPACING	
WSP - WOOD STRUCTURAL PANEL AND	3/8" PANEL W/ MINIMUM 24/0 STRUCTURAL PANEL SPAN RATING	6d COMMON NAILS (2.0" x .113") W/ MINIMUM 1.5" PENETRATION	6" EDGES, 12" FIELD	
CS-WSP CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL	7/16" PANEL W/ MINIMUM 24/16 STRUCTURAL PANEL SPAN RATING	8d COMMON NAILS (2.5" x .131") W/ MINIMUM 1.75" PENETRATION	6" EDGES, 12" FIELD	
PFH - PORTAL FRAME WITH HOLD-DOWNS	3/8"	SEE DETAIL ON THIS PAGE	SEE DETAIL ON THIS PAGE	
PFG - PORTAL FRAME AT GARAGE	3/8"	SEE IRC SECTION R602.10.6.3	SEE IRC SECTION R602.10.6.3	
LIB LET-IN-BRACING	1x4 WOOD OR APPROVED METAL	WOOD: 2-8d COMMON NAILS OR 3-8d (2-1/2" LONG x .113" DIA.) NAILS	WOOD: PER STUE AND TOP AND BOTTOM PLATES	
	STRAPS AT 45 TO 60 DEGREE ANGLES FOR MAX 16" STUD SPACING	SIMPSON WB/WBC INSTALLED IN "X" PAIRS OR IN OPPOSING "V" FASHION AND FASTENED W/ (2) 16d COMMON NAILS FOR PLATE AND (1) 8d COMMON NAIL FOR STUDS	METAL: PER STUDE AND TOP AND BOTTOM PLATES	
		1/2" INTERIOR SHEATHING W/ STUDS AT 16" O.C.: 13 GAGE, 1-3/8" LONG, 19/64" HEAD; .098" DIA., 1-1/4" LONG, ANNULAR-RINGED; 5d COOLER NAIL, .086" DIA., 1-5/8" LONG, 15/64" HEAD; OR GYPSUM BOARD NAIL, .086" DIA. 1-5/8" LONG, 9/32" HEAD PER TABLE R702.3.5 (SEE TABLE FOR OTHER PANEL THICKNESS OPTIONS)	FOR ALL BRACED WALL PANEL	
GB-GYPSUM BOARD	1/2"	EXTERIOR 1/2" SHEATHING: 1-1/2" GALVANIZED ROOFING NAIL; STAPLE GALVANIZED, 1-1/2" LONG; 1-1/4" SCREWS, TYPE W OR S PER TABLE R602.3(1)	LOCATIONS: 7" EDGES (INCLUDING TOI AND BOTTOM PLATES) 7" FIEL	
		EXTERIOR 5/8" SHEATHING: 1-3/4" GALVANIZED ROOFING NAIL; STAPLE GALVANIZED, 1-5/8" LONG; 1-5/8" SCREWS, TYPE W OR S PER TABLE R602.3(1)		

DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENER	SPACING AND LOCATION OF FASTENERS
	ROOF	
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	4-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	TOE NAIL
CEILING JOISTS TO PLATE	4-8d BOX (2-1/2"x0.131") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10 BOX (3"x0.128") OR 3-3"x0.131" NAILS	TOE NAIL
CEILING JOISTS NOT ATTACHED TO PARALLEL RAFTER LAPS OVER PARTITIONS	4-10d BOX (3"x0.128") OR 3-16d COMMON (3-1/2"x0.162") OR 4-3"x0.131" NAILS	FACE NAIL
COLLAR TIE TO RAFTER, FACE NAIL OR 1-1/4"x20 GAGE RIDGE STRAP	4-10d BOX (3"x0.128") OR 3-10d COMMON (3"x0.148") OR 4-3"x0.131" NAILS	FACE NAIL EACH RAFTER
RAFTER OR ROOF TRUSS TO TOP PLATE, TOE NAIL	4-16d BOX (3-1/2"x0.135") OR 3-10d COMMON (3"x0.148") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	2 TOE NAILS ON ONE SIDE AND 1 TOE NAIL ON OPPOSITE SIDE OF EACH RAFTER OR TRUSS
ROOF RAFTERS TO	4-16d BOX (3-1/2"x0.135") OR 3-10d COMMON (3"x0.148") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	TOE NAIL
RIDGE, VALLEY OR HIP RAFTERS	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	END NAIL
	WALL	
STUD TO STUD (NOT	16d COMMON (3-1/2"x0.162")	24" O.C. FACE NAIL
AT BRACED WALL PANELS)	10d BOX (3"x0.128") OR 3"x0.131" NAIL	16" O.C. FACE NAIL
STUD TO STUD AND ABUTTING STUDS AT INTERSECTION WALL CORNERS	16d BOX (3-1/2"x0.135") OR 3"x0.131" NAIL	12" O.C. FACE NAIL
(AT BRACED WALL PANELS)	16d COMMON (3-1/2"x0.162")	16" O.C. FACE NAIL
BUILT-UP HEADER, TWO PIECES	16d COMMON (3-1/2"x0.162")	16" O.C. EACH EDGE FACE NAIL
WITH 1/2" SPACER	16d BOX (3-1/2"x0.135")	12" O.C. EACH EDGE FACE NAIL
CONTINUOUS HEADER TO STUD	5-8d BOX (2-1/2"x0.113") OR 4-8d COMMON (2-1/2"x0.131") OR 4-10d BOX (3"x0.128")	TOE NAIL
	16d COMMON (3-1/2"x0.162")	16" O.C. FACE NAIL
TOP PLATE TO TOP PLATE	10d BOX (3"x0.128") OR 3"x0.131" NAIL	12" O.C. FACE NAIL
DOUBLE TOP PLATE SPLICE	8-16d COMMON (3-1/2"x0.162") OR 12-16d BOX (3-1/2"x0.135") OR 12-10d BOX (3"x0.128") OR 12-3"x0.131" NAILS	FACE NAIL ON EACH SIDE OF END JOINT (MINIMUM 24" LAP SPLICE LENGTH EACH SIDE OF END JOINT)
BOTTOM PLATE TO JOIST, RIM JOIST,	16d COMMON (3-1/2"x0.162")	16" O.C. FACE NAIL
BAND JOIST, OR BLOCKING (NOT BRACED WALL PANELS)	-16d BOX (3-1/2"x0.135") OR 3"x0.131" NAIL	12" O.C. FACE NAIL
BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST, OR BLOCKING (AT BRACED WALL PANELS)	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162") OR 4-3"x0.131" NAILS	3 EACH 16" O.C. FACE NAIL 2 EACH 16" O.C. FACE NAIL 4 EACH 16" O.C. FACE NAIL
TOP OR BOTTOM PLATE TO STUD	4-8d BOX (2-1/2"x0.113") OR 3-16d BOX (3-1/2"x0.135") OR 4-8d COMMON (2-1/2"x0.131") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	TOE NAIL
TOT OR BOTTOMTERIE TO GTOD	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	END NAIL
TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS	3-10d BOX (3"x0.128") OR 2-16d COMMON (3-1/2"x0.162") OR 3-3"x0.131" NAILS	FACE NAIL
1" BRACE TO EACH STUD AND PLATE	3-8d BOX (2-1/2"x0.113") OR 2-8d COMMON (2-1/2"x0.131") OR 2-10d BOX (3"x0.128") OR 2 STAPLES 1-3/4"	FACE NAIL
1"x6" SHEATHING TO EACH BEARING	3-8d BOX (2-1/2"x0.113") OR 2-8d COMMON (2-1/2"x0.131") OR 2-10d BOX (3"x0.128") OR 2 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	FACE NAIL
1"x8" AND WIDER SHEATHINGTO	3-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 3 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	
EACH BEARING	WIDER THAN 1"x8": 4-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 4 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	FACE NAIL

DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENER		ND LOCATION STENERS	
	FLOOR			
JOIST TO SILL, TOP PLATE, OR GIRDER	4-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	TOE	E NAIL	
RIM JOIST, BAND JOIST OR	8d BOX (2-1/2"x0.113")	4" O.C.	TOE NAIL	
BLOCKING TO SILL OR TOP PLATE (ROOF APPLICATIONS ALSO)	8d COMMON (2-1/2"x0.131") OR 10d BOX (3"x0.128") OR 3"x0.131" NAIL	6" O.C.	TOE NAIL	
1"x6" SUBFLOOR OR LESS TO EACH JOIST	3-8d BOX (2-1/2"x0.113") OR 2-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 2 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	FACE NAIL		
2" SUBFLOOR TO JOIST OR GIRDER	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162")	BLIND ANI	BLIND AND FACE NAIL	
2" PLANKS (PLANK & BEAM-FLOOR & ROOF)	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162")	AT EACH BEARING FACE NAIL		
BAND OR RIM JOIST TO JOIST	3-16d COMMON (3-1/2"x0.162") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS OR 4 3"x14 GA. STAPLES, 7/16" CROWN	END NAIL		
	20d COMMON (3"x0.128")	NAIL EACH LAYER AS FOLLOWS: O.C AT TOP END AND BOTTOM A STAGGERED.		
BUILT-UP GIRDERS AND BEAMS, 2" LUMBER LAYERS	10d BOX (3"x0.128") OR 3"x0.131" NAIL	BOTTOM STAGE	NAIL AT TOP AND ERED ON OPPOSIT SIDES	
	AND: 2-20d COMMON (4"x0.192") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	FACE NAIL AT ENDS AND AT EAC SPLICE		
LEDGER STRIP SUPPORTING JOISTS OR RAFTERS	4-16d BOX (3-1/2"x0.135") OR 3-16d COMMON (3-1/2"x0.162") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	AT EACH JOIST OR RAFTER, FACE NAIL		
BRIDGING OR BLOCKING TO JOIST	2-10d BOX (3"x0.128") OR 2-8d COMMON (2-1/2"x0.131") OR 2-3"x0.131" NAILS	EACH END, TOE NAIL		
DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENER	EDGES (IN)	INTERMEDIATE SUPPORTS (IN)	
	ELS, SUBFLOOR, ROOF AND INTERIOR WALL SH PARTICLEBOARD WALL SHEATHING TO FRAMIN		IING AND	
	OOD STRUCTURAL PANEL EXTERIOR WALL SH		FRAMING]	
	6d COMMON (2"x0.113") NAIL (SUBFLOOR,			
3/8" - 1/2"	WALL) OR 8d COMMON (2-1/2"x0.131") NAILS (ROOF) OR RSRS-01 (2-3/8"x0.113") NAIL (ROOF)	6	12	
19/32" - 1"	8d COMMON NAIL (2-1/2"x0.131") OR RSRS-01 (2-3/8"x0.113") NAIL (ROOF)	6	12	
1-1/8" - 1-1.4"	10d COMMON (3"x0.148") NAIL OR 8d (2-1/2"x0.131") DEFORMED NAIL	6	12	
	OTHER WALL SHEATHING			
1/2" STRUCTURAL CELLULOSIC FIBERBOARD SHEATHING	1-1/2" GALVANIZED ROOFING NAIL, 7/16" HEAD DIAMETER OR 1-1/4" LONG 16 GA. STAPLE WITH 7/16" OR 1" CROWN	3 6		
25/32" STRUCTURAL CELLULOSIC FIBERBOARD SHEATHING	1-3/4" GALVANIZED ROOFING NAIL, 7/16" HEAD DIAMETER OR 1-1/2" LONG 16 GA. STAPLE WITH 7/16" OR 1" CROWN	3 6		
1/2" GYPSUM INTERIOR COVERING (R702.3.5)	1-1/2" GALVANIZED ROOFING NAIL: STAPLE GALVANIZED, 1-1/2" LONG; 1-1/4" SCREWS, TYPE "W" OR "S"	7 7		
5/8" GYPSUM INTERIOR COVERING (R702.3.5)	1-3/4" GALVANIZED ROOFING NAIL: STAPLE GALVANIZED, 1-5/8" LONG; 1-5/8" SCREWS, TYPE "W" OR "S"	7 7		
WOOD STRUCTURAL	PANELS, COMBINATION SUBFLOOR UNDERLA	YMENT TO FRAMIN	G	
3/4" AND LESS	6d DEFORMED (2"x0.120") NAIL OR 8d COMMON (2-1/2"x0.131") NAIL	6		
7/8" - 1"	8d COMMON (2-1/2"x0.131") NAIL OR 8d DEFORMED (2-1/2"x0.120") NAIL	6 12		

TABLE R50	7.9.1.3(2) PLACEM LEDGERS	ENT OF LAG SO DECK AND BAND JOI		DLTS IN
MINIMUM EN	O AND EDGE DISTA	ANCES AND SP (INCHES)	ACING BETWE	EN ROWS
	TOP EDGE	BOTTOM EDGE	ENDS	ROW SPACING
LEDGER	2	3/4	2	1-5/8 MIN 5 MAX
				1-5/8 MIN



RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW



EVERSTEAD

3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901

DEW FARMHOUSE

SUMMIT,

REVISIONS


OSAGE

98#

FASTENING SCHEDULE

S550

DATE 10/10/2023 10:22:09 AM SCALE 1/4" = 1'-0"

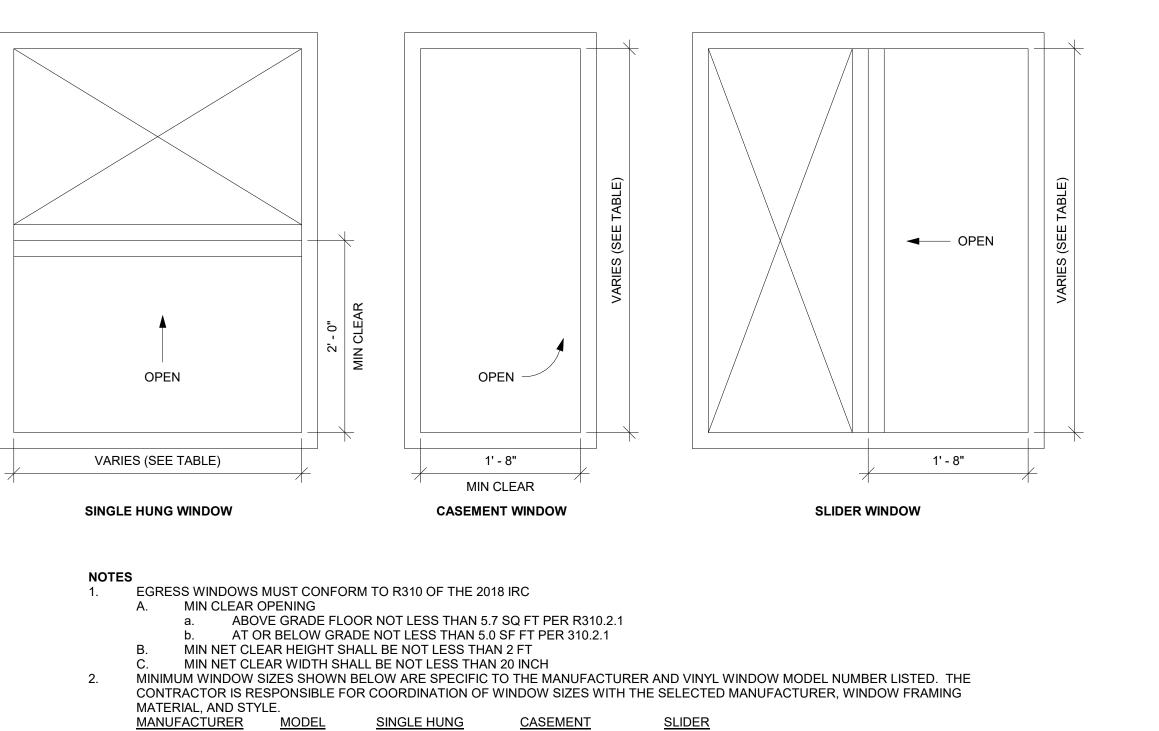

36X40

36X48

36X42

48X40

48X48

48X48

ANDERSON

ANDERSON

JELD-WEN

JELD-WEN

PELLA

PELLA

FF ELEV

WINDOW EGRESS (NTS)

200 SERIES

400 SERIES

250 SERIES

150 SERIES

36X60

V-2500

V-4500

RIM HEADER, SEE NOTES THIS SHEET SIMPSON LUS210 HANGER, UNO. FLOOR SYSTEM -**CONCRETE WINDOW WELL** MANUFACTURED WINDOW WELL HEADER ON JACK STUDS INTERIOR FND -WALL LINE COORDINATE TO ALLOW FULL OPENING OF EGRESS WINDOW EGRESS LADDER REQ'D FOR WELLS MORE THAN 44" DEEP, **EGRESS WINDOW** MANUFACTURED WINDOW DRAINABLE FILL WELL UNIT REINFORCEMENT, SEE NOTES BELOW FF (SLAB) MUST BE 36" BELOW GRADE.

WINDOW WELL MUST MEET REQUIREMENT IN R310.2.6 OF THE IRC AND LOCALLY ADOPTED CODE CONCRETE WINDOW WELL

INTALLED WITH NEW FOUNDATION POUR WINDOW WELL MONOLITHICALLY WITH ADJACENT FND WALL. REINFORCEMENT MATCH ADJACENT WALL REINFORCEMENT, SEE PLANS

B. INSTALLED TO EXISTING FOUNDATION a. REINFORCEMENT


DRILL AND EXPOY HOR BAR INTO EX FND, MIN 6" EMBEDMENT INTO EX FND WALL.

4" DRAIN TO FND TILE DRAIN LINE

(2) #4 BAR CONT IN WALL FTG. b. SEAL WHERE NEW CONCRETE IS POURED AGAINST EX FND WITH MASTIC STRIPS OR OTHER WATER STOP MATERIAL. MANUFACTURED WINDOW WELL

A. INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS COORDINATE DEPTH OF WELL WITH WINDOW AND MANUFACTURER REQUIREMENTS.

SECTION

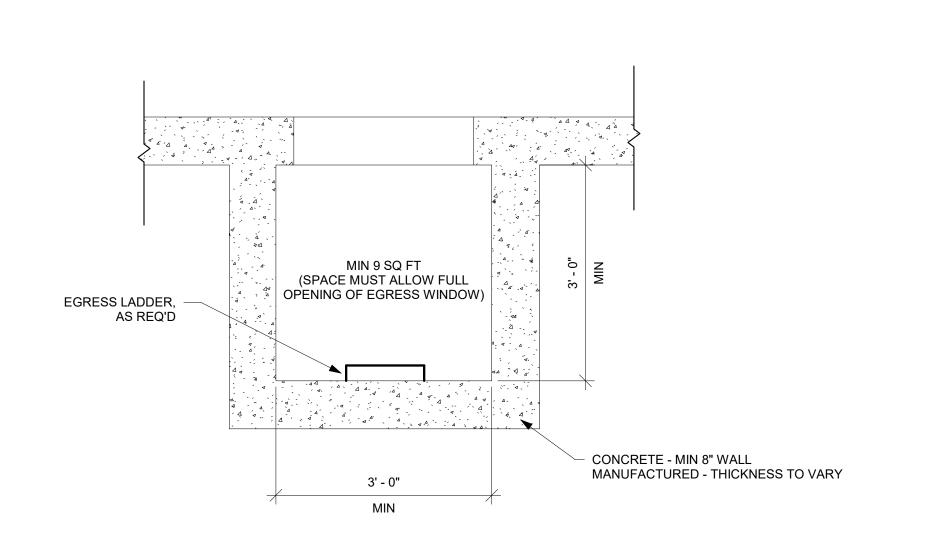

PLAN

WINDOW WELL FOR EGRESS (NTS)

REVISIONS

98#

RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW

NUMBER PE-2015016986 05/30/2024

EVERSTEAD 3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901

EGRESS WINDOWS

S560

SCALE As indicated

10/10/2023 10:22:12 AM