

Date:	8/14/2024		
Job:	JOHNSON TI-3		
Drawing:	1.0	Sheet	1 of 1
Scale:	1/8inch = 1foot		

Description:
 Fire Alarm Tenant Finish

These drawings are the intellectual property and actual property of Fire Alarm Solutions and/or Kenyco Industries, Inc. It is submitted in confidence and is not to be disclosed or used without our expressed written consent.


GREGORY P. GLADFELTER PE
 10233 MILLSTONE DRIVE, #4112
 LENEXA, KS 66220

Gregory Gladfelter PE provides design responsibility for this project to meet the requirements of the applicable codes and standards. The design is based on the information provided to him by the client and is not intended to be a substitute for a site visit. The design is based on the information provided to him by the client and is not intended to be a substitute for a site visit. The design is based on the information provided to him by the client and is not intended to be a substitute for a site visit.



AHJ SEAL

Item	Description
	Remote Power Supply
	End Of Line Resistor
	Photoelectric Smoke Detector
	Alarm Strobe/Ceiling Mount
	Alarm Horn/Stroke Ceiling Mount
	Relay Module

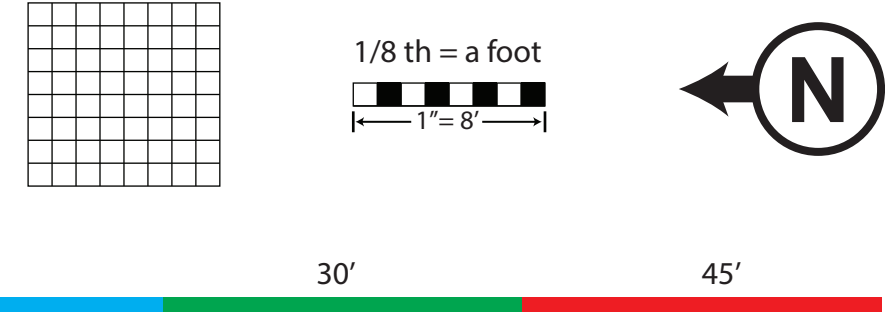

BUILDING IS 100% SPRINKLED


This system designed and installed according to
NFPA 72 2018-IBC 2018 & IFC 2018 SECTION 907

CONSTRUCTION TYPE: V-B
 OCCUPANCY Groups: F-1
 LEVELS: 1
 PROJECT SQUARE FOOTAGE: 61,504
 Central Station Service-Alarm Central

JOHNSON TI-3
 2225 NW Town Centre Blvd.
 Lee's Summit, Missouri 64064

FIRE ALARM PLAN

FA 1.0R

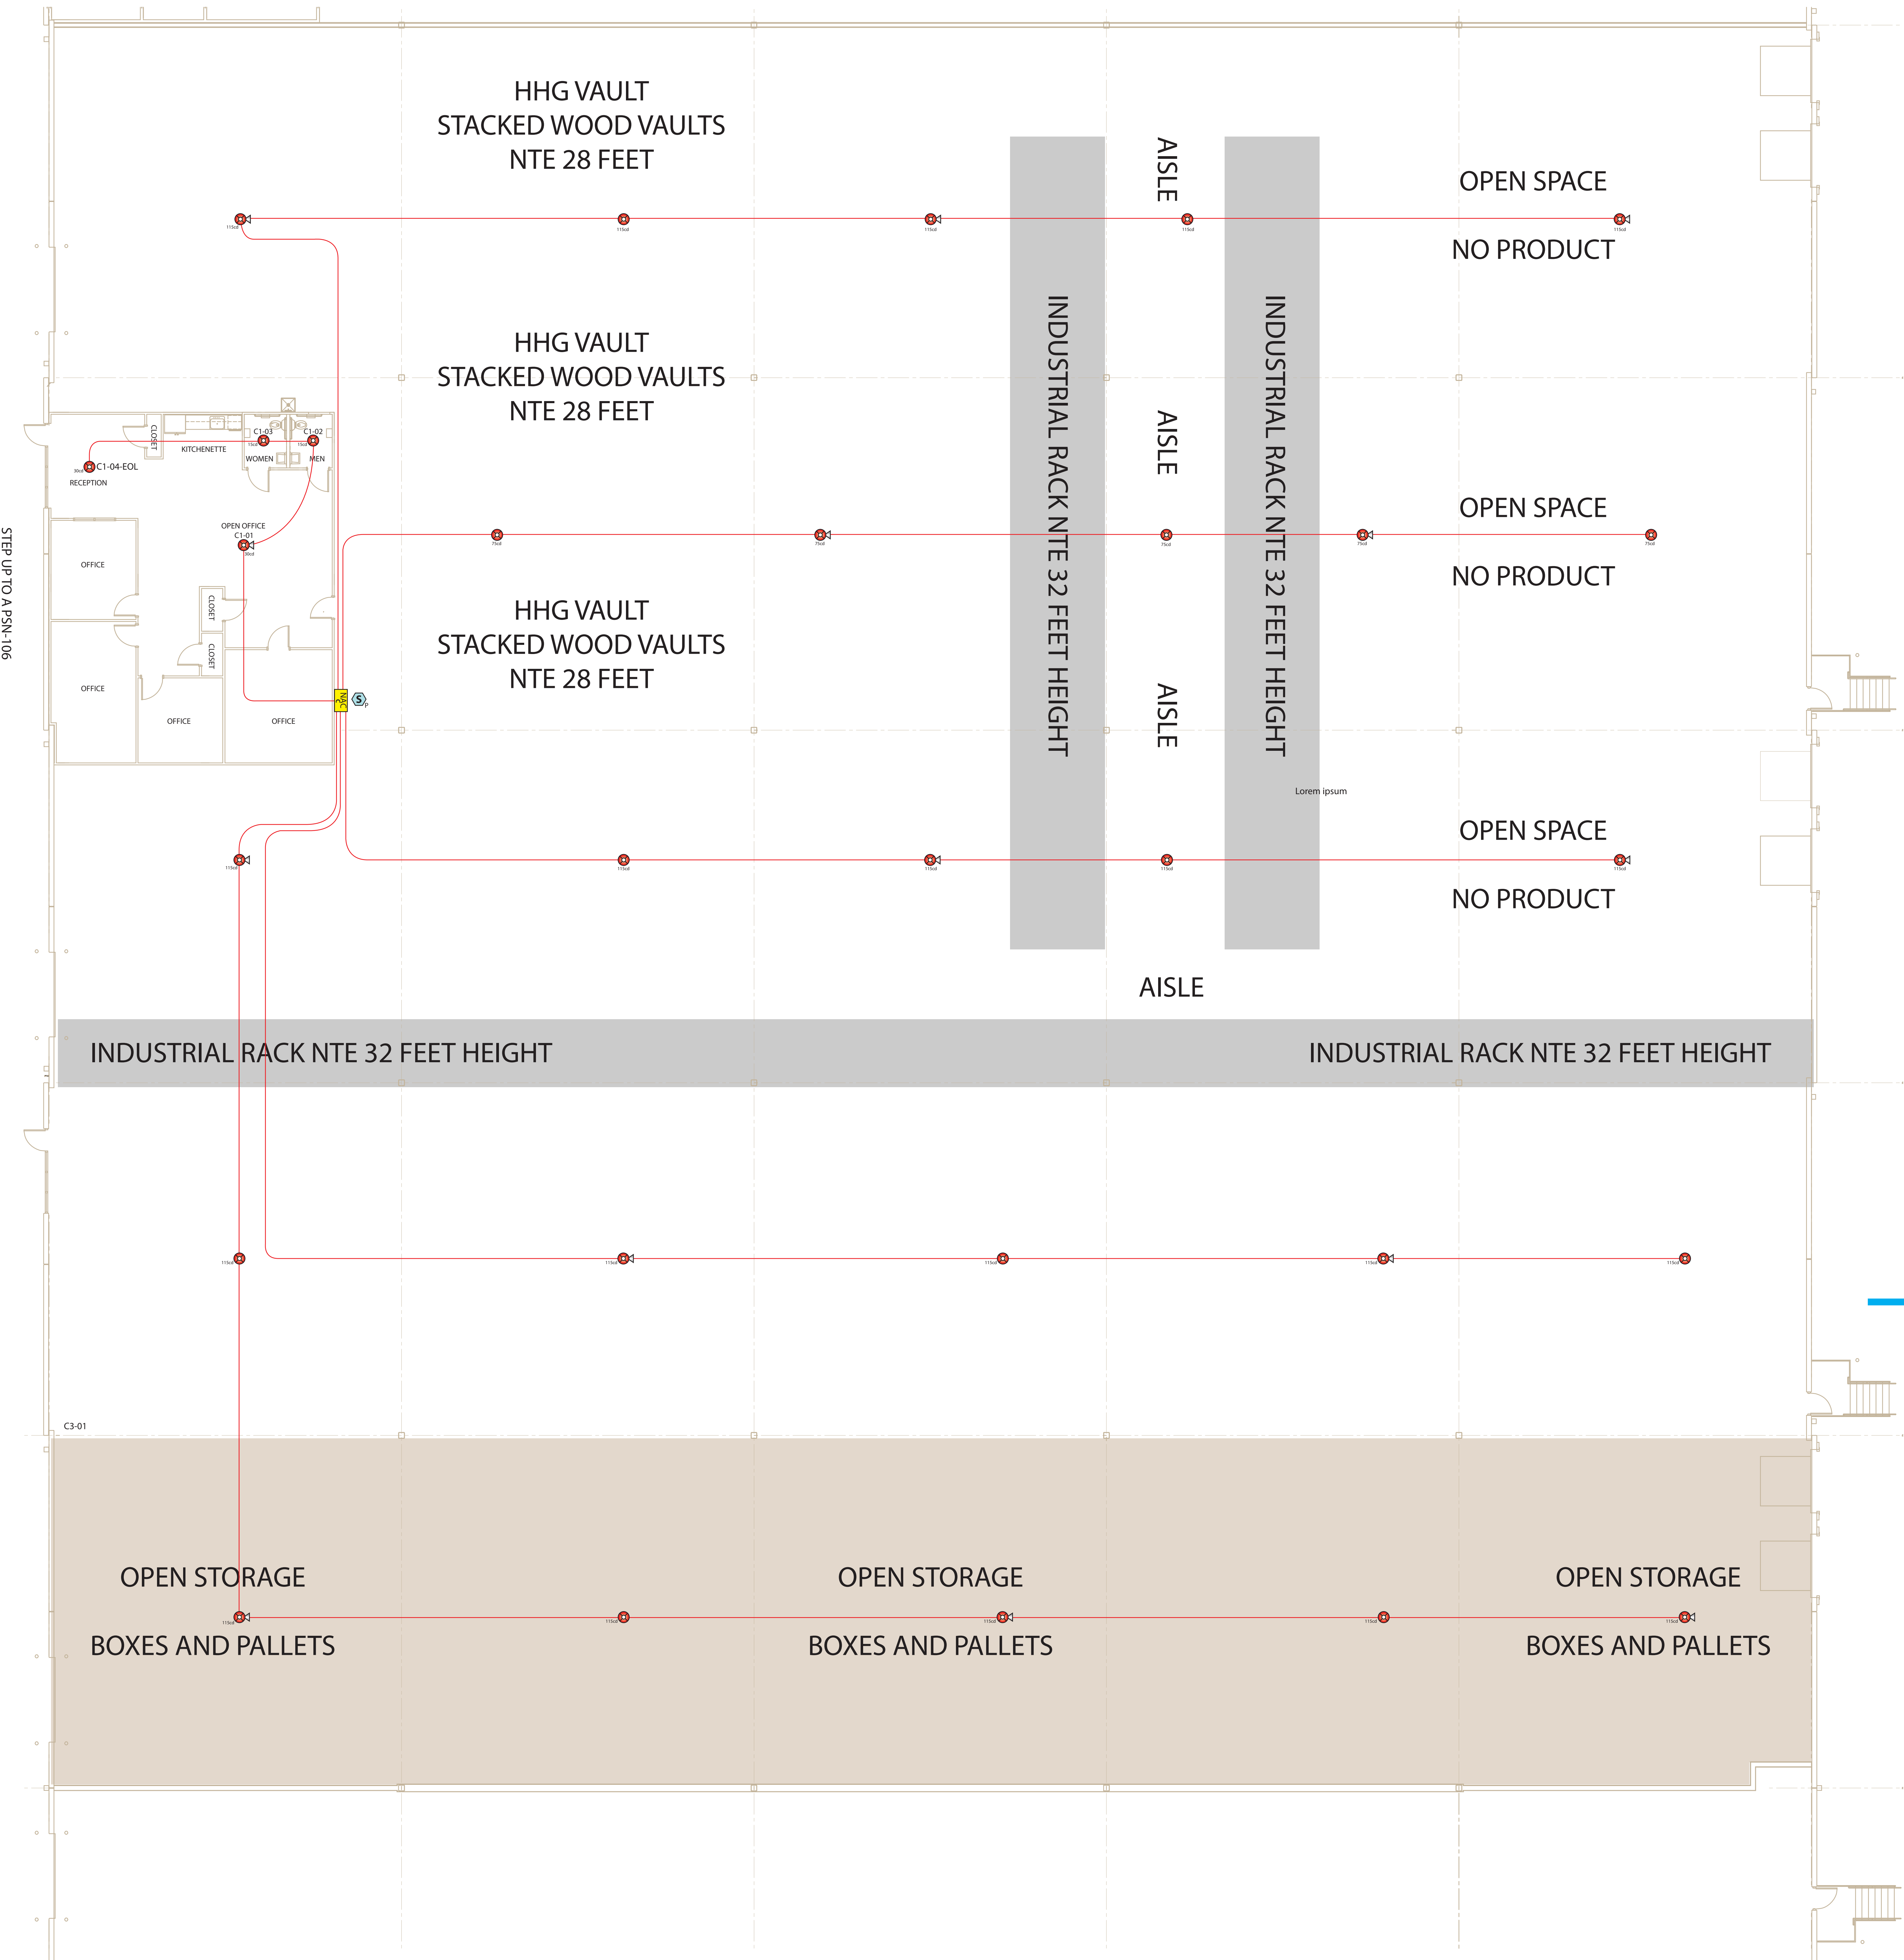

STEP UP TO A PSN-106