



**CURRAN**  
ARCHITECTURE

5719 LAWTON LOOP E. DR. #212  
INDIANAPOLIS, IN 46216  
O :: 317 . 288 . 0681  
F :: 317 . 288 . 0753



PROJECT INFORMATION

LEE'S SUMMIT LOGISTICS  
BUILDING C LOT 3

X CORNER OF  
NE TUDOR RD & MAIN ST  
LEE'S SUMMIT, MO 64086

ISSUE DATES

PERMIT SET 04.26.22

220019

NOTES:


BDA SURVEY WAS DONE IN ACCORDANCE WITH NFPA 72, 1221 AND IFC 510.

95% OF TOTAL COMMON AREAS MUST PASS WITH A DBM LEVEL OF NO LESS THAN -95dbm PER NFPA 72,1221, AND IFC 510.

100% OF CRITICAL AREAS MUST PASS WITH NO LESS THAN 95%dbm PER NFPA 72,1221, AND IFC 510.

RECEIVER FREQUENCY TO BE PROVIDED BY THE AHJ.

BDA SURVEY MUST BE DONE BY FCC/GROL CERTIFIED TECHNICIAN.

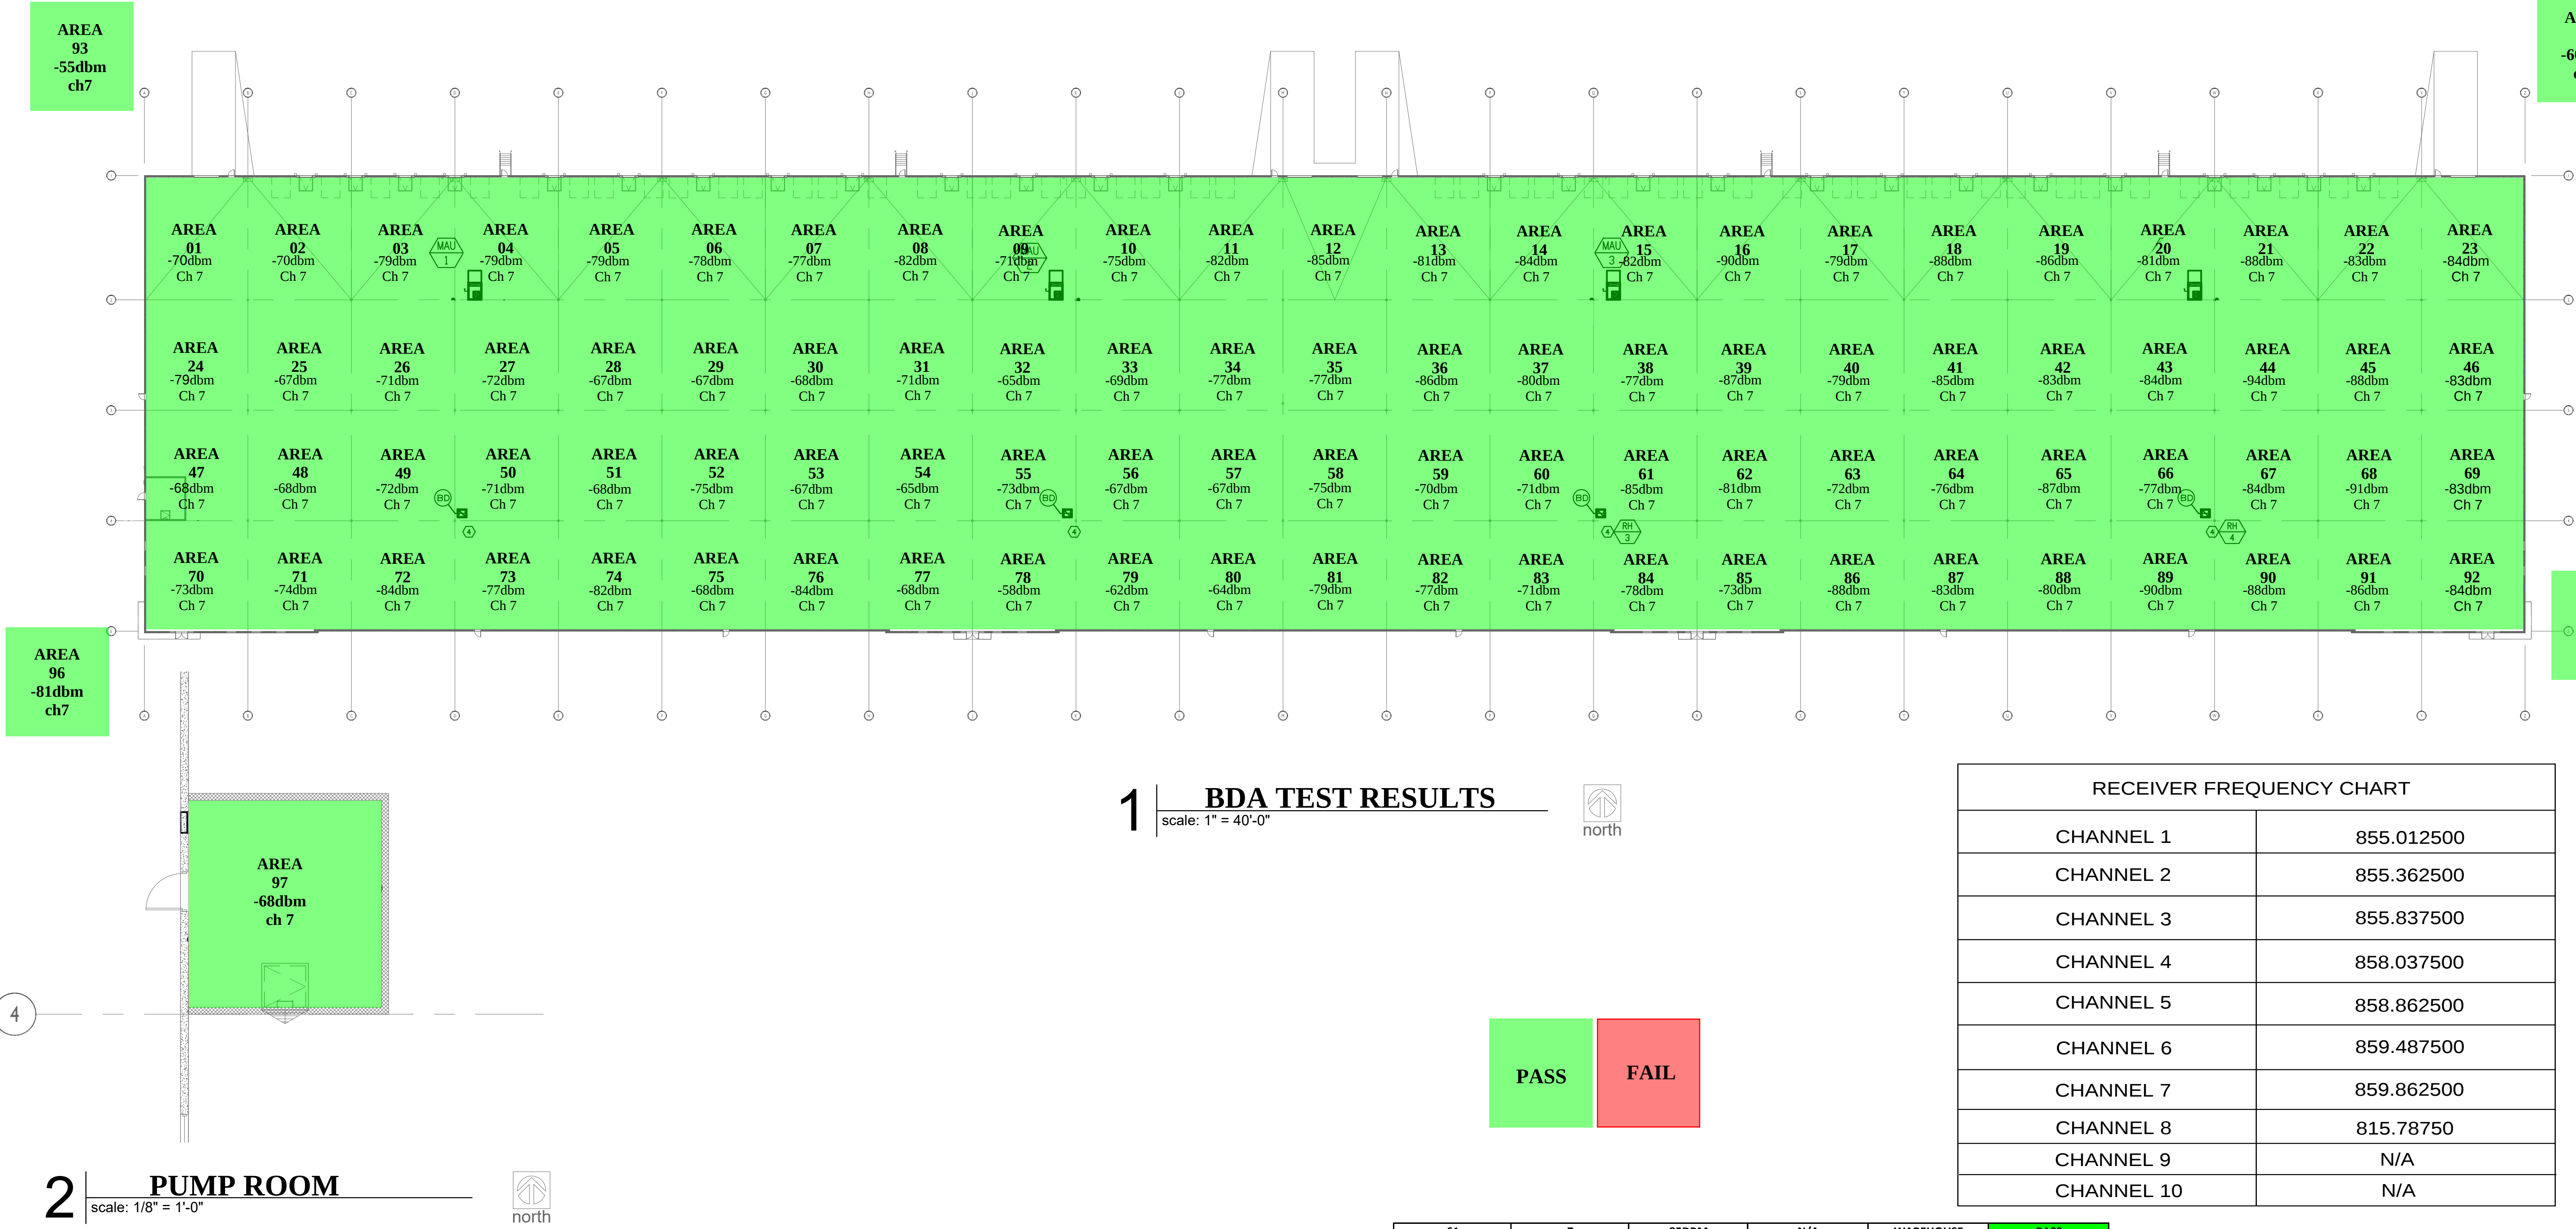

| JOB NAME: LSCC 3                            |         | CHANNEL 1: 855.012500 |            |           |           |
|---------------------------------------------|---------|-----------------------|------------|-----------|-----------|
| ADDRESS: 1231 NW MAIN ST                    |         | CHANNEL 2: 855.362500 |            |           |           |
| STATE/CITY/ZIP: MISSOURI, LEE SUMMIT, 64086 |         | CHANNEL 3: 855.837500 |            |           |           |
| SURBVEYOR NAME: CODY ANASTASIO              |         | CHANNEL 4: 855.037500 |            |           |           |
| DATE: 09-18-2014                            |         | CHANNEL 5: 858.862500 |            |           |           |
| FCC/GROL SN: PG00067600                     |         | CHANNEL 6: 859.487500 |            |           |           |
| FRN: 0030111165                             |         | CHANNEL 7: 859.787500 |            |           |           |
| AREA                                        | CHANNEL | DOWNLINK DBM          | UPLINK DBM | REMARKS   | PASS/FAIL |
| 1                                           | 7       | -70DBM                | N/A        | PUMP ROOM | PASS      |
| 2                                           | 7       | -81DBM                | N/A        | WAREHOUSE | PASS      |
| 3                                           | 7       | -79DBM                | N/A        | WAREHOUSE | PASS      |
| 4                                           | 7       | -79DBM                | N/A        | WAREHOUSE | PASS      |
| 5                                           | 4       | -79DBM                | N/A        | WAREHOUSE | PASS      |
| 6                                           | 7       | -78DBM                | N/A        | WAREHOUSE | PASS      |
| 7                                           | 7       | -77DBM                | N/A        | WAREHOUSE | PASS      |
| 8                                           | 7       | -82DBM                | N/A        | WAREHOUSE | PASS      |
| 9                                           | 7       | -71DBM                | N/A        | WAREHOUSE | PASS      |
| 10                                          | 7       | -75DBM                | N/A        | WAREHOUSE | PASS      |
| 11                                          | 7       | -82DBM                | N/A        | WAREHOUSE | PASS      |
| 12                                          | 7       | -85DBM                | N/A        | WAREHOUSE | PASS      |
| 13                                          | 7       | -81DBM                | N/A        | WAREHOUSE | PASS      |
| 14                                          | 7       | -84DBM                | N/A        | WAREHOUSE | PASS      |
| 15                                          | 7       | -82DBM                | N/A        | WAREHOUSE | PASS      |
| 16                                          | 7       | -90DBM                | N/A        | WAREHOUSE | PASS      |
| 17                                          | 7       | -79DBM                | N/A        | WAREHOUSE | PASS      |
| 18                                          | 7       | -88DBM                | N/A        | WAREHOUSE | PASS      |
| 19                                          | 7       | -86DBM                | N/A        | WAREHOUSE | PASS      |
| 20                                          | 7       | -81DBM                | N/A        | WAREHOUSE | PASS      |
| 21                                          | 7       | -88DBM                | N/A        | WAREHOUSE | PASS      |
| 22                                          | 7       | -83DBM                | N/A        | WAREHOUSE | PASS      |
| 23                                          | 7       | -84DBM                | N/A        | WAREHOUSE | PASS      |
| 24                                          | 7       | -79DBM                | N/A        | WAREHOUSE | PASS      |
| 25                                          | 7       | -67DBM                | N/A        | WAREHOUSE | PASS      |
| 26                                          | 7       | -71DBM                | N/A        | WAREHOUSE | PASS      |

|    |   |        |     |           |      |
|----|---|--------|-----|-----------|------|
| 27 | 7 | -72DBM | N/A | WAREHOUSE | PASS |
| 28 | 7 | -67DBM | N/A | WAREHOUSE | PASS |
| 29 | 7 | -67DBM | N/A | WAREHOUSE | PASS |
| 30 | 7 | -68DBM | N/A | WAREHOUSE | PASS |
| 31 | 7 | -71DBM | N/A | WAREHOUSE | PASS |
| 32 | 7 | -65DBM | N/A | WAREHOUSE | PASS |
| 33 | 7 | -69DBM | N/A | WAREHOUSE | PASS |
| 34 | 7 | -77DBM | N/A | WAREHOUSE | PASS |
| 35 | 7 | -77DBM | N/A | WAREHOUSE | PASS |
| 36 | 7 | -86DBM | N/A | WAREHOUSE | PASS |
| 37 | 7 | -80DBM | N/A | WAREHOUSE | PASS |
| 38 | 7 | -77DBM | N/A | WAREHOUSE | PASS |
| 39 | 7 | -87DBM | N/A | WAREHOUSE | PASS |
| 40 | 7 | -79DBM | N/A | WAREHOUSE | PASS |
| 41 | 7 | -85DBM | N/A | WAREHOUSE | PASS |
| 42 | 7 | -83DBM | N/A | WAREHOUSE | PASS |
| 43 | 7 | -84DBM | N/A | WAREHOUSE | PASS |
| 44 | 4 | -94DBM | N/A | WAREHOUSE | PASS |
| 45 | 7 | -88DBM | N/A | WAREHOUSE | PASS |
| 46 | 7 | -83DBM | N/A | WAREHOUSE | PASS |
| 47 | 7 | -68DBM | N/A | WAREHOUSE | PASS |
| 48 | 7 | -68DBM | N/A | WAREHOUSE | PASS |
| 49 | 7 | -72DBM | N/A | WAREHOUSE | PASS |
| 50 | 7 | -71DBM | N/A | WAREHOUSE | PASS |
| 51 | 7 | -68DBM | N/A | WAREHOUSE | PASS |
| 52 | 7 | -75DBM | N/A | WAREHOUSE | PASS |
| 53 | 7 | -67DBM | N/A | WAREHOUSE | PASS |
| 54 | 7 | -65DBM | N/A | WAREHOUSE | PASS |
| 55 | 7 | -73DBM | N/A | WAREHOUSE | PASS |
| 56 | 7 | -67DBM | N/A | WAREHOUSE | PASS |
| 57 | 7 | -67DBM | N/A | WAREHOUSE | PASS |
| 58 | 7 | -75DBM | N/A | WAREHOUSE | PASS |
| 59 | 7 | -70DBM | N/A | WAREHOUSE | PASS |
| 60 | 7 | -71DBM | N/A | WAREHOUSE | PASS |

|    |   |        |     |            |      |
|----|---|--------|-----|------------|------|
| 61 | 7 | -85DBM | N/A | WAREHOUSE  | PASS |
| 62 | 7 | -81DBM | N/A | WAREHOUSE  | PASS |
| 63 | 7 | -72DBM | N/A | WAREHOUSE  | PASS |
| 64 | 7 | -76DBM | N/A | WAREHOUSE  | PASS |
| 65 | 7 | -87DBM | N/A | WAREHOUSE  | PASS |
| 66 | 7 | -77DBM | N/A | WAREHOUSE  | PASS |
| 67 | 7 | -84DBM | N/A | WAREHOUSE  | PASS |
| 68 | 7 | -91DBM | N/A | WAREHOUSE  | PASS |
| 69 | 7 | -83DBM | N/A | WAREHOUSE  | PASS |
| 70 | 7 | -73DBM | N/A | WAREHOUSE  | PASS |
| 71 | 7 | -74DBM | N/A | WAREHOUSE  | PASS |
| 72 | 7 | -84DBM | N/A | WAREHOUSE  | PASS |
| 73 | 7 | -77DBM | N/A | WAREHOUSE  | PASS |
| 74 | 7 | -82DBM | N/A | WAREHOUSE  | PASS |
| 75 | 7 | -68DBM | N/A | WAREHOUSE  | PASS |
| 76 | 7 | -84DBM | NN  | WAREHOUSE  | PASS |
| 77 | 7 | -68DBM | N/A | WAREHOUSE  | PASS |
| 78 | 7 | -58DBM | N/A | WAREHOUSE  | PASS |
| 79 | 7 | -62DBM | N/A | WAREHOUSE  | PASS |
| 80 | 7 | -64DBM | N/A | WAREHOUSE  | PASS |
| 81 | 7 | -79DBM | N/A | WAREHOUSE  | PASS |
| 82 | 7 | -77DBM | N/A | WAREHOUSE  | PASS |
| 83 | 7 | -71DBM | N/A | WAREHOUSE  | PASS |
| 84 | 7 | -78DBM | N/A | WAREHOUSE  | PASS |
| 85 | 7 | -73DBM | N/A | WAREHOUSE  | PASS |
| 86 | 7 | -88DBM | N/A | WAREHOUSE  | PASS |
| 87 | 7 | 83DBM  | N/A | WAREHOUSE  | PASS |
| 88 | 7 | 80DBM  | N/A | WAREHOUSE  | PASS |
| 89 | 7 | 90DBM  | N/A | WAREHOUSE  | PASS |
| 90 | 7 | 88DBM  | N/A | WAREHOUSE  | PASS |
| 91 | 7 | 86DBM  | N/A | WAREHOUSE  | PASS |
| 92 | 7 | 84DBM  | N/A | WAREHOUSE  | PASS |
| 93 | 7 | 55DBM  | N/A | NW OUTSIDE | PASS |
| 94 | 7 | 60DBM  | N/A | NE OUTSIDE | PASS |
| 95 | 7 | -88DBM | N/A | SE OUTSIDE | PASS |
| 96 | 7 | -81DBM | N/A | SW OUTSIDE | PASS |
| 97 | 7 | -68DBM | N/A | PUMP ROOM  | PASS |