


From MRM South

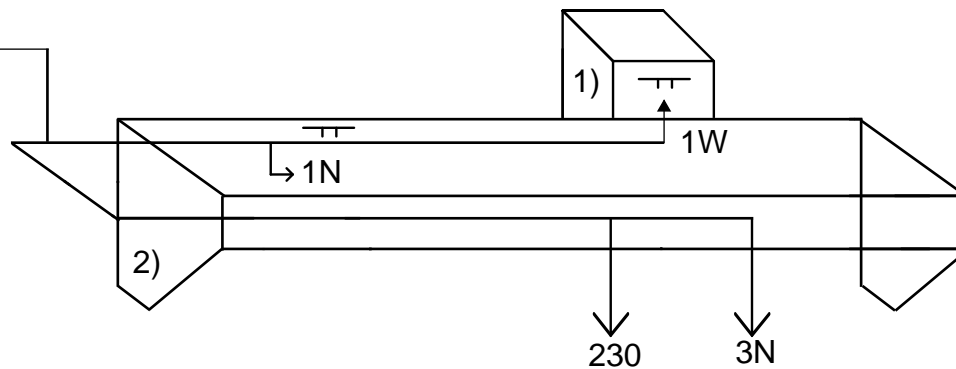


Key:

3N = 3 Flow

1W = 1 Flow

1N = 1 Flow

230 = 2 Flow

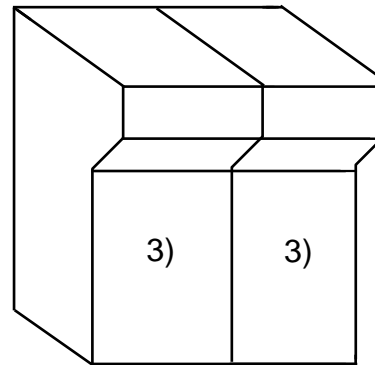

### North Hood Information:

1) 7" x 8" Duct

3) (2) Fryers

2) 3'-6" Hood

Project:  
Pho Noodle  
1720 NW Chipman Rd.  
Lee's Summit, MO

Prepared By:  
451 Fire Protection  
1021 N. Wills  
Independence, MO

Comment:  
(2) - 3.00 Gal. Ansul R-102  
1-1/2" Gas Valve  
Electric Interlock - UL 300  
Split Piped

Total Flow Points Available = 22  
Total Flow Points Used on North Hood = 7