


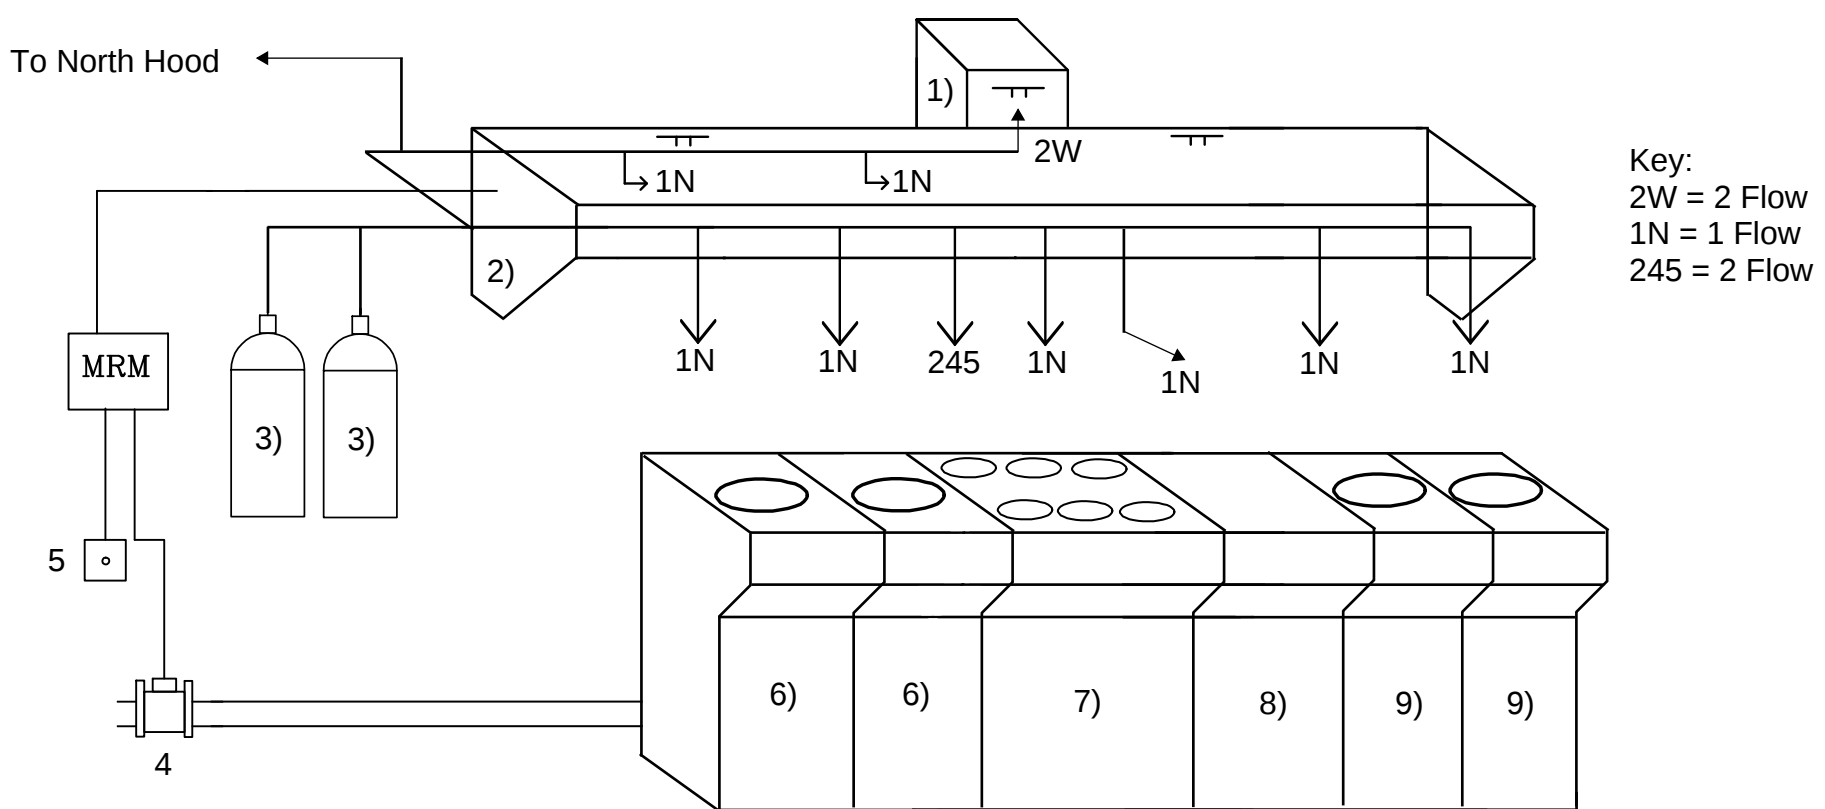

South Hood Information:

- | | | |
|------------------------------|---------------------|-----------------------|
| 1) 10"x29" Duct | 4) 1-1/2" Gas Valve | 7) (6) Burner Range |
| 2) 14'-0" Hood | 5) Remote Pull | 8) 36" Flat Top |
| 3) (2) 3.00 Gal. Ansul R-102 | 6) Wok | 9) (2) 18" Stock Pots |

Project:
 Pho Noodle
 1720 NW Chipman Rd.
 Lee's Summit, MO

Prepared By:
 451 Fire Protection
 1021 N. Wills
 Independence, MO

Comment:
 (2) - 3.00 Gal. Ansul R-102
 1-1/2" Gas Valve
 Electric Interlock - UL 300
 Split Piped

Total Flow Points Available = 22
 Total Flow Points Used on South Hood = 12