



Discovery Pet Spa

1921 NE Trails Edge Boulevard

Lee's Summit, Jackson County, Missouri



ZONING & CODE REVIEW

PROJECT SCOPE: NEW CONSTRUCTION OF AN APPROXIMATELY 10366 SF SINGLE STORY BUILDING OVER SLAB-ON-GRADE FOUNDATION ACCOMMODATING A B-BUSINESS USE AND LOCATED WITHIN THE CITY LIMITS OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI AND SUBJECT TO ALL STATE AND LOCAL DESIGN REQUIREMENTS WITHIN.	
BUILDING CODES IN EFFECT: IBC/2018, IRC/2018, IRC/2018, IFGC/2018, IFGC/2018, NEC/2017, ICC/ANSI A117.1-2009 AS AMENDED AND ADOPTED BY THE CITY OF LEE'S SUMMIT, MISSOURI	
ADMINISTRATION	(CHAPTER 1)
• DESIGN PROFESSIONAL IN RESPONSIBLE CHARGE JAY D. BERENDZEN, ARCHITECT PORTER, BERENDZEN & ASSOCIATES, P.C. 305 EAST BROADWAY, SUITE A ASHLAND, MISSOURI 65010 573.657.2022 PHONE	
USE & OCCUPANCY CLASSIFICATION	(CHAPTER 3)
• B - BUSINESS	
GENERAL BUILDING HEIGHTS & AREAS	(CHAPTER 5)
• (USE GROUP B, CONSTRUCTION TYPE YB - SPRINKLERED)	
HEIGHTS	
• TABULAR ALLOWABLE BUILDING HEIGHT	
• B-BUSINESS USE:	3 STORIES, 60 FEET
• ACTUAL BUILDING HEIGHT:	1 STORIES, 23 FEET
AREA	
• TABULAR ALLOWABLE BUILDING AREA PER FLOOR:	
• B BUSINESS USE:	36,000 SF
• FRONTAGE INCREASE = 75% = 9,000SF(0.75) =	6,750 SF
• TOTAL ALLOWABLE AREA =	42,750 SF
• ACTUAL BUILDING AREAS:	10,366 sf
TYPES OF CONSTRUCTION	(CHAPTER 6)
• TYPE YB - SPRINKLERED	

OWNER: DPLS P1 LLC		Brian P. Maenner bpmmaenner@intrinsicdevelopment.com
3622 Endeavor Avenue, Suite 101 Columbia, Missouri 65201		
CLIENT: INTRINSIC DEVELOPMENT		
3622 Endeavor Avenue, Suite 101 Columbia, Missouri 65201 573.881.0280 phone intrinsicdevelopment.com		Brian P. Maenner bpmmaenner@intrinsicdevelopment.com
ARCHITECT: PORTER, BERENDZEN & ASSOCIATES, P.C.		
	200 South Henry Clay Blvd. Ashland, Missouri 65010 573.657.2022 phone pba-architecture.com	Jay D. Berendzen, AIA jay@pba-architecture.com Jon D. Berendzen, AIA jon@pba-architecture.com
CIVIL ENGINEERING: CROCKETT ENGINEERING CONSULTANTS		
	1000 West Nifong Boulevard, Bldg. 1 Columbia, Missouri 65203 573.447.0292 phone www.crockettengineering.com	Nathan Eckhoff, PE nathan@andersonengineeringinc.com Nolan Dixon, EIT NDixon@crockettengineering.com
STRUCTURAL ENGINEERING: CROCKETT ENGINEERING CONSULTANTS		
	1000 West Nifong Boulevard, Bldg. 1 Columbia, Missouri 65203 573.447.0292 phone www.crockettengineering.com	Greg Linneman, PE GLinneman@crockettengineering.com Jared Verslues, PE JVerslues@crockettengineering.com
MECHANICAL/ELECTRICAL/PLUMBING ENGINEERING: J-SQUARED ENGINEERING		
	2400 Bluff Creek Drive #101 Columbia, Missouri 65201 573.234.4492 phone j-squaredeng.com	JP Watson, PE jp@j-squaredeng.com Jeremy Patrick jeremy@j-squaredeng.com

SHEET INDEX		
CVR	-	COVER SHEET / ARCHITECTURAL CODE REVIEW
CIVIL ENGINEERING DRAWINGS UNDER SEPARATE COVER		
S100	-	COVER / GENERAL STRUCTURAL DATA
S200	-	FOUNDATION PLAN
S210	-	FOUNDATION DETAILS
S211	-	FOUNDATION DETAILS
S300	-	ROOF FRAMING PLAN
S300A	-	SHEAR WALL PLAN
S310	-	ROOF FRAMING DETAILS
S311	-	ROOF FRAMING DETAILS
A100	-	OVERALL FLOOR PLAN
A101	-	FLOOR PLAN / LIFE SAFETY
A201	-	DIMENSIONAL PLAN
A301	-	REFLECTED CEILING PLAN
A401	-	ROOF PLAN
A500	-	EXTERIOR ELEVATIONS
A501	-	EXTERIOR ELEVATIONS
A502	-	EXTERIOR RENDERINGS
A600	-	BUILDING SECTIONS / DETAILS
A601	-	BUILDING SECTIONS / DETAILS
A602	-	BUILDING SECTIONS / DETAILS
A603	-	BUILDING SECTIONS / DETAILS
A700	-	STOREFRONT ELEVATIONS / DETAILS
A800	-	INTERIOR ELEVATIONS
A900	-	SITE DETAILS / SCHEDULES
MEP1	-	MECHANICAL ELECTRICAL PLUMBING COVER SHEET
MEP2	-	SITE UTILITY / SITE LIGHTING PLAN
M101	-	HVAC PLAN
M501	-	HVAC DETAILS
M502	-	HVAC DETAILS
M503	-	HVAC DETAILS
M601	-	HVAC SCHEDULES
EP101	-	POWER PLAN
EL101	-	LIGHTING PLAN
E501	-	ELECTRICAL SCHEDULES
E601	-	ELECTRICAL DETAILS
PS101	-	SANITARY SEWER PLAN
PW101	-	WATER & GAS PLAN
PS01	-	PLUMBING DETAILS & SCHEDULES

GENERAL NOTES	
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND EACH OF HIS SUBCONTRACTORS TO REVIEW THE DRAWINGS TO ASSURE AND COORDINATION OF ALL WORK AFFECTING EACH TRADE. FAILURE TO REVIEW ALL CONTRACT DOCUMENTS FOR APPLICABLE ITEMS OF WORK SHALL NOT RELIEVE THE RESPONSIBLE PARTY FROM PERFORMING ALL WORK REQUIRED.	
• CIVIL, STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING - NOTIFY THE DESIGN TEAM & INTRINSIC DEVELOPMENT OF ALL CONFLICTS WITHIN THE WORK.	
• DRAWINGS - THESE DRAWINGS SHALL NOT BE SCALED. REFER TO DIMENSIONS INDICATED, ACTUAL SIZES OF CONSTRUCTION ITEMS, OR OTHER METHODS OF LOCATING CONSTRUCTION. WHERE NO DIMENSION OR METHOD OF DETERMINING A LOCATION IS GIVEN, VERIFY CORRECT LOCATION WITH THE DESIGN TEAM & INTRINSIC DEVELOPMENT PRIOR TO INSTALLATION.	
• DIMENSIONS - DIMENSIONS ON PLANS ARE FROM FACE OF CONCRETE, MASONRY, OR FRAMING UNLESS OTHERWISE NOTED. DIMENSIONS INDICATED AS "CLEAR" SHALL BE A MINIMUM DIMENSION, (FACE TO FACE) OF FINISH MATERIALS.	
• COORDINATION - GENERAL CONTRACTOR SHALL COORDINATE REQUIREMENTS OF ALL TRADES TO ALLOW FOR TIMELY INCLUSION IN THE WORK SO AS NOT TO DELAY THE WORK OR THE WORK OF ANY SUBCONTRACTOR.	
• EQUIPMENT - REFER TO EQUIPMENT SCHEDULE FOR ADDITIONAL INFORMATION. VERIFY ANY REQUIREMENTS FOR ROUGH-IN OR CONNECTION PRIOR TO CONSTRUCTION TO ASSURE CORRECT INSTALLATION, OPENINGS, ELECTRICAL, MECHANICAL, BLOCKING, ETC.	
• DUCTS, PIPE, CONDUIT, ETC. - ALL VERTICAL AND HORIZONTAL DUCTS, PIPES, CONDUIT, ETC., (WHETHER SHOWN OR NOT) IN FINISHED ROOMS SHALL BE LOCATED WITHIN WALLS OR ABOVE FINISHED CEILINGS. ITEMS THAT CANNOT BE LOCATED WITHIN WALLS OR CEILINGS SHALL BE FURRED IN AND FINISHED TO MATCH ADJACENT SURFACES AND ANY REQUIRED WALL OR CEILING RATINGS. VERIFY ACCEPTABILITY WITH THE DESIGN TEAM & INTRINSIC DEVELOPMENT PRIOR TO ENCASEMENT.	
• FIXTURES - LAVATORIES AND SINKS SHALL BE INSTALLED A MINIMUM OF 4" FROM FINISHED SIDE WALLS. FAUCETS SHALL BE INSTALLED WITH A MINIMUM OF 5" FROM THE OUTLET TO THE FLOOD RIM OF SINKS. INCLUDING THOSE EQUIPPED WITH VACUUM BREAKERS. WATER CLOSETS SHALL BE INSTALLED A MINIMUM OF 16" FROM FINISHED SIDE WALLS TO CENTERLINE OF FIXTURES.	
• BLOCKING - BLOCKING OUTSIDE THE BUILDING ENVELOPE OR SUBJECT TO MOIST OR HUMID CONDITIONS SHALL BE PRESSURE TREATED AND USE CORROSION RESISTANT FASTENERS.	
• ACCESS DOORS - FURNISH AND INSTALL ACCESS DOORS IN WALLS AND NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, FIRE PROTECTION, PLUMBING, ELECTRICAL OR OTHER EQUIPMENT IS REQUIRED. WHERE WALL OR CEILING IS REQUIRED TO BE RATED, PROVIDE ACCESS DOORS OF FIRE RATING EQUAL TO THE ASSEMBLY IN WHICH THEY OCCUR.	
• EXISTING CONDITIONS - THE EXISTING CONDITIONS SHOWN ON THESE DRAWINGS ARE BASED ON INFORMATION PROVIDED TO THE DESIGN TEAM & INTRINSIC DEVELOPMENT. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS ON THE JOB SITE, AND NOTIFY THE DESIGN TEAM & INTRINSIC DEVELOPMENT OF DEVIATIONS FROM THESE DRAWINGS PRIOR TO FABRICATION AND INSTALLATION OF THE WORK.	
• PRECAUTIONS - IF UNFORESEEN CONDITIONS ARE DISCOVERED WHICH COULD RESULT IN DAMAGE TO THE STRUCTURE OR INJURY TO ITS OCCUPANTS, REPORT ANY SUCH CONDITION IMMEDIATELY TO THE DESIGN TEAM & INTRINSIC DEVELOPMENT. TAKE PRECAUTIONS TO PROPERLY SUPPORT THE STRUCTURE.	
• HAZARDOUS MATERIALS - CONTRACTOR SHALL IMMEDIATELY REPORT THE DISCOVERY OF ANY HAZARDOUS MATERIALS TO THE DESIGN TEAM & INTRINSIC DEVELOPMENT.	
• SITE USAGE - USE OF THE SITE FOR ANY CONSTRUCTION STAGING OR OTHER OPERATIONS SHALL BE COORDINATED WITH THE DESIGN TEAM & INTRINSIC DEVELOPMENT. TAKE CARE NOT TO BLOCK OR ADVERSELY AFFECT ANY PUBLIC OR ADJACENT OWNER AREAS.	
• EXIT ACCESS - MAINTAIN FREE, SAFE, AND APPROVED MEANS OF EGRESS IN AND OUT OF PROJECT LOCATION IN ACCORDANCE WITH REQUIREMENTS OF APPLICABLE REGULATORY AGENCIES.	

INTERIOR FINISHES	(CHAPTER 8)
TABLE 803.13 INTERIOR WALL & CEILING FINISH REQUIREMENTS, SPRINKLERED, GROUP B)	
• EXIT ENCLOSURES & EXIT PASSAGEWAYS:	
• CLASS B - (FLAME SPREAD 76-75, SMOKE DEVELOPED 0-450)	
• CORRIDORS:	
• CLASS C - (FLAME SPREAD 76-200, SMOKE DEVELOPED 0-450)	
• ROOMS & ENCLOSED SPACES:	
• CLASS C - (FLAME SPREAD 76-200, SMOKE DEVELOPED 0-450)	

FIRE PROTECTION SYSTEM	(CHAPTER 9)
• AN AUTOMATIC FIRE SPRINKLER SYSTEM IS NOT REQUIRED, HOWEVER IS PROVIDED FOR THIS BUILDING.	
• A MANUAL FIRE ALARM SYSTEM IS NOT REQUIRED FOR THIS BUILDING (907.2.2)	

THE GENERAL CONTRACTOR SHALL PROVIDE & INSTALL PORTABLE FIRE EXTINGUISHER(S) WITH NO MORE THAN 75 FEET OF TRAVEL DISTANCE TO FIRE EXTINGUISHERS LOCATED AS DIRECTED BY THE FIRE MARSHAL.

A KNOX BOX IS REQUIRED AT 6'-0" ABOVE SIDEWALK IN THE LOCATION AS DIRECTED BY THE FIRE MARSHAL.

MEANS OF EGRESS	(CHAPTER 10)
SEE LIFE SAFETY / EGRESS PLAN ON FOLLOWING SHEET A101 FOR DETAILS & INFORMATION.	

ACCESSIBILITY	(CHAPTER 11)
• ACCESSIBLE ROUTES WITHIN THE SITE SHALL BE PROVIDED FROM PUBLIC TRANSPORTATION STOPS, ACCESSIBLE PARKING, ACCESSIBLE PASSENGER LOADING ZONES, AND PUBLIC STREETS OR SIDEWALKS TO THE ACCESSIBLE BUILDING ENTRANCE SERVED (SECTION 1104.1) AT LEAST 60% OF ALL PUBLIC ENTRANCES SHALL BE MADE ACCESSIBLE.	
• AT LEAST 2 PERCENT, BUT NOT LESS THAN ONE, OF EACH TYPE OF PARKING SPACE PROVIDED SHALL BE AN ACCESSIBLE SPACE.	
• THIS BUILDING SHALL CONFORM TO: THE AMERICAN NATIONAL STANDARD FOR ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES (ICC/ANSI A117.1-2017) AND THE LATEST EDITION OF THE AMERICANS WITH DISABILITIES ACT.	

PLUMBING FIXTURES, FAUCETS, & FIXTURE FITTINGS - (IFC 2018)

MINIMUM NUMBER OF PLUMBING FACILITIES

OCCUPANT LOAD: 49 OCCUPANTS

FIXTURE COUNT TO BE DESIGNED WITH A 50/50 DISTRIBUTION BETWEEN SEXES (35 MEN / 15 WOMEN)

• WATER CLOSETS:	1 WC / 25 FOR 1st 50, THEN 1 WC / 50 REMAINDER EXCEEDING 50 OCCUPANTS
• WATER CLOSETS REQUIRED:	(1) MEN'S / (1) WOMEN'S
• WATER CLOSETS PROVIDED =	(1) MEN'S / (1) WOMEN'S
• LAVATORIES:	1 LAV / 40 FOR 1st 80, THEN 1 LAV / 80 REMAINDER EXCEEDING 80 OCCS
• LAVATORIES REQUIRED:	(1) MEN'S / (1) WOMEN'S
• LAVATORIES PROVIDED =	(1) MEN'S / (1) WOMEN'S
• DRINKING FOUNTAINS:	1 DF / 100 OCCUPANTS
• DRINKING FOUNTAINS REQUIRED:	1 REQUIRED
• DRINKING FOUNTAINS PROVIDED =	1 PROVIDED
• SERVICE SINKS:	
• SERVICE SINKS REQUIRED =	1 REQUIRED
• SERVICE SINK PROVIDED =	3 PROVIDED



THE PROFESSIONAL ARCHITECT'S SEAL APPLIED TO THIS SHEET IS VALID FOR THE STATE OF MISSOURI AND THESE BUILDING ON THIS SHEET. ALL DRAWINGS, INSTRUMENTS OR OTHER DOCUMENTS NOT EXISTING OR CONSIDERED PREPARED BY THIS ARCHITECT, AND THE ARCHITECT EXPRESSLY DISCLAIMS ANY AND ALL LIABILITY FOR SUCH DOCUMENTS, PLAN DRAWINGS OR DOCUMENTS NOT EXISTING THIS SEAL.

PORTER, BERENDZEN & ASSOCIATES, P.C. ARCHITECTS

573.657.2022 PHONE
jag@pba-architecture.com

200 SOUTH HENRY CLAY BLVD.
FALL RIVER, MISSOURI 65010

PROJECT

Discovery Park

Discovery Pet Spa

1921 NE Trails Edge Boulevard

Lee's Summit, Jackson County, Missouri

ISSUE

ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024
2	REVISION #1	10/14/2024

PROJECT NO.
FB24218

SHEET TITLE

COVER SHEET

SHEET NUMBER

CVR

Discovery Pet Spa

Lee's Summit, Jackson County, Missouri

GENERAL NOTES

ELEVATION DATUM
SEE ARCHITECTURAL DRAWINGS OR SITE PLAN FOR FINISH FLOOR ELEVATIONS

DESIGN SPECIFICATIONS
2018 INTERNATIONAL BUILDING CODE

EARTHWORK
EARTHWORK OPERATIONS SHALL BE PERFORMED UNDER THE DIRECTION OF A PROFESSIONAL TESTING AGENCY TO ASSURE COMPLIANCE WITH THE RECOMMENDATIONS OF THE SOILS REPORT BY OWN INC. DATED APRIL 15, 2024.

CONCRETE

CONCRETE WORK SHALL CONFORM TO ALL REQUIREMENTS OF THE CURRENT ACI 301, SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS, ACI 318 BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE, ACI 305 SPECIFICATIONS FOR HOT WATER CONCRETE, AND ACI 306 SPECIFICATIONS FOR COLD WEATHER CONCRETE, WITH THE FOLLOWING ADDITIONAL REQUIREMENTS:

- CONCRETE SHALL DEVELOP THE FOLLOWING 28-DAY MINIMUM COMPRESSIVE STRENGTH:

FOUNDATIONS	—	3,000 PSI
CAST-IN-PLACE WALLS	—	3,500 PSI
FLOOR SLAB	—	4,000 PSI
EXTERIOR SLABS, WALLS AND CURBS	—	4,000 PSI
- ALL FOOTINGS SHALL BEAR ON UNDISTURBED SOIL OR ENGINEERED FILL.
- CHLORIDE- BASED ADMIXTURES ARE PROHIBITED IN ALL REINFORCED CONCRETE.
- REINFORCING STEEL SHALL CONFORM TO ASTM A615, A616, OR A617, GRADE 60.
- ALL CONTINUOUS REINFORCING STEEL THAT MEETS AT A CORNER SHALL BE TIED TOGETHER WITH A CORNER BAR THAT HAS SUFFICIENT LAP DISTANCE IN EACH DIRECTION
- CONTINUOUS REINFORCING BARS LAP LENGTH SHALL BE A MINIMUM OF 48 BAR DIAMETERS UNLESS NOTED OTHERWISE
- CONCRETE SLUMP SHALL BE A MAXIMUM OF 4" +/- 1" (ASTM C- 143) AS DELIVERED IN THE FIELD. CONTRACTOR MAY USE CHEMICAL ADMIXTURES TO ATTAIN A MAXIMUM SLUMP OF 8" FOR WORKABILITY. NO WATER MAY BE ADDED TO THE CONCRETE MIX ON SITE UNLESS WATER IS WITHHELD AT THE BATCHING FACILITY. IF WATER IS WITHHELD AT THE BATCHING FACILITY IT SHOULD BE REFLECTED ON THE LOAD TICKET. THE TOTAL AMOUNT OF WATER IN THE MIX SHALL NOT EXCEED WHAT IS NOTED ON THE APPROVED MIXED. THIS SHALL BE NOTED IN THE SPECIAL INSPECTOR'S RECORDS.
- CONCRETE EXPOSED TO WEATHER, VEHICLES, AND/OR DEICING CHEMICALS SHALL BE AIR-ENTRAINED WITH 6% (+/-) 1.5% ENTRAINED AIR BY VOLUME AT POINT OF DISCHARGE. DO NOT ALLOW AIR CONTENT OF TROWELED FINISHED FLOORS TO EXCEED 3%.
- SUBMIT CONCRETE MIX PROPORTIONS PRIOR TO START OF WORK. DO NOT BEGIN CONCRETE PRODUCTION UNTIL MIXES HAVE BEEN REVIEWED AND ARE ACCEPTABLE TO THE ENGINEER.
- READY MIX CONCRETE SHALL COMPLY WITH REQUIREMENTS OF ASTM C94.
- CONCRETE WORK EXECUTION
 - CONSTRUCT FORMS TO CORRECT SIZE, SHAPE, ALIGNMENT, ELEVATION AND POSITION; AND TO SUPPORT VERTICAL AND LATERAL LOADS.
 - POSITION, SUPPORT, AND SECURE REINFORCEMENT AGAINST DISPLACEMENT. MINIMUM CONCRETE COVER FOR REINFORCEMENT SHALL BE, UNLESS NOTED OTHERWISE ON THE DRAWINGS:

CAST AGAINST AND EXPOSED TO EARTH.....	3 INCHES
EXPOSED TO EARTH OR WEATHER.....	2 INCHES
NOT EXPOSED TO WEATHER OR IN CONTACT WITH EARTH.....	1 ½ INCHES
 - PROVIDE CONTROL JOINTS IN SLABS-ON-GRADE AT NOT GREATER THAN 15 FEET ON CENTER IN EACH DIRECTION. SAW CUT CONTROL JOINTS MINIMUM ¼ OF SLAB DEPTH, AS SOON AFTER SLAB FINISHING WITHOUT DISLOGGING AGGREGATE.
 - STEEL TROWEL FINISH ALL INTERIOR CONCRETE SLABS, BROOM FINISH ALL EXTERIOR CONCRETE SLABS.
 - CURE ALL CONCRETE IN COMPLIANCE WITH ACI 301, USING A LIQUID TYPE MEMBRANE, NON-RESIDUAL, CURING COMPOUND COMPLYING WITH ASTM C309. ASSURE COMPATIBILITY WITH FINISH FLOOR COVERING.

STRUCTURAL STEEL

- FABRICATION AND ERECTION OF STRUCTURAL STEEL SHALL BE IN ACCORDANCE WITH THE CURRENT EDITION OF THE AISC SPECIFICATIONS FOR STRUCTURAL STEEL BUILDINGS, THE AISC CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES AND CURRENT OSHA STANDARDS.
- WIDE FLANGE SHAPES SHALL CONFORM TO ASTM A992. STRUCTURAL TUBES SHALL CONFORM TO ASTM A500 GRADE B. ALL OTHER STRUCTURAL STEEL SHALL CONFORM TO ASTM A36.
- BOLTS, UNLESS OTHERWISE SHOWN, SHALL CONFORM TO ASTM A325-N, SIZE AS PER PLAN.
- ANCHOR BOLTS, UNLESS OTHERWISE SHOWN, SHALL CONFORM TO ASTM F1554 GRADE 36.
- SPLICING OF STRUCTURAL STEEL IS PROHIBITED EXCEPT AS DETAILED.
- ALL STRUCTURAL AND MISCELLANEOUS STEEL ITEMS SHALL RECEIVE ONE COAT OF "IRONCLAD RETARDO RUST INHIBITIVE PAINT 163" (BENJAMIN MOORE) OR APPROVED EQUAL UNLESS OTHERWISE INDICATED IN THE SPECIFICATIONS. ALL STEEL SURFACES EMBEDDED IN CONCRETE SHALL NOT BE PAINTED. PREPARATION OF STEEL SURFACES SHALL MEET THE REQUIREMENTS OF THE STEEL STRUCTURES PAINTING COUNCIL (SSPC-SP1) AND THE REMOVAL OF GREASE AND OIL BY SOLVENT CLEANING (SSPC-SP1) AND THE REMOVAL OF MILL SCALE, RUST, WELD FLUX AND SLAG BY HAND TOOL CLEANING (SSPC-SP2). PRIMER SHALL BE APPLIED AT THE MANUFACTURER'S RECOMMENDED RATE BUT NOT LESS THAN ONE GALLON PER 400 SQ.FT. THEREBY DEPOSITING A DRY FILM THICKNESS OF NOT LESS THAN 1.5 MILS. ANY SCARRED AREAS SHALL BE TOUCHED UP WITH THE SAME PAINT AFTER ERECTION.
- ALL WELDING SHALL BE DONE BY QUALIFIED WELDERS IN ACCORDANCE WITH THE CURRENT EDITION OF THE AWS STRUCTURAL WELDING CODE. WELDING ELECTRODES SHALL BE E70XX.

POST-INSTALLED ANCHORS

- ALL POST-INSTALLED ANCHORS SHALL MEET THE REQUIREMENTS OF THE CODE-CITED EDITION OF ACI 318, APPENDIX "D", AND SHALL BE ACCEPTABLE FOR BOTH CRACKED AND UNCRACKED CONCRETE.
- EXPANSION ANCHORS HAVE BEEN DESIGNED AS HILTI KWIK BOLT TZ ANCHORS, UNLESS NOTED OTHERWISE.
- ADHESIVE ANCHORS HAVE BEEN DESIGNED TO USE HILTI HIT HY 200 ADHESIVE IN CONCRETE OR SOLID MASONRY, UNLESS NOTED OTHERWISE.
- EQUIVALENT ANCHORS MAY BE SUBMITTED FOR THE ENGINEER'S APPROVAL. SUBMITTALS ARE THE CONTRACTOR'S RESPONSIBILITY AND MUST INCLUDE EVALUATION REPORTS FROM THE INTERNATIONAL CONFERENCE OF BUILDING OFFICIALS (ICBO).
- EMBEDMENT DEPTH IS DEFINED AS THE DISTANCE FROM THE SURFACE OF THE LOAD-BEARING BASE MATERIAL TO THE DEEPEST PART OF THE ANCHOR AFTER THE ANCHOR HAS BEEN DRIVEN INTO THE HOLE BUT NOT YET EXPANDED.
- ADHESIVE ANCHORS SHALL BE ACCEPTABLE FOR LONG-TERM LOADING. WHEN BASE MATERIAL TEMPERATURES ARE BELOW 40 DEG F, ONLY NON-EPOXY-BASED ADHESIVES SHALL BE USED.
- POST-INSTALLED ANCHORS SHALL ONLY BE USED WHERE SPECIFIED ON THE DRAWINGS. THE CONTRACTOR SHALL OBTAIN APPROVAL FROM THE ENGINEER PRIOR TO USING POST-INSTALLED ANCHORS FOR MISSING OR MISPLACED CAST-IN-PLANE ANCHORS. CARE SHALL BE TAKEN TO AVOID CONFLICTS WITH EXISTING REINFORCING BARS. HOLES SHALL BE DRILLED AND CLEANED PER ANCHOR MANUFACTURER'S SPECIFICATIONS.
- STAINLESS STEEL ANCHORS ARE REQUIRED AT ALL PERMANENTLY EXPOSED WEATHER CONDITIONS.

TIMBER

TIMBER WORK SHALL CONFORM TO ALL REQUIREMENTS OF THE CURRENT ANSI/AWC NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION WITH 2018 NDS SUPPLEMENT FOR WOOD CONSTRUCTION, WITH THE FOLLOWING SUPPLEMENTAL REQUIREMENTS:

- FOR COMMON MEMBER SIZES, THE SPECIES AND GRADES SHALL BE AS FOLLOWS, UNLESS NOTED OTHERWISE:

A.	2X4	SPF No.1/No.2
B.	2X6	SPF No.1/No.2
C.	2X8	DF-L No.2
D.	2X10	DF-L S.S.
E.	2X12	DF-L S.S.

EQUIVALENT (OR BETTER) GRADES & SPECIES MAY BE SUBMITTED FOR THE ENGINEER'S APPROVAL.

- SIZES SHOWN FOR LUMBER ARE NOMINAL SIZES.
- TIMBER EXPOSED TO WEATHER OR GROUND, OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE-IMPREGNATED BY AN APPROVED PROCESS AND PRESERVATIVE.
- SPLICING OF JOISTS, STUDS, OR HEADERS IS PROHIBITED EXCEPT AS SHOWN.
- BOLTS SHALL CONFORM TO ASTM A307. HOLES SHALL BE DRILLED PER SECTION 12.1.3 OF THE 2018 ANSI/AWC NDS FOR WOOD CONSTRUCTION NDS SUPPLEMENT.
- LAG SCREWS AND WOOD SCREWS SHALL BE INSTALLED PER SECTIONS 12.1.4 & 12.1.5 RESPECTIVELY, OF THE 2018 ANSI/AWC NDS FOR WOOD CONSTRUCTION WITH 2018 NDS SUPPLEMENT.
- COMMON NAILS SHALL BE USED, UNLESS NOTED OTHERWISE. IN ADDITION, NAILS SHALL BE GALVANIZED, IF EXPOSED TO WEATHER OR MOISTURE. TOE-NAILS SHALL BE DRIVEN PER SECTION 12.1.6.3 OF THE 2018 ANSI/AWC NDS FOR WOOD CONSTRUCTION WITH 2018 NDS SUPPLEMENT.
- FASTENING SHALL BE PER THE IBC MINIMUM FASTENING SCHEDULE, TABLE 2304.10.1, UNLESS NOTED OTHERWISE.
- CONNECTIONS/CONNECTORS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS.

BRICK LINTEL

- ALL STEEL LINTELS TO BE A36 STEEL, A992 GRADE 50, OR A500 GRADE B. ALL LINTELS TO BE HOT DIPPED GALVANIZED.

PREFABRICATED WOOD TRUSSES

- FLOOR & ROOF TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH THE TRUSS PLATE INSTITUTE (TPI) DESIGN SPECIFICATION FOR METAL PLATE CONNECTED WOOD TRUSSES, AND THE ANSI/NF&PA NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION.
- PROVIDE TEMPORARY AND PERMANENT BRACING ON ALL TRUSSES, AS REQUIRED TO PROVIDE MEMBER AND TRUSS STABILITY.
- FLOOR & ROOF TRUSSES SHALL BE DESIGNED AND CONSTRUCTED FOR A MAXIMUM TOTAL LOAD DEFLECTION OF L/360 AND TO SAFELY SUPPORT THE FOLLOWING LOADS:
 - DEAD, LIVE, SNOW, WIND, EARTHQUAKE: SEE PROJECT DESIGN DATA ON COVER SHEET.
 - MECHANICAL PIPE LOAD: TRUSSES SHALL BE DESIGNED FOR A CONCENTRATED LOAD OF 250 LBS HUNG ANYWHERE ALONG THE BOTTOM CHORD.
 - OVER-FRAMING LOAD: TRUSSES SHALL ALSO BE DESIGNED TO SUPPORT ADDITIONAL OVERBUILD FRAMING, SUCH AS THAT WHICH FORMS VALLEYS AND HIPS ON ROOFS.
 - DRIFTED SNOW LOAD: TRUSSES SHALL BE DESIGNED TO SUPPORT DRIFTED SNOW LOADS IN ACCORDANCE WITH THE APPROPRIATE BUILDING CODE.
 - IN-PLANE LATERAL LOADS: TRUSSES SHALL BE DESIGNED TO SUPPORT ANY LATERAL LOADS CARRIED ANIALLY IN THE PLANE OF THE TRUSS, AS SHOWN ON THE PLANS.
- CABLED END TRUSSES SHALL HAVE VERTICAL MEMBERS SPACED AT 16" O.C. MAXIMUM.
- SUBMITTALS SHALL INCLUDE THE FOLLOWING:
 - SHOP DRAWINGS PREPARED UNDER THE SUPERVISION OF, AND SIGNED AND SEALED BY, A PROFESSIONAL ENGINEER REGISTERED IN THE STATE WHERE THE PROJECT IS BUILT. THESE DRAWINGS SHALL INDICATE SPECIES, GRADE, AND SIZES OF LUMBER TO BE USED; PITCH, SPAN, CAMBER, CONFIGURATION, AND SPACING FOR EACH TYPE OF TRUSS REQUIRED; TYPE, SIZE, MATERIAL, FINISH, AND LOCATION OF METAL CONNECTOR PLATES; AND BEARING DETAILS. SHOW TRUSS LAYOUT AND ALL REQUIRED TEMPORARY AND PERMANENT BRACING AFFECTING THE STRUCTURAL CAPACITY OF THE TRUSSES.

PROVIDE COMPLETE ENGINEERING DESIGN CALCULATIONS THAT INCLUDE DESIGN VALUES, DESIGN ANALYSIS INDICATING LOADING, ASSUMED ALLOWABLE STRESSES, STRESS DIAGRAM, AND CALCULATIONS, AND ANY OTHER INFORMATION NEEDED FOR REVIEW. THE CALCULATIONS SHALL HAVE BEEN SIGNED AND SEALED BY A QUALIFIED PROFESSIONAL ENGINEER WHO IS REGISTERED IN THE STATE WHERE THE PROJECT IS BUILT AND WHO IS RESPONSIBLE FOR PREPARATION OF THE CALCULATIONS.

SPECIAL INSPECTIONS

THE FOLLOWING ITEMS REQUIRE SPECIAL INSPECTION IN ACCORDANCE WITH CHAPTER 17 OF THE INTERNATIONAL BUILDING CODE.

- CONCRETE GROUT DESIGN MIX (PERIODIC)
- PLACING OF CONCRETE AND REINFORCING STEEL (CONTINUOUS OF CONCRETE SAMPLING / PERIODIC OF REINFORCING)
- BOLTS & ANCHORS EMBEDDED IN CONCRETE (PERIODIC)
- STRUCTURAL STEEL FABRICATIONS (UNLESS AISC APPROVED) (PERIODIC)
- STRUCTURAL STEEL BOLTING & WELDING (PERIODIC)
- POST INSTALLED ANCHORS IN CONCRETE (CONTINUOUS)
- IN-SITU SOILS, EXCAVATIONS, FILLING & COMPACTION (PERIODIC)
- WOOD FRAMING:
 - SHEAR WALLS; WALL SIZE, CONFIGURATION, BLOCKING, PANEL GRADE, PANEL THICKNESS, AND FASTENING. (PERIODIC)
 - DIAPHRAGMS (FLOOR AND ROOF SHEATHING); SIZE, CONFIGURATION, BLOCKING, PANEL GRADE, PANEL THICKNESS, AND FASTENING. (PERIODIC)
 - FRAMING MEMBERS AND DETAILS (PERIODIC)
 - MATERIAL GRADE (PERIODIC)
 - CONNECTIONS; HANGERS, HOLD DOWNS, BUILT-UP COLUMNS, BUILT-UP BEAMS (PERIODIC)
 - PRE-ENGINEERED TRUSSES; FRAMING, CONNECTIONS, BRIDGING (PERIODIC)

THE CONTRACTOR SHALL REQUEST SPECIAL INSPECTION OF THE ITEMS LISTED ABOVE PRIOR TO THOSE ITEMS BECOMING INACCESSIBLE AND UNOBSERVABLE DUE TO PROGRESSION OF THE WORK.

DESIGN DATA

2018 INTERNATIONAL BUILDING CODE / ASCE 7-16

BUILDING OCCUPANCY CATEGORY	II
ROOF LOAD DATA	
LIVE LOAD	20
ASPHALT SHINGLES + FELT	4.0
5/8" OSB ROOF SHEATHING	3.0
PRE-ENGINEERED WOOD TRUSSES @ 2'-0" O.C.	4.0
INSULATION (BLOWN)	10
MECHANICAL ALLOWANCE	6.0
5/8" GYP. CEILING	20
FUTURE SOLAR	5.0
TOTAL TO TRUSSES	45 lbs/sqft

RAIN LOAD DATA	
15 MINUTE RAIN INTENSITY	7.49 in/hr
60 MINUTE RAIN INTENSITY	3.52 in/hr

ROOF SNOW LOAD DATA* (*UNBALANCED & DRIFTING SNOW TO BE DETERMINED IN ADDITION TO UNIFORM LOAD, WHERE APPLICABLE)

P_s =	20 lbs/sqft
C_s =	10
I_s =	10
C_t =	10
P_f =	1400 lbs/sqft

WIND DESIGN DATA	
V_{50} =	109 MPH (3-SECOND GUST)
RISK CATEGORY	II
EXPOSURE	C
INTERNAL PRESSURE COEFFICIENT =	± 0.18
MAXIMUM COMPONENTS & CLADDING WIND	±/-3232 lbs/sqft

EARTHQUAKE DESIGN DATA	
RISK CATEGORY	II
I_e =	10
S_s =	0.1
S_1 =	0.068
SITE CLASS	D
S_{as} =	0.107
S_{d1} =	0.109
SEISMIC DESIGN CATEGORY	B
BASIC SEISMIC-FORCE-RESISTING SYSTEM =	
LIGHT-FRAME (WOOD) WALLS SHEATHED WITH WOOD STRUCTURAL PANELS RATED FOR SHEAR RESISTANCE	
R =	6.5
Ω_s =	3.0
C_d =	4.0

DESIGN BASE SHEAR	$V = 0.016 W$
EQUIVALENT LATERAL FORCE PROCEDURE	

NET ALLOWABLE SOIL BEARING 2,500 lbs/sqft**
(*PER GEOTECHNICAL REPORT BY OWN INC. DATED APRIL 15, 2024)

INDEX OF SHEETS

COVER / GENERAL STRUCTURAL DATA	S100
FOUNDATION PLAN	S200
FOUNDATION DETAILS	S210-S211
ROOF FRAMING PLAN	S300
SHEAR WALL PLAN	S300A
ROOF FRAMING DETAILS	S310

REVISIONS:

No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY.



STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Suite 1
Columbia, Missouri 65203
(573) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#200318101

CLIENT:
INTRINSIC DEVELOPMENT
3622 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA
1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:

GENERAL
STRUCTURAL DATA

DESIGNED: JWV

DRAWN: ELT

PROJECT NO.: 230286

SHEET:
S100

NOTE:
ALL DIMENSIONS ARE FROM FACE OF FOUNDATION WALL OR FRAMING;
EDGE OF SLAB OR TRUSS/RAFTER; OR CENTERLINE
OF COLUMN, BEAM, OR JOIST UNLESS NOTED OTHERWISE.

FOUNDATION NOTES

- ① REENTRANT CORNER BARS, REFER TO TYPICAL CRACK
CONTROL REINFORCING DETAIL ON SHEET S210.
- ② FLOOR DRAIN REFER TO MEP FOR
ADDITIONAL INFORMATION.

REVISIONS:

No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY



STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Suite 1
Columbia, Missouri 65203
(573) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000181001

CLIENT:
**INTRINSIC
DEVELOPMENT**
3822 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA
1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:


FOUNDATION
PLAN

DESIGNED: JWV


DRAWN: ELT

PROJECT NO.: 230286

SHEET:
S200

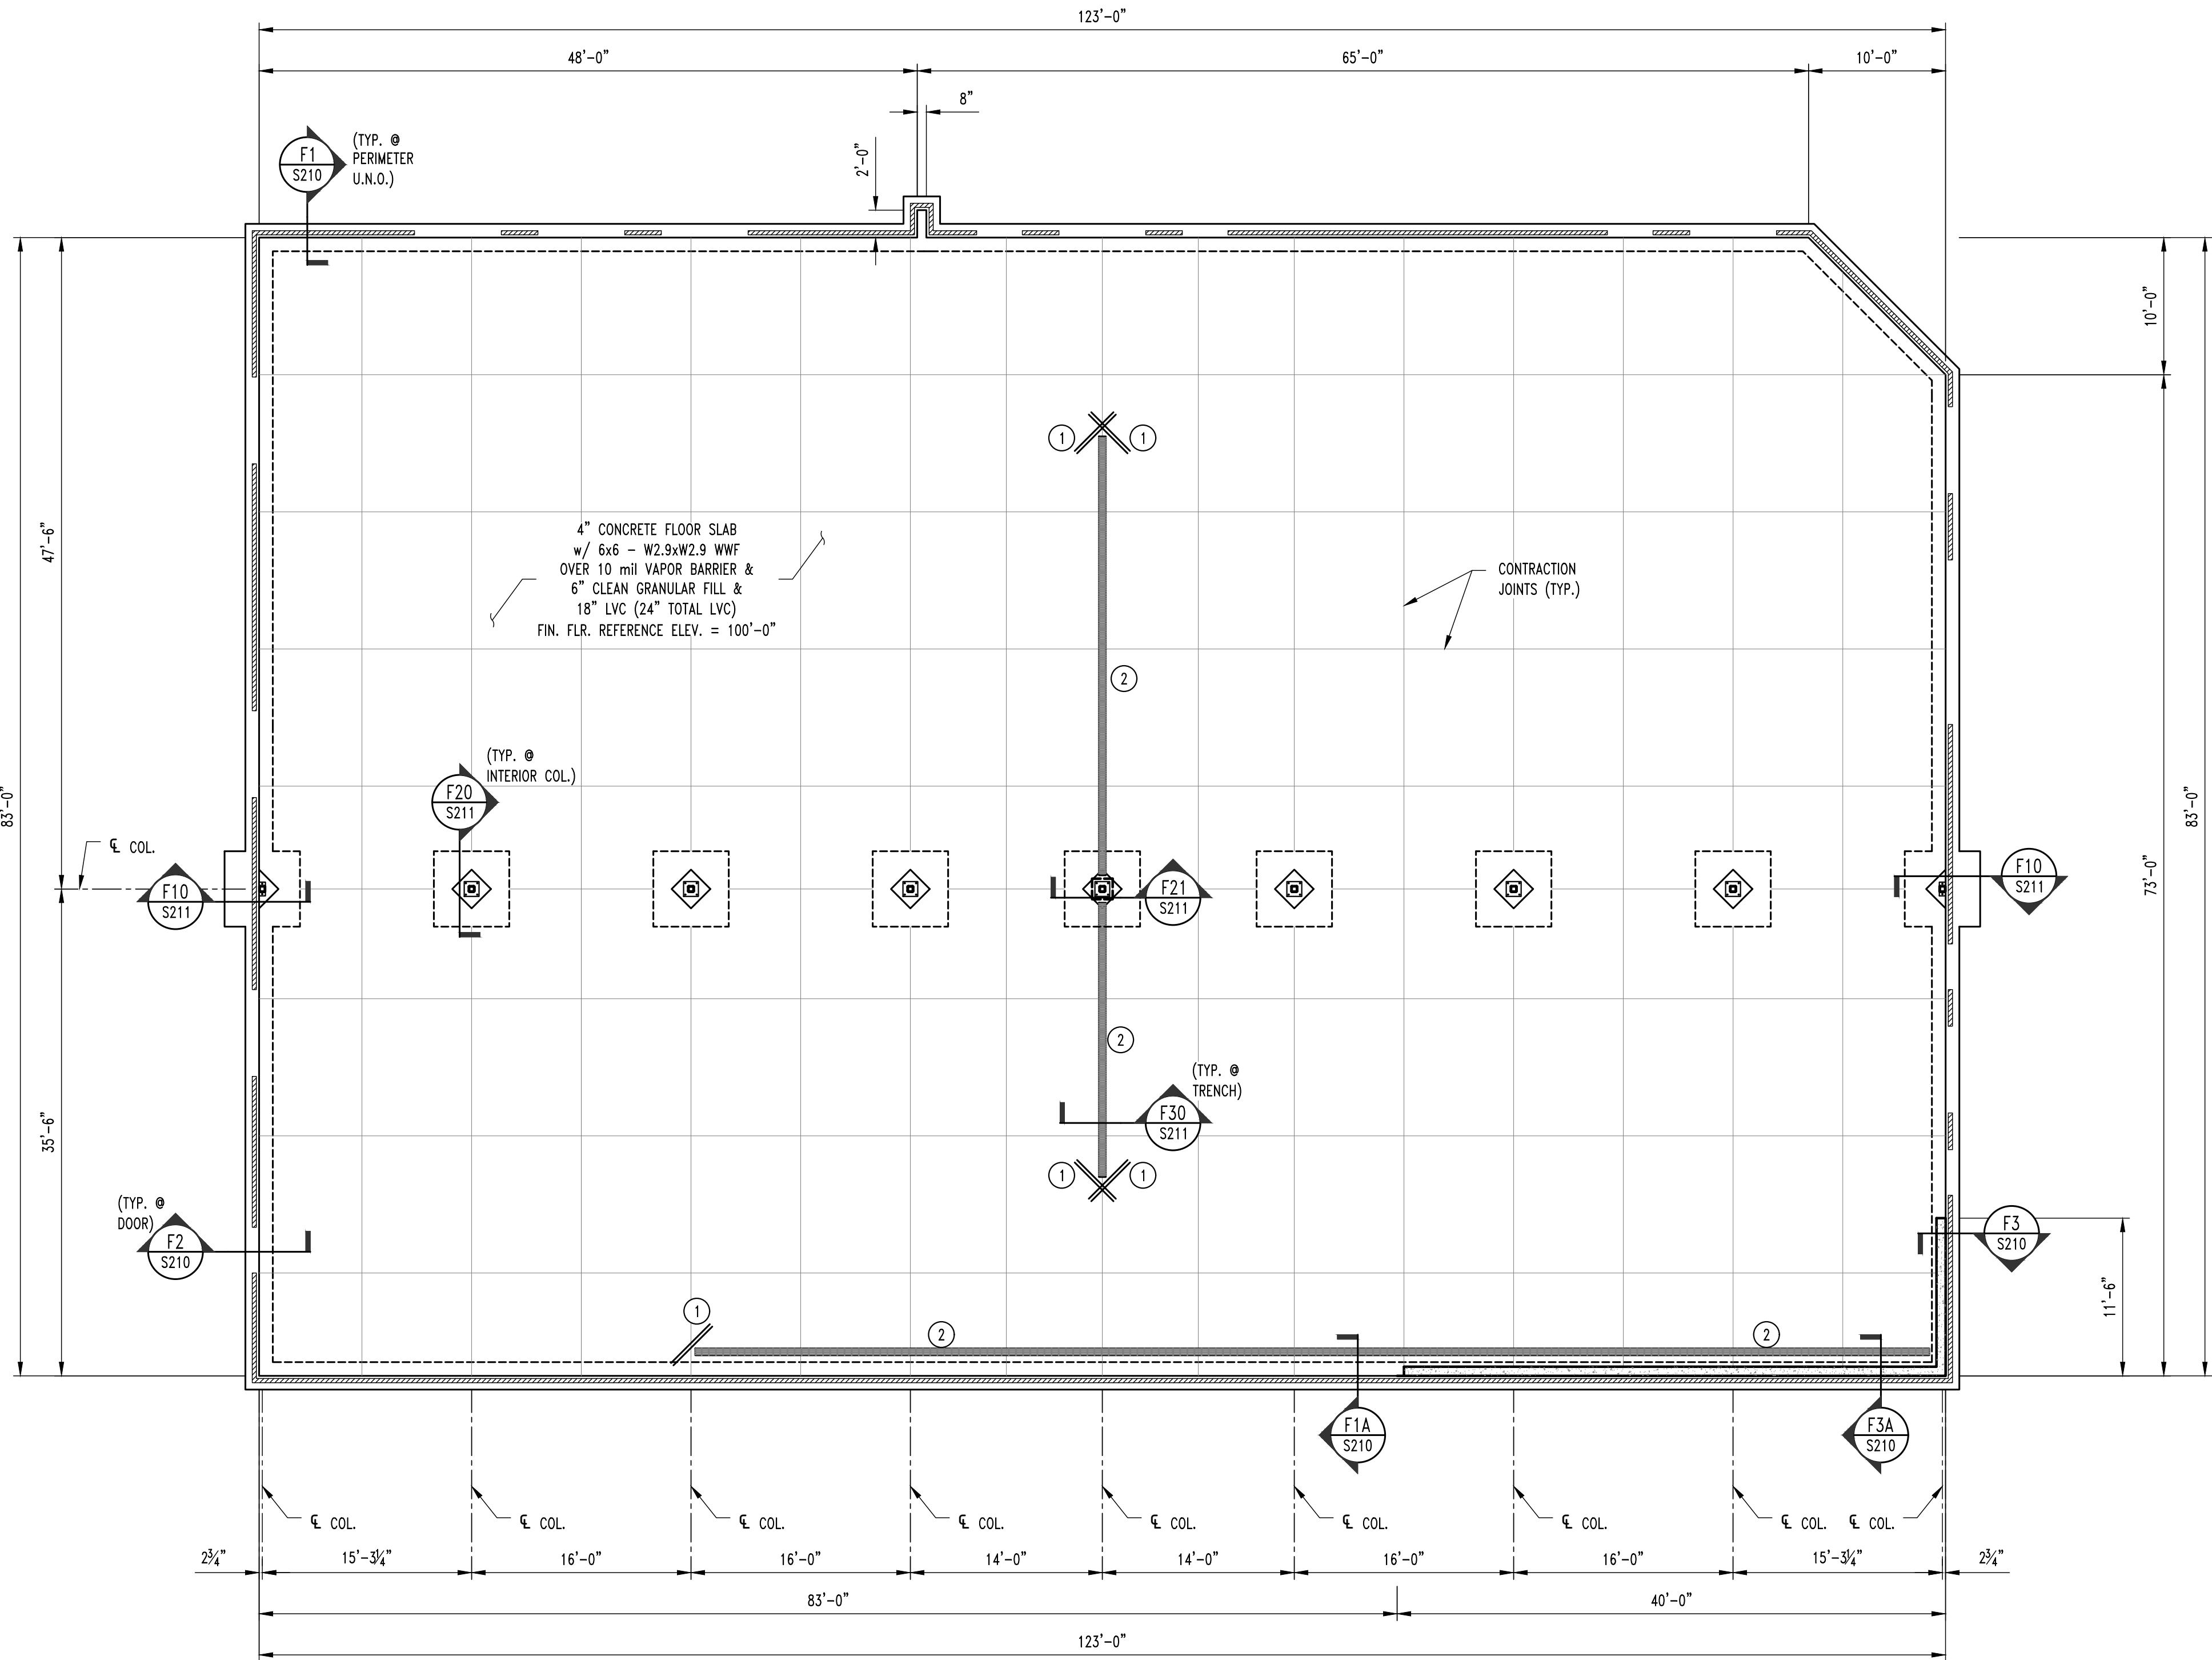


FOUNDATION PLAN
SCALE: 1/8" = 1'-0"
PLAN NORTH

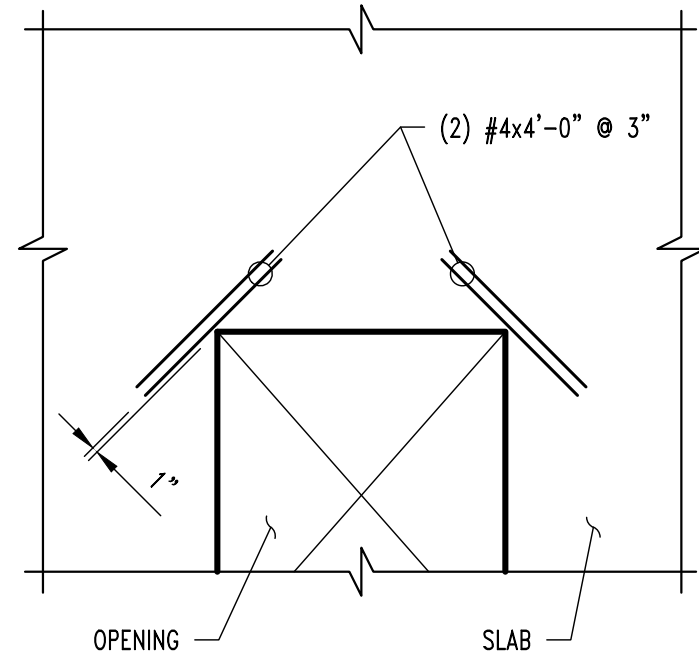


NOTE:
TYPICAL AT ALL REENTRANT CORNERS FOR
SLAB-ON-GRADE & STRUCTURAL SLAB.
REINFORCING TO BE CENTERED IN SLAB THICKNESS.


CRACK CONTROL REINFORCING

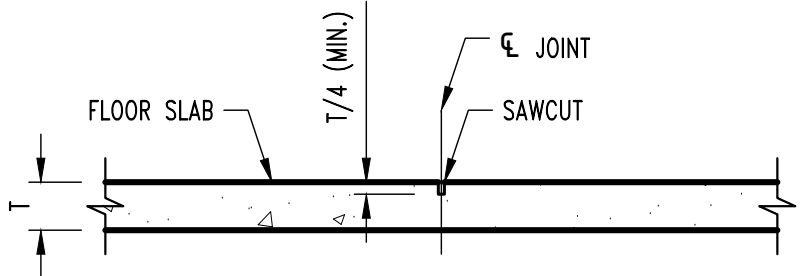


CONTRACTION JOINT

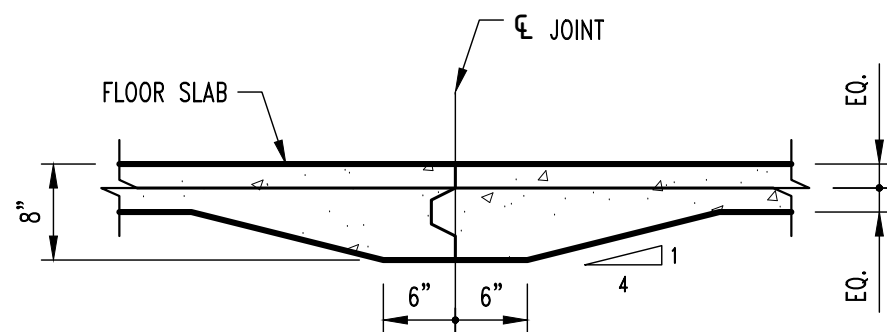


CONSTRUCTION JOINT

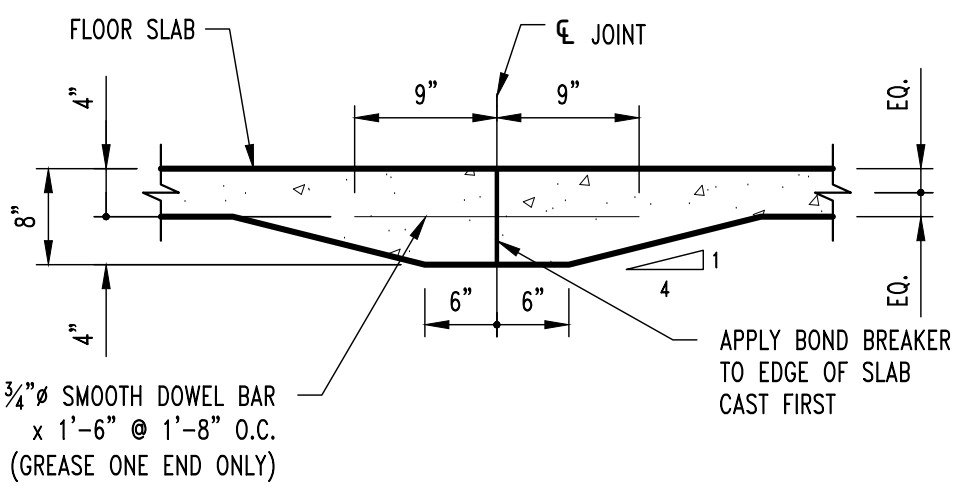


CONSTRUCTION JOINT

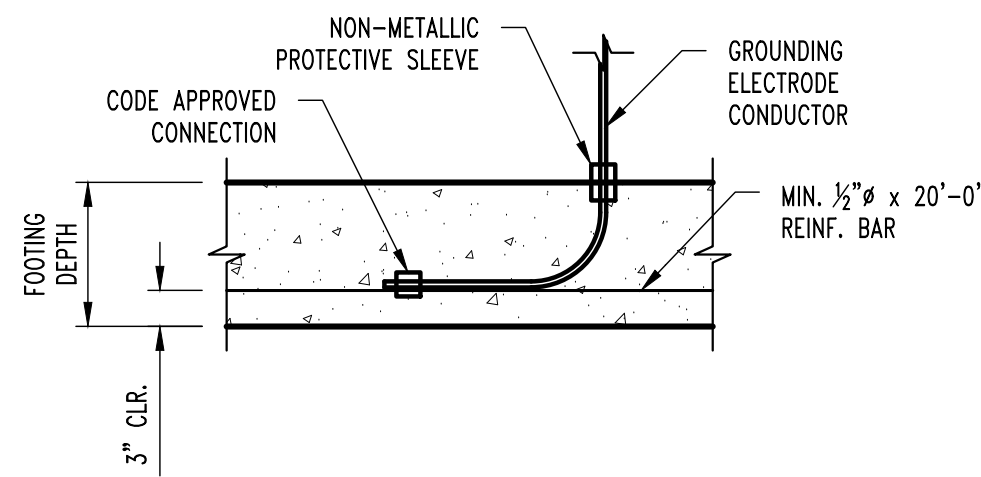


TYP. ELECTRICAL GROUNDING DETAIL @ FOOTING

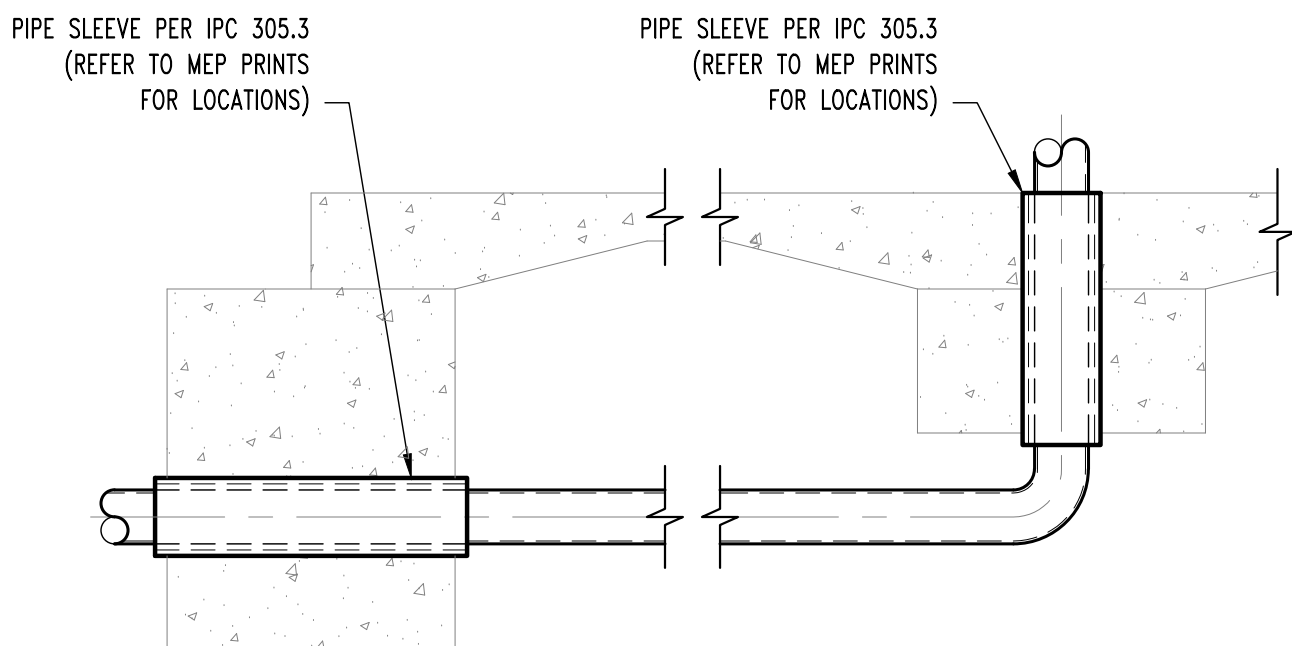


TYP. PLUMBING COORDINATION DETAILS

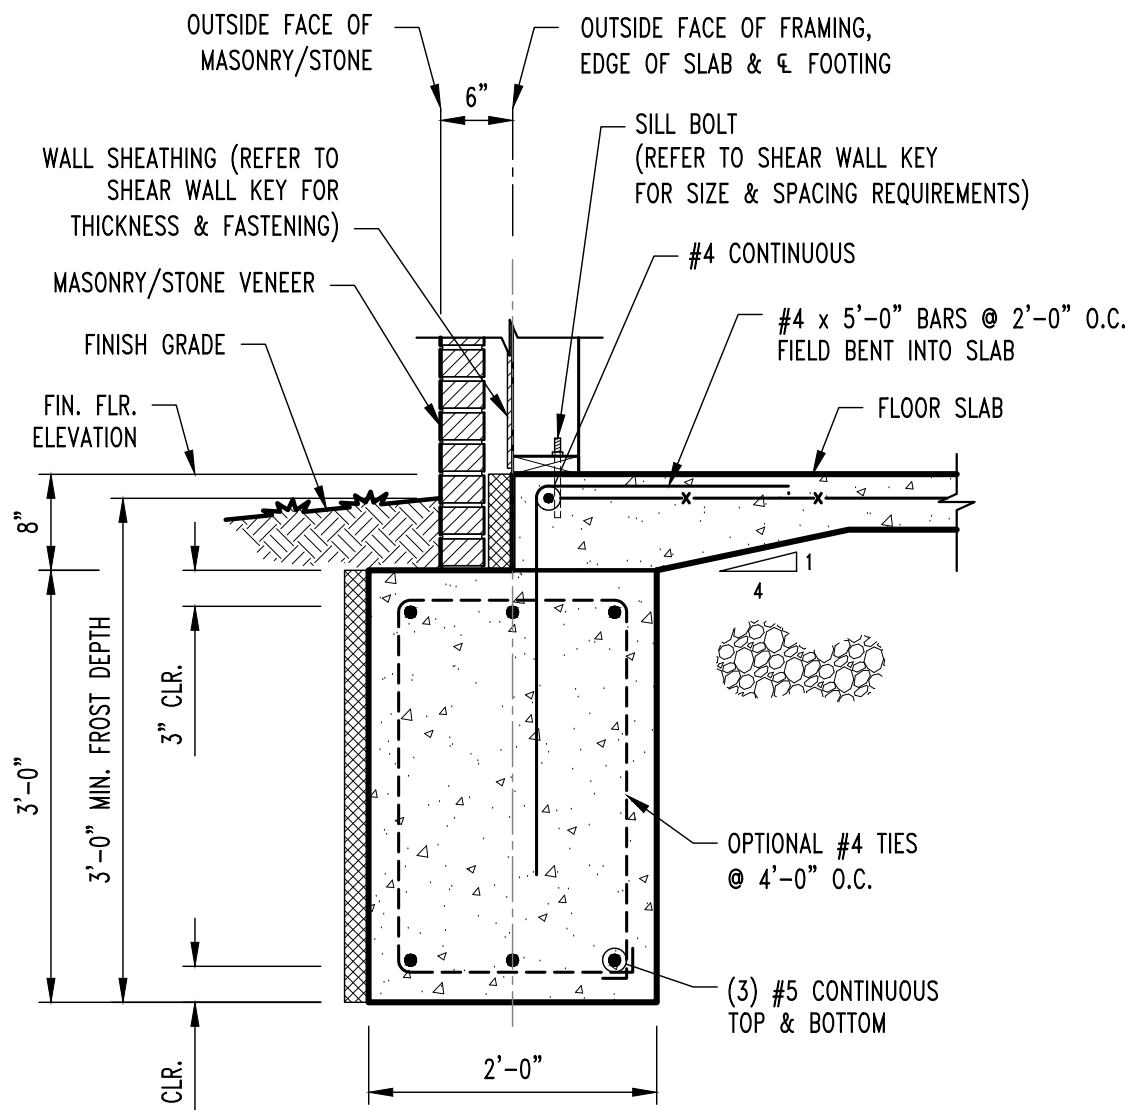


F1
S200
CONT. FOOTING SECTION
SCALE: 3/4" = 1'-0"

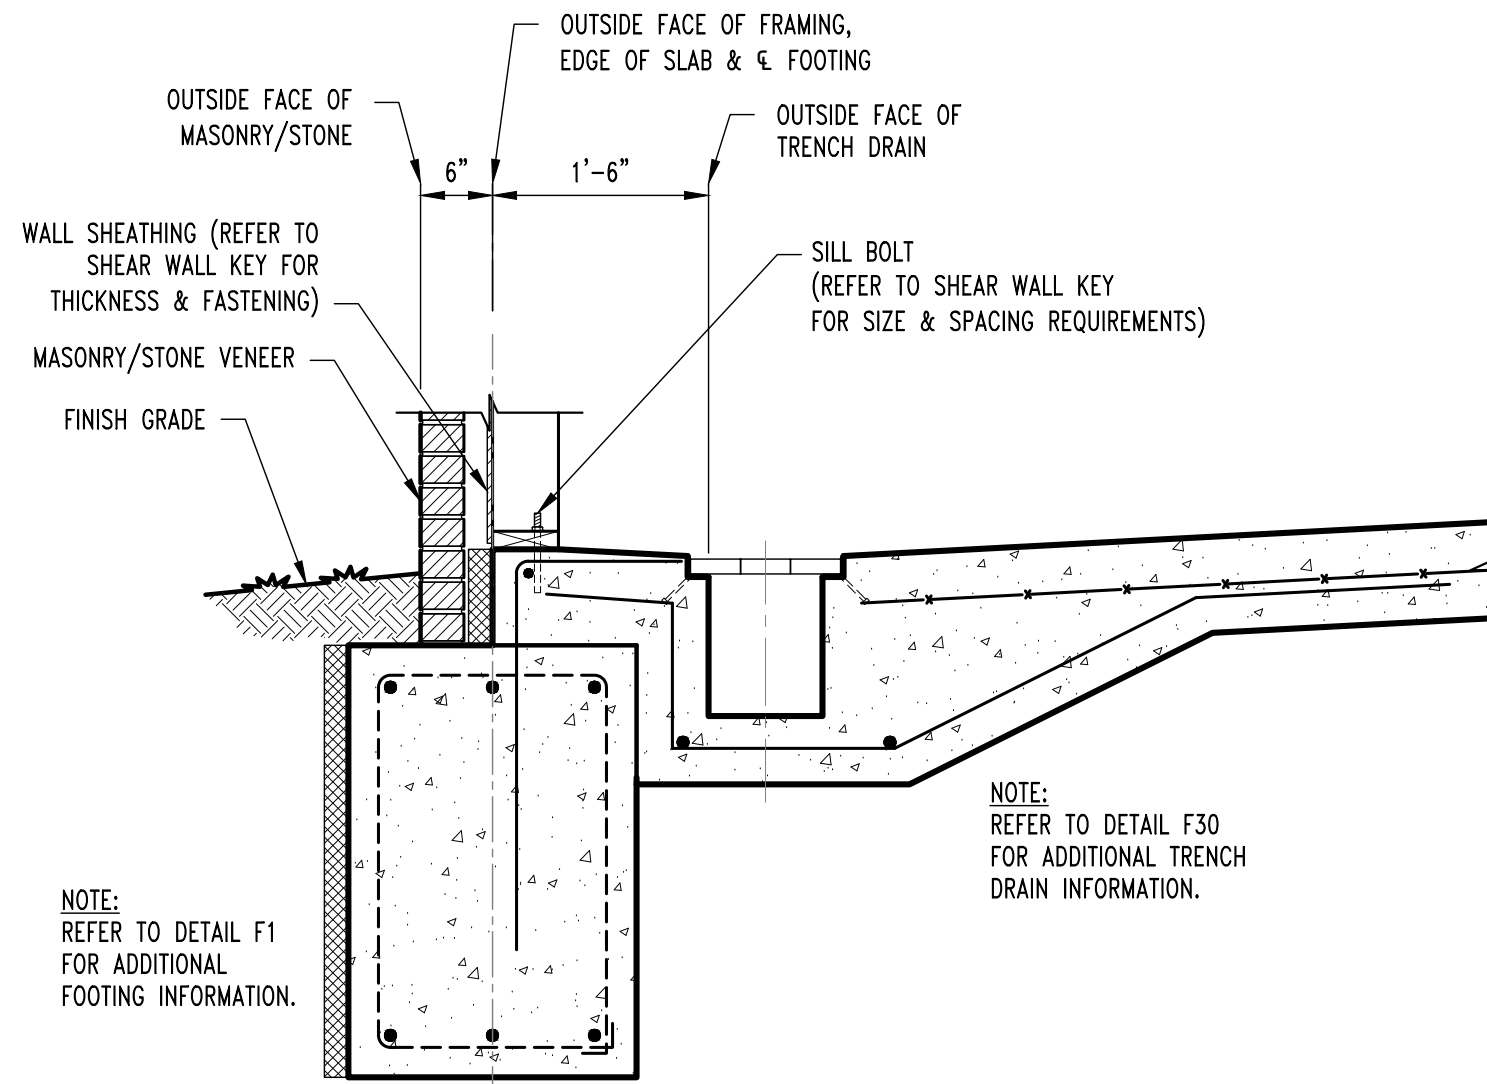


F1A
S200
CONT. FOOTING SECTION
SCALE: 3/4" = 1'-0"

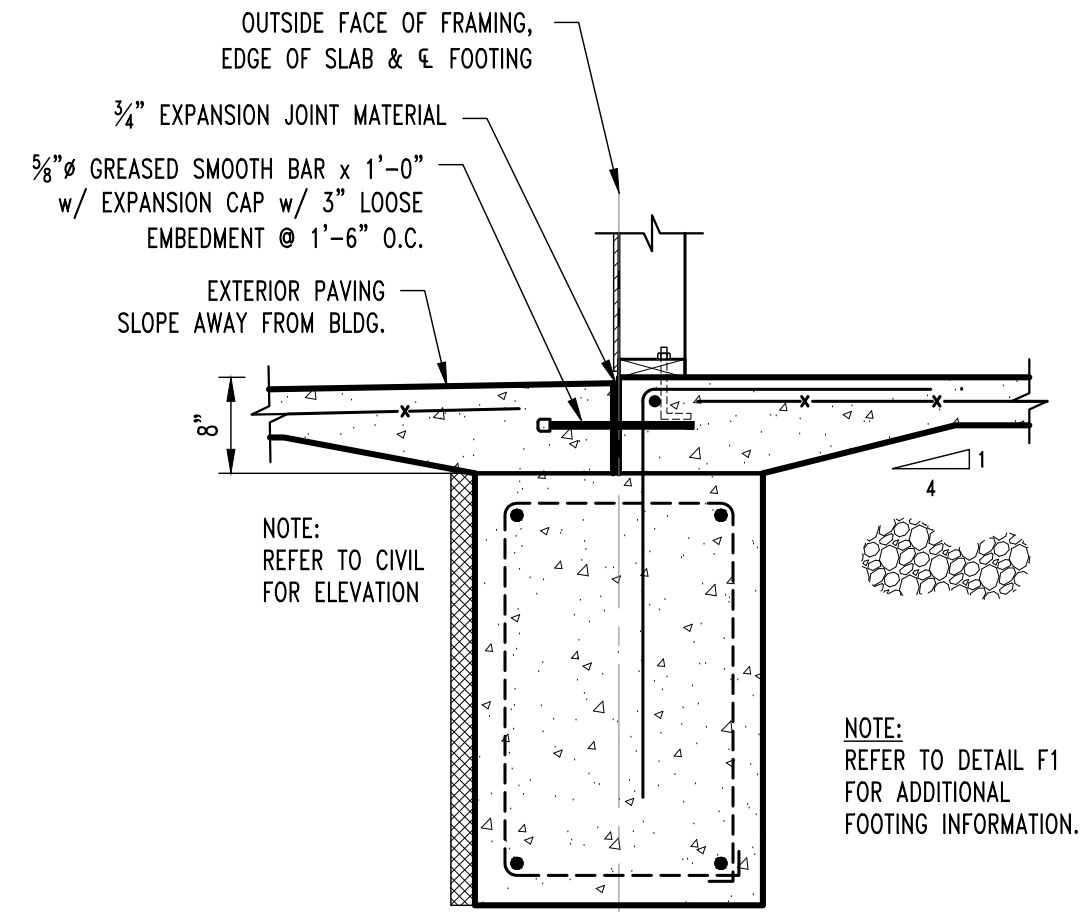

F2
S200
CONT. FOOTING SECTION @ DOOR
SCALE: 3/4" = 1'-0"

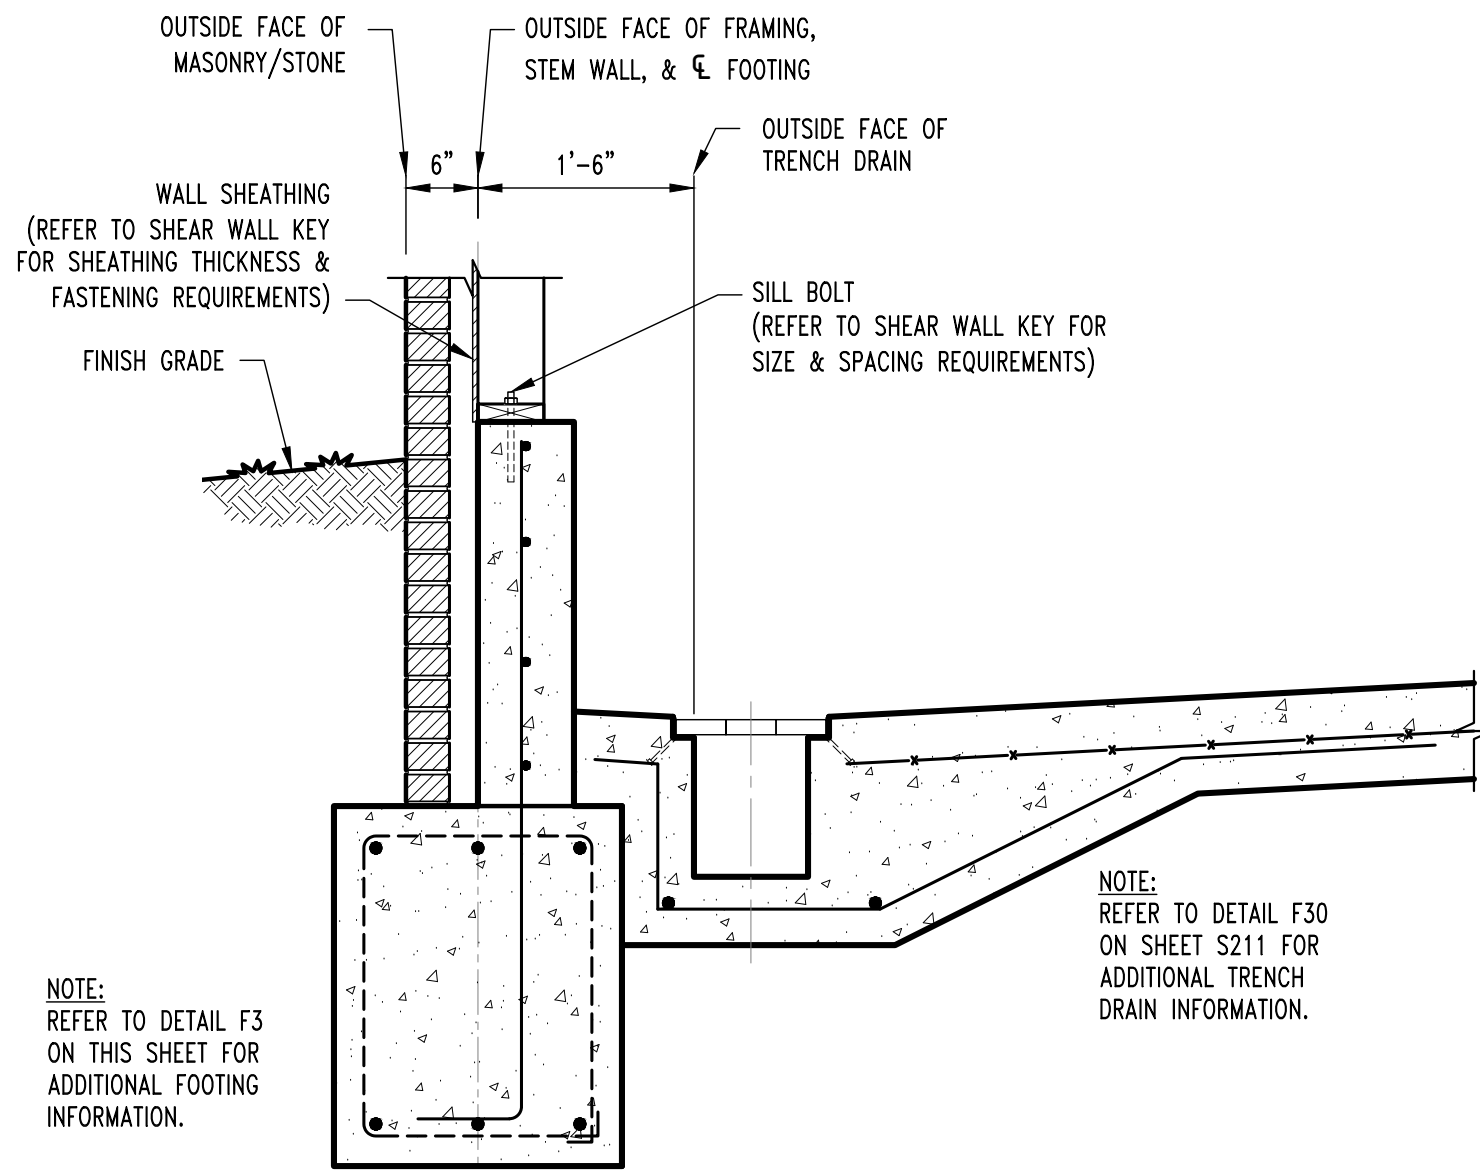

F3A
S200
CONT. FOOTING SECTION
SCALE: 3/4" = 1'-0"

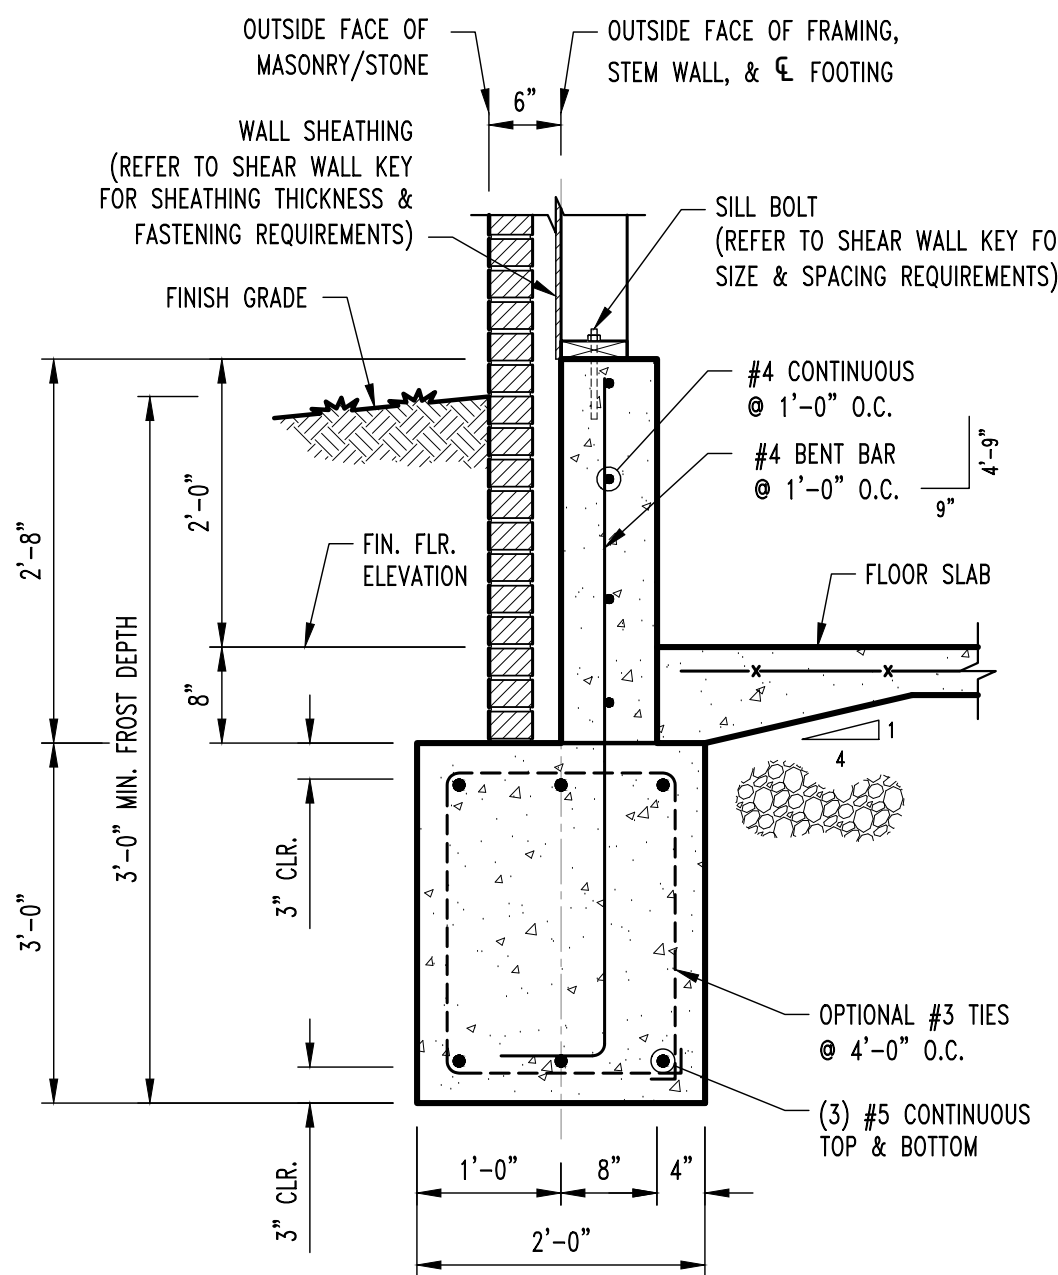

F3
S200
CONT. FOOTING SECTION
SCALE: 3/4" = 1'-0"

REVISIONS:

No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY.



STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. N. Hwy. Blvd. 1
Columbia, Missouri 65203
(573) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#200010101

CLIENT:
INTRINSIC DEVELOPMENT
3822 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA

1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:

FOUNDATION
DETAILS


DESIGNED: JWV

DRAWN: ELT


PROJECT NO.: 230286

SHEET:


S210

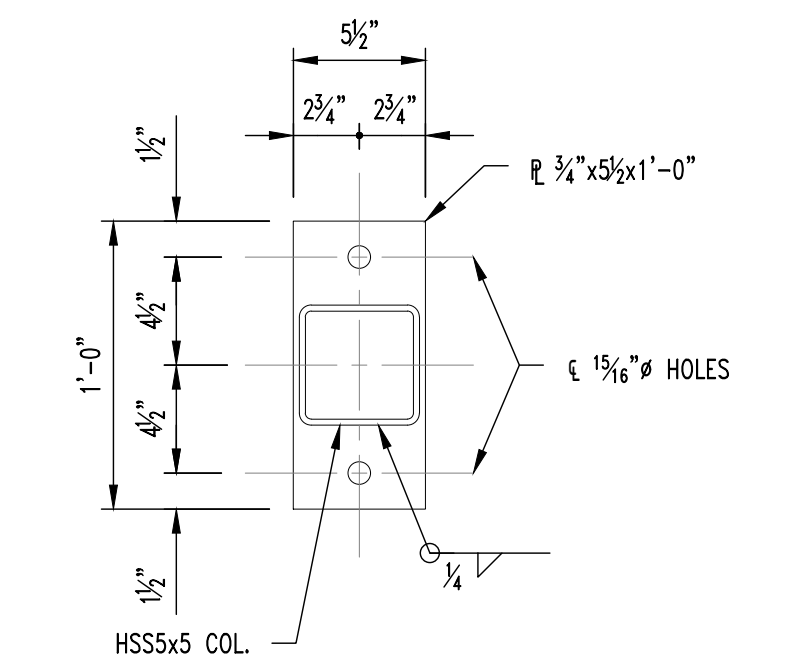


BASE PLATE "BP-1"

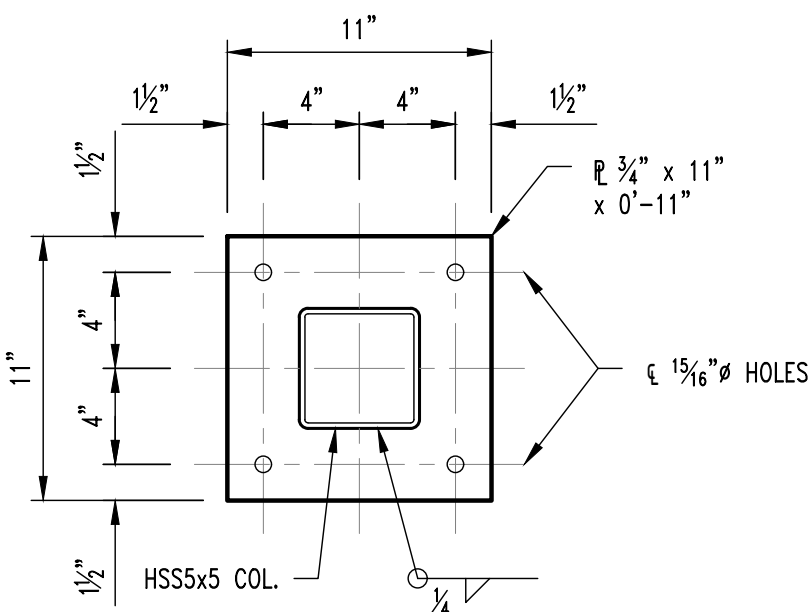

BASE PLATE "BP-2"

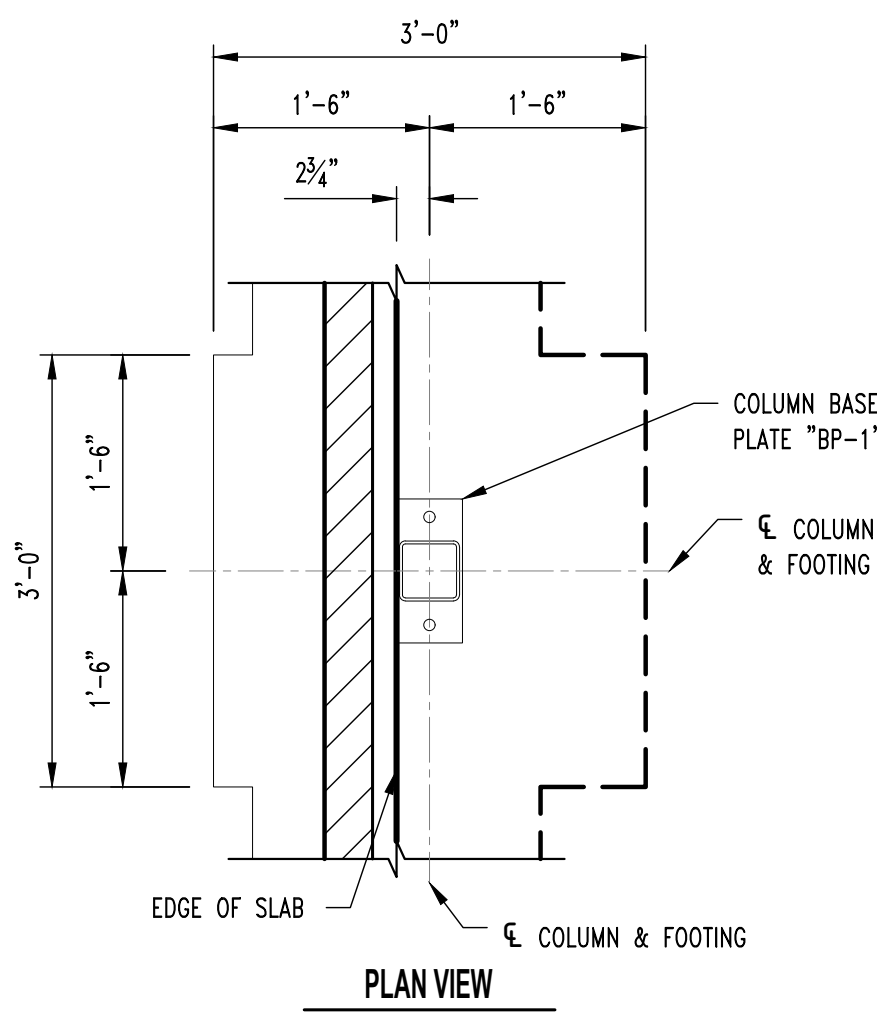


PLAN VIEW

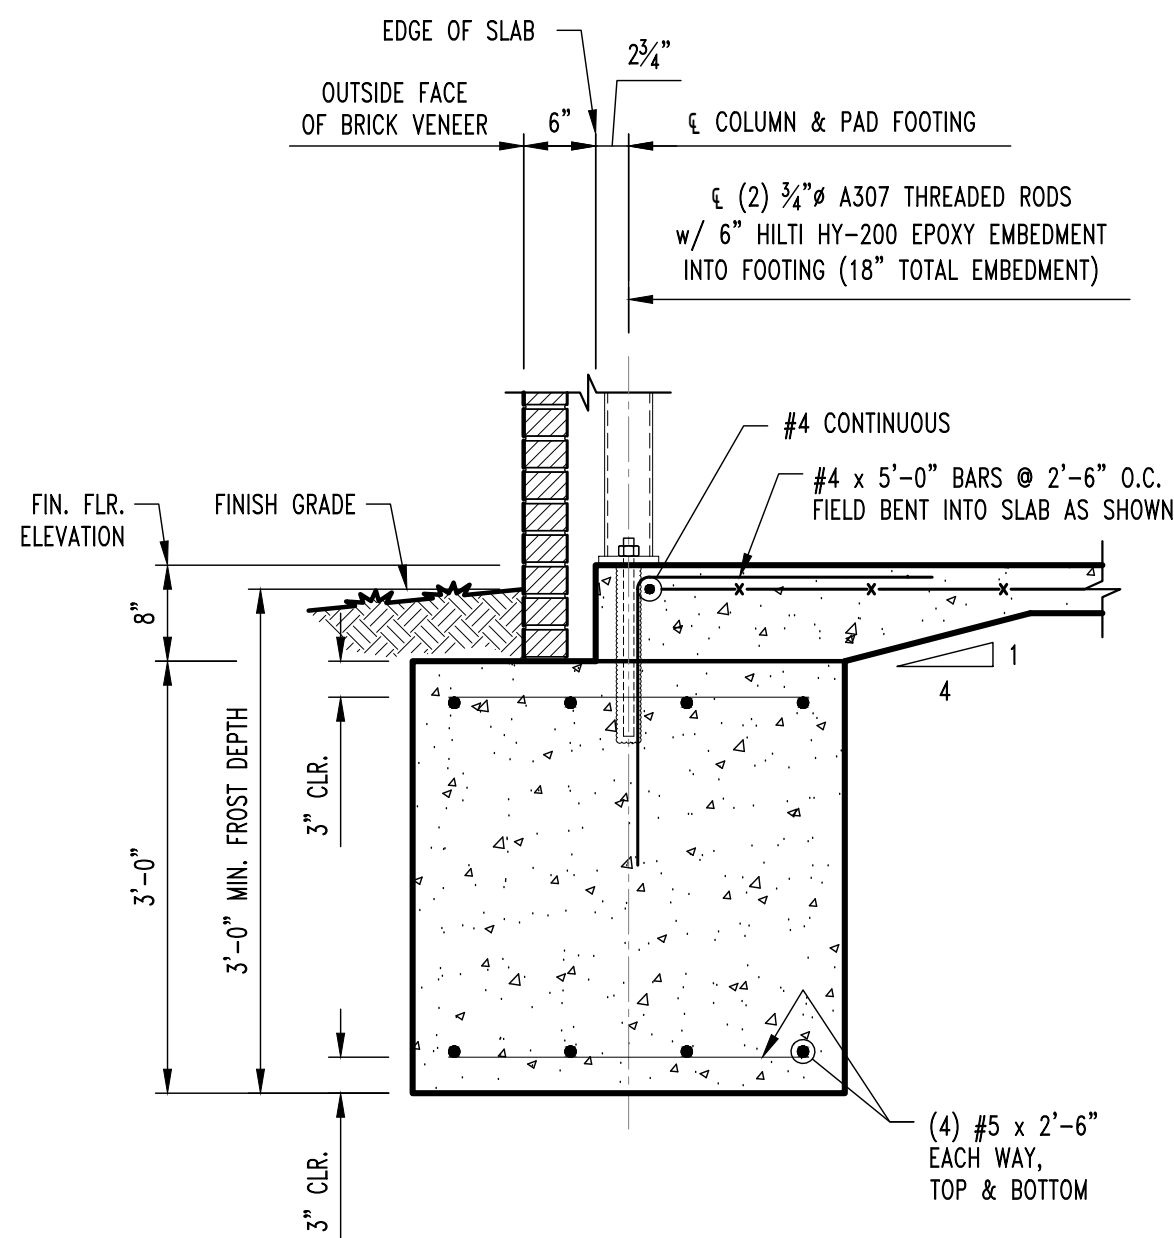


COLUMN FOOTING SECTION

SCALE: 3/4" = 1'-0"

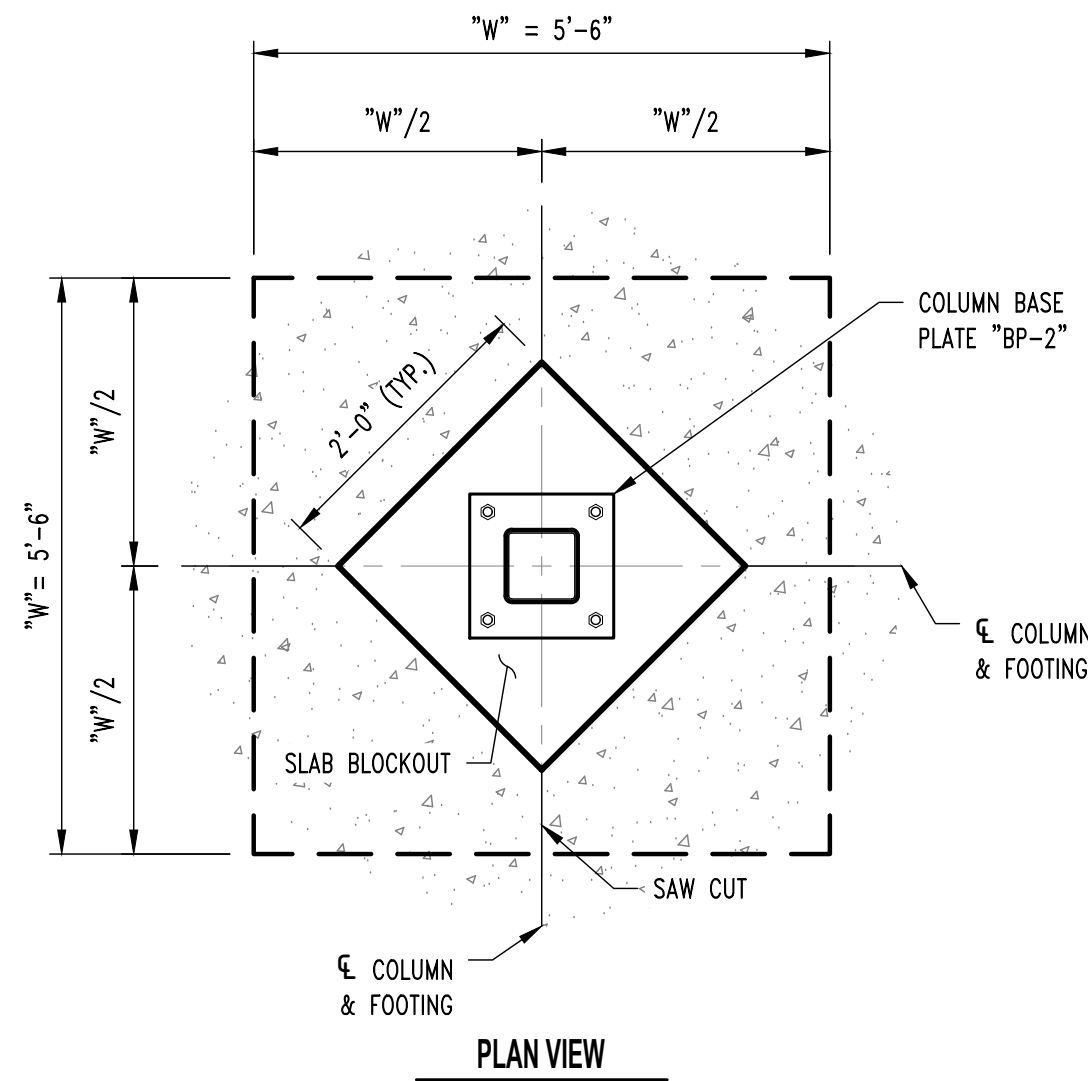


PLAN VIEW

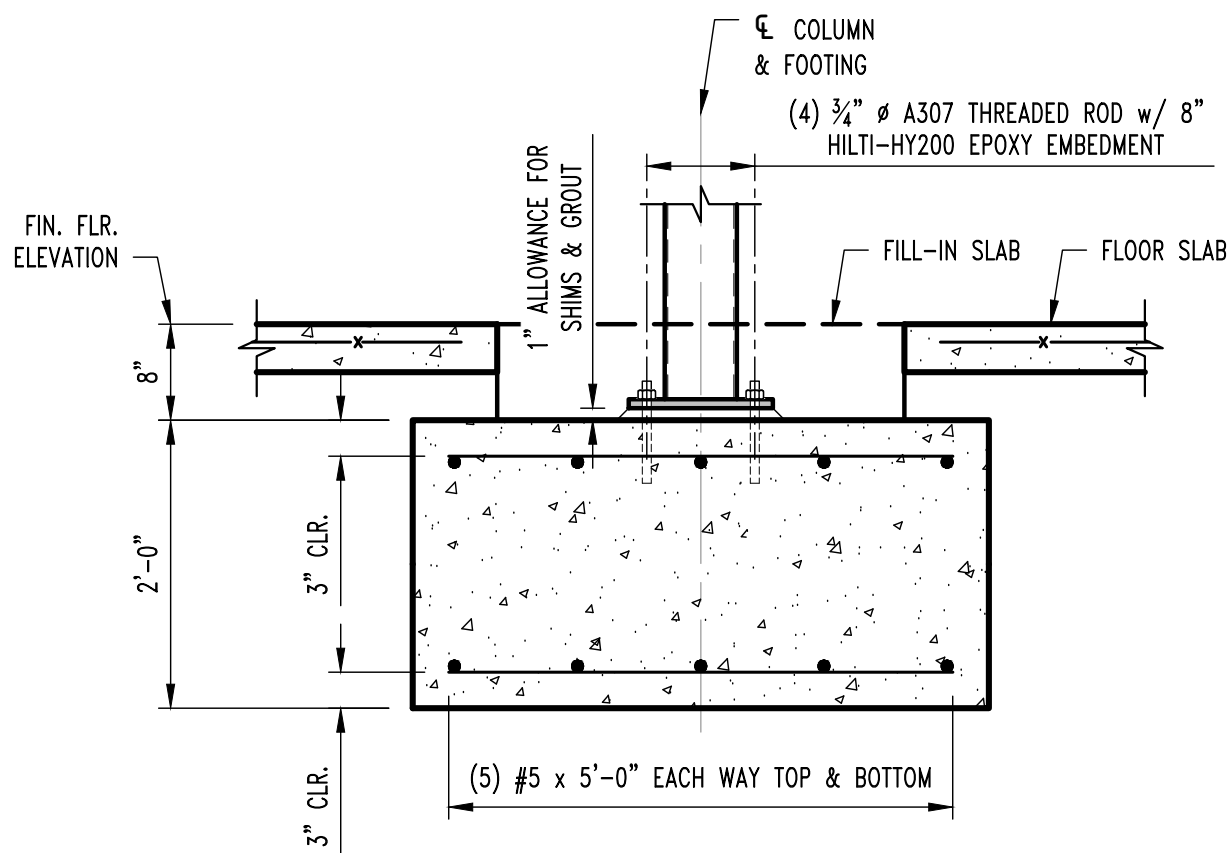


COLUMN FOOTING SECTION

SCALE: 3/4" = 1'-0"

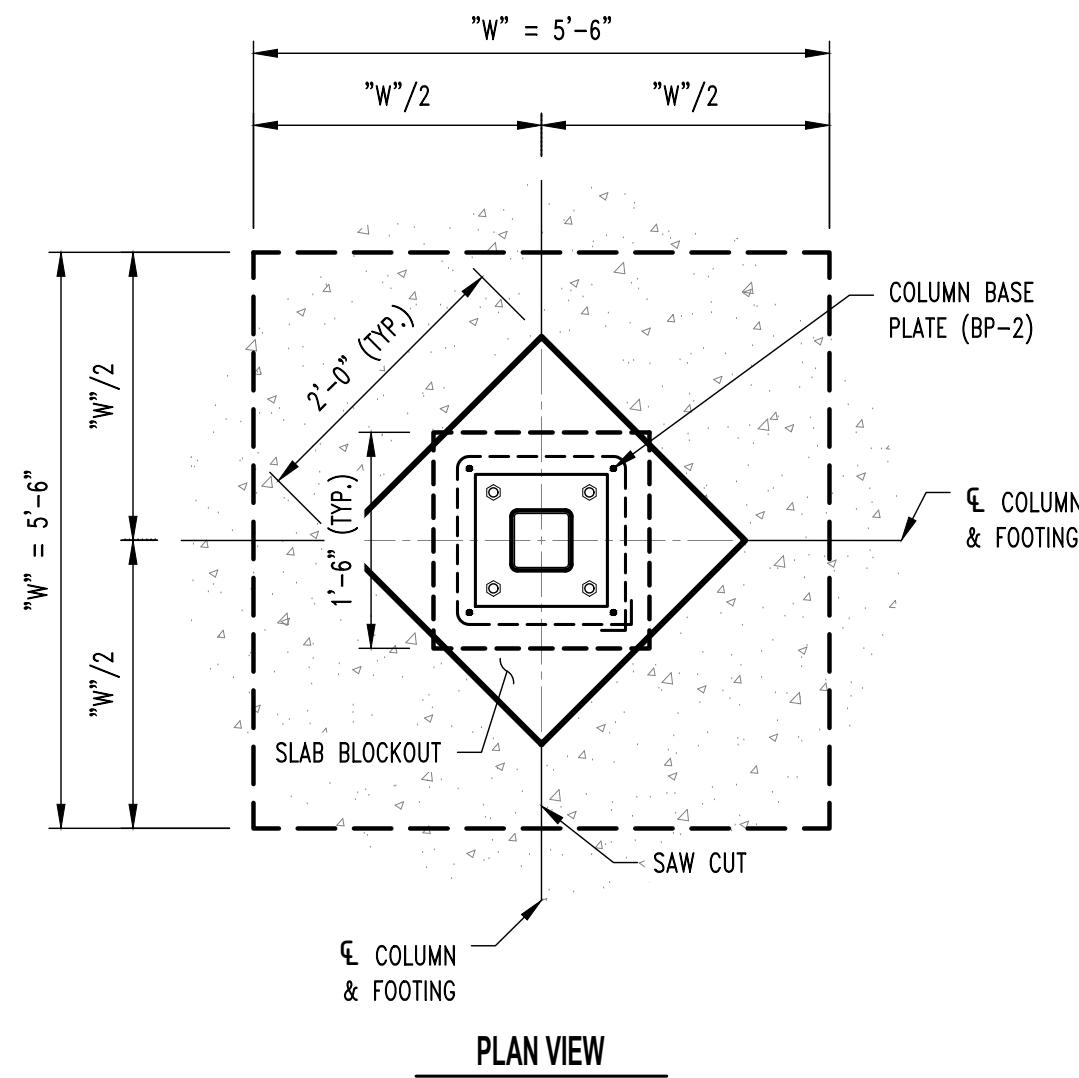


PLAN VIEW

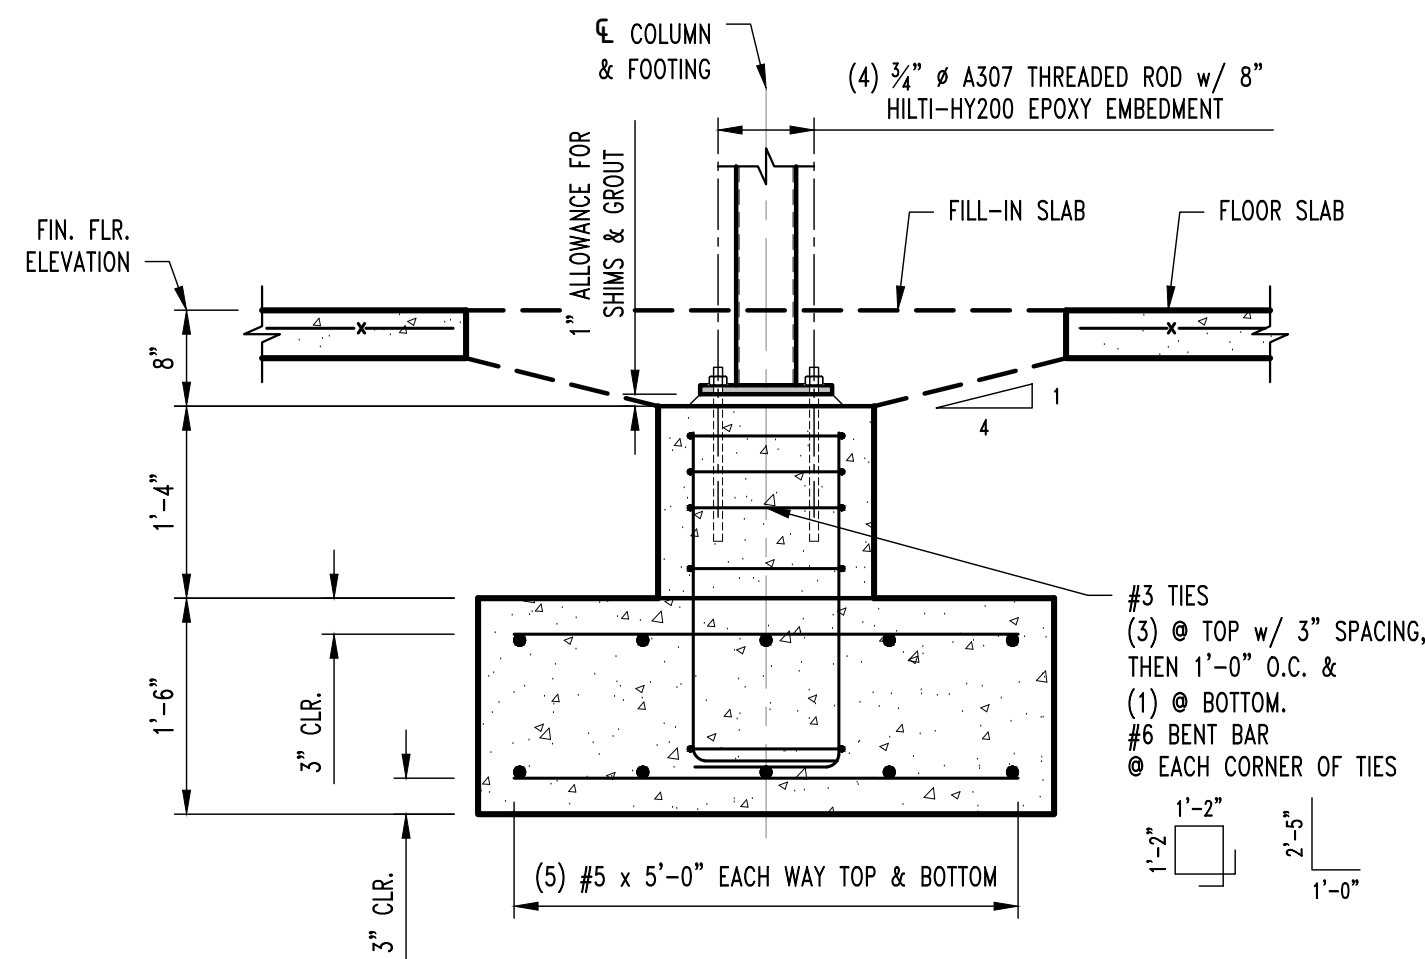

COLUMN FOOTING SECTION

SCALE: 3/4" = 1'-0"

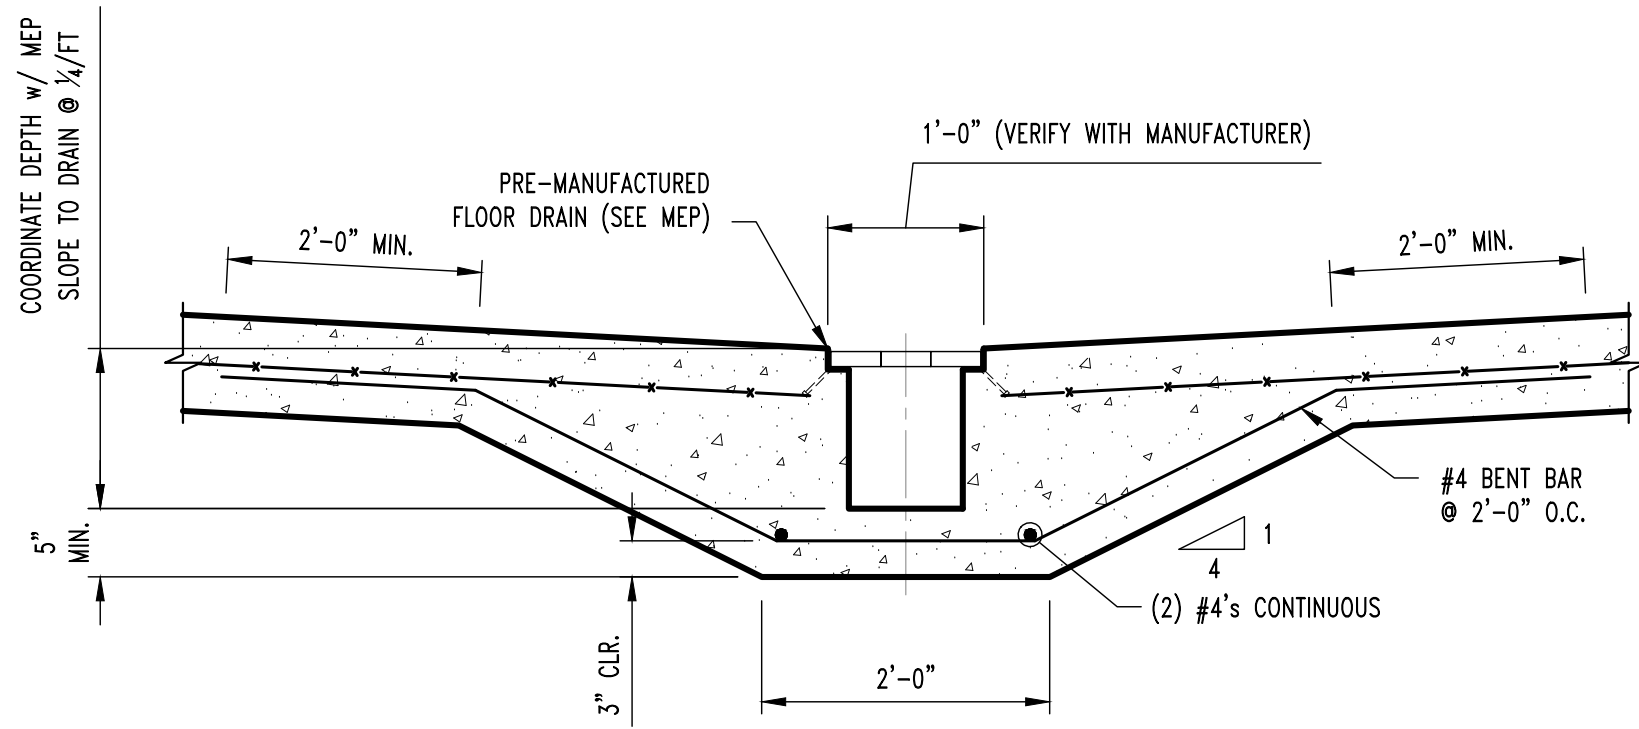

CONT. TRENCH DRAIN SECTION

SCALE: 3/4" = 1'-0"

REVISIONS:

No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY



STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. N. Hwy. Blvd. 1
Columbia, Missouri 65203
(573) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#200313101

CLIENT:
INTRINSIC DEVELOPMENT
3822 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA

1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:

FOUNDATION
DETAILS

DESIGNED: JWV

DRAWN: ELT

PROJECT NO.: 230286

SHEET:

S211

ALL DIMENSIONS ARE FROM FACE OF FOUNDATION WALL OR FRAMING;
EDGE OF SLAB OR TRUSS/RAFTER; OR CENTERLINE
OF COLUMN, BEAM, OR JOIST UNLESS NOTED OTHERWISE.



SCALE: $\frac{1}{8}" = 1'-0"$



HEADER SCHEDULE			
LABEL	HEADER	CRIPPLE/JACK	JAMB/IKING
"H1"	2 Ply 2x6 SPF No.1/No.2	Single Ply 2x6 So. SPF No.1/No.2	2 Ply 2x6 SPF No.1/No.2
"H2"	2 Ply 2x12 Doug. Fr Sel. Struct.	Single Ply 2x6 So. SPF No.1/No.2	4 Ply 2x6 SPF No.1/No.2
"H3"	3 Ply 2x12 Doug. Fr Sel. Struct.	Single Ply 2x6 So. SPF No.1/No.2	5 Ply 2x6 So. Pine Sel. Struct.
"H4"	3 Ply 1.75x11.25 MicroLam 2.0E	Single Ply 2x6 So. SPF No.1/No.2	5 Ply 2x6 So. Pine Sel. Struct.

- ① GIRDER TRUSS
- ② 3-PLY BUILT-UP POST BENEATH GIRDER TRUSS THIS
LEVEL TO FLOOR SLAB CONNECTIONS ARE AS FOLLOWS:
FLOOR SLAB: SIMPSON LTPT2.
ROOF TRUSS: BY TRUSS MANUFACTURER
- ③ GIRDER TO HEADER, REFER TO DETAIL TYP.
GIRDER TO HEADER DETAIL ON SHEET S311
FOR ADDITIONAL INFORMATION.
- ④ PROVIDE SOLID WOOD BLOCKING FASTENED W/ (8) #12
TEK SCREWS IN WEB OF W12 TO FASTEN SIMPSON LGT
TIEDOWN W/ 16d SINKER NAILS TO BLOCKING & GIRDELS
- ⑤ RTU, COORDINATE WITH MEP DRAWINGS FOR EXACT
SIZE, WEIGHT, & LOCATION.

[illegible]

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY



STRUCTURAL ENGINEER:
CRACKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1
Columbia, Missouri 65203
(573) 447-0292
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#20000151301

**INTRINSIC
DEVELOPMENT**
3622 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA

1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:

ROOF FRAMING
PLAN

DESIGNED: JWV

DRAWN: ELT

PROJECT NO.: 230286


SHEET:

S300

NOTE:
ALL DIMENSIONS ARE FROM FACE OF FOUNDATION WALL OR FRAMING;
EDGE OF SLAB OR TRUSS/RAFTER; OR CENTERLINE
OF COLUMN, BEAM, OR JOIST UNLESS NOTED OTHERWISE.

SHEAR WALL NOTES


- ① ALL SHEATHING TO BE CONTINUOUS, UNBROKEN
FOR FULL LENGTH OF DIMENSIONED SHEAR WALL.

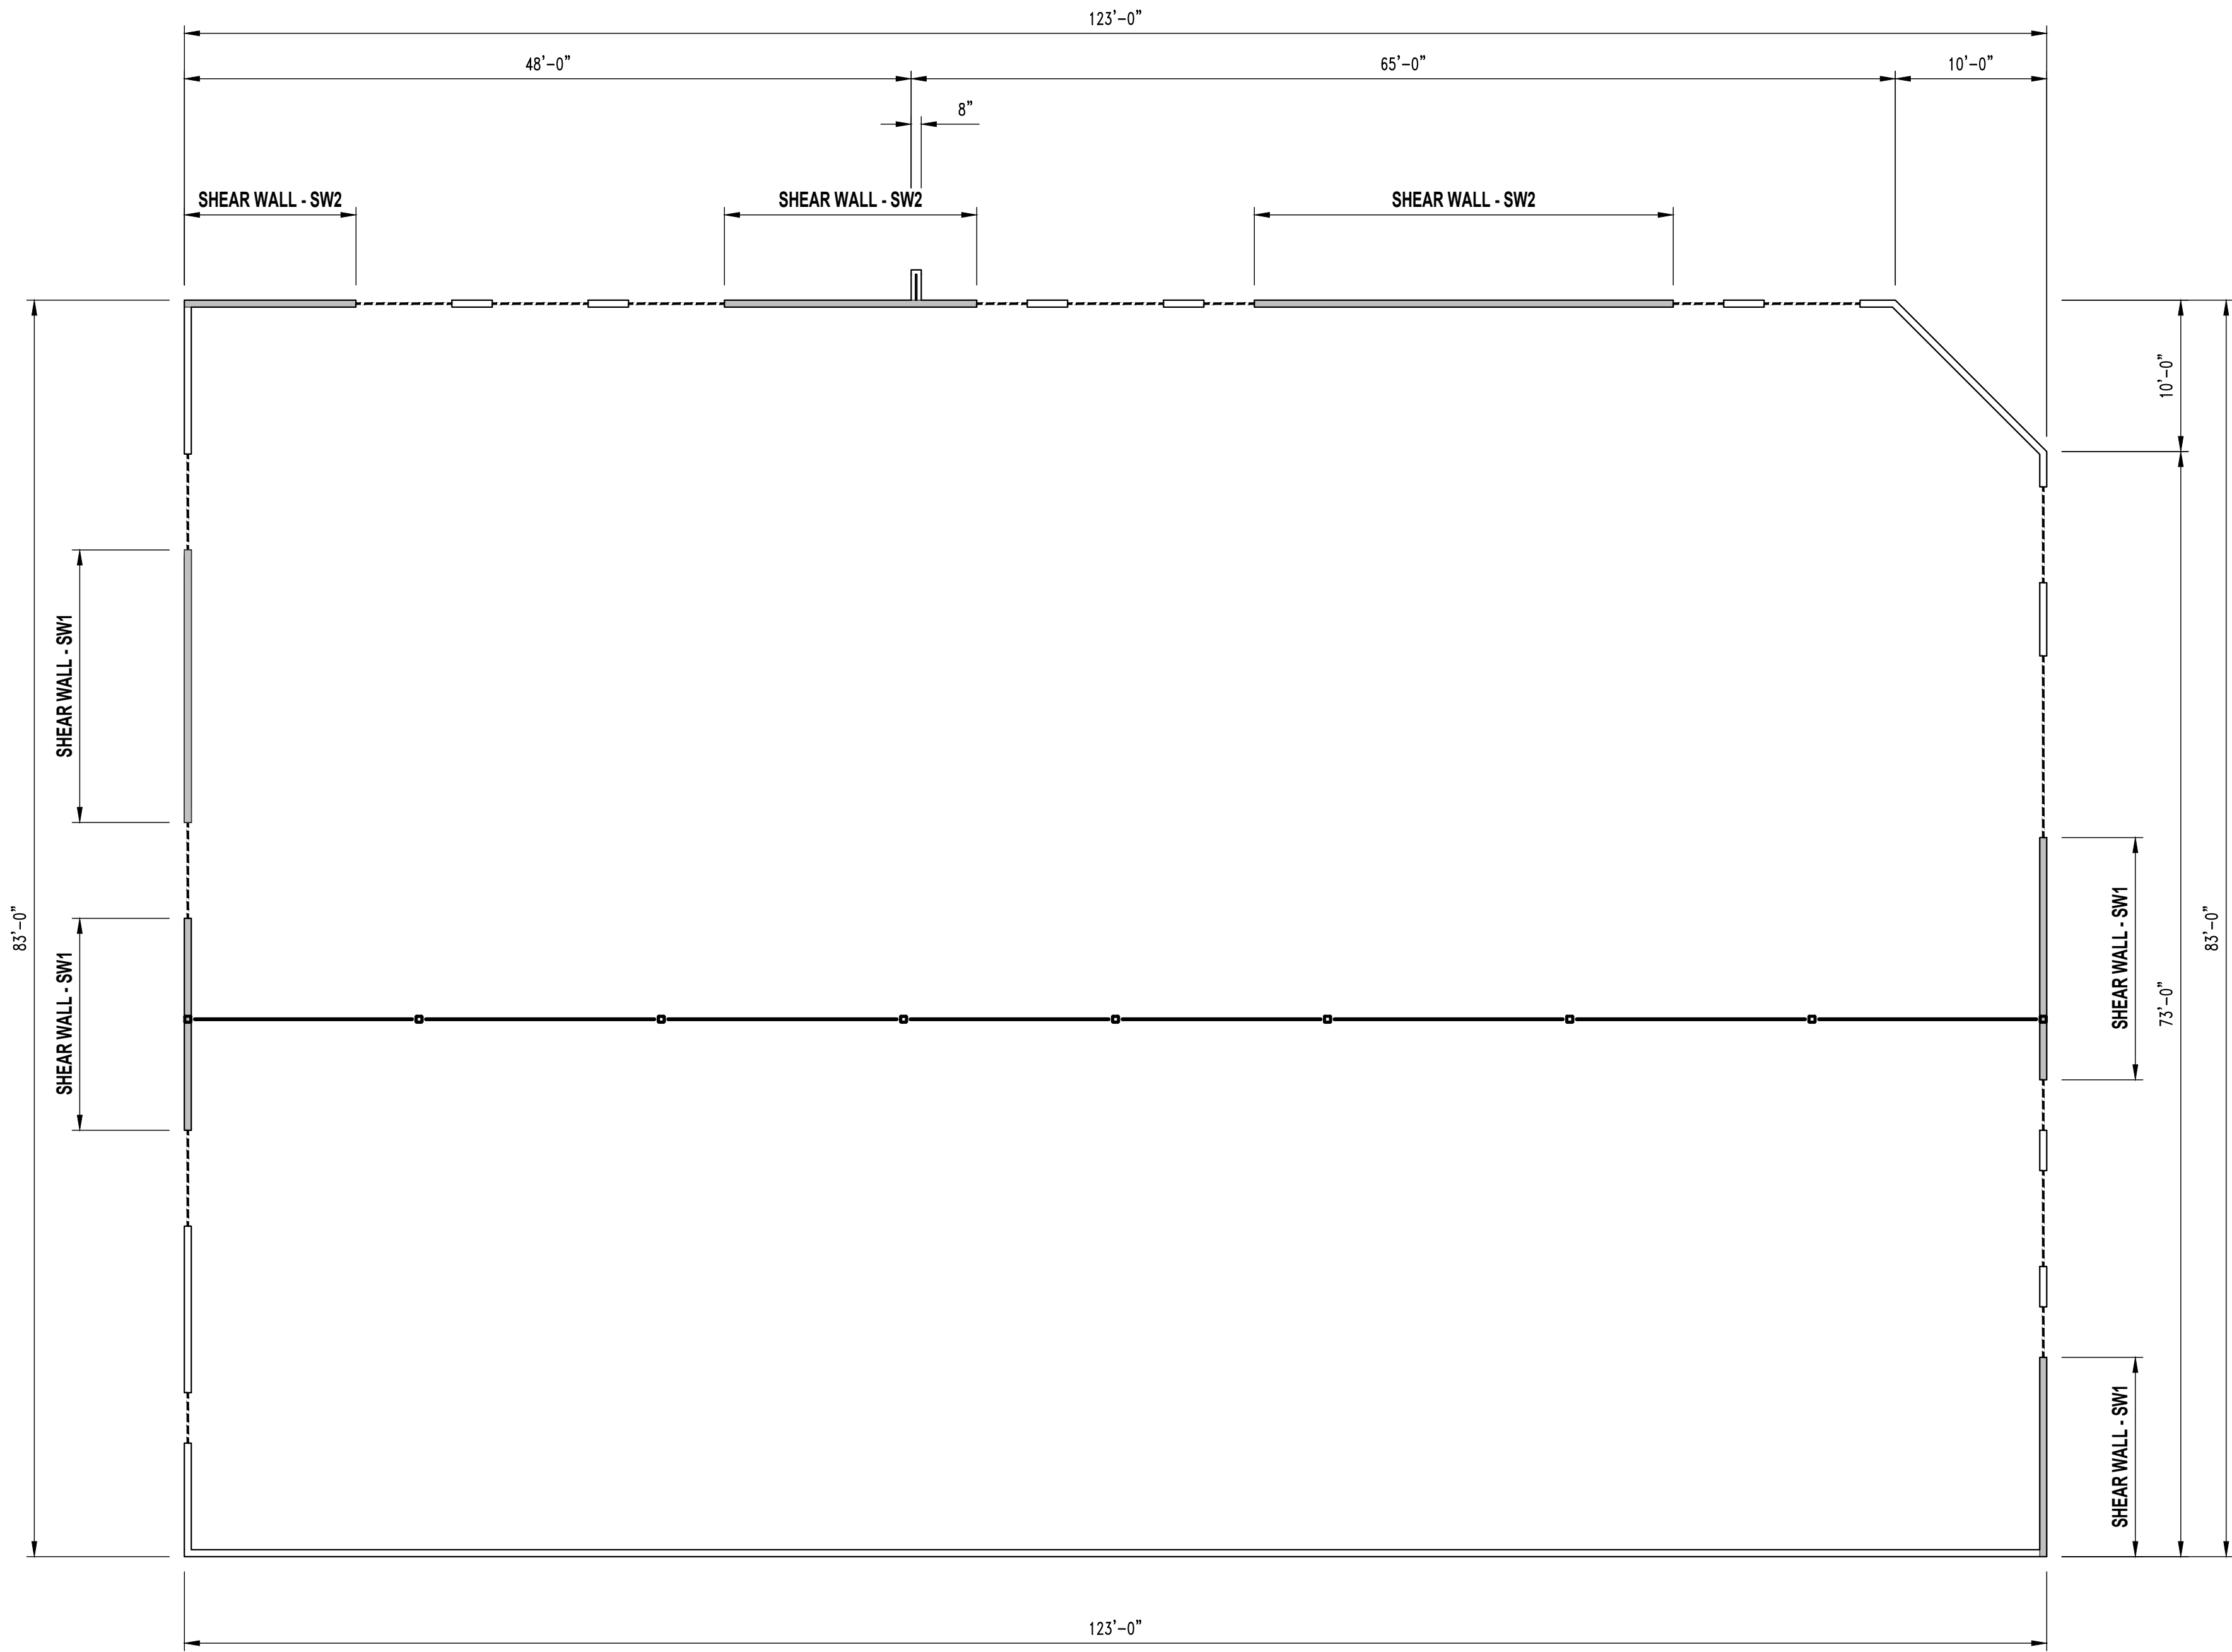

1
S300A

SHEAR WALL PLAN

SCALE: 3/8" = 1'-0"

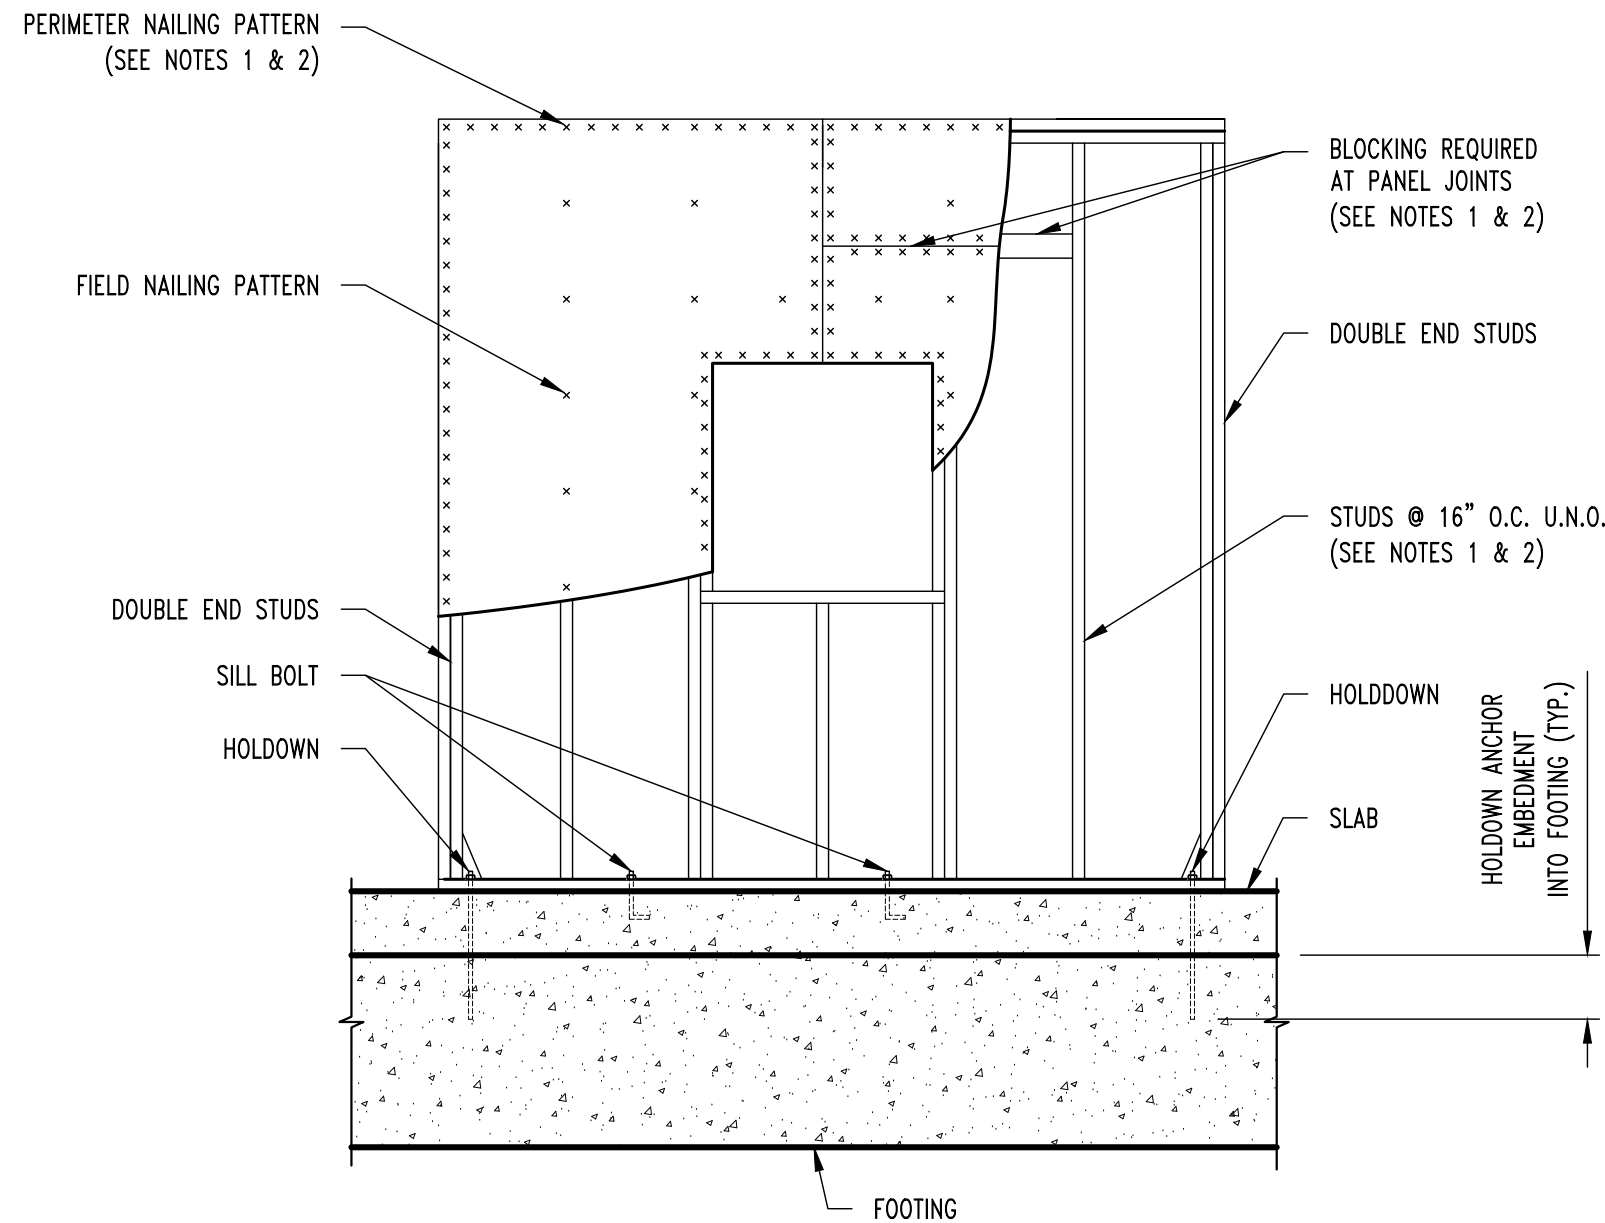

NOTES:

- WHERE TWO SHEETS MEET, BOTH SHEETS SHOULD BE NAILED TO THE SAME FRAMING MEMBER.
- WHEN SHEATHING NAILS ARE SPACED AT 2" O.C. FOR 8d NAILS OR 3" O.C. FOR 10d NAILS, 3x OR DOUBLE 2x FRAMING MEMBERS ARE REQUIRED WHERE SHEETS MEET. FACE NAIL DOUBLE 2x MEMBERS TOGETHER w/ 16d NAILS @ 2 1/2" O.C. STAGGERED EACH FACE OF STUD.
- SEE WALL SECTIONS FOR ADDITIONAL INFORMATION.

TYP. SHEAR WALL DETAIL

SHEAR WALL KEY

SW1 SHEAR WALL

- 7/16" OSB SHEATHING FASTENED WITH 8d NAILS @ 2" O.C. @ PERIMETER / 12" O.C. FIELD
- 1/2" DIAMETER F1554 GRADE 36 STANDARD "J" BOLTS W/ 7" EMBEDMENT @ 1'-0" O.C.
- REQUIRES SIMPSON HDU11-SDS2.5 HOLDOWN FASTENED TO 3-PLY STUDS W/ (30) 3/4x2 1/2 SDS W/ 1" DIAMETER A307 THREADED ROD W/ 20" TOTAL (12" INTO FOOTING) SIMPSON "AT-3G" EPOXY EMBEDMENT AT EACH END OF THE SHEAR WALL

SW2 SHEAR WALL

- 7/16" OSB SHEATHING FASTENED WITH 8d NAILS @ 6" O.C. @ PERIMETER / 12" O.C. FIELD
- 1/2" DIAMETER F1554 GRADE 36 STANDARD "J" BOLTS W/ 7" EMBEDMENT @ 2'-0" O.C.
- REQUIRES SIMPSON HDU4-SDS2.5 HOLDOWN FASTENED TO 2-PLY STUDS W/ (10) 3/4 X 2 1/2 SDS W/ 5/8" DIAMETER A307 THREADED ROD W/ 16" TOTAL (8" INTO FOOTING) SIMPSON "AT-3G" EPOXY EMBEDMENT AT EACH END OF THE SHEAR WALL

TYPICAL WALL UNLESS NOTED

- 7/16" OSB SHEATHING FASTENED WITH 8d NAILS @ 6" O.C. @ PERIMETER / 12" O.C. FIELD
- 1/2" DIAMETER F1554 GRADE 36 STANDARD "J" BOLTS W/ 7" EMBEDMENT @ 4'-0" O.C.
- NO HOLDDOWNS REQUIRED

REVISIONS:

No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY



STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. N. Hwy Blvd, Suite 1
Columbia, Missouri 65203
(573) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#000000001

CLIENT:
INTRINSIC DEVELOPMENT
3822 ENDEAVOR AVE, STE 101
COLUMBIA, MO 65201

DISCOVERY PET SPA
1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:

SHEAR WALL
PLAN


DESIGNED: JWV

DRAWN: ELT

PROJECT NO.: 230286

SHEET:


S300A

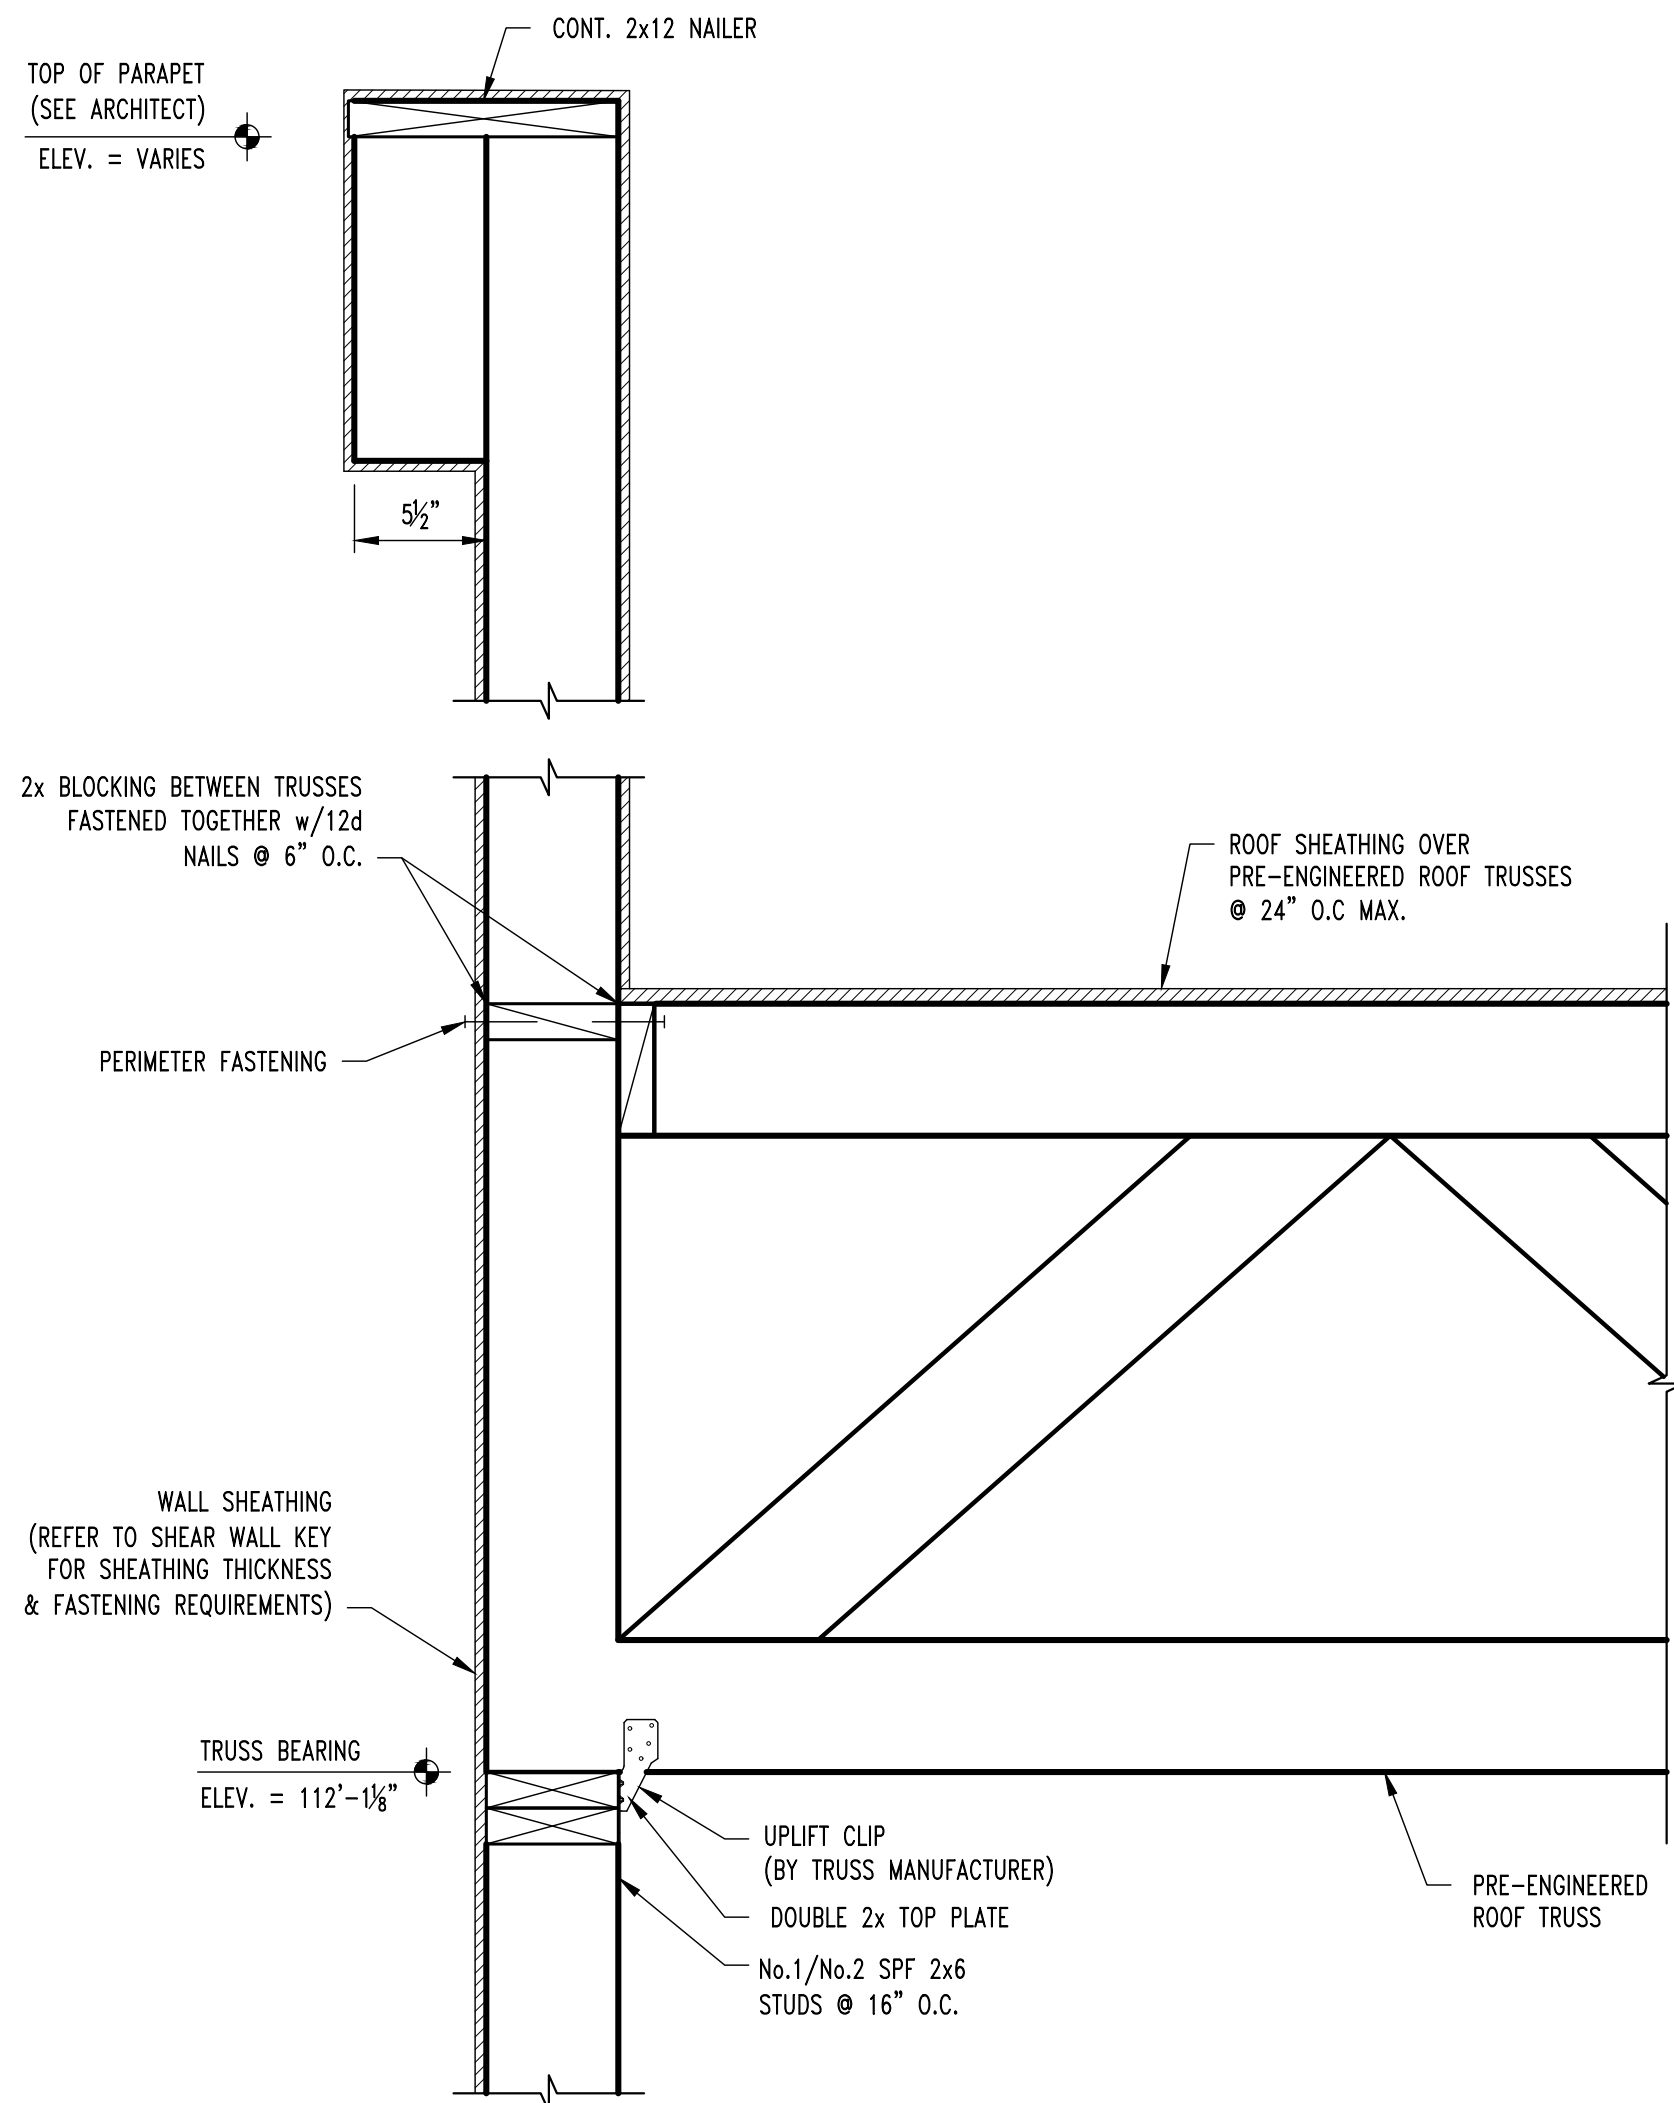

S1
S300

ROOF FRAMING SECTION


SCALE: 1/2" = 1'-0"

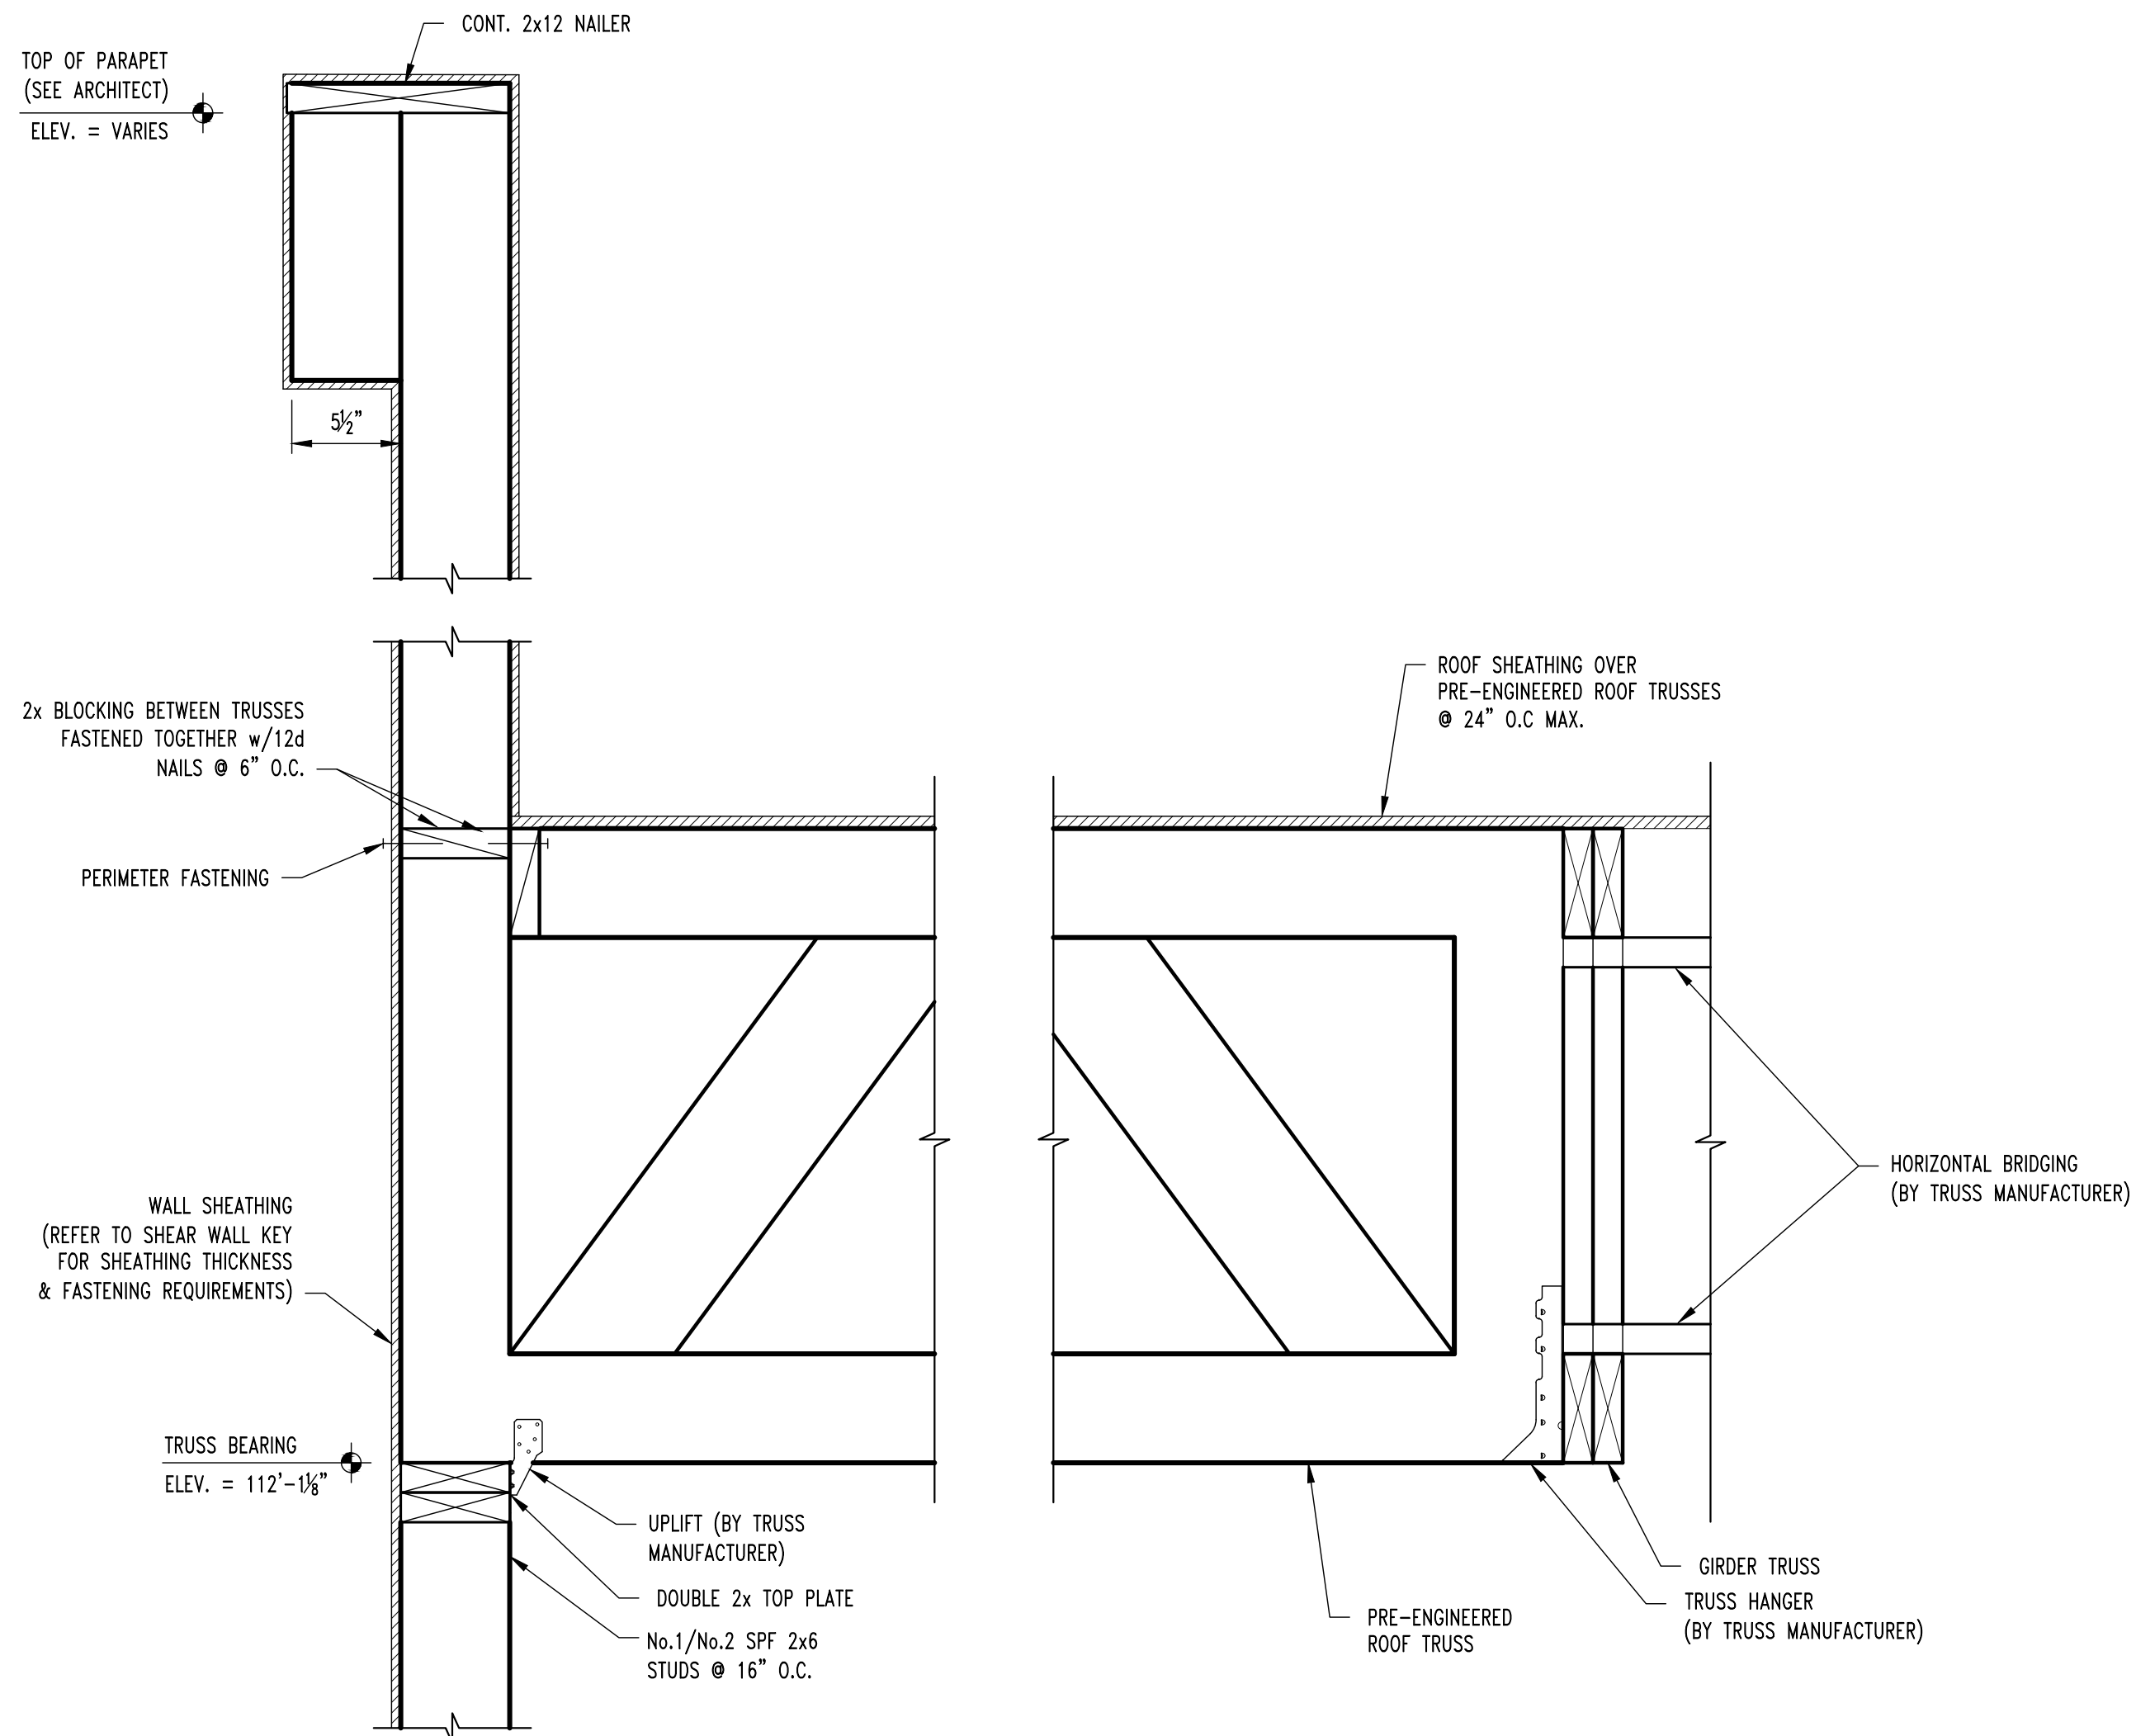

S2
S300

ROOF FRAMING SECTION


SCALE: 1/2" = 1'-0"

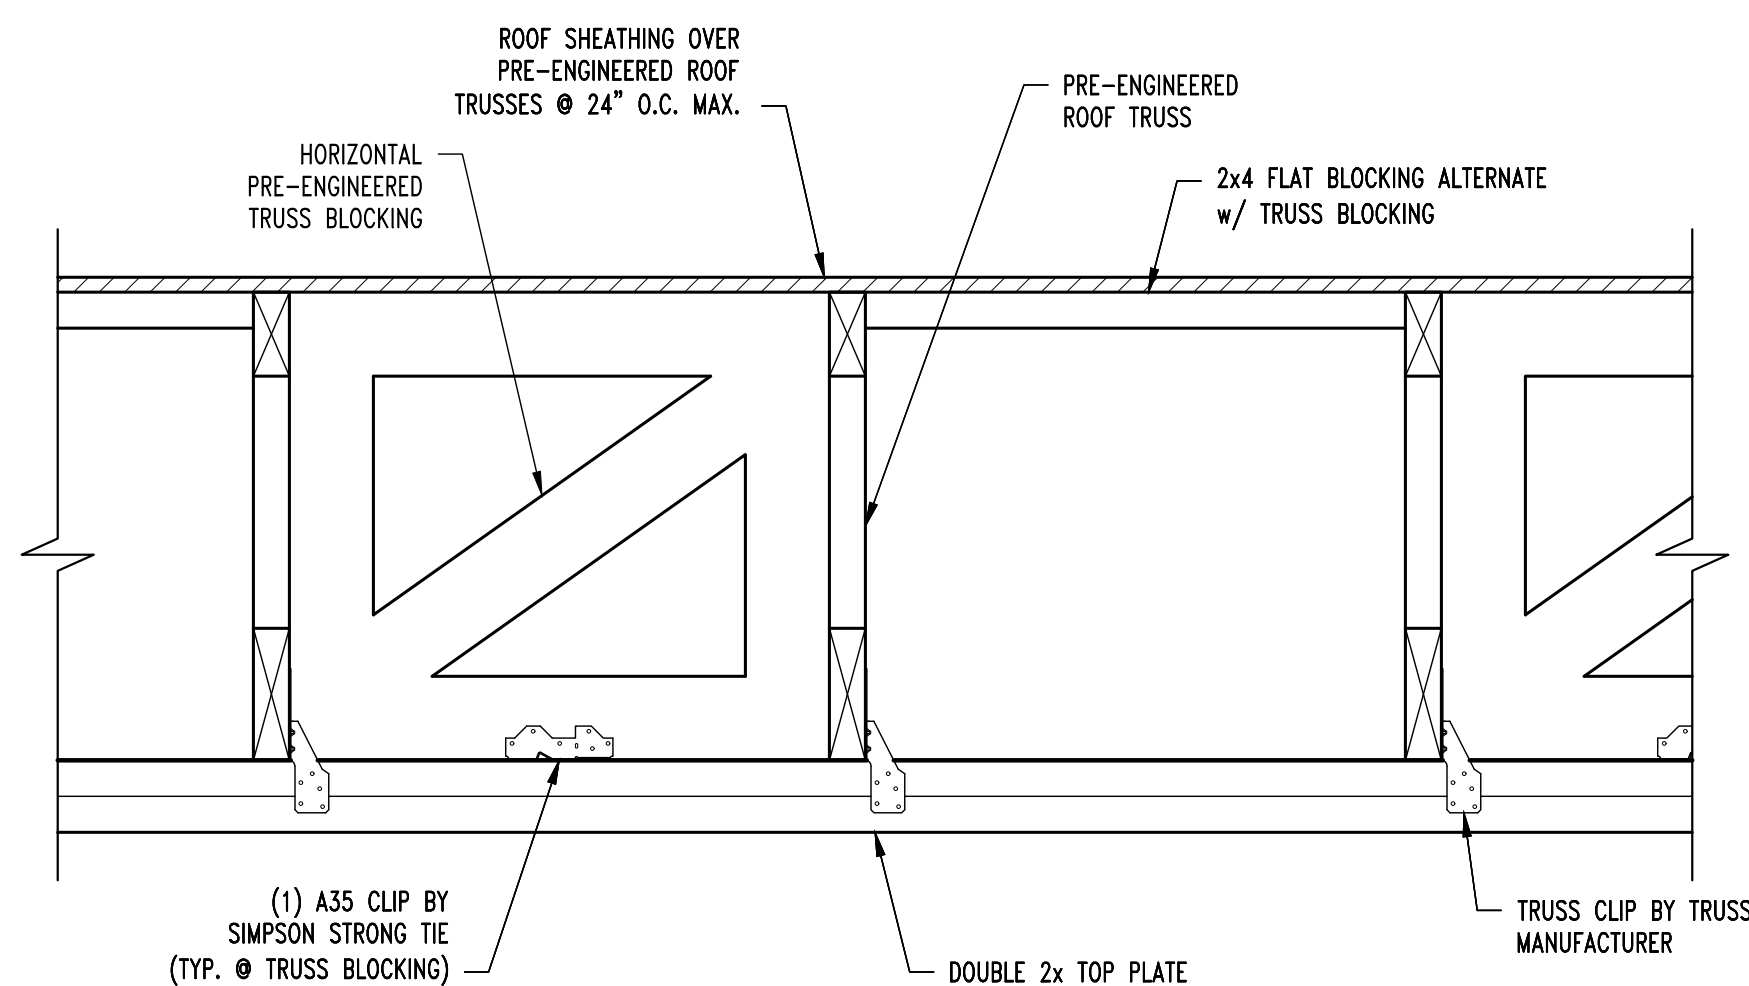

A
S310

TYP. TRUSS BLOCKING SECTION


SCALE: 1/2" = 1'-0"

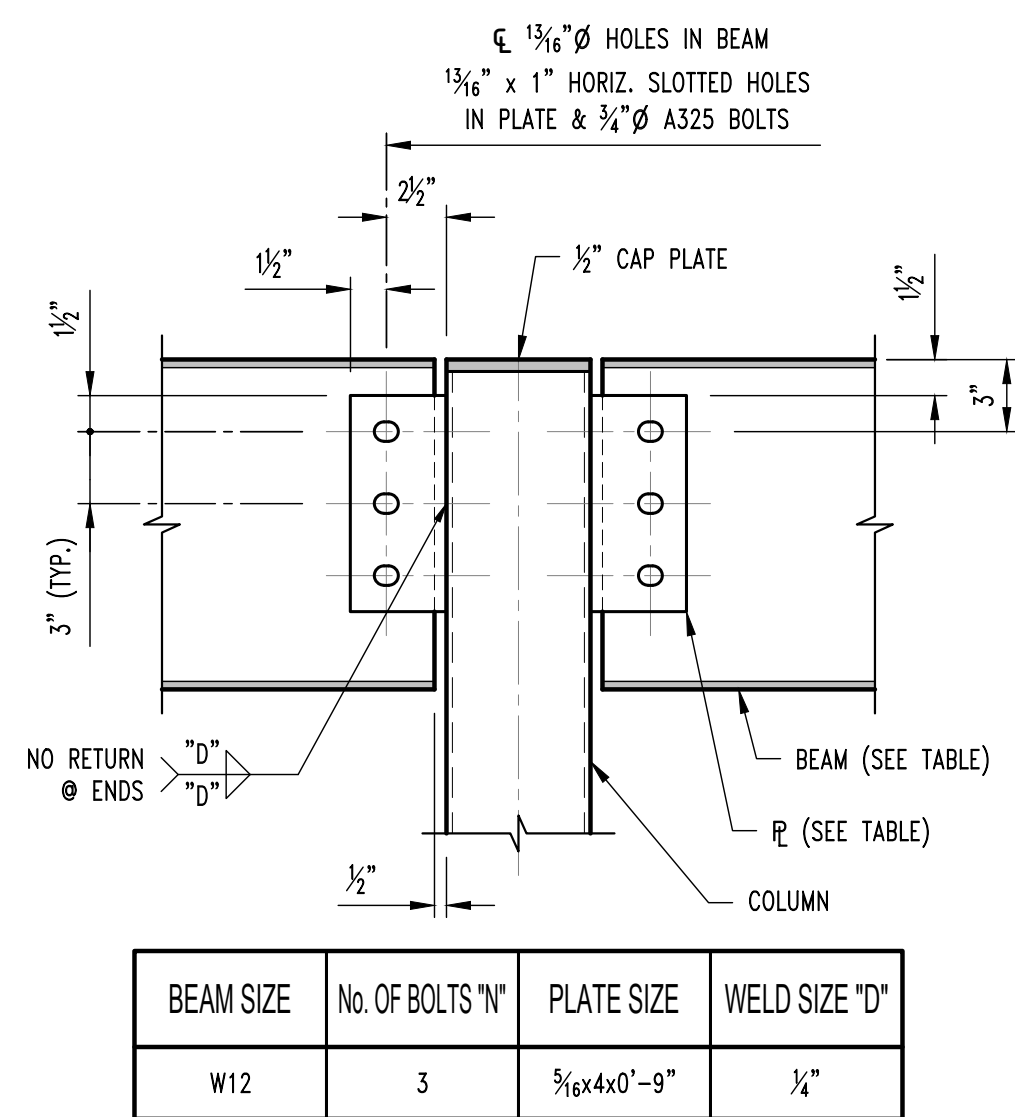

S10
S300

TYP. BEAM TO COLUMN SECTION

SCALE: 1/2" = 1'-0"

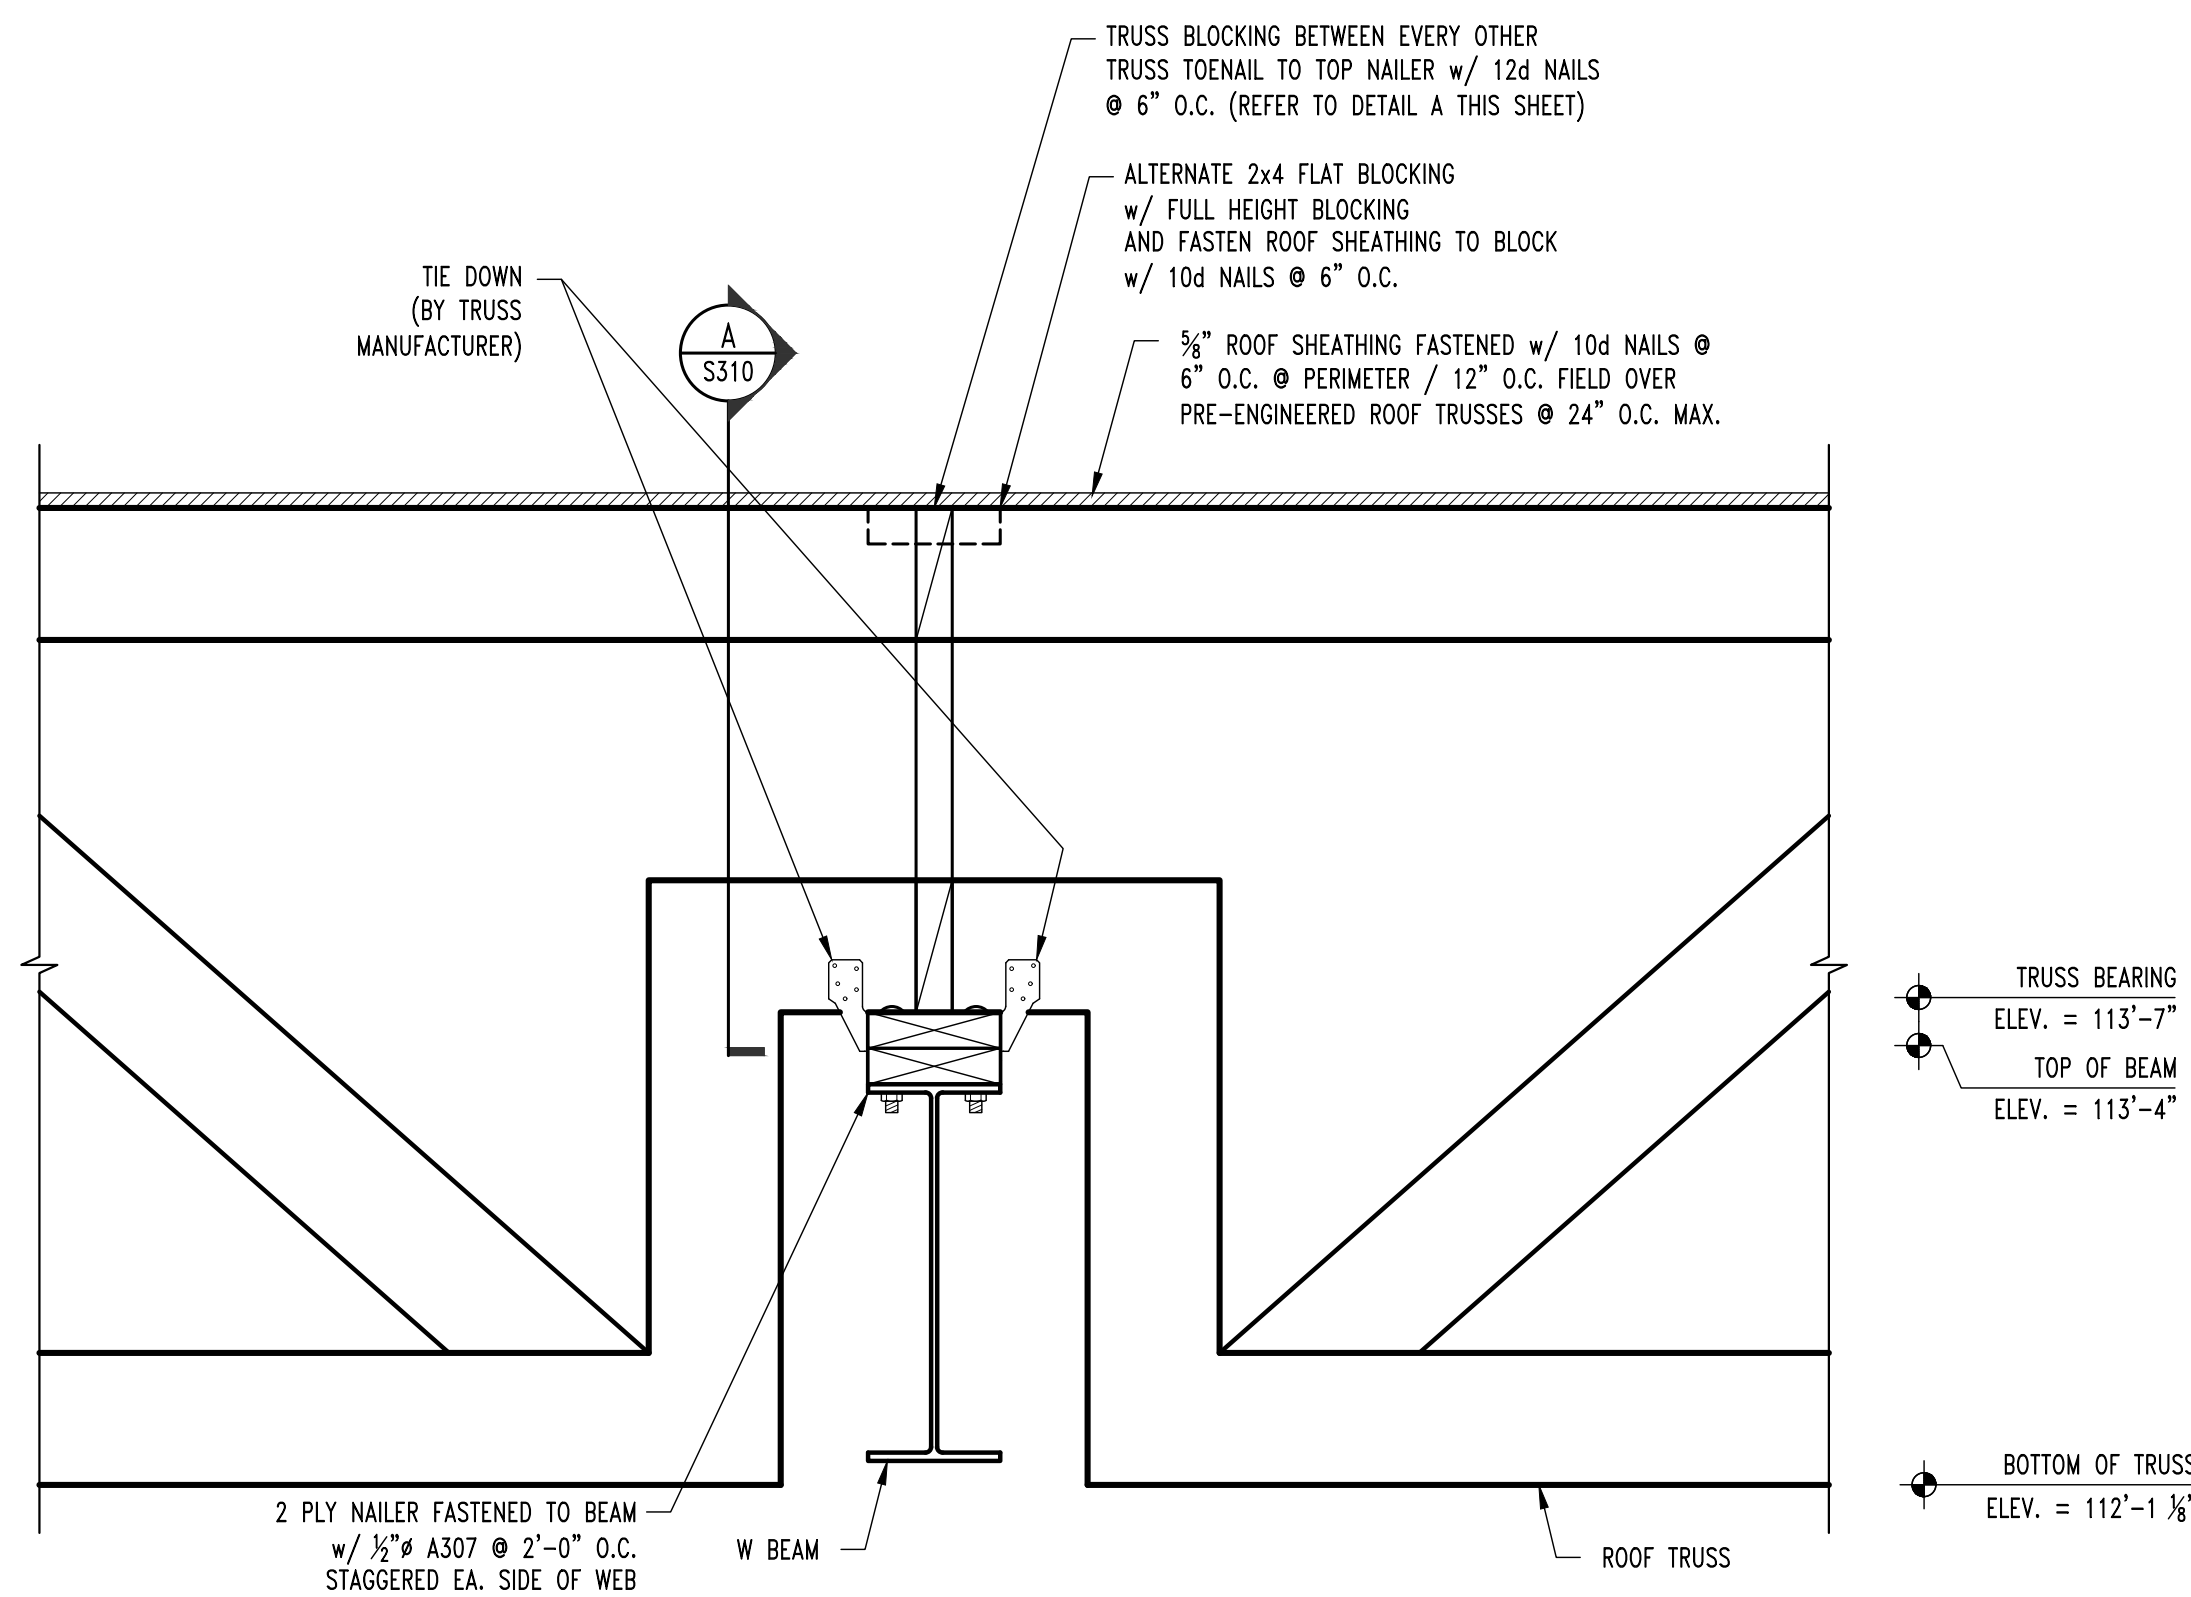

S11
S300

ROOF FRAMING SECTION

SCALE: 1/2" = 1'-0"

REVISIONS:

No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY

STATE OF MISSOURI
JARED W. VORLUBES
NUMBER
PE-2017000387
PROFESSIONAL ENGINEER
9/19/2024

STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Suite 1
Columbia, Missouri 65203
(314) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#2000181001



CLIENT:
**INTRINSIC
DEVELOPMENT**
3822 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA
1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:

ROOF FRAMING
DETAILS

DESIGNED: JWV
DRAWN: ELT
PROJECT NO.: 230286
SHEET:
S310

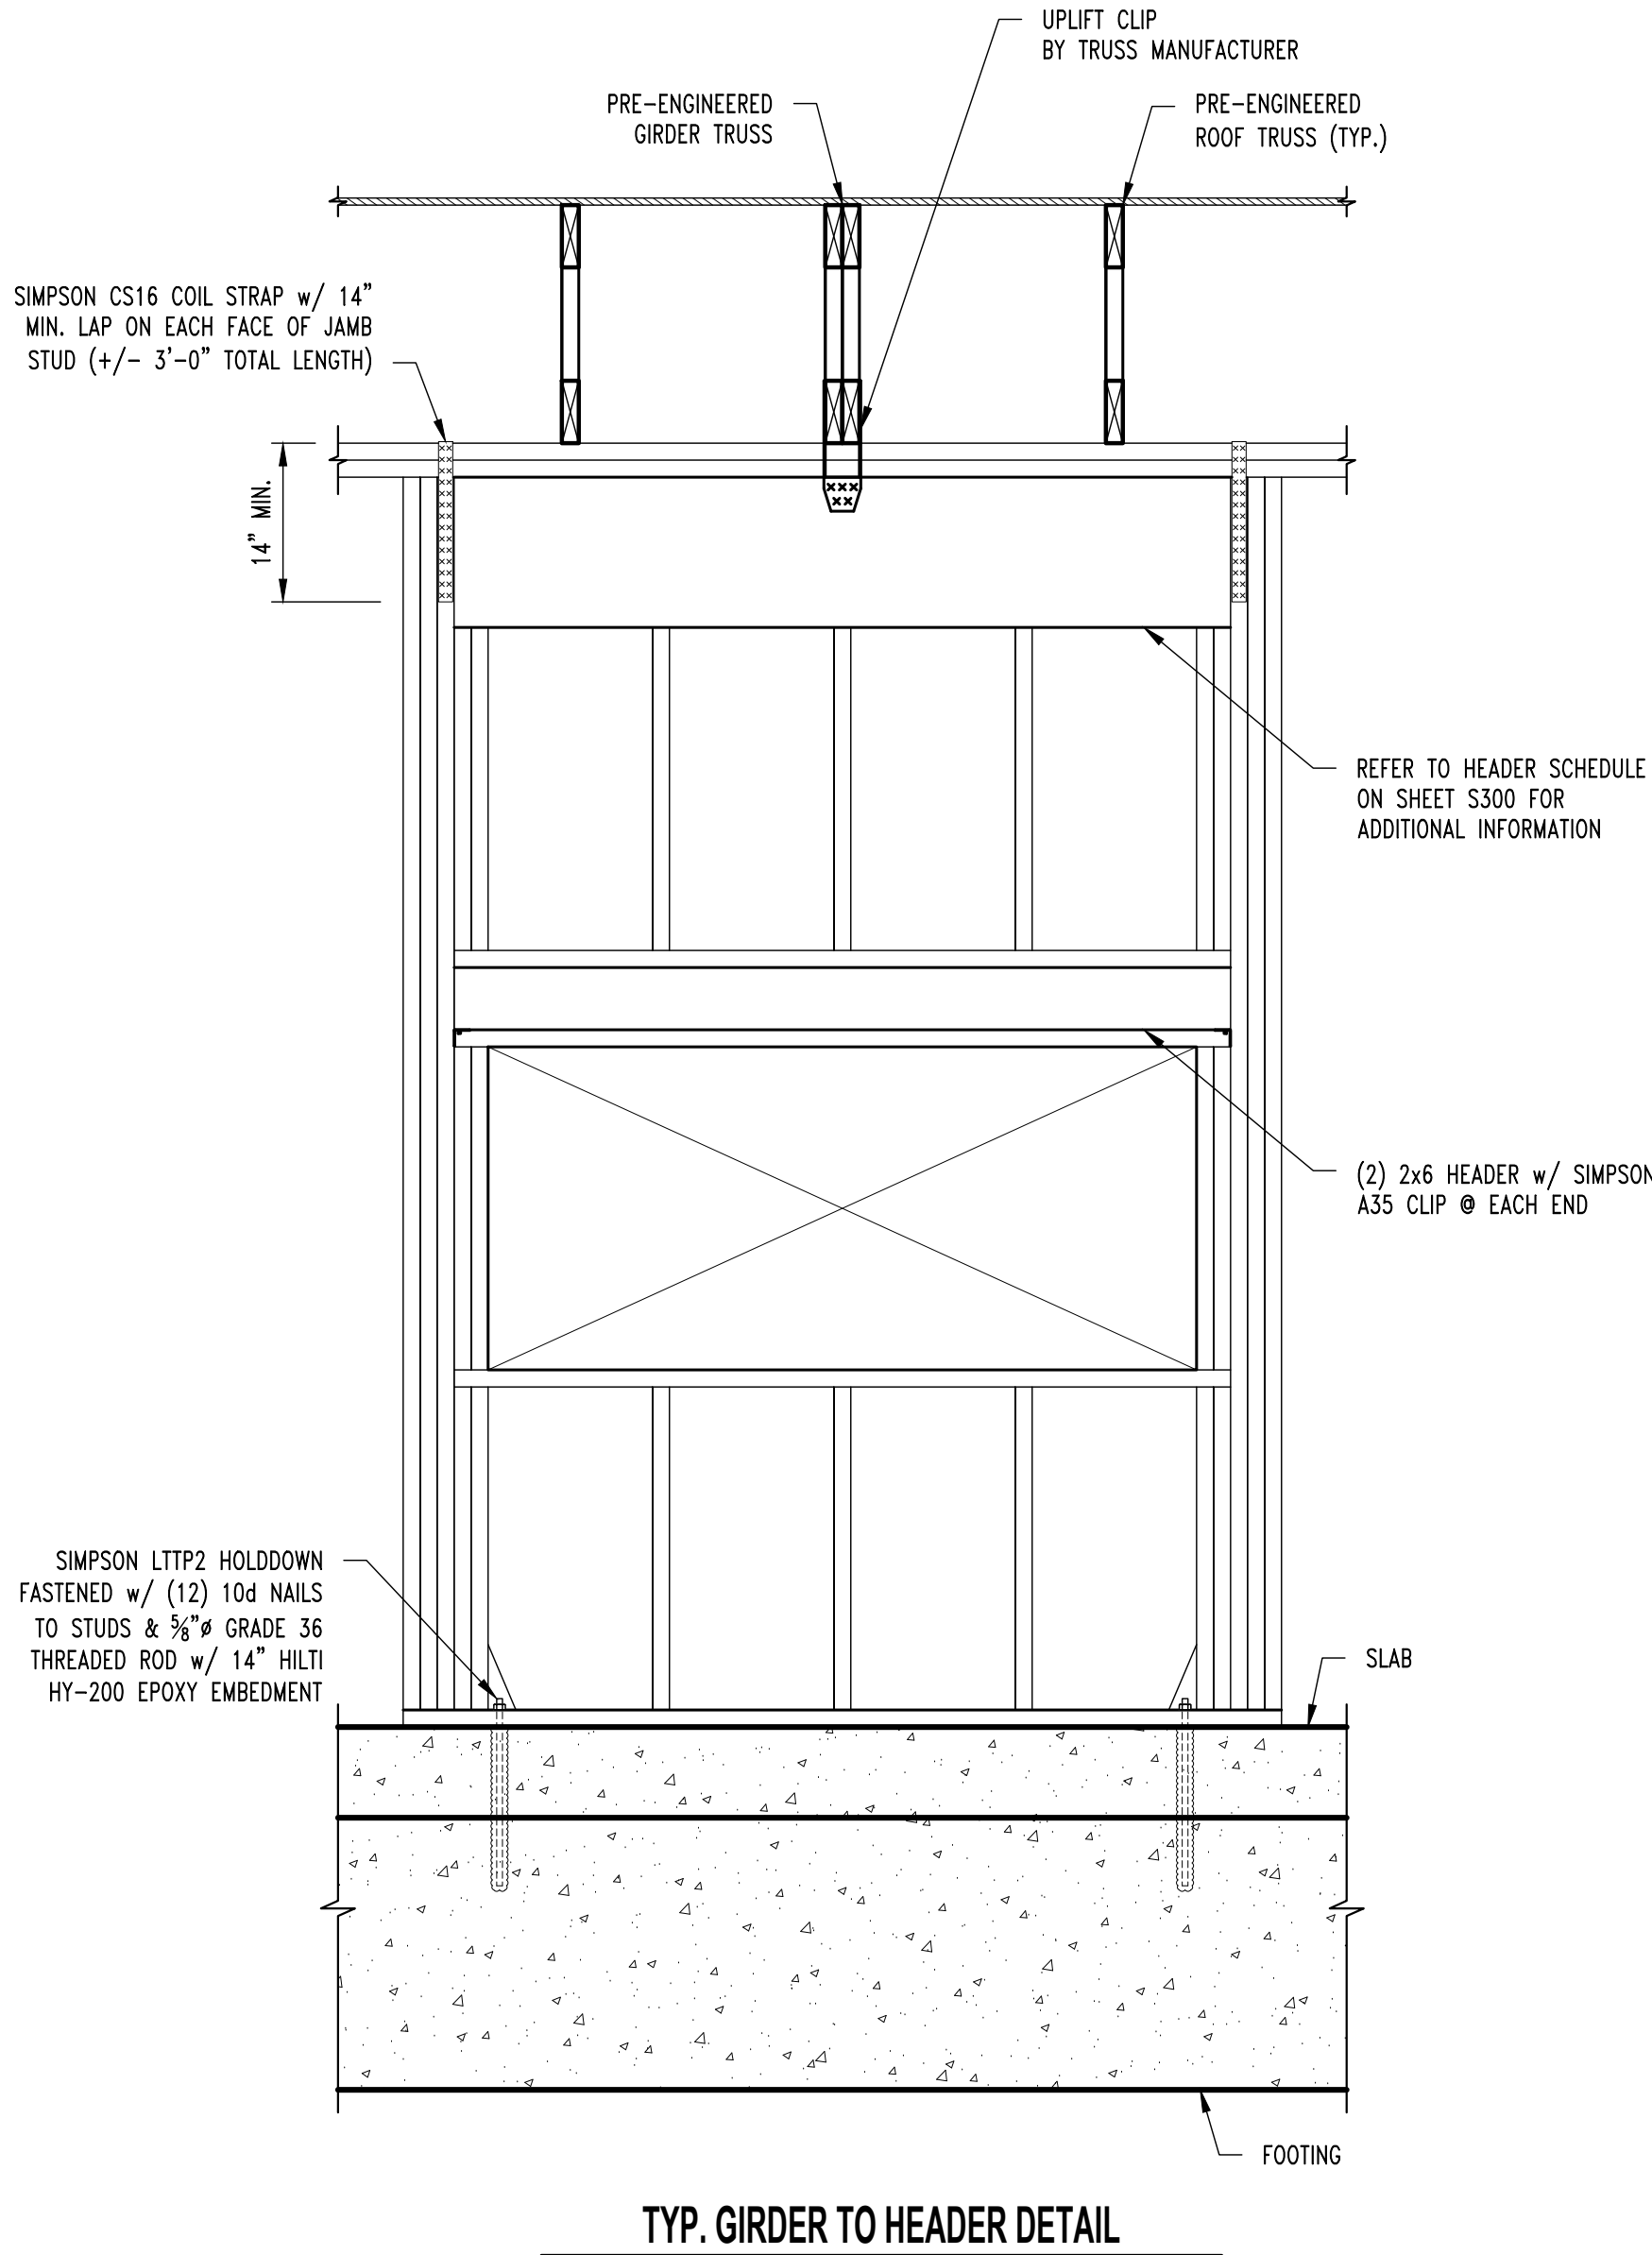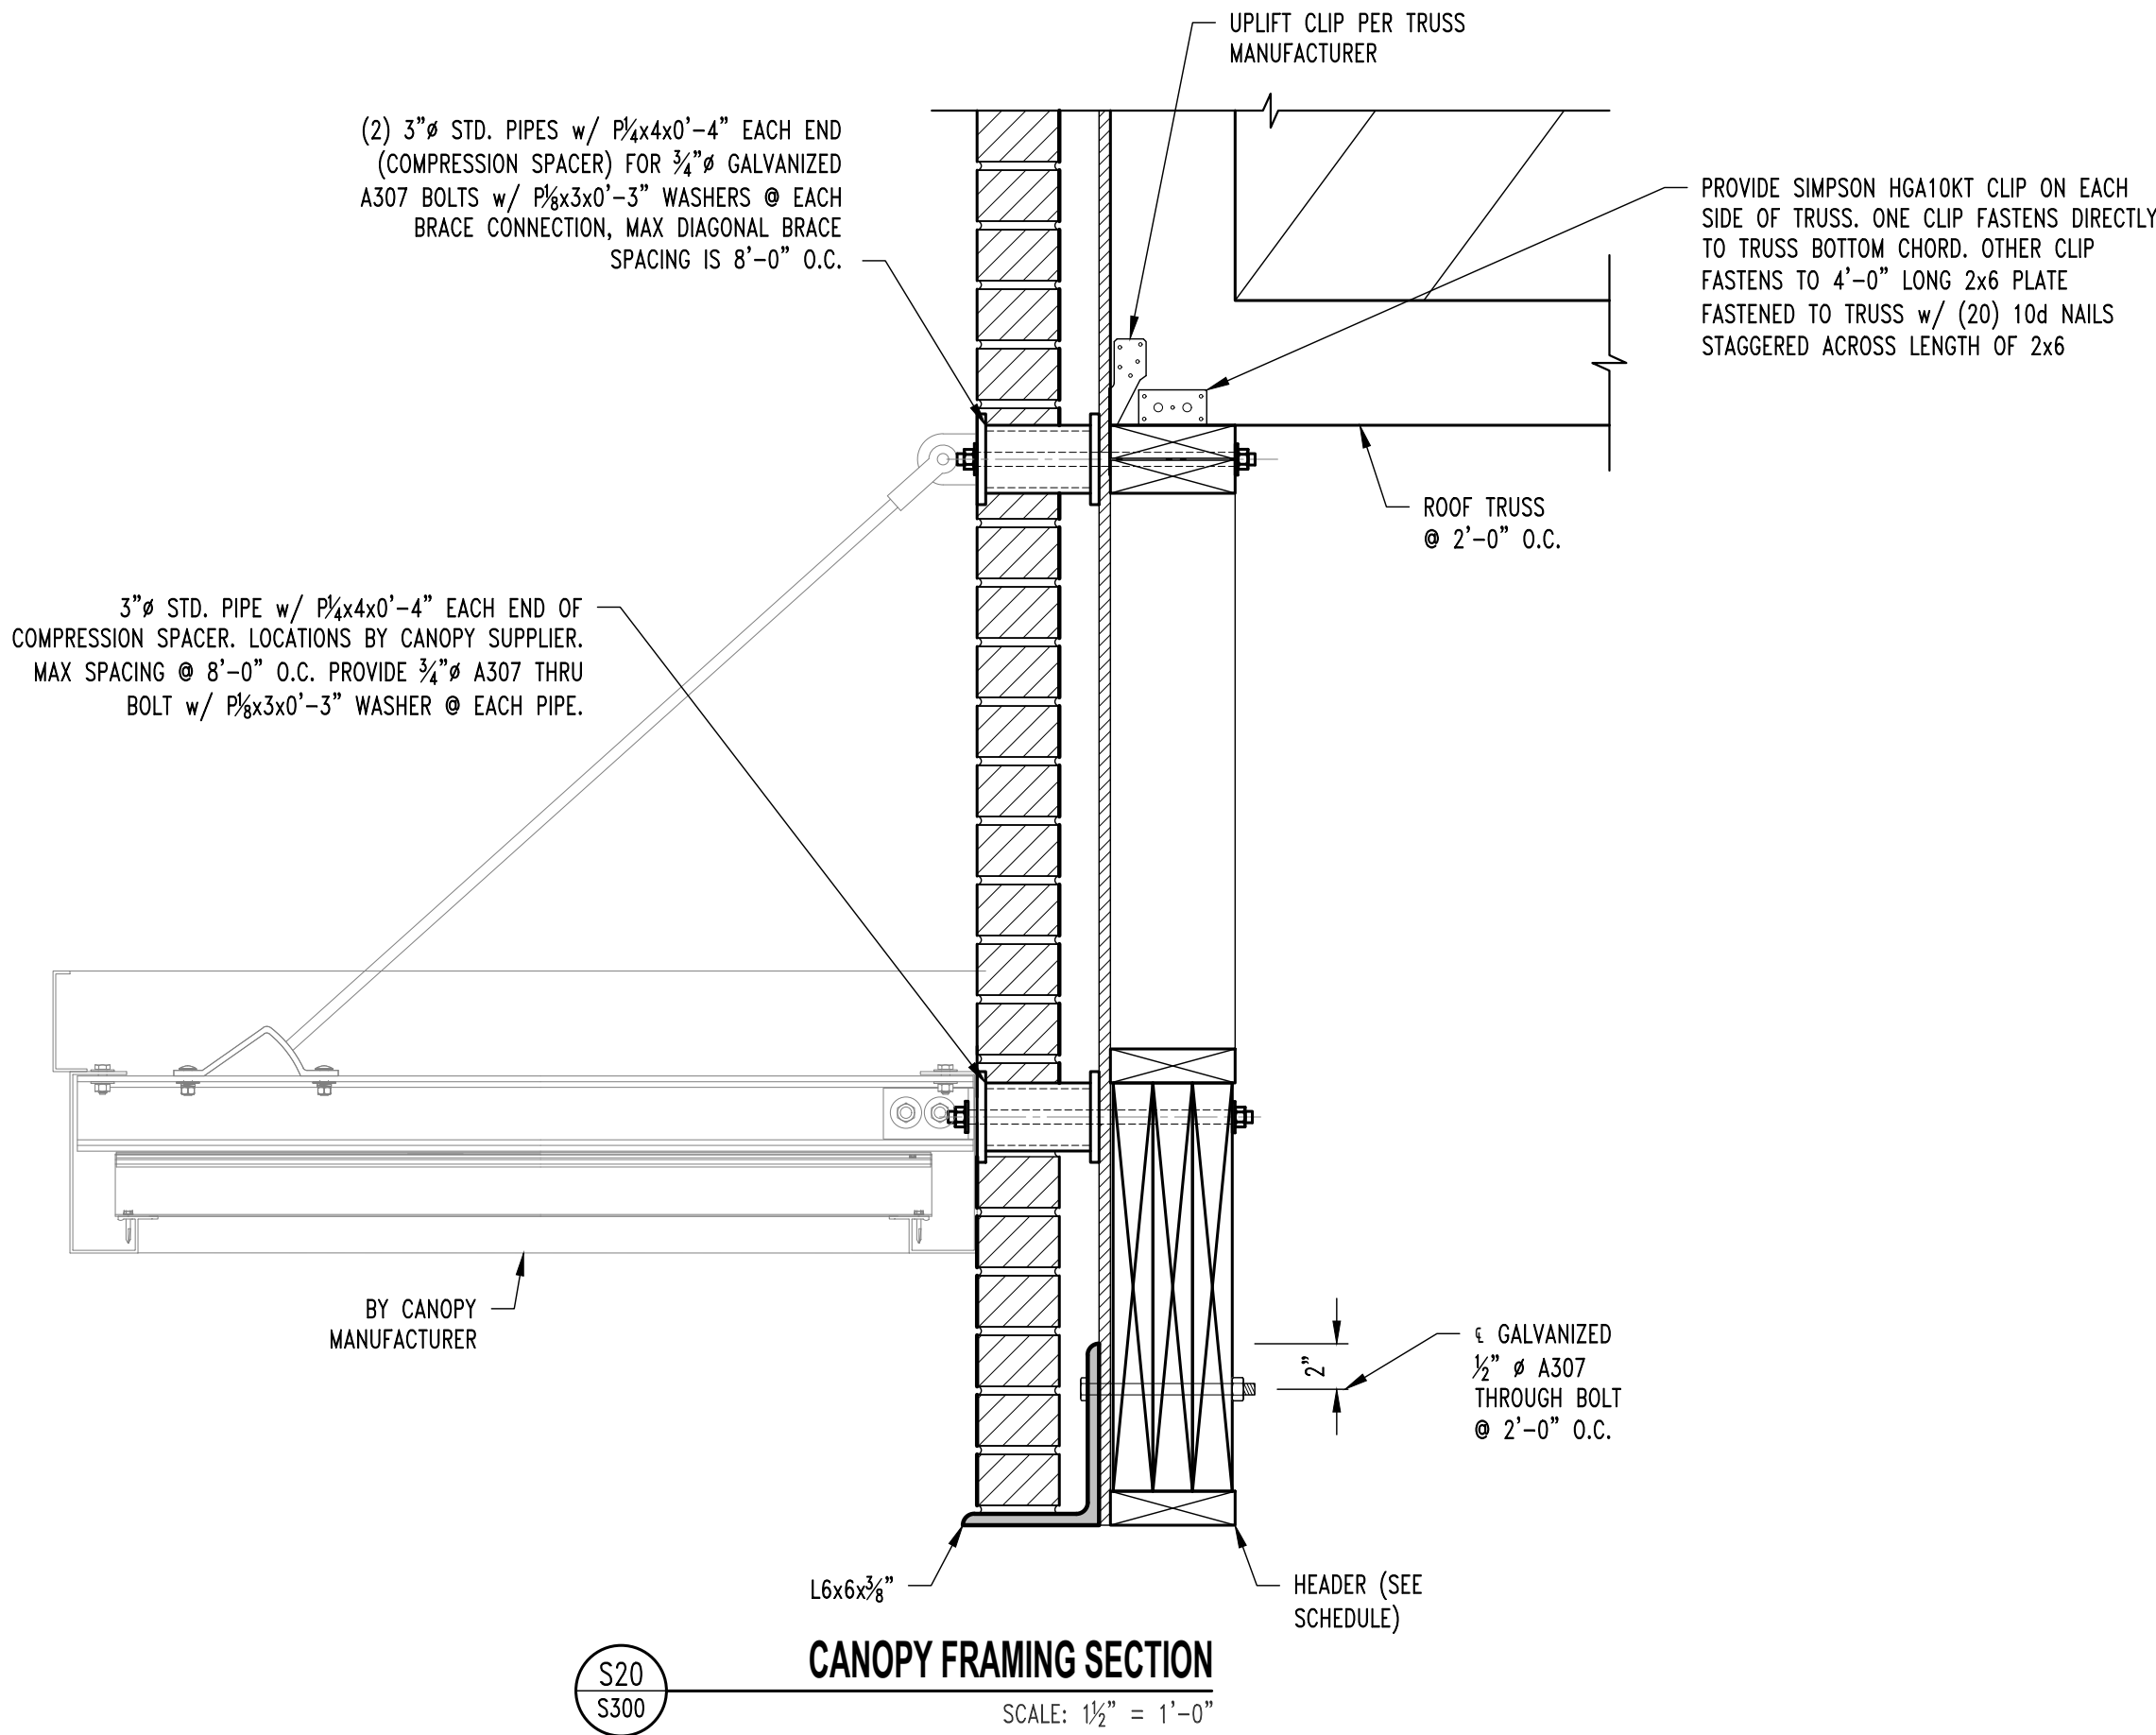

REVISIONS:	
No.	Date
PERMIT SET	09/19/2024

THIS SHEET HAS BEEN SIGNED,
SEALED AND DATED ELECTRONICALLY



STRUCTURAL ENGINEER:
CROCKETT
ENGINEERING CONSULTANTS
1000 W. Nifong Blvd., Suite 1
Columbia, Missouri 65203
(573) 447-0992
www.crockettengineering.com
Crockett Engineering Consultants, LLC
Missouri Certificate of Authority
#200018101

CLIENT:
**INTRINSIC
DEVELOPMENT**
3822 ENDEAVOR AVE. STE. 101
COLUMBIA, MO 65201

DISCOVERY PET SPA
1901 NE TRAILS EDGE BOULEVARD
LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DRAWING INCLUDES:



ROOF FRAMING
DETAILS

DESIGNED: JWV

DRAWN: ELT

PROJECT NO.: 230286

SHEET:
S311

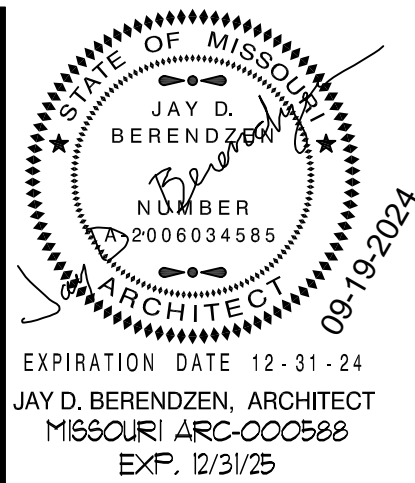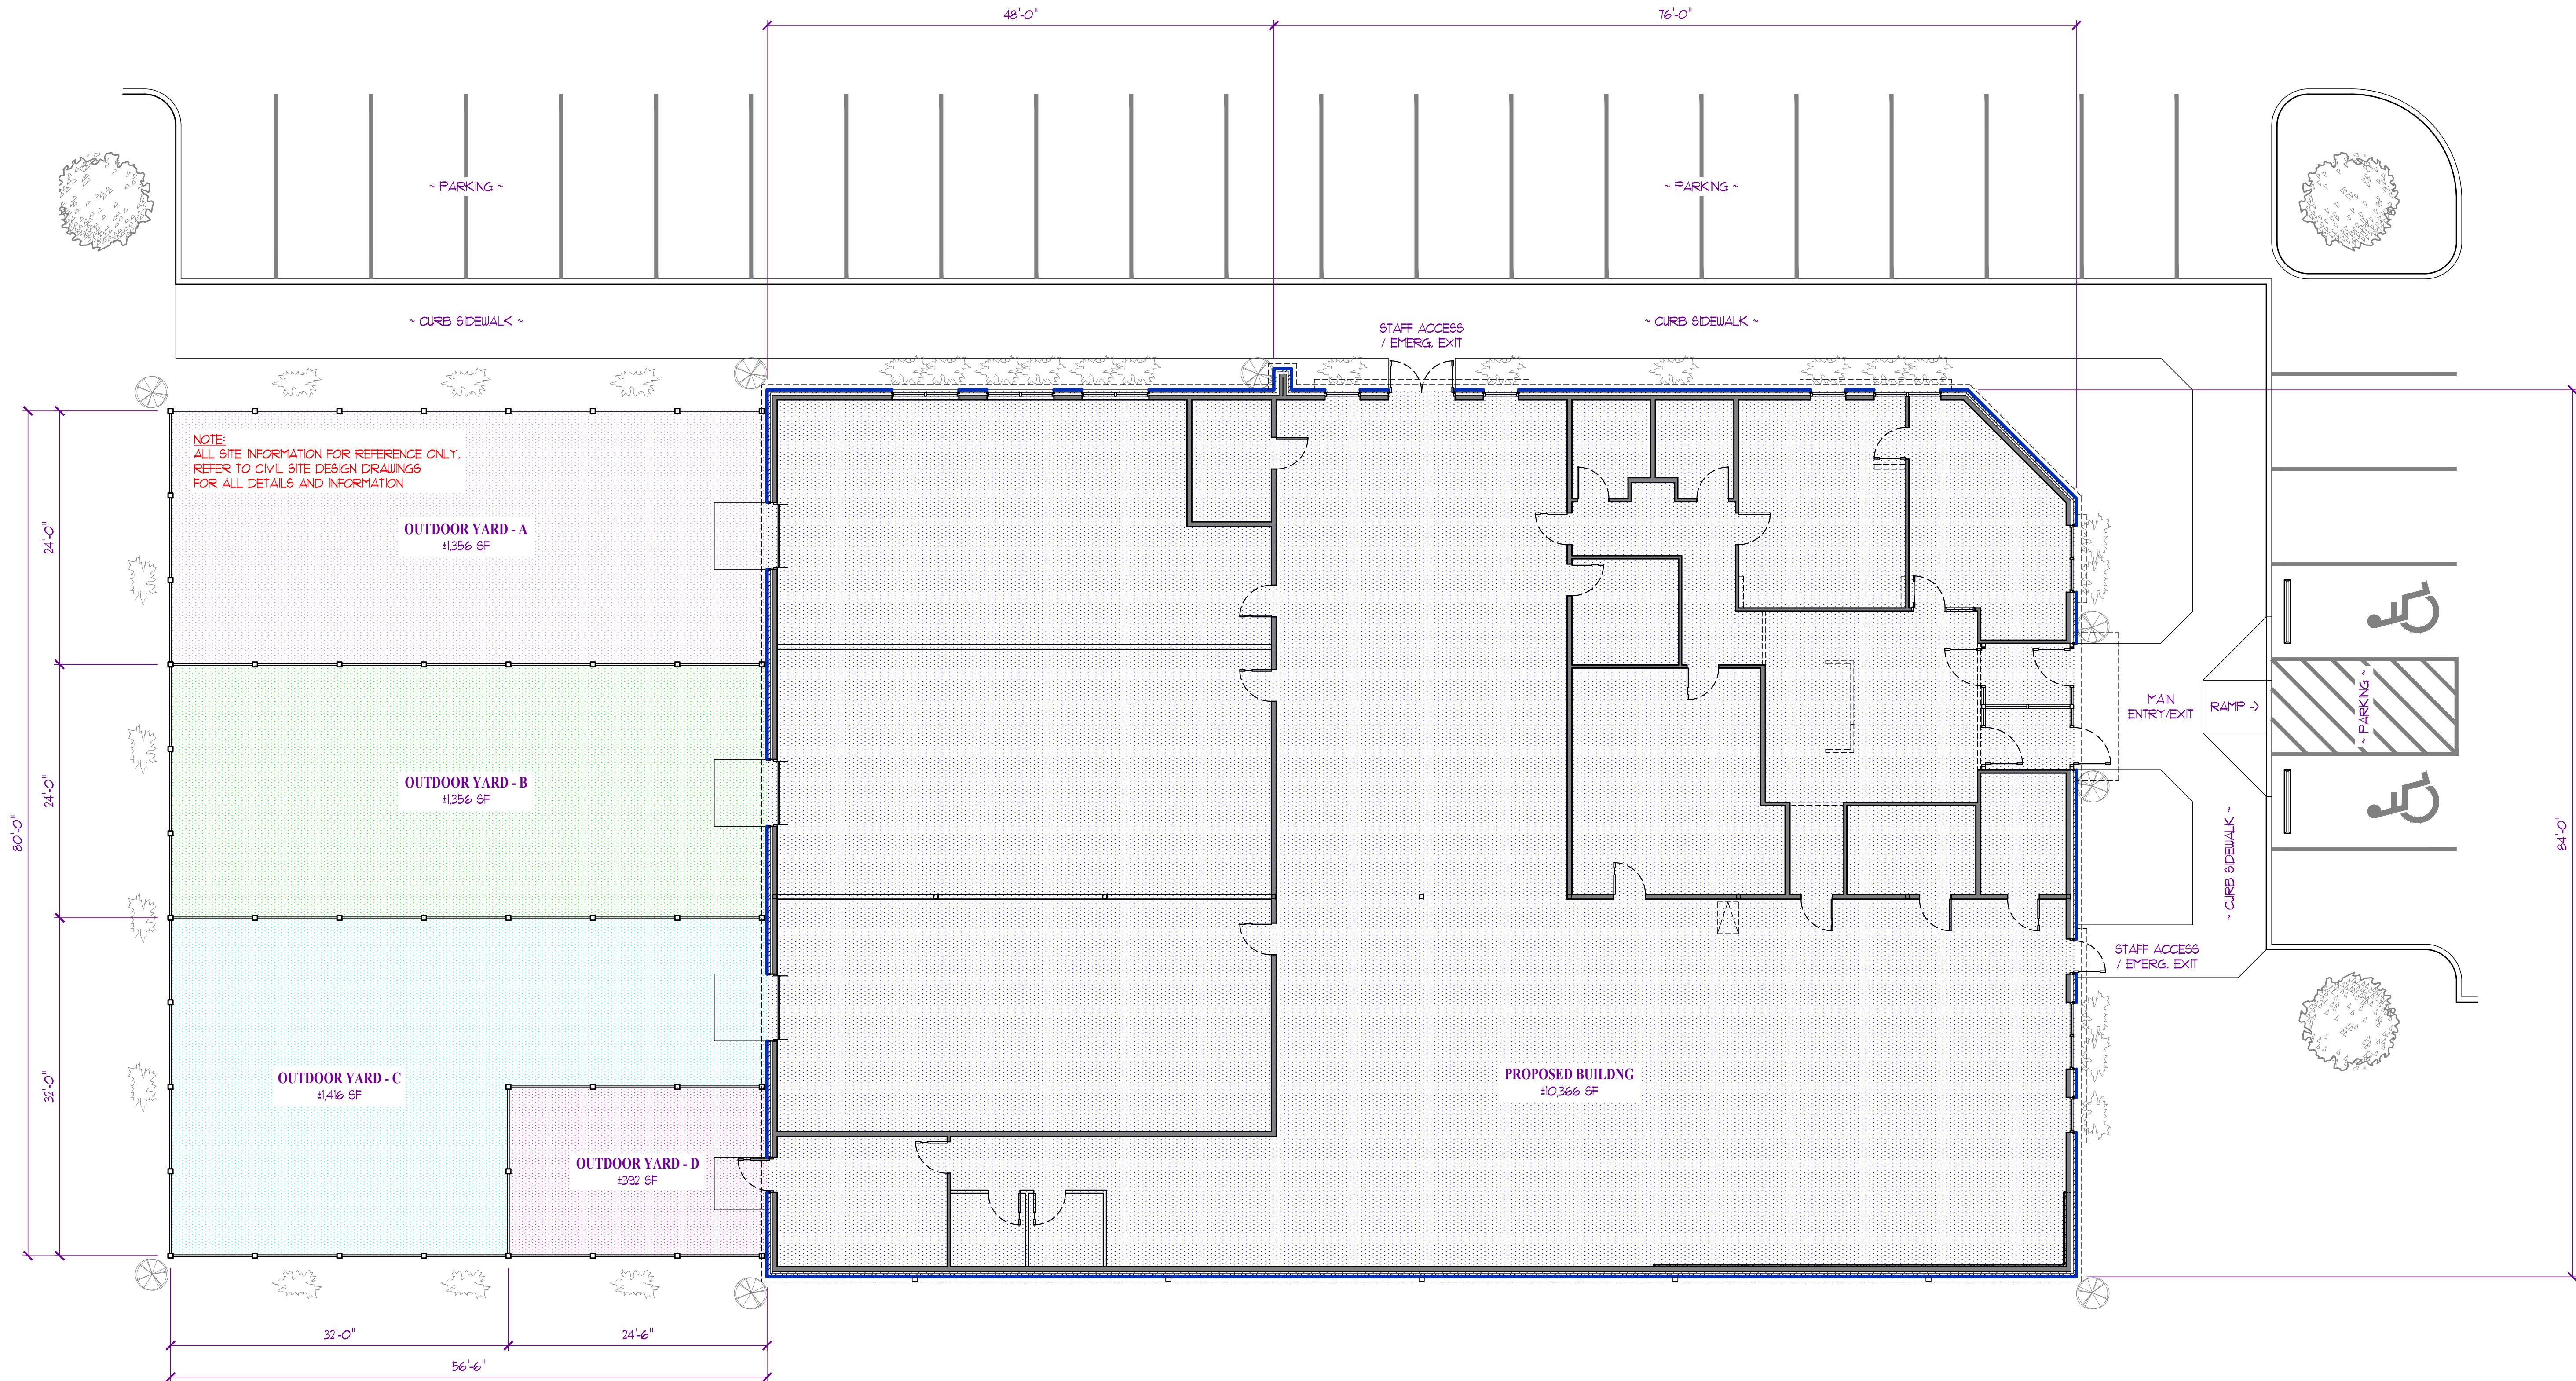

THE PROFESSIONAL ARCHITECT'S SEAL AFFIXED TO THIS SHEET IS VALID FOR THE STATE OF MISSOURI. ALL DRAWINGS, INSTRUMENTS OR OTHER DOCUMENTS NOT EXHIBITING THIS SEAL SHALL BE VOID BY THIS ARCHITECT, AND THIS ARCHITECT EXPRESSLY DISCLAIMS ANY AND ALL LIABILITY FOR ANY ERRORS OR OMISSIONS IN ANY DRAWINGS OR DOCUMENTS NOT EXHIBITING THIS SEAL.

PORTER, BERENDZEN & ASSOCIATES, P.C. ARCHITECTS

200 SOUTH HENRY CLAY BLVD.
P.O. BOX 4146
ASHLAND, MISSOURI 65002

573.651.2022
jag@pba-architects.com

DO NOT SCALE THIS DRAWING. SOME DIMENSIONS MAY VARY FROM SCALE. DIMENSIONS ARE THE PROPERTY OF PORTER, BERENDZEN & ASSOCIATES, P.C. AND MAY NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF PORTER, BERENDZEN & ASSOCIATES, P.C.

Discovery Park

Discovery Pet Spa

1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024


PROJECT NO.
FB2424B

SHEET TITLE

OVERALL
FLOOR PLAN

SHEET NUMBER

A100

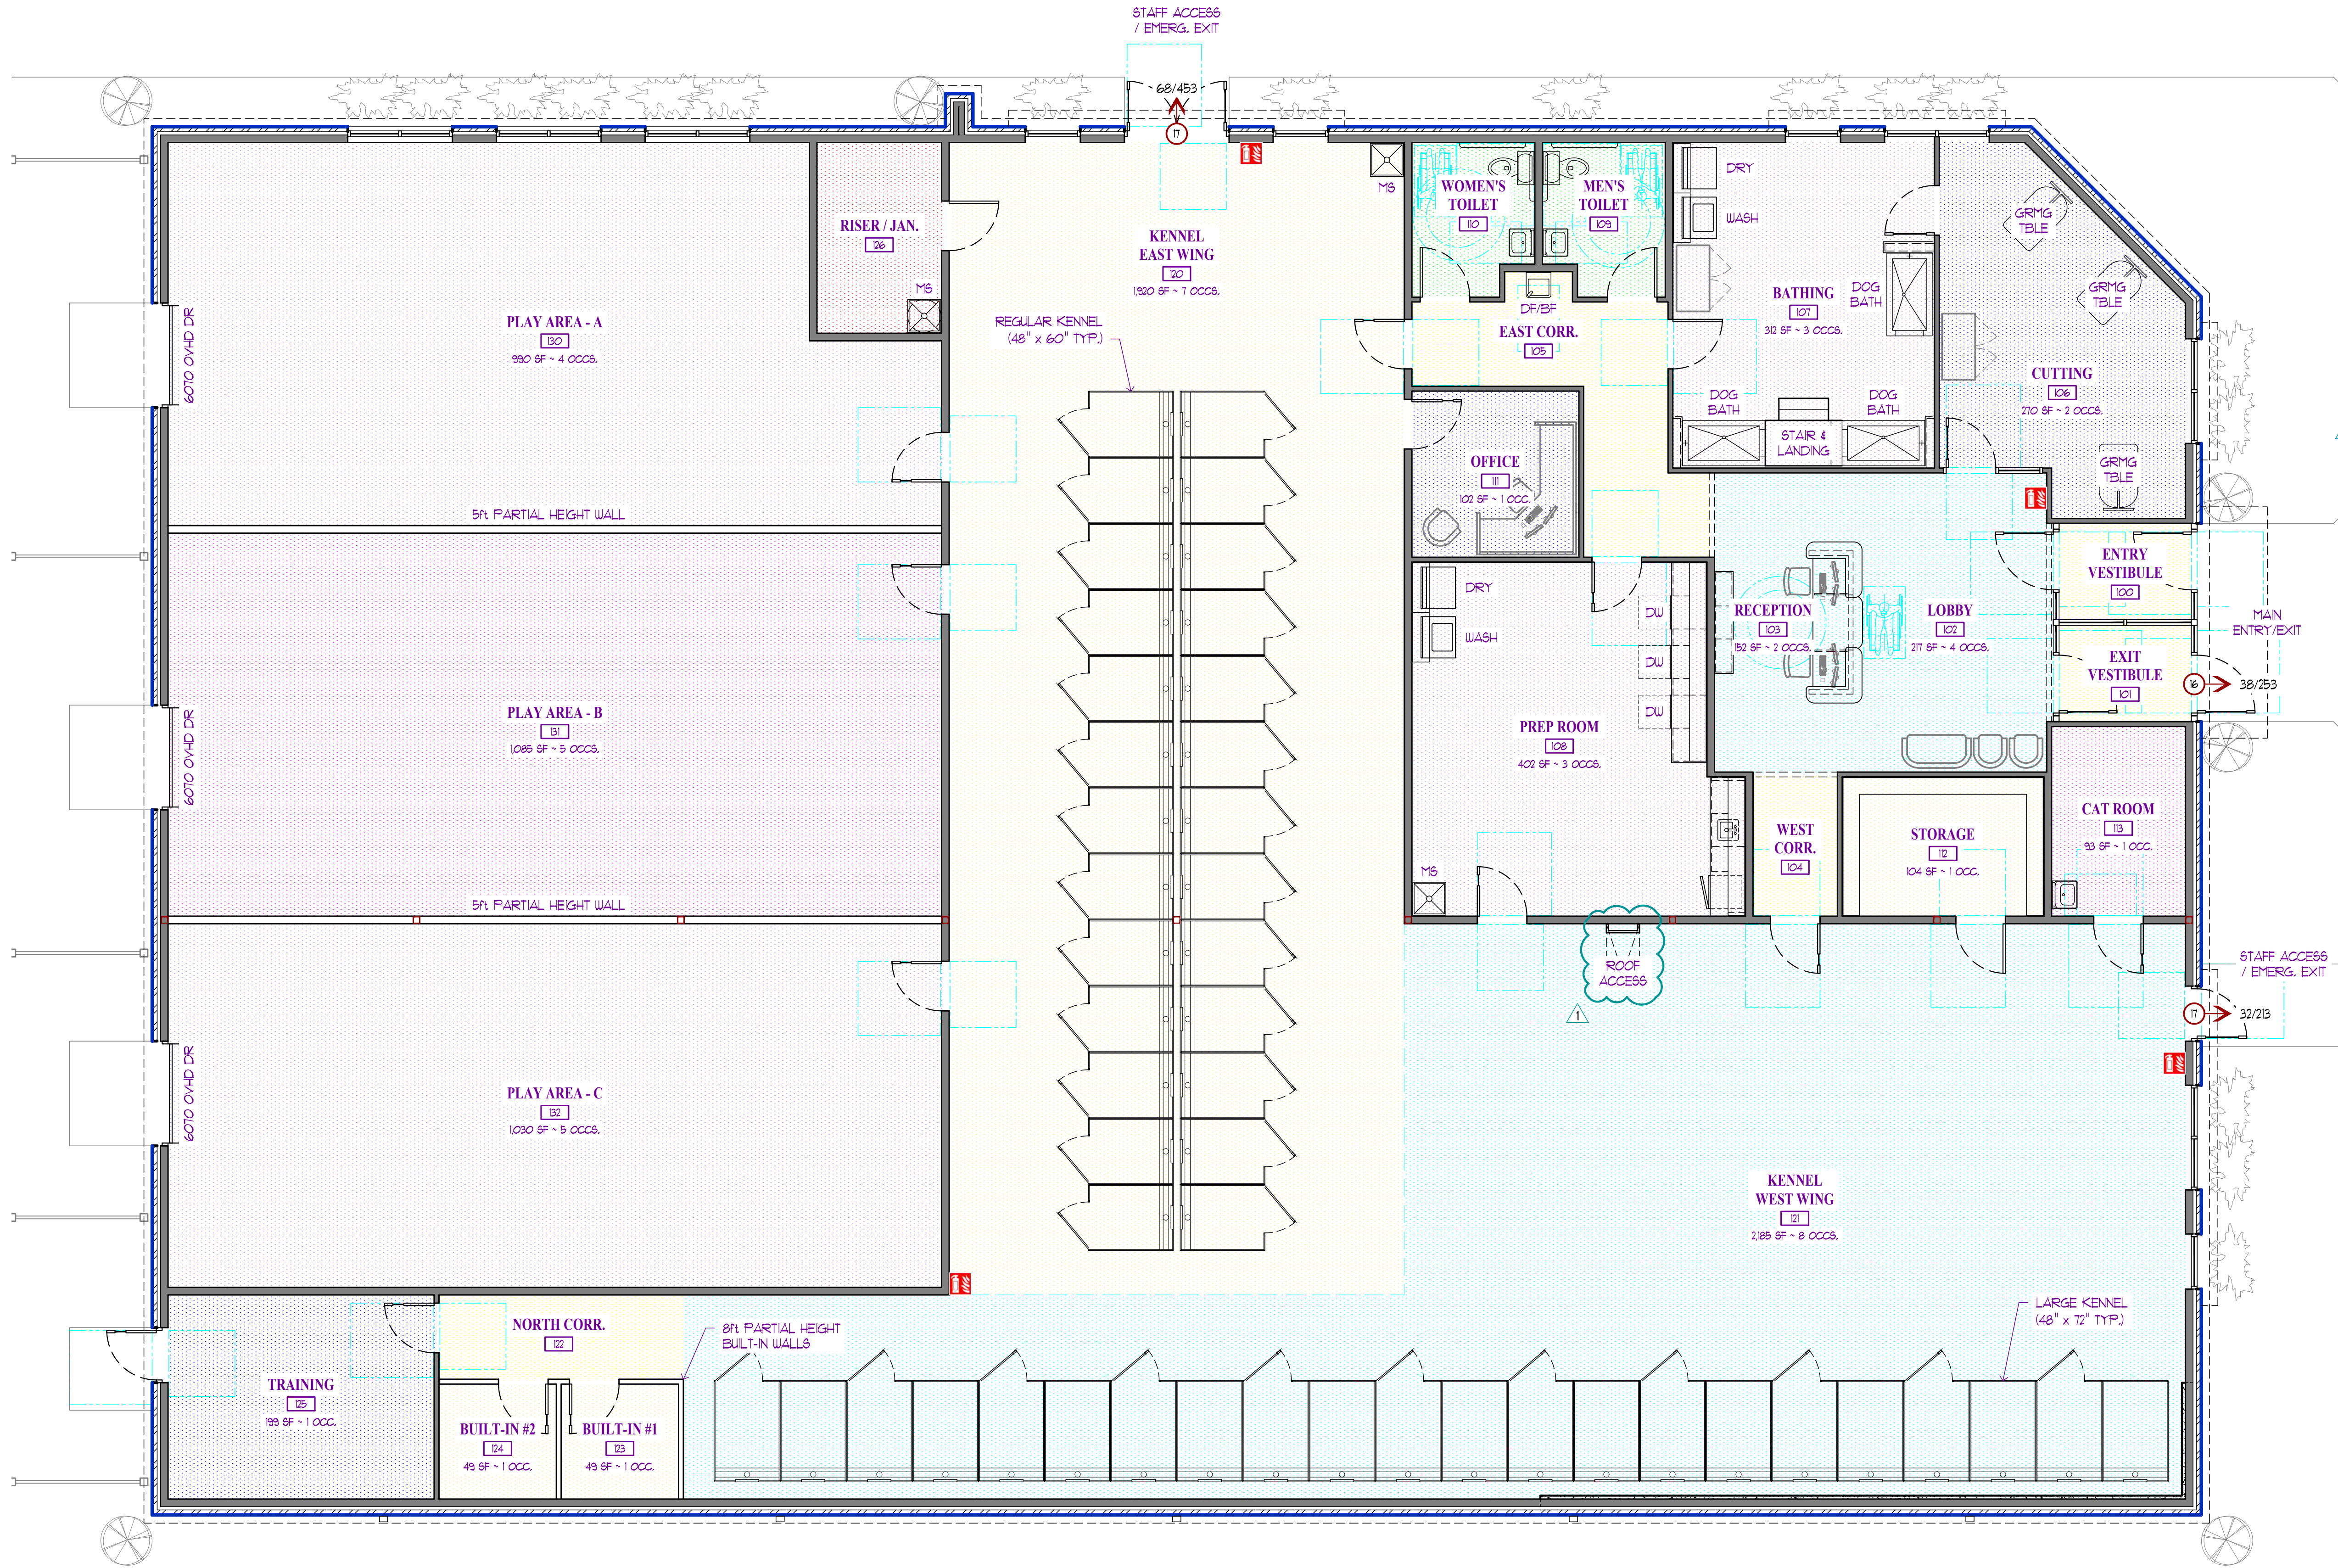

LIFE SAFETY & EGRESS NOTES:

CONSTRUCTION TYPE: TYPE VB - SPRINKLERED

OCCUPANCY: BUSINESS USE OCCUPANCY

BLDG. DESIGN OCCUPANT LOAD: 49 OCCUPANTS
(SEE OCCUPANT LOAD CALCULATION BELOW)

MINIMUM NUMBER OF EXITS REQUIRED = 2 EXITS
PROPOSED EXITS PROVIDED = 3 EXITS

SPACES WITH SINGLE EXIT = 49 OCCS.
75 FEET T.D.

EXIT ACCESS TRAVEL DISTANCE: 300 FEET

EGRESS WIDTH:
REQUIRED = 49 x 0.15' = 7.35"
PROVIDED = 32"


EGRESS DOORS SHALL HAVE A MINIMUM CLEAR OPENING WIDTH OF NOT LESS THAN 32"

EVERY EXIT DOOR SHALL BE OPERABLE FROM THE INSIDE WITHOUT THE USE OF A KEY OR ANY SPECIFIC KNOWLEDGE OR EFFORT.

CORRIDORS:
FIRE RESISTANCE RATING REQUIRED = 0 HOURS
MINIMUM CORRIDOR WIDTH = 44 INCHES
DEAD END CORRIDORS SHALL NOT EXCEED 50 FEET

OCCUPANCY CALCULATIONS

DESIGN LOADING:	
ASSEMBLY UNCONCENTRATED:	1 OCC / 15 SF
OFFICE / BUSINESS:	1 OCC / 150 SF
KENNELS / PLAY ROOMS:	1 OCC / 300 SF
STORAGE / STOCK AREA:	1 OCC / 300 SF
LOBBY 102:	217sf / (4) SEATS = 4 OCCS
RECEPTION 103:	152sf / 150 = 1 OCC
CUTTING 106:	270sf / 150 = 2 OCCS
BATHING 107:	312sf / 150 = 3 OCCS
PREP RM 108:	402sf / 150 = 3 OCCS
OFFICE III:	102sf / 150 = 1 OCC
STORAGE 112:	104sf / 300 = 1 OCC
CAT ROOM 113:	93sf / 300 = 1 OCC
TOTAL OCC LOAD THIS AREA =	17 OCCS
KENNEL BW 120:	1920sf / 300 = 7 OCCS
KENNEL WW 121:	2158sf / 300 = 8 OCCS
BUILT-IN #1 123:	49sf / 300 = 1 OCC
BUILT-IN #2 124:	49sf / 300 = 1 OCC
TRAINING 125:	199sf / 300 = 1 OCC
TOTAL OCC LOAD THIS AREA =	18 OCCS
PLAY "A" 130:	990sf / 300 = 4 OCCS
PLAY "B" 131:	1085sf / 300 = 5 OCCS
PLAY "C" 132:	1030sf / 300 = 5 OCCS
TOTAL OCC LOAD THIS AREA =	14 OCCS
TOTAL BUILDING OCC LOAD =	49 OCCS

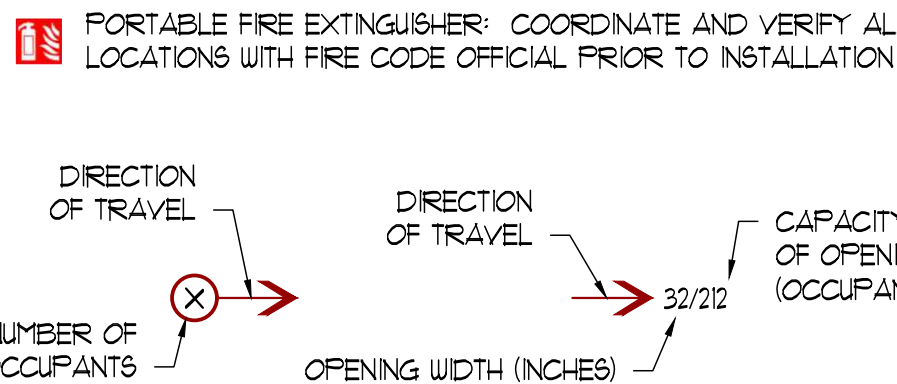

1B FLOOR PLAN / LIFE SAFETY PLAN
SCALE: 3/16" = 1'-0"

JAY D. BERENDZEN

ARCHITECT

2006034588

10-15-2024

EXPIRATION DATE 12-31-24

JAY D. BERENDZEN, ARCHITECT

MISSOURI ARC-000588

EXP. 12/31/25

THE PROFESSIONAL ARCHITECT'S SEAL APPLIED TO THIS SHEET IS VALID FOR THE STATE OF MISSOURI. ALL DRAWINGS NOT EXEMPT FROM THE REQUIREMENTS OF THE ARCHITECT ACT AND THE ARCHITECT ACT. EXCESSIVE DISCREPANCIES OR PLAN DRAWINGS OR DOCUMENTS NOT EXHIBITING THIS SEAL.

PORTER, BERENDZEN & ASSOCIATES, P.C. ARCHITECTS

575.657.2022 PHONE

575.657.2022 FAX

200 SOUTH HENRY CLAY BLVD.

P.O. BOX 11660

JASLAND, MISSOURI 6500

Discovery Park

Discovery Pet Spa

1921 NE Trails Edge Boulevard

Lee's Summit, Jackson County, Missouri

ISSUE

ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024
2	REVISION #1	10/14/2024

PROJECT NO.

FB24248


SHEET TITLE

FLOOR PLAN

LIFE SAFETY PLAN


SHEET NUMBER

A101

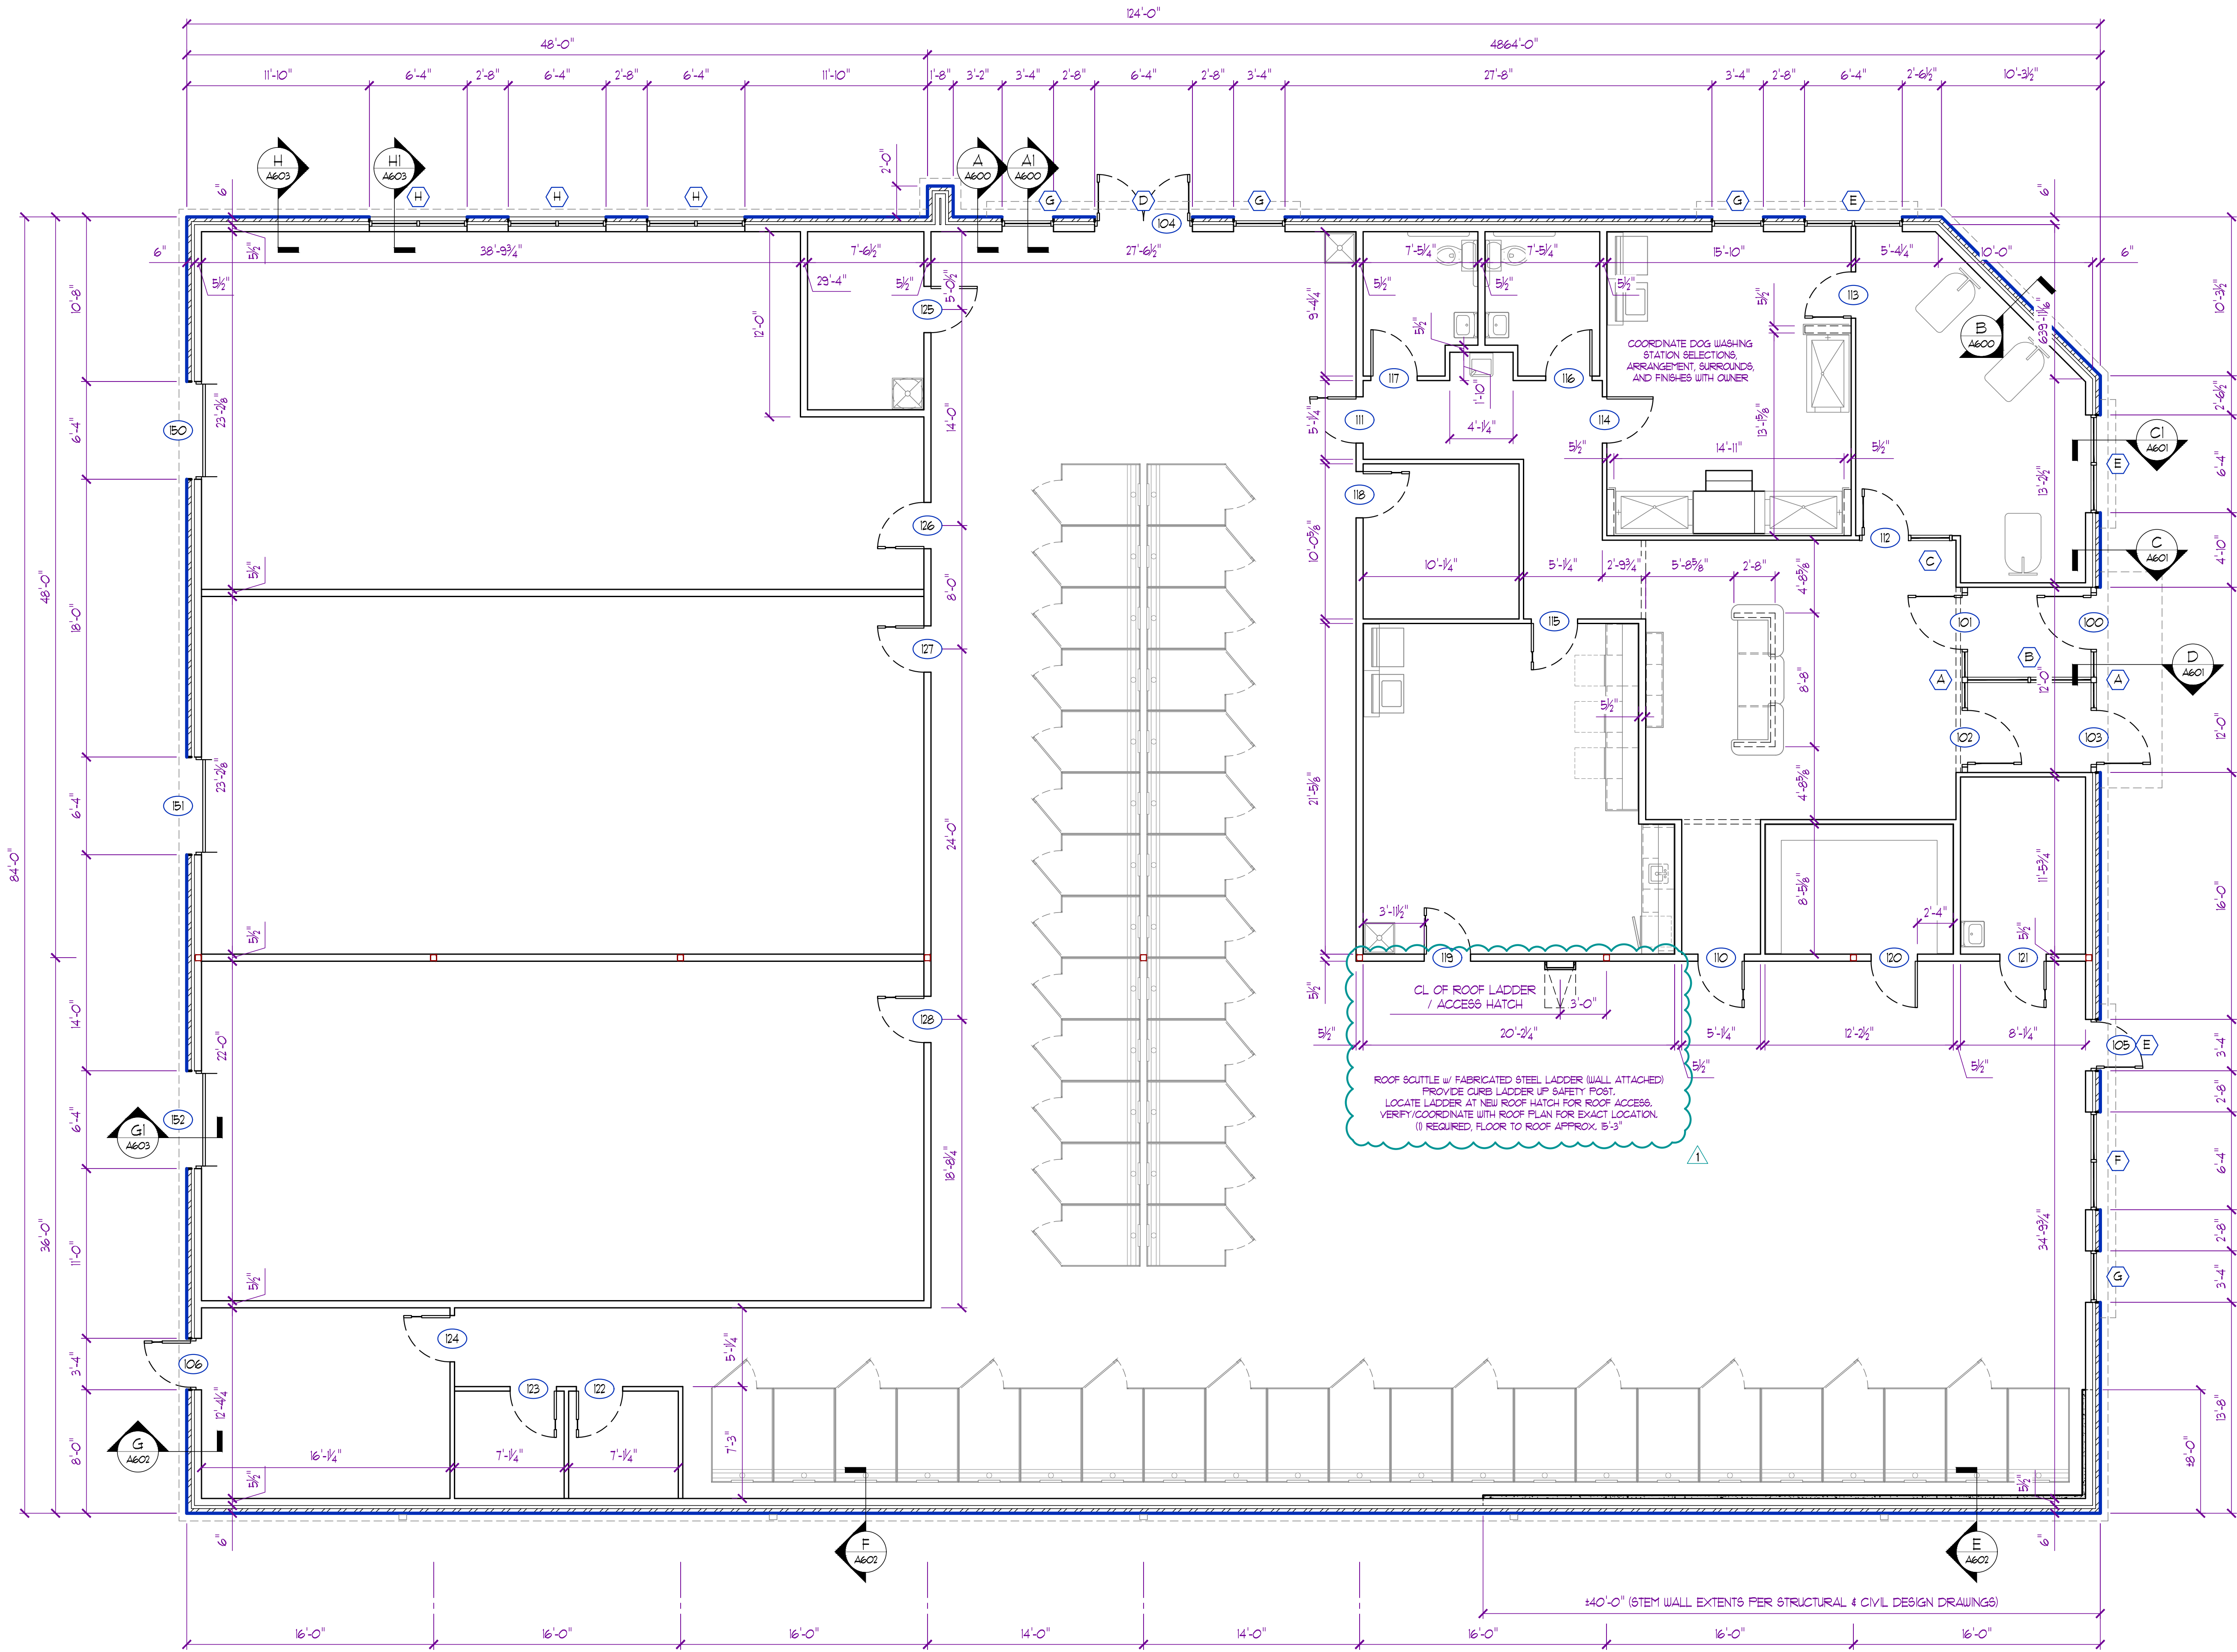

2 DIMENSIONAL PLAN
SCALE: 3/8" = 1'-0"

- FLOOR PLAN GENERAL NOTES:**
- ALL WORK SHALL CONFORM TO ALL STATE, LOCAL, AND/OR ANY AUTHORITY HAVING JURISDICTION.
 - ALL DIMENSIONS SHOWN ARE TO FACE OF MASONRY / STUD OR CENTERLINE OF COLUMN / BEAM UNLESS NOTED OTHERWISE.
 - ALL INTERIOR WALL PARTITIONS ARE TO BE 2x4 WOOD STUD FRAMING @ 16" O.C. MAX. w/ 5/8" GYPSUM BOARD ON EACH SIDE UNLESS NOTED OTHERWISE.
 - INTERIOR WALLS & GYPSUM BOARD TO EXTEND A MIN. OF 6" ABOVE FINISH CEILING. (SEE A300 FOR WALL HEIGHT DIAGRAM)
 - CONTRACTOR TO PROVIDE TEMPORARY & PERMANENT BRACING AS REQUIRED. INTERIOR PARTITIONS TO HAVE DIAGONAL BRACING TO STRUCTURE @ 4'-0" O.C. WHERE APPLICABLE.
 - ALL DOORS TO HAVE A MIN. OF 6" FROM HINGE JAMB TO ADJACENT WALL OR CENTERED IN ROOM / WALL UNLESS NOTED OTHERWISE.
 - INSTALL 4" ACOUSTICAL BATT INSULATION ON CEILING A MIN. OF 24" FROM COMMON WALLS FOR ADDITIONAL SOUND DEADENING AS NECESSARY. (COORDINATE LOCATIONS WITH OWNER / TENANT)
 - ALL EQUIPMENT, APPLIANCES, & FURNITURE SHOWN FOR REFERENCE ONLY. (VERIFY & COORDINATE EQUIPMENT PRIOR TO ANY WORK)
 - SEE STOREFRONT DETAILS ON SHEET A700 FOR REMAINING INFO.
 - SEE ROOM FINISH SCHEDULE ON SHEET A300 FOR REMAINING INFO.

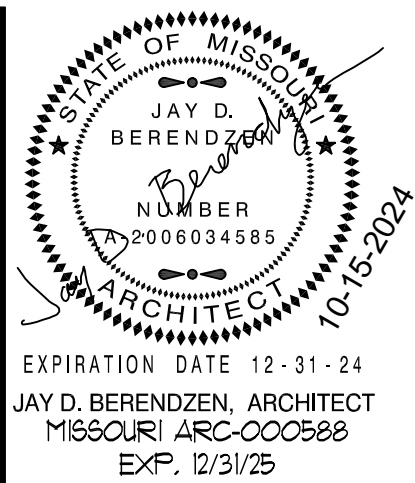

THE PROFESSIONAL ARCHITECT'S SEAL APPLIED TO THIS SHEET IS VALID FOR THE STATE OF MISSOURI. ALL OTHER DIMENSIONS, NOTES, AND/OR SPECIFICATIONS ON THIS SHEET ARE THE PROPERTY OF PORTER, BERENDZEN & ASSOCIATES, P.C. AND MAY NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF PORTER, BERENDZEN & ASSOCIATES, P.C.

PORTER, BERENDZEN & ASSOCIATES, P.C. ARCHITECTS
200 SOUTH HENRY CLAY BLVD.
P.O. BOX 116603
JACKSON, MISSOURI 64500
573.651.2022
jag@pberendzen.com

DO NOT SCALE THIS DRAWING. SOME DIMENSIONS MAY VARY FROM SCALE. DIMENSIONS ARE THE PROPERTY OF PORTER, BERENDZEN & ASSOCIATES, P.C. AND MAY NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT
Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE	ID	DESCRIPTION	DATE
	1	PERMIT	9/19/2024
	2	REVISION #1	10/14/2024


PROJECT NO.
FB242418
SHEET TITLE

DIMENSIONAL PLAN

SHEET NUMBER

RCP GENERAL NOTES:


- SEE ROOM FINISH SCHEDULE ON SHEET A300 FOR ADDITIONAL INFORMATION.
- FOR REFERENCE ONLY. TRADE CONTRACTOR TO VERIFY LOCATION OF ALL CEILING FEATURES AND CEILING MOUNTED EQUIPMENT & FIXTURES.
- REFER TO MECHANICAL-ELECTRICAL-PLUMBING DRAWINGS FOR EXACT EQUIPMENT AND LIGHTING PLACEMENT AND SPECIFICATIONS.
- METAL SUSPENSION SYSTEMS & ACOUSTICAL TILE SHALL BE INSTALLED IN ACCORDANCE WITH IBC 2018.
- GENERAL CONTRACTOR SHALL VERIFY & COORDINATE CEILING HEIGHTS WITH ALL TRADES PRIOR TO INSTALLATION. ANY ADJUSTMENTS SHALL BE COORDINATED WITH OWNER AND GENERAL CONTRACTOR.
- CEILING TILES AND GRIDWORK TO BE CENTERED IN BOTH DIRECTIONS FOR EVERY ROOM OR SPACE UNLESS OTHERWISE DIMENSIONED.
- LIGHTING FIXTURES AND AIR DIFFUSERS SHALL BE SUPPORTED DIRECTLY BY WIRES TO THE STRUCTURE ABOVE.
- ALL DIMENSIONS TO THE FINISHED FACE OF WALL OR CENTERLINE OF CEILING GRID UNLESS NOTED OTHERWISE.

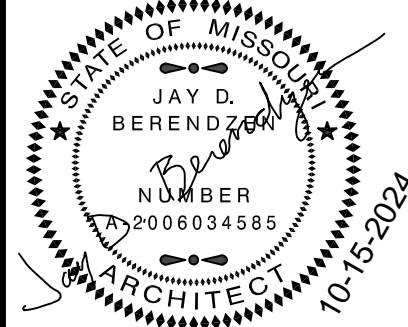

EXPIRATION DATE 12-31-24
JAY D. BERENDZEN, ARCHITECT
MISSOURI ARC-000588
EXP. 12/31/25

THE PROFESSIONAL ARCHITECT'S SEAL AFFIXED TO THIS SHEET IS VALID FOR THE PROJECT AND THIS BUILDING ONLY. ALL DRAWINGS, INSTRUMENTS OR OTHER DOCUMENTS NOT EXHIBITING THIS SEAL ARE NOT TO BE USED. THE ARCHITECT EXPRESSLY DISCLAIMS ANY AND ALL LIABILITY FOR ANY ERRORS OR OMISSIONS IN THIS PLAN DRAWING OR DOCUMENTS NOT EXHIBITING THIS SEAL.

PORTER, BERENDZEN
& ASSOCIATES, P.C.
ARCHITECTS
575.651.2022 PHONE
jag@pba-architects.com
200 SOUTH HENRY CLAY BLVD.
P.O. BOX 116600
ASHLAND, MISSOURI 6500

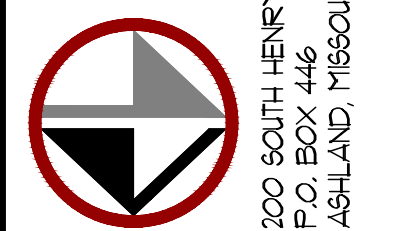

DO NOT SCALE THIS DRAWING. SOME DEVIATION FROM SCALE MAY OCCUR FROM REPRODUCTION. DRAWINGS ARE THE PROPERTY OF PORTER, BERENDZEN & ASSOCIATES, P.C. AND MAY NOT BE COPIED OR USED IN WHOLE OR PART WITHOUT THE WRITTEN CONSENT OF PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT

Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024
2	REVISION #1	10/14/2024


PROJECT NO.
FB2424B

SHEET TITLE

REFLECTED
CEILING PLAN

SHEET NUMBER

A301

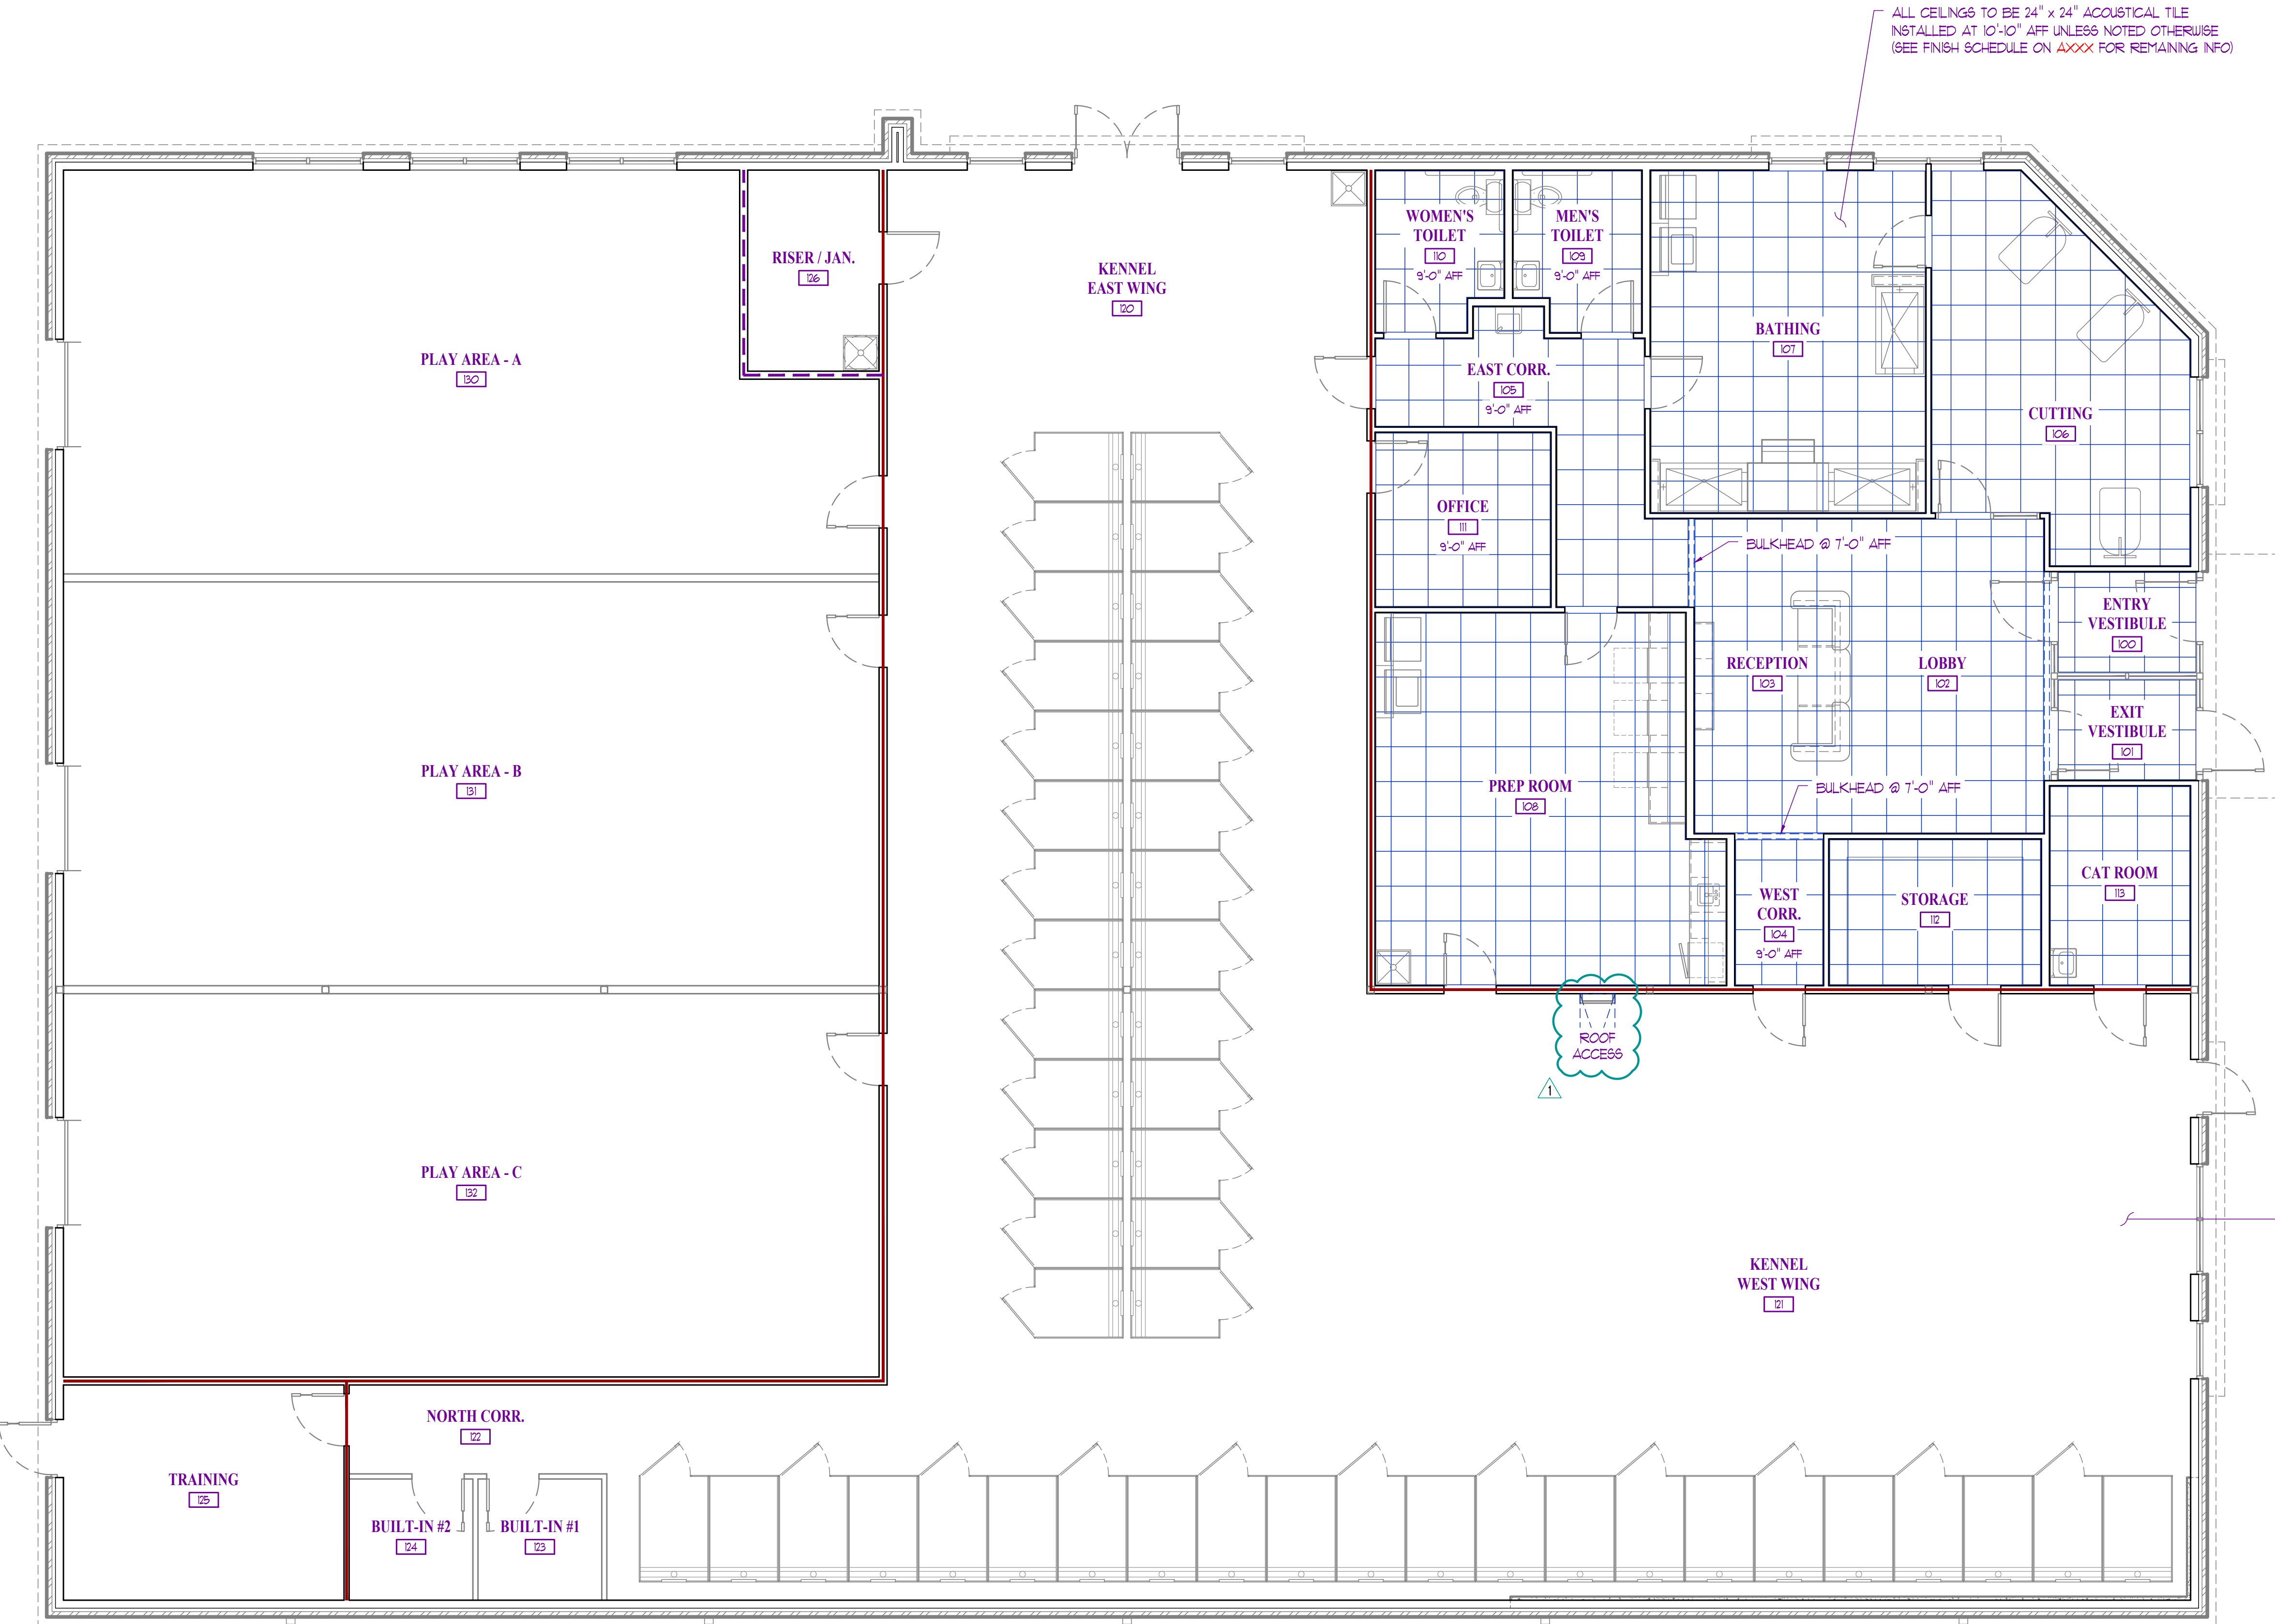


ALL CEILINGS TO BE 24" x 24" ACOUSTICAL TILE
INSTALLED AT 10'-10" AFF UNLESS NOTED OTHERWISE
(SEE FINISH SCHEDULE ON AXXX FOR REMAINING INFO)

REMAINING AREAS TO HAVE EXPOSED STRUCTURE.
ALL WALLS, TRUSSES, BRACING, PIPING, ETC.
ABOVE 12ft AFF TO BE PAINTED GRAY
(TYPICAL UNLESS NOTED OTHERWISE)


3 REFLECTED CEILING PLAN
SCALE: 3/8" = 1'-0"

INDICATES FRAMING & GYPSUM BOARD TO TERMINATE
AT LONG LEG DEFLECTION TRACK BELOW ROOF LID / STRUCTURE
INSTALL SOUND BATT FULL HEIGHT OF WALL

INDICATES FRAMING & GYPSUM BOARD TO TERMINATE
AT LONG LEG DEFLECTION TRACK BELOW ROOF LID / STRUCTURE

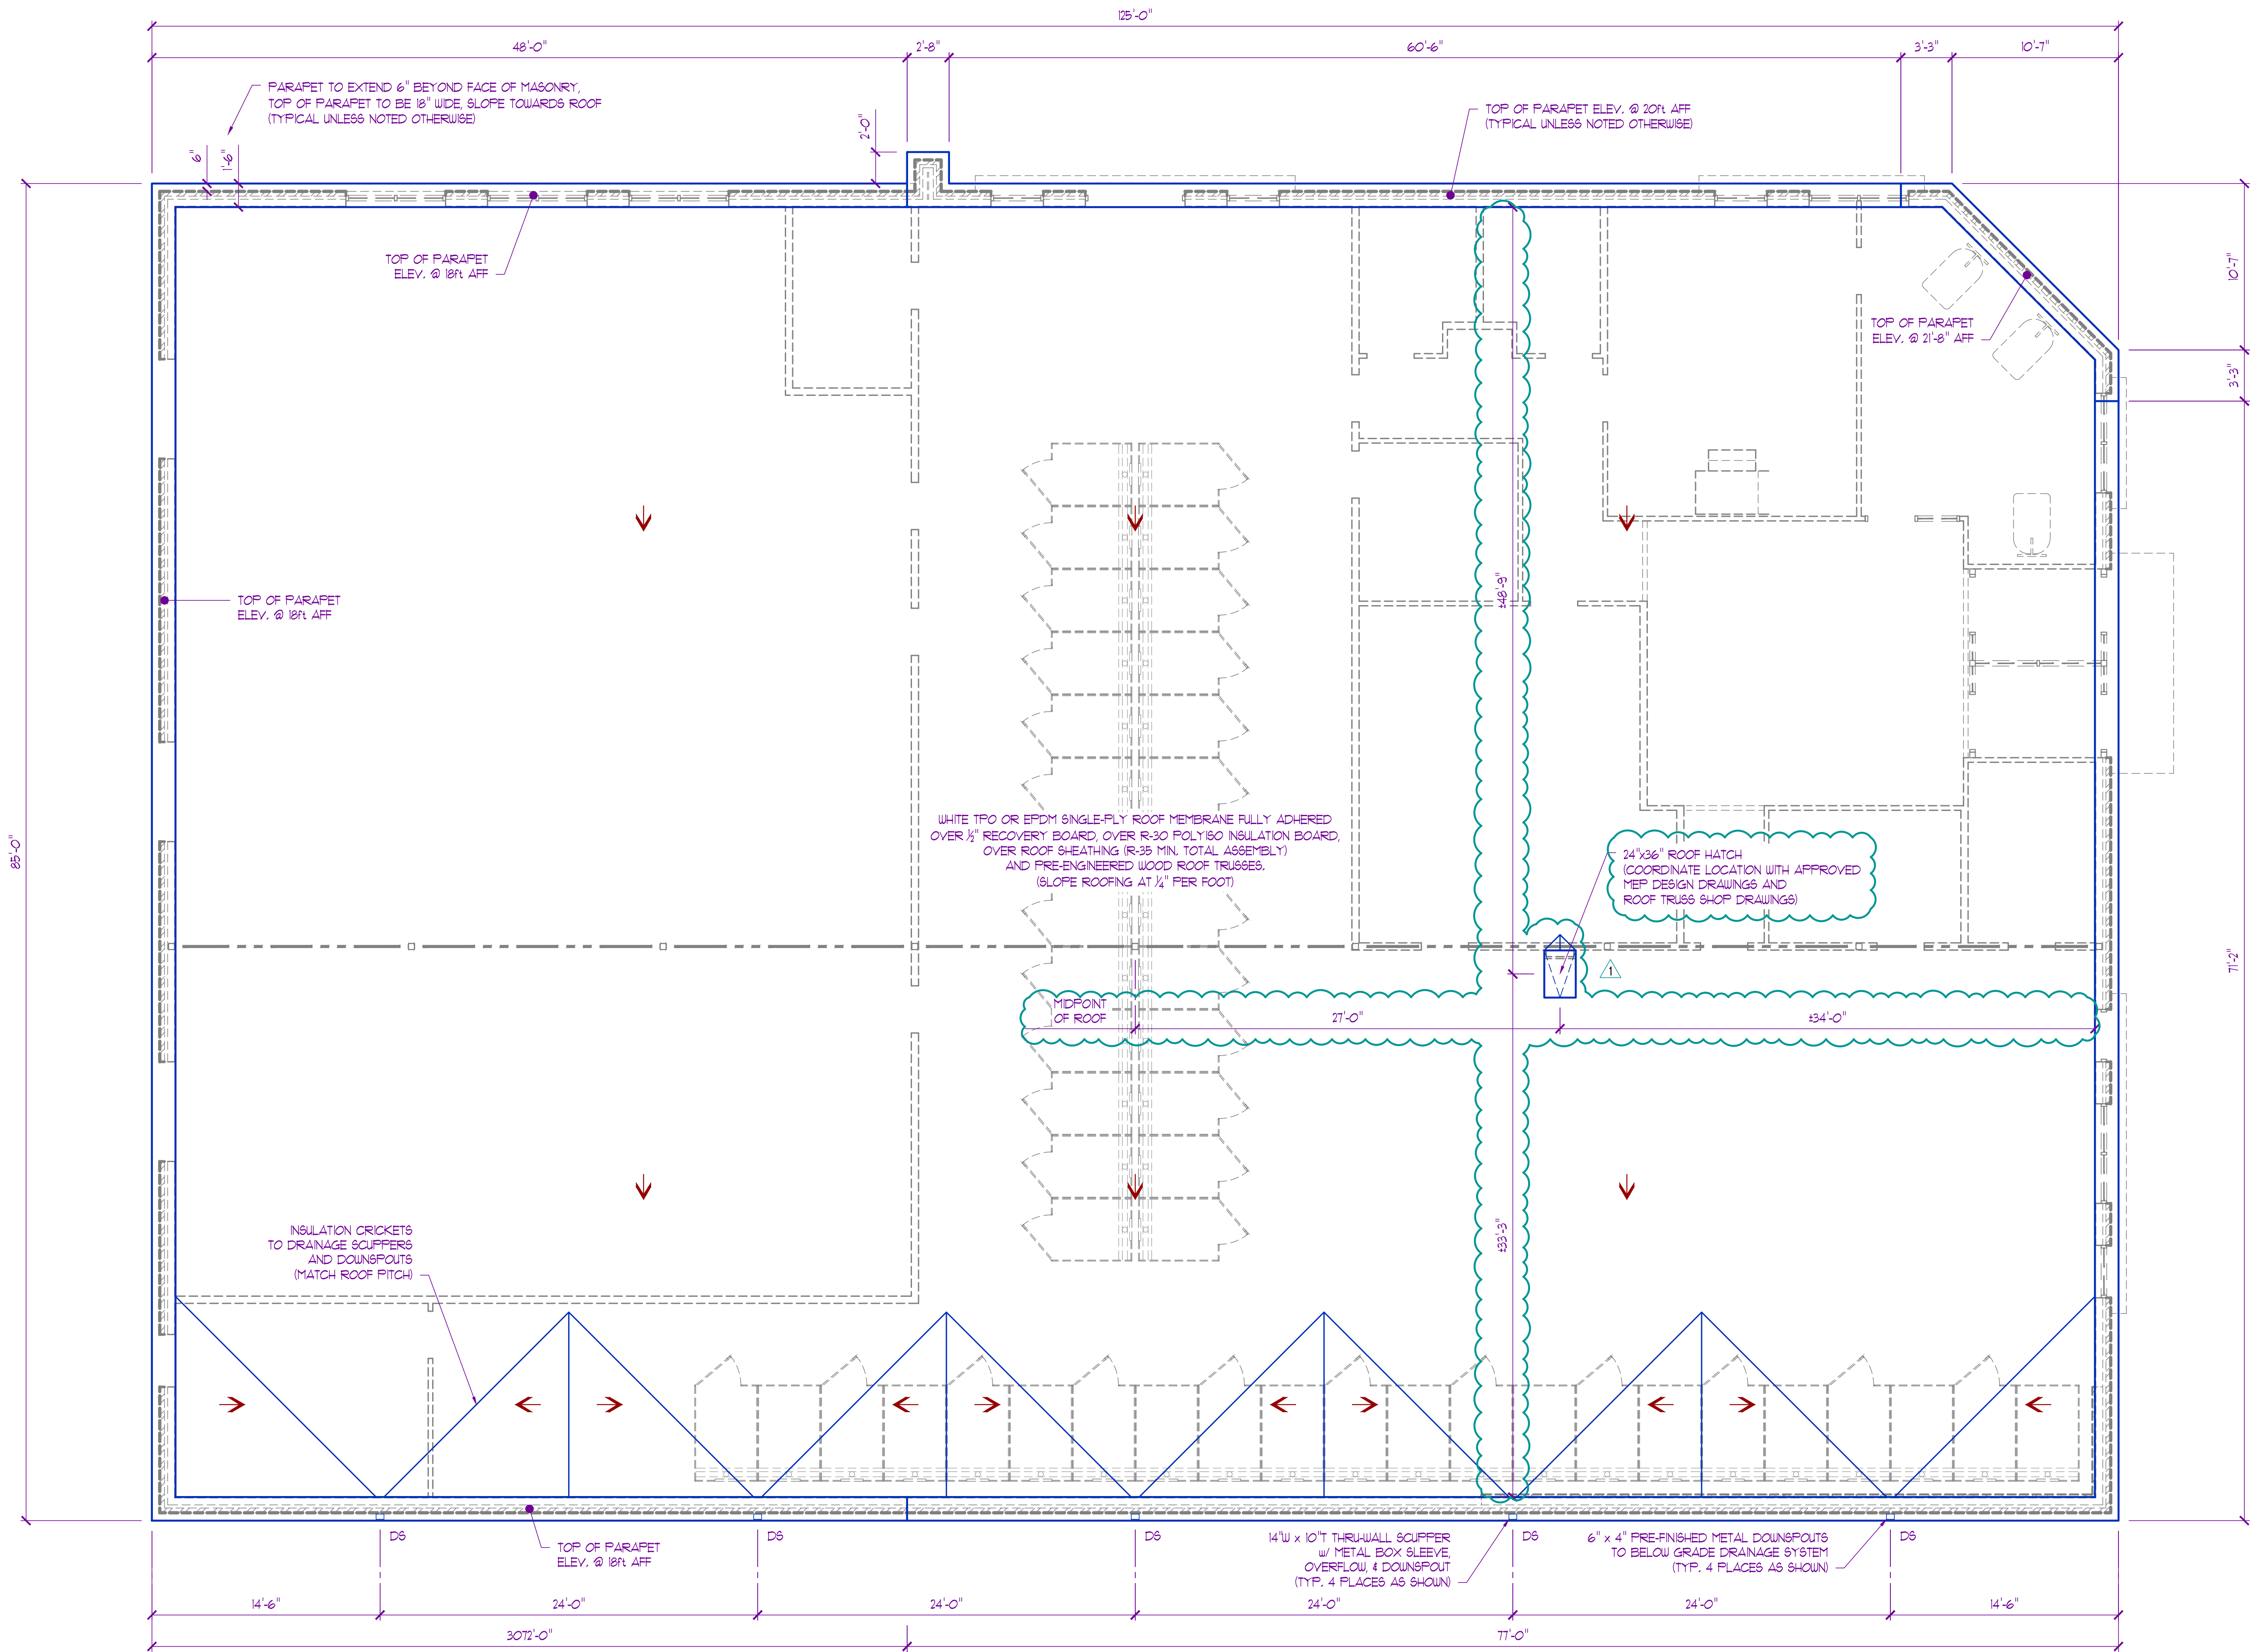

- ROOF PLAN GENERAL NOTES:**
1. VERIFY AND COORDINATE ALL BLOCKING, NALERS, INSULATION STOPS, CRICKETS, FLASHING, ETC. FOR COMPLETE INSTALLATION OF ROOFING SYSTEM.
 2. ROOFING SYSTEM TO BE WARRANTED AND WATERTIGHT.
 3. VERIFY AND COORDINATE ALL ROOFTOP EQUIPMENT, CURBS, GAS LINES, PLUMBING PENETRATIONS, ETC. (12" MIN. ABOVE FINISH ROOF)
 4. EXHAUST FANS & VENTING TO DISCHARGE A MIN. OF 10'-0" FROM ROOFTOP UNITS.
 5. PROVIDE MOLDED ROOF WALK PADS TO AND AROUND ROOFTOP UNITS & OTHER EQUIPMENT AS NECESSARY.

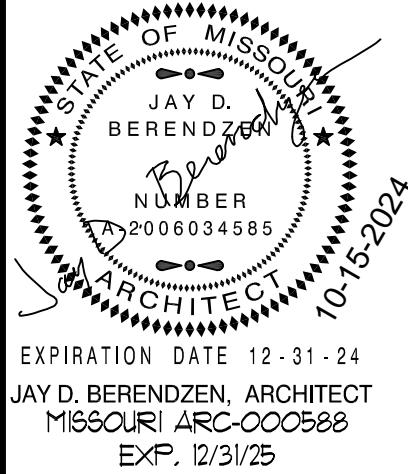

THE PROFESSIONAL ARCHITECTS SEAL AFFIXED TO THIS SHEET IS VALID FOR THE STATE OF MISSOURI AND IS NOT TO BE REPRODUCED OR COPIED ON THIS SHEET. ALL DRAWINGS, INSTRUMENTS OR OTHER DOCUMENTS NOT EXHIBITING THIS SEAL ARE NOT TO BE USED FOR ANY PROJECT. THE ARCHITECT HEREBY DISCLAIMS ANY AND ALL LIABILITY FOR ANY AND ALL DAMAGES OR LOSSES, INCLUDING REASONABLE ATTORNEY'S FEES, ARISING OUT OF OR FROM THE USE OF ANY SUCH DOCUMENTS OR DRAWINGS NOT EXHIBITING THIS SEAL.

PORTER, BERENDZEN & ASSOCIATES, P.C. ARCHITECTS
200 SOUTH HENRY CLAY BLVD.
P.O. BOX 111660
JACKSON, MISSOURI 64201
573.651.2022
jag@pba-architects.com

DO NOT SCALE THIS DRAWING. SOME DIMENSIONS MAY VARY FROM SCALE. DIMENSIONS ARE THE PROPERTY OF PORTER, BERENDZEN & ASSOCIATES, P.C. AND MAY NOT BE COPIED OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT
Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024
2	REVISION #1	10/14/2024

PROJECT NO. **FB24248**
SHEET TITLE

ROOF PLAN

SHEET NUMBER

A401

ROOF DRAINAGE CALCULATIONS:

TOTAL ROOF DRAINAGE AREA: ± 10,575 SF

PROPOSED ROOF DRAINS: (4) @ 2,130 SF
± 10,680 SF

RAINFALL RATE: 3.5" / HOUR


14"W x 10"T x 12"D CONDUCTOR HEAD:
4,600 SF OF DRAINAGE AREA CAPACITY

(EXTEND TOP OF CONDUCTOR TO CONCEAL SCUPPER OPENING, INSTALL OVERFLOW IN CONDUCTOR AT ROOF DRAINAGE ELEVATION)



ELEVATION GENERAL NOTES:

1. FOR REFERENCE ONLY. VERIFY AND COORDINATE ALL EXTERIOR MATERIALS / FINISHES WITH OWNER PRIOR TO ANY WORK.
2. DO NOT SCALE THIS DRAWING. REFER TO DIMENSIONS AND MEMBER SIZES GIVEN AS INDICATED ON FLOOR PLANS, SECTIONS, & DETAILS.

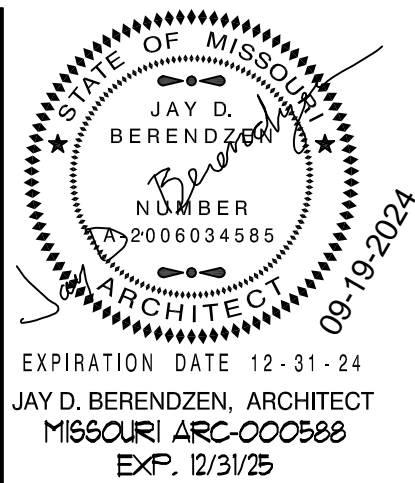

THE PROFESSIONAL ARCHITECTS SEAL APPLIED TO THIS SHEET IS VALID FOR THE STATE OF MISSOURI AND THIS BUILDING ON THIS SHEET. ALL DRAWINGS, INSTRUMENTS OR OTHER DOCUMENTS NOT EXHIBITING THIS SEAL ARE NOT TO BE CONSIDERED PREPARED BY THIS ARCHITECT, AND THE ARCHITECT ASSUMES NO LIABILITY FOR ANY ERRORS, OMISSIONS, OR INADEQUACIES IN ANY DRAWINGS OR DOCUMENTS NOT EXHIBITING THIS SEAL.

PORTER, BERENDZEN & ASSOCIATES, P.C. ARCHITECTS

573.657.1202 PHONE
jag@pbaarchitects.com

200 SOUTH HENRY CLAY BLVD.
FLOOR 200, SUITE 200
JACKSON, MISSOURI 64202

DO NOT SCALE THIS DRAWING. SOME DEVIATION FROM SCALE MAY OCCUR FROM REPRODUCTION. DRAWINGS ARE THE PROPERTY OF PORTER, BERENDZEN & ASSOCIATES, P.C. AND THAT NOT BE COPIED OR USED IN WHOLE OR PART WITHOUT THE WRITTEN CONSENT OF PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT

Discovery Park
Discovery Pet Spa


1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

PROJECT NO.
FB24248

SHEET TITLE
EXTERIOR ELEVATIONS

SHEET NUMBER
A500

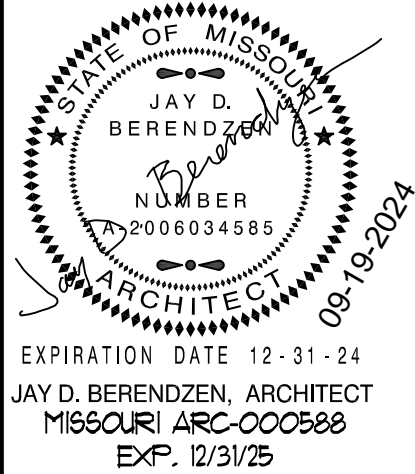

THE PROFESSIONAL ARCHITECTS
SEAL AFFIXED TO THIS SHEET
AND THIS SEAL IS THE PROPERTY OF
ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXHIBITING
CONSIDERED PREPARED BY THIS
ARCHITECT, AND THE ARCHITECT
EXERCISES NO LIABILITY FOR ANY
PLAN, DRAWING OR DOCUMENT
NOT EXHIBITING THIS SEAL

PORTER, BERENDZEN
& ASSOCIATES, P.C.
ARCHITECTS

200 SOUTH HENRY CLAY BLVD.
FARMINGTON, MISSOURI 65010

572.657.1202
jag@pbaarchitects.com

DO NOT SCALE THIS DRAWING
SOME DEVIATION FROM SCALE
MAY OCCUR FROM REPRODUCTION
DRAWINGS ARE THE PROPERTY OF
PORTER, BERENDZEN & ASSOCIATES, P.C.
AND THAT NOT BE COPIED OR
USED IN WHOLE OR PART
WITHOUT THE WRITTEN CONSENT OF
PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT

Discovery Park
Discovery Pet Spa

1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri


ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024


PROJECT NO.
FB24248

SHEET TITLE

EXTERIOR
ELEVATIONS

SHEET NUMBER

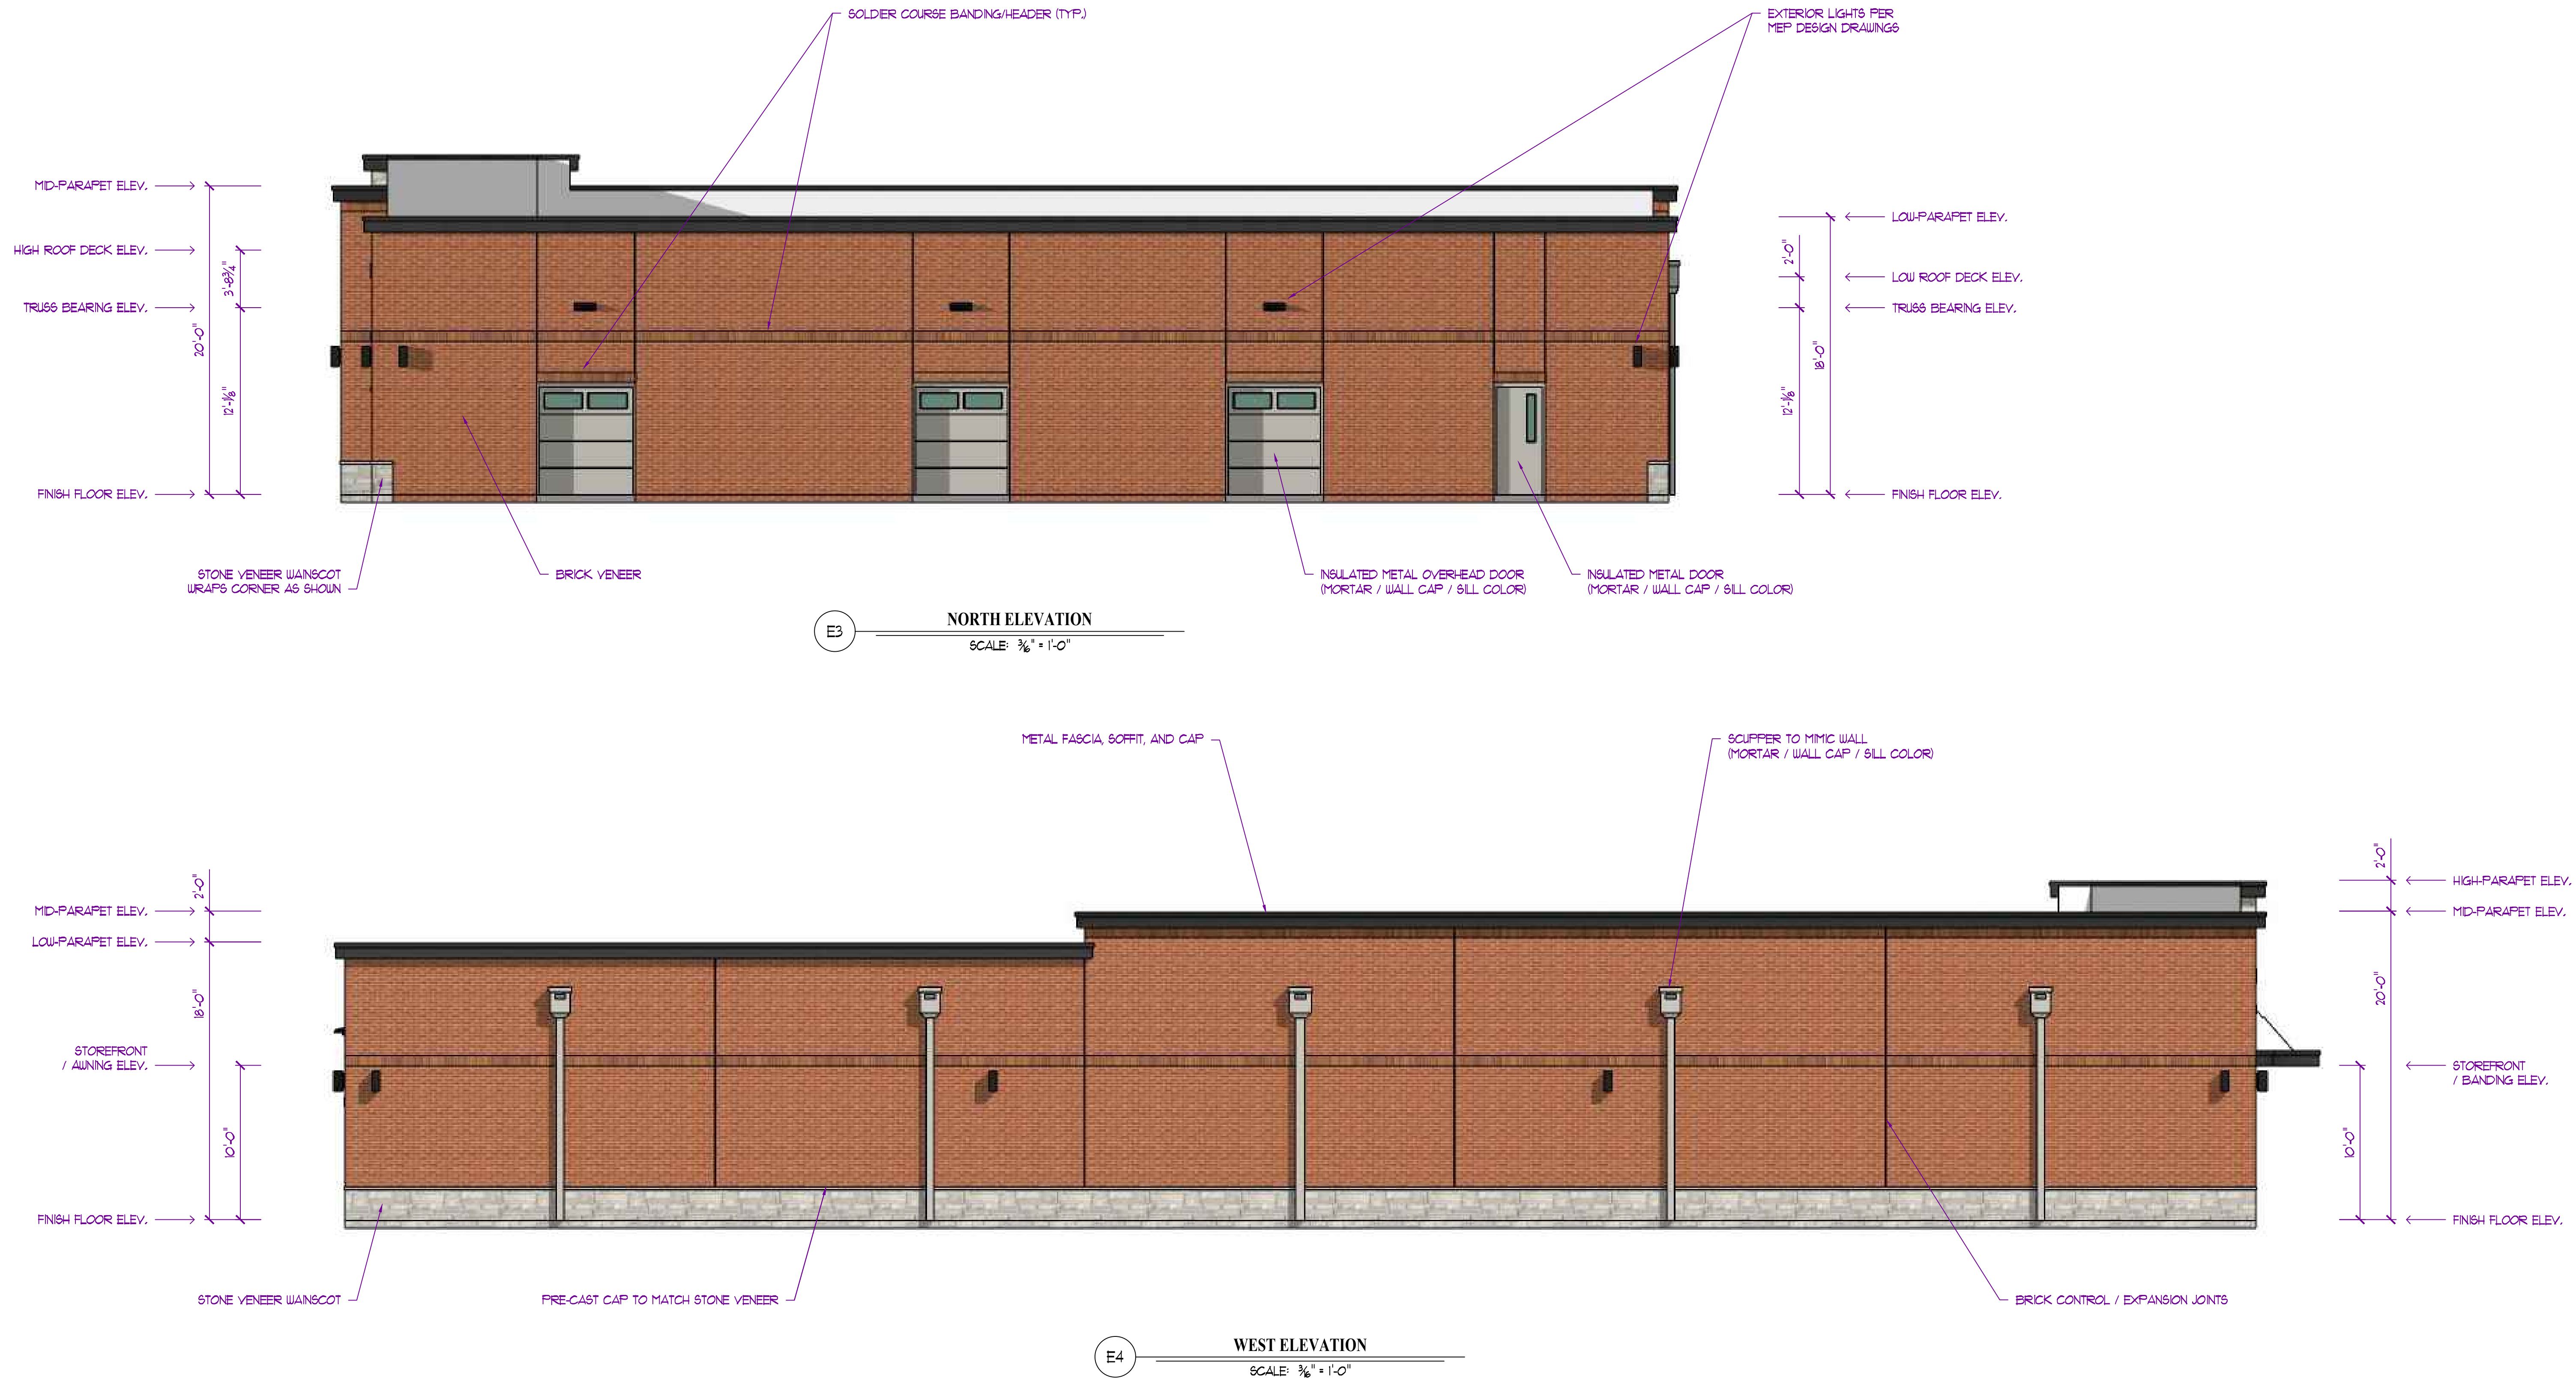

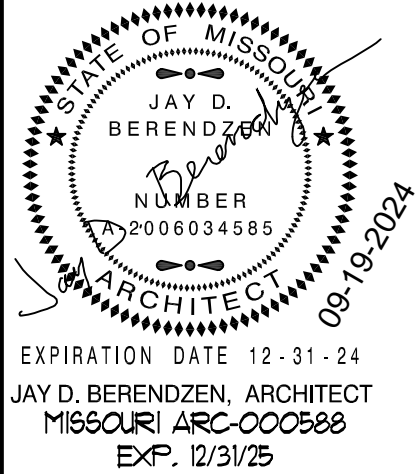

THE PROFESSIONAL ARCHITECTS
SEAL AFFIXED TO HIS SHEET
AND THIS SEAL IS THE ONLY
AND THIS SEAL IS THE ONLY
ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXHIBITING
CONSIDERED PREPARED BY THIS
ARCHITECT, AND THIS ARCHITECT
EXPLICITLY DISCLAIMS ANY AND
ALL LIABILITY FOR ANY AND ALL
PLAN DRAWINGS OR DOCUMENTS
NOT EXHIBITING THIS SEAL

PORTER, BERENDZEN
& ASSOCIATES, P.C.
ARCHITECTS
573.651.2022 PHONE
jag@pba-architecture.com
200 SOUTH HENRY CLAY BLVD.
CLAY CITY, MISSOURI 65010

DO NOT SCALE THIS DRAWING
SOME DEVIATION FROM SCALE
MAY OCCUR FROM REPRODUCTION
DRAWINGS ARE THE PROPERTY OF
PORTER, BERENDZEN & ASSOCIATES, P.C.
AND THAT NOT BE COPIED OR
USED IN WHOLE OR PART
WITHOUT THE WRITTEN CONSENT OF
PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT
Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri


ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

PROJECT NO.
FB24248


SHEET TITLE

EXTERIOR
RENDERINGS


SHEET NUMBER

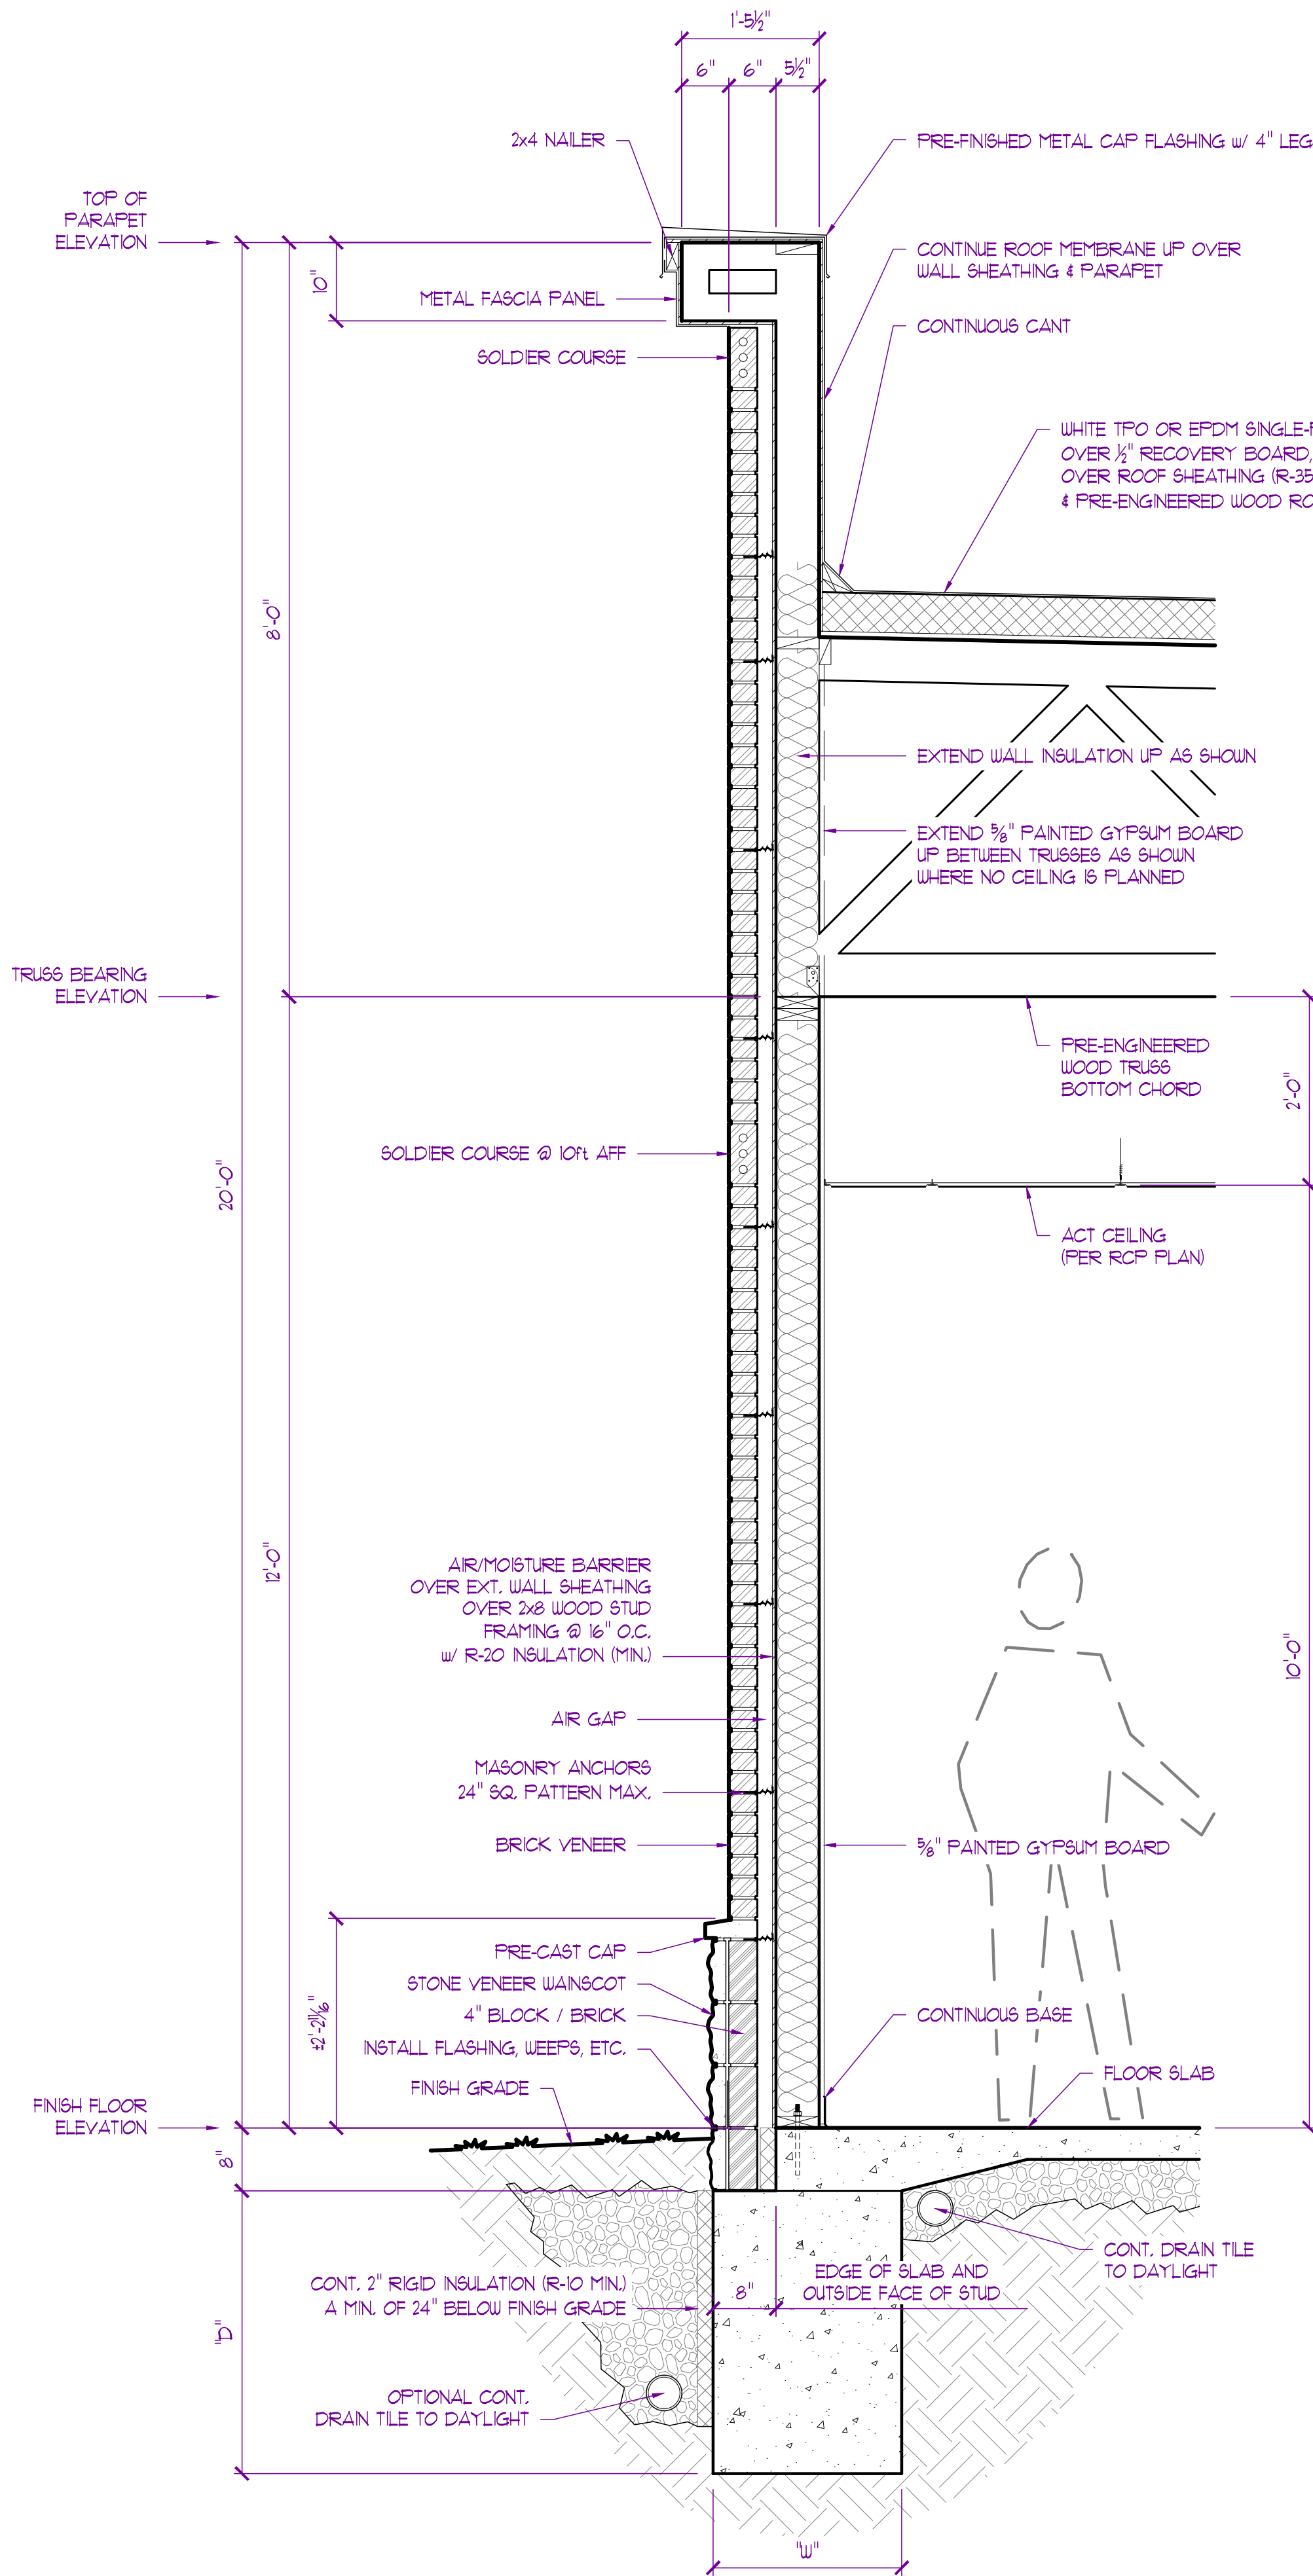

SECTION - A
SCALE: 3/4" = 1'-0"

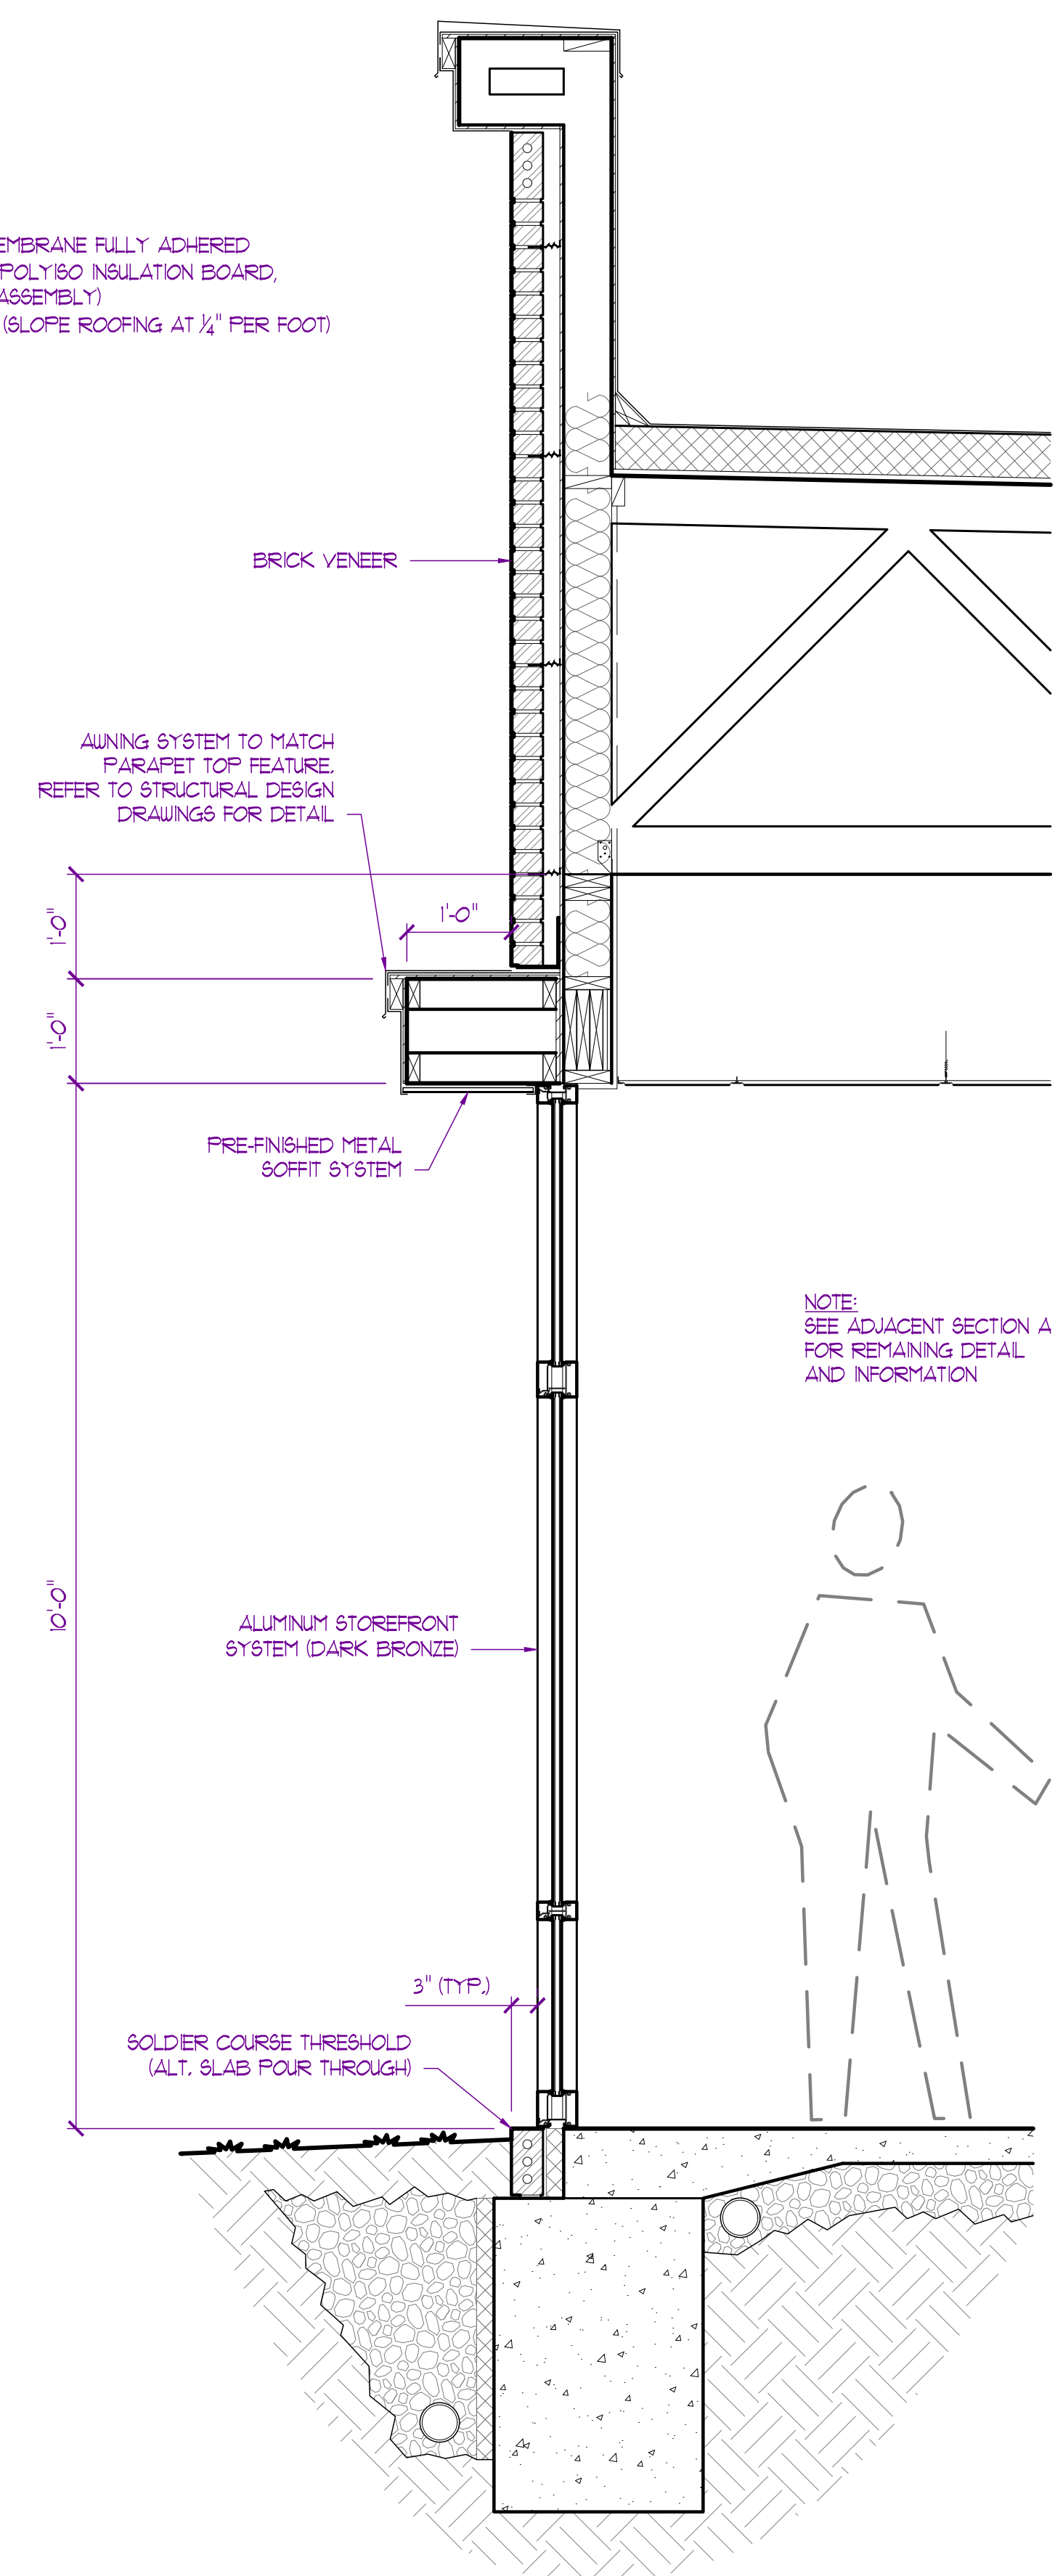


SECTION - A1
SCALE: 3/4" = 1'-0"

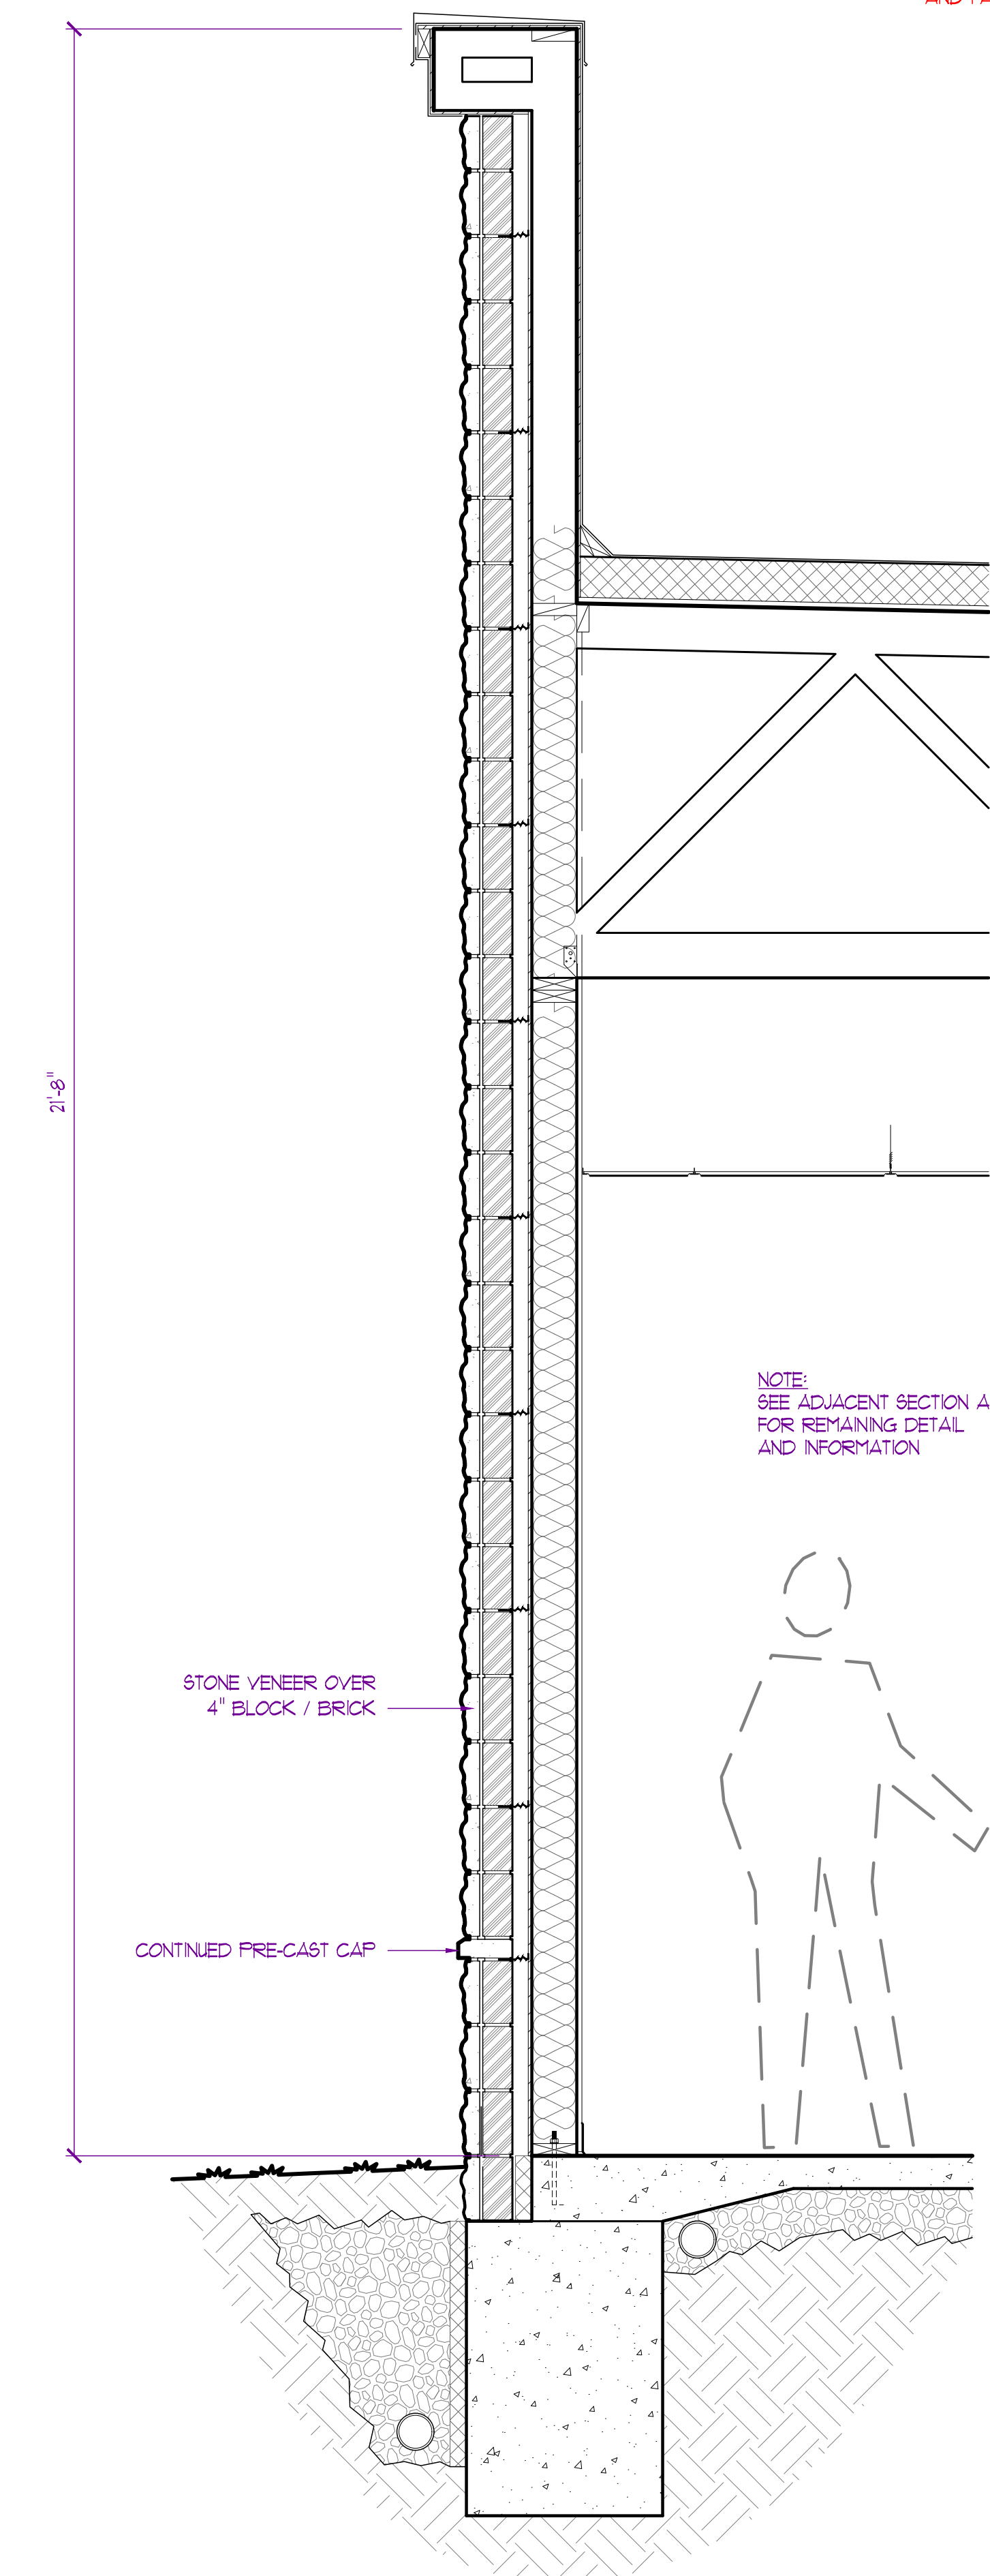

SECTION - B
SCALE: 3/4" = 1'-0"

NOTE:
REFER TO STRUCTURAL DRAWINGS PREPARED BY
CROCKETT ENGINEERING CONSULTANTS FOR
ALL STRUCTURAL MEMBER SIZING, SPACINGS,
AND FASTENING REQUIREMENTS.

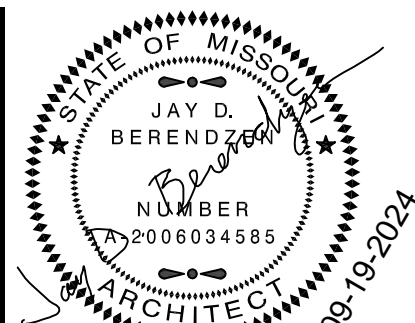

EXPIRATION DATE 12-31-24
JAY D. BERENDZEN, ARCHITECT
MISSOURI ARC-000588
EXP. 12/31/25

THE PROFESSIONAL ARCHITECT'S
SEAL AFFIXED TO HIS SHEETS
AND THIS SEALING OF THIS SHEET
ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXHIBITING
CONSIDERED PREPARED BY THIS
ARCHITECT, AND THE ARCHITECT
EXPRESSLY DISCLAIMS ANY AND
ALL LIABILITY FOR ANY SUCH
PLAN DRAWINGS OR DOCUMENTS
NOT EXHIBITING THIS SEAL.

**PORTER, BERENDZEN
& ASSOCIATES, P.C.**
ARCHITECTS
573.657.2022 PHONE
jag@pba-architecture.com
200 SOUTH HENRY CLAY BLVD.
P.O. BOX 118600
ASHLAND, MISSOURI 65010

DO NOT SCALE THIS DRAWING.
SOME DEVIATION FROM SCALE
MAY OCCUR FROM REPRODUCTION.
DRAWINGS ARE THE PROPERTY OF
PORTER, BERENDZEN & ASSOCIATES, P.C.
AND MAY NOT BE COPIED OR
USED IN WHOLE OR PART
WITHOUT THE WRITTEN CONSENT OF
PORTER, BERENDZEN & ASSOCIATES, P.C.


PROJECT
Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

PROJECT NO.
FB24248


SHEET TITLE
BUILDING
/ WALL SECTIONS

SHEET NUMBER

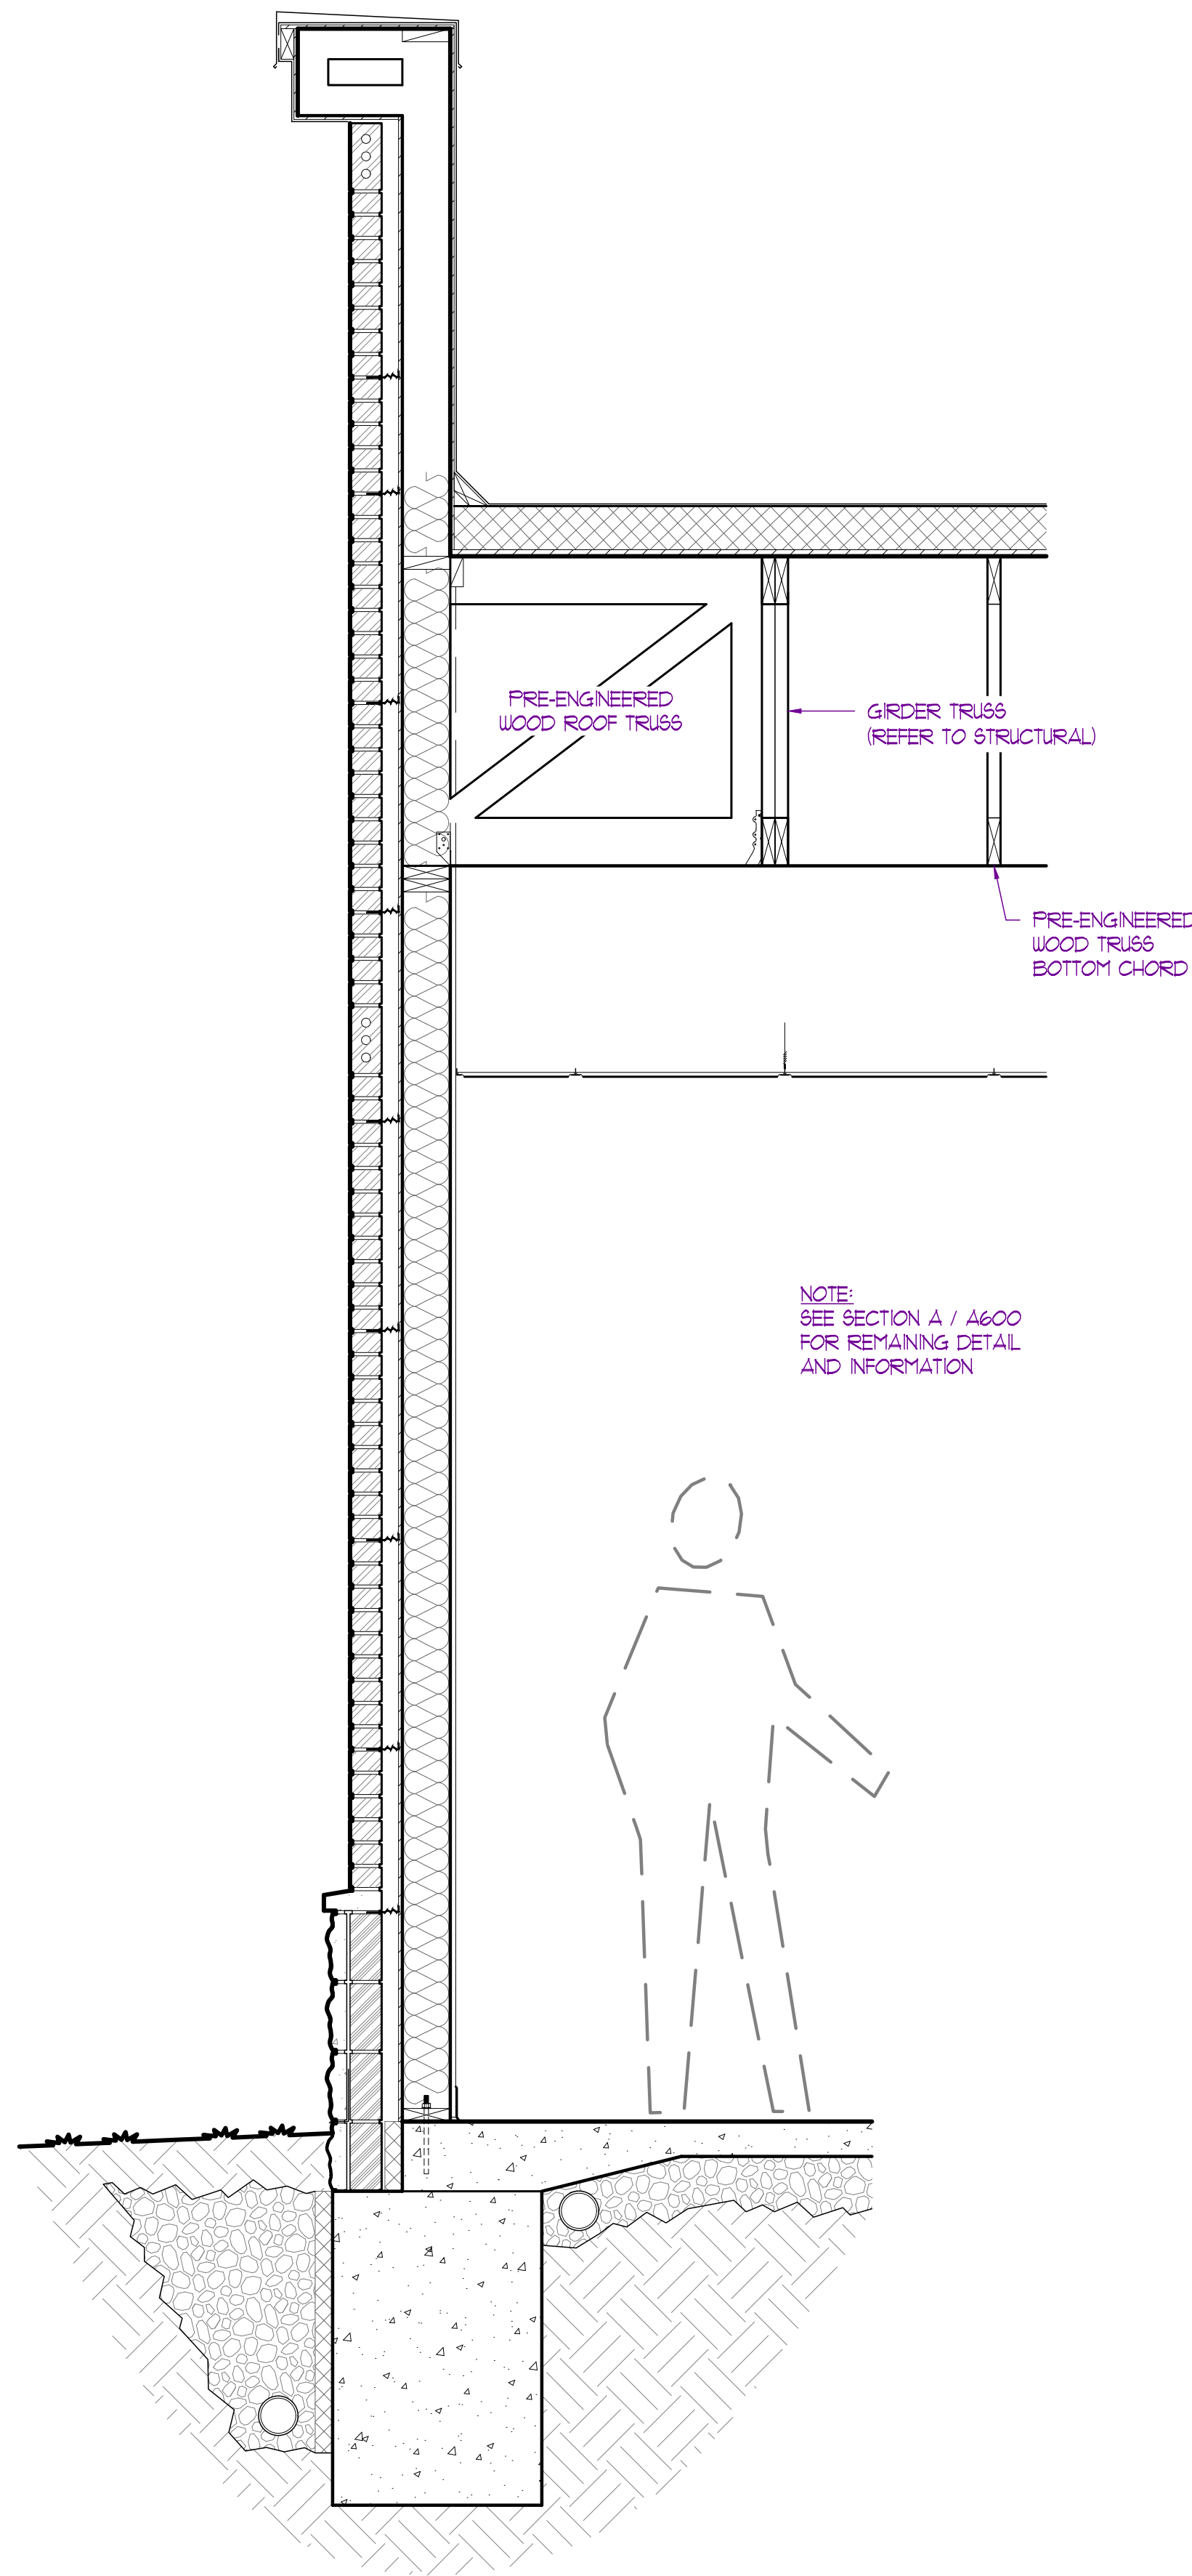


C
A201

SECTION - C
SCALE: 3/4" = 1'-0"

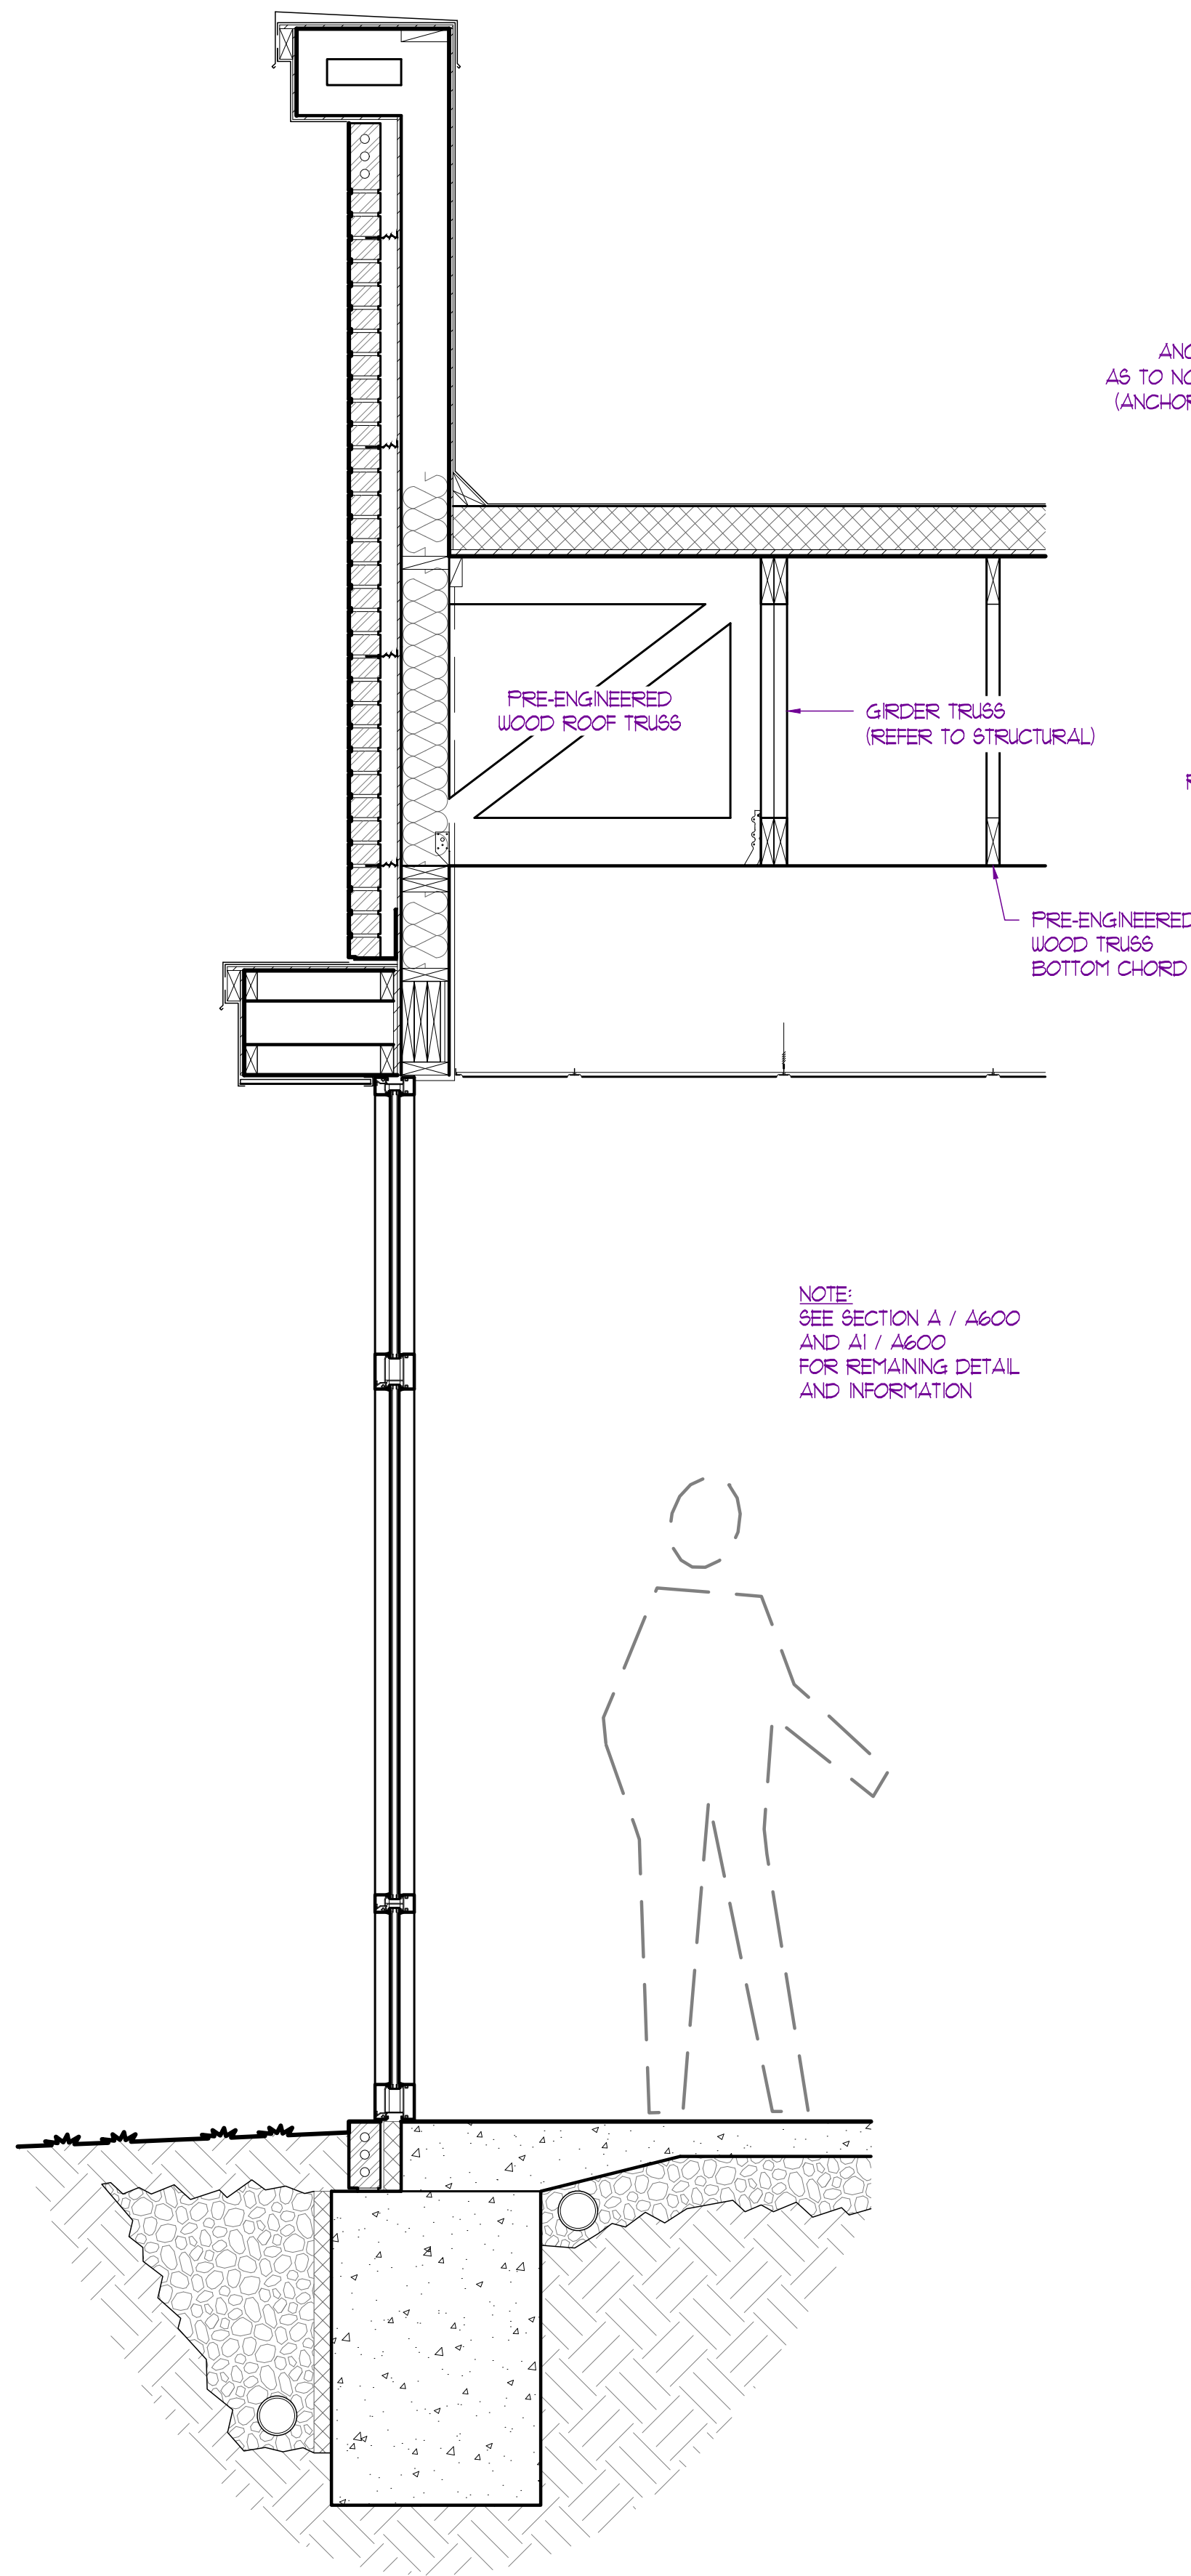

C1
A201


SECTION - C1
SCALE: 3/4" = 1'-0"

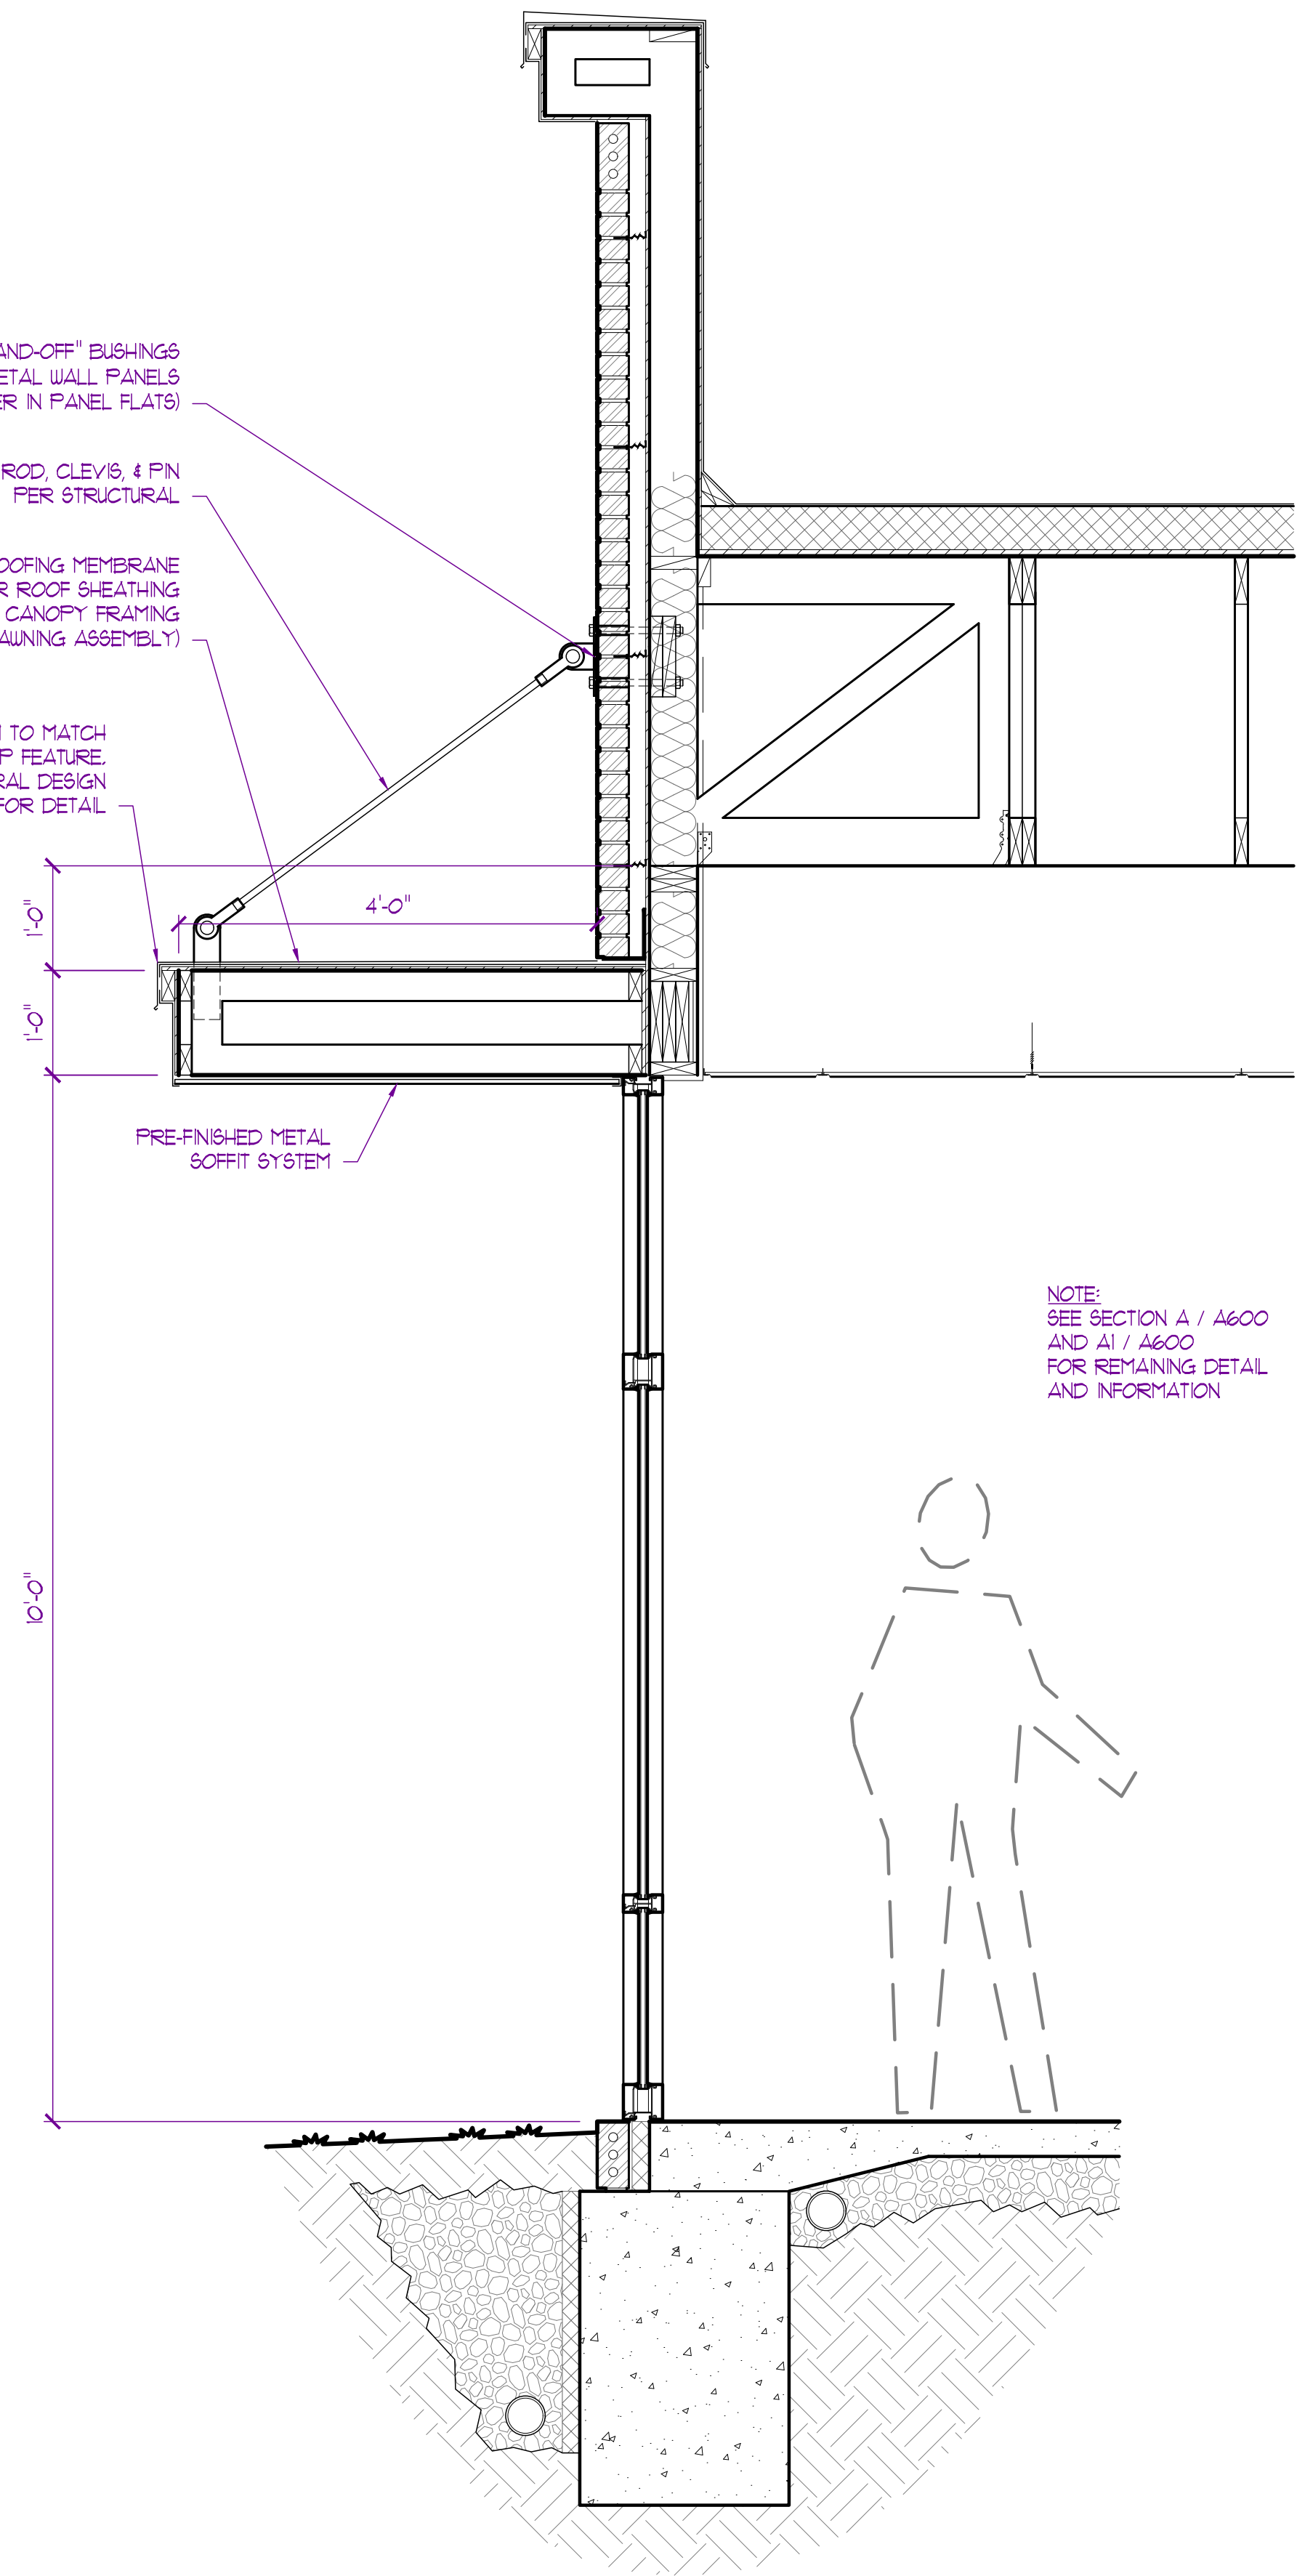

D
A201

SECTION - D
SCALE: 3/4" = 1'-0"

NOTE:
REFER TO STRUCTURAL DRAWINGS PREPARED BY
CROCKETT ENGINEERING CONSULTANTS FOR
ALL STRUCTURAL MEMBER SIZING, SPACINGS,
AND FASTENING REQUIREMENTS.

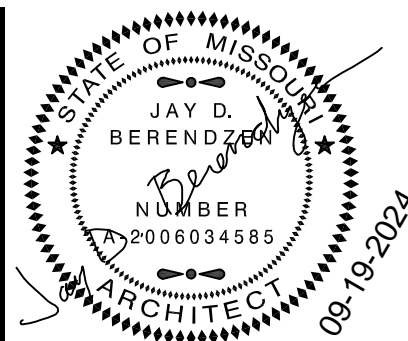

JAY D. BERENDZEN, ARCHITECT
MISSOURI ARC-000588
EXP. 12/31/25

THE PROFESSIONAL ARCHITECT'S
SEAL APPLIED TO HIS SHEETS
AND TO HIS WORK SHALL BE
VALID AND BINDING ON THIS SHEET
AND ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXEMPT
HEREFROM, AND THE ARCHITECT
CONSENTS TO THE SEAL BEING
EXPOSED TO THE PUBLIC AND
TO BE USED BY ANY PERSON
FOR ANY PURPOSE WITHOUT THE
ARCHITECT'S WRITTEN CONSENT.
NOT EXHIBITING THIS SEAL

PORTER, BERENDZEN
& ASSOCIATES, P.C.
ARCHITECTS
200 SOUTH HENRY CLAY BLVD.
F.O. BOX 118600
ASHLAND, MISSOURI 65002
573.657.2022 PHONE
jag@pba-architects.com

DO NOT SCALE THIS DRAWING.
SOME DEVIATION FROM SCALE
MAY OCCUR FROM REPRODUCTION.
DRAWINGS ARE THE PROPERTY OF
PORTER, BERENDZEN & ASSOCIATES, P.C.
AND MAY NOT BE COPIED OR
USED IN WHOLE OR PART
WITHOUT THE WRITTEN CONSENT OF
PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT
Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024


PROJECT NO.
FBA2418

SHEET TITLE

BUILDING
/ WALL SECTIONS


SHEET NUMBER

A601

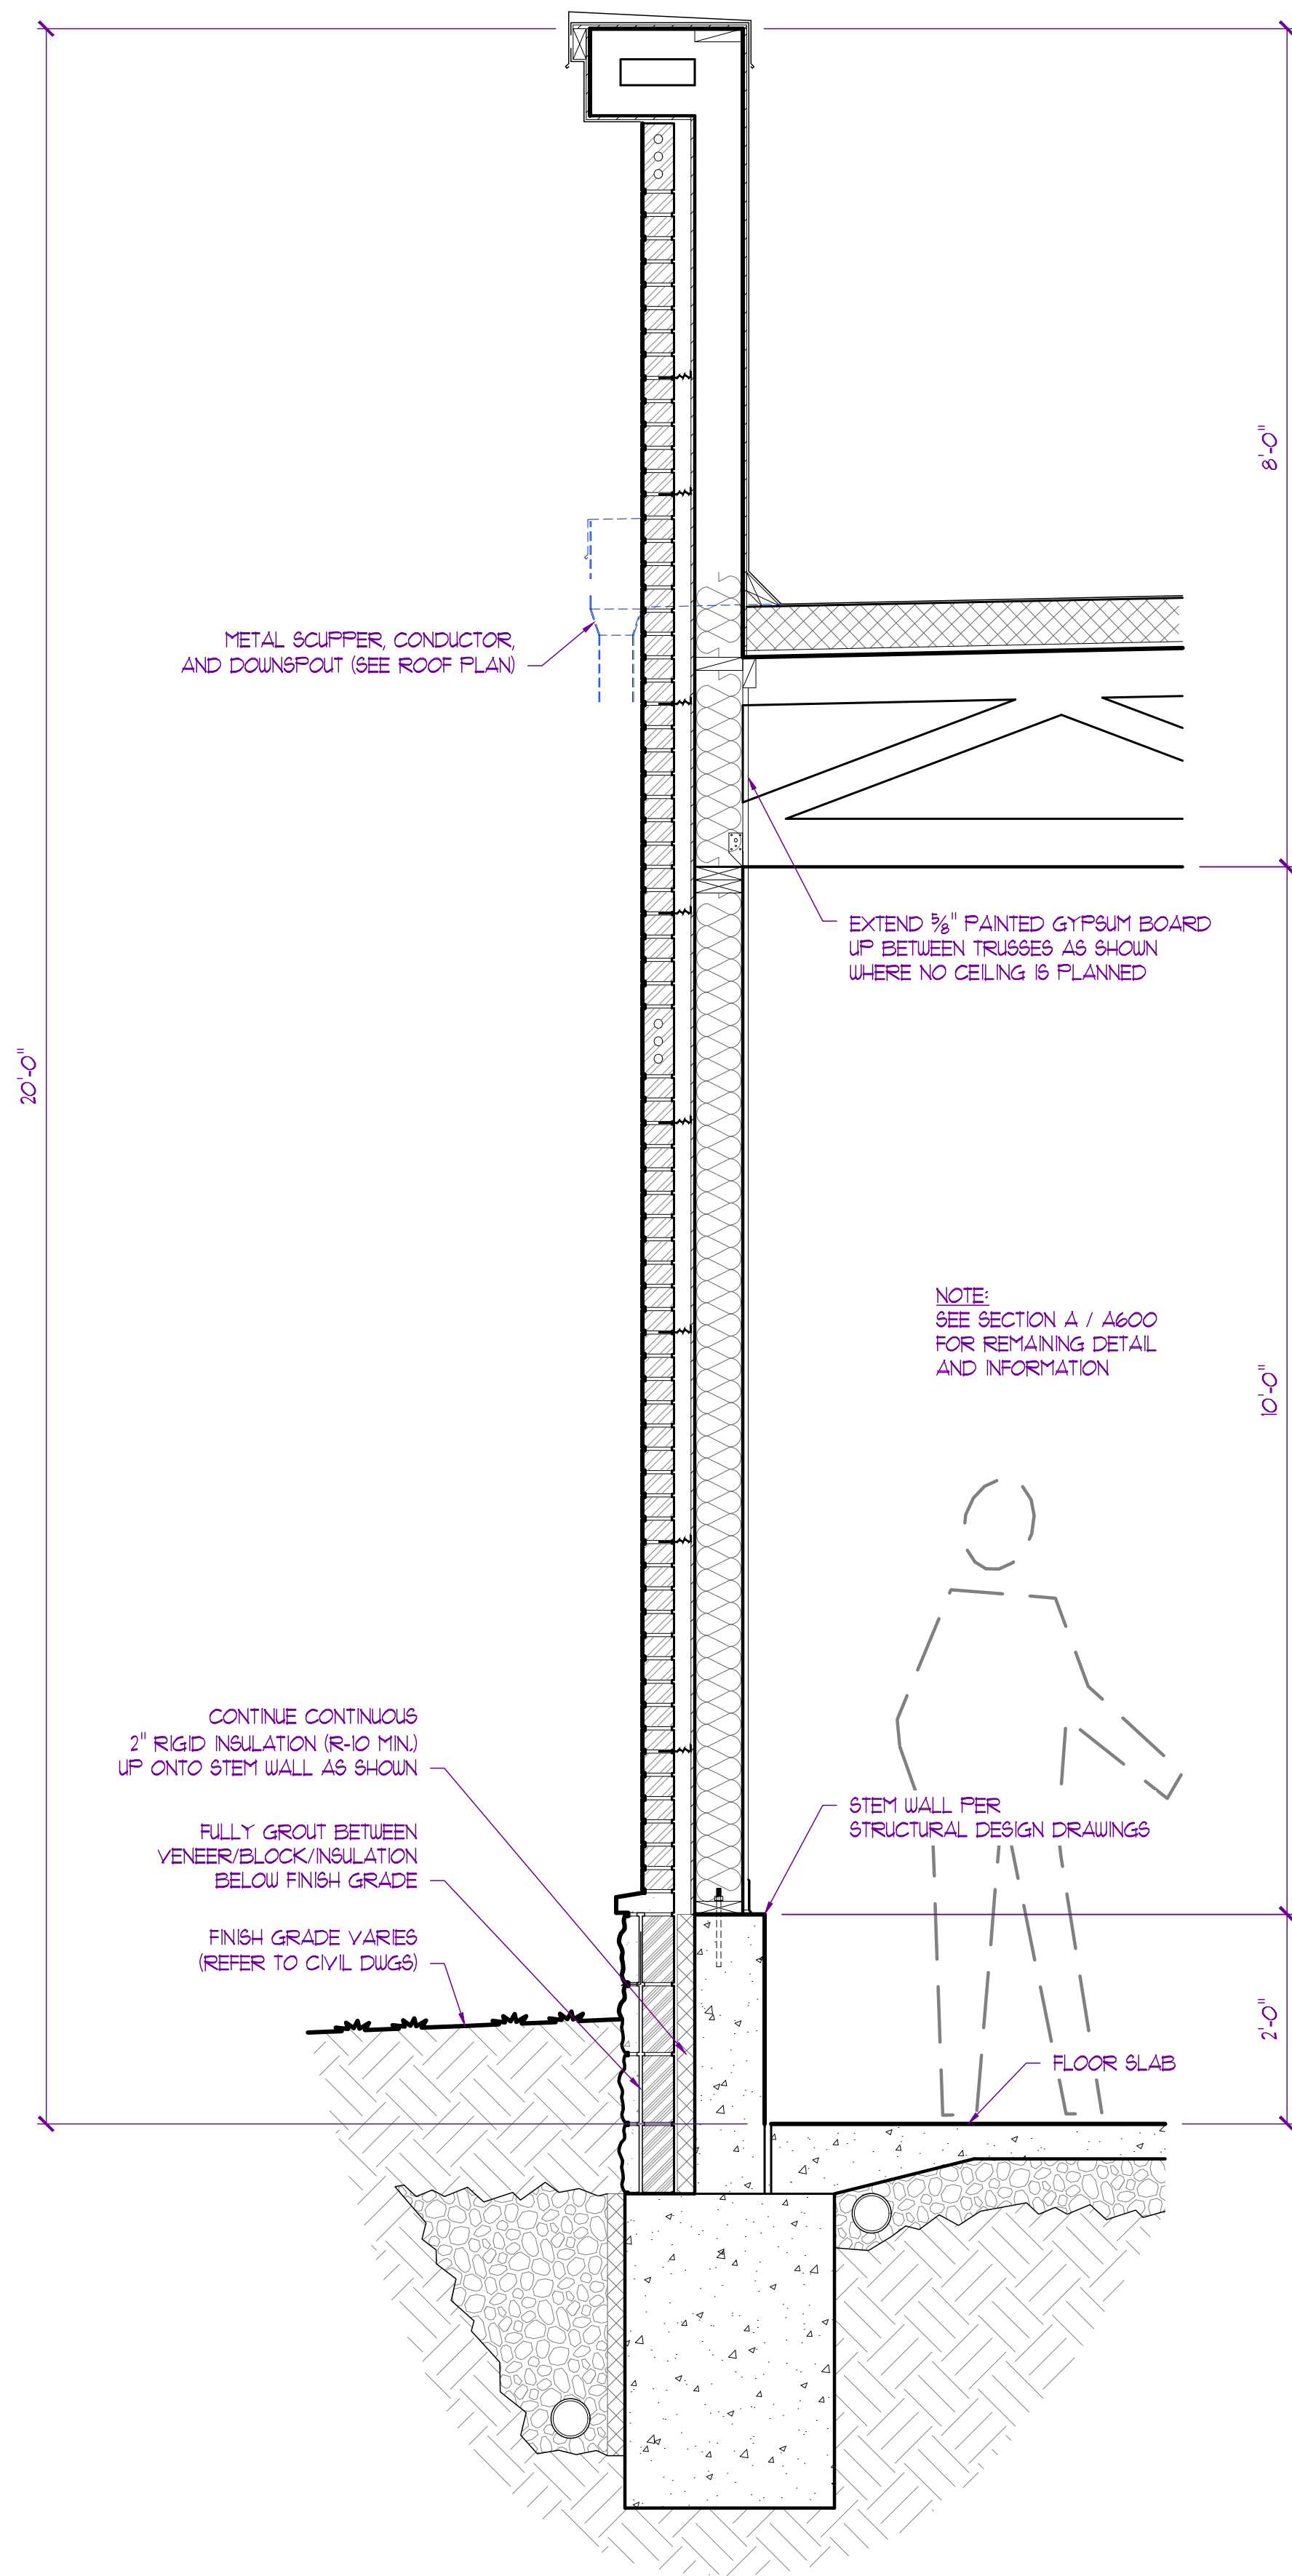


E
A201

SECTION - E
SCALE: 3/4" = 1'-0"

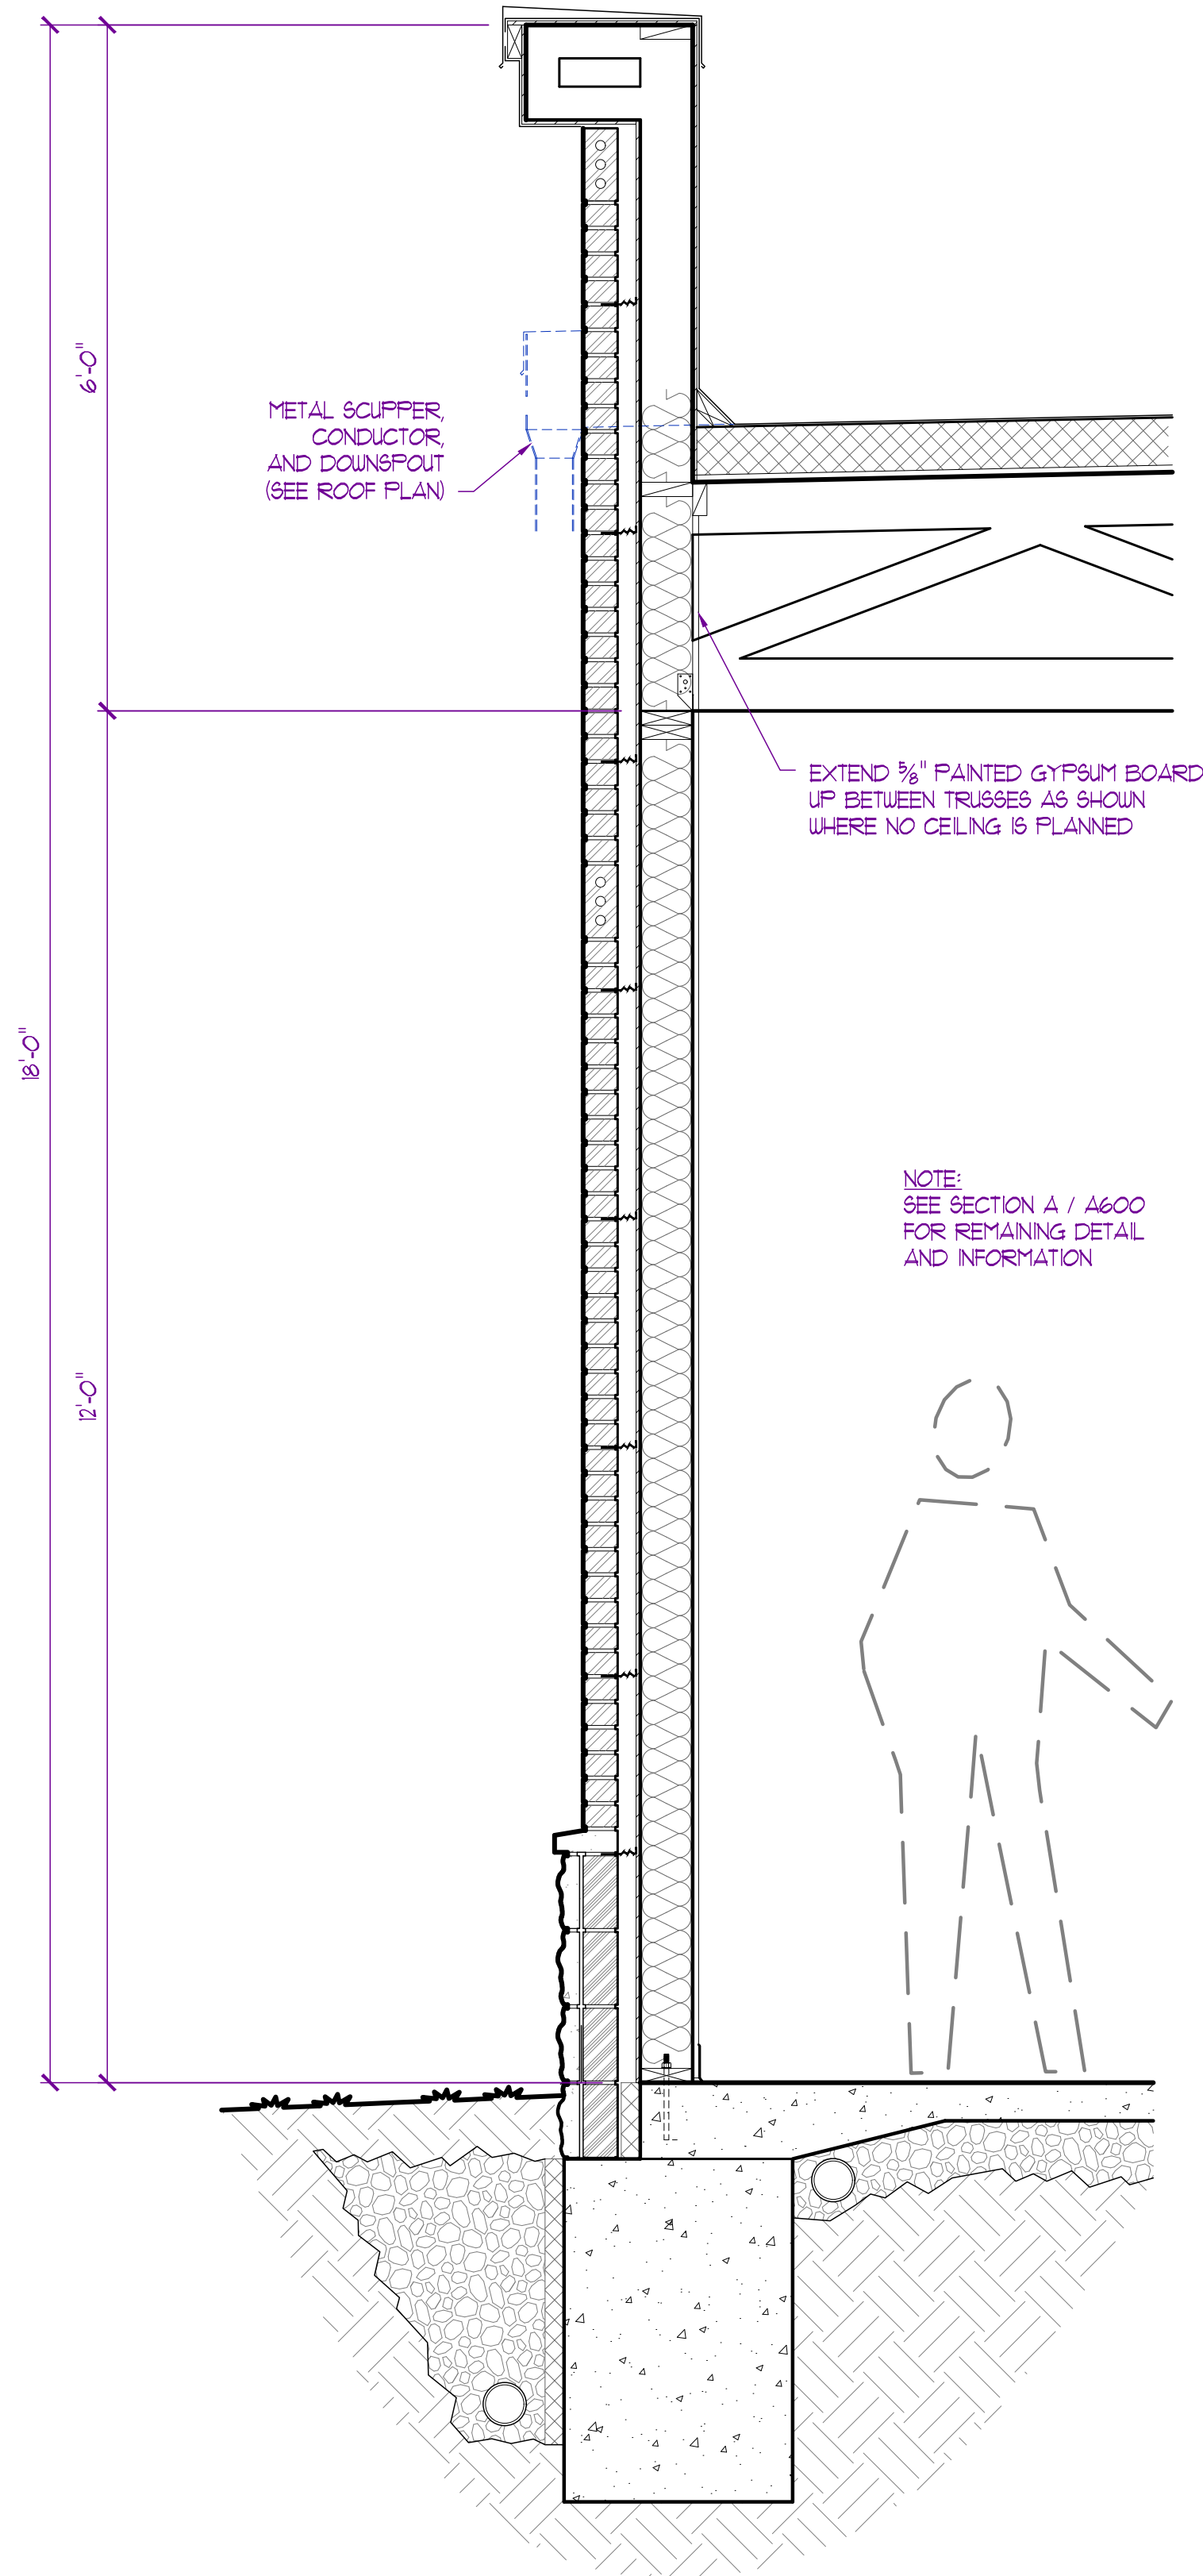

F
A201


SECTION - F
SCALE: 3/4" = 1'-0"

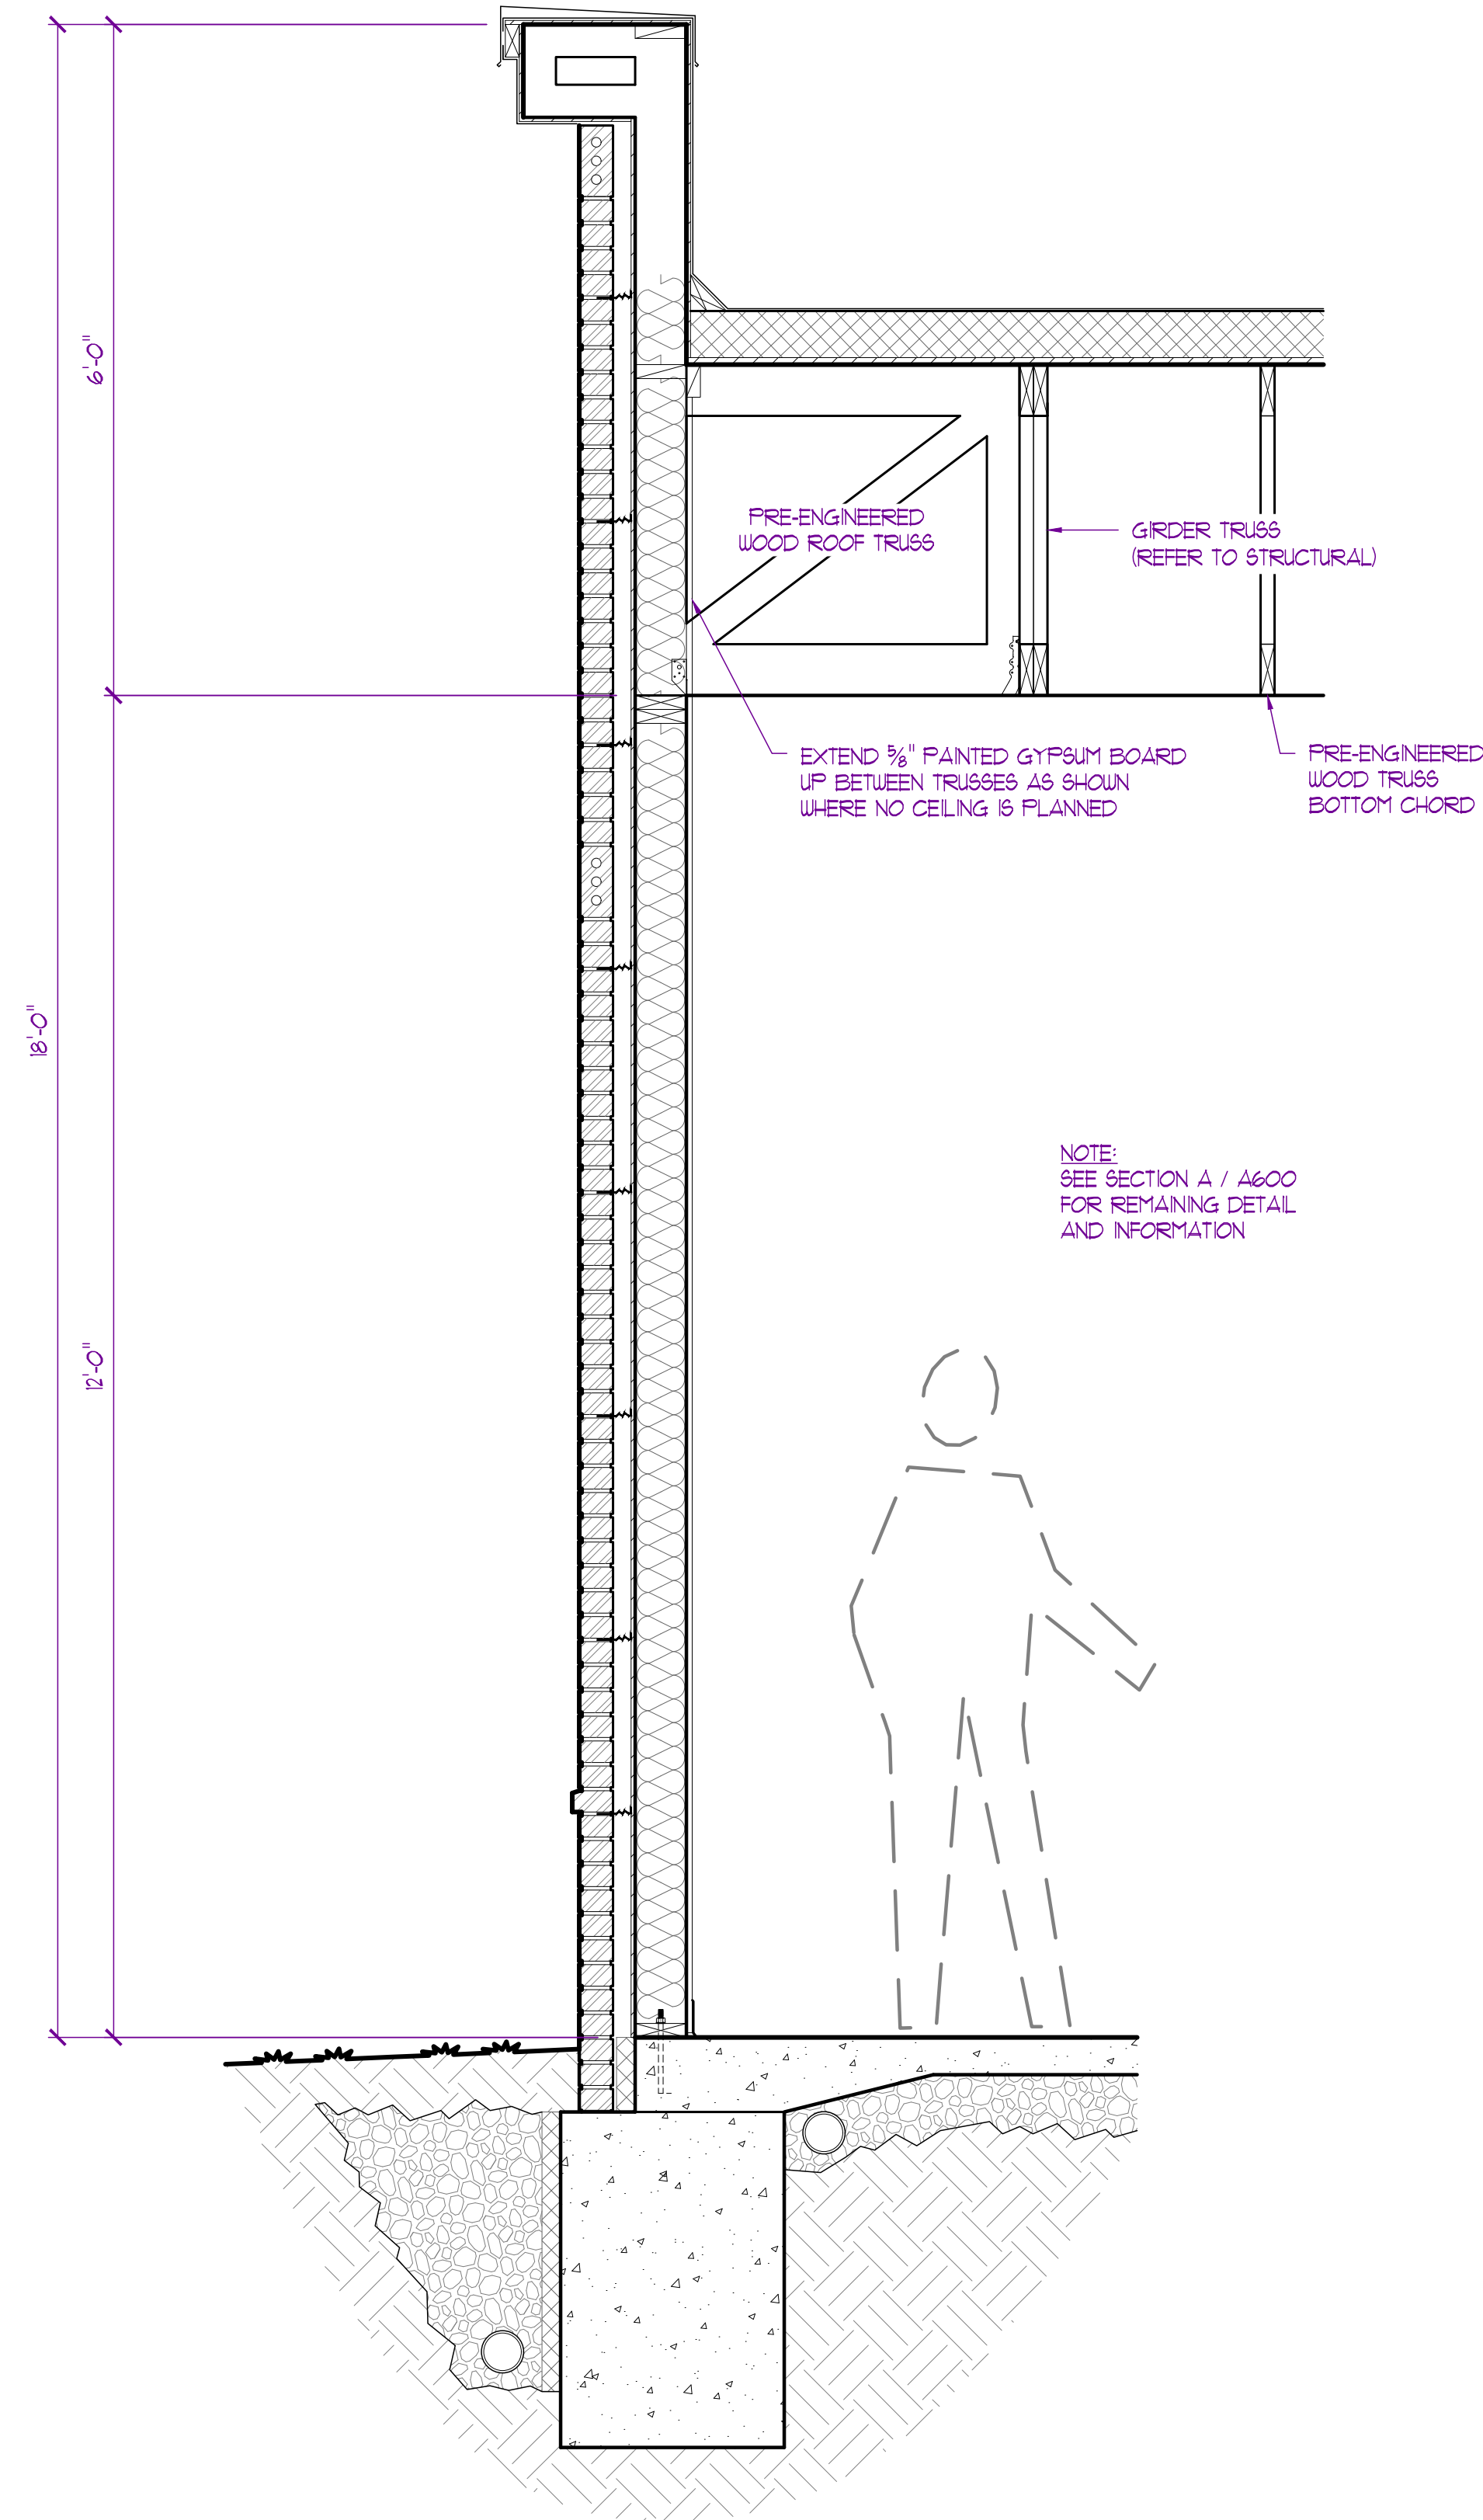

G
A201

SECTION - G
SCALE: 3/4" = 1'-0"

NOTE:
REFER TO STRUCTURAL DRAWINGS PREPARED BY
CROCKETT ENGINEERING CONSULTANTS FOR
ALL STRUCTURAL MEMBER SIZING, SPACINGS,
AND FASTENING REQUIREMENTS.

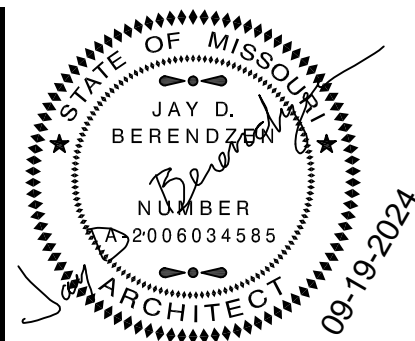

EXPIRATION DATE 12-31-24
JAY D. BERENDZEN, ARCHITECT
MISSOURI ARC-000588
EXP. 12/31/25

THE PROFESSIONAL ARCHITECTS
SEAL AFFIXED TO HIS SHEET
AND THIS SEAL IS THE ONLY
AND THIS SEAL IS THE ONLY
ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXHIBITING
CONSIDERED PREPARED BY THIS
ARCHITECT, AND THE ARCHITECT
EXPRESSLY DISCLAIMS ANY AND
ALL LIABILITY FOR ANY AND ALL
PLAN DRAWINGS OR DOCUMENTS
NOT EXHIBITING THIS SEAL.

PORTER, BERENDZEN
& ASSOCIATES, P.C.
ARCHITECTS
573.657.2022 PHONE
jag@pba-architects.com
200 SOUTH HENRY CLAY BLVD.
F.O. BOX 118600
KANSAS CITY, MISSOURI 64600

DO NOT SCALE THIS DRAWING
SOME DEVIATION FROM SCALE
MAY OCCUR FROM REPRODUCTION
DRAWINGS ARE THE PROPERTY OF
PORTER, BERENDZEN & ASSOCIATES, P.C.
AND THAT NOT BE COPIED OR
USED IN WHOLE OR PART
WITHOUT THE WRITTEN CONSENT OF
PORTER, BERENDZEN & ASSOCIATES, P.C.

PROJECT

Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

PROJECT NO.
FB24248


SHEET TITLE

BUILDING
/ WALL SECTIONS

SHEET NUMBER

A602

1. ALL ASSEMBLIES SHOWN ARE FROM EXTERIOR VIEW UNLESS NOTED OTHERWISE
2. GENERAL CONTRACTOR TO FIELD VERIFY ALL DOOR / WINDOW ROUGH OPENINGS PRIOR TO FABRICATION
3. PROVIDE SEALANT AT JOINTS AND OPENINGS FOR WEATHER TIGHT INSTALLATION
4. ALL STOREFRONT ASSEMBLIES TO MEET U-FACTOR VALUES AS INDICATED IN BUILDING ELEVATION REPORT
5. ALL STOREFRONT DOORS / WINDOWS, TRIM, ACCESSORIES, BREAK METAL, ETC. PROVIDED BY SUBCONTRACTOR
6. ALL STOREFRONT FRAMES TO BE DARK BRONZE OR EQUAL
7. ALL EXTERIOR GLAZING TO BE LOW E INSULATED GLASS W/ GRAY TINT (SAFETY GLASS WHERE INDICATED OR REQUIRED BY CODE)
8. ALL INTERIOR GLAZING TO BE 1/4" SINGLE PANE FLOAT GLASS (SAFETY GLASS WHERE INDICATED OR REQUIRED BY CODE)
9. SEE DOOR SCHEDULE ON SHEET A200 FOR REMAINING DOOR INFORMATION

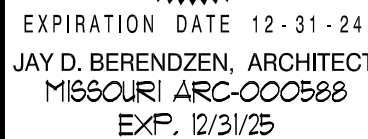

THE PROFESSIONAL ARCHITECT'S SEAL APPLIED TO THIS SHEET APPLIES ONLY TO THE MATERIALS AND ITEMS SHOWN ON THIS SHEET. NO OTHER DRAWINGS, INSTRUMENTS OR DOCUMENTS NOT EXHIBITED WITH THIS SEAL SHALL NOT BE CONSIDERED PREPARED BY THIS ARCHITECT, AND THIS ARCHITECT EXPRESSLY DISCLAIMS ANY AND ALL RESPONSIBILITY FOR SUCH UNLAWFUL OR UNAUTHORIZED REUSE OF THIS SEAL OR ANY DOCUMENTS NOT EXHIBITED WITH THIS SEAL.

DO NOT SCALE THIS DRAWING.
 SOME DEVIATION FROM SCALE
 MAY OCCUR FROM REPRODUCTION.
 DRAWINGS ARE THE PROPERTY
 OF PORTER, BERENZDIN & ASSOCIATES, P.C.
 AND MAY NOT BE COPIED OR
 USED IN WHOLE OR PART
 WITHOUT THE WRITTEN CONSENT OF
 PORTER, BERENZDIN & ASSOCIATES, P.C.

PROJECT

Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

ISSUE

ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

PROJECT NO. _____

PBA2418

SHEET TITLE

STOREFRONT
ELEVATIONS / DETAILS

SHEET NUMBER

A700



QUANTITY = 2



C



F

QUANTITY = 3



G


QUANTITY = 4



QUANTITY = :

STATE OF MISSOURI
JAY D. BERENDZEN
NUMBER
2006034585
ARCHITECT
EXPIRATION DATE 12-31-25

- THE PROFESSIONAL ARCHITECTS
SEAL AFFIXED TO THIS SHEET
APPLIES ONLY TO THE MATERIALS
AND ITEMS SHOWN ON THIS SHEET.
ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXHIBITING
THIS SEAL SHALL NOT BE
CONSIDERED PREPARED BY THIS
ARCHITECT, AND THIS ARCHITECT
EXPRESSLY DISCLAIMS ANY AND
ALL RESPONSIBILITY FOR SUCH
PLAN DRAWINGS OR DOCUMENTS
NOT EXHIBITING THIS SEAL.



PROJECT

ISSUE		
ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

SHEET TITLE

SHEET NUMBER

INSTALL FAUX DOORS ON EACH END

3'-0"

2'-0" B34

2'-0" B24

2'-0" B24



SOLID SURFACE COUNTERTOP AND BACKSPLASH TO MATCH RECEPTION DESK

CABINET DOORS: SHAKER STYLE FACE FRAME WITH BEADBOARD PANELING TO MATCH RECEPTION DESK


CABINET DRAWERS: SHAKER STYLE FACE FRAME WITH SOLID BACK PANEL

RECEPTION CABINET DETAIL

SCALE: $\frac{1}{2}" = 1'-0"$

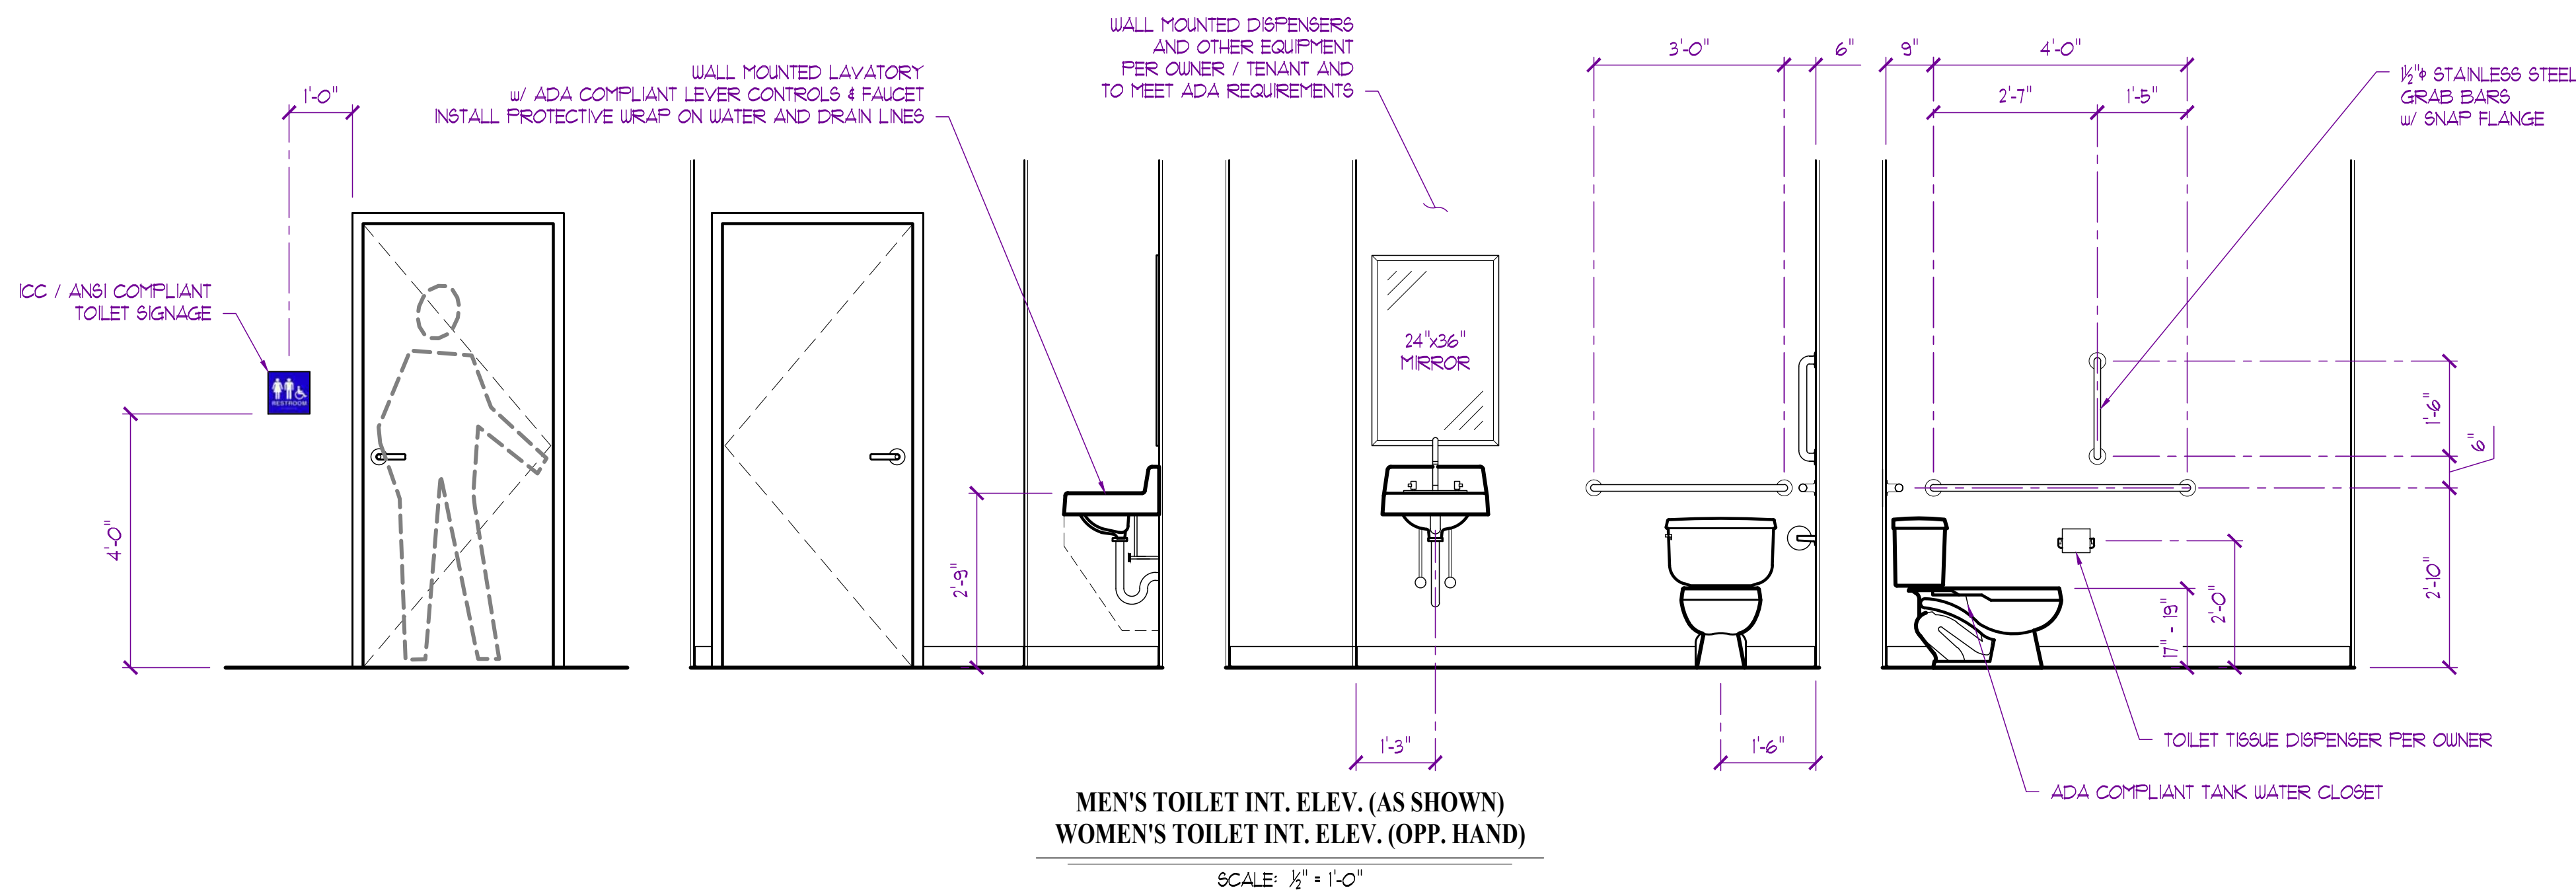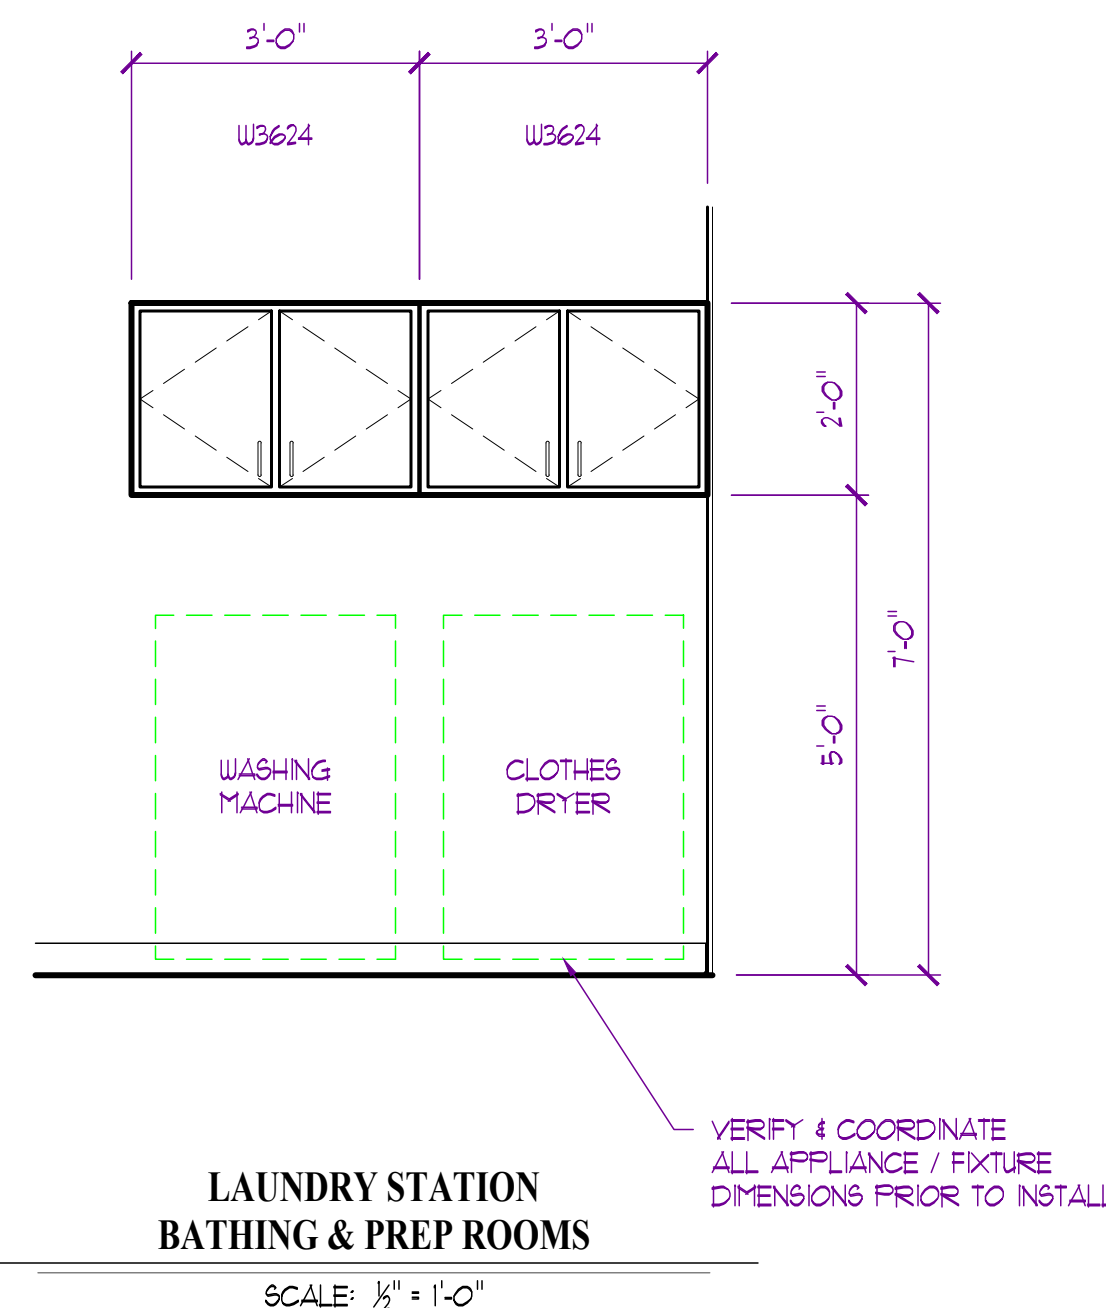


1. FOR REFERENCE ONLY. REFER TO CIVIL DRAWINGS FOR LOCATIONS
2. ALL MATERIALS & FINISHES TO BE SELECTED AND APPROVED BY OWNER / TENANT PRIOR TO ANY WORK




LEGEND: FLOORING			LEGEND: WALLS		
EXST	Existing Flooring to Remain		EXST	Existing to Remain	
SC-1	Sealed Concrete Floor		PGB-1	Painted Gypsum Board Color per Owner / Tenant	
SSC-1	Stained & Sealed Concrete F		PGB-E	Painted Gypsum Board Epoxy Based in compliance with IBC 2018 1209.2.1 thru 1209.2.4	
LVT-1	Luxury Vinyl Tile		FRP-1	Fiberglass Reinforced Plastic Panel	
CPT-1	Carpet Tile & Pad				
B-1	Wall Base	4" Vinyl Base			
CRNR	Corner Guard				

BM	By Manufacturer	
DOORS:		
ASF	Aluminum Glass Storefront	
WD-1	Solid Core Wood Door	
IHM-1	Insulated Hollow Metal Door	
HM-1	Hollow Metal Door	
IOD-1	Insulated Overhead Door	
FRAMES:		
HMF	Hollow Metal Frame	Painted
LOCKS & OPERATORS:		
FL-1	Passage Lockset	
PV-1	Office / Privacy Lockset	Keyed Deadbolt w/ Deadlatch Push Paddle
DB-1	Dead Bolt	4"x16" Standard Push/Pull Plates w/ Optional Kick Plates Each Side
PPL-1	Push / Pull Plates	
HARDWARE:		
H-1	Hinge	1 1/2" Pair Full Mortise Template Ball Bearing Standard Weight Hinges, Finish Per Owner / Tenant
H-2	Hinge	3 Pair Full Mortise Template Ball Bearing Heavy Weight Hinges, Finish Per Owner / Tenant
C-1	Closer	Surface Closer (Finish to Match Adjacent Hardware)
DS-1	Door Stop	Wall Mounted Door Stop
DS-2	Door Stop	Floor Mounted Door Stop
DS-3	Door Stop	Hinge Mounted Door Stop

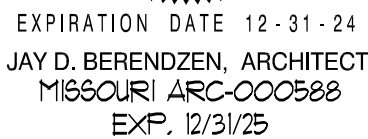

THE PROFESSIONAL ARCHITECTS
SEAL AFFIXED TO THIS SHEET
APPLIES ONLY TO THE MATERIALS
AND ITEMS SHOWN ON THIS SHEET
AND ALL DRAWINGS, INSTRUMENTS OR
OTHER DOCUMENTS NOT EXHIBITED
THIS SEAL SHALL NOT BE
CONSIDERED PREPARED BY THIS
ARCHITECT, AND THIS ARCHITECT
EXPRESSLY DISCLAIMS ANY AND
ALL RESPONSIBILITY FOR SUCH
PLAN DRAWINGS OR DOCUMENTS
NOT EXHIBITED THIS SEAL.

PORTER, BERENDZEN
& ASSOCIATES, P.C.
ARCHITECTS
573.657.2022 PHONE
jag@pba-architecture.com
CLAY BLVD.
RI 05010

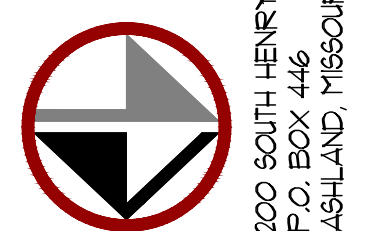

DO NOT SCALE THIS DRAWING.
SOME DEVIATION FROM SCALE
MAY OCCUR FROM REPRODUCTION.
DRAWINGS ARE THE PROPERTY OF
PORTER BERENDZEN & ASSOCIATES P.C.
AND MAY NOT BE COPIED OR
USED IN WHOLE OR PART
WITHOUT THE WRITTEN CONSENT OF
PORTER BERENDZEN & ASSOCIATES P.C.

References

Discovery Park
Discovery Pet Spa
1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

16 JUL 1997

ID	DESCRIPTION	DATE
1	PERMIT	9/19/2024

PROJECT NO. _____


SHEET TITLE

SITE DETAILS

SCHEDULES

SHEET NUMBER

A900

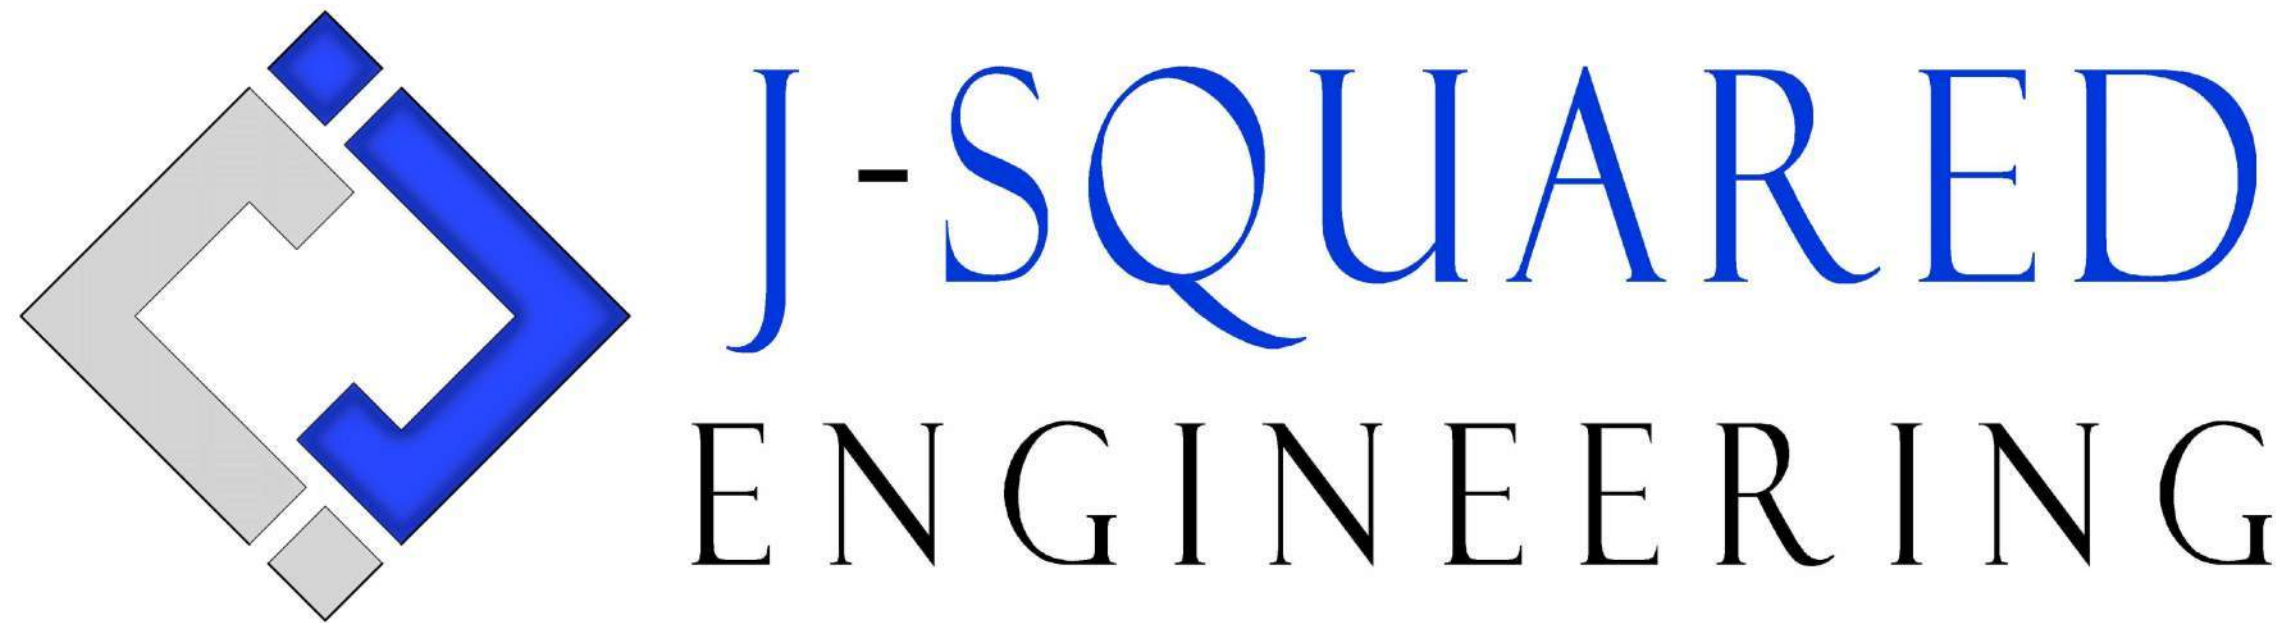

MECHANICAL - ELECTRICAL - PLUMBING DESIGN DRAWINGS FOR:

Discovery Park
Discovery Pet Spa

1921 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri 64064

GENERAL MEP SPECIFICATIONS

1. GENERAL
- 1.1.

ALL WORK SHALL BE PERFORMED IN COMPLIANCE WITH LOCALLY ADOPTED CODES AND ORDINANCES. IT IS THE RESPONSIBILITY OF CONTRACTOR TO REVIEW AND UNDERSTAND ALL DRAWINGS AND SPECIFICATIONS IN CONTRACT DOCUMENTS. EACH CONTRACTOR IS RESPONSIBLE FOR ALL WORK ASSOCIATED WITH THEIR TRADE, REGARDLESS OF WHERE WORK IS DEPICTED IN PROJECT DRAWINGS OR SPECIFICATIONS.
- 1.2.

LAYOUT OF SYSTEMS SHOWN ON PLANS ARE APPROXIMATE AND SCHEMATIC IN NATURE. ALL SYSTEMS WILL NEED TO BE FIELD-COORDINATED. CONTRACTOR SHALL INCLUDE THIS COORDINATION IN THEIR SCOPE AND INCLUDE ALL COSTS OF MODIFYING LAYOUT AS REQUIRED IN THEIR BID. PLANS ARE NOT INTENDED TO BE SHOP DRAWINGS FROM WHICH MATERIALS CAN BE ORDERED, FABRICATED, OR INSTALLED WITHOUT ADDITIONAL FIELD MEASUREMENTS AND COORDINATION.
- 1.3.

NOT ALL SPECIFIC PIECES AND COMPONENTS OF EACH SYSTEM ARE DETAILED OR OUTLINED ON PLANS. CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NECESSARY PARTS AND LABOR TO PRODUCE A COMPLETE AND FULLY OPERATIONAL SYSTEM UNLESS STATED OTHERWISE ON PLANS. CONTRACTOR IS TO PROVIDE AND INCLUDE ALL EQUIPMENT AND MATERIAL NEEDED TO COMPLETE WORK ASSOCIATED WITH THEIR BID UNLESS ANY ITEMS ARE SPECIFICALLY NOTED ON PLANS AS PROVIDED BY OTHERS. ALL MATERIALS TO BE NEW, FIRST CLASS, AND INSTALLED PER MANUFACTURER'S PUBLISHED INSTRUCTIONS.
- 1.4.

WHERE CONFLICTS EXIST BETWEEN MEP PLANS AND CIVIL, ARCHITECTURAL, OR STRUCTURAL PLANS, NOTIFY MEP ENGINEER OF DISCREPANCIES FOR CLARIFICATION PRIOR TO PERFORMING ANY WORK THAT MAY CONTRADICT INFORMATION ELSEWHERE IN THE PROJECT PLANS.
- 1.5.

THESE PLANS ARE NOT TO BE SCALED. SEE ARCHITECTURAL PLANS FOR DIMENSIONS. WHERE THERE IS A CONFLICT BETWEEN ARCHITECTURAL DIMENSIONS AND MEP DIMENSIONS, ARCHITECTURAL SHALL GOVERN.
- 1.6.

CONTRACTOR IS TO INCLUDE IN THEIR SCOPE THE COST OF ALL PERMITS, INSPECTIONS, METERING, TAPS, ETC. ASSOCIATED WITH THEIR WORK.
- 1.7.

CONTRACTOR IS RESPONSIBLE FOR ALL EXCAVATION, CUTTING, CORING, PATCHING, AND BACKFILL REQUIRED TO COMPLETE THEIR WORK, UNLESS NOTED OTHERWISE ON PLANS.
- 1.8.

SPECIFIC EQUIPMENT MANUFACTURERS AND/OR MODEL NUMBERS LISTED ON PLANS ARE TO ESTABLISH A BASIS-OF-DESIGN FOR QUALITY AND PERFORMANCE, VERIFY THAT SUBSTITUTIONS WILL BE ACCEPTABLE PRIOR TO PURCHASE & INSTALLATION.
- 1.9.

NOTIFY ENGINEER OF ANY MAJOR PLAN DISCREPANCIES OR CONFLICTS PRIOR TO PROVIDING BIDS OR COMPLETING ANY WORK.
- 1.10.

SEE DISCIPLINE SHEETS FOR ADDITIONAL TRADE SPECIFIC SPECIFICATIONS.
- 1.11.

WHERE SHUTDOWN OF ANY EXISTING UTILITY OR SERVICE TO BUILDING IS REQUIRED FOR COMPLETION OF WORK, COORDINATE OUTAGE WITH OWNER AS TO NOT DISRUPT TYPICAL OPERATIONS.
2. WORKMANSHIP
- 2.1.

SYSTEMS SHALL BE INSTALLED IN A FIRST-CLASS MANNER USING BEST ACCEPTABLE METHODS AND PRACTICES.
- 2.2.

ALL SYSTEMS SHALL BE INSTALLED PARALLEL OR PERPENDICULAR TO BUILDING ORIENTATION. COMPONENTS SHALL BE INSTALLED LEVEL AND PLUMB WITH ATTENTION GIVEN TO OVERALL AESTHETICS.
- 2.3.

CONTRACTOR IS RESPONSIBLE FOR COORDINATING EQUIPMENT LOCATIONS AND SYSTEM ROUTING WITH OTHER TRADES PRIOR TO INSTALLATION.
- 2.4.

CONTRACTOR TO GUARANTEE ALL MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE YEAR FROM THE DATE THE COMPLETED PROJECT IS RELEASED TO THE OWNER, UNLESS NOTED OTHERWISE ON PLANS.
- 2.5.

DURING INSTALLATION OF MATERIALS OR ACTIVITIES IN NEW WORK SCOPE, AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN. ANY DAMAGE TO EXISTING SURFACES OR EQUIPMENT SHALL BE CORRECTED AT NO COST TO OWNER.

DEFERRED SUBMITTAL NOTES

1. FIRE ALARM SYSTEM
- 1.1.

FIRE ALARM SYSTEM COMPONENTS SHOWN (IF APPLICABLE) ARE GENERAL AND SCHEMATIC IN NATURE, SHOWN FOR APPROXIMATE ROUGH-IN LOCATIONS AND QUANTITIES ONLY. CONTRACTOR TO VERIFY EXACT DEVICE LOCATIONS AND REQUIREMENTS WITH FIRE ALARM SYSTEM DESIGNER OF RECORD PRIOR TO ROUGH-IN.
- 1.2.

FIRE ALARM CONTRACTOR SHALL PROVIDE DEFERRED SUBMITTAL PACKAGE FOR FIRE ALARM SYSTEM. SUBMITTAL SHALL INCLUDE BATTERY CALCULATIONS, VOLTAGE DROP CALCULATIONS, EQUIPMENT SPECIFICATIONS FOR DEVICES AND PANELS, ETC. DESIGN SHALL BE SEALED BY A QUALIFIED DESIGN PROFESSIONAL LICENSED BY THE STATE.
2. FIRE SPRINKLER SYSTEM
- 2.1.

WHERE COMBINED FIRE & DOMESTIC WATER SUPPLY LINES ARE SHOWN ON PLANS, INSTALLING CONTRACTOR SHALL VERIFY WITH FIRE SPRINKLER CONTRACTOR THAT INCOMING LINE SIZE IS ADEQUATE FOR FIRE SUPPRESSION SYSTEM.
- 2.2.


FIRE SPRINKLER CONTRACTOR TO PROVIDE DEFERRED SUBMITTAL PACKAGE FOR FIRE SPRINKLER SYSTEM. SUBMITTAL SHALL INCLUDE HYDRAULIC CALCULATIONS AND SPRINKLER SYSTEM DRAWINGS SEALED BY A QUALIFIED DESIGN PROFESSIONAL LICENSED BY THE STATE.

REFERENCED CODES IN EFFECT


- PROJECT HAS BEEN DESIGNED IN COMPLIANCE WITH THE FOLLOWING CODES LISTED BELOW, BUT THIS IS NOT AN EXHAUSTIVE LIST. PROJECT SHALL COMPLY WITH ALL APPLICABLE CODES, STANDARDS, AND LOCAL REQUIREMENTS.
- 2018 INTERNATIONAL MECHANICAL CODE
 - 2018 INTERNATIONAL PLUMBING CODE
 - 2018 INTERNATIONAL FUEL GAS CODE
 - 2018 INTERNATIONAL FIRE CODE
 - 2017 NATIONAL ELECTRIC CODE

SHEET LIST TABLE

SHEET #	SHEET TITLE
MEP1	MECHANICAL ELECTRICAL PLUMBING COVER SHEET
MEP2	SITE UTILITIES - SITE LIGHTING
M101	HVAC PLAN
M501	HVAC DETAILS
M502	HVAC DETAILS
M503	HVAC DETAILS
M601	HVAC SCHEDULES
EP101	POWER PLAN
EL101	LIGHTING PLAN
E501	ELECTRICAL SCHEDULES
E601	ELECTRICAL DETAILS
PS101	SANITARY SEWER PLAN
PW101	WATER & GAS PLAN
P501	PLUMBING DETAILS & SCHEDULES

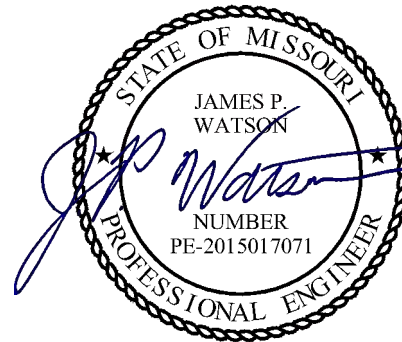

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

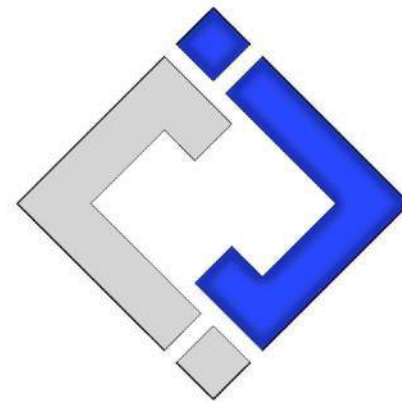

J-SQUARED
ENGINEERING
2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW


ISSUE TITLE DATE

PERMIT 09-19-2024

SITE LIGHTING FIXTURE SCHEDULE										
TAG	MANUFACTURER (OR EQUAL)	MODEL NUMBER (OR EQUAL)	DESCRIPTION	MOUNTING	LUMEN OUTPUT	CCT (°K)	CRI	VOLTS	WATTS	NOTES
PL1	MCGRAW-EDISON	PRV-XL-PA4A-740-U-5WQ	LED SITE LUMINAIRE	20' POLE ON 30" BASE	33,525	4000	70	UNV	245	WITH #MS/DIM-L40 MOTION SENSING DIMMING
PL2	MCGRAW-EDISON	PRV-XL-PA4B-740-U-T4W-HSS	LED SITE LUMINAIRE	20' POLE ON 30" BASE	28,286	4000	70	UNV	303	WITH #MS/DIM-L40 MOTION SENSING DIMMING
NOTES: 1. VERIFY LIGHT FIXTURE FINISHES WITH OWNER / ARCHITECT PRIOR TO ORDERING.										

SITE LIGHTING CALCULATION SUMMARY							
AREA / LABEL	CALC TYPE	UNITS	AVG	MAX	MIN	AVG/MIN	MAX/MIN
DOG RUN	ILLUMINANCE	FC	1.42	1.57	0.0	N.A.	N.A.
SIDEWALK AREAS	ILLUMINANCE	FC	1.30	3.50	0.6	2.2:1	5.8:1
SITE	ILLUMINANCE	FC	2.05	6.60	0.6	3.4:1	11.0:1
NOTES: 1. PHOTOMETRIC CALCULATIONS DO NOT INCLUDE EXISTING LIGHTING							

SITE UTILITIES - SITE LIGHTING PLAN SYMBOL LEGEND



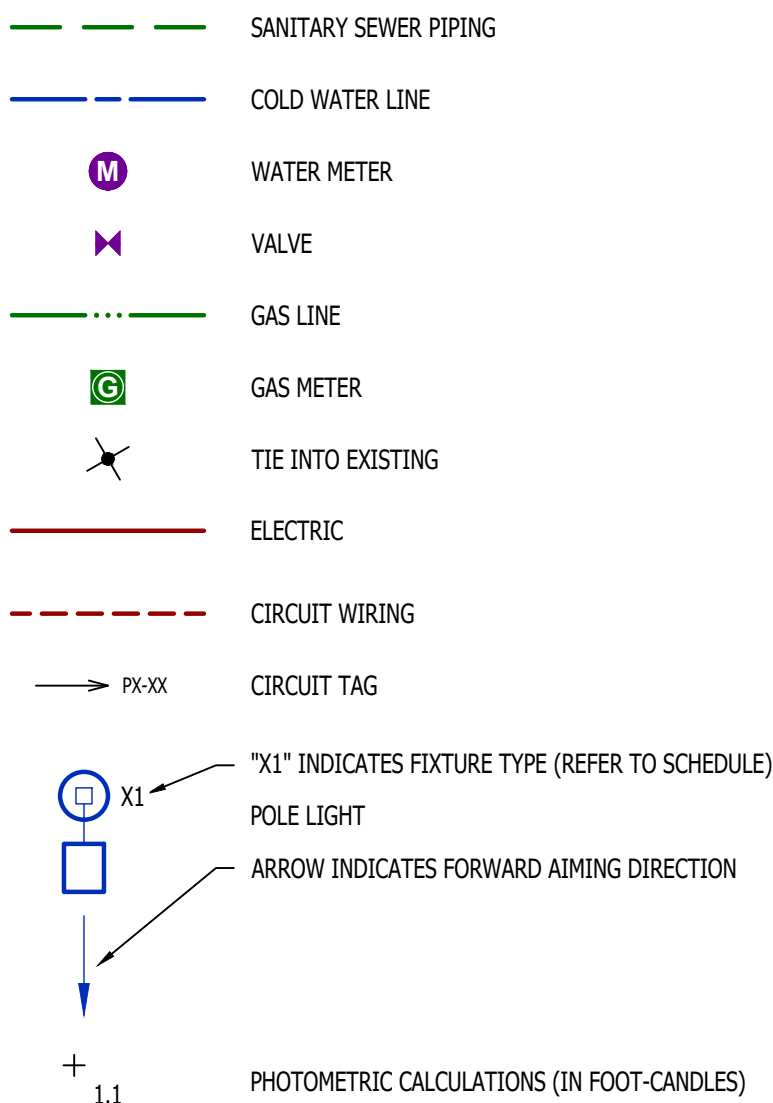


SITE UTILITIES - SITE LIGHTING PLAN GENERAL NOTES:


- REFER TO CIVIL PLANS FOR EXACT UTILITY LOCATIONS, CONNECTIONS, DETAILS, ETC.
- SITE PHOTOMETRIC VALUES SHOWN HAVE BEEN CALCULATED PER SPECIFIED LIGHT FIXTURES AT INDICATED MOUNTING HEIGHTS. ANY CHANGES OR ALTERATIONS TO LIGHTING LAYOUT SHOWN WILL REQUIRE RECALCULATING SITE PHOTOMETRICS AND WILL THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR / EQUIPMENT SUPPLIER.
- PHOTOMETRIC CALCULATIONS SHOWN DO NOT INCLUDE EXISTING LIGHT FIXTURE(S), ONLY NEW POLE LIGHT FIXTURE(S) SHOWN.

SITE UTILITIES - SITE LIGHTING PLAN KEY NOTES:

- REFER TO BUILDING LIGHTING PLANS FOR WALLPACK INFORMATION.
- 1" CONDUIT WITH (2) #10 CU. & (1) #10 CU. EQ. GRD.
- EXISTING POLE LIGHT FED FROM ADJACENT BUILDING (DATA INCLUDED IN PHOTOMETRIC CALCULATION)
- WEATHERPROOF GFCI RECEPTACLE MOUNTED TO FENCE, COORDINATE WITH G.C.

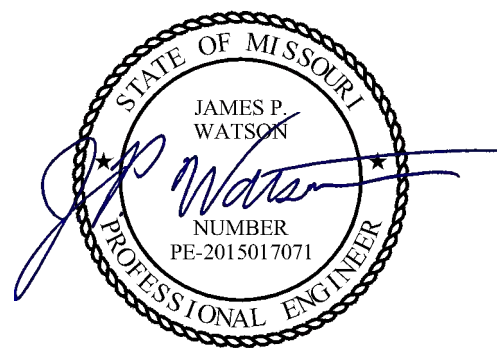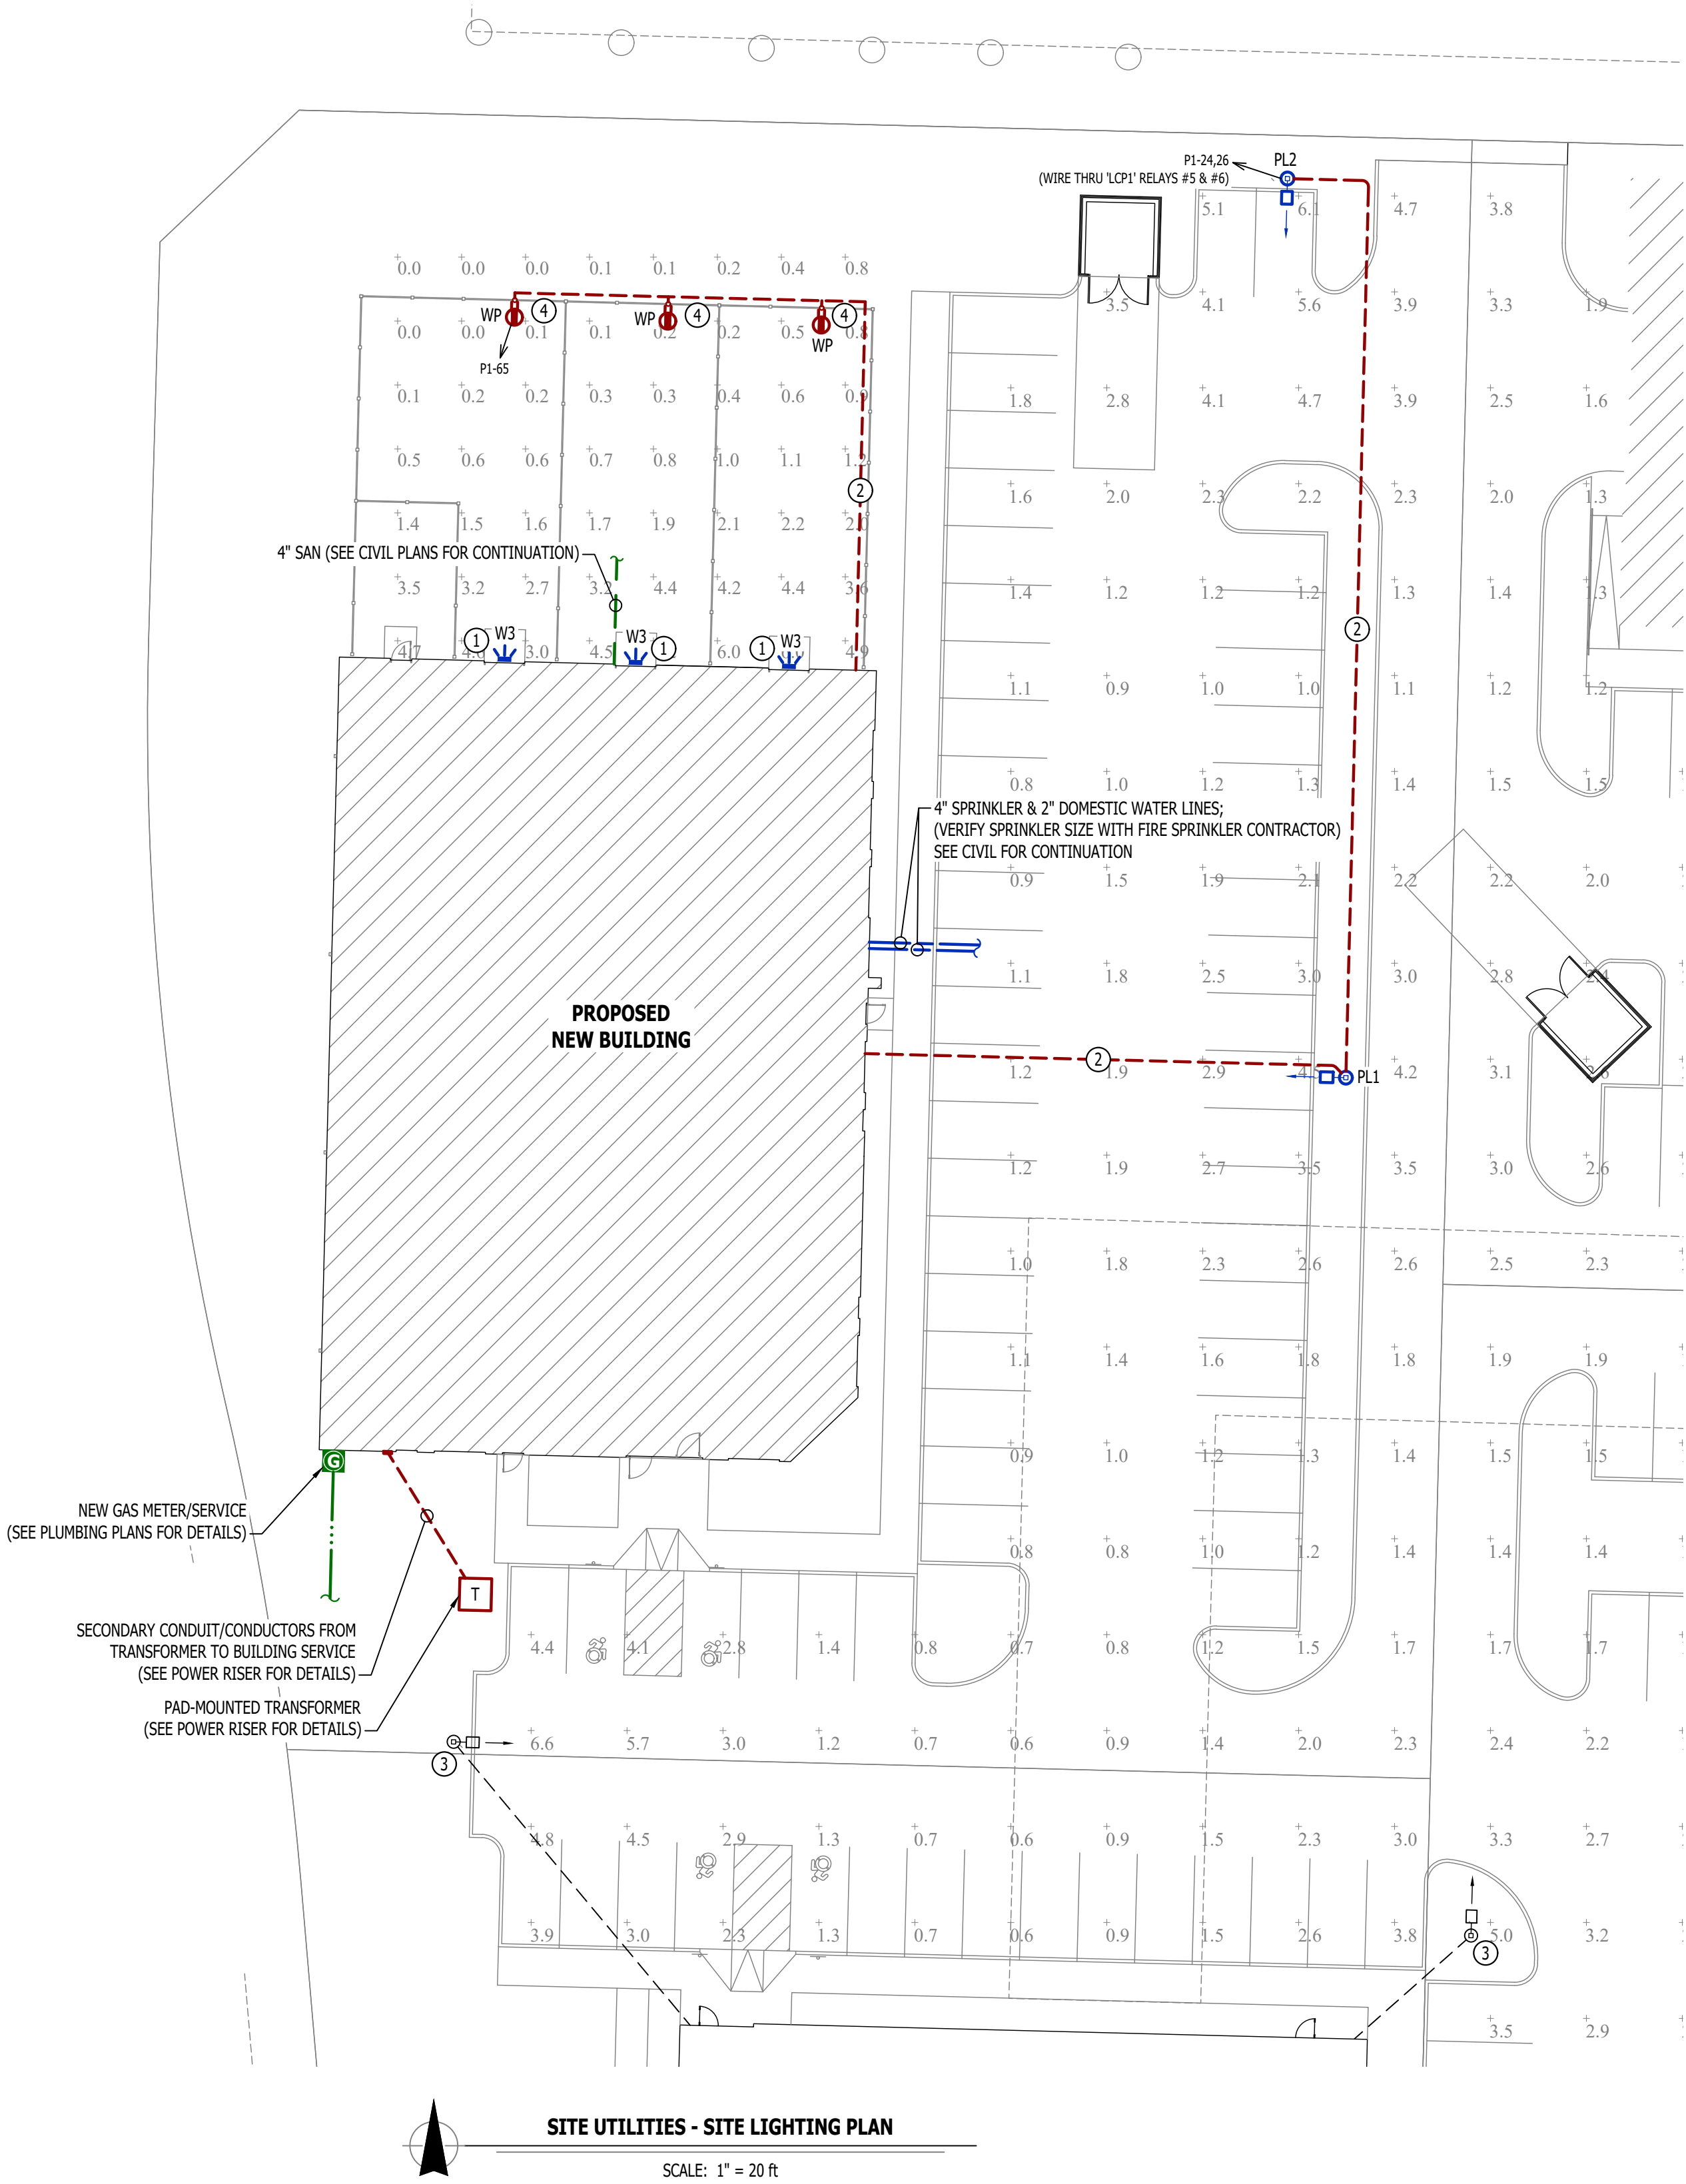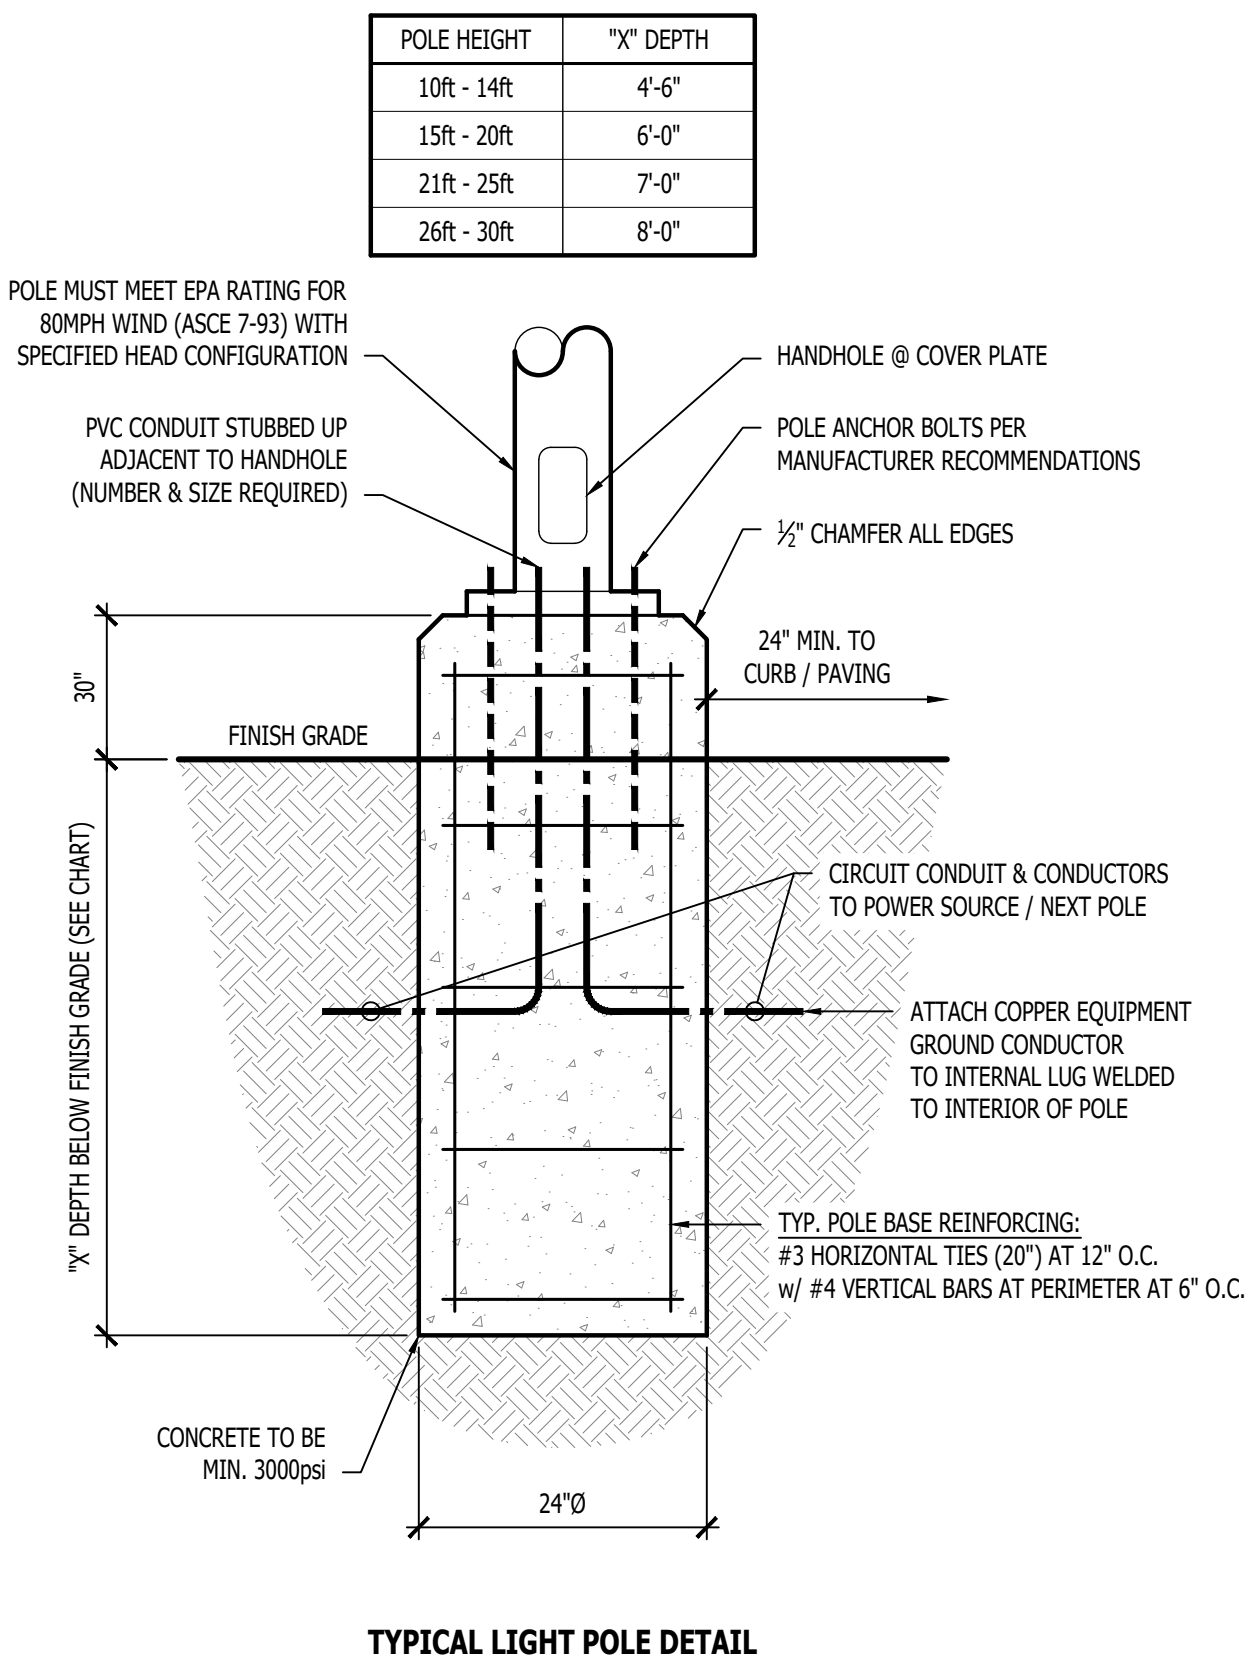

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

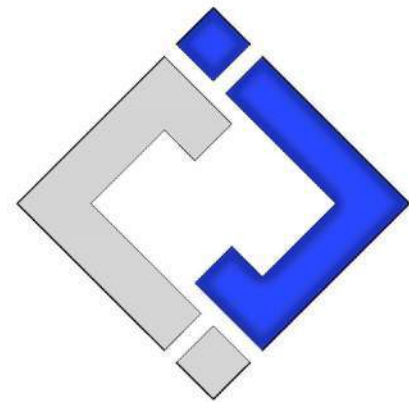

J-SQUARED
ENGINEERING

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW

ISSUE TITLE DATE

PERMIT 09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

SITE UTILITIES
- SITE
LIGHTING

SHEET NUMBER

MEP2

HVAC PLAN SYMBOL LEGEND

- ← EQUIPMENT TYPE (REFER TO EQUIPMENT SCHEDULE)
← EQUIPMENT REFERENCE NUMBER
← DIFFUSER/GRILLE TYPE (REFER TO SCHEDULE)
← CUBIC FEET PER MINUTE (CFM) / FACE SIZE
- SUPPLY DUCTWORK
RETURN DUCTWORK
EXHAUST DUCTWORK
FLEX DUCT
- SUPPLY DIFFUSER (HATCH INDICATES "NO FLOW ZONE")
RETURN DIFFUSER
BALANCE DAMPER
THERMOSTAT

HVAC PLAN GENERAL NOTES:


- REFER TO M500 AND/OR M600 SERIES SHEETS FOR ADDITIONAL HVAC NOTES, DETAILS, REQUIREMENTS, AND SCHEDULES.
- HVAC CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL EQUIPMENT, DUCTWORK, REFRIGERANT PIPING, CONDENSATE PIPING, HANGERS / SUPPORTS, ETC. WITH PLUMBING AND ELECTRICAL TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE REIMBURSED.

HVAC PLAN KEY NOTES:

- BALANCE AIRFLOW TO AMOUNT SHOWN (XXX CFM).
- 24x20 (OR EQUAL) OPEN-ENDED EXHAUST DUCT WITH BALANCE DAMPER; BALANCE EXHAUST FLOW TO 2,925 CFM.
- TRANSFER GRILLE CENTERED ABOVE DOOR.
- 4" DRYER VENT UP THRU ROOF TO GOOSENECK.


SEQUENCE OF OPERATIONS NOTES:

- DOAS-1 ONE SUPPLY / EXHAUST FAN TO RUN CONTINUOUSLY.
 - DISCHARGE AIR TEMPERATURE TO MODULATE AS NEEDED FOR SPACE CONDITIONING.
- RTU-1 TO DELIVER OA DURING OCCUPIED HOURS.
- EXHAUST FANS TO OPERATE DURING OCCUPIED HOURS.
- SEE BUILDING AIR BALANCE SUMMARY AND HVAC EQUIPMENT SCHEDULES FOR DETAILS.

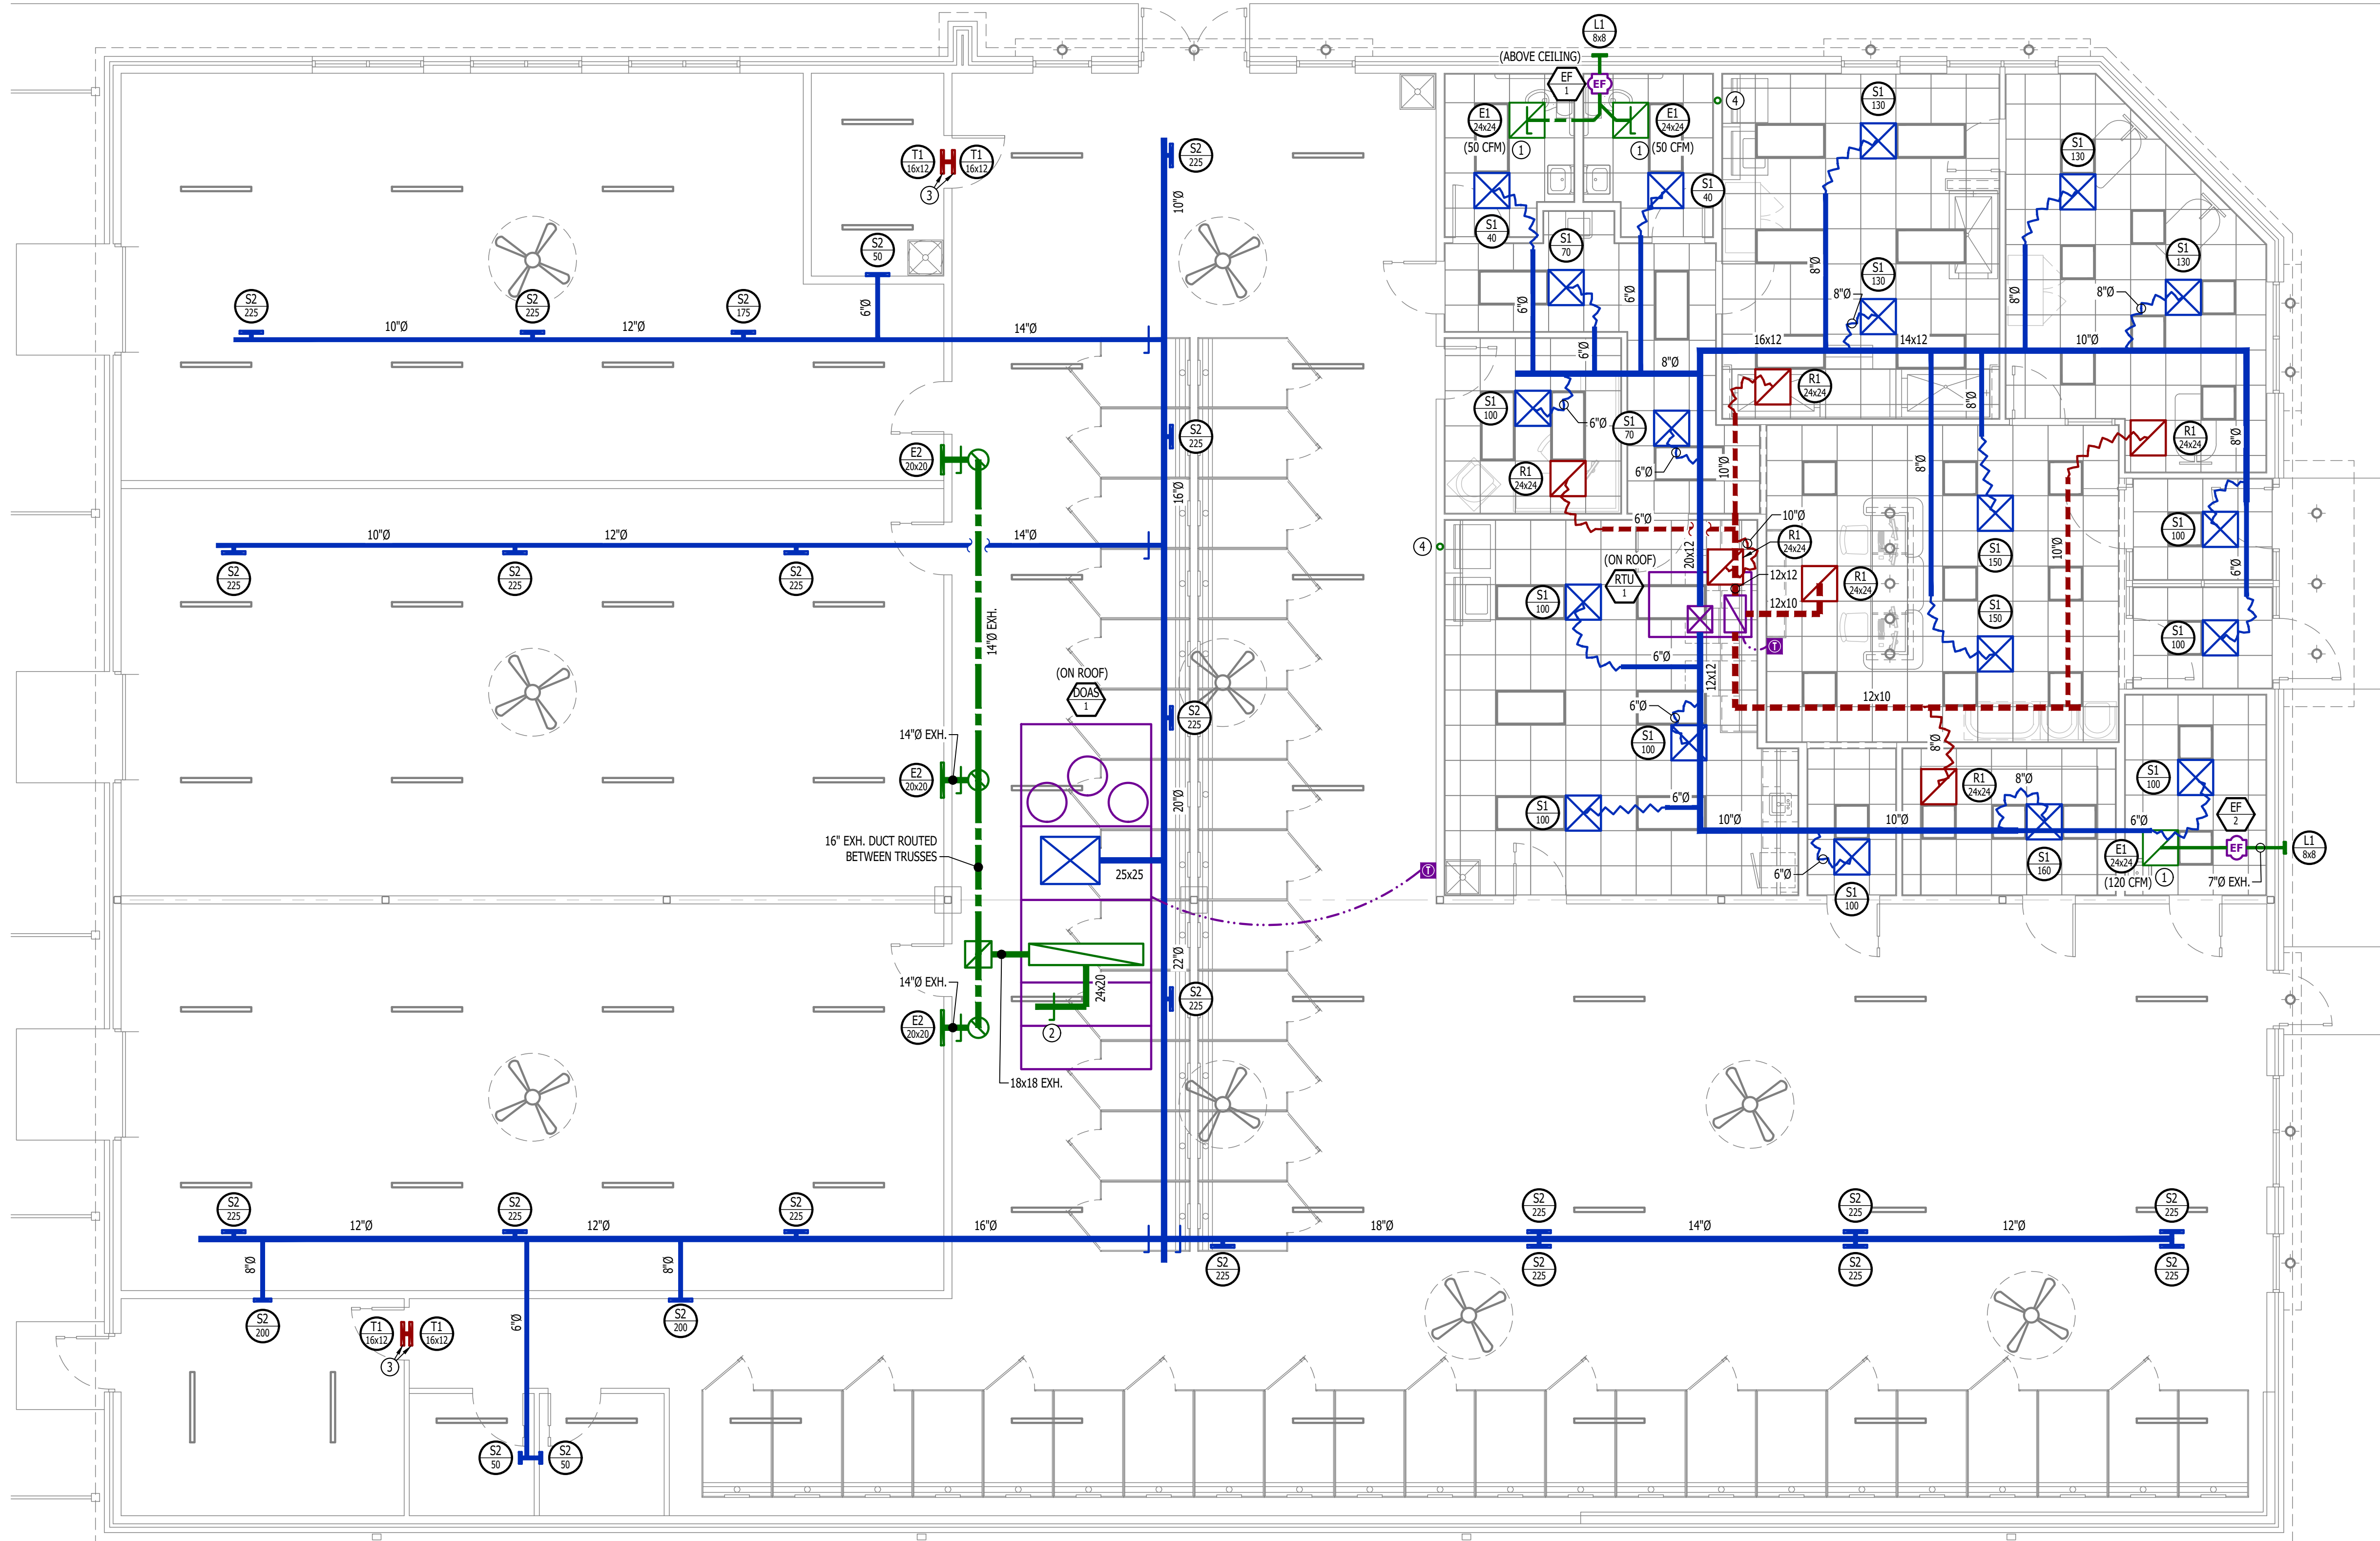


HVAC PLAN

SCALE: 3/16" = 1'-0"

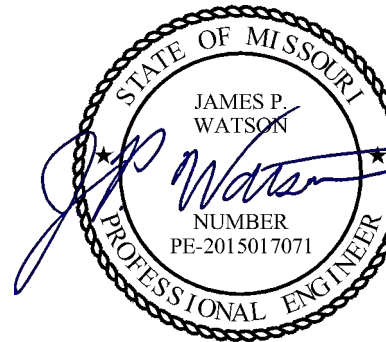

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

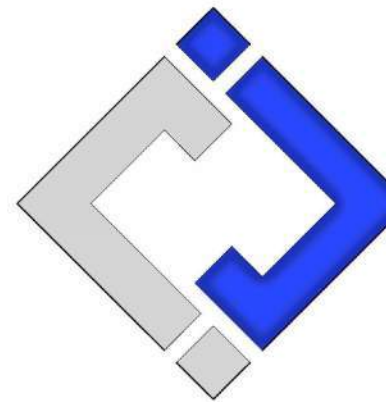

J-SQUARED
ENGINEERING

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW

ISSUE TITLE DATE

PERMIT 09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

HVAC PLAN

SHEET NUMBER

M101

HVAC SPECIFICATIONS

1.

GENERAL
- 1.1.

REFER TO GENERAL MEP SPECIFICATIONS SECTION FOR ADDITIONAL REQUIREMENTS.
2.

WORKMANSHIP
- 2.1.

COORDINATE WITH ALL OTHER TRADES SO THAT HVAC EQUIPMENT AND DUCT WORK DOES NOT BLOCK REQUIRED ACCESS OR CLEARANCE TO ANY EQUIPMENT, ACCESS PANELS, ELECTRICAL JUNCTION BOXES, ELECTRICAL PANELS, ETC.
- 2.2.

ALL HVAC EQUIPMENT IS TO BE INSTALLED PER MANUFACTURER'S PUBLISHED RECOMMENDATIONS AND/OR INSTALLATION INSTRUCTIONS.
- 2.3.

ALL EQUIPMENT TO BE INSTALLED LEVEL AND PLUMB, PARALLEL OR PERPENDICULAR TO BUILDING ORIENTATION WHERE POSSIBLE.
- 2.4.

ROOFTOP MOUNTED RTU'S SHALL BE INSTALLED ON CURBS PER MANUFACTURER'S INSTRUCTIONS. CURB HEIGHT SHALL PROVIDE A MINIMUM OF 6' BETWEEN EQUIPMENT AND TOP OF ROOF IN ALL LOCATIONS.
- 2.5.

GRADE MOUNTED RTUS, CONDENSING UNITS, AND HEAT PUMPS TO BE INSTALLED ON 4" REINFORCED CONCRETE PAD EXTENDING 4" BEYOND EACH EDGE OF THE EQUIPMENT, OR A MANUFACTURER APPROVED PRE-MANUFACTURED BASE.
- 2.6.

APPROPRIATE ATTENTION SHALL BE GIVEN TO INDOOR AIR QUALITY THROUGHOUT CONSTRUCTION; PROTECT INSIDE OF NEW DUCTWORK & AIR-HANDLING EQUIPMENT FROM DUST, DIRT, DEBRIS, PAINT, MOISTURE, ETC. INSULATION SHALL BE REPLACED IF EXPOSED TO MOISTURE. AN INDEPENDENT, PROFESSIONAL DUCT CLEANING COMPANY SHALL CLEAN ALL NEW DUCTWORK IF EQUIPMENT WAS USED DURING CONSTRUCTION, AND EQUIPMENT/COILS SHALL ALSO BE THOROUGHLY CLEANED.
- 2.7.

FIELD COORDINATE LOCATIONS OF ALL DIFFUSERS, GRILLES, REGISTERS, ETC. WITH LIGHT FIXTURE LOCATIONS AND ADJUST AS NECESSARY.
3.

EQUIPMENT
- 3.1.

ALL EQUIPMENT SHOWN ON MECHANICAL PLANS SHALL BE PROVIDED & INSTALLED BY MECHANICAL CONTRACTOR UNLESS NOTED OTHERWISE.
- 3.2.

ALL EQUIPMENT MUST PROVIDE PERFORMANCE AS SPECIFIED ON PLANS. WHERE SPECIFIC MANUFACTURERS AND/OR MODELS ARE INDICATED ON PLANS, CONTRACTOR TO PROVIDE MODEL INDICATED OR APPROVED EQUAL. VERIFY SUBSTITUTION APPROVAL PRIOR TO PURCHASE OR INSTALLATION OF EQUIPMENT.
- 3.3.

CONTRACTOR TO SUPPLY SUBMITTALS FOR ALL EQUIPMENT FOR REVIEW BY ARCHITECT AND ENGINEER. FORMAL APPROVAL SHALL BE RECEIVED BY CONTRACTOR PRIOR TO EQUIPMENT PURCHASE.
- 3.4.

CONTRACTOR TO SHARE APPROVED EQUIPMENT SUBMITTALS WITH ANY PERTINENT ELECTRICAL OR PLUMBING REQUIREMENTS WITH RESPECTIVE CONTRACTORS WITHIN TWO WEEKS OF RECEIVING APPROVED SUBMITTALS FROM ARCHITECT/ENGINEER.
- 3.5.

ALL EQUIPMENT SHOWN ON PLANS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS WITH ADEQUATE ACCESS AND CLEARANCE FOR SERVICING OR REPLACEMENT.
- 3.6.

ALL HORIZONTAL FURNACES WITH AC COILS SHALL BE EQUIPPED WITH CORROSION RESISTANT DRAIN PAN. DRAIN PAN TO DISCHARGE TO SANITARY WASTE VIA INDIRECT CONNECTION WITH AIR GAP. DRAIN PAN TO PROVIDE SECONDARY OVERFLOW OR FLOAT SWITCH INTERLOCKED WITH UNIT TO SHUT DOWN UNIT ON HIGH WATER SIGNAL.
- 3.7.

ALL EXTERIOR REFRIGERANT COILS TO BE PROTECTED BY FACTORY EQUIPPED HAIL GUARDS.
- 3.8.

REFRIGERANT PIPING TO BE ACR COPPER OR TYPE L COPPER.
- 3.9.

ALL AIR HANDLING EQUIPMENT SHALL BE EQUIPPED WITH MERV-8 FILTRATION AT RETURN OPENING UNLESS OTHERWISE NOTED.
- 3.10.

ALL AIR FILTERS SHALL BE SIZED FOR A MAXIMUM FACE VELOCITY OF 500FPM.
- 3.11.

PROVIDE & INSTALL ALL EQUIPMENT FLUES/VENTS PER MANUFACTURER'S SPECIFICATIONS. TERMINATIONS SHALL BE AT LEAST 10' FROM ANY FRESH AIR INTAKE.
- 3.12.

PROVIDE NEW AIR FILTERS IN ALL EQUIPMENT PRIOR TO TESTING & BALANCING AND BEFORE TURNING OVER SYSTEM(S) TO OWNERSHIP.
- 3.13.

IF ANY EXISTING EQUIPMENT IS TO BE REUSED, CLEAN AND INSPECT EQUIPMENT PRIOR TO BEGINNING WORK. VERIFY THAT EQUIPMENT IS IN GOOD WORKING CONDITION, REPORT ANY DEFICIENCIES TO ENGINEER.
4.

DUCTWORK
- 4.1.

DUCTWORK TO BE GALVANIZED STEEL, SEAL CLASS B, CONSTRUCTED PER SMACNA STANDARDS.
- 4.2.

DUCTWORK THICKNESS:
- 4.2.1.

26 GA. MINIMUM UP TO 16" DUCT
- 4.2.2.

24 GA. UP TO 20"
- 4.2.3.

22 GA. UP TO 24"
- 4.2.4.

20 GA. UP TO 28"
- 4.2.5.

18 GA. UP TO 36"
- 4.3.

TURNING VANES SHALL BE PROVIDED AND INSTALLED AT ALL 90° BENDS AND TEES.
- 4.4.

ALL DUCT DIMENSIONS LISTED ARE TO INTERIOR OF DUCT LINER UNLESS NOTED OTHERWISE ON PLANS.
- 4.5.

BALANCE DAMPERS MUST BE PROVIDED TO ALLOW ADJUSTMENT AT EACH AIR TERMINAL.
- 4.5.1.

WHERE BRANCH TAKEOFF IS ACCESSIBLE (ABOVE LAY-IN CEILING OR EXPOSED DUCT), BALANCE DAMPER IS TO BE INSTALLED AT TAKEOFF.
- 4.5.2.

WHERE TAKEOFF IS INACCESSIBLE (IN ATTIC OR SOFFIT), BALANCE DAMPER IS TO BE LOCATED SUCH THAT IT IS ACCESSIBLE FROM FACE OF AIR DEVICE.
- 4.6.

HVAC CONTRACTOR RESPONSIBLE FOR ALL DUCTWORK TRANSITIONS AND FITTINGS AS REQUIRED FOR FINAL CONNECTIONS TO HVAC EQUIPMENT.
- 4.7.

UNLESS NOTED OTHERWISE ON PLANS, FLEXIBLE DUCT CONNECTIONS MAY USED FROM BRANCH DUCTS TO FINAL AIR DEVICES, BUT SHALL NOT EXCEED 8'-0" IN LENGTH. FLEXIBLE DUCT CONNECTORS MUST BE SUPPORTED PER PLAN DETAILS.
5.

INSULATION
- 5.1.

DUCTWORK
- 5.1.1.

SEE "TYPICAL DUCT INSULATION DIAGRAM" FOR INSTALLATION SPECIFIC REQUIREMENTS.
- 5.1.2.

INTERNAL DUCT LINER TO BE EQUAL TO 'JOHNS MANVILLE LINACOUSTIC R-300'.
- 5.1.3.

EXTERNAL DUCT WRAP TO INCLUDE VAPOR BARRIER. EQUAL TO 'JOHNS MANVILLE MICROLITE' WITH FSK JACKET.
- 5.2.

REFRIGERANT PIPING
- 5.2.1.

SPLIT SYSTEM (SUCTION LINE ONLY) - 1" CLOSED CELL ELASTOMERIC FOAM (EQUAL TO 'ARMAFLEX AP').
- 5.3.

VRV/VRF SYSTEMS (BOTH SUCTION AND HOT GAS LINES) 1 1/2" EPDM (EQUAL TO 'AEROFLEX AEROCEL AC') WITHIN CONDITIONED SPACES & 2" EPDM (EQUAL TO 'AEROFLEX AEROCEL AC') IN UNCONDITIONED SPACES, AND WITH BANDED ALUMINUM SHIELDING IN EXTERIOR SPACES.
- 5.4.

CONDENSATE PIPING
- 5.4.1.

SPLIT SYSTEMS - WHERE CONDENSATE PIPING IS LOCATED IN UNCONDITIONED SPACE, INSULATE WITH 1/2" ELASTOMERIC. NO INSULATION REQUIRED WITHIN CONDITIONED SPACES.
- 5.4.2.




VRV/VRF - INSULATE WITH 1/2" ELASTOMERIC.
6.

TESTING AND BALANCING
- 6.1.


ALL SYSTEMS MUST BE BALANCED TO WITHIN 10% OF VALUES INDICATED ON PLAN.
- 6.2.

HVAC CONTRACTOR TO PROVIDE WRITTEN BALANCE REPORT INCLUDING FLOW VALUES INDICATED ON PLANS, INITIAL MEASURED FLOW VALUES, AND FINAL MEASURED VALUES.
- 6.3.

THIRD PARTY CERTIFIED TEST AND BALANCE NOT REQUIRED UNLESS OTHERWISE NOTED ON PLANS OR WITHIN PROJECT MANUAL.

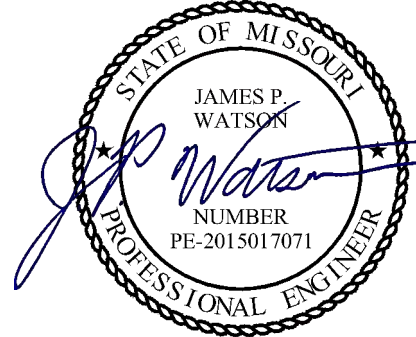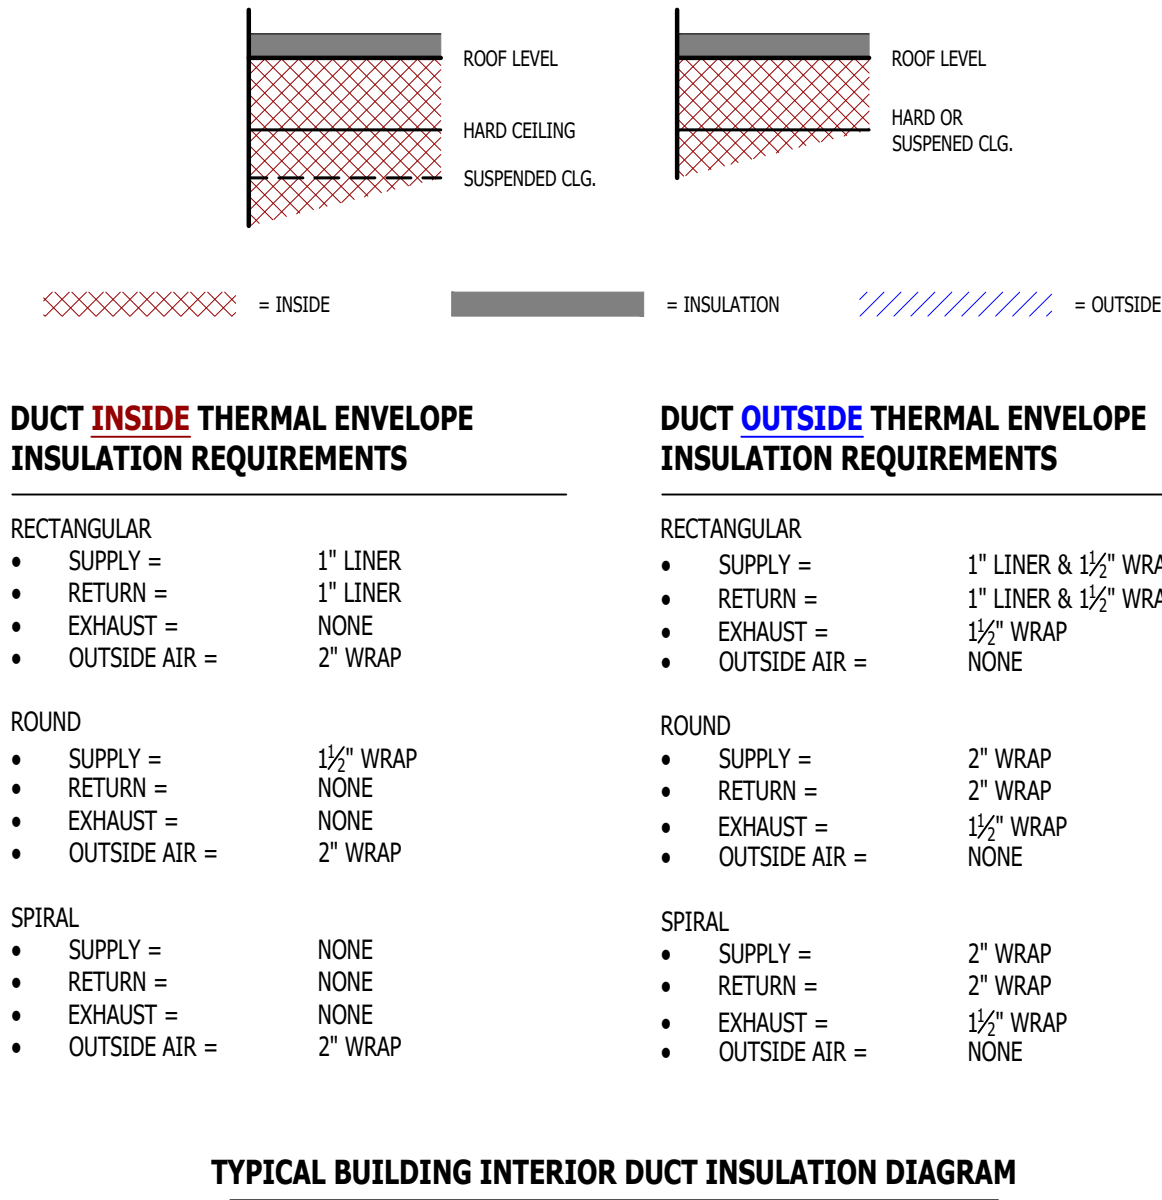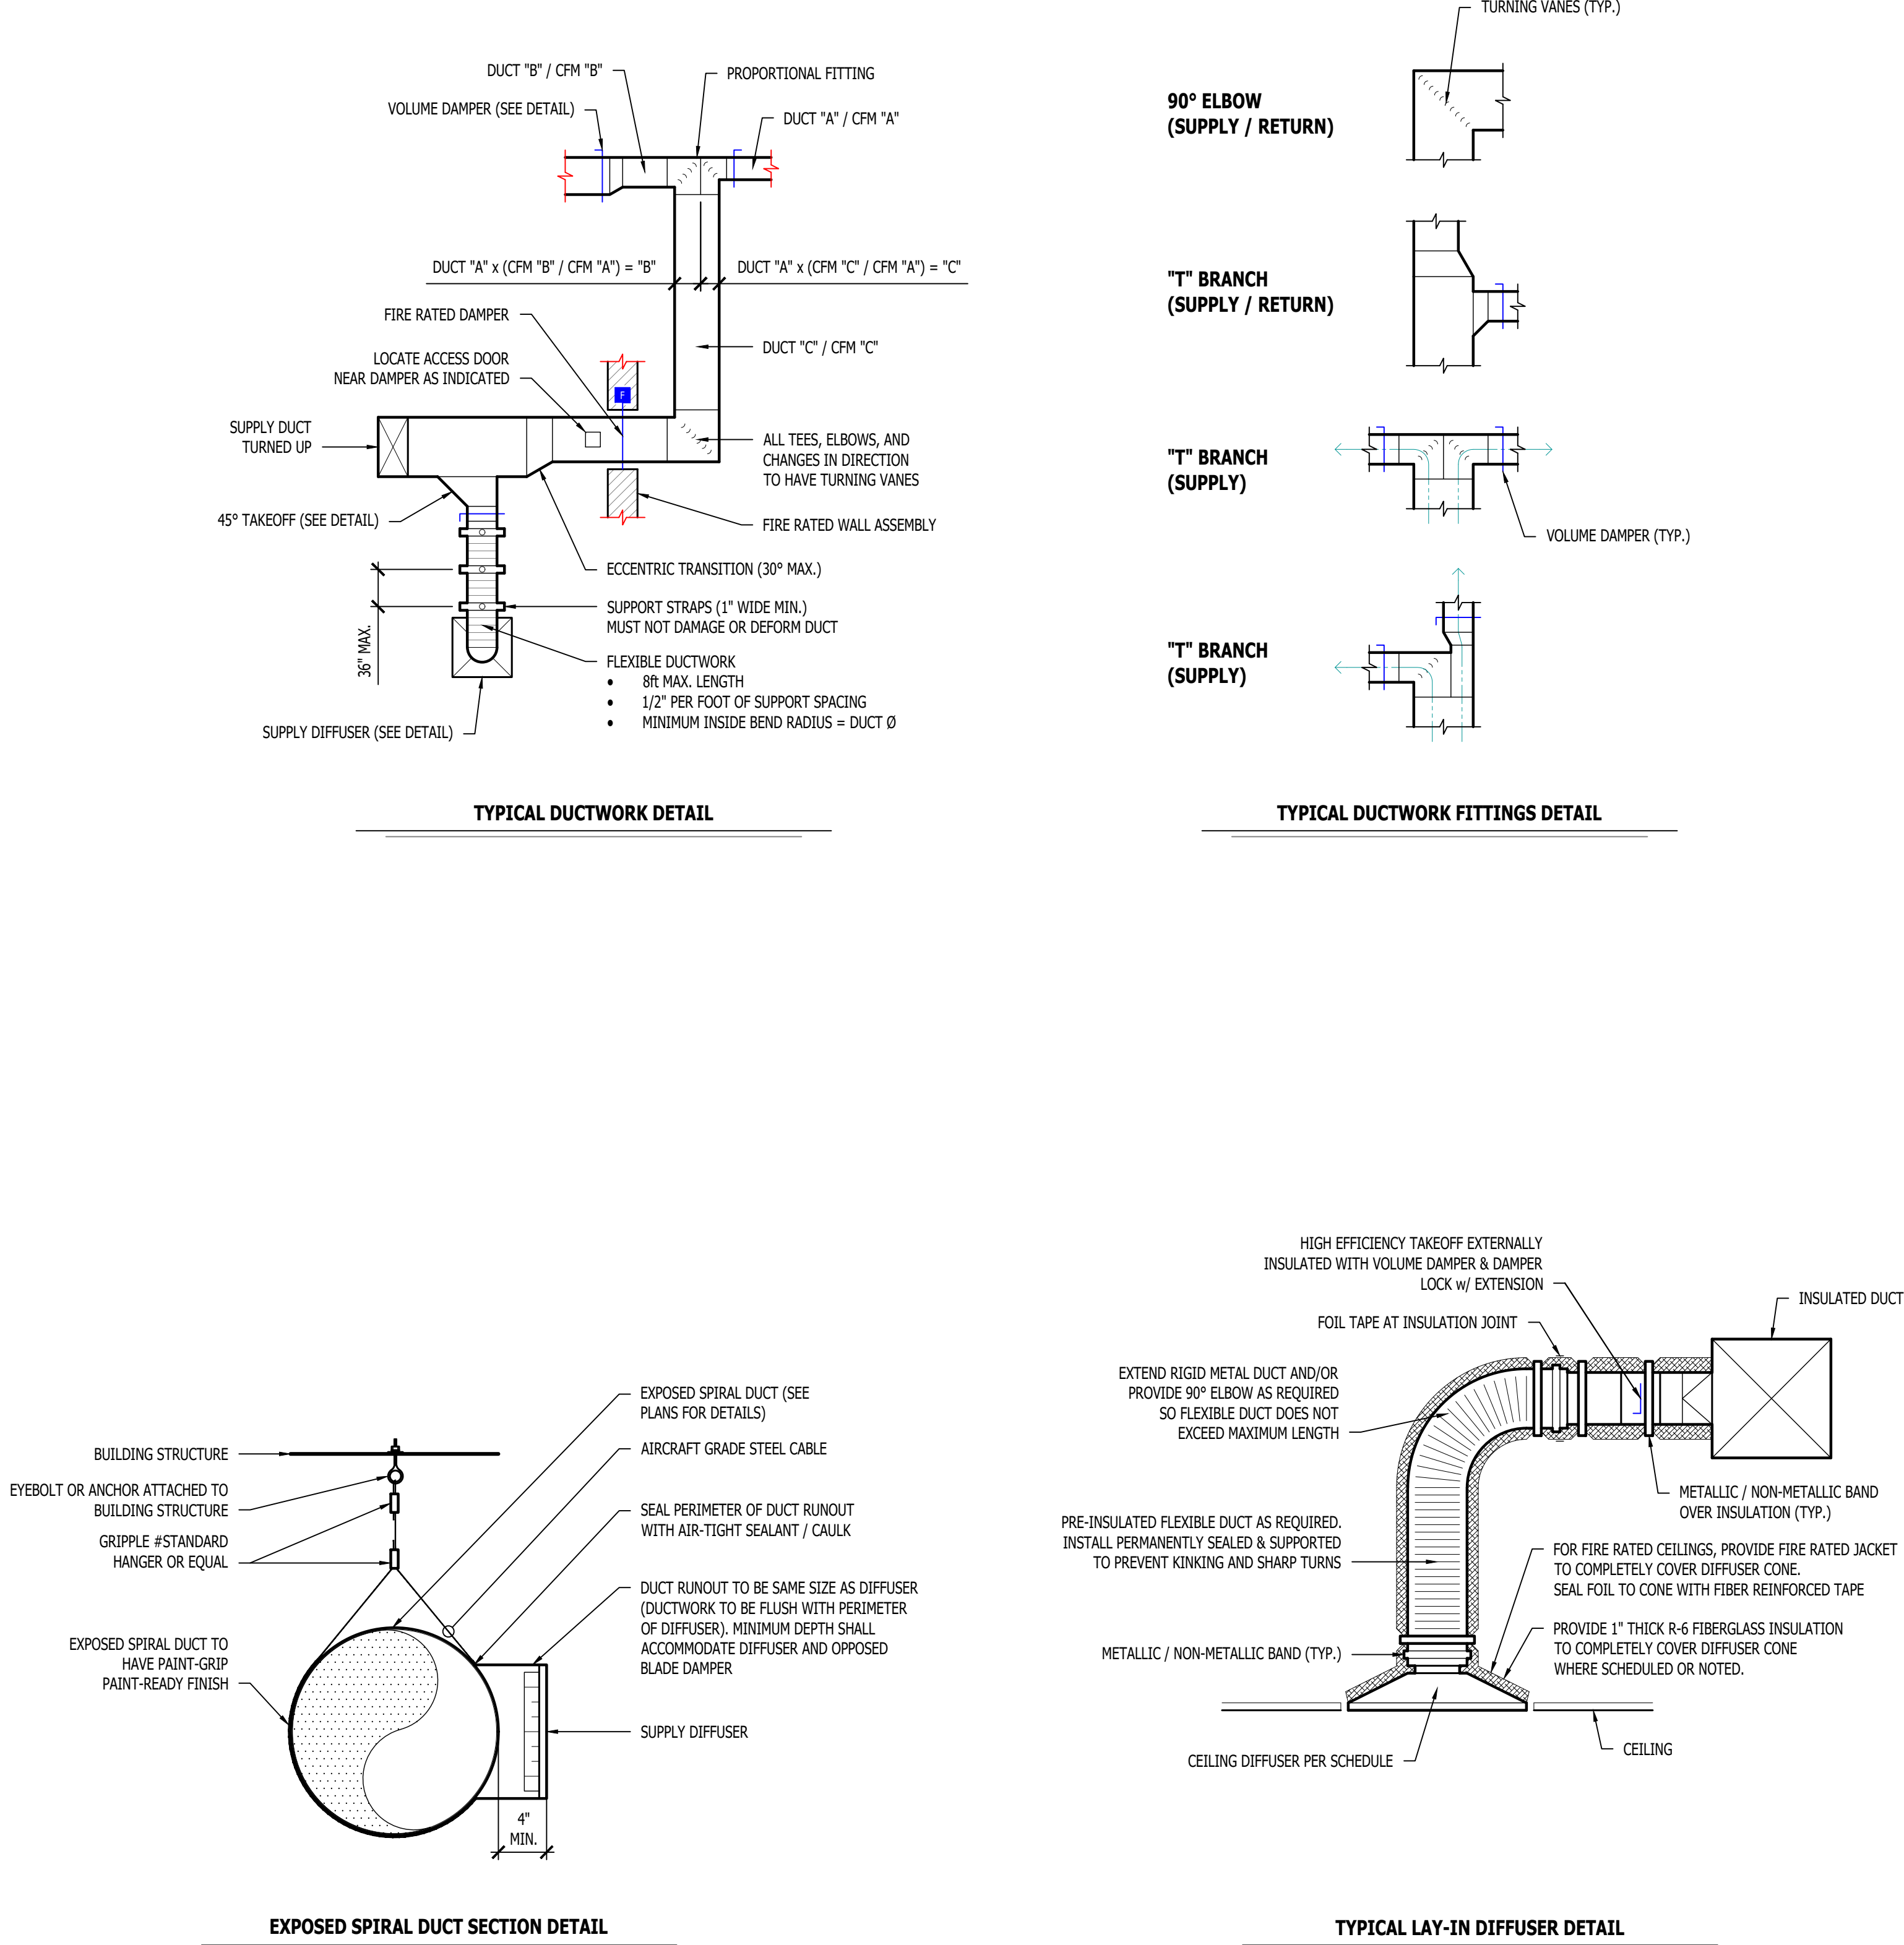

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

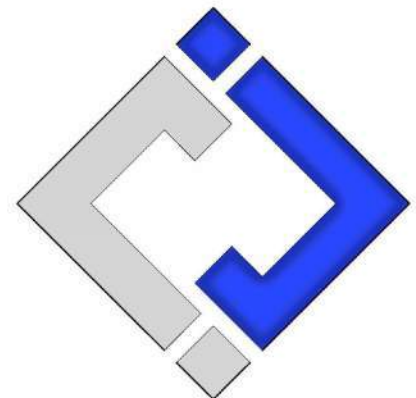

**J-SQUARED
ENGINEERING**
2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No:	J21205
J2 DESIGN:	ACW
ISSUE TITLE	DATE
PERMIT	09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

HVAC DETAILS








SHEET NUMBER

M501

FAN #1 CAS-HVAC4-I600-30MF-30T-ERV - HEATER

- NOTES:
- DO NOT OBSTRUCT OUTSIDE AIR INLET, OUTSIDE AIR COIL OR OUTSIDE AIR FAN.
 - CORNER DENOTES CORNER WEIGHT.
 - ROOF OPENING MUST BE 2" SMALLER THAN CURB DIMENSIONS IN BOTH DIRECTIONS.
 - CONNECTION FROM BREAKER TO UNITS SAFETY DISCONNECT SWITCH TO BE COPPER WIRE ONLY.
 - EXTERIOR GAS CONNECTION PROVIDED BY FACTORY WITH QUICK SEAL AND ANTI-ROTATION BRACKET.

*NOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE AS OUTLINED IN AMCA PUBLICATION 201. WHEN USING RECTANGULAR DUCTWORK, ELBOWS MUST BE RADIUS THROAT, RADIUS BACK WITH TURNING VANES. FLEXIBLE DUCTWORK AND SQUARE THROAT/SQUARE BACK ELBOWS SHOULD NOT BE USED. ANY TRANSITION AND/OR TURNS IN THE DUCTWORK WILL CAUSE SYSTEM EFFECT. SYSTEM EFFECT WILL DRASTICALLY INCREASE STATIC PRESSURE AND REDUCE AIRFLOW, DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY. FAILURE TO PROPERLY SIZE DUCTWORK MAY CAUSE SYSTEM EFFECTS AND REDUCE PERFORMANCE OF THE EQUIPMENT. SUGGESTED STRAIGHT DUCT SIZE IS 30.875" x 39.75".

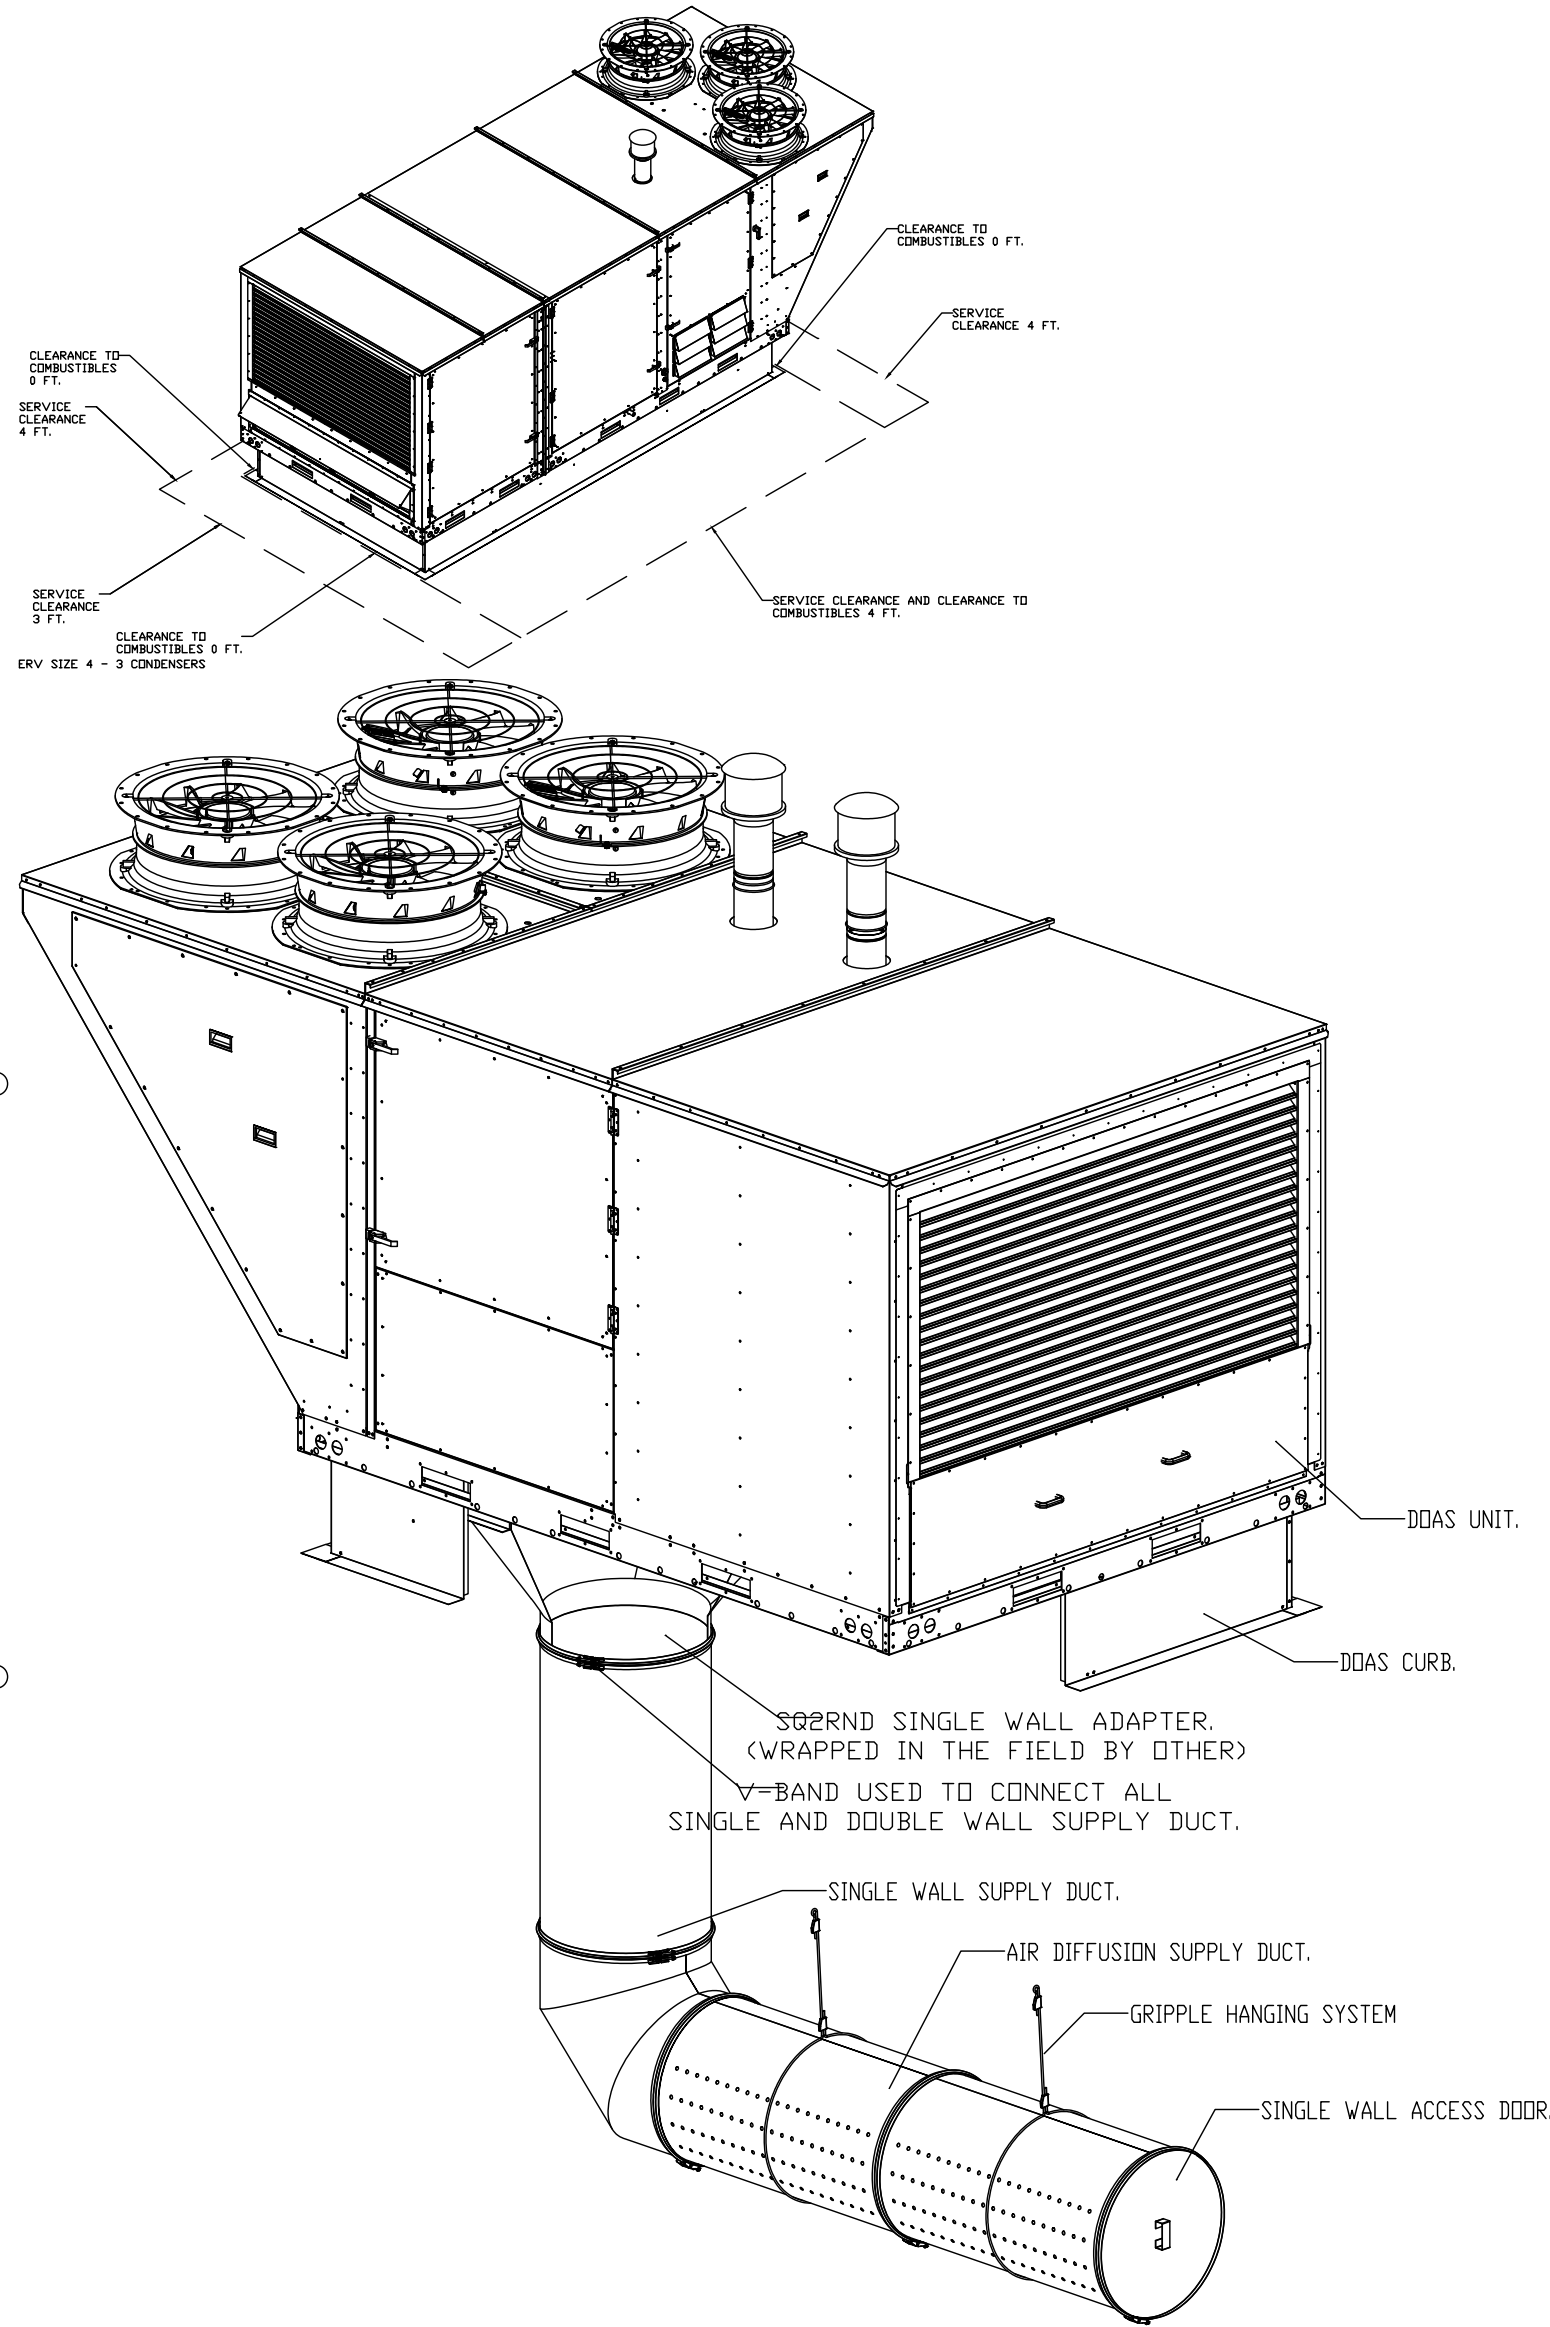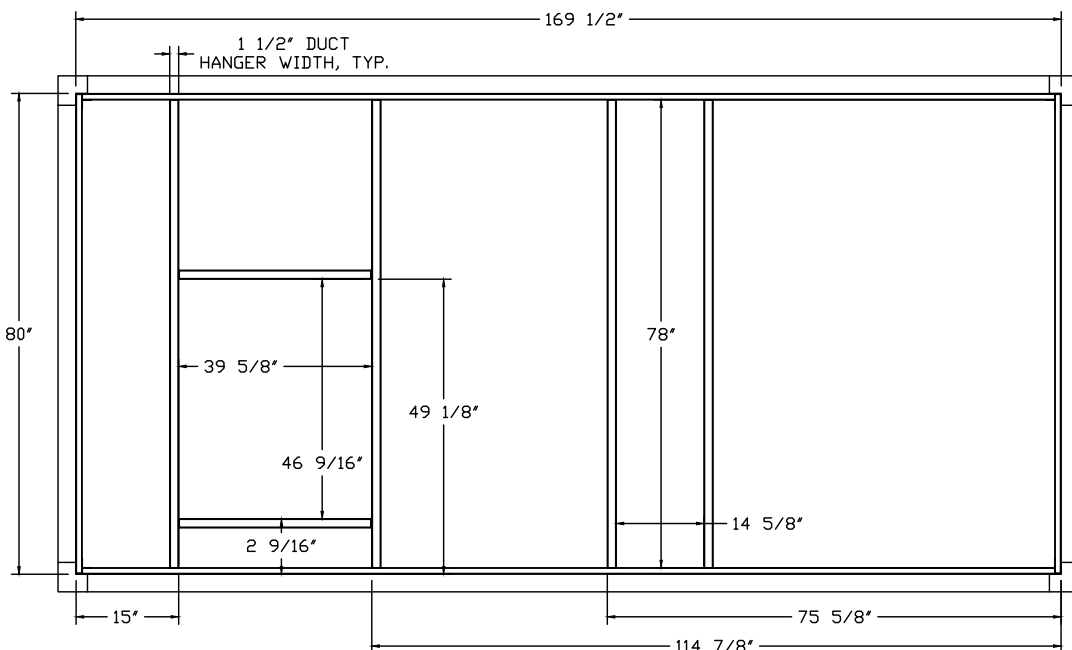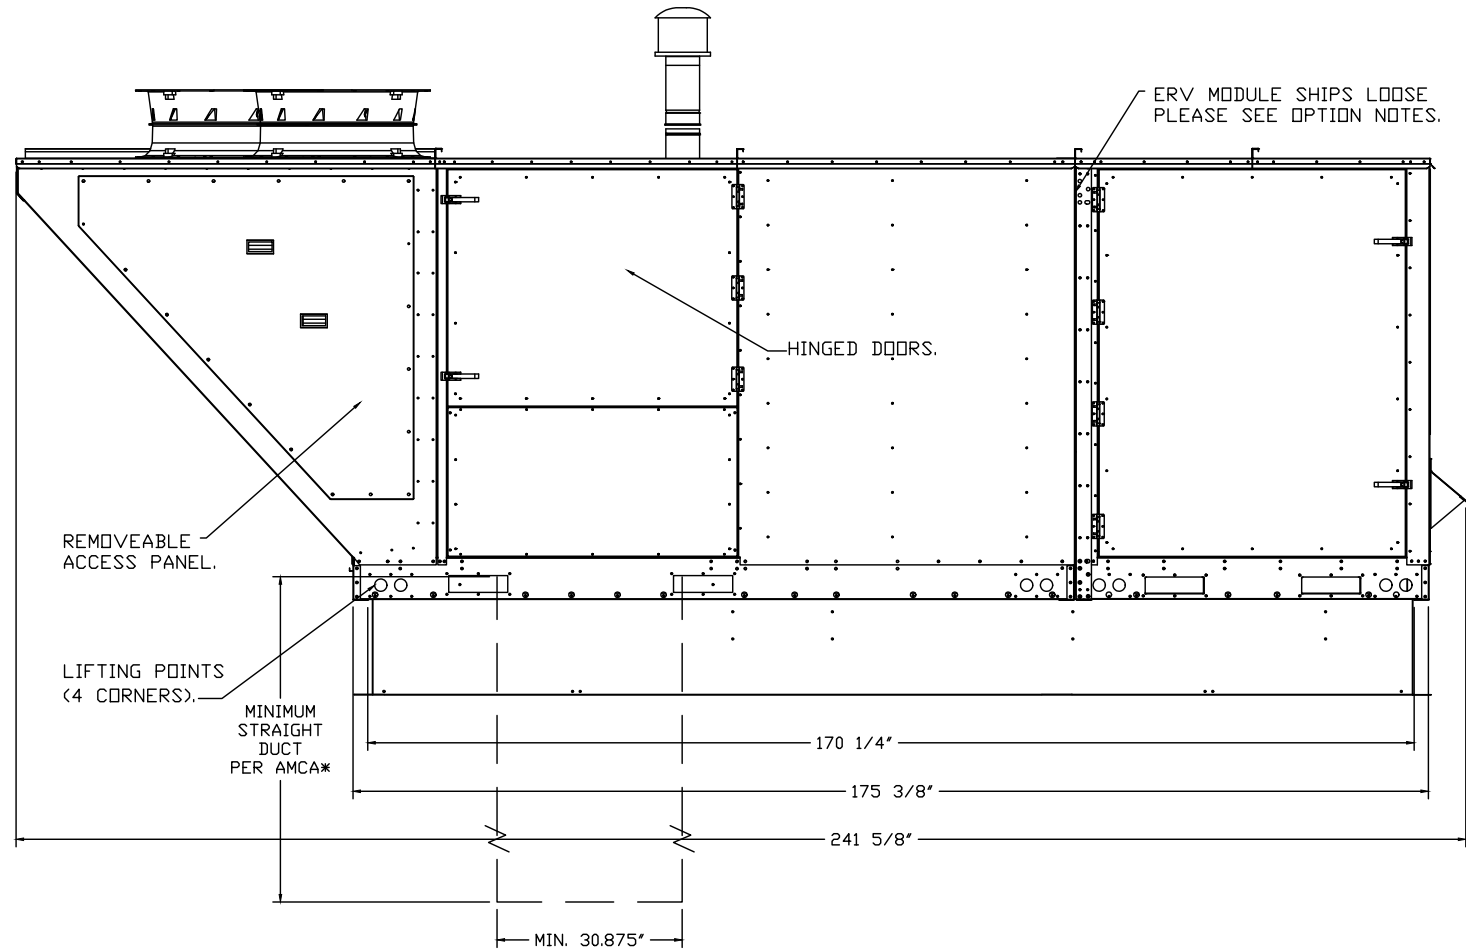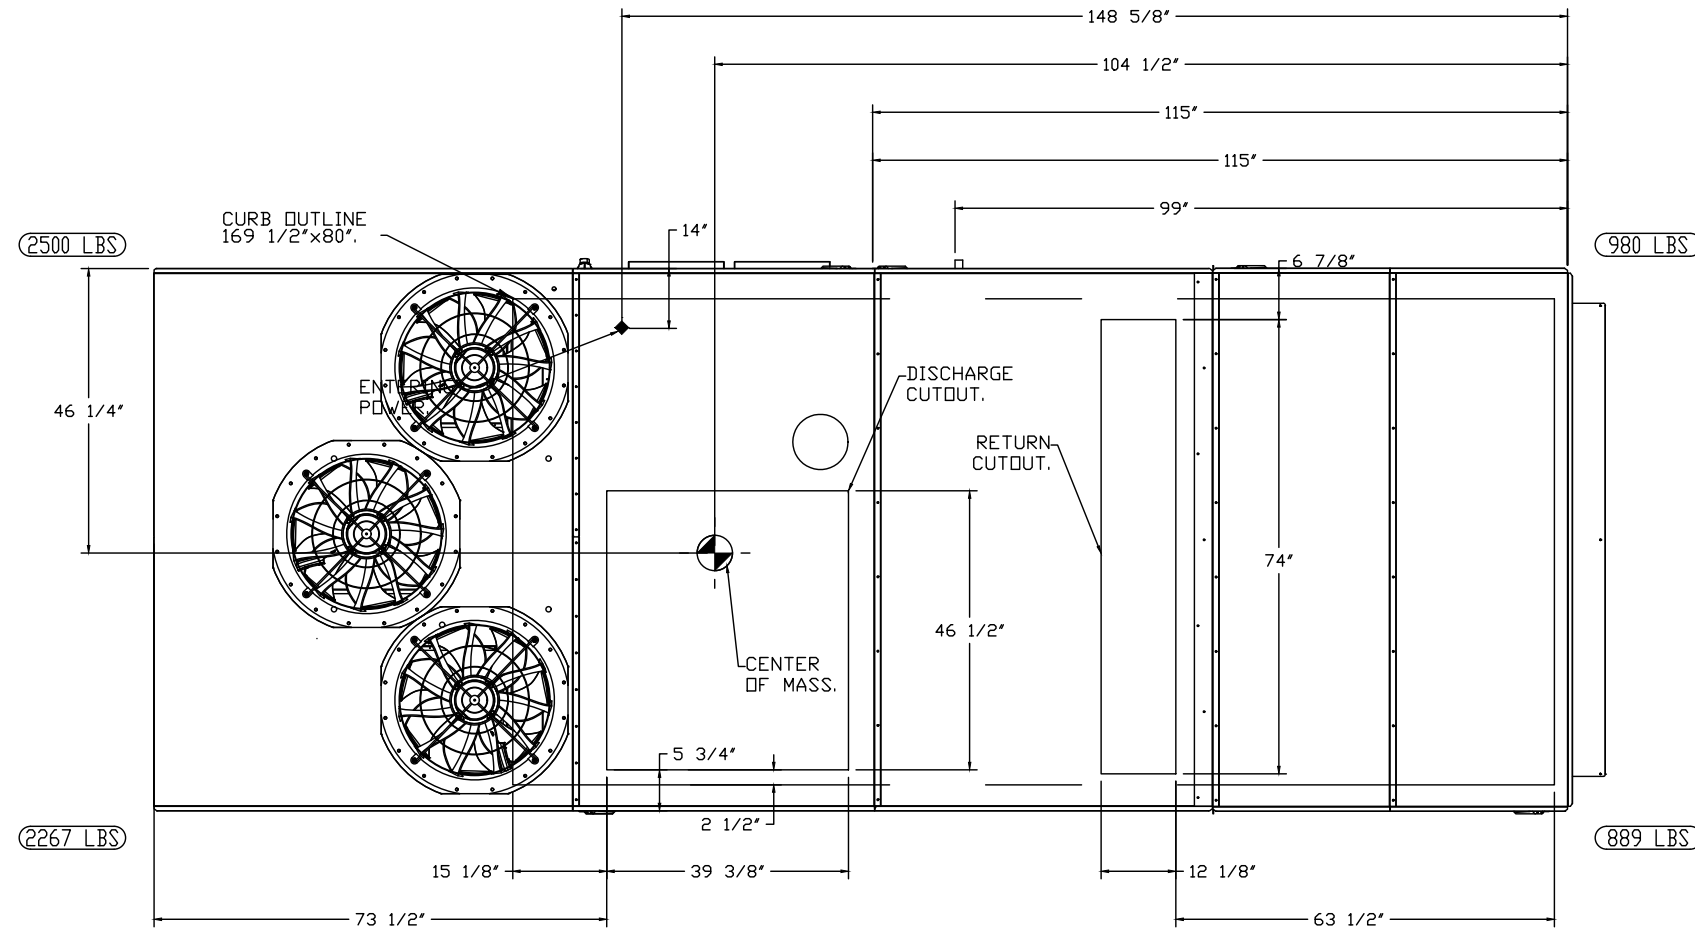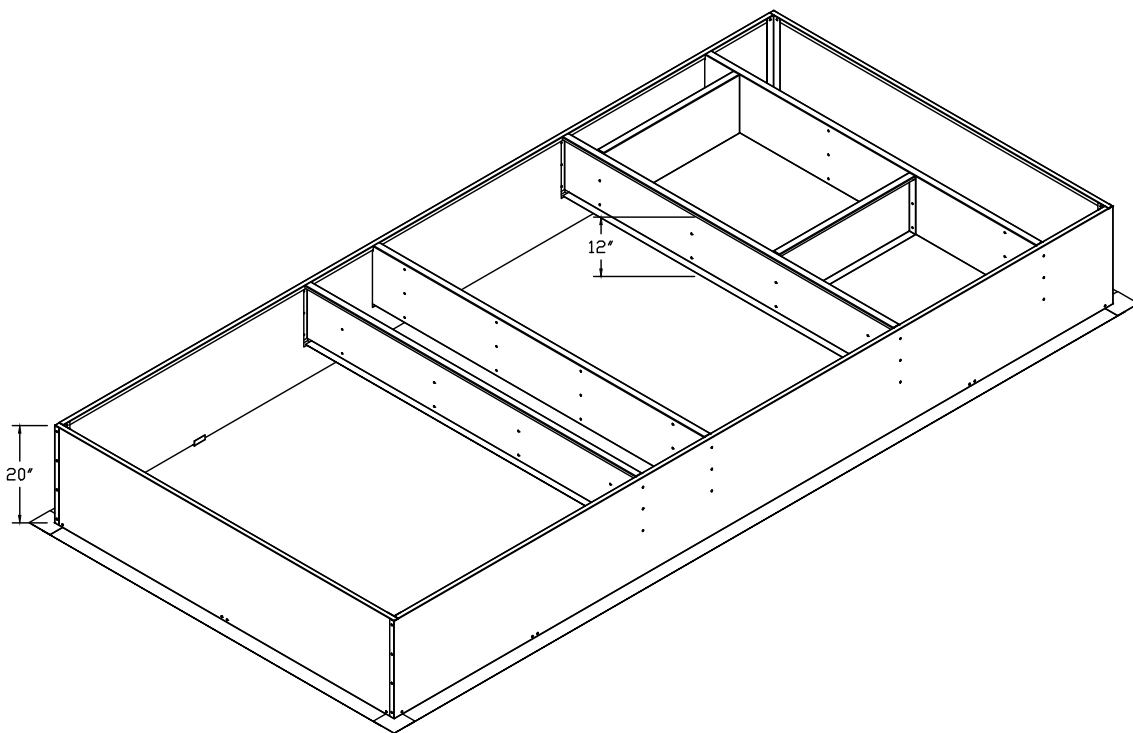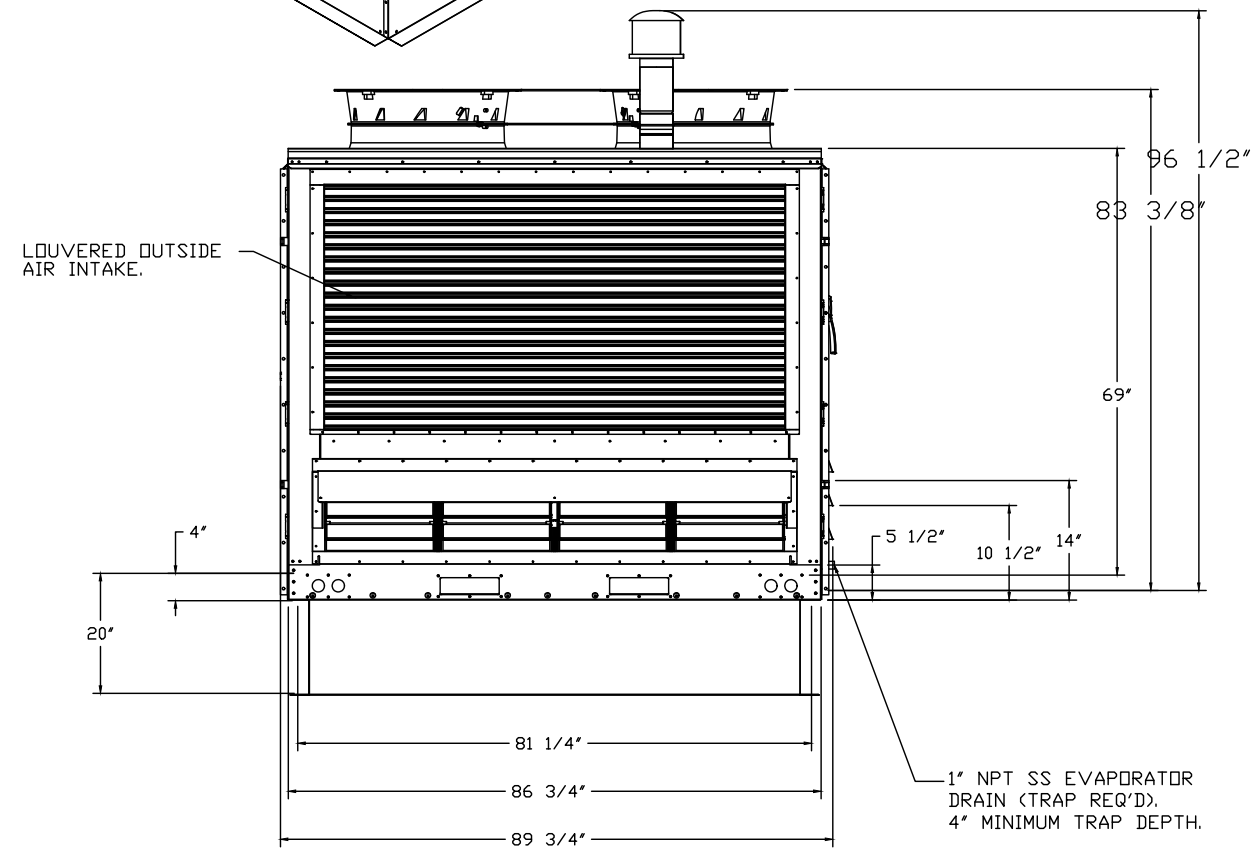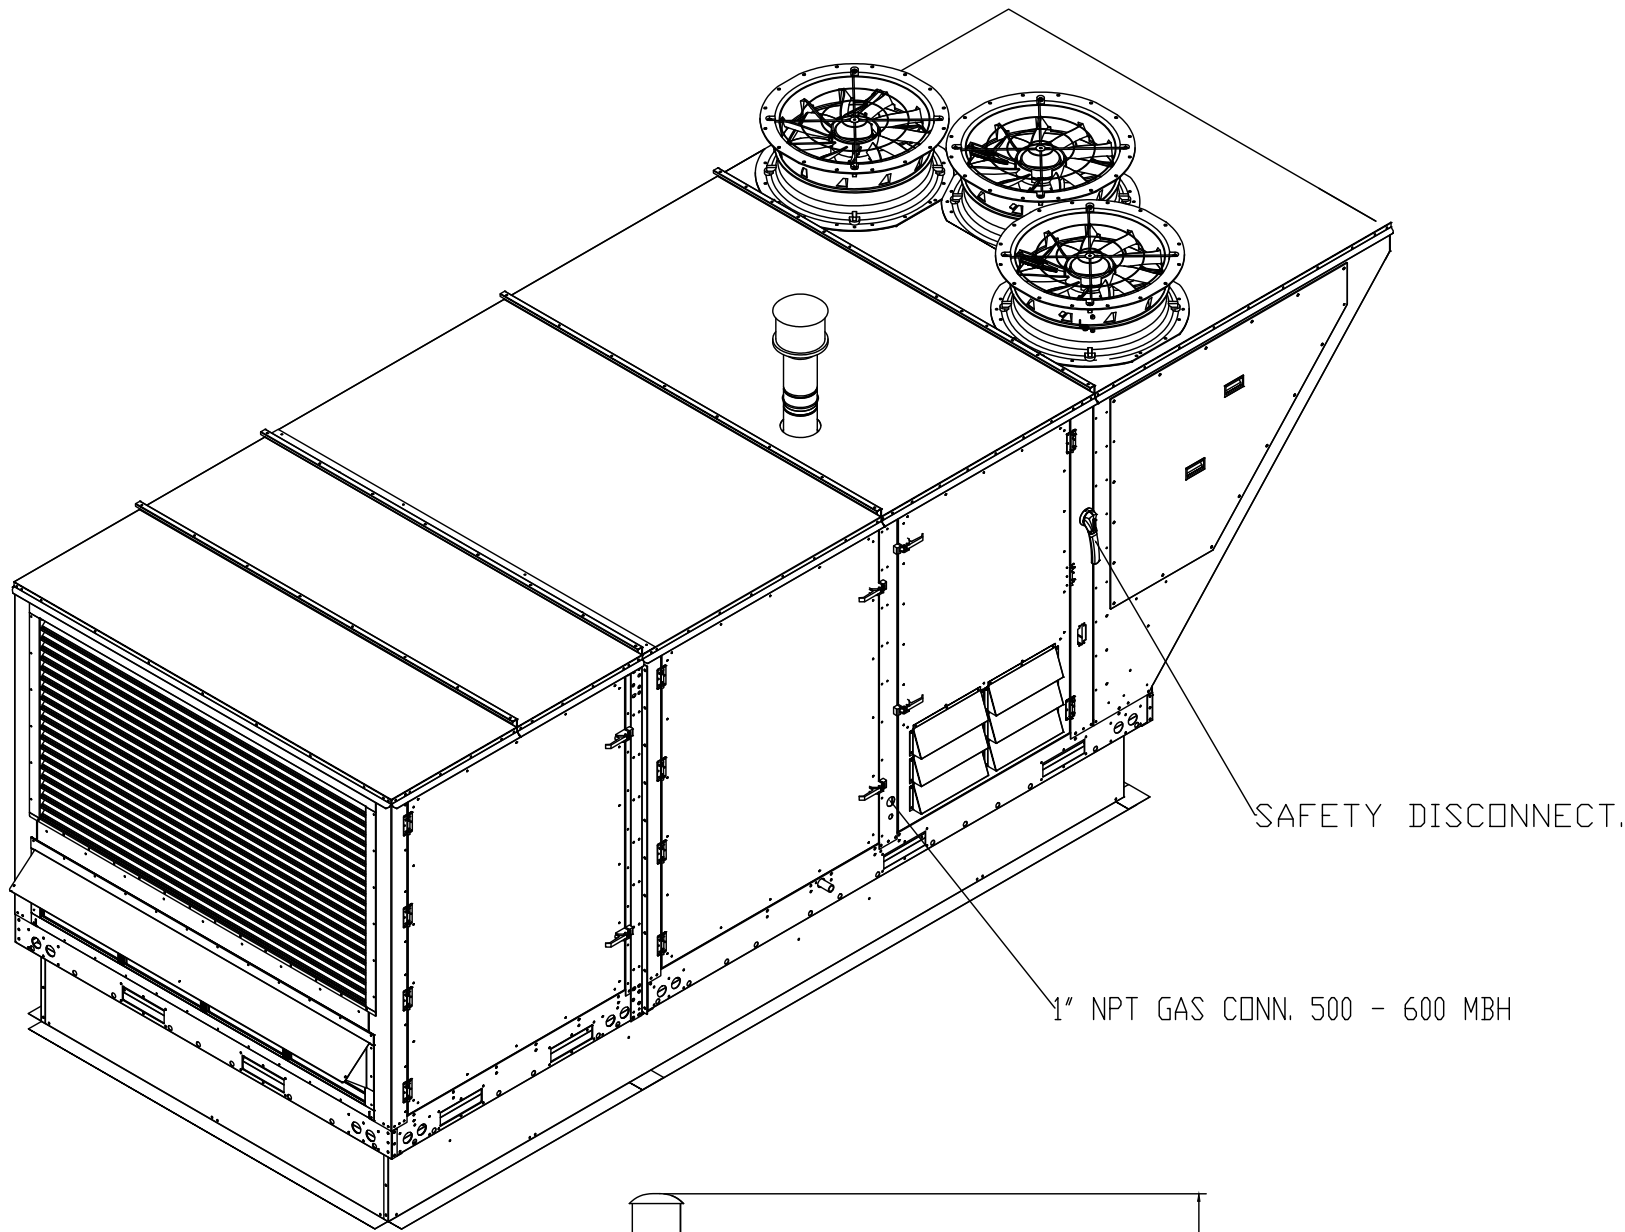

AIR DIFFUSION SUPPLY DUCT SPECIFICATIONS:
PROVIDE AIR DIFFUSION SUPPLY DUCT EQUAL TO CAPTIVEAIRE SYSTEMS MODEL DW-S0(HC), DW-S90(HC), & DW-S180(HC). THREE DISTINCT HOLE PATTERN OPTIONS TO COVER A VARIETY OF CEILING HEIGHTS. NO ADDITIONAL DIFFUSERS REQUIRED, AS THE DUCT ITSELF PROVIDES AIR DIFFUSION. MADE OF HIGH QUALITY STAINLESS STEEL DESIGNED TO LAST 20+ YEARS.
HIGH INDUCTION SUPPLY DUCT IS CONSTRUCTED USING 24 GAUGE, 430 SS - 5" THRU 24".
HIGH INDUCTION SUPPLY DUCT IS CONSTRUCTED USING 20 GAUGE, 430 SS - 26" THRU 36".
QUICK INSITE ASSEMBLY USING EPDM GASKETS & UNIVERSAL V-BANDS.
DOUBLE WALL SUPPLY DUCT AVAILABLE FOR INTERIOR AND EXTERIOR SPACES, EITHER CONDITIONED OR UNCONDITIONED.
DOUBLE WALL SUPPLY DUCT AVAILABLE IN DW-1S, DW-2S, & DW-3S TO MEET SPECIFIC REGIONAL 'R' VALUE REQUIREMENTS.

Insulation R-value Recommendations		
Supply Duct Type	Minimum R-value	Space Type
Single Wall - S & -HC	N/A	Conditioned Space Only
Double Wall - 1S	R-4	Unconditioned Interior Space Only
Double Wall - 2S	R-8	Unconditioned Space Climate Zones 1-4
Double Wall - 3S	R-12	Unconditioned Space Climate Zones 5-8


DOUBLE WALL SUPPLY DUCT IS INSULATED WITH A 24 GAUGE 430 STAINLESS OUTER SHELL. AIR DIFFUSION SUPPLY DUCT COMPLIES WITH SMACNA (SHEET METAL AND AIR CONDITIONING CONTRACTORS) BEST PRACTICES. POSITIONING OF SPRINKLERS TO AVOID OBSTRUCTION TO DISCHARGE, SEE NFPA 13, TABLE 8.12.5.1.1.

TYPICAL DDAS/RTU ROOF MOUNTING INSTALLATION INSTRUCTIONS


- SECURE THE CURB TO THE ROOF FRAMING MEMBERS BY DRILLING 1/4" PILOT HOLES IN THE CURB FLANGES AT LOCATIONS SHOWN IN THE DIAGRAM BELOW. USING 3/8" X 2" ZINC PLATED STEEL LAG BOLTS, AND ZINC PLATED WASHERS, SCREW THROUGH THE CURB FLANGES AND INTO THE ROOF FRAMING MEMBERS. A MINIMUM OF (5) LAG BOLTS ON EACH SHORT SIDE, AND (7) LAG BOLTS ON EACH LONG SIDE IS REQUIRED.
- SECURE THE UNIT BASE TO THE SIDE WALLS OF THE CURB USING (24) 1/4"-14 X 2" SELF-DRILLING, STEEL ZINC PLATED SCREWS. PRE-PUNCHED HOLES HAVE BEEN PROVIDED FOR EACH SCREW LOCATION.

Diagram showing the roof mounting installation of the HVAC unit. Labels include: DDAS/RTU, SCREW DDAS/RTU TO CURB WALL THROUGH PRE-PUNCHED HOLES (4 SIDES), CURB, LONG SIDE OF CURB, SHORT SIDE OF CURB, DDAS/RTU, 1-1/2" TYP., EVENLY SPACED TYP., 4-1/2" TYP., DETAIL 2, DETAIL 1.

NOTE: ALL MODEL NUMBERS ON THIS SHEET ARE CAPTIVE-AIRE.

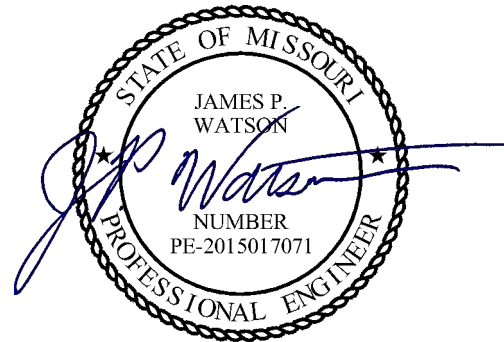

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

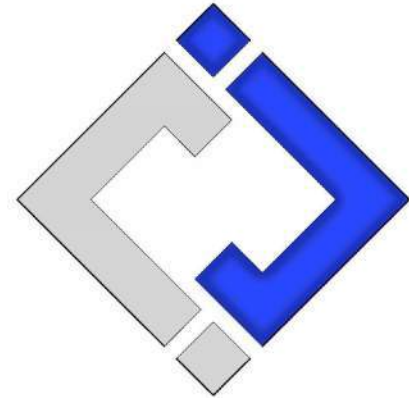

**J-SQUARED
ENGINEERING**
2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

12 PROJECT No: 121205
12 DESIGN: ACW

ISSUE TITLE DATE
PERMIT 09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

HVAC DETAILS

SHEET NUMBER

M502

DOAS/RTU FAN SCHEDULE - JOB#6933699

FAN INFORMATION										ELECTRICAL INFORMATION				COOLING INFORMATION				REHEAT INFORMATION				GAS HEAT INFORMATION				NOTES																
FAN UNIT NO	TAG	QTY	DOAS/RTU MODEL #	MANUFACTURER	BLOWER	RETURN AIR CFM	MAX OUTSIDE AIR CFM	TOTAL CFM	WEIGHT (LBS)	ESP	HP	PHASE	VOLT	MCA	MDCP	OUTSIDE AIR DB WB	MIXED AIR DB WB	LEAVING AIR DB WB	DP	TOTAL CAPACITY	CAPACITY SENS.	IEER	ISMRE	DISCHARGE DB WB	DESIR'D DB WB		MAX	MOISTURE REMOVAL RATE	GAS TYPE	INPUT BTU/H	OUTPUT BTU/H	TEMP RISE	REQUIRED INPUT GAS PRESSURE									
		1	CAS-HVAC4-1600-30-30T-ERV	CAPTIVEAIRE	30MF-4-RTU	0	5000	5000	6636	1.000	7.50	3	208	173.4A	175A		86.7°F	79.0°F	78.4°F	68.3°F	41.4°F	41.4°F	41.4°F	37B.1	20L.2	MBH	17.8	4.8	70.0°F	54.8°F	15B.7	MBH	260	MBH	153.4	LBS/HR	NATURAL	600000	466000	62°F	7 IN. W.C. - 14 IN. W.C.	1,2,3,4,5,6,7,8,9,10,11,12,13,14,15,16,17,18,19,20
NOTES: 1. INVERTER SCROLL COMPRESSOR WITH INTEGRATED OIL SENSOR. DIGITAL OR STAGED SCROLL NOT AN APPROVED EQUAL. 2. DIRECT DRIVE PLENUM BLOWER. BELT DRIVEN BLOWERS ARE NOT ACCEPTABLE. 3. INTEGRATED MONITORING VIA CELLULAR CONNECTION BY MANUFACTURER. 4. REFRIGERATION PRESSURE MONITORING ON HIGH AND LOW PRESSURE SIDE OF SYSTEM INCLUDED THROUGH DIGITAL INTERFACE. 5. EC MOTOR CONDENSING FAN. 6. ELECTRONIC EXPANSION VALVE. TXV NOT ACCEPTABLE. 7. SUCTION LINE ACCUMULATOR. 8. FACTORY COMMISSIONING WITH 5 YEAR PARTS WARRANTY, 25 YEAR WARRANTY ON STAINLESS STEEL HEAT EXCHANGER. 9. AVERAGING INTAKE, EVAP AND DISCHARGE TEMPERATURE SENSORS (DISCHARGE SENSOR TO BE FACTORY MOUNTED WITHIN UNIT). 10. 2" EXTERIOR DUAL-WALL CONSTRUCTION W/ 6-12 INSULATION-MINIMUM 200" EXTERIOR W/ 1/4"GA BASE. 11. TOTAL ENERGY RECOVERY WHEEL WITH SPEED CONTROLS FOR FROST PROTECTION AND MODULATION TO CAPACITY. INCLUDES SUPPLY AND EXHAUST FILTER & WHEEL MONITORING. 12. 80% EFFICIENT FURNACE WITH MODULATING INPUT TO MAINTAIN CONSTANT COMBUSTION EFFICIENCY ACROSS FIRING RANGE. 16:1 TURNDOWN WITH NG AND 19:1 TURNDOWN WITH LP. 13. EXHAUST CFM MONITORING INTEGRAL TO UNIT WITH CFM MEASUREMENT INCLUDED THROUGH DIGITAL INTERFACE. 14. FILTERED SUPPLY AND EXHAUST AIR STREAMS WITHIN ENERGY RECOVERY VENTILATOR MODULE. 15. SUPPLY CFM MONITORING INTEGRAL TO UNIT WITH CFM MEASUREMENT INCLUDED THROUGH DIGITAL INTERFACE. 16. FULLY MODULATING HOT GAS REHEAT. 17. 4" MERV-15 IN-UNIT FILTRATION.																																										

FOR QUESTIONS, CALL THE
St. Louis Mechanical
REGION 109
PHONE: (636) 229 - 9777
EMAIL: reg109scaptive.com

DOAS/RTU ENERGY RECOVERY SCHEDULE

FAN UNIT NO	TAG	EXHAUST AIR FAN (ECM)					SUPPLY AIR SUMMER			RETURN AIR DB/WB TEMP(°F)	DESIGN RECOVERED SUMMER CAPACITY			SUPPLY AIR WINTER			RETURN AIR DB/WB TEMP(°F)	DESIGN RECOVERED WINTER CAPACITY		
		CFM	ESP	MOTOR HP	V/φ/HZ	ENTERING AIR DB/WB TEMP(°F)	LEAVING AIR DB/WB TEMP(°F)	TOTAL	SENSIBLE		LATENT	ENTERING AIR DB/WB TEMP(°F)	LEAVING AIR DB/WB TEMP(°F)	TOTAL	SENSIBLE	LATENT				
		1		4900	1	4.8	208/3/60	86.7/79.0	78.4/68.3	75.0/62.0	212.0 MBH	41.4 MBH	170.7 MBH	9.0/6.3	49.6/42.3	69.0/55.0	304.9 MBH	216.1 MBH	88.8 MBH	

FAN OPTIONS

FAN UNIT NO	TAG	QTY	DESCRIPTION	IMPORTANT NOTE
1		1	INLET PRESSURE GAUGE, 0-35"	
1		1	TOTAL CFM MONITORING	
1		1	INTAKE FIRESTAT SET TO 135°F	
1		1	FIRECESTAT	
1		1	DISCHARGE FIRESTAT SET TO 240°F	
1		1	SHIP LOOSE GAS STRAINER 1"	
1		1	SINGLE POINT ELECTRICAL CONNECTION FOR RTU, 750VA TRANSFORMER USED. IF A NON-DCV PREWIRE CONTROLS THIS UNIT, THE ERV, HAZ, HAV, OR EEP PREWIRE OPTION MUST BE SELECTED. DOES NOT PROVIDE SUPPLY STARTER IN PREWIRE.	
1		1	CASLINK BUILDING MONITORING SYSTEM - INTERNET OR CELLULAR CONNECTION REQUIRED	
1		1	RTU4 DOWN DISCHARGE	
1		1	OVERHEAT STAT	
1		1	VFD FACTORY MOUNTED AND WIRED IN RTU COMMERCIAL CONTROL VESTIBULE	
1		1	30 TON MODULATING COOLING OPTION, 208/230V, 3CFS, R410A REFRIGERANT, VARIABLE	
1		1	30 TON MODULATING REHEAT OPTION - SPACE DEWPOINT CONTROL - R410A	
1		1	RTU INTAKE/RETURN DAMPER - DA PERCENTAGE CONTROL	
1		1	RTU4 HAIL GUARD	
1		1	RTU4 DOWN RETURN	
1		1	VAV PACKAGE W/ MANUAL/DDC CONTROL (571 VFD INCLUDED)	
1		1	4" MERV 15 FILTERS FOR RTU GTY, 12"	
1		1	RTU4 POWERED CONVENIENCE OUTLET (GFCI), 15 AMP	
1		1	OCCUPIED SCHEDULING	
1		1	ENERGY RECOVERY VENTILATOR FOR 208/230V RTU4 - ERV MODULE SHIPS LOOSE, AND SHALL BE CONNECTED TO THE MAIN UNIT IN THE FIELD PER THE INSTRUCTIONS OUTLINED IN THE OWNER INSTALL MANUAL.	
1		1	RTU4 ECONOMIZER BAROMETRIC RELIEF	
1		1	2" MERV 13 SUPPLY FILTERS FOR ERV4	
1		1	4" MERV 15 RETURN FILTERS FOR ERV4	
1		1	RTU4 CURB DUCT HANGER	
1		1	DUCT MOUNTED SMOKE DETECTOR - SHIPS LOOSE	
1		1	ERV EXHAUST FAN - SUPPLY FAN REFERENCE CONTROL	
1		1	HIGH TURNDOWN OPTION FOR DOAS UNITS	
1		1	MANIFOLD PRESSURE GAUGE, 0 TO 10" WC, 2 FURNACES	
1		1	5 YEAR ENTIRE UNIT PARTS WARRANTY, 10 YEAR ENTIRE UNIT PARTS WARRANTY WITH REMOTE MONITORING AND CAPTIVEAIRE SERVICE CONTRACT, 25 YEAR STAINLESS STEEL FURNACE PARTS WARRANTY (SEE ADDITIONAL DETAILS)	
1		1	EXTERIOR GAS CONNECTION PROVIDED BY FACTORY WITH QUICK SEAL AND ANTI-ROTATION BRACKET	




CURB ASSEMBLIES

NO	ON FAN	WEIGHT	ITEM	SIZE
1	# 1	436 LBS	CURB	80.000"W X 16.950"D X 20.000"H INSULATED 16 GAUGE

CONTROLS DESIGN SERVICE

BIENNIAL ANALYSIS OF EQUIPMENT PERFORMANCE REQUIRED BY THE MANUFACTURER TO OPTIMIZE SYSTEM FIRST INSTALL. DETAILED PERFORMANCE REPORT TO BE PRESENTED TO OWNER/DP ON QUARTERLY BASIS FOR THE FIRST YEAR.

HMI SCHEDULE				
UNIT NUMBER	HMI #	HMI LOCATION	TEMP AVERAGING	MODBUS ADDRESS
FAN #1	HMI #1 - UNIT	IN UNIT	NOT AVERAGED	55
FAN #1	HMI #2 - SPACE	SPACE	AVERAGED	56

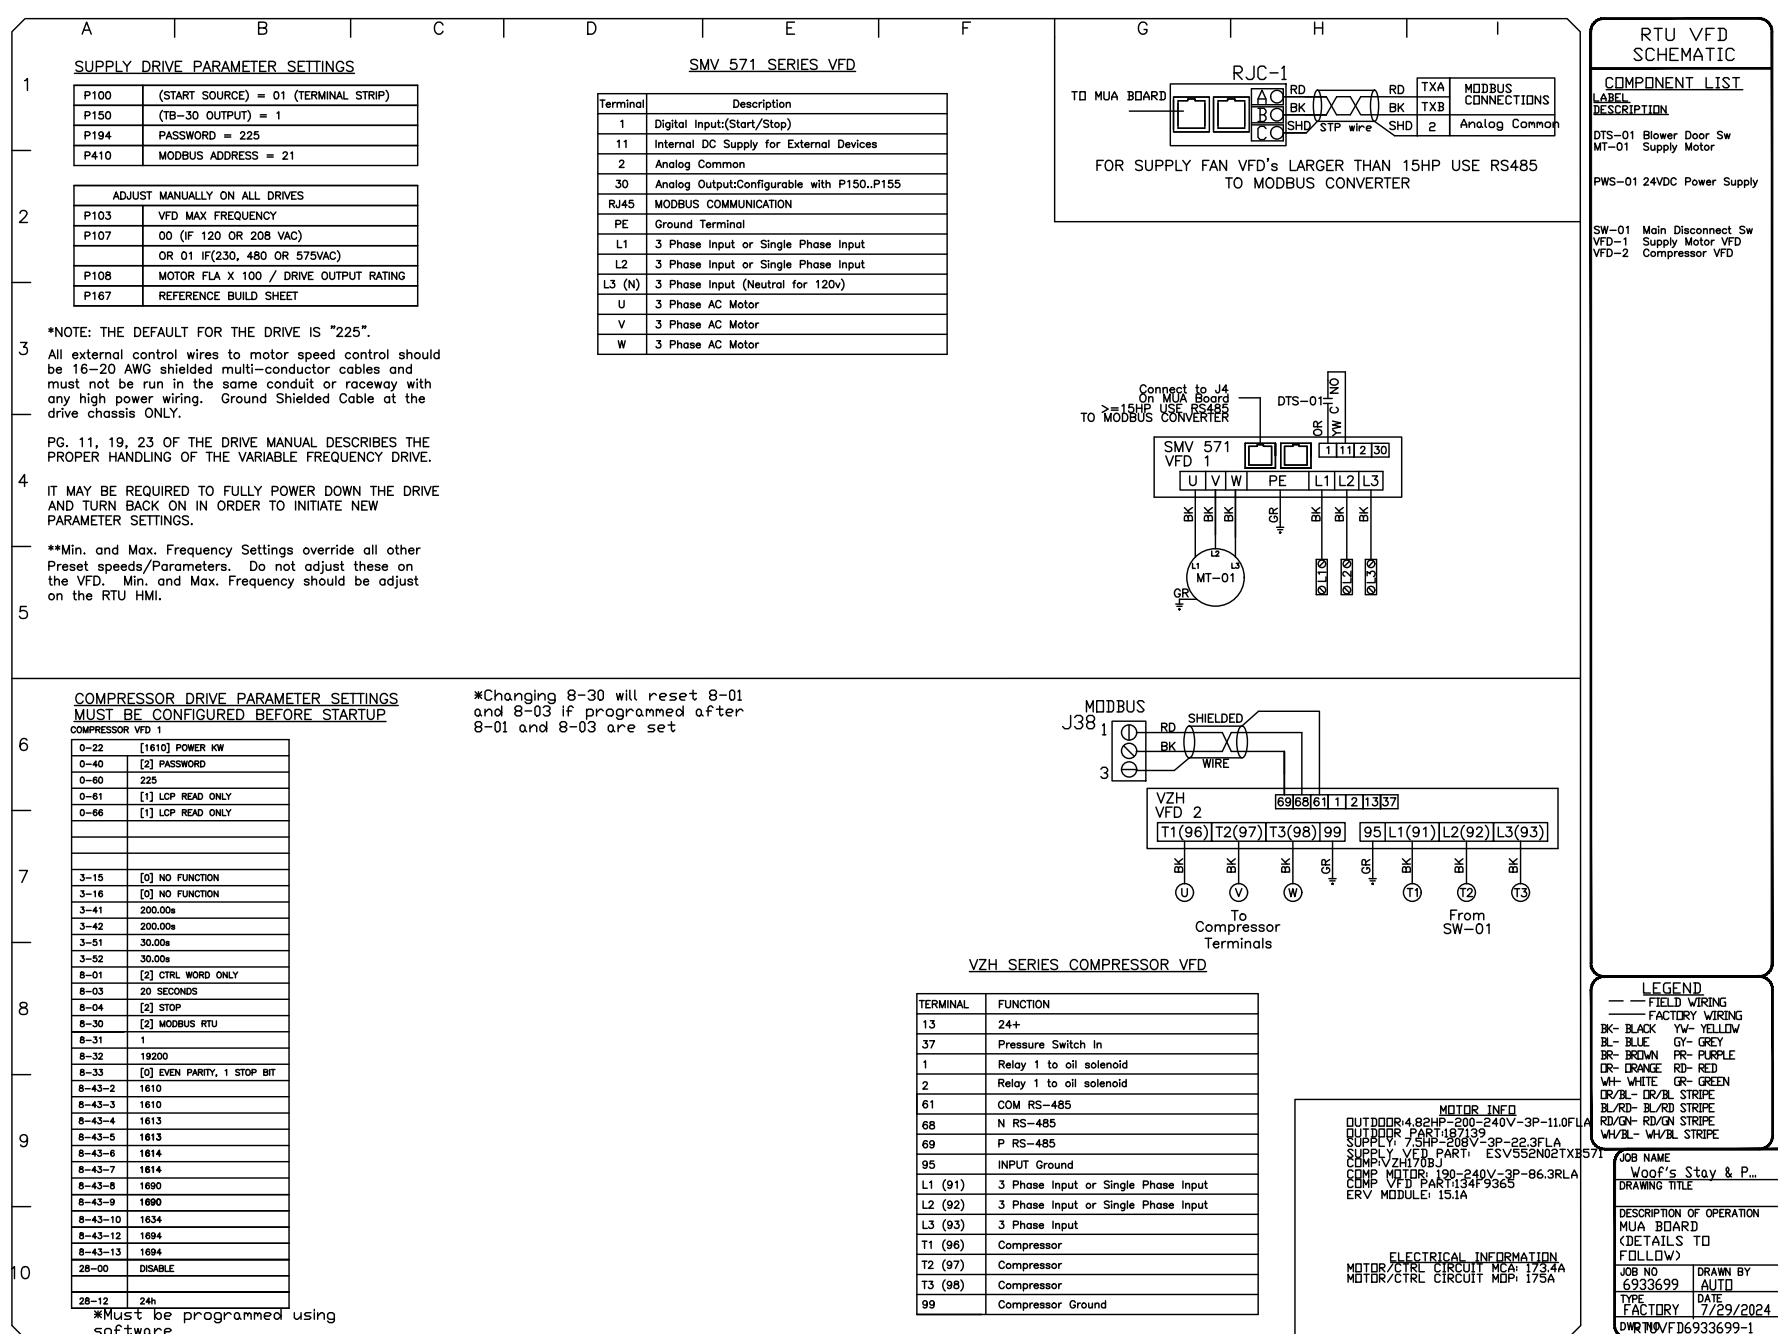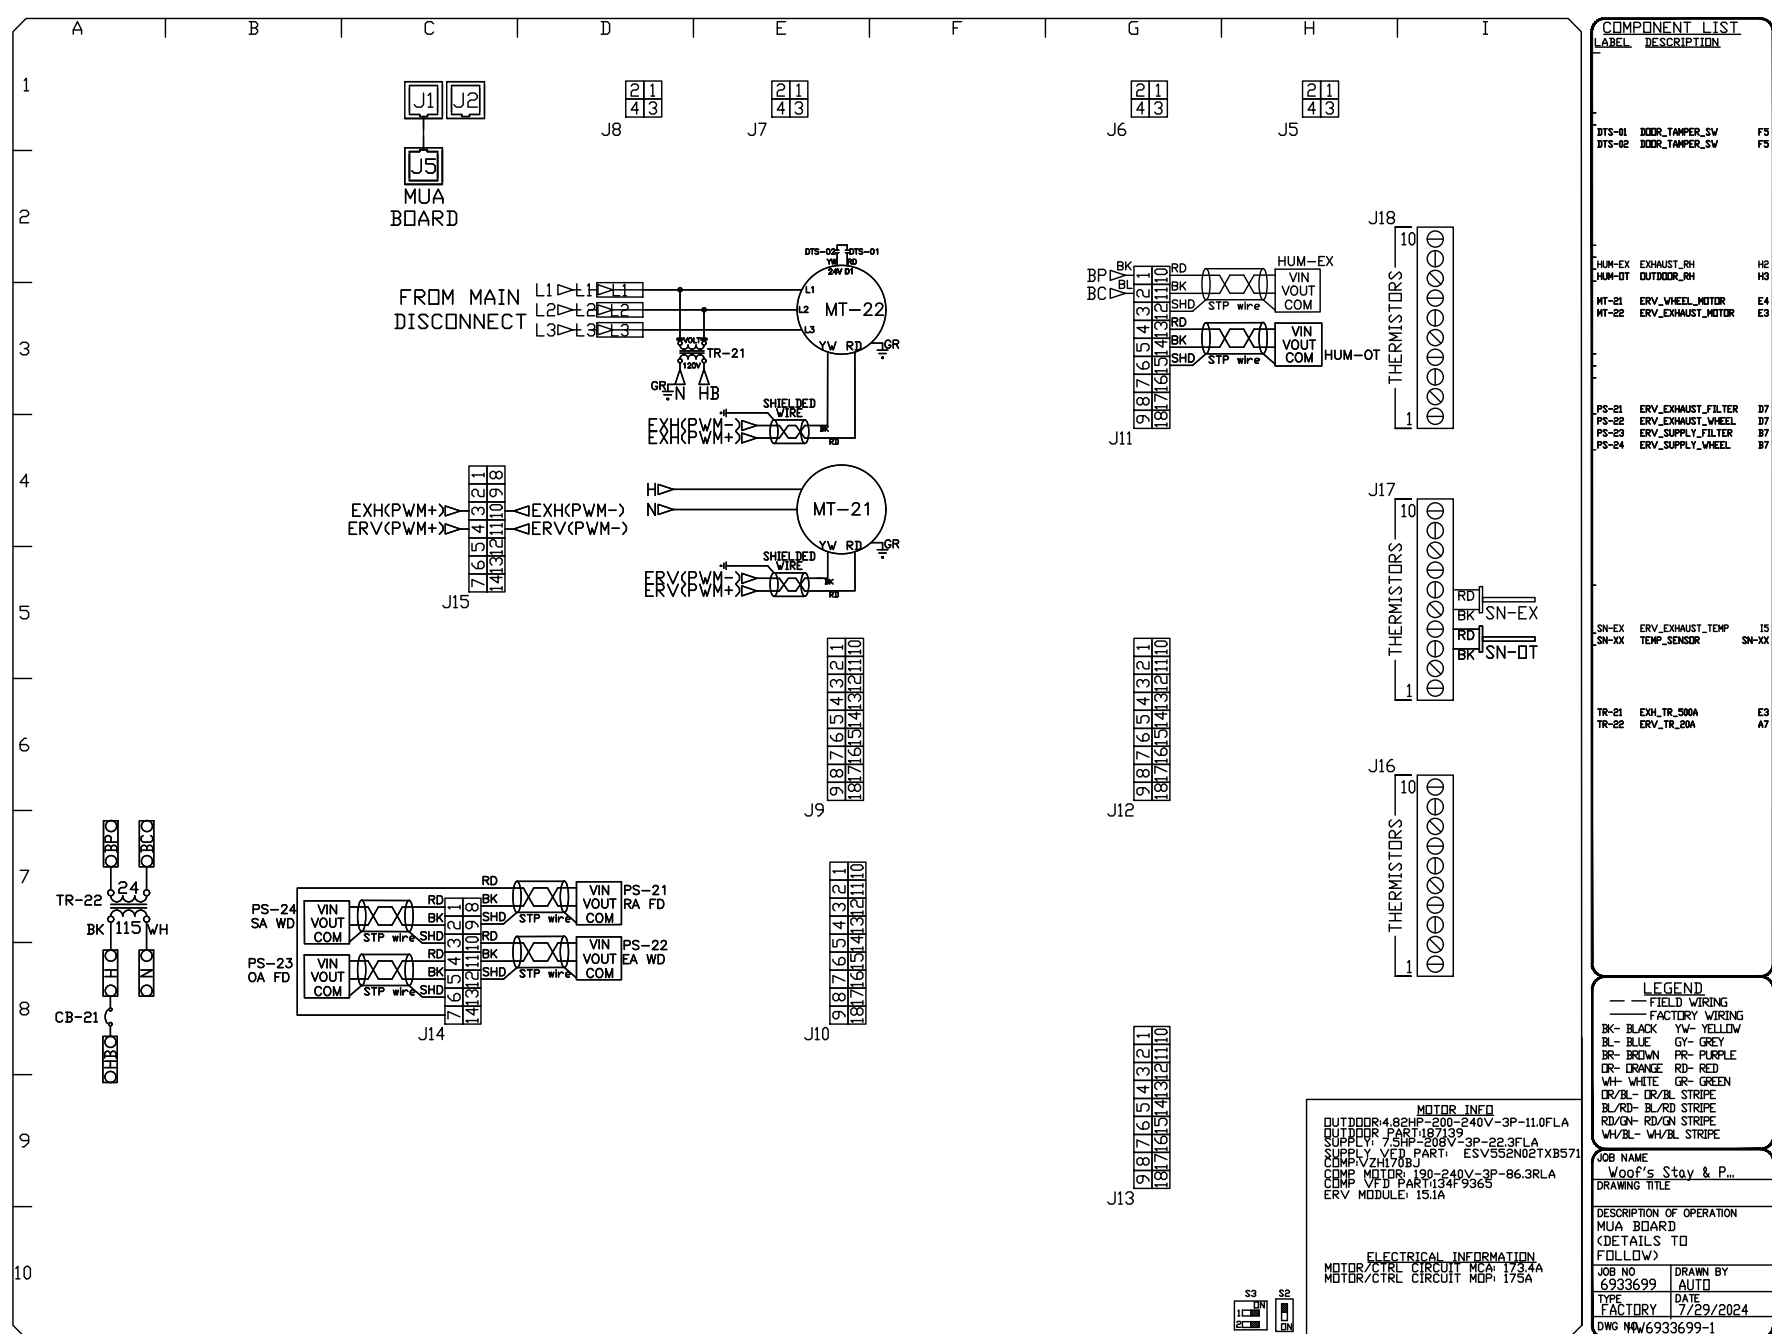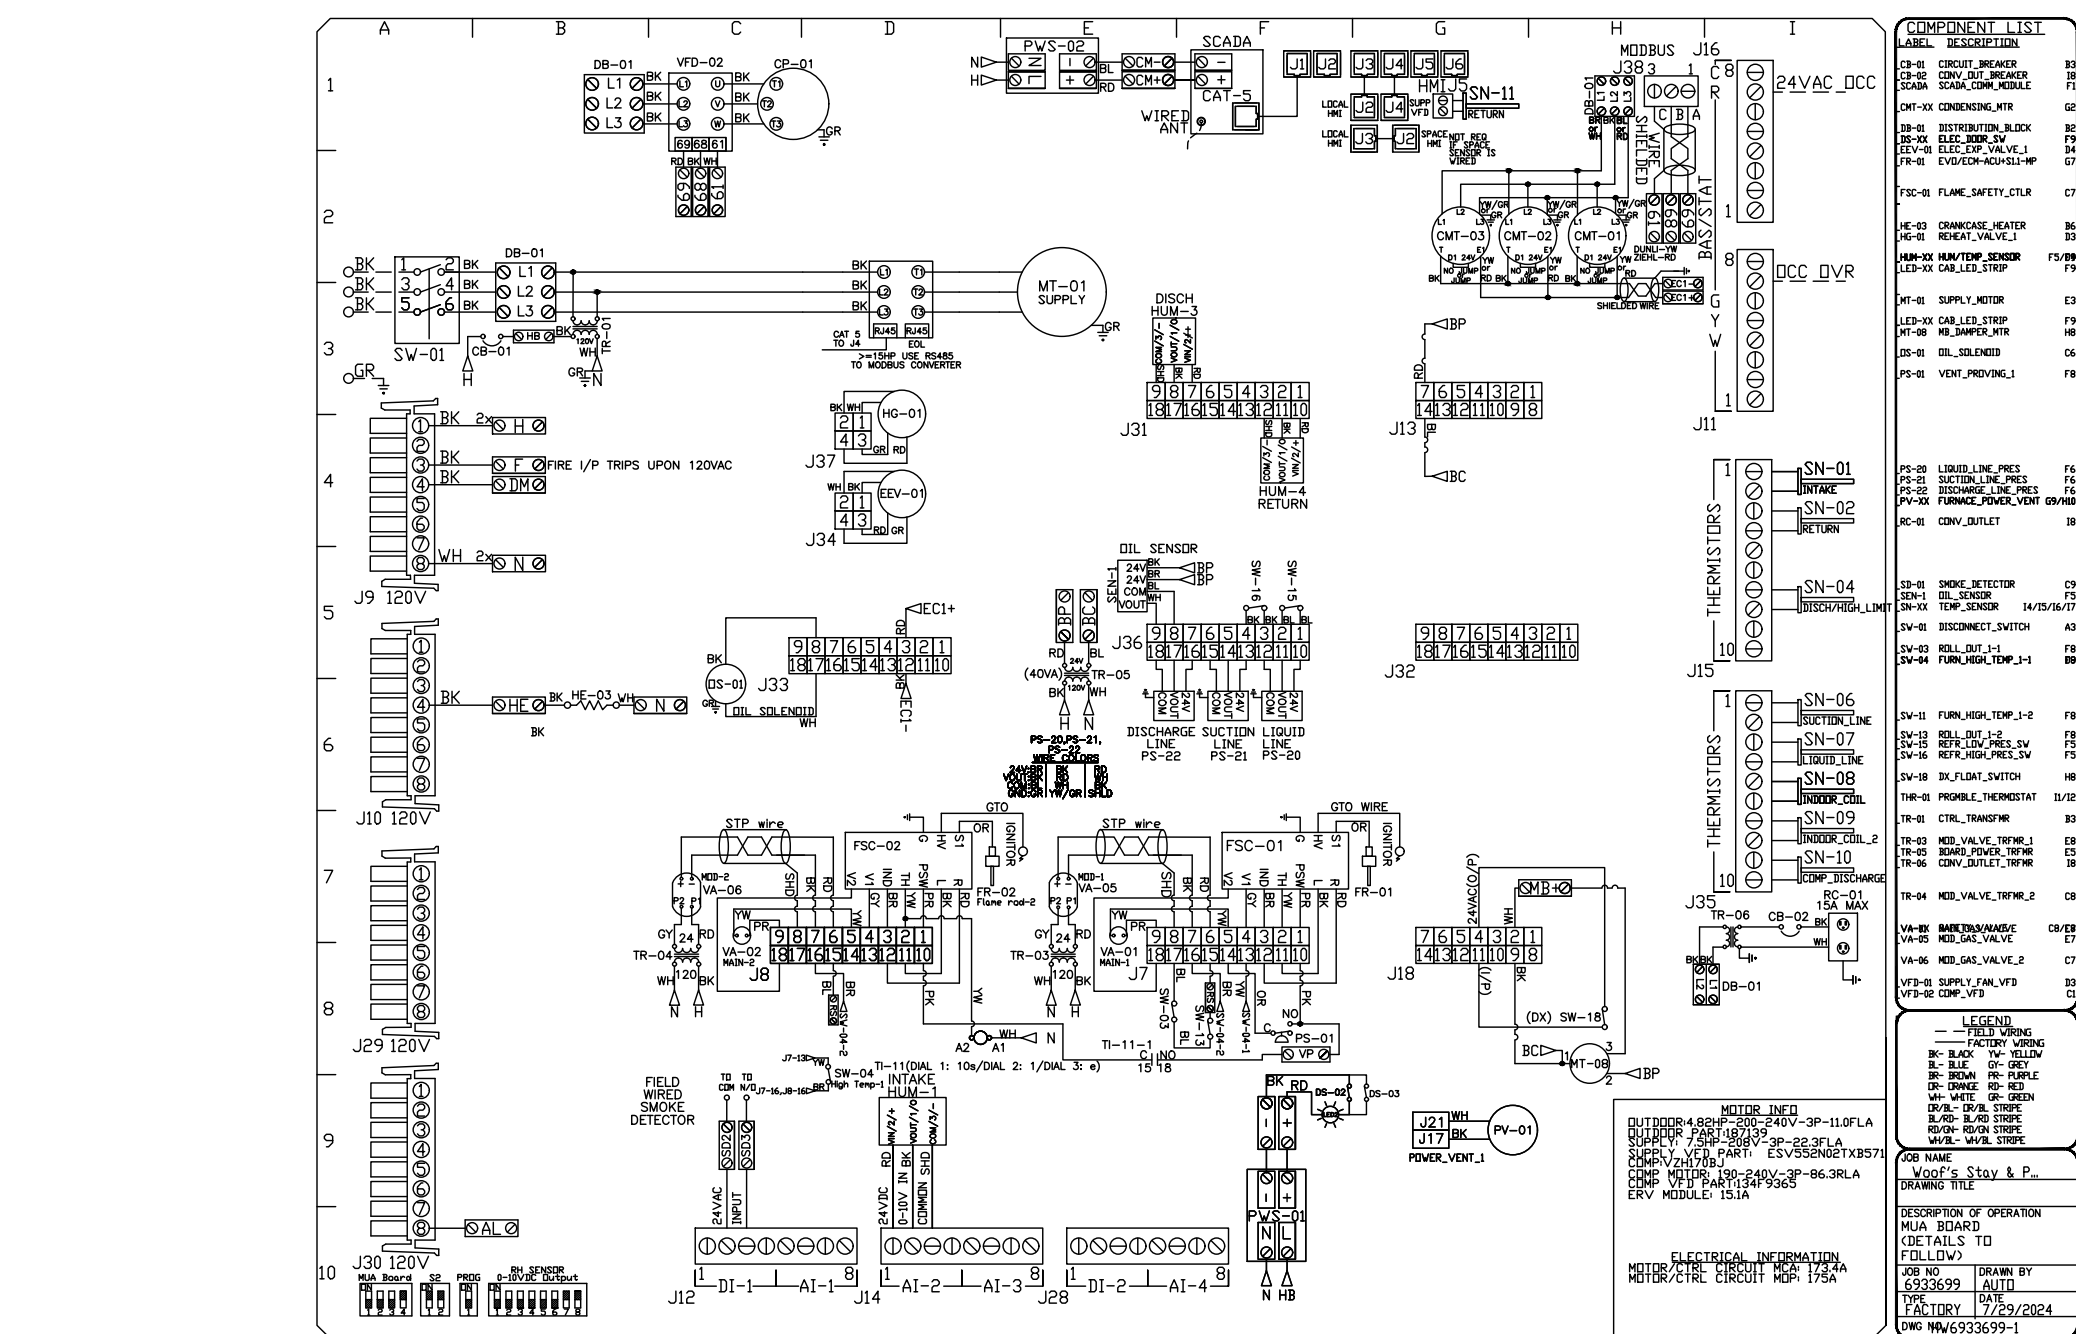


NOTE: ALL MODEL NUMBERS ON THIS SHEET ARE CAPTIVE-AIRE.

SYSTEM DESIGN VERIFICATION (SDV)


IF ORDERED, CAS SERVICE WILL PERFORM A SYSTEM DESIGN VERIFICATION (SDV) ONCE ALL EQUIPMENT HAS HAD A COMPLETE START UP PER THE OPERATION AND INSTALLATION MANUAL. TYPICALLY, THE SDV WILL BE PERFORMED AFTER ALL INSPECTIONS ARE COMPLETE.

ANY FIELD RELATED DISCREPANCIES THAT ARE DISCOVERED DURING THE SDV WILL BE BROUGHT TO THE ATTENTION OF THE GENERAL CONTRACTOR AND CORRESPONDING TRADES ON SITE. THESE ISSUES WILL BE DOCUMENTED AND FORWARDED TO THE APPROPRIATE SALES OFFICE. IF CAS SERVICE HAS TO RESOLVE A DISCREPANCY THAT IS A FIELD ISSUE, THE GENERAL CONTRACTOR WILL BE NOTIFIED AND BILLED FOR THE WORK. SHOULD A RETURN TRIP BE REQUIRED DUE TO ANY FIELD RELATED DISCREPANCY THAT CANNOT BE RESOLVED DURING THE SDV, THERE WILL BE ADDITIONAL TRIP CHARGES.

DURING THE SDV, CAS SERVICE WILL ADDRESS ANY DISCREPANCY THAT IS THE FAULT OF THE MANUFACTURER. SHOULD A RETURN TRIP BE REQUIRED, THE GENERAL CONTRACTOR AND APPROPRIATE SALES OFFICE WILL BE NOTIFIED. THERE WILL BE NO ADDITIONAL CHARGES FOR MANUFACTURER DISCREPANCIES.

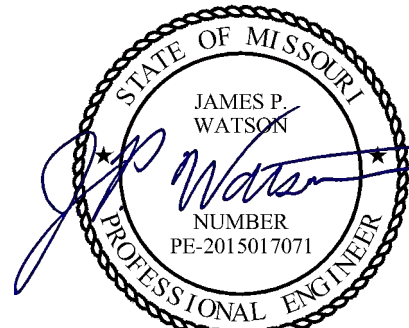

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

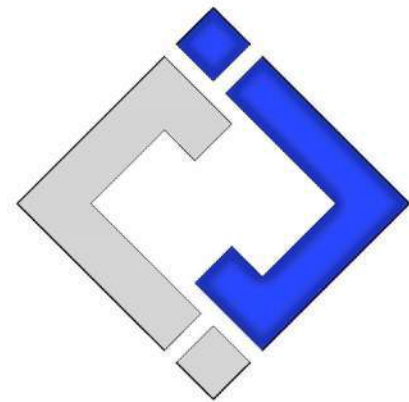

J-SQUARED
ENGINEERING

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205
J2 DESIGN: ACW

ISSUE TITLE DATE
PERMIT 09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

A4H APPROVAL STAMP

SHEET TITLE

HVAC DETAILS

SHEET NUMBER

M503

DEDICATED OUTSIDE AIR SYSTEM (DOAS) SCHEDULE																											
TAG	MANUFACTURER (OR EQUAL)	MODEL NUMBER (OR EQUAL)	AIRFLOW					ENERGY RECOVERY				GAS HEATING			COOLING							ELECTRICAL			PHYSICAL		NOTES
			SUPPLY FAN		EXHAUST FAN			RECOVERED CAPACITY		MIXED AIR L.A.T.		INPUT CAPACITY (kBTU)	OUTPUT CAPACITY (kBTU)	TEMP RISE (°F)	E.A.T.		L.A.T.		SENSIBLE CAPACITY (kBTU)	NET TOTAL CAPACITY (kBTU)	IEER	VOLTS/ PH	MCA	OCP	DIMENSIONS (LxWxH)	WEIGHT (LBS)	
			AIRFLOW (CFM)	E.S.P (in. H2O)	AIRFLOW (CFM)	E.S.P (in. H2O)	HP	COOLING (kBTU)	HEATING (kBTU)	COOLING (°F)	HEATING (°F)				D.B. (°F)	W.B. (°F)	D.B. (°F)	W.B. (°F)									
DOAS-1	CAPTIVEAIRE	CAS-HVAC4-L600-30-30T-ERV	5000	1.0	4900	1.0	4.8	212.0	304.9	75/62	69/55	600	486	82	78.4	68.3	41.4	41.4	201.2	378.1	17.8	208/3	173.4	175	241x90x36	6636	1 - 21
NOTES: 1. INVERTER SCROLL COMPRESSOR WITH INTEGRATED OIL SENSOR. DIGITAL OR STAGED SCROLL NOT AN APPROVED EQUAL. 2. DIRECT DRIVE PLENUM BLOWER. BELT DRIVEN BLOWERS ARE NOT ACCEPTABLE. 3. INTEGRATED MONITORING VIA CELLULAR CONNECTION BY MANUFACTURER. 4. REFRIGERATION PRESSURE MONITORING ON HIGH AND LOW PRESSURE SIDE OF SYSTEM INCLUDED THROUGH INTERFACE. 5. EC MOTOR CONDENSING FANS 6. ELECTRONIC EXPANSION VALVE. TXV NOT ACCEPTABLE. 7. SUCTION LINE ACCUMULATOR. 8. FACTORY COMMISSIONING WITH 5-YEAR PARTS WARRANTY, 25 YEAR WARRANTY ON STAINLESS STEEL HEAT EXCHANGER. 9. AVERAGING INTAKE, EVAP AND DISCHARGE TEMPERATURE SENSORS (DISCHARGE SENSORS TO BE FACTORY MOUNTED WITHIN UNIT). 10. 2" EXTERIOR DUAL-WALL CONSTRUCTION WITH R-13 INSULATION MINIMUM 20GA EXTERIOR WITH 14GA BASE 11. TOTAL ENERGY RECOVERY WHEEL WITH SPEED CONTROLS FOR FROST PROTECTION AND MODULATION TO CAPACITY. INCLUDES SUPPLY & EXHAUST FILTER & WHEEL MONITORING. 12. 81% EFFICIENT FURNACE, WITH MODULATING INDUCTER TO MAINTAIN CONSTANT COMBUSTION EFFICIENCY ACROSS FIRING RANGE. 16:1 TURNDOWN WITH NATURAL GAS. 13. EXHAUST CFM MONITORING INTEGRAL TO UNIT WITH CFM MEASUREMENT INCLUDED THROUGH DIGITAL INTERFACE. 14. FILTERED SUPPLY AND EXHAUST AIR STREAMS WITHIN ENERGY RECOVERY VENTILATOR MODULE. 15. SUPPLY CFM MONITORING INTEGRAL TO UNIT WITH CFM MEASUREMENT INCLUDED THROUGH DIGITAL VALVE. 16. FULL MODULATING HOT GAS REHEAT. 17. 4" MERV-15 IN-UNIT FILTRATION. 18. HAIL GUARD FOR CONDENSING COIL. 19. BAROMETRIC RELIEF DAMPER. 20. DOWN DISCHARGE / DOWN RETURN. 21. WITH CURB-MOUNTED SCREENING SYSTEM EQUAL TO CURBS-PLUS NUVIEW SYSTEM WITH SMOOTH PANEL PROFILE, FLAT TRIM, STANDARD COLOR DETERMINED BY ARCHITECT.																											


RTU SCHEDULE															
TAG	EQUIPMENT DESCRIPTION	SIZE (TONS)	ORIENTATION	TOTAL AIRFLOW (CFM)	E.S.P. (in. H20)	OA AIRFLOW MAX / MIN (CFM)	GAS HEATING		COOLING (IA: 80 DB/ 67 WB, OA: 95 DB)			ELECTRICAL			NOTES
							INPUT (kBTU)	OUTPUT (kBTU)	SENSIBLE (kBTU)	TOTAL (kBTU)	MIN. EFFICIENCY	VOLTS / PHASE	MCA	OCF	
RTU-1	ROOF TOP UNIT	5.0	DOWN FLOW	2000	1.0	200 / 200	130	104	47.3	63.5	13.4 SEER2	208/3	29	40	1, 2, 3, 4, 5, 6, 7, 8
NOTES:															
1. PROVIDE AND INSTALL 7 DAY PROGRAMABLE HONEYWELL THERMOSTAT. COORDINATE EXACT MOUNTING LOCATION WITH OWNER.															
2. WITH FACTORY HAIL GUARD.															
3. WITH FACTORY INSTALLED DISCONNECT.															
4. ECONOMIZER (WITH EITHER BAROMETRIC RELIEF SIZED AT 100% OF FLOW AT 1/10" RETURN DUCT STATIC PRESSURE, OR POWERED EXHAUST); CONTROL TO BE ADJUSTABLE FIXED POINT SET AT 65°F. ECONOMIZER TO BE IECC COMPLIANT WITH FAULT DETECTION AND NOTIFICATION.															
5. WITH POWERED WEATHERPROOF GFCI RECEPTACLE.															
6. WITH HOT GAS REHEAT/DEHUMIDIFICATION OPTION.															
7. WITH NEEDLE-POINT IONIZATION FILTRATION SYSTEM EQUAL TO GPS SYSTEMS #GPS-FC24-AC															
8. WITH CURB-MOUNTED SCREENING SYSTEM EQUAL TO CURBS-PLUS NUVIEW SYSTEM WITH SMOOTH PANEL PROFILE, FLAT TRIM, STANDARD COLOR DETERMINED BY ARCHITECT															

EXHAUST FAN SCHEDULE											
TAG	EQUIPMENT TYPE	MANUFACTURER (OR EQUAL)	MODEL (OR EQUAL)	FLOW		ELECTRICAL			PHYSICAL		NOTES
				CFM	S.P.	VOLT/PH	MCA	OCP	DIM.	WEIGHT	
EF-1	IN-LINE EXHAUST FAN	SOLER & PALAU	TD-SILENT	100	3/8"	120/1	1	20-1	19x11x9	14	1, 2
EF-2	IN-LINE EXHAUST FAN	SOLER & PALAU	TD-SILENT	120	3/8"	120/1	1	20-1	19x11x9	14	1, 2
NOTES:											
1. WITH BACKDRAFT DAMPER											
2. WITH SPEED CONTROLLER											


AIR DEVICE SCHEDULE						
TAG	SERVICE	MANUFACTURER (OR EQUAL)	MODEL (OR EQUAL)	SIZE	COLOR / FINISH	NOTES
E1	EXHAUST	PRICE	80	AS INDICATED	WHITE	
E2	EXHAUST	PRICE	530	AS INDICATED	WHITE	
L1	EXHAUST	POTTORFF	EFD	AS INDICATED	PRIMED	PAINT TO MATCH EXTERIOR
R1	RETURN	PRICE	80	AS INDICATED	WHITE	
S1	SUPPLY	PRICE	SPD	24x24	WHITE	
S2	SUPPLY	PRICE	S20	12x6	WHITE	
T1	TRANSFER	PRICE	STG	AS INDICATED	WHITE	
<div>NOTES:</div> <div>1. VERIFY AIR DEVICE FINISHES WITH OWNER/ARCHITECT PRIOR TO INSTALLATION</div>						

BUILDING AIR BALANCE SUMMARY			
EQUIPMENT	OA (CFM)	EXHAUST (CFM)	NET (CFM)
RTU-1	200	0	200
DOAS-1	5000	4900	100
EF-1	0	100	-100
EF-2	0	120	-120
TOTAL	5200	5120	80
<div>NOTES:</div> <div>1. DOAS-1 OPERATES CONTINUOUSLY</div> <div>2. EF-2 OPERATES CONTINUOUSLY</div> <div>3. EF-1 OPERATES DURING OCCUPIED HOURS</div> <div>4. RTU BLOWER OPERATES CONTINUOUSLY</div>			

DIFFUSER NECK SIZING SCHEDULE	
AIRFLOW (CFM)	NECK SIZE (in)
0 - 120	6"
120 - 210	8"
210 - 325	10"
325 - 470	12"
470 - 640	14"

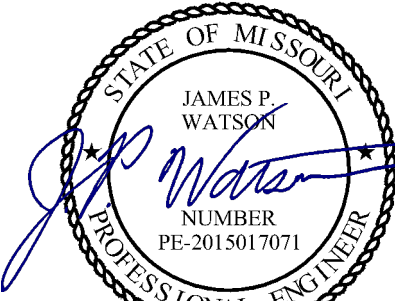

James Watson, P.E. October 11, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

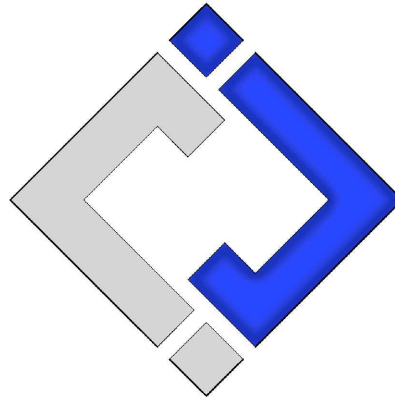

**J-SQUARED
ENGINEERING**

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW

ISSUE TITLE DATE

PERMIT 09-19-2024

REVISION 1 10-11-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

HVAC
SCHEDULES

SHEET NUMBER

M601

FIRE ALARM PLAN SYMBOL LEGEND

- M** MODULE
SD SMOKE DETECTOR
HS HORN STROBE - WALL MOUNT

POWER PLAN SYMBOL LEGEND



- CIRCUIT WIRING
--> PX-XX CIRCUIT TAG
J JUNCTION BOX
XX +42 RECEPTACLE
INDICATES MOUNTING HEIGHT TO BOTTOM OF BOX (STANDARD @ 18" AFF UNLESS NOTED OTHERWISE)
"WP" = WEATHERPROOF OUTDOOR RECEPTACLE
"AW" = ABOVE WINDOW RECEPTACLE
"AC" = ABOVE CEILING RECEPTACLE
"EX" = EXISTING RECEPTACLE TO REMAIN
 GFCI DUPLEX CONVENIENCE RECEPTACLE
 208V RECEPTACLE
 QUADPLEX CONVENIENCE RECEPTACLE
 DATA / PHONE JACK
BOX WITH 1" CONDUIT & PULL STRING UP TO CEILING SPACE (STANDARD @ 18" AFF UNLESS NOTED OTHERWISE)
 DISCONNECT

POWER PLAN GENERAL NOTES:


- REFER TO E500 AND/OR E600 SERIES SHEETS FOR ADDITIONAL ELECTRICAL NOTES, DETAILS, REQUIREMENTS, AND SCHEDULES.
- ELECTRICAL CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL ELECTRICAL EQUIPMENT, WIRING, HANGERS / SUPPORTS, ETC. WITH HVAC AND PLUMBING TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE REIMBURSED.

POWER PLAN KEY NOTES:

- POWER FOR CORD REEL EQUAL TO KH INDUSTRIES MODEL RTAG3LW-WCS20-112F, 120V, 20A CORD REEL. CORD REEL SHALL BE MOUNTED AT CEILING GRID HEIGHT; SUPPORT FROM BUILDING STRUCTURE ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
- WIRE DRINKING FOUNTAIN RECEPTACLE DOWNSTREAM OF GFCI RECEPTACLE SO THAT DRINKING FOUNTAIN RECEPTACLE IS GFCI PROTECTED.
- POWER FOR EXTERIOR SIGNAGE; COORDINATE EXACT LOCATION & REQUIREMENTS WITH SIGNAGE SUPPLIER/INSTALLER.
- POWER FOR HOT WATER RECIRCULATION PUMP; COORDINATE EXACT LOCATION & REQUIREMENTS WITH PLUMBING CONTRACTOR.
- 3/4" CONDUIT BELOW SLAB FOR RECEPTION DESK POWER/DATA; COORDINATE EXACT LOCATION & REQUIREMENTS WITH OWNER.
- PROVIDE & INSTALL (2) 3" CONDUIT FROM DEMARCS TO MECHANICAL ROOM; COORDINATE EXACT LOCATION & REQUIREMENTS WITH OWNER.
- POWER FOR I.T. EQUIPMENT; COORDINATE EXACT LOCATION & REQUIREMENTS WITH OWNER.
- WEATHERPROOF HORN/STROBE NOTIFICATION DEVICE NEAR FDC. COORDINATE WITH SPRINKLER CONTRACTOR.
- MONITOR MODULES FOR TAMPER/FLOW SWITCHES & FIRE ALARM CONTROL PANEL IN RISER ROOM; COORDINATE EXACT LOCATIONS & REQUIREMENTS WITH SPRINKLER CONTRACTOR.
- RECEPTACLE MOUNTED ON ROOFTOP.

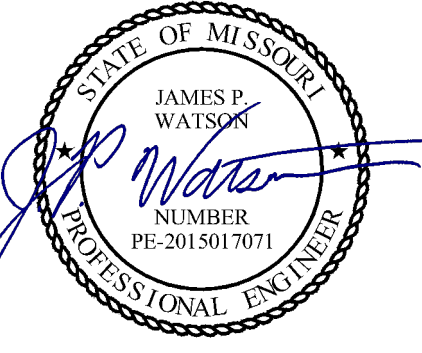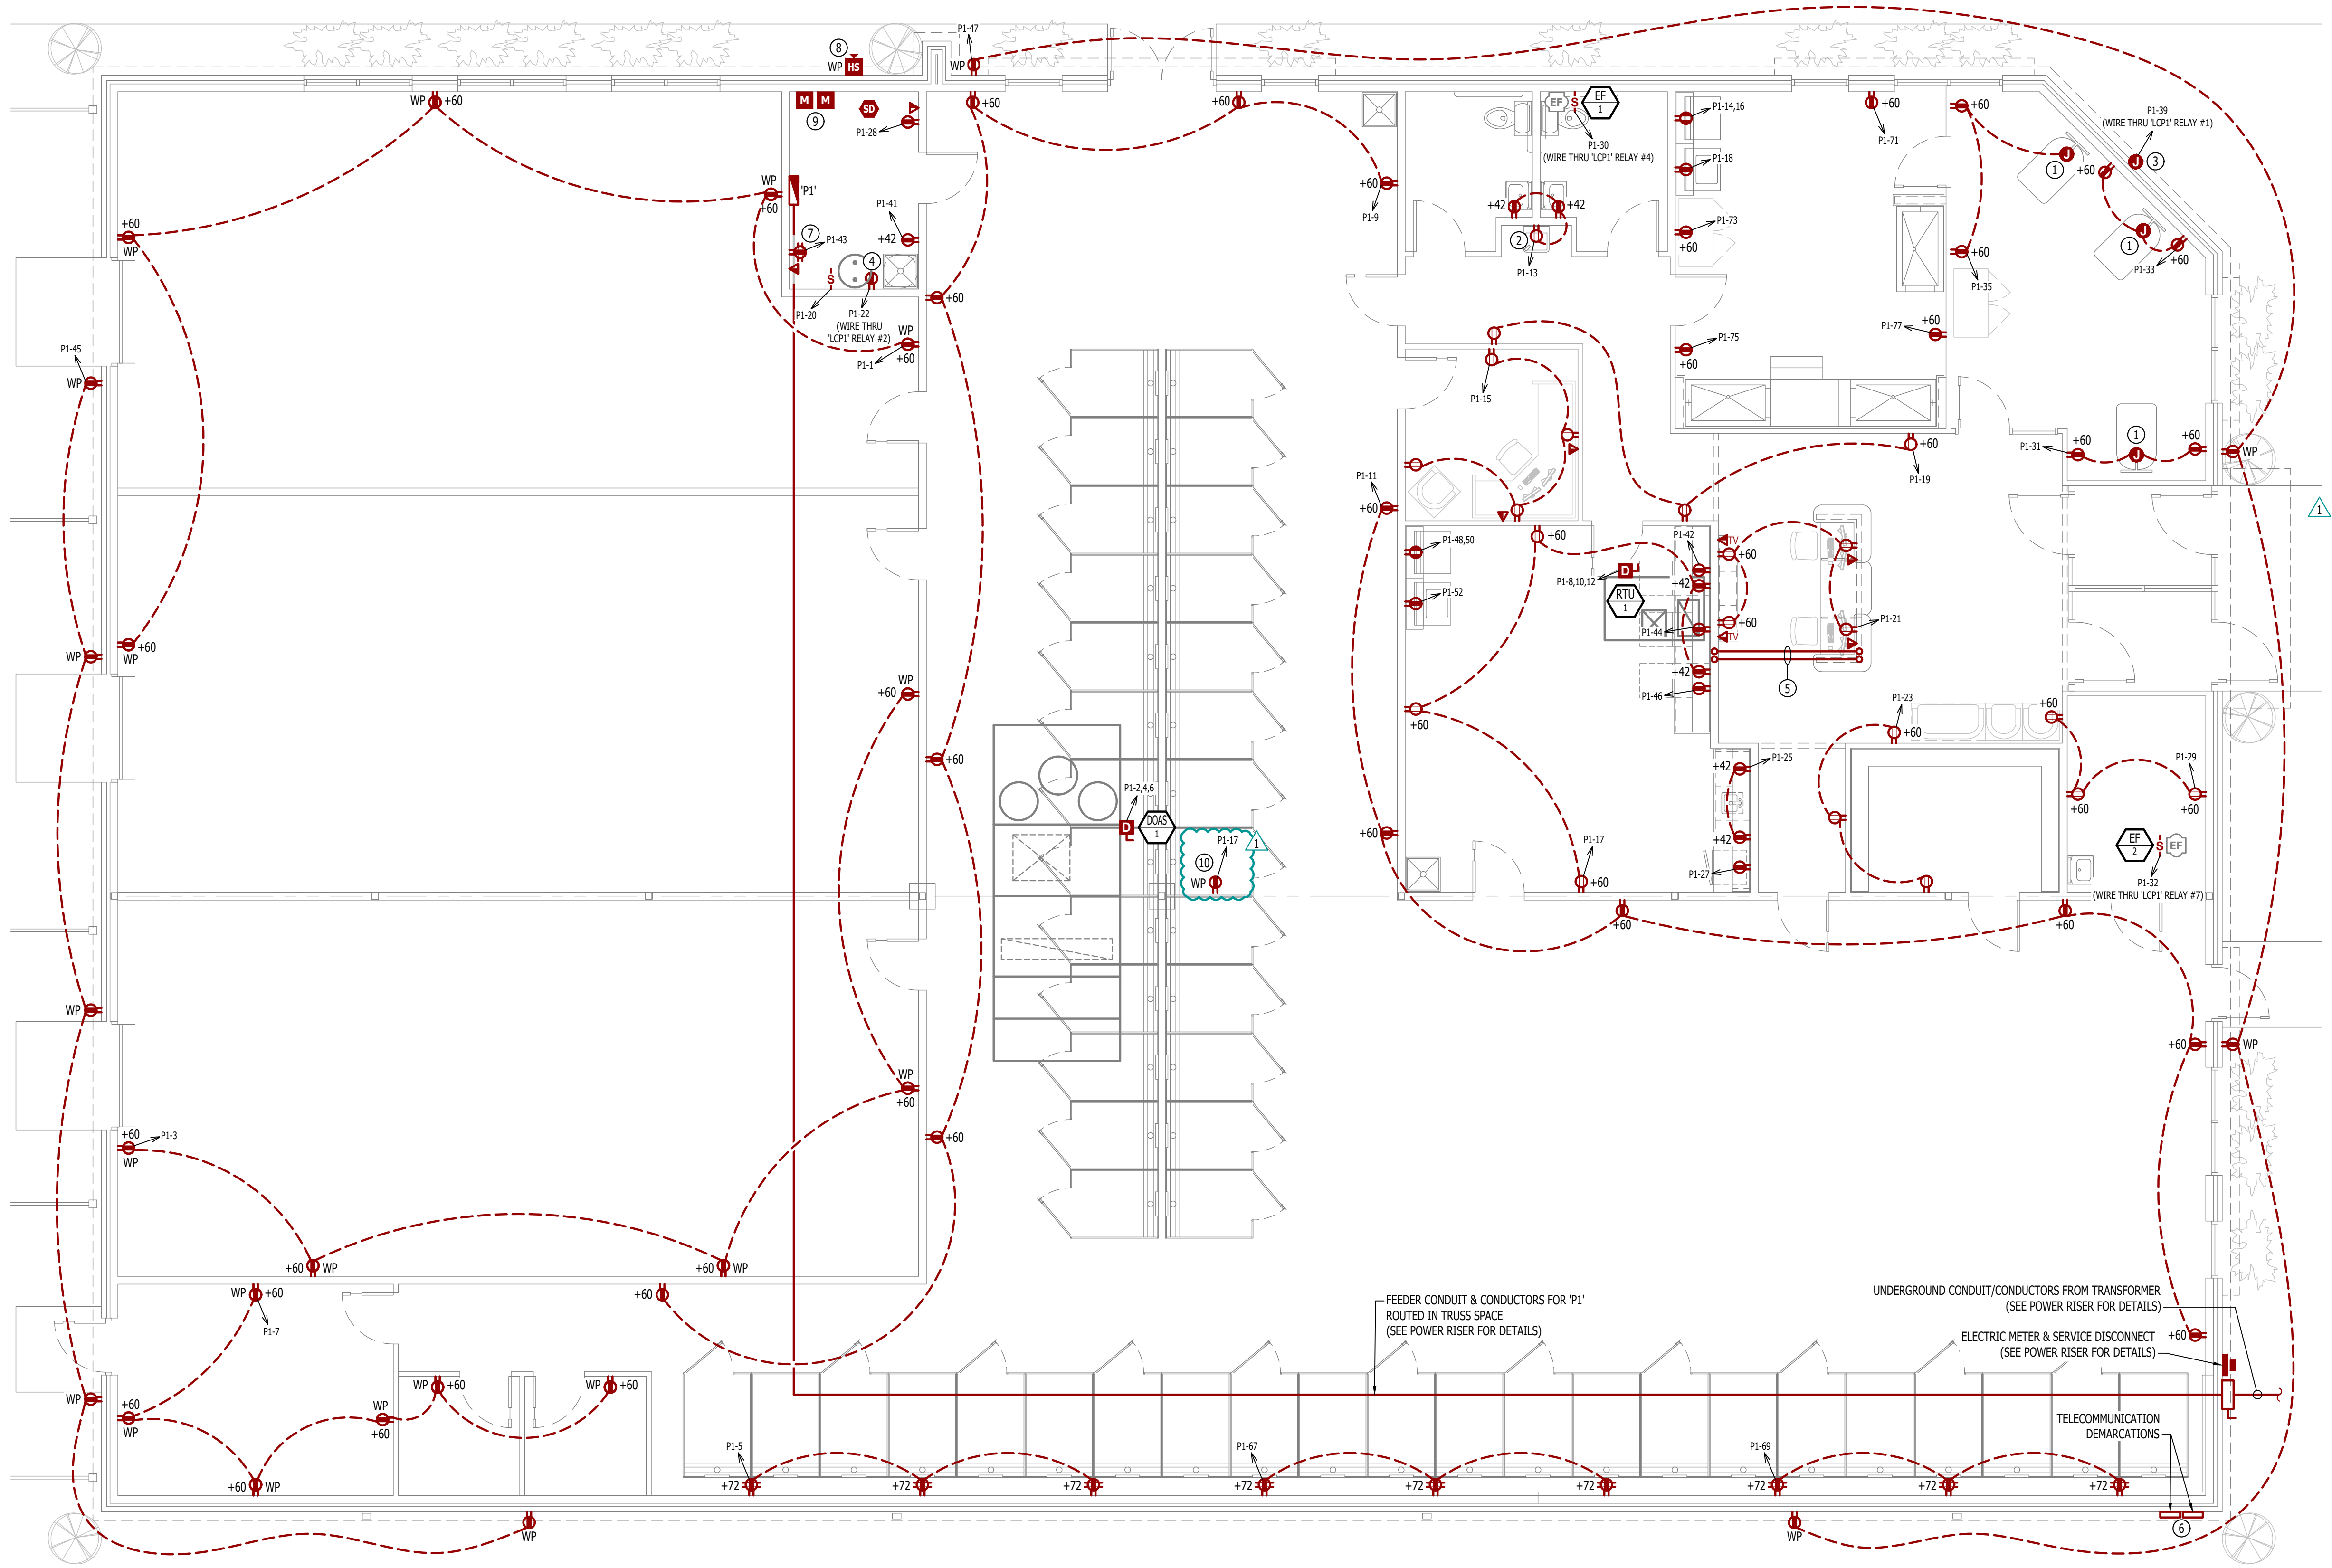

James Watson, P.E. October 11, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

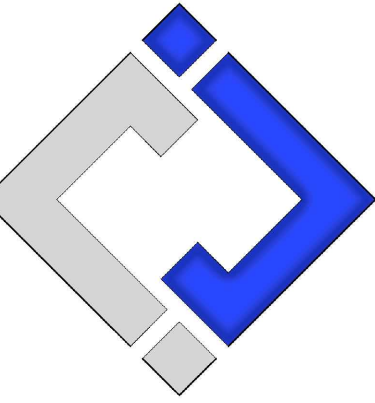

**J-SQUARED
ENGINEERING**

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW

ISSUE TITLE DATE

PERMIT 09-19-2024

REVISION 1 10-11-2024

Mechanical - Electrical - Plumbing Design Drawings for
Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri


A43 APPROVAL STAMP

SHEET TITLE

POWER PLAN

SHEET NUMBER

EP101

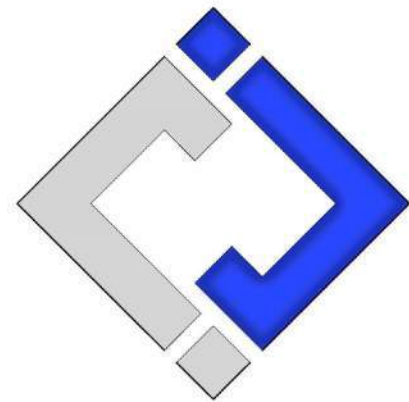

**J-SQUARED
ENGINEERING**

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW

ISSUE TITLE DATE

PERMIT 09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for
Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

LIGHTING PLAN

SHEET NUMBER

EL101

LIGHTING PLAN SYMBOL LEGEND

- X1** ← "X1" INDICATES FIXTURE TYPE (REFER TO SCHEDULE)
EM ← "EM" INDICATES EMERGENCY BATTERY BACKUP
NL ← "NL" INDICATES UN-SWITCHED NIGHT LIGHT
- EXIT LIGHT
- INDICATES REQUIRED REMOTE HEAD
- EMERGENCY EGRESS LIGHT
- SWITCH (WALL MOUNTED)
- SWITCH TYPE:
- 3 = 3-WAY
 - 4 = 4-WAY
 - OP = PASSIVE INFRARED OCCUPANCY SENSOR
 - OU = ULTRASONIC OCCUPANCY SENSOR
 - OT = DUAL-TECHNOLOGY OCCUPANCY SENSOR
 - VP = PASSIVE INFRARED VACANCY SENSOR
 - VU = ULTRASONIC VACANCY SENSOR
 - VT = DUAL-TECHNOLOGY VACANCY SENSOR
 - M = MOMENTARY SWITCH
 - SS = SCENE SWITCH
 - SC = SPEED CONTROLLER (CEILING FAN)
- DIMMER SWITCH (WALL MOUNTED)
- SWITCH TYPE:
- SEE "SWITCH (WALL MOUNTED)" FOR TYPE DESIGNATIONS
- SWITCH (CEILING MOUNTED)
- SWITCH TYPE:
- SEE "SWITCH (WALL MOUNTED)" FOR TYPE DESIGNATIONS

OCCUPANCY SENSOR

- AUTO FULL-ON (OR 50% IF NOTED)
- AUTOMATICALLY TURN OFF LIGHTING AFTER 20 MINUTES WITHOUT OCCUPANT DETECTION
- WITH MANUAL OVERRIDE CONTROL (IF NOTED)

VACANCY SENSOR

- MANUAL FULL-ON
- AUTOMATICALLY TURN OFF LIGHTING AFTER 20 MINUTES WITHOUT OCCUPANT DETECTION
- WITH MANUAL OVERRIDE CONTROL (IF NOTED)

LIGHTING PLAN GENERAL NOTES:

- REFER TO E500 AND/OR E600 SERIES SHEETS FOR ADDITIONAL LIGHTING NOTES, DETAILS, REQUIREMENTS, AND SCHEDULES.
- OCCUPANCY/VACANCY SENSOR QUANTITIES AND GENERAL LOCATIONS SHOWN FOR REFERENCE ONLY. CONTRACTOR TO PROVIDE & INSTALL SENSOR WITH SPACING PER MANUFACTURER'S SPECIFICATIONS AND INCLUDE ADDITIONAL SENSORS IF NECESSARY. CEILING-MOUNTED SENSORS SHALL BE INSTALLED WITHIN MANUFACTURER'S ACCEPTABLE MOUNTING HEIGHT RANGE.
- ELECTRICAL CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL FIXTURES, WIRING, HANGERS / SUPPORTS, ETC. WITH HVAC AND PLUMBING TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE REIMBURSED.

LIGHTING PLAN KEY NOTES:

- ① INCLUDE INLINE DIMMER SWITCH FOR EXTERIOR LIGHTING CIRCUIT LOCATED NEAR LIGHTING CONTROL PANEL.

"W1" FIXTURES MOUNTED @ 10" AFF
(TYP. UNLESS NOTED OTHERWISE)

"W3" FIXTURES MOUNTED @ 12" AFF
(TYP. UNLESS NOTED OTHERWISE)

"S1" FIXTURES MOUNTED
TO BOTTOM OF EXPOSED TRUSSES
(TYP. UNLESS NOTED OTHERWISE)

"C1" FIXTURES MOUNTED IN UNDERSIDE OF CANOPY
(TYP. UNLESS NOTED OTHERWISE)

"W2" FIXTURES MOUNTED ABOVE
EXTERIOR SIGNAGE AT ≈ 18'-6" A.F.F.
(COORDINATE WITH SIGNAGE
SUPPLIER/INSTALLER)



LIGHTING PLAN

SCALE: 3/16" = 1'-0"

ELECTRICAL SPECIFICATIONS

1.

GENERAL
- 1.1.

CONTRACTOR IS RESPONSIBLE TO PROVIDE ALL NECESSARY PIECES AND COMPONENTS TO PROVIDE A COMPLETE AND COMPLIANT ELECTRICAL SYSTEM UNLESS OTHERWISE NOTED ON PLANS.
- 1.2.

THE ENTIRE ELECTRICAL SYSTEM SHALL BE CONTINUOUSLY GROUNDED. EVERY BRANCH CONDUIT SHALL INCLUDE A GREEN GROUND CONDUCTOR SIZED PER NEC.
- 1.3.

ARC-FAULT CIRCUITS SHALL BE RUN WITH A DEDICATED NEUTRAL AS REQUIRED BY MANUFACTURER.
- 1.4.

PROVIDE PERMANENT ARC-FLASH LABEL AFFIXED TO EVERY DISCONNECT AND PANEL.
- 1.5.

PROVIDE TYPE WRITTEN PANEL SCHEDULE FOR EACH PANEL.
2.

WORKMANSHIP
- 2.1.

ALL ELECTRICAL SYSTEM COMPONENTS SHALL BE INSTALLED LEVEL, PLUMB, AND PARALLEL/PERPENDICULAR TO BUILDING ORIENTATION WHERE POSSIBLE.
- 2.2.

ALL ELECTRICAL DEVICES AND LIGHT FIXTURES SHALL BE INSTALLED IN A SAFE, FIRST-CLASS MANNER WITH ATTENTION GIVEN TO OVERALL AESTHETICS.
CARE SHOULD BE TAKEN TO ALLOW FOR FUTURE REPLACEMENT AND ACCESS FOR SERVICE.
3.

MATERIALS
- 3.1.

CONDUIT & CONDUCTORS
- 3.1.1.

ALL CONDUCTORS SIZES INDICATED ARE COPPER UNLESS NOTED OTHERWISE ON PLANS.
- 3.1.2.

ABOVE GRADE CONDUCTORS SHALL BE TYPE THHN.
BELOW GRADE CONDUCTORS SHALL BE TYPE XHHW-2.
- 3.1.3.

MINIMUM CONDUCTOR SIZE SHALL BE #12 AWG UNLESS NOTED OTHERWISE. 120-VOLT, 20-AMP CIRCUITS WITH CONDUCTOR LENGTHS GREATER THAN 100' SHALL BE #10 AWG MINIMUM.
ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR MEASURING ACTUAL CONDUCTOR LENGTH AND INCREASING CONDUCTOR SIZE TO COMPENSATE FOR VOLTAGE DROP AS REQUIRED BY NEC.
- 3.1.4.

RIGID GALVANIZED OR SCHEDULE 40 PVC CONDUIT SHALL BE USED FOR SERVICE WIRING, BELOW GRADE INSTALLATIONS, OR WHERE EXPOSED TO WEATHER.
- 3.1.5.

IN APPLICATIONS OTHER THAN THOSE LISTED IN 3.1.4, EMT OR MC CABLE IS ACCEPTABLE.
WHERE CONDUCTORS ARE PROTECTED FROM DAMAGE, ENCLOSED IN BUILDING MATERIALS, AND CONSTRUCTION IS OF A PERMITTED TYPE, NM CABLE MAY BE USED.
- 3.1.6.

FOR CAST-IN-PLACE CONCRETE, TILT-UP WALL CONSTRUCTION, OR PRE-MANUFACTURED WALL SYSTEMS, COORDINATE EXACT LOCATIONS OF ALL DEVICES WITHIN WALLS WITH WALL SUPPLIER.
CONDUIT EMBEDDED IN WALLS SHALL BE SCHEDULE 80 PVC OR LFMC, OR OTHER SYSTEM APPROVED BY WALL MANUFACTURER.
- 3.1.7.

EXPOSED CONDUIT SHALL BE PAINTED TO MATCH ADJACENT SURFACES, VERIFY COLOR WITH ARCHITECT/OWNER.
- 3.2.

DEVICES
- 3.2.1.

CONTRACTOR TO PROVIDE J-BOXES, COVER PLATES, AND ANY ACCESSORIES REQUIRED TO PROVIDE A COMPLETE SYSTEM. SEE ARCHITECTURAL PLANS FOR DEVICE COLORS.
DUPLEX RECEPTACLES SHALL BE TAMPER RESISTANT, 20-AMP, EQUAL TO LEVITON #TBR-20.
- 3.2.2.

SINGLE POLE TOGGLE WALL SWITCHES SHALL BE EQUAL TO LEVITON CS120-2.
THREE-WAY TOGGLE WALL SWITCHES SHALL BE EQUAL TO LEVITON CS320-2.
- 3.2.3.

DIMMER SWITCHES SHALL BE TESTED WITH FIXTURES AND LAMPS FOR COMPATIBILITY. SEE LIGHTING PLANS FOR DETAILS.
- 3.2.4.

WHERE GFCI PROTECTION IS SHOWN ON PLANS AND UNLESS OTHERWISE NOTED, PROVIDE A LISTED GFCI-PROTECTED RECEPTACLE WHERE THE RECEPTACLE IS ACCESSIBLE ON PLANS. IF THE RECEPTACLE LOCATION IS NOT ACCESSIBLE AS DEFINED BY NEC, PROVIDE GFCI PROTECTION AT CIRCUIT BREAKER.
- 3.2.5.

DO NOT INSTALL OCCUPANCY/VACANCY SENSORS WITHIN 48" OF HVAC DIFFUSERS/GRILLES OR SIMILAR OBSTRUCTION THAT MAY AFFECT SENSOR FUNCTIONALITY. ALL SENSORS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
- 3.2.6.

ALL APPLICABLE SWITCHES, RECEPTACLES, CONTROLS, ETC. SHALL BE MOUNTED AT ADA-ACCESSIBLE HEIGHTS.
- 3.2.7.

WIRING DEVICES SHOWN ON PLANS NEXT TO ONE ANOTHER SHALL UTILIZE A SINGLE COVER PLATE UNLESS NOTED OTHERWISE.
- 3.2.8.


WIRING DEVICES SHOWN BACK-TO-BACK ON EACH SIDE OF A WALL SHALL BE OFFSET TO REDUCE SOUND TRANSMISSION.
- 3.2.9.

EACH RECEPTACLE COVER SHALL BE NEATLY AND LEGIBLY LABELED WITH CORRESPONDING PANEL AND CIRCUIT NUMBER FOR CIRCUIT IDENTIFICATION.
4.

EMERGENCY LIGHTING
- 4.1.


BRANCH CIRCUIT FEEDING EMERGENCY FIXTURE(S) SHALL BE SAME BRANCH CIRCUIT AS THAT SERVING NORMAL LIGHTING IN SAME AREA AND CONNECTED AHEAD OF ANY LOCAL SWITCHES.
- 4.2.

EMERGENCY LIGHTING SYSTEM SHALL PROVIDE 1FC AVERAGE AND 0.1FC MINIMUM ALONG EGRESS PATHS. ADJUST ANY EMERGENCY FIXTURES AS NECESSARY TO PROVIDE PROPER ILLUMINATION WITHOUT OBSTRUCTION FROM FURNITURE OR OBSTACLES.

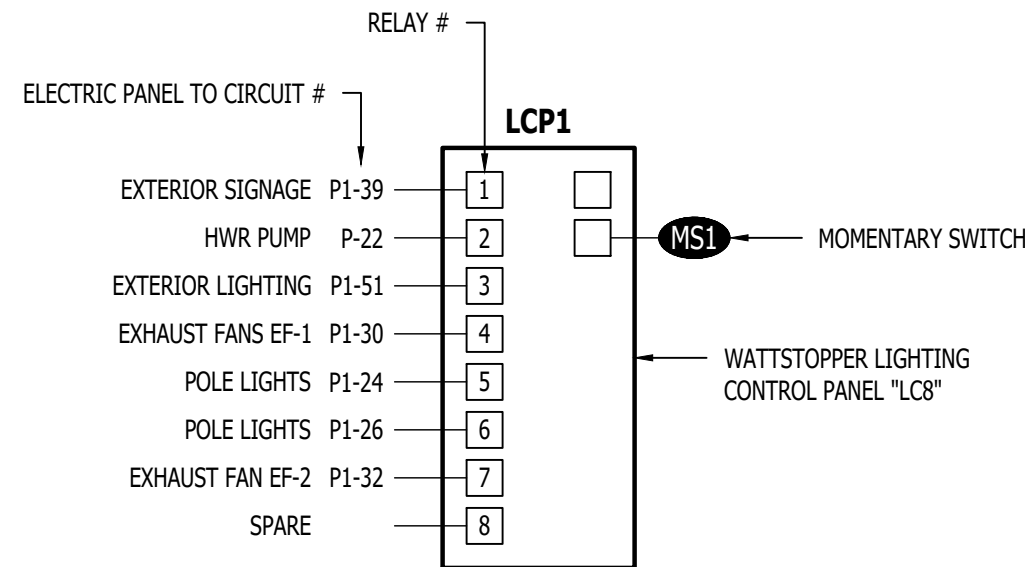

LIGHTING CONTROL PANEL SCHEDULE		
RELAY #	OVERRIDE SWITCH	OPERATIONAL SCHEDULE
1	NO	ON DURING OCCUPIED HOURS
2	NO	ON DURING OCCUPIED HOURS
3	YES	ON DURING NIGHT HOURS
4	NO	ON DURING OCCUPIED HOURS
5	YES	ON DURING NIGHT HOURS
6	YES	ON DURING NIGHT HOURS
7	NO	ON DURING OCCUPIED HOURS
8	-	-


LIGHTING CONTROL PANEL

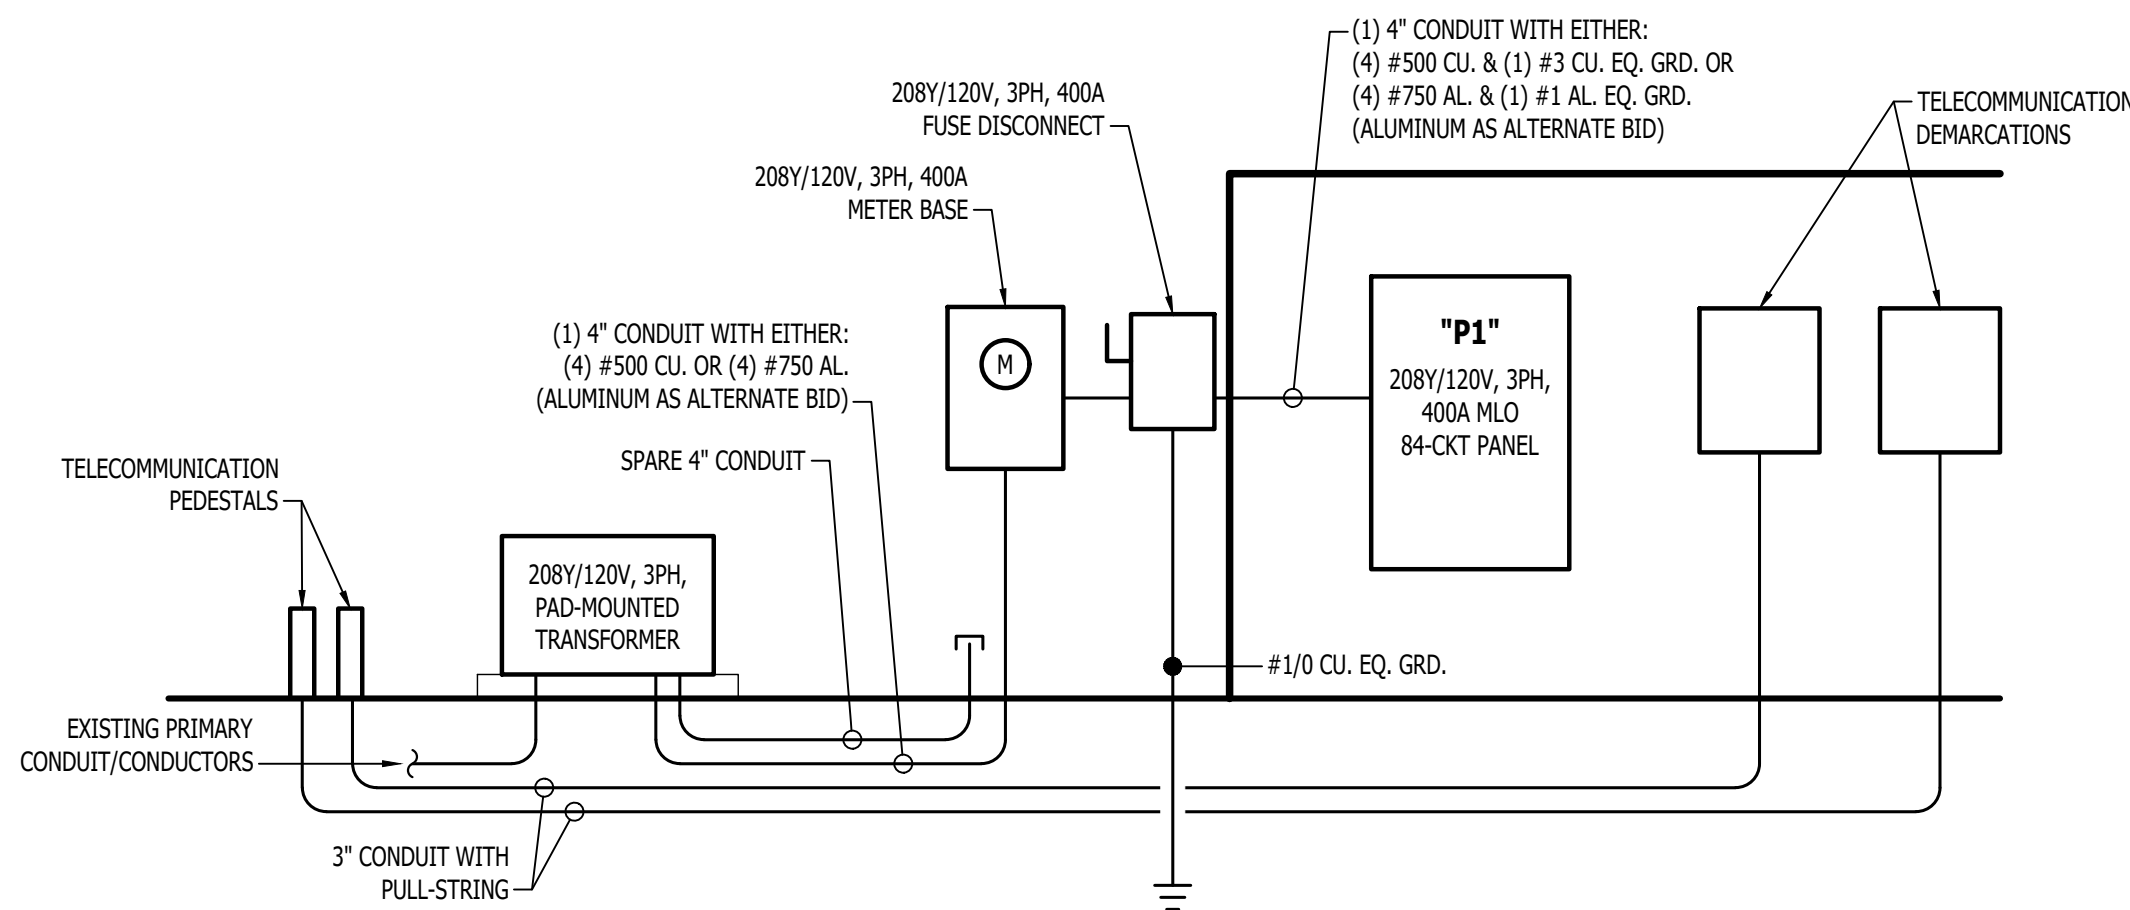


POWER RISER NOTES:

- COORDINATE DETAILS & REQUIREMENTS OF NEW ELECTRIC SERVICE WITH EVERY.
- ALL NEW METERING EQUIPMENT MUST BE APPROVED BY EVERY.
- EACH METER MUST BE PERMANENTLY LABELED.
- AIC-RATINGS BASED ON:
 - TRANSFORMER: 75kVA, 100% POWER FACTOR, 3.50% Z, LOCATED APPROXIMATELY WHERE SHOWN ON PLANS.
 - METER LOCATION INSTALLED APPROXIMATELY WHERE SHOWN ON PLANS.
 - ELECTRICAL PANEL LOCATION INSTALLED APPROXIMATELY WHERE SHOWN ON PLANS.
 - CONTRACTOR TO FIELD VERIFY FINAL EQUIPMENT LOCATIONS AND PERFORM ADDITIONAL AIC RATING CALCULATIONS IF NECESSARY.


POWER RISER

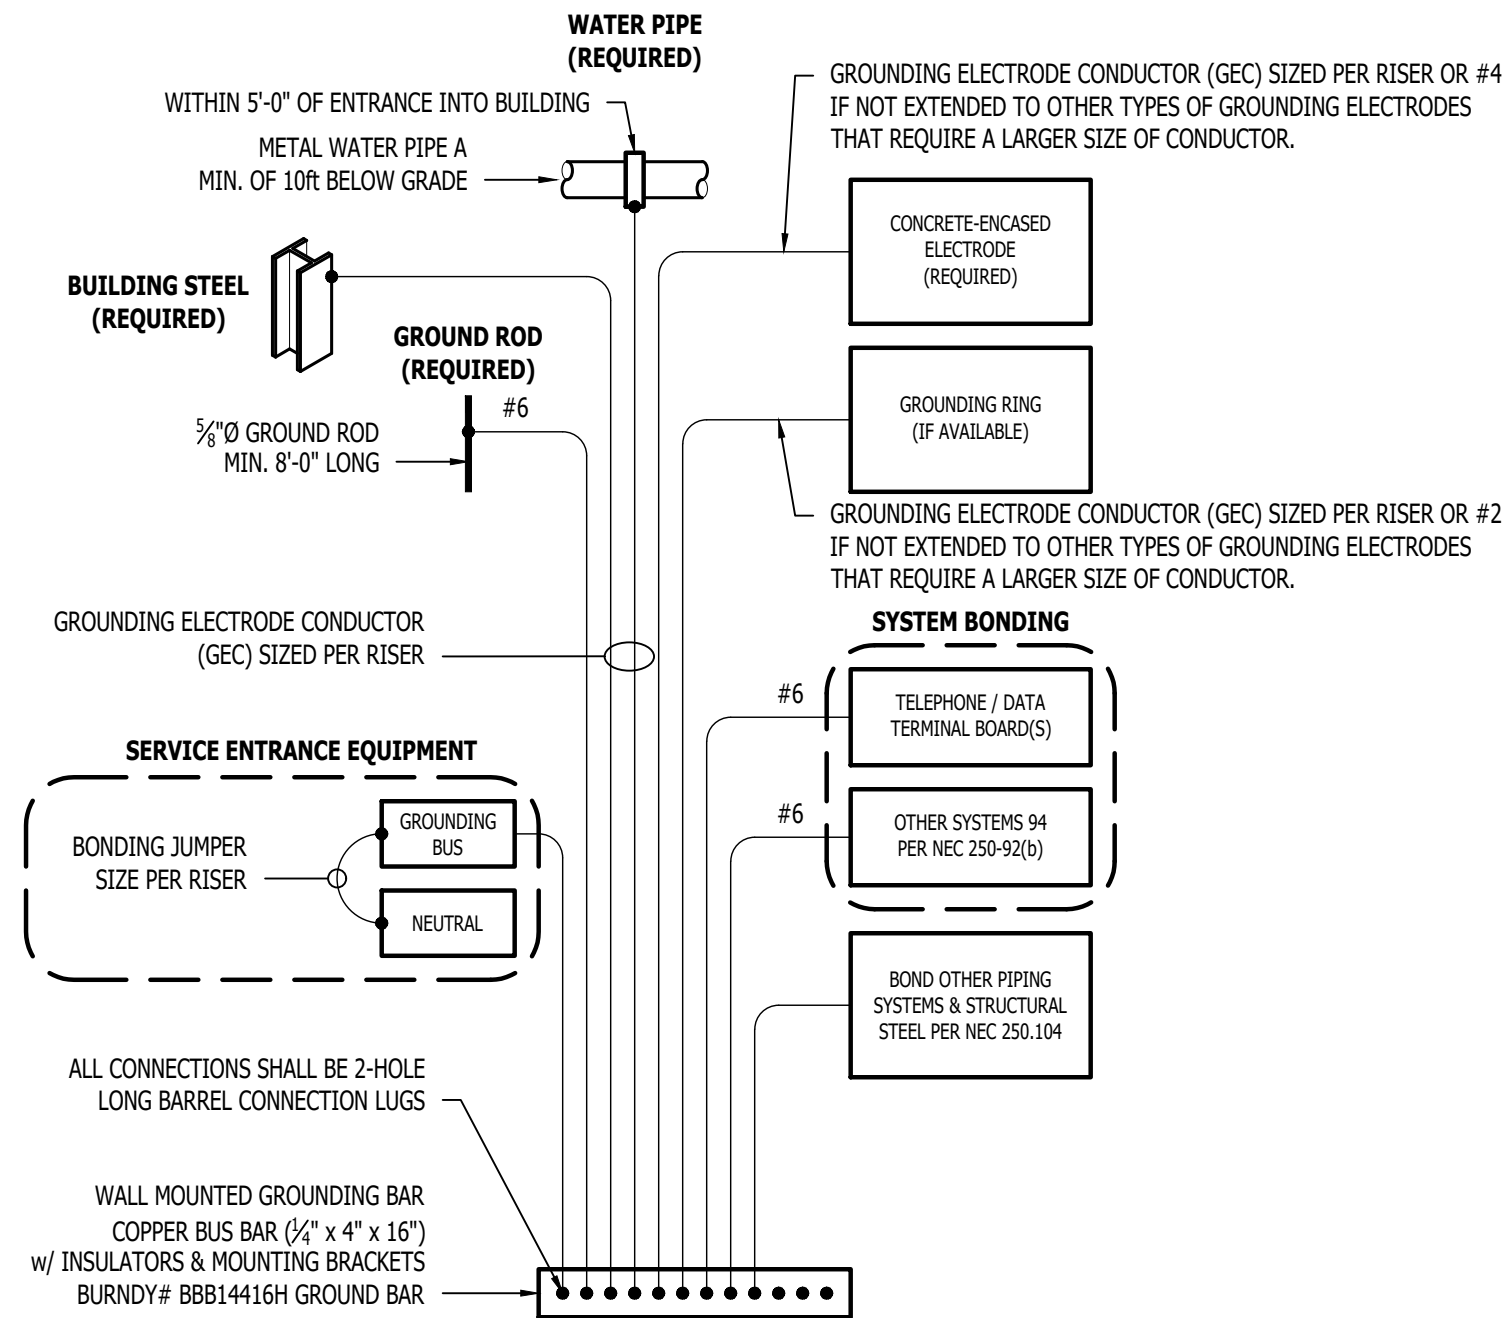

TYPICAL GROUNDING & BONDING DETAIL

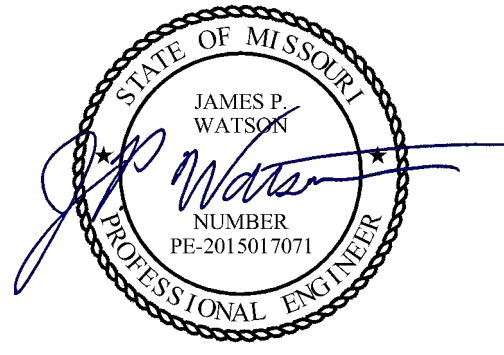

James Watson, P.E. September 19, 2024
PE-2015017071
MO Certificate of Authority # 2018029680

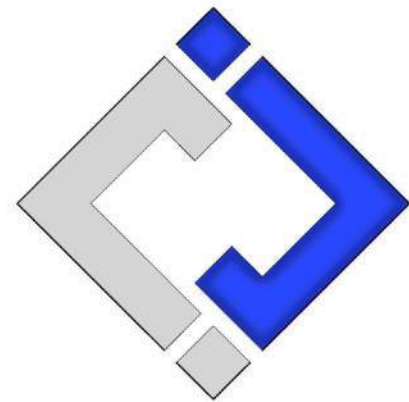

J-SQUARED
ENGINEERING

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No:	J21205
J2 DESIGN:	ACW

ISSUE TITLE		DATE
PERMIT		09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri


AHJ APPROVAL STAMP

SHEET TITLE

ELECTRICAL
SCHEDULES

SHEET NUMBER

E501



ISSUE TITLE	DATE
PERMIT	09-19-2024
REVISION 1	10-11-2024

100

Mechanical - Electrical - Plumbing Design Drawings for

Discovery Park

Discovery Pet Spa

**1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri**

AHJ APPROVAL STAMP

SHEET TITLE

ELECTRICAL DETAILS

SHEET NUMBER

E601

79	ROOFTOP RECEPTACLE	20-1	1.5
----	--------------------	------	-----

NOTES:


1. ALL BRANCH CIRCUIT CONDUCTORS SHALL BE COPPER. ALL WIRE SIZES SHOWN ARE BASED ON CONDUCTOR TEMPERATURE RATING OF 75°C & AMBIENT TEMPERATURE OF 30°C PER NEC.
2. DISTANCE SHOWN ABOVE IS LENGTH FROM OVERCURRENT PROTECTION TO DEVICE/EQUIPMENT.
3. REFER TO PLAN SHEETS FOR BRANCH CONDUCTOR SIZING LENGTHS GREATER THAN SHOWN ABOVE.
4. VOLTAGE DROP CALCULATIONS BASED ON 3% DROP, 80% CIRCUIT LOAD, THIN/TWNY INSULATION, 100% POWER FACTOR, BALANCED LOAD, NEGLIGIBLE REACTANCE, & SIX OR LESS CURRENT-CARRYING CONDUCTORS IN RACEWAY.

NOTES:

1. ALL WIRE SIZES SHOWN ARE BASED ON CONDUCTOR TEMPERATURE RATING OF 75°C & AMBIENT TEMPERATURE RATING OF 30°C PER NEC.
2. MAXIMUM ALLOWABLE VOLTAGE DROP FOR FEEDER CONDUCTORS SHALL BE 2%.
3. ELECTRICAL CONTRACTOR TO ADJUST CONDUCTOR SIZES FOR LONG CIRCUIT LENGTHS & AMBIENT TEMPERATURES HIGHER THAN 30°C.

NOTES:

1. VERIFY LIGHT FIXTURE FINISHES WITH OWNER / ARCHITECT PRIOR TO INSTALLATION.
2. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING TYPES THROUGHOUT. COORDINATE EXACT MOUNTING DETAILS WITH GENERAL CONTRACTOR

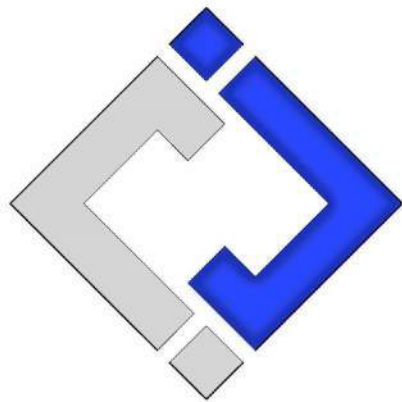

**J-SQUARED
ENGINEERING**

2400 Bluff Creek Drive, Suite 101
Columbia, Missouri 65201
573 - 234 - 4492 phone
www.j-squaredeng.com

J2 PROJECT No: J21205

J2 DESIGN: ACW

ISSUE TITLE DATE

PERMIT 09-19-2024

Mechanical - Electrical - Plumbing Design Drawings for
Discovery Park

Discovery Pet Spa

1901 NE Trails Edge Boulevard
Lee's Summit, Jackson County, Missouri

AHJ APPROVAL STAMP

SHEET TITLE

SANITARY SEWER PLAN

SHEET NUMBER

PS101

SANITARY SEWER PLAN SYMBOL LEGEND


- SANITARY SEWER PIPING
- VENT PIPING
- PIPING TURNED DOWN / TURNED UP
- TIE INTO EXISTING

SANITARY SEWER PLAN GENERAL NOTES:

- REFER TO P500 AND/OR P600 SERIES SHEETS FOR ADDITIONAL PLUMBING NOTES, DETAILS, REQUIREMENTS, AND SCHEDULES.
- PLUMBING CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL EQUIPMENT, PIPING, HANGERS / SUPPORTS, ETC. WITH HVAC AND ELECTRICAL TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE REIMBURSED.
- ANY EXISTING SANITARY/VENT PIPING SHOWN IS FOR REFERENCE ONLY. PLUMBING CONTRACTOR TO FIELD VERIFY EXACT PIPING SIZE, LOCATIONS, DEPTH, DIRECTION, CONDITION, ETC. PRIOR TO INSTALLATION OF ANY MATERIAL AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

SANITARY SEWER PLAN KEY NOTES:

- 2" TUB DRAIN ABOVE SLAB WITHIN CASEWORK.
- 2" TUB DRAIN DOWN TO BELOW SLAB.
- 2" VENT UP IN WALL.

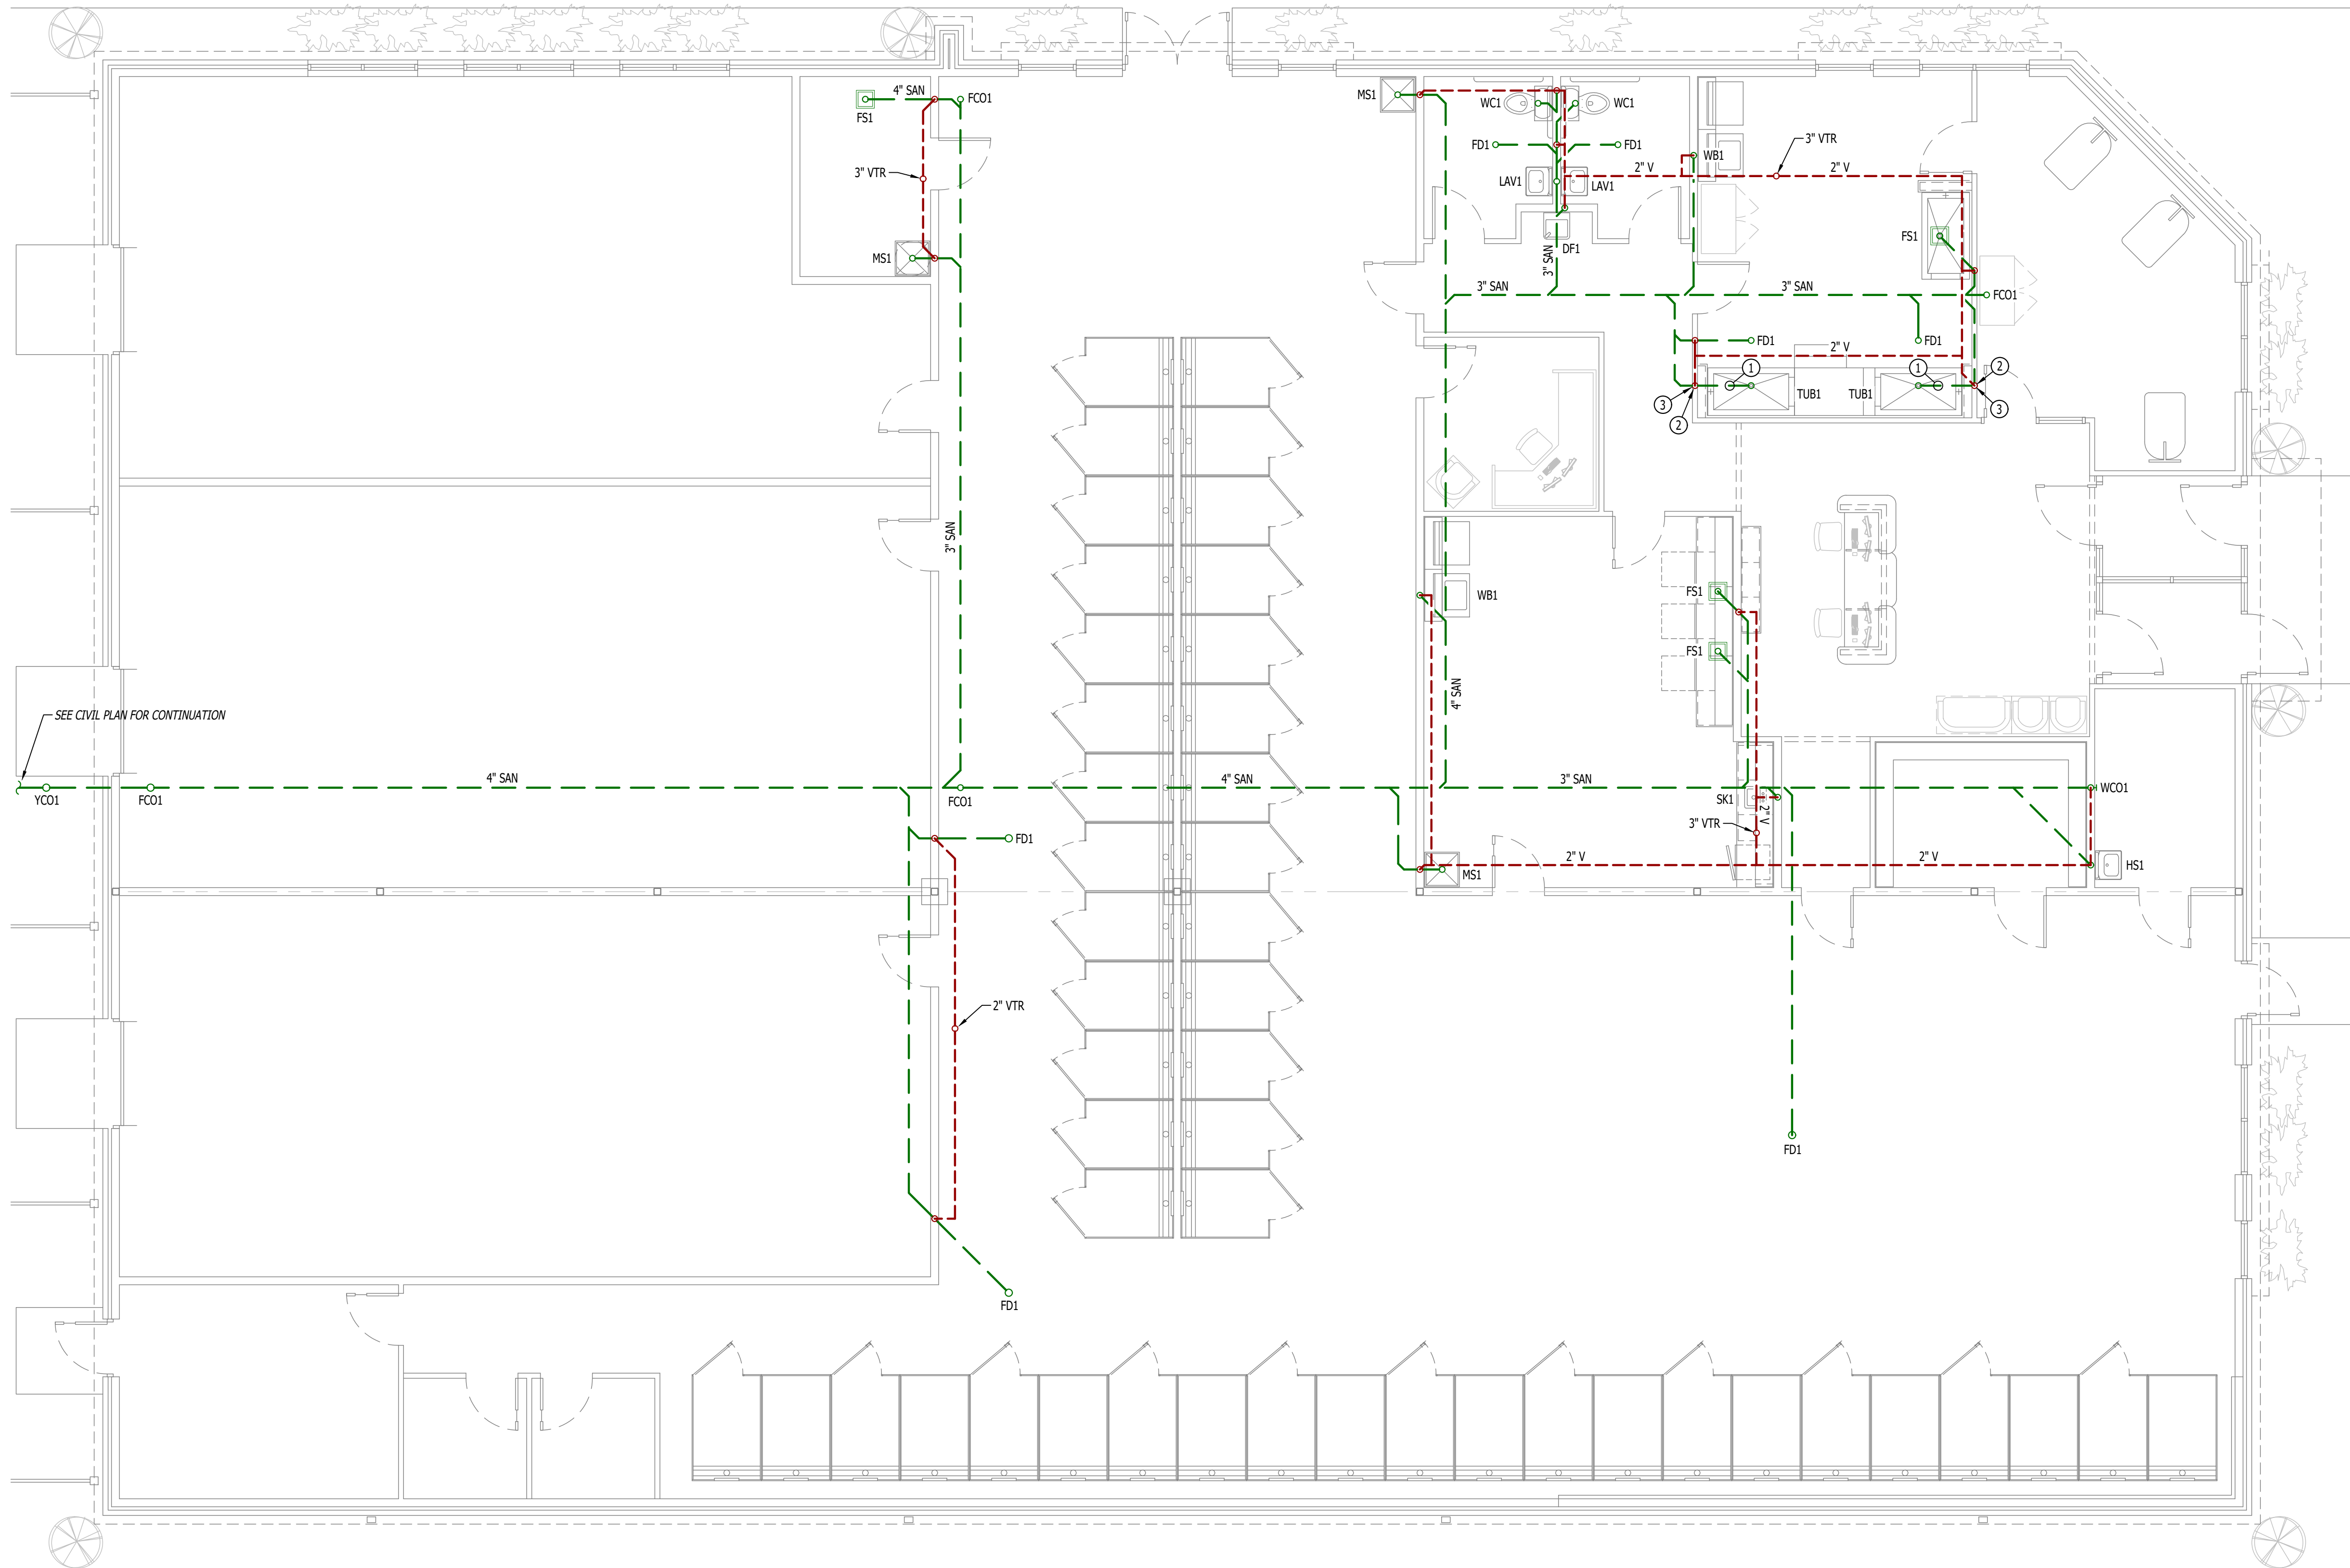

SANITARY SEWER PLAN

SCALE: 3/16" = 1'-0"

WATER & GAS PLAN SYMBOL LEGEND


	COLD WATER LINE		WATER METER
	HOT WATER LINE		VALVE
	HOT WATER RECIRCULATION LINE		PUMP
	GAS LINE		GAS METER
	PIPING TURNED DOWN / TURNED UP		TIE INTO EXISTING

WATER & GAS PLAN GENERAL NOTES:

1. REFER TO P500 AND/OR P600 SERIES SHEETS FOR ADDITIONAL PLUMBING NOTES, DETAILS, REQUIREMENTS, AND SCHEDULES.
2. PLUMBING CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL EQUIPMENT, PIPING, HANGERS / SUPPORTS, ETC. WITH HVAC AND ELECTRICAL TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE REIMBURSED.

WATER & GAS PLAN KEY NOTES:

- ① 1/2" CW & 1/2" HW DOWN IN WALL TO GROOMING TUB; COORDINATE EXACT DETAILS & REQUIREMENTS WITH EQUIPMENT INSTALLER/SUPPLIER
- ② WATER HEATER VENT & COMBUSTION AIR ROUTED/TERMINATED UP THRU ROOF PER MANUFACTURER'S SPECIFICATION.

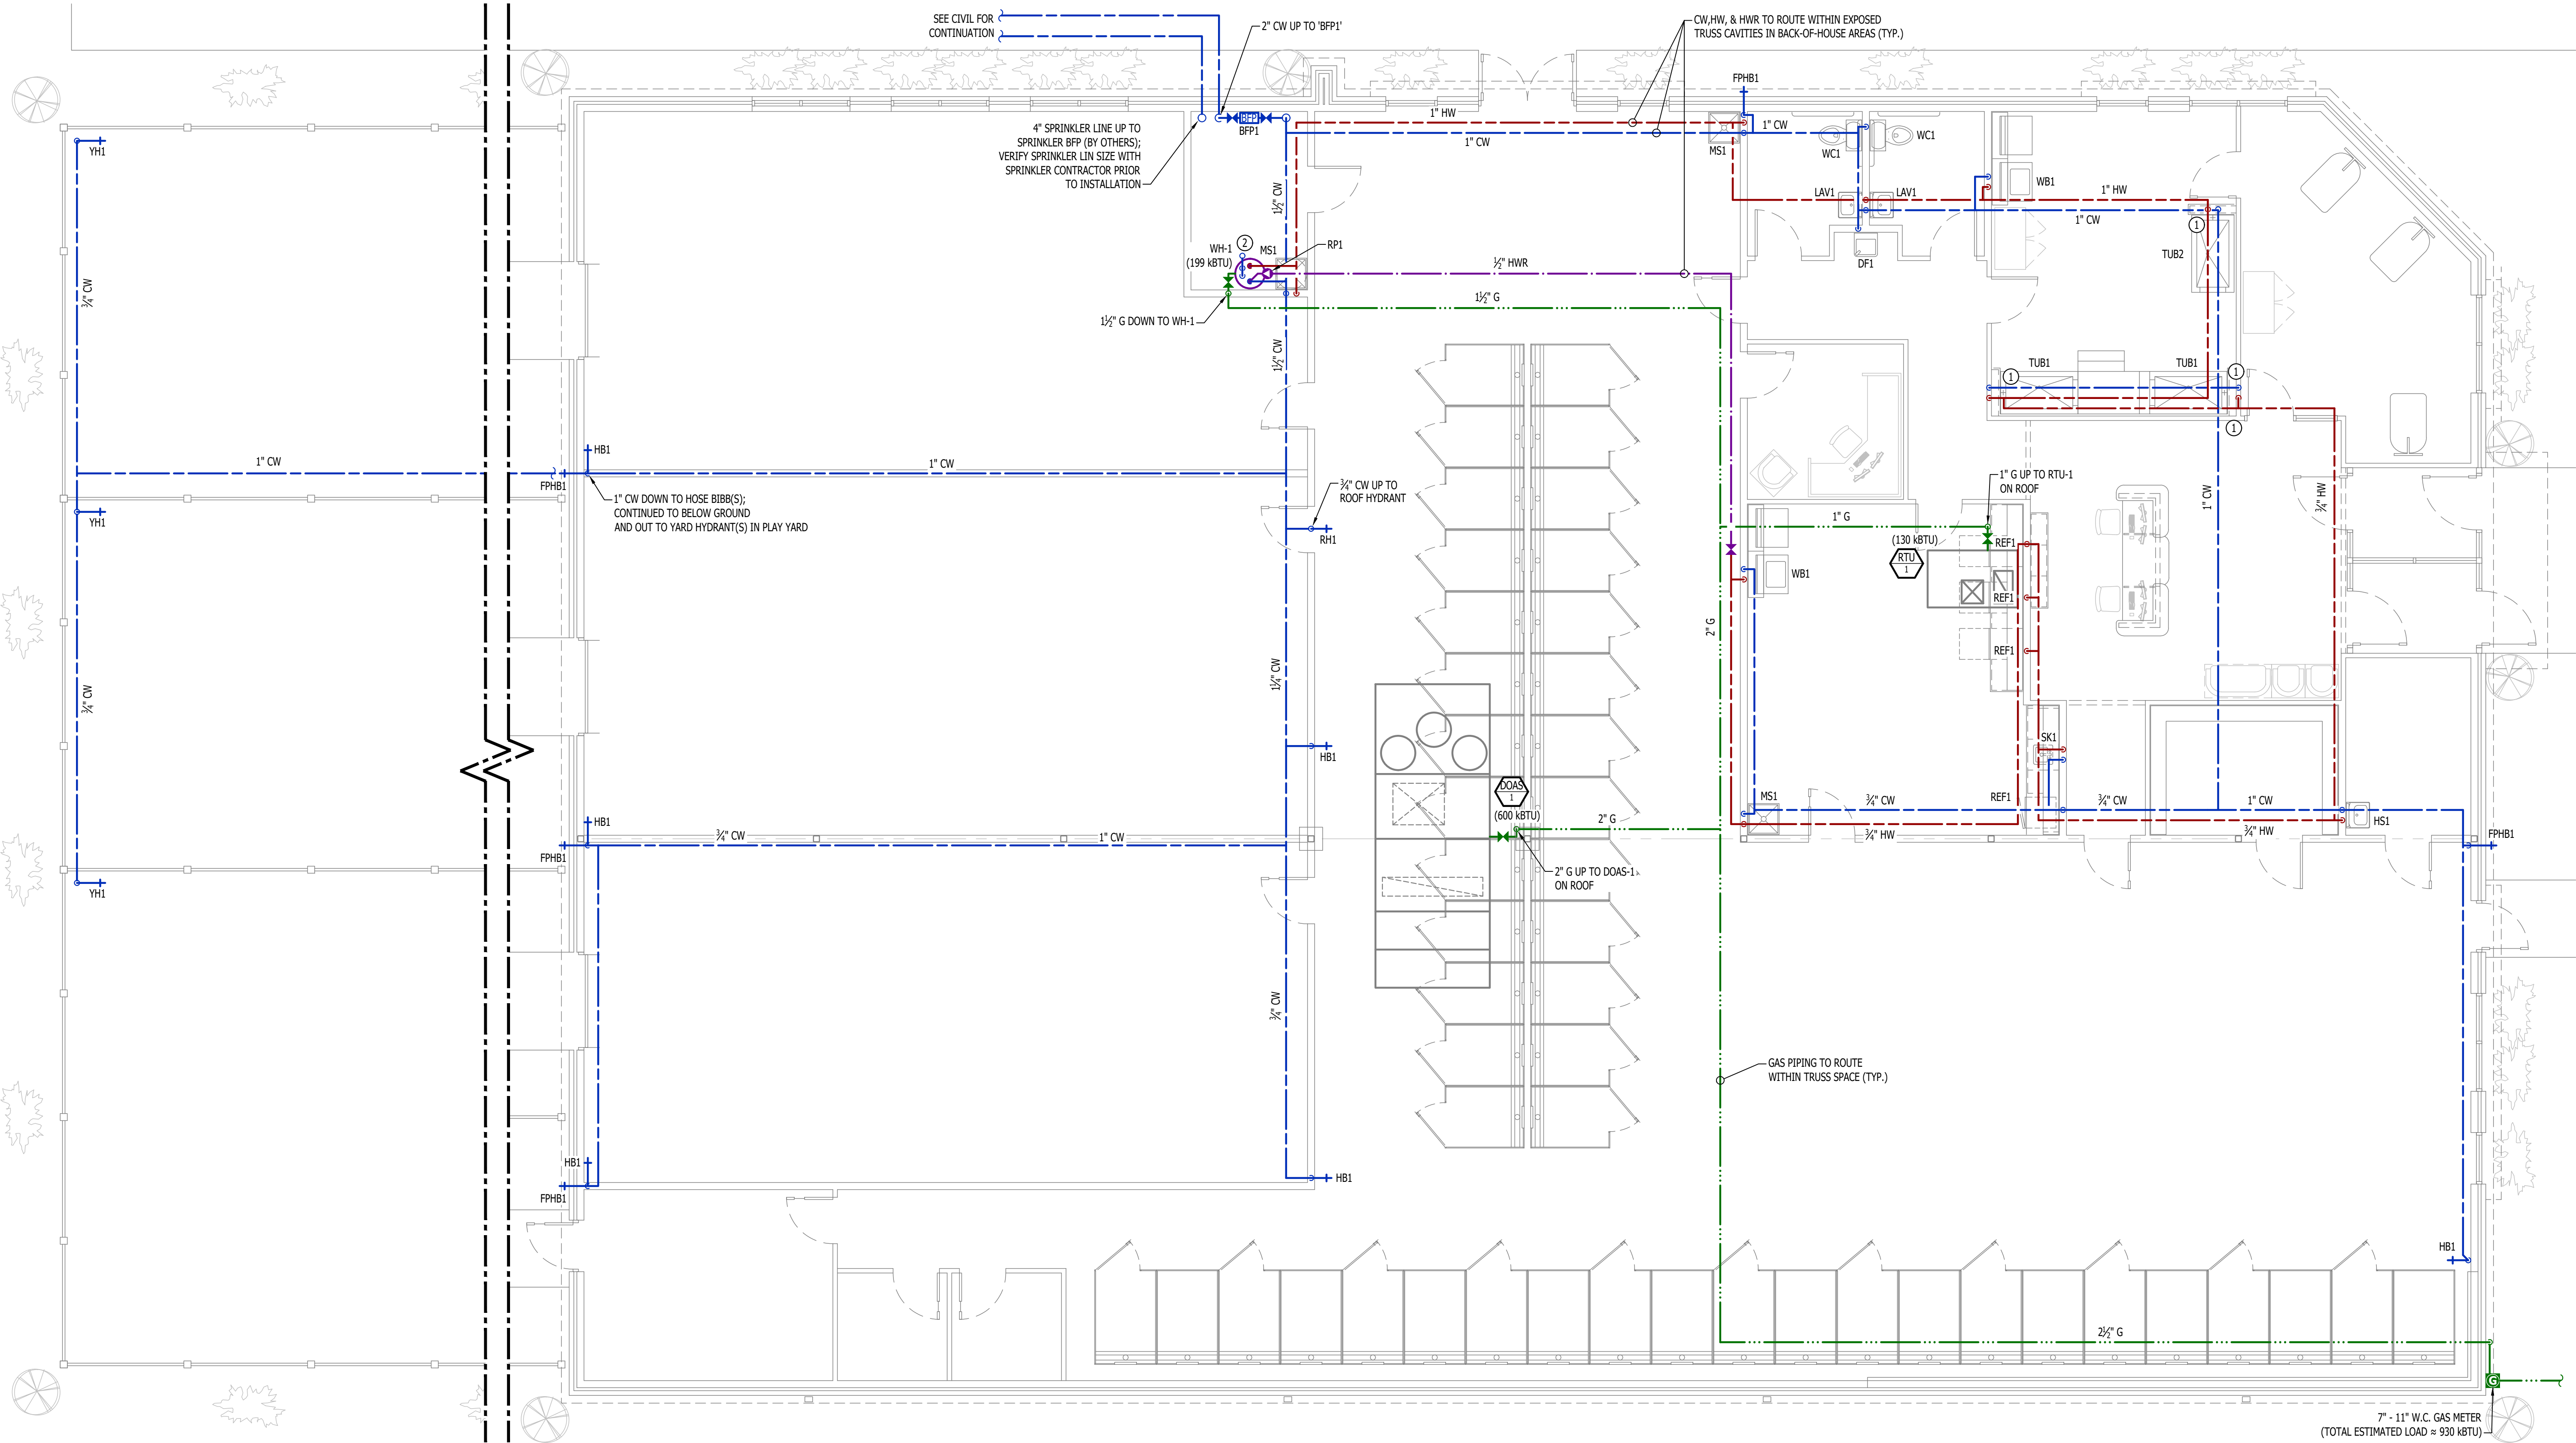

J2 PROJECT No:	J21205
J2 DESIGN:	ACW
ISSUE TITLE	DATE
PERMIT	09-19-2024

PLUMBING SPECIFICATIONS

1.

GENERAL
- 1.1.

PLUMBING CONTRACTOR IS RESPONSIBLE TO PROVIDE ALL ESCUTCHEONS, ¼ TURN STOPS, P-TRAPS, AND SUPPLY LINES TO PROVIDE A COMPLETE SYSTEM AT EACH FIXTURE INDICATED ON PLANS UNLESS NOTED OTHERWISE.
- 1.2.

ALL PLUMBING SYSTEMS SHALL BE INSTALLED LEVEL, PLUMB, AND PARALLEL/PERPENDICULAR TO BUILDING ORIENTATION WHERE POSSIBLE.
- 1.3.

COORDINATE ALL PIPING INSTALLATIONS WITH STRUCTURAL GRADE BEAMS, FOOTINGS, COLUMN PIERS, ETC. SLEEVE PIPING THRU STRUCTURAL ELEMENTS AS NECESSARY, VERIFY WITH STRUCTURAL ENGINEER.
- 1.4.

VERIFY ALL UTILITY CONNECTION POINTS WITH PROPOSED PLUMBING LAYOUTS PRIOR TO BEGINNING WORK.
- 1.5.

CLEAN ALL PLUMBING FIXTURES AND CHANGE FAUCET AERATORS AND SINK STRAINERS AT PROJECT COMPLETION PRIOR TO TURNING OVER TO OWNERSHIP.
2.

EQUIPMENT / FIXTURES
- 2.1.

ALL EQUIPMENT AND/OR FIXTURES MUST MEET OR EXCEED THE PERFORMANCE, FUNCTIONAL INTENT, AND AESTHETICS AS MODELS SPECIFIED ON PLANS. WHERE SPECIFIC MANUFACTURERS AND/OR MODELS ARE INDICATED ON PLANS OR WITHIN SCHEDULES, CONTRACTOR TO PROVIDE MODEL INDICATED OR APPROVED EQUAL. VERIFY SUBSTITUTION APPROVAL PRIOR TO PURCHASE OR INSTALLATION OF EQUIPMENT.
- 2.2.

CONTRACTOR TO SUPPLY SUBMITTALS FOR ALL EQUIPMENT FOR REVIEW BY ARCHITECT AND ENGINEER. FORMAL APPROVAL SHALL BE RECEIVED BY CONTRACTOR PRIOR TO EQUIPMENT PURCHASE.
- 2.3.

CONTRACTOR TO SHARE APPROVED EQUIPMENT SUBMITTALS WITH ANY PERTINENT ELECTRICAL REQUIREMENTS WITH ELECTRICAL CONTRACTORS WITHIN TWO WEEKS OF RECEIVING APPROVED SUBMITTALS FROM ARCHITECT/ENGINEER.
3.

SANITARY
- 3.1.

BELOW AND ABOVE GRADE WASTE AND VENT PIPING IN BUILDING TO BE SOLID CORE SCHEDULE 40 PVC LISTED FOR DWV APPLICATIONS.
- 3.2.

NO WASTE OR VENT PIPING INSTALLED BELOW GRADE SHALL BE SMALLER THAN 2".
- 3.3.

MINIMUM SLOPES FOR WASTE PIPING (UNLESS NOTED OTHERWISE ON PLANS):
- 3.3.1.

2 ½" OR LESS DIAMETER: ¼" PER FOOT
- 3.3.2.

3" TO 6" DIAMETER: ½" PER FOOT
- 3.3.3.

8" OR LARGER DIAMETER: ¾" PER FOOT
- 3.4.

ACCESSIBLE FULL PIPE SIZE CLEANOUTS SHALL BE PROVIDED & INSTALLED ON BUILDING SANITARY LINES AT LOCATIONS SHOWN ON PLANS, AT INTERVALS OF NO MORE THAN 100', AT EVERY CHANGE IN DIRECTION GREATER THAN 45°, AND AT THE BASE OF EACH WASTE STACK.
- 3.5.

WASTE AND VENT PIPING IN PLENUMS SHALL BE CAST IRON, PLENUM-RATED CPVC, OR PVC WITH AN INSULATION WRAP LISTED FOR USE AS SUCH AN ASSEMBLY.
- 3.6.

ALL VENT PIPE TERMINATIONS SHALL BE LOCATED EITHER 10' HORIZONTALLY OR 3' ABOVE MECHANICAL AIR INTAKE LOCATIONS. TERMINATIONS SHALL NOT BE INSTALLED UNDER ANY OPERABLE BUILDING OPENING OR OPERABLE ADJACENT BUILDING OPENING. CONTRACTOR TO OFFSET VENT PIPING AS NECESSARY TO MEET THESE REQUIREMENTS.
4.

DOMESTIC WATER
- 4.1.

ALL DOMESTIC WATER PIPING TO BE EITHER COPPER OR PEX, SHALL CONFORM TO NSF 61 AND BE LISTED FOR USE IN POTABLE WATER SYSTEMS.
- 4.1.1.

WHERE PEX PIPING IS USED, IT SHALL BE INCREASED ONE PIPE SIZE FROM WHAT IS INDICATED ON PLANS FOR ALL PORTIONS OF DISTRIBUTION SYSTEM.
- 4.1.2.

PEX-A MAY BE INSTALLED AT SIZES INDICATED ON PLANS ONLY IF AN ENGINEERED PLAN IS SUBMITTED SHOWING ACCEPTABLE PRESSURE DROPS AND FLUID VELOCITIES, APPROVAL MUST BE GRANTED PRIOR TO PURCHASE AND INSTALLATION.
- 4.1.3.

COPPER WATER PIPING BELOW GRADE SHALL BE TYPE "K". BELOW GRADE JOINTS SHALL BE SILVER SOLDERED. THERE SHALL BE NO JOINTS IN WATER PIPING LOCATED BENEATH BUILDING SLAB.
- 4.1.4.

COPPER WATER PIPING ABOVE GRADE SHALL BE TYPE "L".
- 4.2.

PROVIDE WATER HAMMER ARRESTORS AT ALL QUICK-CLOSE VALVES. FIXTURES REQUIRING WATER HAMMER ARRESTORS INCLUDE BUT ARE NOT LIMITED TO FLUSH VALVES, SENSOR FAUCETS, AND WASHING MACHINE BOXES. AIR CHAMBERS SHALL NOT BE PERMITTED.
- 4.3.

ALL DOMESTIC WATER PIPING SHALL BE ROUTED WITHIN BUILDING THERMAL ENVELOPE AND WITHIN WALL CAVITIES, ABOVE FINISHED CEILINGS, OR BELOW SLAB TO REMAIN CONCEALED UNLESS OTHERWISE NOTED. NOTIFY ENGINEER OF ANY NECESSARY ADJUSTMENTS THAT REQUIRE PIPING TO BE EXPOSED.
- 4.4.

DOMESTIC WATER PIPING INSULATION
- 4.4.1.

ALL HW PIPING, WHETHER COPPER OR PEX, SHALL BE INSULATED WITH PLENUM RATED CLOSED CELL ELASTOMERIC INSULATION.
- 4.4.1.1.

FOR PIPING LESS THAN 1½", INSULATION THICKNESS TO BE 1".
- 4.4.1.2.

FOR PIPING 1½" OR GREATER, INSULATION THICKNESS SHALL BE 1½".
- 4.4.2.

CW COPPER PIPING TO INSULATED WITH ½" PLENUM RATED CLOSED CELL ELASTOMERIC INSULATION. CW PEX NEED NOT BE INSULATED UNLESS NOTED OTHERWISE ON PLANS.
5.

GAS PIPING
- 5.1.

GAS PIPING SHALL BE INSTALLED LEVEL, PLUMB, AND PARALLEL OR PERPENDICULAR TO BUILDING ORIENTATION WHERE POSSIBLE.
- 5.2.

QUARTER-TURN FULL-PORT SHUTOFF VALVES SHALL BE INCLUDED AT EACH APPLIANCE CONNECTION, AS WELL AS AN IN-LINE REGULATOR FROM DELIVERY PRESSURE TO APPLIANCE OPERATING PRESSURE IF REQUIRED. INCLUDE SEDIMENT TRAPS PER IFGC REQUIREMENTS.
- 5.1.

NATURAL GAS AND LIQUID PROPANE (LP) PIPING TO SHALL BE SCHEDULE 40 BLACK STEEL.
- 5.2.

PIPE JOINTS SHALL BE THREADED WITH CLASS 150 FITTINGS, OR WELDED. NOTIFY OWNER/GC OF ANY NECESSARY HOT-WORK ASSOCIATED WITH WELDED CONNECTIONS.
- 5.3.

WHERE PIPING IS EXPOSED ON EXTERIOR FACE OF BUILDING, PAINT TO MATCH BUILDING. PAINT YELLOW IN ALL OTHER LOCATIONS.
- 5.4.

ON ROOFTOPS, INSTALL GAS PIPE WITH "ROOFTOP BLOX" PER MANUFACTURER'S INSTRUCTION.
6.

STORM DRAIN PIPING
- 6.1.

ABOVE AND BELOW GRADE STORM PIPING SHALL BE SOLID CORE SCHEDULE 40 PVC.
- 6.2.

ALL PRIMARY & SECONDARY STORM DRAIN PIPING & FITTINGS SHALL BE INSULATED WITH ½" FIBERGLASS INSULATION WITH ASJ JACKET.
- 6.3.

STORM DRAIN PIPING IN PLENUMS SHALL BE CAST IRON, PLENUM-RATED CPVC, OR PVC WITH AN INSULATION WRAP LISTED FOR USE AS SUCH AN ASSEMBLY.

PLUMBING FIXTURE SCHEDULE				
TAG	DESCRIPTION	MANUFACTURER (OR EQUAL)	MODEL (OR EQUAL)	NOTES
BFP1	BACKFLOW PREVENTER	WILKINS	975XL2	1-1/2" RPZ
DF1	DRINKING FOUNTAIN & BOTTLE FILLER	ELKAY	LZS8WSLP	
EXP1	EXPANSION TANK	WATTS	PLT-12	
FCO1	FLOOR CLEANOUT	ZURN	1400	
FD1	FLOOR DRAIN	ZURN	Z415-BZ	WITH Z1072 TRAP SEAL
FPHB1	FROST PROOF HOSE BIB	WOODFORD	MODEL 67	
FS1	FLOOR SINK	ZURN	FD2370	WITH DOME STRAINER AND HALF-GRATE
HB1	HOSE BIB	JR SMITH	5670-H	INTERIOR HOSE BIB WITH VACUUM BREAKER
HS1	HAND SINK - WALL MOUNT	REGENCY	600HS12EFW	WITH HANDS-FREE GOOSENECK FAUCET
LAV1	LAVATORY (WALL HUNG W/MANUAL FAUCET)	AMERICAN STANDARD	0355.012	WITH ZURN Z81104-XL FAUCET, 1/4 TURN STOPS, BRAIDED STAINLESS STEEL SUPPLIES, TRIUBRO LAV GUARD 2, & 'TMV1'
MS1	MOP SINK	FIAT	MSB2424	WITH ZURN Z843M1 FAUCET WITH WALL HOOK
REF1	REFRIGERATOR BOX	SIOUX CHIEF	696-G1000	
RH1	ROOF HYDRANT	WOODFORD	SRH-MS	
RP1	RECIRCULATION PUMP	GRUNDFOS	UP10-16 AUTO	
SK1	ADA SINGLE COMPARTMENT SINK (19x18x5.5)	ELKAY	LRAD191855	WITH TWO HANDLED ZURN Z871C4-XL FAUCET
TMV1	THERMOSTATIC MIXING VALVE - POINT OF USE	WATTS	LFUSG	
TUB1	ELEVATED WALK-IN PET TUB	PETLIFT	BT-MB58	VERIFY WITH OWNER; WITH MOEN POSI-TEMP MIXING VALVE AND HANDHELD SHOWER ASSEMBLY
TUB2	WALK-IN PET TUB (AT FINISHED FLOOR)	K9 SPA	CLASSIC SPA	VERIFY WITH OWNER; WITH MOEN POSI-TEMP MIXING VALVE AND HANDHELD SHOWER ASSEMBLY
WB1	WASHER BOX	OATEY	38529	WASHER BOX W/ 1/4 TURN VALVES
WC1	WATER CLOSET - ADA HEIGHT - TANK	AMERICAN STANDARD	Z15AA.004	WITH CHURCH 9500SSCT SELF SUSTAINING SEAT, STAINLESS BRAIDED SUPPLY, AND 1/4 TURN SHUT-OFF.
WH1	WATER HEATER - GAS	A.O. SMITH	BTH-199	100 GALLON, 199KBTU NATURAL GAS, WITH 'EXP1'
YCO1	YARD CLEAN OUT	ZURN	Z1400	
YH1	YARD HYDRANT	WOODFORD	Y34	
NOTES: 1. VERIFY NECESSARY FIXTURES MEET ADA REQUIREMENTS WITH ARCHITECT PRIOR TO INSTALLATION. 2. VERIFY FIXTURE SELECTIONS AND FINISHES WITH OWNER / ARCHITECT PRIOR TO PURCHASE.				

PLUMBING CONNECTION SIZING SCHEDULE					
FIXTURE		SANITARY PIPING		SUPPLY PIPING	
TYPE	TYPICAL ABBREVIATION	WASTE CONNECTION	VENT CONNECTION	COLD WATER CONNECTION	HOT WATER CONNECTION
DRINKING FOUNTAIN	DF	1-1/2"	1-1/4"	1/2"	-
FLOOR DRAIN	FD	3"	2"	-	-
HAND / HAIR SINK	HS / SK	2"	1-1/4"	1/2"	1/2"
HOSE BIBB	HB	-	-	3/4"	-
LAVATORY	LAV	1-1/2"	1-1/4"	1/2"	1/2"
MOP SINK	MS	3"	1-1/2"	1/2"	1/2"
ICE MAKER OUTLET BOX	REF	-	-	1/2"	-
SHOWER	SH	3"	1-1/2"	1/2"	1/2"
URINAL	UR	2"	1-1/4"	3/4"	-
WATER CLOSET (FLUSH TANK)	WC	3"	2"	1/2"	-
WATER CLOSET (FLUSH VALVE)	WC	3"	2"	1"	-
NOTES: 1. SIZES SHOWN ABOVE ARE TYPICAL UNLESS NOTED OTHERWISE ON PLANS					

