


3/4" (20 mm) NPT


WHERE INSTALLED IN STORAGE UNITS

 **SERIES VK532, K=5.6, 1/2" NPT, QR UPRIGHT, SIN VK532**
MAXIMUM SPACING = 16" X 16"
MINIMUM SPACING BETWEEN SPRINKLERS = 8'-0"
MAXIMUM DISTANCE OFF WALL = 8'-0"
SPRINKLER DEMAND = 51 gpm @ 20.7 psi

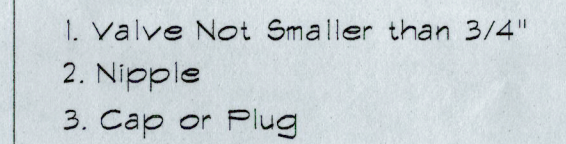


Lee's Summit Fire Department
Lee's Summit, Missouri

10/31/2024

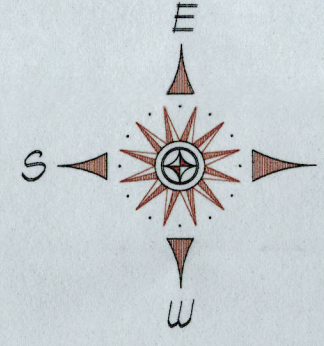

TOTAL LEVEL ONE FLOOR AREA = 34,375 sq. ft.

ALL PIPING TO BE INSTALLED
@ 10'-6" AFF THIS LEVEL - U.N.C.

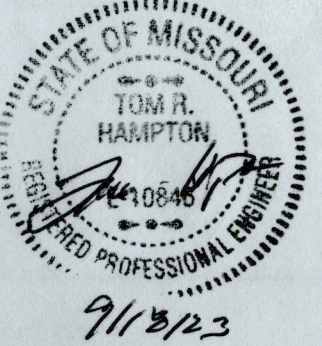

9/18/23

SUBMITTAL DRAWING

TOTAL QUANTITY OF SPRINKLERS ON SHEET: 39

SHEET DESCRIPTION:
HOUSEHOLD STORAGE

CONTRACT WITH: STRICKLAND CONSTRUCTION	DRAWING NO. FP - 3 of 5
---	----------------------------