


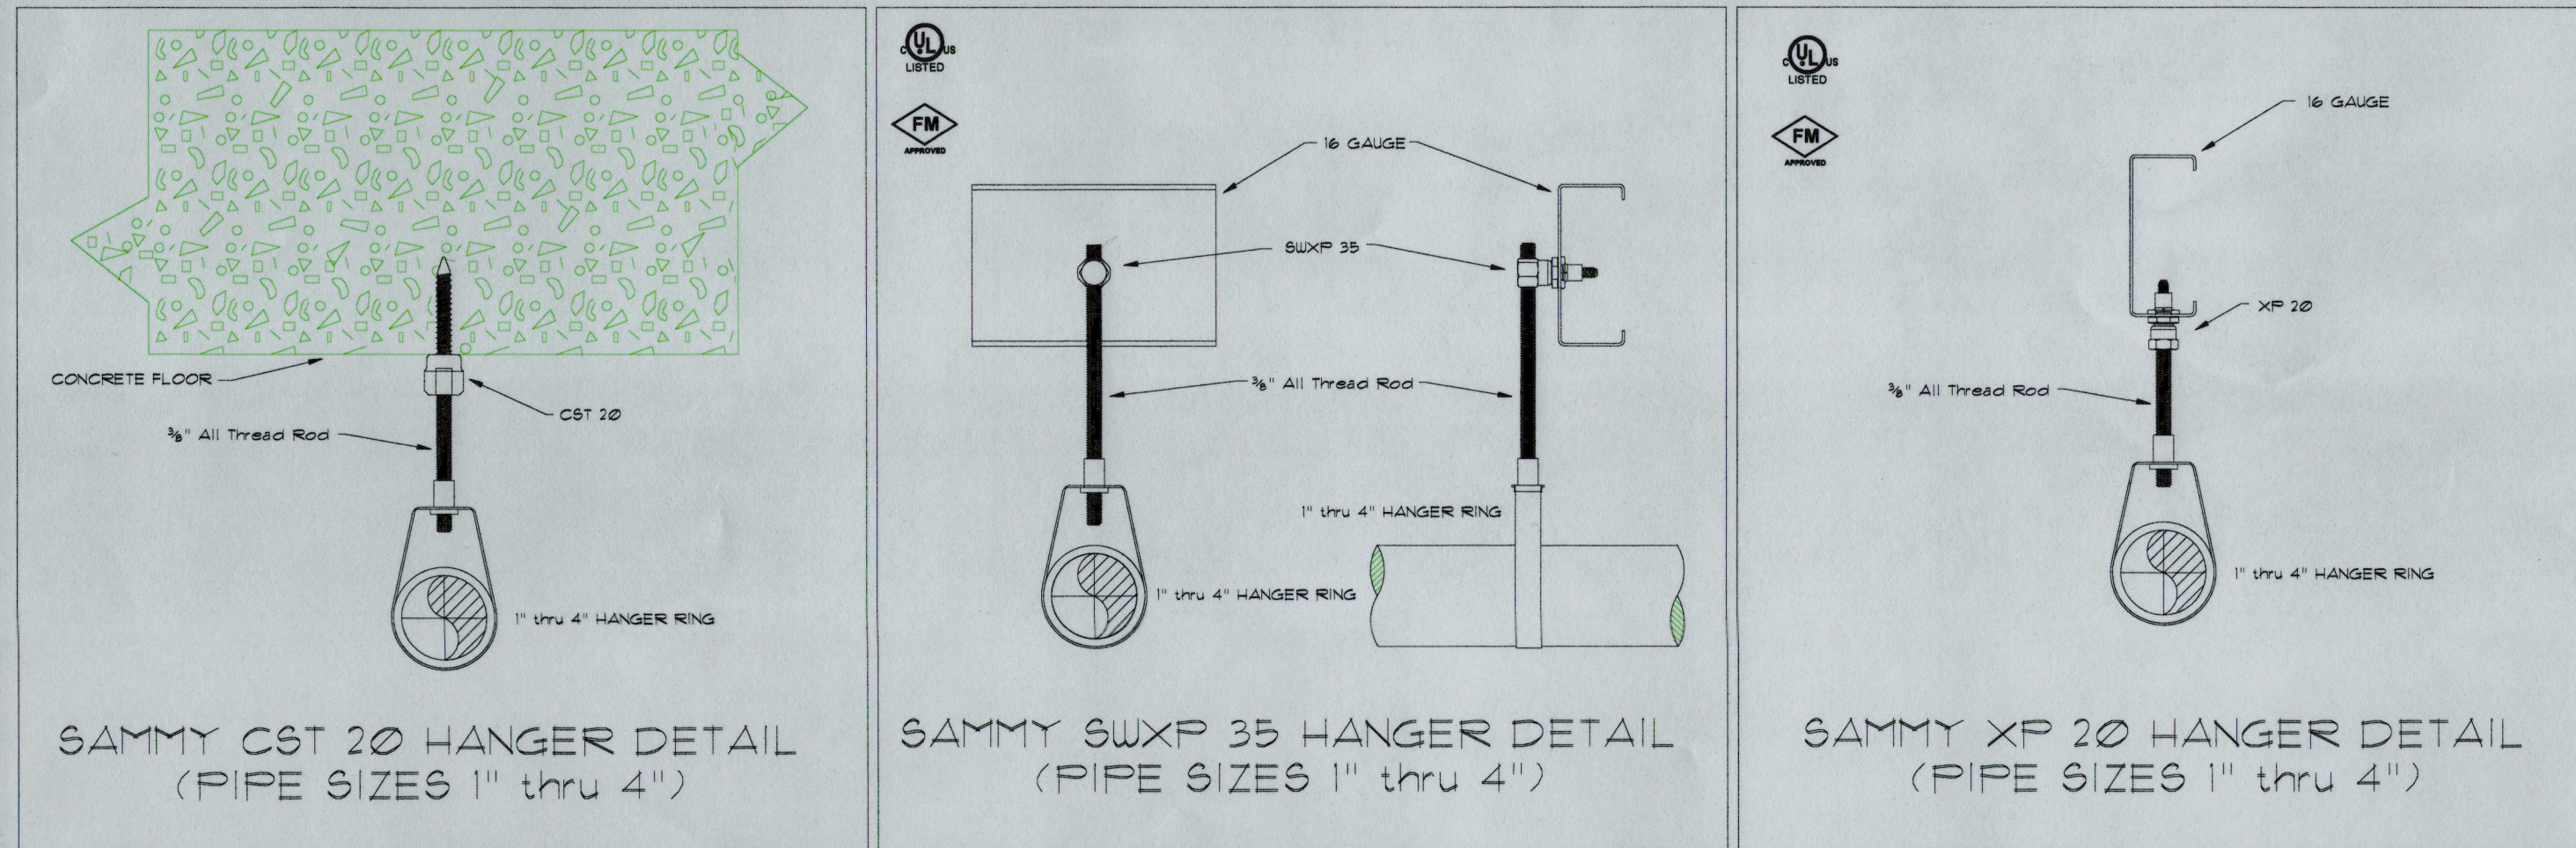

HANGER SPACING CHART

MAXIMUM DISTANCE BETWEEN HANGERS (FT-IN) PER NFPA-13

PIPE SIZE	1/2"	3/4"	1"	1 1/4"	1 1/2"	2"	2 1/2"	3"	4"	6"
STEEL PIPE	N/A	12-0	12-0	12-0	12-0	12-0	12-0	12-0	12-0	12-0
THREADED LIGHTWALL	N/A	12-0	12-0	12-0	12-0	12-0	12-0	12-0	N/A	N/A
COPPER	8-0	8-0	10-0	10-0	12-0	12-0	12-0	12-0	12-0	12-0
CPVC	8-0	8-0	8-0	10-0	12-0	12-0	12-0	12-0	12-0	12-0

DISTANCE FROM SPRINKLER TO HANGER PER NFPA-13


36" FOR 1" & 1 1/4" LARGER
48" FOR 1 1/2" & 2" LARGER
60" FOR 2 1/2" & 3" LARGER
72" FOR 3" & 4" LARGER
96" FOR 4" & 6" LARGER

MAX
THEN EXTEND HERE

HANGER ROD SIZE PER NFPA-13


PIPE SIZE	DIAM. OF ROD	PIPE SIZE	DIAM. OF ROD
UP TO AND INCLUDING 4"	3/8"	6" AND 8"	1/2"

NOTE: IF PRESSURE EXCEEDS 150 PSI, PROVIDE HANGER FOR ANTI-DIVERSITY TO PREVENT HEAD EXCEEDING 1.5"

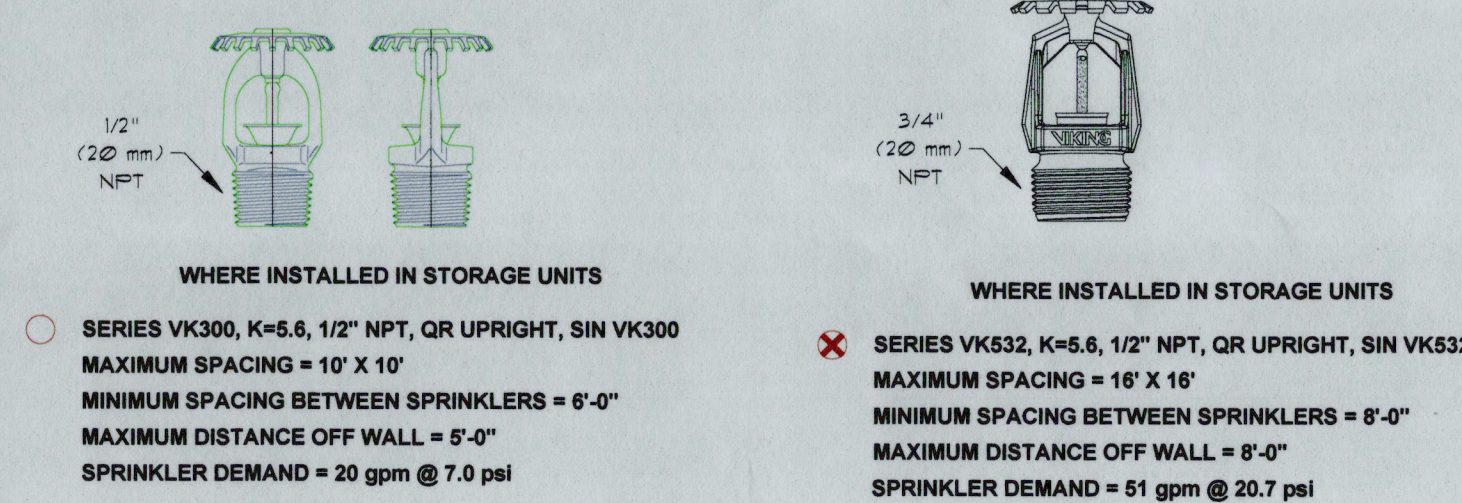

RELEASED FOR CONSTRUCTION
As Noted on Plan Review

Lee's Summit Fire Department
Lee's Summit, Missouri
10/31/2024

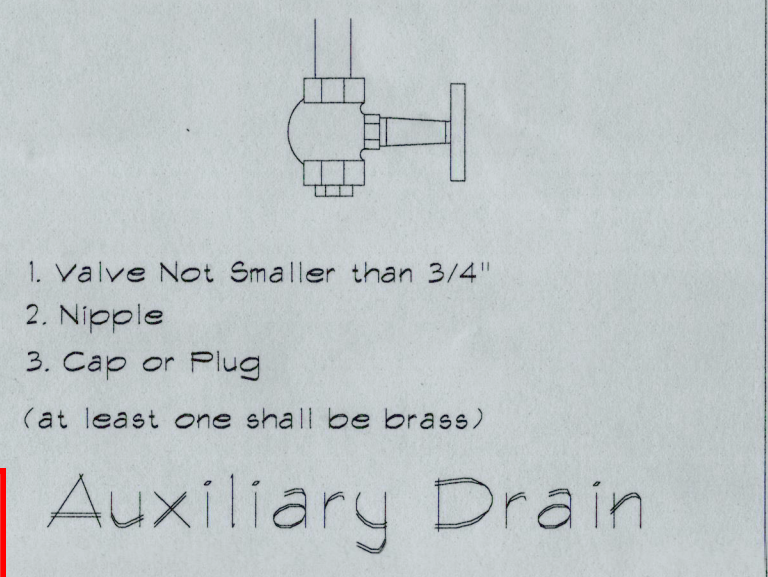

ALL PIPING TO BE INSTALLED @ 10'-0" AFF THIS LEVEL - UNO.

ALL PIPING TO BE INSTALLED @ 10'-0" AFF THIS LEVEL - UNO.

