



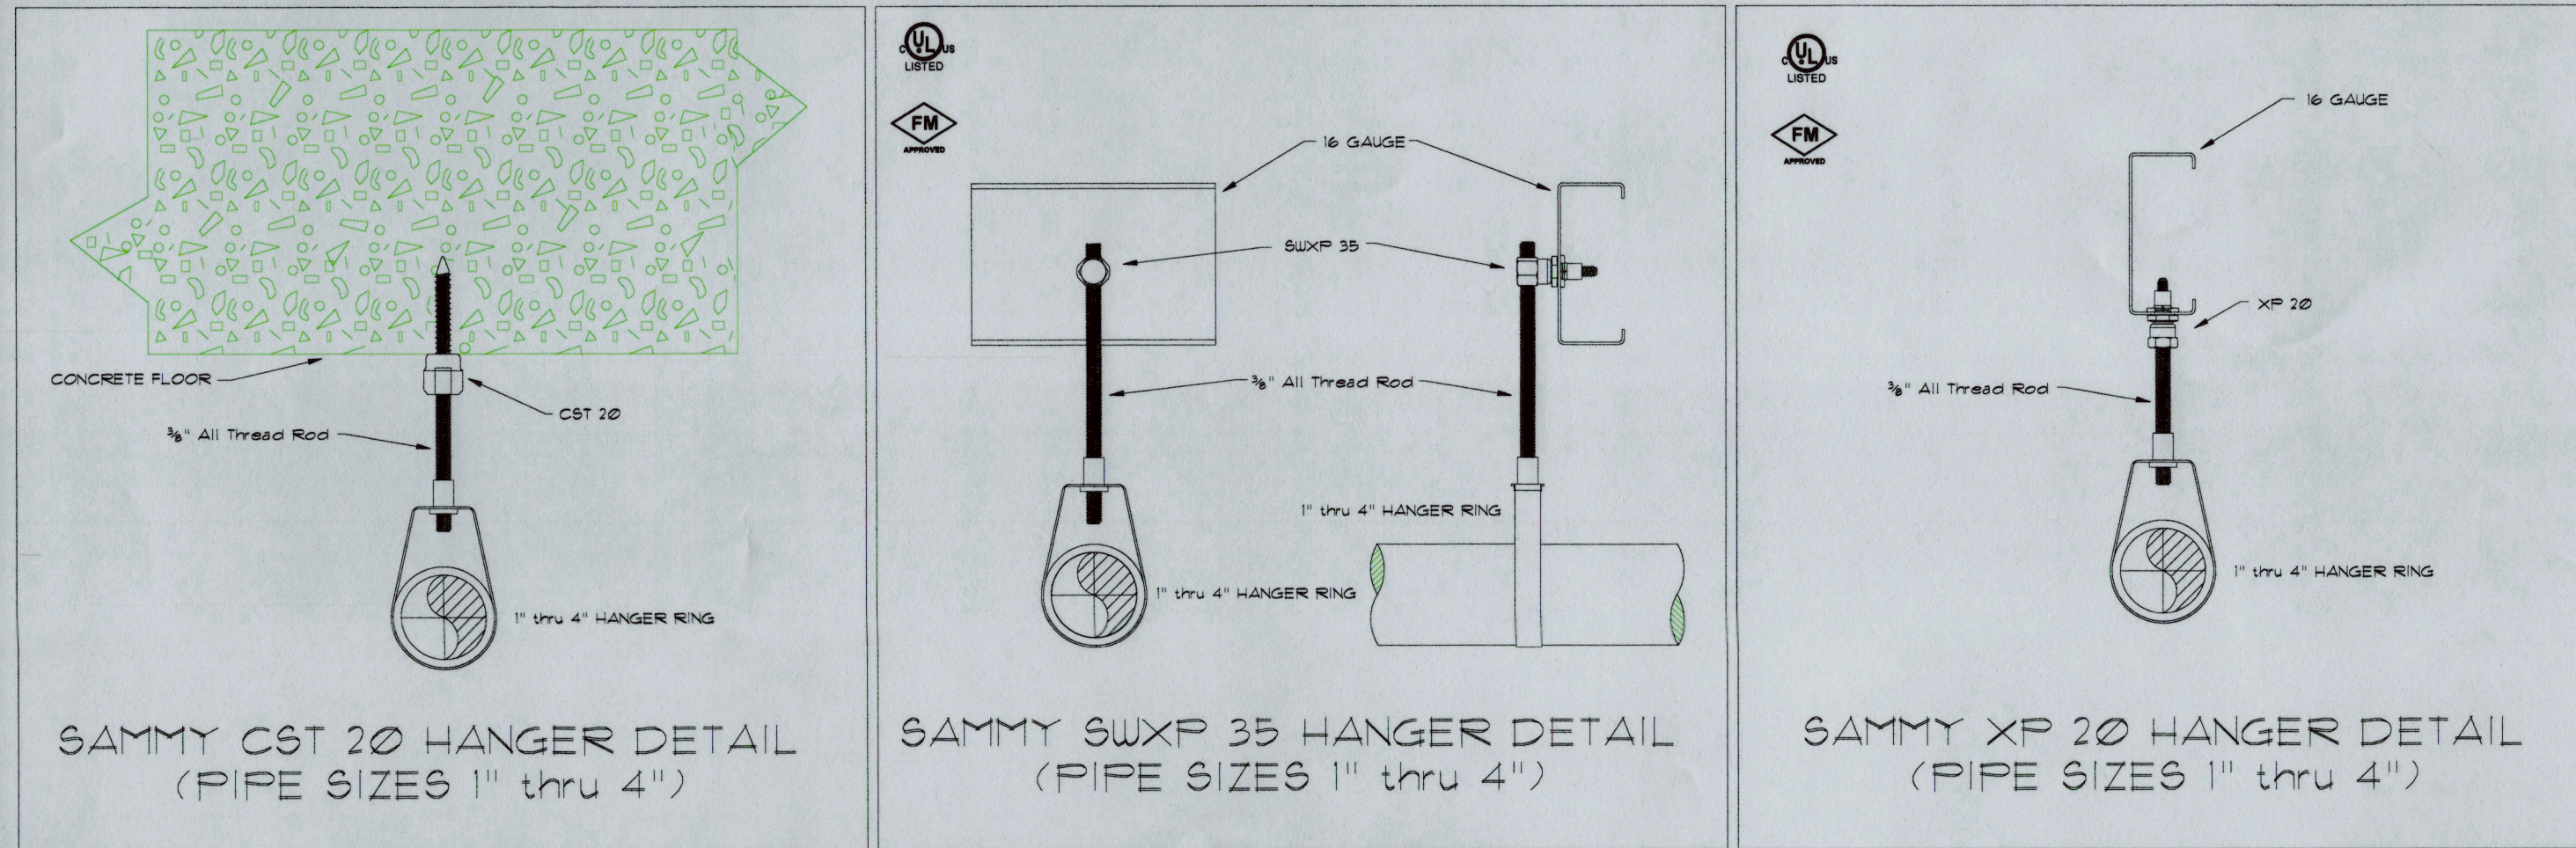

HANGER SPACING CHART									
MAXIMUM DISTANCE BETWEEN HANGERS (FT.-IN.) PER NFPA-13									
PIPE SIZE	1/2"	3/4"	1"	1 1/2"	2"	2 1/2"	3"	4"	6"
STEEL PIPE	N/A	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"
THREADED LIGHTWALL	N/A	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	N/A	N/A
COPPER	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"
CPVC	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	1'-0"	N/A	N/A
DISTANCE FROM SPRINKLER TO HANGER PER NFPA-13									
HANGER ROD SIZE PER NFPA-13									
PIPE SIZE	DIAM. OF ROD		PIPE SIZE	DIAM. OF ROD		PIPE SIZE	DIAM. OF ROD		PIPE SIZE
UP TO AND INCLUDING 4"	3/8"		6" AND 8"	1/2"		10"	3/4"		12"
NOTE: IF PRESSURE EXCEEDS 150 PSI, PROVIDE HANGER FOR 240 PSI (20 PSI PERCENT HEAD) EXCEEDING 100'									

ALL PIPING TO BE INSTALLED @ 1'-0" BTG THIS LEVEL - UNO.

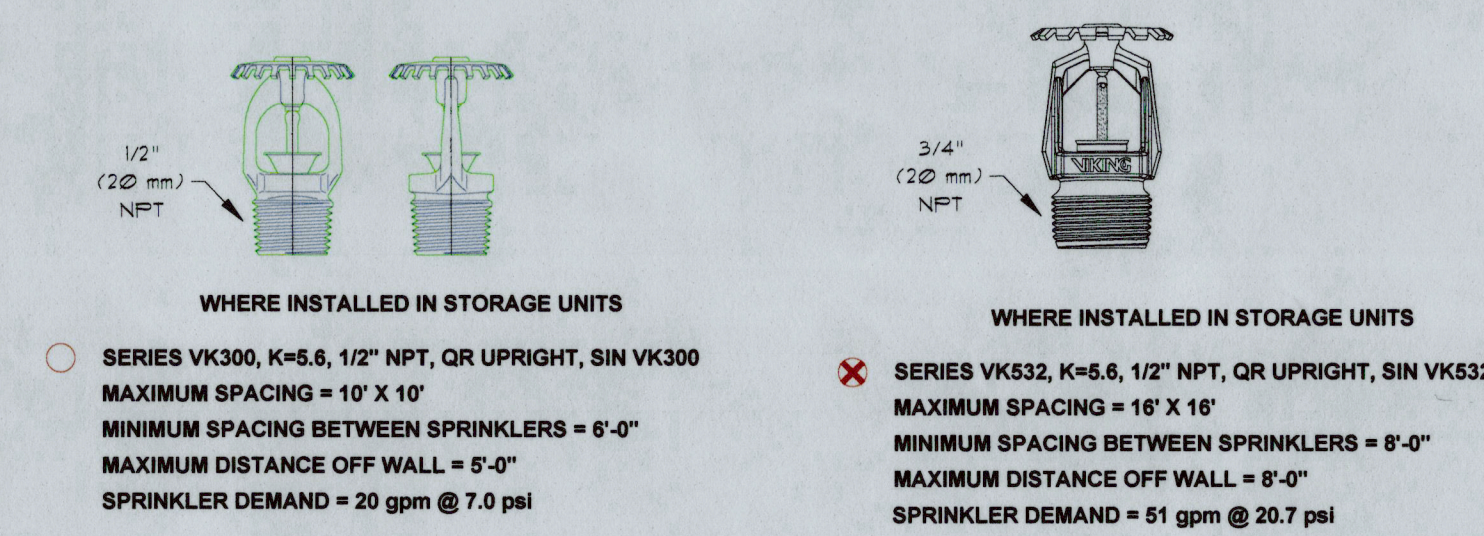

RELEASED FOR CONSTRUCTION
As Noted on Plan Review

Lee's Summit Fire Department
Lee's Summit, Missouri
10/31/2024

1. Valve Not Smaller than 3/4"
2. Nipple
3. Cap or Plug
(at least one shall be brass)
Auxiliary Drain

