

### STRUCTURAL NOTES:

ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATION RESIDENTIAL CODE OR ATTACHED ENGINEER SPECIFICATIONS WHERE APPLICABLE.

### **ELEVATIONS**:

- GARAGE DOORS SHALL MEET DASMA OR ULTIMATE DESIGN WIND SPEED OF 115
- WALL FRAMING SHALL BE DOUGLAS FIR LARCH #2 UNLESS OTHERWISE NOTED. IN BEARING WALLS, STUDS WHICH ARE NOT MORE THAN TEN FEET IN LENGTH SHALL BE SAPCED NOT MORE THAN IS SPECIFIED BY IRC TABLE R602.3(5) FOR
- WATER-RESISTIVE EXTERIOR WALL BARRIER IN WALL SECTION SHALL COMPLY

RELEASE FOR CONSTRUCTION

**AS NOTED ON PLANS REVIEW** 

**DEVELOPMENT SERVICES** 

LEE'S SUMMIT, MISSOURI

11/01/2024 4:04:46

- WHEN APPLICABLE, CONTINUOUS STUDS BETWEEN FLOOR AND ROOF/CEILING DIAPHRAGM SHALL COMPLY WITH IRC R602.3. ALL UNMARKED HEADERS SHALL BE A MINIMUM #2 DOUGLAS FIR LARCH (2) 2 X 10
- SHIPLAP SIDING MUST BE FASTENED AT BOTH UNDERLAP AND OVERLAP.

CORRESPONDING STUD SIZE.

<u>2021 IECC NOTES:</u>
METHOD USED FOR COMPLIANCE: TOTAL BUILDING PERFORMANCE (R405) THERMAL ENVELOPE CERTIFICATION PROVIDED IN PROJECT CALCULATION PACKAGE AND ATTACHED TO THESE PLANS.

> 4.11 4/12 2ND FLOOR/MAIN LEVEL PLATE ENTRY LEVEL PLATE MAIN LEVEL DECK LOWER LEVEL PLATE 4040 EGRESS SLIDER 1.71 @ 7' H.

SCALE: 3/16" = 1'-0"

# S000 STRUCTURAL GENERAL NOTES

S501 FOUNDATION DETAILS S503 GARAGE/SLAB DETAILS S510 FRAMING STANDARDS

S520 DECK DETAILS S530 BRACING DETAILS S550 FASTENING SCHEDULE S560 EGRESS WINDOW

CEDAR BRACKET

SCALE: 1/4" = 1'-0"

### **GENERAL NOTES**

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER VENDOR.

WINDOW SIZES ARE WRITTEN II X 6'-6" FIXED.

- A1. FRONT AND REAR ELEVATION
- A6. ROOF PLAN

SQUA	SQUARE FOOTAGE TABLE							
FINISHE	D SQUARE FO	OTAGE						
	PER UNIT	TOTAL						
MAIN LEVEL	692		1384					
UPPER LEVEL	646		1292					
LOWER LEVEL	463		926					
TOTAL	1801		3602					
UNFINISHED SQUARE FOOTAGE								
	PER UNIT	TOTAL						

ER UNIT	TOTAL	ISS
434	868	
63	126	09
120	240	

**REVISIONS** DESCRIPTION

SHEET NUMBER:

**SHEET INDEX** 

A3. FOUNDATION FLOOR PLAN

A5. UPPER LEVEL PLAN

**EVERSTEAD** 

SQUAF	RE FOOTAGE T	ABLE
FINISHE	D SQUARE FO	OTAGE
	PER UNIT	TOTAL
MAIN LEVEL	692	138
UPPER LEVEL	646	129
LOWER LEVEL	463	92
TOTAL	1801	360
UNFINISH	ED SQUARE I	OOTAGE
	PER UNIT	TOTAL
GARAGE	434	86
LOWER LEVEL	63	12
DECK	120	24

REAR ELEVATION

\_\_\_\_\_ \_\_\_\_\_\_ \_-----4040 EGRESS SLIDER GAS RISER

**CPG DBA** 1.12 TOP OF FOOTING DEPTH DETERMINED PER SITE. .41 4X4 CEDAR POST .71 CONCRETE WINDOW WELL FOR EGRESS WITH LADDER. PROVED SLEEVE THROUGH

FRONT & REAR ELEVATION NOTES

FOUNDATION.

.61 5/4"X8" TRIM.

ABOVE GRADE.

3.15 BOARD AND BATTEN

1X4 TRIM AT TOP.

3.18 CAST STONE CAP

BY CODE.

5.13 FURNACE VENT.

3.17 MANUFACTURED STONE VENEER

3.57 26"X6" CEDAR BRACKET, RE: 3/A1

1/2" OSB SHEATHING OR AS REQUIRED

BUILD CRICKET VALLEY AWAY FROM

INTERSECTION FOR POSITIVE DRAINAGE.

LAYER OF STRUCTURAL SHEATHING.

13 PANEL SIDING WITH 3/4X4 TRIM AROUNI

DOORS, WINDOWS, AND CORNERS UNLESS NOTED OTHERWISE. BOTTOM OF SIDING SHALL BE A MINIMUM OF 6"

WALL FOR FOUNDATION DRAIN. TOP OF WINDOW WELL TO BE 3" BELOW TOP O 15 ENTIRE REAR WALL TO BE DOUBLE WAI CONSTRUCTION. §" ZIP PANELS AS 1ST

.11 LAP SIDING WITH 5/4X6 TRIM AROUND 120 SE 30TH ST. DOORS, WINDOWS, AND CORNERS UNLESS NOTED OTHERWISE. LEE'S SUMMIT, MO 64082

COPYRIGHT 2017 HOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE 3.42 6X6 CEDAR POST. 1X6 TRIM AT BASE. SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF PACES ARE PROTECTED BY COPYRIGHT REGISTERE CPG. INC. ANY REPRODUCTION. USE. O SCLOSURE OF THE INFORMATION CONTAINED HEREIN MINIMUM ROOFING COMPOSITION- 30 YE COMPOSITE SHINGLES ON 15# FELT ON

D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR

BIDDING AND CONSTRUCTION OF THIS PROJECT IS

A CLAYTON COMPANY

816-246-6700

ADDRESS: A: 3712 SW KNOXVILLE CT. B: 3710 SW KNOXVILLE CT

PROFESSIONAL SEAL:

HANNAH CHRISTINE

NUMBER PE-2023046346 10/29/2024 ONAL

EVERSTEAD IS RESPONSIBLE FOR

STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS

WERE PROVIDED BY OTHERS.


FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0"


- A2. LEFT AND RIGHT ELEVATION
- A4. MAIN LEVEL PLAN

3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> VERSION #: V1.0

SUE DATE: 9.26.2024

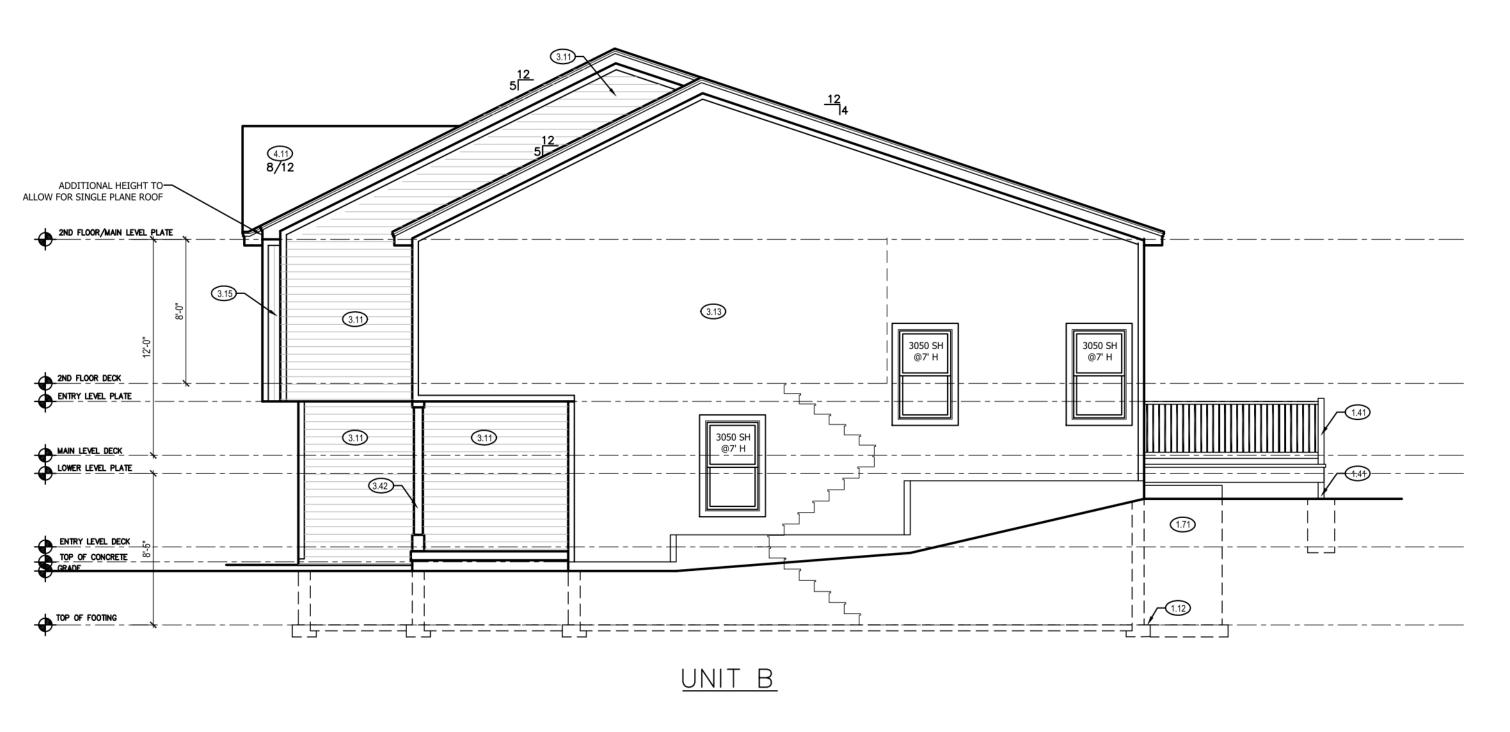

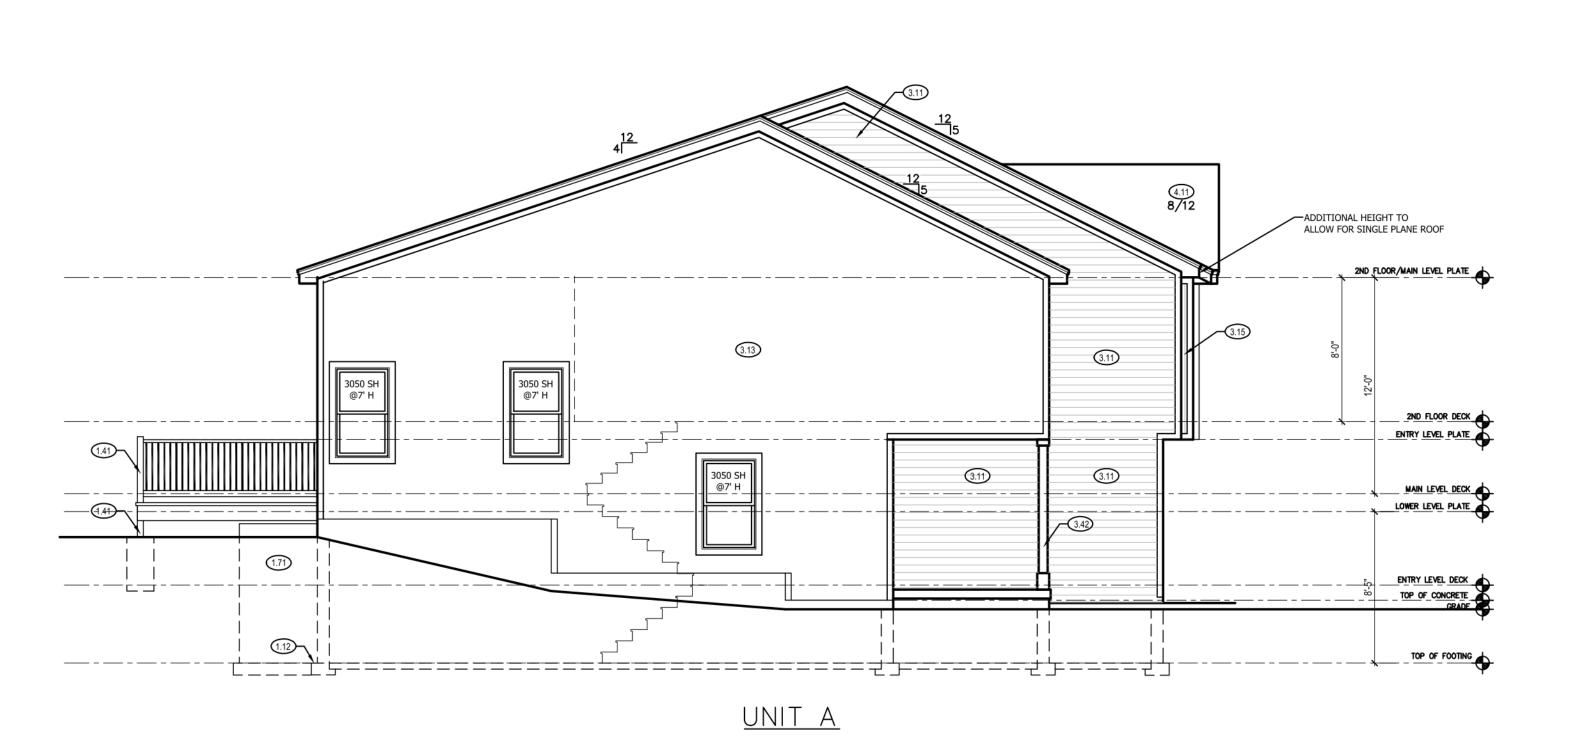

### **LEFT & RIGHT SIDE ELEVATION NOTES**

- 1.12 TOP OF FOOTING DEPTH DETERMINED PER SITE.
- 1.41 6X6 CEDAR POST
- 1.71 CONCRETE WINDOW WELL FOR EGRESS WITH LADDER. PROVED SLEEVE THROUGH WALL FOR FOUNDATION DRAIN. TOP OF WINDOW WELL TO BE 3" BELOW TOP OF FOUNDATION.
- 3.11 LAP SIDING WITH 5/4X6 TRIM AROUND DOORS, WINDOWS, AND CORNERS UNLESS NOTED OTHERWISE.
- 3.13 PANEL SIDING WITH 3/4X4 TRIM AROUND DOORS, WINDOWS, AND CORNERS UNLESS NOTED OTHERWISE. BOTTOM OF SIDING SHALL BE A MINIMUM OF 6" ABOVE GRADE.
- 3.15 BOARD AND BATTEN
- 3.42 6X6 CEDAR POST. 1X6 TRIM AT BASE. 1X4 TRIM AT TOP.
- 4.11 MINIMUM ROOFING COMPOSITION- 30 YR COMPOSITE SHINGLES ON 15# FELT ON 1/2" OSB SHEATHING OR AS REQUIRED BY CODE.
- 4.31 BUILD CRICKET VALLEY AWAY FROM INTERSECTION FOR POSITIVE DRAINAGE. 5.23 34"X60" FIBERGLASS SHOWER. SEE PRICE SUMMARY.

### **STRUCTURAL NOTES:**

1. ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATION RESIDENTIAL CODE OR ATTACHED **ENGINEER** SPECIFICATIONS WHERE APPLICABLE.

### **ELEVATIONS:**

- GARAGE DOORS SHALL MEET DASMA OR **ULTIMATE DESIGN** WIND SPEED OF 115 MPH
- REQUIREMENTS. WALL FRAMING SHALL BE DOUGLAS FIR LARCH #2 UNLESS OTHERWISE NOTED.
- IN BEARING WALLS, STUDS WHICH ARE NOT MORE THAN TEN FEET IN LENGTH SHALL BE SAPCED NOT MORE THAN IS SPECIFIED BY IRC TABLE R602.3(5) FOR CORRESPONDING STUD SIZE. WATER-RESISTIVE EXTERIOR WALL BARRIER IN WALL SECTION SHALL COMPLY WITH IRC
- R703.2. WHEN APPLICABLE, CONTINUOUS STUDS BETWEEN FLOOR AND ROOF/CEILING DIAPHRAGM
- SHALL COMPLY WITH IRC R602.3. ALL UNMARKED **HEADERS SHALL** BE A MINIMUM #2 DOUGLAS FIR LARCH (2) 2 X 10 ON LOAD BEARING
- WALLS. SHIPLAP SIDING MUST BE FASTENED AT BOTH UNDERLAP AND OVERLAP.

CPG DBA



120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

# COPYRIGHT 2017

DRAWING HAS BEEN PREPARED BY SUMMIT HOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED CPG, INC. ANY REPRODUCTION, USE, OR ISCLOSURE OF THE INFORMATION CONTAINED HEREIN VITHOUT THE WRITTEN CONSENT FROM CPG, INC. D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS STRICTLY PROHIBITED.

ADDRESS: A: 3712 SW KNOXVILLE CT. B: 3710 SW KNOXVILLE CT.

# WIN EMERAL OSAGE #78

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > VERSION #: V1.0

ISSUE DATE: 09.26.2024

SHEET NUMBER:

### **GENERAL NOTES**

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER VENDOR.

WINDOW SIZES ARE WRITTEN IN FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0" X 6'-6" FIXED.

DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 11/01/2024 4:04:46

### **STRUCTURAL NOTES:**

ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATION RESIDENTIAL CODE OR ATTACHED ENGINEER SPECIFICATIONS WHERE APLLICABLE.

### FOUNDATION NOTES:

- ALL FOOTINGS MEET OR EXCEED MINIMUM FROST DEPTH OF 36".
- SOIL BEARING CAPACITY SHALL BE 1500 PSF.
- COMPRESSSIVE STRENGTH OF CONCRETE FC COMPRESSIVE STRENGTH SHALL BE DAMPPROOFED. DAMPPROOFING SHALL EXTEND FROM THE EDGE OF THE FOOTING TO THE FINISHED GRADE (R-406.1). METHOD OF DAMPPROOFING OR WATERPROOFING SHALL BE A MINIMUM 6-MIL. THICK MOISTURED BARRIER OVER POROUS GRAVEL BASE UNDER BASEMENT FLOOR SLAB PER R405.2.2. LAP JOINTS SHALL BE MINIMUM 6".
- FOUNDATION WALLS SHALL BE DAMPPROOFED PER IRC SECTION R406.
- FOUNDATION DRAINAGE WILL BVE IN ACCORDANCE WITH IRC SECTION R405.
- BASEMENT EGRESS OPENINGS SHALL BE IN ACCORDANCE WITH IRC SECTION R310.1. ALL INTERIOR FOOTINGS OF LOAD BEARINGS WALLS AND COLUMNS SHALL BE ISOLATED FROM THE BASEMENT FLOOR SLAB.
- ALL ANCHOR BOLTS SHALL NOT BE SPACED MORE THAN 3' O.C. AND BE EMBEDDED INTO THE CONCRETE A MINIMUM OF 7". IF BASEMENT SLAB ELEVATION IS ABOVE GRADE CONSULT ENGINEER.

### DEAD MAN SPACING:

- ALL DEAD MAN SHALL BE SPACED NO MORE THAN 16' FROM EGRESS WELL, REAR
- GARAGE WALL, 24" RETURN ON FOUNDATION WALL OR ANOTHER DEAD MAN. DEAD MEN ARE NOT REQUIRED ON EXTERIOR GARAGE WALLS OR FOUNDATION
- WALLS THAT ARE 5' OR LESS.
- WALL TRANSITIONING FROM ELSS THAN 5' TALL TO MORE THAN 5' TALL WITH STEP DOWNS: A DEAD MAN IS REQUIRED WITHIN 8' OF STEP DOWN (tRANSITIONING FROM LESS THAN 5' TALL TO MORE THAN 5' TALL WALL LOCATION) ON WALL 5' TALL OR

### **BLOCKING NOTE:**

- SOLID BLOCKING BETWEEN JOISTS AT 48" O.C.
- EXTEND BLOCKING ONE JOIST BAY PAST EACH SIDE OF ISLAND ABOVE

CONTRACTOR TO CONFIRM FOUNDATION HEIGHTS W/ SITE SPECIFIC PLOT PLAN

### **CRAWL SPACE NOTES:**


- UNDER-FLOOR SPACE SHALL CONFORM TO 2018 IRC SECTION R408
- PER 2018 IRC R408.3 UNDER-FLOOR VENTILATION IS NOT REQUIRED WHERE:
- · EXPOSED EARTH IS COVERED W/ CONTINUOUS CLASS 1 VAPER RETARDER.
- JOINTS SHALL OVERLAP 6" AND SHALL BE SEALED OR TAPED. EDGES OF VAPER RETARDER SHALL EXTEND 6" UP STEM WALL AND PERIMETER WALL INSULATED IN
- ACCORDANCE WITH SECT N1103.3.1 · CONTINUOUSLY OPERATED MECHANICAL EXHAUST VENTILATION AT A RATE EQUAL TO 1 CUBIC FOOT PER
- MINUTE (0.47 L/s) FOR EACH 50 SQUARE FEET OF CRAWL SPACE FLOOR AREA.
- UNDER-FLOOR ACCESS SHALL BE PROVIDED AND SHALL BE A MINIMUM OF 18"x24" OPENING.
- ALL WALLS OVER 10' SHALL BE DOUGLAS FIR-LARCH #2 2x4 STUDS FULL HEIGHT CONTINUOUS UNO.
- ALL WALLS OVER 12' SHALL BE DOUGLAS FIR-LARCH #2 (M-12) LUMBER 2x6 STUDS FULL HEIGHT CONTINUOUS.

							ISOLA	ATED FOO	OTINGS AND COLUMN PADS
FOUNDATION	WALL AND FOOTII	NG TABLE (3000 PSI C FROM INSIDE TENSIO	CONCRETE AND 40 KSI RE DN FACE)	EBAR PLACED 2"	S	ΥM	PIER DIAMETER	DEPTH	MINIMUM REINFORCEMENT GRAD 40 KSI STEEL
WALL TYPE	NOMINAL WALL THICKNESS	VERTICAL SPACING AND SIZE	HORIZONTAL SPACING AND SIZE	FOOTING SPECIFICATION U.N.O. ON PLANS		^ G\	12"	3'-0"	(4) VERTICAL #4
TRENCH FOOTING	16"	#4 BARS @18" O.C.	(2) #4 BARS TOP & BOT. CONT.				12	3-0	(+) VEITHOLE #4
< 6'-0" WALL		#4 BARS @36" O.C.			<u> </u>	<u>+</u>	16"	3'-0"	(4) VERTICAL #4
8'-0" WALL	8"	#4 BARS @16" O.C.		16" x 8" CONC. FTG. W/ (2) #4 BARS CONT.		Ĺ	18"	3'-0"	(4) VERTICAL #4
9'-0" WALL		#4 BARS @12" O.C.	#4 BARS @ 24" O.C.		/1	κ\	24"	3'-0"	(4) VERTICAL #4
10'-0" WALL		#4 BARS @8" O.C.				\ ,			
11'-0" WALL	10"	#4 BARS @9" O.C.		24" x 12" CONC. FTG.		L\	28"	3'-0"	(4) VERTICAL #4
12'-0" WALL	10"	#4 BARS @6" O.C.		W/ (3) #4 BARS CONT.					NOT REQUIRED RE FOR A MAXIMUM COLUMN HEIGHT

	T			
SYM	PIER DIAMETER	DEPTH	MINIMUM REINFORCEMENT GRADI 40 KSI STEEL	
G	12"	3'-0"	(4) VERTICAL #4	
H	16"	3'-0"	(4) VERTICAL #4	
<u></u>	18"	3'-0"	(4) VERTICAL #4	
K	24"	3'-0"	(4) VERTICAL #4	
/L\	28"	3'-0"	(4) VERTICAL #4	

COLUMN AND PAD SIZES ARE FOR A MAXIMUM COLUMN HEIGHT OF 10'. COLUMNS GREATER THAN 10' REQUIRE A SEPARATE ENGINEERED DESIGN. FOOTINGS A-F SPACING OF 6" O.C. WITH 3" CLEAR COVER.

### DIMENSIONS MEASURED FROM CENTERLINE OF PARTY WALL ASSEMBLY.

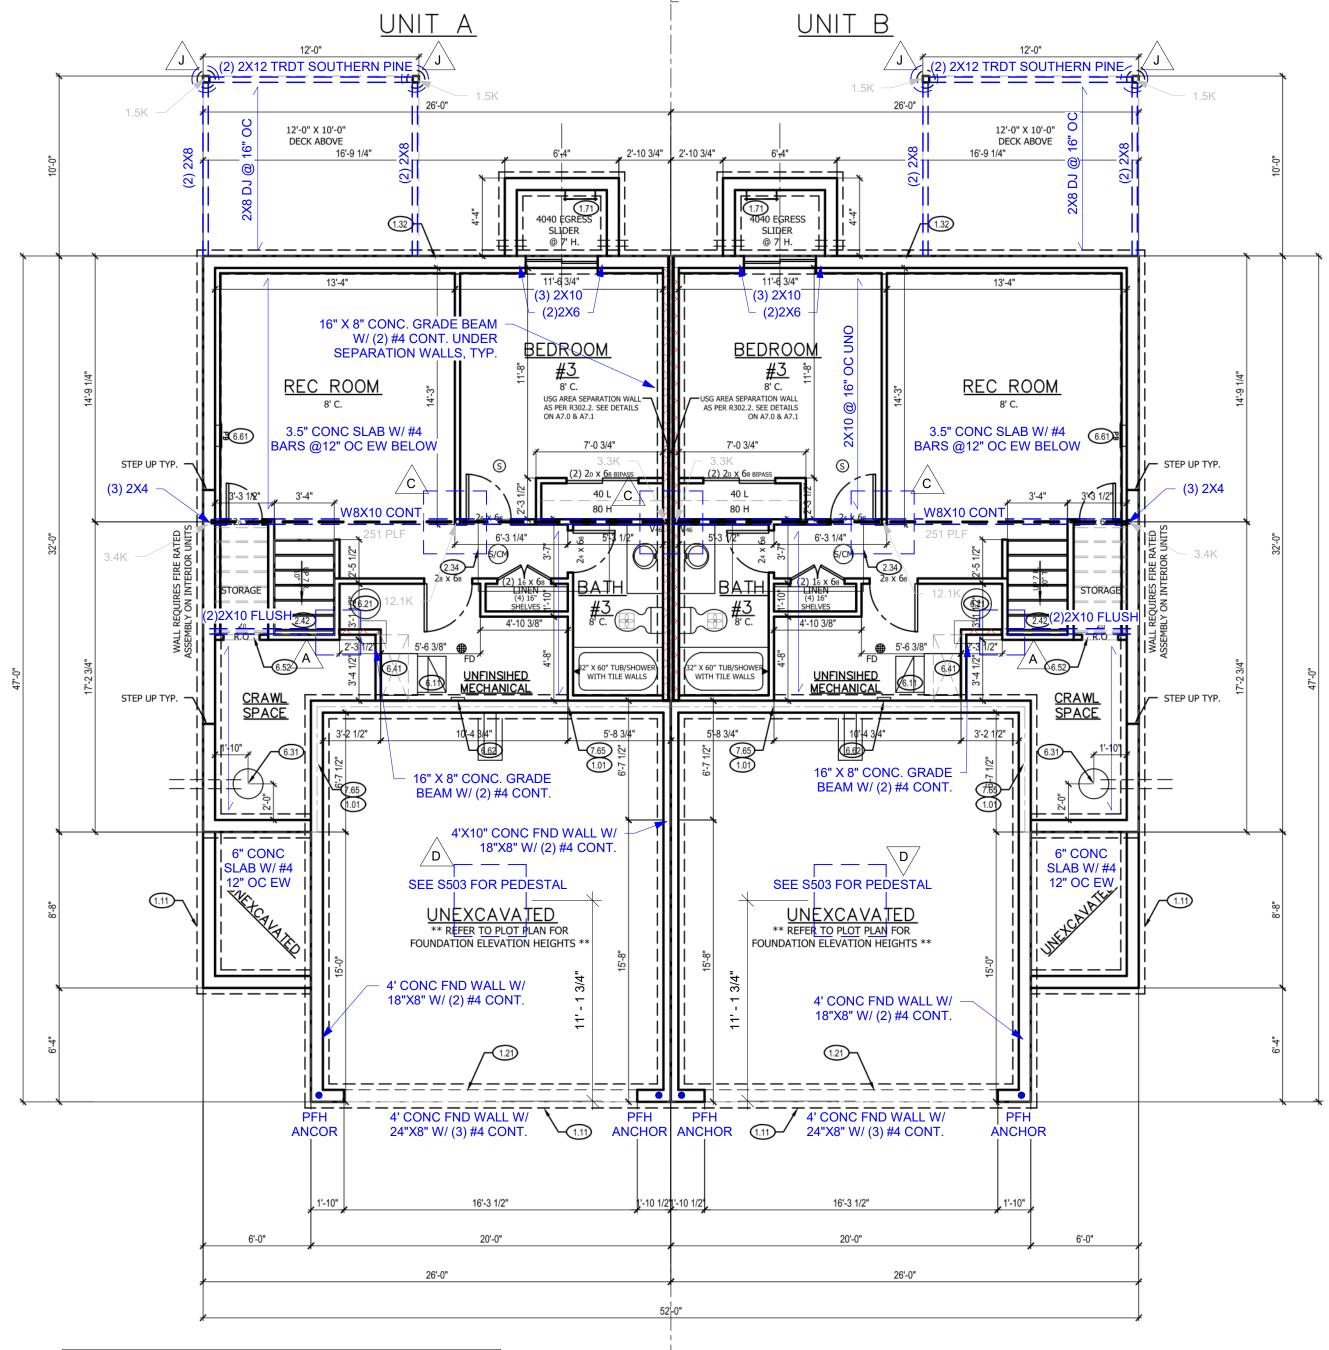

SYM         PIER PAD SIZE         DEPTH         MINIMUM REINFORCEMENT GRADE 40 STEEL COLUMN MIN FY = 35 KSI           A         30"x30"         1'-0"         (5) #4 BAR E.W.         3" DIAMETER           B         36"x36"         1'-0"         (6) #4 BAR E.W.         3" DIAMETER           C         42"x42"         1'-2"         (7) #4 BAR E.W.         3" DIAMETER           D         48"x48"         1'-4"         (8) #4 BAR E.W.         3" DIAMETER           E         54"x54"         1'-4"         (9) #4 BAR E.W.         3.5" DIAMETER           F         60"x60"         1'-6"         (10) #4 BAR E.W.         3.5" DIAMETER					
B 36"x36" 1'-0" (6) #4 BAR E.W. 3" DIAMETER  C 42"x42" 1'-2" (7) #4 BAR E.W. 3" DIAMETER  D 48"x48" 1'-4" (8) #4 BAR E.W. 3" DIAMETER  E 54"x54" 1'-4" (9) #4 BAR E.W. 3.5" DIAMETER	SYM		DEPTH	REINFORCEMENT GRADE	STEEL COLUMN,
C 42"x42" 1'-2" (7) #4 BAR E.W. 3" DIAMETER  48"x48" 1'-4" (8) #4 BAR E.W. 3" DIAMETER  54"x54" 1'-4" (9) #4 BAR E.W. 3.5" DIAMETER	A	30"x30"	1'-0"	(5) #4 BAR E.W.	3" DIAMETER
D 48"x48" 1'-4" (8) #4 BAR E.W. 3" DIAMETER  E 54"x54" 1'-4" (9) #4 BAR E.W. 3.5" DIAMETER	B	36"x36"	1'-0"	(6) #4 BAR E.W.	3" DIAMETER
E 54"x54" 1'-4" (9) #4 BAR E.W. 3.5" DIAMETER	c	42"x42"	1'-2"	(7) #4 BAR E.W.	3" DIAMETER
(0), 11 - 11 - 11 - 11 - 11 - 11 - 11 - 11	D	48"x48"	1'-4"	(8) #4 BAR E.W.	3" DIAMETER
F 60"x60" 1'-6" (10) #4 BAR E.W. 3.5" DIAMETER	E	54"x54"	1'-4"	(9) #4 BAR E.W.	3.5" DIAMETER
	F	60"x60"	1'-6"	(10) #4 BAR E.W.	3.5" DIAMETER

ISOLATED FOOTINGS AND COLUMN PADS

FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0" SCALE: 3/16" = 1'-0" X 6'-6" FIXED.

**GENERAL NOTES** 

VENDOR.

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD

TERMINOLOGY. ACTUAL LUMBER

WINDOW SIZES ARE WRITTEN

### FOUNDATION PLAN NOTES

- 01 HOLD SILL PLATE BACK 4"
- 1 CONTINUOUS CONCRETE FOOTING
- .21 RECESS TOP OF FOUNDATION WALL 1.32 2X6 STUD WALL WITH TREATED SILL
- PLATE CONCRETE WINDOW WELL FOR EGRESS WITH LADDER. PROVED SLEEVE THROUGH WALL FOR FOUNDATION DRAIN. TOP OF WINDOW WELL TO BE 3" BELOW TOP OF
- FOUNDATION. DOUBLE 2X4 STUD WALL 2.34 PROVIDE ADDITIONAL BRACING FOR
- ISLAND ABOVE.
- 2.42 FIRE RATED SHEETROCK UNDER STAIRS
- DIRECT FURNACE. FUEL BURNING APPLIANCES SHALL BE DIRECT VENTED TO EXTERIOR FOR COMBUSTION AIR.
- 5.21 HOT WATER HEATER WITH THERMAL EXPANSION CONTROL DEVICE SUMP PIT AND PUMP. PROVIDE ELECTRICAL GFCI PROTECTION. PROVIDE
- SLEEVE THROUGH FOOTING. 3.41 HVAC CHASE ABOVE
- 6.52 CRAWL SPACE ACCESS 6.61 200 AMP ELECTRICAL PANEL. LOCATION

TO BE DETERMINED ON SITE.

- 5.62 UFER GROUND- VERIFY LOCATION WITH PROJECT MANAGER.
- 7.65 LINE OF FLOOR ABOVE

NSTRUMENT OF SERVICE AND IS INTENDED FOR USE NLY ON THIS PROJECT. ALL DRAWINGS SPECIFICATIONS, AND DESIGNS, INCLUDING THE

**CPG DBA** 

A CLAYTON COMPANY

120 SE 30TH ST.

LEE'S SUMMIT, MO 64082

816-246-6700

COPYRIGHT 2017

IOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN

OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED SCLOSURE OF THE INFORMATION CONTAINED HEREIN /ITHOUT THE WRITTEN CONSENT FROM CPG, INC D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS STRICTLY PROHIBITED.

ADDRESS: A: 3712 SW KNOXVILLE CT. B: 3710 SW KNOXVILLE CT.

> EMERA SAGE #78 MN NN NN

PROFESSIONAL SEAL:



**EVERSTEAD IS RESPONSIBLE FOR** STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > VERSION #: V1.0

ISSUE DATE: 09.26.2024

SHEET NUMBER:

SIZING IS EXPECTED TO VARY PER

### **BRACING METHODS**

BRACING CS-PF PER IRC R602.10.6.4

BRACING CS-WSP PER IRC R602.10

BRACING WSP PER IRC R602.10 (INCLUDES PARTIAL PANELS PER IRC R602.10.5.2)

BRACING LIB PER IRC R602.10

MINIMUM LIB LENGTH PER 2018 IRC TABLE R602.10.5: 55" - 8' TALL WALL HEIGHT 62" - 9' TALL WALL HEIGHT

• 69" - 10' TALL WALL HEIGHT

**WALL BRACING NOTES:** 

DETAIL 9-S400.

WITH IRC R602.10.4.4

INSTALLED ON

WALL BRACING IS DESIGNED IN ACCORDANCE WITH IRC R602.10

FOR METHOD CS-WSP STRUCTURAL PANEL SHEATHING SHALL BE

ALL HORIZONTAL PANEL JOINTS SHALL OCCUR OVER AND BE

APPROPRIATE PANEL EDGE-NAILING SCHEDULE IN ACCORDANCE

INTERIOR FINISH OF EXTERIOR WALLS SHALL BE MINIMUM 1/2"

NAILED TO COMMON FRAMING OR BLOCKING WITH AN

GYPSUM BOARD INSTALLED ON THE INTERIOR SIDE.

CONSTRUCTED IN CONFORMANCE WITH 2018 IRC R602.10.4 AND R602.10.5

INCLUDING AREAS ABOVE AND BELOW OPENINGS AND GABLE END WALLS.

ALL SHEATHABLE SURFACES ON ONE SIDE OF THE BRACED WALL LINE

END CONDITIONS SHALL MEET THE REQUIREMENTS OF R602.10.7 AND

BRACING METHODS SHALL BE PER PLAN AND SHALL BE

BRACING PFH PER IRC R602.10.6.2


BRACING GB PER IRC R602.10

### **GENERAL PLAN NOTES**

- ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATIONAL RESIDENTIAL CODE OR ATTACHED ENGINEER SPECIFICATIONS WHERE APPLICABLE.
- ALL DIMENSIONS ARE FROM FACE OF STUD U.N.O. MINIMUM DOUBLE JOIST UNDER INTERIOR NON-LOAD BEARING WALLS. CANTILEVERS, OVER BEAMS, AND DOOR JAMBS SHALL BE BLOCKED.
- CEILING JOISTS SHALL BE 2x6 @ 16" O.C. U.N.O. WALL CONSTRUCTION SHALL BE CAPABLE OF ACCOMMODATING ALL
- LOADS IMPOSED ACCORDING TO IRC R301. EXTERIOR WALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH IRC 602 & FIGURES R602.3(1) AND R602.3(2).
- ANY WOOD MEMBERS IN CONTACT WITH CONCRETE OR MASONRY (OR THE FURRING THEY ARE ATTACHED TO) SHALL BE OF DECAY RESISTANT
- INTERIOR NON-LOAD BEARING WALLS SHALL BE ISOLATED FROM THE FLOOR FRAMING ABOVE UNLESS THE INTERIOR NON-LOAD BEARING WALL RESTS DIRECTLY ON A FOOTING.
- SOLID BLOCKING BETWEEN JOISTS AT 48" O.C. AND EXTEND BLOCKING ONE JOIST BAY PAST EACH SIDE OF KITCHEN ISLAND
- DOUBLE JOIST UNDER KITCHEN ISLAND AND TUBS ALL JOIST HANGERS TO BE SIMPSON LUS HANGERS UNO

INTERIOR LOAD BEARING WALL

# DIMENSIONS MEASURED FROM CENTERLINE OF PARTY WALL ASSEMBLY.

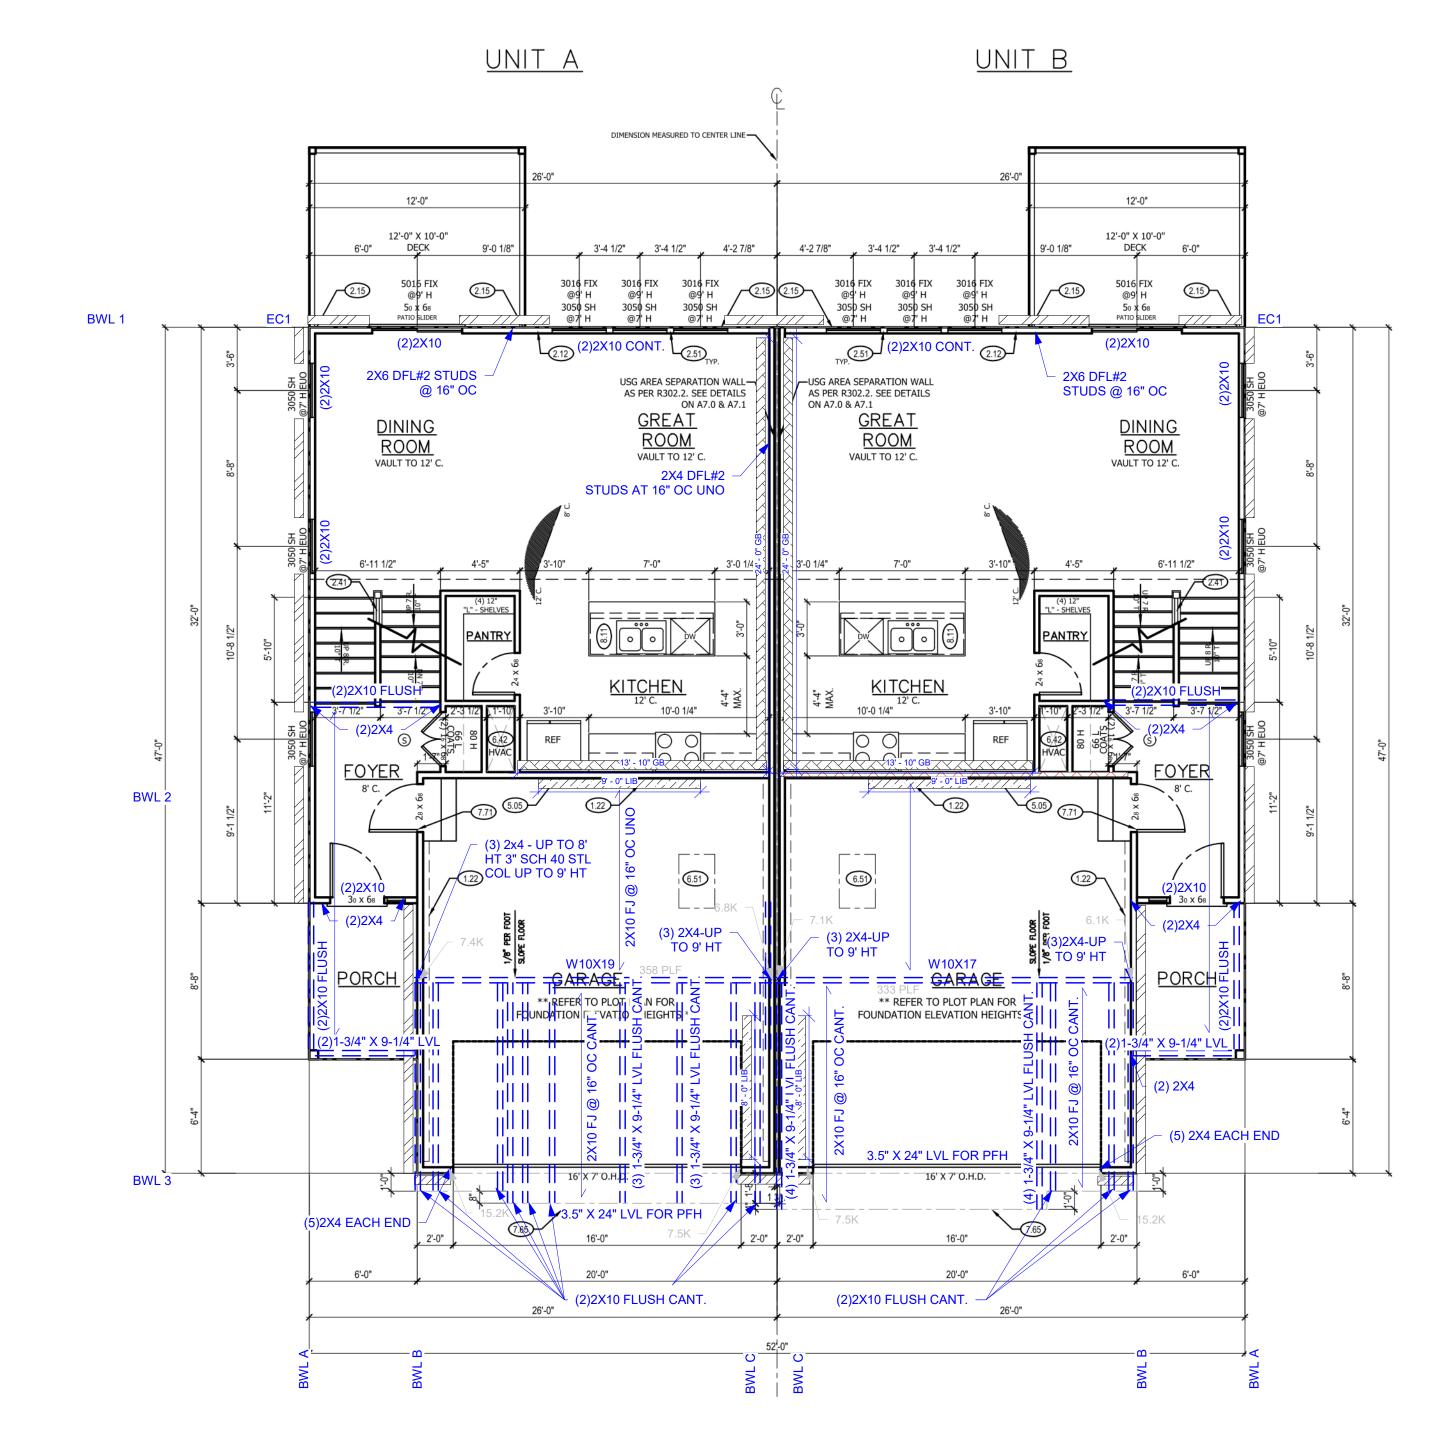

CLIMATE ZONE FENESTRATION U-FACTOR SKYLIGHT U-FACTOR FENESTRATION SHGC CEILING AND ATTICS R-VALUE WALL R-VALUE R-VALUE SLAB R-VALUE SLAB R-VALUE WALL R-VALUE SLAB R-VALUE WALL R-VALUE WAL	IR	RC TABLE N1102.1.	2 (R402.1.2) II	NSULATION AND F	ENESTRATION	REQUIREM	ENTS BY COMPO	ONENT (PAR	TIAL) AND ENERG	GY CONSERVATION	ON CODE COMPLIA	NCE
				FENESTRATION	ATTICS	VAULIS	WALL	FLOOR				
		.32	.55	.40	49	49	20 OR 13+5H	19	10/13	10, 2 FT	10/13	8

### MAIN FLOOR PLAN NOTES

- .22 EXPOSED TOP OF FOUNDATION WALL.
- 2.12 2X6 STUD WALL 2.15 ENTIRE REAR WALL TO BE DOUBLE WALL
- CONSTRUCTION. § ZIP PANELS AS 1ST LAYER OF STRUCTURAL SHEATHING.
- .41 CURB STAIR SYSTEM WITH OPEN
- 2.51 3 STUDS BETWEEN WINDOW UNITS
- 3.42 6X6 CEDAR POST. 1X6 TRIM AT BASE 1X4 TRIM AT TOP.
- 5.05 HOSE BIBB 3.42 HVAC FLOOR OPENING. HEADER OFF FLOOR JOISTS AS REQUIRED. BUMP TRUSSES AS NECESSARY FOR HVAC
- 51 1'-10"X3'-0" MINIMUM ATTIC ACCESS WITH 3/4" BACKER BOARD AND 2 LATCHES. BUMP TRUSSES FOR ATTIC
- 7.65 LINE OF FLOOR ABOVE 7.71 20 MINUTE FIRE RATED SOLID CORE WITH
- SELF-CLOSING HINGES 11 24" CABINET + 12" OVERHANG FLAT ISLAND. VERIFY LOCATION WITH PERSONAL BUILDER.

**CPG DBA** 



120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

COPYRIGHT 2017 IS DRAWING HAS BEEN PREPARED BY SUMMI

HOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN NSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, OR DISCLOSURE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE WRITTEN CONSENT FROM CPG, INC. D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT ISTRICTLY PROHIBITED.

ADDRESS: A: 3712 SW KNOXVILLE CT. B: 3710 SW KNOXVILLE CT.

WIN EMERA

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> EVERSTEAD 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > VERSION #: V1.0

SHEET NUMBER:

ISSUE DATE: 09.26.2024

### GENERAL NOTES

SCALE: 3/16" = 1'-0"

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER VENDOR.

WINDOW SIZES ARE WRITTEN FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0" X 6'-6" FIXED.

BRACING WSP PER IRC R602.10 (INCLUDES PARTIAL PANELS PER IRC R602.10.5.2)

BRACING LIB PER IRC R602.10

MINIMUM LIB LENGTH PER 2018 IRC TABLE R602.10.5: 55" - 8' TALL WALL HEIGHT

62" - 9' TALL WALL HEIGHT 69" - 10' TALL WALL HEIGHT BRACING METHODS SHALL BE PER PLAN AND SHALL BE

DETAIL 9-S400.

WITH IRC R602.10.4.4

CONSTRUCTED IN CONFORMANCE WITH 2018 IRC R602.10.4 AND R602.10.5

INCLUDING AREAS ABOVE AND BELOW OPENINGS AND GABLE END WALLS.

FOR METHOD CS-WSP STRUCTURAL PANEL SHEATHING SHALL BE

ALL HORIZONTAL PANEL JOINTS SHALL OCCUR OVER AND BE

APPROPRIATE PANEL EDGE-NAILING SCHEDULE IN ACCORDANCE

INTERIOR FINISH OF EXTERIOR WALLS SHALL BE MINIMUM 1/2"

NAILED TO COMMON FRAMING OR BLOCKING WITH AN

GYPSUM BOARD INSTALLED ON THE INTERIOR SIDE.

ALL SHEATHABLE SURFACES ON ONE SIDE OF THE BRACED WALL LINE

END CONDITIONS SHALL MEET THE REQUIREMENTS OF R602.10.7 AND

BRACING PFH PER IRC R602.10.6.2

BRACING GB PER IRC R602.10

### **GENERAL PLAN NOTES**


- ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATIONAL RESIDENTIAL CODE OR ATTACHED ENGINEER SPECIFICATIONS WHERE
- ALL DIMENSIONS ARE FROM FACE OF STUD U.N.O.
- MINIMUM DOUBLE JOIST UNDER INTERIOR NON-LOAD BEARING WALLS.
- CANTILEVERS, OVER BEAMS, AND DOOR JAMBS SHALL BE BLOCKED.
- CEILING JOISTS SHALL BE 2x6 @ 16" O.C. U.N.O. WALL CONSTRUCTION SHALL BE CAPABLE OF ACCOMMODATING ALL LOADS IMPOSED ACCORDING TO IRC R301.
- EXTERIOR WALLS SHALL BE CONSTRUCTED IN ACCORDANCE WITH IRC 602 & FIGURES R602.3(1) AND R602.3(2).
- ANY WOOD MEMBERS IN CONTACT WITH CONCRETE OR MASONRY (OR THE FURRING THEY ARE ATTACHED TO) SHALL BE OF DECAY RESISTANT MATERIAL.

INTERIOR NON-LOAD BEARING WALLS SHALL BE ISOLATED FROM THE

- FLOOR FRAMING ABOVE UNLESS THE INTERIOR NON-LOAD BEARING WALL RESTS DIRECTLY ON A FOOTING.
- SOLID BLOCKING BETWEEN JOISTS AT 48" O.C. AND EXTEND BLOCKING ONE JOIST BAY PAST EACH SIDE OF KITCHEN ISLAND
- DOUBLE JOIST UNDER KITCHEN ISLAND AND TUBS
- ALL JOIST HANGERS TO BE SIMPSON LUS HANGERS UNO

INTERIOR LOAD BEARING WALL

### **WALL BRACING NOTES:** DIMENSIONS MEASURED FROM CENTERLINE OF PARTY WALL ASSEMBLY. WALL BRACING IS DESIGNED IN ACCORDANCE WITH IRC R602.10

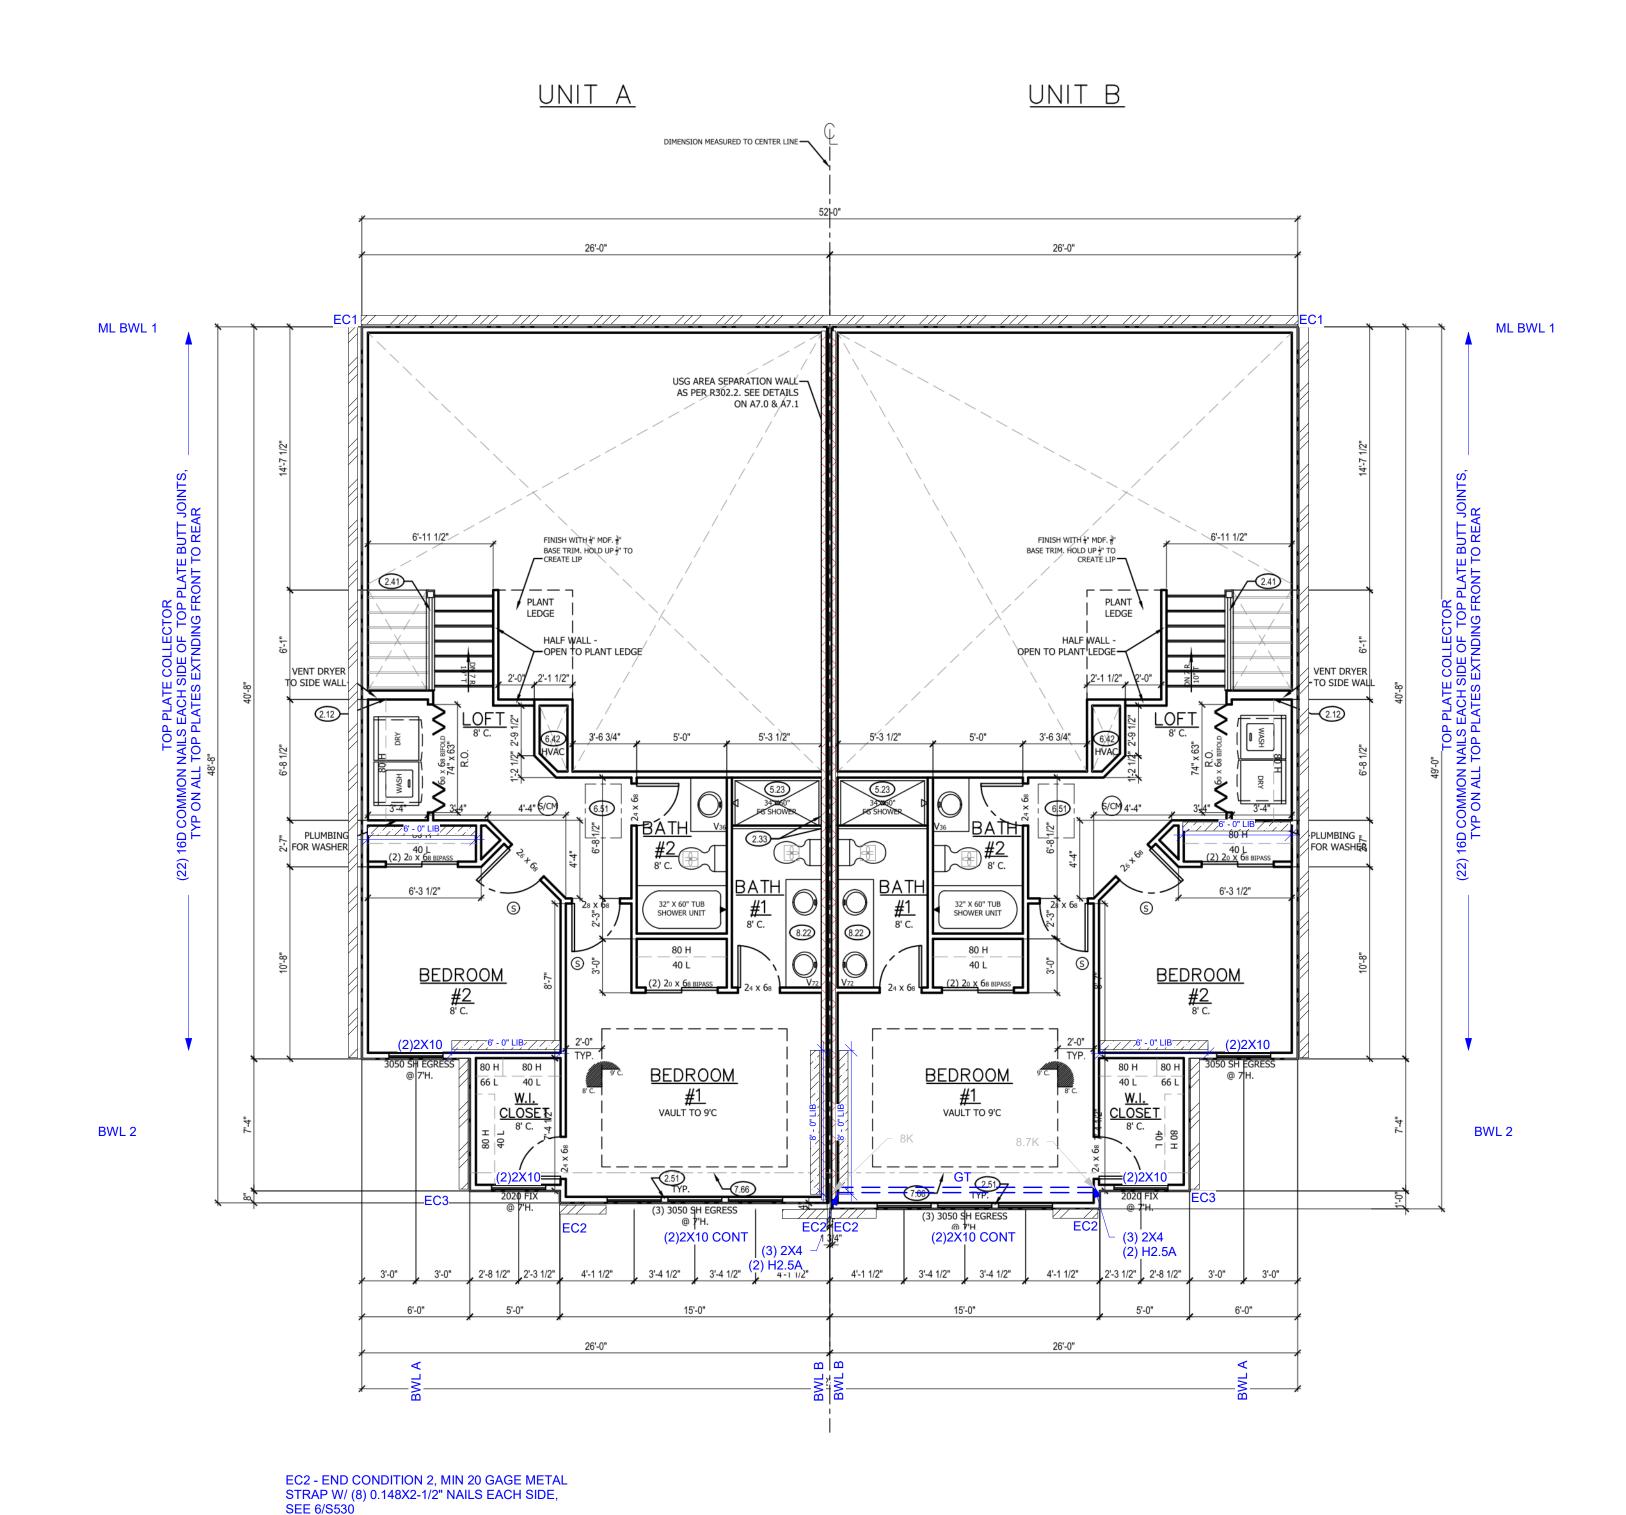

IRC TABLE N1102.1.2 (R402.1.2) INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT (PARTIAL) AND ENERGY CONSERVATION CODE COMPLIANCE CEILING AND VAULTS WOOD FRAME GLAZED U-FACTOR U-FACTOR FENESTRATION ATTICS CLIMATE FENESTRATION SKYLIGHT FLOOR BASEMENT SLAB R-VALUE CRAWL SPACE DUCTWORK WALL R-VALUE R-VALUE | WALL R-VALUE | & DEPTH | WALL R-VALUE | R-VALUE R-VALUE SHGC R-VALUE 4 EXCEPT 20 OR 13+5H 10, 2 FT 10/13 MARINE

SCALE: 3/16" = 1'-0"

**GENERAL NOTES** 

VENDOR.

X 6'-6" FIXED.

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD

TERMINOLOGY. ACTUAL LUMBER

SIZING IS EXPECTED TO VARY PER

WINDOW SIZES ARE WRITTEN IN

FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X

5'-0" SINGLE HUNG, 3066 FIX = 3'-0"

- 2.11 DOUBLE 2X4 STUD WALL
- 2.12 2X6 STUD WALL
- 2.13 PONY WALL
- 2.15 ENTIRE REAR WALL TO BE DOUBLE WALL CONSTRUCTION. 8" ZIP PANELS AS 1ST LAYER OF STRUCTURAL SHEATHING. 33 INSTALL FULL WALL HEIGHT THERMOPLY
- INSULATION BEFORE FRAMING SECONDARY 2X4 WALL FOR PLUMBING 2.51 3 STUDS BETWEEN WINDOW UNITS
- 5.23 34"X60" FIBERGLASS SHOWER. SEE PRICE SUMMARY.
- 6.42 HVAC BUMP TRUSSES AS NECESSARY FOR HVAC ACCESS 6.51 1'-10"X3'-0" MINIMUM ATTIC ACCESS WITH 3/4" BACKER BOARD AND 2

LATCHES. BUMP TRUSSES FOR ATTIC

7.66 LINE OF FLOOR BELOW

8.22 CONTINUOUS FLAT VANITY

COPYRIGHT 2017 HOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, OR DISCLOSURE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE WRITTEN CONSENT FROM CPG, INC.
D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR
BIDDING AND CONSTRUCTION OF THIS PROJECT IS
STRICTLY PROHIBITED.

**CPG DBA** 

A CLAYTON COMPANY

120 SE 30TH ST.

LEE'S SUMMIT, MO 64082

816-246-6700

ADDRESS: A: 3712 SW KNOXVILLE CT.

B: 3710 SW KNOXVILLE CT.

WIN EMERA

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > VERSION #: V1.0

ISSUE DATE: 09.26.2024

SHEET NUMBER:

DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 11/01/2024 4:04:46

- TRUSS FRAMED ROOF NOTES


  1. ALL CONSTRUCTION SHALL CONFORM TO 2018 INTERNATIONAL RESIDENTIAL CODE OR ATTACHED ENGINEER SPECIFICATIONS WHERE APPLICABLE.
- DESIGNED FOR LIGHT ROOF COVERING, UNO. SEE G000 FOR MINIMUM LOADING.
- ALL EXTERIOR AND/OR LOAD BEARING WALL HEADERS SHALL BE MIN. (2) #2 2X10 UNO. CONSULT ENGINEER IF TRUSSES BEAR ON INTERIOR WALLS SHOWN AS NON-LOAD
- BEARING ON APPROVED POINTS. PROVIDE 2X SOLID BLOCKING SUPPORT BELOW ALL POINT LOADS CONTINUOUS TO
- BEARING STRUCTURE AND/OR FOUNDATION BELOW. WOOD TRUSSES SHALL BE IN ACCORDANCE WITH IRC 802.10.
- CONSULT ENGINEER IF TRUSSES BEAR ON INTERIOR WALLS SHOWN AS NON-LOAD BEARING ON APPROVED PRINTS.
- GIRDER TRUSSES MUST HAVE LOAD CARRIED DOWN TO THE FOUNDATION OR LOAD
- SUPPORTING MEMBER. STUD PACK / COLUMN SHOWN ON PLANS. ROOF COVERING SHALL BE ASPHALT SHINGLES AND SHALL COMPLY WITH IRC 2018
- MINIMUM ROOF SLOPE FOR ASPHALT SHINGLES SHALL BE 2:12. ROOF SLOPES IN BETWEEN 4:12 AND 2:12 SHALL REQUIRE DOUBLE UNDERLAYMENT IN
- ACCORDANCE WITH IRC 2018 TABLE R905.1.1(2). EVERSTEAD STRUCTURAL SCOPE ENDS AT TOP PLATE FOR ROOF TRUSSES.

TRUSS DIRECTION GIRDER TRUSS LOCATION \_ \_ \_ \_ \_ \_ \_ INTERIOR LOAD BEARING WALL

# DIMENSIONS MEASURED FROM CENTERLINE OF PARTY WALL ASSEMBLY.

<u>unit a</u>

<u>UNIT B</u>

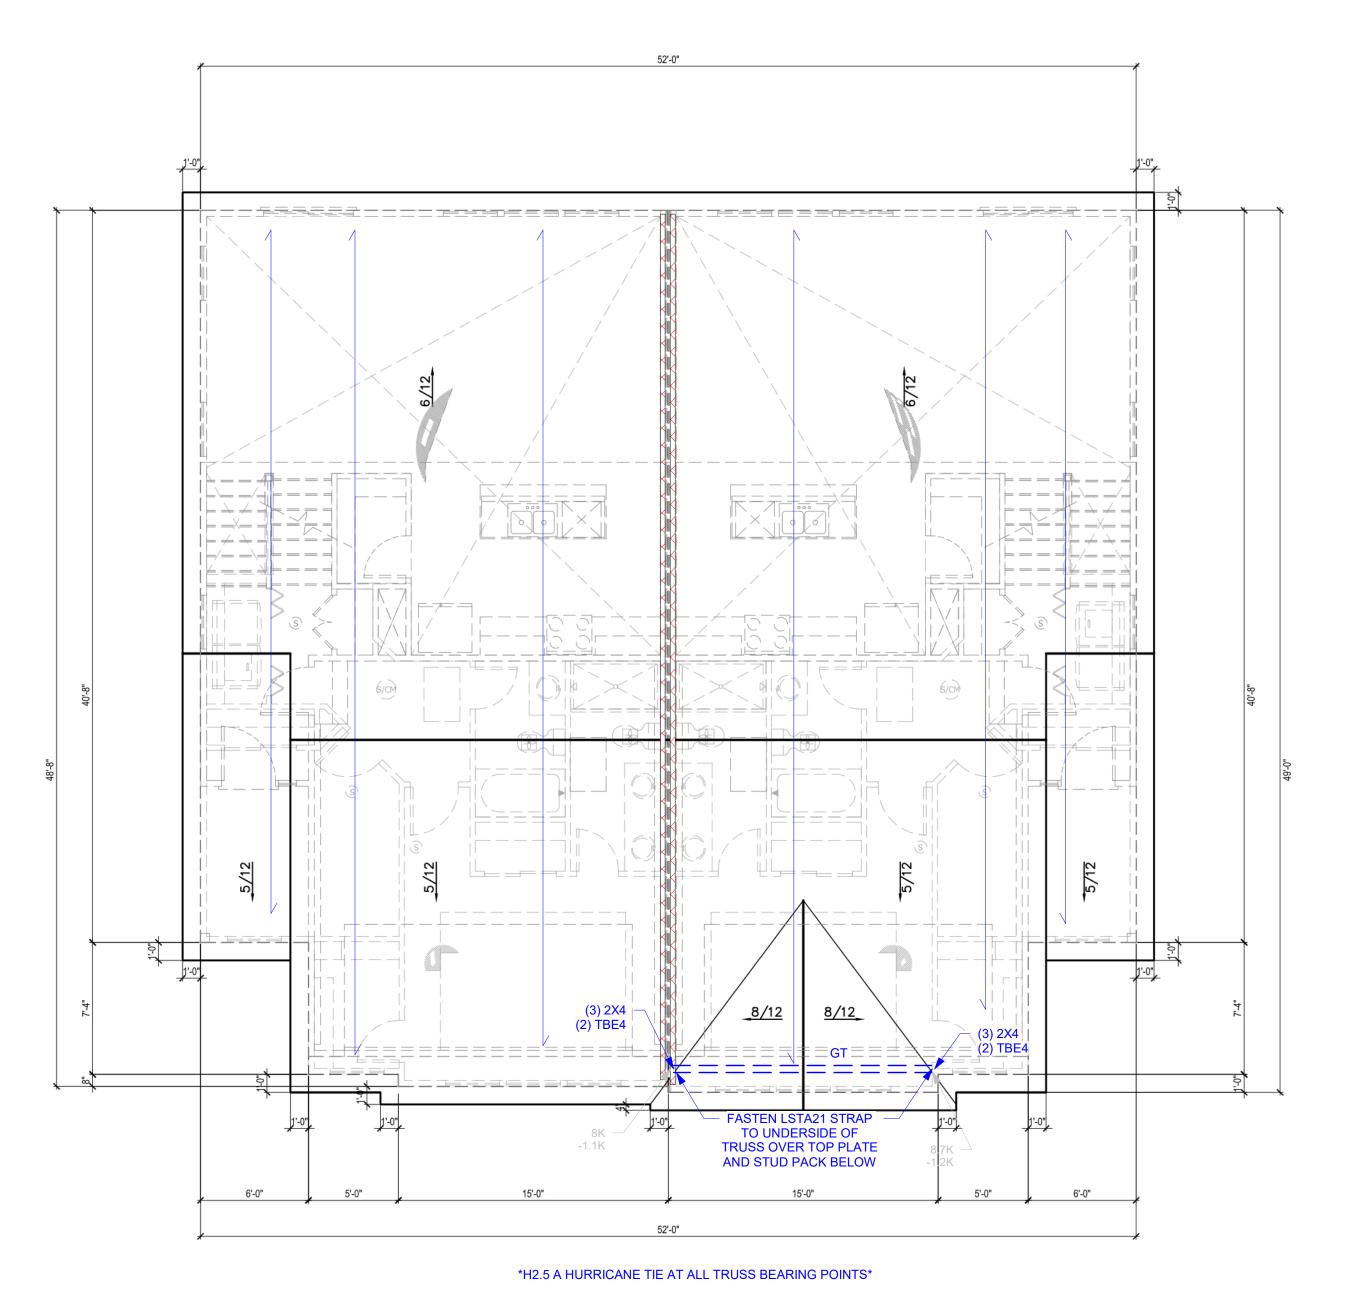

ROOF PLAN NOTES

- MINIMUM ROOFING COMPOSITION- 30 Y COMPOSITE SHINGLES ON 15# FELT ON 1/2" OSB SHEATHING OR AS REQUIRED BY CODE.
- .31 BUILD CRICKET VALLEY AWAY FROM INTERSECTION FOR POSITIVE DRAINAGE.





120 SE 30TH ST. LEE'S SUMMIT, MO 64082 816-246-6700

COPYRIGHT 2017 THIS DRAWING HAS BEEN PREPARED BY SUMMIT HOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN NSTRUMENT OF SERVICE AND IS INTENDED FOR USE DNLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE DVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED TO CPG, INC. ANY REPRODUCTION, USE, OR DISCLOSURE OF THE INFORMATION CONTAINED HEREIN WITHOUT THE WRITTEN CONSENT FROM CPG, INC. D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS STRICTLY PROHIBITED.

ADDRESS: A: 3712 SW KNOXVILLE CT. B: 3710 SW KNOXVILLE CT

PROFESSIONAL SEAL:



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS WERE PROVIDED BY OTHERS.

> **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > VERSION #: V1.0

ISSUE DATE: 09.26.2024

SHEET NUMBER:

SCALE: 3/16" = 1'-0"


VENDOR.

WINDOW SIZES ARE WRITTEN IN FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0" X 6'-6" FIXED.

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD

TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER

**GENERAL NOTES** 

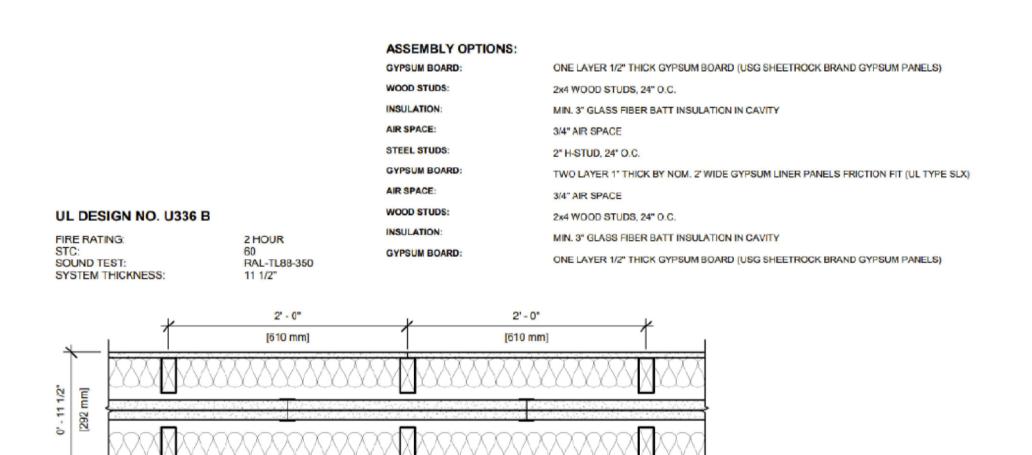

2' - 0"

**Runner Installation** 

USG H-stud

**Exterior Wall Intersection (as required)** 

-2" USG H-stud

gypsum panels ---

USG C-runner

.063" USG aluminum

breakaway clip


—weather barrier

-2" USG C-runners


exterior sheathing

exterior cladding

power-driven

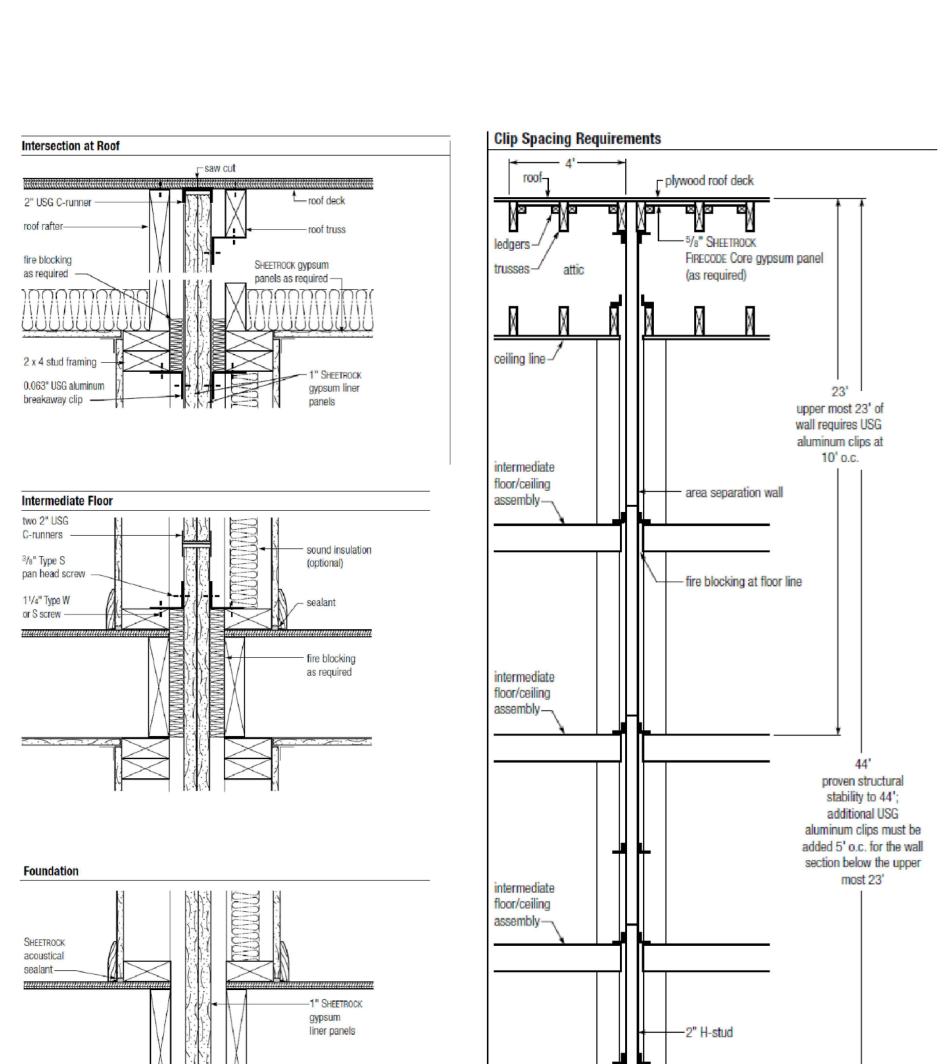

adjacent framing

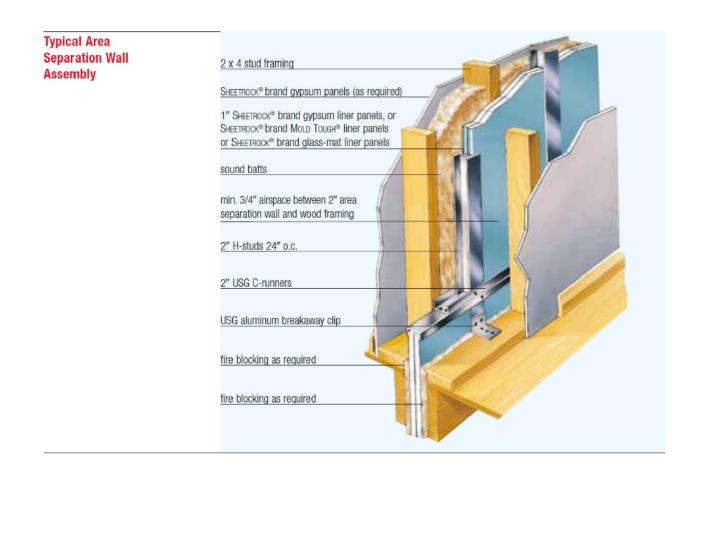

# **NSG**

PROFESSIONAL SEAL: HANNAH CHRISTINE

TWIN EMERAL OSAGE #78

CPG DBA

A CLAYTON COMPANY

120 SE 30TH ST.

LEE'S SUMMIT, MO 64082

816-246-6700

COPYRIGHT 2017

HOMES, OR UNDER THEIR DIRECT SUPERVISION AS AN INSTRUMENT OF SERVICE AND IS INTENDED FOR USE

INSTRUMENT OF SERVICE AND IS INTENDED FOR USE ONLY ON THIS PROJECT. ALL DRAWINGS, SPECIFICATIONS, AND DESIGNS, INCLUDING THE OVERALL LAYOUT, FORM, AND COMPOSITION OF SPACES ARE PROTECTED BY COPYRIGHT REGISTERED

CPG, INC. ANY REPRODUCTION, USE, OR SCLOSURE OF THE INFORMATION CONTAINED HEREIN

THOUT THE WRITTEN CONSENT FROM CPG, INC D/B/A SUMMIT HOMES EXCEPT AS REQUIRED FOR BIDDING AND CONSTRUCTION OF THIS PROJECT IS

ADDRESS:

A: 3712 SW KNOXVILLE CT

B: 3710 SW KNOXVILLE CT.

RICTLY PROHIBITED.

DRAWING HAS BEEN PREPARED BY SUMMI

NUMBER PE-2023046346 10/29/2024 EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS

WERE PROVIDED BY OTHERS. **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> VERSION #: V1.0

ISSUE DATE: 05.17.2024

SHEET NUMBER:

### **GENERAL NOTES**

PARTY WALL DETAIL SCALE: N.T.S.

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER VENDOR.

WINDOW SIZES ARE WRITTEN IN FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0" X 6'-6" FIXED.


LEE'S SUMMIT, MISSOURI 11/01/2024 4:04:46

### UL/cUL SYSTEM NO. W-L-1406

# METAL PIPE THROUGH GYPSUM WALL ASSEMBLY

F-RATING = 2-HR. T-RATING = 0-HR.

L-RATING AT AMBIENT = LESS THAN 1 CFM / SQ FT L-RATING AT 400°F = LESS THAN 4 CFM / SQ FT

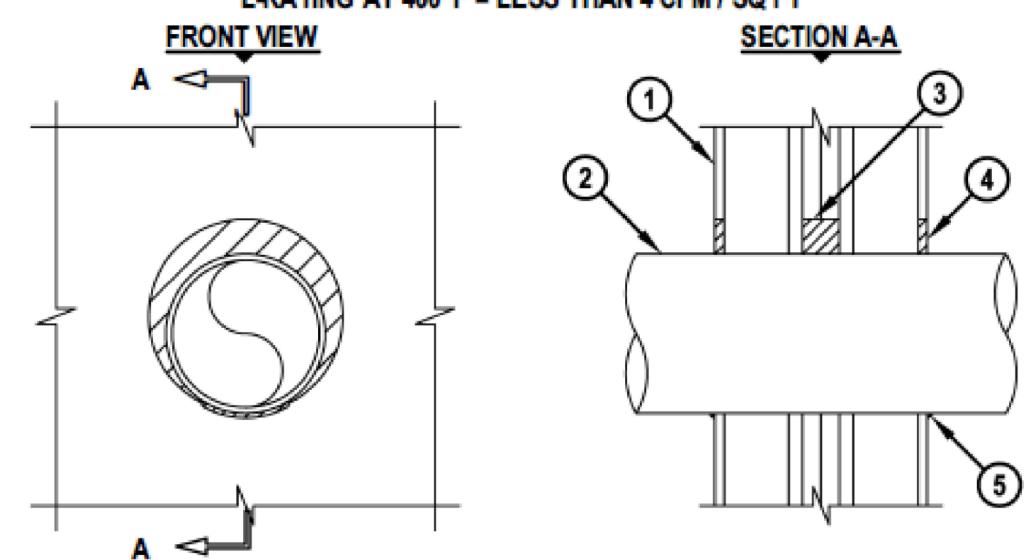

- 1. GYPSUM WALL ASSEMBLY (UL/cUL CLASSIFIED U300 SERIES) (2-HR. FIRE-RATING) CONSISTING OF THE FOLLOWING:
  - A. NOMINAL 2 x 4 STUDS SPACED MAXIMUM 24" OC.
  - B. STEEL "H" SHAPED STUDS SPACED MAXIMUM 24" OC.
  - C. TWO LAYERS 1" GYPSUM SHAFT LINER PANELS.
  - D. MINIMUM 1/2" THICK GYPSUM WALLBOARD.
- 2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
  - A. MAXIMUM 8" NOMINAL DIAMETER STEEL PIPE (SCHEDULE 5 OR HEAVIER).
  - B. MAXIMUM 8" NOMINAL DIAMETER CAST OR DUCTILE IRON PIPE.
  - C. MAXIMUM 4" NOMINAL DIAMETER COPPER PIPE OR TUBING.
  - D. MAXIMUM 6" NOMINAL DIAMETER STEEL CONDUIT.
  - E. MAXIMUM 4" NOMINAL DIAMETER EMT.
- 3. MINIMUM 2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED WITHIN GYPSUM SHAFT LINER PANELS.
- 4. MINIMUM 1/2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED FLUSH WITH OUTER SURFACES OF GYPSUM WALLBOARD.
- 5. MINIMUM 1/4" BEAD FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT AT OUTER SURFACE OF GYPSUM WALLBOARD.


NOTES: 1. MAXIMUM DIAMETER OF OPENING = 10-1/2".

2. ANNULAR SPACE = MINIMUM 0", MAXIMUM 1-7/8".

# UL SYSTEM NO. W-L-2472

### PLASTIC PIPE THROUGH GYPSUM WALL ASSEMBLY

F-RATING = 2-HR. T-RATING = 2-HR.

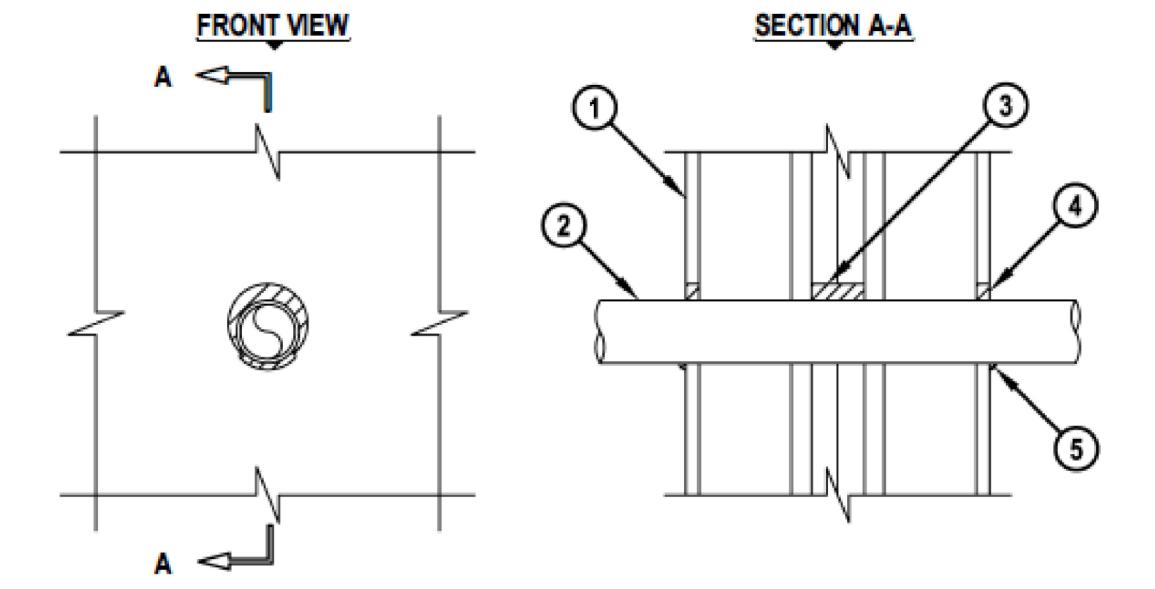

- 1. GYPSUM WALL ASSEMBLY (UL CLASSIFIED U300 SERIES) (2-HR. FIRE-RATING) CONSISTING OF THE FOLLOWING:
  - A. NOMINAL 2 x 4 STUDS SPACED MAXIMUM 24" OC.
  - B. STEEL "H" SHAPED STUDS SPACED MAXIMUM 24" OC.
  - C. TWO LAYERS 1" GYPSUM SHAFT LINER PANELS.
  - D. MINIMUM 1/2" THICK GYPSUM WALLBOARD.
- 2. PENETRATING ITEM TO BE ONE OF THE FOLLOWING:
  - A. MAXIMUM 2" NOMINAL DIAMETER PVC PLASTIC PIPE (CELLULAR OR SOLID CORE).
  - B. MAXIMUM 2" NOMINAL DIAMETER CPVC PLASTIC PIPE (CLOSED PIPING SYSTEM ONLY).
  - C. MAXIMUM 2" NOMINAL DIAMETER RNC-PVC CONDUIT.
- 3. MINIMUM 2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED WITHIN GYPSUM SHAFT LINER PANELS.
- 4. MINIMUM 1/2" DEPTH FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED FLUSH WITH OUTER SURFACES OF GYPSUM WALLBOARD.
- 5. MINIMUM 1/4" BEAD FS-ONE MAX OR FS-ONE INTUMESCENT FIRESTOP SEALANT APPLIED AT POINT OF CONTACT AT OUTER SURFACE OF GYPSUM WALLBOARD.

NOTES: 1. MAXIMUM DIAMETER OF OPENING = 3".

- ANNULAR SPACE = MINIMUM 0", MAXIMUM 5/8".
- CLOSED OR VENTED PIPING SYSTEM (PVC, RNC = SCHEDULE 40; CPVC = SDR 13.5).

# Q U NS N

# summi A CLAYTON COMPANY

**CPG DBA** 


120 SE 30TH ST LEE'S SUMMIT, MO 64082 816-246-6700

COPYRIGHT 2017 /A SUMMIT HOMES EXCEPT AS REQUIRED FOR

A: 3712 SW KNOXVILLE CT. B: 3710 SW KNOXVILLE CT

TWIN EMERAL
OSAGE #78

PROFESSIONAL SEAL



EVERSTEAD IS RESPONSIBLE FOR STRUCTURAL SPECIFICATIONS ONLY. ARCHITECTURAL PLANS

> **EVERSTEAD** 3741 NE TROON DR. LEES SUMMIT, MO 64064 816-399-4901

> > **VERSION #:** V1.0

ISSUE DATE: 05.17.2024

### **GENERAL NOTES**

DIMENSIONAL LUMBER IS LABELED PER INDUSTRY STANDARD TERMINOLOGY. ACTUAL LUMBER SIZING IS EXPECTED TO VARY PER

WINDOW SIZES ARE WRITTEN I FEET AND INCHES PER INDUSTRY STANDARDS. EX: 3050 SH = 3'-0" X 5'-0" SINGLE HUNG, 3066 FIX = 3'-0"

SHEET NUMBER

### **GENERAL NOTES IRC 2018**

PLANS SHALL COMPLY WITH 2018 INTERNATIONAL RESIDENTIAL CODE (IRC) WITH AMENDMENTS AS ADOPTED BY THE APPROPRIATE GOVERNING JURISDICTION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER OF RECORD IF ANY CHANGES OR DEVIATIONS FROM THE PLAN ARE MADE DURING CONSTRUCTION. THE ENGINEER OF RECORD MAY REQUIRE REVISED DRAWING OR CALCULATIONS AT ITS DISCRETION. IF DISCREPANCIES ARE IDENTIFIED THE MOST CONSERVATIVE SPECIFICATION SHALL APPLY.

### A.2 LOADING ASSUMPTIONS

ROOF + CEILING (NO STORAGE) 15 PSF ROOF + CEILING (STORAGE) 20 PSF CEILING JOISTS (STORAGE) 10 PSF EXTERIOR BALCONY / DECK 10 PSF INTERIOR FLOOR (MAIN FLOOR) 15 PSF INTERIOR FLOOR (UPPER FLOORS) 10 PSF 8" THICK MASONRY WALL 96 PSF 6" THICK MASONRY WALL 72 PSF 15 PSF EXTERIOR LIGHT FRAMED WOOD WALLS INTERIOR LIGHT FRAMED WOOD WALLS 10 PSF (INTERIOR WALLS INCLUDED IN 15 PSF DEAD LOAD)

LIVE ROOF LIVE LOAD FLOOR LIVE LOAD 40 PSF (HABITABLE) GARAGE 50 PSF WITH 2000 LB POINT LOAD STORAGE 20 PSF (UNINHABITABLE) **GUARDRAIL** 

CONTINUOUS LINEAR MAXIMUM POINT 200 LBS

GROUND SNOW LOAD 20 PSF

VELOCITY 115 MPH **EXPOSURE CATEGORY** 

### SOIL AND SITE ASSUMPTIONS

- FOUNDATION DESIGN ASSUMES MINIMUM SOIL BEARING FOR THE SITE OF 1,500 PSF (2,000 PSF FOR KANSAS CITY, MO) UNLESS OTHERWISE NOTED. CONTRACTOR TO VISUALLY INSPECT THE SITE OR PROVIDE GEOTECHNICAL INVESTIGATION TO VERIFY MINIMUM ACCEPTABLE SOIL CONDITIONS FOR CL (SILTY CLAY) AS DEFINED BY 2018 IRC. THE CONTRACTOR IS RESPONSIBLE FOR ANY SOIL CONDITION THAT DOES NOT MEET THE MINIMUM REQUIREMENTS AND FOR CONTACTING THE ENGINEER OF
- ACCESSORY STRUCTURES WITH AN EAVE HEIGHT LESS THAN 10'-0" AND AN AREA LESS THAN 600 FT MAT PROVIDE A MINIMUM SOIL COVER OF 12 INCHES MEASURED FROM THE BOTTOM OF CONCRETE.
- LATERAL SOIL PRESSURES UNLESS OTHERWISE NOTED

**ACTIVE** 60 PSF AT REST 100 PSF

SITE GRADING SHALL PROVIDE POSITIVE DRAINAGE AWAY FROM THE STRUCTURE AT A MINIMUM OF 0.5% (6" IN THE FIRST 10'-0"). ALTERNATE APPROACHES MAY BE APPROVED IF THE ALTERNATE DESIGN IS EQUIVALENT IN EFFECTIVENESS AND PERFORMANCE, AND PROVIDES FOR POSITIVE SITE DRAINAGE.

### FOUNDATION NOTES

### FOUNDATION ANCHORAGE (IRC R403.1.6)

- SILL PLATES SHALL BE BOLTED TO THE FOUNDATION WALL WITH A MINIMUM 1/2" DIAMETER ANCHOR BOLTS EMBEDDED AT LEAST 7" INTO THE CONCRETE.
- BOLTS SHALL BE SPACED NO GREATER THAN 6'-0" O.C.
- THERE SHALL BE A MINIMUM OF TWO BOLTS PER PLATE SECTION, WITH A BOLT PLACED WITHIN 12" AND NOT CLOSER THAN 7 BOLT DIAMETERS OF THE END OF EACH PLATE SECTION
- A PROPERLY SIZED NUT AND WASHER SHALL BE TIGHTENED ON EACH BOLT TO THE PLATE, (NOTE: 7" EMBEDMENT + 1-1/2" SILL PLATE + 3/4" FOR NUT AND WASHER EQUALS A 9-1/4" LONG
- WALL BRACING METHODS (IRC R602) MAY REQUIRE ADDITIONAL ANCHORAGE.

### C.2 CONCRETE SLABS

- CONCRETE SLABS PLACED ON FILL MATERIAL WHICH SHALL BE COMPARED TO ENSURE UNIFORM SUPPORT OF THE SLAB AND SHALL NOT EXCEED 24" OF COMPACTED GRANULATED MATERIAL (SAND OR GRAVEL) OR 8" OF EARTH:
  - THIS MAY OCCUR AT GARAGE FLOOR FILLS, OR OVER EXCAVATED AREAS UNDER FLOOR SLABS.
  - THE DESIGN AND INSTALLATION DETAILS IN THIS DOCUMENT (WHERE APPLICABLE BASED ON SIZE AND SPACING LIMITATIONS) MAY BE USED IN LIEU OF PROVIDING A SEPARATE DESIGN.
  - STRUCTURAL SLABS EXCEEDING THE SPANS AND CONDITIONS OF THE APPROVED DETAILS SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER.
- SLABS AT MAX 4'-0" OVER-DIG ADJACENT TO FOUNDATION WALL:
  - WHERE SOIL IS EXCAVATED FOR A MAXIMUM DIMENSION OF 4'-0" HORIZONTALLY ADJACENT TO A FOUNDATION WALL. THE STANDARD OVER-DIG DETAIL MAY BE USED IN LIEU OF A COMPLETE STRUCTURAL SLAB.
  - SEE "TYPICAL FOOTING/FOUNDATION WALL/STANDARD SLAB AT MAX 4'-0" OVER-DIG"

### VAPOR RETARDER / BARRIER (IRC R506.2.3)

A 6 MILLIMETER POLYETHYLENE OR APPROVED VAPOR RETARDER WITH JOINTS LAPPED A MINIMUM OF 6" IS REQUIRED BETWEEN THE CONCRETE FLOOR SLAB AND THE BASE COURSE OR PREPARED SUBGRADE, (NOT REQUIRED FOR GARAGE SLABS OR DETACHED UNHEATED ACCESSORY BUILDINGS).

### C.4 FOOTINGS

- THE BOTTOM OF ALL FOOTINGS SHALL EXTEND NOT LESS THAN 36" BELOW GRADE FOR FROST PROTECTION (IRC R403.1.4).
- FOOTINGS FOR FREESTANDING ACCESSORY STRUCTURES WITH AN AREA OF 600 SQ. FT. OR LESS AND AN EAVE HEIGHT OF 10'-0" OR LESS SHALL EXTEND BELOW GRADE A MINIMUM OF
- EXTERIOR WALLS, BEARING WALLS, COLUMNS AND PIERS SHALL BE SUPPORTED ON CONTINUOUS SOLID MASONRY OR CONCRETE FOOTINGS, OR APPROVED STRUCTURAL SYSTEM TO SAFELY SUPPORT THE IMPOSED LOADS AND SHALL BE SIZED AND REINFORCED IN ACCORDANCE WITH THIS STANDARD OR SHALL BE ENGINEERED DESIGN.
- FOOTINGS UNDER FOUNDATION WALLS SHALL BE CONTINUOUS AROUND THE STRUCTURE AND FROM ONE LEVEL TO THE NEXT.
- THE CONTINUOUS TRANSITIONS BETWEEN FOOTINGS AT DIFFERENT LEVELS ENCLOSING USABLE SPACE SHALL BE MADE BY APPROVED SOLID JUMPS OR SUPPORT SYSTEMS TO PROVIDE SAFE SUPPORT OF THE STRUCTURE.
- SEE "TYPICAL FOOTING/FOUNDATION WALLS/STANDARD SLAB AT MAXIMUM 4" OVER-DIG" AND "FOOTING JUMP" DETAILS.

### C.5 CONCRETE

- ALL CONCRETE CONSTRUCTION SHOULD CONFORM TO ACI 318-14 (OR ACI 332) OR 2018 IRC.
- THE MINIMUM CONCRETE 28 DAY COMPRESSIVE STRENGTH SHALL BE AS SPECIFIED IN IRC TABLE R402.2.

### C.5 CONCRETE (CONT.)

- CONCRETE MIX TO UTILIZE A MAXIMUM WATER-CEMENT MATERIALS RATIO OF 0.45 FOR ALL APPLICATIONS. ADMIXTURES SHALL NOT CONTAIN ANY CHLORIDES.
- CONCRETE POURED AGAINST AN EXISTING SURFACE SHOULD BE ROUGHENED TO A MINIMUM
- REBAR PLACEMENT SHALL BE AS FOLLOWS:
  - CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3.0 IN CLR CONCRETE EXPOSED TO EARTH OR WEATHER 1.5 IN CLR NOT EXPOSED TO WEATHER OR GROUND
  - 3/4 IN CLR SLABS, WALLS, JOISTS 1.5 IN CLR BEAMS, COLUMNS

CONCRETE MIX DESIGN SHALL BE 6% (±1%) AIR-ENTRAINED FOR GARAGE SLABS, FOOTINGS,

- WALLS, OR FLATWORK EXPOSED TO WEATHER SHORING AND SUPPORTING FORMWORK SHALL NOT BE REMOVED FROM HORIZONTAL MEMBERS BEFORE CONCRETE STRENGTH REACHES 70% OF STRENGTH DETERMINED BY CYLINDERS OR 28 DAYS.
- ALL FOUNDATION WALLS ENCLOSING BELOW GRADE SPACE SHALL BE DAMPPROOFED. THE DAMPPROOFING SHALL EXTEND FROM THE EDGE OF THE FOOTING TO THE FINISHED GRADE. (IRC R406.1)

### C.6 CONCRETE WALLS WITH REINFORCEMENT STEEL

- REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 40.
- SMOOTH BARS OR WELDED WIRE FABRIC SHALL CONFORM TO ASTM 185.
- 90 DEG. HOOK SHOWN IN DRAWINGS SHALL BE STANDARD PER ACI 318-14.
- STRAIGHT EXTENSION LENGTH = 12X BAR DIA BEND DIAMETER = 12X BAR DIA.

### HOOKED DOWELS:

- HOOKED DOWELS FROM FOUNDATIONS TO WALL SHALL BE PROVIDED TO MATCH VERTICAL WALL REINFORCING AND EXTENDED TO 3" CLEAR FROM BOTTOM OF
- HOOKED DOWELS MATCH SLAB REINFORCING FROM SLAB TO WALLS OR SLAB TO
- PROVIDE (2) #5 BARS AROUND PERIMETER OF ALL SUSPENDED SLABS.
- WHERE SPLICES ARE NECESSARY IN REINFORCEMENT, THE LENGTH OF LAP SPLICE SHALL BE IN ACCORDANCE WITH TABLE R608.5.4(1) AND FIGURE R608.5.4(1). THE MAXIMUM GAP BETWEEN NONCONTACT PARALLEL BARS AT A LAP SPLICE SHALL NOT EXCEED THE SMALLER OF ONE-FIFTH THE REQUIRED LAP LENGTH AND 6 INCHES (152MM) [SEE FIGURE R608.5.4.(1)].
- TOP HORIZONTAL REINFORCEMENT SHALL BE PLACED WITHIN 12" FROM THE TOP OF THE
- HORIZONTAL WALL REINFORCEMENT SHALL TERMINATE AT THE END OF THE WALL WITH A STANDARD HOOK

### C.7 COLD WEATHER CONCRETE

- COLD WEATHER IS DEFINED AS THREE CONSECUTIVE DAYS WHERE THE AVERAGE DAILY TEMPERATURE DROPS BELOW 40 DEGREES FAHRENHEIT AND NOT ABOVE 50 DEGREES FAHRENHEIT FOR MORE THAN HALF OF ANY ONE OF THOSE THREE DAYS.
- COLD WEATHER CONCRETE WORK SHALL CONFORM TO ACI 306.
- ALL MATERIALS AND EQUIPMENT REQUIRED FOR PROTECTION SHALL BE AVAILABLE AT THE PROJECT SITE BEFORE COLD WEATHER CONCRETING BEGINS.
- THE CONCRETE MIX DESIGN PROVIDED BY THE SUPPLIER SHALL AT A MINIMUM REACH THE AVERAGE 28 DAY MIX DESIGN COMPRESSIVE STRENGTH IN MINIMUM 72 HOURS OR 2000 PSI -
- THE TEMPERATURE OF CONCRETE AT PLACEMENT SHALL BE A MINIMUM OF 55 DEGREES
- THE MINIMUM CONCRETE TEMPERATURE AT THE TIME OF MIXING SHALL NOT BE BELOW 65
- ALL SNOW, ICE AND FROST MUST BE REMOVED PRIOR TO PLACING CONCRETE.
- THE CONTRACTOR SHALL PROVIDE ADEQUATE PROTECTION FOR CONCRETE AGAINST FREEZING AND MAINTAIN A CONCRETE TEMPERATURE OF 55 DEGREES FAHRENHEIT FOR A 72 HOUR PERIOD AFTER CONCRETE PLACEMENT. THIS MAY BE ACHIEVED WITH THE USE OF INSULATING BLANKETS AND/OR THE USE OF TEMPORARY HEATERS.
- GROUND TEMPERATURE AT THE TIME OF PLACEMENT OF SLAB OR FOOTINGS SHALL NOT BE LESS THAN 35 DEGREES FAHRENHEIT.
- INSULATION, FORMS AND HEATERS MAY BE REMOVED AFTER 72 HOURS .
- MAINTAIN ADEQUATE PROTECTION OF SUB GRADE AND ADEQUATE DRAINAGE AWAY FROM EXPOSED CONCRETE ELEMENT TO PREVENT FREEZING.

C.8 FOOTNOTES

WHICHEVER IS GREATER.

- VERTICAL REINFORCEMENT FOR CONCRETE WALLS THAT ARE NOT FULL HEIGHT AND FOR REINFORCEMENT SPACED 24" O.C. MAY BE PLACED IN THE MIDDLE OF THE WALL. OTHER WALLS SHALL HAVE VERTICAL REINFORCEMENT PLACED AS FOLLOWS:
  - 8" WALL MINIMUM 2" FROM TENSION FACE
- 10" WALL MINIMUM 6-3/4" FROM THE OUTSIDE FACE EXTEND BARS TO WITHIN 8" OF THE TOP OF THE WALL
- HORIZONTAL REINFORCEMENT:
- ONE BAR SHALL BE PLACED WITHIN 12" OF THE TOP OF THE WALL
- OTHER BARS SHALL BE EQUALLY SPACED WITH SPACING NOT TO EXCEED 24" O.C. HORIZONTAL BARS SHOULD BE AS CLOSE TO THE TENSION FACE AS POSSIBLE
- (INTERIOR); AND BEHIND THE VERTICAL REINFORCEMENT (I.E. 2" FROM INSIDE FACE) SUPPLEMENTAL REINFORCEMENT AT CORNERS - PLACE 1 #4 REBAR 48" LONG AT 45 DEGREE ANGLE AT CORNERS OF OPENINGS. PLACE REINFORCEMENT WITHIN 6" OF THE EDGE OF INSIDE CORNERS.
- AT MASONRY LEDGES THE MINIMUM WALL THICKNESS SHALL BE 3-1/2". LEDGES SHALL NOT EXCEED A DEPTH OF MORE THAN 24" BELOW THE TOP OF THE WALL FOR WALL THICKNESS LESS THAN 4". PROVIDE #4 BARS AT MAXIMUM 24" O.C. TO WITHIN 8" OF THE TOP OF THE WALL.
- STRAIGHT WALLS MORE THAN 5'-0" TALL AND MORE THAN 16-0" LONG SHALL BE PROVIDED WITH EXTERIOR BRACED RETURN WALLS. WALL LENGTH SHALL BE MEASURED USING INSIDE THE SHORTEST DIMENSION BETWEEN INTERSECTING WALLS (SEE TYPICAL DEAD MAN SECTION).

### MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF CONCRETE PER TABLE R402.2 MINIMUM SPECIFIED COMPRESSIVE STRENGTH (f'c) TYPE OR LOCATION OF CONCRETE FOR SEVER WEATHERING POTENTIAL CONSTRUCTION BASEMENT WALLS, FOUNDATIONS AND OTHER CONCRETE NOT 2,500 EXPOSED TO THE WEATHER BASEMENT SLABS AND INTERIOR SLABS ON 2,500 GRADE, EXCEPT GARAGE FLOOR SLABS BASEMENT WALLS, FOUNDATION WALLS, EXTERIOR WALLS AND OTHER VERTICAL CONCRETE WORK 3,000 EXPOSED TO THE WEATHER PORCHES, CARPORT SLABS AND STEPS EXPOSED TO THE WEATHER, AND GARAGE 3,500 FLOOR SLABS SUSPENDED SLABS 4,000

### D. <u>FRAMING/STRUCTURE</u>

### D.1 FRAMING NOTES

- ALL NON TREATED LUMBER SIZES ARE DOUGLAS FIR-LARCH #2 UNLESS OTHERWISE NOTED
- ALL TREATED/ROT RESISTANT LUMBER SIZES ARE #2 TREATED SOUTHERN YELLOW PINE, UNLESS OTHERWISE NOTED.
  - ALL UNMARKED HEADERS SHALL BE A MINIMUM #2 DOUGLAS FIR-LARCH (2) 2X10 ON LOAD
- BEARING WALLS. ALL HEADERS/BEAMS TO BEAR ON A MINIMUM OF (2) 2X4 JACK STUDS UNO. KING STUDS
- SHALL BE PROVIDED AT ALL HEADERS IN ACCORDANCE WITH IRC TABLE R602.7.5.
- DOUBLE JOIST UNDER PARALLEL INTERIOR NON-LOAD BEARING WALLS.
- CANTILEVERS, OVER BEAMS AND DOOR JAMBS SHALL BE BLOCKED.
- ANY WOOD MEMBER IN CONTACT WITH CONCRETE OR MASONRY (OR THE FURRING THEY ARE ATTACHED TO) SHALL BE OF DECAY RESISTANT MATERIAL.
- IN BEARING WALLS, STUDS WHICH ARE NOT MORE THAN 10'-0" FEET IN LENGTH SHALL BE SPACED NOT MORE THAN IS SPECIFIED IN IRC TABLE R602.3(5) FOR THE CORRESPONDING STUD SIZE. THOSE STUDS GREATER THAN 10'-0" FEET IN LENGTH SHALL BE DESIGNED BY A PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT.
- ALL WOOD STRUCTUAL PANELS SHALL CONFORM TO THE MOST CURRENT APPLICABLE SPECIFICATION AND SUPPLEMENTS OF THE APA OR EQUIVALENT. ALL PANEL END JOINTS SHALL OCCUR OVER SUPPORTS AND SHALL BE STAGGERED ONE HALF PANEL LENGTH FROM ADJACENT PANELS. PROVIDE 1/8" INCH SPACE AT PANEL ENDS. WOOD STRUCTURAL PANEL MOISTURE CONTENT SHALL BE LESS THEN OR EQUAL TO 16%.
- ALL STRUCTURAL FRAMING MEMBERS SHALL BE AS FOLLOWS UNO:
- 2X4 OR 2X6 EXTERIOR WALLS AS PERMITTED BY CODE: DOUGLAS FIR-LARCH #2 (DF-L #2)
- EXTERIOR WALLS TO BE CONTINUOUSLY SHEATHED WITH MIN. 7/16" OSB., UNLESS BRACING IS SHOWN ON PLANS EXTERIOR OSB SHEATHING TO BE FASTENED WITH 8D COMMON NAILS; 6" O. C. AT PANEL
- EDGES, 12" O. C. IN THE FIELD. 2X4 OR 2X6 INTERIOR LOAD BEARING WALLS DF-L #2 OR BETTER.
- LOAD BEARING, BRACED, AND SHEAR WALLS, REQUIRE A DOUBLE TOP PLATE. THE TOP
- PLY BEING FIELD APPLIED WITH A MIN. 24" LAP SPLICE FIELD APPLIED LAP SPLICED TOP PLATE: DF-L #2 OR BETTER
- LOAD BEARING HEADERS PER HEADER SCHEDULE OR AS SHOWN ON FRAMING PLANS. LOAD BEARING HEADERS TO BE FABRICATED WITH THE HEADER AT THE UNDER SIDE OF
- THE TOP PLATE WITH CRIPPLE FRAMING BELOW AS NEEDED UNO. INTERIOR NON LOAD BEARING WALLS: DF-L #2 STUD GRADE OR BETTER
- DOUBLE TOP PLATE IS NOT REQUIRED FOR INTERIOR NON LOAD BEARING WALLS HEADER CRIPPLE SPACING CAN BE 24" O. C. REGARDLESS OF WALL STUD SPACING FOR
- NON LOAD BEARING WALLS CRIPPLE FRAMING NOT REQUIRED ABOVE OR BELOW OPENINGS WHERE THE VERTICAL CLEAR HEIGHT IS 22" OR LESS FOR NON-LOAD BEARING WALLS.
- ALL LUMBER IN CONTACT WITH MASONRY OR OTHERWISE EXPOSED TO WEATHERING TO BE
- PRESSURE TREATED (PT). FIELD APPLIED SILL PLATE: TREATED LUMBER
- BOTTOM (SOLE) PLATE IN CONTACT WITH MASONRY: TREATED LUMBER
- ALL PRESSURE TREATED WOOD SHALL BE PRESSURE TREATED WITH WATER-BORNE PRESERVATIVES. PRESSURE TREATMENT SHALL COMPLY WITH THE REQUIREMENTS OF AWPB, C2, LP-22, AND IRC SECTION R317. ALL LUMBER < 8" ABOVE THE FINISHED GRADE SHALL BE PRESSURE TREATED.
- FASTENERS, INCLUDING NUTS AND WASHERS, FOR PRESSURE TREATED WOOD SHALL BE HOT-DIPPED, ZINC-COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER. COATING TYPES AND WEIGHTS FOR CONNECTORS IN CONTACT WITH PRESSURE TREATED WOOD SHALL BE IN ACCORDANCE WITH THE CONNECTOR MANUFACTURER'S RECOMMENDATIONS. IN THE ABSENCE OF MANUFACTURER'S RECOMMENDATIONS, A MIN. OF ASTM A653 TYPE G185 ZINC-COATED GALVANIZED STEEL, OR EQUIVALENT, SHALL BE USED. FOR EXCEPTIONS, REFER TO R317.3.1.

ENGINEERED LUMBER MIIMUM DESIGN REQUIREMENTS						
F <sub>b</sub> (PSI) E (PSI) F <sub>v</sub> (PSI)						
LVL	3100	1.9X10 <sup>6</sup>	285			
DOUGLAS FIR-LARCH	900	1.6X10 <sup>6</sup>	180			
GLU-LAM	2400	1.8X10 <sup>6</sup>	230			

### D.2 STRUCTURAL STEEL

- STEEL DESIGN, FABRICATION, AND ERECTION SHALL CONFORM WITH AMERICAN INSTITUTE OF STEEL CONSTRUCTION.
- STEEL PIPE COLUMNS SHALL BE A MINIMUM OF SCHEDULE 40.
- STEEL GRADE AND SPECIFICATION SHALL BE AS FOLLOWS:
  - **HOLLOW STRUCTURAL SECTIONS:** CHANNELS, PLATES, ANGLES, AND COLUMNS: WIDE FLANGES:
  - STEEL PIPE COLUMN ANCHOR RODS:
- BOLTS SHALL CONFORM TO ASTM A307
- WELDING SHALL CONFORM TO THE AWS CODES FOR BUILDING CONSTRUCTION, WELDING SHALL BE PERFORMED IN ACCORDANCE TO WELDING PROCEDURE SPECIFICATIONS (WPS) AS REQUIRED IN AWS D1.1. THE WPS VARIABLES SHALL BE WITHIN THE PARAMETERS ESTABLISHED BY THE FILLER-METAL MANUFACTURER.

ASTM A500 ( $F_Y = 46 \text{ KSI}$ )

ASTM F1554 ( $F_Y = 36 \text{ KSI}$ )

ASTM A53 GR.B ( $F_Y = 35$  KSI)

ASTM A36 ( $F_Y = 36 \text{ KSI}$ ) ASTM A992 (F<sub>Y</sub> = 50 KSI)

- WELDS SHALL USE E70XX ELECTRODES AND A MINIMUM OF 3/16" SIZE UNLESS NOTED
- ALL WELDS SPECIFIED AS FIELD WELDS MAY BE SHOP WELDED AT THE CONTRACTOR'S OPTION IF ERECTION CAN STILL BE EXECUTED.

# <u>GLAZING</u>

- GLAZING IN HAZARDOUS LOCATIONS AS IDENTIFIED IN IRC R308.4 SHALL BE OF APPROVED SAFETY GLAZING MATERIALS.
- DOOR WHERE THE NEAREST VERTICAL EDGE OF THE GLAZING IS WITHIN A 24" ARC OF EITHER VERTICAL EDGE OF THE DOOR IN A CLOSED POSITION AND WHERE THE BOTTOM EDGE OF THE GLAZING IS LESS THAN 60" ABOVE THE FLOOR. GLAZING ADJACENT TO THE LANDING AT THE BOTTOM OF THE STAIRWAY WHERE THE GLAZING IS LESS THAN 36 INCHES ABOVE THE LANDING AND WITHIN A 60 IN HORIZONTAL

ARC LESS THAN 180 DEGREES FROM THE BOTTOM TREAD NOSING SHALL BE

GLASS IN STORM DOORS: INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A

- CONSIDERED A HAZARDOUS LOCATION. GLAZING IN WALLS, ENCLOSURES OR FENCES CONTAINING OR FACING HOT TUBS, SPAS, WHIRLPOOLS, SAUNAS, STEAM ROOMS, BATHTUBS, SHOWERS, AND INDOOR OR OUTDOOR SWIMMING POOLS WHERE THE BOTTOM EXPOSED EDGE OF THE GLAZING IS
- LESS THAN 60" MEASURED VERTICALLY ABOVE ANY STANDING OR WALKING SURFACE. WINDOW FALL PROTECTION SHALL BE PROVIDED IN ACCORDANCE WITH IRC R312.2.

### F. <u>STAIRWAYS</u>

STAIRWAYS SHALL PROVIDE A MAXIMUM 7-3/4" RISE AND A MINIMUM 10" RUN.

EDGES OF THE TREADS.

- REQUIRED GUARD RAILS AT OPEN-SIDED WALKING SURFACES, INCLUDING STAIRS, PORCHES, BALCONIES, OR LANDINGS, SHALL NOT BE LESS THAN 36" HIGH MEASURED VERTICALLY ABOVE THE ADJACENT WALKING SURFACE.
  - EXCEPTION (1): GUARD RAILS ON THE OPEN SIDES OF STAIRS SHALL HAVE A HEIGHT NOT LESS THAN 34" MEASURED VERTICALLY FROM A LINE CONNECTING THE LEADING EDGES OF THE TREADS.
  - EXCEPTION (2): WHERE THE TOP OF THE GUARD ALSO SERVES AS A HANDRAIL ON THE OPEN SIDES OF STAIRS, THE TOP OF THE GUARD SHALL NOT BE LESS THAN 34" AND NOT MORE THAN 38" MEASURED VERTICALLY FROM A LINE CONNECTING THE LEADING
- GUARD RAIL ENCLOSURES SHALL HAVE INTERMEDIATE RAILS OF ORNAMENTAL PATTERNS THAT DO NOT ALLOW PASSAGE OF A SPHERE 4" IN DIAMETER.
- EACH STAIRWAY OF FOUR OR MORE RISERS SHALL PROVIDE A CONTINUOUS HANDRAIL ON AT LEAST ONE SIDE BETWEEN 34" AND 38" ABOVE THE NOSING OF THE TREADS.
- HANDRAILS SHALL HAVE A CIRCULAR CROSS SECTION OF 1-1/4" TO 2" OR OTHER APPROVED GRASPABLE SHAPE PER IRC R311.7.8.5.
- MINIMUM 6'-8" OF HEADROOM CLEARANCE IS REQUIRED IN STAIRWAYS.
- ENCLOSED ACCESSIBLE SPACE UNDER STAIRWAYS SHALL HAVE WALLS AND THE UNDERSIDE OF THE STAIR AND LANDING PROTECTED WITH 1/2" GYPSUM BOARD ON ENCLOSURE PER IRC

### **GARAGES**

- THE GARAGE FLOOR SHALL SLOPE 1/8" PER 12" TO DRAIN OR VEHICLE ENTRY DOORWAYS.
- DOORS BETWEEN THE GARAGE AND THE DWELLING TO BE: SELF CLOSING, MINIMUM 1-3/8" SOLID CORE OR HONEYCOMBED STEEL DOOR, AND AT LEAST 20 MINUTE FIRE RATED.
- THE GARAGE SHALL BE SEPARATED FROM THE DWELLING AND ITS ATTIC AREAS BY A MINIMUM 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE WHERE A FLOOR/CEILING SPACE IS PROVIDED ABOVE.
  - THE GARAGE COLUMNS AND BEAMS SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED WITH 1/2" GYPSUM BOARD OR EQUIVALENT.
- WHERE HABITABLE SPACE OCCURS ABOVE THE GARAGE FLOOR/CEILING ASSEMBLY SHALL BE PROTECTED WITH A MINIMUM 5/8" TYPE "X" GYPSUM BOARD ON THE GARAGE CEILING.
- GARAGE DOOR AND FRAME THE "H" FRAME FOR THE ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2X6 VERTICAL JAMBS RUNNING FROM THE FLOOR TO CEILINGS, ATTACHED WITH 1-3/4" X 0.120" NAILS AT 7" O.C. STAGGERED WITH (7) 3-1/4" X 0.120" NAILS THROUGH THE JAMB INTO THE HEADER, 2X8 HEADER (MINIMUM) FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
- GARAGE VEHICLE DOORS AND FRAMES SHALL BE DESIGNED AND INSTALLED TO MEET THE 115 MPH WIND LOAD REQUIREMENT OF DASMA 108 AND ASTM E330-96 (IRC R301.2.1).

- THE ROOF IS DESIGNED FOR 20 PSF GROUND SNOW LOAD (MINIMUM).
- PROVIDE 2X SOLID BLOCKING SUPPORT BELOW ALL POINT LOADS CONTINUOUS TO BEARING STRUCTURE AND/OR FOUNDATION BELOW.
- ROOF IS ENGINEERED TO COMPLY WITH IRC R802.
- ROOF TO BE ASPHALT SHINGLES UNO AND SHALL COMPLY WITH IRC 2018 SECT. R905.2
- MINIMUM ROOF SLOPE FOR ASPHALT SHINGLES SHALL BE 2:12.
- ROOF SLOPES IN BETWEEN 2:12 AND 4:12 SHALL REQUIRE DOUBLE UNDERLAYMENT IN ACCORDANCE WITH IRC 2018 SECTION R905.2.2:
- "APPLY A 19-INCH (483MM) STRIP OF UNDERLAYMENT FELT PARALLEL TO AND STARTING AT THE EAVES, FASTENED SUFFICIENTLY TO HOLD IN PLACE. STARTING AT THE EAVE, APPLY 36-INCH-WIDE (914 MM) SHEETS OF UNDERLAYMENT, OVERLAPPING SUCCESSIVE SHEETS 19 INCHES (483MM), AND FASTENED SUFFICIENTLY TO HOLD IN PLACE. END LAPS SHALL BE 4-INCH (102MM) AND SHALL BE OFFSET BY 6 FEET (1829 MM). DISTORTIONS IN THE UNDERLAYMENT SHALL NOT INTERFERE WITH THE ABILITY OF THE SHINGLES TO SEAL."

### SAFETY REQUIREMENTS

# I.1 EMERGENCY EGRESS AND RESCUE

- PROVIDE ONE WINDOW FROM EACH BEDROOM THAT HAS A MINIMUM OPENABLE AREA OF 5.7
- SQ. FT. WITH A MINIMUM OPENABLE HEIGHT OF 24" AND WIDTH OF 20". BASEMENT EGRESS TO MEET THE REQUIREMENTS OF IRC R310.

# SMOKE AND CARBON MONOXIDE SAFETY (PER IRC R314)

- PROVIDE SMOKE ALARMS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA AND ON EACH FLOOR INCLUDING BASEMENTS.
- SMOKE ALARMS SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE DWELLING.

# CARBON MONOXIDE DETECTORS SHALL BE INSTALLED AS REQUIRED PER IRC R315.

- (THE FOLLOWING SHALL APPLY UNLESS "ECA" SHEETS HAVE BEEN INCLUDED IN THE PLAN SET)
- LIGHTING FIXTURES PENETRATING THE THERMAL ENVELOPE SHALL BE IC-RATED, LEAKAGE RATED AND SEALED TO THE GYPSUM WALLBOARD AS REQUIRED PER IRC N1102.4.5.
- PROGRAMMABLE THERMOSTATS SHALL BE INSTALLED AS REQUIRED PER IRC N1103.1.1. AIR HANDLERS SHALL BE RATED FOR MAXIMUM 2% AIR LEAKAGE RATE PER IRC N1103.3.2.1.
- BUILDING FRAMING CAVITIES SHALL NOT BE USED AS DUCTS OR PLENUMS.

HOT WATER PIPES SHALL BE INSULATED AS REQUIRED PER IRC N1103.4.

ALL EXHAUST FANS SHALL TERMINATE TO THE BUILDING EXTERIOR AS REQUIRED PER IRC

MAKEUP AIR SYSTEMS SHALL BE INSTALLED FOR KITCHEN EXHAUST HOODS THAT EXCEED 400

EX

FV

FJ

FTG

FND

HDR

STL

TYP

CFM AS REQUIRED PER IRC M1503.6. AN AIR HANDLING SYSTEM SHALL NOT SERVE BOTH THE LIVING SPACE AND THE GARAGE PER IRC M1601.6 ENERGY CONSERVATION.

### **ABBREVIATIONS**

BOT

CJ

CXN

ABOVE FINISHED FLOOR AΒ ANCHOR BOLT BM BEARING BELOW FINISHED FLOOR BFF

CEILING JOIST

CONNECTION

BRACED WALL LINE

CLR CLEAR COL COLUMN CONC CONCRETE CONCRETE MASONRY UNIT

BOTTOM

CONT CONTINUOUS DOUBLE DIAMETER DIA EW **EACH WAY** EFF EFFECTIVE

**ELEVATION** END CONDITION ENGINEER OF RECORD EΩ FQUAL **EQUIV EQUIVALENT** 

EFP EQUIVALENT FLUID PRESSURE

HORZ HORIZONTAL MAX MAXIMUM MINIMUM MIN NTS NOT TO SCALE OC ON CENTER PED PEDESTAL PCF POUNDS PER CUBIC FOOT POUNDS PER LINEAR FOOT POUNDS PER SQUARE FOOT PSI POUNDS PER SQURE INCH PRESSURE TREATED PT RAF RAFTER STRUCTURAL INSULATED PANEL SIP

STEEL

VERT VERTICAL

TYPICAL

UNO UNLESS NOTED OTHERWISE

EXISTING

FOOTING

HEADER

FIELD VERIFY

FLOOR JOIST

FOUNDATION

FINISHED FLOOR

8/2<mark>8/2024</mark>E1F98.20NPTMU

S

0

SW

2

HANNAH

NUMBER

PE-2023046346 10/29/2024

EVERSTEAD

3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

everstead.com (816)399-490°


CHRISTINE

REVISIONS

**STRUCTURAL GENERAL NOTES** 

SCALE

DEVEASPINENTATERO 11/01/2024 4:04:46

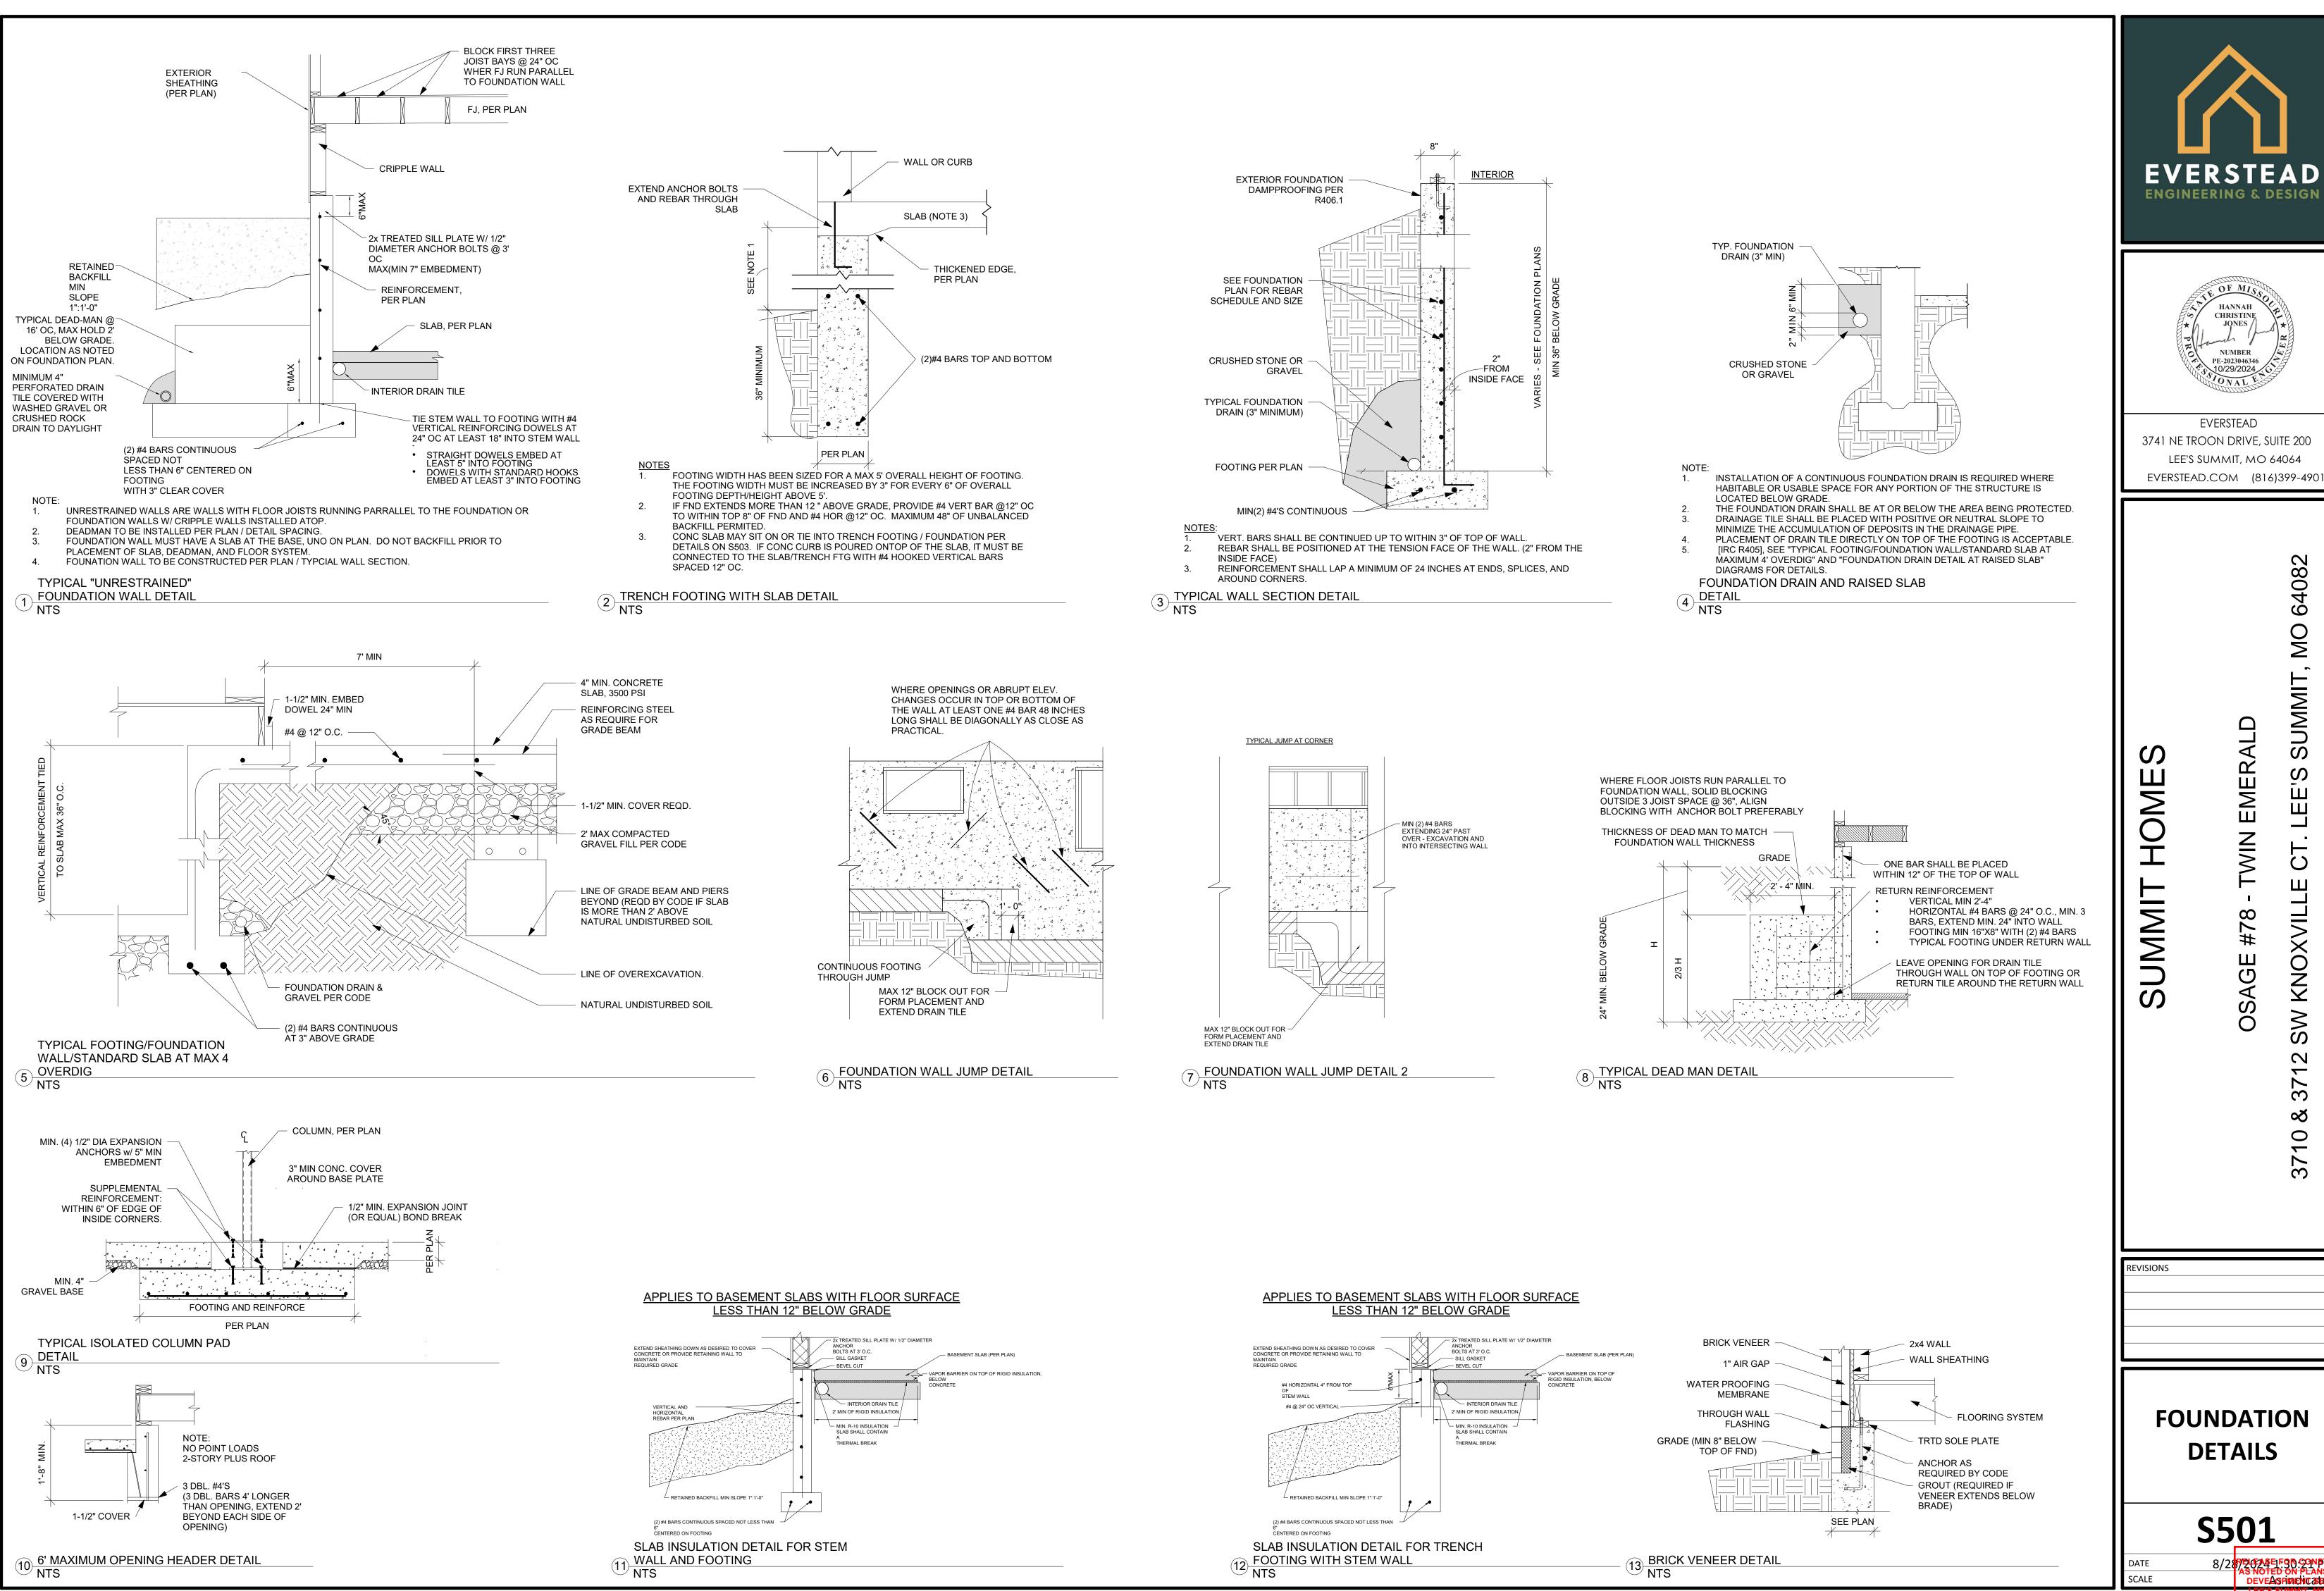

**ENGINEERING & DESIGN** 

HANNAH

NUMBER

PE-2023046346

**EVERSTEAD** 

LEE'S SUMMIT, MO 64064

10/29/2024

CHRISTINE


(D

UMMIT, S KNO 7

64082

**FOUNDATION DETAILS** 

**S501** 8/28/9/6/A&E1F.9.6 CONFITMU AS NOTED ON PLANS RE DEVEASRINENICATES OF

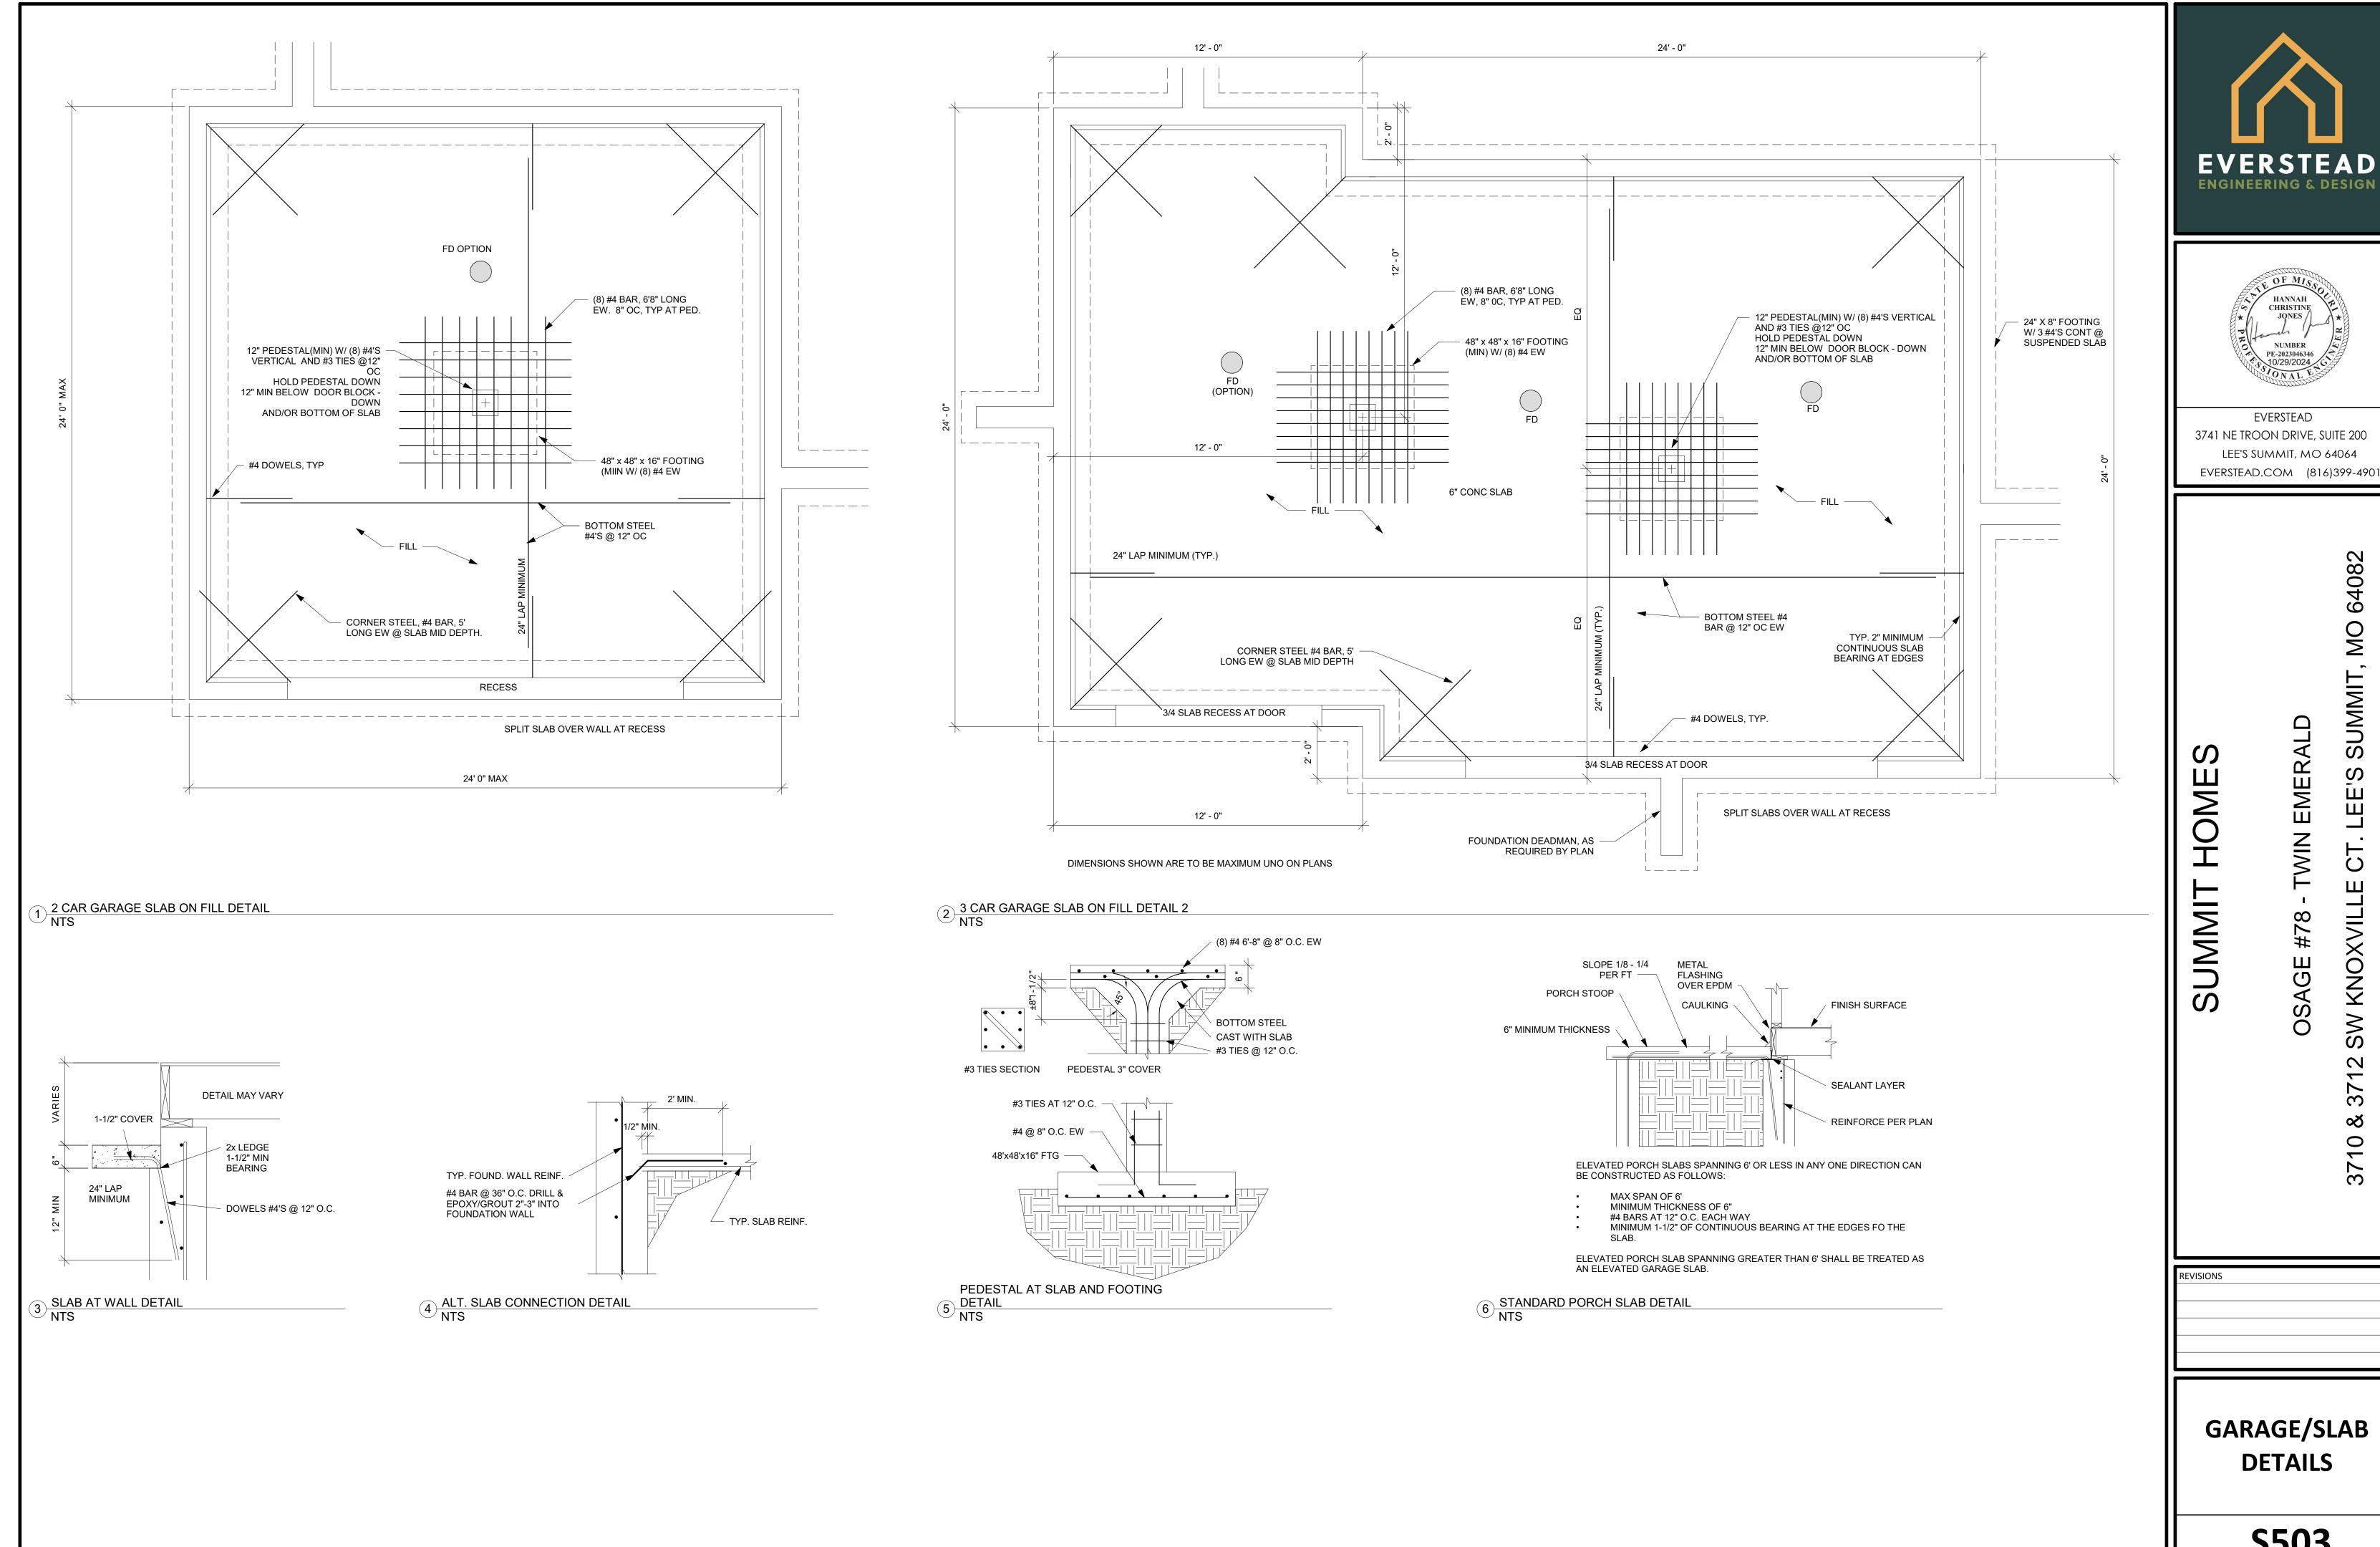

SAG

**S503** 

SCALE


8/28/9/6/A&EIFOR CONPTRIUM AS NOTED ON PLANS RE DEVEASHINDICATERON

11/01/2024 4:04:46

KNOXVILLE 2

**EVERSTEAD** 



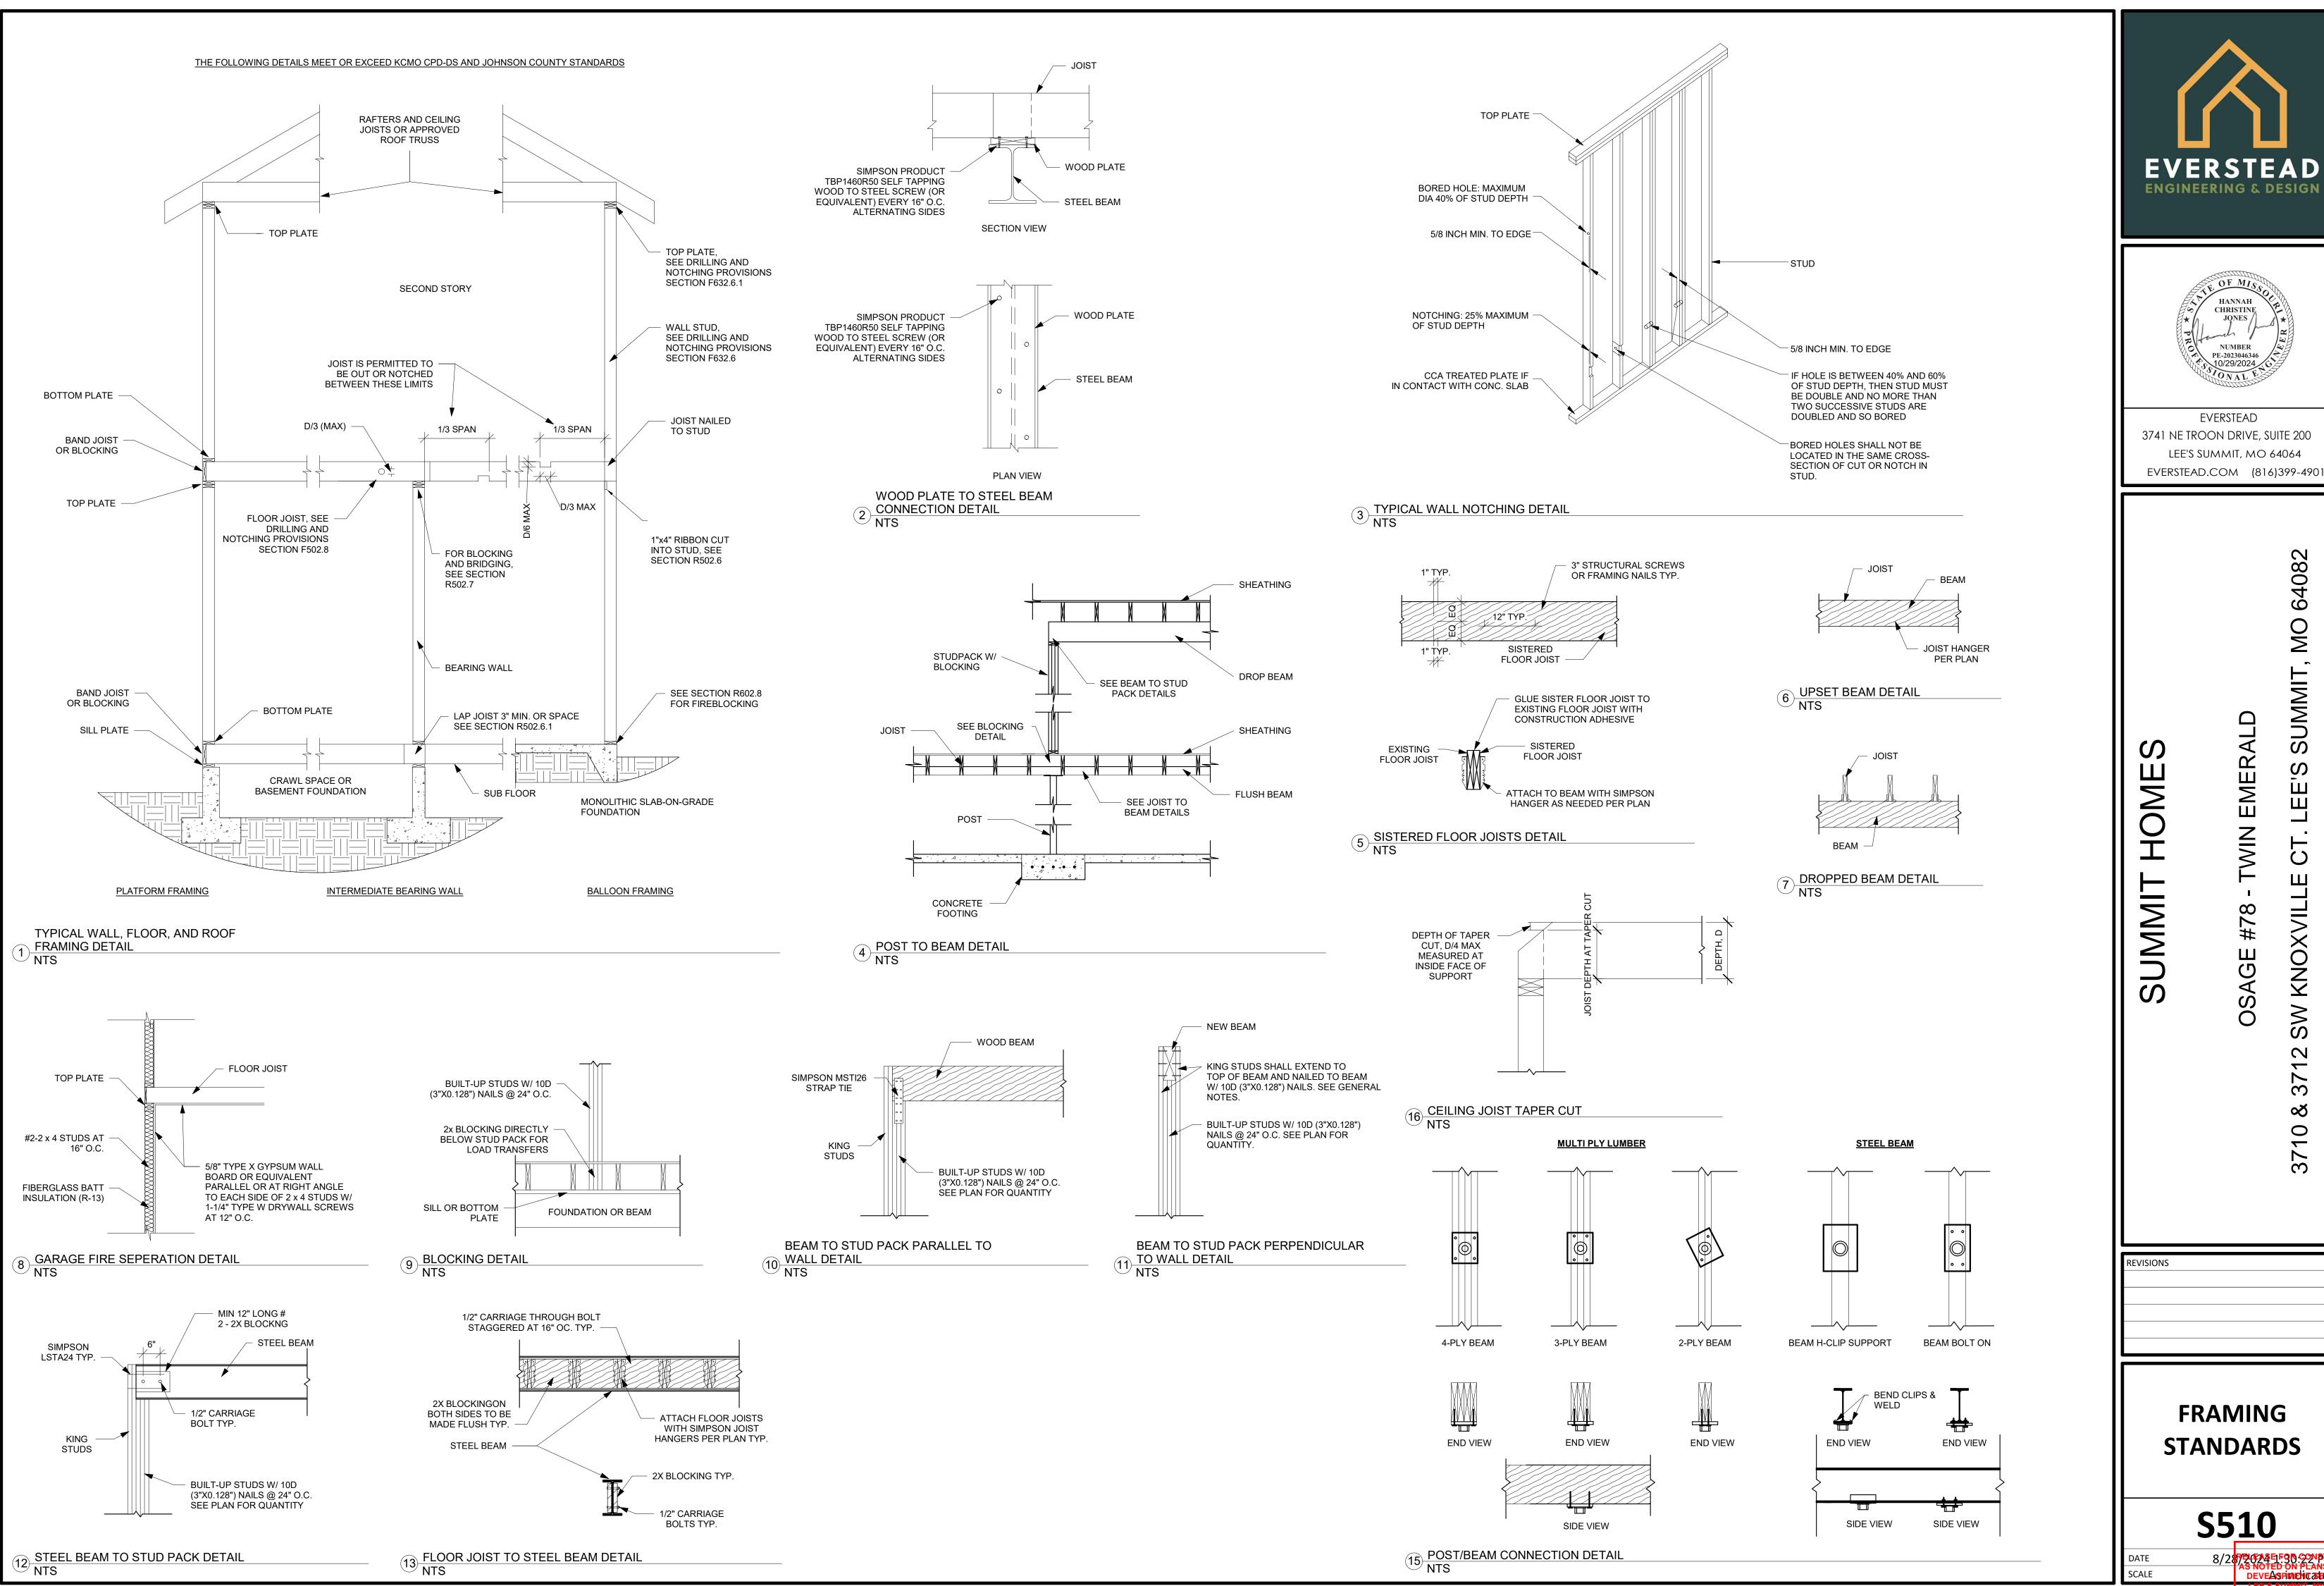



Ŋ

64082 SUMMIT, KNO 2

HANNAH CHRISTINE

NUMBER

PE-2023046346


**EVERSTEAD** 

LEE'S SUMMIT, MO 64064



**S510** 

8/28/9/6/45 F.96 CONFINU AS NOTED ON PLANS RE DEVEASFINENT STEECH

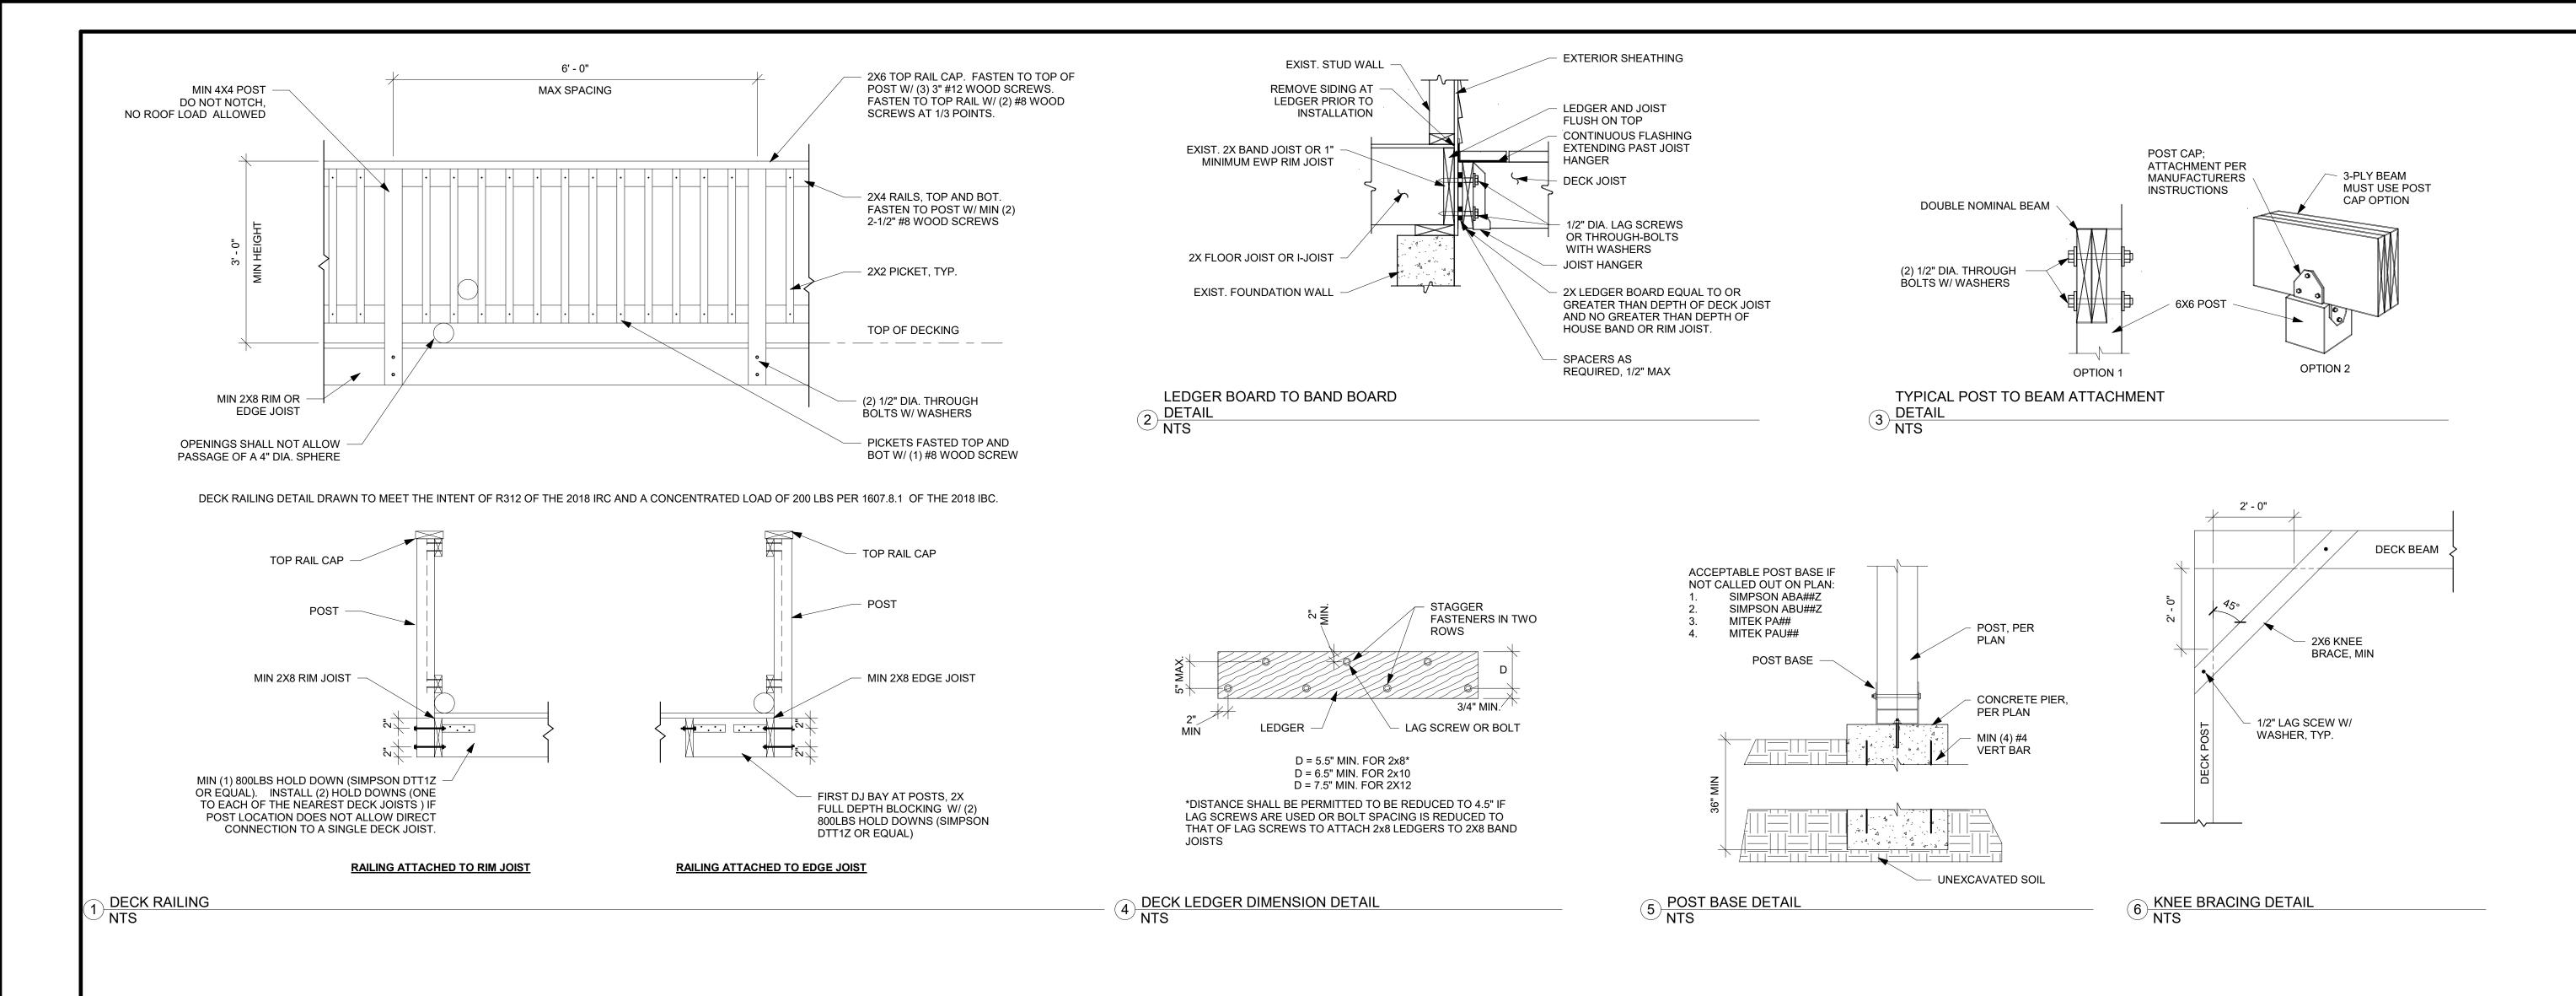

	BLE R507.9.1.3( 'E LOAD = 40 P					SF)	
			J	IOIST SPAN			
CONNECTION DETAILS	6' AND LESS	6'1" TO 8'	8'1" TO 10'	10'1" TO 12'	12'1" TO 14'	14'1" TO 16'	16'1" TO
		ON-CE	NTER SPAC	NG OF FASTE	ENERS (INCHI	ES)	
1/2" DIAMETER LAG SCREW WITH 1/2" MAXIMUM SHEATHING	30	23	18	15	13	11	10
1/2" DIAMETER BOLT WITH 1/2" MAXIMUM SHEATHING	36	36	34	29	24	21	19
1/2" DIAMETER BOLT WITH 1" MAXIMUM SHEATHING	36	36	29	24	21	18	16

DECK LEDGER CONNECTION TO BAND

JOIST (R507.9.1.3(1))

ER EM SAGE

**ENGINEERING & DESIGN** 

HANNAH CHRISTINE

NUMBER PE-2023046346 10/29/2024

**EVERSTEAD** 3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901

64082

SUMMIT,

KNOXVILLE


**DECK DETAILS** 

**S520** 

DATE SCALE

REVISIONS

8/28/5/45/ASELFOR CONPTRUCT
AS NOTED ON PLANS REV
DEVEASRING TO THE CONTROL OF TH

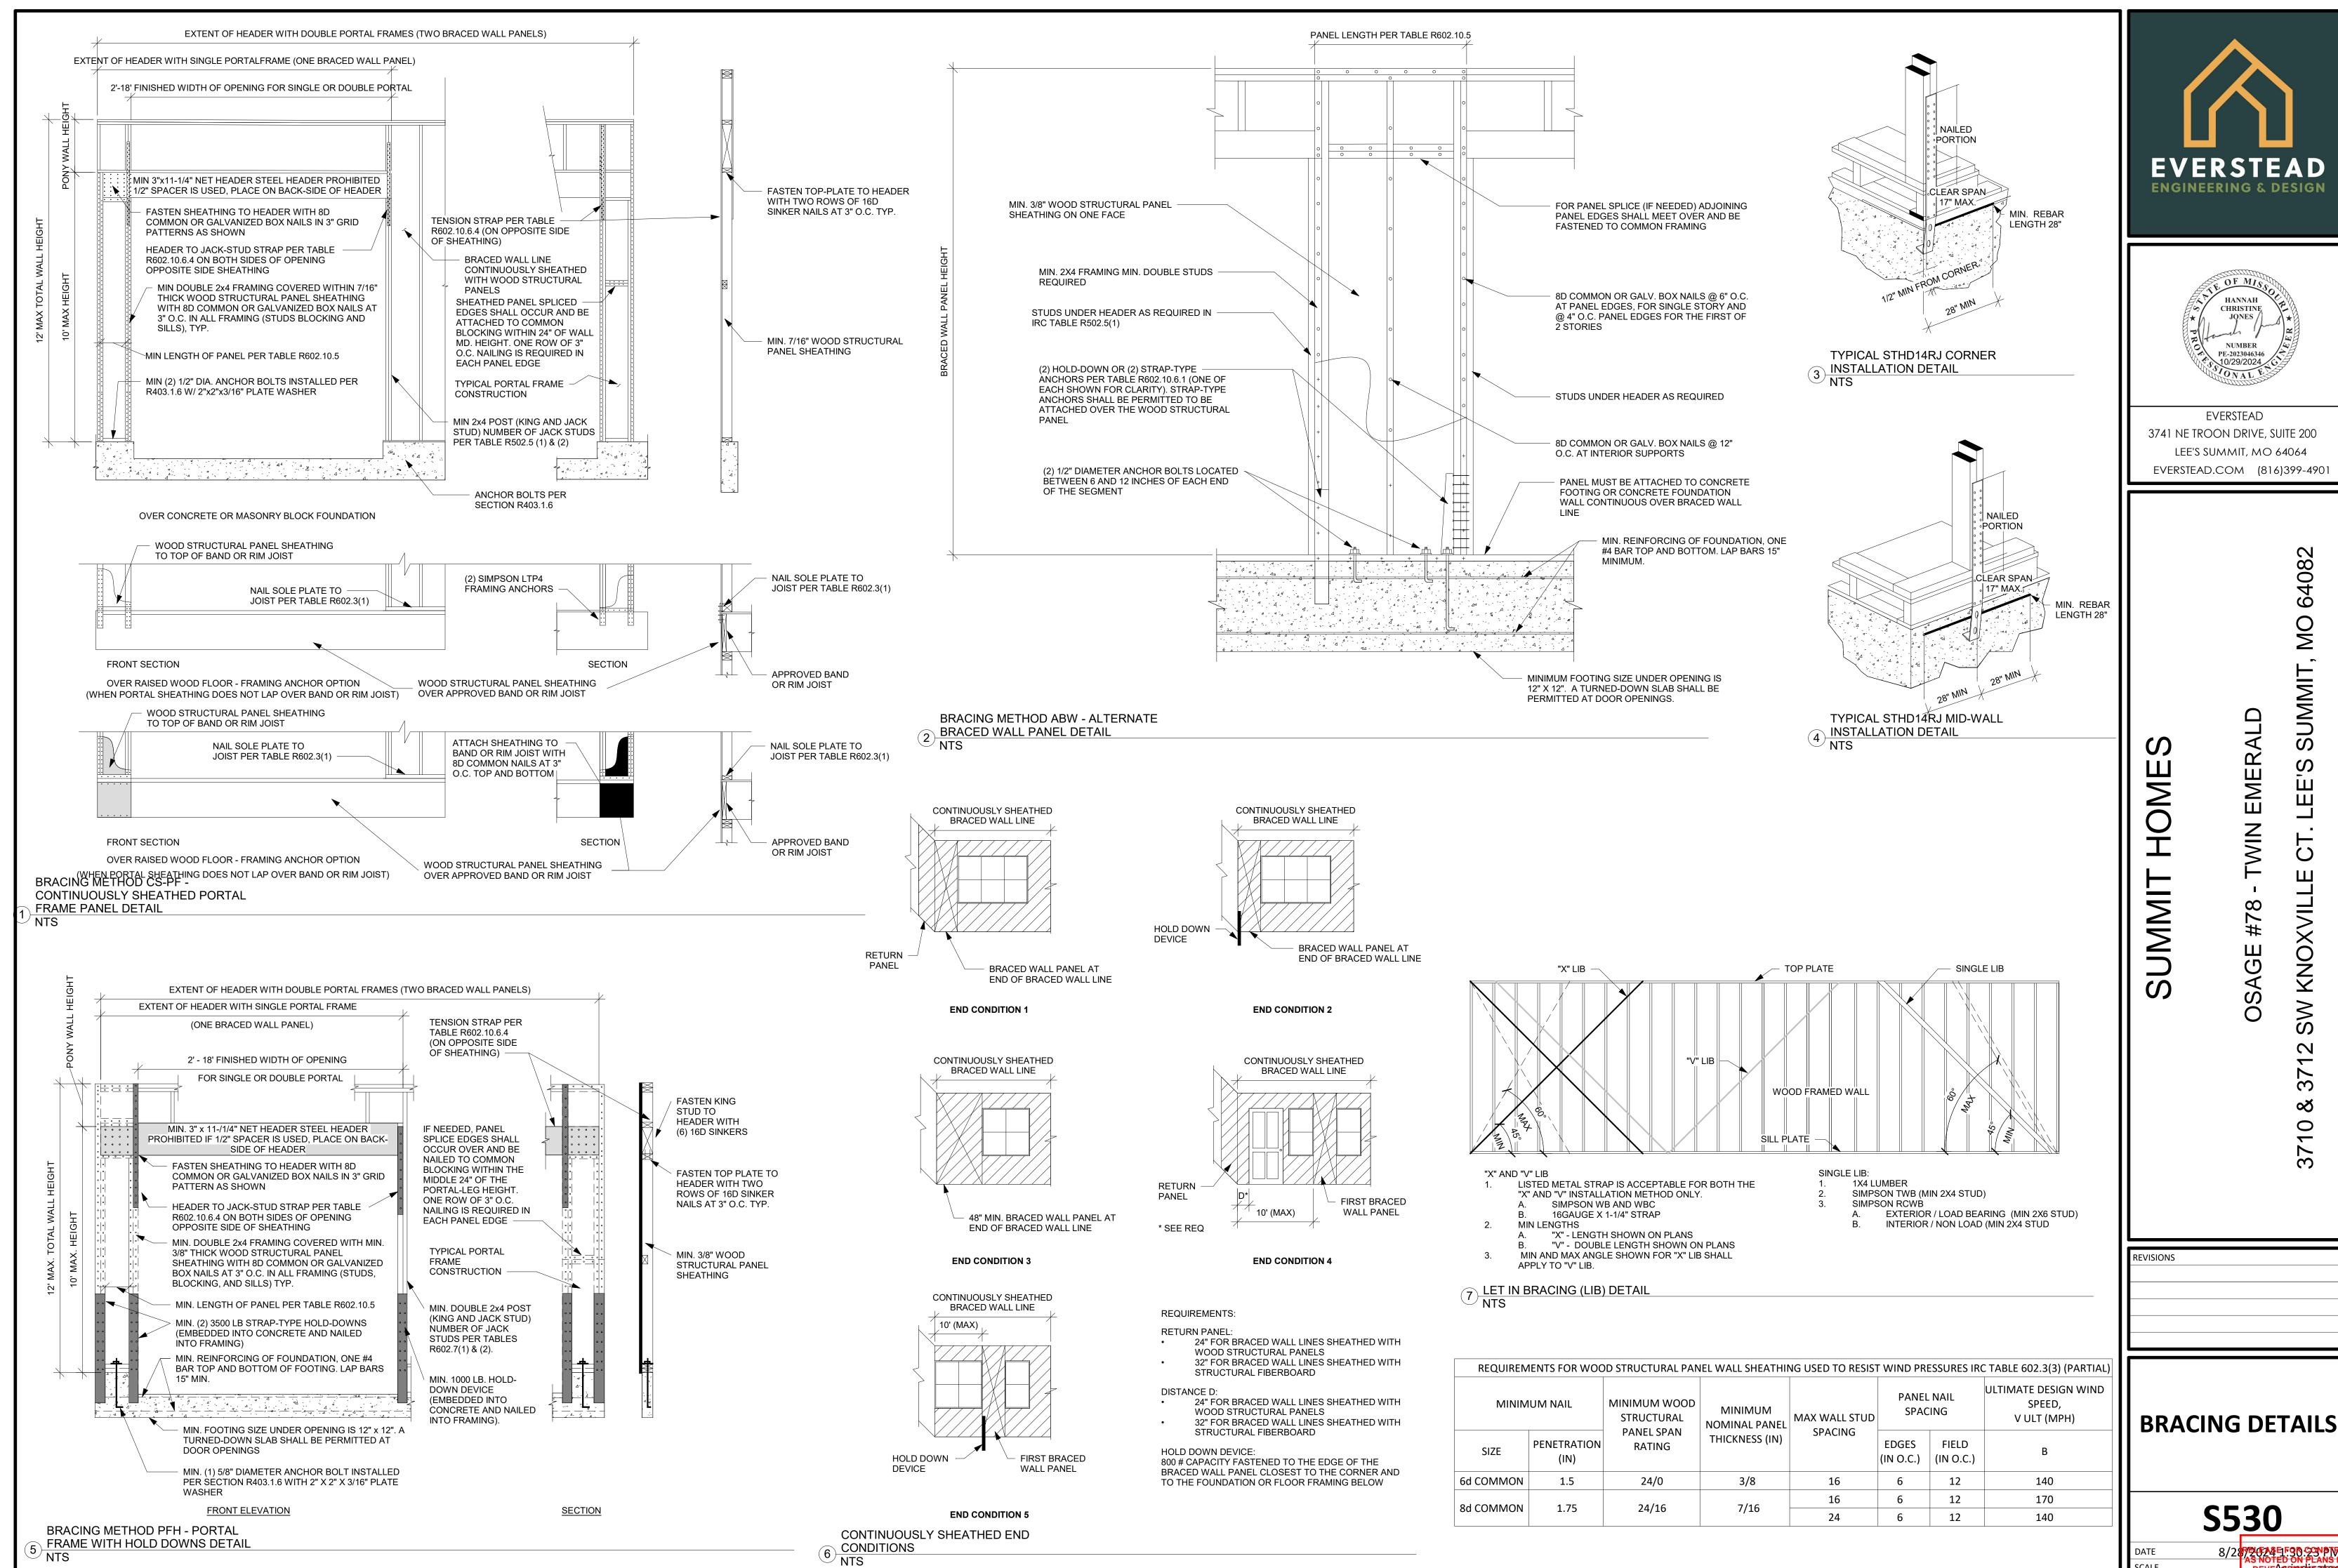

HANNAH

NUMBER

PE-2023046346

**EVERSTEAD** 

10/29/2024

CHRISTINE

UMMIT, S 0 2

**S530** 8/287962451F90.2309701 AS NOTED ON PLANS RI DEVEASRIMENICATERO

11/01/2024 4:04:47


SCALE

	BRACING METHODS TABLE R602	10.4 (PARTIAL)	
METHODS MATERIAL	CONNECTION CRI	TERIA	
METHODS, MATERIAL	THICKNESS	FASTENERS	SPACING
WSP - WOOD STRUCTURAL PANEL AND CS-WSP CONTINUOUSLY SHEATHED	3/8" PANEL W/ MINIMUM 24/0 STRUCTURAL PANEL SPAN RATING	6d COMMON NAILS (2.0" x .113") W/ MINIMUM 1.5" PENETRATION	6" EDGES, 12" FIELD
WOOD STRUCTURAL PANEL	7/16" PANEL W/ MINIMUM 24/16 STRUCTURAL PANEL SPAN RATING	8d COMMON NAILS (2.5" x .131") W/ MINIMUM 1.75" PENETRATION	6" EDGES, 12" FIELD
PFH - PORTAL FRAME WITH HOLD-DOWNS	3/8"	SEE DETAIL ON THIS PAGE	SEE DETAIL ON THIS PAGE
PFG - PORTAL FRAME AT GARAGE	3/8"	SEE IRC SECTION R602.10.6.3	SEE IRC SECTION R602.10.6.3
LIB LET-IN-BRACING	1x4 WOOD OR APPROVED METAL	WOOD: 2-8d COMMON NAILS OR 3-8d (2-1/2" LONG x .113" DIA.) NAILS	WOOD: PER STUD AND TOP AND BOTTOM PLATES
	STRAPS AT 45 TO 60 DEGREE ANGLES FOR MAX 16" STUD SPACING	SIMPSON WB/WBC INSTALLED IN "X" PAIRS OR IN OPPOSING "V" FASHION AND FASTENED W/ (2) 16d COMMON NAILS FOR PLATE AND (1) 8d COMMON NAIL FOR STUDS	METAL: PER STUD AND TOP AND BOTTOM PLATES
		1/2" INTERIOR SHEATHING W/ STUDS AT 16" O.C.: 13 GAGE, 1-3/8" LONG, 19/64" HEAD; .098" DIA., 1-1/4" LONG, ANNULAR-RINGED; 5d COOLER NAIL, .086" DIA., 1-5/8" LONG, 15/64" HEAD; OR GYPSUM BOARD NAIL, .086" DIA. 1-5/8" LONG, 9/32" HEAD PER TABLE R702.3.5 (SEE TABLE FOR OTHER PANEL THICKNESS OPTIONS)	FOR ALL BRACED WALL PANEL
GB-GYPSUM BOARD	1/2"	EXTERIOR 1/2" SHEATHING: 1-1/2" GALVANIZED ROOFING NAIL; STAPLE GALVANIZED, 1-1/2" LONG; 1-1/4" SCREWS, TYPE W OR S PER TABLE R602.3(1)	LOCATIONS: 7" EDGES (INCLUDING TOP AND BOTTOM PLATES) 7" FIELD
		EXTERIOR 5/8" SHEATHING: 1-3/4" GALVANIZED ROOFING NAIL; STAPLE GALVANIZED, 1-5/8" LONG; 1-5/8" SCREWS, TYPE W OR S PER TABLE R602.3(1)	

DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENER	SPACING AND LOCATION OF FASTENERS		
	ROOF			
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	4-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	TOE NAIL		
CEILING JOISTS TO PLATE	4-8d BOX (2-1/2"x0.131") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10 BOX (3"x0.128") OR 3-3"x0.131" NAILS	TOE NAIL		
CEILING JOISTS NOT ATTACHED TO PARALLEL RAFTER LAPS OVER PARTITIONS	4-10d BOX (3"x0.128") OR 3-16d COMMON (3-1/2"x0.162") OR 4-3"x0.131" NAILS	FACE NAIL		
COLLAR TIE TO RAFTER, FACE NAIL OR 1-1/4"x20 GAGE RIDGE STRAP	4-10d BOX (3"x0.128") OR 3-10d COMMON (3"x0.148") OR 4-3"x0.131" NAILS	FACE NAIL EACH RAFTER		
RAFTER OR ROOF TRUSS TO TOP PLATE, TOE NAIL	4-16d BOX (3-1/2"x0.135") OR 3-10d COMMON (3"x0.148") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	2 TOE NAILS ON ONE SIDE AND 1 TOE NAIL ON OPPOSITE SIDE OF EACH RAFTER OR TRUSS		
ROOF RAFTERS TO	4-16d BOX (3-1/2"x0.135") OR 3-10d COMMON (3"x0.148") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	TOE NAIL		
RIDGE, VALLEY OR HIP RAFTERS	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	END NAIL		
	WALL			
STUD TO STUD (NOT	16d COMMON (3-1/2"x0.162")	24" O.C. FACE NAIL		
AT BRACED WÀLL PANELS)	10d BOX (3"x0.128") OR 3"x0.131" NAIL	16" O.C. FACE NAIL		
STUD TO STUD AND ABUTTING STUDS AT	16d BOX (3-1/2"x0.135") OR 3"x0.131" NAIL	12" O.C. FACE NAIL		
INTERSECTION WALL CORNERS (AT BRACED WALL PANELS)	16d COMMON (3-1/2"x0.162")	16" O.C. FACE NAIL		
BUILT-UP HEADER, TWO PIECES	16d COMMON (3-1/2"x0.162")	16" O.C. EACH EDGE FACE NAIL		
WITH 1/2" SPACER	16d BOX (3-1/2"x0.135")	12" O.C. EACH EDGE FACE NAIL		
CONTINUOUS HEADER TO STUD	5-8d BOX (2-1/2"x0.113") OR 4-8d COMMON (2-1/2"x0.131") OR 4-10d BOX (3"x0.128")	TOE NAIL		
	16d COMMON (3-1/2"x0.162")	16" O.C. FACE NAIL		
TOP PLATE TO TOP PLATE	10d BOX (3"x0.128") OR 3"x0.131" NAIL	12" O.C. FACE NAIL		
DOUBLE TOP PLATE SPLICE	8-16d COMMON (3-1/2"x0.162") OR 12-16d BOX (3-1/2"x0.135") OR 12-10d BOX (3"x0.128") OR 12-3"x0.131" NAILS	FACE NAIL ON EACH SIDE OF END JOINT (MINIMUM 24" LAP SPLICE LENGTH EACH SIDE OF END JOINT)		
BOTTOM PLATE TO JOIST, RIM JOIST,	16d COMMON (3-1/2"x0.162")	16" O.C. FACE NAIL		
BAND JOIST, OR BLOCKING (NOT BRACED WALL PANELS)	-16d BOX (3-1/2"x0.135") OR 3"x0.131" NAIL	12" O.C. FACE NAIL		
BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST, OR BLOCKING (AT BRACED WALL PANELS)	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162") OR 4-3"x0.131" NAILS	3 EACH 16" O.C. FACE NAIL 2 EACH 16" O.C. FACE NAIL 4 EACH 16" O.C. FACE NAIL		
	4-8d BOX (2-1/2"x0.113") OR 3-16d BOX (3-1/2"x0.135") OR 4-8d COMMON (2-1/2"x0.131") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	TOE NAIL		
TOP OR BOTTOM PLATE TO STUD	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	END NAIL		
TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS	3-10d BOX (3"x0.128") OR 2-16d COMMON (3-1/2"x0.162") OR 3-3"x0.131" NAILS	FACE NAIL		
1" BRACE TO EACH STUD AND PLATE	3-8d BOX (2-1/2"x0.113") OR 2-8d COMMON (2-1/2"x0.131") OR 2-10d BOX (3"x0.128") OR 2 STAPLES 1-3/4"	FACE NAIL		
1"x6" SHEATHING TO EACH BEARING	3-8d BOX (2-1/2"x0.113") OR 2-8d COMMON (2-1/2"x0.131") OR 2-10d BOX (3"x0.128") OR 2 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	FACE NAIL		
1"x8" AND WIDER SHEATHINGTO	3-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 3 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG			
EACH BEARING	WIDER THAN 1"x8": 4-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 4 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	FACE NAIL		

DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENER	SPACING AND LOCATION OF FASTENERS		
	FLOOR	T		
JOIST TO SILL, TOP PLATE, OR GIRDER	4-8d BOX (2-1/2"x0.113") OR 3-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	то	E NAIL	
RIM JOIST, BAND JOIST OR	8d BOX (2-1/2"x0.113")	4" O.C.	TOE NAIL	
BLOCKING TO SILL OR TOP PLATE (ROOF APPLICATIONS ALSO)	8d COMMON (2-1/2"x0.131") OR 10d BOX (3"x0.128") OR 3"x0.131" NAIL	6" O.C.	TOE NAIL	
1"x6" SUBFLOOR OR LESS TO EACH JOIST	3-8d BOX (2-1/2"x0.113") OR 2-8d COMMON (2-1/2"x0.131") OR 3-10d BOX (3"x0.128") OR 2 STAPLES, 1" CROWN, 16 GA., 1-3/4" LONG	FAC	CE NAIL	
2" SUBFLOOR TO JOIST OR GIRDER	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162")	BLIND AN	D FACE NAIL	
2" PLANKS (PLANK & BEAM-FLOOR & ROOF)	3-16d BOX (3-1/2"x0.135") OR 2-16d COMMON (3-1/2"x0.162")	AT EACH BEA	RING FACE NAIL	
BAND OR RIM JOIST TO JOIST	3-16d COMMON (3-1/2"x0.162") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS OR 4 3"x14 GA. STAPLES, 7/16" CROWN	EN	D NAIL	
	20d COMMON (3"x0.128")	O.C AT TOP EN	ER AS FOLLOWS: 32' D AND BOTTOM AND GGERED.	
BUILT-UP GIRDERS AND BEAMS, 2" LUMBER LAYERS	10d BOX (3"x0.128") OR 3"x0.131" NAIL	BOTTOM STAGO	E NAIL AT TOP AND GERED ON OPPOSITI SIDES	
	AND: 2-20d COMMON (4"x0.192") OR 3-10d BOX (3"x0.128") OR 3-3"x0.131" NAILS	FACE NAIL AT ENDS AND AT EAC SPLICE		
LEDGER STRIP SUPPORTING JOISTS OR RAFTERS	4-16d BOX (3-1/2"x0.135") OR 3-16d COMMON (3-1/2"x0.162") OR 4-10d BOX (3"x0.128") OR 4-3"x0.131" NAILS	AT EACH JOIST OR RAFTER, FAC NAIL		
BRIDGING OR BLOCKING TO JOIST	2-10d BOX (3"x0.128") OR 2-8d COMMON (2-1/2"x0.131") OR 2-3"x0.131" NAILS	EACH END, TOE NAIL		
DESCRIPTION OF BUILDING MATERIALS	NUMBER AND TYPE OF FASTENER	EDGES (IN)	INTERMEDIATE SUPPORTS (IN)	
F	ELS, SUBFLOOR, ROOF AND INTERIOR WALL SEPARTICLEBOARD WALL SHEATHING TO FRAMIN OOD STRUCTURAL PANEL EXTERIOR WALL SH	G		
3/8" - 1/2"	6d COMMON (2"x0.113") NAIL (SUBFLOOR, WALL) OR 8d COMMON (2-1/2"x0.131") NAILS (ROOF) OR RSRS-01 (2-3/8"x0.113") NAIL (ROOF)	6	12	
19/32" - 1"	8d COMMON NAIL (2-1/2"x0.131") OR RSRS-01 (2-3/8"x0.113") NAIL (ROOF)	6 12		
1-1/8" - 1-1.4"	10d COMMON (3"x0.148") NAIL OR 8d (2-1/2"x0.131") DEFORMED NAIL	6 12		
	OTHER WALL SHEATHING		I	
1/2" STRUCTURAL CELLULOSIC FIBERBOARD SHEATHING	1-1/2" GALVANIZED ROOFING NAIL, 7/16" HEAD DIAMETER OR 1-1/4" LONG 16 GA. STAPLE WITH 7/16" OR 1" CROWN	3	6	
25/32" STRUCTURAL CELLULOSIC FIBERBOARD SHEATHING	1-3/4" GALVANIZED ROOFING NAIL, 7/16" HEAD DIAMETER OR 1-1/2" LONG 16 GA. STAPLE WITH 7/16" OR 1" CROWN	3	6	
1/2" GYPSUM INTERIOR COVERING (R702.3.5)	1-1/2" GALVANIZED ROOFING NAIL: STAPLE GALVANIZED, 1-1/2" LONG; 1-1/4" SCREWS, TYPE "W" OR "S"	7	7	
5/8" GYPSUM INTERIOR COVERING (R702.3.5)	1-3/4" GALVANIZED ROOFING NAIL: STAPLE GALVANIZED, 1-5/8" LONG; 1-5/8" SCREWS, TYPE "W" OR "S"	7	7	
WOOD STRUCTURAL	PANELS, COMBINATION SUBFLOOR UNDERLAY	YMENT TO FRAMIN	IG	
3/4" AND LESS	6d DEFORMED (2"x0.120") NAIL OR 8d COMMON (2-1/2"x0.131") NAIL	6	12	
7/8" - 1"	8d COMMON (2-1/2"x0.131") NAIL OR 8d DEFORMED (2-1/2"x0.120") NAIL	6 12		
	10d COMMON (3"x0.148") NAIL OR			





EVERSTEAD 3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901

WIN EMERALD

OSAGE

SUMMIT, MO 64082

LEE'S


3710 & 3712 SW KNOXVILLE

**FASTENING SCHEDULE** 

S5<u>50</u>

REVISIONS

8/28/PLOFASEIFOR CONPTRICE
AS NOTED ON PLANS REVIL
DEVELD/MENTISEBVICES
LEE'S SUMMIT, MISSOURI
11/01/2024 4:04:47

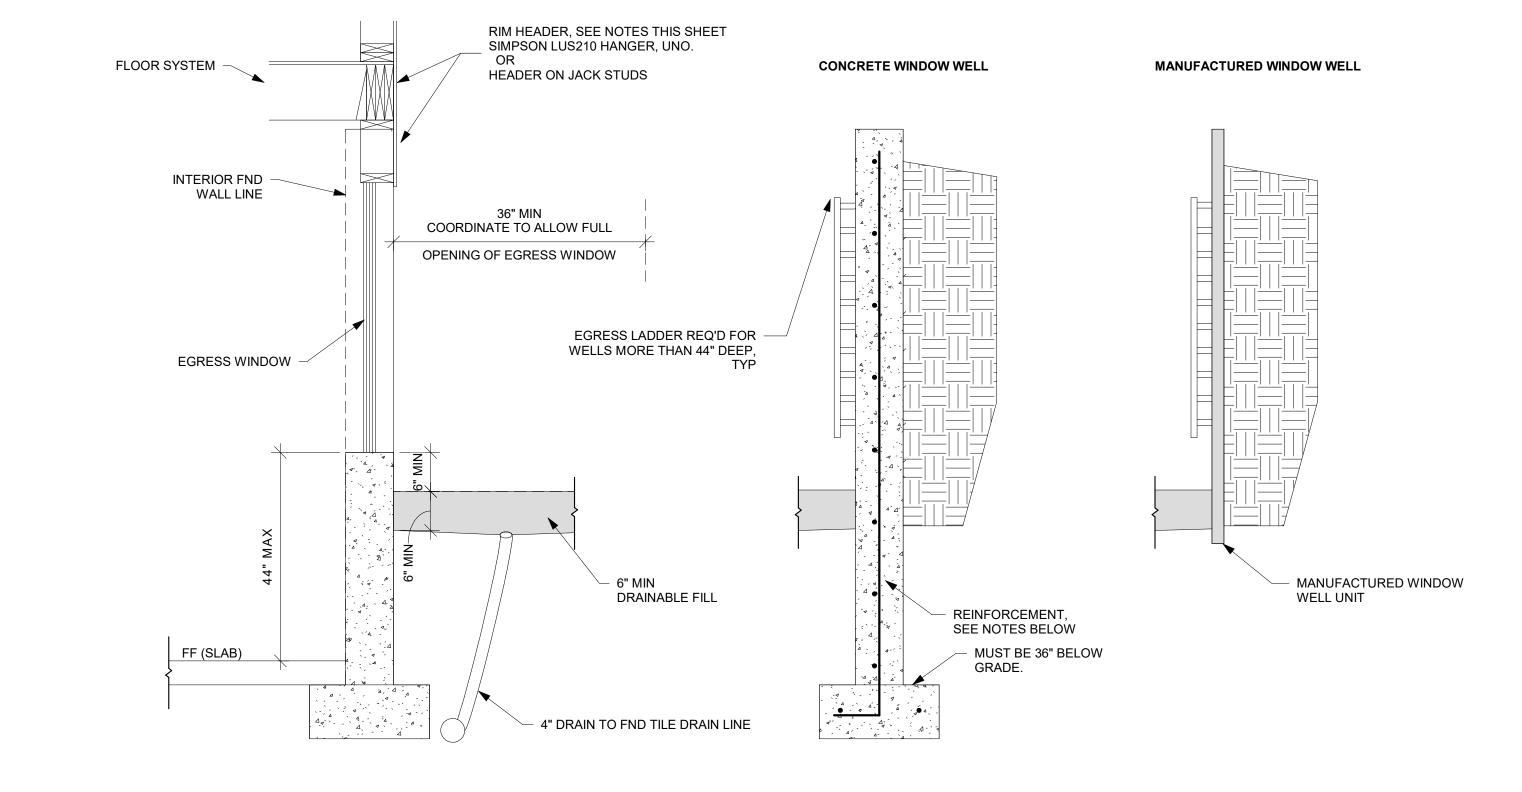

WINDOW WELL MUST MEET REQUIREMENT IN R310.2.6 OF THE IRC AND LOCALLY ADOPTED CODE CONCRETE WINDOW WELL

INTALLED WITH NEW FOUNDATION POUR WINDOW WELL MONOLITHICALLY WITH ADJACENT FND WALL. REINFORCEMENT


MATCH ADJACENT WALL REINFORCEMENT, SEE PLANS B. INSTALLED TO EXISTING FOUNDATION a. REINFORCEMENT

#4 BAR @ 12" OC EW IN WALLS DRILL AND EXPOY HOR BAR INTO EX FND, MIN 6" EMBEDMENT INTO EX FND WALL.

(2) #4 BAR CONT IN WALL FTG. b. SEAL WHERE NEW CONCRETE IS POURED AGAINST EX FND WITH MASTIC STRIPS OR OTHER WATER STOP MATERIAL.

MANUFACTURED WINDOW WELL A. INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS COORDINATE DEPTH OF WELL WITH WINDOW AND MANUFACTURER REQUIREMENTS.

SECTION

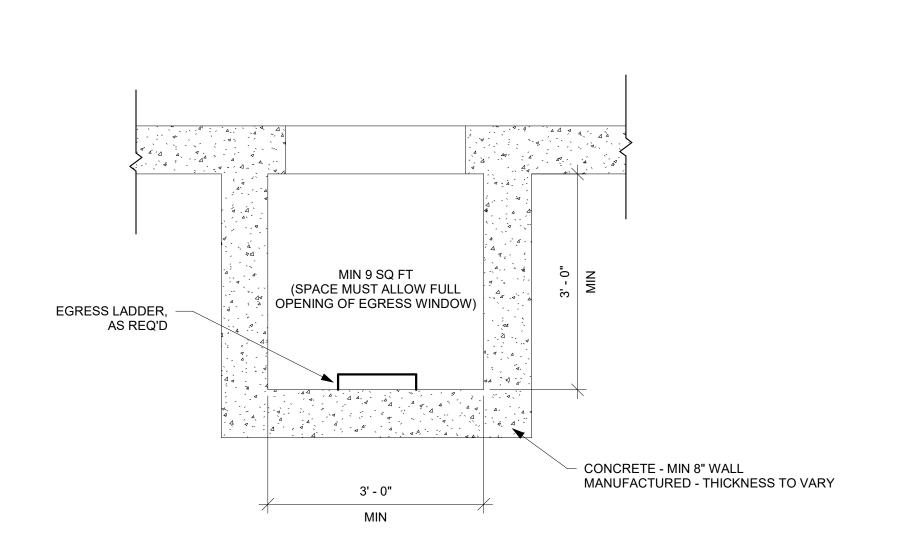

PLAN

# SUMMIT

REVISIONS

 $\mathbb{Z}$ SAGI

**ENGINEERING & DESIGN** 

CHRISTINE

NUMBER PE-2023046346

EVERSTEAD 3741 NE TROON DRIVE, SUITE 200

LEE'S SUMMIT, MO 64064

EVERSTEAD.COM (816)399-4901

64082

UMMIT,

S

KNOXVILLE

3710

**EGRESS WINDOWS** 

**S560** SCALE

8/28/9/6/45 F96 92/9 MU AS NOTED ON PLANS RE DEVEASHINENIC & LEE ON I 11/01/2024 4:04:47

WINDOW EGRESS (NTS)

FF ELEV

VARIES (SEE TABLE)

**SINGLE HUNG WINDOW** 

EGRESS WINDOWS MUST CONFORM TO R310 OF THE 2018 IRC

200 SERIES

400 SERIES

250 SERIES

150 SERIES

V-2500

V-4500

MIN NET CLEAR HEIGHT SHALL BE NOT LESS THAN 2 FT MIN NET CLEAR WIDTH SHALL BE NOT LESS THAN 20 INCH

MIN CLEAR OPENING

MATERIAL, AND STYLE.

**MANUFACTURER** 

ANDERSON

ANDERSON

JELD-WEN

JELD-WEN

PELLA

PELLA

1' - 8"

MIN CLEAR

**CASEMENT WINDOW** 

MINIMUM WINDOW SIZES SHOWN BELOW ARE SPECIFIC TO THE MANUFACTURER AND VINYL WINDOW MODEL NUMBER LISTED. THE CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF WINDOW SIZES WITH THE SELECTED MANUFACTURER, WINDOW FRAMING

CASEMENT

36X40

36X48

36X42

48X40

48X48

48X48

ABOVE GRADE FLOOR NOT LESS THAN 5.7 SQ FT PER R310.2.1 AT OR BELOW GRADE NOT LESS THAN 5.0 SF FT PER 310.2.1

36X60

1' - 8"

**SLIDER WINDOW** 

WINDOW WELL FOR EGRESS (NTS)