

HANGER Quantity SCHEDULE LUS24 18 LUS26 10 HUS26 10 ▲ HHUS26-2 0 ▲ HGUS26-2 0 ▲ HGUS28-3 0 LTHJA26 4 TJC37 0 TJC57 △ HTS20 0 Job Site Address
City, State
Designer
10/8/2024 Triangle denotes the left end of the Truss as it appears on the Engineered Drawings Job Name provided. Customer

Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

EVERSTEAD SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY SUBMITIAL WAS REVIEWED FOR DESIGN CONFORMITY
AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE
FOR CONFIRMING AND CORRELATING DIMENSIONS AT
JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES,
FABRICATION, COORDINATION OF HIS OR HER WORK
WITH OTHER TRADES, AND FULL COMPLIANCE WITH
CONTRACT DOCUMENTS.

STATUS:

APPROVED AS NOTED 10/30/2024

REVIEWED BY: HCJ

ENGINEER, EVERSTEAD ENGINEERING & DESIGN LLC

TRUSS LAYOUT APPROVED FOR THE ADDRESS LISTED


RELEASE FOR CONSTRUCTION **AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES** LEE'S SUMMIT, MISSOURI 11/12/2024 11:08:53

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

2nd Floor Truss Layout

Scale: 3/16'' = 1'

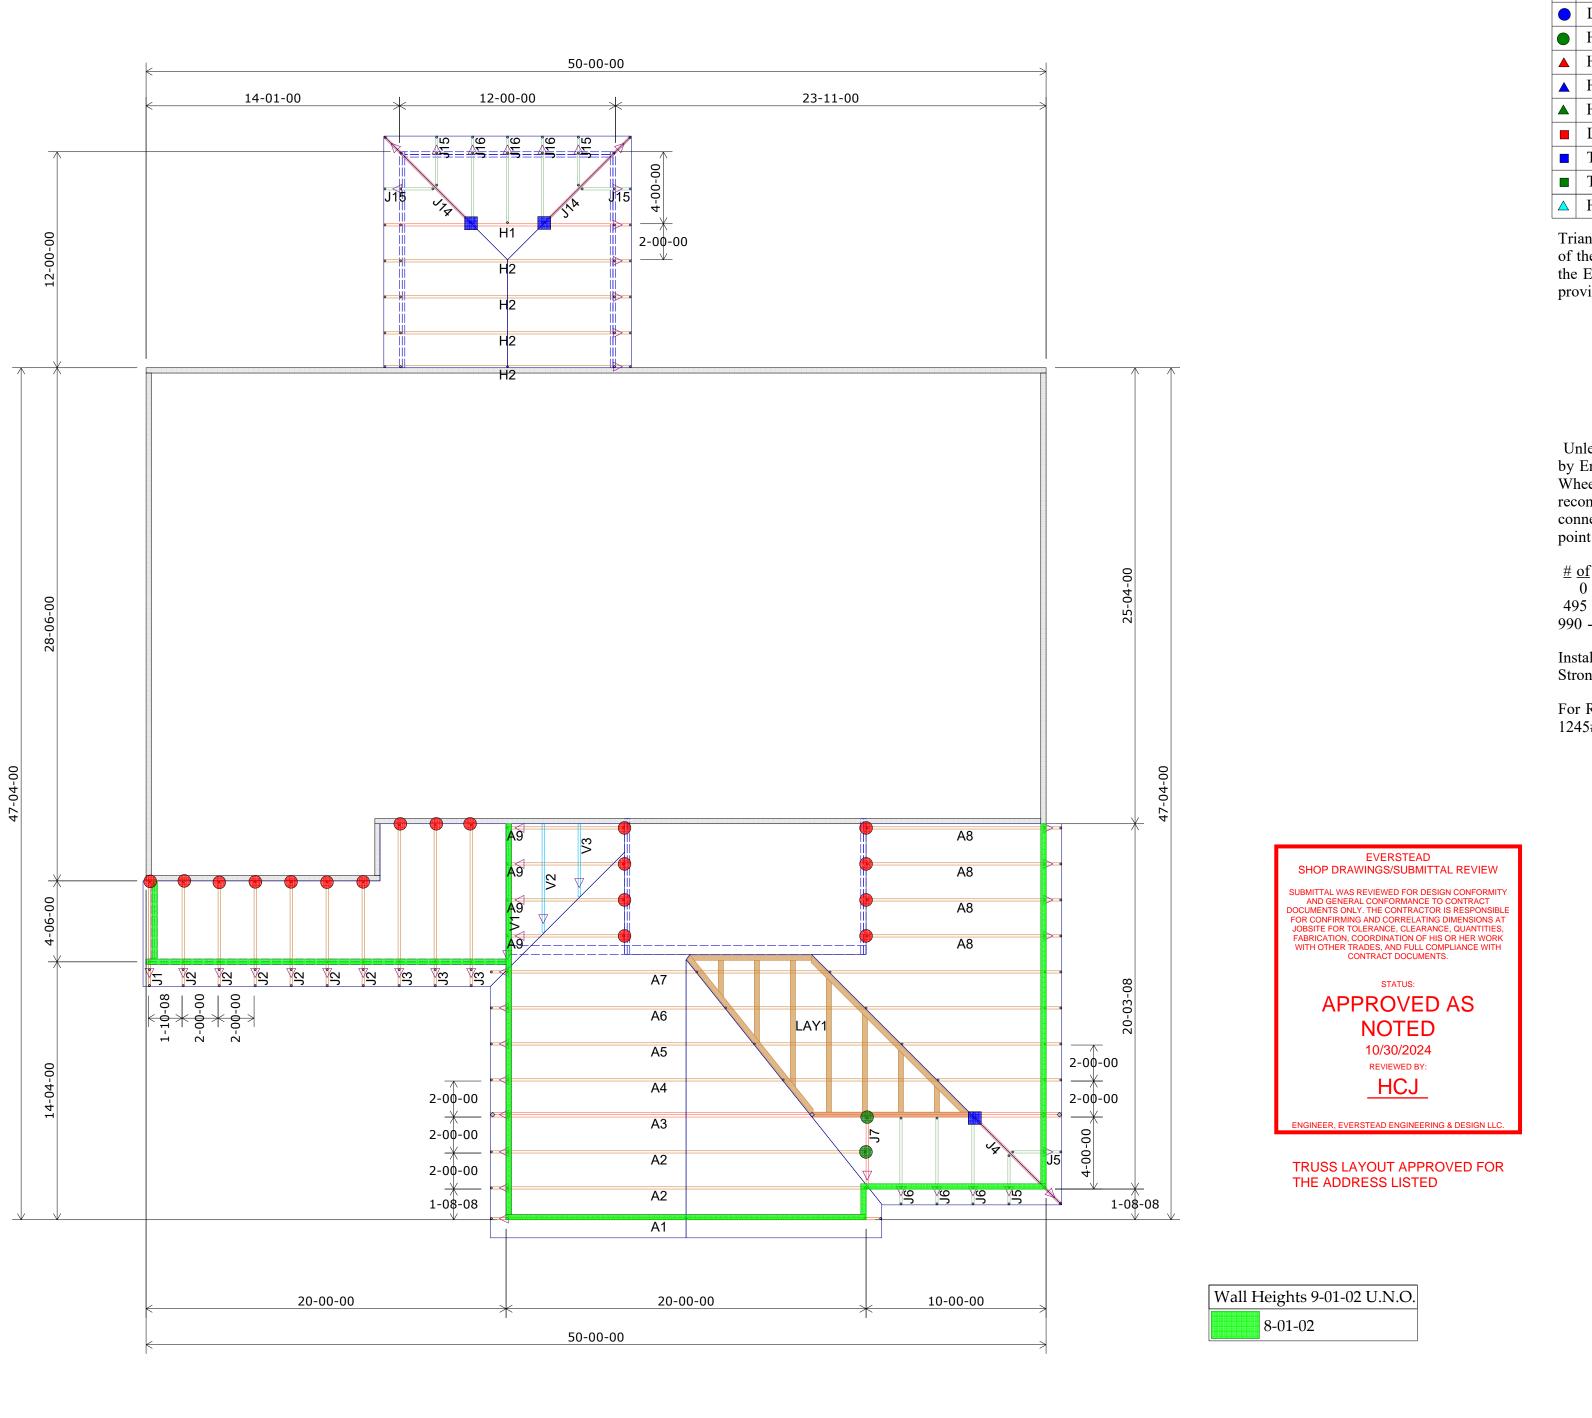

1st Floor Truss Layout Scale: 3/16'' = 1'

SCHEDULE LUS24 18 LUS26 10 HUS26 10 ▲ HHUS26-2 0 ▲ HGUS26-2 0 ▲ HGUS28-3 0 LTHJA26 TJC37 4 TJC57 0 △ HTS20 0 Triangle denotes the left end of the Truss as it appears on the Engineered Drawings Job Name provided. Customer HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Quantity


Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

HANGER

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

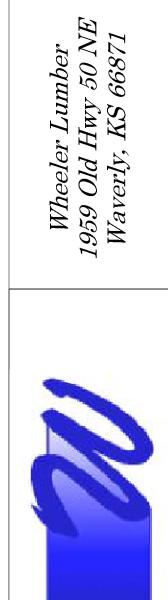

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOUR
11/12/2024 11:08:53