



**MiTek, Inc.**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

Re: MSA2408-R  
1404 NE ERNEST WAY, LEE'S SUMMIT

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Quality Truss LLC.

Pages or sheets covered by this seal: I68915658 thru I68915692

My license renewal date for the state of Missouri is December 31, 2025.

Missouri COA: Engineering 001193



October 17, 2024

Sevier, Scott, Engineer

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.


RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:43

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	CJ3	Jack-Open	5	1	168915658
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:17:55  
ID:E60b4EvW3MSZNIvUT0YHcz1iTe-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWCDol7J4zJC?f

Page: 1

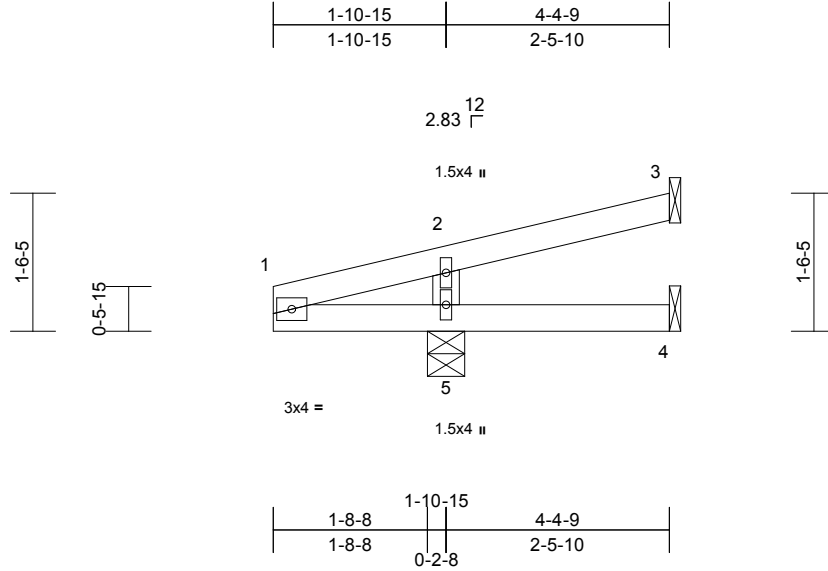

Scale = 1:17.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	0.01	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	-0.02	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	4-5	>999	360		
BCDL	10.0										Weight: 14 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 4-4-9 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 3= Mechanical, 4= Mechanical,  
5=0-4-15  
Max Horiz 5=27 (LC 8)  
Max Uplift 3=-19 (LC 12), 4=-12 (LC 18),  
5=-38 (LC 8)  
Max Grav 3=64 (LC 18), 4=23 (LC 7), 5=450 (LC 18)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-25/35, 2-3=-39/9  
BOT CHORD 1-5=-4/27, 4-5=0/0  
WEBS 2-5=-320/50

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearings are assumed to be: , Joint 5 SP No.2 .
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 3, 12 lb uplift at joint 4 and 38 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:43


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	CJ3A	Jack-Open	1	1	168915659
					Job Reference (optional)

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:17:56

Page: 1

ID:vKaCW2\_vZclXzN?QsttoADya1jE-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

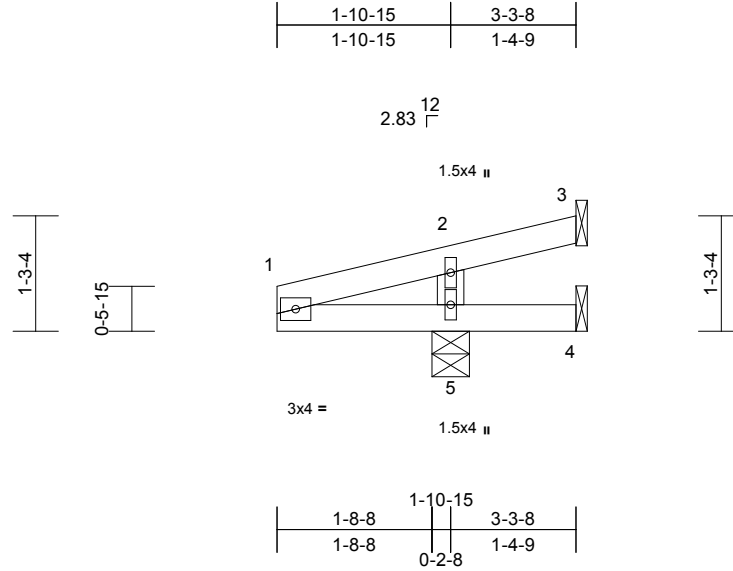

Scale = 1:16.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	0.00	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	-0.01	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	4-5	>999	360		
BCDL	10.0										Weight: 11 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 3-3-8 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 3= Mechanical, 4= Mechanical,  
5=0-4-15  
Max Horiz 5=21 (LC 8)  
Max Uplift 3=-26 (LC 7), 4=-61 (LC 18), 5=-45 (LC 8)  
Max Grav 3=-2 (LC 8), 4=13 (LC 8), 5=446 (LC 18)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-17/31, 2-3=-33/0  
BOT CHORD 1-5=-4/21, 4-5=0/0  
WEBS 2-5=-277/40

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearings are assumed to be: , Joint 5 SP No.2 .
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 3, 61 lb uplift at joint 4 and 45 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:43

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	CJ5	Diagonal Hip Girder	2	1	168915660
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:17:56  
ID:E60b4EvW3MSZNivUT0YHcz1iTe-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

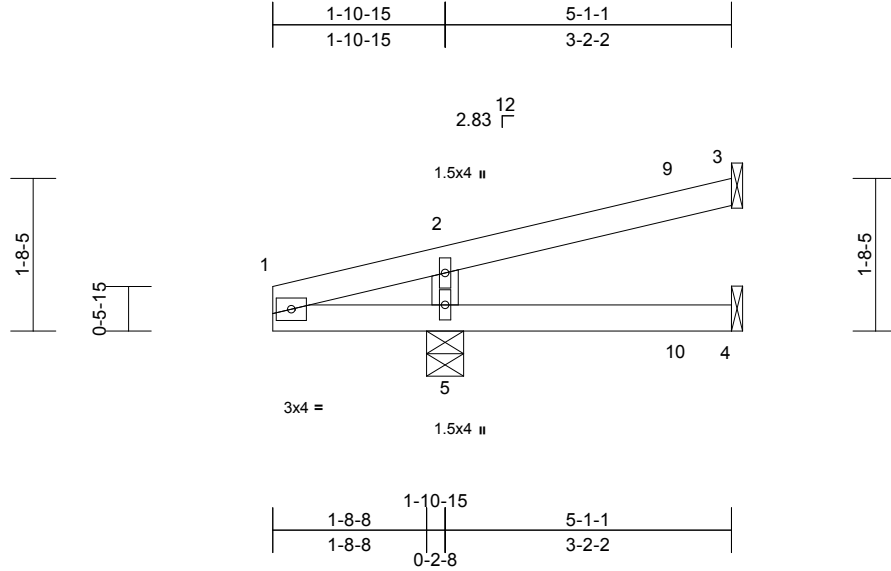

Scale = 1:18.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	0.01	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	0.01	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.04	Horz(CT)	-0.01	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	4-5	>999	360		
BCDL	10.0										Weight: 16 lb	FT = 0%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-1-1 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	3= Mechanical, 4= Mechanical, 5=0-4-15
Max Horiz	5=32 (LC 8)
Max Uplift	3=-23 (LC 12), 4=-6 (LC 38), 5=-36 (LC 8)
Max Grav	3=107 (LC 18), 4=41 (LC 7), 5=478 (LC 18)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-31/39, 2-3=-46/17
BOT CHORD	1-5=-7/32, 4-5=0/0
WEBS	2-5=-370/61

#### NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: , Joint 5 SP No.2 .
- Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 3, 6 lb uplift at joint 4 and 36 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 31 lb down and 18 lb up at 4-5-10 on top chord, and 5 lb down and 18 lb up at 4-5-10 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-3=-70, 4-6=-20  
Concentrated Loads (lb)  
Vert: 10=3 (B)



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:43


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	GR1	Hip Girder	1	2	168915661
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:17:58

Page: 1

ID:OvBRbz0UWdwmg5ea\_KzuXz0Tue-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

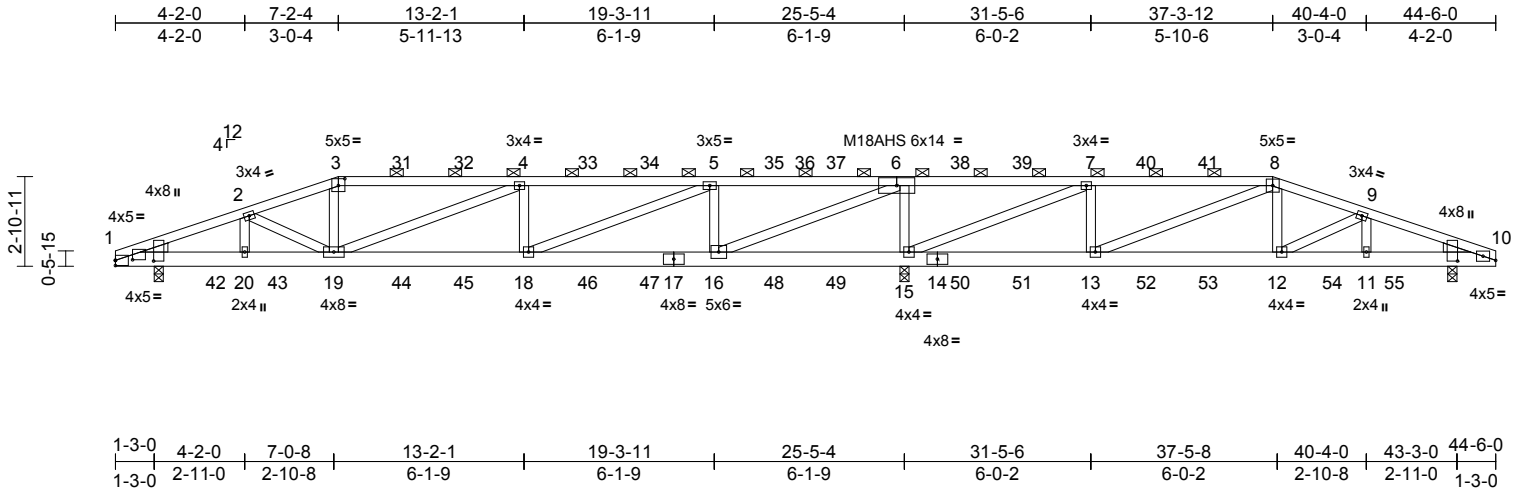

Scale = 1:74.7												
Plate Offsets (X, Y): [1:0-6-10,0-0-4], [1:0-0-4,1-2-12], [3:0-2-8,0-2-11], [10:0-2-6,0-0-6], [10:0-0-4,1-2-12]												
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.86	Vert(LL)	-0.15	16-18	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.31	Vert(CT)	-0.23	16-18	>999	180	M18AHS	186/179
TCDL	10.0	Rep Stress Incr	NO	WB	0.75	Horz(CT)	0.02	10	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.05	18	>999	360		
BCDL	10.0											
											Weight: 502 lb	FT = 0%

<b>LUMBER</b>	
TOP CHORD	2x4 SP No.2 *Except* 6-8:2x4 SP No.1
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.2
WEDGE	Left: 2x4 SP No.2 Right: 2x4 SP No.2
<b>BRACING</b>	
TOP CHORD	Structural wood sheathing directly applied or 5-6-0 oc purlins, except 2-0-0 oc purlins (4-11-3 max.): 3-8.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 15-16.
<b>REACTIONS</b>	
(size)	1=0-3-8, 10=0-3-8, 15=0-3-8
Max Horiz	1=28 (LC 12)
Max Uplift	1=-94 (LC 12), 10=-75 (LC 13), 15=-190 (LC 8)
Max Grav	1=2348 (LC 36), 10=1581 (LC 36), 15=5797 (LC 35)
<b>FORCES</b>	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-3447/164, 2-3=-4067/175, 3-4=-3869/185, 4-5=-4689/195, 5-7=-2039/3721, 7-8=-639/105, 8-9=-2019/128, 9-10=-2077/129
BOT CHORD	1-20=-150/3179, 19-20=-150/3179, 18-19=-159/4689, 16-18=-62/2039, 15-16=-3376/141, 13-15=-40/639, 12-13=-75/1882, 11-12=-90/1899, 10-11=-90/1899
WEBS	3-19=0/455, 8-12=0/465, 2-20=-444/12, 2-19=-10/895, 9-11=-94/48, 9-12=-5/219, 6-15=-3488/256, 7-13=0/718, 7-15=-4645/171, 8-13=-1482/64, 4-18=-825/183, 4-19=-886/29, 5-16=-2156/215, 6-16=-193/5889, 5-18=-108/2864

- NOTES**
- 2-ply truss to be connected together with 10d (0.148"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL = 1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - All bearings are assumed to be SP 2400F 2.0E .
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 190 lb uplift at joint 15, 94 lb uplift at joint 1 and 75 lb uplift at joint 10.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 17, 2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44

16023 Swingley Ridge Rd  
Missouri City, MO 63050  
816-424-6200 / MiTek-USA.com

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	GR1	Hip Girder	1	2	I68915661
					Job Reference (optional)

14) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 224 lb down and 46 lb up at 7-2-4, 224 lb down and 45 lb up at 9-3-0, 224 lb down and 45 lb up at 11-3-0, 224 lb down and 45 lb up at 13-3-0, 224 lb down and 45 lb up at 15-3-0, 224 lb down and 45 lb up at 17-3-0, 224 lb down and 45 lb up at 19-3-0, 224 lb down and 45 lb up at 21-3-0, 224 lb down and 45 lb up at 23-3-0, 224 lb down and 45 lb up at 25-3-0, 224 lb down and 45 lb up at 27-3-0, 224 lb down and 45 lb up at 29-3-0, 224 lb down and 45 lb up at 31-3-0, 224 lb down and 45 lb up at 33-3-0, and 224 lb down and 45 lb up at 35-3-0, and 224 lb down and 46 lb up at 37-3-12 on top chord, and 312 lb down and 21 lb up at 3-3-0, 242 lb down and 21 lb up at 5-3-0, 64 lb down at 7-3-0, 64 lb down at 9-3-0, 64 lb down at 11-3-0, 64 lb down at 13-3-0, 64 lb down at 15-3-0, 64 lb down at 17-3-0, 64 lb down at 19-3-0, 64 lb down at 21-3-0, 64 lb down at 23-3-0, 64 lb down at 25-3-0, 64 lb down at 27-3-0, 64 lb down at 29-3-0, 64 lb down at 31-3-0, 64 lb down at 33-3-0, 64 lb down at 35-3-0, 64 lb down at 37-3-0, and 242 lb down and 21 lb up at 39-3-0, and 312 lb down and 21 lb up at 41-3-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-3=-70, 3-8=-70, 8-10=-70, 21-26=-20  
Concentrated Loads (lb)  
Vert: 3=-189 (B), 19=-53 (B), 12=-53 (B), 6=-189 (B), 15=-53 (B), 7=-189 (B), 13=-53 (B), 8=-189 (B), 4=-189 (B), 18=-53 (B), 5=-189 (B), 16=-53 (B), 31=-189 (B), 32=-189 (B), 33=-189 (B), 34=-189 (B), 35=-189 (B), 37=-189 (B), 38=-189 (B), 39=-189 (B), 40=-189 (B), 41=-189 (B), 42=-312 (B), 43=-242 (B), 44=-53 (B), 45=-53 (B), 46=-53 (B), 47=-53 (B), 48=-53 (B), 49=-53 (B), 50=-53 (B), 51=-53 (B), 52=-53 (B), 53=-53 (B), 54=-242 (B), 55=-312 (B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))




**RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI**

18023 Swingley Ridge Rd  
Smithville, MO 64089  
816-404-6200 / MiTek-USA.com

**01/16/2025 2:41:44**



Page: 1

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**Mitek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Chesham, MO 64010  
#34-0201 MitekUS.com  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	GR2	Hip Girder	1	2	I68915662
					Job Reference (optional)

15) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 224 lb down and 45 lb up at 7-9-0, 224 lb down and 45 lb up at 9-9-0, 224 lb down and 45 lb up at 11-9-0, 224 lb down and 45 lb up at 13-9-0, 224 lb down and 45 lb up at 15-9-0, 224 lb down and 45 lb up at 17-9-0, 224 lb down and 45 lb up at 19-9-0, 224 lb down and 45 lb up at 21-9-0, 224 lb down and 45 lb up at 23-9-0, 224 lb down and 45 lb up at 25-9-0, 224 lb down and 45 lb up at 27-9-0, 224 lb down and 45 lb up at 29-9-0, 224 lb down and 45 lb up at 31-9-0, and 224 lb down and 45 lb up at 33-9-0, and 224 lb down and 45 lb up at 35-9-0 on top chord, and 305 lb down and 25 lb up at 3-9-0, 235 lb down and 22 lb up at 5-9-0, 64 lb down at 7-9-0, 64 lb down at 9-9-0, 64 lb down at 11-9-0, 64 lb down at 13-9-0, 64 lb down at 15-9-0, 64 lb down at 17-9-0, 64 lb down at 19-9-0, 64 lb down at 21-9-0, 64 lb down at 23-9-0, 64 lb down at 25-9-0, 64 lb down at 27-9-0, 64 lb down at 29-9-0, 64 lb down at 31-9-0, 64 lb down at 33-9-0, 64 lb down at 35-9-0, and 235 lb down and 22 lb up at 37-9-0, and 305 lb down and 25 lb up at 39-9-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (lb/ft)
- Vert: 1-3=-70, 3-10=-70, 10-12=-70, 24-29=-20
- Concentrated Loads (lb)
- Vert: 20=-53 (F), 23=-305 (F), 21=-53 (F), 4=-189 (F), 18=-53 (F), 6=-189 (F), 9=-189 (F), 15=-53 (F), 13=-305 (F), 16=-53 (F), 34=-189 (F), 35=-189 (F), 36=-189 (F), 37=-189 (F), 39=-189 (F), 40=-189 (F), 41=-189 (F), 42=-189 (F), 44=-189 (F), 45=-189 (F), 46=-189 (F), 47=-189 (F), 48=-235 (F), 49=-53 (F), 50=-53 (F), 51=-53 (F), 52=-53 (F), 53=-53 (F), 54=-53 (F), 55=-53 (F), 56=-53 (F), 57=-53 (F), 58=-53 (F), 59=-235 (F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))



**RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI**

18023 Swingley Ridge Rd  
Missouri City, MO 63050  
816-424-6200 / MiTek-USA.com

**01/16/2025 2:41:44**




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	GR3	Half Hip Girder	1	1	I68915663
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 9.08 E 8.82 Aug 30 2024 Print: 8.820 E Aug 30 2024 MiTek Industries, Inc. Wed Oct 16 14:41:12

Page: 1

ID:KO7Uxx5wOgADLuNX\_F5H7Kya1oG-NmsukeY\_s9E9Vbt2?hOvb2TPdWVzGGJTPN5QmtySp6c

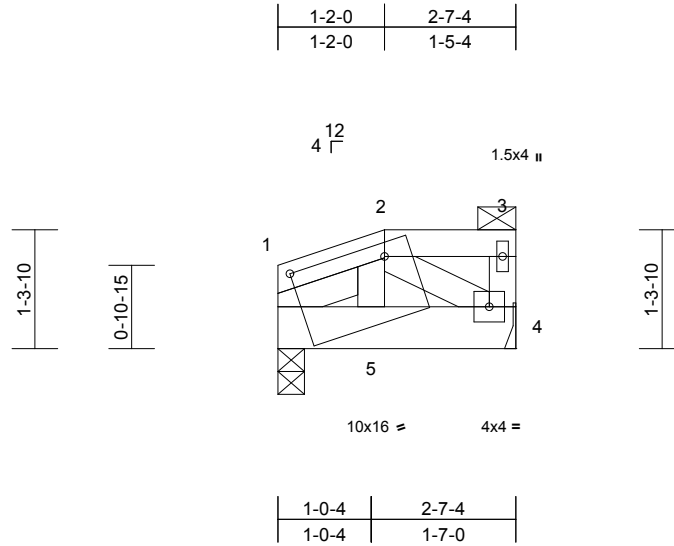

Scale = 1:17.3

Plate Offsets (X, Y): [5:1-0-8,0-1-12]															
Loading		(psf)	Spacing		2-0-0	CSI		DEFL		in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)		25.0	Plate Grip DOL		1.15	TC		Vert(LL)		0.00	5-8	>999	240	MT20	244/190
Snow (Pf)		25.0	Lumber DOL		1.15	BC		Vert(CT)		0.00	5-8	>999	180		
TCDL		10.0	Rep Stress Incr		NO	WB		Horz(CT)		0.00	1	n/a	n/a		
BCLL		0.0	Code		IRC2018/TPI2014	Matrix-MP		Wind(LL)		0.00	5	>999	360		
BCDL		10.0												Weight: 15 lb	FT = 0%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP 2400F 2.0E  
WEBS 2x4 SP No.2  
SLIDER Left 2x4 SP No.2 -- 0-11-10

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-7-4 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-3.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (lb/size) 1=1750/0-3-8, 4=493/ Mechanical  
Max Horiz 1=22 (LC 11)  
Max Uplift 1=-73 (LC 8), 4=-41 (LC 9)  
Max Grav 1=1774 (LC 33), 4=522 (LC 32)

**FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-619/35  
BOT CHORD 1-5=-52/646, 4-5=-51/558  
WEBS 2-5=-14/574, 2-4=-685/56

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) Provide adequate drainage to prevent water ponding.

- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 73 lb uplift at joint 1 and 41 lb uplift at joint 4.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 39 lb up at 1-2-0 on top chord, and 2089 lb down and 44 lb up at 0-8-0, and 40 lb up at 1-2-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-2=-70, 2-3=-70, 4-6=-20  
Concentrated Loads (lb)  
Vert: 5=34 (F), 2=33 (F), 8=-2089 (B)



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT	168915664
MSA2408-R	GR4	Hip Girder	1	2	Job Reference (optional)	

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:01  
ID:HerTJcOXXwntufBFfVyP6Sya17H-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

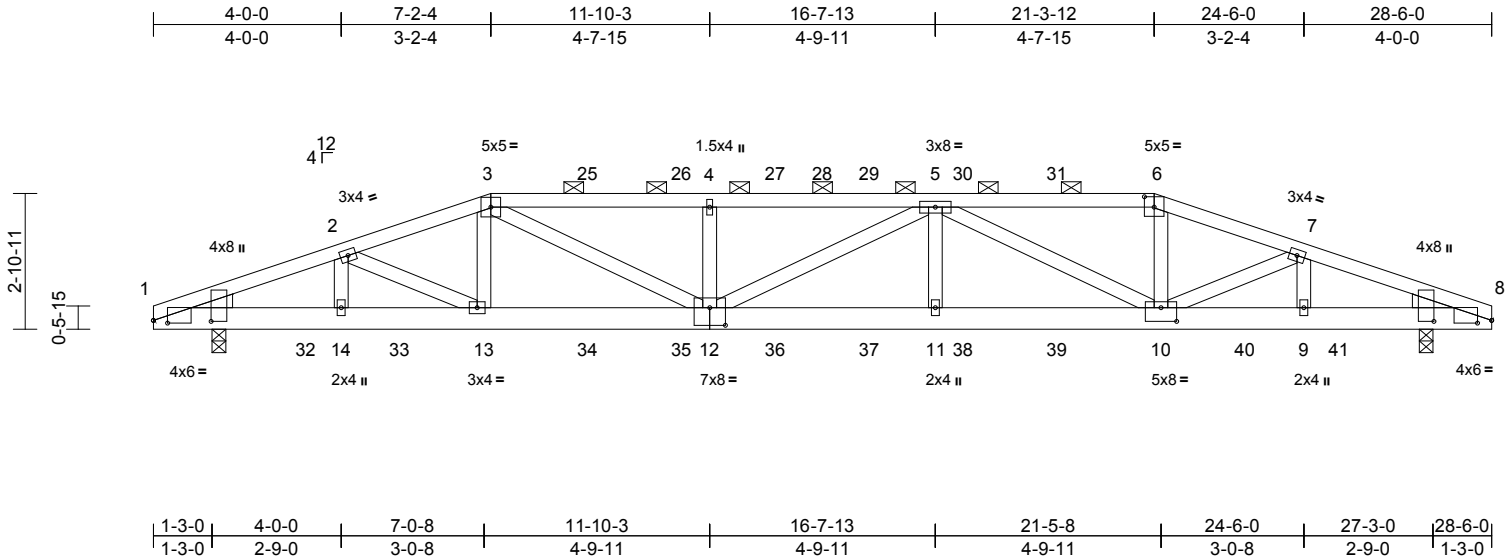

Scale = 1:49.8

Plate Offsets (X, Y): [1:0-3-10,0-0-11], [1:0-0-4,1-2-12], [6:0-2-8,0-2-11], [8:0-3-10,0-0-11], [8:0-0-4,1-2-12], [10:0-4-0,0-3-8], [12:0-4-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	-0.22	11-12	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.41	Vert(CT)	-0.34	11-12	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.27	Horz(CT)	0.05	8	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.08	11-12	>999	360		
BCDL	10.0											
Weight: 320 lb											FT = 0%	

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP 2400F 2.0E  
WEBS 2x4 SP No.2  
WEDGE Left: 2x4 SP No.2  
Right: 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 4-11-2 oc purlins, except 2-0-0 oc purlins (4-0-10 max.): 3-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 1=0-3-8, 8=0-3-8  
Max Horiz 1=28 (LC 57)  
Max Uplift 1=-113 (LC 8), 8=-113 (LC 9)  
Max Grav 1=2951 (LC 36), 8=2951 (LC 36)

#### FORCES

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-4457/193, 2-3=-5593/227, 3-4=-7166/272, 4-5=-7165/272, 5-6=-5195/225, 6-7=-5523/223, 7-8=-4476/195  
BOT CHORD 1-14=-172/4127, 13-14=-172/4127, 11-13=-225/7287, 10-11=-225/7287, 9-10=-153/4146, 8-9=-153/4146  
WEBS 2-14=-802/39, 2-13=-33/1403, 3-13=0/248, 3-12=-72/2095, 4-12=-869/143, 5-12=-187/50, 5-11=0/361, 5-10=-2362/87, 6-10=0/1072, 7-10=-28/1305, 7-9=-742/35

#### NOTES

- 2-ply truss to be connected together with 10d (0.148"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP 2400F 2.0E.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 1 and 113 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 224 lb down and 46 lb up at 7-2-4, 224 lb down and 45 lb up at 9-3-0, 224 lb down and 45 lb up at 11-3-0, 224 lb down and 45 lb up at 13-3-0, 224 lb down and 45 lb up at 15-3-0, 224 lb down and 45 lb up at 17-3-0, and 224 lb down and 45 lb up at 19-3-0, and 224 lb down and 46 lb up at 21-3-12 on top chord, and 312 lb down and 21 lb up at 3-3-0, 242 lb down and 21 lb up at 5-3-0, 64 lb down at 7-3-0, 64 lb down at 9-3-0, 64 lb down at 11-3-0, 64 lb down at 13-3-0, 64 lb down at 15-3-0, 64 lb down at 17-3-0, 64 lb down at 19-3-0, 64 lb down at 21-3-0, and 242 lb down and 21 lb up at 23-3-0, and 312 lb down and 21 lb up at 25-3-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

#### LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-3=-70, 3-6=-70, 6-8=-70, 15-20=-20  
Concentrated Loads (lb)



October 17, 2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	GR4	Hip Girder	1	2	I68915664
					Job Reference (optional)

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:01  
ID:HerTJcOXXwntufBFevyP6Sya17H-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 2

Vert: 6=-189 (B), 13=-53 (B), 3=-189 (B), 10=-53 (B),  
25=-189 (B), 26=-189 (B), 27=-189 (B), 29=-189 (B),  
30=-189 (B), 31=-189 (B), 32=-312 (B), 33=-242 (B),  
34=-53 (B), 35=-53 (B), 36=-53 (B), 37=-53 (B),  
38=-53 (B), 39=-53 (B), 40=-242 (B), 41=-312 (B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))



**RELEASE FOR CONSTRUCTION**  
**AS NOTED ON PLANS REVIEW**  
**DEVELOPMENT SERVICES**  
**LEE'S SUMMIT, MISSOURI**  
**01/16/2025 2:41:44**

18023 Swingley Ridge Rd  
Potosi, MO 63003  
816-404-0200 / MiTek-USA.com


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H1	Roof Special	1	1	168915665
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:02

Page: 1

ID:ET3Ha9\_iFgI9F4QQnf7RLz1hwh-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

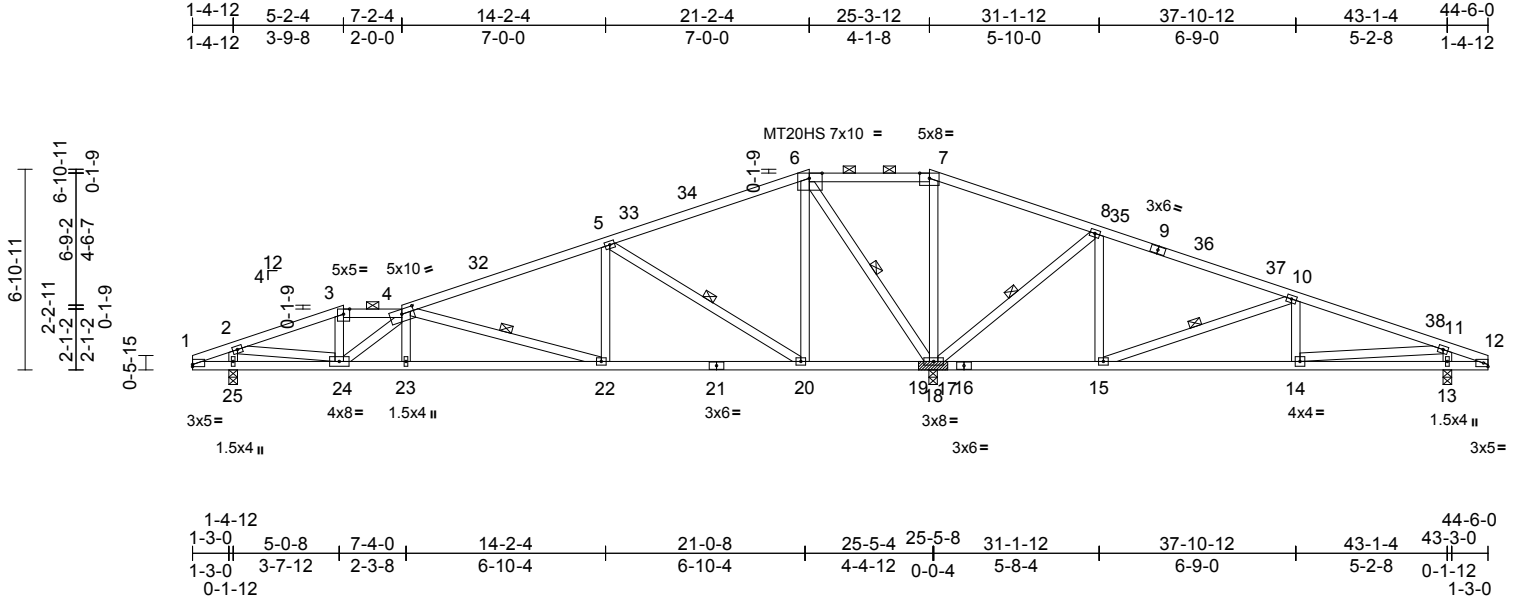

Scale = 1:77.7					
Plate Offsets (X, Y): [1:Edge,0-0-14], [4:0-5-0,0-2-0], [6:0-5-4,Edge]					
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>	<b>DEFL</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.96
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.65
TCDL	10.0	Rep Stress Incr	YES	WB	0.65
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR	
BCDL	10.0				
				<b>in</b>	<b>(loc)</b>
				<b>l/defl</b>	<b>L/d</b>
				<b>MT20</b>	<b>GRIP</b>
				Vert(LL)	22-23
				Vert(CT)	22-23
				Horz(CT)	18
				Wind(LL)	22-23
					360
				Weight: 247 lb FT = 0%	

**LUMBER**  
TOP CHORD 2x4 SP No.2 \*Except\* 4-6,7-9:2x4 SP No.1  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 3-4, 6-7.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 18-20,15-18,14-15.  
WEBS 1 Row at midpt 4-22, 5-20, 6-18, 8-18, 10-15

**REACTIONS** (size) 13=0-3-8, 18=(0-3-8 + bearing block), (req. 0-4-2), 25=0-3-8  
Max Horiz 25=74 (LC 12)  
Max Uplift 13=62 (LC 9), 25=49 (LC 8)  
Max Grav 13=645 (LC 28), 18=3499 (LC 40), 25=1135 (LC 40)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-114/6, 2-3=-1514/57, 3-4=-1368/63, 4-5=-1020/68, 5-6=0/760, 6-7=0/1698, 7-8=0/1886, 8-10=-51/783, 10-11=-801/281, 11-12=-126/10  
BOT CHORD 1-25=-2/136, 24-25=-72/160, 23-24=-112/1961, 22-23=-107/1969, 20-22=-46/891, 18-20=-643/95, 15-18=-706/87, 14-15=-249/715, 13-14=-10/155, 12-13=-10/155  
WEBS 3-24=0/398, 4-24=-805/33, 4-23=0/210, 4-22=-1246/63, 5-22=0/475, 5-20=-1632/80, 6-20=0/964, 6-18=-1926/51, 7-18=-863/37, 8-18=-1457/63, 8-15=0/517, 10-15=-1163/44, 10-14=0/232, 2-25=-1055/91, 2-24=-30/1256, 11-13=-575/111, 11-14=-253/638

**NOTES**

- 2x4 SP No.2 bearing block 12" long at jt. 18 attached to front face with 2 rows of 10d (0.148"x3") nails spaced 3" o.c. 8 Total fasteners. Bearing is assumed to be SP No.2.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 3x4 (=) MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 49 lb uplift at joint 25 and 62 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



October 17,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H1A	Roof Special	1	1	168915666
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:02

Page: 1

ID:4uq4K9fSgMCbM\_yeFAxN8z1hgK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

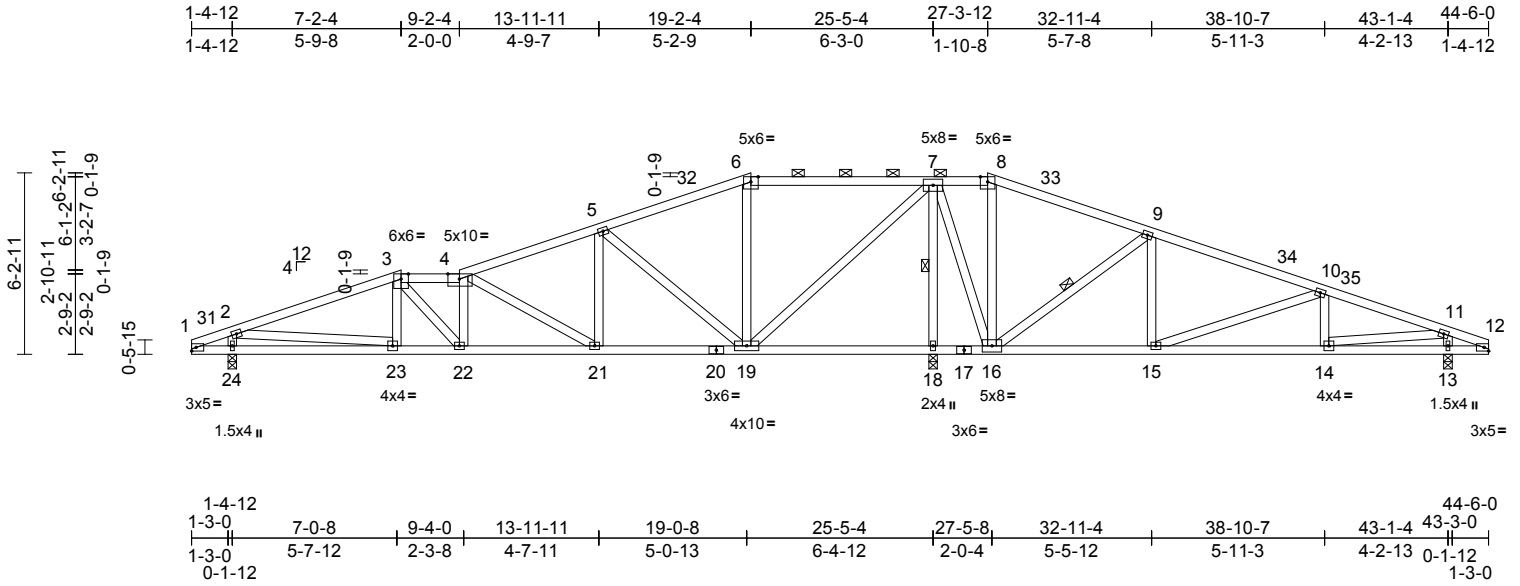

Scale = 1:77.6									
Plate Offsets (X, Y): [4:0-4-12,Edge]									
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.10 21-22	>999	240
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.49	Vert(CT)	-0.17 21-22	>999	180
TCDL	10.0	Rep Stress Incr	YES	WB	0.92	Horz(CT)	0.02 13	n/a	n/a
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.04 21-22	>999	360
BCDL	10.0								
									<b>PLATES</b> MT20
									<b>GRIP</b> 244/190
									Weight: 257 lb FT = 0%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 3-4, 6-8.  
BOT CHORD Rigid ceiling directly applied or 4-8-11 oc bracing.

**WEBS** 1 Row at midpt 9-16, 7-18

**REACTIONS** (size) 13=0-3-8, 18=0-3-8, 24=0-3-8  
Max Horiz 24=66 (LC 12)  
Max Uplift 13=59 (LC 9), 18=6 (LC 8), 24=52 (LC 8)  
Max Grav 13=871 (LC 40), 18=2914 (LC 40), 24=1244 (LC 40)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-322/16, 2-3=-1789/69, 3-4=-1764/88, 4-5=-1188/81, 5-6=-357/129, 6-7=-304/91, 7-8=0/872, 8-9=0/1015, 9-10=-549/348, 10-11=-1118/103, 11-12=-44/12  
BOT CHORD 1-24=-8/373, 23-24=-74/373, 22-23=-77/1609, 21-22=-72/1757, 19-21=-34/1061, 18-19=-1365/47, 16-18=-1365/47, 15-16=-311/440, 14-15=-61/1025, 13-14=-4/56, 12-13=-4/56  
WEBS 3-23=-67/82, 4-22=-247/104, 6-19=-432/66, 8-16=-671/14, 9-16=-1281/55, 3-22=-63/397, 5-21=0/513, 5-19=-1243/68, 4-21=-871/44, 7-18=-2751/62, 7-16=-14/1510, 7-19=-47/1895, 2-24=-1206/131, 2-23=-21/1241, 9-15=0/406, 10-15=-809/33, 10-14=-67/149, 11-13=-787/88, 11-14=-57/987

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are 3x4 (=) MT20 unless otherwise indicated.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) All bearings are assumed to be SP No.2 .
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 6 lb uplift at joint 18, 52 lb uplift at joint 24 and 59 lb uplift at joint 13.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H1B	Roof Special	1	1	168915667
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:02  
ID:2zQRZd2VO2dEPpAxFileQOAz0UDG-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

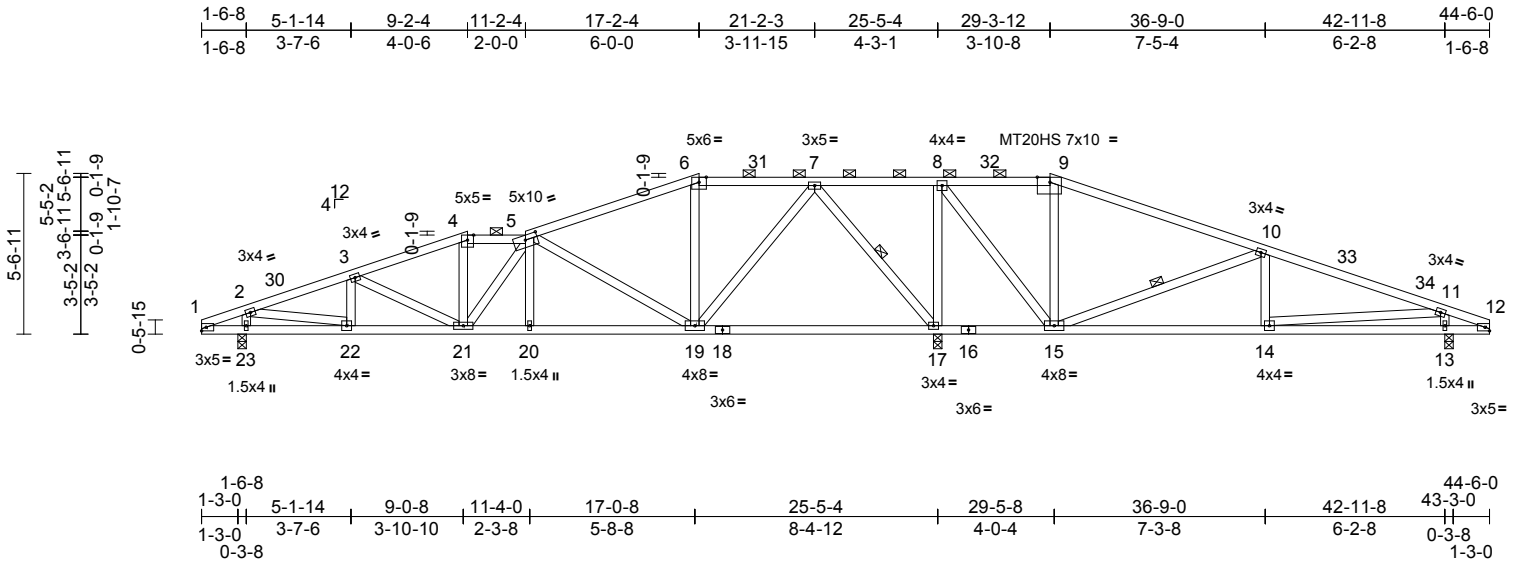

Scale = 1:77.6									
Plate Offsets (X, Y): [5:0-5-0,0-2-0], [9:0-5-4,Edge]									
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.11 17-19	>999	240
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.22 17-19	>999	180
TCDL	10.0	Rep Stress Incr	YES	WB	0.86	Horz(CT)	0.03 17	n/a	n/a
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.03 20	>999	360
BCDL	10.0								
									<b>PLATES</b>
									MT20
									MT20HS
									<b>GRIP</b>
									244/190
									187/143
									Weight: 247 lb FT = 0%

**LUMBER**  
TOP CHORD 2x4 SP No.2 \*Except\* 9-12:2x4 SP No.1  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 4-4-7 oc purlins, except 2-0-0 oc purlins (4-0-8 max.): 4-5, 6-9.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 17-19,14-15 4-8-12 oc bracing: 15-17.  
WEBS 1 Row at midpt 10-15, 7-17

**REACTIONS** (size) 13=0-3-8, 17=0-3-8, 23=0-3-8  
Max Horiz 23=58 (LC 13)  
Max Uplift 13=59 (LC 9), 17=-21 (LC 8), 23=55 (LC 8)  
Max Grav 13=904 (LC 40), 17=2569 (LC 40), 23=1256 (LC 40)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-45/21, 2-3=-1673/59, 3-4=-1460/77, 4-5=-1311/83, 5-6=-642/72, 6-7=-554/85, 7-8=0/1388, 8-9=0/472, 9-10=-15/563, 10-11=-1119/108, 11-12=-197/13  
BOT CHORD 1-23=0/51, 22-23=-53/76, 21-22=-67/1529, 20-21=-58/1379, 19-20=-56/1381, 17-19=-452/67, 15-17=-1388/53, 14-15=-51/987, 13-14=-10/226, 12-13=-10/226

**WEBS** 4-21=0/304, 5-20=0/127, 5-19=-1148/77, 6-19=-322/61, 9-15=-690/68, 10-15=-1326/56, 10-14=0/266, 3-21=-254/50, 5-21=-265/122, 3-22=-250/58, 2-23=-1142/78, 2-22=-41/1523, 11-13=-843/121, 11-14=-75/766, 7-19=-1/1323, 7-17=-1475/73, 8-17=-1302/74, 8-15=-35/1599

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) Provide adequate drainage to prevent water ponding.
  - 6) All plates are MT20 plates unless otherwise indicated.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) All bearings are assumed to be SP No.2.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 23, 59 lb uplift at joint 13 and 21 lb uplift at joint 17.
  - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



October 17,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H1C	Roof Special	1	1	168915668
Job Reference (optional)					


Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:03

Page: 1


ID:QeVbIS9GAqgPui3a0?HT\_4z0UAX-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

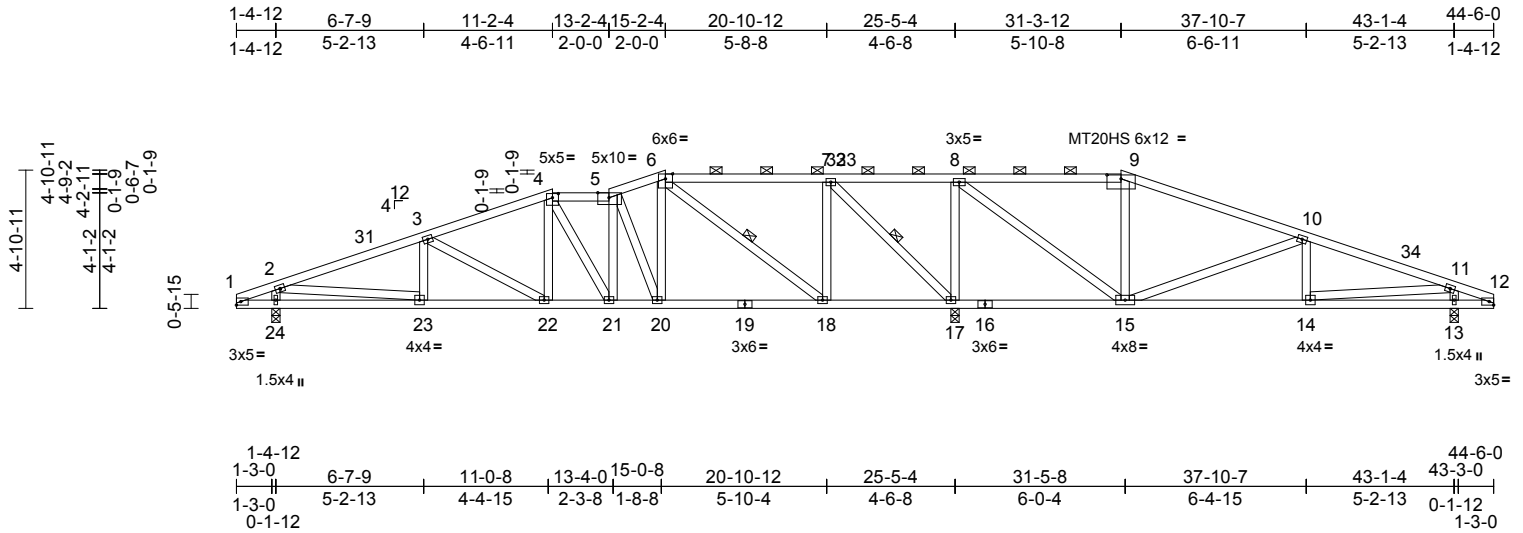

Page: 1

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are MT20 plates unless otherwise indicated.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) All bearings are assumed to be SP No.2 .
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 16, 53 lb uplift at joint 21 and 49 lb uplift at joint 12.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1 .
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



## NOTES

- 1) Unbalanced roof live loads have been considered for this design.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))


**Mitek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Chesham, MO 64010  
#34-0201 MitekUS.com  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H1E	Hip	1	1	168915670
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:03  
ID:tp8zaJhQPXSzwaNi6KKXpfz0U5z-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCdoi7J4zJC?f

Page: 1

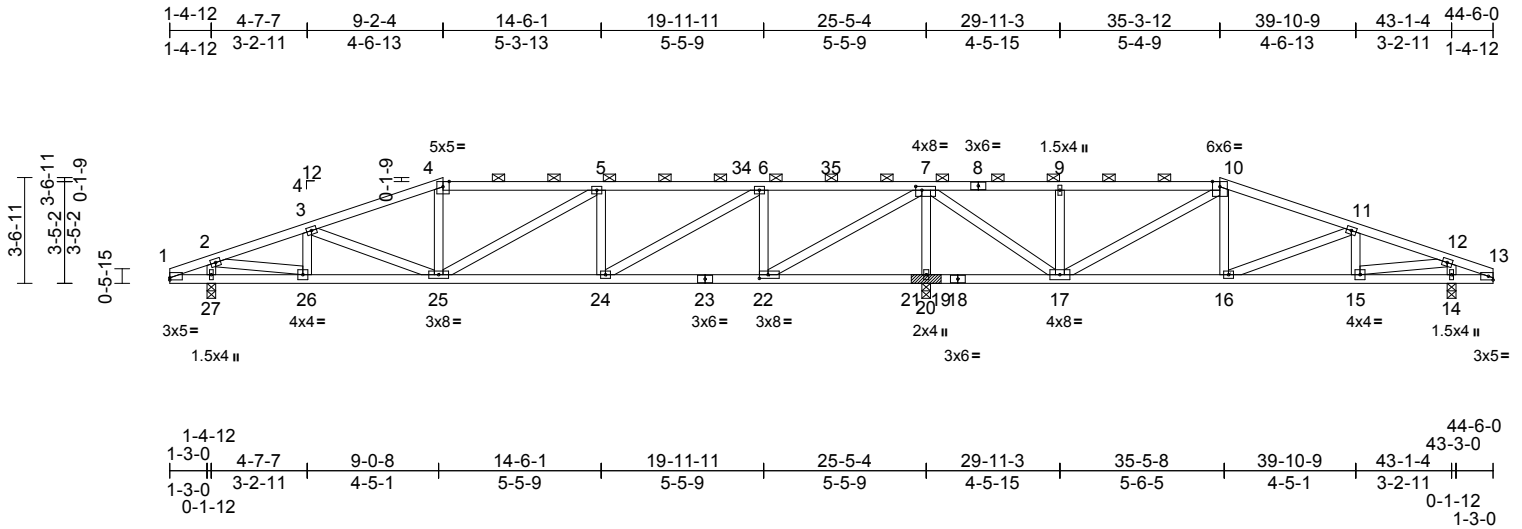

Scale = 1:77.4									
Plate Offsets (X, Y): [1:Edge,0-0-14], [7:0-2-8,0-1-8], [22:0-3-8,0-1-8]									
<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.12 24	>999	240
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.19 24-25	>999	180
TCDL	10.0	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.02 20	n/a	n/a
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.05 24-25	>999	360
BCDL	10.0								
Weight: 231 lb FT = 0%									

<b>LUMBER</b>	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
<b>BRACING</b>	
TOP CHORD	Structural wood sheathing directly applied or 4-1-9 oc purlins, except 2-0-0 oc purlins (3-10-7 max.): 4-10.
BOT CHORD	Rigid ceiling directly applied or 4-6-5 oc bracing.
<b>REACTIONS</b>	
(size)	14=0-3-8, 20=(0-3-8 + bearing block), 27=0-3-8
Max Horiz	27=34 (LC 13)
Max Uplift	14=45 (LC 9), 20=56 (LC 8), 27=53 (LC 8)
Max Grav	14=926 (LC 36), 20=3002 (LC 35), 27=1188 (LC 36)
<b>FORCES</b>	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-81/12, 2-3=-1610/72, 3-4=-1703/87, 4-5=-1613/97, 5-6=-1816/99, 6-7=-731/73, 7-9=-51/218, 9-10=-51/220, 10-11=-758/106, 11-12=-1105/86, 12-13=-27/43
BOT CHORD	1-27=-1/84, 26-27=-31/91, 25-26=-71/1479, 24-25=-54/1816, 22-24=-29/731, 20-22=-1572/53, 17-20=-1572/53, 16-17=-36/643, 15-16=-50/1002, 14-15=-3/31, 13-14=-3/31
WEBS	3-25=-250/248, 4-25=0/198, 10-16=0/269, 11-16=-418/25, 3-26=-258/56, 2-27=-1067/71, 2-26=-43/1479, 11-15=-160/56, 12-14=-820/73, 12-15=-51/1026, 7-20=-2877/113, 7-17=-35/1751, 9-17=-542/75, 10-17=-861/18, 7-22=-64/2655, 5-24=-512/82, 5-25=-238/310, 6-24=-31/1250, 6-22=-1224/99

- NOTES**
- 2x4 SP No.2 bearing block 12" long at jt. 20 attached to front face with 2 rows of 10d (0.148"x3") nails spaced 3" o.c. 8 Total fasteners. Bearing is assumed to be SP No.2.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - Provide adequate drainage to prevent water ponding.
  - All plates are 3x4 (=) MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - All bearings are assumed to be SP No.2 .
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 27, 45 lb uplift at joint 14 and 56 lb uplift at joint 20.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 17,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:44


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H2	Roof Special Girder	1	1	168915671
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:04

Page: 1

ID:Hz?G0WMOg2UYWpAxdD6WRFz0UCs-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

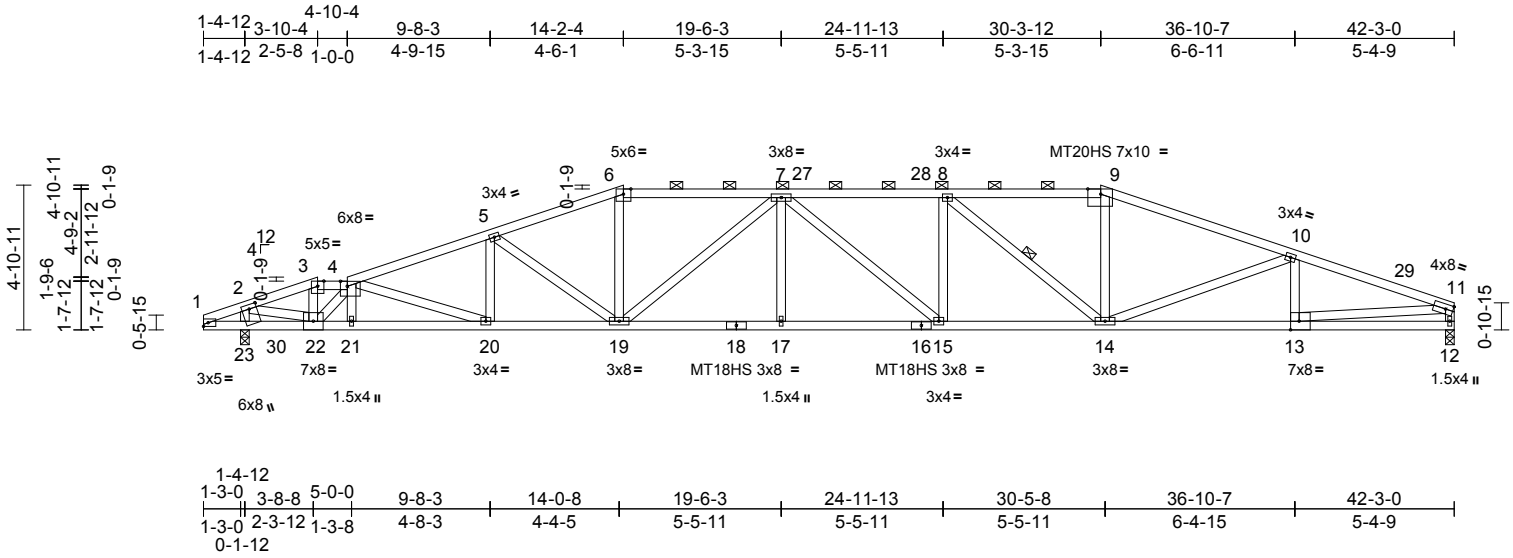

Scale = 1:75.9

Plate Offsets (X, Y): [4:0-2-12,0-2-0], [9:0-5-4,Edge], [13:0-3-8,Edge], [23:0-1-12,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	1.00	Vert(LL)	-0.47	15-17	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.94	Vert(CT)	-0.80	15-17	>610	180	MT20HS	187/143
TCDL	10.0	Rep Stress Incr	NO	WB	0.95	Horz(CT)	0.21	12	n/a	n/a	MT18HS	244/190
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.21	15-17	>999	360		
BCDL	10.0											
											Weight: 232 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2 \*Except\* 6-9,9-11:2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (2-4-9 max.): 3-4, 6-9.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 8-14

REACTIONS (size) 12=0-3-8, 23=0-3-8  
Max Horiz 23=57 (LC 12)  
Max Uplift 12=42 (LC 9), 23=117 (LC 8)  
Max Grav 12=2032 (LC 40), 23=2661 (LC 40)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-368/26, 2-3=-3623/119, 3-4=-3378/118, 4-5=-4524/133, 5-6=-4209/132, 6-7=-3969/137, 7-8=-4754/124, 8-9=-3767/128, 9-10=-4012/115, 10-11=-4098/100

BOT CHORD 1-23=-17/332, 22-23=-61/332, 21-22=-158/4634, 20-21=-152/4634, 19-20=-107/4200, 17-19=-63/4832, 15-17=-63/4832, 14-15=-40/4754, 13-14=-66/3839, 12-13=0/0

WEBS 3-22=-37/1064, 2-23=-2049/90, 4-21=-12/126, 4-22=-2114/113, 6-19=0/937, 5-20=0/237, 9-14=0/849, 10-13=-374/88, 2-22=-88/3224, 7-17=0/224, 7-19=-1118/64, 8-15=0/264, 8-14=-1279/59, 5-19=-804/75, 4-20=-452/77, 11-12=-1982/65, 11-13=-67/3870, 10-14=-496/270, 7-15=-256/94

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.1 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 117 lb uplift at joint 23 and 42 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 502 lb down and 53 lb up at 2-5-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)

Vert: 1-3=-70, 3-4=-70, 4-6=-70, 6-9=-70, 9-11=-70, 12-24=-20  
Concentrated Loads (lb)  
Vert: 30=-502 (B)



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H2A	Roof Special	1	1	168915672
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:04  
ID:UoRh?PYLefiskdVjukszhQz0UA1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

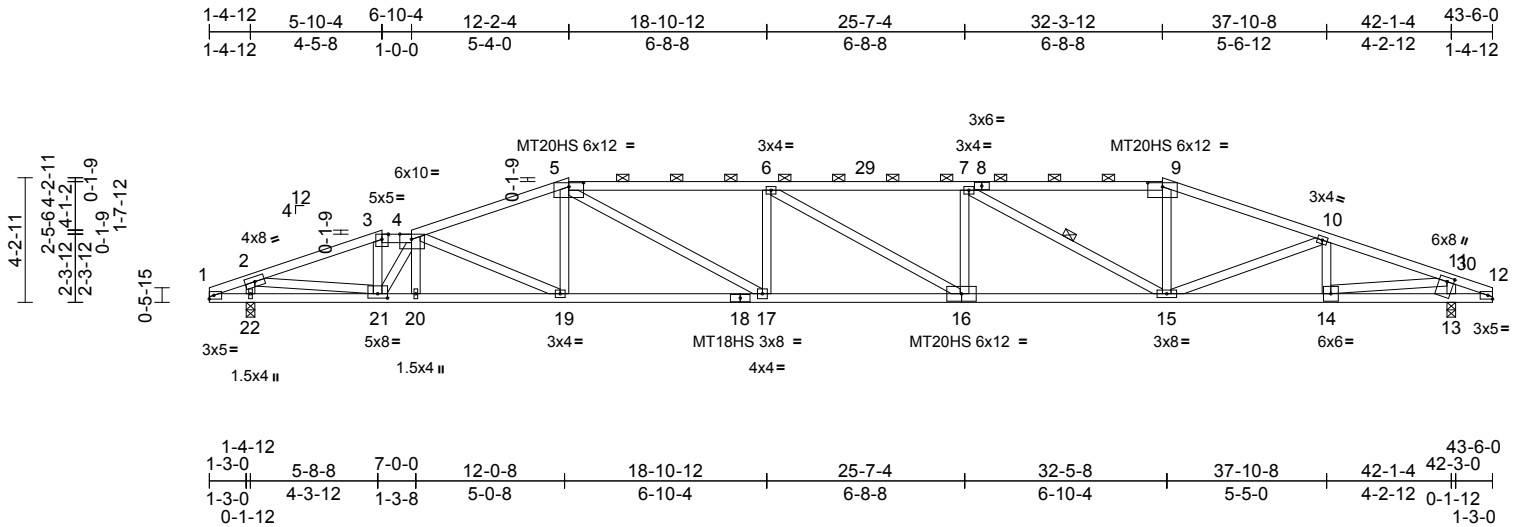

Scale = 1:75.9

Plate Offsets (X, Y): [4:0-4-12, Edge], [5:0-6-0, 0-1-11], [9:0-6-0, 0-1-11], [11:0-1-12, 0-2-12], [21:0-4-0, 0-1-12]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.86	Vert(LL)	-0.57	16-17	>858	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.91	16-17	>534	180	MT20HS	187/143
TCDL	10.0	Rep Stress Incr	YES	WB	0.84	Horz(CT)	0.19	13	n/a	n/a	MT18HS	244/190
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.22	16-17	>999	360		
BCDL	10.0											
											Weight: 226 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2 \*Except\* 5-8,8-9:2x4 SP 2400F 2.0E  
BOT CHORD 2x4 SP 2400F 2.0E  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 1-11-5 oc purlins, except 2-0-0 oc purlins (2-5-3 max.): 3-4, 5-9  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 7-15

#### REACTIONS

(size) 13=0-3-8, 22=0-3-8  
Max Horiz 22=43 (LC 12)  
Max Uplift 13=68 (LC 9), 22=71 (LC 8)  
Max Grav 13=2046 (LC 40), 22=2027 (LC 40)

#### FORCES

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-390/8, 2-3=-3975/105, 3-4=-3725/111, 4-5=-4756/133, 5-6=-6051/156, 6-7=-5956/143, 7-9=-4183/132, 9-10=-4433/121, 10-11=-3809/100, 11-12=-347/5  
BOT CHORD 1-22=0/384, 21-22=-27/384, 20-21=-114/4555, 19-20=-112/4563, 17-19=-77/4502, 15-17=-89/6048, 14-15=-57/3579, 13-14=0/348, 12-13=0/348  
WEBS 3-21=0/1043, 4-21=-1826/51, 4-20=0/134, 4-19=-617/80, 5-19=0/370, 5-17=-69/1784, 6-17=-757/116, 6-16=-251/92, 7-16=0/297, 7-15=-2026/73, 9-15=0/895, 10-15=-109/679, 2-22=-1861/116, 2-21=-66/3410, 10-14=-483/69, 11-13=-1861/101, 11-14=-67/3271

#### NOTES

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are MT20 plates unless otherwise indicated.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) All bearings are assumed to be SP 2400F 2.0E .
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 22 and 68 lb uplift at joint 13.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089, Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:05 Page: 1  
ID:118aTbBLa\_uWbwCHjObdTz0U7O-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC7f

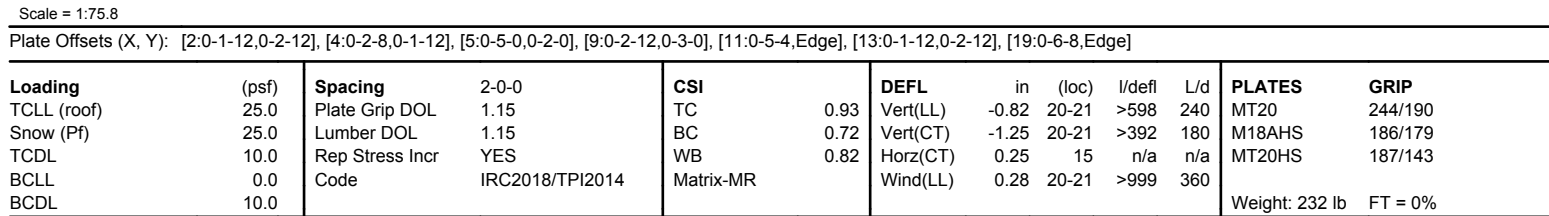

LOAD CASE(S) Standard



October 17, 2024

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP11 Quality Criteria, and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcscomponents.com](http://www.sbcscomponents.com))

**Mitek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingle Ridge Rd  
Crested Hill, MO 65010  
#84-0209, Nixa, MO  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H3	Hip	1	1	168915674
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:05

Page: 1

ID:gSPqfllYdRVn2QsX0FRLkz1i5K-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDol7J4JC?f

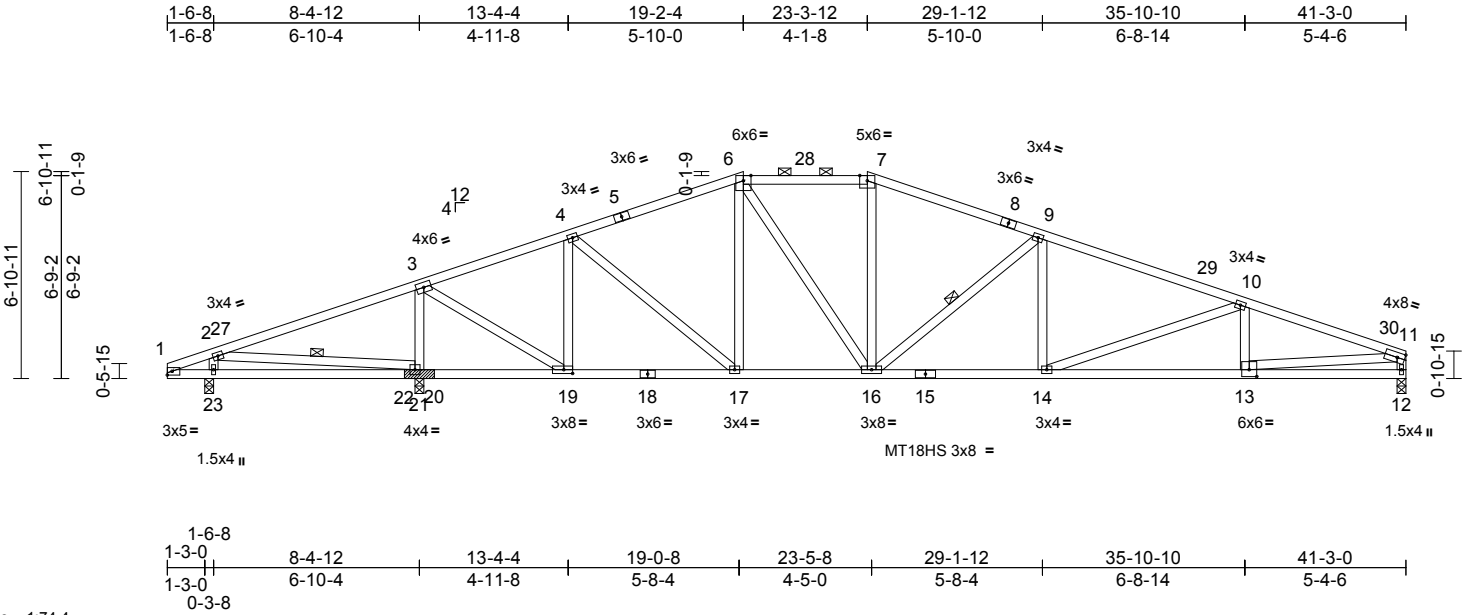

Scale = 1:74.4

Plate Offsets (X, Y): [13:0-3-0,0-2-12], [19:0-3-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	-0.24	13-14	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.98	Vert(CT)	-0.38	13-14	>999	180	MT18HS	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.08	12	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.08	13-14	>999	360		
BCDL	10.0											
											Weight: 235 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2 \*Except\* 1-5:2x4 SP No.1  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (3-6-10 max.): 6-7.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc  
bracing, Except:  
5-2-12 oc bracing: 19-21  
2-2-0 oc bracing: 13-14.  
WEBS 1 Row at midpt 9-16, 2-21

**REACTIONS** (size) 12=0-3-8, 21=(0-3-8 + bearing  
block), (req. 0-3-10), 23=0-3-8  
Max Horiz 23=81 (LC 12)  
Max Uplift 12=29 (LC 9), 21=5 (LC 8),  
23=176 (LC 52)  
Max Grav 12=1861 (LC 36), 21=3058 (LC  
36), 23=169 (LC 51)

**FORCES** (lb) - Maximum Compression/Maximum  
Tension

TOP CHORD 1-2=-230/22, 2-3=0/1316, 3-4=-1223/52,  
4-6=-1861/70, 6-7=-2024/97, 7-9=-2250/87,  
9-10=-3227/81, 10-11=-3759/70  
BOT CHORD 1-23=-21/290, 21-23=-93/290,  
19-21=-1132/54, 17-19=-6/1069,  
16-17=0/1680, 14-16=0/2952,  
13-14=-37/3518, 12-13=0/0  
WEBS 4-19=-1249/43, 6-17=-416/62, 6-16=-52/691,  
7-16=0/317, 3-21=-2753/75, 3-19=0/2572,  
4-17=0/829, 9-14=0/350, 9-16=-1189/67,  
11-12=-1814/51, 10-13=-328/86,  
10-14=-601/59, 11-13=-38/3546,  
2-23=-131/272, 2-21=-1430/18

#### NOTES

- 2x4 SP No.2 bearing block 12" long at jt. 21 attached to front face with 2 rows of 10d (0.148"x3") nails spaced 3" o.c. 8 Total fasteners. Bearing is assumed to be SP No.2.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 12, 5 lb uplift at joint 21 and 176 lb uplift at joint 23.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089, Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:05 Page: 1  
ID:FcCGSSV?Kl dfMKhr2alXWz1i5e-RfC?PsB70Hg3NSqPqnL8w3ulTXbGKWrCDoi7J4zJC?f



<b>LUMBER</b>		2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
TOP CHORD	2x4 SP No.2 *Except* 1-5:2x4 SP No.1	Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
BOT CHORD	2x4 SP No.2	3) TCELL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
WEBS	2x4 SP No.2	4) Unbalanced snow loads have been considered for this design.
<b>BRACING</b>		5) Provide adequate drainage to prevent water ponding.
TOP CHORD	Structural wood sheathing directly applied or 2-4-2 oc purlins, except	6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
	2-0-0 oc purlins (3-7-10 max.): 5-7.	7) All bearings are assumed to be SP No.2 .
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:	8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 11, 19 lb uplift at joint 19 and 223 lb uplift at joint 20.
	5-3-8 oc bracing: 18-19.	9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
WEBS	1 Row at midpt 2-19	10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
<b>REACTIONS</b>		<b>LOAD CASE(S)</b> Standard
	(size) 11=0-3-8, 19=0-3-8, 20=0-3-8	
	Max Horiz 20=72 (LC 12)	
	Max Uplift 11=-34 (LC 9), 19=-19 (LC 8), 20=-223 (LC 52)	
	Max Grav 11=1771 (LC 36), 19=2856 (LC 36), 20=127 (LC 38)	
<b>FORCES</b>		
	(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-248/25, 2-3=-10/1280, 3-4=-798/59, 4-5=-1464/68, 5-6=-1321/78, 6-7=-2055/109, 7-8=-2266/99, 8-9=-3122/94, 9-10=-3413/78	
BOT CHORD	1-20=-21/320, 19-20=-89/320, 18-19=-1097/63, 16-18=-13/669, 15-16=0/1774, 13-15=-13/2872, 12-13=-48/3193, 11-12=0/0	
WEBS	5-16=0/169, 6-16=-921/40, 6-14=-50/525, 7-14=0/305, 8-13=0/272, 8-14=-1010/60, 10-11=-1727/54, 9-12=-368/75, 10-12=-49/3227, 9-13=-344/46, 4-18=-1236/36, 3-19=-2560/86, 4-16=-7/1046, 2-20=-174/316, 2-19=-1423/28, 3-18=0/2183, 6-15=0/152	

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDF=6.0psf; BCDF=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Provide adequate drainage to prevent water ponding.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) All bearings are assumed to be SP No.2.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 11, 19 lb uplift at joint 19 and 223 lb uplift at joint 20.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 17.2024

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**Mitek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Crestwood, MO 63024  
#34-0201 NixUS, Inc  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H3B	Hip	1	1	168915676
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:06

Page: 1

ID:OTplqGGJqoHn6tE7AV3tcEyeynL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

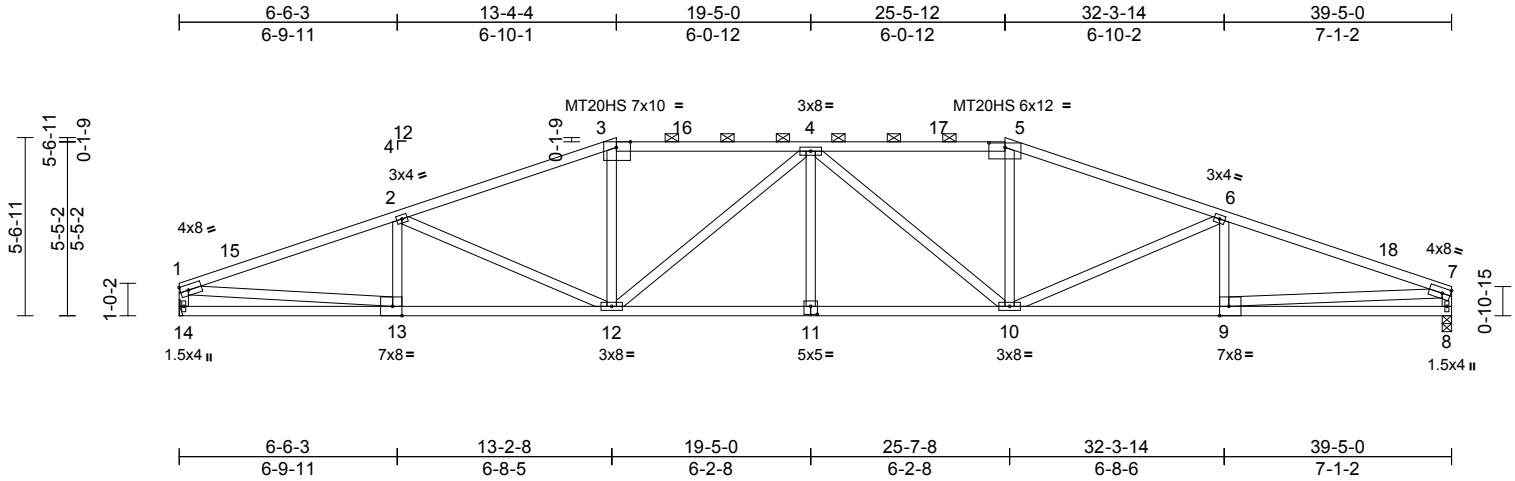

Scale = 1:74.3

Plate Offsets (X, Y): [3:0-5-4,Edge], [5:0-6-0,0-1-11], [9:0-3-8,Edge], [11:0-2-8,0-3-0], [13:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.33	11	>999	240	MT20HS	187/143
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.57	10-11	>829	180	MT20	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	1.00	Horz(CT)	0.14	8	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.14	11	>999	360		
BCDL	10.0											
Weight: 215 lb											FT = 0%	

#### LUMBER

TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 3-5:2x4 SP No.2  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 3-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 8=0-3-8, 14= Mechanical  
Max Horiz 14=54 (LC 13)  
Max Uplift 8=35 (LC 9), 14=34 (LC 8)  
Max Grav 8=2112 (LC 36), 14=2105 (LC 36)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-4207/85, 2-3=-3557/97, 3-4=-3247/110, 4-5=-3283/112, 5-6=-3597/99, 6-7=-4364/89  
BOT CHORD 13-14=-50/54, 12-13=-79/3926, 10-12=-9/3639, 9-10=-45/4072, 8-9=0/0  
WEBS 2-13=-309/97, 2-12=-726/73, 3-12=0/605, 4-12=-717/57, 4-11=0/243, 4-10=-680/57, 5-10=0/622, 6-9=-246/98, 6-10=-845/74, 7-8=-2050/68, 7-9=-45/4090, 1-14=-2046/66, 1-13=-43/3951

#### NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are MT20 plates unless otherwise indicated.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Bearings are assumed to be: , Joint 8 SP No.1 .
- 9) Refer to girder(s) for truss to truss connections.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 14 and 35 lb uplift at joint 8.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089, Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:06 Page: 1  
ID:UEtmPEaaUSDRDPBVfZJmEva1CB-RfC?PsB70Hg3NSqPqnL8w3u1TXbGKWrCDoi7J4zJC?f

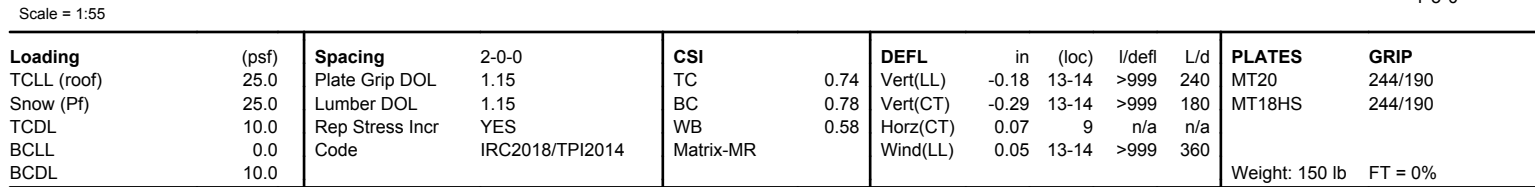

- 4) Unbalanced snow loads have been considered for this design.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are MT20 plates unless otherwise indicated.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) All bearings are assumed to be SP No.2.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 15 and 34 lb uplift at joint 9.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)**      Standard

LOAD CASE(S) Standard

- ## NOTES
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCdL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10



October 17, 2024

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcscomponents.com](http://www.sbcscomponents.com))

**Mitek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
16023 Swinley Ridge Rd  
Cresskill, NJ 08017  
DEVELOPMENT SERVICES  
Lee's Summit, Missouri  
914.420.1100  
01/16/2025 2:41:45




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	H4A	Hip	1	1	168915678
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:06

Page: 1

ID:JktAVMhf2PhWdOeO4AS6aQya1Am-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

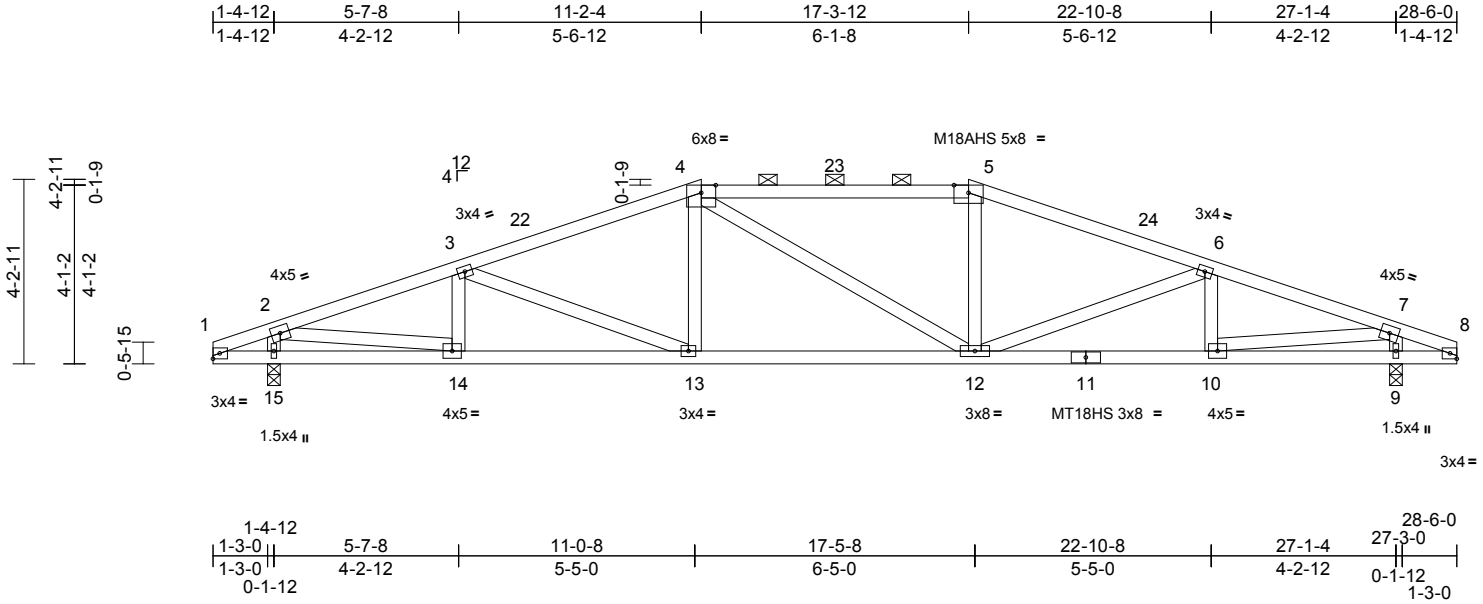

<b>Loading</b>	(psf)	<b>Spacing</b>	2-0-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.14	13-14	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.25	12-13	>999	180	M18AHS	186/179
TCDL	10.0	Rep Stress Incr	YES	WB	0.56	Horz(CT)	0.07	9	n/a	n/a	MT18HS	244/190
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.05	13	>999	360		
BCDL	10.0										Weight: 143 lb	FT = 0%

<b>LUMBER</b>		
TOP CHORD	2x4	SP No.2
BOT CHORD	2x4	SP No.2
WEBS	2x4	SP No.2
<b>BRACING</b>		
TOP CHORD	Structural wood sheathing directly applied or 2-5-14 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 4-5.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
<b>REACTIONS</b>	(size)	9=0-3-8, 15=0-3-8
	Max Horiz	15=43 (LC 12)
	Max Uplift	9=42 (LC 9), 15=42 (LC 8)
	Max Grav	9=1624 (LC 36), 15=1624 (LC 36)
<b>FORCES</b>		
	(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-155/4, 2-3=-2624/44, 3-4=-2283/53, 4-5=-2072/68, 5-6=-2283/52, 6-7=-2624/45, 7-8=-155/4	
BOT CHORD	1-15=0/166, 14-15=-36/166, 13-14=-36/2425 12-13=0/2072, 10-12=-5/2425, 9-10=0/166, 8-9=0/166	
WEBS	3-13=-368/131, 4-13=0/277, 4-12=-237/238, 5-12=0/277, 6-12=-367/131, 3-14=-296/62, 6-10=-296/61, 7-9=-1490/77, 7-10=-19/2286, 2-15=-1490/77, 2-14=-21/2287	

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 9 and 42 lb uplift at joint 15.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089, Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:06 Page: 1  
ID:CaD0dzZp5XlIGS8ElIk?Vcya19e-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDdoi7J4zJC?f

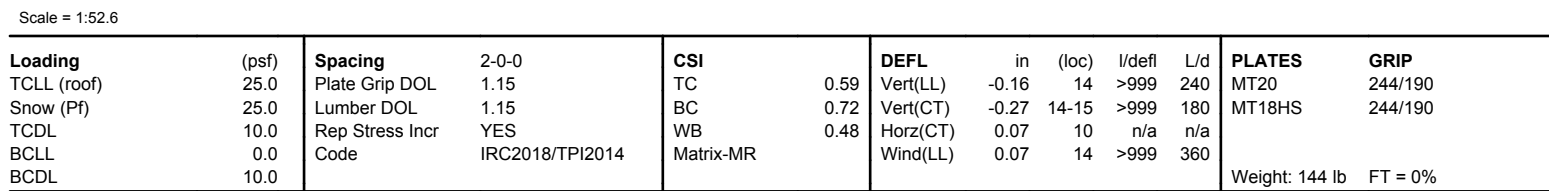

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)  
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
16023 Swingley Ridge Rd  
Greenfield, MO 65601  
816.424.6600  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	J2	Jack-Open	8	1	168915680
					Job Reference (optional)

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:07

Page: 1

ID: \_ZmwUjBtBwv4A4JyMxTryz1iUa-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

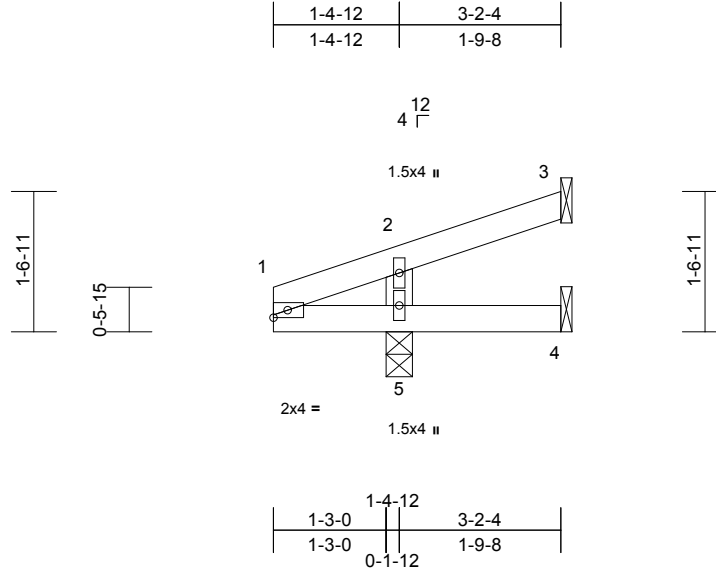

Scale = 1:17.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	0.00	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	-0.01	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	4-5	>999	360		
BCDL	10.0											
											Weight: 10 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 3-2-4 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 3= Mechanical, 4= Mechanical,  
5=0-3-8  
Max Horiz 5=28 (LC 8)  
Max Uplift 3=-17 (LC 12), 4=-10 (LC 18),  
5=-22 (LC 8)  
Max Grav 3=46 (LC 18), 4=16 (LC 7), 5=329 (LC 18)

#### FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-25/34, 2-3=-38/9  
BOT CHORD 1-5=-3/28, 4-5=0/0  
WEBS 2-5=-230/34

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearings are assumed to be: , Joint 5 SP No.2 .
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 3, 10 lb uplift at joint 4 and 22 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	J3	Jack-Open	2	1	168915681
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:07

Page: 1

ID: \_ZmwUjBtBwv4A4JyMsxTryz1iUa-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

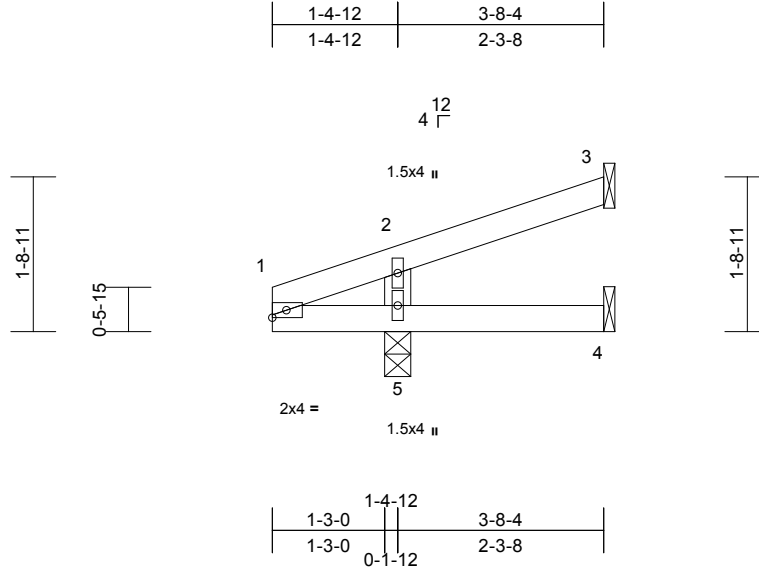

Scale = 1:18.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	0.00	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	-0.01	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	4-5	>999	360		
BCDL	10.0											
											Weight: 12 lb	FT = 0%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 3-8-4 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	3= Mechanical, 4= Mechanical, 5=0-3-8
	Max Horiz	5=33 (LC 8)
	Max Uplift	3=-20 (LC 12), 5=-20 (LC 8)
	Max Grav	3=76 (LC 18), 4=29 (LC 7), 5=349 (LC 18)

#### FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-32/38, 2-3=-45/17
BOT CHORD	1-5=-3/33, 4-5=0/0
WEBS	2-5=-264/42

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearings are assumed to be: , Joint 5 SP No.2 .
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 20 lb uplift at joint 3 and 20 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

#### LOAD CASE(S)

Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	J3A	Jack-Open	2	1	168915682
					Job Reference (optional)

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:07

Page: 1

ID: \_ZmwUjBtBwv4A4JyMxTryz1iUa-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

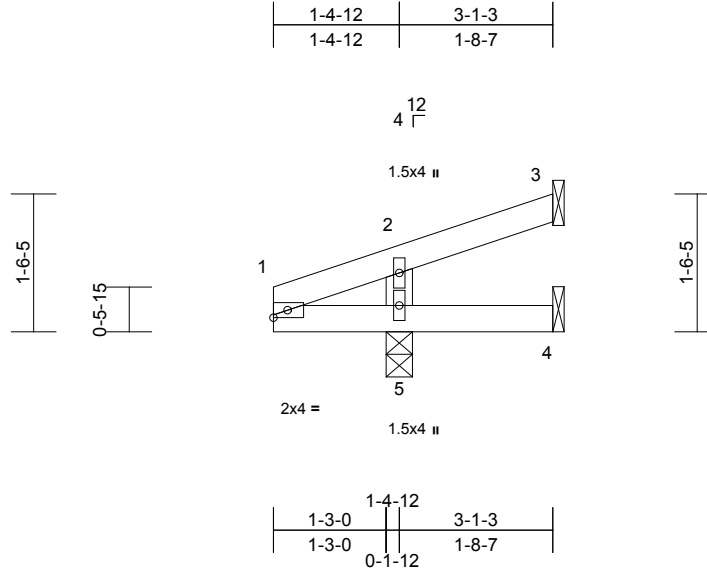

Scale = 1:17.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	0.00	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	0.00	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	-0.01	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	4-5	>999	360		
BCDL	10.0										Weight: 10 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 3-1-3 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 3= Mechanical, 4= Mechanical,  
5=0-3-8  
Max Horiz 5=27 (LC 8)  
Max Uplift 3=-16 (LC 12), 4=-13 (LC 18),  
5=-22 (LC 8)  
Max Grav 3=40 (LC 18), 4=13 (LC 7), 5=326 (LC 18)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-24/34, 2-3=-37/8  
BOT CHORD 1-5=-3/27, 4-5=0/0  
WEBS 2-5=-225/33

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearings are assumed to be: , Joint 5 SP No.2 .
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 3, 13 lb uplift at joint 4 and 22 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:45

Job MSA2408-R	Truss J6	Truss Type Jack-Partial	Qty 39	Ply 1	1404 NE ERNEST WAY, LEE'S SUMMIT Job Reference (optional)	I68915683
------------------	-------------	----------------------------	-----------	----------	--	-----------

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:07  
ID:8Xn4wBoUWhc2bVlo3OjRi6z1iJS-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

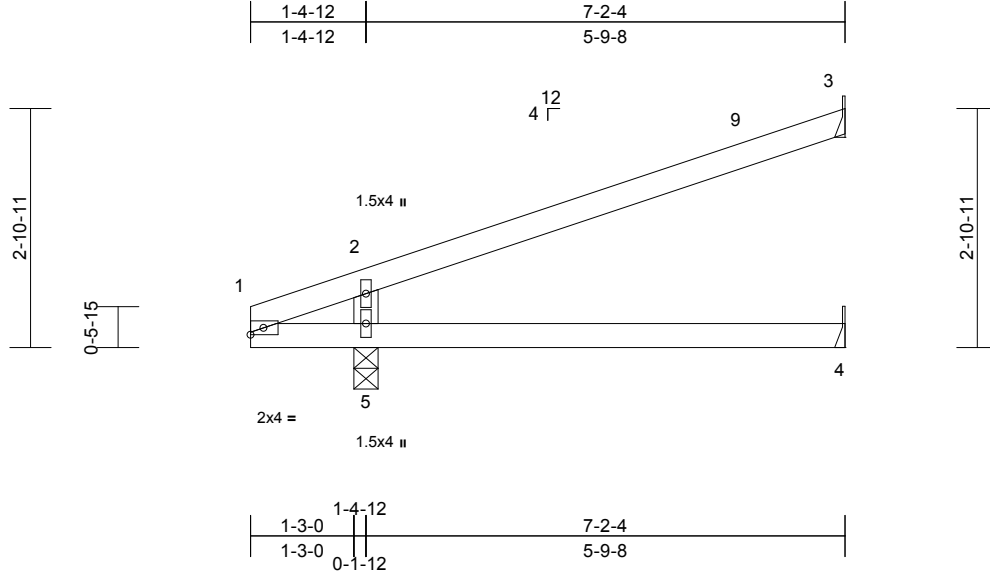

Scale = 1:22.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.87	Vert(LL)	-0.05	4-5	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.37	Vert(CT)	-0.11	4-5	>633	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.05	3	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.03	4-5	>999	360		
BCDL	10.0										Weight: 23 lb	FT = 0%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 1-11-14 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

<b>REACTIONS</b> (size)	3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz	5=64 (LC 8)
Max Uplift	3=-44 (LC 8), 5=-18 (LC 8)
Max Grav	3=259 (LC 18), 4=104 (LC 7), 5=546 (LC 18)

<b>FORCES</b> (lb) - Maximum Compression/Maximum Tension	
--	--

TOP CHORD	1-2=-82/96, 2-3=-105/63
BOT CHORD	1-5=-49/64, 4-5=0/0
WEBS	2-5=-635/135

#### NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearings are assumed to be: , Joint 5 SP No.2 .
- 6) Refer to girder(s) for truss to truss connections.

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 3 and 18 lb uplift at joint 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	J6A	Half Hip	4	1	168915684
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:07  
ID:JarXyh6kxQ8GlurDwB4u4z1iKL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

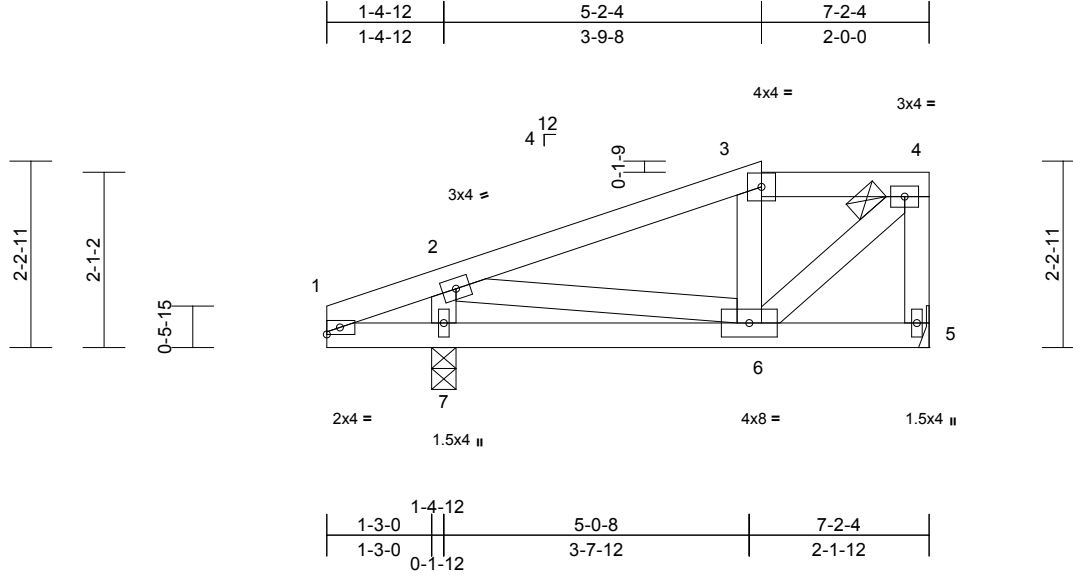

Scale = 1:21.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	0.00	6-7	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	-0.01	6-7	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.00	5	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	6-7	>999	360		
BCDL	10.0										Weight: 36 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 5= Mechanical, 7=0-3-8  
Max Horiz 7=50 (LC 11)  
Max Uplift 5=-9 (LC 8), 7=-29 (LC 8)  
Max Grav 5=262 (LC 32), 7=548 (LC 33)

#### FORCES

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-40/8, 2-3=-270/5, 3-4=-189/14, 4-5=-251/14  
BOT CHORD 1-7=-13/65, 6-7=-47/65, 5-6=-17/13  
WEBS 2-7=-518/70, 2-6=0/123, 3-6=-136/36, 4-6=0/260

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- Bearings are assumed to be: Joint 7 SP No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 9 lb uplift at joint 5 and 29 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46




Page: 1

October 17, 2024

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Crestedmont, MO 68026  
#34-0201-1160 US, Inc.  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46



Page: 1

**WARNING – Verify design parameters and check notes on this and included MiTek® literature. Page 4474169, 11/20/23 before use.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria**, and **DSB-22** available from Truss Plate Institute ([www.tpiinst.org](http://www.tpiinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))


**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Crested Butte, MO 64805  
#34-0201 NixUS, Inc  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46

Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	J6D	Half Hip Girder	2	1	I68915687
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:08  
ID:N7I3FSITPDBeG8GbjaZNQz1iJa-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

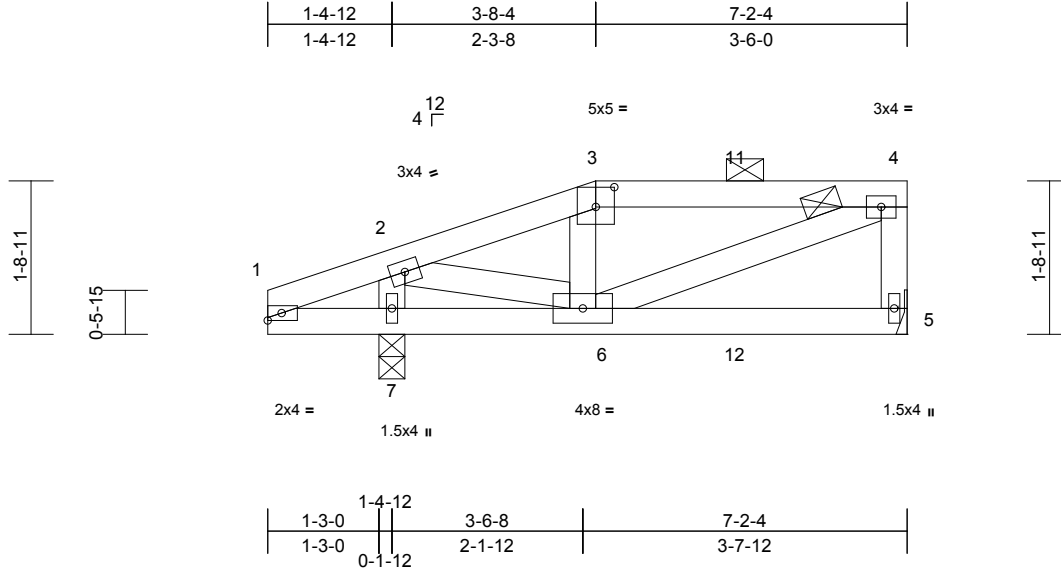

Scale = 1:19.3

Plate Offsets (X, Y): [3:0-2-8,0-2-11]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.44	Vert(LL)	0.00	5-6	>999	240	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	-0.01	5-6	>999	180	
TCDL	10.0	Rep Stress Incr	NO	WB	0.07	Horz(CT)	0.00	5	n/a	n/a	
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MP		Wind(LL)	0.00	5-6	>999	360	
BCDL	10.0										
										Weight: 34 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 5= Mechanical, 7=0-3-8  
Max Horiz 7=40 (LC 11)  
Max Uplift 5=-13 (LC 9), 7=-31 (LC 8)  
Max Grav 5=325 (LC 32), 7=516 (LC 33)

#### FORCES

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-18/112, 2-3=-291/6, 3-4=-254/10, 4-5=-295/29  
BOT CHORD 1-7=-68/19, 6-7=-76/6, 5-6=-13/10  
WEBS 3-6=-139/39, 4-6=-8/277, 2-6=0/292, 2-7=-454/40

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearings are assumed to be: Joint 7 SP No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 13 lb uplift at joint 5 and 31 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 59 lb down and 32 lb up at 3-8-4, and 55 lb down and 24 lb up at 5-3-0 on top chord, and 12 lb down and 25 lb up at 3-8-4, and 3 lb down and 6 lb up at 5-3-0 on bottom chord. The design/selection of such connection device (s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-3=-70, 3-4=-70, 5-8=-20  
Concentrated Loads (lb)  
Vert: 3=-16 (F), 6=4 (F), 11=-13 (F), 12=2 (F)




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089, Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:08 Page: 1  
ID:5wnyG0D3uwtThAB\_At72HTz1i3Q-RfC?PsB70Hg3NSgPqnL8w3uITxbGKWrcD0i7J4zJC?f



<b>LUMBER</b>		2) Wind: ASCE 7-16; Vult=115mph (3-second gust)	Ver: 1-3=-70, 3-4=-70, 4-7=-70, 7-11=-70, 23-26=-20
TOP CHORD	2x4 SP No.2 *Except* 7-8,8-11:2x4 SP No.1	Vasd=91mph; TCdL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone;	Concentrated Loads (lb) Ver: 21=4 (F)
BOT CHORD	2x4 SP No.2	cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60	
WEBS	2x4 SP No.2		
<b>BRACING</b>			
TOP CHORD	Structural wood sheathing directly applied or 1-7-8 oc purlins, except	3) TCELL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10	
BOT CHORD	2-0-0 oc purlins (5-1-12 max.): 3-4.		
	Rigid ceiling directly applied or 5-8-1 oc bracing.	4) Unbalanced snow loads have been considered for this design.	
WEBS	1 Row at midpt 7-16	5) Provide adequate drainage to prevent water ponding.	
<b>REACTIONS</b>		6) All plates are MT20 plates unless otherwise indicated.	
	(size) 12=0-3-8, 16=0-3-8, 22=0-3-8	7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	
	Max Horiz 22=-82 (LC 13)	8) All bearings are assumed to be SP No.2 .	
	Max Uplift 12=-65 (LC 89), 22=-46 (LC 8)	9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 46 lb uplift at joint 22 and 65 lb uplift at joint 12.	
	Max Grav 12=630 (LC 85), 16=2755 (LC 38), 22=1213 (LC 38)	10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.	
<b>FORCES</b>		11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.	
	(lb) - Maximum Compression/Maximum Tension	12) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 43 lb down and 22 lb up at 3-2-4 on top chord, and 9 lb down and 21 lb up at 3-2-4 on bottom chord. The design/ selection of such connection device(s) is the responsibility of others.	
TOP CHORD	1-2=-21/106, 2-3=-1218/40, 3-4=-1065/41, 4-5=-2666/109, 5-6=-1789/124, 6-7=-516/169, 7-9=-45/1534, 9-10=-757/444, 10-11=-204/16	13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).	
BOT CHORD	1-22=-71/23, 21-22=-82/80, 20-21=-131/2488, 19-20=-81/1617, 18-19=-136/389, 16-18=-757/69, 14-16=-994/83, 13-14=-386/659, 12-13=-22/237, 11-12=-22/237	<b>LOAD CASE(S)</b> Standard	
WEBS	3-21=-31/389, 4-21=-1656/58, 4-20=-400/86, 7-16=-2287/72, 2-22=-1101/58, 2-21=-23/1235, 5-20=-46/945, 5-19=-900/123, 6-19=-81/1584, 6-18=-1310/144, 7-18=-69/1850, 10-12=-576/140, 8-16=-1148/89, 8-14=0/431, 9-14=-882/43, 9-13=0/271, 10-13=-446/430	1) Dead & Snow (balanced); Lumber Increase=1.15; Plate	

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the proper calculation, storage, delivery, erection and loading of trusses and truss systems, see **ANSI/TPI 1 Quality Criteria**, and **DSB-22** available from the Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	T3	Common	4	1	168915689
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:08

Page: 1

ID:FqkHRZ5AvIKhh3O1MSahbzz1iDv-RfC?PsB70Hq3NSgPqnl8w3uITxbGKWrCDoi7J4zJC?f

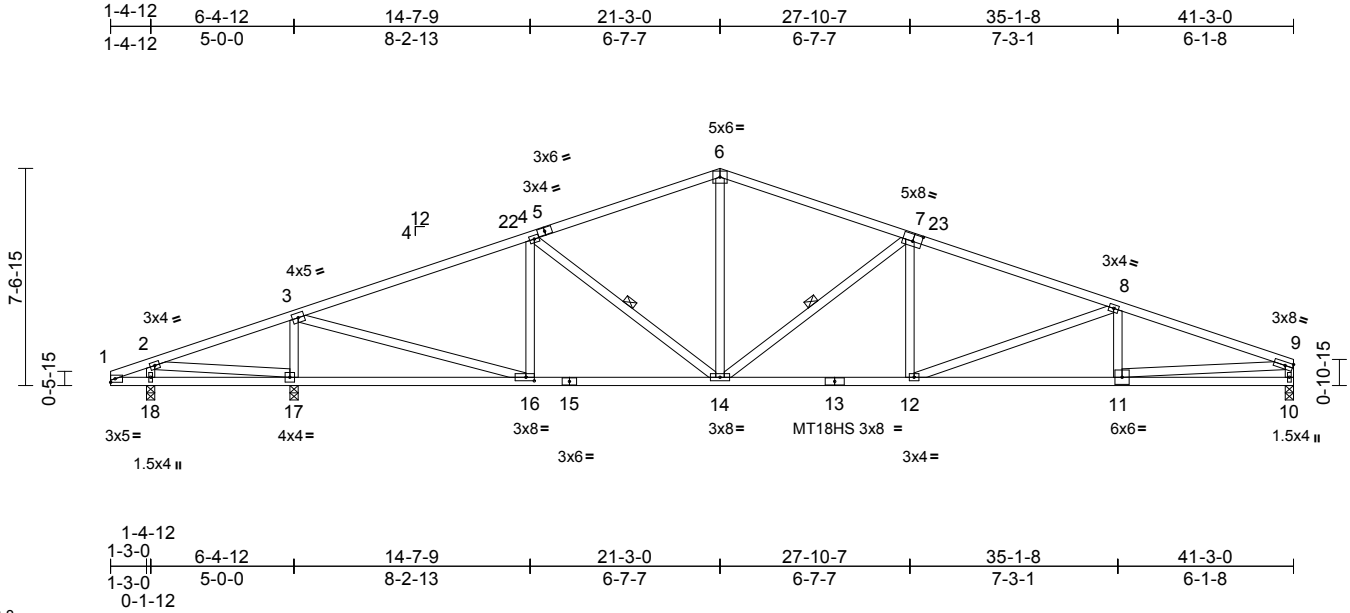

Scale = 1:76.8

Plate Offsets (X, Y): [7:0-3-12,0-3-0], [16:0-3-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.94	Vert(LL)	-0.19	11-12	>999	240	MT18HS 244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.38	11-12	>999	180	MT20 244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.73	Horz(CT)	0.07	10	n/a	n/a	
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.09	11-12	>999	360	
BCDL	10.0										
Weight: 221 lb FT = 0%											

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

WEBS 1 Row at midpt 4-14, 7-14

REACTIONS (size) 10=0-3-8, 17=0-3-8, 18=0-3-8

Max Horiz 18=90 (LC 12)

Max Uplift 10=-19 (LC 9), 17=-9 (LC 8),

18=-182 (LC 19)

Max Grav 10=1529 (LC 19), 17=2266 (LC 1),

18=72 (LC 31)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-22/143, 2-3=-10/834, 3-4=-1877/21,  
4-6=-1864/66, 6-8=-2742/58, 8-9=-3151/48

BOT CHORD 1-18=-112/22, 17-18=-141/61,  
16-17=-728/46, 14-16=0/1697, 12-14=0/2540,  
11-12=-12/2951, 10-11=0/0

WEBS 6-14=0/681, 2-18=-35/214, 9-10=-1478/46,  
4-16=-537/77, 3-16=0/2500, 4-14=-229/275,  
7-12=0/397, 7-14=-1109/78, 8-11=-188/91,  
8-12=-538/64, 9-11=-12/2969,  
3-17=-2017/96, 2-17=-631/13

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)  
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 10, 182 lb uplift at joint 18 and 9 lb uplift at joint 17.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard




October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46

Page: 1

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
16023 Swingley Ridge Rd  
Crestedmont, MO 63001  
#34-0201-1160 US  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46




Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	T3B	Common	1	1	168915691
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:09  
ID:dMW0YP25GKaRSK7bbX3bNqz1iHr-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

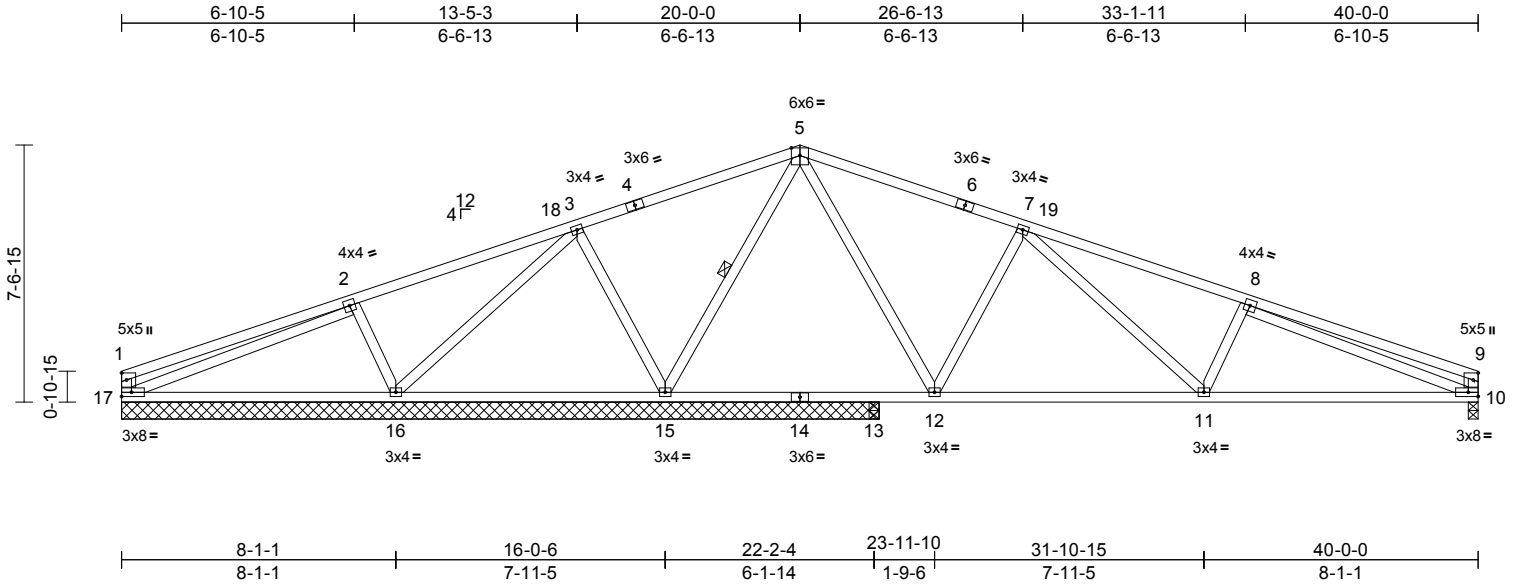

Scale = 1:68.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.10	11-12	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.63	Vert(CT)	-0.22	11-12	>955	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.02	10	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.04	11-12	>999	360		
BCDL	10.0											
											Weight: 214 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 3-11-2 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

WEBS 1 Row at midpt 5-15

**REACTIONS** (size) 10=0-3-8, 13=0-3-8, 15=22-4-0, 16=22-4-0, 17=22-4-0  
Max Horiz 17=62 (LC 13)  
Max Uplift 10=28 (LC 9), 15=11 (LC 9), 16=55 (LC 12), 17=2 (LC 8)  
Max Grav 10=907 (LC 19), 13=146 (LC 19), 15=1956 (LC 1), 16=541 (LC 31), 17=317 (LC 31)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-535/39, 2-3=-15/237, 3-5=0/840, 5-7=-587/101, 7-8=-1491/96, 8-9=-690/47, 1-17=-374/56, 9-10=-435/59

BOT CHORD 16-17=-81/144, 15-16=-563/92, 13-15=-48/79, 12-13=-48/79, 11-12=0/857, 10-11=-43/1488

WEBS 2-17=-23/402, 8-10=-986/36, 2-16=-490/117, 3-16=-4/538, 3-15=-655/94, 5-15=-1583/64, 5-12=-35/937, 7-12=-891/120, 7-11=-2/720, 8-11=-360/111

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2 lb uplift at joint 17, 28 lb uplift at joint 10, 55 lb uplift at joint 16 and 11 lb uplift at joint 15.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



October 17, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46


Job	Truss	Truss Type	Qty	Ply	1404 NE ERNEST WAY, LEE'S SUMMIT
MSA2408-R	T4	Common	1	1	168915692
Job Reference (optional)					

Quality Truss LLC (Smithville, MO), Smithville, MO - 64089,

Run: 8.82 S Sep 25 2024 Print: 8.820 S Sep 25 2024 MiTek Industries, Inc. Tue Oct 15 12:18:09

Page: 1

ID:GKKd85aO6xrmr8f2AmLNojya1G4-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

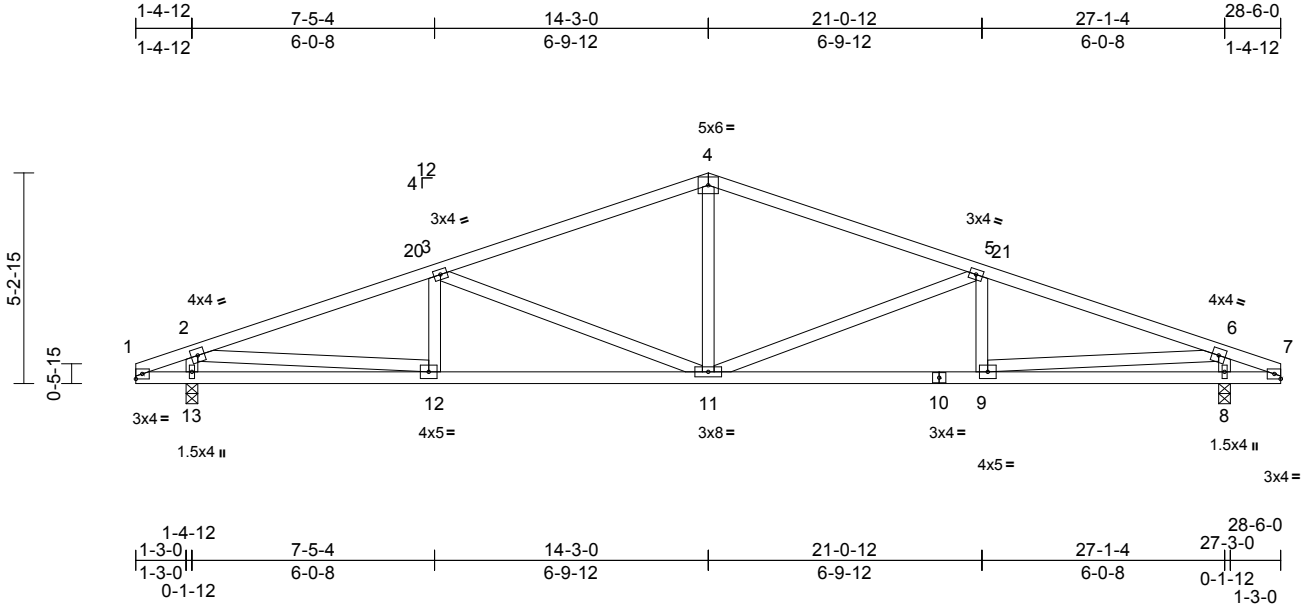

Scale = 1:56.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.12	9-11	>999	240	MT20	244/190
Snow (Pf)	25.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.24	9-11	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.68	Horz(CT)	0.05	8	n/a	n/a		
BCLL	0.0	Code	IRC2018/TPI2014	Matrix-MR		Wind(LL)	0.05	11-12	>999	360		
BCDL	10.0										Weight: 140 lb	FT = 0%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.2

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS (size)

8=0-3-8, 13=0-3-8  
Max Horiz 13=55 (LC 12)  
Max Uplift 8=-29 (LC 9), 13=-29 (LC 8)  
Max Grav 8=1322 (LC 19), 13=1322 (LC 18)

#### FORCES

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-288/13, 2-3=-2363/19, 3-4=-1721/25, 4-5=-1721/25, 5-6=-2363/19, 6-7=-288/13  
BOT CHORD 1-13=0/313, 12-13=-54/313, 11-12=-10/2186, 9-11=0/2186, 8-9=-2/313, 7-8=-2/313  
WEBS 3-12=-103/121, 3-11=-736/78, 4-11=0/546, 5-11=-736/78, 5-9=-103/121, 2-13=-1193/101, 2-12=0/1926, 6-8=-1193/101, 6-9=0/1926

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=20ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=25.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All bearings are assumed to be SP No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 13 and 29 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

#### LOAD CASE(S)

Standard



October 17, 2024



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46

# Symbols

## PLATE LOCATION AND ORIENTATION

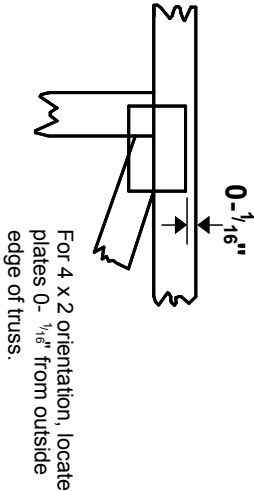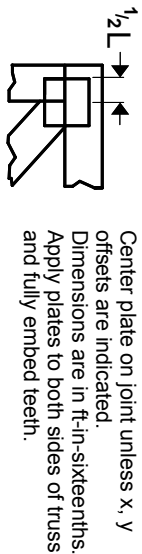

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

## PLATE SIZE


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

**Industry Standards:**  
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

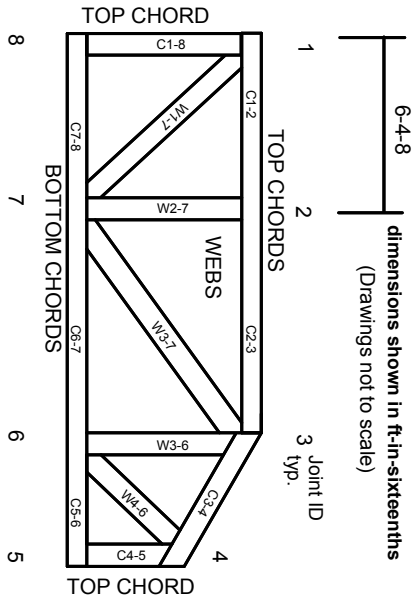

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## Product Code Approvals

ICC-ES Reports:  
ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

## Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.  
Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

RELEASE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/16/2025 2:41:46