

March 26, 2025

Suntria
2141 E Broadway Road
Suite 202
Tempe, AZ 85282

Re: Engineering Services
Gaylord Residence
2043 SW Hook Farm Drive, Lee's Summit MO
5.880 kW System

To Whom It May Concern:

We have received information regarding solar panel installation on the roof of the above referenced structure. Our evaluation of the structure is to verify the existing capacity of the roof system and its ability to support the additional loads imposed by the proposed solar system.

A. Site Assessment Information

1. Site visit documentation identifying attic information including size and spacing of framing for the existing roof structure.
2. Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information will be utilized for approval and construction of the proposed system.

B. Description of Structure:

Roof Framing: 2x6 dimensional lumber at 16" on center with purlin support near midspan
Roof Material: Composite Asphalt Shingles
Roof Slopes: 31 degrees
Attic Access: Accessible
Foundation: Permanent

C. Loading Criteria Used

- **Dead Load**
 - Existing Roofing and framing = 7 psf
 - New Solar Panels and Racking = 3 psf
 - TOTAL = 10 PSF
- **Live Load** = 20 psf (reducible) – 0 psf at locations of solar panels
- **Ground Snow Load** = 20 psf
- **Wind Load** based on ASCE 7-16
 - Ultimate Wind Speed = 109 mph (based on Risk Category II)
 - Exposure Category C

Analysis performed of the existing roof structure utilizing the above loading criteria is in accordance with the 2018 IRC. This analysis indicates that the existing framing will support the additional panel loading without damage, if installed correctly.

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025


D. Solar Panel Anchorage

1. The solar panels shall be mounted in accordance with the most recent K2 Systems installation manual. If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
2. The maximum allowable withdrawal force for a #14 lag screw is 194 lbs per inch of penetration as identified in the National Design Standards (NDS) of timber construction specifications. Based on two screws with a minimum penetration depth of 2", the allowable capacity per connection is greater than the design withdrawal force (demand). Considering the variable factors for the existing roof framing and installation tolerances, the connection using two # 14 lag screws with a minimum of 2" embedment will be adequate and will include a sufficient factor of safety.
3. Considering the wind speed, roof slopes, size and spacing of framing members, and condition of the roof, the panel supports shall be placed no greater than 48" on center.

Based on the above evaluation, this office certifies that with the racking and mounting specified, the existing roof system will adequately support the additional loading imposed by the solar system. This evaluation is in conformance with the 2018 IRC, current industry standards and practice, and is based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Very truly yours,

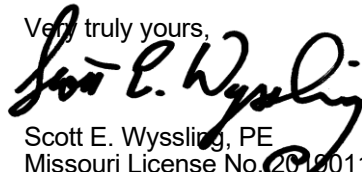
Scott E. Wyssling, PE
Missouri License No. 2019011786
Missouri COA #2020037943



Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Missouri COA # 2020037943

Signed 3/26/2025

NEW PHOTOVOLTAIC SYSTEM 5.880 KW DC
2043 SW HOOK FARM DR, LEE'S SUMMIT, MO 64082

SUNTRIA™

2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS
JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

ALL STAMP
RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
04/01/2025

SYSTEM SIZE
(N) 5.880 KW DC
(N) 4.060 KW AC

REVISIONS	DATE				
	DESCRIPTION				
REV					

SHEET TITLE
COVER PAGE

DRAWN DATE	03/25/2025
DRAWN BY	JJIA
REVIEWED BY	-

SHEET TITLE
PV - 0

GENERAL NOTES

- 1.1.1 PROJECT NOTES:
- 1.1.2 THIS PHOTOVOLTAIC (PV) SYSTEM SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE (NEC) ARTICLE 690, ALL MANUFACTURER'S LISTING AND INSTALLATION INSTRUCTIONS, AND THE RELEVANT CODES AS SPECIFIED BY THE AUTHORITY HAVING JURISDICTION'S (AHJ) APPLICABLE CODES.
- 1.1.3 THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION.
- 1.1.4 GROUND FAULT DETECTION AND INTERRUPTION (GFDI) DEVICE IS INTEGRATED WITH THE MICROINVERTER IN ACCORDANCE WITH NEC 690.41(B)
- 1.1.5 ALL PV SYSTEM COMPONENTS; MODULES, UTILITY-INTERACTIVE INVERTERS AND SOURCE CIRCUIT COMBINER BOXES ARE IDENTIFIED AND LISTED FOR USE IN PHOTOVOLTAIC SYSTEMS AS REQUIRED BY NEC 690.4: PV MODULES: UL1703, IEC61730, AND IEC61215, AND NFPA 70 CLASS C FIRE INVERTERS: UL 1741 CERTIFIED, IEEE 1547, 929, 519, COMBINER BOX(ES): UL 1703 OR UL 1741 ACCCESSORY
- 1.1.6 MAX DC VOLTAGE CALCULATED USING MANUFACTURER PROVIDED TEMP COEFFICIENT FOR VOC. IF UNAVAILABLE, MAX DC VOLTAGE CALCULATEDD ACCORDING TO NEC 690.7.
- 1.1.7 ALL INVERTERS, PHOTOVOLTAIC MODULES, PHOTOVOLTAIC PANELS, AND SOURCE CIRCUIT COMBINERS INTENDED FOR USE IN A PHOTOVOLTAIC POWER SYSTEM WILL BE IDENTIFIED AND LISTED FOR THE APPLICATION PER 690.4 (D). SHALL BE INSTALLED ACCORDING TO ANY INSTRUCTIONS FROM LISTING OR LABELING [NEC 110.3].
- 1.1.8 ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANCE. ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.
- 1.2.1 SCOPE OF WORK
- 1.2.2 PRIME CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND SPECIFICATIONS OF THE GRID-TIED PHOTOVOLTAIC SYSTEM RETROFIT. PRIME CONTRACTOR WILL BE RESPONSIBLE FOR COLLECTING EXISTING ONSITE REQUIREMENTS TO DESIGN, SPECIFY, AND INSTALL THE EXTERIOR ROOF-MOUNTED PORTION OF THE PHOTOVOLTAIC SYSTEMS DETAILED IN THIS DOCUMENT
- 1.3.1 WORK INCLUDES:
- 1.3.2 PV RACKING SYSTEM INSTALLATION - K2 CROSSRAIL
- 1.3.3 PV MODULE AND INVERTER INSTALLATION - SILFAB SOLAR SIL-420BG (420W) PV MODULES / ENPHASE IQ8PLUS-72-M-US MICROINVERTERS
- 1.3.4 PV EQUIPMENT ROOF MOUNT
- 1.3.5 PV SYSTEM WIRING TO A ROOF-MOUNTED JUNCTION BOX
- 1.3.6 PV LOAD CENTERS (IF INCLUDED)
- 1.3.7 PV METERING/MONITORING (IF INCLUDED)
- 1.3.8 PV DISCONNECTS
- 1.3.9 PV GROUNDING ELECTRODE & BONDING TO (E) GEC
- 1.3.10 PV FINAL COMMISSIONING
- 1.3.11 (E) ELECTRICAL EQUIPMENT RETROFIT FOR PV
- 1.3.12 SIGNAGE PLACED IN ACCORDANCE WITH THE LOCAL BUILDING CODE

PROJECT INFORMATION

OWNER
NAME: JEFFREY GAYLORD

SCOPE OF WORK
SYSTEM SIZE: DC SIZE : 5.880 KW DC
AC SIZE : 4.060 KW AC
(N) (14) SILFAB SOLAR SIL-420BG (420W) PV MODULES
(N) (14) ENPHASE IQ8PLUS-72-M-US MICROINVERTERS
(N) (1) ENPHASE X-IQ-AM1-240-5C COMBINER BOX


K2 SPLICEFOOT XL MOUNTS WITH K2 CROSSRAIL RAILS

ATTACHMENT TYPE: RAFTER MOUNT
MSP UPGRADE: NO
METER UPGRADE: NO

AUTHORITIES HAVING JURISDICTION
BUILDING: LEE'S SUMMIT CITY
ZONING: LEE'S SUMMIT CITY
UTILITY: EVERGY MISSOURI WEST
APN: 69200061800000000

DESIGN SPECIFICATION
OCCUPANCY: II
CONSTRUCTION: SFR
ZONING: RESIDENTIAL
GROUND SNOW LOAD: 20 psf
WIND EXPOSURE: C
WIND SPEED: 109 mph


APPLICABLE CODES & STANDARDS
BUILDING: IBC 2018 IRC 2018
ELECTRICAL: NEC 2017
FIRE: IFC 2018

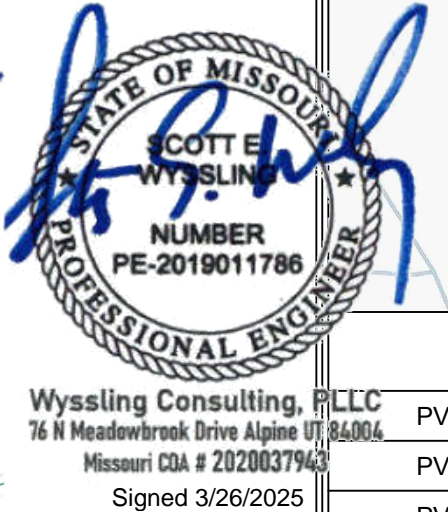

SATELLITE VIEW



VICINITY MAP

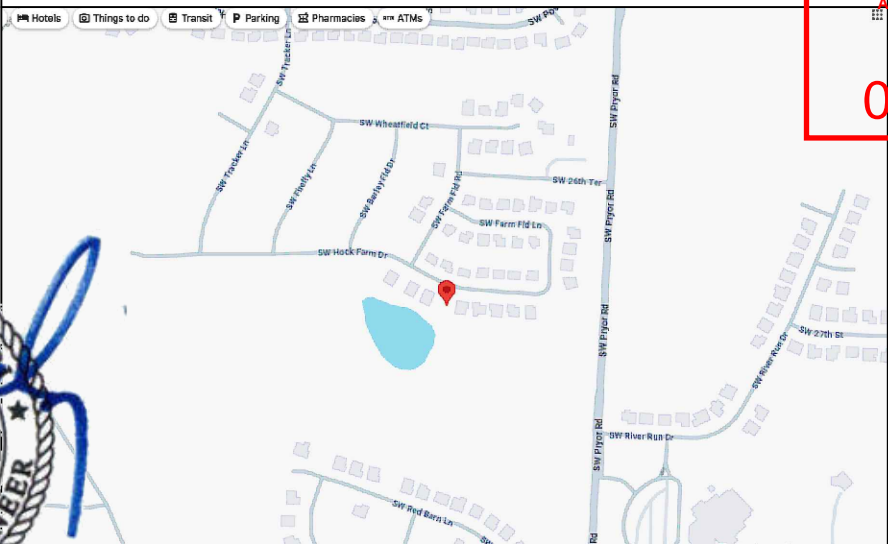

SHEET INDEX

PV - 0	COVER PAGE
PV - 1	SITE PLAN
PV - 2	ELECTRICAL PLAN
PV - 3	ATTACHMENT PLAN
PV - 4	STANDOFF DETAILS
PV - 5	ONE LINE DIAGRAM
PV - 6	THREE LINE DIAGRAM
PV - 7	ELECTRICAL CALCULATIONS
PV - 8	WARNING LABELS

NOTES:

1. ALL CONSTRUCTION / INSTALLATION IS TO COMPLY WITH THE FOLLOWING:
ALL DIMENSIONS ARE APPROXIMATE.

2. ROOF VENTS, SKYLIGHTS, WILL NOT BE COVERED UPON PV INSTALLATION.

3. AC DISCONNECT IS LOCATED WITHIN 10FT FROM THE UTILITY METER.

PV MODULE SPECIFICATIONS	
MANUFACTURER / MODEL	SILFAB SOLAR SIL-420BG (420W) PV MODULES
VMP	38.51 V
IMP	10.91 A
VOC	46.36 V
ISC	11.4 A
PV MODULE QUANTITY	14

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL	ENPHASE IQ8PLUS-72-M-US MICROINVERTERS
MAXIMUM OUTPUT POWER	290W
NOMINAL VOLTAGE	240V
NOMINAL OUTPUT CURRENT	1.21A
INVERTER QUANTITY	14

NOTES:

1. LOCATION OF JUNCTION BOX(ES), AC DISCONNECT(S), AC COMBINER PANEL(S), AND OTHER ELECTRICAL EQUIPMENT RELEVANT TO PV INSTALLATION SUBJECT TO CHANGE BASED ON SITE CONDITIONS.


2. SETBACKS AT RIDGES CAN BE REDUCED TO 18 INCHES IF TOTAL PV AREA IS WITHIN 33% OF TOTAL ROOF AREA IN COMPLIANCE WITH IBC 2018:

TOTAL ROOF AREA = 3579.9734 SQFT

TOTAL PV AREA = 14(73.4" X 40.5")/(144 IN^2)
= 288.96 SQFT

(288.96 SQFT/3579.9734 SQFT)100 = 8.07%

TOTAL PV AREA POPULATES 8.07% OF TOTAL ROOF AREA

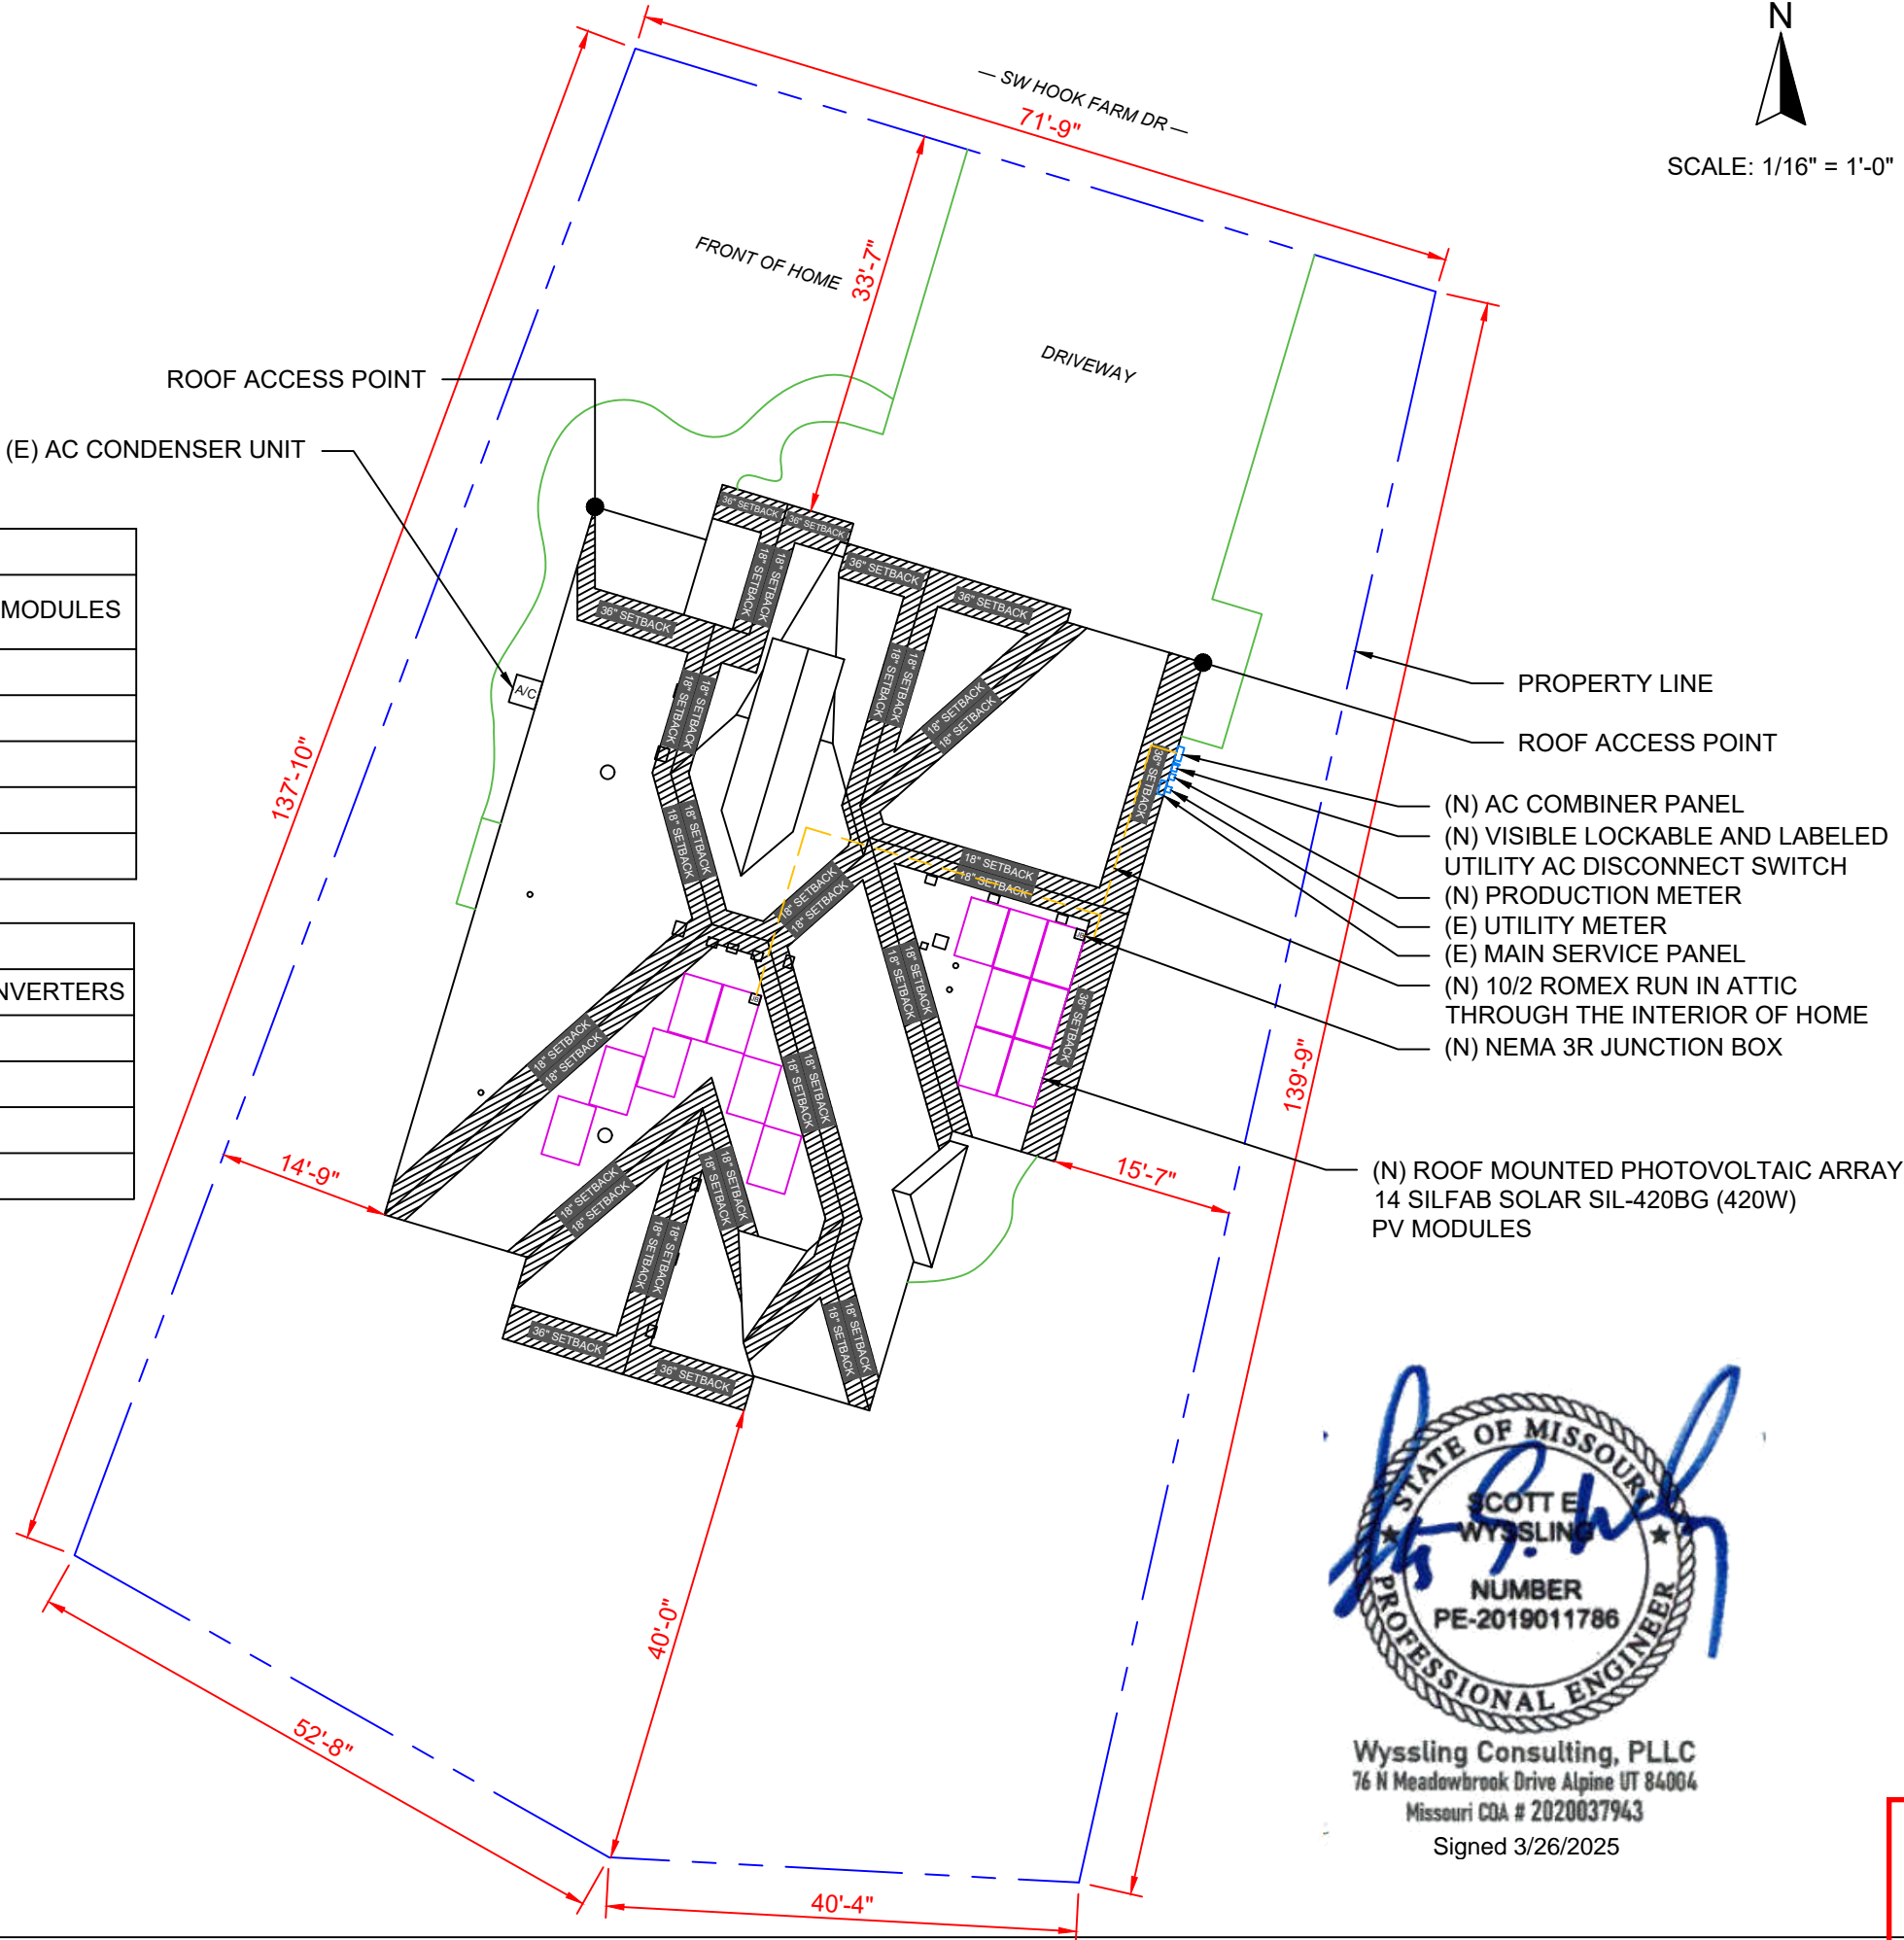

SCALE: 1/16" = 1'-0"

SUNTRIA™

2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS

JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE

(N) 5.880 KW DC
(N) 4.060 KW AC

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE

SITE PLAN

DRAWN DATE 03/25/2025

DRAWN BY JJIA

REVIEWED BY

AS NOTED FOR CONSTRUCTION
SHEET TITLE
PV-1
LEE'S SUMMIT, MISSOURI

04/01/2025



Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Missouri COA # 2020037943

Signed 3/26/2025



MEETS OR EXCEEDS IBC IRC CONSTRUCTION STANDARDS LOAD CALCULATIONS

MODULE TYPE, DIMENSIONS & WEIGHT:

NUMBER OF PANELS IN ARRAY = 14 MODULES
MODULE TYPE = SILFAB SOLAR SIL-420BG PV MODULES
NUMBER OF CONNECTIONS TO ROOF = 46
WEIGHT OF INDIVIDUAL PANEL = 45.8 LBS / 20.77 KG
MOUNTING SYSTEM WEIGHT: 1.5 LBS PER MODULE
TOTAL WEIGHT OF ARRAY: 641.20 LBS
WEIGHT AT EACH CONNECTION: 641.20 LBS / 46 = 13.94 LBS
SOLAR PANEL AREA = 73.4" X 40.5" = 20.64 SQFT
TOTAL ARRAY AREA = 14X20.64 = 288.96 SQFT
DISTRIBUTED LOAD = 641.20/288.96 = 2.22 PSF




Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Missouri COA # 2020037943
Signed 3/26/2025

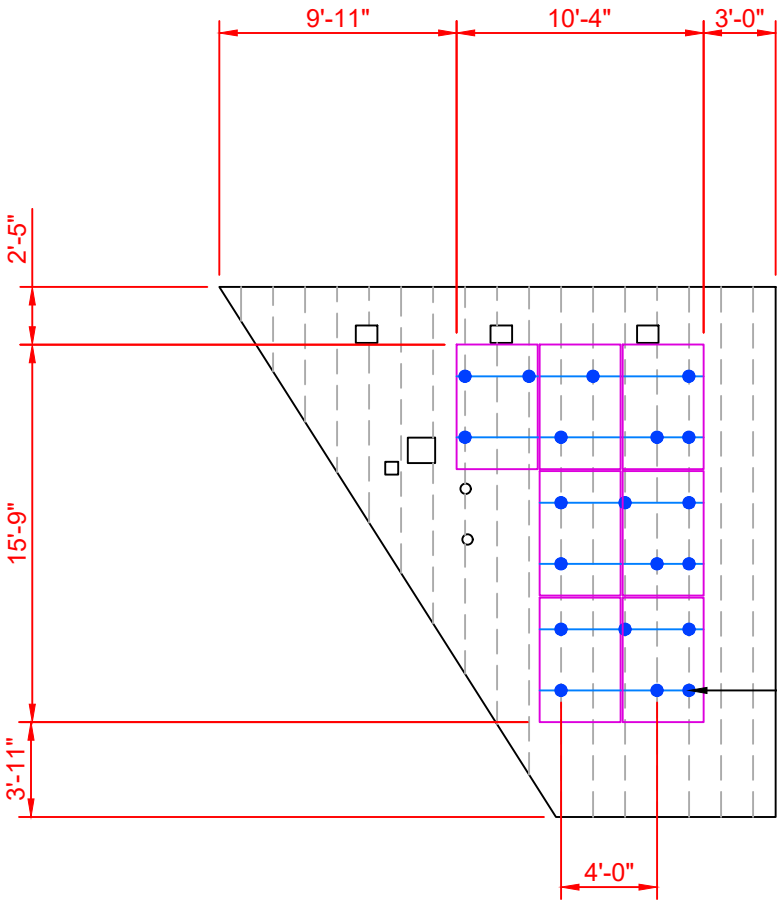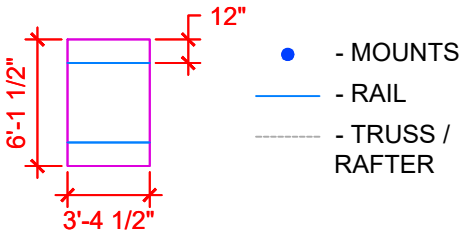

ARRAY 1
TILT: 31°
AZIMUTH: 197°
ROOF MATERIAL: COMP SHINGLE

MOUNTING POINTS, REFER
TO DETAIL
(TYP. TYPE RACKING)

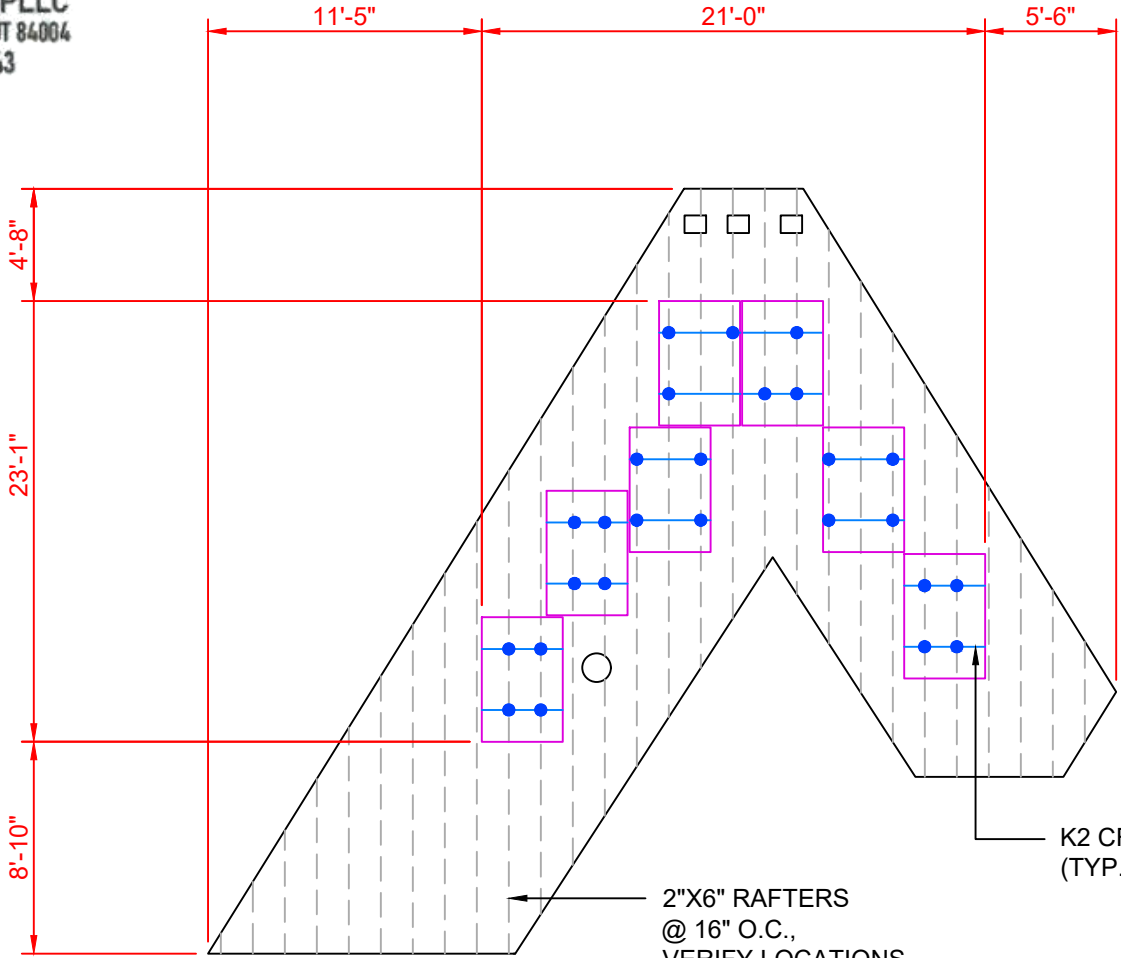

ARRAY 2
TILT: 31°
AZIMUTH: 197°
ROOF MATERIAL: COMP SHINGLE

SUNTRIA™

2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS

JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE

(N) 5.880 KW DC
(N) 4.060 KW AC

REV	DESCRIPTION	DATE			

SHEET TITLE

ATTACHMENT
PLAN

DRAWN DATE03/25/2025

DRAWN BYJJIA

REVIEWED BY

RELEASE FOR CONSTRUCTION


AS NOTED FOR FINAL REVIEW


DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

pv-3

04/01/2025

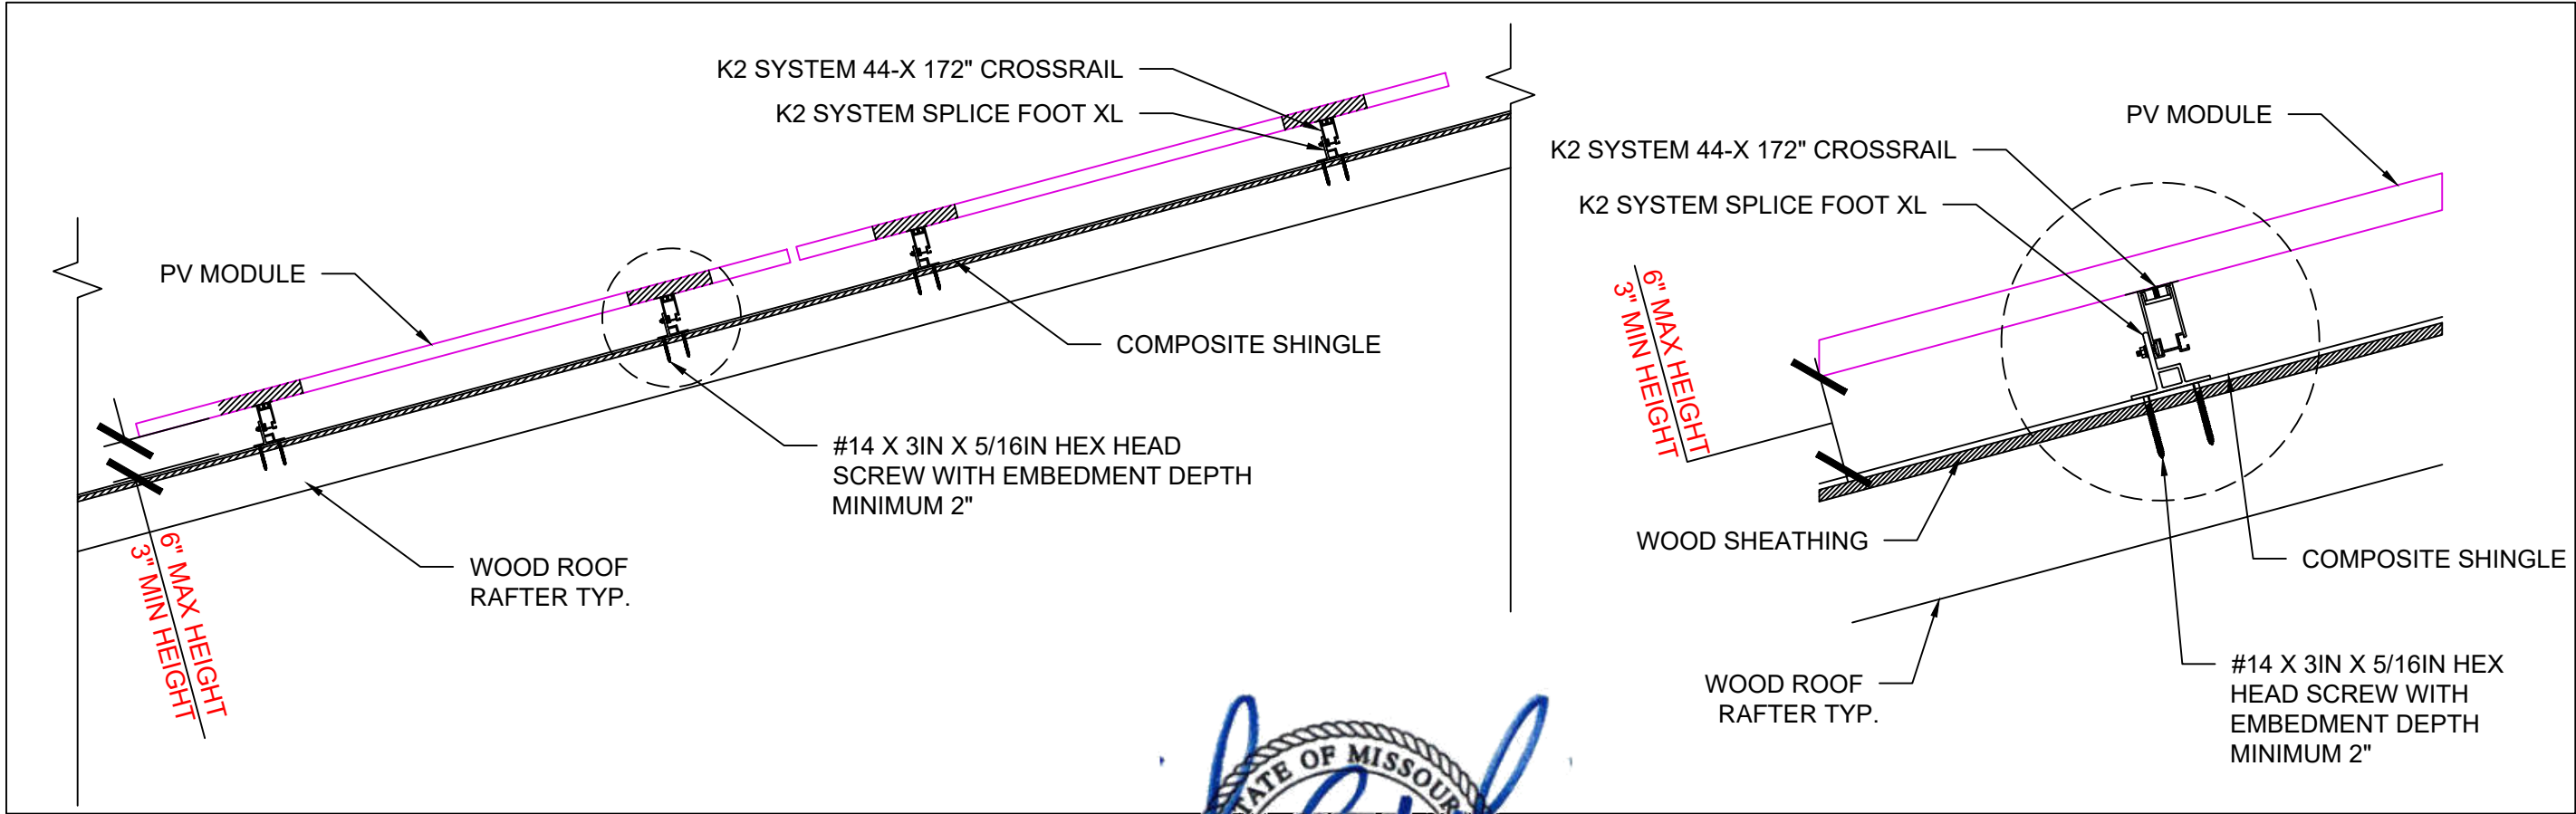


Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Missouri COA # 2020037943
Signed 3/26/2025

1 | **STAND OFF DETAILS**
NOT TO SCALE


2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS
JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE
(N) 5.880 KW DC
(N) 4.060 KW AC

REV	DESCRIPTION	DATE			

SHEET TITLE
**STANDOFF
DETAILS**
DRAWN DATE 03/25/2025
DRAWN BY JJIA
REVIEWED BY
RELEASE FOR CONSTRUCTION
AS NOTED FOR FINAL REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
PV-4
04/01/2025

"ALL EXPOSED PV ROOFTOP CONDUCTORS THAT ARE NOT LOCATED UNDER THE ARRAY MODULES, SHALL INCLUDE LISTED JUNCTION BOXES AT BOTH ENDS OF THE RACEWAY TO TRANSITION FROM EXPOSED CONDUCTORS TO THE LISTED RACEWAYS."

PHOTOVOLTAIC INSTALLATION ELECTRICAL DIAGRAM
RATED 5,880 DC WATTS UNDER (STC)

(2) BRANCHED CIRCUITS OF 7 MODULES

ADDITIONAL NOTES:
MARKING IS REQUIRED ON ALL INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, CABLE ASSEMBLIES, AND JUNCTION BOXES TO ALERT THE FIRE SERVICE TO AVOID CUTTING THEM. MARKING SHOULD BE PLACED ON ALL INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, AND CABLE ASSEMBLIES, AT A MINIMUM OF EVERY 10 FEET, AT TURNS AND ABOVE AND OR BELOW PENETRATIONS AND ALL DC COMBINER AND JUNCTION BOXES


WIRE / CONDUIT SCHEDULE			
TAG	CONDUCTOR DETAILS	GROUND DETAILS	CONDUIT SIZE
1	(2) #12 Q-CABLE CU	(1) #6 AWG BARE CU	FREE AIR
2	(2) #10/2 ROMEX IN ATTIC (4) #10 AWG THHN/THWN-2, CU ON EXTERIOR	(1) #8 AWG THWN-2, CU	3/4" EMT OR PVC
3	(3) #10 AWG THWN-2, CU	(1) #6 AWG THWN-2, CU	3/4" EMT OR PVC


PV MODULE SPECIFICATIONS	
MANUFACTURER / MODEL	SILFAB SOLAR SIL-420BG (420W) PV MODULES
VMP	38.51 V
IMP	10.91 A
VOC	46.36 V
ISC	11.4 A
PV MODULE QUANTITY	14

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL	ENPHASE IQ8PLUS-72-M-US MICROINVERTERS
MAXIMUM OUTPUT POWER	290W
NOMINAL VOLTAGE	240V
NOMINAL OUTPUT CURRENT	1.21A
INVERTER QUANTITY	14



AC DISCONNECT IS LOCATED
WITHIN 10' FROM UTILITY METER

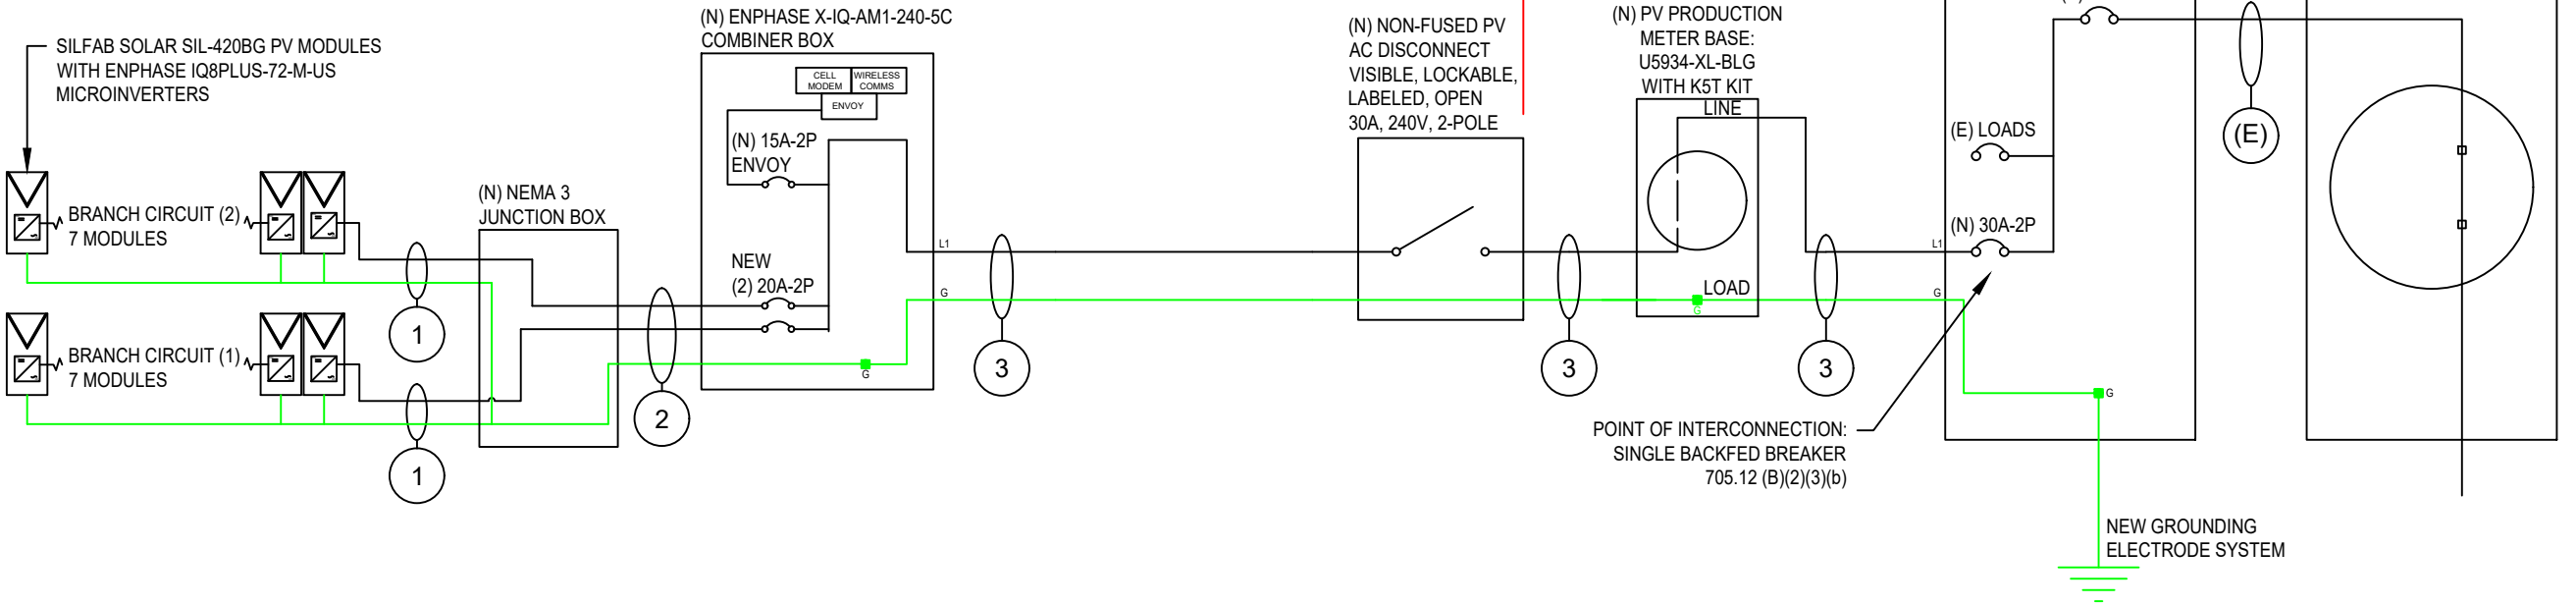



2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS

JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE

(N) 5.880 KW DC
(N) 4.060 KW AC

REVISIONS	DATE			
DESCRIPTION				
REV				

SHEET TITLE

ONE LINE
DIAGRAM

DRAWN DATE	03/25/2025
DRAWN BY	JJIA
REVIEWED BY	

RELEASE FOR CONSTRUCTION

AS NOTED FOR FINAL REVIEW

DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

pv-5

04/01/2025

"ALL EXPOSED PV ROOFTOP CONDUCTORS THAT ARE NOT LOCATED UNDER THE ARRAY MODULES, SHALL INCLUDE LISTED JUNCTION BOXES AT BOTH ENDS OF THE RACEWAY TO TRANSITION FROM EXPOSED CONDUCTORS TO THE LISTED RACEWAYS."

PHOTOVOLTAIC INSTALLATION ELECTRICAL DIAGRAM
RATED 5,880 DC WATTS UNDER (STC)

(2) BRANCHED CIRCUITS OF 7 MODULES

ADDITIONAL NOTES:
MARKING IS REQUIRED ON ALL INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, CABLE ASSEMBLIES, AND JUNCTION BOXES TO ALERT THE FIRE SERVICE TO AVOID CUTTING THEM. MARKING SHOULD BE PLACED ON ALL INTERIOR AND EXTERIOR DC CONDUIT, RACEWAYS, ENCLOSURES, AND CABLE ASSEMBLIES, AT A MINIMUM OF EVERY 10 FEET, AT TURNS AND ABOVE AND OR BELOW PENETRATIONS AND ALL DC COMBINER AND JUNCTION BOXES

WIRE / CONDUIT SCHEDULE			
TAG	CONDUCTOR DETAILS	GROUND DETAILS	CONDUIT SIZE
1	(2) #12 Q-CABLE CU	(1) #6 AWG BARE CU	FREE AIR
2	(2) #10/2 ROMEX IN ATTIC (4) #10 AWG THHN/THWN-2, CU ON EXTERIOR	(1) #8 AWG THWN-2, CU	3/4" EMT OR PVC
3	(3) #10 AWG THWN-2, CU	(1) #6 AWG THWN-2, CU	3/4" EMT OR PVC


PV MODULE SPECIFICATIONS	
MANUFACTURER / MODEL	SILFAB SOLAR SIL-420BG (420W) PV MODULES
VMP	38.51 V
IMP	10.91 A
VOC	46.36 V
ISC	11.4 A
PV MODULE QUANTITY	14

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL	ENPHASE IQ8PLUS-72-M-US MICROINVERTERS
MAXIMUM OUTPUT POWER	290W
NOMINAL VOLTAGE	240V
NOMINAL OUTPUT CURRENT	1.21A
INVERTER QUANTITY	14



Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Missouri COA # 2020037943
Signed 3/26/2025

AC DISCONNECT IS LOCATED
WITHIN 10' FROM UTILITY METER

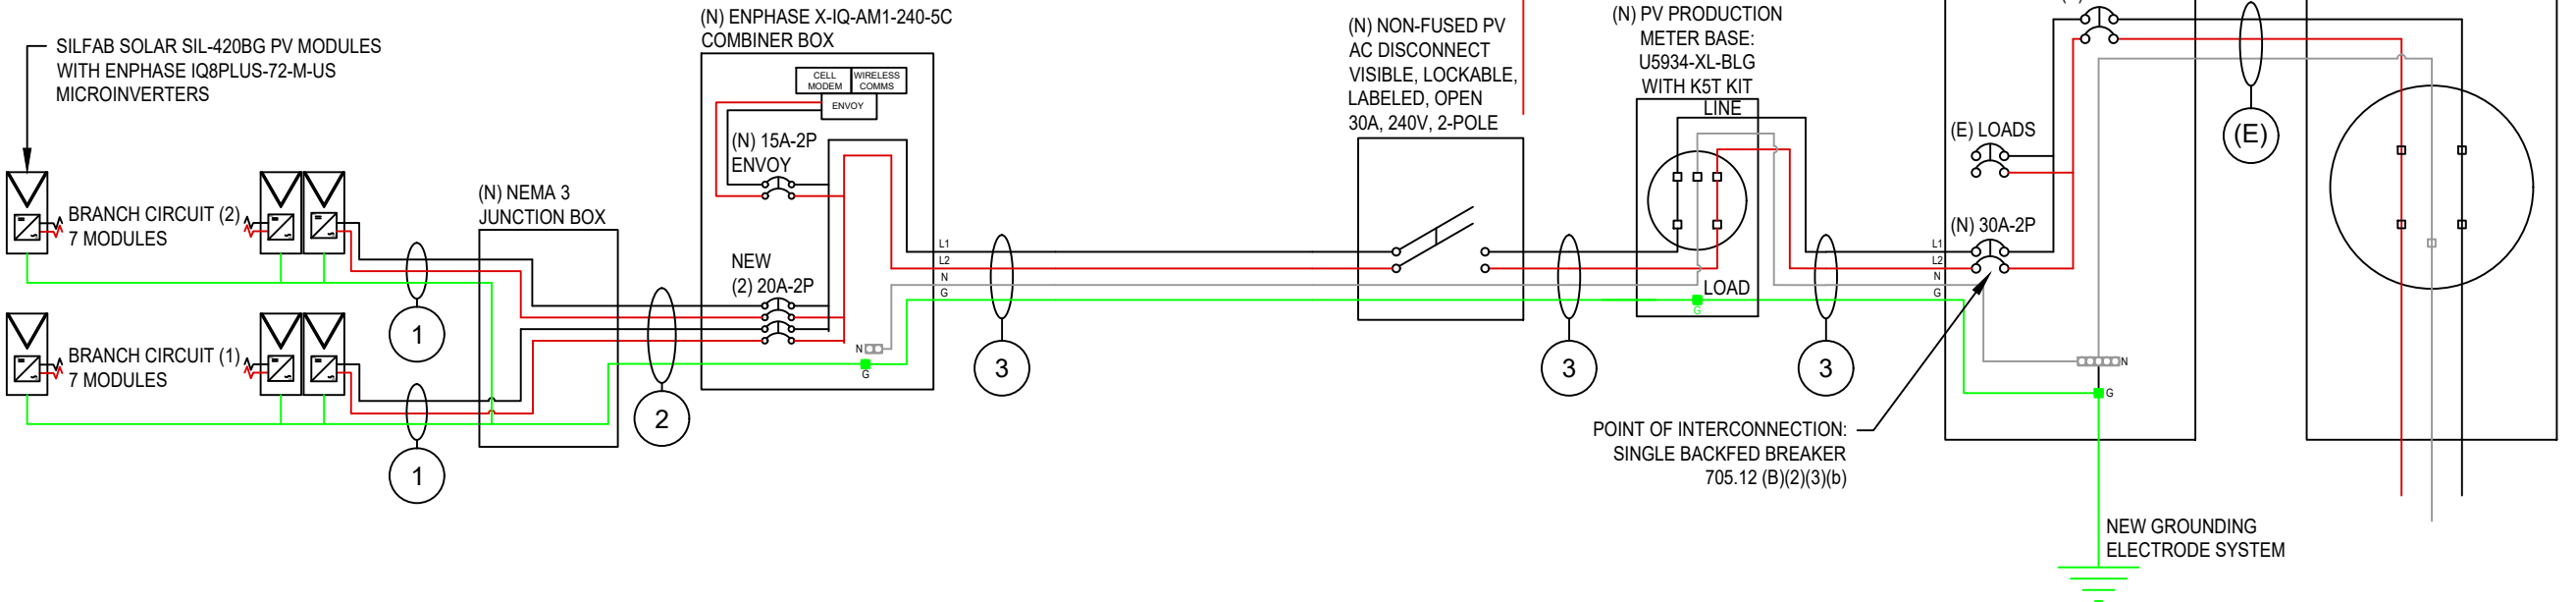

SUNTRIA™

2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS

JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE

(N) 5.880 KW DC
(N) 4.060 KW AC

REVISIONS

REV	DESCRIPTION	DATE

SHEET TITLE
THREE LINE
DIAGRAM

DRAWN DATE 03/25/2025

DRAWN BY JJIA

REVIEWED BY

RELEASE FOR CONSTRUCTION

AS NOTED FOR FINAL REVIEW
DEVELOPMENT SERVICES
PV - 6
LEE'S SUMMIT, MISSOURI

04/01/2025

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL	SILFAB SOLAR SIL-420BG (420W) PV MODULES
VMP	38.51 V
IMP	10.91 A
VOC	46.36 V
ISC	11.4 A
DIMENSION	73.4" L X 40.5"W X 1.4" D

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL	ENPHASE IQ8PLUS-72-M-US MICROINVERTERS
MAXIMUM OUTPUT POWER	290 W
NOMINAL VOLTAGE	240 A
NOMINAL OUTPUT CURRENT	1.21 A
INVERTER QUANTITY	14

AMBIENT TEMPERATURE SPECS	
RECORD LOW TEMP	-20°
AMBIENT TEMP (HIGH TEMP 2%)	35°
CONDUCTOR HEIGHT	0.5"
CONDUCTOR TEMPERATURE RATE	90°

PERCENT OF VALUES	NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT
.80	4-6
.70	7-9
.50	10-20

MICROINVERTER CALCULATIONS

1. CURRENT CARRYING CONDUCTOR


(A) BEFORE IQ COMBINER PANEL
AMBIENT TEMPERATURE - (35)°C ...NEC 310.15(B)(2)
TEMPERATURE DERATE FACTOR - 0.96 ...NEC 310.15(B)(1)
GROUPING FACTOR - 0.8 ...NEC 310.15(C)(1)

CONDUCTOR AMPACITY
= (INVERTER O/P CURRENT) x 1.25 / A.T.F / G.F ...NEC 690.8(B)
=[(7x1.21) x 1.25] / [0.96 / 0.8]
=13.79 A
SELECTED CONDUCTOR - #10 THWN-2 ...NEC 310.16


(B) AFTER IQ COMBINER PANEL
AMBIENT TEMPERATURE - (35)°C ...NEC 310.15(B)(2)
TEMPERATURE DERATE FACTOR - 0.96 ...NEC 310.15(B)(1)
GROUPING FACTOR - 1 ...NEC 310.15(C)(1)

CONDUCTOR AMPACITY
= (INVERTER O/P CURRENT) x 1.25 / A.T.F / G.F ...NEC 690.8(B)
=[(14x1.21) x 1.25] / [0.96]
=22.06 A
SELECTED CONDUCTOR - #8 AWG THWN-2 ...NEC 310.16

2. PV OVERCURRENT PROTECTION ...NEC 690.9(B)
= TOTAL INVERTER O/P CURRENT x 1.25
= (14 x 1.21) x 1.25 = 21.18 A
SELECTED OCPD = 30 A ...NEC 240.6



Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Missouri COA # 2020037943
Signed 3/26/2025



2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS

JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE

(N) 5.880 KW DC
(N) 4.060 KW AC

REV	DESCRIPTION	DATE

SHEET TITLE

ELECTRICAL
CALCULATIONS

DRAWN DATE	03/25/2025
DRAWN BY	JJIA
REVIEWED BY	


RELEASE FOR CONSTRUCTION

AS NOTED FOR FINAL REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
PV - 7

04/01/2025


ALL LABELS TO BE ENGRAVED AND MECHANICALLY BONDED UNLESS OTHERWISE STATED

LABEL LOCATION : COMBINER BOX / CIRCUITS /
CONDUIT COMBINER BOX / ENCLOSURES / EMT ENCLOSURES

**WARNING**

ELECTRICAL SHOCK HAZARD
TERMINALS ON BOTH LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

NEC 705.20(7) & NEC 690.13(B)

**WARNING**

TURN OFF PHOTOVOLTAIC AC
DISCONNECT PRIOR TO WORKING
INSIDE PANEL

NEC 110.27(C) & OSHA 1910.145(f)(7)

LABEL LOCATION : BUILDING / STRUCTURE

THIS EQUIPMENT SUITABLE
FOR ATTACHMENT TO
FLOATING STRUCTURES, OR
ATTACHED TO STRUCTURES
FLOATING ON BODIES
OF WATER.

NEC 690.4(G)

LABEL LOCATION : MAIN SERVICE
DISCONNECT / UTILITY METER


MAIN PHOTOVOLTAIC
SYSTEM DISCONNECT

NEC 690.13(B)



CAUTION

POWER TO THIS BUILDING IS ALSO SUPPLIED
FROM THE FOLLOWING SOURCES WITH
DISCONNECTS LOCATED AS SHOWN

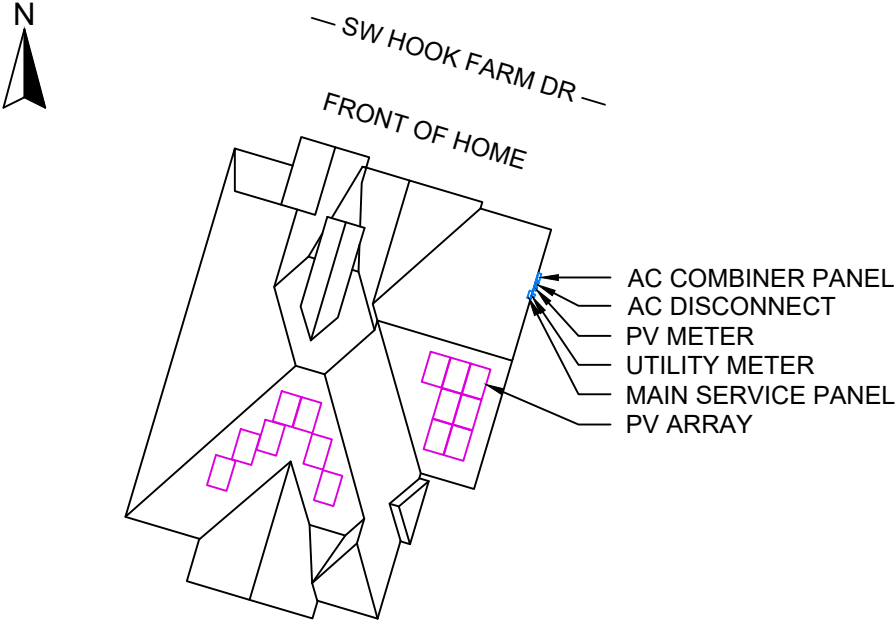

2043 SW HOOK FARM DR, LEE'S SUMMIT, MO 64082

LABEL LOCATION: MAIN SERVICE PANEL [NEC 705.10 & 690.56(A)(B)]

LABEL LOCATION : EMT / CONDUIT RACEWAYS


PHOTOVOLTAIC POWER SOURCE

NEC 690.31(D)(2)

DO NOT DISCONNECT
UNDER LOAD

NEC 690.15(B) & NEC 690.33(D)(2)


LABEL LOCATION : AC DISCONNECT / BREAKER / POINTS OF CONNECTION

**WARNING**

ELECTRICAL SHOCK HAZARD

TERMINALS ON BOTH LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

NEC 705.20(7) & NEC 690.13(B)

**WARNING**

ELECTRICAL SHOCK HAZARD

THIS EQUIPMENT FED BY
MULTIPLE SOURCES:
TOTAL RATING OF ALL OVERCURRENT
DEVICES EXCLUDING MAIN POWER
SUPPLY SHALL NOT EXCEED
AMPACITY OF BUSBAR

NEC 705.12(B)(3)

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUTDOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN ARRAY

IFC 605.11.3.1(1) & 690.12(D)

RAPID SHUTDOWN SWITCH
FOR SOLAR PV SYSTEM

NEC 690.12(D)(2)

**CAUTION**

PHOTOVOLTAIC SYSTEM CIRCUIT IS BACKFED

INTERACTIVE PHOTOVOLTAIC POWER
FLOWING THROUGH THIS PANEL


AC OPERATING CURRENT 16.94 AAC
AC OPERATING VOLTAGE 240 VAC

LABEL LOCATION : MAIN SERVICE DISCONNECT

**WARNING**

POWER SOURCE OUTPUT
CONNECTION. DO NOT
RELOCATE THIS
OVERCURRENT DEVICE

NEC 705.12(B)(2)

**WARNING**

ELECTRICAL SHOCK HAZARD


TERMINALS ON BOTH LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

NEC 705.20(7) & NEC 690.13(B)

**WARNING**

TURN OFF PHOTOVOLTAIC
AC DISCONNECT PRIOR TO
WORKING INSIDE PANEL

NEC 705.82 & NEC 710.15(C)


**WARNING**

SINGLE 120-VOLT SUPPLY
DO NOT CONNECT
MULTIWIRE BRANCH CIRCUITS

NEC 705.82 & NEC 710.15(C)

**WARNING DUAL POWER SOURCE**
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

NEC 705.30(C) & NEC 690.59



2141 E BROADWAY RD SUITE 202,
TEMPE, AZ 85282
855-248-884

PROJECT NAME & ADDRESS
JEFFREY GAYLORD
SUN11284
2043 SW HOOK FARM DR,
LEE'S SUMMIT, MO 64082
METER NO: 25272935

AHJ STAMP

SYSTEM SIZE
(N) 5.880 KW DC
(N) 4.060 KW AC

REV	DESCRIPTION	DATE	

SHEET TITLE
WARNING
LABELS

DRAWN DATE 03/25/2025
DRAWN BY JJIA


REVIEWED BY
RELEASE FOR CONSTRUCTION
AS NOTED FOR REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
pv-8

04/01/2025

BOM			
Job Number	SUN11284		MO
Job Name	JEFFREY GAYLORD		
System Size	5.880 KW DC		
Item	Manufacturer	Part Number	Quantity
Inverter	Enphase	IQ8PLUS-72-M-US microinverter, compatible with 72-cell PV Modules, 240v, 300VA peak power	14
Panels	Silfab Solar	SIL-420BG (420W) PV MODULES	14
MicroInverters Mounts	K2	4000629-H MicroInverters Mounts	14
Racking Rails	K2	4000819-US Cross Rail 44-X 172", Mill	7
Splice Plate	K2	4000051-T Tool-Less Rail Connector	0
Mounting	K2	XL- 4000165 Rail Splice Foot XL	32
Endclamp	K2	4000145-US End clamp	36
Midclamp	K2	4000145-US Mid clamp	10
Ground Lug	K2	4000006-H Ground Lug, 13mm Hex Set	9
Junction Box	EZ Solar	JB 1.2 PV Rooftop Junction Box	2
Disconnect A/C Non-Fused	Siemens	LNF221R 30A 240V SFTY SW	1
Disconnect A/C Fused	Siemens	GF222NR 60A 240V SFTY SW	0
Fuses	Bussman/Eaton	FRN-R-30 30A Fuses	0
Breaker	Cutler Hammer	BR220 20A 2P Breaker	2
Breaker	Cutler Hammer	BR230 30A 2P Breaker	1
AC Combiner	Enphase	X-IQ-AM1-240-5/5C 125A Combiner box Includes Cellmodem (CELLMODEM-M1-06-SP-05)	1
Monitoring	Enphase	CELLMODEM-M1 M ENPHASE MOBILE CONNECT LTE CAT M1 CELL MODEM, 5YR	0
CT	Enphase	CTs	0
Q-Cable	Enphase	Q-12-10-240 CABLE PORTRAIT	18
Q-Cable	Enphase	Q-12-10-240 CABLE LANDSCAPE	0
Tap Connector	Ilsco	IPC406 Insulation Piercing Tap	0
Strain Reliefs	Heyco	M3234GBR-SM	2
Incidentals / Extras			
PV METER	U5934-XL-BLG w/K5T KIT		1

SILFAB ELITE

SIL - 420 BG

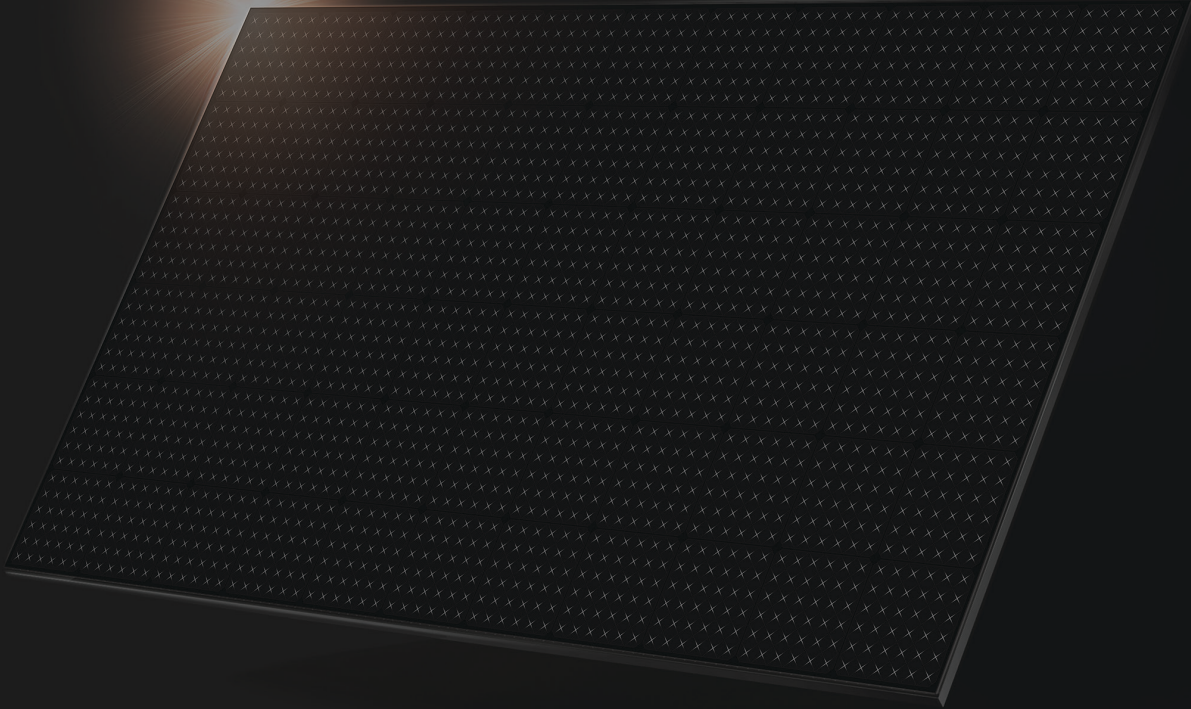

••• NOT JUST ANOTHER SOLAR PANEL.

Silfab Elite

Back-contact technology with an innovative conductive backsheet and integrated cell design delivers the highest performance, durability and beautiful aesthetics.

Manufactured exclusively in the United States.

SILFABSOLAR.COM



RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025

ELECTRICAL SPECIFICATIONS		420	
Test Conditions		STC	NOCT
Module Power (Pmax)	Wp	420	313
Maximum power voltage (Vpmax)	V	38.51	35.89
Maximum power current (Ipmax)	A	10.91	8.73
Open circuit voltage (Voc)	V	46.36	43.45
Short circuit current (Isc)	A	11.4	9.18
Module efficiency	%	21.9%	20.4%
Maximum system voltage (VDC)	V	1000	
Series fuse rating	A	20	
Power Tolerance	Wp	0 to +10	


Measurement conditions: STC 1000 W/m² • AM 1.5 • Temperature 25 °C • NOCT 800 W/m² • AM 1.5 • Measurement uncertainty ≤ 3%
Sun simulator calibration reference modules from Fraunhofer Institute. Electrical characteristics may vary by ±5% and power by 0 to +10W.

MECHANICAL PROPERTIES / COMPONENTS	METRIC	IMPERIAL
Module weight	20.8±0.2	45.8±0.4 lbs
Dimensions (H x L x D)	1864 mm x 1029 mm x 35 mm	73.4 in x 40.5 in x 1.4 in
Maximum surface load (wind/snow)*	5400 Pa rear load / 5400 Pa front load	112.8 lb/ft ² rear load / 112.8 lb/ft ² front load
Hail impact resistance	ø 25 mm at 83 km/h	ø 1 in at 51.6 mph
Cells	66 high-efficiency mono-PERC MWT c-Si cells 166 x 166 mm	66 high-efficiency mono-PERC MWT c-Si cells 6.53 x 6.53 in
Glass	3.2 mm high transmittance, tempered, anti-reflective coating	0.126 in high transmittance, tempered, anti-reflective coating
Cables and connectors (refer to installation manual)	1200 mm ø 5.7 mm, MC4 from Staubli	47.2 in, ø 0.22 (12AWG), MC4 from Staubli
Backsheet	Multilayer, integrated insulation film and electrically conductive backsheet, superior hydrolysis and UV resistance, fluorine-free PV backsheet	
Frame	Anodized Aluminum (Black)	
Bypass diodes	3 diodes-30SQ045T (45V max DC blocking voltage, 30A max forward rectified current)	
Junction Box	UL 3730 Certified, IEC 62790 Certified, IP67 rated	

TEMPERATURE RATINGS		WARRANTIES	
Temperature Coefficient Isc	+0.046 %/°C	Module product workmanship warranty	25 years**
Temperature Coefficient Voc	-0.279 %/°C	Linear power performance guarantee	30 years
Temperature Coefficient Pmax	-0.377 %/°C		≥ 98% end 1st yr
NOCT (± 2°C)	43.5 °C		≥ 94.7% end 12th yr
Operating temperature	-40/+85 °C		≥ 90.8% end 25th yr
			≥ 89.3% end 30th yr

CERTIFICATIONS		SHIPPING SPECS	
Product	UL 61215-1:2017 Ed.1, UL 61215-2:2017 Ed.1, UL 61730-1:2017 Ed.1, UL 61730-2:2017 Ed.1, CSA C22.2#61730-1:2019 Ed.2, CSA C22.2#61730-2:2019 Ed.2, IEC 61215-1:2016 Ed.1, IEC 61215-2:2016 Ed.1, IEC 61730-1:2016 Ed.2, IEC 61730-2:2016 Ed.2, IEC 61701:2020 (Salt Mist Corrosion), IEC 62716:2013 (Ammonia Corrosion), CEC Listing, UL Fire Rating: Type 1	Modules Per Pallet:	27 or 27 (California)
Factory	ISO9001:2015	Pallets Per Truck	31 or 30 (California)
		Modules Per Truck	837 or 810 (California)

- * ⚠ Warning. Read the Safety and Installation Manual for mounting specifications and before handling, installing and operating modules.
** 12 year extendable to 25 years subject to registration and conditions outlined under "Warranty" at silfab.com.
PAN files generated from 3rd party performance data are available for download at: silfab.com/downloads.

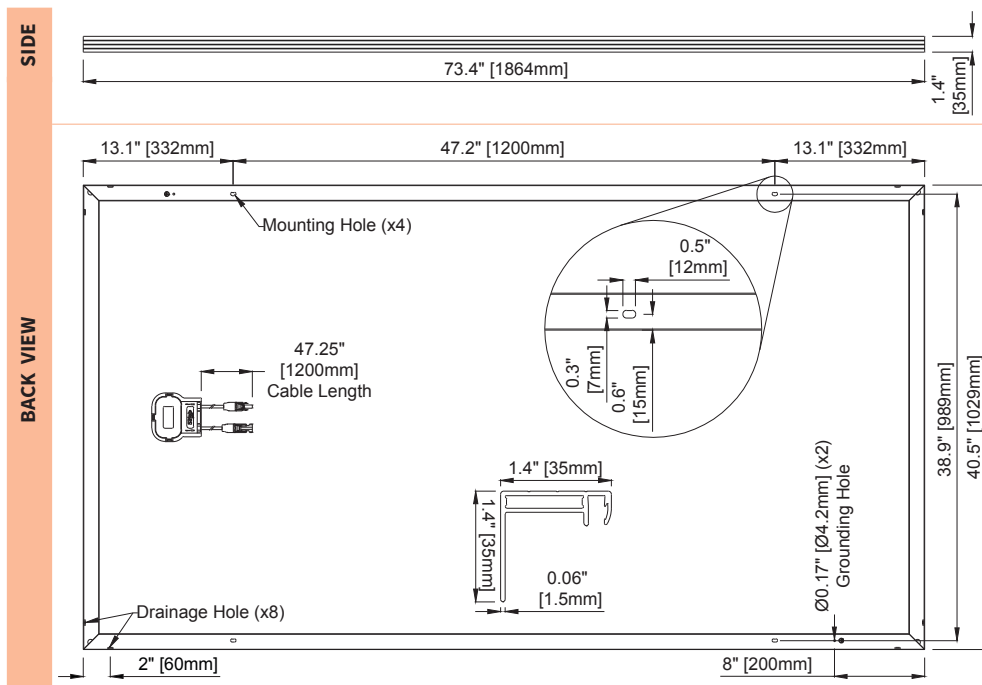

SILFAB SOLAR INC.

1770 Port Drive
Burlington WA 98233 USA
T +1 360.569.4733
info@silfab.com
SILFABSOLAR.COM

7149 Logistics Lane
Fort Mill SC 29715 USA
T +1 839.400.4338

240 Courtneypark Drive East
Mississauga ON L5T 2S5 Canada
T +1 905.255.2501

FOR CONSTRUCTION

FOR CONSTRUCTION

FOR CONSTRUCTION

FOR CONSTRUCTION

FOR CONSTRUCTION

FOR CONSTRUCTION

FOR CONSTRUCTION


04/01/2025

IQ8 and IQ8+ Microinverters

Our newest IQ8 Microinverters^{1,2,3} are the industry's first microgrid-forming⁴, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently.



Key specifications	IQ8-60-M-US	IQ8PLUS-72-M-US
Peak output power	245 VA	300 VA
Nominal grid voltage (L-L)	240 V, split-phase (L-L), 180°	
Nominal frequency	60 Hz	60 Hz
CEC weighted efficiency	97%	97%
Maximum input DC voltage	50 V	60 V
MPPT voltage range	27–37 V	27–45 V
Maximum module I_{sc}	20 A	20 A
Ambient temperature range	–40°C to 60°C (–40°F to 140°F)	

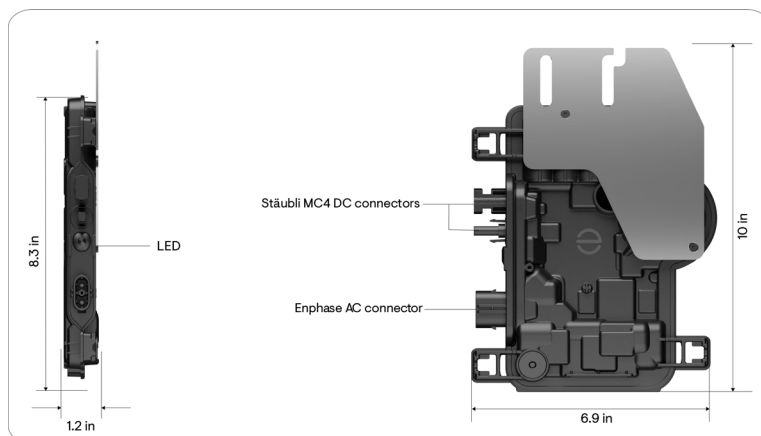

Simple

- Lightweight and compact with plug-and-play connectors
- Power line communication (PLC) between components
- Faster installation with simple two-wire cabling

Reliable

- Produce power even when the grid is down
- More than one million cumulative hours of testing
- Industry-leading limited warranty of up to 25 years
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

Microgrid-forming

- Compliant with the latest advanced grid support⁵
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) and IEEE 1547:2018 (UL 1741-SB 3rd Ed.)

¹ IQ8 Series Microinverters can be added to existing IQ7 systems on the same IQ Gateway only in the following grid-tied configurations: Solar Only or Solar + Battery (IQ Battery 3T/10T and IQ Battery 5P) without backup.

² IQ7 Series Microinverters cannot be added to a site with existing IQ8 Series Microinverters on the same gateway. Mixed system of IQ7 and IQ8 will not support IQ8-specific PCS features and grid-forming capabilities.

³ IQ Microinverters ship with default settings that meet North America's IEEE 1547 interconnection standard requirements. Region-specific adjustments may be requested by an Authority Having Jurisdiction (AHJ) or utility representative, according to the IEEE 1547 interconnection standard. Use an IQ Gateway to make these changes during installation.

⁴ Meets UL 1741 only when installed with IQ System Controller 2 or 3.

⁵ IQ8 and IQ8+ support split-phase, 240 V installations only.

Input data (DC)	Units	IQ8-60-M-US	IQ8PLUS-72-M-US
Commonly used module pairings ⁶	W	235–350	235–440
Module compatibility	—	To meet compatibility, PV modules must be within maximum input DC voltage and maximum module I_{sc} . Module compatibility can be checked at https://enphase.com/installers/microinverters/calculator .	
MPPT voltage range	V	27–37	27–45
Operating range	V	16–48	16–58
Minimum/Maximum start voltage	V	22/48	22/58
Maximum input DC voltage	V	50	60
Maximum continuous input DC current	A	10	12
Maximum input DC short-circuit current	A	25	
Maximum module I_{sc}	A	20	
Overvoltage class DC port	—	II	
DC port backfeed current	mA	0	
PV array configuration	—	Ungrounded array; no additional DC side protection required; AC side protection requires maximum 20 A per branch circuit.	
Output data (AC)	Units	IQ8-60-M-US	IQ8PLUS-72-M-US
Peak output power	VA	245	300
Maximum continuous output power	VA	240	290
Nominal grid voltage (L-L)	V	240, split-phase (L-L), 180°	
Minimum and Maximum grid voltage ⁷	V	211-264	
Maximum continuous output current	A	1.0	1.21
Nominal frequency	Hz	60	
Extended frequency range	Hz	47–68	
AC short-circuit fault current over three cycles	Arms	2	
Maximum units per 20 A (L-L) branch circuit ⁸	—	16	13
Total harmonic distortion	%	<5	
Overvoltage class AC port	—	III	
AC port backfeed current	mA	30	
Power factor setting	—	1.0	
Grid-tied power factor (adjustable)	—	0.85 leading ... 0.85 lagging	
Peak efficiency	%	97.7	
CEC weighted efficiency	%	97	
Nighttime power consumption	mW	23	25
Mechanical data		IQ8-60-M-US	IQ8PLUS-72-M-US
Ambient temperature range		–40°C to 60°C (–40°F to 140°F)	

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025

⁶ No enforced DC/AC ratio

Mechanical data	IQ8-60-M-US	IQ8PLUS-72-M-US
Relative humidity range	4% to 100% (condensing)	
DC connector type	Stäubli MC4	
Dimensions (H × W × D)	212 mm (8.3 in) × 175 mm (6.9 in) × 30.2 mm (1.2 in)	
Weight	1.1 kg (2.43 lb)	
Cooling	Natural convection—no fans	
Approved for wet locations	Yes	
Pollution degree	PD3	
Enclosure	Class II double-insulated, corrosion-resistant polymeric enclosure	
Environmental category/UV exposure rating	NEMA Type 6/Outdoor	
Compliance	IQ8-60-M-US	IQ8PLUS-72-M-US
Certifications	<p>CA Rule 21 (UL 1741-SA), UL 62109-1, IEEE 1547:2018 (UL 1741-SB 3rd Ed.), FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01.</p> <p>This product is UL Listed as PV rapid shutdown equipment and conforms with NEC 2014, NEC 2017, NEC 2020, and NEC 2023 section 690.12 and C22.1-2018 Rule 64-218 rapid shutdown of PV systems, for AC and DC conductors, when installed according to the manufacturer's instructions.</p>	

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025

Components of the Enphase Energy System



IQ Battery

All-in-one AC-coupled storage solution that integrates seamlessly with your solar energy system, providing reliable backup power and intelligent energy management for maximum performance and energy savings.




IQ System Controller

The IQ System Controller connects the home to the grid power, IQ Batteries, generator and solar PV with microinverters.



IQ Combiner/IQ Gateway

The IQ Combiner/IQ Gateway is a device that performs energy management, provides internet connectivity, and integrates with the IQ Series Microinverters to provide complete control and insights into the Enphase Energy System.



IQ Cable

The IQ Cable is a continuous-length 12-AWG cable with pre-installed connectors for IQ Microinverters that support faster, simpler, and more reliable installations. The cable is handled like standard outdoor-rated electrical wire, allowing it to be cut, spliced, and extended as needed.



X-IQ-AM1-240-5-HDK
X-IQ-AM1-240-5C-HDK
X-IQ-AM1-240-5
X-IQ-AM1-240-5C

IQ Combiner 5/5C

The IQ Combiner 5/5C consolidates interconnection equipment into a single enclosure and streamlines IQ Series Microinverters and IQ Gateway installation by providing a consistent, pre-wired solution for residential applications. IQ Combiner 5/5C uses wired control communication and is compatible with IQ System Controller 3/3G and IQ Battery 5P.

The IQ Combiner 5/5C, IQ Series Microinverters, IQ System Controller 3/3G, and IQ Battery 5P provide a complete grid-agnostic Enphase Energy System.



IQ Series Microinverters

The high-powered smart grid-ready IQ Series Microinverters (IQ6, IQ7, and IQ8 Series) simplify the installation process.



IQ System Controller 3/3G

Provides microgrid interconnection device (MID) functionality by automatically detecting grid failures and seamlessly transitioning the home energy system from grid power to backup power.



IQ Battery 5P

Fully integrated AC battery system. Includes six field-replaceable IQ8D-BAT Microinverters.



IQ Load Controller

Helps prioritize essential appliances during a grid outage to optimize energy consumption and prolong battery life.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect (CELLMODEM-M1-06-SP-05), only with IQ Combiner 5C
- Supports flexible networking: Wi-Fi, Ethernet, or cellular
- Provides production metering (revenue grade) and consumption monitoring

Easy to install

- Mounts to one stud with centered brackets
- Supports bottom, back, and side conduit entries
- Supports up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV branch circuits
- Factory installed hold-down kit
- Bluetooth-based Wi-Fi provisioning for easy Wi-Fi setup

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- 5-year limited warranty
- 2-year labor reimbursement program coverage included for IQ Combiner SKUs*
- UL1741 Listed



5-year limited warranty



*For country-specific warranty information, see the <https://enphase.com/installers/resources/warranty> page.

© 2024 Enphase Energy. All rights reserved. Enphase, the e and CC logos, IQ, and certain other marks listed at

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025

IQ Combiner 5/5C

MODEL NUMBER	
IQ Combiner 5 (X-IQ-AM1-240-5/ X-IQ-AM1-240-5-HDK)	IQ Combiner 5 with IQ Gateway printed circuit board for integrated revenue-grade PV production metering (ANSI C12.20 ±0.5%), consumption monitoring (±2.5%), and IQ Battery monitoring (±2.5%). Includes a silver solar shield to deflect heat. IQ-AM1-240-5-HDK includes a factory installed hold-down kit compatible with all the circuit breakers mentioned in the Accessories and Replacement Parts section.
IQ Combiner 5C (X-IQ-AM1-240-5C / X-IQ-AM1-240-5C-HDK)	IQ Combiner 5C with IQ Gateway printed circuit board for integrated revenue-grade PV production metering (ANSI C12.20 ±0.5%), consumption monitoring (±2.5%), and IQ Battery monitoring (±2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05) ¹ . Includes a silver solar shield to deflect heat. IQ-AM1-240-5C-HDK includes a factory installed hold-down kit compatible with all the circuit breakers mentioned in the Accessories and Replacement Parts section.
WHAT'S IN THE BOX	
IQ Gateway printed circuit board	IQ Gateway is the platform for total energy management for comprehensive, remote maintenance, and management of the Enphase Energy System
Busbar	80 A busbar with support for one IQ Gateway breaker and four 20 A breakers for installing IQ Series Microinverters and IQ Battery 5P
IQ Gateway breaker	Circuit breaker, 2-pole, 10 A/15 A
Production CT	Pre-wired revenue-grade solid-core CT, accurate up to ±0.5%
Consumption CT	Two consumption metering clamp CTs, shipped with the box, accurate up to ±2.5%
IQ Battery CT	One battery metering clamp CT, shipped with the box, accurate up to ±2.5%
CTRL board	Control board for wired communication with IQ System Controller 3/3G and the IQ Battery 5P
Enphase Mobile Connect (only with IQ Combiner 5C)	4G-based LTE-M1 cellular modem (CELLMODEM-M1-06-SP-05) with a 5-year T-Mobile data plan
Accessories kit	Spare control headers for the COMMS-KIT-2 board
ACCESSORIES AND REPLACEMENT PARTS (NOT INCLUDED, ORDER SEPARATELY)	
CELLMODEM-M1-06-SP-05	4G-based LTE-M1 cellular modem with a 5-year T-Mobile data plan
CELLMODEM-M1-06-AT-05	4G-based LTE-M1 cellular modem with a 5-year AT&T data plan
Circuit breakers (off-the-shelf)	Supports Eaton BR2XX, Siemens Q2XX, and GE/ABB THQL21XX Series circuit breakers (XX represents 10, 15, 20, 30, 40, 50, or 60). Also supports Eaton BR220B, BR230B, and BR240B circuit breakers compatible with the hold-down kit.
Circuit breakers (provided by Enphase)	BRK-10A-2-240V, BRK-15A-2-240V, BRK-20A-2P-240V, BRK-15A-2P-240V-B, and BRK-20A-2P-240V-B (more details in the “Accessories” section)
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 5/5C
XA-ENV2-PCBA-5	IQ Gateway replacement printed circuit board (PCB) for IQ Combiner 5/5C
X-IQ-NA-HD-125A	Hold-down kit compatible with Eaton BR-B Series circuit breakers (with screws). Not required for X-IQ-AM1-240-5-HDK/X-IQ-AM1-240-5C-HDK.
XA-COMMS2-PCBA-5	Replacement COMMS-KIT-2 printed circuit board (PCB) for IQ Combiner 5/5C
ELECTRICAL SPECIFICATIONS	
Rating	80 A
System voltage and frequency	120/240 VAC or 120/208 VAC, 60 Hz
Busbar rating	125 A
Fault current rating	10 kAIC
Maximum continuous current rating (input from PV/ storage)	64 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR, Siemens Q, or GE/ABB THQL Series distributed generation (DG) breakers only (not included)
Maximum total branch circuit breaker rating (input)	80 A of distributed generation/95 A with IQ Gateway breaker included
IQ Gateway breaker	10 A or 15 A rating GE/Siemens/Eaton included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway

¹ A plug-and-play industrial-grade cell modem for systems of up to 60 microinverters. Available in the United States, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
04/01/2025

ACCESSORIES AND REPLACEMENT PARTS (NOT INCLUDED, ORDER SEPARATELY)		
Consumption monitoring CT (CT-200-CLAMP)		A pair of 200 A clamp-style current transformers is included with the box
IQ Battery metering CT		200 A clamp-style current transformer for IQ Battery metering, included with the box
MECHANICAL DATA		
Dimensions (W × H × D)		37.5 cm × 49.5 cm × 16.8 cm (14.75" × 19.5" × 6.63"). Height is 53.5 cm (21.06") with mounting brackets.
Weight		7.5 kg (16.5 lb)
Ambient temperature range		-40°C to 46°C (-40°F to 115°F)
Cooling		Natural convection, plus heat shield
Enclosure environmental rating		Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes		<ul style="list-style-type: none"> • 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors • Always follow local code requirements for conductor sizing
Communication (in-premise connectivity)		Built-in CTRL board for wired communication with the IQ Battery 5P and the IQ System Controller 3/3G. Integrated power line communication for IQ Series Microinverters.
Altitude		Up to 2,600 meters (8,530 feet)
COMMUNICATION INTERFACES		
Integrated Wi-Fi		802.11b/g/n (dual band 2.4 GHz/5 GHz) for connecting the Enphase Cloud through the internet.
Wi-Fi range (recommended)		10 m (32.8 feet)
Bluetooth		BLE4.2, 10 m range to configure Wi-Fi SSID
Ethernet		Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included) for connecting to the Enphase Cloud through the internet.
Cellular/Mobile Connect		CELLMODEM-M1-06-SP-05 or CELLMODEM-M1-06-AT-05 (included with the IQ Combiner 5C)
Digital I/O		Digital input/output for grid operator control
USB 2.0		Mobile Connect, COMMS-KIT-01 for IQ Battery 3/3T/10/10T, COMMS-KIT-02 for IQ Battery 5P
Access point (AP) mode		For connection between the IQ Gateway and a mobile device running the Enphase Installer App
Metering ports		Up to two Consumption CTs, one IQ Battery CT, and one Production CT
Power line communication		90–110 kHz
Web API		See https://developer-v4.enphase.com
Local API		See Guide for local API
COMPLIANCE		
IQ Combiner with IQ Gateway		UL 1741, CAN/CSA C22.2 No. 107.1, Title 47 CFR, Part 15, Class B, ICES 003, NOM-208-SCFI-2016, UL 61010-1, CAN/CSA 22.2 No. 61010-1, IEEE 1547: 2018 (UL 1741-SB, 3rd Ed.), IEEE 2030.5/CSIP Compliant, Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
COMPATIBILITY		
PV	Microinverters	IQ6, IQ7, and IQ8 Series Microinverters
COMMS-KIT-01 ²	IQ System Controller	EP200G101-M240US00
	IQ System Controller 2	EP200G101-M240US01
	IQ Battery	ENCHARGE-3-1P-NA, ENCHARGE-10-1P-NA, ENCHARGE-3T-1P-NA, ENCHARGE-10T-1P-NA
COMMS-KIT-02 ³	IQ System Controller 3	SC200D111C240US01, SC200G111C240US01
	IQ Battery	IQBATTERY-5P-1P-NA

² For information about IQ Combiner 5/5C compatibility with the 2nd-generation batteries, refer to the [compatibility matrix](#).

³ IQ Combiner 5/5C comes pre-equipped with COMMS-KIT-02.

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025

Accessories

Mobile Connect



4G-based LTE-M1 cellular modem with a 5-year data plan (CELLMODEM-M1-06-SP-05 for T-Mobile and CELLMODEM-M1-06-AT-05 for AT&T)

Circuit breakers



BRK-10A-2-240V Circuit breaker, 2-pole, 10 A, Eaton BR210
BRK-15A-2-240V Circuit breaker, 2-pole, 15 A, Eaton BR215
BRK-20A-2P-240V Circuit breaker, 2-pole, 20 A, Eaton BR220
BRK-15A-2P-240V-B Circuit breaker, 2-pole, 15 A, Eaton BR215B with hold-down kit support
BRK-20A-2P-240V-B Circuit breaker, 2-pole, 20 A, Eaton BR220B with hold-down kit support

CT-200-SOLID



200 A revenue-grade solid-core Production CT with <0.5% error rate (replacement SKU)

CT-200-CLAMP






200 A clamp-style consumption and battery metering CT with <2.5% error rate (replacement SKU)

CrossRail 44-X Max

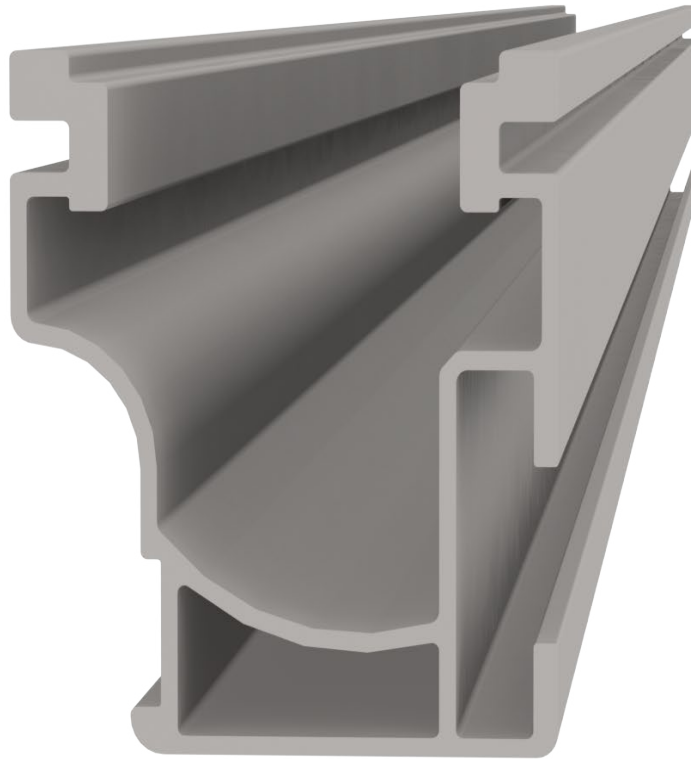

DATA SHEET



Part Number	Description
4000819	CrossRail 44-X Max 172'', Mill
4000819-US	CrossRail 44-X Max 172'', Mill, DC 
4000820	CrossRail 44-X Max 172'', Dark
4000820-US	CrossRail 44-X Max 172'', Dark, DC 
4000919	CrossRail 44-X Max 185'', Mill
4000920	CrossRail 44-X Max 185'', Dark

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025



TECHNICAL DATA

	CrossRail 44-X Max
Material	Series 6000 Aluminum
Flexibility	Modular construction, suitable for any system size, height adjustable
Weight	0.50lbs/ft (0.746kg/m)
Finish	Mill or Dark
Certifications	UL 2703, ASCE 7-16, Class A Fire Rating
Warranty	25 years

CROSS-SECTIONAL PROPERTIES

	CrossRail 44-X Max
Sx	0.175 in ³ (2.861 cm ³)
Sy	0.147 in ³ (2.410 cm ³)
A (Section X)	0.428 in ² (2.763 cm ²)

LOAD		RAIL SPAN								
SNOW (psf)	WIND (mph)	32"	4'	64"	6'	80"	8'	112"	10'	12'
0	120									
0	140									
0	160									
10	120									
10	140									
10	160									
20	140									
20	160									
30	160									
40	160									
80	160									
100	160									


44X/MAX 48X 48XL CR80

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025



Measurements: [mm] inches

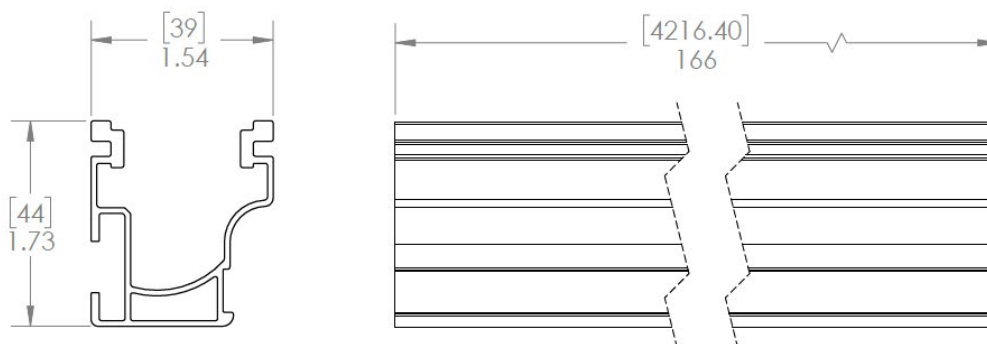

Notes:


- / Structural values and spand diagrams determined in accordance with the Aluminum Design Manual and ASCE 7-16
- / System evaluated under UL2703

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025



TECHNICAL DATA

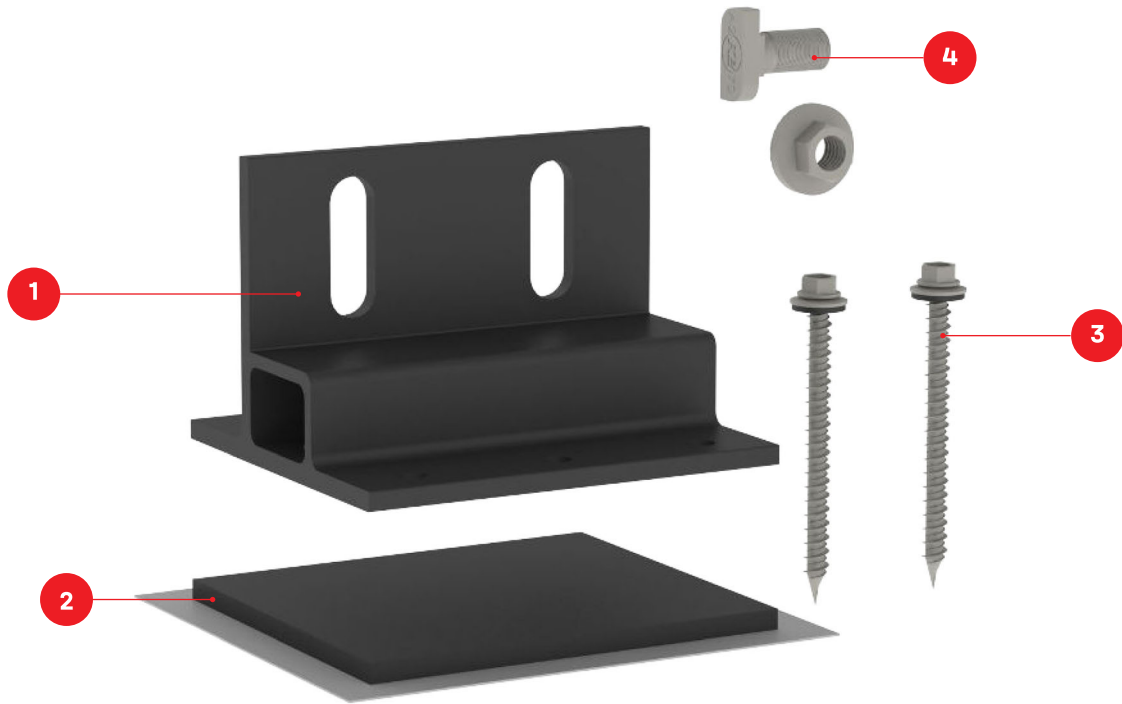

Splice Foot XL

Item Number	Description	Part Number
1	Splice Foot XL	4000165 Splice Foot XL #14 Kit, Dark 4000300 Splice Foot XL #14 Kit, Mill
2	K2 EverSeal	
3	#14 × 3in x 5/16in Hex Head Screw	
4	T-Bolt & Hex Nut Set	


	Splice Foot XL
Roof Type	Composition shingle, EPDM, TPO, Bitumen, Asphalt
Material	Aluminum with stainless steel hardware
Finish	Mill
Roof Connection	#14 × 3in x 5/16in Hex Head Screw
Code Compliance	UL 2703
Compatibility	CrossRail 44-X, 48-X, 48-XL, 80

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
04/01/2025

TECHNICAL DATA



Units: [in] mm

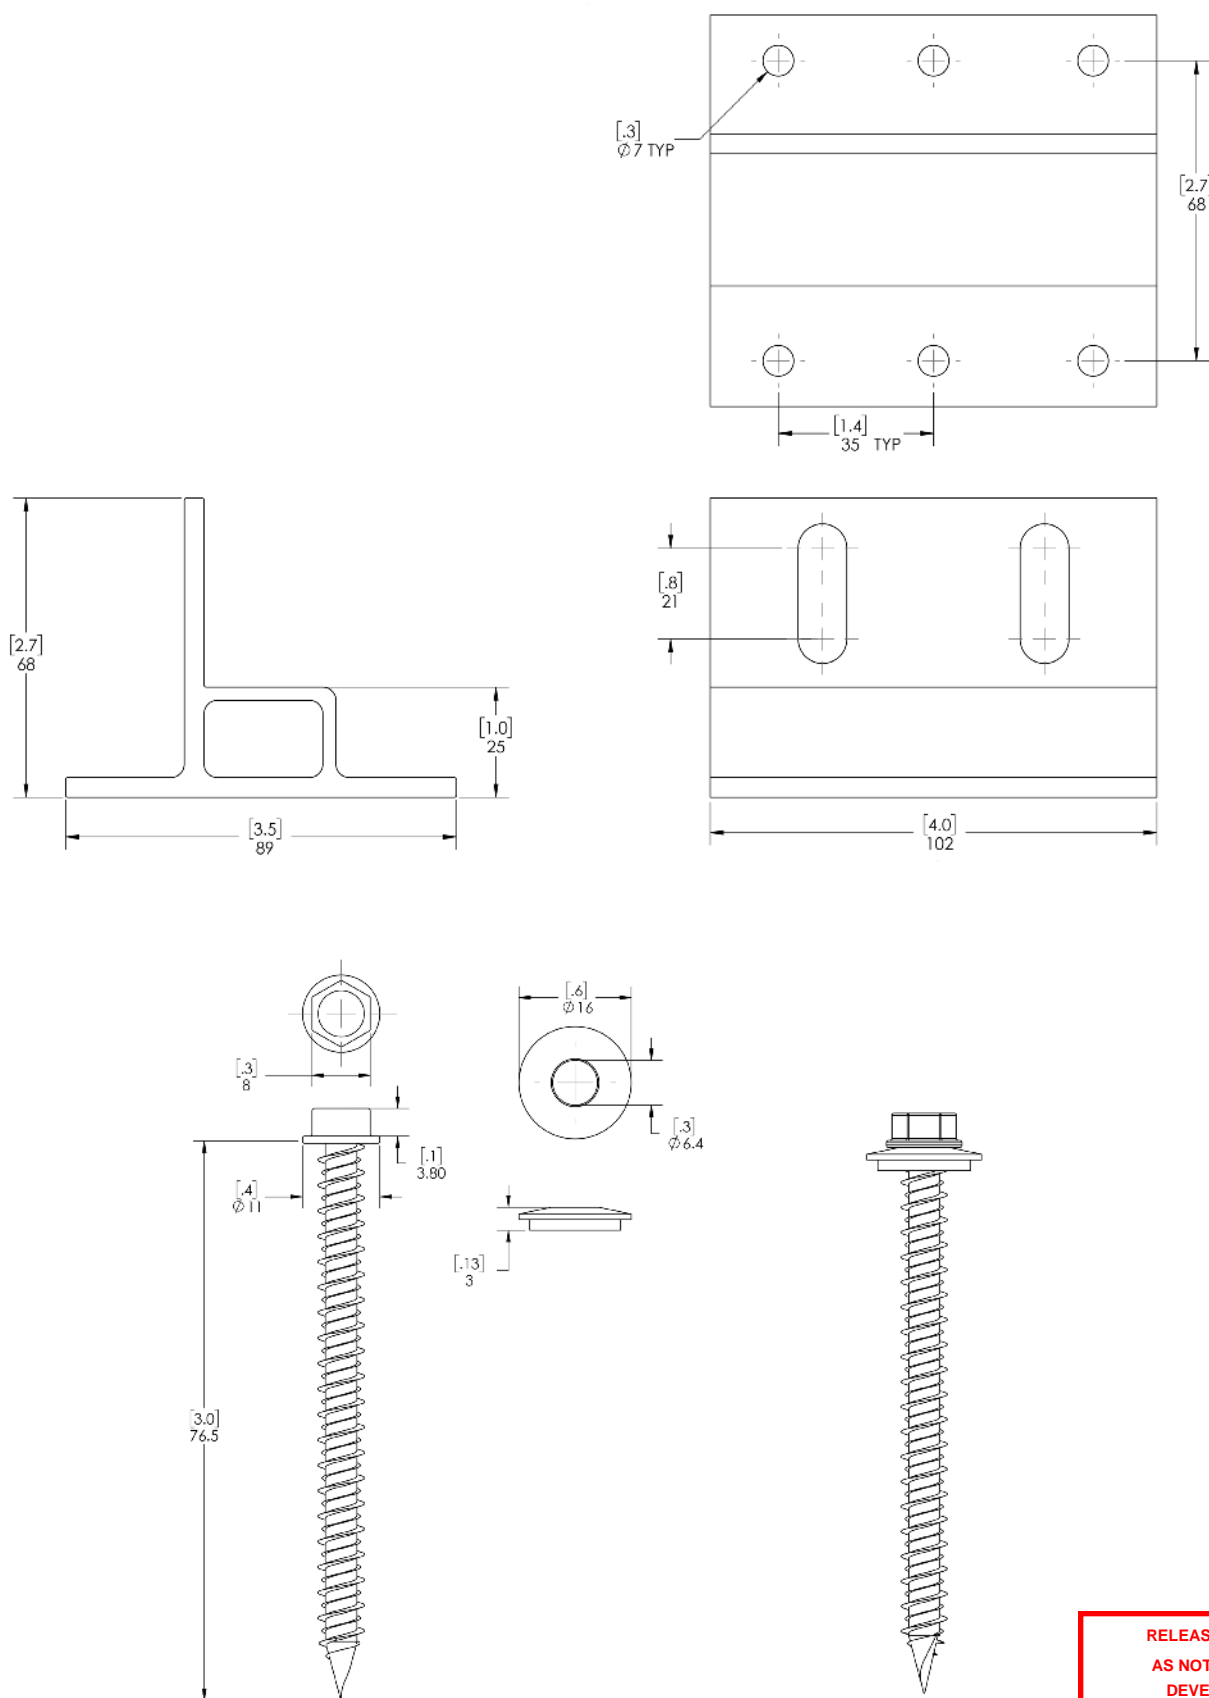

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

04/01/2025

We support PV systems
Formerly Everest Solar Systems




K2 Ground Lug

PRODUCT SHEET

Part Number	Description
4000006-H	Everest Ground Lug Set, 13mm Hex

- ▶ Top mount configuration
- ▶ No copper wire bending makes for simple installation
- ▶ MK3 technology provides highest rail engagement
- ▶ UL 2703 Listed
- ▶ Compatible with 8AWG and 6AWG solid copper wire
- ▶ Works with all CrossRail profiles.

U5934-XL-BLG

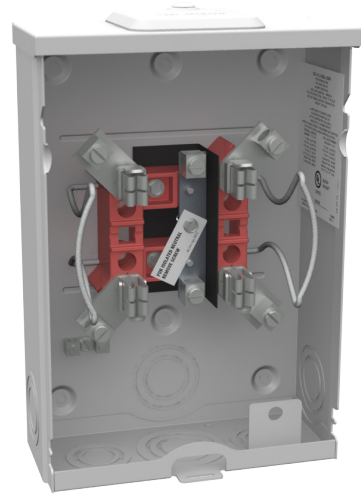

Catalog Number	U5934-XL-BLG
Marketing Product Description	4 Terminal Ringless Small Closing Plate 7-8 In Barrel Lock Ground With Bracket Provision
UPC	784572592278
Length (IN)	3.61
Width (IN)	8
Height (IN)	11.5
Brand Name	Milbank
Type	Ringless Meter Socket
Application	Meter Socket
Standard	UL Listed;Type 3R
Voltage Rating	600 Volts Alternating Current
Amperage Rating	100 Continuous Ampere
Phase	1 Phase
Frequency Rating	60 Hertz
Size	3.61L x 8W x 11.5H
Number Of Cutouts	0
Cutout Size	No Main Breaker
Cable Entry	Overhead or Underground
Terminal	Single Mechanical
Insulation	Glass Polyester
Mounting	Surface Mount

Enclosure	G90 Galvanized Steel with Powder Coat Finish
Jaw Quantity	4 Terminal
Bypass Type	No Bypass
Number of Meter Positions	1 Position
Equipment Ground	Ground Bar
Hub Opening	Small Closing Plate
Line Side Wire Range	12 - 1/0 AWG
Load Side Wire Range	12 - 1/0 AWG
Number Of Receptacles	0


Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI



MILBANK®
ENERGY AT WORK



K5T

Catalog Number	K5T
Marketing Product Description	Fifth Terminal Use With 40 Block Square Hole
UPC	784572212565
Length (IN)	0.545
Width (IN)	1.347
Height (IN)	1.575
Weight (LB)	0.08
Brand Name	Milbank
Type	Fifth Terminal Kit
Special Features	3 OClock Position;9 OClock Position
Application	Metering Accessory
Connection	10-32 Screw
Wire Size	No Wire Required
Terminal Size	.545L x 1.347W x 1.575H
Voltage Rating	600 Volts Alternating Current
Material	Copper
Mounting	Plug In

Please consult serving utility for their requirements prior to ordering or installing, as specifications and approvals vary by utility and may require local electrical inspector approval. All installations must be installed by a licensed electrician and must comply with all national and local codes, laws and regulations. Milbank reserves the right to make changes in specifications and features shown without notice or obligation.

RELEASE FOR CONSTRUCTION
AS NOTED FOR PLAN REVIEW
DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI