




APPLICANT SITE NAME:  
**LEES SUMMIT**

**RELEASED FOR CONSTRUCTION**  
As Noted on Plan Review  
  
Development Services Department  
Lee's Summit, Missouri  
12/02/2025

PROJECT:  
**RAWLAND**

DRAWING DESCRIPTION:  
**PRELIMINARY CD**

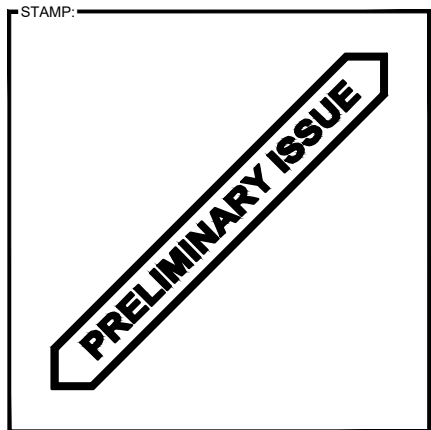

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE# DISCIPLINE:  
CJ CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL CC  
REJ ROBERT E. JENSEN PE-028974 CIVIL CC  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL CC  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E



**SITE INFORMATION**

SITE ADDRESS: TBD  
LEE'S SUMMIT, MO 64063

COUNTY: JACKSON

PROPERTY OWNER: CITY OF LEE'S SUMMIT  
207 SW MARKET ST  
LEE'S SUMMIT, MO 64063

TOWER INFORMATION:  
LATITUDE: 38° 55' 51.69" N (NAD 83)  
LONGITUDE: 94° 22' 54.45" W (NAD 83)  
GROUND ELEV: 1017' AMSL  
OVERALL STRUCTURE HEIGHT: 120'-0" AGL  
TOWER HEIGHT: 120'-0" AGL  
TOWER TYPE: MONOPOLE

APPLICANT: CITY OF LEE'S SUMMIT  
207 SW MARKET ST  
LEE'S SUMMIT, MO 64063

CLIENT: HAYDEN TOWER SERVICE, INC.  
2836 NW HIGHWAY 24  
TOPEKA, KANSAS 66618  
PHONE: (785) 232-1840  
FAX: (785) 232-1877

**CONSULTING TEAM**

ENGINEERING:  
SSC, INC.  
7171 WEST 95TH STREET, SUITE 600  
OVERLAND PARK, KANSAS 66212  
PHONE: (913) 438-7700  
FAX: (913) 438-7777  
SSC SITE ID: SSC-30322  
PROJECT ID: P-048362

CLIENT MANAGER:  
DALLAS PELLAND

A&E PROJECT MANAGER:  
JEREMY BRISCOE

LEAD ENGINEER:  
CHRIS GIANNOTTI

LEAD ELECTRICAL:  
SHELTON KEISLING

**DRAWING INDEX**

SHEET NO.	SHEET TITLE	DISC.
T-1.0	TITLE SHEET	C/E
	SURVEY (BY OTHERS)	
A-0.0	GRADING PLAN	C
A-1.0	OVERALL SITE PLAN	C
A-1.1	ENLARGED SITE PLAN	C
A-2.0	TOWER ELEVATION	C
A-3.0	SHELTER ELEVATIONS	C
A-4.0	CONSTRUCTION DETAILS (1 OF 2)	C
A-4.1	CONSTRUCTION DETAILS (2 OF 2)	C
A-5.0	FENCE DETAILS	C
E-1.0	OVERALL UTILITY PLAN	E
E-2.0	ENLARGED UTILITY PLAN AND DETAILS	E
E-3.0	ELECTRICAL DETAILS	E
G-1.0	GROUNDING PLAN	E
G-2.0	GROUNDING RISER DIAGRAM	E
G-3.0	GROUNDING DETAILS (1 OF 3)	E
G-3.1	GROUNDING DETAILS (2 OF 3)	E
G-3.2	GROUNDING DETAILS (3 OF 3)	E
SP-1.0	SPECIFICATIONS (1 OF 7)	C
SP-1.1	SPECIFICATIONS (2 OF 7)	C
SP-1.2	SPECIFICATIONS (3 OF 7)	C
SP-1.3	SPECIFICATIONS (4 OF 7)	C
SP-1.4	SPECIFICATIONS (5 OF 7)	C
SP-2.0	SPECIFICATIONS (6 OF 7)	E
SP-2.1	SPECIFICATIONS (7 OF 7)	E



**DRAWING NOTICE:**  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

**SUBMITTALS:**

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
**LEES SUMMIT**

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: **TITLE SHEET** SHEET #: **T-1.0**

**JURISDICTION COMPLIANCE**

ALL WORK SHALL BE PERFORMED AND MATERIALS INSTALLED IN ACCORDANCE WITH THE CURRENT EDITIONS OF THE FOLLOWING CODES AS ADOPTED BY THE LOCAL GOVERNING AUTHORITIES. NOTHING IN THESE PLANS IS TO BE CONSTRUED TO PERMIT WORK NOT CONFORMING TO THESE CODES.

- INTERNATIONAL BUILDING CODE
- INTERNATIONAL MECHANICAL CODE
- ANSI/TIA-222 STRUCTURAL STANDARD
- NFPA 780 - LIGHTNING PROTECTION CODE
- NATIONAL ELECTRICAL CODE

Know what's below.  
Call before you dig.  
www.call811.com

THE UTILITIES AS SHOWN ON THIS SET OF DRAWINGS WERE DEVELOPED FROM THE INFORMATION AVAILABLE. THE INFORMATION PROVIDED IS NOT IMPLIED NOR INTENDED TO BE THE COMPLETE INVENTORY OF UTILITIES IN THIS AREA. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THE LOCATION OF ALL UTILITIES (WHETHER SHOWN OR NOT) AND PROTECT SAID UTILITIES FROM ANY DAMAGE CAUSED BY CONTRACTOR'S ACTIVITIES.

# LEE'S SUMMIT

## PART OF THE SE1/4, SECTION 31-T48N-R31W, IN JACKSON COUNTY, MISSOURI

**Notes:**

Bearings shown hereon are referenced to Grid North of the Missouri State Plane Coordinate System of 1983 (NAD 83), (2011 ADJ.), West Zone. They are obtained by static GPS observations and Rinex File submittals for NGS Opus solutions.

Vertical Datum = NAVD88 using GEOID12B

This survey's purpose is to establish and describe a Lease Area and associated Easements. It is not a boundary survey of the Parent Parcel.

The Lease Area and associated Easements lie entirely within the Parent Parcel.

During this survey's fieldwork, there were no visible encroachments in the Lease Area or associated Easements.


The Non-Exclusive Access/Utility Easements terminates at Public Right of Way.

\*\* An utility locate was requested on 09-30-24, as Ticket No. 242743082.

The utilities shown on this drawing were developed from the information available (existing utility maps, aboveground observations, and or surface markings placed on the ground by the utility company or a representative thereof). This company has not attempted to excavate or go below the surface to locate utilities. It does not extend or imply a guarantee or warranty on the exact location of or complete inventory of utilities in this area. The contractor shall be responsible for verifying the location and depth of all utilities (whether shown or not) before excavation or construction and protecting them from damage.

**LEGEND**

LIGHT POLE	⊗ LP
ELECTRIC TRANSFORMER	□ ET
UTILITY VAULT	□ UV
KEY PAD	• KP
IRRIGATION VALVE	• IV
SIGN	△
GATE POST	• GP
MANHOLE (UTILITY)	⊕
PROPOSED TOWER	△
TREE (DIA.)	🌳
CEDAR/PINE (DIA.)	🌲
BUSH	🌿
FENCE	— X —
OVERHEAD POWER LINE	—•••••
UNDERGROUND ELECTRIC LINE	--- ELE ---
BENCHMARK	⊕
CONTROL POINT	△

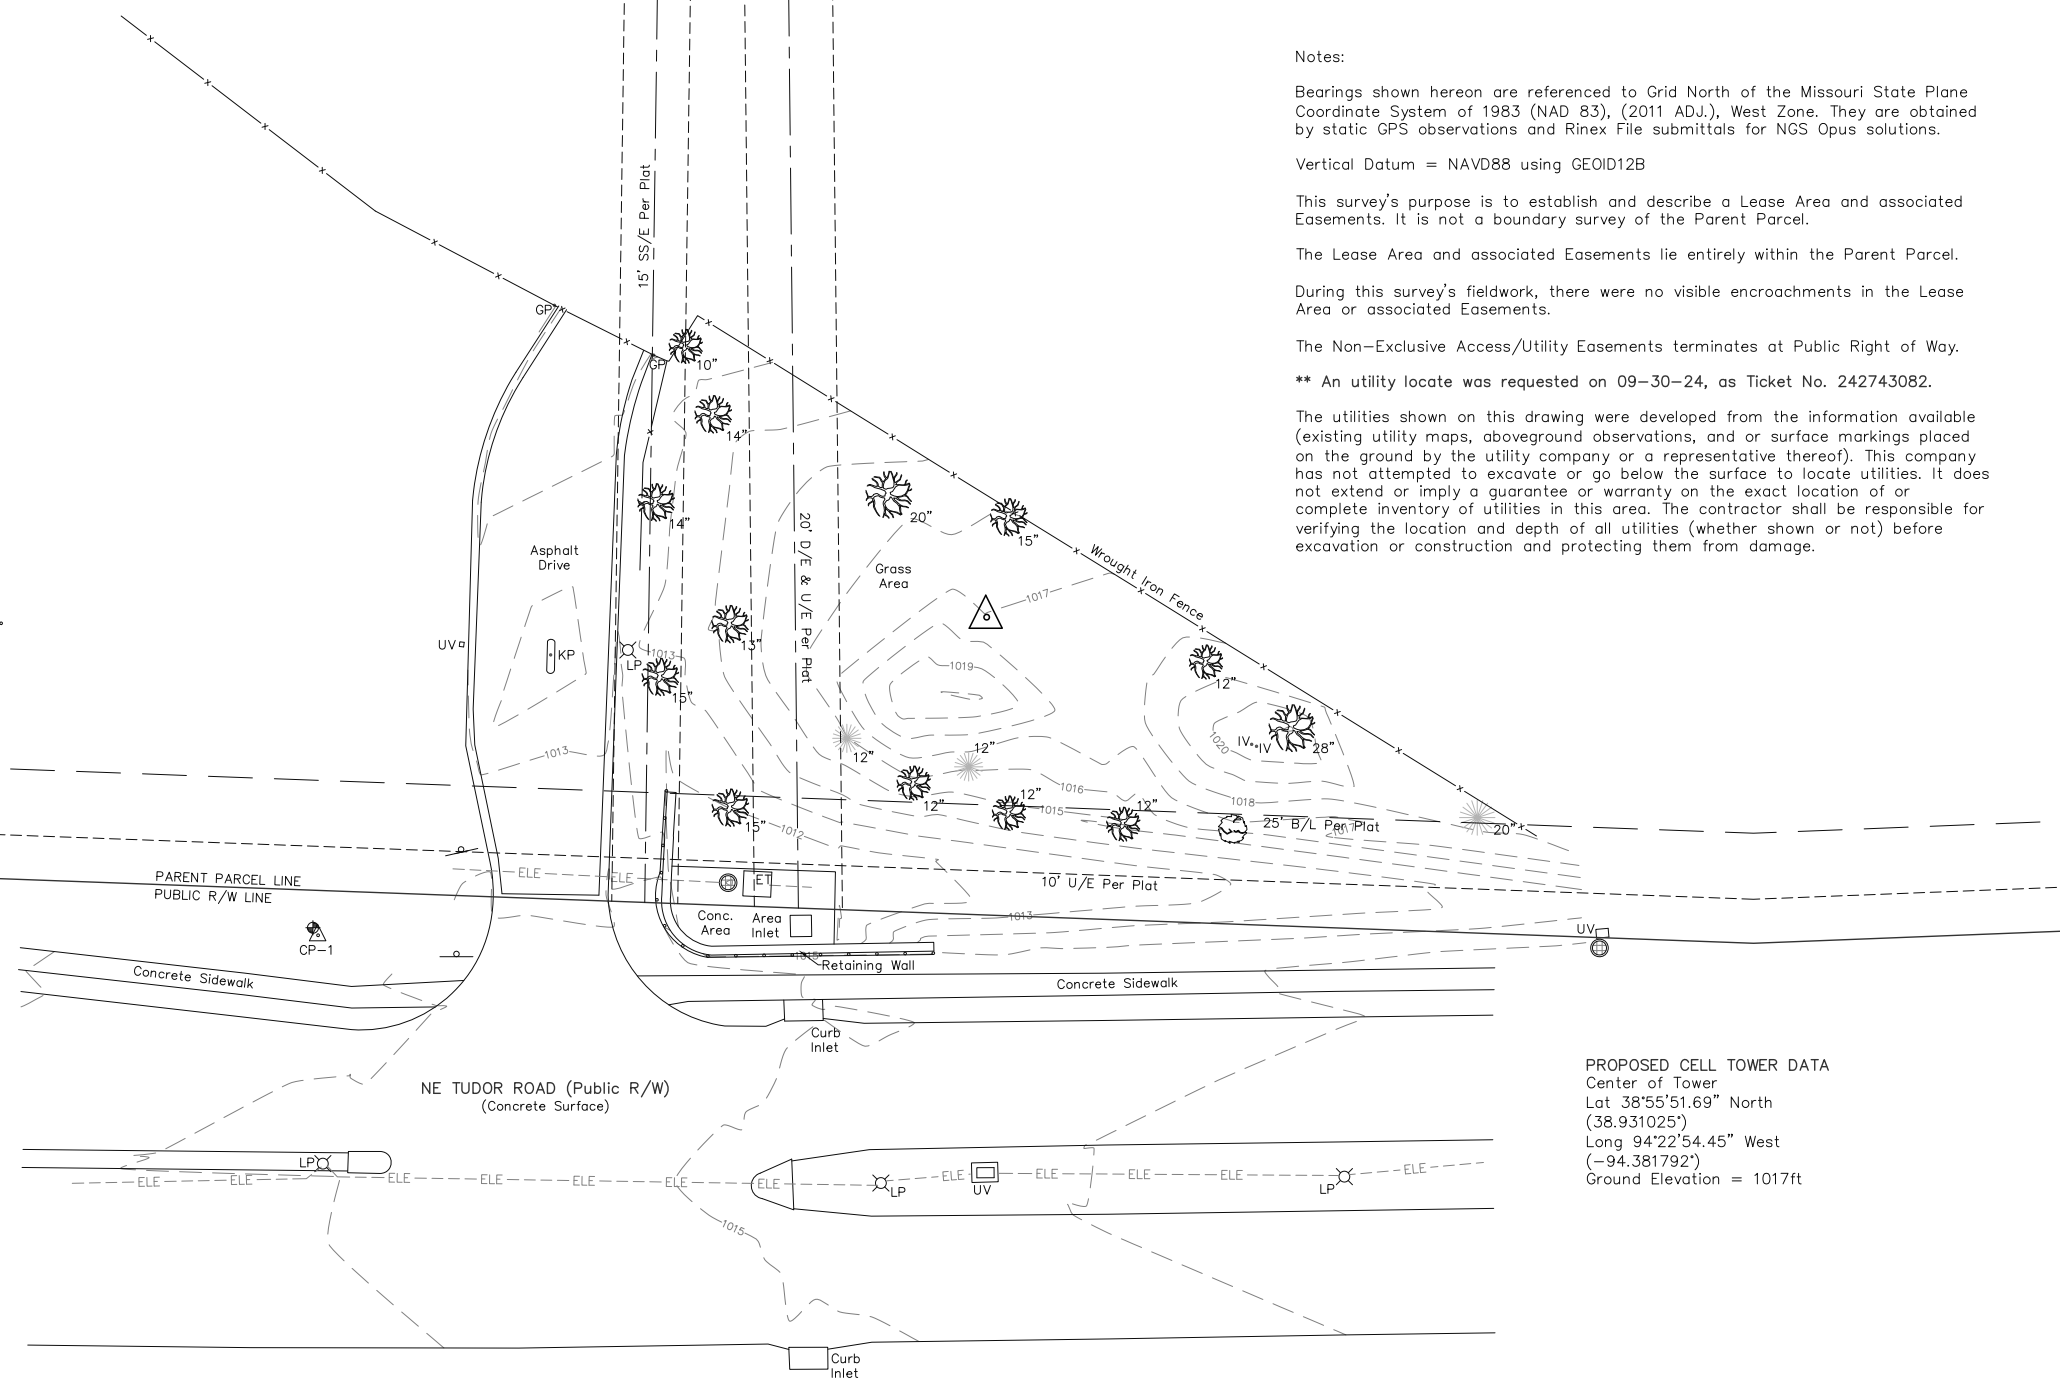


**PROPOSED CELL TOWER DATA**  
 Center of Tower  
 Lat 38°55'51.69" North  
 (38.931025°)  
 Long 94°22'54.45" West  
 (-94.381792°)  
 Ground Elevation = 1017ft

**BENCH MARK**  
 Top of 1/2" Iron Bar w/  
 Control Cap at CP-1  
 Elevation = 1013.68ft

**CERTIFICATION:**  
 I HEREBY CERTIFY THAT A SURVEY WAS MADE BY ME, OR UNDER MY DIRECT SUPERVISION, ON THE GROUND OF THE LEASE AREA, AND ASSOCIATED EASEMENT PREMISES HEREIN DESCRIBED, AND THE RESULTS OF SAID SURVEY ARE REPRESENTED HEREON TO THE BEST OF MY PROFESSIONAL KNOWLEDGE AND BELIEF.

PRELIMINARY


JEFFREY B. LOVELACE MO-LS2580  
 DATE: \_\_\_\_\_

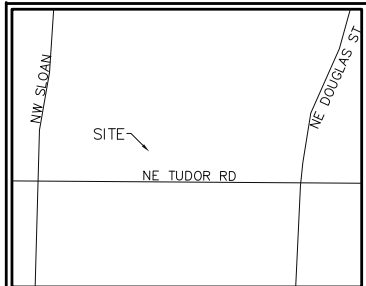

**Hayden**  
**TOWER SERVICE, INC.**  
 2936 N.W. Hwy 24  
 Topeka, KS 66618  
 Phone: (785) 232-1840  
 Fax: (785) 232-1877

**LA** **LOVELACE & ASSOCIATES**  
 Land Surveying - Land Planning  
 Telecommunications Surveys  
 929 SE 3rd Street Lee's Summit, Missouri 64063  
 Phone: (816) 347-9997 Fax: (816) 347-9979

**SURVEY PROVIDED BY:**  
 LOVELACE AND ASSOCIATES, LLC  
 P.O. BOX 68,  
 LEE'S SUMMIT, MO 64063  
 TELEPHONE: 816-347-9997  
 FAX: 816-347-9979

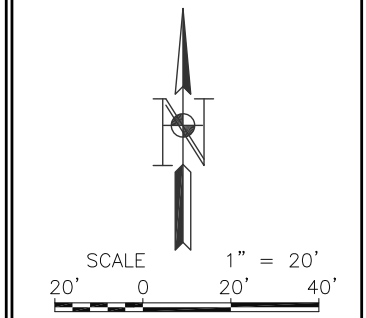

**FLOOD NOTE:**  
 According to my interpretations of Community Panel No. 29095C0417G of the Flood Insurance Rate Map for Lee's Summit, Missouri, the subject property is in Flood Zone "X", ie. "areas determined to be Outside the 0.2% annual chance floodplain".



CALL BEFORE YOU DIG - DRILL - BLAST  
 1-800-344-7483  
 (TOLL FREE)  
 MISSOURI ONE CALL SYSTEM, INC.

SITE I.D.: NA
SITE NAME: LEE'S SUMMIT
SITE LOCATION: 10 NE TUDOR RD, LEE'S SUMMIT, MO
LA PROJECT NO.: 24171
DRAWN BY: A.C.T.
CHECKED BY: J.B.L.
DATE: 10-11-24
FIELDWORK DATE: 10-10-24

Certificate of Authority:  
 Missouri - 2002026538

SHEET NUMBER  
1 OF 1

NOTE:  
SLOPES SHALL NOT EXCEED 3:1  
(3 FEET HORIZONTAL TO 1 FOOT VERTICAL)

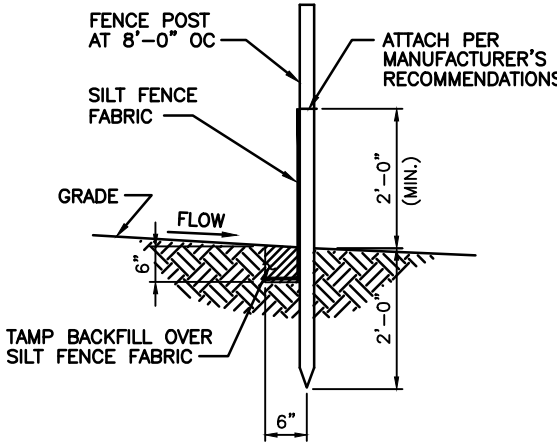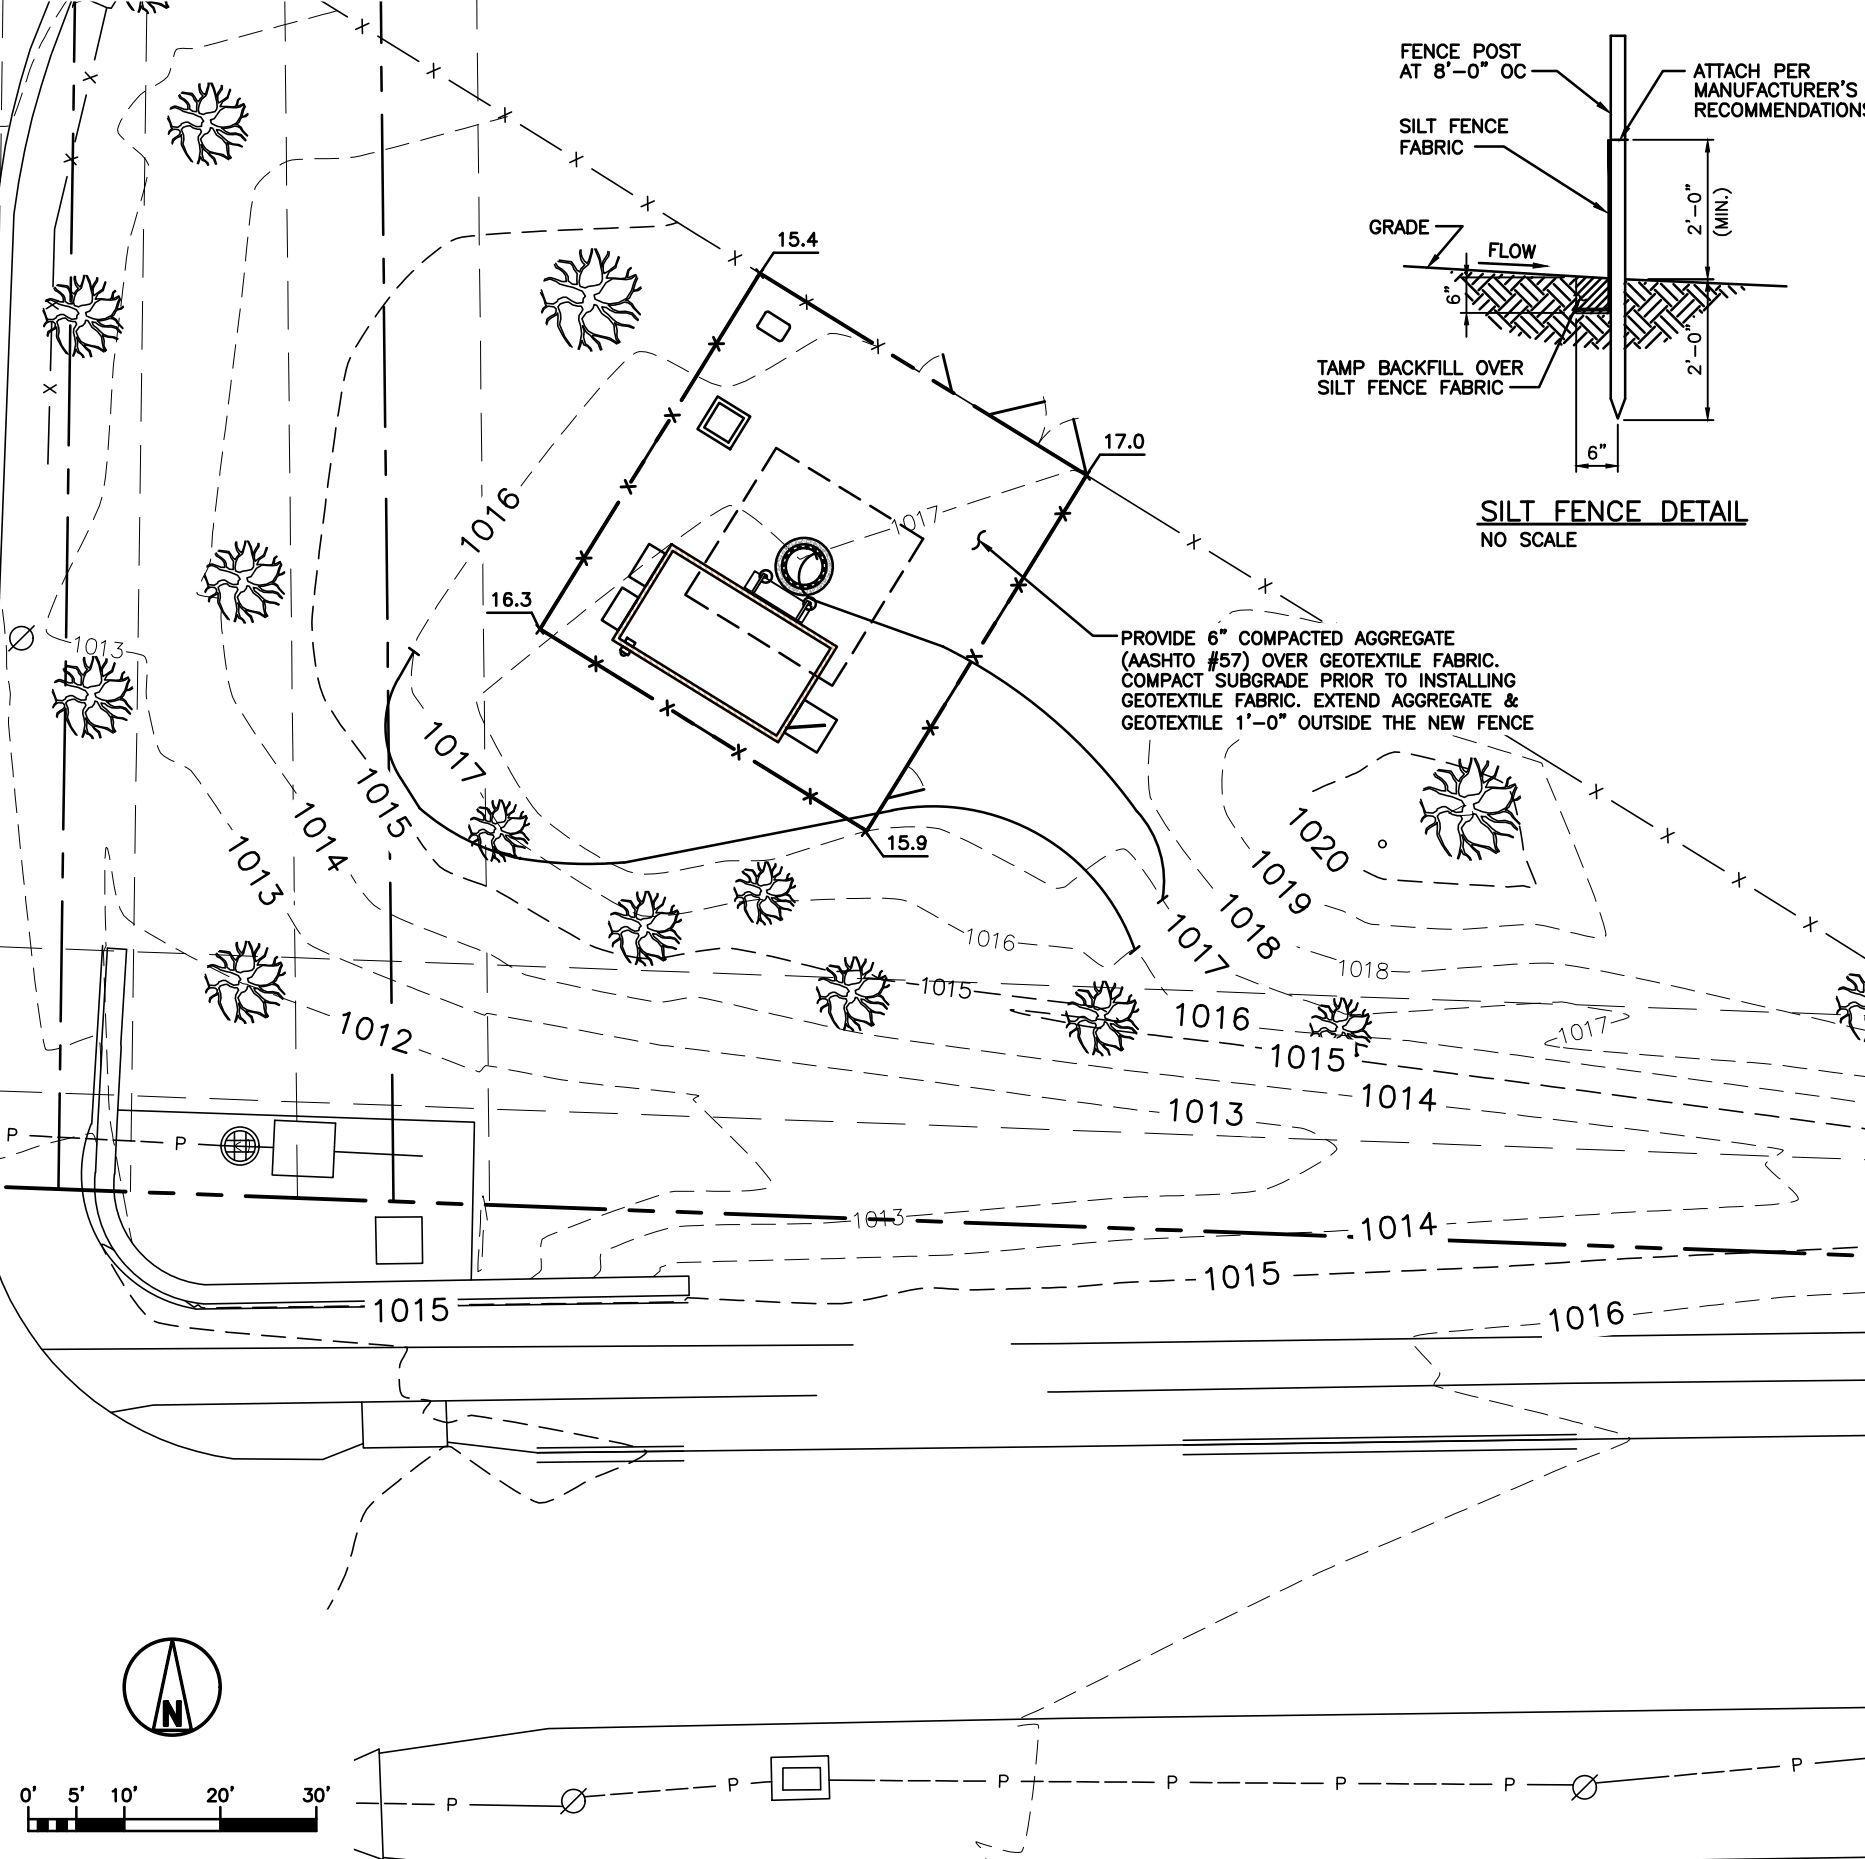

**SILT FENCE DETAIL**  
NO SCALE

**GRADING NOTES:**

1. STRIP THE GROUND OF ALL VEGETATION AND DEBRIS.
2. PROOF ROLL WITH LOADED TANDEM TO IDENTIFY SOFT SPOTS.
3. REMOVE SOFT SPOT MATERIAL AND COMPACT TO 95% AT STRUCTURE, 90% ELSEWHERE.
4. INSTALL GEOTEXTILE FABRIC ON PREPARED SUBGRADE.
5. PLACE AND COMPACT 6" AGGREGATE SURFACING.
6. SEE SPECIFICATIONS DRAWINGS FOR REQUIREMENTS OF BACKFILL MATERIAL.
7. MAINTAIN REASONABLE DUST CONTROL METHODS DURING CONSTRUCTION.
8. ENTIRE DRIVE LENGTH SHALL BE POSITIVE DRAINING DURING, AND AT COMPLETION OF CONSTRUCTION.
9. CONTRACTOR SHALL OBTAIN ANY SITE SPECIFIC SOILS REPORTS AND FOLLOW ALL RECOMMENDATIONS. A DISCREPANCY BETWEEN CONSTRUCTION DRAWINGS AND SOILS REPORT, THE GEOTECHNICAL REPORT SHALL GOVERN. SSC TO BE NOTIFIED OF DISCREPANCY.

**SILTRATION NOTES:**

1. SILTRATION CONTROL DEVICES TO REMAIN IN PLACE UNTIL ADEQUATE VEGETATION GROWTH INSURES NO FURTHER EROSION.
2. SILTRATION FENCES SHALL BE INSPECTED PERIODICALLY FOR DAMAGE AND FOR THE AMOUNT OF SEDIMENTATION WHICH HAS ACCUMULATED. REMOVAL OF SEDIMENT WILL BE REQUIRED WHEN IT REACHES 1/2 FENCE HEIGHT.
3. ATTACHMENT OF GEOTEXTILE FABRIC TO BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
4. SILT FENCING TO BE USED AT ALL AREAS OF EXCAVATION.

STAMP:

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE#:  
DISCIPLINE:  
CJ CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL  
REJ ROBERT E. JENSEN PE-028974 CIVIL  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E

OEM:

APPLICANT:

PLANS PREPARED FOR:

PLANS PREPARED BY:

DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:


DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
**LEES SUMMIT**

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063


SHEET DESCRIPTION: **GRADING PLAN**  
SHEET #: **A-0.0**

SCALE: 1:10 (22"x34")  
SCALE: 1:20 (11"x17")

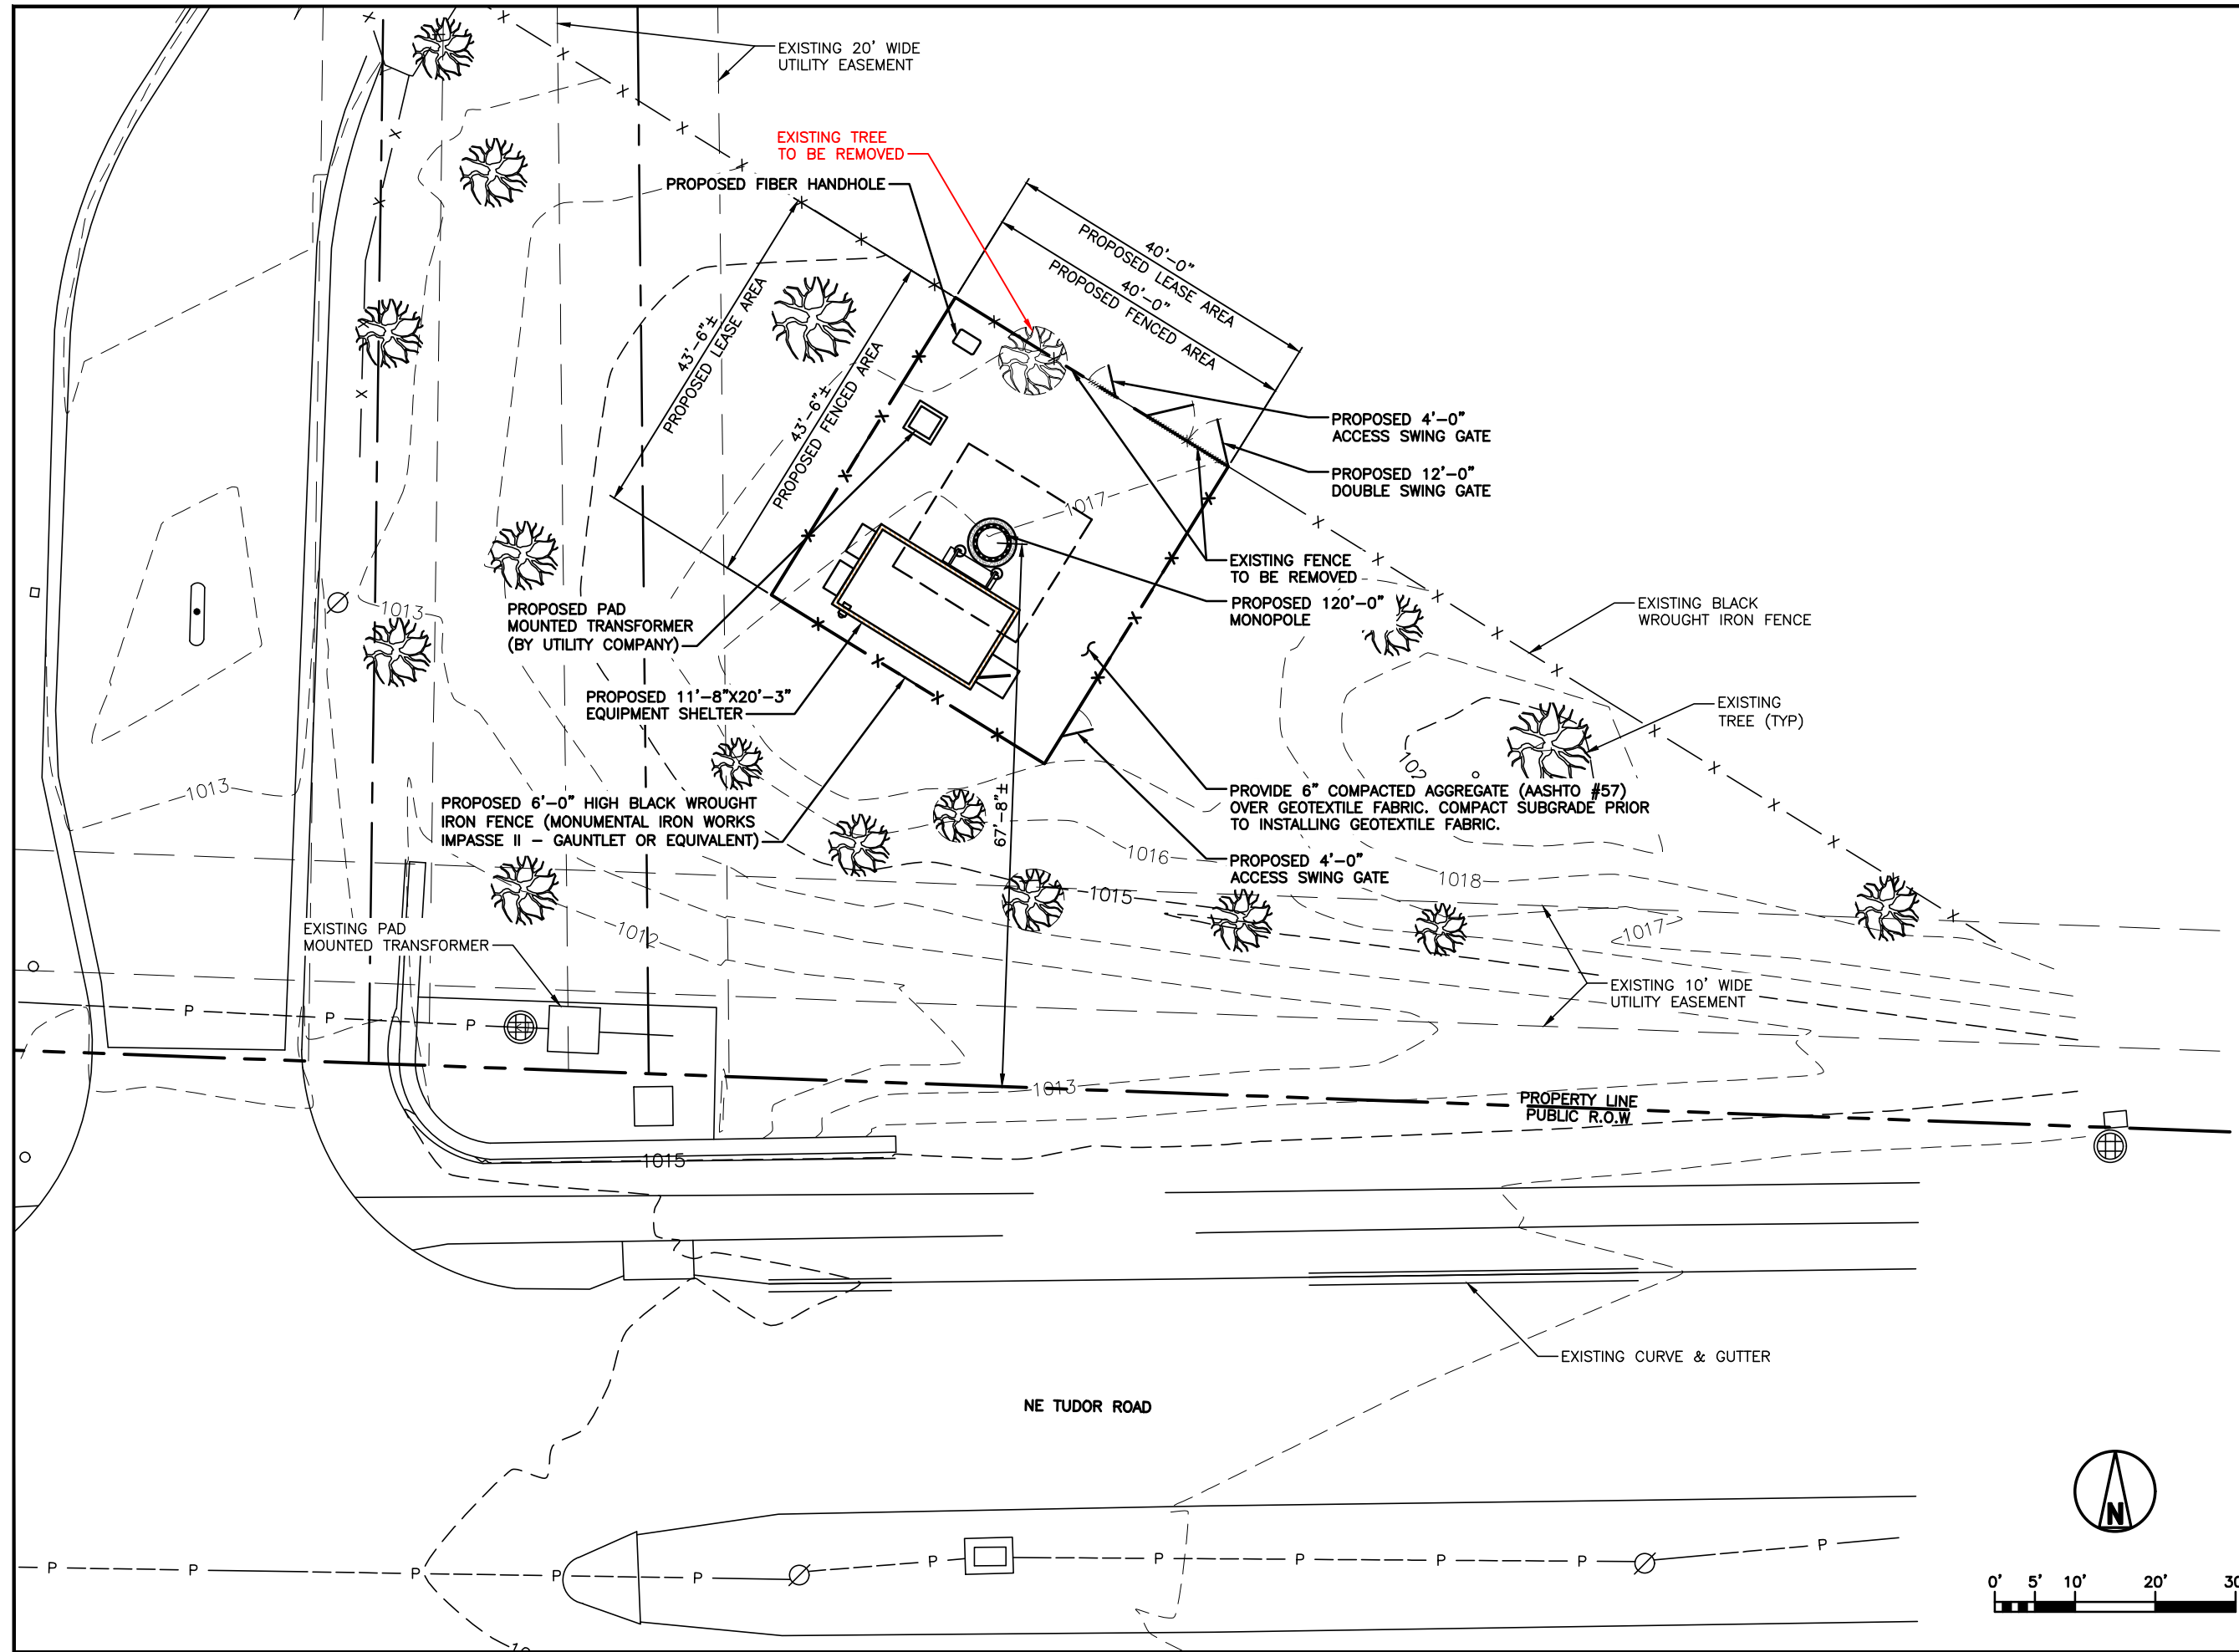

STAMP:  
**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 C.O. CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
 R.E.J. ROBERT E. JENSEN PE-028974 CIVIL C  
 P.M.S. PHILIP M. SWOBODA PE-2024040585 CIVIL C  
 S.D.K. SHELTON D. KEISLING PE-27323 ELECTRICAL E  
 D.J.W. DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
 T.M.S. TERRANCE M. SUPER PE-18521 ELECTRICAL E

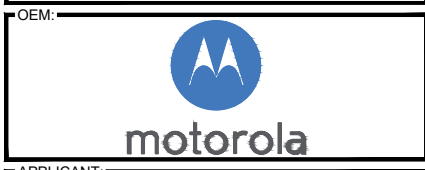

DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.


SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT


SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: OVERALL SITE PLAN  
 SHEET #: A-1.0

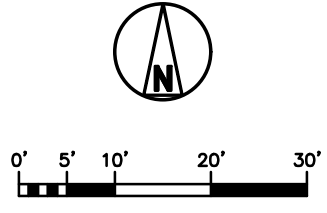

OVERALL SITE PLAN


SCALE: 1:10 (22"x34")  
 SCALE: 1:20 (11"x17")

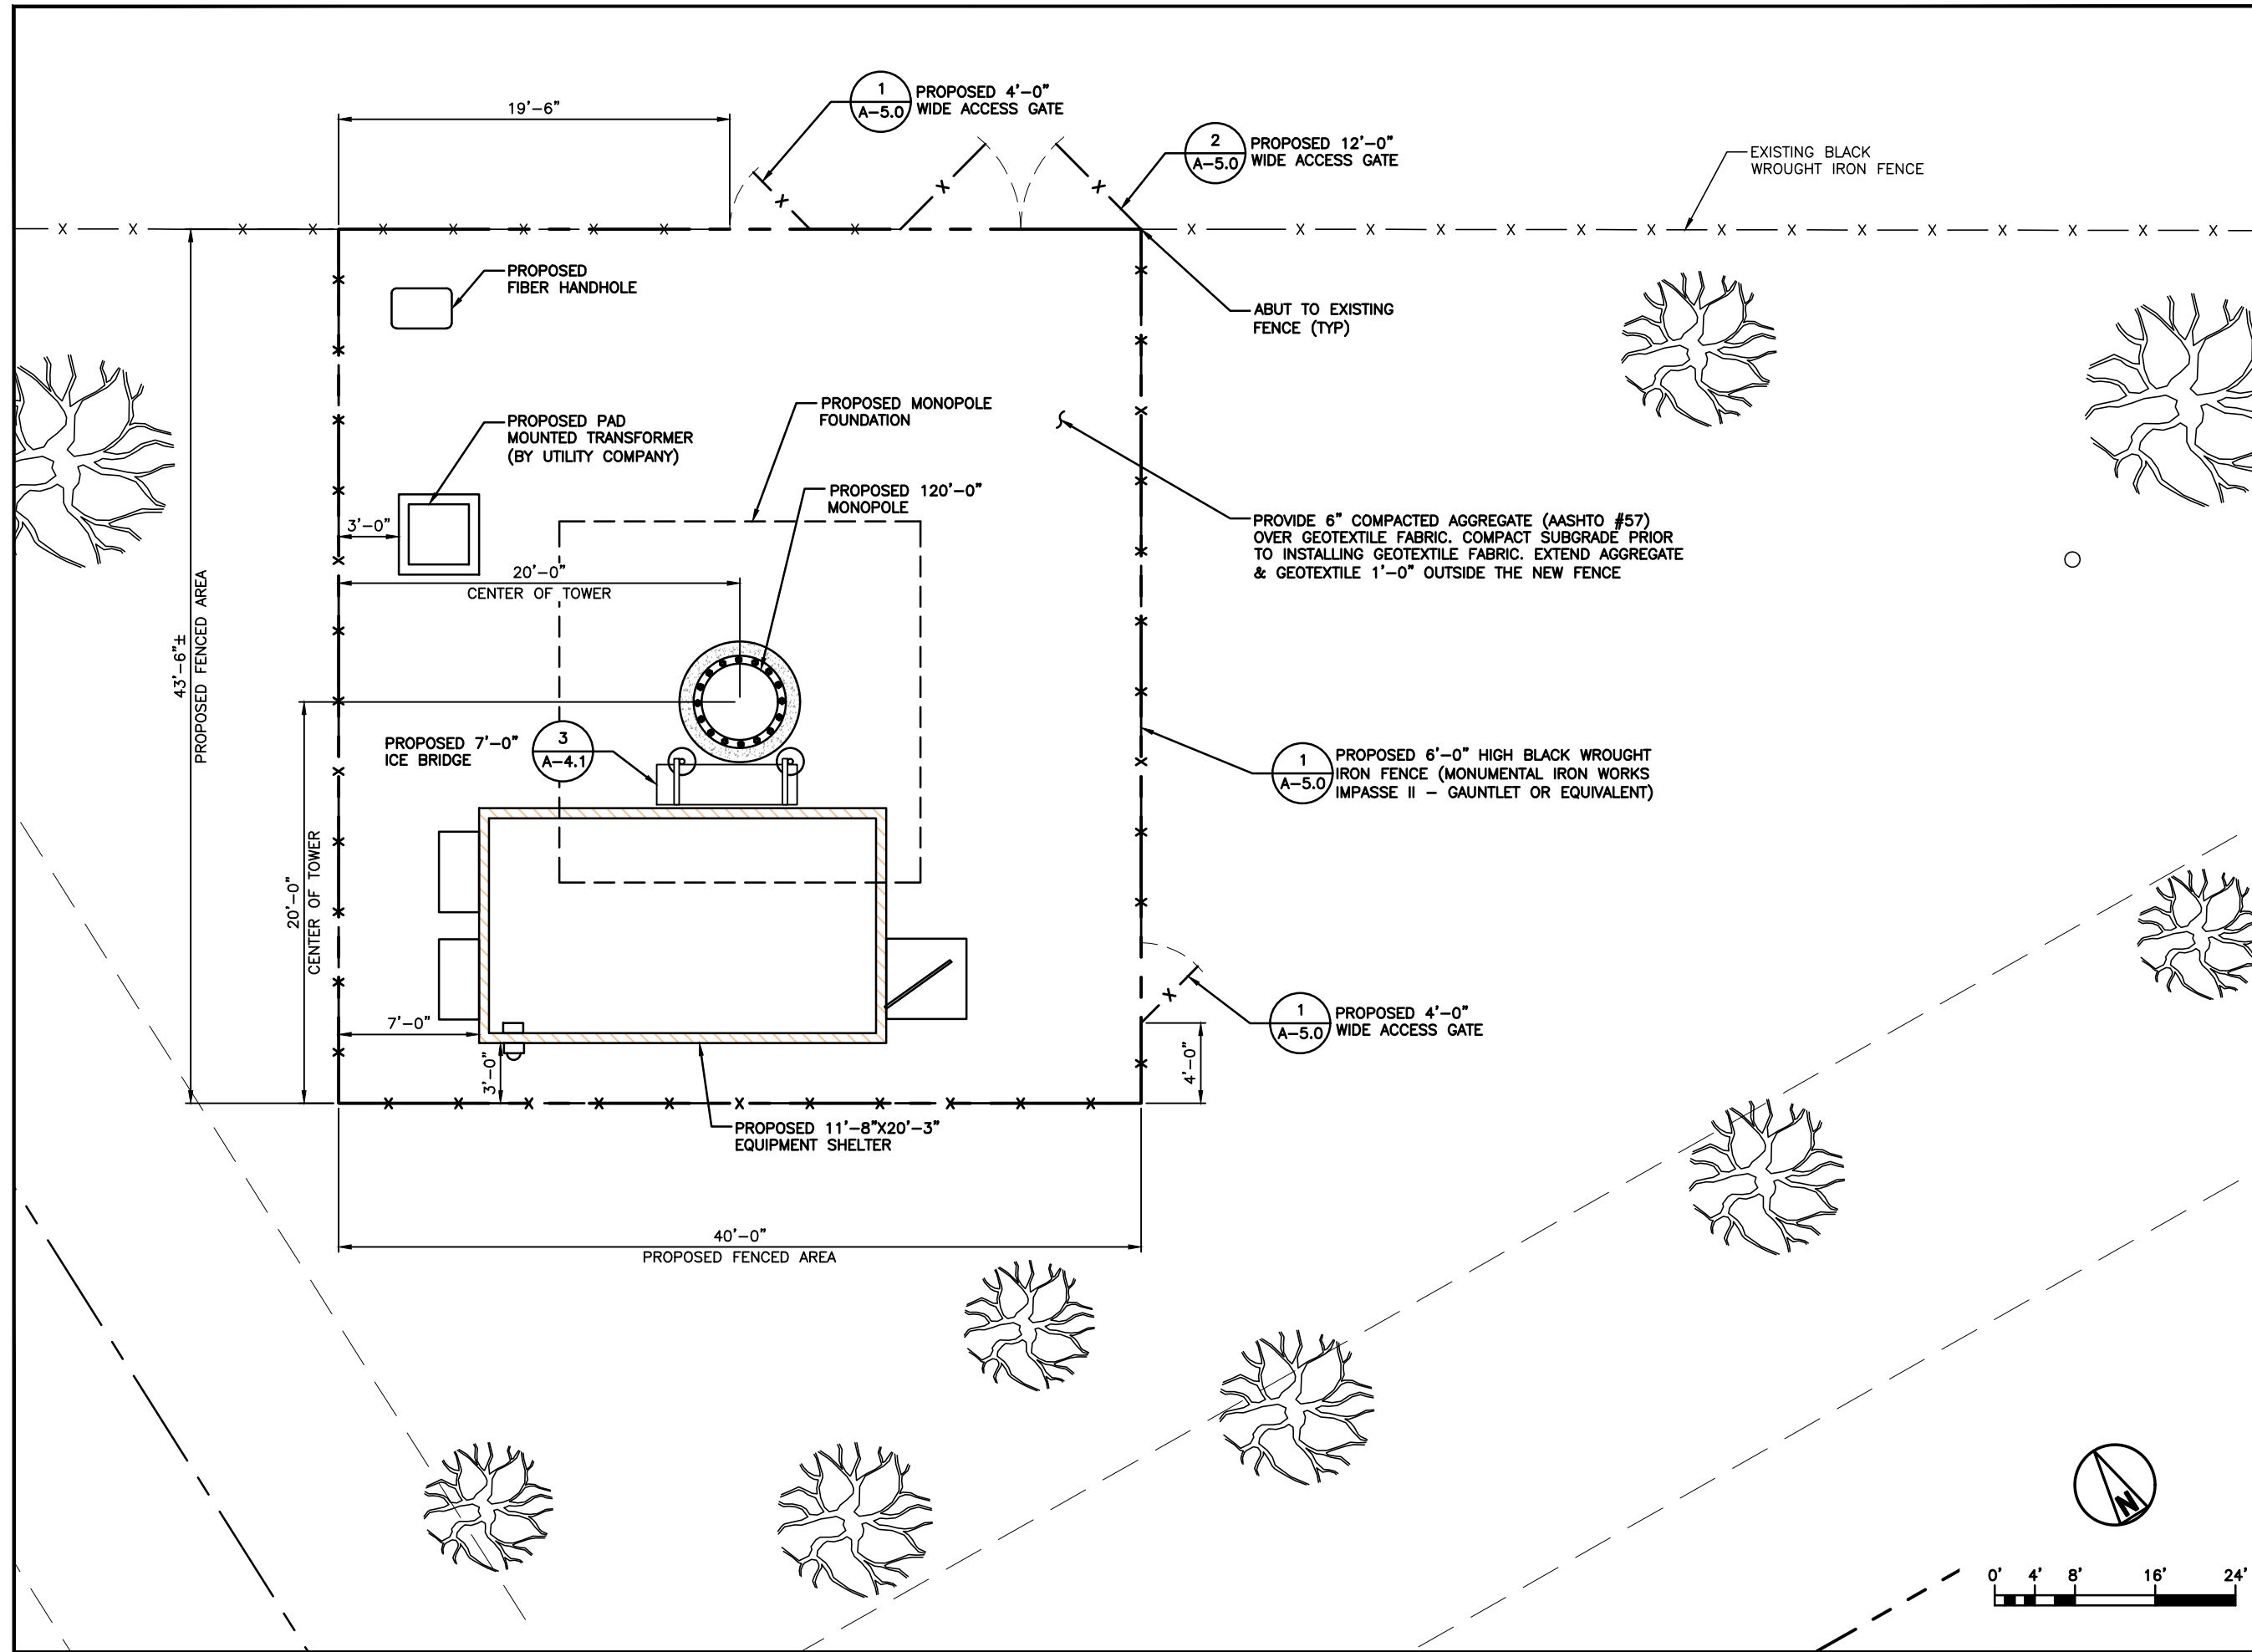

STAMP:

**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 C.C. CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C.C.  
 R.E.J. ROBERT E. JENSEN PE-028974 CIVIL  
 P.M.S. PHILIP M. SWOBODA PE-2024040585 CIVIL  
 S.D.K. SHELTON D. KEISLING PE-27323 ELECTRICAL E  
 D.J.W. DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
 T.M.S. TERRANCE M. SUPER PE-18521 ELECTRICAL E

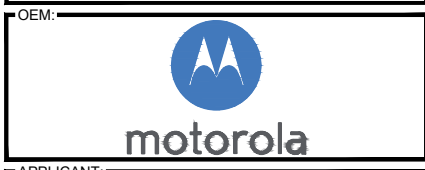

DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.


SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT

SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: ENLARGED SITE PLAN  
 SHEET #: A-1.1



1/8" = 1'-0" (22"x34")  
 1/16" = 1'-0" (11"x17")

ENLARGED SITE PLAN


ALL STRUCTURE INFORMATION SHOWN IS FOR ILLUSTRATION PURPOSES ONLY, AND MAY DIFFER FROM THE FINAL DESIGN PROVIDED BY THE STRUCTURE MANUFACTURER. THE CONTRACTOR SHALL CONSTRUCT THE STRUCTURE, FOUNDATION, AND ALL OTHER RELATED COMPONENTS IN ACCORDANCE WITH THE STRUCTURE MANUFACTURER'S DRAWINGS AND SPECIFICATIONS.

- OVERALL STRUCTURE HEIGHT  
ELEV. @ 120'-0" AGL  
TOP OF TOWER  
● 120'-0" AGL
- ☉ OF PROPOSED MW DISH ANTENNA  
ELEV. = 115'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 110'-0" AGL

- ☉ OF PROPOSED MW DISH ANTENNA  
ELEV. = 95'-0" AGL
- ☉ OF PROPOSED MW DISH ANTENNA  
ELEV. = 90'-0" AGL

- PROPOSED OMNI ANTENNA  
ELEV. = 65'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 60'-0" AGL

- PROPOSED OMNI ANTENNA  
ELEV. = 37'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 34'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 31'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 28'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 25'-0" AGL
- PROPOSED OMNI ANTENNA  
ELEV. = 22'-0" AGL

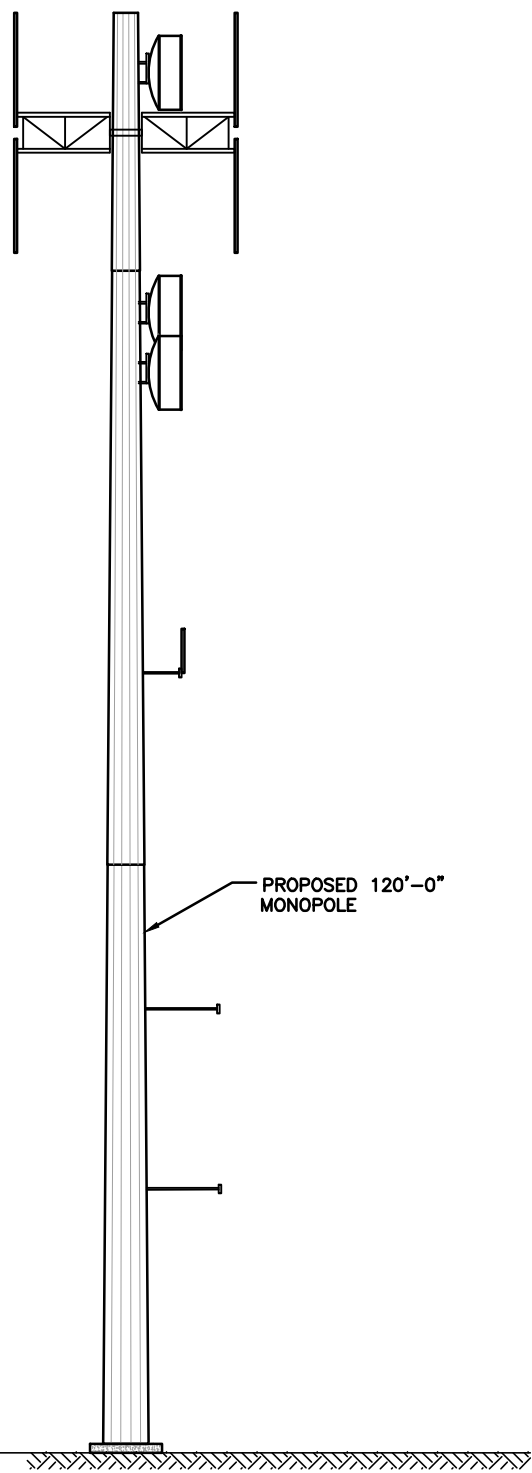

ANTENNA LOADING KEY								
ANTENNA MODEL #	QTY.	ANTENNA BASE ELEVATION	LINE SIZE	AZIMUTH	EQUIPMENT	ANTENNA SIZE	ANTENNA MOUNT	PROPOSED OR FUTURE LOADING
CC807-8	4	110'-0"	(4) 7/8"	N/A	TTA	9'-6"	6' STAND-OFF	PROPOSED
DS1X00CS36UN	1	66'-11"	7/8"	N/A	TTA	3'-8"	3' STAND-OFF	PROPOSED
Y1505	1	60'-0"	1/2"	N/A		6'-0"	6' STAND-OFF	PROPOSED
Y8066	1	37'-0"	1/2"	N/A		2'-3"	3' STAND-OFF	PROPOSED
Y8066	1	34'-0"	1/2"	N/A		2'-3"	N/A	PROPOSED
Y8066	1	31'-0"	1/2"	N/A		2'-3"	N/A	PROPOSED
Y8066	1	28'-0"	1/2"	N/A		2'-3"	N/A	PROPOSED
Y8066	1	25'-0"	1/2"	N/A		2'-3"	N/A	PROPOSED
Y8066	1	22'-0"	1/2"	N/A		2'-3"	3' STAND-OFF	PROPOSED

MICROWAVE LOADING KEY								
MICROWAVE MODEL #	QTY.	MICROWAVE ELEVATION	LINE SIZE	AZIMUTH	EQUIPMENT	DISH SIZE	DISH MOUNT	PROPOSED OR FUTURE LOADING
VHLP6-6W-4GR/A	1	115'-0"	EW63	N/A	HYBRID FIBER	6'-0"	PIPE MOUNT	PROPOSED
VHLP6-6W-6WH	1	95'-0"	(2) EW63	N/A	HYBRID FIBER	6'-0"	PIPE MOUNT	PROPOSED
VHLP6-6W-4GR/A	1	90'-0"	EW63	N/A	HYBRID FIBER	6'-0"	PIPE MOUNT	PROPOSED

**ANTENNA NOTES:**

- ANTENNA CONTRACTOR SHALL INSURE ALL ANTENNA MOUNTING PIPES ARE PLUMB.
- MULTI PORT ANTENNAS: TERMINATE UNUSED ANTENNA PORTS WITH CONNECTOR CAP & WEATHERPROOF THOROUGHLY.
- CONTRACTOR MUST FOLLOW ALL MANUFACTURER'S RECOMMENDATIONS REGARDING THE INSTALLATION OF COAXIAL CABLES, CONNECTORS, AND ANTENNAS.
- WEATHERPROOF ALL ANTENNA CONNECTORS WITH SELF AMALGAMATING TAPE.
- ANTENNA CONTRACTOR SHALL PERFORM A "TAPE DROP" MEASUREMENT TO CONFIRM/VALIDATE ANTENNA CENTER LINE (ACL) HEIGHT. CONTRACTOR SHALL SUBMIT A COMPLETED HEIGHT VERIFICATION FORM TO THE CONSTRUCTION MANAGER.
- ALL AZIMUTHS ARE ORIENTED CLOCKWISE FROM TRUE NORTH.

STAMP:

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE#:  
DISCIPLINE:  
C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
REJ ROBERT E. JENSEN PE-208974 CIVIL C  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E

OEM:

APPLICANT:

PLANS PREPARED FOR:

PLANS PREPARED BY:

DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.



SUBMITTALS:				
DESCRIPTION	DATE	BY	REV	
ISSUED FOR REVIEW	10/14/25	DSL	A	
REISSUED FOR REVIEW	10/23/25	DSL	B	
REISSUED FOR REVIEW	11/13/25	DSL	C	

APPLICANT SITE NAME:  
  
LEES SUMMIT



SITE ADDRESS:  
  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION:	SHEET #:
TOWER ELEVATION	A-2.0

**GENERAL NOTES:**  
 1. EXPOSED AGGREGATE PAINTED CONCRETE PANELS  
 2. FINAL CONDUIT LOCATIONS TO BE DETERMINED

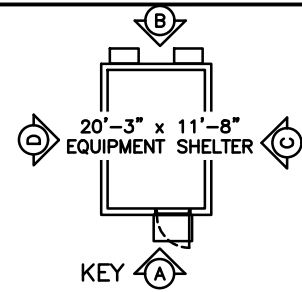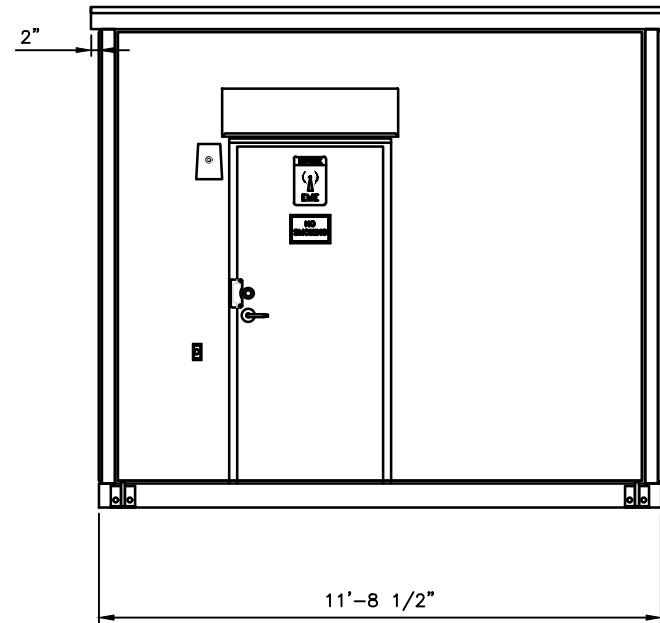

**GENERAL NOTES:**  
 1. EXPOSED AGGREGATE PAINTED CONCRETE PANELS  
 2. FINAL CONDUIT LOCATIONS TO BE DETERMINED

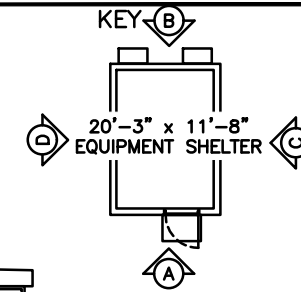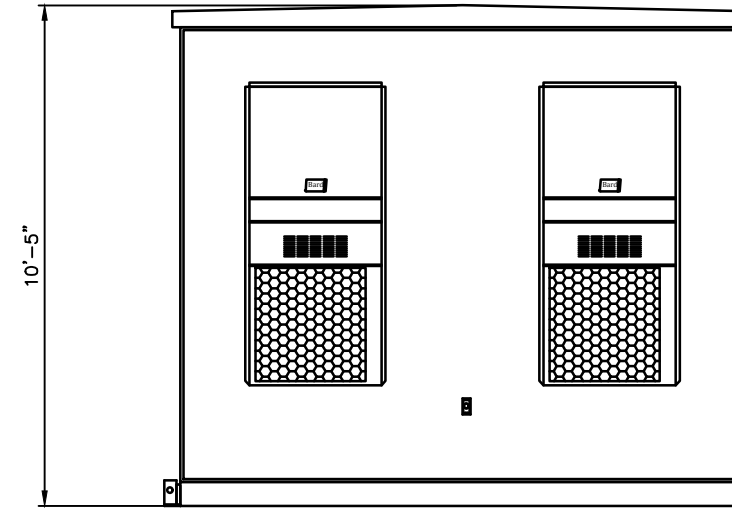



SHELTER ELEVATION "A"

3



SHELTER ELEVATION "B"

1

**GENERAL NOTES:**  
 1. EXPOSED AGGREGATE PAINTED CONCRETE PANELS  
 2. FINAL CONDUIT LOCATIONS TO BE DETERMINED

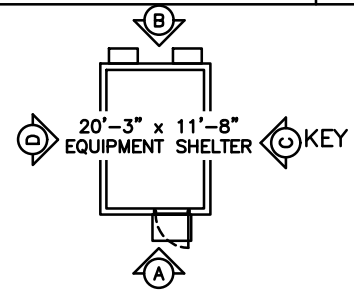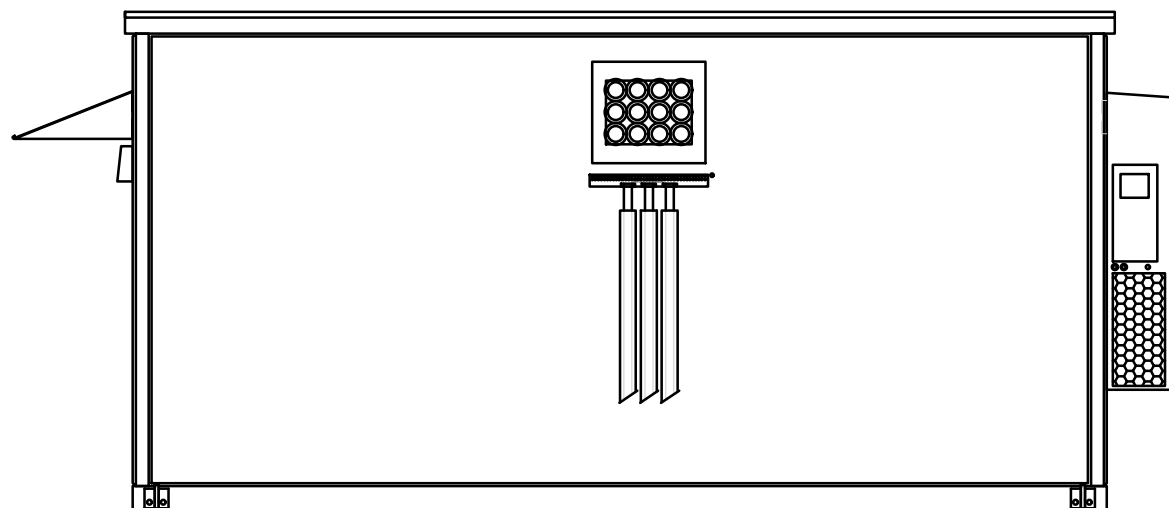

**GENERAL NOTES:**  
 1. EXPOSED AGGREGATE PAINTED CONCRETE PANELS  
 2. FINAL CONDUIT LOCATIONS TO BE DETERMINED

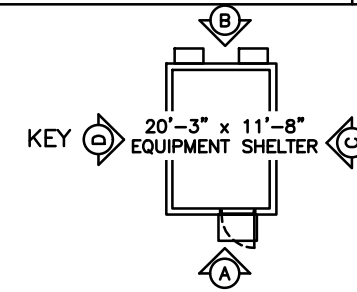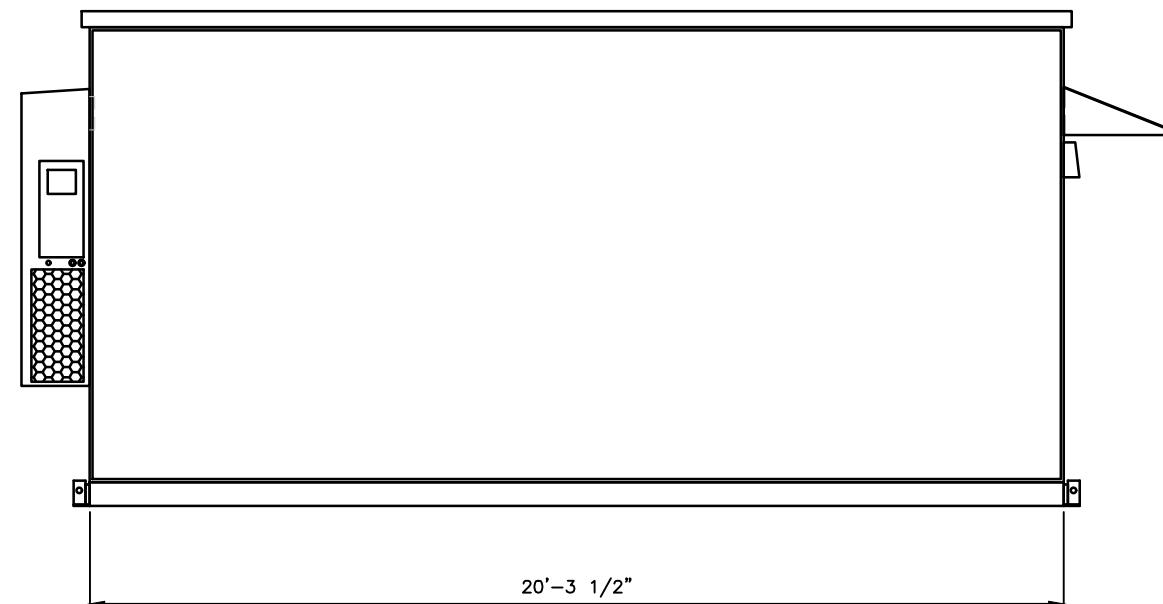


SHELTER ELEVATION "C"

4

SHELTER ELEVATION "D"

2

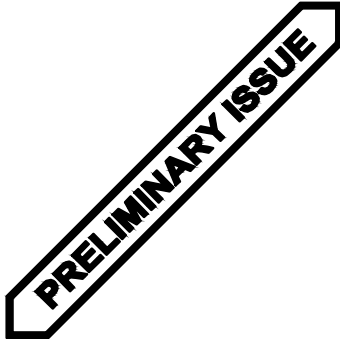STAMP:  


ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
 REJ ROBERT E. JENSEN PE-028974 CIVIL C  
 PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
 SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
 DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
 TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E



DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.


SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT

SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063


SHEET DESCRIPTION: SHELTER ELEVATIONS  
 SHEET #: A-3.0

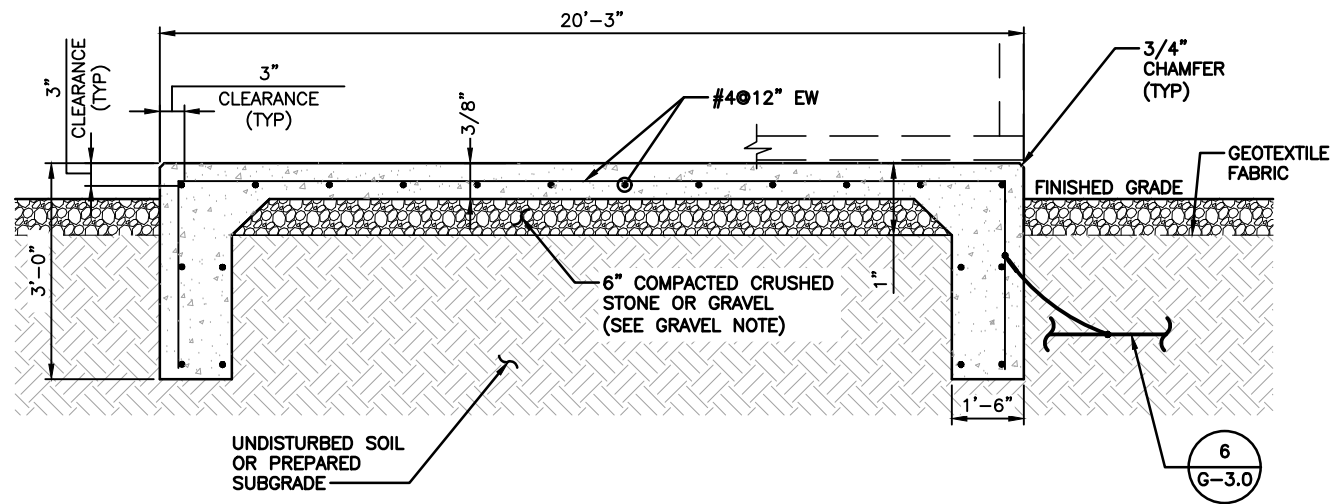

**GRAVEL NOTE:**  
 1. GRAVEL SHALL BE NATURAL OR CRUSHED STONE WITH 100 PERCENT PASSING 1 INCH SIEVE.

**FOUNDATION NOTE:**

MINIMUM SOIL BEARING CAPACITY OF 2000 PSF IS ASSUMED IN ALL FOUNDATIONS AND SLAB AREAS. (GENERAL CONTRACTOR SHALL VERIFY PRIOR TO CONSTRUCTION)

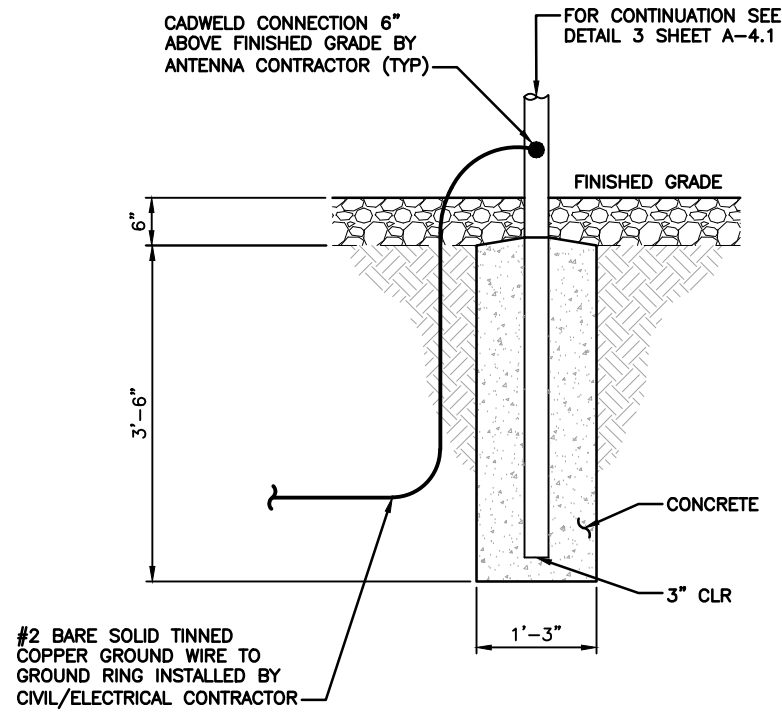

FURNISHED AND INSTALLED BY ANTENNA CONTRACTOR

SHELTER PAD DETAIL

3

SUPPORT POST (CONCRETE PIER)


1

DETAIL NOT USED

4

DETAIL NOT USED

2

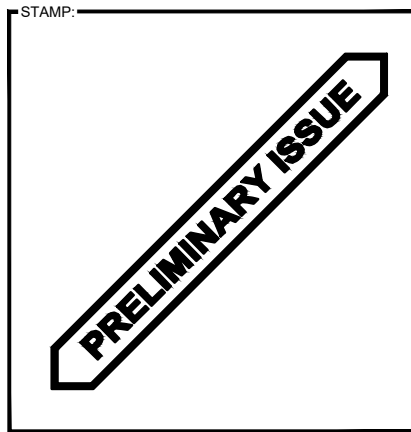

ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
 REJ ROBERT E. JENSEN PE-028974 CIVIL C  
 PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
 SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
 DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
 TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E




**DRAWING NOTICE:**  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT


SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: CONSTRUCTION DETAILS (1 OF 2)  
 SHEET #: A-4.0

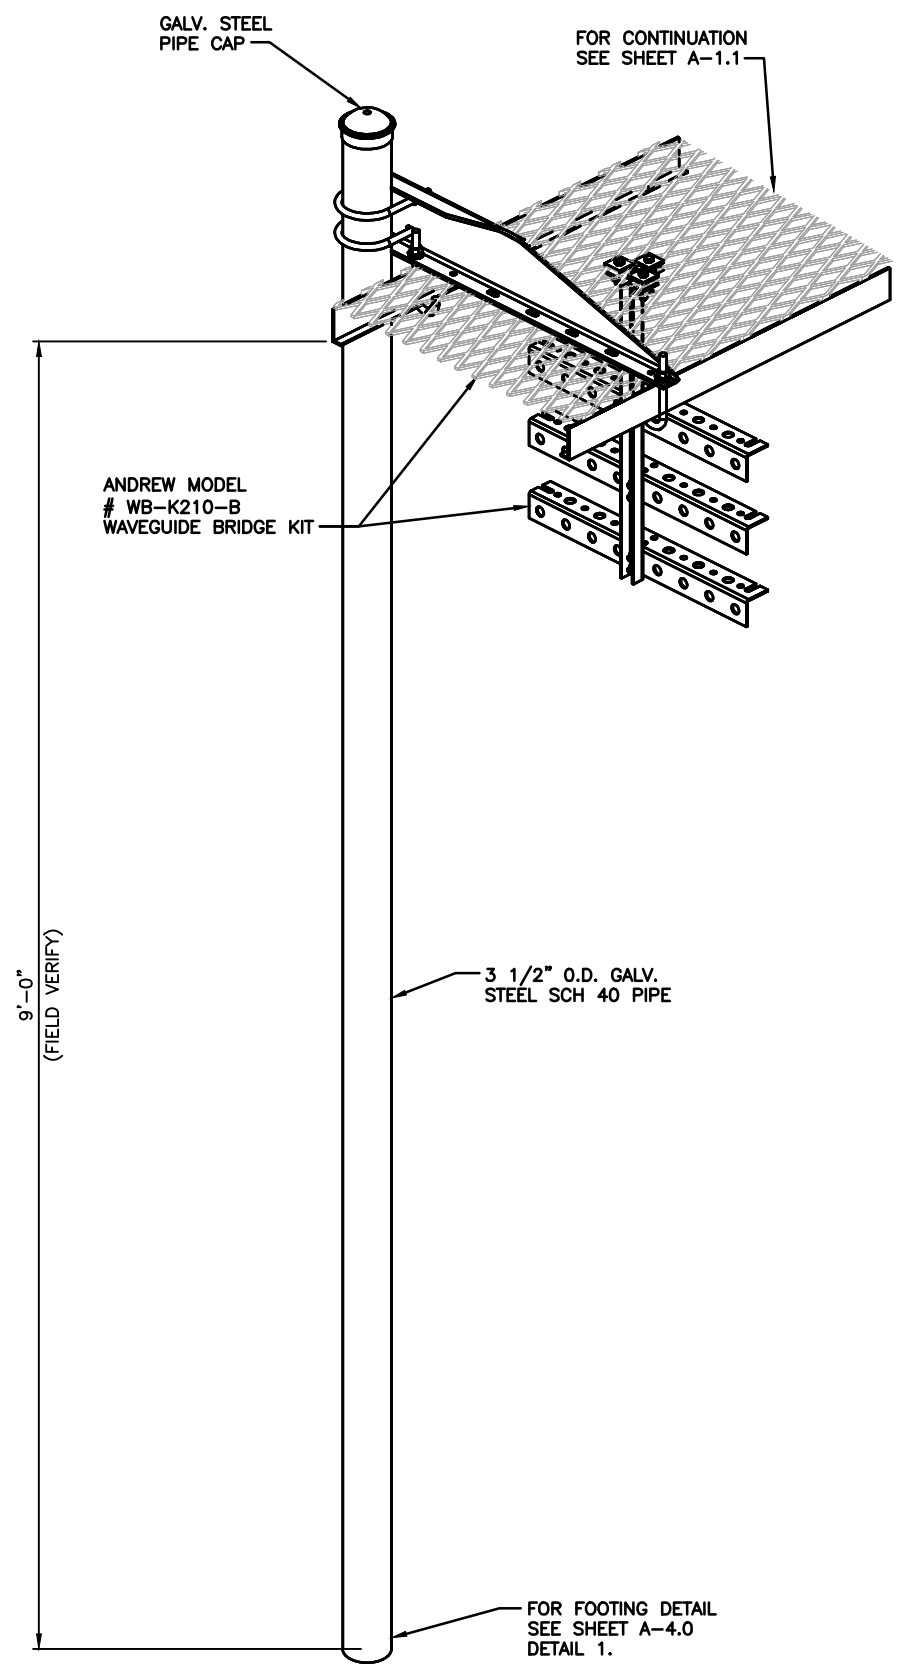

ICE BRIDGE SUPPORT POST DETAIL


3

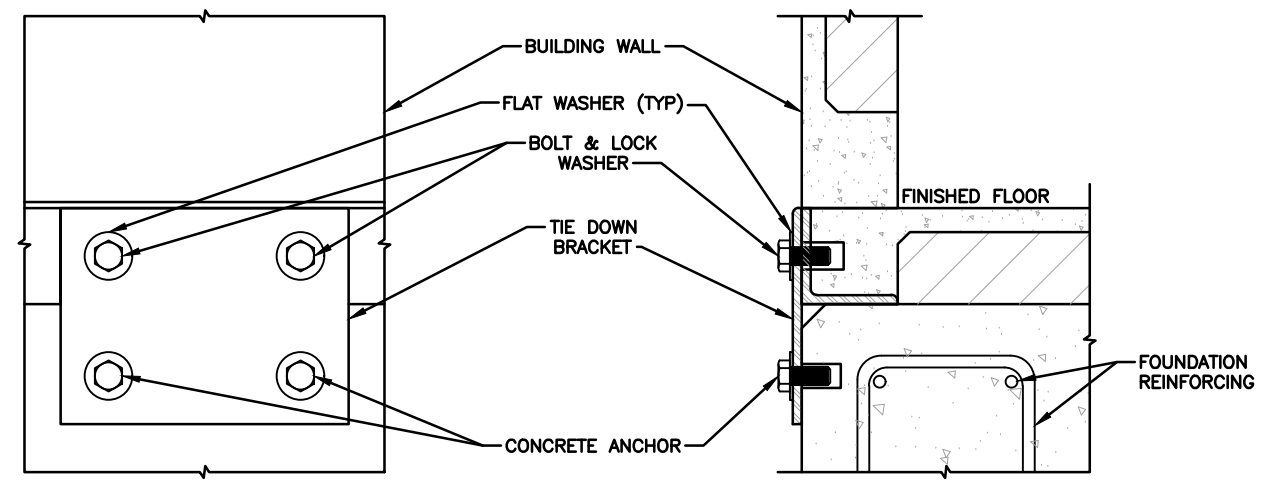

- TIE DOWN BRACKET NOTES:**
1. FURNISHED BY SHELTER MANUFACTURER INSTALLED BY CONTRACTOR.
  2. VERIFY BRACKET AND HARDWARE SIZES WITH MANUFACTURER.

SHELTER TIE DOWN DETAIL

1

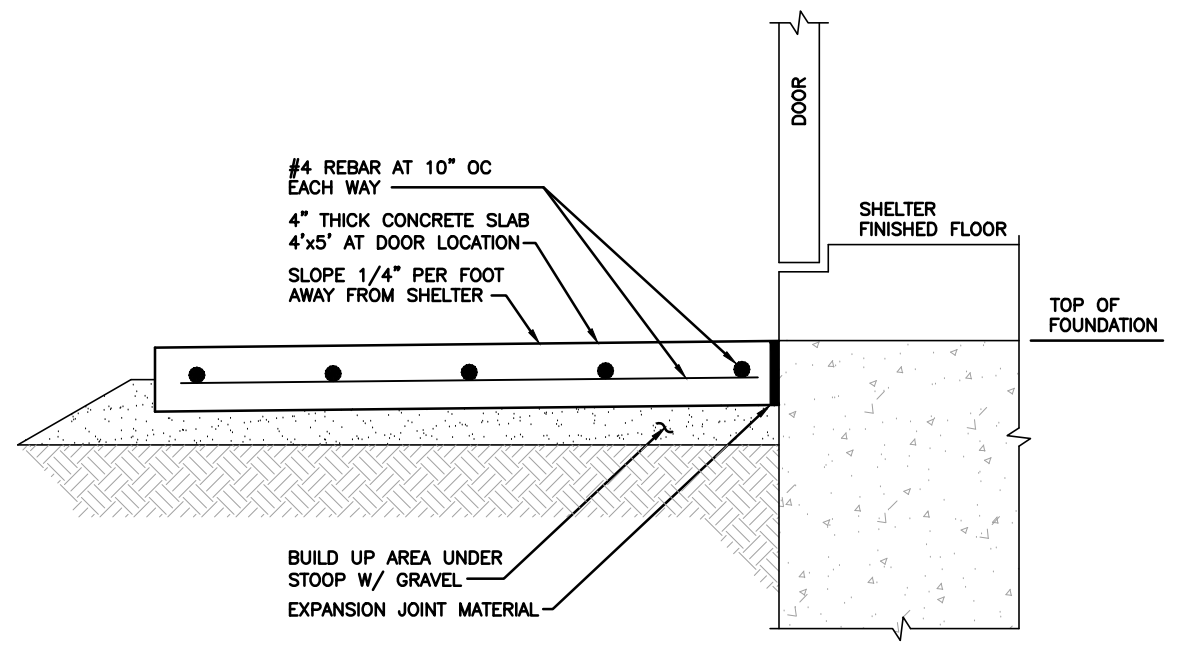

STOOP DETAIL

2

STAMP:

**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE#:  
 DISCIPLINE:  
 CC CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL  
 REJ ROBERT E. JENSEN PE-028974 CIVIL  
 PMS PHILIP M. SWOBODA PE-2024040585 CIVIL  
 SDK SHELTON D. KEISLING PE-27323 ELECTRICAL  
 DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL  
 TMS TERRANCE M. SUPER PE-18521 ELECTRICAL

OEM:

APPLICANT:

PLANS PREPARED FOR:

PLANS PREPARED BY:

DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:


DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT

SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION:  
 CONSTRUCTION DETAILS (2 OF 2)

SHEET #:  
 A-4.1

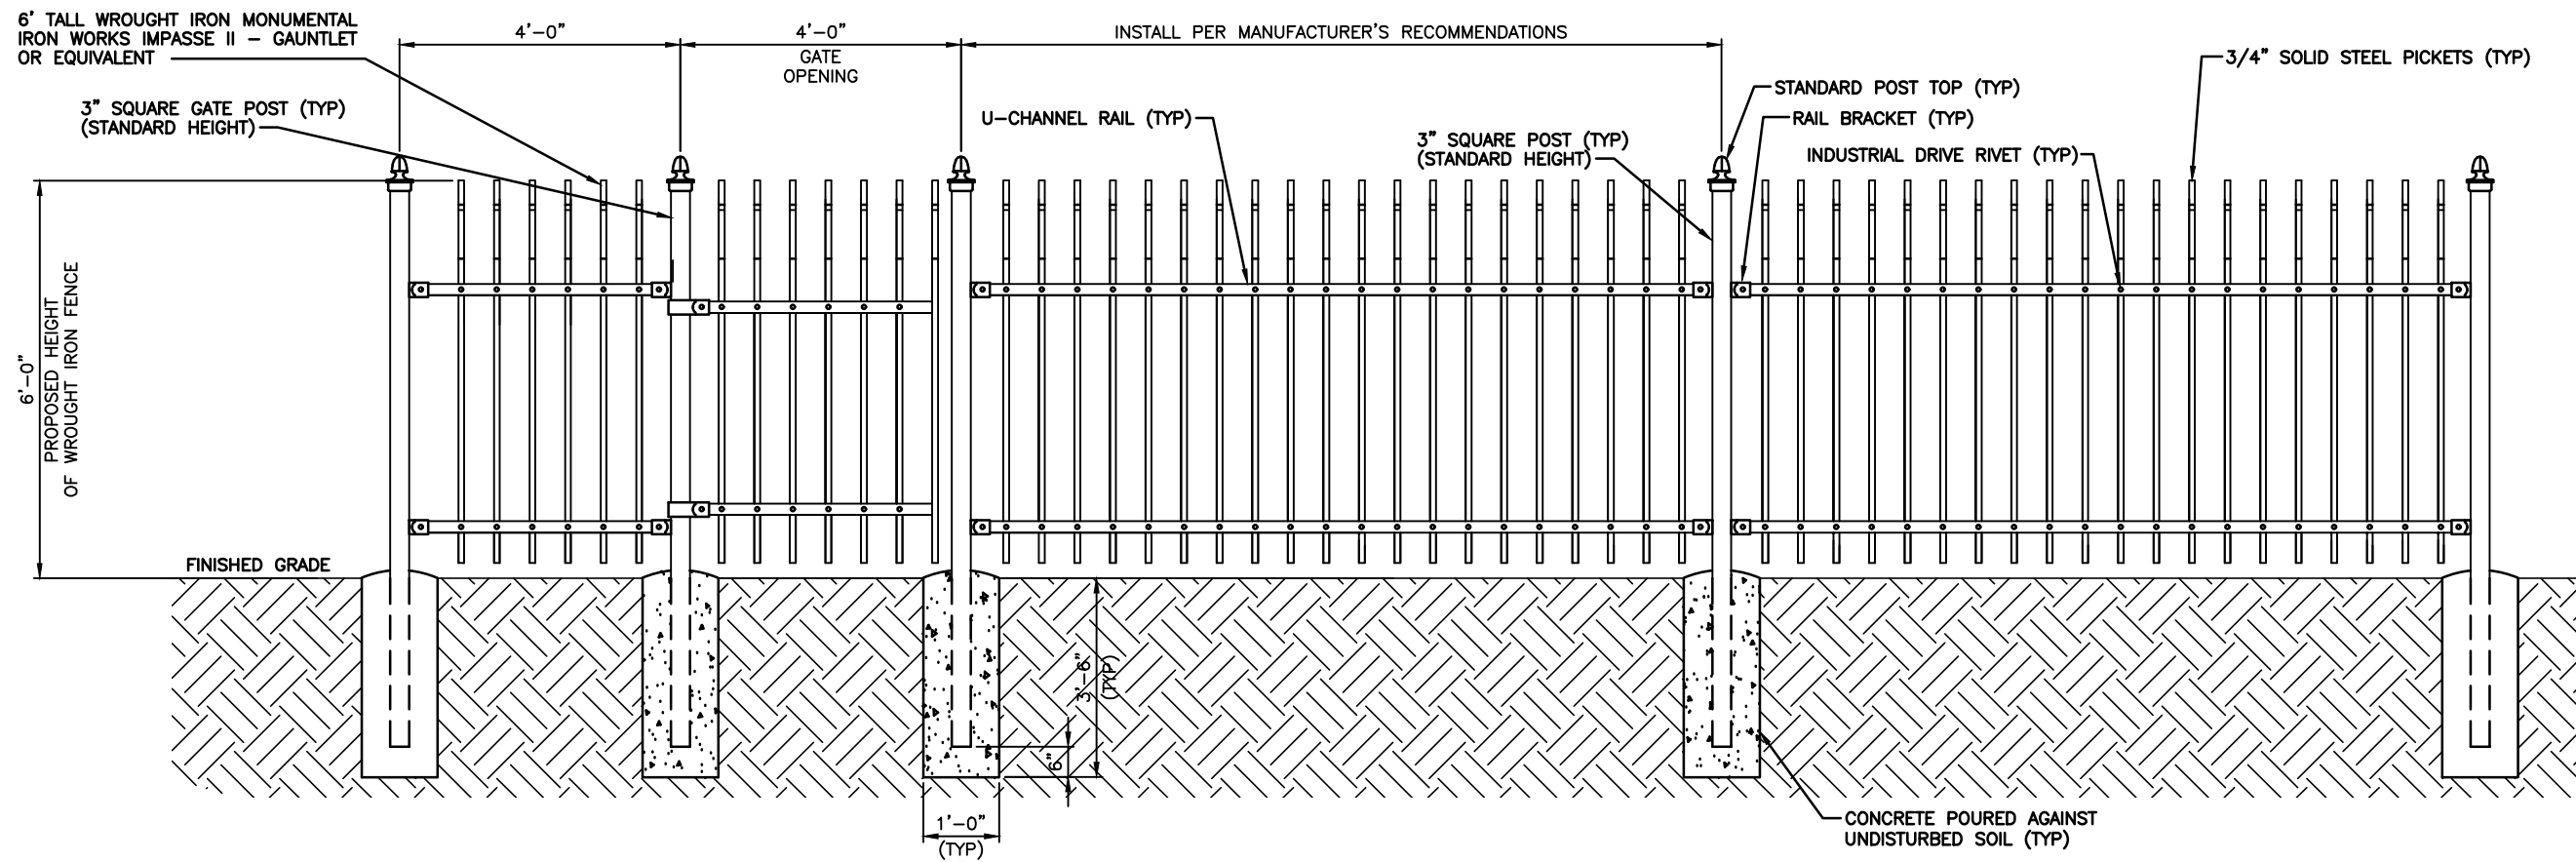


FENCE, GATE, AND COMPOUND CROSS SECTION

1




FENCE PICKET DETAIL

3

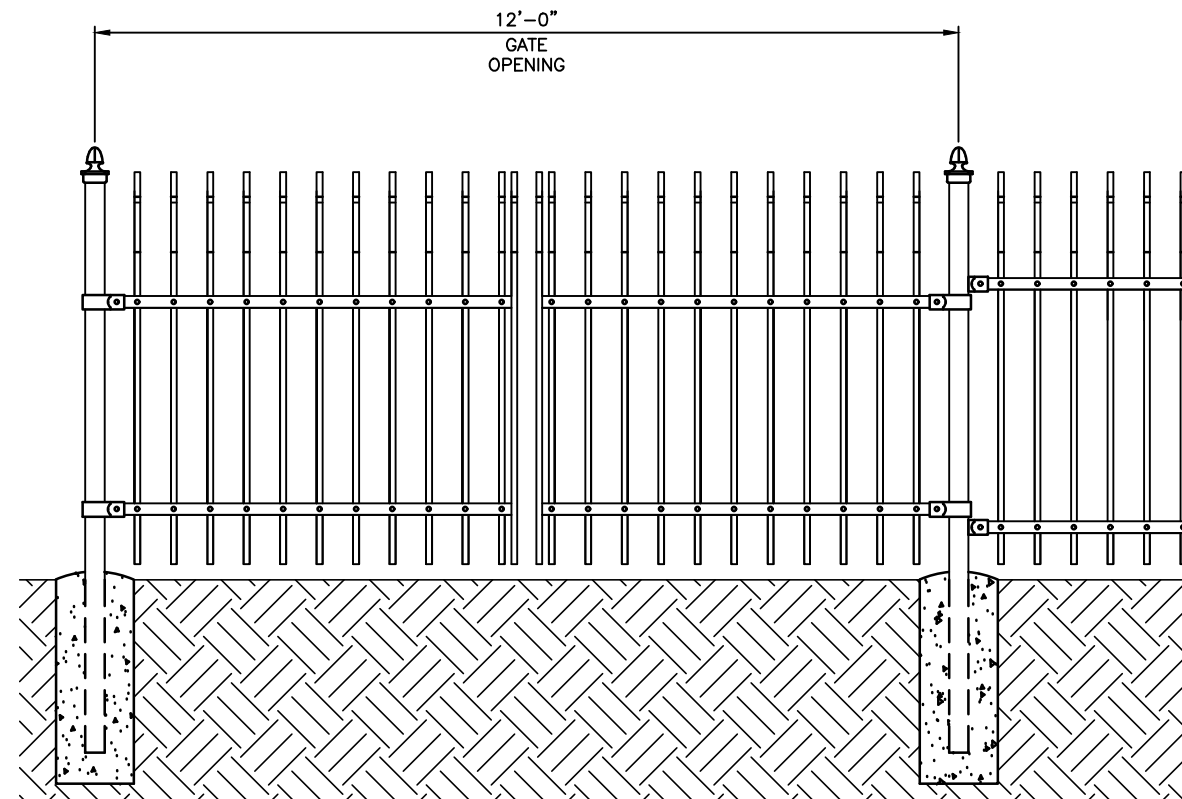

DOUBLE GATE DETAIL

2

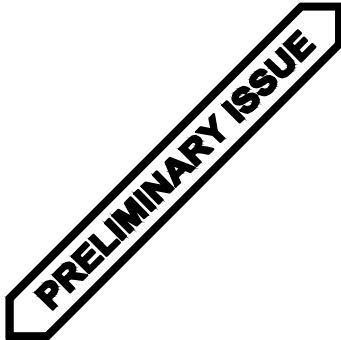STAMP:  
  
**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 CC CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL  
 REJ ROBERT E. JENSEN PE-028974 CIVIL  
 PMS PHILIP M. SWOBODA PE-2024040585 CIVIL  
 SDK SHELTON D. KEISLING PE-27323 ELECTRICAL  
 DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL  
 TMS TERRANCE M. SUPER PE-18521 ELECTRICAL



DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.


SUBMITTALS:


DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT

SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: FENCE DETAILS  
 SHEET #: A-5.0

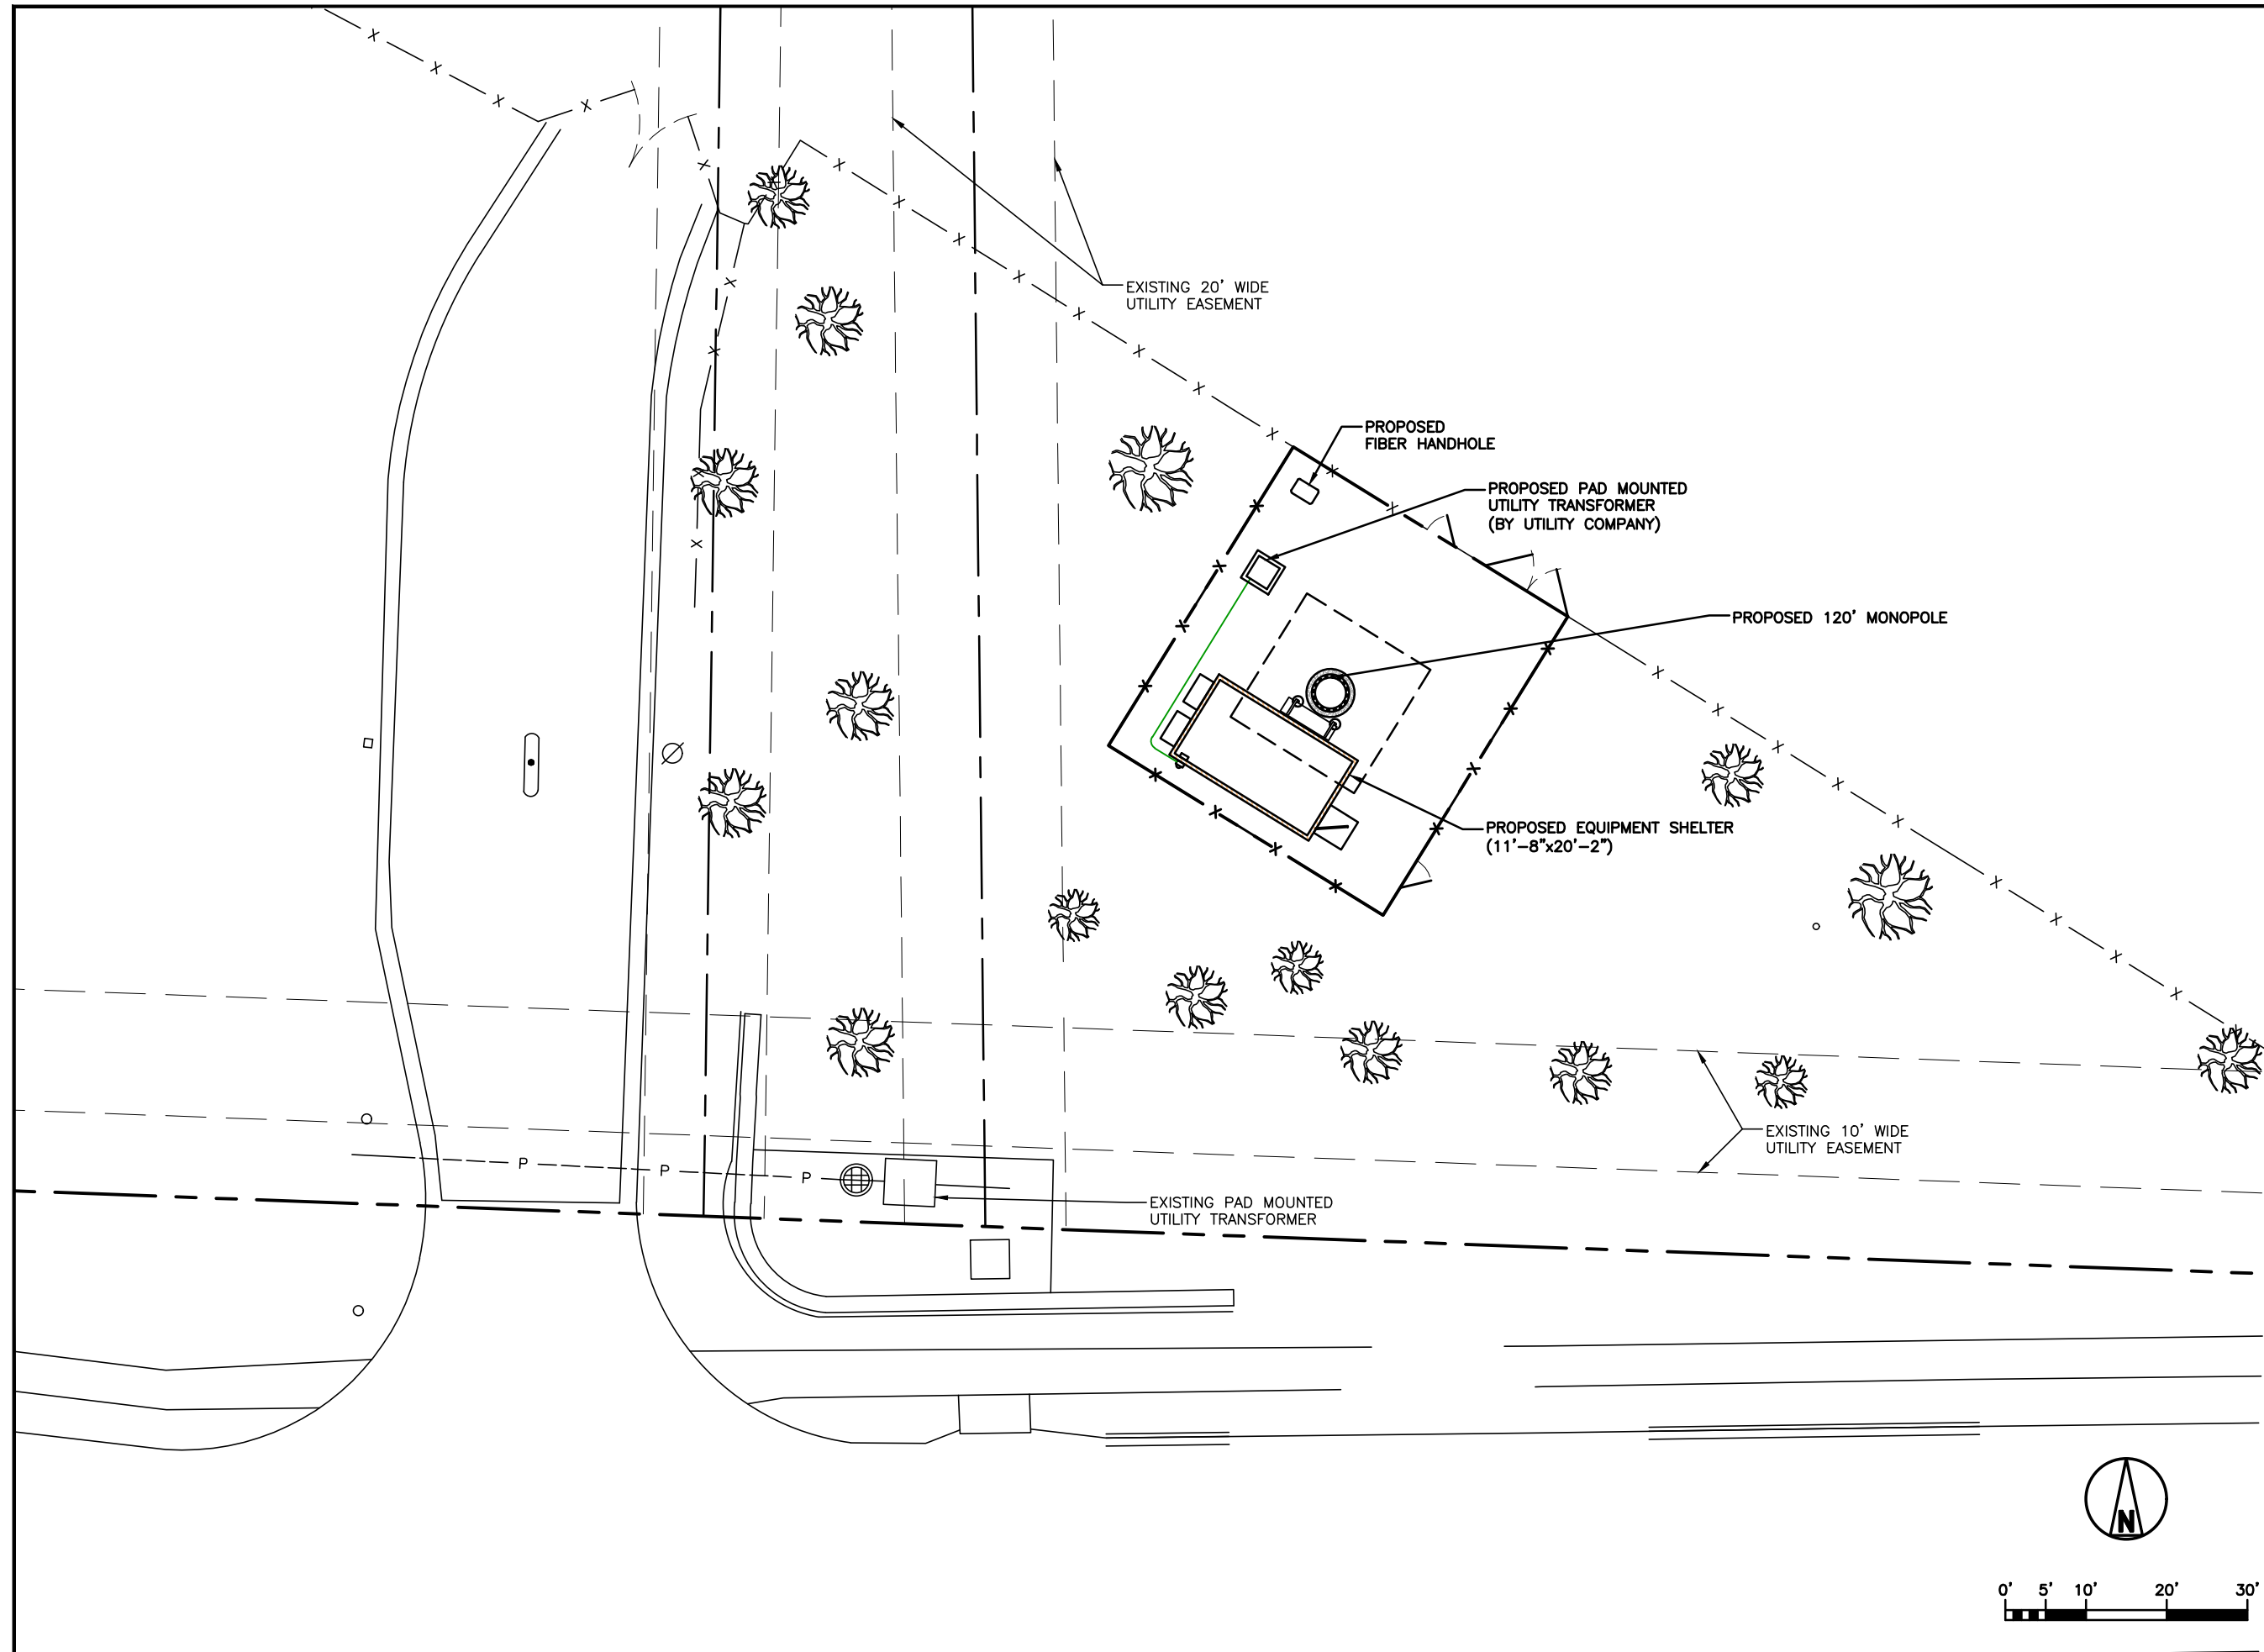

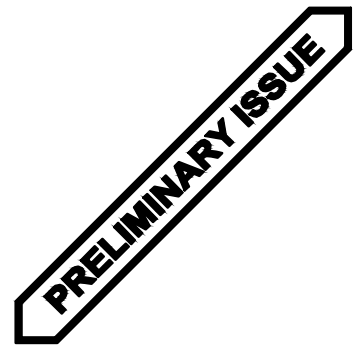STAMP:  


ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 CC CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL CC  
 REJ ROBERT E. JENSEN PE-208974 CIVIL CC  
 PMS PHILIP M. SWOBODA PE-2024040585 CIVIL CC  
 SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
 DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
 TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E



DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.


SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT


SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: OVERALL UTILITY PLAN  
 SHEET #: E-1.0

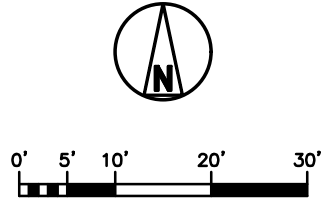


OVERALL UTILITY PLAN

SCALE: 1:10 (22"x34")  
 SCALE: 1:20 (11"x17")

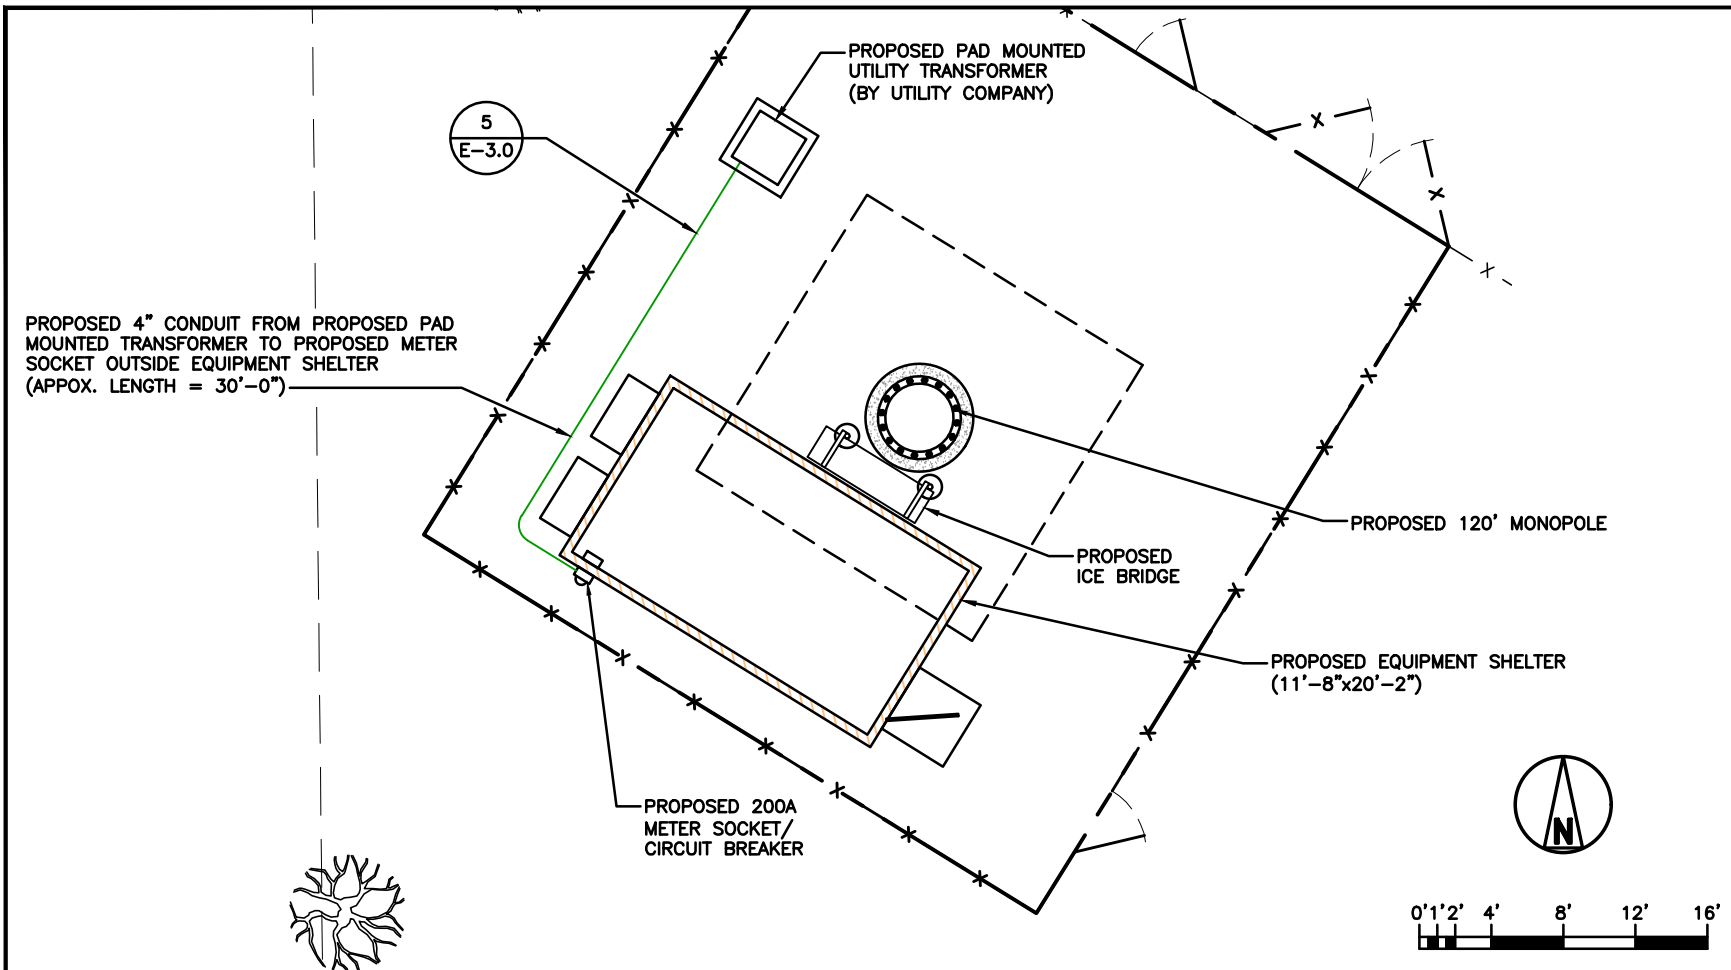

ENLARGED ELECTRICAL PLAN 4

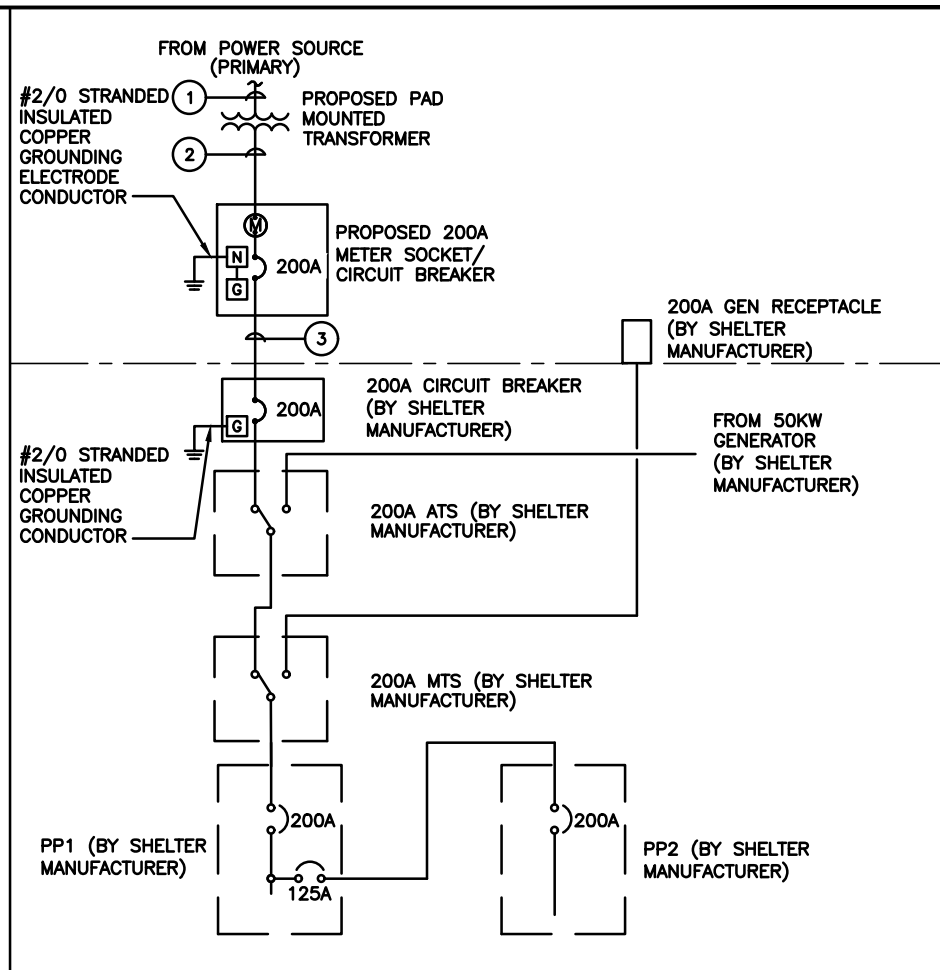

ONE-LINE DIAGRAM 1

NO.	FROM	TO	CONFIGURATION	FUNCTION
①	SOURCE	TRANSFORMER	(BY UTILITY COMPANY)	PRIMARY
②	TRANSFORMER	METER SOCKET	3#3/0, 1#6G, 2" C	SERVICE LATERAL
③	METER SOCKET	CIRCUIT BREAKER (IN SHELTER)	3#3/0, 1#6G, 2" C	NORMAL POWER FEEDER FROM METER SOCKET OUTSIDE SHELTER TO CIRCUIT BREAKER IN SHELTER

CIRCUIT SCHEDULE 2


- ALL ELECTRICAL WORK SHALL CONFORM TO REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE AS A MINIMUM STANDARD.
- ALL EXTERIOR ABOVE GROUND CONDUIT SHALL BE RIGID GALVANIZED STEEL (RGS) AND ALL INTERIOR ABOVE GROUND CONDUIT SHALL BE ELECTRICAL METALLIC TUBING (EMT) UNLESS OTHERWISE INDICATED.
- ALL UNDERGROUND CONDUIT SHALL BE SCH 40 PVC UNLESS OTHERWISE INDICATED OR AS REQUIRED BY LOCAL UTILITY COMPANY. ALL UNDERGROUND ELBOWS SHALL BE SWEEPING BENDS.

GENERAL NOTES 3

DETAIL NOT USED 5

STAMP:  
**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE# DISCIPLINE:  
CJ CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL CC  
REJ ROBERT E. JENSEN PE-0289174 CIVIL CC  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL CC  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E

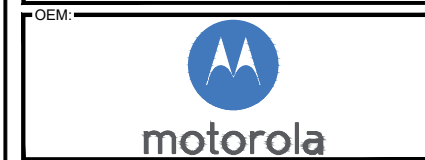


DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C


APPLICANT SITE NAME:  
LEES SUMMIT

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063


SHEET DESCRIPTION: ENLARGED UTILITY PLAN & DETAILS  
SHEET #: E-2.0

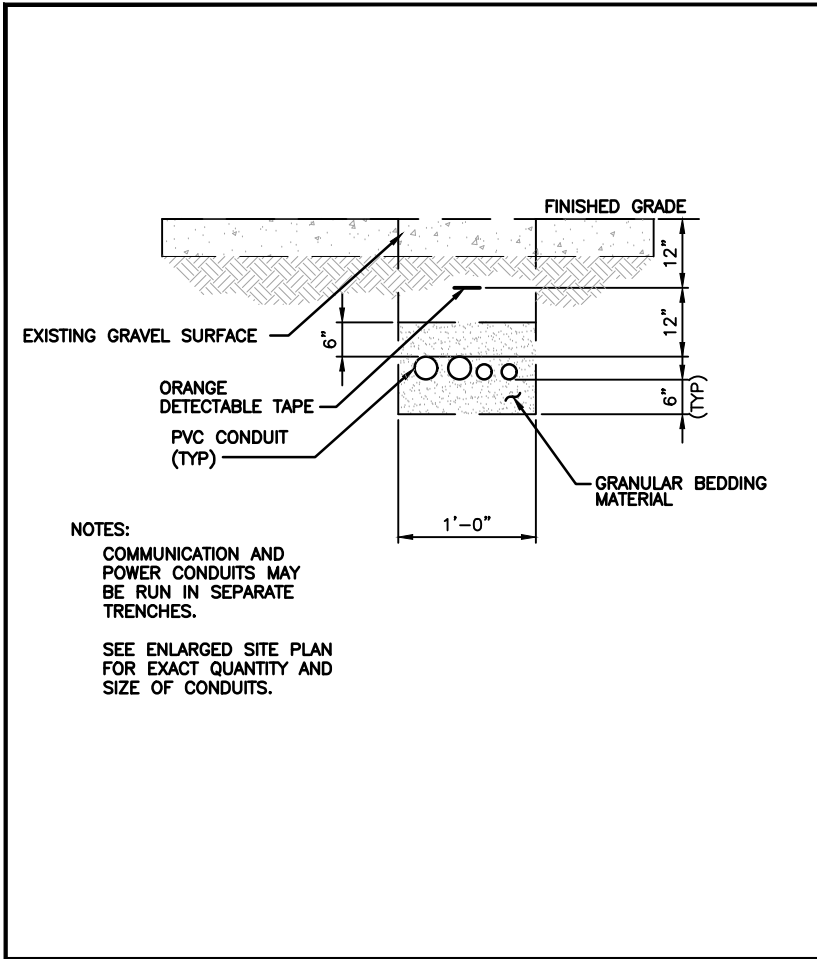

TRENCH DETAIL (SITE) 5

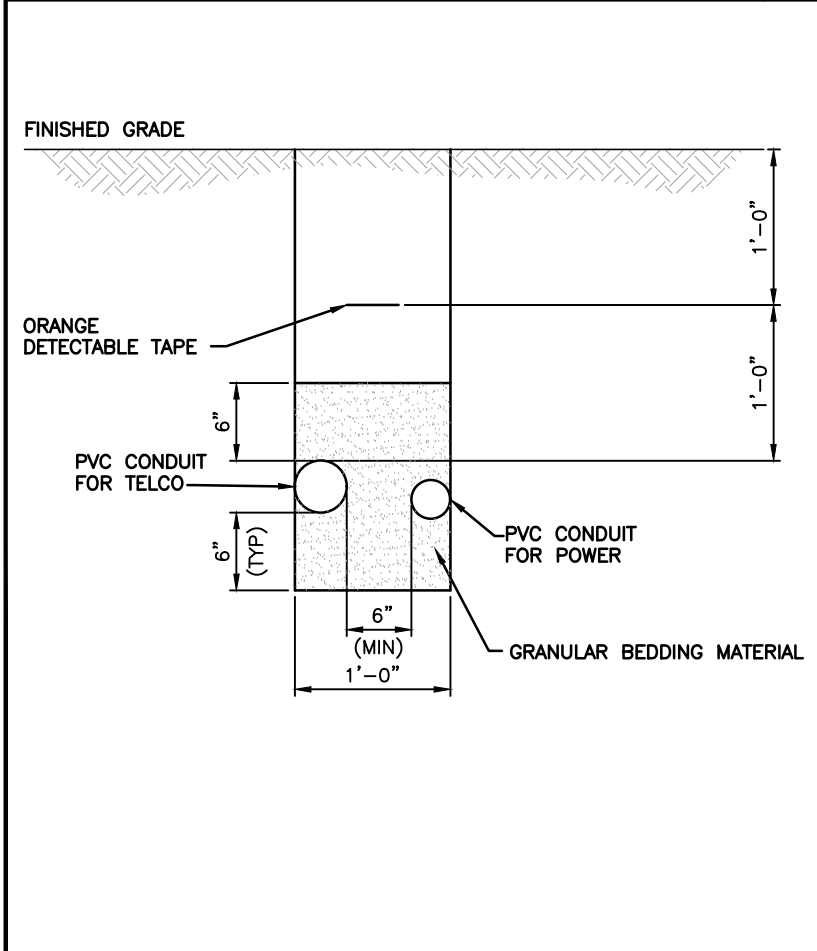


TRENCH DETAIL (INCOMING) 6

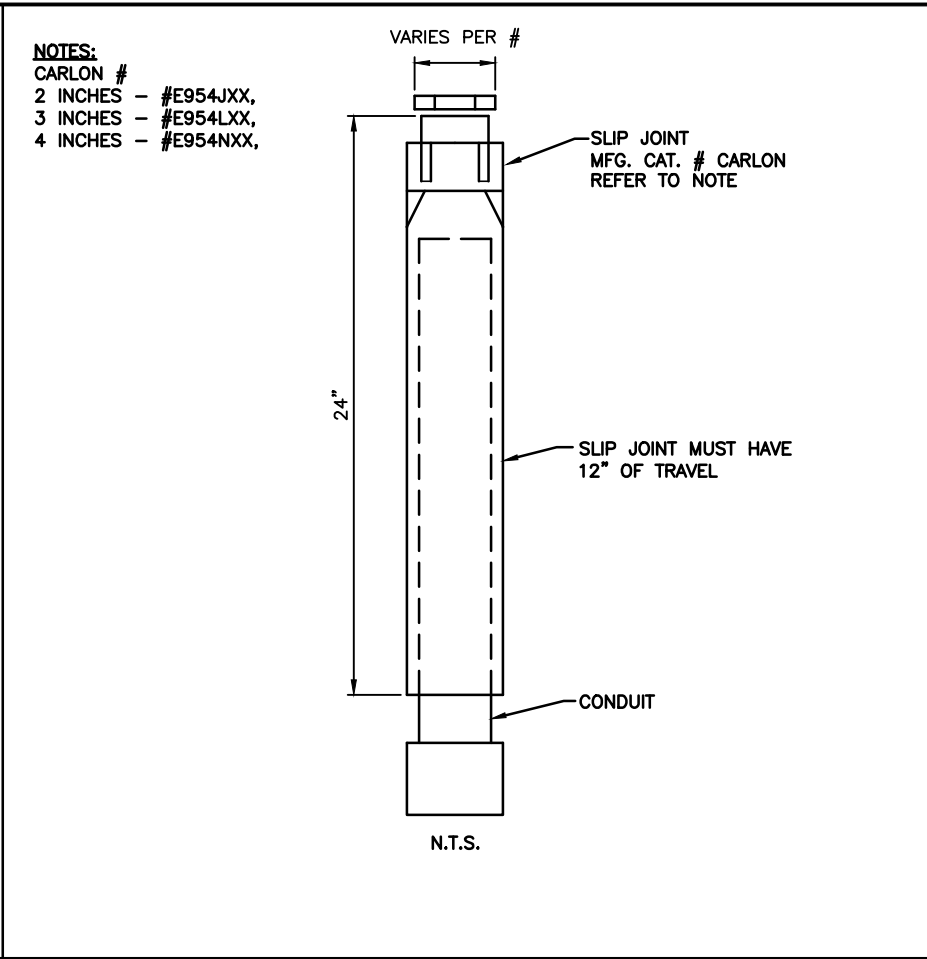

SLIP JOINT DETAIL 3


DETAIL NOT USED 4

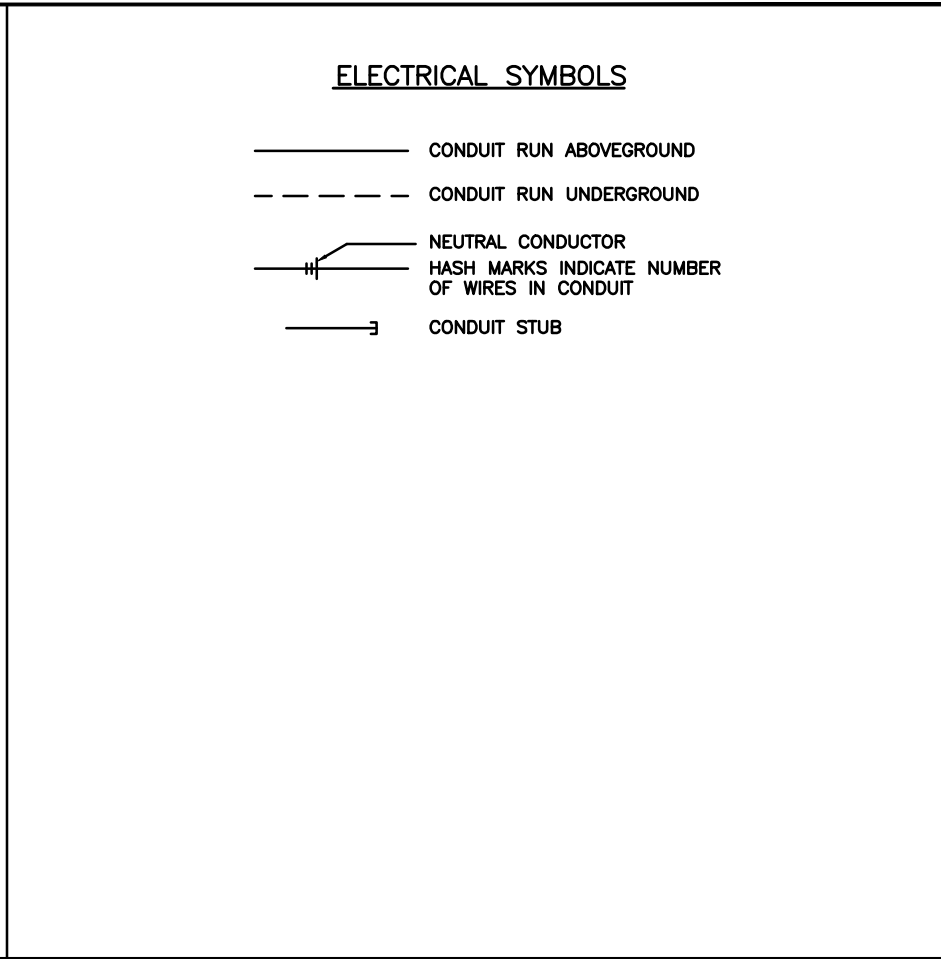

ELECTRICAL SYMBOLS 1

1. THE ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THE POWER CONNECTION POINT WITH THE UTILITY COMPANY PRIOR TO COMMENCING WORK.
2. THE ELECTRICAL CONTRACTOR SHALL NOTIFY HAYDEN TOWER'S CONSTRUCTION MANAGER AFTER CALLING FOR ELECTRICAL INSPECTION OF BELOW-GRADE CONDUITS AND OTHER ELECTRICAL WORK PRIOR TO COVERING.
3. THE ELECTRICAL CONTRACTOR SHALL NOTIFY THE SITE CONSTRUCTION MANAGER AFTER THE ELECTRICAL INSPECTION HAS BEEN PERFORMED AND ACCEPTED (GREEN TAGGED).
4. THE ELECTRICAL CONTRACTOR SHALL PAY FOR ALL ELECTRICAL UTILITY FEES PER NOTE #12 ON SHEET T01 OF THE CONSTRUCTION DOCUMENTS.
5. THE ELECTRICAL CONTRACTOR SHALL NOTIFY THE UTILITY COMPANY REQUESTING ENERGIZING OF THE SITE AND SHALL NOTIFY THE SITE CONSTRUCTION MANAGER WHEN THIS TASK HAS BEEN COMPLETED.
6. THE ELECTRICAL CONTRACTOR SHALL CONVEY THE POLE NUMBER, TRANSFORMER NUMBER, AND THE METER NUMBER TO THE SITE CONSTRUCTION MANAGER.

ELECTRICAL NOTES 2

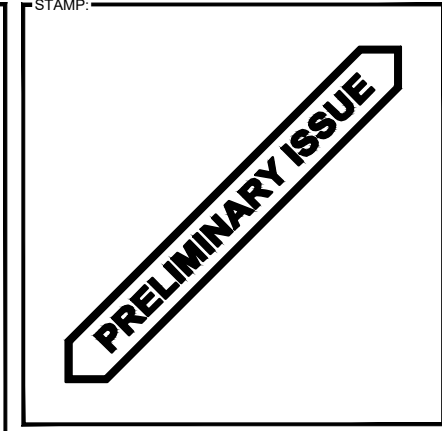

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE# DISCIPLINE:  
C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
REJ ROBERT E. JENSEN PE-028974 CIVIL C  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E



DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:	DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW		10/14/25	DSL	A
REISSUED FOR REVIEW		10/23/25	DSL	B
REISSUED FOR REVIEW		11/13/25	DSL	C

APPLICANT SITE NAME:  
  
LEES SUMMIT


SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: ELECTRICAL DETAILS  
SHEET #: E-3.0



**NOTE:**

GROUND LEADS ENTERING THE SHELTER SHALL HAVE 1/2" RIGID PVC SLEEVES 12" MIN BELOW FINISHED GRADE TO 6" FROM CONNECTION POINT. ALL OTHERS SHALL HAVE 1/2" NONMETALLIC FLEXIBLE CONDUIT SLEEVES MIN 12" BELOW GRADE TO 6" FROM CONNECTION POINT.

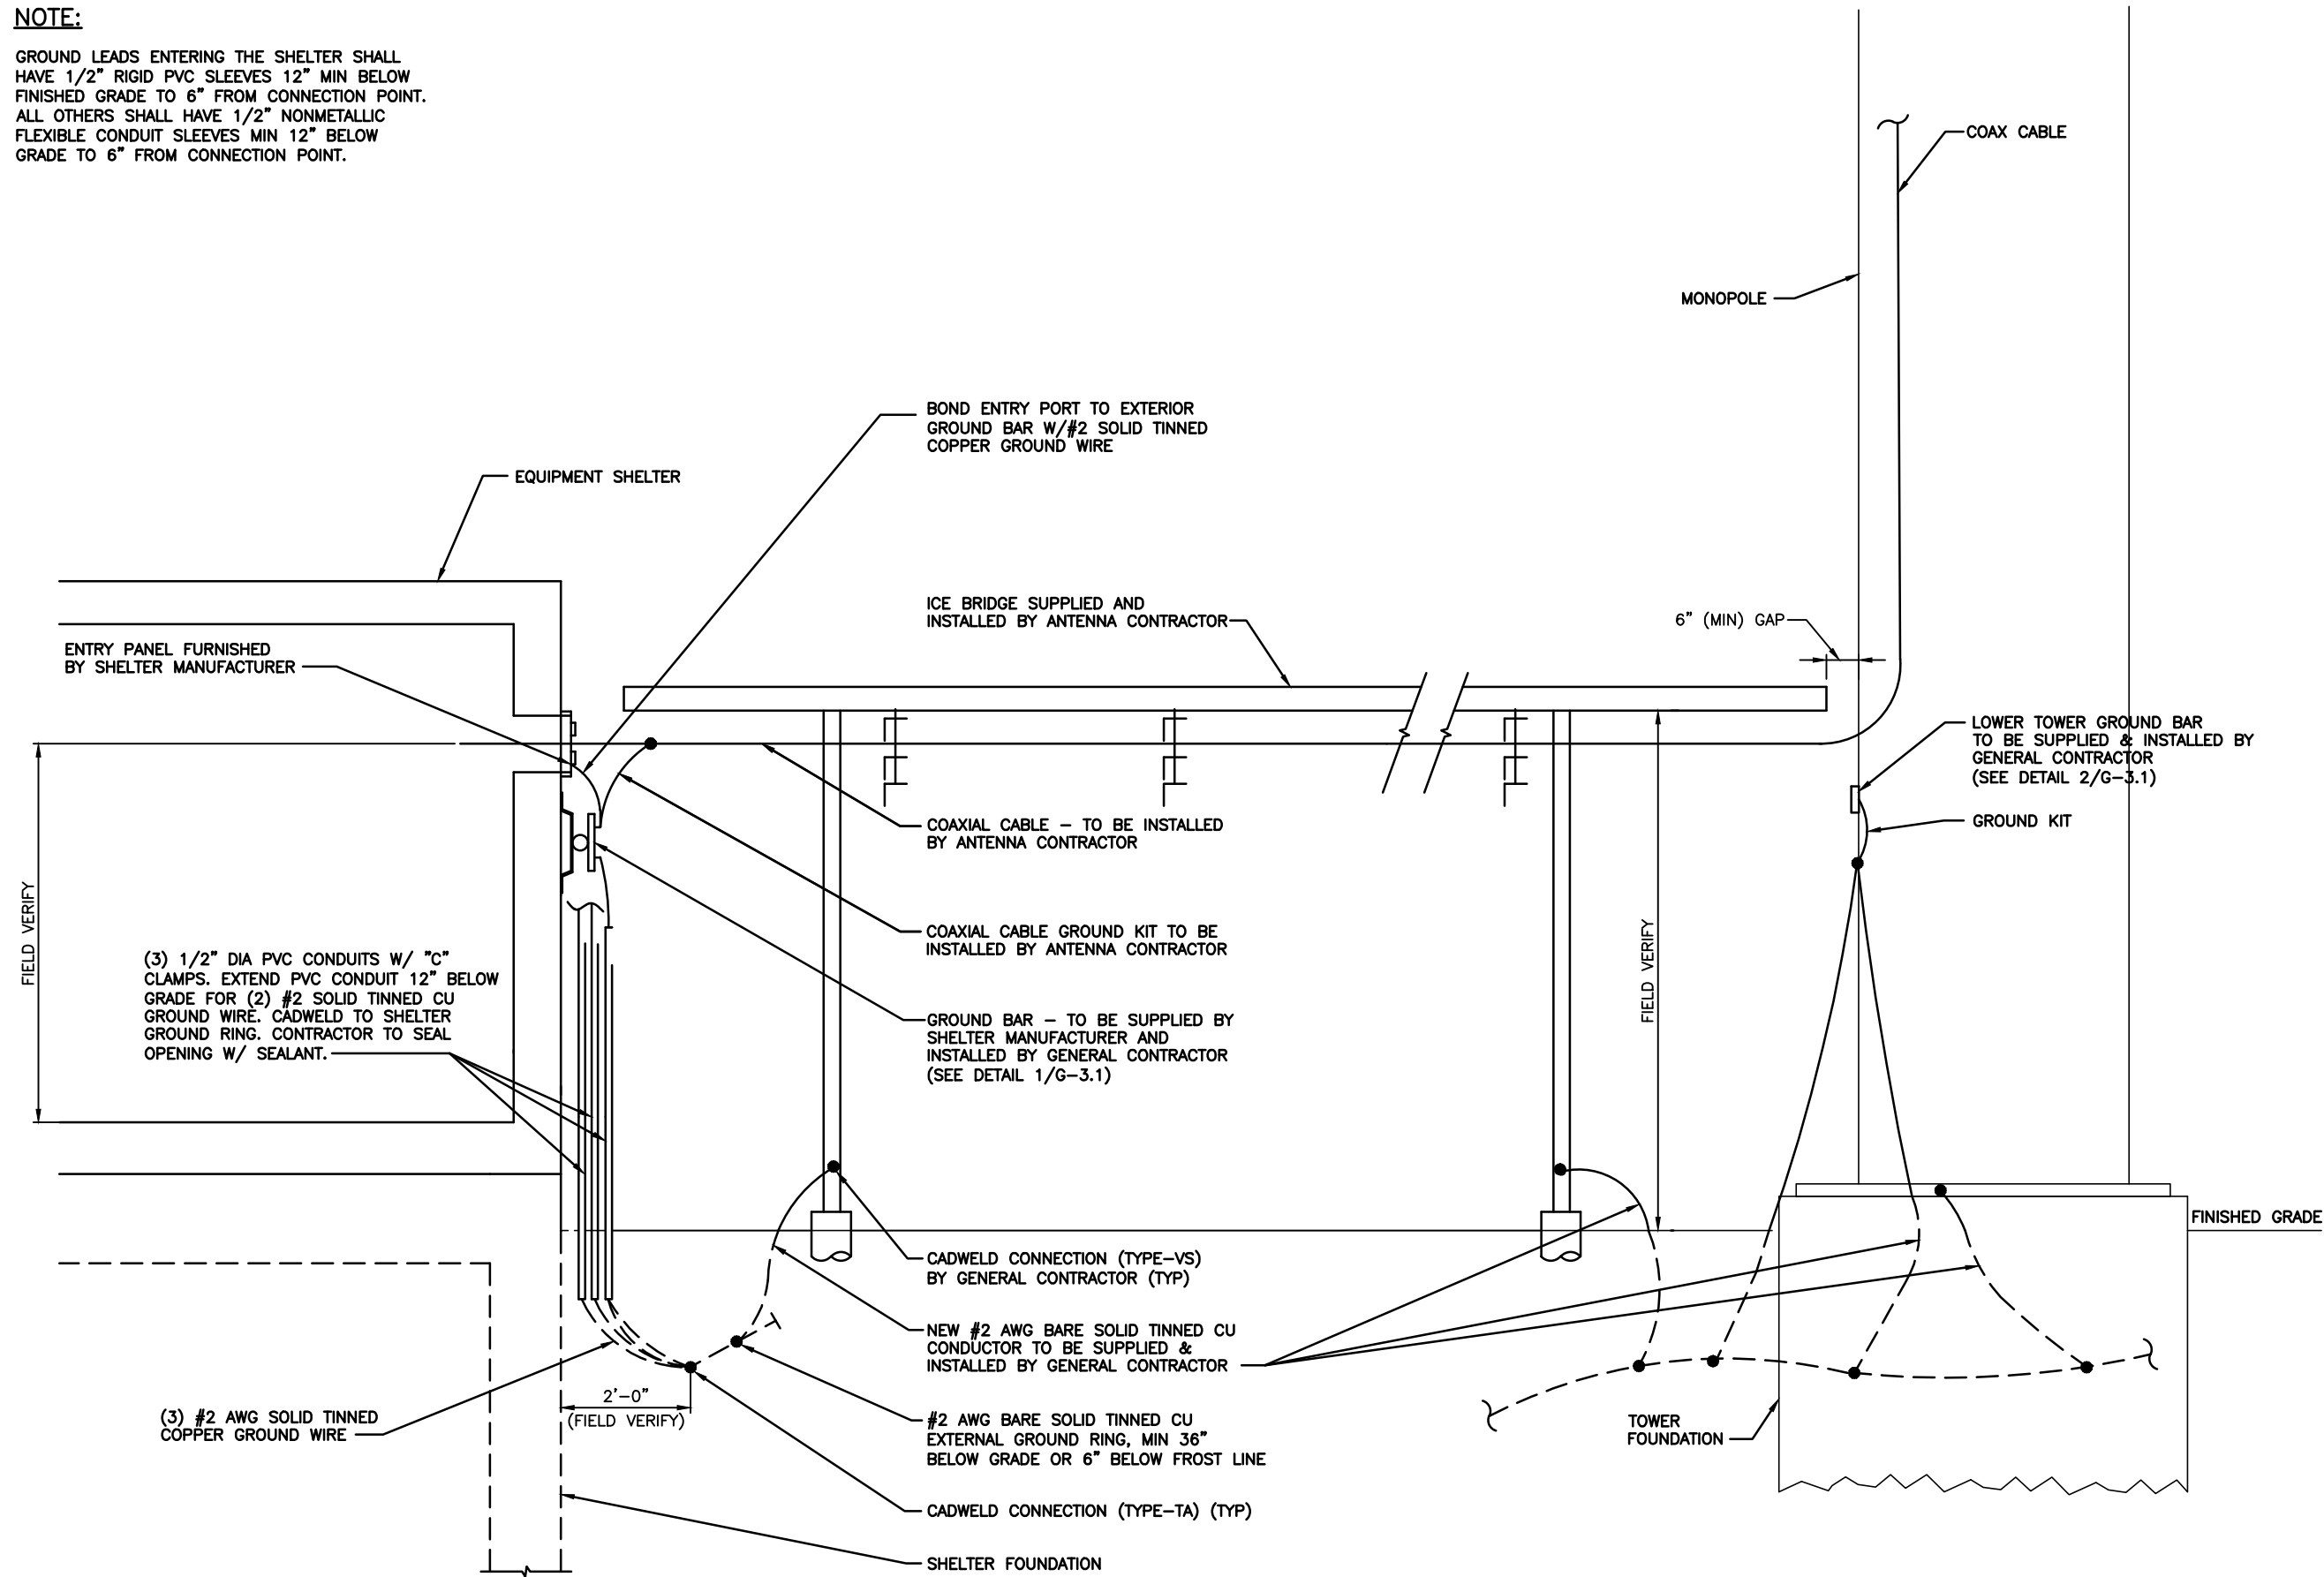

GROUNDING RISER DIAGRAM

STAMP:

**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
 STATE OF MISSOURI  
 STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
 ENGINEER: PE# DISCIPLINE:  
 CC CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL CC  
 REJ ROBERT E. JENSEN PE-208974 CIVIL CC  
 PMS PHILIP M. SWOBODA PE-2024040585 CIVIL CC  
 SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
 DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
 TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E

OEM:

APPLICANT:

PLANS PREPARED FOR:

PLANS PREPARED BY:

DRAWING NOTICE:  
 THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.


SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
 LEES SUMMIT


SITE ADDRESS:  
 TBD  
 LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: GROUNDING RISER DIAGRAM  
 SHEET #: G-2.0

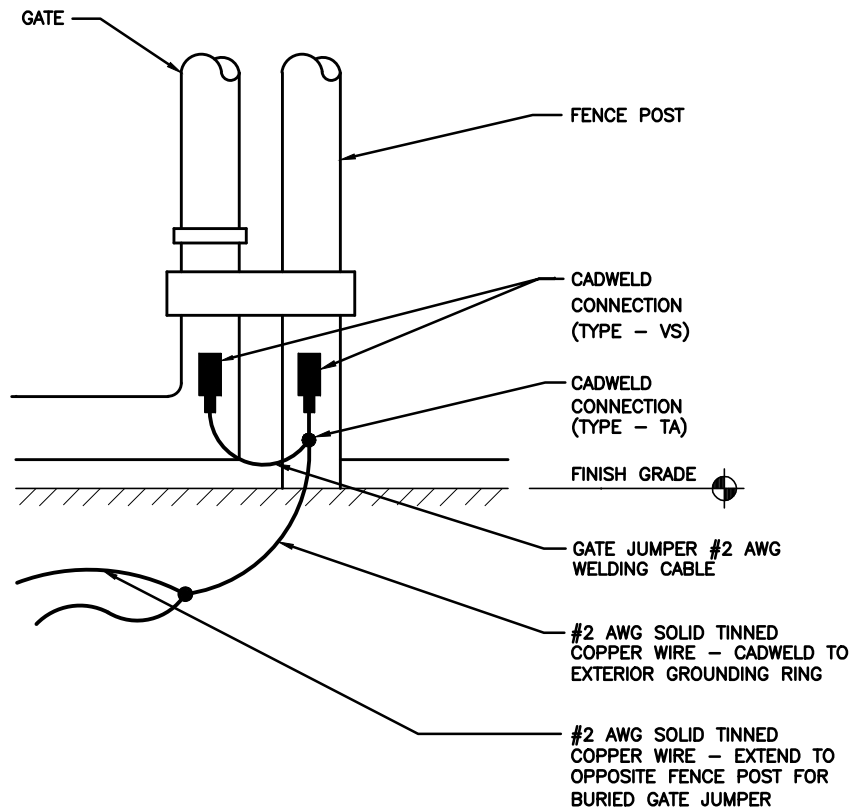


SWINGING GATE DETAIL (TYP)

5

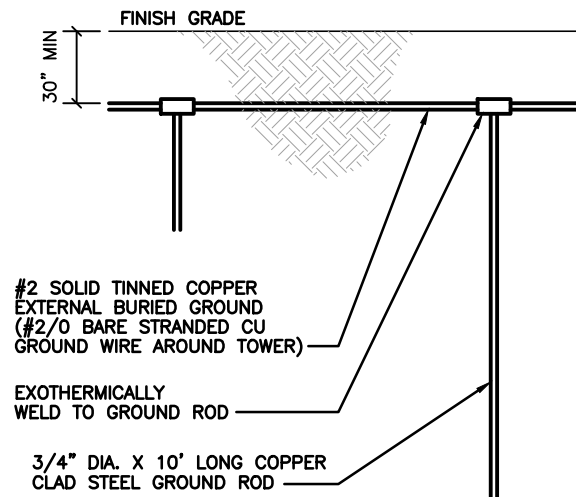


GROUND ROD DETAIL

3

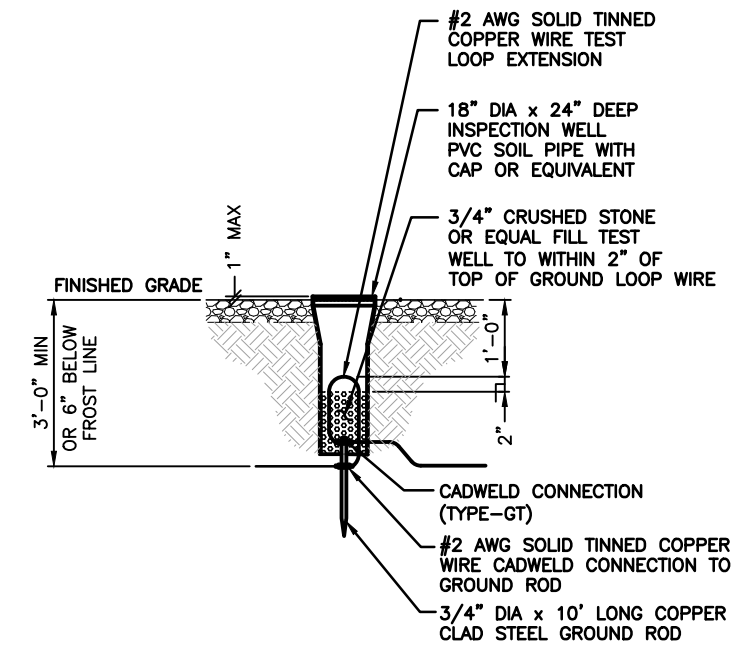


INSPECTION WELL

1

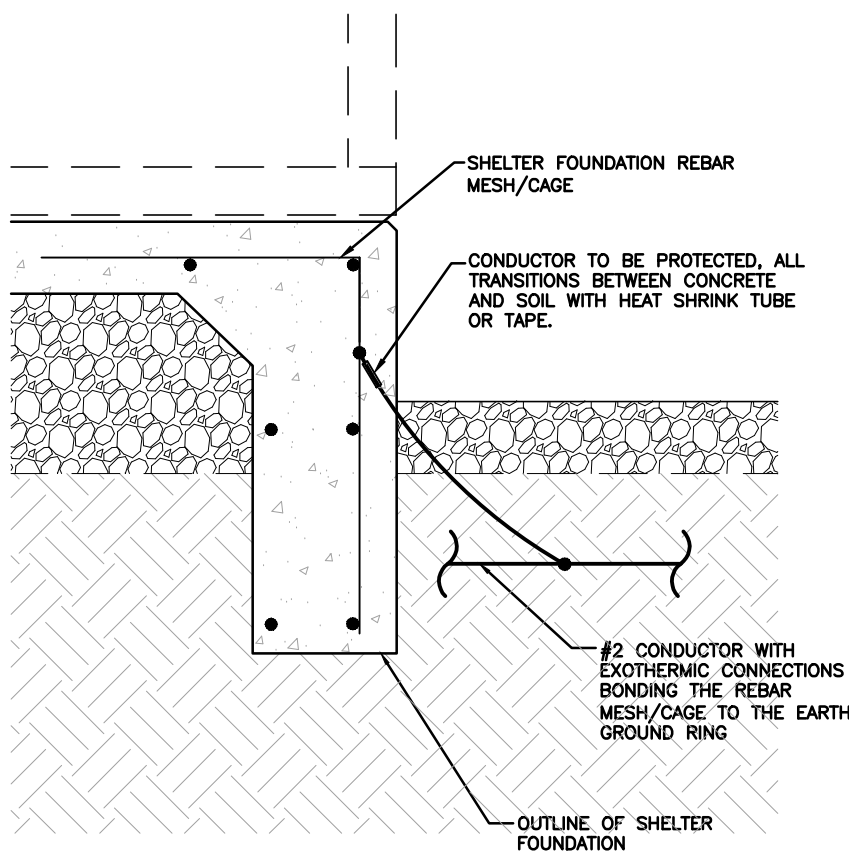


FOUNDATION GROUNDING DETAIL

6

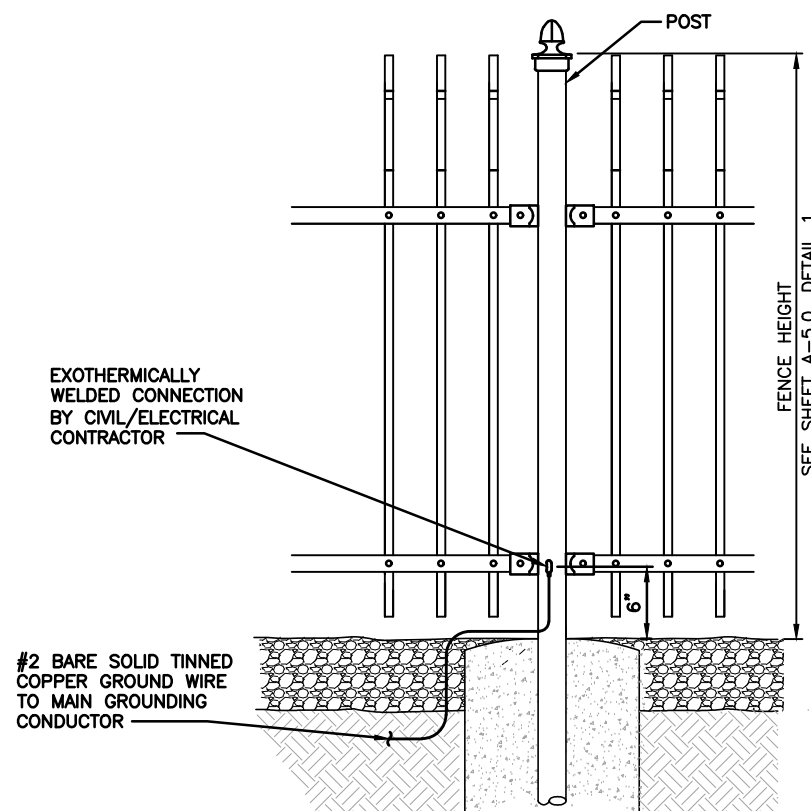

FENCE END, CORNER, AND POST GROUNDING

4

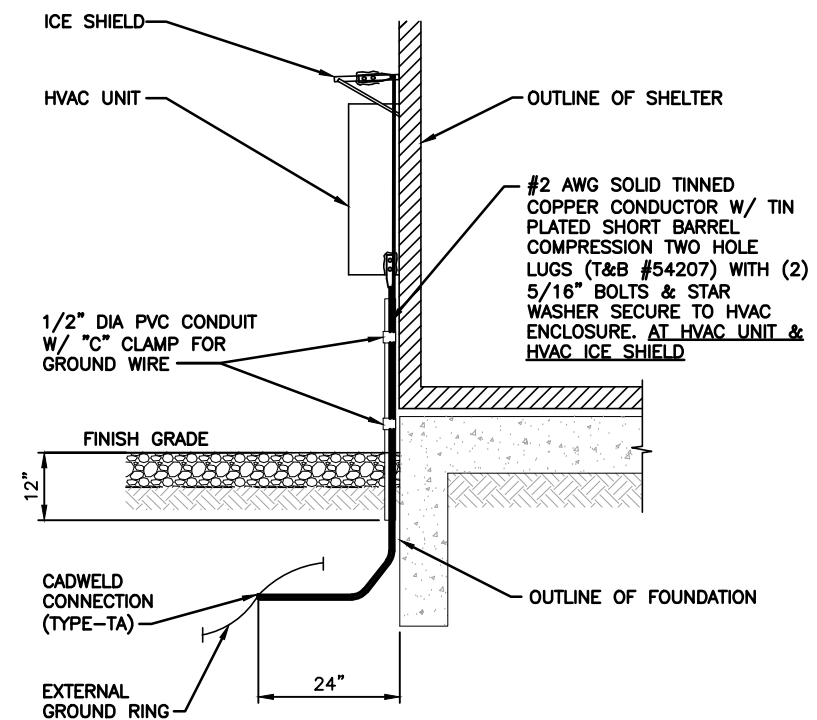

HVAC GROUNDING DETAIL

2

STAMP:  
**PRELIMINARY ISSUE**

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE#:  
DISCIPLINE:  
C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL  
C/O ROBERT E. JENSEN PE-028974 CIVIL  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL



DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C


APPLICANT SITE NAME:  
**LEES SUMMIT**

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION:  
**GROUNDING DETAILS (1 OF 3)**

SHEET #:  
**G-3.0**



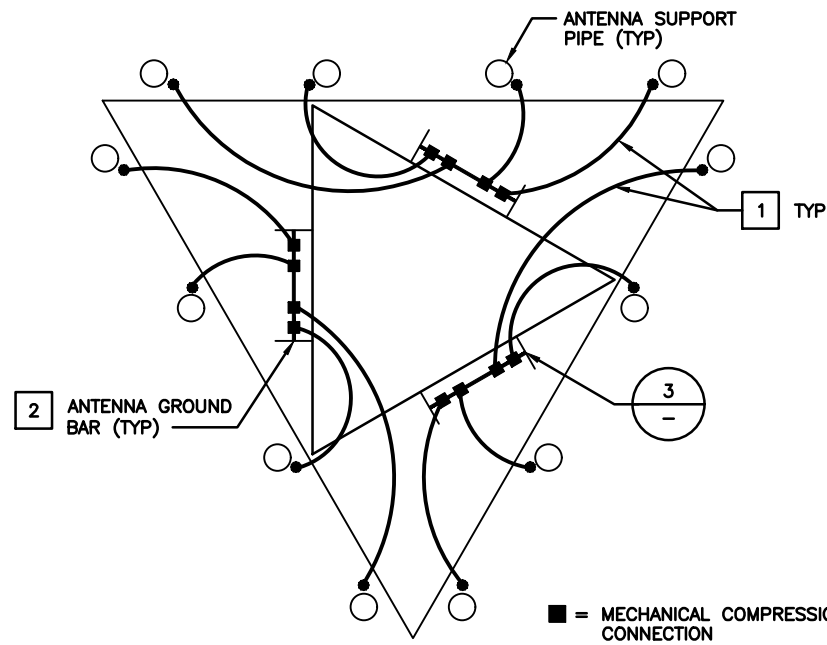


NOTES:

- 1 COAX GROUND KIT WIRES.
- 2 MOUNT TOWER GROUND BAR DIRECTLY TO TOWER WITHOUT ISOLATION BUSHINGS. CONTRACTOR TO REMOVE TOWER GALVANIZED COATING WHERE GROUND BAR COMES INTO CONTACT WITH TOWER. SUPPLY AND INSTALL COLD GALVANIZING TO TOWER AND GROUND BAR CLAMPS AFTER INSTALLATION.

ANTENNA GROUNDING PLAN

5

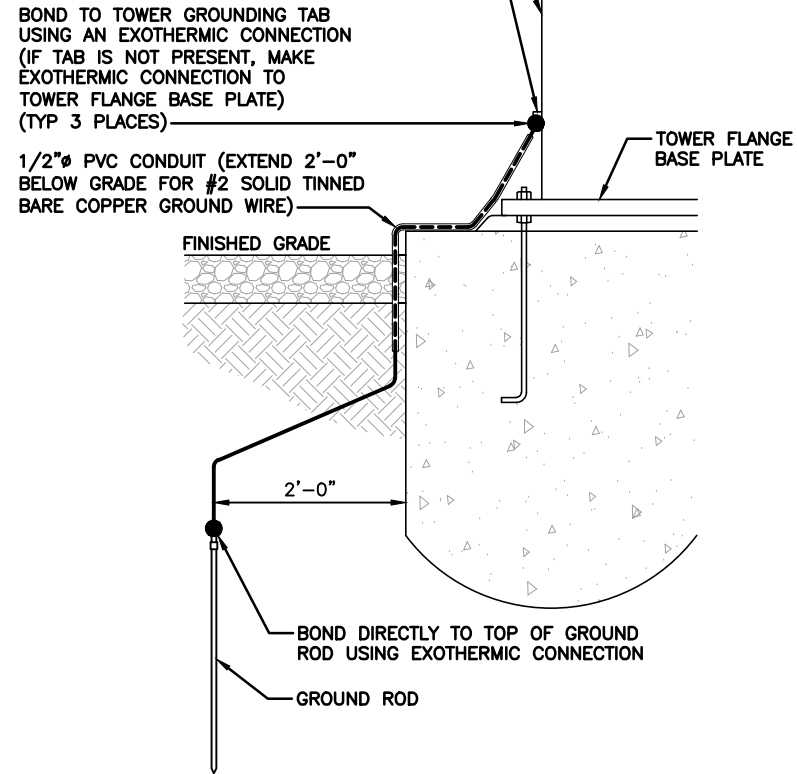


TOWER GROUNDING DETAIL

3

DETAIL NOT USED

1

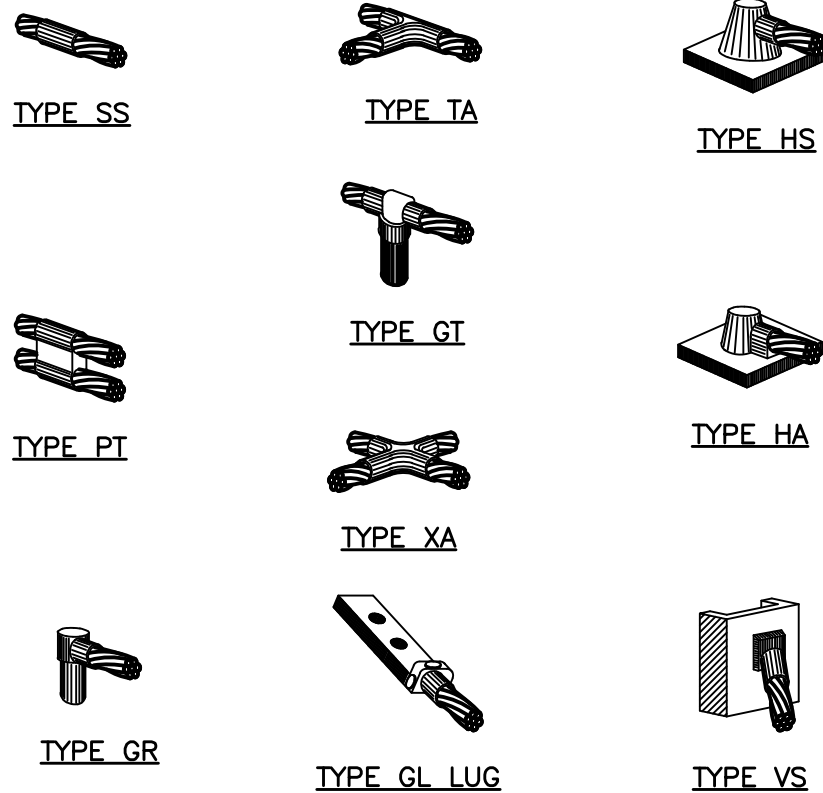

EXOTHERMIC CONNECTION TYPE DETAILS

6

DETAIL NOT USED

4

DETAIL NOT USED

2

STAMP:

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE#:  
DISCIPLINE:  
C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
REJ ROBERT E. JENSEN PE-028974 CIVIL C  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E

OEM:

APPLICANT:

PLANS PREPARED FOR:

PLANS PREPARED BY:

DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
  
LEES SUMMIT

SITE ADDRESS:  
  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION:  
GROUNDING  
DETAILS  
(3 OF 3)

SHEET #:  
G-3.2

**GENERAL REQUIREMENTS**

**PART 1: GENERAL**

**1.1 INTENT:**

- A. THESE SPECIFICATIONS AND CONSTRUCTION DRAWINGS DESCRIBE THE WORK TO BE DONE AND THE MATERIALS TO BE FURNISHED FOR CONSTRUCTION. PLANS ARE NOT TO BE SCALED.
- B. THE DRAWINGS AND SPECIFICATIONS ARE INTENDED TO BE FULLY EXPLANATORY AND SUPPLEMENTARY, HOWEVER, SHOULD ANYTHING BE SHOWN, INDICATED OR SPECIFIED ON ONE AND NOT THE OTHER, IT SHALL BE DONE THE SAME AS IF SHOWN, INDICATED OR SPECIFIED IN BOTH.
- C. THE INTENTION OF DOCUMENTS IS TO INCLUDE ALL LABOR AND MATERIALS REASONABLY NECESSARY FOR THE PROPER EXECUTION AND COMPLETION OF THE WORK AS STIPULATED IN THE CONTRACT.
- D. CONFLICTS: THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL MEASUREMENTS AT THE SITE BEFORE ORDERING MATERIALS OR DOING ANY WORK. NO COMPENSATION SHALL BE ALLOWED DUE TO DIFFERENCES BETWEEN ACTUAL DIMENSIONS AND THOSE ON THE DOCUMENTS. ANY DISCREPANCY SHALL BE REPORTED TO THE OWNER OR THEIR AGENT FOR CONSIDERATION.

**1.2 LICENSING REQUIREMENTS:**

- A. THE CONTRACTOR IS RESPONSIBLE FOR PROCUREMENT AND MAINTAINING ALL APPLICABLE LICENSES AND BONDS.

**1.3 STORAGE:**

- A. ALL MATERIALS MUST BE STORED IN A LEVEL AND DRY FASHION THAT DOES NOT OBSTRUCT THE FLOW OF OTHER WORK. ANY STORAGE METHOD MUST MEET ALL RECOMMENDATIONS OF THE ASSOCIATED MANUFACTURER.

**1.4 CLEAN UP:**

- A. THE CONTRACTOR SHALL KEEP THE SITE FREE FROM ACCUMULATION OF WASTE MATERIALS OR RUBBISH AT ALL TIMES.

**1.5 QUALITY ASSURANCE:**

- A. ALL WORK SHALL BE IN ACCORDANCE WITH APPLICABLE LOCAL, STATE, AND FEDERAL REGULATIONS.

PART 2: PRODUCTS – NOT APPLICABLE TO THIS SECTION

PART 3: EXECUTION – NOT APPLICABLE TO THIS SECTION

END OF SECTION

**COMMUNICATIONS/ANTENNA'S**

**PART 1: GENERAL**

**1.1 WORK INCLUDED:**

- A. ANTENNA AND FEEDLINE CABLES ARE FURNISHED BY OWNER UNDER SEPARATE CONTRACT. THE CONTRACTOR SHALL ASSIST ANTENNA INSTALLATION CONTRACTOR IN TERMS OF COORDINATION AND SITE ACCESS. ERECTION SUBCONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF PERSONNEL AND PROPERTY FROM HAZARDOUS EXPOSURE TO OVERHEAD DANGER.
- B. INSTALL ANTENNAS AS INDICATED ON DRAWINGS AND OWNER SPECIFICATIONS.
- C. INSTALL GALVANIZED STEEL ANTENNA MOUNTS AS INDICATED ON DRAWINGS.
- D. INSTALL FURNISHED GALVANIZED STEEL WAVEGUIDE LADDER AS INDICATED ON DRAWINGS.
- E. THE CONTRACTOR SHALL PROVIDE FREQUENCY DOMAIN REFLECTOMETER (FDR) TEST RESULTS TO THE CONSTRUCTION MANAGER AND OWNER WITHIN ONE WEEK OF COMPLETION.
- F. INSTALL FEEDLINE CABLES AND TERMINATORS BETWEEN ANTENNAS AND EQUIPMENT PER MANUFACTURER'S RECOMMENDATIONS. WEATHERPROOF ALL CONNECTORS BETWEEN THE ANTENNA AND EQUIPMENT PER MANUFACTURER'S REQUIREMENTS. TERMINATE ALL FEEDLINE CABLE THREE (3) FEET IN EXCESS OF ENTRY PORT LOCATION UNLESS OTHERWISE STATED.
- G. ANTENNA AND FEEDLINE CABLE GROUNDING:
  - 1. ALL FEEDLINE CABLE GROUNDING CONNECTIONS ARE TO BE WEATHER SEALED WITH ANDREW CONNECTOR/SPLICE WEATHERPROOFING KITS OR APPROVED EQUAL.
  - 2. ALL FEEDLINE CABLE GROUNDING KITS ARE TO BE INSTALLED ON STRAIGHT RUNS OF FEEDLINE CABLE (NOT WITHIN BENDS)

**1.2 RELATED WORK:**

- A. FURNISH THE FOLLOWING WORK AS SPECIFIED UNDER CONSTRUCTION DOCUMENTS, BUT COORDINATE WITH OTHER TRADES PRIOR TO BID:
  - 1. FLASHING OF OPENING INTO OUTSIDE WALLS.
  - 2. SEAL AND CAULK ALL OPENINGS.
  - 3. PAINTING.
  - 4. CUTTING AND PATCHING.

**1.3 REQUIREMENTS OF REGULATOR AGENCIES:**

- A. FURNISH UL LISTED EQUIPMENT WHERE SUCH LABEL IS AVAILABLE, INSTALL IN CONFORMANCE WITH UL STANDARDS WHERE APPLICABLE.
- B. INSTALL ANTENNA, ANTENNA CABLES, AND GROUNDING SYSTEM IN ACCORDANCE WITH DRAWINGS AND SPECIFICATIONS IN EFFECT AT PROJECT LOCATION AND RECOMMENDATIONS OF STATE AND LOCAL BUILDING CODES, AND ANY SPECIAL CODES HAVING JURISDICTION OVER SPECIFIC PORTIONS OF WORK. THIS INCLUDES BUT IS NOT LIMITED TO THE FOLLOWING:
  - 1. TIA-222 (TELECOMMUNICATIONS INDUSTRY ASSOCIATION) – STRUCTURAL STANDARDS FOR STEEL ANTENNA TOWERS AND ANTENNA SUPPORTING STRUCTURES.
  - 2. FAA (FEDERAL AVIATION ADMINISTRATION ADVISORY) – CIRCULAR AC 70/7460-1K, OBSTRUCTION MARKING AND LIGHTING.
  - 3. FCC (FEDERAL COMMUNICATIONS COMMISSION) – RULES AND REGULATIONS OBSTRUCTION MARKING AND LIGHTING SPECIFICATIONS FOR ANTENNA STRUCTURES AND HIGH INTENSITY OBSTRUCTION LIGHTING SPECIFICATIONS FOR ANTENNA STRUCTURES.
  - 4. AISC (AMERICAN INSTITUTE OF STEEL CONSTRUCTION) – SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS.
  - 5. NEC (NATIONAL ELECTRICAL CODE) – FOR TOWER LIGHTING KITS.
  - 6. UL (UNDERWRITERS LABORATORIES) – APPROVED ELECTRICAL PRODUCTS.
  - 7. IN ALL CASES, THE FAA RULES AND THE FCC RULES ARE APPLICABLE AND IN THE EVENT OF CONFLICT, SUPERSEDE ANY OTHER STANDARDS OR SPECIFICATIONS.
  - 8. LIFE SAFETY CODE NFPA, LATEST EDITION.

PART 2: PRODUCTS – NOT APPLICABLE TO THIS SECTION

PART 3: EXECUTION – NOT APPLICABLE TO THIS SECTION

END OF SECTION

**SITE CLEARING/EROSION CONTROL**

**PART 1: GENERAL**

**1.1 SUMMARY:**

- A. PROVIDE SITE-CLEARING AS REQUIRED TO COMPLETE WORK AS SHOWN ON CONTRACT DOCUMENTS INCLUDING CLEARING, GRUBBING, STRIPPING, EROSION AND SILTATION CONTROL, AND PROTECTION OF LANDSCAPE MATERIALS DESIGNATED TO BE PROTECTED DURING CONSTRUCTION.

**1.2 QUALITY ASSURANCE:**

- A. COMPLY WITH GOVERNING CODES AND REGULATIONS.
- B. SITE PROTECTION: PROVIDE ALL NECESSARY JOB SITE MAINTENANCE FROM COMMENCEMENT OF WORK UNTIL COMPLETION OF THE SUBCONTRACT
- C. AVOID DAMAGE TO THE SITE AND TO EXISTING FACILITIES, STRUCTURES, TREES, AND SHRUBS DESIGNATED TO REMAIN. TAKE PROTECTIVE MEASURES TO PREVENT EXISTING FACILITIES THAT ARE NOT DESIGNATED FOR REMOVAL FROM BEING DAMAGED BY THE WORK.

**PART 2: PRODUCTS**

**2.1 MATERIALS:**

- A. TREE PROTECTION, EROSION CONTROL, SILTATION CONTROL, AND DUST CONTROL MATERIALS SUITABLE FOR SITE CONDITIONS.

**PART 3: EXECUTION**

**3.1 SITE CLEARING OPERATIONS:**

- A. PROTECTION OF EXISTING TREES, VEGETATION, LANDSCAPING, AND SITE IMPROVEMENTS NOT SCHEDULED FOR CLEARING WHICH MIGHT BE DAMAGED BY CONSTRUCTION ACTIVITIES.
- B. TRIMMING OF EXISTING TREES AND VEGETATION AS RECOMMENDED BY ARBORIST FOR PROTECTION DURING CONSTRUCTION ACTIVITIES.
- C. CLEARING AND GRUBBING OF STUMPS AND VEGETATION, AND REMOVAL AND DISPOSAL OF DEBRIS, RUBBISH, DESIGNATED TREES, AND SITE IMPROVEMENTS.
- D. TOPSOIL STRIPPING AND STOCKPILING.
- E. TEMPORARY EROSION CONTROL, SILTATION CONTROL, AND DUST CONTROL.
- F. TEMPORARY PROTECTION OF ADJACENT PROPERTY, STRUCTURES, BENCHMARKS, AND MONUMENTS.
- G. WATERING OF TREES AND VEGETATION DURING CONSTRUCTION ACTIVITIES.
- H. REMOVAL AND LEGAL DISPOSAL OF CLEARED MATERIALS.
- I. MAINTAIN ALL EXISTING FENCING AND GATES TO MAINTAIN A SECURE SITE AT ALL TIMES.
- J. PROVIDE AND MAINTAIN ALL TEMPORARY FENCING, BARRICADES, WARNING SIGNALS AND SIMILAR DEVICES NECESSARY TO PROTECT LIFE AND PROPERTY DURING THE ENTIRE PERIOD OF CONSTRUCTION. REMOVE ALL SUCH DEVICES UPON COMPLETION OF THE WORK.

**3.2 CLEARING:**


- A. PREVENT DAMAGE TO EXISTING IMPROVEMENTS INDICATED TO REMAIN, INCLUDING ON AND OFF SITE. PROTECT EXISTING TREES AND VEGETATION INDICATED TO REMAIN. DO NOT STOCKPILE MATERIALS AND RESTRICT TRAFFIC WITHIN DRIP LINE OF EXISTING TREES TO REMAIN OR THAT INTERFERE WITH ACCESS TO SITE. PROVIDE AND MAINTAIN TEMPORARY GUARDS TO ENCIRCLE TREES OR GROUPS OF TREES TO REMAIN; OBTAIN APPROVAL BEFORE BEGINNING WORK.
- B. WATER VEGETATION AS REQUIRED TO MAINTAIN HEALTH. COVER TEMPORARILY EXPOSED ROOTS WITH WET BURLAP AND BACKFILL AS SOON AS POSSIBLE. COAT CUT PLANT SURFACES WITH APPROVED EMULSIFIED ASPHALT PLANT COATING.
- C. REPAIR OR REPLACE VEGETATION DESIGNATED FOR REUSE, WHICH HAS BEEN DAMAGED. REMOVE HEAVY GROWTHS OF GRASS BEFORE STRIPPING. STOCKPILE SATISFACTORY TOPSOIL CONTAINING NO LARGE STONES, FOREIGN MATTER AND WEEDS ON SITE FOR REUSE.
- D. COMPLETELY REMOVE ALL IMPROVEMENTS, STUMPS AND DEBRIS EXCEPT FOR THOSE INDICATED TO REMAIN. REMOVE BELOW GRADE IMPROVEMENTS AT LEAST 12" BELOW FINISH GRADE SO AS NOT TO INTERFERE WITH NEW CONSTRUCTION. REMOVE ABANDONED MECHANICAL AND ELECTRICAL WORK AS REQUIRED.
- E. PREVENT EROSION AND SILTATION OF STREETS, CATCH BASINS AND PIPING. CONTROL WINDBLOWN DUST. REMOVE WASTE MATERIALS AND UNSUITABLE SOIL FROM SITE AND DISPOSE OF IN A LEGAL MANNER.
- F. EXCEPT WHERE EXCAVATION TO GREATER DEPTH IS INDICATED, FILL DEPRESSIONS RESULTING FROM CLEARING, GRUBBING AND DEMOLITION WORK COMPLETELY WITH SUITABLE FILL AND COMPACT AS REQUIRED.

**3.3 EROSION CONTROL:**


- A. PROVIDE EROSION AND SILTATION CONTROL AS REQUIRED TO MEET ALL LOCAL AND STATE REQUIREMENTS.

END OF SECTION

STAMP:

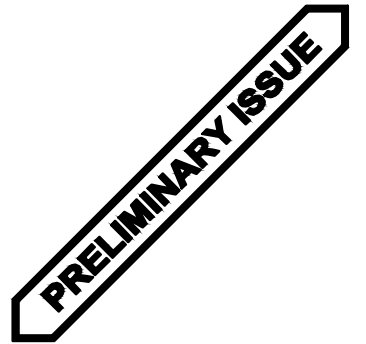

ENGINEERING LICENSE:			
STATE OF MISSOURI			
STATE CERTIFICATE OF AUTHORIZATION # EF-2791			
ENGINEER:	PE#:	DISCIPLINE:	
CS CHRISTOPHER GIANNOTTI	PE-2020038653	CIVIL	C C C
REJ ROBERT E. JENSEN	PE-028974	CIVIL	
PMS PHILIP M. SWOBODA	PE-2024040585	CIVIL	
SDK SHELTON D. KEISLING	PE-27323	ELECTRICAL	E
DJW DAVID J. WALDRON	PE-2024034789	ELECTRICAL	E
TMS TERRANCE M. SUPER	PE-18521	ELECTRICAL	E

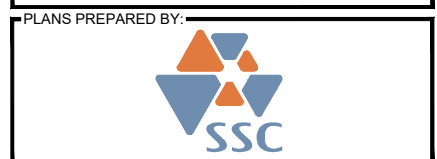

**DRAWING NOTICE:**  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:	DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW		10/14/25	DSL	A
REISSUED FOR REVIEW		10/23/25	DSL	B
REISSUED FOR REVIEW		11/13/25	DSL	C

APPLICANT SITE NAME:  
**LEES SUMMIT**

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: <b>SPECIFICATIONS (1 OF 7)</b>	SHEET #: <b>SP-1.0</b>
--	---------------------------

**CAST-IN-PLACE-CONCRETE**

**PART 1: GENERAL**

**1.1 SUMMARY:**

- A. FURNISH AND INSTALL ALL CAST-IN-PLACE CONCRETE, REINFORCING AND ACCESSORIES, AS SPECIFIED HEREIN AND AS SHOWN ON THE DRAWINGS.

**1.2 SUBMITTALS:**

- A. PRODUCT DATA: SUBMIT MANUFACTURER'S PRODUCT DATA AND INSTALLATION INSTRUCTIONS FOR EACH MATERIAL AND PRODUCT USED.
- B. SHOP DRAWINGS: SUBMIT SHOP DRAWINGS INDICATING MATERIAL CHARACTERISTICS, DETAILS OF CONSTRUCTION, CONNECTIONS, AND RELATIONSHIP WITH ADJACENT CONSTRUCTION.
  - 1. SHOP DRAWINGS SHALL BE PREPARED AND STAMPED BY A QUALIFIED ENGINEER LICENSED IN THE JURISDICTION OF THE PROJECT.
- C. MIX DESIGN: SUBMIT FOR APPROVAL MIX DESIGN PROPOSED FOR USE.

**1.3 QUALITY ASSURANCE:**

- A. COMPLY WITH GOVERNING CODES AND REGULATIONS. PROVIDE PRODUCTS OF ACCEPTABLE MANUFACTURERS, WHICH HAVE BEEN IN SATISFACTORY USE IN SIMILAR SERVICE FOR A MINIMUM OF THREE YEARS. USE EXPERIENCED INSTALLERS. DELIVER, HANDLE, STORE MATERIALS IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
- B. TESTING: EMPLOY AN INDEPENDENT TESTING AGENCY ACCEPTABLE TO OWNER TO DESIGN CONCRETE MIXES AND TO PERFORM MATERIAL EVALUATION TESTS. PROVIDE 4 AND 28 DAY CYLINDER TESTS. COMPLY WITH ASTM C 143, C 173, C 31 AND C 39.
- C. STANDARDS
  - 1. ACI 301, SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS.
  - 2. ACI 318, BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE, AND CRSI MANUAL OF STANDARD PRACTICE.

**PART 2: PRODUCTS**

**2.1 MATERIALS:**

- A. MATERIALS SHALL CONFORM TO THE RESPECTIVE PUBLICATIONS AND OTHER REQUIREMENTS SPECIFIED HEREIN.
- B. CEMENT: CEMENT SHALL CONFORM TO ASTM C150, TYPE 1. CEMENT MAY BE BAGGED OR BULK. CEMENT SHALL BE USED FROM ONLY ONE MILL THROUGHOUT PROJECT.
- C. FINE AGGREGATE: FINE AGGREGATE SHALL CONFORM TO ASTM C33-08 AND SHALL BE UNIFORMLY GRADED, CLEAN, SHARP, WASHED MATERIAL OR CRUSHED SAND, FREE FROM ORGANIC IMPURITIES.
- D. COURSE AGGREGATE: COURSE AGGREGATE SHALL CONFORM TO ASTM C33-08 AND SHALL BE NATURAL WASHED GRAVEL OR WASHED CRUSHED ROCK HAVING HARD, STRONG, DURABLE PIECES, FREE FORM ADHERENT COATINGS, THE MAXIMUM SIZE OF COARSE AGGREGATE SHALL BE 3/4" IN ACCORDANCE WITH THE REQUIREMENTS OF ASTM C33-08; GRADATION SIZE NO. 67.
- E. WATER: WATER USED IN THE CONCRETE MIX SHALL BE POTABLE, CLEAN, AND FREE FROM OILS, ACIDS, SALTS, CHLORIDES, ALKALI, SUGAR, VEGETABLE, OR OTHER INJURIOUS SUBSTANCES.
- F. REINFORCING STEEL: ALL BARS ARE TO BE NEW BILLET STEEL CONFORMING TO ASTM A615, GRADE 60. BENDING DETAILS ARE TO CONFORM TO THE STANDARDS OF ACI 318.
- G. FORMS: THE FORMS SHALL BE TRUE AND RIGID AND CONFORM TO SHAPE, LINE AND DIMENSIONS AS SHOWN ON THE DRAWINGS. ALL FORMS SHALL BE RIGIDLY CONSTRUCTED, BRACED AND TIED TO PREVENT ANY DEFLECTION OR DISPLACEMENT DURING PLACING OF CONCRETE. ALL EXPOSED CORNERS AND EDGES SHALL HAVE 3/4" FILLETS. ALL JOINTS SHALL BE MORTAR TIGHT; OPEN JOINTS SHALL BE SEALED AS REQUIRED.
- H. CONCRETE:
  - 1. PROPORTIONING: CONCRETE SHALL CONFORM TO THE FOLLOWING:
    - a. CEMENT-6 SACKS PER CUBIC YARD, MINIMUM
    - b. WATER SHALL BE KEPT TO AN ABSOLUTE MINIMUM TO MAINTAIN SLUMP AS SPECIFIED
    - c. AGGREGATE; SAND FACTOR SHALL BE AS REQUIRED TO GIVE THE BEST WORKABLE MIX WITHIN THE RANGE OF 46% TO 52% OF TOTAL AGGREGATE.
    - d. STRENGTH-4,000 PSI AT 28 DAYS, UNLESS NOTED OTHERWISE
    - e. ALL CONCRETE SHALL CONTAIN A WATER-REDUCING AGENT AND SHALL HAVE THREE (3) TO FIVE (5) PERCENT ENTRAINED AIR.

**2.2 SLUMP:**

- A. THE MAXIMUM SLUMP SHALL NOT EXCEED 3" EXCEPT FOR CONCRETE TO BE PLACED IN FORMS 8" WIDE OR LESS, WHERE THE MAXIMUM SLUMP SHALL BE 4".
- B. THE DETERMINATION OF SLUMP SHALL CONFORM TO ASTM C143.

**2.3 MIXING:**

- A. THE CONTRACTOR SHALL USE READY-MIXED CONCRETE, MIXED AND DELIVERED IN CONFORMANCE WITH ASTM C94.

**2.4 MIXTURES:**

- A. THE CONCRETE SHALL CONTAIN AN AIR-ENTRAINING ADMIXTURE COMPLYING WITH THE REQUIREMENTS OF ASTM C-260 AND ACI 212.1R AND A WATER-REDUCING ADMIXTURE COMPLYING WITH THE REQUIREMENTS OF ASTM C-494 AND ACI 212.1R. ADMIXTURES SHALL BE PURCHASE AND BATCHED IN LIQUID SOLUTION. THE USE OF CALCIUM CHLORIDE OR AN ADMIXTURE CONTAINING CALCIUM CHLORIDE IS PROHIBITED.
- B. ADMIXTURES SHALL BE OF THE SAME MANUFACTURER TO ASSURE COMPATIBILITY.
- C. ACCEPTABLE MANUFACTURERS ARE:
  - 1. W.R. GRACE 3. MASTER BUILDERS
  - 2. SIKA GROUP 4. EUCLID CHEMICAL CO

**2.5 CURING COMPOUNDS:**

- A. CURING COMPOUNDS SHALL CONFORM TO ASTM C309, TYPE 1, ID, CLASS A AND B AND ASTM C171 AS APPLICABLE

**PART 3: EXECUTION**

**3.1 GENERAL:**

- A. CONSTRUCT AND ERECT FORMWORK IN ACCORDANCE WITH ACI 301 ACI 347.
- B. COLD-WEATHER CONCRETING SHALL BE IN ACCORDANCE WITH ACI 306.
- C. HOT-WEATHER CONCRETING SHALL BE IN ACCORDANCE WITH ACI 305.

**3.2 INSERTS, EMBEDDED COMPONENTS AND OPENINGS:**

- A. CONTRACTOR SHALL CHECK ALL CIVIL, ARCHITECTURAL, STRUCTURAL, AND ELECTRICAL DRAWINGS FOR OPENINGS, SLEEVES, ANCHOR BOLTS, INSERTS AND OTHER ITEMS TO BE BUILT INTO THE CONCRETE WORK.
- B. COORDINATE THE WORK OF OTHER SECTIONS IN FORMING AND SETTING OPENINGS, RECESSES, SLOTS, CHASES, ANCHORS, INSERTS AND OTHER ITEMS TO BE EMBEDDED.
- C. EMBEDDED ITEMS SHALL BE SET ACCURATELY IN LOCATION, ALIGNMENT, ELEVATION, AND PLUMBNESS. LOCATE AND MEASURE FROM ESTABLISHED SURVEYED REFERENCE BENCHMARKS.
- D. EMBEDDED ITEMS SHALL BE ANCHORED INTO PLACE AS REQUIRED TO PREVENT MOVEMENT DURING CONCRETE PLACEMENT AND CONSOLIDATION. COMPONENTS FORMING A PART OF A COMPLETE ASSEMBLY SHALL BE ALIGNED BEFORE ANCHORING. PROVIDE TEMPORARY BRACING, ANCHORAGE, AND TEMPLATES AS REQUIRED TO MAINTAIN THE SETTING AND ALIGNMENT.

**3.3 REINFORCEMENT PLACEMENT:**

- A. REINFORCEMENT SHALL BE PLACED IN ACCORDANCE WITH CHECKED AND RELEASED DRAWINGS AND ACI 301 AND ACI 315; SECURELY WIRE-TIE REINFORCEMENT AT ALL INTERSECTIONS.
- B. ACCURATELY POSITION, SUPPORT AND SECURE REINFORCEMENT AGAINST DISPLACEMENT FROM FORMWORK CONSTRUCTION OR CONCRETE PLACEMENT AND CONSOLIDATION. REINFORCING SHALL BE SUPPORTED ON METAL CHAIRS, RUNNERS, BOLSTERS, SPACERS, AND HANGERS.
- C. SPLICES OF REINFORCING BARS SHALL BE CLASS B UNLESS SHOWN OTHERWISE. SPLICES SHALL BE STAGGERED. FULL DEVELOPMENT LENGTH SHALL BE PROVIDED ACROSS JOINTS.
- D. LOCATE REINFORCING TO PROVIDE CONCRETE COVER AND SPACING SHOWN ON THE DRAWINGS. MINIMUM COVER SHALL BE AS REQUIRED BY ACI 318.
- E. WELDING OF AND TO ANY REINFORCING MATERIALS INCLUDING TACK WELDING OF CROSSING BARS IS STRICTLY PROHIBITED. BARS SHALL BE FREE OF FLAKY OR SCALY RUST AT THE TIME THE CONCRETE IS PLACED.

**3.4 CONCRETE PLACEMENT:**

- A. PRIOR TO PLACING CONCRETE, FORMS AND REINFORCEMENT SHALL BE THOROUGHLY INSPECTED. ALL WOOD CHIPS, DIRT, ETC., AS WELL AS ALL TEMPORARY BRACING, TIES, AND CLEATS REMOVED, AND ALL OPENINGS FOR UTILITIES PROPERLY BOXED, ALL FORMS SHALL BE PROPERLY SECURED IN THEIR CORRECT POSITION AND MADE TIGHT. ALL REINFORCING AND EMBEDDED ITEMS SHALL BE SECURED IN THEIR PROPER LOCATIONS.. ALL OLD AND DRY CONCRETE AND DIRT SHALL BE CLEANED AND ALL STANDING WATER AND OTHER FOREIGN MATTER REMOVED.

- B. PLACING CONCRETE SHALL BE IN ACCORDANCE WITH ACI 301 AND ACI 304 AND SHALL BE CARRIED OUT AT SUCH A RATE THAT THE CONCRETE PREVIOUSLY PLACED IS STILL PLASTIC AND INTEGRATED WITH THE FRESHLY PLACE CONCRETE. CONCRETING, ONCE STARTED, SHALL BE CARRIED ON AS A CONTINUOUS OPERATION UNTIL THE SECTION IS COMPLETED. NO COLD JOINTS SHALL BE ALLOWED.
- C. CONSTRUCTION JOINTS: USE KEYWAYS, CONTINUE REINFORCEMENT THROUGH JOINT.
- D. EXPANSION JOINTS: FOR EXTERIOR WORK, LOCATE AT 30'-0" O.C. MAXIMUM, AT APPROVED LOCATIONS. PROVIDE SMOOTH DOWELS ACROSS JOINT WHICH PERMIT 1" HORIZONTAL MOVEMENT AND NO VERTICAL SHEAR MOVEMENT.
- E. ISOLATION JOINTS: PROVIDE BETWEEN SLABS AND VERTICAL ELEMENTS SUCH AS COLUMNS AND STRUCTURAL WALLS.
- F. CONTROL JOINTS: PROVIDE SAWN OR TOOLED JOINTS OR REMOVABLE INSERT STRIPS; DEPTH EQUAL TO 1/4 SLAB THICKNESS. SPACING SHALL BE AS REQUIRED AND APPROVED.
- G. ALL CONCRETE SHALL BE THOROUGHLY CONSOLIDATED AND COMPACTED BY VIBRATION, SPADING, RODDING, OR FORKING DURING THE OPERATION OF PLACING AND DEPOSITING IN ACCORDANCE WITH ACI 309. THE CONCRETE SHALL BE WORKED AROUND REINFORCEMENT, EMBEDDED ITEMS, AND INTO THE CORNERS OF THE FORMS SO AS TO ELIMINATE ALL AIR AND STONE POCKETS.

**3.5 FINISHING:**


- A. FINISHING OF ALL SLABS SHALL BE IN ACCORDANCE WITH ACI 302.1; SECTION 7.2 WITH A MINIMUM OF THREE TROWELINGS.
  - 1. INTERIOR SLAB FINISH TOLERANCE AS MEASURED IN ACCORDANCE WITH ASTM E 1155, SHALL HAVE AN OVERALL TEST F NUMBER FOR FLATNESS, FF=20 AND FOR LEVEL, FL=15. THE MINIMUM LOCAL NUMBER FOR FLATNESS, FF=15 AND FOR LEVEL, FL=10.
  - 2. EXTERIOR SLAB FINISH SHALL BE FLAT (FF=20) AND SHALL BE SLOPED A MINIMUM OF 1/8" PER FOOT TO A MAXIMUM OF 1/4" PER FOOT TO PREVENT PONDING WATER.
- B. SURFACES OF SLABS SHALL RECEIVE TWO COATS OF CLEAR SEALER/HARDNER.
- C. ABOVE GRADE WALL SURFACES SHALL HAVE A SMOOTH FORM FINISH AS DEFINED IN CHAPTER 10 OF ACI 301.

**3.6 CURING:**


- A. FRESHLY DEPOSITED CONCRETE SHALL BE PROTECTED FROM PREMATURE DRYING AND EXCESSIVELY HOT OR COLD TEMPERATURES AND SHALL BE MAINTAINED WITH MINIMAL MOISTURE LOSS AT A RELATIVELY CONSTANT TEMPERATURE FOR A PERIOD OF TIME NECESSARY FOR THE HYDRATION OF THE CEMENT AND PROPER HARDENING OF THE CONCRETE.
- B. CURING SHALL IMMEDIATELY FOLLOW THE FINISH OPERATION. CONCRETE SHALL BE KEPT CONTINUOUSLY MOIST AT LEAST OVERNIGHT, IMMEDIATELY FOLLOWING THE INITIAL CURING. BEFORE THE CONCRETE HAS DRIED, ADDITIONAL CURING SHALL BE ACCOMPLISHED BY ONE OF THE FOLLOWING MATERIALS OR METHODS:
  - 1. PONDING OR CONTINUOUS SPRINKLING
  - 2. ABSORPTIVE MAT OR FABRIC KEPT CONTINUOUSLY WET
  - 3. NON-ABSORPTIVE FILM (POLYETHYLENE) OVER A PREVIOUSLY SPRINKLED SURFACE
  - 4. SAND OR OTHER COVERING KEPT CONTINUOUSLY WET
  - 5. CONTINUOUS STEAM (NOT EXCEEDING 150 DEGREES F) OR VAPOR MIST BATH.
  - 6. SPRAYED-ON CURING COMPOUND APPLIED IN TWO COATES, SPRAYED IN PERPENDICULAR DIRECTIONS.
- C. THE FINAL CURING SHALL CONTINUE UNTIL THE CUMULATIVE NUMBER OF DAYS OR FRACTION THEREOF, NOT NECESSARILY CONSECUTIVE, DURING WHICH TEMPERATURE OF THE AIR IN CONTACT WITH CONCRETE IS ABOVE 50 DEGREES F HAS TOTALED SEVEN (7) DAYS. CONCRETE SHALL NOT BE PERMITTED TO FREEZE DURING THE CURING PERIOD. RAPID DRYING AT THE END OF THE CURING PERIOD SHALL BE PREVENTED.

END OF SECTION

STAMP:

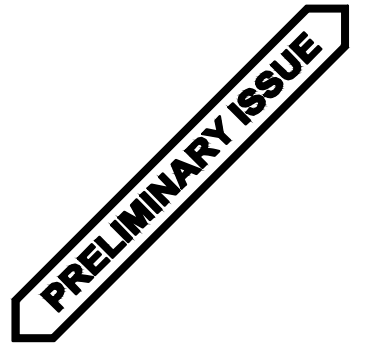

ENGINEERING LICENSE:			
STATE OF MISSOURI			
STATE CERTIFICATE OF AUTHORIZATION # EF-2791			
ENGINEER:	PE#:	DISCIPLINE:	
C/O CHRISTOPHER GIANNOTTI	PE-2020038653	CIVIL	C
REJ ROBERT E. JENSEN	PE-028974	CIVIL	C
PMS PHILIP M. SWOBODA	PE-2024040585	CIVIL	C
SDK SHELTON D. KEISLING	PE-27323	ELECTRICAL	E
DJW DAVID J. WALDRON	PE-2024034789	ELECTRICAL	E
TMS TERRANCE M. SUPER	PE-18521	ELECTRICAL	E

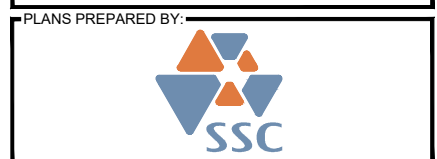

**DRAWING NOTICE:**  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:				
	DESCRIPTION	DATE	BY	REV
	ISSUED FOR REVIEW	10/14/25	DSL	A
	REISSUED FOR REVIEW	10/23/25	DSL	B
	REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
**LEES SUMMIT**

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION:	SHEET #:
SPECIFICATIONS (2 OF 7)	SP-1.1

**UNIT MASONRY**

**PART 1: GENERAL**

**1.1 SUMMARY:**

- A. PROVIDE UNIT MASONRY CONSTRUCTION AS INDICATED ON THE DRAWINGS.

**PART 2: PRODUCTS**

**2.1 MATERIALS:**

**A. CLAY MASONRY UNITS:**

1. APPLICATION: BRICK AND CONCRETE BLOCK CAVITY WALLS.
2. SIZE: STANDARD MODULAR, 3-5/8" THICK BY 2-1/4" HIGH BY 7-5/8" LONG OR AS INDICATED ON DRAWINGS.
3. TYPE: ASTM C 216, TYPE FBS, FOR GENERAL EXPOSED USE, OR AS INDICATED ON DRAWINGS. GRADE SHALL BE SW, UNLESS NOTED OTHERWISE ON DRAWINGS.
4. SPECIAL SHAPES: AS REQUIRED BY BUILDING CONFIGURATION. OR AS INDICATED ON DRAWINGS
5. BOND PATTERN: RUNNING BOND

**B. CONCRETE MASONRY UNITS:**

1. CONCRETE MASONRY UNITS: HOLLOW, LOAD-BEARING, NORMAL WEIGHT, ASTM C 90, GRADE N, TYPE 1, 1500 F'M COMPRESSIVE STRENGTH:
  - a. MEDIUM WEIGHT
2. SIZE: 7-5/8" HIGH BY 15-5/8" LONG BY EITHER 7-5/8" OR 11-5/8" THICK OR AS INDICATED ON DRAWINGS.
3. SPECIAL SHAPES: AS REQUIRED BY BUILDING CONFIGURATION.
4. BOND PATTERN: RUNNING BOND UNLESS NOTED OR SHOWN DIFFERENTLY ON DRAWINGS.

**C. LIMESTONE/PRECAST TRIM UNITS:**

1. GRADE AND COLOR: AS SHOWN ON DRAWINGS
2. FINISH: AS IDENTIFIED ON DRAWINGS

**D. MORTAR AND GROUT FOR BRICK AND CONCRETE MASONRY UNIT ASSEMBLIES:**

1. MORTAR MIX: ASTM C 270, TYPE S, FOR REINFORCED MASONRY, MASONRY BELOW GRADE AND MASONRY IN CONTACT WITH EARTH AND ASTM C 270, TYPE N, FOR ABOVE-GRADE LOADBEARING AND NONLOADBEARING WALLS. PORTLAND CEMENT SHALL CONFORM TO ASTM C150, TYPE 1. MASONRY CEMENT SHALL CONFORM TO ASTM C91. FINE AGGREGATE SHALL CONFORM TO ASTM C144.
2. MORTAR COLOR: NATURAL COLOR UNLESS NOTED OTHERWISE ON DRAWINGS.
3. GROUT: ALL GROUT FOR FILLING BOND BEAMS AND REINFORCED CELLS SHALL CONFORM TO NON-AIR ENTRAINED GROUT PER ASTM C476 WITH PORTLAND CEMENT PER ASTM C150, TYPE 1, AND FINE AND COARSE AGGREGATE PER ASTM C404.

**E. REINFORCING STEEL:**

1. REINFORCING BARS: ASTM A 615, GRADE 60.
2. WELDED WIRE FABRIC: ASTM A 185, PLAIN.

**F. REINFORCING: WELDED WIRE WITH DEFORMED SIDE RODS.**

1. STEEL WIRE: 9 GAUGE (.1875 INCH) GALVANIZED STEEL.
2. TRUSS TYPE

**G. TIES AND ANCHORS:**

1. BENT WIRE TIES: GALVANIZED STEEL.
2. RIGID ANCHORS: GALVANIZED STEEL STRAPS.

**PART 3: EXECUTION**

**3.1 INSTALLATION:**

**A. INSTALLATION OF MASONRY ASSEMBLIES:**

1. COMPLY WITH PCA RECOMMENDED PRACTICES FOR LAYING CONCRETE BLOCK, BRICK INSTITUTE OF AMERICA BIA TECH NOTES, AND NCMA TEK BULLETINS.
2. COMPLY WITH COLD WEATHER AND WARM WEATHER PROTECTION PROCEDURES AS RECOMMENDED IN BIA TECH NOTES.

END OF SECTION

**STRUCTURAL STEEL FRAMING**

**PART 1: GENERAL**

**1.1 SUMMARY:**

- A. PROVIDE STRUCTURAL STEEL ASSEMBLIES, FABRICATIONS, AND ERECTION OF STEEL AND OTHER ITEMS AS SHOWN ON THE DRAWINGS OR REQUIRED FOR A COMPLETE INSTALLATION.

**1.2 QUALITY ASSURANCE:**

- A. COMPLY WITH ALL APPLICABLE GOVERNING CODES AND REGULATIONS. PROVIDE PRODUCTS OF ACCEPTABLE MANUFACTURERS, WHICH HAVE BEEN IN SATISFACTORY USE IN SIMILAR SERVICE FOR THREE YEARS. USE EXPERIENCED INSTALLERS. DELIVER, HANDLE, AND STORE MATERIALS IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
- B. STANDARDS: AISC, CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES, AND APPLICABLE REGULATIONS.
- C. ARCHITECTURALLY EXPOSED STRUCTURAL STEEL: COMPLY WITH FABRICATION REQUIREMENTS, INCLUDING TOLERANCE LIMITS, AND INSTALLATION TOLERANCES OF AISC'S "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES" FOR STRUCTURAL STEEL.
- D. ERECTION TOLERANCES: AISC STANDARDS.

**1.3 SUBMITTALS:**

- A. SUBMIT FABRICATION AND ERECTION DRAWINGS SHOWING ALL DETAILS, CONNECTIONS, MATERIAL DESIGNATIONS, AND ALL TOP OF STEEL ELEVATIONS TO ENGINEER FOR APPROVAL.
- B. WELDERS SHALL BE QUALIFIED AS PRESCRIBED IN AWS D1.1.

**PART 2: PRODUCTS**

**2.1 MATERIALS:**

**A. STRUCTURAL STEEL:**

1. STRUCTURAL STEEL SHAPES, PLATES, AND BARS: ASTM A 572, ASTM A-36.
2. COLD-FORMED STEEL TUBING: ASTM A 500, GRADE B.
3. STEEL PIPE: ASTM A 53, TYPE E OR S, GRADE B; OR ASTM A 501.
4. ANCHOR BOLTS: ASTM A 307, NON-HEADED TYPE
5. COMMON (MACHINE) BOLTS SHALL CONFORM TO ASTM A307 GRADE A AND NUTS TO ASTM A563. ONE COMMON BOLT ASSEMBLY SHALL CONSIST OF A BOLT, A HEAVY HEX NUT, AND A HARDENED WASHER. BOLTS AND NUTS TO BE HOT DIPPED GALVANIZED PER ASTM A153 IF EXPOSED.
6. HIGH STRENGTH BOLTS SHALL CONFORM TO ASTM A325 OR A490, AS APPLICABLE. ONE HIGH STRENGTH BOLT ASSEMBLY SHALL CONSIST OF A HEAVY HEX STRUCTURAL BOLT, A HEAVY HEX NUT, AND A HARDENED WASHER CONFORMING TO ASTM F436. THE HARDENED WASHER SHALL BE INSTALLED AGAINST THE ELEMENT TURNED IN TIGHTENING. BOLTS AND NUTS TO BE HOT-DIP GALVANIZED PER ASTM A153 IF EXPOSED.

**7. AUXILIARY MATERIALS:**

- a. DIRECT TENSION INDICATORS: ASTM A 959
- b. ELECTRODES FOR WELDING: AWS CODE; E70XX

**8. GROUTS:**

- a. CEMENT GROUT: PORTLAND CEMENT, SAND.
- b. METALLIC SHRINKAGE-RESISTANT GROUT: PREMIXED FERROUS AGGREGATE GROUTING COMPOUND ASTM C 1107.
- c. NONMETALLIC SHRINKAGE-RESISTANT GROUT: PREMIXED NONMETALLIC GROUTING COMPOUND, ASTM C 1107.

**B. SHOP PAINTING**

1. GENERAL: ALL STRUCTURAL STEEL MATERIALS EXPOSED TO THE ELEMENTS SHALL BE HOT DIPPED GALVANIZED PER ASTM 123. ALL OTHER STRUCTURAL STEEL SHALL BE SHOP PRIMED.
  - a. DO NOT PAINT SURFACES TO BE WELDED OR HIGH-STRENGTH BOLTED WITH FRICTION-TYPE CONNECTIONS.
  - b. DO NOT PAINT SURFACES SCHEDULED TO RECEIVE SPRAYED-ON FIREPROOFING.
2. STRUCTURAL STEEL FACTORY APPLIED PRIMER PAINT (FOR NON-GALVANIZED MATERIALS): STANDARD RED OXIDE, LEAD AND CHROMATE-FREE, NON-ASHPALTIC, RUST-INHIBITING PRIMER COMPLYING WITH FS TT-P-664

3. ZINC COATED (HOT DIP GALVANIZED) PER ASTM A123 (AFTER FABRICATION): TOUCH-UP AFTER ERECTION: CLEAN AND WIRE BRUSH ANY ABRADED AND OTHER SPOTS WORN THROUGH ZINC COATING, INCLUDING THREADED PORTIONS OF BOLTS AND WELDS AND TOUCH-UP WITH GALVANIZING REPAIR PAINT.

**C. FIELD PAINTING: REPAIR / TOUCH-UP OF DAMAGED GALVANIZED OR PRIMED SURFACES:**

- a. FOR GALVANIZED SURFACES, USE ORGANIC ZINC-RICH COATING MATCHING THE APPEARANCE OF HOT-DIP GALVANIZING CONTAINING AT LEAST 65% - 69% OR ABOVE 92% METALLIC ZINC. BY WEIGHT IN THE DRY FILM, MEETING THE PERFORMANCE REQUIREMENTS OF THE FOLLOWING: ASTM A 780-01, DOD-P-21035B, MIL-P-46105, AND SSPC PS-12, PS-12.01, PS-20, PS-22, PS-29 AND PS-30
- b. FOR PRIMED SURFACES, CLEAN ALL SURFACES AND RE-PRIME PER RECOMMENDATIONS OF ORIGINAL PRIME MATERIALS.

**PART 3: EXECUTION**

**3.1 FABRICATION:**

**A. SHOP FABRICATE AND ASSEMBLE MATERIALS AS SPECIFIED HEREIN:**

1. FABRICATE ITEMS IN ACCORDANCE WITH THE AISC-ASD SPECIFICATIONS
2. ALL EXPOSED STRUCTURAL STEEL SHALL BE HOT DIP GALVANIZED PER ASTM A123
3. PROPERLY MARK AND MATCH-MARK MATERIALS FOR FIELD ASSEMBLY AND FOR IDENTIFICATION AS TO LOCATION FOR WHICH INTENDED
4. FABRICATE AND DELIVER IN A SEQUENCE WHICH WILL EXPEDITE ERECTION AND MINIMIZE FIELD HANDLING OF MATERIALS.
5. PROVIDE FINISH SURFACE OF MEMBERS EXPOSED IN THE FINAL STRUCTURE FREE FROM MARKINGS, BURRS, AND OTHER DEFECTS.

**B. CONNECTIONS**

1. PROVIDE BOLTS AND WASHERS OF TYPES AND SIZE REQUIRED FOR COMPLETION OF FIELD ERECTION. USE 3/4" DIAMETER A325 N BOLTS UNLESS NOTED OTHERWISE.
2. INSTALL HIGH STRENGTH THREADED FASTENERS IN ACCORDANCE WITH RCSC "SPECIFICATIONS FOR STRUCTURAL JOINTS" USING ASTM A325 N OR ASTM A490 BOLTS.
3. WELDED CONSTRUCTION SHALL COMPLY WITH AWS D1.1 FOR PROCEDURES, APPEARANCE, QUALITY OF WELDS, AND METHODS USED IN CORRECTING WELDED WORK.
4. THE FABRICATOR SHALL FURNISH AND INSTALL ERECTION CLIPS FOR FIT-UP OF WELDED CONNECTIONS.
5. DOUBLE ANGLE MEMBERS SHALL HAVE WELDED FILLERS SPACED IN ACCORDANCE WITH CHAPTER E4 OF THE AISC-ASD SPECIFICATION.
6. GUSSET AND STIFFENER PLATES SHALL BE 3/8" THICK MINIMUM.

**3.2 INSTALLATION:**


- A. INSTALLATION OF STRUCTURAL STEEL SHALL COMPLY WITH AISC "CODE OF STANDARD PRACTICE".
- B. STRUCTURAL FIELD WELDING SHALL BE DONE BY THE ELECTRIC SUBMERGED OR SHIELDED METAL ARC PROCESS. WELDED CONSTRUCTION SHALL COMPLY WITH AWS D1.1
- C. PROVIDE TEMPORARY SHORING AND BRACING WITH CONNECTIONS OF SUFFICIENT STRENGTH TO BEAR IMPOSED LOADS. REMOVE WHEN FINAL CONNECTIONS HAVE BEEN MADE.
- D. ALIGN AND ADJUST MEMBERS AS REQUIRED PRIOR TO FINAL INSPECTION.
- E. INSTALL AND FULLY TENSION HIGH STRENGTH THREADED FASTENERS IN ACCORDANCE WITH RCSC, "SPECIFICATIONS FOR STRUCTURAL JOINTS" USING ASTM A 325 N OR ASTM A 490 BOLTS.

**3.3 FINAL INSPECTION:**

- A. CLEAN ALL SURFACES UPON COMPLETION OF WORK.
- B. COMPLY WITH AISC CODES AND SPECIFICATIONS, AND WITH AWS "STRUCTURAL WELDING CODE".
- C. TOUCH-UP FIELD WELDS AND ABRADED AREAS AS REQUIRED.

END OF SECTION

STAMP:

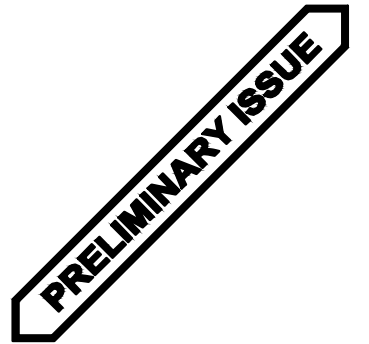

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE# DISCIPLINE:  
CJ CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
REJ ROBERT E. JENSEN PE-028974 CIVIL C  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E



DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:	DESCRIPTION	DATE	BY	REV
	ISSUED FOR REVIEW	10/14/25	DSL	A
	REISSUED FOR REVIEW	10/23/25	DSL	B
	REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
  
LEES SUMMIT

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: SPECIFICATIONS (3 OF 7)	SHEET #: SP-1.2
--	--------------------

**EARTH MOVING/EXCAVATION/BACKFILLING SECTION**

**PART 1: GENERAL**

**1.1 SUMMARY:**

- A. PROVIDE EARTHWORK OPERATIONS INCLUDING BUT NOT LIMITED TO EXCAVATION, GRADING, TRENCHING AND COMPACTION.

**1.2 QUALITY ASSURANCE COMPACTION:**

- A. UNDER STRUCTURES, BUILDING SLABS, STEPS, PAVEMENTS, AND WALKWAYS, 95% MAXIMUM DENSITY, ASTM D 1557.
  - 1. GRADING TOLERANCES:
    - a. LAWNS, UNPAVED AREAS, AND WALKS, PLUS OR MINUS 1".
    - b. KEEP SITE FREE FROM ANY PONDING WATER
    - c. GRADING TOLERANCE FOR FILL UNDER BUILDING OR EQUIPMENT SLABS: PLUS OR MINUS 1/4" MEASURED WITH 10'-0" STRAIGHTEDGE.
  - 2. TESTING: FIELD TESTING OF EARTHWORK AND COMPACTION SHALL BE PERFORMED BY OWNER'S INDEPENDENT TESTING LAB. THIS WORK IS TO BE COORDINATED BY THE CONTRACTOR.
  - 3. ALL WORK SHALL BE INSPECTED AND RELEASED BY THE OWNER OR HIS AGENT WHO SHALL CARRY OUT THE GENERAL INSPECTION OF THE WORK AS SPECIFIED AND/OR CALLED OUT BY THE CONSTRUCTION DOCUMENTS. PROVIDE A MINIMUM OF 48 HOURS NOTICE PRIOR TO ANY PLACEMENT OF CONCRETE OR BACKFILLING OF TRENCHES. IT IS THE CONTRACTOR'S RESPONSIBILITY TO REQUEST TIMELY INSPECTIONS PRIOR TO PROCEEDING WITH FURTHER WORK THAT WOULD MAKE PARTS OF WORK INACCESSIBLE OR DIFFICULT TO INSPECT.
  - 4. EXISTING UTILITIES: DO NOT INTERRUPT EXISTING UTILITIES SERVING FACILITIES OCCUPIED BY THE OWNER OR OTHERS, EXCEPT WHEN PERMITTED IN WRITING BY OWNER OR HIS AGENT AND THEN ONLY AFTER ACCEPTABLE TEMPORARY UTILITY SERVICES HAVE BEEN PROVIDED.

**PART 2: PRODUCTS**

**2.1 GENERAL:**

- A. UTILITY TRENCH: PROVIDE WELL GRADED SAND (SW-SM) FROM BASE OF TRENCH TO MINIMUM ABOVE THE HIGHEST CONDUIT WITHIN TRENCH. REMAINDER OF TRENCH AREA CAN BE EITHER AB 3 OR CLEAN GRAVEL AS DESCRIBED HEREIN. COMPACT AS REQUIRED TO PREVENT SETTLING.
- B. ACCESS ROADS: 6" MINIMUM (UNLESS NOTED OTHERWISE ON DRAWINGS) COMPACTED AB 3 OR APPROVED EQUAL (UNWASHED CRUSHED LIMESTONE GRAVEL CONSISTING OF MULTIPLE AGGREGATE SIZES, ROCK CHIPS, AND ROCK DUST.)
- C. COMPOUND (NEW CONSTRUCTION): 2" THICK CLEAN GRAVEL, WITH 100% PASSING THROUGH A 1" SIEVE OVER 4" COMPACTED AB 3.
- D. COMPOUND (EXISTING): PROVIDE CLEAN GRAVEL WITH 100% PASSING THROUGH A 1" SIEVE AS REQUIRED TO BRING COMPOUND TO PROPER GRADE OR REPAIR EXISTING DAMAGED AREAS.
- E. STRUCTURAL FILL: PROVIDE 4" MINIMUM AB 3 BELOW STRUCTURES OR SLABS

**2.2 MATERIALS:**

- A. GEOTEXTILE FABRIC: PROVIDE MIRAFI 500X OR APPROVED EQUAL.
- B. PLASTIC MARKING TAPE: SHALL BE ACID AND ALKALI RESISTANT POLYETHYLENE FILM SPECIFICALLY MANUFACTURED FOR MARKING AND LOCATING UNDERGROUND UTILITIES, 6" WIDE WITH A MINIMUM THICKNESS OF 0.004". TAPE SHALL HAVE MINIMUM STRENGTH OF 1500 PSI IN BOTH DIRECTIONS AND MANUFACTURED WITH INTEGRAL WIRES OR OTHER MEANS TO ENABLE DETECTION BY A METAL DETECTOR WHEN BURIED UP TO 3'-0" DEEP. THE CORE OF THE TAPE SHALL BE ENCASED IN A PROTECTIVE JACKET OR OTHER MEANS TO PROTECT FROM CORROSION. TAPE COLOR SHALL BE RED FOR ELECTRIC UTILITIES AND ORANGE FOR TELECOMMUNICATION

**PART 3: EXECUTION**

**3.1 INSTALLATION:**

- A. PRIOR TO EXCAVATING, THOROUGHLY EXAMINE AREA TO BE EXCAVATED AND/OR TRENCHED TO VERIFY THE LOCATIONS OF FEATURES ON THE DRAWINGS AND TO ASCERTAIN THE EXISTENCE OF ANY STRUCTURE NOT SHOWN THAT MIGHT INTERFERE WITH NEW CONSTRUCTION. NOTIFY THE OWNER OR HIS AGENT OF ANY OBSTRUCTIONS THAT WILL PREVENT ACCOMPLISHMENT OF THE WORK AS INDICATED ON THE DRAWINGS.
- B. EXCAVATION IS UNCLASSIFIED AND INCLUDES EXCAVATION TO SUBGRADE REGARDLESS OF MATERIALS. REPAIR EXCAVATIONS BEYOND ELEVATIONS AND DIMENSIONS INDICATED AS REQUIRED.
- C. MAINTAIN STABILITY OF EXCAVATIONS; COORDINATE SHORING AND BRACING AS REQUIRED BY AUTHORITIES HAVING JURISDICTION. PREVENT SURFACE AND SUBSURFACE WATER FROM ACCUMULATING IN EXCAVATIONS. STOCKPILE SATISFACTORY MATERIALS FOR REUSE, ALLOW FOR PROPER DRAINAGE.

- D. COMPACT MATERIALS AT THE OPTIMUM MOISTURE CONTENT AS DETERMINED BY ASTM D 1557 BY AERATION OR WETTING TO 95% OF MAXIMUM DRY DENSITY TO SUITABLE DEPTH.
- E. PLACE ACCEPTABLE MATERIALS IN LAYERS NOT MORE THAN 8" LOOSE DEPTH FOR MATERIALS COMPACTED BY HEAVY EQUIPMENT AND NOT MORE THAN 4" LOOSE DEPTH FOR MATERIALS COMPACTED BY HAND EQUIPMENT TO SUBGRADES INDICATED AS FOLLOWS:
  - 1. STRUCTURAL FILL: USE UNDER FOUNDATIONS, SLABS ON GRADE IN LAYERS AS INDICATED.
  - 2. DRAINAGE FILL: USE UNDER DESIGNATED BUILDING SLABS, AT FOUNDATION DRAINAGE AND ELSEWHERE AS INDICATED.
  - 3. COMMON FILL: USE UNDER UNPAVED AREAS.
  - 4. SUBBASE MATERIAL: USE UNDER GENERAL COMPOUND AREA. IF THICKNESS OF LIFT IS GREATER THAN 6" SPREAD AND COMPACT THE CRUSHED STONE IN MULTIPLE LIFTS OF EQUAL THICKNESS WITH A MAXIMUM LIFT OF 6"
- F. GRADE TO 1/2" ABOVE OR BELOW REQUIRED SUBGRADE AND TO A TOLERANCE OF 1/4" IN 10'-0".
- G. PROTECT NEWLY GRADED AREAS FROM TRAFFIC AND EROSION. RE-COMPACT AND RE-GRADE SETTLED, DISTURBED AND DAMAGED AREAS TO RESTORE QUALITY, APPEARANCE, AND CONDITION.
- H. CONTROL EROSION TO PREVENT RUNOFF INTO SEWERS OR DAMAGE TO AREAS.
- I. CONTROL DUST TO PREVENT HAZARDS TO ADJACENT PROPERTIES AND VEHICLES. IMMEDIATELY REPAIR OR REMEDY DAMAGE CAUSED BY DUST INCLUDING AIR FILTERS IN EQUIPMENT AND VEHICLES. CLEAN SOILED SURFACES.
- J. DISPOSE OF WASTE AND UNSUITABLE MATERIALS OFF-SITE IN A LEGAL MANNER.

**3.2 BACKFILL:**

- A. AS SOON AS PRACTICAL AFTER COMPLETING CONSTRUCTION OF THE RELATED STRUCTURE, INCLUDING THE SPECIFIED MINIMUM CURING PERIOD FOR CAST-IN-PLACE CONCRETE, BACKFILL THE EXCAVATION WITH APPROVED MATERIAL TO RESTORE THE REQUIRED FINISHED GRADE.
  - 1. PRIOR TO PLACING BACKFILL AROUND STRUCTURES, ALL FORMS SHALL HAVE BEEN REMOVED AND THE EXCAVATION CLEANED OF ALL TRASH, DEBRIS, AND UNSUITABLE MATERIALS.
  - 2. BACKFILL BY PLACING AND COMPACTING SUITABLE BACKFILL MATERIAL OR SELECT GRANULAR BACKFILL MATERIAL, WHEN REQUIRED IN UNIFORM HORIZONTAL LAYERS OF NO GREATER THAN 8" LOOSE THICKNESS. WHERE HAND OPERATED COMPACTORS ARE USED, THE FILL MATERIAL SHALL BE PLACED IN LIFTS NOT TO EXCEED 4" IN LOOSE DEPTH.
  - 3. IF THE DENSITY TESTING INDICATES THAT THE SPECIFIED DENSITY, THE SUCCEEDING LAYER SHALL NOT BE PLACED UNTIL THE SPECIFICATION REQUIREMENTS ARE MET UNLESS AUTHORIZED BY THE GEO-TECHNICAL ENGINEER. THE CONTRACTOR SHALL TAKE WHATEVER APPROPRIATE ACTION IS NECESSARY TO OBTAIN PROPER COMPACTION.
- B. COMPACT EACH LAYER OF BACKFILL TO A MINIMUM OF 95% OF THE MAXIMUM DRY DENSITY AS PROVIDED BY THE STANDARD PROCTOR TEST, ASTM D 698.

**3.3 TRENCH EXCAVATION:**

- A. UTILITY TRENCHES SHALL BE EXCAVATED TO THE LINES AND GRADES SHOWN ON THE DRAWINGS OR AS DIRECTED BY THE OWNER OR HIS AGENT. PROVIDE SHORING, SHEETING AND BRACING AS REQUIRED TO PREVENT CAVING OR SLOUGHING OF THE TRENCH WALLS.
- B. EXTEND THE TRENCH WIDTH A MINIMUM OF 6" BEYOND THE OUTSIDE EDGE OF THE OUTER-MOST CONDUIT.
- C. WHEN SOFT, YIELDING, OR OTHERWISE UNSTABLE SOIL CONDITIONS ARE ENCOUNTERED, BACKFILL AT THE REQUIRED TRENCH TO A DEPTH OF NO LESS THAN 12" BELOW THE REQUIRED ELEVATION AND BACKFILL WITH GRANULAR BEDDING MATERIAL.

**3.4 TRENCH BACKFILL:**

- A. PROVIDE GRANULAR BEDDING MATERIAL (WELL GRADED SAND) IN ACCORDANCE WITH THE DRAWINGS AND THE UTILITY REQUIREMENTS.
- B. NOTIFY THE OWNER OR HIS AGENT 24 HOURS IN ADVANCE OF BACKFILLING.
- C. CONDUCT UTILITY CHECK TESTS BEFORE BACKFILLING. BACKFILL AND COMPACT TRENCH BEFORE ACCEPTANCE TESTING.
- D. PLACE GRANULAR TRENCH BACKFILL UNIFORMLY ON BOTH SIDES OF THE CONDUITS IN 6" UNCOMPACTED LIFTS UNTIL 6" OVER THE CONDUITS. SOLIDLY RAM AND TAMP BACKFILL INTO SPACES AROUND CONDUITS.
- E. PROTECT CONDUIT FROM LATERAL MOVEMENT, IMPACT DAMAGE, OR UNBALANCED LOADING.

- F. ABOVE THE CONDUIT EMBEDMENT ZONE, PLACE AND COMPACT BACKFILL MATERIAL IN 8" MAXIMUM LOOSE THICKNESS LIFTS TO RESTORE THE REQUIRED FINISHED SURFACE GRADE.
- G. COMPACT FINAL TRENCH BACKFILL TO A DENSITY EQUAL TO OR GREATER THAN EXISTING UNDISTURBED MATERIAL ADJACENT TO THE TRENCH BUT NO LESS THAN A MINIMUM OF 95% OF THE MAXIMUM DRY DENSITY AS PROVIDED BY THE STANDARD PROCTOR TEST, ASTM D 698.

**3.5 AGGREGATE ACCESS ROAD (IF APPLICABLE):**


- A. CLEAR, GRUB, STRIP AND EXCAVATE FOR ACCESS ROAD TO THE LINES AND GRADES INDICATED ON DRAWINGS. SCARIFY TO A DEPTH OF 6" AND PROOF-ROLL ALL HOLES, RUTS, SOFT PLACES AND OTHER DEFECTS.
- B. THE ENTIRE SUBGRADE SHALL BE COMPACTED TO NOT LESS THAN 95% OF THE MAXIMUM DRY DENSITY AS PROVIDED BY THE STANDARD PROCTOR TEST, ASTM D 1557.
- C. AFTER PREPARATION OF THE SUBGRADE IS COMPLETE, THE GEOTEXTILE FABRIC (MIRAFI 500X) SHALL BE INSTALLED TO THE LIMITS INDICATED ON DRAWINGS BY ROLLING THE FABRIC OUT LONGITUDINALLY ALONG ROADWAY. THE FABRIC SHALL NOT BE DRAGGED ACROSS THE SUBGRADE. PLACE THE ENTIRE ROLL IN A SINGLE OPERATION, AS SMOOTHLY AS POSSIBLE.
  - 1. OVERLAPS PARALLEL TO THE ROADWAY WILL BE PERMITTED AT THE CENTERLINE AND AT LOCATIONS BEYOND THE ROADWAY SURFACE WIDTH. NO LONGITUDINAL OVERLAPS SHALL BE LOCATED BETWEEN THE CENTERLINE AND THE SHOULDER. PARALLEL OVERLAPS SHALL BE A MINIMUM OF 3'-0" WIDE.
  - 2. TRANSVERSE OR PERPENDICULAR OVERLAPS AT THE END OF A ROLL SHALL OVERLAP IN THE DIRECTION OF THE AGGREGATE PLACEMENT (PREVIOUS ROLL ON TOP) AND SHALL HAVE A MINIMUM LENGTH OF 3'-0".
  - 3. ALL OVERLAPS SHALL BE PINNED WITH STAPLES OR NAILS BETWEEN 10" AND 12" LONG TO INSURE POSITIONING DURING PLACEMENT OF AGGREGATE. PIN LONGITUDINAL SEAMS AT 25'-0" O.C. AND TRANSVERSE SEAMS EVERY 5'-0" O.C.
- D. THE AGGREGATE BASE AND SURFACE COURSES SHALL BE CONSTRUCTED IN LAYERS NOT MORE THAN 6" (COMPACTED) THICKNESS. AGGREGATE TO BE PLACED ON GEOTEXTILE FABRIC AND SHALL BE END-DUMPED ON THE FABRIC FROM THE FREE END OF THE FABRIC OR OVER PREVIOUSLY PLACED AGGREGATE. AT NO TIME SHALL EQUIPMENT BE PERMITTED ON THE ROADWAY WITH LESS THAN 6" OF MATERIAL COVERING THE FABRIC.
- E. THE AGGREGATE SHALL BE IMMEDIATELY COMPACTED TO NOT LESS THAN 95% OF THE MAXIMUM DRY DENSITY AS PROVIDED BY THE PROCTOR TEST, ASTM D 1557 WITH A TAMPING ROLLER, A PNEUMATIC-TIRED ROLLER, OR WITH A VIBRATORY MACHINE OR ANY COMBINATION OF THE ABOVE. THE TOP LAYER SHALL BE GIVEN A FINAL ROLLING WITH A THREE-WHEEL OR TANDEM ROLLER.

**3.6 FINISH GRADING:**

- A. PERFORM ALL GRADING TO PROVIDE SMOOTH, EVEN SURFACE DRAINAGE OF THE ENTIRE AREA WITHIN THE LIMITS OF CONSTRUCTION. GRADING SHALL BE COMPATIBLE WITH ALL SURROUNDING TOPOGRAPHY AND STRUCTURES.
- B. UTILIZE SATISFACTORY FILL MATERIALS RESULTING FROM THE EXCAVATION WORK IN THE CONSTRUCTION OF FILLS, EMBANKMENTS AND FOR THE REPLACEMENT OF REMOVED UNSUITABLE MATERIALS.
- C. ACHIEVE FINISHED GRADE BY PLACING A MINIMUM OF 6" OF AB 3 ON TOP OF SOIL STABILIZER FABRIC.
- D. REPAIR ALL ACCESS ROADS AND SURROUNDING AREAS USED DURING THE COURSE OF THIS WORK TO THEIR ORIGINAL CONDITION.

END OF SECTION

STAMP:

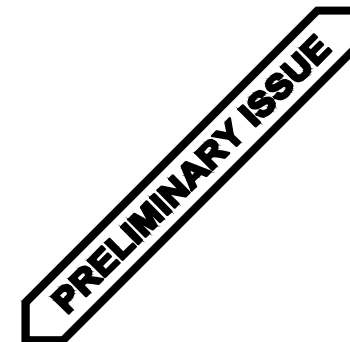

ENGINEERING LICENSE:  
STATE OF MISSOURI  
STATE CERTIFICATE OF AUTHORIZATION # EF-2791  
ENGINEER: PE# DISCIPLINE:  
C/O CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL C  
REJ ROBERT E. JENSEN PE-028974 CIVIL C  
PMS PHILIP M. SWOBODA PE-2024040585 CIVIL C  
SDK SHELTON D. KEISLING PE-27323 ELECTRICAL E  
DJW DAVID J. WALDRON PE-2024034789 ELECTRICAL E  
TMS TERRANCE M. SUPER PE-18521 ELECTRICAL E



DRAWING NOTICE:  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
  
LEES SUMMIT

SITE ADDRESS:  
  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: SPECIFICATIONS (4 OF 7) SHEET #: SP-1.3



**ELECTRICAL**

**PART 1: GENERAL**

**1.1 GENERAL CONDITIONS:**

- A. THE CONTRACTOR SHALL INSPECT THE SITE WHERE THIS WORK IS TO BE PERFORMED AND FULLY FAMILIARIZE HIMSELF WITH ALL CONDITIONS RELATED TO THIS PROJECT.
- B. THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS AND LICENSES AND SHALL MAKE ALL DEPOSITS AND PAY ALL FEES REQUIRED FOR THE PERFORMANCE OF WORK UNDER THIS SECTION.
- C. DRAWINGS SHOW THE GENERAL ARRANGEMENT OF ALL SYSTEMS AND COMPONENTS COVERED UNDER THIS SECTION. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS. DRAWINGS SHALL NOT BE SCALED TO DETERMINE DIMENSIONS.

**1.2 LAWS, REGULATIONS, ORDINANCES, STATUTES AND CODES:**

- A. ALL WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, AND ALL APPLICABLE LOCAL LAWS, REGULATIONS, ORDINANCES, STATUTES AND CODES.

**1.3 REFERENCES:**

- A. THE PUBLICATIONS LISTED BELOW FORM PART OF THIS SPECIFICATION. EACH PUBLICATION SHALL BE THE LATEST REVISION AND ADDENDUM IN EFFECT ON THE DATE THIS SPECIFICATION IS ISSUED FOR CONSTRUCTION UNLESS NOTED OTHERWISE. EXCEPT AS MODIFIED BY THE REQUIREMENTS SPECIFIED HEREIN OR THE DETAILS OF THE DRAWINGS, WORK INCLUDED IN THIS SPECIFICATION SHALL CONFORM TO THE APPLICABLE PROVISIONS OF THESE PUBLICATIONS.

1. NEC (NATIONAL ELECTRICAL CODE)
2. ANSI/IEEE (AMERICAN NATIONAL STANDARDS INSTITUTE)
3. IEEE (INSTITUTE OF ELECTRICAL AND ELECTRONICS ENGINEERS)
4. ASTM (AMERICAN SOCIETY FOR TESTING AND MATERIALS)
5. ICEA (INSULATED CABLE ENGINEERS ASSOCIATION)
6. NEMA (NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION)
7. NFPA (NATIONAL FIRE PROTECTION ASSOCIATION)
8. OSHA (OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION)
9. UL (UNDERWRITERS LABORATORIES, INC.)

**1.4 SCOPE OF WORK:**

- A. WORK UNDER THIS SECTION SHALL CONSIST OF FURNISHING ALL LABOR, MATERIAL AND ASSOCIATED SERVICES REQUIRED TO COMPLETELY CONSTRUCT AND LEAVE READY FOR OPERATION SYSTEMS AS SHOWN ON THE DRAWINGS AND HEREIN DESCRIBED.
- B. ALL ELECTRICAL EQUIPMENT UNDER THIS CONTRACT SHALL BE PROPERLY TESTED, ADJUSTED, AND ALIGNED BY THE CONTRACTOR.
- C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL EXCAVATING, DRAINING, TRENCHES, BACKFILLING, AND REMOVAL OF EXCESS DIRT.
- D. THE CONTRACTOR SHALL FURNISH TO THE OWNER, CERTIFICATES OF FINAL INSPECTION AND APPROVAL FROM THE INSPECTION AUTHORITIES HAVING JURISDICTION.

**PART 2: PRODUCTS**

**2.1 GENERAL:**

- A. ALL ITEMS OF MATERIALS AND EQUIPMENT SHALL BE NEW, FREE FROM DEFECTS AND OF THE BEST QUALITY NORMALLY USED FOR THE PURPOSE IN GOOD COMMERCIAL PRACTICE.
- B. ALL MATERIALS AND EQUIPMENT SHALL BE ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION AS SUITABLE FOR THE USE INTENDED.
- C. ALL EQUIPMENT SHALL BEAR THE UNDERWRITERS LABORATORIES LABEL OF APPROVAL, AND SHALL CONFORM TO REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE.
- D. ALL OVERCURRENT DEVICES SHALL HAVE AN INTERRUPTING RATING EQUAL TO OR GREATER THAN THE SHORT CIRCUIT CURRENT TO WHICH THEY ARE SUBJECTED, 10,000 AIC MINIMUM. VERIFY AVAILABLE SHORT CIRCUIT CURRENT DOES NOT EXCEED THE RATING OF ELECTRICAL EQUIPMENT.

**2.2 MATERIALS AND EQUIPMENT:**

**A. CONDUIT:**

1. RIGID GALVANIZED STEEL CONDUIT (RGS) SHALL BE HOT-DIP GALVANIZED INSIDE AND OUTSIDE INCLUDING ENDS AND THREADS AND ENAMELED OR LACQUERED INSIDE IN ADDITION TO GALVANIZING.
2. FLEXIBLE METAL CONDUIT SHALL BE GALVANIZED, ZINC-COATED STEEL, PVC COATED FOR OUTDOOR APPLICATIONS.
3. CONDUIT CLAMPS, STRAPS AND SUPPORTS SHALL BE STEEL OR MALLEABLE IRON. ALL FITTINGS SHALL BE COMPRESSION TYPE AND WATERTIGHT.
4. NON-METALLIC CONDUIT AND FITTINGS SHALL BE SCHEDULE 40 PVC, HEAVY-WALL RIGID WITH SOLVENT-CEMENT-TYPE JOINTS AS RECOMMENDED BY THE MANUFACTURER.

**B. WIRE AND CABLE:**

1. WIRE AND CABLE SHALL BE FLAME-RETARDANT, MOISTURE AND HEAT RESISTANT THERMOPLASTIC, SINGLE CONDUCTOR, COPPER, TYPE THHN/THWN-2, 600 VOLT, SIZES AS INDICATED, #12 AWG MINIMUM.
2. #10 AWG AND SMALLER CONDUCTORS SHALL BE SOLID AND #8 AWG AND LARGER CONDUCTORS SHALL BE STRANDED.
3. SOLDERLESS, PRESSURE-TYPE CONNECTORS CONSTRUCTED OF HIGH-STRENGTH, NON-CORRODIBLE, TIN-PLATED COPPER DESIGNED TO FURNISH HIGH-PULLOUT STRENGTH AND HIGH CONDUCTIVITY JOINTS SHALL BE USED.
4. SUPPORT GRIPS SHALL BE SINGLE WEAVE, CLOSED MESH, HIGH-GRADE, NON-MAGNETIC, TIN-COATED BRONZE CAPABLE OF SUPPORTING TEN TIMES THE CABLE DEAD WEIGHT, HUBBELL KELLEMS OR APPROVED EQUAL.

**C. DISCONNECT SWITCHES:**

1. DISCONNECT SWITCHES SHALL BE HEAVY DUTY, DEAD-FRONT, QUICK-MAKE, QUICK-BREAK, EXTERNALLY OPERABLE, HANDLE LOCKABLE AND INTERLOCKED WITH COVER IN CLOSED POSITION, RATING AS INDICATED, UL LABELED FURNISHED IN NEMA 3R ENCLOSURE, SQUARE D CLASS 3110 OR APPROVED EQUAL.


**D. SYSTEM GROUNDING:**

1. GROUNDING CONDUCTOR SHALL BE SOLID TINNED BARE COPPER, SIZE AS INDICATED, EXCEPT ABOVE GROUND GROUNDING CONDUCTORS SHALL BE STRANDED INSULATED.
2. GROUND BUSES SHALL BE GALVANIZED STEEL BARS OF RECTANGULAR CROSS SECTION.
3. CONNECTORS SHALL BE HIGH-CONDUCTIVITY, HEAVY DUTY, LISTED AND LABELED AS GROUNDING CONNECTORS FOR THE MATERIALS USED. USE TWO-HOLE COMPRESSION LUGS WITH HEAT SHRINK FOR MECHANICAL CONNECTIONS.
4. EXOTHERMIC WELDED CONNECTIONS SHALL BE PROVIDED IN KIT FORM AND SELECTED FOR THE SPECIFIC TYPES, SIZES, AND COMBINATIONS OF CONDUCTORS AND OTHER ITEMS TO BE CONNECTED.
5. GROUND RODS SHALL BE COPPER-CLAD STEEL WITH HIGH-STRENGTH STEEL CORE AND ELECTROLYTIC-GRADE COPPER OUTER SHEATH, MOLTEN WELDED TO CORE, 3/4" x 10'-0".

**E. OTHER MATERIALS:**

1. THE CONTRACTOR SHALL PROVIDE OTHER MATERIALS, THOUGH NOT SPECIFICALLY DESCRIBED, WHICH ARE REQUIRED FOR A COMPLETELY OPERATIONAL SYSTEM AND PROPER INSTALLATION OF THE WORK.

STAMP:

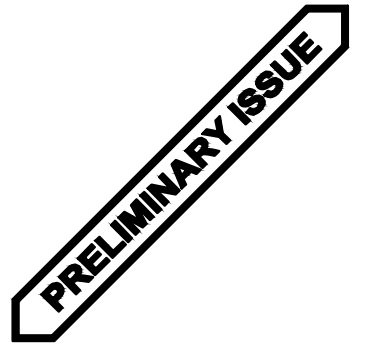

ENGINEERING LICENSE:			
STATE OF MISSOURI			
STATE CERTIFICATE OF AUTHORIZATION # EF-2791			
ENGINEER:	PE#:	DISCIPLINE:	
CO CHRISTOPHER GIANNOTTI	PE-2020038653	CIVIL	C
REJ ROBERT E. JENSEN	PE-028974	CIVIL	C
PMS PHILIP M. SWOBODA	PE-2024040585	CIVIL	C
SDK SHELTON D. KEISLING	PE-27323	ELECTRICAL	E
DJW DAVID J. WALDRON	PE-2024034789	ELECTRICAL	E
TMS TERRANCE M. SUPER	PE-18521	ELECTRICAL	E



**DRAWING NOTICE:**  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:				
	DESCRIPTION	DATE	BY	REV
	ISSUED FOR REVIEW	10/14/25	DSL	A
	REISSUED FOR REVIEW	10/23/25	DSL	B
	REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
  
LEES SUMMIT

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION:	SHEET #:
SPECIFICATIONS (6 OF 7)	SP-2.0

**PART 3: EXECUTION**

**3.1 GENERAL:**

- A. ALL MATERIALS AND EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- B. EQUIPMENT SHALL BE TIGHTLY COVERED AND PROTECTED AGAINST DIRT OR WATER, AND AGAINST CHEMICAL OR MECHANICAL INJURY DURING INSTALLATION AND CONSTRUCTION PERIODS.

**3.2 LABOR AND WORKMANSHIP:**

- A. ALL LABOR FOR THE INSTALLATION OF MATERIALS AND EQUIPMENT FURNISHED FOR THE ELECTRICAL SYSTEM SHALL BE DONE BY EXPERIENCED MECHANICS OF THE PROPER TRADES.
- B. ALL ELECTRICAL EQUIPMENT FURNISHED SHALL BE ADJUSTED, ALIGNED AND TESTED BY THE CONTRACTOR AS REQUIRED TO PRODUCE THE INTENDED PERFORMANCE.
- C. UPON COMPLETION OF THE WORK, THE CONTRACTOR SHALL THOROUGHLY CLEAN ALL EXPOSED EQUIPMENT, REMOVE ALL LABELS AND ANY DEBRIS, CRATING OR CARTONS AND LEAVE THE INSTALLATION FINISHED AND READY FOR OPERATION.

**3.3 COORDINATION:**

- A. THE CONTRACTOR SHALL COORDINATE THE INSTALLATION OF ELECTRICAL ITEMS WITH THE OWNER-FURNISHED EQUIPMENT DELIVERY SCHEDULE TO PREVENT UNNECESSARY DELAYS IN THE TOTAL WORK.

**3.4 INSTALLATION:**

- A. CONDUIT:
  1. ALL ELECTRICAL WIRING SHALL BE INSTALLED IN CONDUIT AS HEREIN SPECIFIED. NO CONDUIT OR TUBING OF LESS THAN 3/4" NOMINAL SIZE SHALL BE USED.
  2. PROVIDE RGS CONDUIT FOR ALL EXPOSED, EXTERIOR CONDUIT.
  3. PROVIDE SCHEDULE 40 PVC OR RGS CONDUIT BELOW GRADE, 1" MINIMUM, UNLESS NOTED OTHERWISE. ALL 90 DEGREE BENDS TO ABOVE GRADE SHALL BE RGS. MINIMUM BURIAL DEPTH SHALL BE 24" CLEAR TO TOP OF CONDUIT, UNLESS NOTED OTHERWISE.
  4. USE GALVANIZED FLEXIBLE STEEL CONDUIT WHERE DIRECT CONNECTION IS NOT DESIRABLE FOR REASONS OF EQUIPMENT MOVEMENT, VIBRATION, OR FOR EASE OF MAINTENANCE. USE LIQUIDTIGHT, PVC COATED FLEXIBLE METAL CONDUIT FOR OUTDOOR APPLICATIONS.
  5. INSTALL GALVANIZED FLEXIBLE STEEL CONDUIT AT ALL POINTS OF CONNECTION TO EQUIPMENT MOUNTED ON SUPPORTS TO ALLOW FOR EXPANSION AND CONTRACTION.
  6. A RUN OF CONDUIT BETWEEN BOXES OR FITTINGS SHALL NOT CONTAIN MORE THAN THE EQUIVALENT OF FOUR QUARTER-BENDS INCLUDING THOSE BENDS LOCATED IMMEDIATELY AT THE BOX OR FITTING. THE RADIUS OF BENDS SHALL NEVER BE SHORTER THAN THAT OF THE CORRESPONDING TRADE ELBOW.
  7. WHERE CONDUIT HAS TO BE CUT IN THE FIELD, IT SHALL BE CUT SQUARE WITH A PIPE CUTTER USING CUTTING KNIVES.
  8. ALL CONDUITS SHALL BE SWABBED CLEAN BY PULLING AN APPROPRIATE SIZE MANDREL THROUGH THE CONDUIT BEFORE INSTALLATION OF WIRE OR CABLE. CLEAR ALL BLOCKAGES AND REMOVE BURRS, DIRT, AND DEBRIS.
  9. INSTALL PULL STRINGS IN ALL EMPTY CONDUITS. IDENTIFY PULL STRINGS AT EACH END WITH ITS DESTINATION.
  10. PROVIDE INSULATED GROUNDING BUSHINGS FOR ALL CONDUITS STUBBED INTO EQUIPMENT ENCLOSURES OR STUBBED OUT FOR FUTURE USE BY OTHERS.
  11. CONTRACTOR IS RESPONSIBLE FOR PROTECTING ALL CONDUITS DURING CONSTRUCTION. TEMPORARY OPENINGS IN THE CONDUIT SYSTEM SHALL BE PLUGGED OR CAPPED TO PREVENT ENTRANCE OF MOISTURE OR FOREIGN MATTER. CONTRACTOR SHALL REPLACE ANY CONDUITS CONTAINING FOREIGN MATERIALS THAT CANNOT BE REMOVED.
  12. INSTALL 2" ORANGE DETECTABLE TAPE 12" ABOVE ALL UNDERGROUND CONDUIT AND WIRE.
  13. CONDUITS SHALL BE INSTALLED IN SUCH A MANNER AS TO INSURE AGAINST COLLECTION OF TRAPPED CONDENSATION.

**B. WIRE AND CABLE:**

- 1. ALL POWER WIRING SHALL BE COLOR CODED AS FOLLOWS:

DESCRIPTION	120/240V	208Y/120V	480Y/277V
PHASE A	BLACK	BLACK	BROWN
PHASE B	RED	RED	ORANGE
PHASE C		BLUE	YELLOW
NEUTRAL	WHITE	WHITE	GRAY
GROUND	GREEN	GREEN	GREEN

- 2. SPLICES SHALL BE MADE ONLY AT OUTLETS, JUNCTION BOXES, OR ACCESSIBLE RACEWAYS WITH PRESSURE-TYPE CONNECTORS.
- 3. PULLING LUBRICANTS SHALL BE SOAPSTONE POWDER, POWDERED TALC, OR A COMMERCIAL PULLING COMPOUND. NO SOAP SUDS, SOAP FLAKES, OIL, OR GREASE SHALL BE USED, AS THESE MAY BE HARMFUL TO CABLE INSULATION. CONTRACTOR SHALL USE NYLON OR HEMP ROPE FOR PULLING CABLE TO AVOID SCORING THE CONDUIT.
- 4. CABLES SHALL BE NEATLY TRAINED, WITHOUT INTERLACING, AND BE OF SUFFICIENT LENGTH IN ALL BOXES, EQUIPMENT, ETC. TO PERMIT MAKING A NEAT ARRANGEMENT. CABLES SHALL BE SECURED IN A MANNER TO AVOID TENSION ON CONDUCTORS OR TERMINALS, AND SHALL BE PROTECTED FROM MECHANICAL INJURY AND FROM MOISTURE. SHARP BENDS OVER CONDUIT BUSHINGS ARE PROHIBITED. DAMAGED CABLES SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.

**C. DISCONNECT SWITCHES:**

- 1. INSTALL DISCONNECT SWITCHES LEVEL AND PLUMB. CONNECT TO WIRING SYSTEM AND GROUND AS INDICATED.

**D. GROUNDING:**

- 1. ALL METALLIC PARTS OF ELECTRICAL EQUIPMENT WHICH DO NOT CARRY CURRENT SHALL BE GROUNDED IN ACCORDANCE WITH THE REQUIREMENTS OF ARTICLE 250 OF THE NATIONAL ELECTRICAL CODE.
- 2. PROVIDE ELECTRICAL GROUNDING AND BONDING SYSTEMS INDICATED WITH ASSEMBLY OF MATERIALS, INCLUDING GROUNDING ELECTRODES, BONDING JUMPERS AND ADDITIONAL ACCESSORIES AS REQUIRED FOR A COMPLETE INSTALLATION.
- 3. ROUTE GROUNDING CONNECTIONS AND CONDUCTORS TO GROUND IN THE SHORTEST AND STRAIGHTEST PATHS POSSIBLE TO MINIMIZE TRANSIENT VOLTAGE RISES.
- 4. TIGHTEN GROUNDING AND BONDING CONNECTORS, INCLUDING SCREWS AND BOLTS, IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED TORQUE TIGHTENING VALUES FOR CONNECTORS AND BOLTS. WHERE MANUFACTURER'S TORQUING REQUIREMENTS ARE NOT AVAILABLE, TIGHTEN CONNECTIONS TO COMPLY WITH TIGHTENING TORQUE VALUES SPECIFIED IN UL 486A TO ASSURE PERMANENT AND EFFECTIVE GROUNDING.
- 5. ALL UNDERGROUND GROUNDING CONNECTIONS SHALL BE MADE BY THE EXOTHERMIC WELD PROCESS AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- 6. ALL GROUND CONNECTIONS SHALL BE INSPECTED FOR TIGHTNESS. EXOTHERMIC-WELDED CONNECTIONS SHALL BE APPROVED BY THE CONSTRUCTION INSPECTOR BEFORE BEING PERMANENTLY CONCEALED.
- 7. APPLY CORROSION-RESISTANT FINISH TO FIELD CONNECTIONS, AND PLACES WHERE FACTORY APPLIED PROTECTIVE COATINGS HAVE BEEN DESTROYED. USE COPPER-BASED "NO-OX" OR APPROVED EQUAL.
- 8. A SEPARATE, CONTINUOUS, INSULATED EQUIPMENT GROUNDING CONDUCTOR SHALL BE INSTALLED IN ALL FEEDER AND BRANCH CIRCUITS
- 9. BOND ALL INSULATED GROUNDING BUSHINGS WITH A BARE #6 AWG GROUNDING CONDUCTOR TO A GROUND BUS OR GROUNDING LUG IN ENCLOSURE.
- 10. DIRECT BURIED GROUND CONDUCTORS SHALL BE INSTALLED AT A NOMINAL DEPTH OF 30" BELOW GRADE, UNLESS NOTED OTHERWISE.
- 11. ALL GROUNDING CONDUCTORS EMBEDDED IN OR PENETRATING CONCRETE SHALL BE INSULATED OR INSTALLED IN PVC CONDUIT.
- 12. INSTALL ELECTROLYTIC GROUNDING SYSTEM IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. REMOVE SEALING TAPE FROM LEACHING AND BREATHER HOLES. INSTALL PROTECTIVE BOX FLUSH WITH GRADE.
- 13. DRIVE GROUND RODS UNTIL TOPS ARE 30" BELOW FINAL GRADE.
- 14. GROUNDING CONDUCTOR TO EQUIPMENT GROUND LUGS:
  - a. BOLTED TO EQUIPMENT HOUSING WITH STAINLESS STEEL BOLTS AND LOCK WASHERS.
  - b. ALL EQUIPMENT TO BE GROUNDED SHALL BE FREE OF PAINT OR ANY OTHER MATERIAL COVERING BARE METAL AT THE POINT OF CONNECTION.

**3.5 ACCEPTANCE TESTING:**

- A. PROVIDE PERSONNEL AND EQUIPMENT, MAKE REQUIRED TESTS, AND SUBMIT TEST REPORTS UPON COMPLETION OF TESTS.
- B. WHEN MATERIAL AND/OR WORKMANSHIP IS FOUND NOT TO COMPLY WITH THE SPECIFIED REQUIREMENTS, THE NONCOMPLYING ITEMS SHALL BE REMOVED FROM THE JOBSITE AND REPLACED WITH ITEMS COMPLYING WITH THE SPECIFIED REQUIREMENTS PROMPTLY AFTER RECEIPT OF NOTICE OF SUCH NON-COMPLIANCE.


**C. TEST PROCEDURES:**

- 1. ALL FEEDERS SHALL HAVE THEIR INSULATION TESTED AFTER INSTALLATION, BUT BEFORE CONNECTION TO DEVICES. THE CONDUCTORS SHALL TEST FREE FROM SHORT CIRCUITS AND GROUNDS. TESTING SHALL BE FOR ONE MINUTE USING 1000V DC. INVESTIGATE ANY VALUES LESS THAN 50 MEGAOHMS.
- 2. PRIOR TO ENERGIZING CIRCUITRY, TEST WIRING DEVICES FOR ELECTRICAL CONTINUITY AND PROPER POLARITY CONNECTIONS.
- 3. MEASURE AND RECORD VOLTAGES BETWEEN PHASES AND BETWEEN PHASE WIRES AND NEUTRALS. SUBMIT A REPORT OF MAXIMUM AND MINIMUM VOLTAGES.
- 4. PERFORM GROUND TEST TO MEASURE GROUND RESISTANCE OF GROUNDING SYSTEM USING THE IEEE STANDARD 3-POINT "FALL-OF-POTENTIAL" METHOD. PROVIDE PLOTTED TEST VALUES & LOCATION SKETCH. NOTIFY THE ENGINEER IMMEDIATELY IF MEASURED VALUE IS OVER 5 OHMS.

END OF SECTION

END OF SPECIFICATION

STAMP:

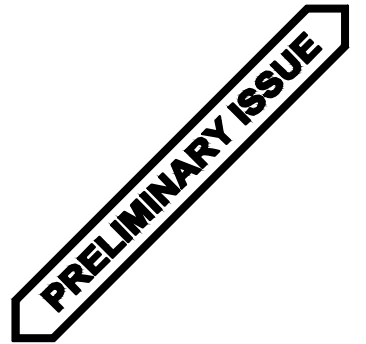

ENGINEERING LICENSE:			
STATE OF MISSOURI			
STATE CERTIFICATE OF AUTHORIZATION # EF-2791			
ENGINEER:	PE#:	DISCIPLINE:	
CC CHRISTOPHER GIANNOTTI	PE-2020038653	CIVIL	C C C
REJ ROBERT E. JENSEN	PE-028974	CIVIL	
PMS PHILIP M. SWOBODA	PE-2024040585	CIVIL	
SDK SHELTON D. KEISLING	PE-27323	ELECTRICAL	E
DJW DAVID J. WALDRON	PE-2024034789	ELECTRICAL	E
TMS TERRANCE M. SUPER	PE-18521	ELECTRICAL	E



**DRAWING NOTICE:**  
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	10/14/25	DSL	A
REISSUED FOR REVIEW	10/23/25	DSL	B
REISSUED FOR REVIEW	11/13/25	DSL	C

APPLICANT SITE NAME:  
  
LEES SUMMIT

SITE ADDRESS:  
TBD  
LEE'S SUMMIT, MO 64063

SHEET DESCRIPTION: SPECIFICATIONS (7 OF 7)	SHEET #: SP-2.1
--	--------------------