


Test Area

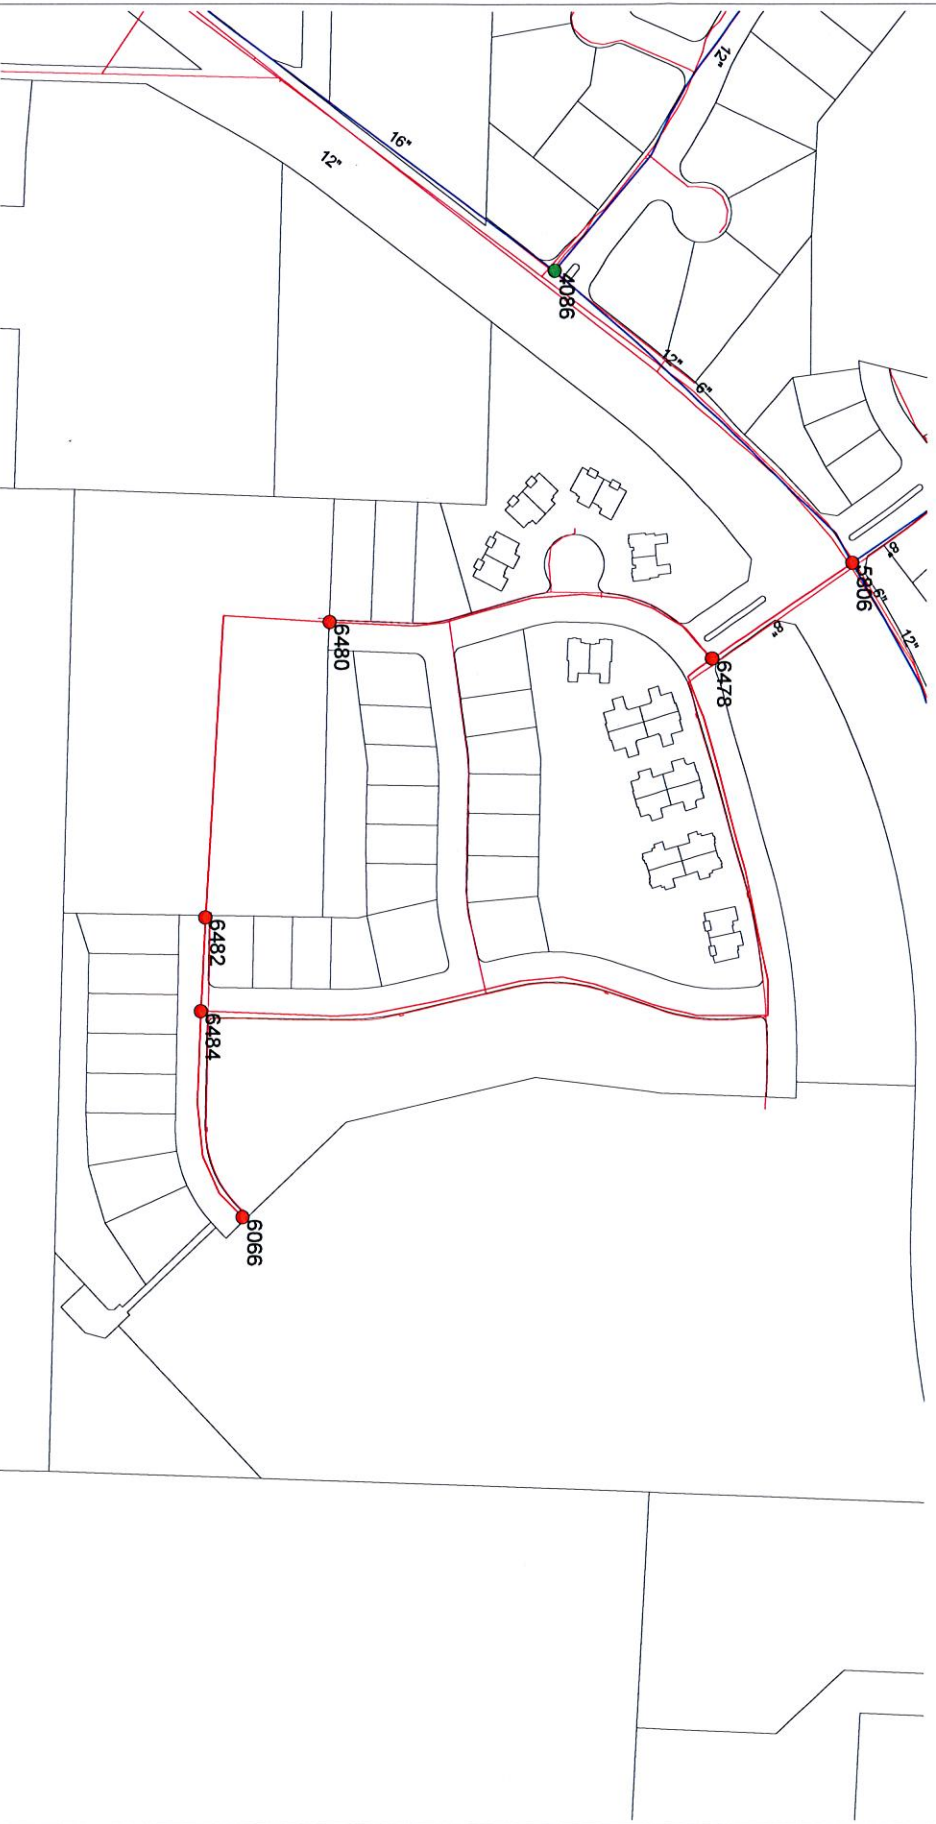

Test Area Fireflow

☐	ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)	Available Flow at Hydrant (gpm)	Available Flow Pressure (psi)
☐	6066	0.00	92.46	1,108.39	1,000.00	82.05	2,983.07	20.09
☐	6478	0.00	76.43	1,108.39	1,000.00	71.93	4,460.38	20.20
☐	6482	0.00	79.03	1,108.39	1,000.00	71.34	3,208.23	20.10
☐	6484	0.00	82.93	1,108.39	1,000.00	75.20	3,314.80	20.11
☐	5806	42.50	73.83	1,108.39	1,000.00	71.48	7,467.36	20.55
☐	6480	12.00	82.50	1,108.39	1,000.00	75.57	3,555.63	20.13

Test Area Junction Report

	ID	Demand (gpm)	Elevation (ft)	Head (ft)	Pressure (psi)
1	☐ 6066	0.00	895.00	1,108.39	92.46
2	☐ 6478	0.00	932.00	1,108.39	76.43
3	☐ 6482	0.00	926.00	1,108.39	79.03
4	☐ 6484	0.00	917.00	1,108.39	82.93
5	☐ 5806	42.50	938.00	1,108.39	73.83
6	☐ 6480	12.00	918.00	1,108.39	82.50