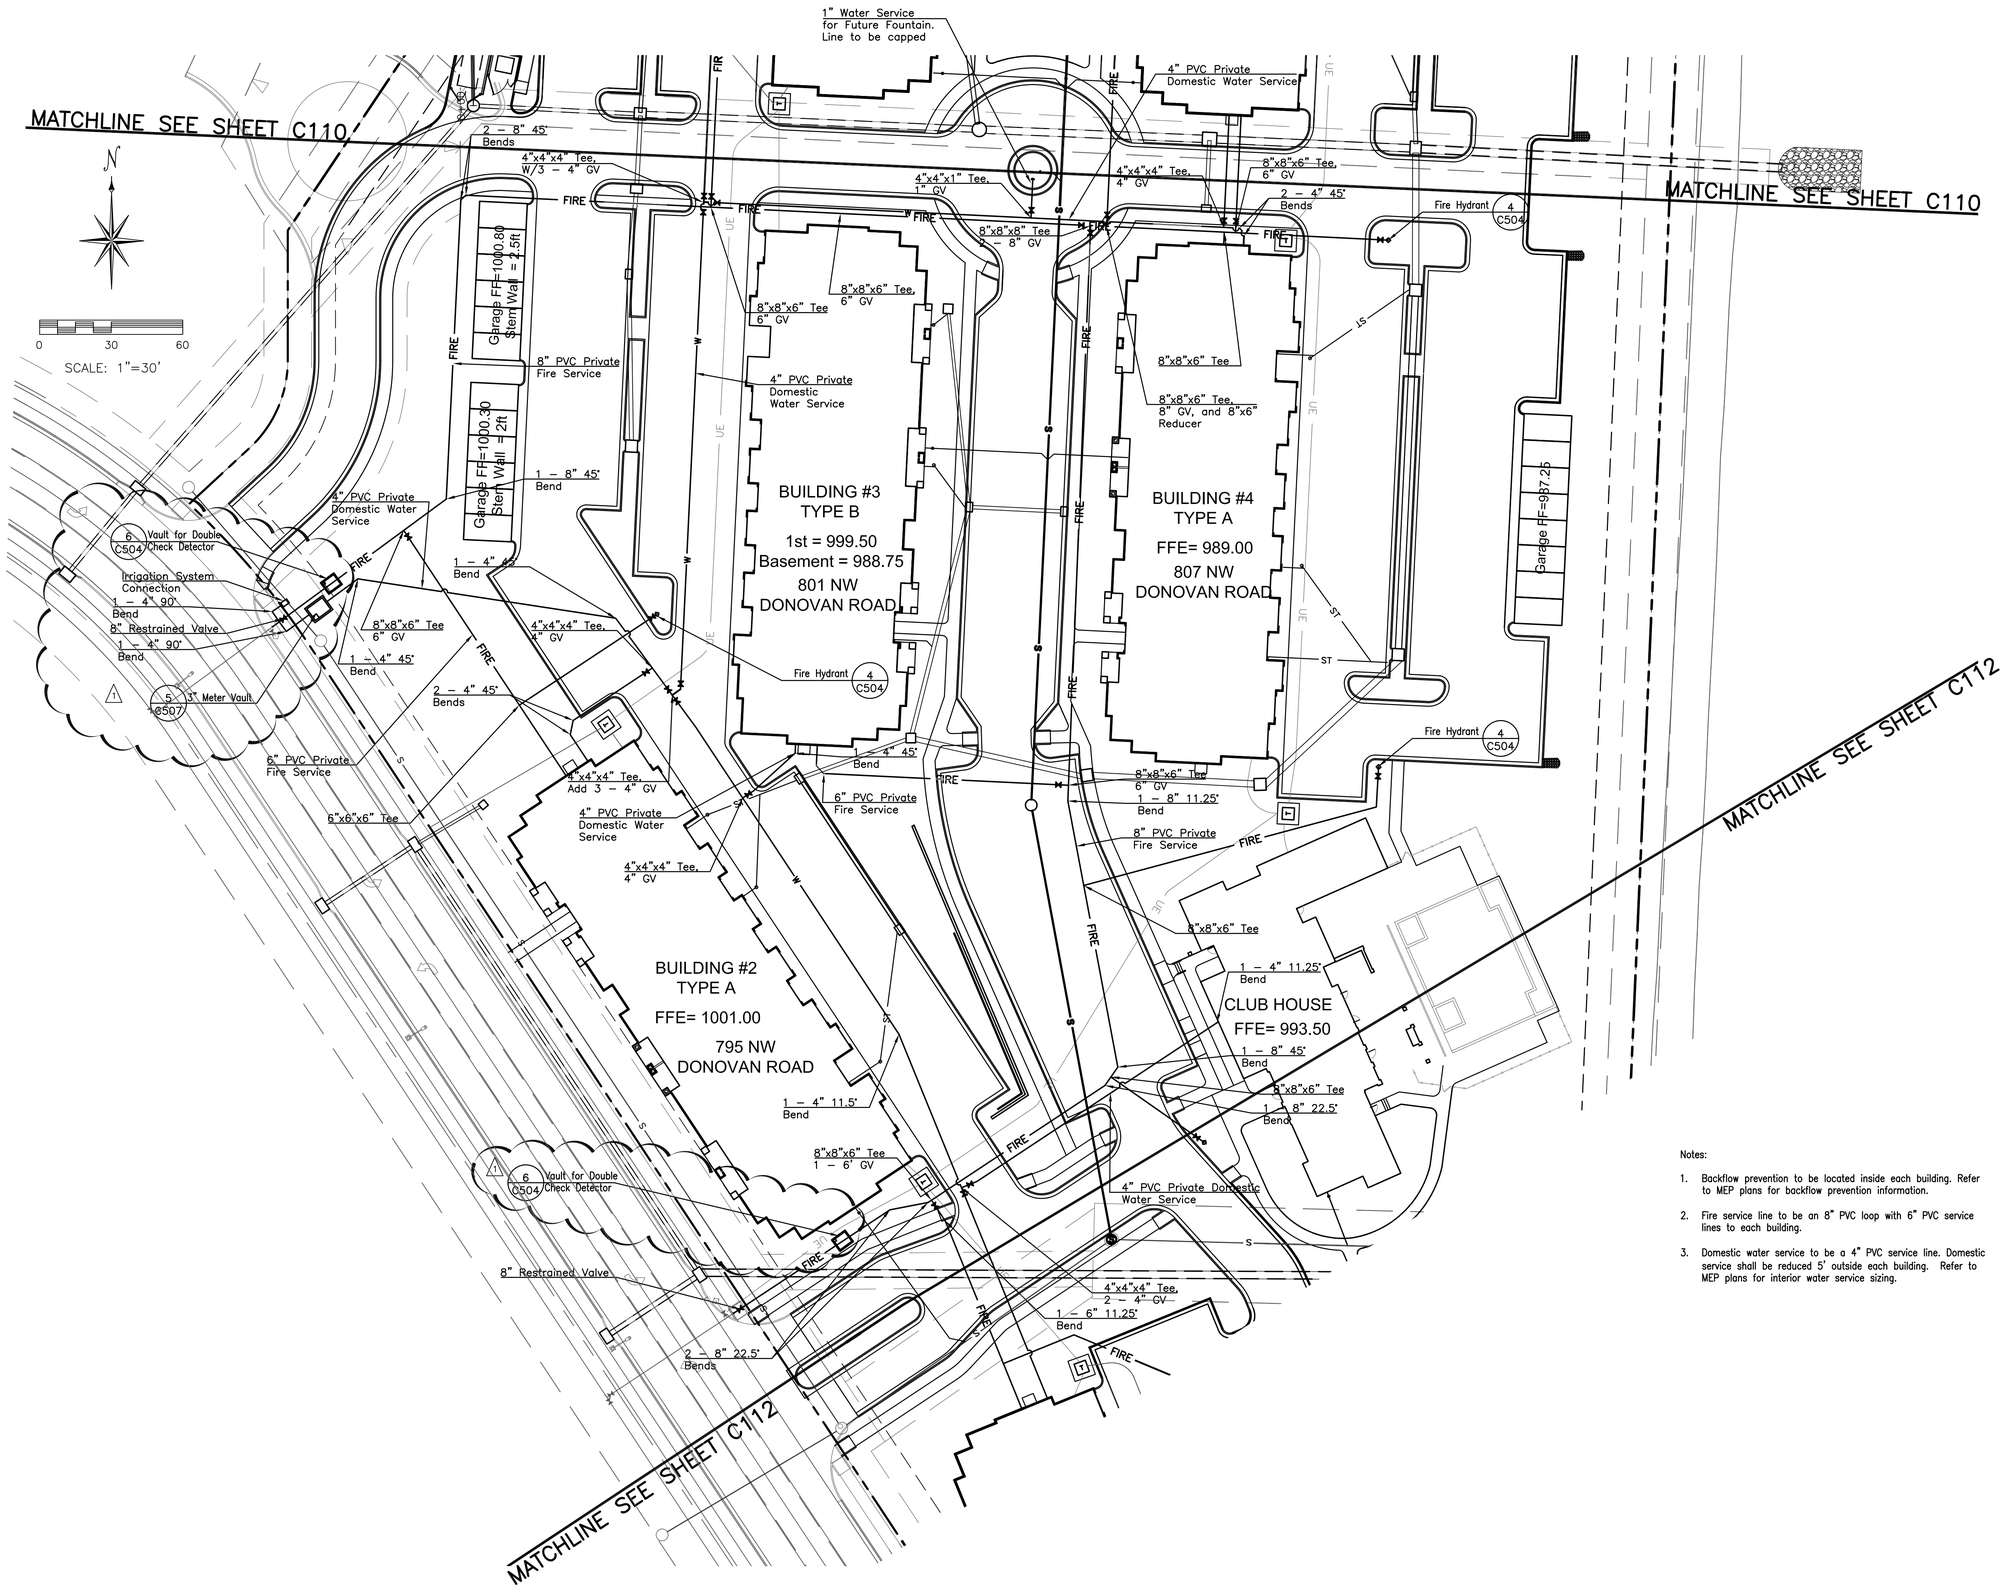

Notes:

1. Backflow prevention to be located inside each building. Refer to MEP plans for backflow prevention information.
2. Fire service line to be an 8" PVC loop with 6" PVC service lines to each building.
3. Domestic water service to be a 4" PVC service line. Domestic service shall be reduced 5' outside each building. Refer to MEP plans for interior water service sizing.

NSPJ ARCHITECTS, PA
ARCHITECTURE LANDSCAPE ARCHITECTURE INTERIORS ENERGY SERVICES
3515 W. 75TH ST., SUITE 201
PRAIRIE VILLAGE, KS 66208
P. 913.831.1415
F. 913.831.1563
NSPJARCH.COM

© COPYRIGHT 2015

McCLURE ENGINEERING Co.
building strong communities.
1901 Pennsylvania Drive
Columbia, MO 65202
P 573-814-1568
F 573-814-1128
MISSOURI CERTIFICATE OF AUTHORITY NO. E-2006023253
EXPIRES: DECEMBER 31, 2016

STATE OF MISSOURI
KEENAN SIMON
NUMBER PE-2016017682
PROFESSIONAL ENGINEER
09/27/2016

Keenan Simon
MO-2016017682
Expires: 12-31-2016

A NEW APARTMENT COMMUNITY AT:

SUMMIT SQUARE

701 NW WARD RD.
LEE'S SUMMIT, MISSOURI

DRAWING RELEASE LOG

- 03.04.2016 - PDP SUBMITTAL
- 06.09.2016 - FDP SUBMITTAL
- 07.01.2016 - 80% PROGRESS SET
- 07.15.2016 - PERMIT SUBMITTAL
- 08.05.2016 - BID SET
- 09.15.2016 - BID SET

REVISIONS
1 City Comments 09/23/2016

DATE
09/15/2016
JOB NO.
80816033
DRAWN BY:
GRK
SHEET NO.
WATER SYSTEM PLAN CENTRAL
C111