



* Geogrid may be substituted for stabilization

1 ASPHALT PAVEMENT
C501 N.T.S.

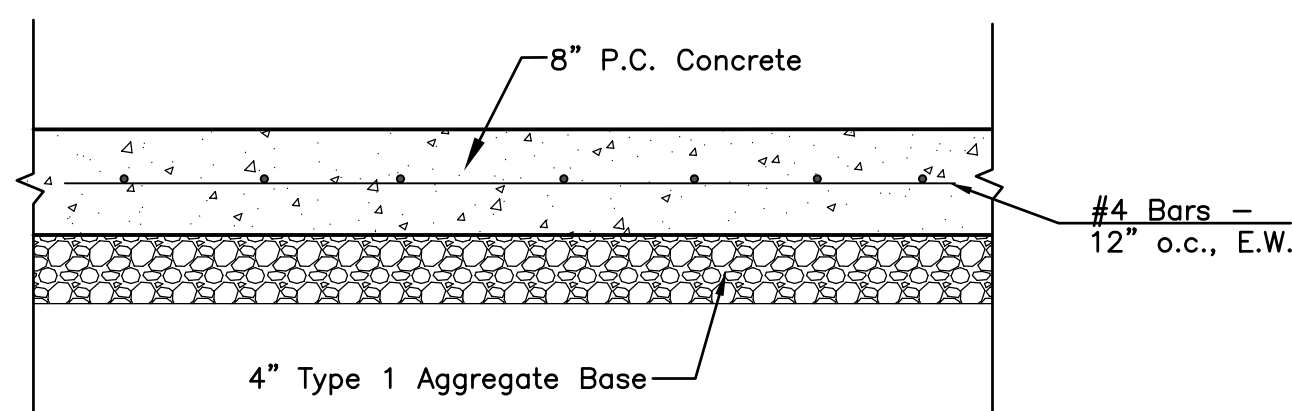


2 HEAVY DUTY P.C.C. PAVEMENT
C501 N.T.S.

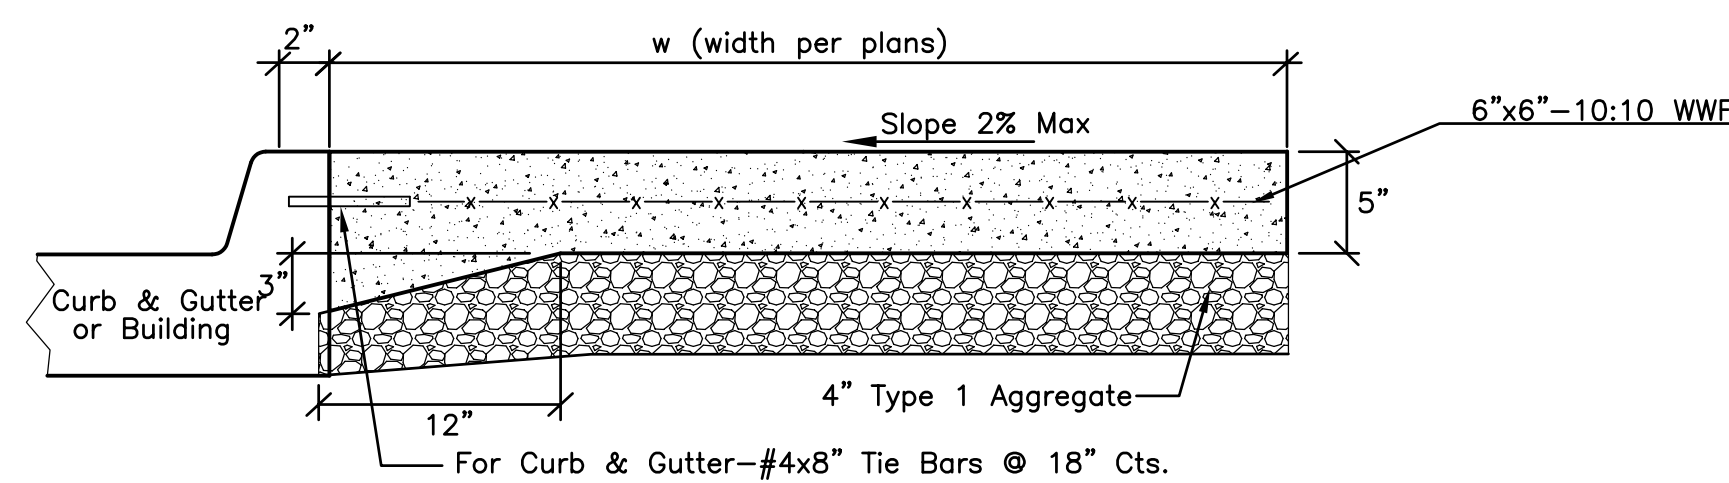

- NOTES:
1. Transverse Type C1 Joint walk width
 2. Type A Expansion Joints at Intersections with Other Walks and 72' Cts.
 3. Joints Per Detail (C502)


SIDEWALK AT CURB

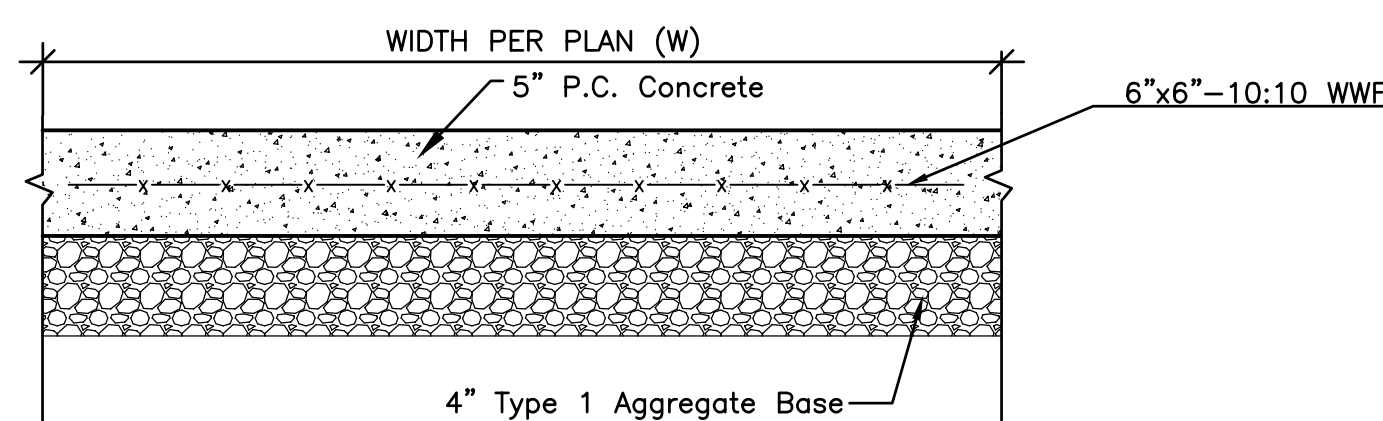


- NOTES:
1. Joints Per Detail (C502)
 2. Install joints at W' centers and at intersections with other sidewalks and ramps.

SIDEWALK NO CURB

3 PCC SIDEWALK
C501 N.T.S.

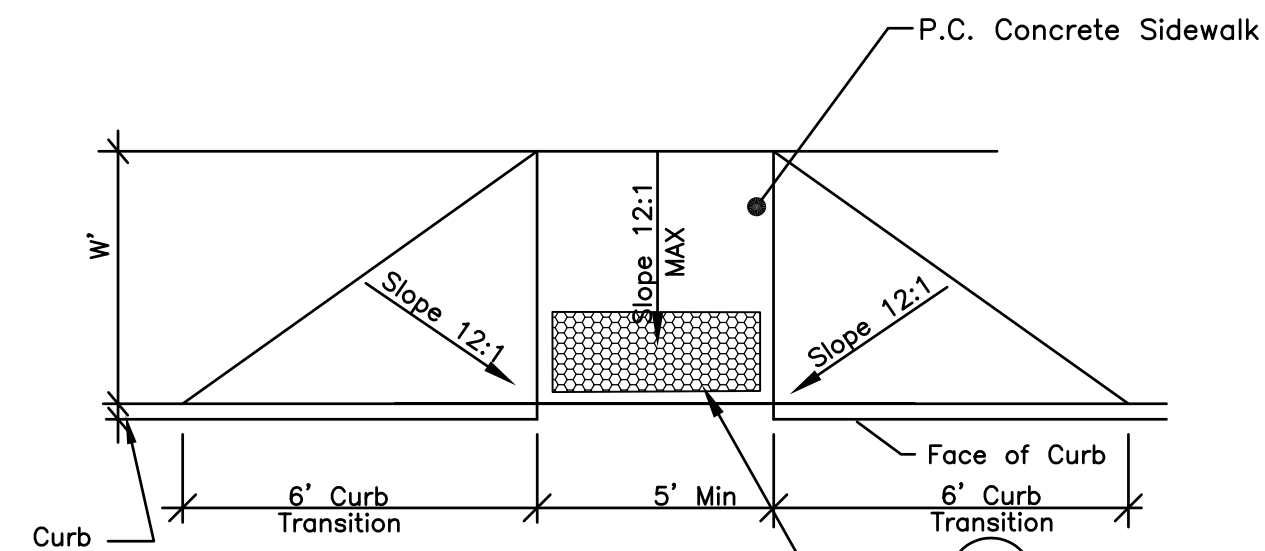


TYPE A - STRAIGHT RAMP

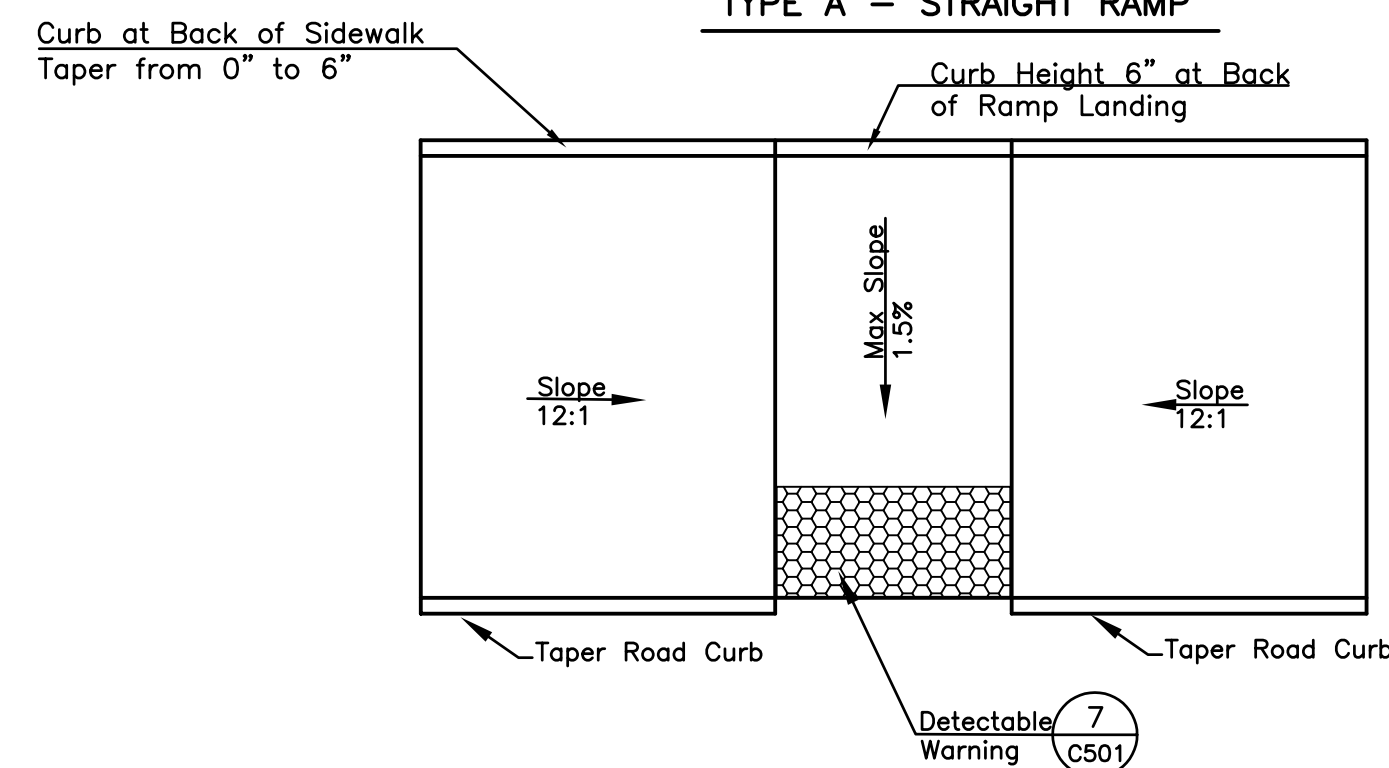


IN LINE RAMP

4 SIDEWALK ACCESSIBLE RAMP
C501 N.T.S.

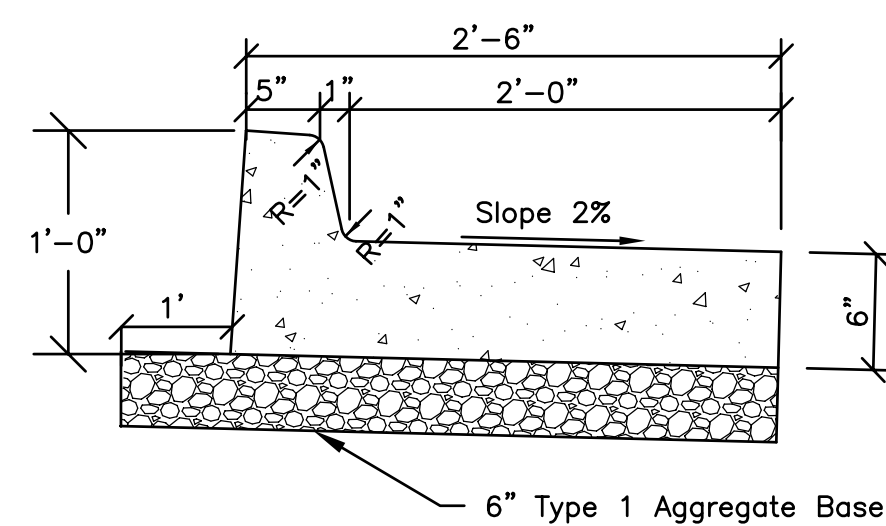


REVERSE SLOPE PCC CURB

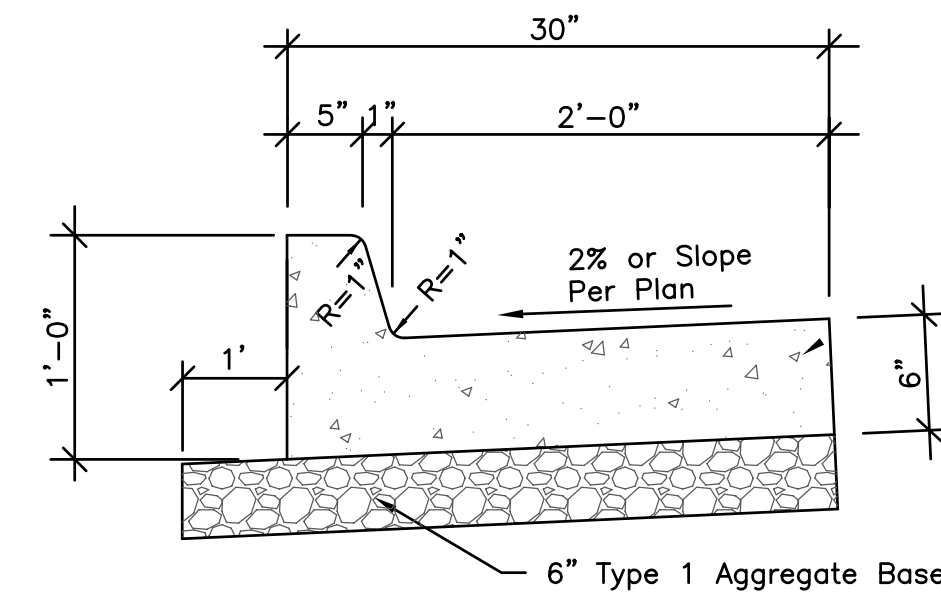

- NOTES:
1. All P.C. concrete shall be f'c = 4000 psi.
 2. Install 1/2" expansion joints in curb and gutter section at P.C. and P.T. of curb radius of intersections and every 150'.
 3. Install construction joints in curb and gutter section at 10 ft. maximum spacing.
 4. 4% parabolic crown in acceptable in lieu of 2% normal crown.

5 CURB AND GUTTER
C501 N.T.S.

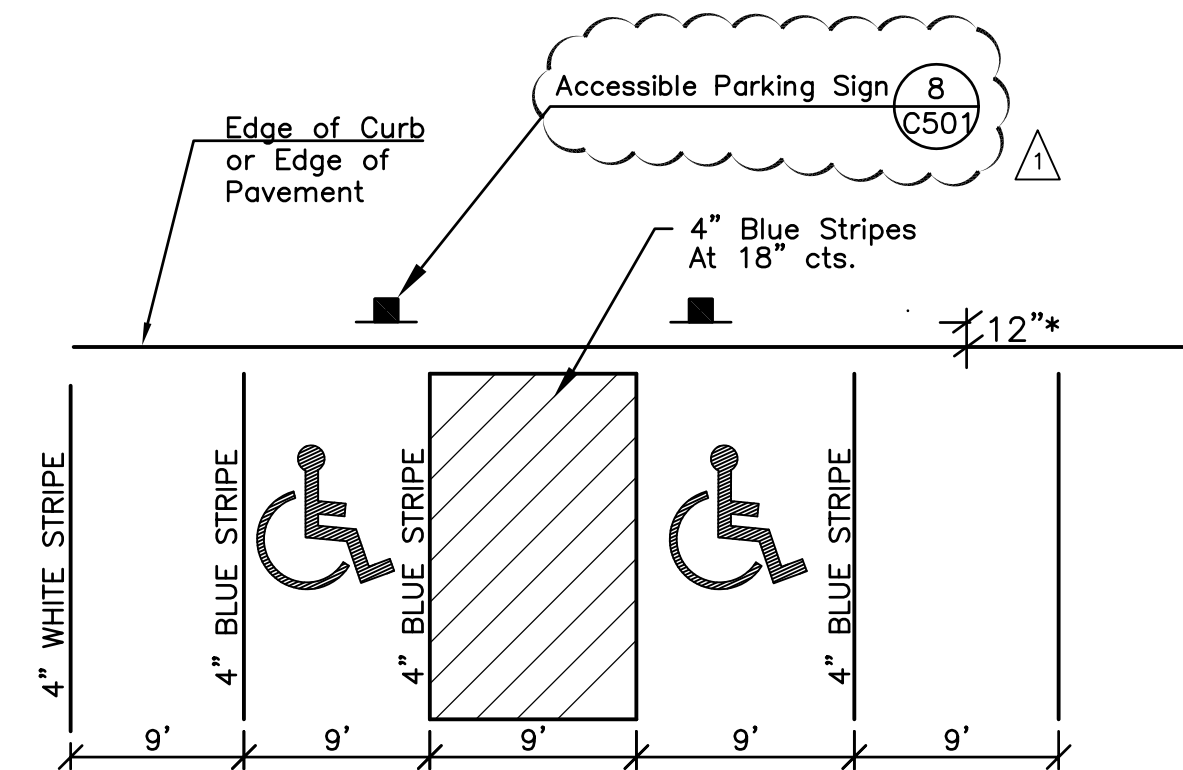


HEAD-IN PARKING/HANDICAP PARKING

- Notes:
1. All accessible parking and accessible routes shall comply with the Americans with Disabilities Act.
 2. Accessible parking space slopes shall not exceed 2% in any direction.

*Place signs behind sidewalk where applicable.


6 PARKING STALL STRIPING DETAILS
C501 N.T.S.

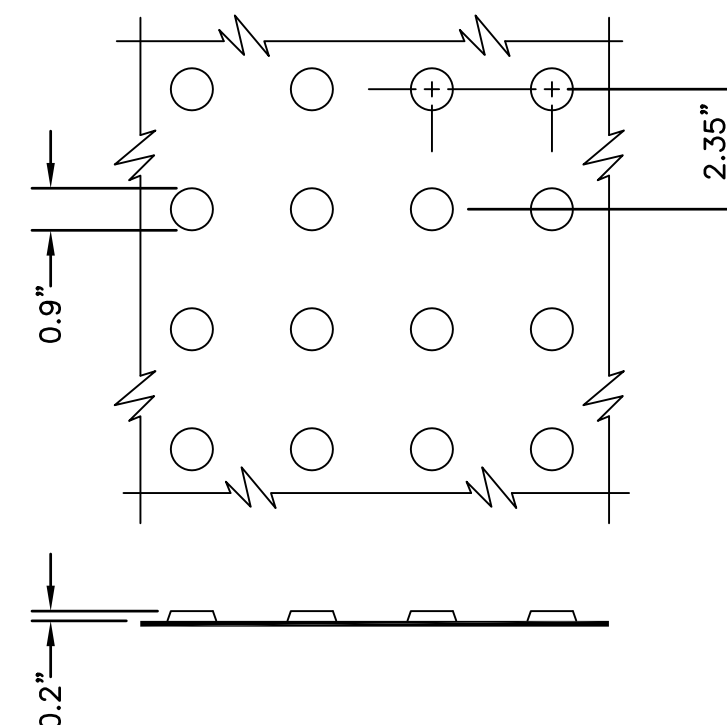

NOTES:

- 1) Place detectable warnings at locations shown on plans and details.
- 2) Detectable warning tiles shall be ADA Solutions 2448 REP-Safety Red (Fed. color 31350) or approved equal.

7 DETECTABLE WARNING
C501 N.T.S.

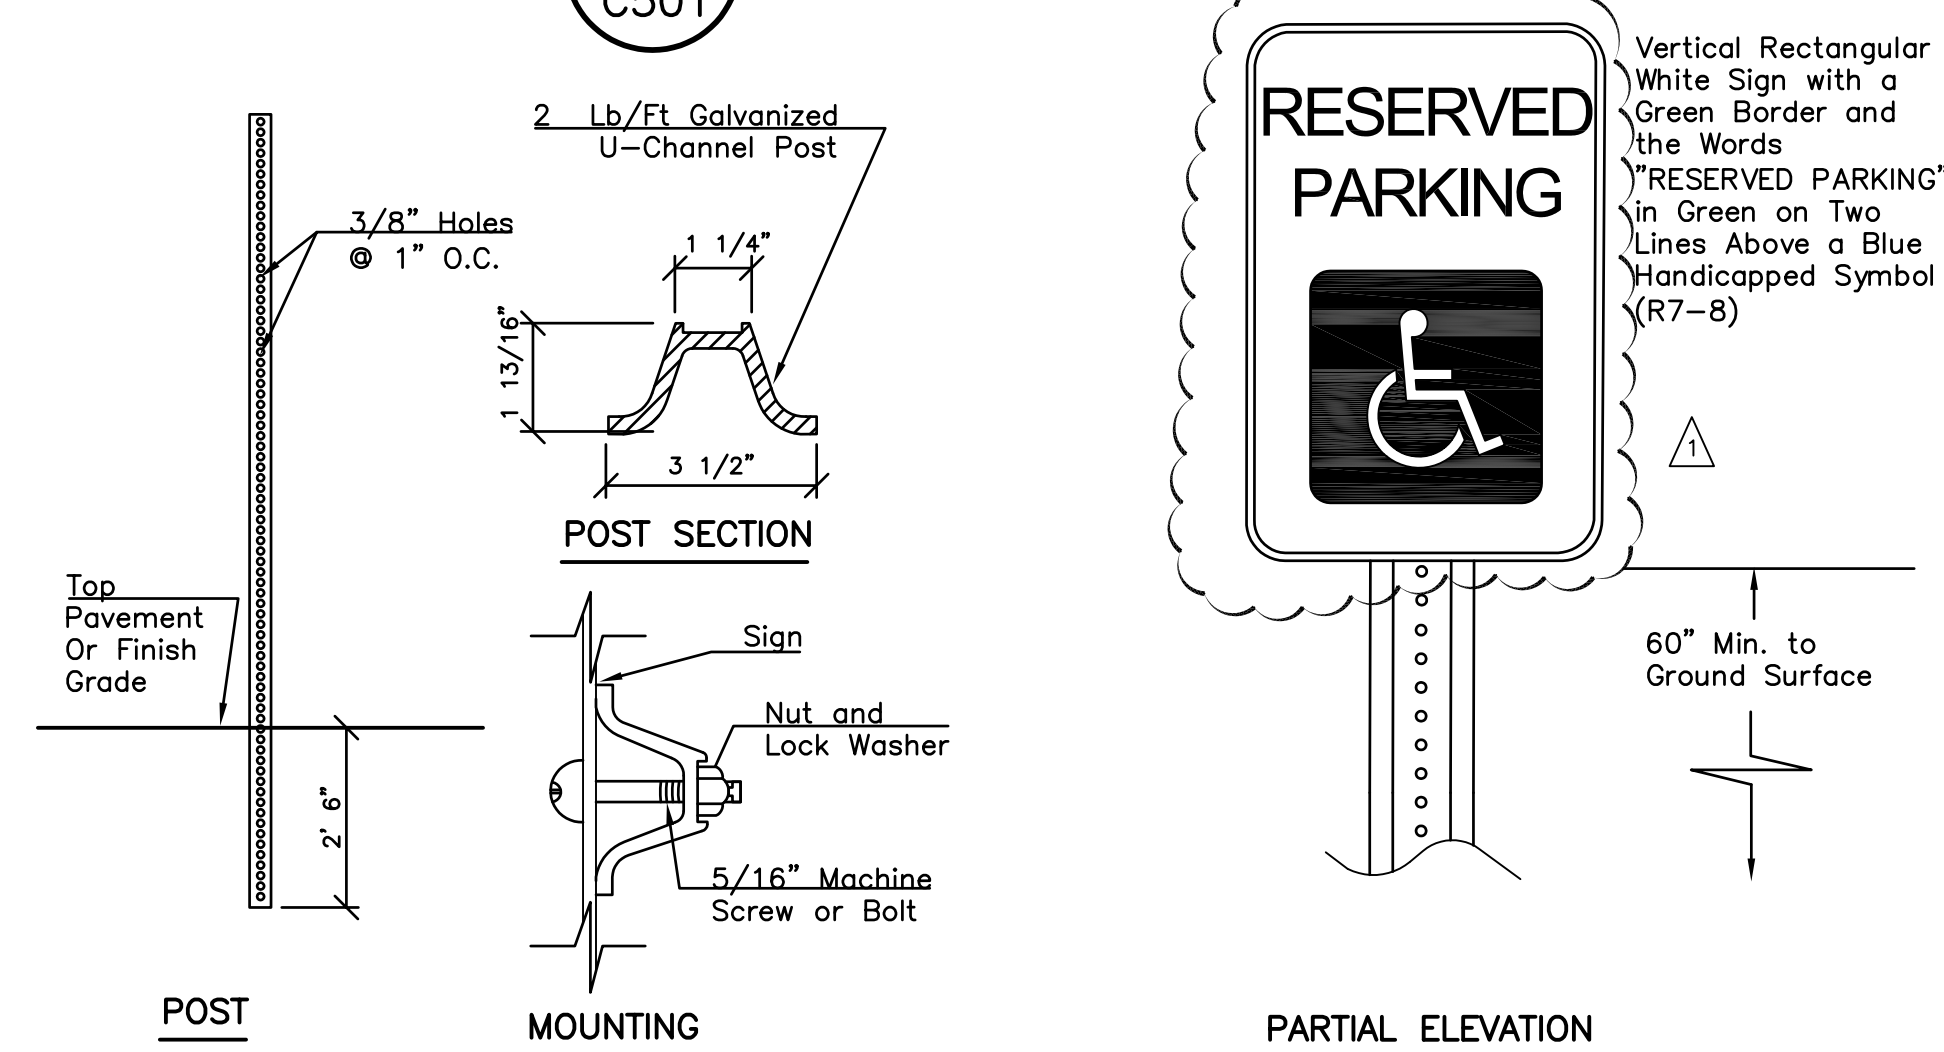

- Notes:
1. See Site Plan for Sign Locations
 2. See Separate Detail if Bollards are Required
 3. Sign Type Shall be R7-8 (Without the Arrow)

8 ACCESSIBLE PARKING SIGN
C501 N.T.S.