

RECEIVED

MAY 2 2014

CITY OF LEE'S SUMMIT  
CODES ADMINISTRATION

**GEOTECHNICAL ENGINEERING  
SERVICES REPORT**

for the

**FRONTIER JUSTICE  
NEC OF INDEPENDENCE AVENUE AND JONES DRIVE  
LEE'S SUMMIT, MISSOURI**

Prepared for

**FRONTIER JUSTICE  
8611 S. STILLHOUSE ROAD  
OAK GROVE, MISSOURI 64075**

Prepared by

**Professional Service Industries, Inc.  
1211 W Cambridge Circle Drive  
Kansas City, Kansas 66103  
Telephone (913) 310-1600**

**PSI PROJECT NUMBER 338-888**


**March 7, 2014**

**PSI** *Information  
To Build On*

**Engineering • Consulting • Testing**

1211 W. Cambridge Circle Drive • Kansas City, KS 66103

Phone 913/310-1600 • Fax 913/310-1601

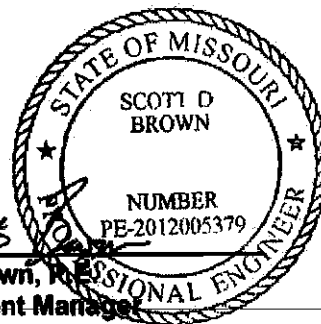

**Scott Brown, P.E.**  
**Department Manager**  
**Geotechnical Services**  
**Missouri License # 2012005379**  
**Expires 12/31/2014**

*Nicholas J. Roth*  
**Reviewed by:**  
**Nicholas J. Roth, P.E.**  
**Principal Consultant**

The above Professional Engineering Seal and signature is an electronic reproduction of the original seal and signature. An original hard copy was sent to the client listed on this document. This electronic reproduction shall not be construed as an original or certified document.

*Information To Build On*

## TABLE OF CONTENTS

	Page No.
<b>PROJECT INFORMATION .....</b>	<b>2</b>
Project Authorization .....	2
Project Description.....	2
Purpose and Scope of Services .....	3
<b>DRILLING, FIELD AND LAB TESTING PROCEDURES .....</b>	<b>3</b>
Drilling and Sampling Procedures .....	3
Field Tests and Measurements .....	3
Laboratory Testing Program .....	4
<b>SITE AND SUBSURFACE CONDITIONS.....</b>	<b>5</b>
Site Location and Description .....	5
Subsurface Conditions .....	5
Water Level Measurements .....	6
<b>GEOTECHNICAL EVALUATION .....</b>	<b>6</b>
Geotechnical Discussion .....	6
Shear Strength and Compressibility of Soil .....	6
Medium to High Plasticity Clay .....	7
Shallow Rock.....	7
Dissimilar Bearing Materials.....	7
Equipment Mobility .....	7
Soil Compaction .....	7
<b>GEOTECHNICAL RECOMMENDATIONS.....</b>	<b>8</b>
Site Preparation.....	8
High Plasticity Clay Considerations .....	10
Foundation Recommendations.....	10
Earthquake and Seismic Design Consideration.....	11
Floor Slab Recommendations.....	12
Utilities Trenching .....	13
Pavement Recommendations.....	14
Asphalt Pavement.....	15
Concrete Pavement.....	15
Pavement Subgrade Preparation .....	15
Pavement Drainage & Maintenance .....	16
<b>CONSTRUCTION CONSIDERATIONS.....</b>	<b>16</b>
Moisture Sensitive Soils/Weather Related Concerns .....	16
Drainage and Groundwater Considerations .....	16
Excavations.....	16
<b>GEOTECHNICAL RISK.....</b>	<b>17</b>
<b>REPORT LIMITATIONS .....</b>	<b>17</b>

**Appendix -**

**Site Vicinity Map  
Boring Location Sketch  
Boring Logs  
General Notes  
Laboratory Data**

---

---

---

## PROJECT INFORMATION

### Project Authorization

The following table summarizes, in chronological order, the Project Authorization History for the services performed and represented in this report by Professional Service Industries, Inc. (PSI).

PROJECT TITLE: FRONTIER JUSTICE-LEE'S SUMMIT, MO		
Date Requested and Reference Number	Date	Requested/Provided By
Request for Proposal	1/31/14	Mr. Stuart Mullen of Range Development Services
PSI Proposal Number: 338115386R	2/18/14	Scott Brown and Kelly Rotert of PSI
Notice to Proceed	2/18/14	Mr. Michael Brown of Frontier Justice

### Project Description

PSI understands that the project includes construction of a new approximately 32,000 square feet in plan area commercial office building. The building will be a one-story, rectangular or "L"-shaped wood frame structure without a basement. The proposed building will be located within the north portion of the site. Paved parking and drive area will be located on the west, south and east sides of the building and use for primarily for automobile traffic.

The following table lists the material and information provided for this project:

DESCRIPTION OF MATERIAL	PROVIDER/SOURCE	DATE
Site Plan, Sheet A0.1	Range Development Services/Liquid Design	2/17/14

The following table lists the structural loads and site features that are required for or are the design basis for the conclusions of this report:

STRUCTURAL LOAD/PROPERTY	REQUIREMENT/REPORT BASIS		
	BUILDING	R	B
Maximum Column Loads	60 kips		X
Maximum Wall Loads	2.0 kips per linear foot		X
Finish Floor type	Slab-on-grade		X
Maximum Floor Loads	150 psf		X
Settlement Tolerances	1 inch total, 3/4 inch differential		X
PAVEMENTS			
Pavement 18-kip ESAL (cycle & duration)	30,000 (light), 60,000 (heavy)		X
GRADING			
Planned grade variations at site, Feet	5 feet		X

\*"R" = Requirement indicates specific design information was supplied.

"B" = Report Basis indicates specific design information was not supplied; therefore, this report is based on this parameter.

The geotechnical recommendations presented in this report are based on the available project information, building location, and the subsurface materials described in this report. If the noted information is incorrect, please inform PSI in writing so that we may amend the recommendations presented in this report if appropriate and if desired by the client. PSI will not be responsible for the implementation of its recommendations when it is not notified of changes in the project.

### Purpose and Scope of Services

The purpose of this study was to explore the subsurface conditions within the site to evaluate and provide recommendations for site preparation and grading and for design of foundation and pavement section systems for the proposed construction. PSI's contracted scope of services included drilling 10 soil test borings at the site to depths of about 5 feet to 15 feet below the ground surface or refusal, select laboratory testing, and preparation of this geotechnical report. This report briefly outlines the testing procedures, presents available project information, describes the site and subsurface conditions, and presents recommendations regarding the following:

- Grading procedures for site development.
- Foundation types, depths and allowable bearing capacities.
- Seismic parameters for use in design.
- Pavement section design and pavement subgrade preparation.
- Comments regarding geotechnical factors that will impact construction and performance of the proposed construction.

The scope of services did not include an environmental assessment for determining the presence or absence of wetlands, or hazardous or toxic materials in the soil, bedrock, surface water, groundwater, or air on, below, or around this site. Any statements in this report or on the boring logs regarding odors, colors, and unusual or suspicious items or conditions are strictly for informational purposes. PSI's scope also did not provide any service to investigate or detect the presence of moisture, mold or other biological contaminants in or around any structure, or any service that was designed or intended to prevent or lower the risk of the occurrence or the amplification of the same. Client should be aware that mold is ubiquitous to the environment with mold amplification occurring when building materials are impacted by moisture.

## **Drilling, Field and Lab Testing Procedures**

### Drilling and Sampling Procedures

The soil borings were performed with a truck-mounted rotary head drill rig. Borings were advanced using 3¼-inch inside diameter hollow-stem augers. Representative samples were obtained employing split-spoon and thin-wall tube sampling procedures in general accordance with ASTM procedures.

### Field Tests and Measurements

#### ***Penetration Tests and Split-Barrel Sampling of Soils***

During the sampling procedure, Standard Penetration Tests (SPT) were performed at regular intervals (2½-foot intervals to 10 feet and 5-foot intervals thereafter) to obtain the standard penetration value (N) of the soil. The results of the standard penetration test indicate the relative density and comparative consistency of the soils, and thereby provide a basis for estimating the relative strength and compressibility of the soil profile components. The split-barrel sampler provides a soil sample for identification purposes and for laboratory tests appropriate for soil obtained from a sampler that may produce large shear strain while obtaining the sample.

### ***Thin-Walled (Shelby) Tube Geotechnical Sampling of Soils***

Thin-walled tube samples are utilized to obtain a relatively undisturbed specimen suitable for laboratory tests of structural properties or other tests that might be influenced by soil properties. A relatively undisturbed sample is obtained by pressing a thin-walled metal tube (typically an outside diameter 3 inches) into the in-situ soil, removing the soil-filled tube, and sealing the ends to reduce the soil disturbance or moisture loss. These samples may be utilized in the laboratory to obtain the following information or perform the following tests: Unconfined Compressive Strength ( $q_u$ ), Laboratory Determination of Water Content, Wet and Dry Density, Percent Saturation, and Atterberg Limits

### ***Water Level Measurements***

Water level observations were attempted during and upon completion of the drilling operation using a 100-foot tape measure. The depths of observed water levels in the boreholes are noted on the boring logs presented in the appendix of this report. In the borings where water was unable to be observed during the field activities, in relatively impervious soils, the accurate determination of the groundwater elevation may not be possible even after several days of observation. Seasonal variations, temperature and recent rainfall conditions may influence the levels of the groundwater table and volumes of water will depend on the permeability of the soils.

### **Laboratory Testing Program**

In addition to the field investigation, a supplemental laboratory-testing program was conducted to determine additional engineering characteristics of the foundation materials necessary in analyzing the behavior of the soils as it relates to the construction of the proposed structures. The laboratory testing program is as follows:

### ***Laboratory Determination of Water (Moisture) Content of Soil by Mass***

The water content is a significant index property used in establishing a correlation between soil behavior and its index properties. The water content is used in expressing the phase relationship of air, water, and solids in a given volume of material. In fine grained cohesive soils, the behavior of a given soil type often depends on its water content. The water content of a soil along with its liquid and plastic limits as determined by Atterberg Limit testing, is used to express its relative consistency or liquidity index.

### ***Atterberg Limits***

The Atterberg Limits are defined by the liquid limit (LL) and plastic limit (PL) states of a given soil. These limits are used to determine the moisture content limits where the soil characteristics changes from behaving more like a fluid on the liquid limit end to where the soil behaves more like individual soil particles on the plastic limit end. The liquid limit is often used to indicate if a soil is a low or high plasticity soil. The plasticity index (PI) is the difference between the liquid limit and the plastic limit. The plasticity index is used in conjunction with the liquid limit to assess if the material will behave like a silt or clay. The material can also be classified as an organic material by comparing the liquid limit of the natural material to the liquid limit of the sample after being oven-dried.

### ***Unconfined Compressive Strength of Cohesive Soil ( $q_u$ )***

The primary purpose of the unconfined compressive strength test is to obtain the undrained compressive strength of soils that possess sufficient cohesion to permit testing in the unconfined state. Unconfined compressive strength ( $q_u$ ) is the compressive stress at which an unconfined cylindrical specimen of soil will fail in a simple compression test. In this test method, unconfined compressive strength is taken as the maximum load obtained per unit area or the load per unit area at 15% axial strain, whichever is obtained first during the performance of a test. For the unconfined

compressive strength test, the shear strength ( $s_u$ ) is calculated to be half of the compressive stress at failure.

## SITE AND SUBSURFACE CONDITIONS

### Site Location and Description

The proposed project will be located on the northeast corner of the intersection of Independence Avenue and Jones Drive in Lee's Summit, Missouri. At the time of drilling, the site was a vacant grass field that generally sloped downward from east to west with a visually difference in elevation of about 5 feet. The site is also border to the east by Interstate 470. The site latitude and longitude are approximately 38.9648° and -94.36054°, respectively.

### Subsurface Conditions

The site subsurface conditions were explored with 10 soil test borings. Six (6) of these borings were drilled within the proposed building area and four (4) borings were drilled within parking and drive areas. Building boring depths ranged from 4 feet to 15 feet and pavement borings ranged from depths of 3 feet to 5 feet. The boring locations and depths were suggested by PSI and reviewed with the client prior to drilling. PSI personnel staked the borings in the field by measuring distances from available surface features.

In general, the thickness of the organic surface layer was about 4 inches. The soils encountered at the borings, beneath the organic surface soils, primarily included fine-grained soils that extended to depths of about 3 to 13 feet below the existing grade. These soils were underlain by weathered shale to shale and weathered limestone to the terminal depths of the borings. Based on results of Atterberg limits and visual classification, the clay soils were classified as medium to high plasticity clay (CL-CH, CH) in accordance with the Unified Soil Classification System (USCS).

The following table briefly summarizes the range of results from the field and laboratory testing programs. Please refer to the attached boring logs and laboratory data sheets for more specific information:

Soil Type	Depth (ft)	Soil Classification (USCS)	Moisture Content (%)	Dry Unit Weight (pcf)	Uncorrected Compressive Strength (q <sub>tip</sub> )	Liquid Limit (%)	Plastic Limit (%)
Medium to High Plasticity Clay	0-13	4-18	19-46	94-103	2.1-2.8	47-52	21-22
Weathered Shale to Shale	9-14 ½	30-SSR	14-23	-	-	-	-
Weathered Limestone	3-15	-	-	-	-	-	-

Auger refusal materials were encountered within the borings at depths ranging from about 4 to 15 feet within the borings completed. Refusal is a designation applied to materials that cannot be further penetrated by the power auger with ordinary effort and is normally indicative of a very hard or very dense material, such as boulders or gravel lenses or the upper surface of bedrock.

The above subsurface description is of a generalized nature to highlight the major subsurface stratification features and material characteristics. The boring logs included in the Appendix should be reviewed for specific information at individual boring locations. These records include soil/rock descriptions, stratifications, penetration resistances, and locations of the samples and laboratory test data. The stratifications shown on the boring logs represent the conditions only at the actual boring locations. Variations may occur and should be expected between boring locations. The stratifications represent the approximate boundary between subsurface materials and the actual transition may be gradual. Water level information obtained during field operations is also shown on these boring logs. The samples that were not altered by laboratory testing will be retained for sixty (60) days from the date of this report and then will be discarded.

### Water Level Measurements

Free groundwater was not observed in the borings upon completion, indicating that groundwater at the site at the time of the exploration was either below the terminated depths of the borings, or that the soils encountered are relatively impermeable. Although free water was not encountered at this time, water can be present within the depths explored during other times of the year depending upon climatic and rainfall conditions. However, it should be noted that saturated soils were identified during laboratory analysis at depths as shallow as 6 feet below the ground surface. Additionally, discontinuous zones of perched water may exist within the overburden materials and/or at the contact with bedrock. The water level measurements presented in this report are the levels that were measured at the time of PSI's field activities.

## **GEOTECHNICAL EVALUATION**

### Geotechnical Discussion

There are 6 primary geotechnical characteristics at this site, which will affect the selection and performance of the foundations for this structure. The following summarizes those concerns:

1. The shear strength and compressibility of the upper soils will control the behavior of the proposed structure.
2. Medium to High plasticity "fat" clays were encountered in the exploration that could require remediation.
3. Shallow rock was encountered in the building area that could be difficult to excavate for general grading, footings and utility trenches.
4. Dissimilar bearing materials will likely be encountered at the footing subgrade elevations.
5. Relatively wet and sensitive soils were encountered in the upper parts of the borings and equipment mobility difficulty may be anticipated.
6. Drying of some of the on site soils may be required to achieve proper compaction during grading.

### Shear Strength and Compressibility of Soil

The primary geotechnical property controlling the bearing capacity and compressibility of the soils bearing the applied loads is the shear strength of the clay soil. Based on 2 feet of cut or fill and a shallow foundation bearing at a depth of 3 feet below exterior or adjacent grades, the applied foundation load on a shallow foundation up to 4 feet wide will be distributed through the 8 to 12 feet of soil generally beneath the footing. PSI believes the shear strength of the insitu clay soils in this zone will range from 800 psf to 1,500 psf with strengths exceeding 2,500 psf in weathered shale, shale and limestone zones. Based on past experience, PSI anticipates that on engineered fill placed as recommended will have a minimum shear strength of 1,500 psf. This shear strength is considered



"undrained" or a "total stress" parameter and will be used in conjunction with other physical and geometric parameters to calculate an allowable bearing capacity.

#### Medium to High Plasticity Clay

Medium to high plasticity "fat" clays are present in the project area that may expand and shrink thereby impacting the proposed construction. Where these soils are within about 18 inches of lightly loaded structural features or slabs and 6 inches beneath pavements, remediation is recommended or class "C" flyash or lime-treatment of the high plastic clay the clays can be performed. Class "C" flyash or lime-treatment of the high plastic clay would reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. Lightly loaded structures are defined as having normal operating loads of less than 2 kips per linear foot for walls and 50 kips for columns. Fat clays have the potential for volume change with changes in the soil moisture content. In severe cases, movement and distress to footings and foundation walls can occur, although a severe case is not obviously apparent at this site. Remedial measures are recommended in select areas of the site to reduce the shrink/swell potential. Grading the subgrade to drain and not trap water below the slabs and pavements is recommended to further reduce the potential of distress from these soils.

#### Shallow Rock

Weathered rock consisting of weathered limestone and shale was encountered as shallow as 3 feet below the existing grade and auger refusal was encountered as shallow as 4 feet on weathered limestone. Some of these rock areas may be difficult to excavate, especially in footing and utility trenches. Excavation machinery equipped with rock chippers may be required in some locations. In addition, intact ledges or boulders of sound and hard rock may be encountered within the shale and limestone layers that could increase the excavation difficulty.

#### Dissimilar Bearing Materials

Footings for the building should bear on similar materials. PSI anticipates native clay soils and weathered shale/shale and weathered limestone to be encountered at footing depths. However, the clay bearing material may be relatively wet and weak in comparison to the weathered shale/shale and weathered limestone. PSI recommends that footing excavations that encounter relatively hard rock or soft soils be over-excavated and backfilled with a low plasticity material to a minimum depth of approximately one (1) foot below the base of the footing. The footings will then bear on similar material, which reduces the potential of relative differential settlement.

#### Equipment Mobility

The presence of wet, potentially sensitive shallow soils will increase the difficulty of site grading. PSI has been involved with projects in this region where these soils can undergo a loss of stability during wetter portions of the year. PSI anticipates that the soils at their current moisture levels will become easily disturbed if subjected to conventional rubber tire or narrow track-type equipment resulting in a loss of strength and characteristic "pumping". Soils that become disturbed would need to be excavated and replaced; however, this remedial excavation may expose progressively wetter soils with depth, thus compounding the condition. Thus, a normal approach to subgrade preparation may not be possible.

#### Soil Compaction

Since the surface soils at the site predominantly consist of high moisture content clay soils and medium to high plasticity clays, it may become difficult to achieve the desired compaction of the soils due to high current moisture contents. After stripping activities the surface soils may also not pass a proof roll in their high moisture content state. The soils may need to be scarified and dried to a

moisture content that will facilitate compaction in accordance with the structural fill requirements of this report. If scarifying, drying and recompacting of the soils does not stabilize the soils, removing and replacement with new structural fill or treating the soils with class "C" flyash or lime-treatment of the soils clays may need to be performed.

### GEOTECHNICAL RECOMMENDATIONS

The following geotechnical related recommendations have been developed on the basis of the subsurface conditions encountered and PSI's understanding of the proposed development. Should changes in the project criteria occur, a review must be made by PSI to determine if modifications to our recommendations will be required.

#### Site Preparation

PSI recommends that topsoil, vegetation, roots, soft, organic, frozen, or unsuitable soils in the construction areas be stripped from the site and either wasted or stockpiled for later use in non-structural areas. A representative of the geotechnical engineer should evaluate and document the required depth of removal at the time of construction.

After stripping to the proposed subgrade level, as required, the building area and parking area should be proof-rolled with a loaded tandem axle dump truck or similar heavy rubber tired vehicle (typically with an axle load greater than nine (9) tons). Soils that are observed to rut or deflect excessively (typically greater than one (1) inch) under the moving load should be undercut and replaced with properly compacted low plasticity fill material. The proof-rolling and undercutting activities should be witnessed by a representative of the geotechnical engineer and should be performed during a period of dry weather. Care should be taken during construction activities not to allow excessive drying or wetting of exposed soils. The subgrade soils should be scarified and compacted to at least 95% of the materials' standard or modified Proctor maximum dry density, in general accordance with ASTM procedures, to a depth of at least twelve (12) inches below the surface.

Highly plasticity fat clays should be removed where they are present within a depth of 18 inches beneath proposed slabs or lightly loaded structural features and 6 inches beneath proposed pavements. This material should be replaced with a low plasticity compacted soil, a dense positively-drained graded crushed stone or class "C" flyash or lime-treatment of the high plastic clays can be performed. Class "C" flyash or lime-treatment of the high plastic clay would reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. A representative of PSI's geotechnical engineer should observe the subgrade soils, perform plasticity index tests, and estimate the approximate extent of the exposed fat clays. If it is desirable to modify the fat clays with a commercially available class "C" flyash or lime product, PSI recommends that actual application amounts be set by conducting a laboratory class "C" flyash or lime series test. The geotechnical engineer's representative should observe the remediation procedures for compliance with the project plans and specifications.

Moisture content changes, typically either higher than 3% above the plastic limit or lower than the plastic limit, in the highly plastic soils should not be permitted during or after construction. Increases in moisture content can cause swelling of the high plasticity soils during construction and increase shrinkage potentials due to drying after construction. If the exposed fat clays become inundated or desiccated, PSI recommends they be removed prior to new fill placement. Ideally, excavation should be performed during a period of dry weather.

After subgrade preparation and observation have been completed, fill placement required to establish grade may begin. Low-plasticity structural fill materials placed beneath the lightly loaded structural

features or slabs should be free of organic or other deleterious materials and have a maximum particle size of less than three (3) inches. Low-plasticity soils are defined as having a liquid limit less than forty-five (45) and plasticity index less than twenty-five (25). The on-site high plasticity fat clay soils may be utilized as fill material to within 1 foot below the final grade for pavements and 2 feet below the final subgrade for lightly loaded structures and building slabs. If high plasticity fat clays are utilized as fill, they should have a liquid limit no greater than seventy-five (75) and a plasticity index no greater than forty-five (45). A representative of PSI should be on-site to observe, test, and document the placement of the fill. If the fill is too dry, water should be uniformly applied and thoroughly mixed into the soil by disking or scarifying. Close moisture content control will be required to achieve the recommended degree of compaction.

Fill should be placed in maximum loose lifts of eight (8) inches and compacted to at least 95% of the materials' standard Proctor maximum dry density, and within a range of the optimum moisture content as designated in the table below, as determined in general accordance with ASTM procedures. Each lift of compacted-engineered fill should be tested and documented by a representative of the geotechnical engineer prior to placement of subsequent lifts. The edges of compacted fill should extend a minimum of five (5) feet beyond the building footprint, or a distance equal to the depth of fill beneath the footings, whichever is greater. The measurement should be taken from the outside edge of the footing to the toe of the excavation prior to sloping.

The fill placed should be tested and documented by a geotechnical technician and directed by a geotechnical engineer to evaluate the placement of fill material. It should be noted that the geotechnical engineer of record can only certify the testing that is performed and the work observed by that engineer or staff in direct report to that engineer. The fill should be evaluated in accordance with the following table:

MATERIAL TESTED	PROCTOR TYPE	MIN. DRY DENSITY	PLACEMENT MOISTURE CONTENT RANGE	FREQUENCY OF TESTING
Structural Lean Clay Fill* (Cohesive)	Standard	95%	-1 to +3 %	1 per 2,500 ft <sup>2</sup> of fill placed / lift
Structural Fat Clay Fill* (Cohesive)	Standard	95%	0 to +3%	1 per 2,500 ft <sup>2</sup> of fill placed / lift
Structural Fill (Granular)*	Standard	95%	-2 to +2 %	1 per 2,500 ft <sup>2</sup> of fill placed / lift
Random Fill (non load bearing)	Standard	90%	-3 to +3 %	1 per 6,000 ft <sup>2</sup> of fill placed / lift
Utility Trench Backfill	Standard	95%	-1 to +3 %	1 per 150 lineal foot / lift

\*Structural Fill is defined as fill beneath or supporting any improvements on site

\*1 Minimum 3 per lift.

The test frequency for the laboratory reference should be one laboratory Proctor or Relative Density test for each material used on the site. If the borrow or source of fill material changes, a new reference moisture/density test should be performed.

Tested fill materials that do not achieve either the required dry density or moisture content range shall be recorded, the location noted, and reported to the Contractor and Owner. A re-test of that area should be performed after the Contractor performs remedial measures.

#### High Plasticity Clay Considerations

Due to the presence of high plasticity clays, consideration should be given to measures that can reduce the long term shrink/swell potential of the clay soils. High plasticity clays expand or shrink by absorbing or losing moisture; therefore, reducing the moisture content variation of a soil will reduce its volume change. Although it is not possible to prevent soil moisture changes, a number of steps may be taken to aid in the reduction of subsoil moisture content variations. These steps are intended to help reduce the shrink/swell potential, not eliminate it. Some of these measures are:

1. During construction, a positive drainage scheme should be implemented and maintained to prevent ponding of water on subgrades.
2. The building subgrade should not be allowed to dry out; backfill should proceed as soon as possible to minimize changes in the natural moisture regime.
3. Permanent positive drainage should be maintained around the building through a roof/gutter system connected to drainage piping or discharging upon paved surfaces, thereby transmitting water away from the foundation perimeter. In addition, site grading should provide rapid drainage of surface water away from foundation areas.
4. Utility trenches should be backfilled with low plasticity clays to reduce the potential of the trenches to act as aqueducts transmitting water beneath the structures due to excess surface water infiltration.
5. Shrubbery, flower beds and sprinkler systems surrounding the structures should be eliminated or at least limited, and should be designed so that the bedding soils drain away from the building areas. The planters should have impermeable bases with weep holes discharging into drainage pipes or onto paved surfaces.
6. Trees and/or large bushes should not be planted adjacent to the structures.
7. Since plumbing and other water leaks can cause excessive heaving of high plasticity soils, every effort should be made to maintain the plumbing in good working order and prevent or minimize water leaks and discharges. It is recommended that all water supply lines and waste water lines be tested for leaks prior to backfilling the utility trenches.

#### Foundation Recommendations

Footings for the building should bear on similar materials. PSI anticipates that clay and weathered shale/shale and weathered limestone will be encountered depending on final design elevations. However, the clay bearing material will be relatively wet and weak in comparison to the shale and limestone. PSI recommends that footing excavations be extended to where all foundations bear on one type of bearing material. If the final design elevations do not allow for this option and footings are to bear on a combination of shale/limestone and clay then the relatively hard rock should be over-excavated and backfilled with a low plasticity material to a depth of approximately one (1) foot. The footings will then bear on similar material, which reduces the potential of relative differential settlement. Spread footings for exhibit columns and continuous footings for bearing walls can be designed for the following allowable soil bearing pressures:

Bearing Surface	Column Footings	Continuous Footings
Lean and Fat Clay	3,000	2,500
Shale/Limestone	5,000	5,000
Engineered Fill	3,000	2,500

PSI recommends a minimum dimension of twenty-four (24) inches for square footings and eighteen (18) inches for continuous footings to minimize the possibility of a local bearing capacity failure.

Exterior footings and footings in unheated areas should be located at a depth of thirty-six (36) inches or deeper below the final exterior grade to provide adequate frost protection. If the building is to be constructed during the winter months or if footings will likely be subjected to freezing temperatures after foundation construction, then the footings should be protected from freezing. PSI recommends that interior footings be a minimum depth of eighteen (18) inches below the finished floor elevation. Footings bearing on competent rock can be located at nominal depths compatible with architectural and structural considerations.

The foundation excavations should be observed and documented by a representative of PSI prior to steel or concrete placement to assess that the foundation materials are consistent with the materials discussed in this report, and therefore are capable of supporting the design loads. Soft or loose soil zones encountered at the bottom of the footing excavations should be removed to the level of competent naturally deposited soils or properly compacted structural fill as directed by the geotechnical engineer. Cavities formed as a result of excavation of soft or loose soil zones should be backfilled with lean concrete or dense graded compacted crushed stone.

After opening, footing excavations should be observed and concrete placed as quickly as possible to avoid exposure of the footing bottoms to wetting and drying. Surface run-off water should be drained away from the excavations and not be allowed to pond. If possible, the foundation concrete should be placed during the same day the excavation is made. If it is required that footing excavations be left open for more than one day, they should be protected to reduce evaporation or entry of moisture.

Based on the known subsurface conditions and site geology, laboratory testing and past experience, PSI anticipates that properly designed and constructed footings supported on the recommended materials should experience total and differential settlement between adjacent columns of less than one (1) inch and  $\frac{3}{4}$  inch, respectively.

Be advised that as a part of the foundation selection process, there is a cost/benefit evaluation. Although PSI is recommending a specific foundation type, we have not accomplished the cost/benefit evaluation.

#### Earthquake and Seismic Design Consideration

The 2009 International Building Code requires a site class for the calculation of earthquake design forces. This class is a function of soil type (i.e., depth of soil and strata types). Based on the depth to rock and the estimated shear strength of the soil at the boring locations, Site Class "C" is recommended. The USGS-NEHRP probabilistic ground motion values near latitude 38.9649° and longitude -94.3605° are as follows:

SEISMIC HAZARD ZONE	RECENT (10 YEAR)	INTERMEDIATE (10 YEAR)	SEVERE (10 YEAR)
PGA	5.6	---	---
0.2 (S <sub>s</sub> )	12.8	1.2	---
1.0 (S <sub>1</sub> )	6.1	---	1.7

The Site Coefficients,  $F_a$  and  $F_v$  were interpolated from IBC 2009 Tables 1613.5.3(1) and 1613.5.3(2) as a function of the site classifications and the mapped spectral response acceleration at the short ( $S_s$ ) and 1 second ( $S_1$ ) periods.

### Floor Slab Recommendations

The floor slab can be grade supported on a minimum of 18 inches of properly compacted low plasticity structural fill. Alternatively, class "C" flyash or lime-treatment of the medium to high plastic clay can be accomplished to reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. Proof-rolling, as discussed earlier in this report, should be accomplished to identify soft or unstable soils that should be removed from the floor slab area prior to fill placement and/or floor slab construction. These soils should be replaced with properly compacted structural fill as described earlier in this report.

PSI recommends that a minimum four (4) inch thick free-draining well graded granular mat be placed beneath the floor slab to enhance drainage. This 4 inch mat can be included in the 18 inches of remediation recommended in the areas of undocumented fill and fat clay. The soil surface shall be graded to drain away from the building without low spots that can trap water prior to placing the granular drainage layer. Polyethylene sheeting should be placed to act as a vapor retarder where the floor will be in contact with moisture sensitive equipment or products such as tile, wood, carpet, etc., as directed by the design professional. The decision to locate the vapor retarder in direct contact with the slab or beneath the layer of granular fill should be made by the design professional after considering the moisture sensitivity of subsequent floor finishes, anticipated project conditions, and the potential effects of slab curling and cracking. The floor slabs should have an adequate number of joints to reduce cracking resulting from differential movement and shrinkage.

For subgrade prepared as recommended and properly compacted fill, a modulus of subgrade reaction,  $k$  value, of 140 pounds per cubic inch (pci) may be used in the grade slab design based on correlation to values typically resulting from a 1 ft. x 1 ft. plate load test. However, depending on how the slab load is applied, the value will have to be geometrically modified. Where slab loading is distributed over more than a 1 foot by 1 foot area, the value  $k$  should be adjusted for larger areas using the following expression for cohesive and cohesionless soil:

Modulus of Subgrade Reaction,  $k_s = \left(\frac{k}{B}\right)$  for cohesive soil and

$$k_s = k \left(\frac{B+1}{2B}\right)^2 \text{ for cohesionless soil}$$

Where:  $k_s$  = coefficient of vertical subgrade reaction for loaded area,  
 $k$  = coefficient of vertical subgrade reaction for 1 square foot area, and  
 $B$  = effective width of area loaded, in feet

The precautions listed below should be followed for construction of slab-on-grade pads. These details will not reduce the amount of movement, but are intended to reduce potential damage should some settlement of the supporting subgrade take place. Some increase in moisture content is inevitable as a result of development and associated landscaping. However, extreme moisture content increases can be largely controlled by proper and responsible site drainage, building maintenance and irrigation practices.

- Cracking of slab-on-grade concrete is normal and should be expected. Cracking can occur not only as a result of heaving or compression of the supporting soil and/or bedrock material, but also as a result of concrete curing stresses. The occurrence of concrete shrinkage crack, and problems associated with concrete curing may be reduced and/or controlled by limiting the slump of the concrete, proper concrete placement, finishing, and curing, and by the placement of crack control joints at frequent intervals, particularly where re-entrant slab corners occur. The American Concrete Institute (ACI) recommends a maximum panel size (in feet) equal to approximately three times the thickness of the slab (in inches) in both directions. For example, joints are recommended at a maximum spacing of twelve (12) feet based on having a four-inch slab. PSI also recommends that the slab be independent of the foundation walls. Using fiber reinforcement in the concrete can also control shrinkage cracking.
- Areas supporting slabs should be properly moisture conditioned and compacted. Backfill in all interior and exterior water and sewer line trenches should be carefully compacted to reduce the shear stress in the concrete extending over these areas.

Exterior slabs should be isolated from the building. These slabs should be reinforced to function as independent units. Movement of these slabs should not be transmitted to the building foundation or superstructure.

#### Utilities Trenching

Excavation for utility trenches shall be performed in accordance with OSHA regulations as stated in 29 CFR Part 1926. It should be noted that utility trench excavations have the potential to degrade the properties of the adjacent fill materials. Utility trench walls that are allowed to move laterally can lead to reduced bearing capacity and increased settlement of adjacent structural elements and overlying slabs.

Backfill for utility trenches is as important as the original subgrade preparation or structural fill placed to support either a foundation or slab. Therefore, it is imperative that the backfill for utility trenches be placed to meet the project specifications for the structural fill of this project. PSI recommends that flowable fill or lean mix concrete be utilized for utility trench backfill. If on-site soils are placed as trench backfill, the backfill for the utility trenches should be placed in four (4) to six (6) inch loose lifts and compacted to a minimum of 95% of the maximum dry density achieved by the standard Proctor test. The backfill soil should be moisture conditioned to be within 2% of the optimum moisture content as determined by the standard Proctor test. Up to four (4) inches of bedding material placed directly under the pipes or conduits placed in the utility trench can be compacted to the 90% compaction criteria with respect to the standard Proctor. Compaction testing should be performed for every 200 cubic yards of backfill place or each lift within 200 linear feet of trench, which ever is less. Backfill of utility trenches should not be performed with water standing in the trench. If granular material is used for the backfill of the utility trench, the granular material should have a gradation that will filter protect the backfill material from the adjacent soils. If this gradation is not available, a geosynthetic non-woven filter fabric should be used to reduce the potential for the migration of fines into the backfill material. Granular backfill material shall be compacted to meet the above compaction criteria. The clean granular backfill material should be compacted to achieve a relative density greater than 75% or as specified by the geotechnical engineer for the specific material used.

### Pavement Recommendations

PSI's scope of services did not include extensive sampling and CBR testing of existing subgrade or potential sources of imported fill for the specific purpose of detailed pavement analysis. Instead, this report is based on pavement-related design parameters that are considered to be typical for the area soils types.

Pavement sections can be grade supported on a minimum of 6 inches of properly compacted low plasticity structural fill. The crushed stone base can be included in the 6 inches of remediation recommended in the areas. Proof-rolling, as discussed earlier in this report, should be accomplished to identify soft or unstable soils that should be removed from the pavement area prior to fill placement and/or pavement construction. These soils should be replaced with properly compacted structural fill as described earlier in this report.

Pavement sections were evaluated using Pavement Assessment Software (PAS), which is based on the 1993 AASHTO Design equations, a reliability of 80%, an annual growth rate of 2%, and a 20 year equivalent 18-kip single axle load (ESAL) of 30,000 for light duty pavements and 60,000 for heavy duty pavements. Flexible Pavements were evaluated based on an initial serviceability of 4.2 and a terminal service of 2.0. Rigid Pavements were evaluated based on an initial serviceability of 4.5, a terminal service of 2.0, an unreinforced concrete mix with a 28-day modulus of rupture of 650 pounds per square inch (psi) (approximately 4,000 psi compressive strength), are assumed to be edge supported, and dowel and mesh reinforced.

In large areas of pavement, or where pavements are subject to significant traffic, a more detailed analysis of the subgrade and traffic conditions should be made. The results of such a study will provide information necessary to design an economical and serviceable pavement.

The recommended thicknesses presented below are considered typical and minimum for the assumed parameters. The client, the owner, and the project principals should be aware that thinner pavement sections might result in increased maintenance costs and lower than anticipated pavement life. The pavement subgrade should be prepared as discussed below.

The PSI recommendation is based on the subgrade soils being prepared to achieve a minimum CBR of three (3). On this basis, it is possible to use a locally typical "standard" pavement section consisting of the following:

RECOMMENDED THICKNESSES (INCHES)		
PAVEMENT MATERIALS*	CAR PARKING	DRIVEWAYS
Asphaltic Surface Course	1½	1½
Asphaltic Binder Course	2	3½
Crushed stone (¾-inch minus)	6	6
Or		
Portland Cement Concrete	5	6
Crushed stone (¾-inch minus)	4	4

\*Pavement materials should conform to local and state guidelines, if applicable.



### Asphalt Pavement

The granular base course should be built at least two (2) feet wider than the pavement on each side to support the tracks of the slipform paver. This extra width is structurally beneficial for wheel loads applied at the pavement edge. The asphalt base course should be compacted to a minimum of 95% Marshall density according to ASTM D1559.

Asphaltic surface mixture should have a minimum stability of 1,800 pounds and the surface course should be compacted to a minimum of 97% Marshall density according to ASTM D1559. Asphalt mixes should comply with APWA or MODOT specifications.

Asphaltic concrete mix designs and Marshall characteristics should be reviewed to determine if they are consistent with the recommendations given in this report.

### Concrete Pavement

Because the pavement at this site will be subjected to freeze-thaw cycles, PSI recommends that an air entrainment admixture be added to the concrete mix to achieve air content in the range of 5% to 7% to provide freeze-thaw durability in the concrete. PSI recommends that a Concrete with a 28-day specified compressive strength of 4,000 psi should be used. A mixture with a maximum slump of four (4) inches is acceptable. If a water reducing admixture is specified, the slump can be higher. It is recommended that admixtures be submitted to the owner in advance of use in the concrete.

Pavement for any dumpster areas or areas subject to consistent heavy loads should be constructed of Portland cement concrete with load transfer devices installed where construction joints are required. A thickened edge is recommended on the outside of slabs subjected to wheel loads. This thickened edge usually takes the form of an integral curb. Fill material should be compacted behind the curb or the edge of the outside slabs should be thickened. The following are recommended to enhance the quality of the pavement.

- Moisten subgrade just prior to placement of concrete.
- Cure fresh concrete with a liquid membrane-forming curing compound.
- Keep automobile traffic off the slab for three (3) days and truck traffic off the slab for seven (7) days, unless tests are made to determine that the concrete has gained adequate strength (i.e., usually 70% of design strength).

### Pavement Subgrade Preparation

Prior to paving, the prepared subgrade should be proof-rolled using a loaded tandem axle dump truck or similar type of pneumatic tired equipment with a minimum gross weight of nine (9) tons per single axle. Localized soft areas identified should be repaired prior to paving. Moisture content of the subgrade should be maintained between -2% and +3% of the optimum at the time of paving. It may require rework when the subgrade is either desiccated or wet.

Construction traffic should be minimized to prevent unnecessary disturbance of the pavement subgrade. Disturbed areas, as verified by PSI, should be removed and replaced with properly compacted material.

The edges of compacted fill should extend a minimum two (2) feet beyond the edges of the pavement, or a distance equal to the depth of fill beneath the pavement, whichever is greater. The measurement should be taken from the outside edge of the pavement to the toe of the excavation prior to sloping.

### Pavement Drainage & Maintenance

PSI recommends pavements be sloped to provide rapid surface drainage. Water allowed to pond on or adjacent to the pavement could saturate the subgrade, cause premature deterioration of the pavements, and may require removal and replacement. PSI recommends the subgrade be sloped to drain prior to placing the crushed stone base. Consideration should be given to the use of interceptor drains to collect and remove water collecting in the crushed stone base. The interceptor drains could be incorporated with the storm drains of other utilities located in the pavement areas.

Periodic maintenance of the pavement should be anticipated. This should include sealing of cracks and joints and by maintaining proper surface drainage to avoid ponding of water on or near the pavement areas. Underdrains, sub-drains and underslab drains presented in this report will not prevent moisture vapor that can cause mold growth.

### **CONSTRUCTION CONSIDERATIONS**

PSI should be retained to provide observation and testing of construction activities involved in the foundation, earthwork, and related activities of this project. PSI cannot accept responsibility for conditions that deviate from those described in this report, nor for the performance of the foundation system if not engaged to also provide construction observation and testing for this project.

#### Moisture Sensitive Soils/Weather Related Concerns

The upper fine-grained soils encountered at this site may be sensitive to disturbances caused by construction traffic and to changes in moisture content. During wet weather periods, increases in the moisture content of the soil can cause significant reduction in the soil strength and support capabilities. In addition, soils that become wet may be slow to dry and thus significantly retard the progress of grading and compaction activities. It will, therefore, be advantageous to perform earthwork and foundation construction activities during dry weather.

#### Drainage and Groundwater Considerations

PSI recommends that the Contractor determine the actual groundwater levels at the site at the time of the construction activities to assess the impact groundwater may have on construction. Water should not be allowed to collect in the foundation excavation, on floor slab areas, or on prepared subgrades of the construction area either during or after construction. Undercut or excavated areas should be sloped toward one corner to facilitate removal of collected rainwater, groundwater, or surface runoff. Positive site drainage should be provided to reduce infiltration of surface water around the perimeter of the building and beneath the floor slabs. The grades should be sloped away from the building and surface drainage should be collected and discharged such that water is not permitted to infiltrate the backfill and floor slab areas of the building.

#### Excavations

In Federal Register, Volume 54, Number 209 (October 1989), the United States Department of Labor, Occupational Safety and Health Administration (OSHA) amended its "Construction Standards for Excavations, 29 CFR, part 1926, Subpart P". This document was issued to better enhance the safety of workers entering trenches or excavations. It is mandated by this federal regulation that excavations, whether they be utility trenches, basement excavation or footing excavations, be constructed in accordance with the new OSHA guidelines. It is PSI's understanding that these regulations are being strictly enforced and if they are not closely followed, the owner and the contractor could be liable for substantial penalties.

The contractor is solely responsible for designing and constructing stable, temporary excavations and should shore, slope, or bench the sides of the excavations as required to maintain stability of both the excavation sides and bottom. The contractor's "responsible person", as defined in 29 CFR Part 1926, should evaluate the soil exposed in the excavations as part of the contractor's safety procedures. In no case should slope height, slope inclination, or excavation depth, including utility trench excavation depth, exceed those specified in local, state, and federal safety regulations.

PSI is providing this information solely as a service to our client. PSI does not assume responsibility for construction site safety or the contractor's or other parties' compliance with local, state, and federal safety or other regulations.

### **GEOTECHNICAL RISK**

The concept of risk is an important aspect of the geotechnical evaluation. The primary reason for this is that the analytical methods used to develop geotechnical recommendations do not comprise an exact science. The analytical tools which geotechnical engineers use are generally empirical and must be used in conjunction with engineering judgment and experience. Therefore, the solutions and recommendations presented in the geotechnical evaluation should not be considered risk-free and, more importantly, are not a guarantee that the interaction between the soils and the proposed structure will perform as planned. The engineering recommendations presented in the preceding section constitutes PSI's professional estimate of those measures that are necessary for the proposed structure to perform according to the proposed design based on the information generated and referenced during this evaluation, and PSI's experience in working with these conditions.

### **REPORT LIMITATIONS**

The recommendations submitted are based on the available subsurface information obtained by PSI and design details furnished by Frontier Justice and their consultants. If there are revisions to the plans for this project or if deviations from the subsurface conditions noted in this report are encountered during construction, PSI should be notified immediately to determine if changes in the foundation recommendations are required. If PSI is not retained to perform these functions, PSI will not be responsible for the impact of those conditions on the project.

The geotechnical engineer warrants that the findings, recommendations, specifications, or professional advice contained herein have been made in accordance with generally accepted professional geotechnical engineering practices in the local area. No other warranties are implied or expressed.

After the plans and specifications are more complete, the geotechnical engineer should be retained and provided the opportunity to review the final design plans and specifications to check that our engineering recommendations have been properly incorporated into the design documents. At that time, it may be necessary to submit supplementary recommendations. This report has been prepared for the exclusive use of Frontier Justice and their consultant for the specific application to the proposed Frontier Justice development on the northeast corner of Independence Avenue and Jones Drive in Lee's Summit, Missouri.

---

---

## Appendix

**Site Vicinity Map**

Professional Service Industries, Inc.



Site Vicinity Plan  
Frontier Justice  
NEC of Independence Ave and Jones Drive  
Lee's Summit, MO


PSI Project No:	338-888
Aerial Year:	2012
Drawing Date:	2/28/14
Drawn By:	AR

---

---

**Boring Location Plan**

Professional Service Industries, Inc.

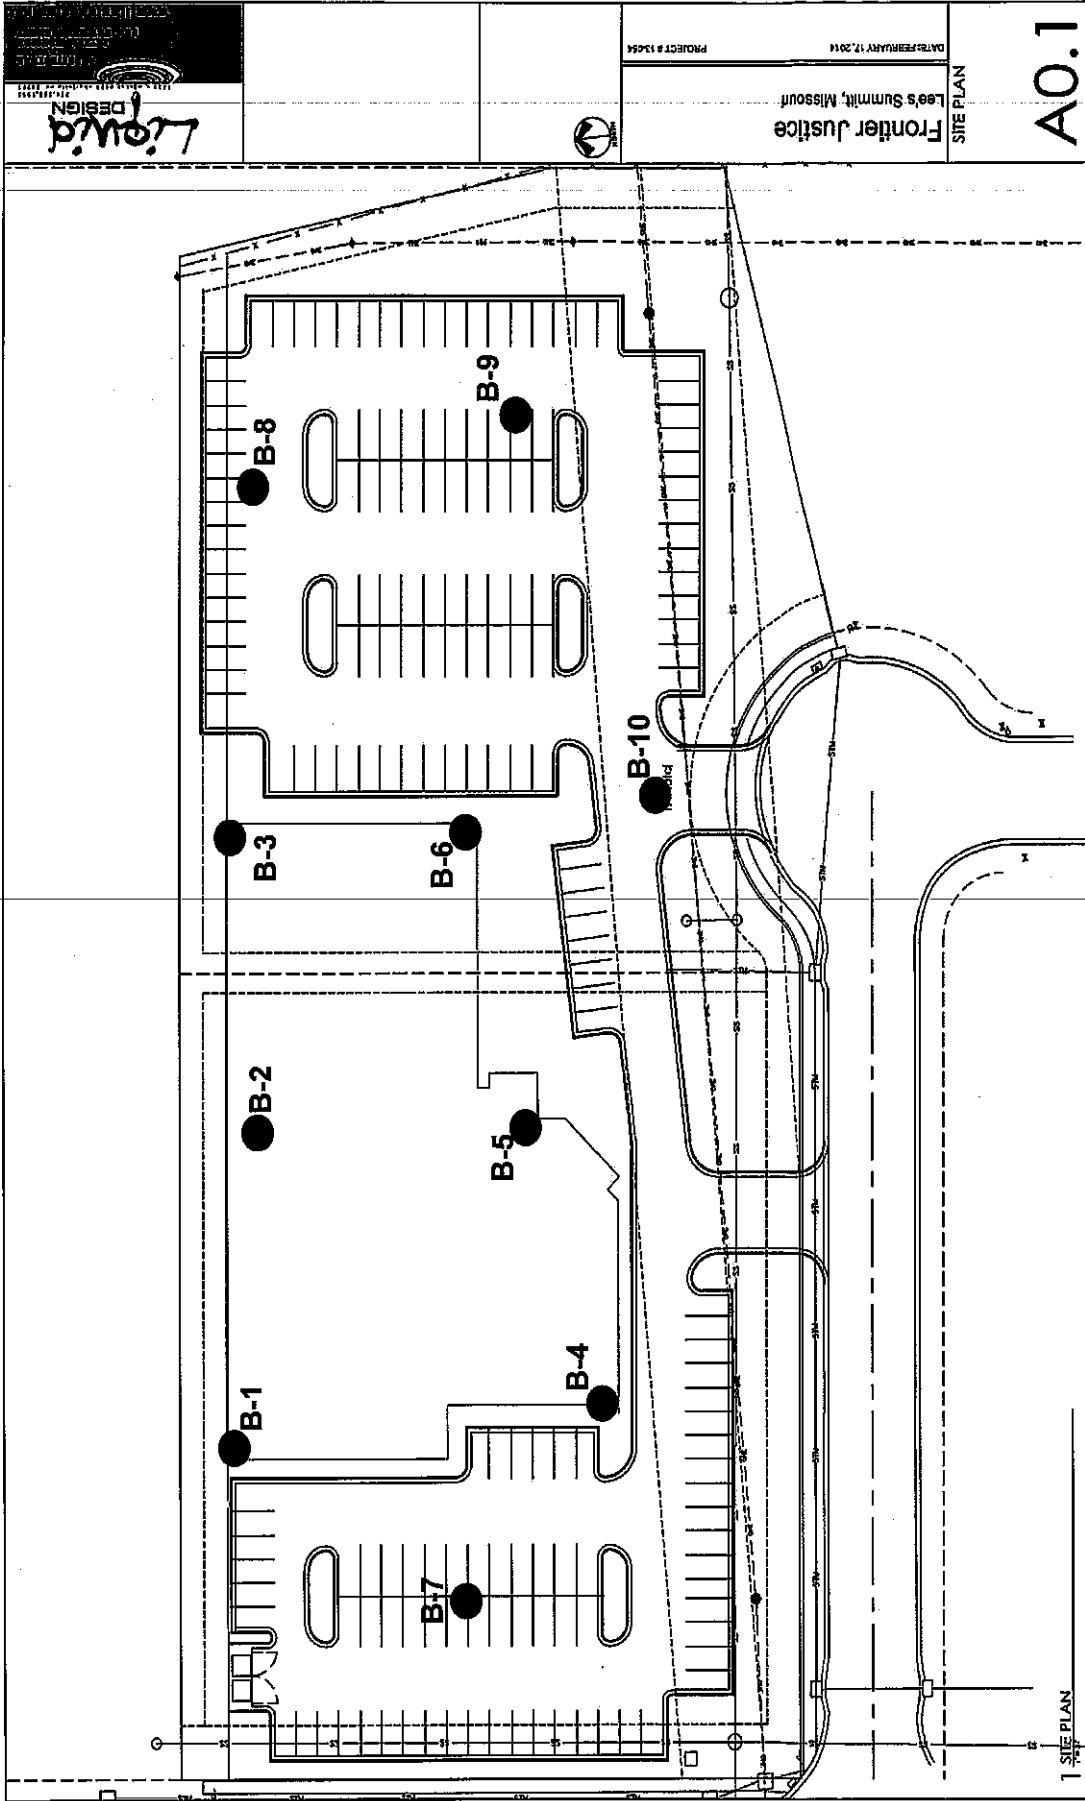

Not to scale

Boring Location Diagram  
Frontier Justice  
NE Jones Drive  
Lee's Summit, Missouri

PSI Proposal No.:

338115386

Date:

2/18/13

Drawn By:

SDB



---

---

**Boring Logs**

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-01</b>
DATE COMPLETED: 3/4/14	DRILLER: DJK    LOGGED BY: JRB	
COMPLETION DEPTH: 14.0 ft	DRILL RIG: CME-55	Water
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	While Drilling: not observed
ELEVATION: N/A	SAMPLING METHOD: SS/ST	Upon Completion: not observed
LATITUDE: 38.9649°	HAMMER TYPE: Automatic	Delay: N/A
LONGITUDE: -94.3602°	EFFICIENCY: 81%	<b>BORING LOCATION:</b> See Location Plan
STATION: N/A    OFFSET: N/A	REVIEWED BY: SB	

REMARKS: N<sub>60</sub> denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS) Push Pressure (ST)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @	Additional Remarks
									X Moisture    PL LL	STRENGTH, tsf ▲ Qu    * Qp	
0		ORGANIC LAYER - 4 inches				<b>HIGH PLASTICITY CLAY</b> - brown and dark gray brown, moist, stiff		3-5-6 N <sub>60</sub> =15	24	LL = 52 PL = 22	
				1	12	High plasticity clay, brown and dark gray brown					
				2	16	Grading, brown and reddish brown	CH				DD = 103 pcf Sat = 97% Q <sub>u</sub> = 2.8 tsf
5				3	13			3-3-5 N <sub>60</sub> =11	25		
				4	11	Grading, light brown and light gray brown		2-2-2 N <sub>60</sub> =5	38		
10						<b>WEATHERED LIMESTONE</b>					
						Auger refusal at 14 feet.					



Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-02</b>
DATE COMPLETED: 3/4/14	DRILLER: DJK LOGGED BY: JRB	
COMPLETION DEPTH: 13.5 ft	DRILL RIG: CME-55	Water <input type="checkbox"/> While Drilling not observed
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	<input type="checkbox"/> Upon Completion not observed
ELEVATION: N/A	SAMPLING METHOD: SS	<input type="checkbox"/> Delay N/A
LATITUDE: 38.9649°	HAMMER TYPE: Automatic	<b>BORING LOCATION:</b> See Location Plan
LONGITUDE: -94.3602°	EFFICIENCY: 81%	
STATION: N/A	OFFSET: N/A	REVIEWED BY: SB

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	STANDARD PENETRATION TEST DATA		Additional Remarks
									N in blows/ft $\odot$		
									Moisture, %		
										Strength, tsf	
										Qu $\blacktriangle$ $\ast$ Qp $\ast$	
0						<b>ORGANIC LAYER - 4 inches</b> <b>HIGH PLASTICITY CLAY</b> - brown and gray brown, moist, stiff					
				1	13			3-5-5 $N_{60}=14$	26		
				2	14	Grading, brown and reddish brown		3-3-4 $N_{60}=9$	27		
5				3	18		CH	8-3-5 $N_{60}=11$	28		
				4	15	Grading, shaley, light brown and light gray		3-6-7 $N_{60}=18$	19		
10						<b>WEATHERED SHALE</b> - light gray brown					
						<b>WEATHERED LIMESTONE</b>					
						Auger refusal at 13 1/2 feet.					



Professional Service Industries, Inc.  
1211 W. Cambridge Circle Drive  
Kansas City, KS 66103  
Telephone: (913) 310-1600

PROJECT NO.: 338-888  
PROJECT: Frontier Justice  
LOCATION: EC of Jones Drive and Independence Ave.  
Lee's Summit, MO

DATE STARTED: 3/4/14		DRILL COMPANY: PSI Inc.		<b>BORING B-03</b>	
DATE COMPLETED: 3/4/14		DRILLER: DJK		LOGGED BY: JRB	
COMPLETION DEPTH: 15.0 ft		DRILL RIG: CME-55		Water	
BENCHMARK: N/A		DRILLING METHOD: 3 1/4" HSA		<input type="checkbox"/> While Drilling not observed <input type="checkbox"/> Upon Completion not observed <input type="checkbox"/> Delay N/A	
ELEVATION: N/A		SAMPLING METHOD: SS		BORING LOCATION:	
LATITUDE: 38.9649°		HAMMER TYPE: Automatic		See Location Plan	
LONGITUDE: -94.3602°		EFFICIENCY: 81%			
STATION: N/A		OFFSET: N/A		REVIEWED BY: SB	

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	STANDARD PENETRATION TEST DATA				Additional Remarks
									N in blows/ft @		STRENGTH, tsf		
									Moisture, %	PL	LL		
									0 25 50	X	Moisture	Moisture	
										▲ Qu	* Qp		
									0 2.0 4.0				
0						<b>ORGANIC LAYER - 4 inches</b> <b>HIGH PLASTICITY CLAY</b> - brown and reddish brown, moist, stiff		3-4-4 $N_{60}=11$	25				
				1	13								
				2	12		CH	3-3-4 $N_{60}=9$	26				
5						Grading, shaley, light brown and light gray		3-5-6 $N_{60}=15$	24				
				3	16								
				4	10	<b>WEATHERED SHALE</b> - light brown and light gray brown, moist, very stiff		6-8-14 $N_{60}=30$	19				
						<b>SHALE</b> - light gray, moist, hard							
10													
				5	11			11-14-50/5'	14				
15						Boring terminated at 15 feet.							



Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-04</b>
DATE COMPLETED: 3/4/14	DRILLER: DJK    LOGGED BY: JRB	
COMPLETION DEPTH: 14.8 ft	DRILL RIG: CME-55	Water
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	▽ While Drilling    not observed
ELEVATION: N/A	SAMPLING METHOD: SS/ ST	▼ Upon Completion    not observed
LATITUDE: 38.9649°	HAMMER TYPE: Automatic	▽ Delay    N/A
LONGITUDE: -94.3602°	EFFICIENCY: 81%	<b>BORING LOCATION:</b> See Location Plan
STATION: N/A    OFFSET: N/A	REVIEWED BY: SB	

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS) Push Pressure (ST)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @	Additional Remarks
0						<b>ORGANIC LAYER - 4 Inches</b> <b>MEDIUM PLASTICITY CLAY</b> - gray brown, moist, stiff	CL-CH	4-5-5 $N_{60}=14$	26	Moisture: X PL: <input checked="" type="checkbox"/> LL: <input checked="" type="checkbox"/>	
				1	11						
				2	15	<b>HIGH PLASTICITY CLAY</b> - brown and reddish brown, moist, stiff			26		DD = 94 pcf Sat = 90% $Q_u = 2.1$ tsf
5				3	18		CH	4-5-6 $N_{60}=15$	21		
				4	18			4-4-5 $N_{60}=12$	27		
10				5	6	<b>WEATHERED SHALE</b> - light brown and light gray brown, moist, hard		2-50	23		
						Auger refusal at 14½ feet.					



Professional Service Industries, Inc.  
1211 W. Cambridge Circle Drive  
Kansas City, KS 66103  
Telephone: (913) 310-1600

PROJECT NO.: 338-888  
PROJECT: Frontier Justice  
LOCATION: EC of Jones Drive and Independence Ave.  
Lee's Summit, MO

DATE STARTED: 3/4/14		DRILL COMPANY: PSI Inc.		<b>BORING B-05</b>	
DATE COMPLETED: 3/4/14		DRILLER: DJK		LOGGED BY: JRB	
COMPLETION DEPTH: 14.0 ft		DRILL RIG: CME-55		Water	
BENCHMARK: N/A		DRILLING METHOD: 3 1/4" HSA		<input type="checkbox"/> While Drilling not observed <input type="checkbox"/> Upon Completion not observed <input type="checkbox"/> Delay N/A	
ELEVATION: N/A		SAMPLING METHOD: SS		BORING LOCATION:	
LATITUDE: 38.9649°		HAMMER TYPE: Automatic		See Location Plan	
LONGITUDE: -94.3602°		EFFICIENCY: 81%			
STATION: N/A		OFFSET: N/A		REVIEWED BY: SB	

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4833.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	STANDARD PENETRATION TEST DATA		Additional Remarks	
									N in blows/ft @			
									Moisture, %	Strength, tsf		
									0 25 50	<input type="checkbox"/> Moisture <input type="checkbox"/> PL <input type="checkbox"/> LL		
										0 2.0 4.0	<input type="checkbox"/> Qu <input type="checkbox"/> Qp	
0		ORGANIC LAYER - 4 inches										
		HIGH PLASTICITY CLAY - brown and dark gray brown, moist, stiff		1	10			4-6-5 $N_{60}=15$	24			
		Grading, brown and reddish brown		2	18		CH	4-4-5 $N_{60}=12$	24			
5				3	18			3-3-4 $N_{60}=9$	29			
		Grading, shaley, light brown and light gray		4	16			2-4-6 $N_{60}=14$	25			
10		WEATHERED LIMESTONE										
		LIMESTONE										
		Auger refusal at 14 feet.										




Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-06</b>									
DATE COMPLETED: 3/4/14	DRILLER: DJK    LOGGED BY: JRB										
COMPLETION DEPTH: 4.0 ft	DRILL RIG: CME-55	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width:5%; text-align: center;">Water</td> <td style="width:15%;"><input type="checkbox"/> While Drilling</td> <td style="width:80%;">not observed</td> </tr> <tr> <td></td> <td><input type="checkbox"/> Upon Completion</td> <td>not observed</td> </tr> <tr> <td></td> <td><input type="checkbox"/> Delay</td> <td>N/A</td> </tr> </table>	Water	<input type="checkbox"/> While Drilling	not observed		<input type="checkbox"/> Upon Completion	not observed		<input type="checkbox"/> Delay	N/A
Water	<input type="checkbox"/> While Drilling		not observed								
	<input type="checkbox"/> Upon Completion		not observed								
	<input type="checkbox"/> Delay	N/A									
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	BORING LOCATION: See Location Plan									
ELEVATION: N/A	SAMPLING METHOD: SS										
LATITUDE: 38.9649°	HAMMER TYPE: Automatic										
LONGITUDE: -94.3602°	EFFICIENCY: 81%										
STATION: N/A    OFFSET: N/A	REVIEWED BY: SB										

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©	Additional Remarks
										X Moisture <input type="checkbox"/> PL <input type="checkbox"/> LL	
										STRENGTH, tsf ▲ Qu    * Qp	
	0			1	11	<b>ORGANIC LAYER - 4 inches</b> <b>MEDIUM PLASTICITY CLAY</b> - gray brown, moist, stiff low plasticity, gray brown  <b>WEATHERED LIMESTONE</b>  Auger refusal at 4 feet.	CL-CH	4-3-5 $N_{60}=11$	26	© <input checked="" type="checkbox"/> X <input checked="" type="checkbox"/>	LL = 47 PL = 21



Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

The stratification lines represent approximate boundaries. The transition may be gradual.

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-07</b>
DATE COMPLETED: 3/4/14	DRILLER: DJK LOGGED BY: JRB	
COMPLETION DEPTH: 5.0 ft	DRILL RIG: CME-55	Water: <input type="checkbox"/> While Drilling not observed
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	<input type="checkbox"/> Upon Completion not observed
ELEVATION: N/A	SAMPLING METHOD: SS	<input type="checkbox"/> Delay N/A
LATITUDE: 38.9649°	HAMMER TYPE: Automatic	<b>BORING LOCATION:</b> See Location Plan
LONGITUDE: -94.3602°	EFFICIENCY: 81%	
STATION: N/A	OFFSET: N/A	
	REVIEWED BY: SB	

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4833.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA				Additional Remarks
										N in blows/ft @				
										<input type="checkbox"/> Moisture	<input type="checkbox"/> PL	<input type="checkbox"/> LL		
										STRENGTH, tsf				
										<input type="checkbox"/> Qu	<input type="checkbox"/> *	<input type="checkbox"/> Qp		
0						<b>ORGANIC LAYER - 4 inches</b> <b>MEDIUM PLASTICITY CLAY</b> - dark gray brown, moist, stiff								
				1	13		CL-CH	6-5-7 $N_{60}=16$	23					
				2	11	grading, brown and dark gray brown		7-6-6 $N_{60}=16$	20					
5						Boring terminated at 5 feet.								




Professional Service Industries, Inc.  
1211 W. Cambridge Circle Drive  
Kansas City, KS 66103  
Telephone: (913) 310-1600

PROJECT NO.: 338-888  
PROJECT: Frontier Justice  
LOCATION: EC of Jones Drive and Independence Ave.  
Lee's Summit, MO



DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-08</b>												
DATE COMPLETED: 3/4/14	DRILLER: DJK    LOGGED BY: JRB													
COMPLETION DEPTH: 4.5 ft	DRILL RIG: CME-55	<table style="width:100%; border-collapse: collapse;"> <tr> <td style="width:5%; text-align: center;">Water</td> <td style="width:10%; text-align: center;">▽</td> <td style="width:75%;">While Drilling</td> <td style="width:10%;">not observed</td> </tr> <tr> <td></td> <td style="text-align: center;">∇</td> <td>Upon Completion</td> <td>not observed</td> </tr> <tr> <td></td> <td style="text-align: center;">∇</td> <td>Delay</td> <td>N/A</td> </tr> </table>	Water	▽	While Drilling	not observed		∇	Upon Completion	not observed		∇	Delay	N/A
Water	▽		While Drilling	not observed										
	∇		Upon Completion	not observed										
	∇	Delay	N/A											
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	BORING LOCATION: See Location Plan												
ELEVATION: N/A	SAMPLING METHOD: SS													
LATITUDE: 38.9649°	HAMMER TYPE: Automatic													
LONGITUDE: -94.3602°	EFFICIENCY: 81%													
STATION: N/A    OFFSET: N/A	REVIEWED BY: SB													

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @	Additional Remarks
										X Moisture <input type="checkbox"/> PL <input type="checkbox"/> LL	
										STRENGTH, tsf ▲ Qu    * Qp	
0				1	18	<b>ORGANIC LAYER - 4 inches</b> <b>HIGH PLASTICITY CLAY</b> - reddish brown, moist, stiff  <b>WEATHERED LIMESTONE</b>  Auger refusal at 4 1/2 feet.	CH	3-4-6 $N_{60}=14$	25	◎    X	



Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-09</b>
DATE COMPLETED: 3/4/14	DRILLER: DJK    LOGGED BY: JRB	
COMPLETION DEPTH: 5.0 ft	DRILL RIG: CME-55	Water <input type="checkbox"/> While Drilling    not observed
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	Water <input type="checkbox"/> Upon Completion    not observed
ELEVATION: N/A	SAMPLING METHOD: SS	Water <input type="checkbox"/> Delay    N/A
LATITUDE: 38.9649°	HAMMER TYPE: Automatic	<b>BORING LOCATION:</b>
LONGITUDE: -94.3602°	EFFICIENCY: 81%	See Location Plan
STATION: N/A    OFFSET: N/A	REVIEWED BY: SB	

REMARKS: N<sub>60</sub> denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©	Additional Remarks
										<input type="checkbox"/> Moisture <input type="checkbox"/> PL <input type="checkbox"/> LL	
										STRENGTH, tsf <input type="checkbox"/> Qu <input type="checkbox"/> * <input type="checkbox"/> Qp	
0		M.L. 3				<b>ORGANIC LAYER - 4 Inches</b>					
		M.L. 3				<b>HIGH PLASTICITY CLAY</b> - brown and reddish brown, moist, stiff					
		M.L. 3		1	10	Grading, limestone seam	CH	3-4-5 N <sub>60</sub> =12	22	<input type="checkbox"/>	
		M.L. 3		2	18	Grading, soft		1-1-2 N <sub>60</sub> =4	46	<input type="checkbox"/>	
5						Boring terminated at 5 feet.					




Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

DATE STARTED: 3/4/14	DRILL COMPANY: PSI Inc.	<b>BORING B-10</b>
DATE COMPLETED: 3/4/14	DRILLER: DJK    LOGGED BY: JRB	
COMPLETION DEPTH: 3.0 ft	DRILL RIG: CME-55	Water <input type="checkbox"/> While Drilling    not observed
BENCHMARK: N/A	DRILLING METHOD: 3 1/4" HSA	<input type="checkbox"/> Upon Completion    not observed
ELEVATION: N/A	SAMPLING METHOD: SS	<input type="checkbox"/> Delay    N/A
LATITUDE: 38.9649°	HAMMER TYPE: Automatic	BORING LOCATION: See Location Plan
LONGITUDE: -94.3602°	EFFICIENCY: 81%	
STATION: N/A    OFFSET: N/A	REVIEWED BY: SB	

REMARKS:  $N_{60}$  denotes the normalization to 60% efficiency as described in ASTM D4633.

Elevation (feet)	Depth (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @	Additional Remarks
										<input type="checkbox"/> Moisture <input type="checkbox"/> PL <input type="checkbox"/> LL	
										STRENGTH, tsf <input type="checkbox"/> Qu <input type="checkbox"/> Qp	
	0			1	10	<b>ORGANIC LAYER - 4 inches</b> <b>HIGH PLASTICITY CLAY</b> - brown and reddish brown, moist, stiff  Auger refusal at 3 feet.	CH	4-4-5 $N_{60}=12$	25	<input checked="" type="checkbox"/> X <input type="checkbox"/> $\oplus$	



Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600

PROJECT NO.: 338-888  
 PROJECT: Frontier Justice  
 LOCATION: EC of Jones Drive and Independence Ave.  
 Lee's Summit, MO

---

---

## General Notes



## GENERAL NOTES

### SAMPLE IDENTIFICATION

The Unified Soil Classification System (USCS), AASHTO 1988 and ASTM designations D2487 and D-2488 are used to identify the encountered materials unless otherwise noted. Coarse-grained soils are defined as having more than 50% of their dry weight retained on a #200 sieve (0.075mm); they are described as: boulders, cobbles, gravel or sand. Fine-grained soils have less than 50% of their dry weight retained on a #200 sieve; they are defined as silts or clay depending on their Atterberg Limit attributes. Major constituents may be added as modifiers and minor constituents may be added according to the relative proportions based on grain size.

### DRILLING AND SAMPLING SYMBOLS

SFA: Solid Flight Auger - typically 4" diameter flights, except where noted.	SS: Split-Spoon - 1 3/8" I.D., 2" O.D., except where noted.
HSA: Hollow Stem Auger - typically 3 1/4" or 4 1/4" I.D. openings, except where noted.	ST: Shelby Tube - 3" O.D., except where noted.
M.R.: Mud Rotary - Uses a rotary head with Bentonite or Polymer Slurry	BS: Bulk Sample
R.C.: Diamond Bit Core Sampler	PM: Pressuremeter
H.A.: Hand Auger	CPT-U: Cone Penetrometer Testing with Pore-Pressure Readings
P.A.: Power Auger - Handheld motorized auger	

### SOIL PROPERTY SYMBOLS

N: Standard "N" penetration: Blows per foot of a 140 pound hammer falling 30 inches on a 2-inch O.D. Split-Spoon.  
 N<sub>60</sub>: A "N" penetration value corrected to an equivalent 60% hammer energy transfer efficiency (ETR)  
 Q<sub>u</sub>: Unconfined compressive strength, TSF  
 Q<sub>p</sub>: Pocket penetrometer value, unconfined compressive strength, TSF  
 w%: Moisture/water content, %  
 LL: Liquid Limit, %  
 PL: Plastic Limit, %  
 PI: Plasticity Index = (LL-PL), %  
 DD: Dry unit weight, pcf  
 ▽, ▽, ▽ Apparent groundwater level at time noted

### RELATIVE DENSITY OF COARSE-GRAINED SOILS

Relative Density	N - Blows/foot
Very Loose	0 - 4
Loose	4 - 10
Medium Dense	10 - 30
Dense	30 - 50
Very Dense	50 - 80
Extremely Dense	80+

### ANGULARITY OF COARSE-GRAINED PARTICLES

Description	Criteria
Angular:	Particles have sharp edges and relatively plane sides with unpolished surfaces
Subangular:	Particles are similar to angular description, but have rounded edges
Subrounded:	Particles have nearly plane sides, but have well-rounded corners and edges
Rounded:	Particles have smoothly curved sides and no edges

### GRAIN-SIZE TERMINOLOGY

Component	Size Range
Boulders:	Over 300 mm (>12 in.)
Cobbles:	75 mm to 300 mm (3 in. to 12 in.)
Coarse-Grained Gravel:	19 mm to 75 mm (3/4 in. to 3 in.)
Fine-Grained Gravel:	4.75 mm to 19 mm (No.4 to 3/4 in.)
Coarse-Grained Sand:	2 mm to 4.75 mm (No.10 to No.4)
Medium-Grained Sand:	0.42 mm to 2 mm (No.40 to No.10)
Fine-Grained Sand:	0.075 mm to 0.42 mm (No. 200 to No.40)
Silt:	0.005 mm to 0.075 mm
Clay:	<0.005 mm

### PARTICLE SHAPE

Description	Criteria
Flat:	Particles with width/thickness ratio > 3
Elongated:	Particles with length/width ratio > 3
Flat & Elongated:	Particles meet criteria for both flat and elongated

### RELATIVE PROPORTIONS OF FINES

Descriptive Term	% Dry Weight
Trace:	< 5%
With:	5% to 12%
Modifier:	>12%



## GENERAL NOTES

(Continued)

### CONSISTENCY OF FINE-GRAINED SOILS

<u>Q<sub>u</sub> - TSF</u>	<u>N - Blows/foot</u>	<u>Consistency</u>
0 - 0.25	0 - 2	Very Soft
0.25 - 0.50	2 - 4	Soft
0.50 - 1.00	4 - 8	Firm (Medium Stiff)
1.00 - 2.00	8 - 15	Stiff
2.00 - 4.00	15 - 30	Very Stiff
4.00 - 8.00	30 - 50	Hard
8.00+	50+	Very Hard

### MOISTURE CONDITION DESCRIPTION

<u>Description</u>	<u>Criteria</u>
Dry:	Absence of moisture, dusty, dry to the touch
Moist:	Damp but no visible water
Wet:	Visible free water, usually soil is below water table

### RELATIVE PROPORTIONS OF SAND AND GRAVEL

<u>Descriptive Term</u>	<u>% Dry Weight</u>
Trace:	< 15%
With:	15% to 30%
Modifier:	>30%

### STRUCTURE DESCRIPTION

<u>Description</u>	<u>Criteria</u>	<u>Description</u>	<u>Criteria</u>
Stratified:	Alternating layers of varying material or color with layers at least 1/8-inch (6 mm) thick	Blocky:	Cohesive soil that can be broken down into small angular lumps which resist further breakdown
Laminated:	Alternating layers of varying material or color with layers less than 1/8-inch (6 mm) thick	Lensed:	Inclusion of small pockets of different soils
Fissured:	Breaks along definite planes of fracture with little resistance to fracturing	Layer:	Inclusion greater than 3 inches thick (75 mm)
Slickensided:	Fracture planes appear polished or glossy, sometimes striated	Seam:	Inclusion 1/8-inch to 3 inches (3 to 75 mm) thick extending through the sample
		Parting:	Inclusion less than 1/8-inch (3 mm) thick

### SCALE OF RELATIVE ROCK HARDNESS

<u>Q<sub>u</sub> - TSF</u>	<u>Consistency</u>
2.5 - 10	Extremely Soft
10 - 50	Very Soft
50 - 250	Soft
250 - 525	Medium Hard
525 - 1,050	Moderately Hard
1,050 - 2,600	Hard
>2,600	Very Hard

### ROCK BEDDING THICKNESSES

<u>Description</u>	<u>Criteria</u>
Very Thick Bedded	Greater than 3-foot (>1.0 m)
Thick Bedded	1-foot to 3-foot (0.3 m to 1.0 m)
Medium Bedded	4-inch to 1-foot (0.1 m to 0.3 m)
Thin Bedded	1 1/4-inch to 4-inch (30 mm to 100 mm)
Very Thin Bedded	1/2-inch to 1 1/4-inch (10 mm to 30 mm)
Thickly Laminated	1/8-inch to 1/2-inch (3 mm to 10 mm)
Thinly Laminated	1/8-inch or less "paper thin" (<3 mm)

### ROCK VOIDS

<u>Voids</u>	<u>Void Diameter</u>
Pit	<6 mm (<0.25 in)
Vug	6 mm to 50 mm (0.25 in to 2 in)
Cavity	50 mm to 600 mm (2 in to 24 in)
Cave	>600 mm (>24 in)

### GRAIN-SIZED TERMINOLOGY

(Typically Sedimentary Rock)

<u>Component</u>	<u>Size Range</u>
Very Coarse Grained	>4.76 mm
Coarse Grained	2.0 mm - 4.76 mm
Medium Grained	0.42 mm - 2.0 mm
Fine Grained	0.075 mm - 0.42 mm
Very Fine Grained	<0.075 mm

### ROCK QUALITY DESCRIPTION

<u>Rock Mass Description</u>	<u>RQD Value</u>
Excellent	90 - 100
Good	75 - 90
Fair	50 - 75
Poor	25 - 50
Very Poor	Less than 25

### DEGREE OF WEATHERING
















**Slightly Weathered:** Rock generally fresh, joints stained and discoloration extends into rock up to 25 mm (1 in), open joints may contain clay, core rings under hammer impact.

**Weathered:** Rock mass is decomposed 50% or less, significant portions of the rock show discoloration and weathering effects, cores cannot be broken by hand or scraped by knife.

**Highly Weathered:** Rock mass is more than 50% decomposed, complete discoloration of rock fabric, core may be extremely broken and gives clunk sound when struck by hammer, may be shaved with a knife.

# SOIL CLASSIFICATION CHART


NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS		
			GRAPH	LETTER			
<p><b>COARSE GRAINED SOILS</b></p> <p>MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE</p>	<p><b>GRAVEL AND GRAVELLY SOILS</b></p> <p>(LITTLE OR NO FINES)</p>	CLEAN GRAVELS		<b>GW</b>	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES		
				<b>GP</b>	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES		
		GRAVELS WITH FINES		<b>GM</b>	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES		
		(APPRECIABLE AMOUNT OF FINES)		<b>GC</b>	CLAYEY GRAVELS, GRAVEL - SAND - CLAY MIXTURES		
	<p><b>SAND AND SANDY SOILS</b></p> <p>MORE THAN 50% OF COARSE FRACTION PASSED ON NO. 4 SIEVE</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>			<b>SW</b>	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES	
					<b>SP</b>	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES	
		SANDS WITH FINES		<b>SM</b>	SILTY SANDS, SAND - SILT MIXTURES		
		(APPRECIABLE AMOUNT OF FINES)		<b>SC</b>	CLAYEY SANDS, SAND - CLAY MIXTURES		
		<p><b>FINE GRAINED SOILS</b></p> <p>MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE</p>	<p><b>SILTS AND CLAYS</b></p> <p>LIQUID LIMIT LESS THAN 50</p>			<b>ML</b>	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY
						<b>CL</b>	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS
				<b>OL</b>	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY		
<p><b>SILTS AND CLAYS</b></p> <p>LIQUID LIMIT GREATER THAN 50</p>				<b>MH</b>	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS		
				<b>CH</b>	INORGANIC CLAYS OF HIGH PLASTICITY		
		<b>OH</b>	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS				
<p><b>HIGHLY ORGANIC SOILS</b></p>				<b>PT</b>	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS		



**Laboratory Data**



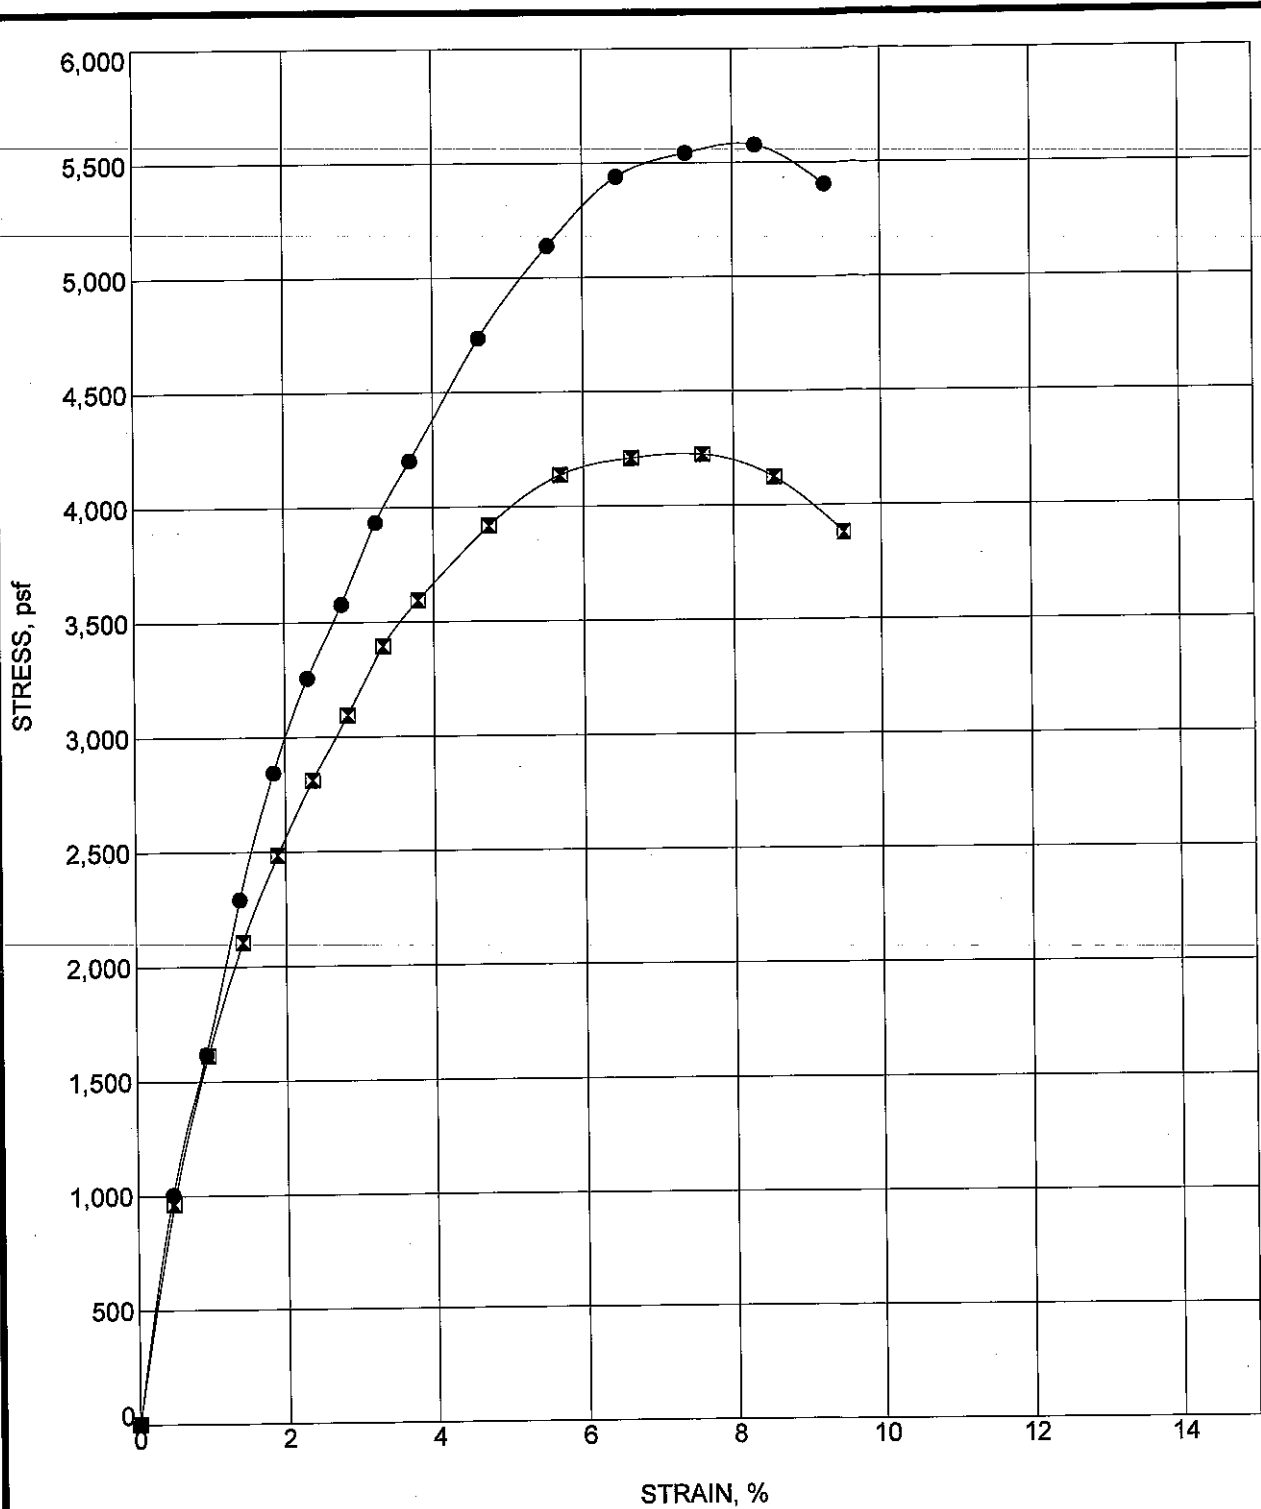

Boring	Depth	$\gamma_d$ (pcf)	MC%	$Q_u$ (psf)
● B-01	4.0	103	23	5578
☒ B-04	4.0	94	26	4223


Boring	Depth	$\gamma_d$ (pcf)	MC%	$Q_u$ (psf)



Professional Service Industries, Inc.  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600  
 Fax: (913) 310-1601

**UNCONFINED COMPRESSION TESTS**

PSI Job No.: 338-888  
 Project: Frontier Justice  
 Location: NEC of Jones Drive and Independence Av.  
 Lee's Summit, MO

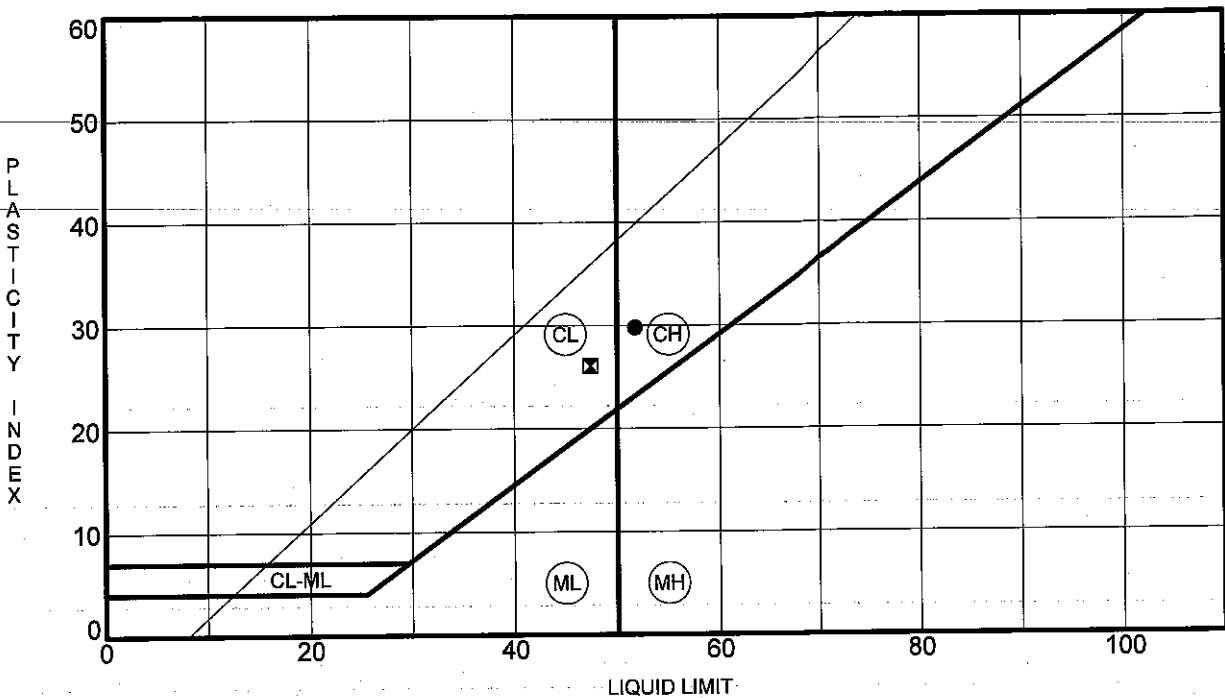

Boring	Depth (ft)	LL	PL	PI	Fines	Classification (*Visual)
● B-01	1.5	52	22	30		High plasticity clay, brown and dark gray brown
☒ B-06	1.5	47	21	26		Medium plasticity, gray brown



**Professional Service Industries, Inc.**  
 1211 W. Cambridge Circle Drive  
 Kansas City, KS 66103  
 Telephone: (913) 310-1600  
 Fax: (913) 310-1601

### ATTERBERG LIMIT RESULTS

PSI Job No.: 338-888  
 Project: Frontier Justice  
 Location: NEC of Jones Drive and Independence Ave.  
 Lee's Summit, MO