


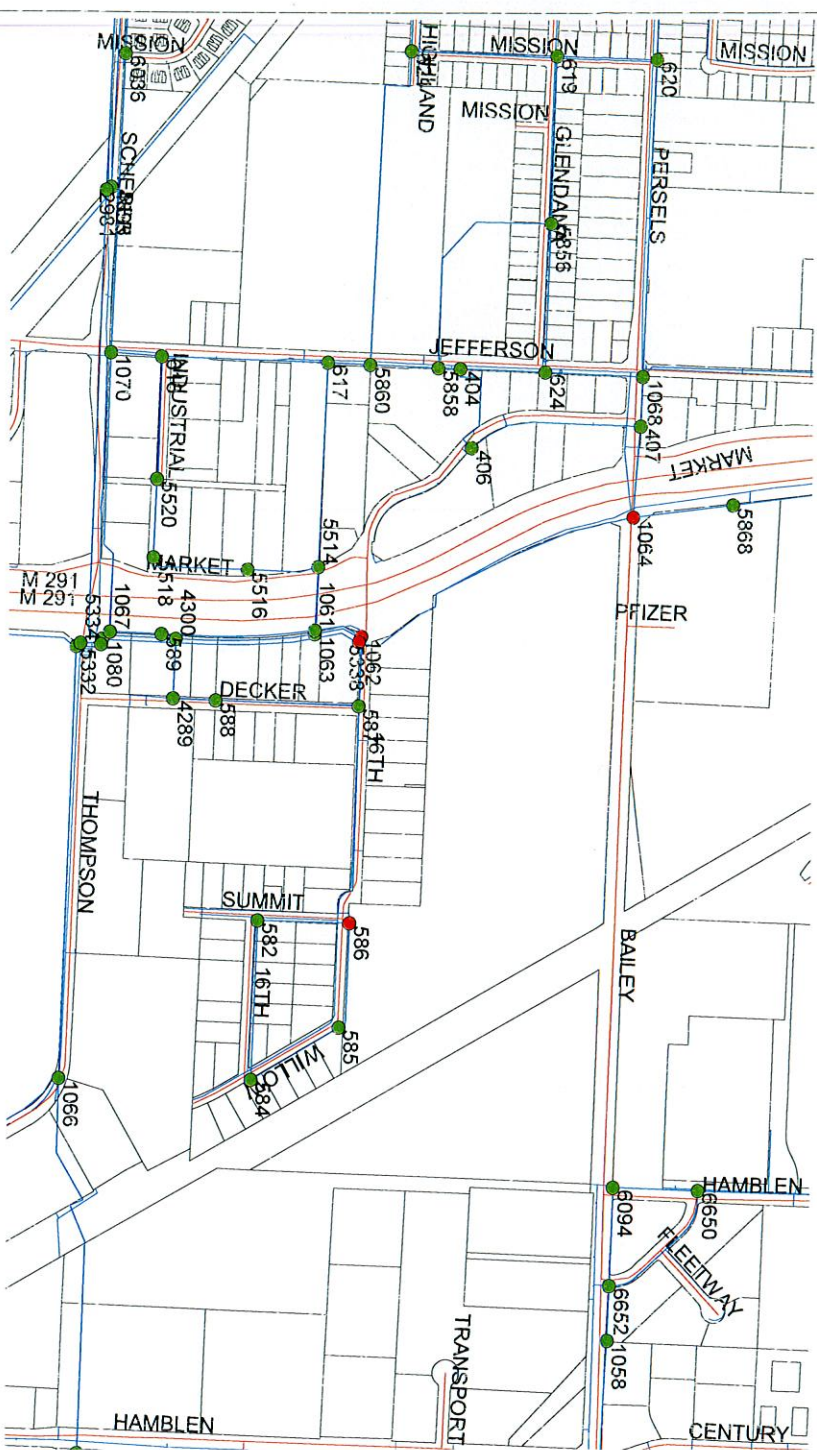

-

Pre

Test Report Print Title

	ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)	Available Flow at Hydrant (gpm)	Available Flow Pressure (psi)
1	☐ 1064	64.00	62.57	1,187.40	3,500.00	51.96	9,114.28	20.00
2	☐ 1062	64.00	73.29	1,192.14	3,500.00	52.87	6,296.97	20.00
3	☐ 5338	0.00	73.30	1,192.16	3,500.00	67.15	16,796.99	20.00
4	☐ 586	0.00	75.20	1,191.55	1,000.00	22.53	1,027.44	20.00



Post

Test Report Print Title

	ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)	Available Flow at Hydrant (gpm)	Available Flow Pressure (psi)
1	☐ 1064	64.00	62.44	1,187.10	3,500.00	52.62	9,778.98	20.00
2	☐ 1062	64.00	72.95	1,191.36	3,500.00	54.65	6,709.83	20.00
3	☐ 5338	0.00	72.99	1,191.46	3,500.00	66.76	16,741.01	20.00
4	☐ 586	0.00	73.53	1,187.70	1,000.00	69.77	5,889.66	20.00
5	☐ 10000	68.83	128.87	1,187.41	3,500.00	116.89	14,272.29	20.00
6	☐ 10002	68.83	128.97	1,187.65	3,500.00	117.35	14,713.15	20.00
7	☐ 10004	68.83	129.10	1,187.95	3,500.00	119.52	17,430.41	20.00