


Manor at Stoney Creek 2nd

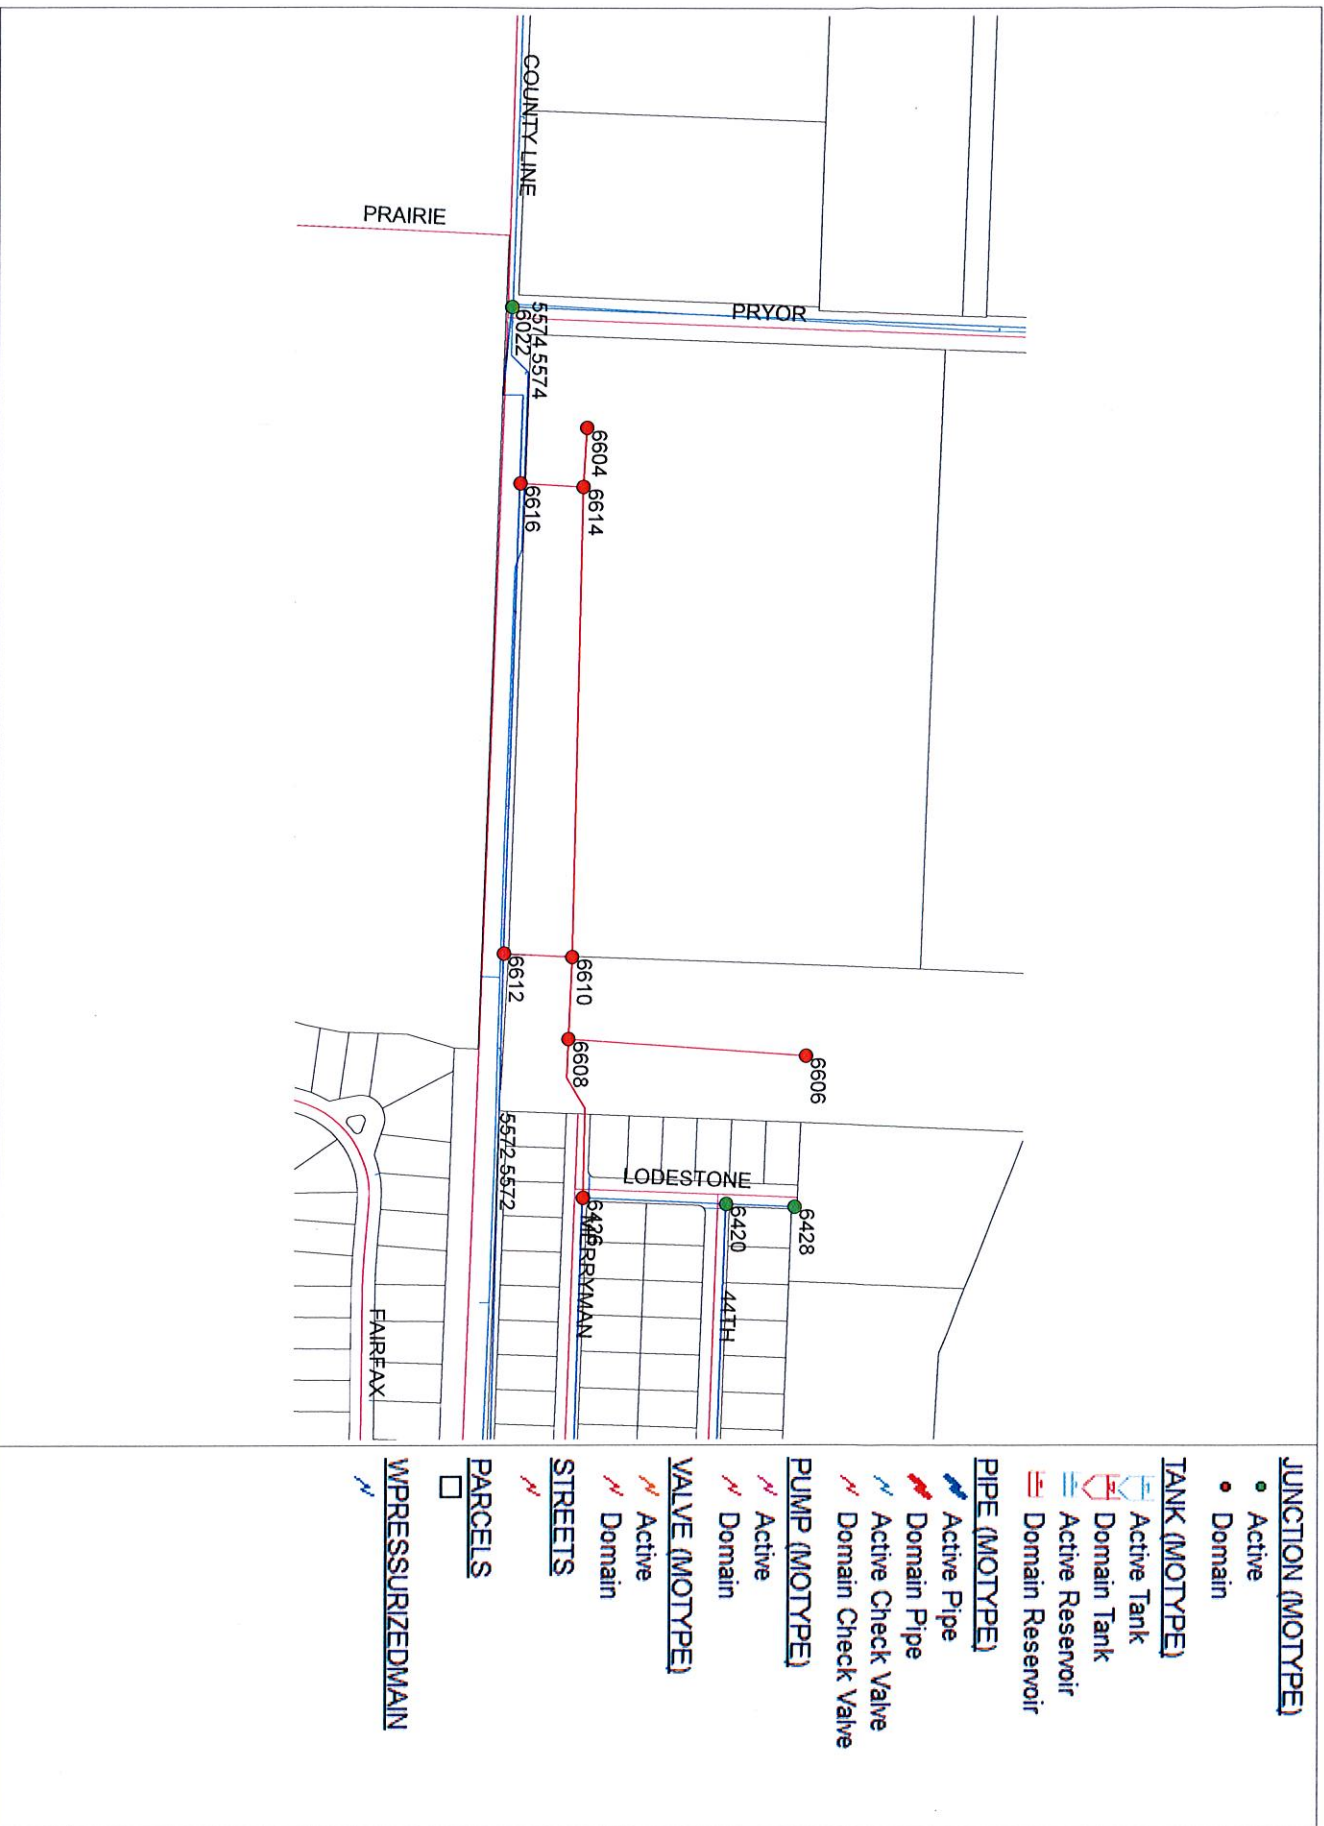

Manor at Stoney Creek 2nd

	ID	Demand (gpm)	Elevation (ft)	Head (ft)	Pressure (psi)
1	☐ 6426	0.00	1,017.00	1,191.33	75.54
2	☐ 6604	0.00	1,010.00	1,191.37	78.59
3	☐ 6606	0.00	1,014.00	1,191.34	76.84
4	☐ 6608	0.00	1,017.00	1,191.34	75.54
5	☐ 6610	0.00	1,017.00	1,191.34	75.54
6	☐ 6612	8.60	1,017.00	1,191.34	75.54
7	☐ 6614	0.00	1,010.00	1,191.37	78.59
8	☐ 6616	8.60	1,008.00	1,191.37	79.46

Manor at Stoney Creek 2nd

ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)	Available Flow at Hydrant (gpm)	Available Flow Pressure (psi)
☐ 6426	0.00	75.54	1,191.33	1,000.00	70.71	4,894.62	20.00
☐ 6604	0.00	78.59	1,191.37	1,000.00	72.63	4,143.24	20.00
☐ 6606	0.00	76.84	1,191.34	1,000.00	68.22	3,089.93	20.00
☐ 6608	0.00	75.54	1,191.34	1,000.00	70.61	4,781.56	20.00
☐ 6610	0.00	75.54	1,191.34	1,000.00	70.90	5,051.98	20.00
☐ 6612	8.60	75.54	1,191.34	1,000.00	71.12	5,318.30	20.00
☐ 6614	0.00	78.59	1,191.37	1,000.00	73.53	4,780.66	20.00
☐ 6616	8.60	79.46	1,191.37	1,000.00	74.85	5,259.34	20.00