


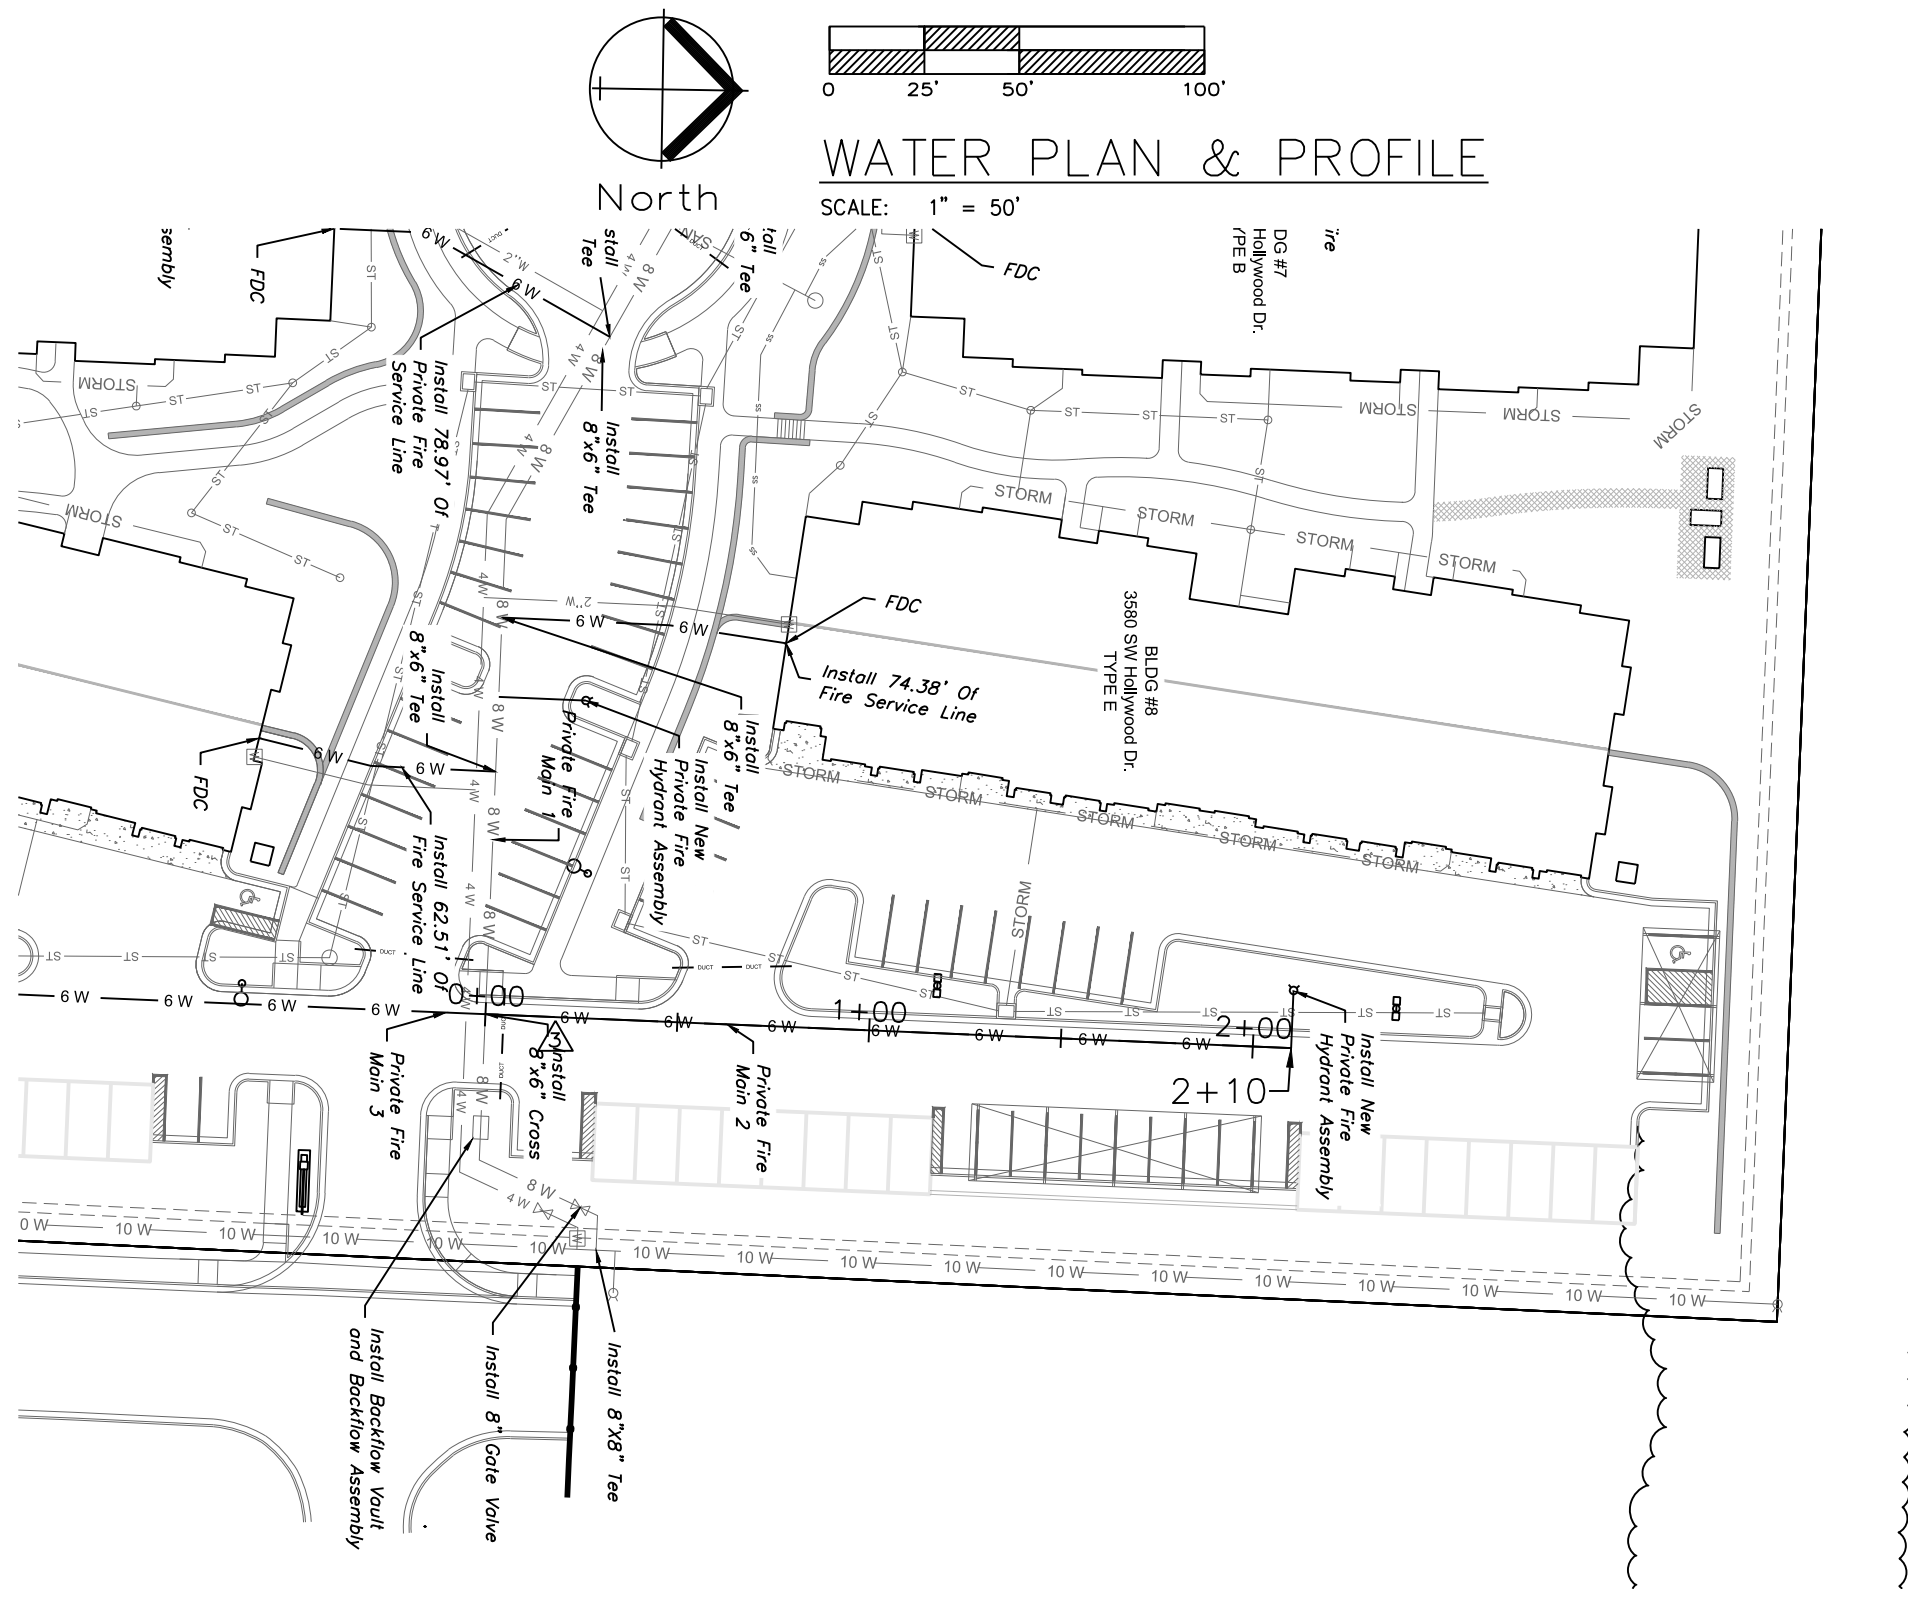

REV. 3-21-17

Planning Review

- Relocated the monument signs to be outside the easements.
- Architectural drawings are to match the water on the civil drawings.
- Updated the building addresses as requested.

Engineering Review

- Labeled the sanitary and water lines as private as requested.
- Removed the cover sheets for the private water and sanitary.
- Provided locations for the domestic water lines as requested.

Fire Review

- FDC are located on the plans.

REV. 3-24-17

- Removed ramp.
- Added Stair.


REV. 5-3-17

Planning Review


- Reconciled Water Line 1, 2, and 3 locations.

Engineering Review


- Water Lines have been altered to provide a separate Fire Line and Public Line.
- 2" Water Meters are being used for this project and are located near the buildings.
- Provided note stating that the public lines along Cheddington Dr. and Hollywood Dr. are part of a separate construction set.
- Changed the note stating the use of 6" fire line shall be DIP shall not be used for this project.
- Removed the note stating to tap the fire line.
- Reconciled the fire lines and the domestic lines to be separated.
- Relabeled the profiles as requested.
- Provided utility crossings in the profile views.
- The color scheme is due to the printer malfunctioning.

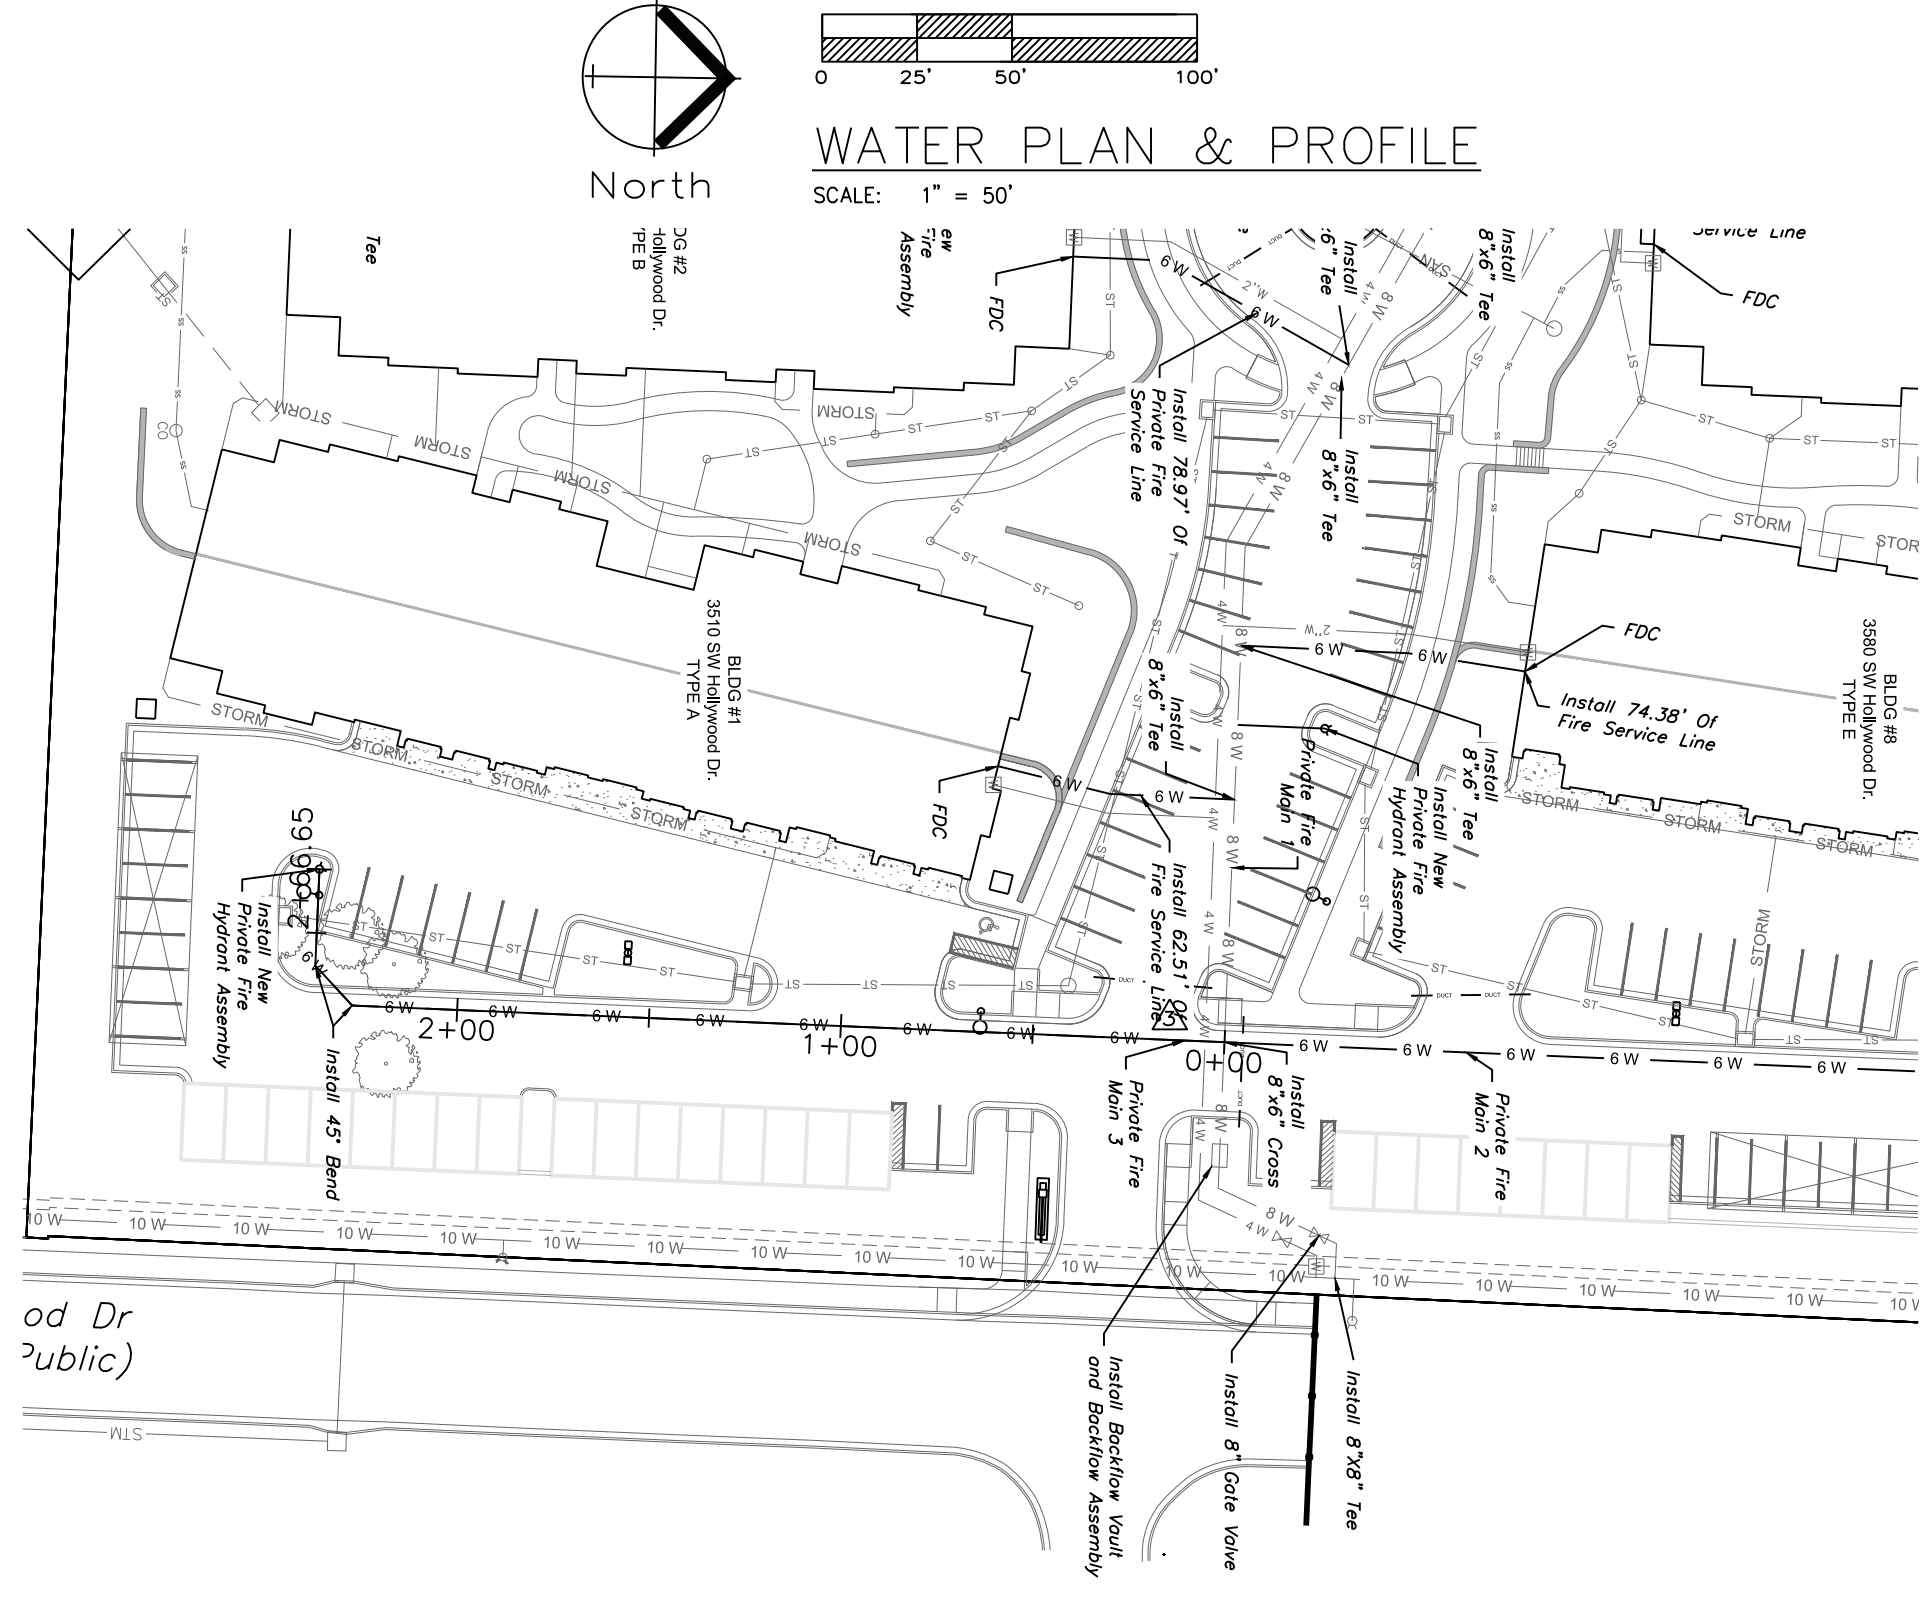

PRIVATE FIRE MAIN 2

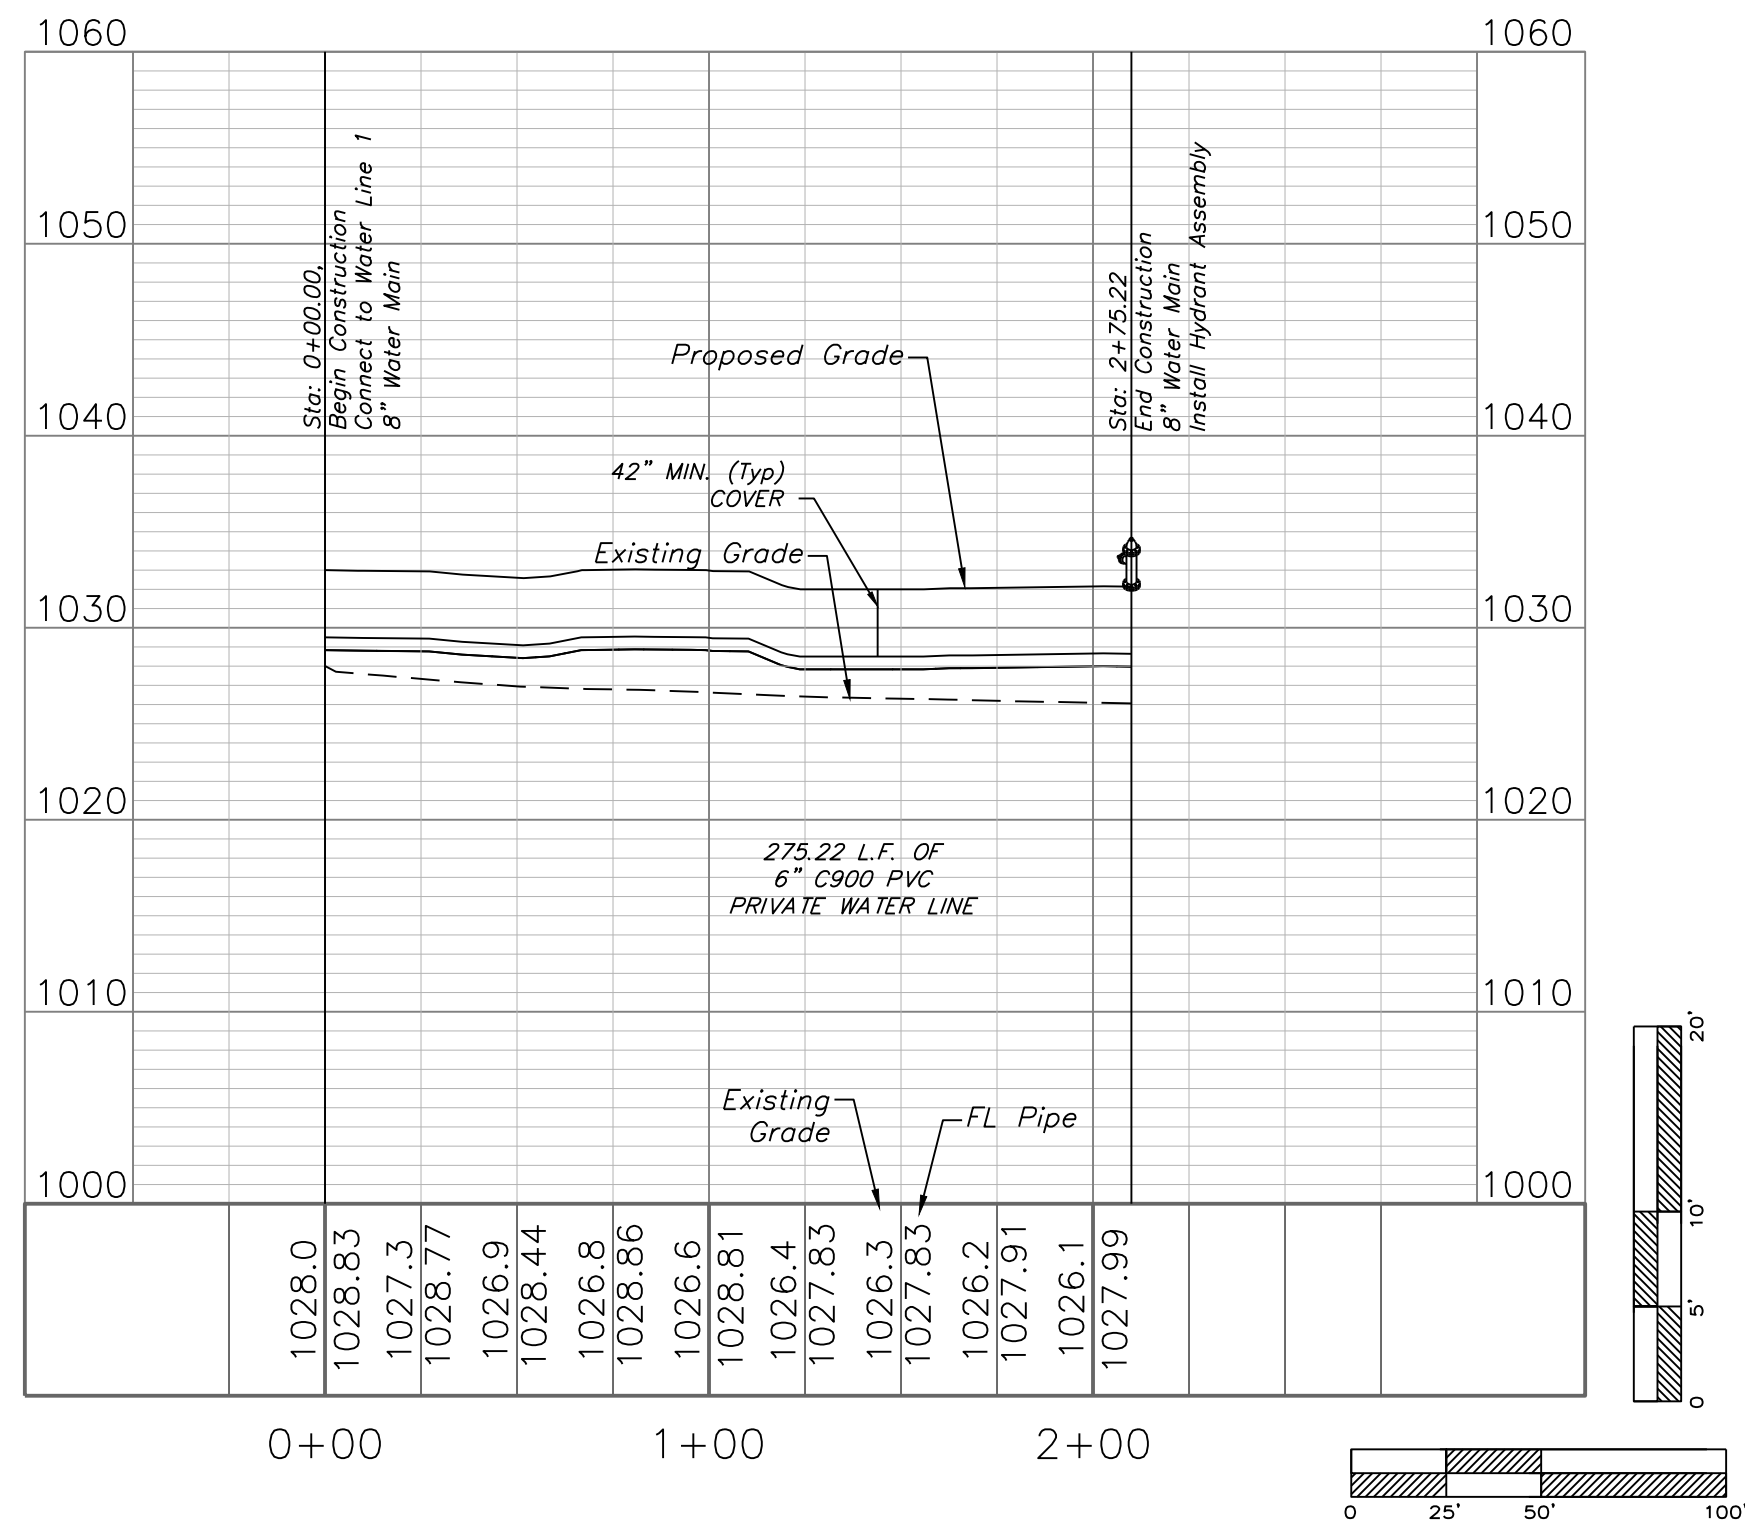

PRIVATE FIRE MAIN 3

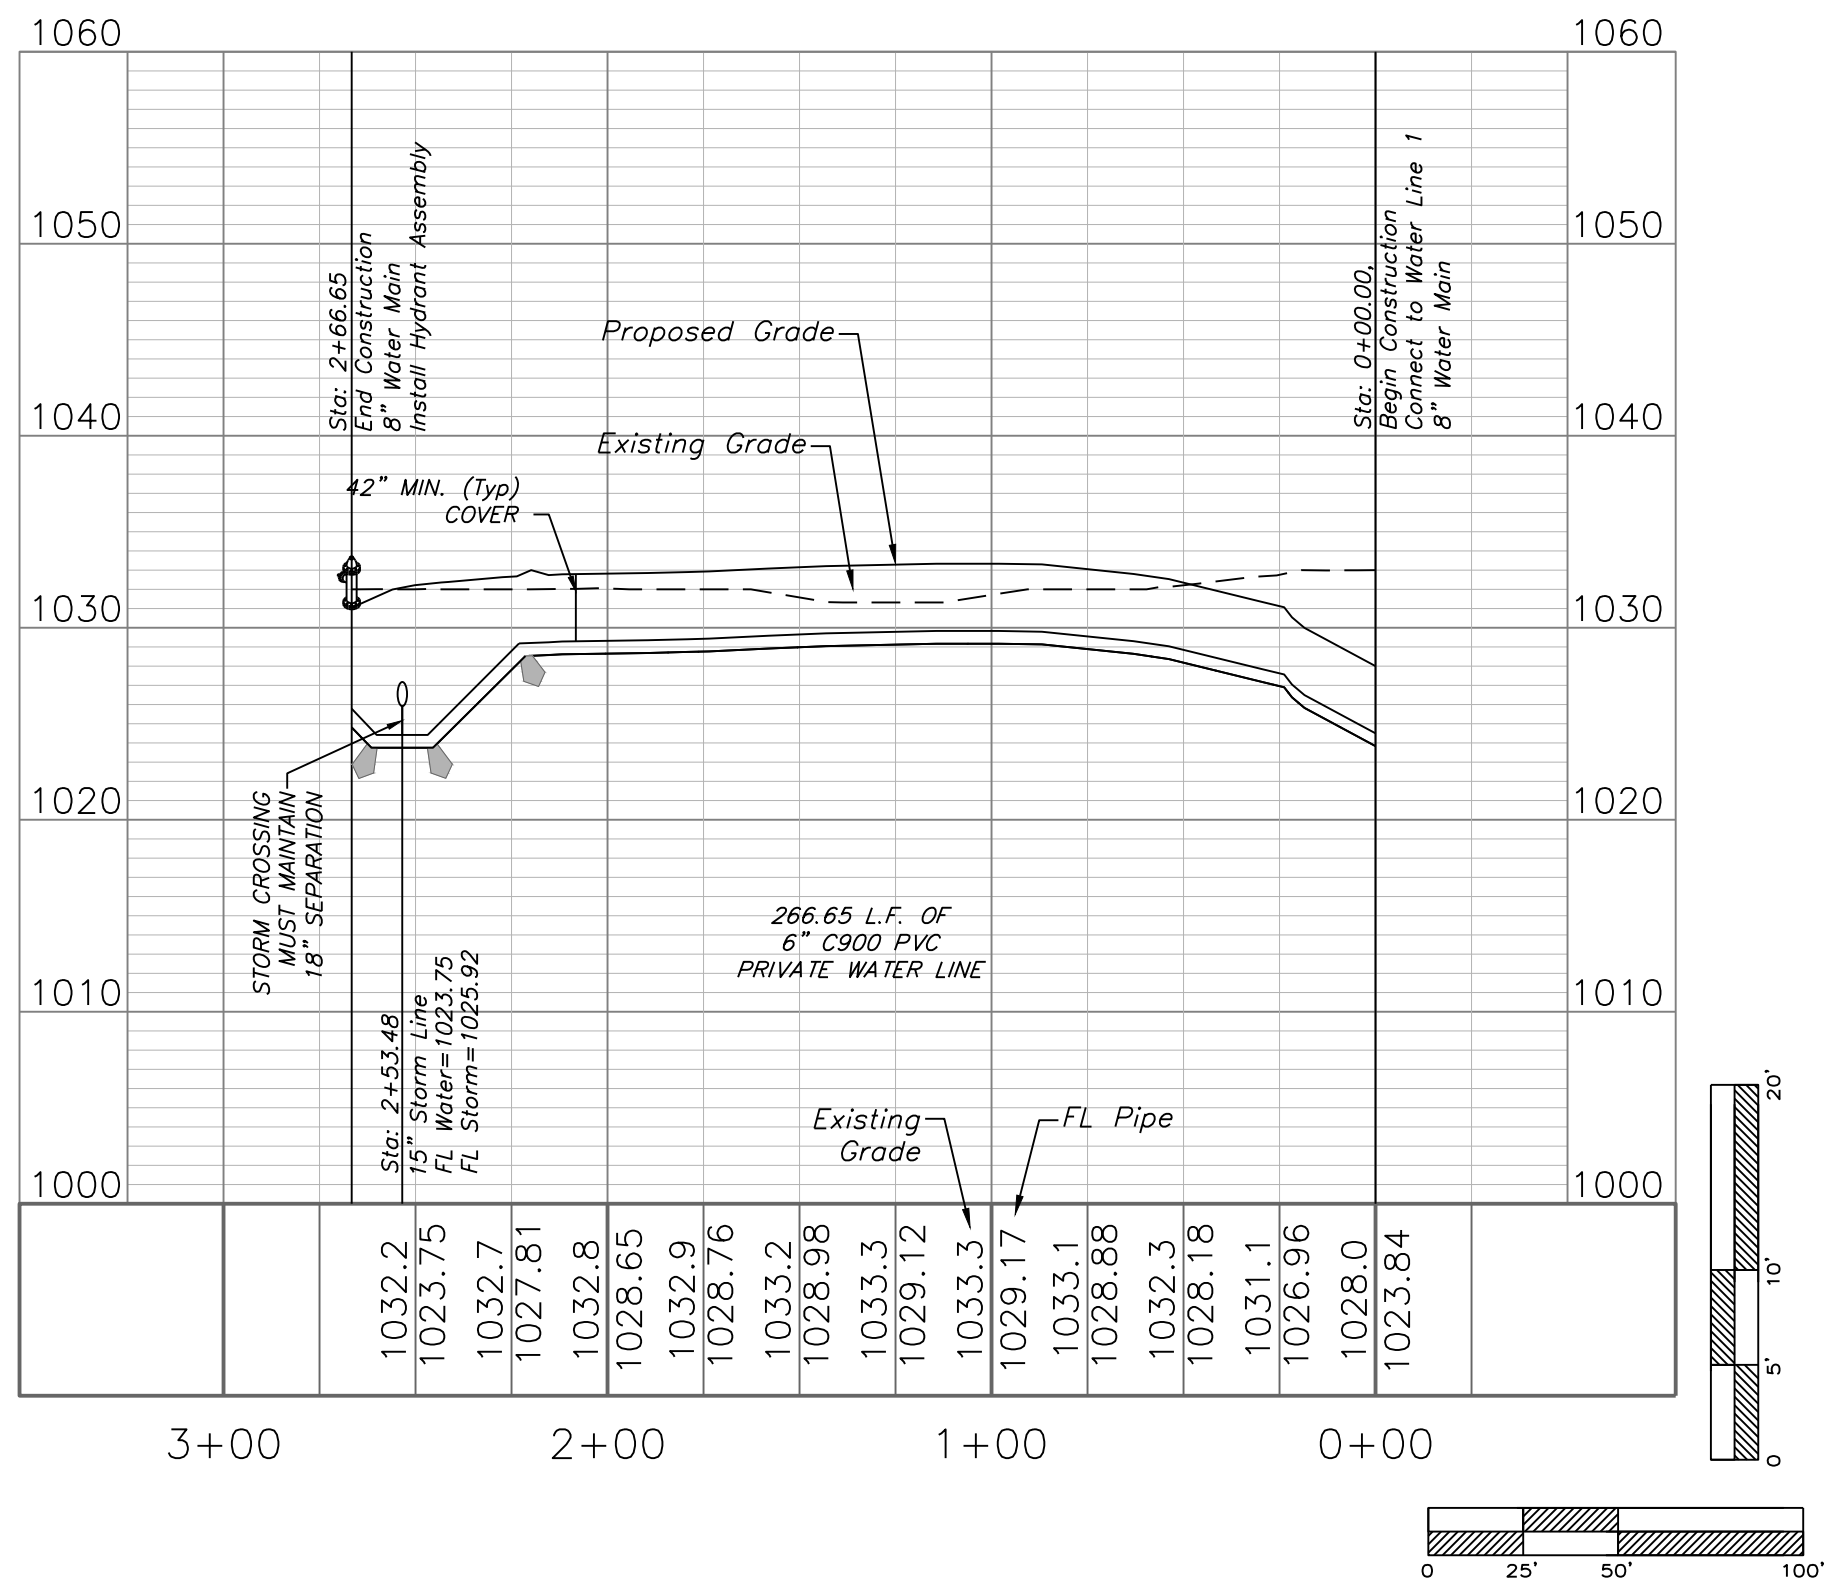

- REV. 3-21-17
- REV. 3-24-17
- REV. 5-3-17
- REV. 6-5-17
- REV. 7-3-17
- CONT. SET. 7-26-17
- REV. 12-1-17