



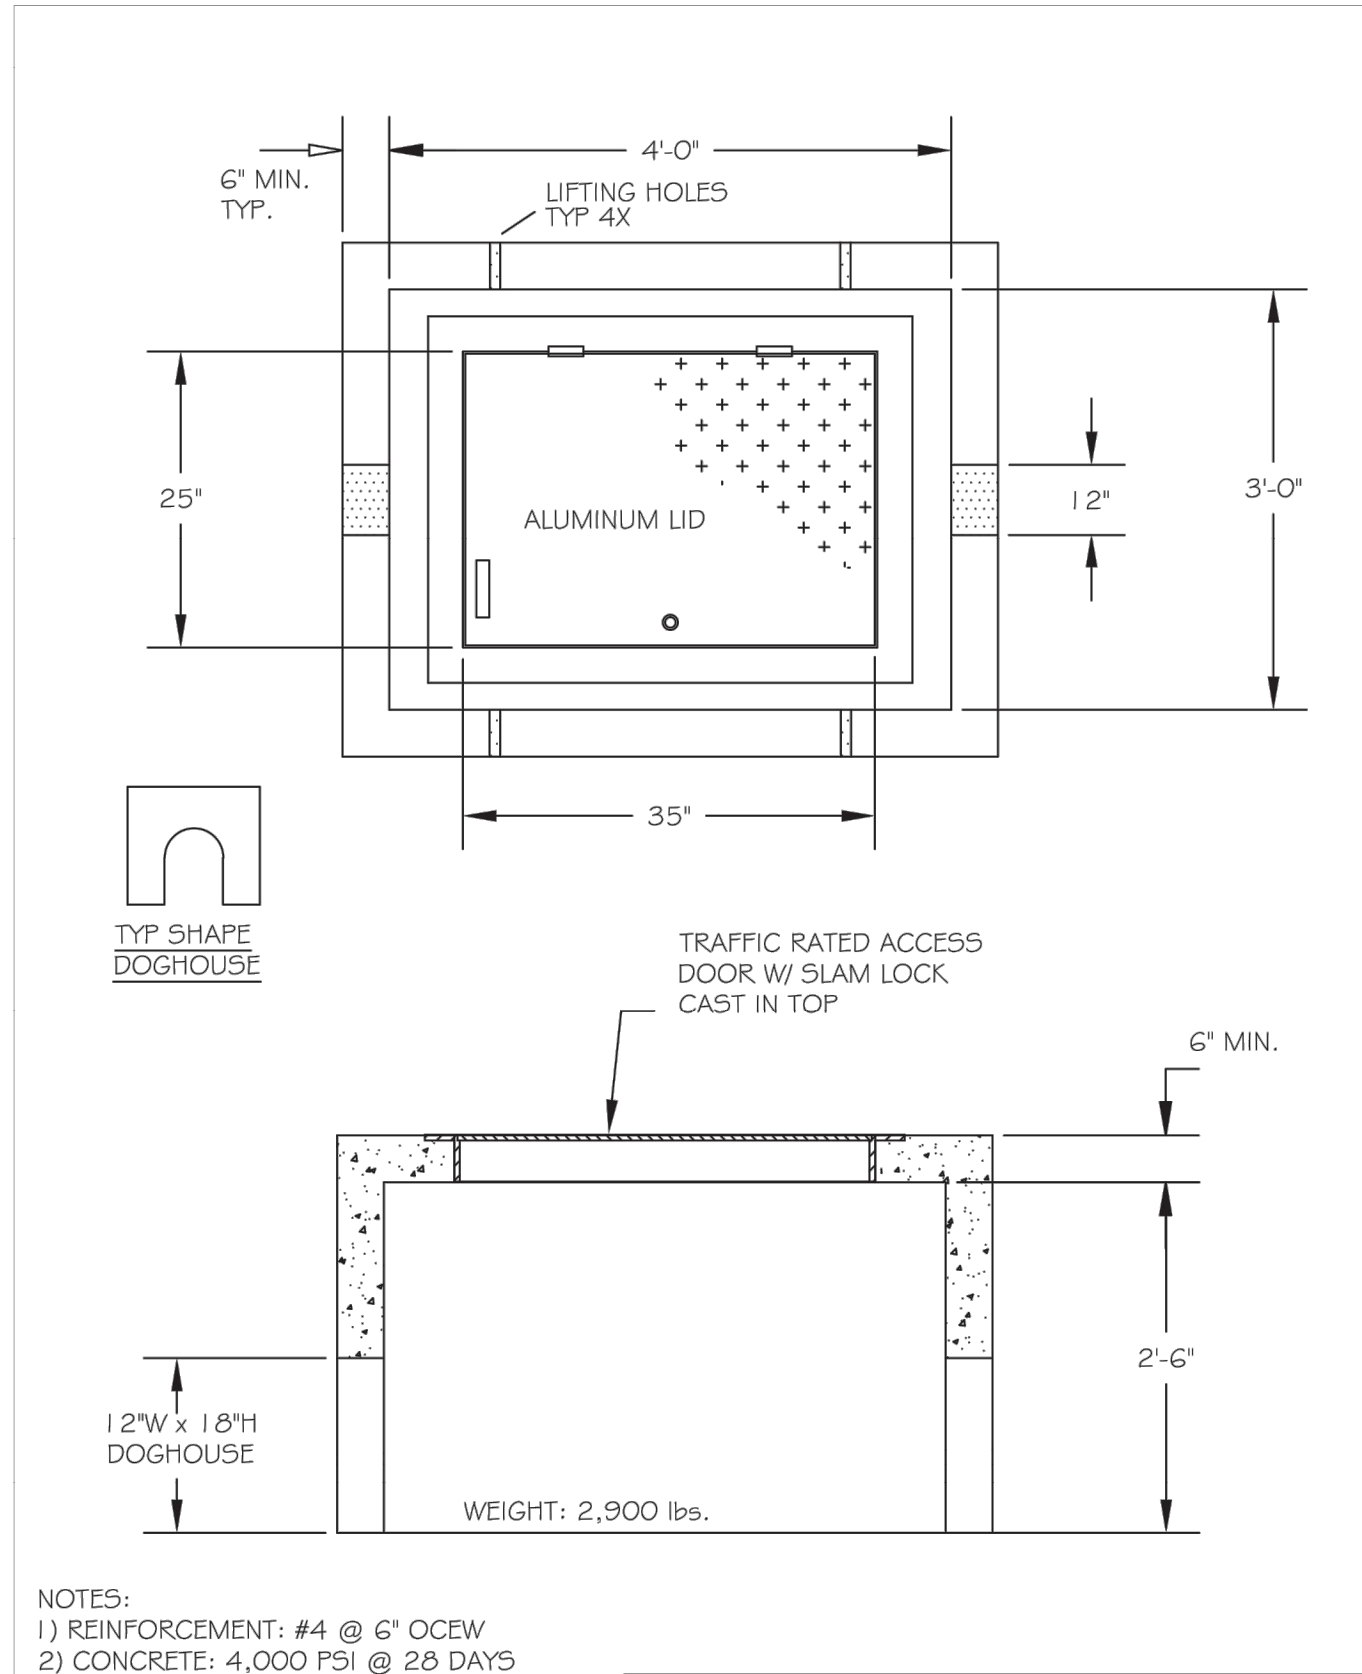

- NOTES:
- 1) REINFORCEMENT: #4 @ 6" OCEW
 - 2) CONCRETE: 4,000 PSI @ 28 DAYS
 - 3) 6" OF #6/7 STONE SHALL BE PLACED IN BOTTOM OF VAULT
 - 4) METER FLANGE SHALL BE PLACED 42" BELOW FINISHED GRADE

4" Meter Vault Detail

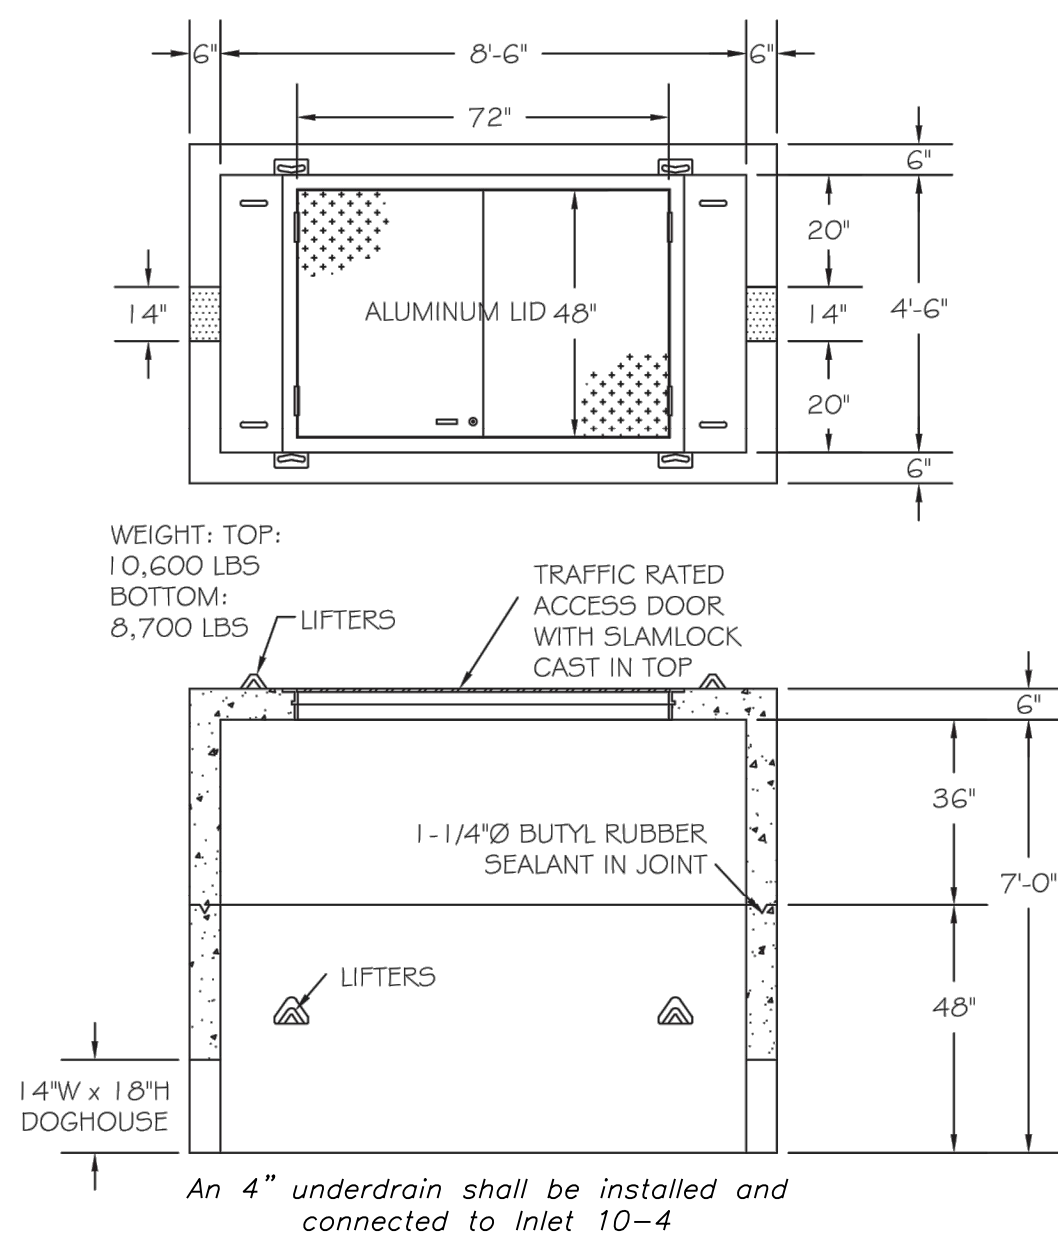

- NOTES:
- 1) REINFORCEMENT: #4 @ 6" OCEW
 - 2) CONCRETE: 4,000 PSI @ 28 DAYS
 - 3) 6" OF #6/7 STONE SHALL BE PLACED IN BOTTOM OF VAULT
 - 4) METER FLANGE SHALL BE PLACED 49" BELOW FINISHED GRADE

Back Flow Vault Detail

