




1. METER INSTALLATION SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC OR IN CONCRETE PAVEMENT WITHOUT CITY APPROVAL.
2. METER SHALL BE LOCATED OTHER THAN IN FRONT OF PROPERTY LINE. CITY APPROVAL SHALL BE OBTAINED.
3. CITY TO FURNISH ITEMS A-K.
4. NO OTHER EQUIPMENT SHALL BE INSTALLED IN THIS PIT.
5. 42" MINIMUM BURY DEPTH FOR ALL SERVICE LINES.
6. EXCAVATION FOR TAP TO EXPOSE 4 LINEAR FEET OF MAIN.
7. TWO SPRINGS ALLOWED BETWEEN METER AND MAIN.
8. SERVICE CONNECTION TAP AT APPROXIMATELY 45 DEGREES.
9. WATER AND GROUNDWATER PROTECTION: ANY WATER THAT OVERFLOWS SHALL DRAIN AWAY FROM THE WELL
10. CONTACT WATER UTILITIES, 816-369-1800, FOR REQUIREMENTS OF A METER LARGER THAN 2"



Date: 02/13
Drawn By: JN
Checked By: DL
FILE: WAT-11
Rev: 1/14
Rev:

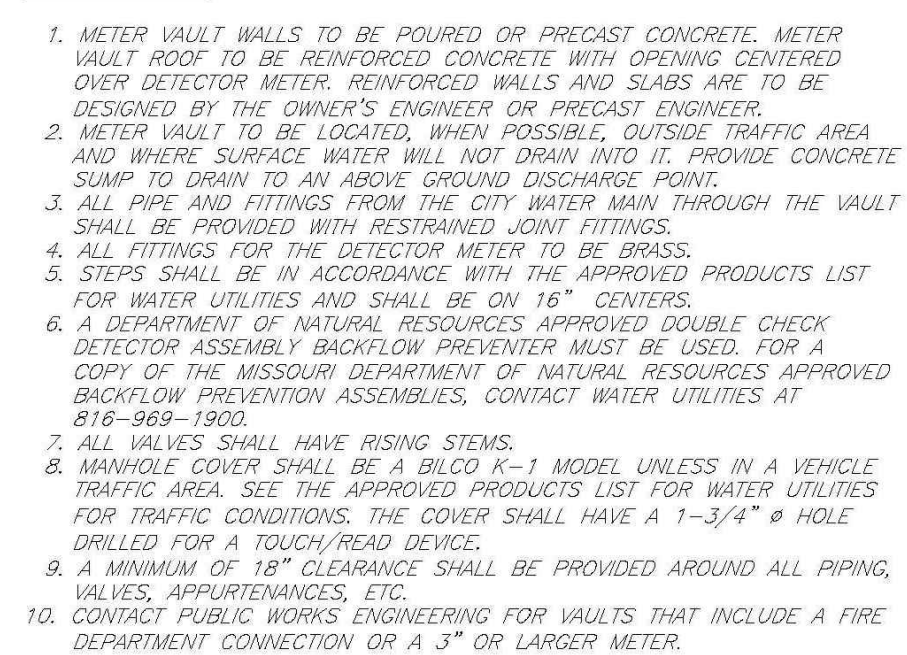

Project	Sheet	V/A
Drawn By: AS		
Checked By: DL		
Date: 1/14		
Rev: 1/14		
OF		
WAT-12		

Professional Registration
Missouri
Engineering 2005002186-D
Surveying 2005008319-D
Kansas
Engineering E-1695
Surveying LS-218
Oklahoma
Engineering 6254
Nebraska
Engineering CA2821

**ENGINEERING
ENGINEERING & SURVEYING-
SOLUTIONS**

50 SE 30TH STREET
LEE'S SUMMIT, MO 64082
P: (816) 623-9888 F: (816) 623-9849