



1-17-2018

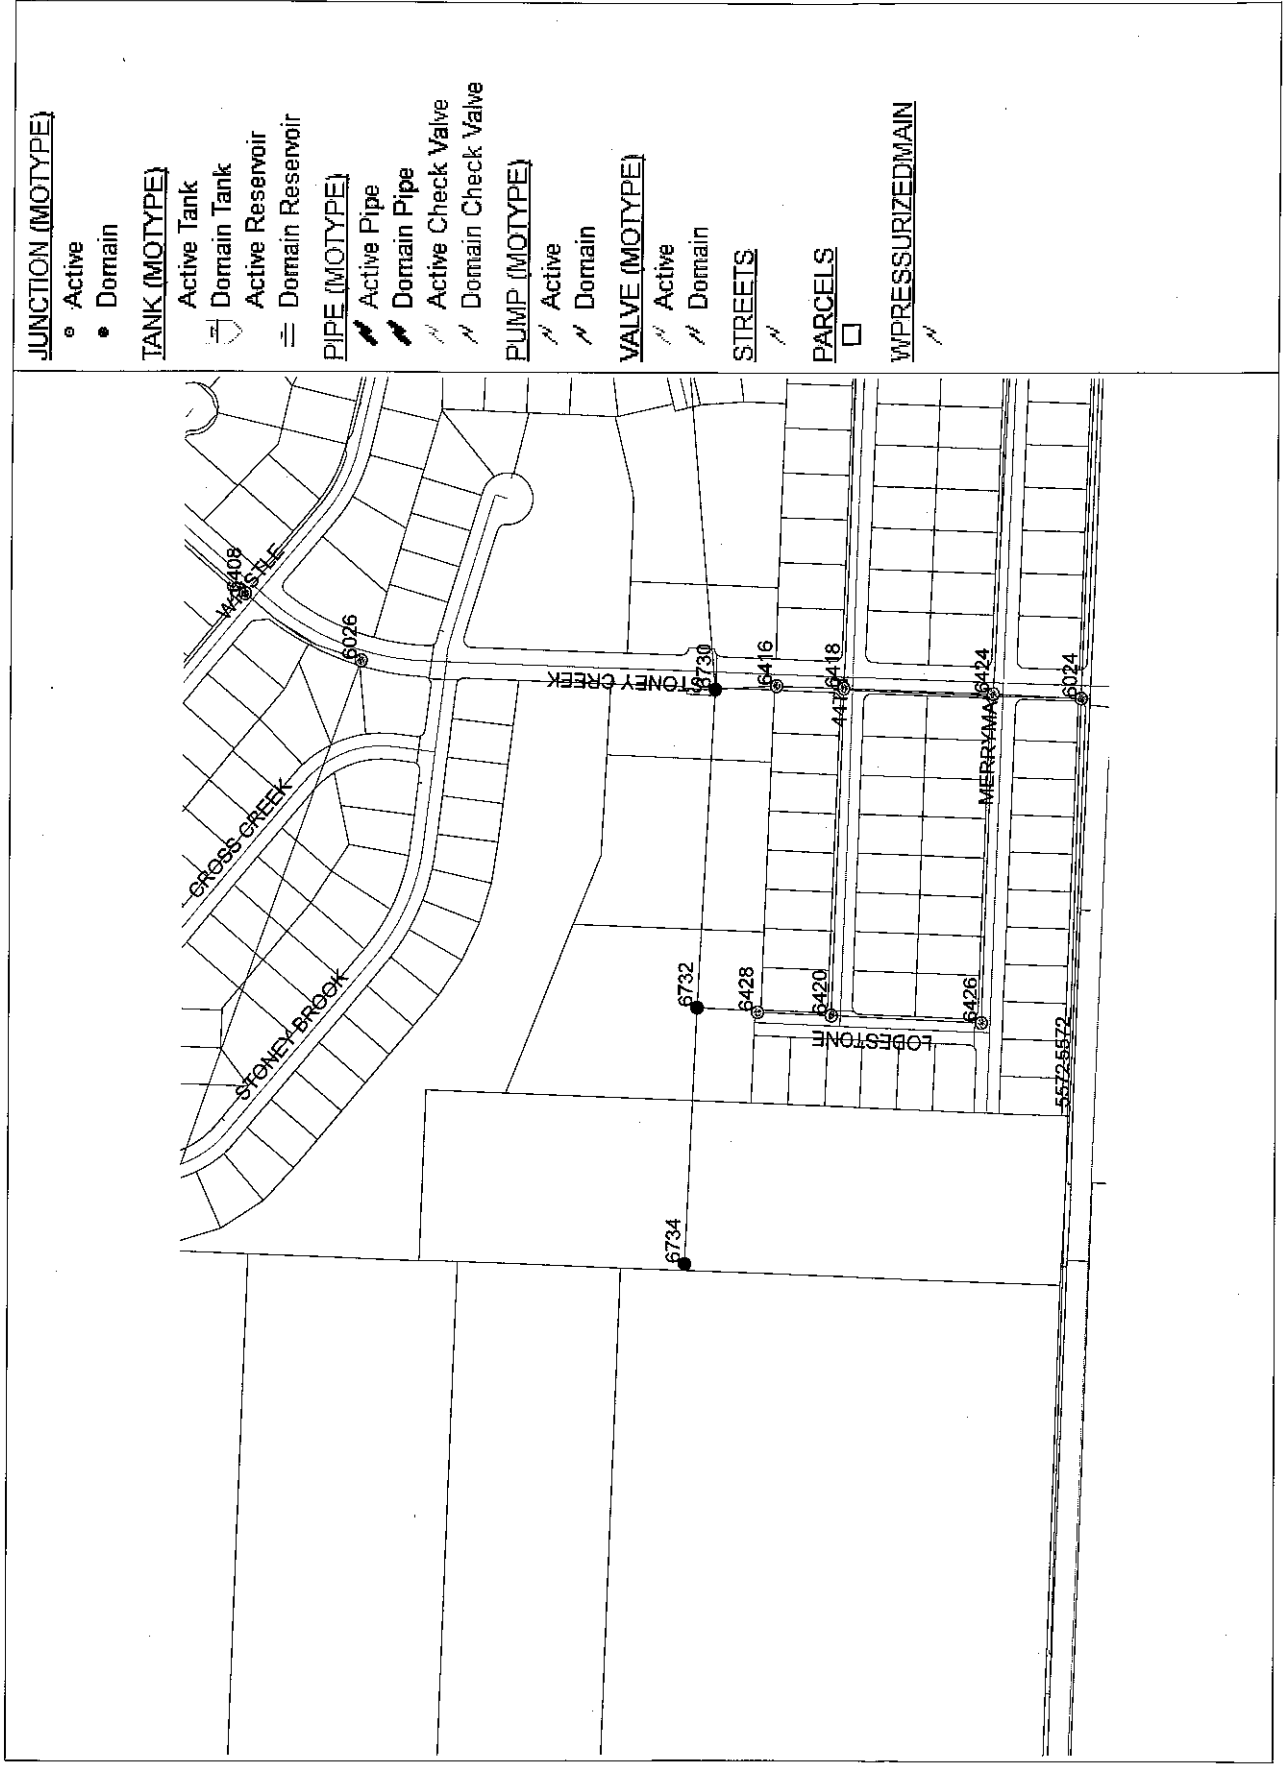

Prepared By:

Date: 1/24/2018 12:16:47 PM

Stoney Creek Fire flows Reserve and Manor

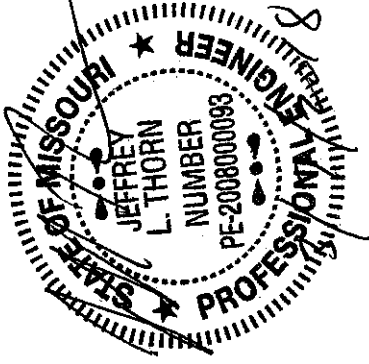

ID	Total Demand (gpm)	Available Flow at Hydrant (gpm)	Critical Node ID	Critical Node Pressure (psi)	Critical Node Head (ft)	Design Flow (gpm)
1 ☐ 6730	1,068.83	8,141.92	6734	-14.89	981.63	6,054.05
2 ☐ 6732	1,061.70	3,966.91	6734	10.45	1,040.11	3,613.55
3 ☐ 6734	1,061.70	2,659.20	6734	20.00	1,062.16	2,659.18