
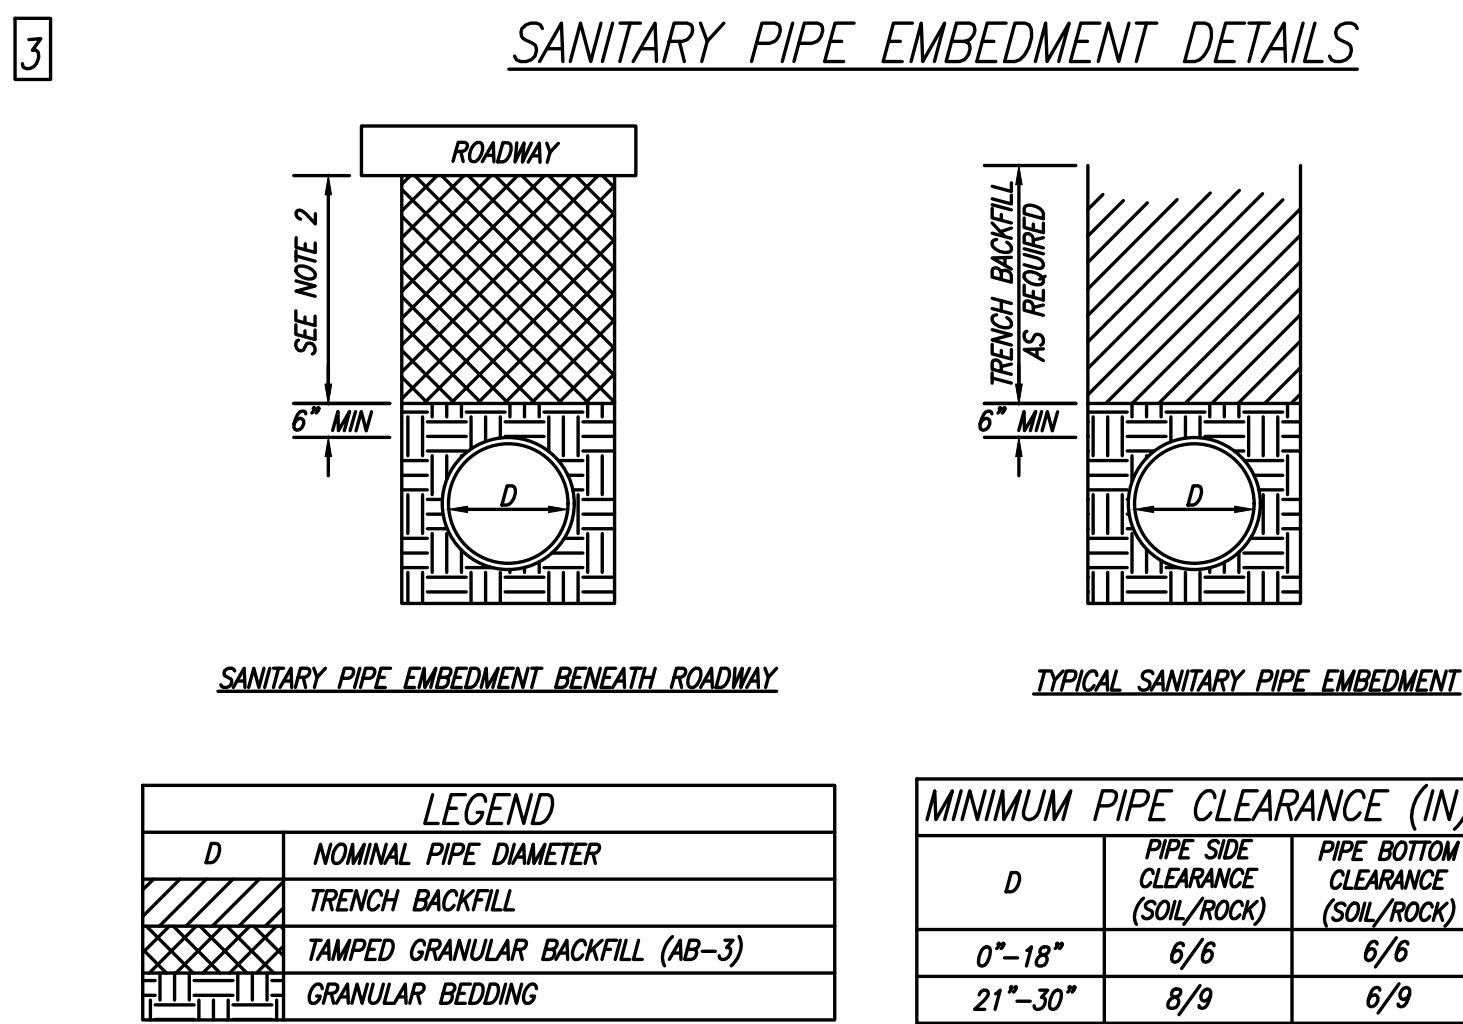
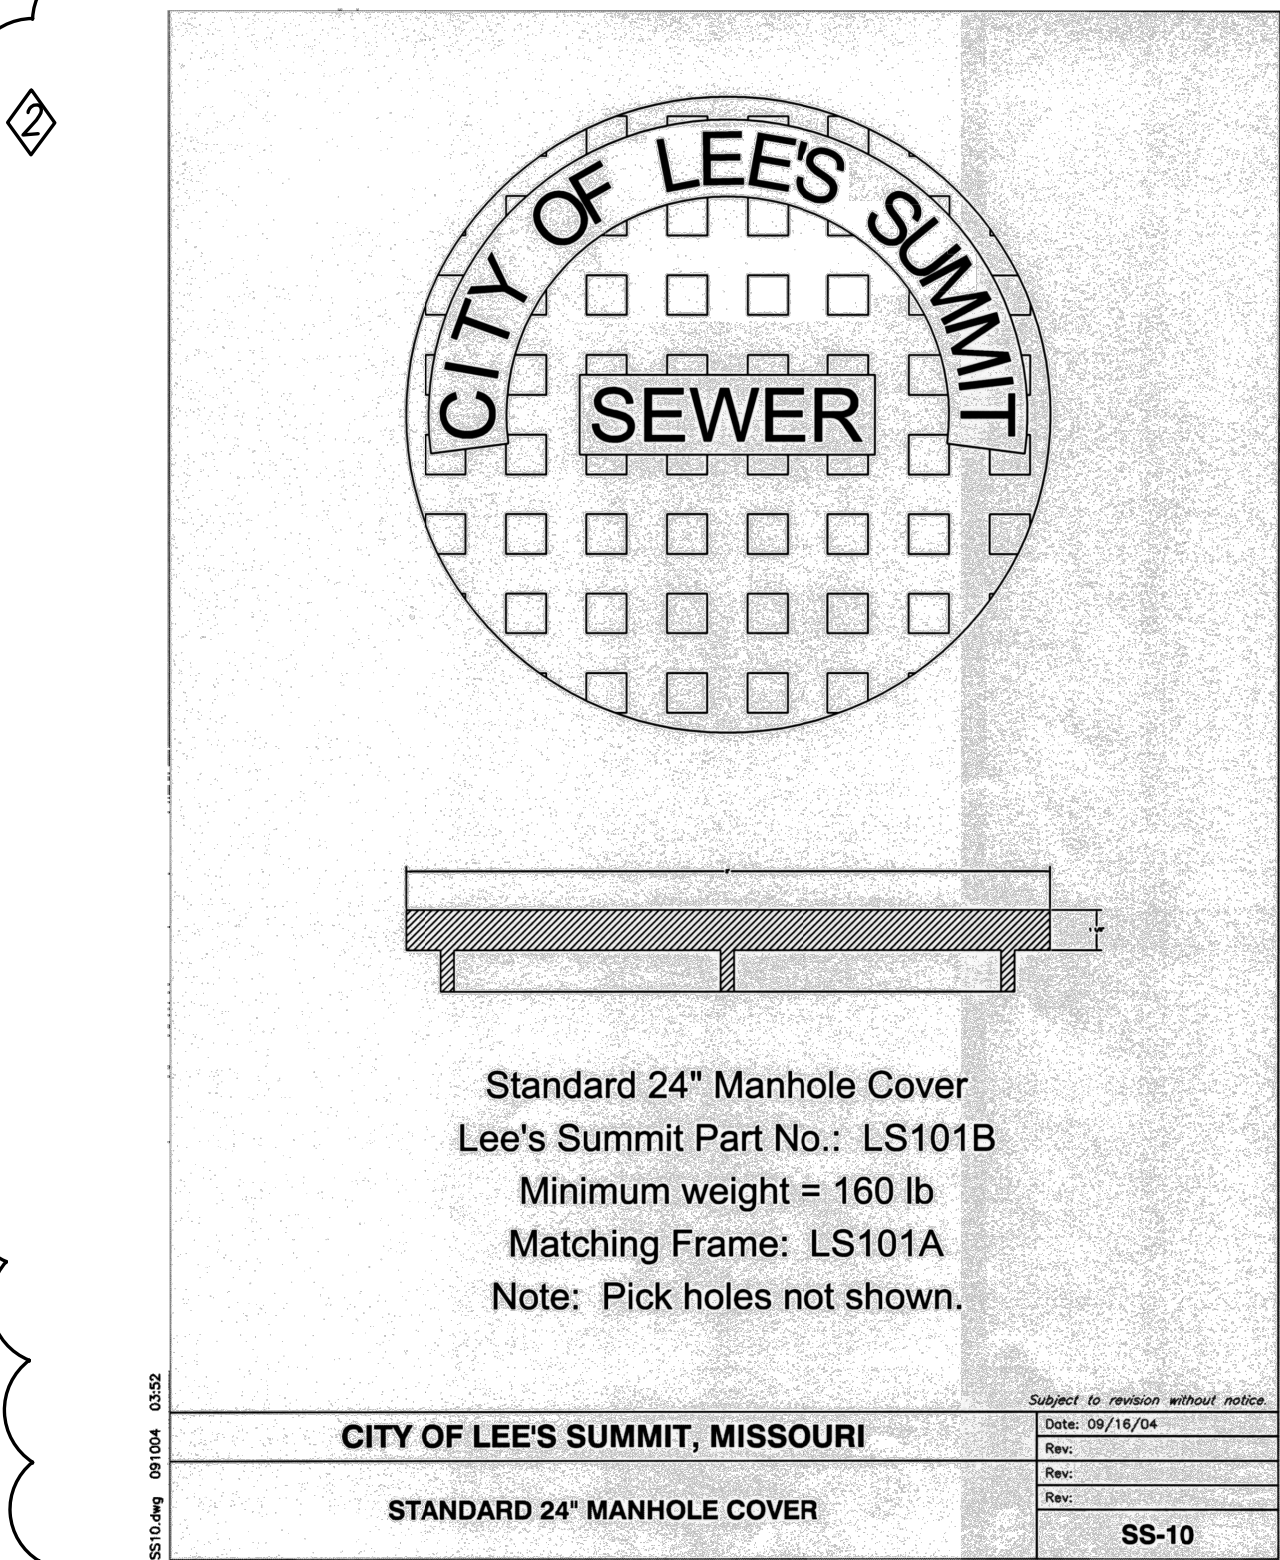


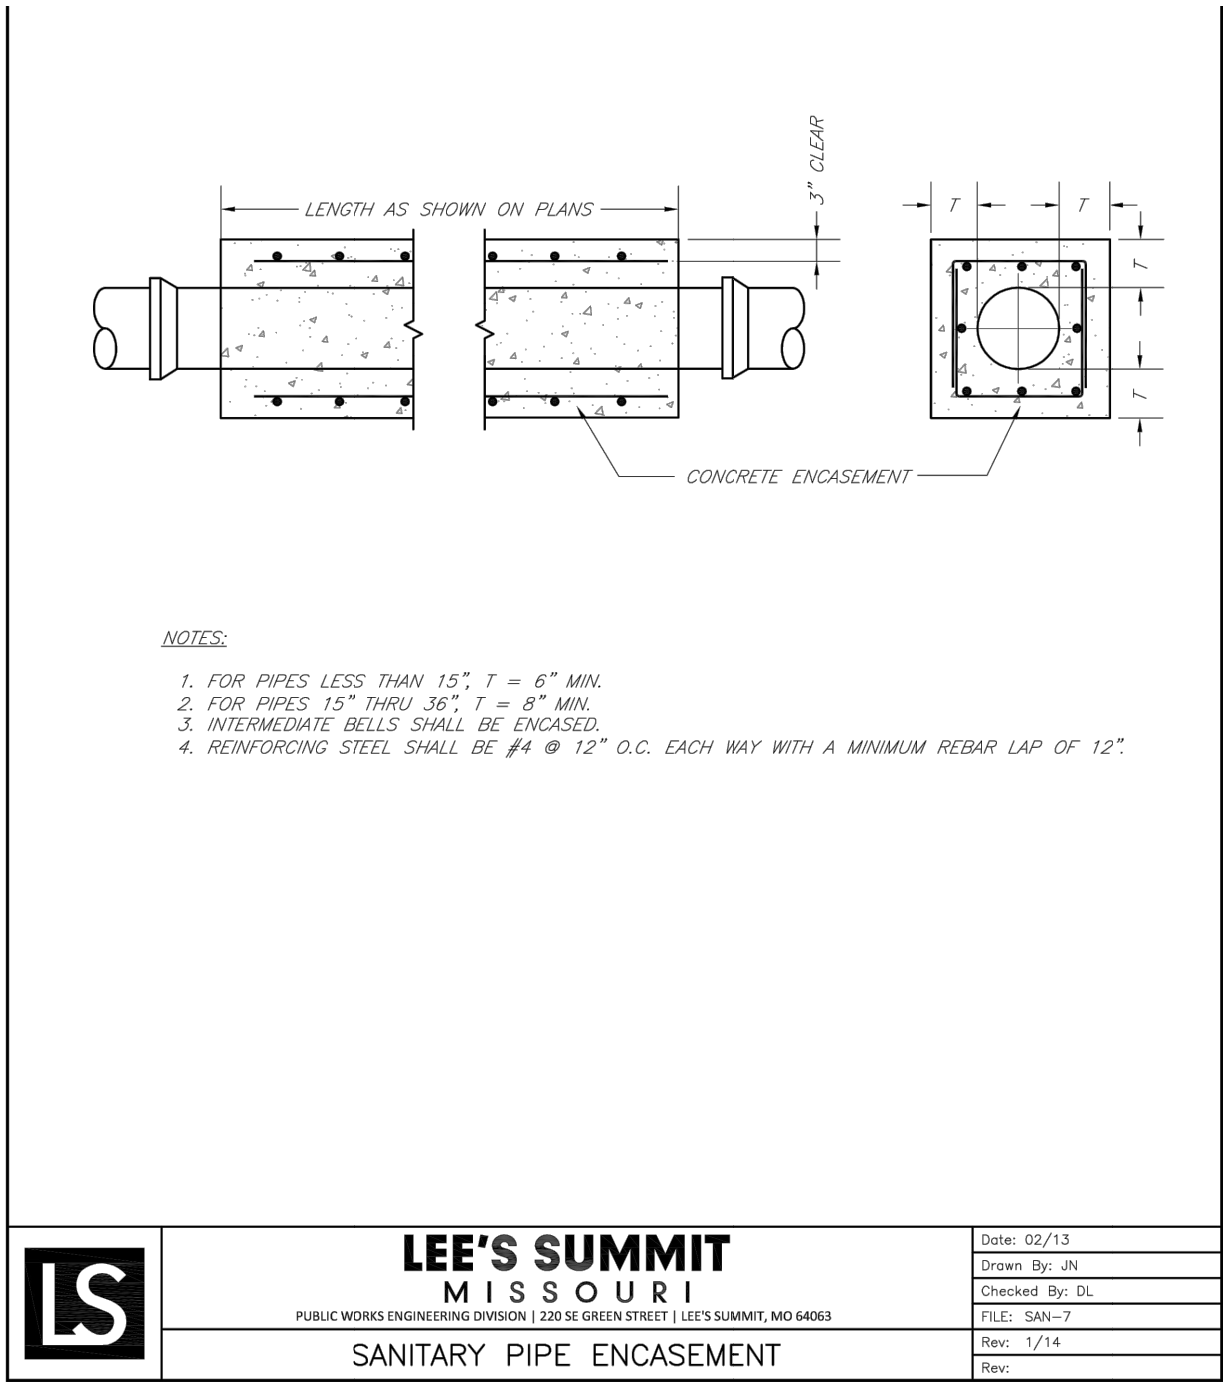

- NOTES:
1. GRANULAR BEDDING SHALL BE 1/2" CLEAN ROCK WITH A MAXIMUM PARTICLE SIZE 3/4 INCH ROCK, PASSING #200 SIEVE ≤35% (PI ≤10 AND LL ≤40). MATERIAL TO BE PLACED IN NOT MORE THAN 6" LAYERS AND COMPACTED BY SLICING WITH A SHOVEL OR VIBRATING.
 2. TAMPED GRANULAR BACKFILL (AB-3) SHALL BE GRANULAR MATERIAL WITH A MAXIMUM PARTICLE SIZE 1 - 1/2 INCH ROCK, PASSING #40 SIEVE (PI ≤8) 15 TO 50% AND #200 SIEVE ≤35%. THIS MATERIAL SHALL BE USED FOR ALL EXISTING AND PROPOSED STREET CROSSINGS FOR MAIN AND LATERAL CONSTRUCTION
 3. TRENCH BACKFILL SHALL BE FINELY DIVIDED MATERIAL FREE FROM DEBRIS AND STONES, COMPACTED TO 95% MAXIMUM DENSITY.
 4. NARROW TRENCH: SUITABLE BACKFILL MATERIAL FOR TRENCHES 24 INCHES OR LESS IN WIDTH AND SHALL BE FLOWABLE BACKFILL (CLSM).
 5. STANDARD TRENCH: SUITABLE BACKFILL MATERIAL FOR TRENCHES BETWEEN 24 TO 48 INCHES WIDE SHALL BE EITHER FLOWABLE BACKFILL (CLSM) OR DENSE, WELL-GRADED AGGREGATE BASE MATERIAL. AGGREGATE BASE MATERIAL SHALL MEET THE REQUIREMENTS FOR KDOT AB-3 OR MODOT TYPES 1 OR 5.
 6. WIDE TRENCH: SUITABLE BACKFILL MATERIAL FOR TRENCHES GREATER THAN 48 INCHES WIDE SHALL BE EITHER MATERIALS SPECIFIED FOR STANDARD TRENCH OR SUITABLE MATERIAL AS SPECIFIED FOR "EARTH EMBANKMENT" IN APWA STANDARD SPECIFICATIONS, SECTION 2102.2.H

REVISION

REVISED ON 02-26-18: DETAILS
ADDED/MODIFIED

REVISED ON 03-23-18: DETAILS
ADDED/MODIFIED

STATE OF MISSOURI
BRIAN L. GLENN
PE-2010011667
03-27-2018
PHOENIX ENGINEERING & SURVEYING, LLC

PHOENIX ENGINEERING & SURVEYING, LLC

3855 S. NORTHERN BLVD.
INDEPENDENCE, MO 64052
(816) 743-9000 FAX (816) 743-9700
ENGINEERING CERTIFICATE NO.: MO E-2000151302-D KS: E-853
SURVEYING CERTIFICATE NO.: MO LS-2000151303-D KS: LS-138

WHISPERING WOODS - 1ST PLAT
LOTS 1 THRU 33
LEE'S SUMMIT, JACKSON COUNTY, MO
SANITARY SEWER PLANS
DETAILS

DESIGNED
BLG
DRAWN
JRT
SCALE
NOTED
DATE
09-01-2017
JOB NO.
04078
SHEET

10 of 10