

SCOPE OF WORK

PROPOSED-TOWER:

- REMOVE (6) EXISTING ANTENNAS
- REMOVE (3) EXISTING RRHs
- REMOVE (3) EXISTING TMAs
- REMOVE (6) EXISTING COAX
- INSTALL (6) PROPOSED ANTENNAS
- INSTALL (12) PROPOSED RRHs
- INSTALL (3) PROPOSED DUAL RRH MOUNTS
- INSTALL (2) PROPOSED DC6 SURGE SUPPRESSION UNITS
- INSTALL (1) PROPOSED FIBER TRUNK
- INSTALL (4) PROPOSED DC POWER TRUNKS

PROPOSED-GROUND:

- INSTALL (1) PROPOSED NOKIA BBU (BY OTHERS)
- INSTALL (1) PROPOSED DC12 SURGE SUPPRESSION UNIT
- INSTALL (1) PROPOSED CABLE ENTRY PORT BOOT
- INSTALL (1) PROPOSED FIBER STORAGE BOX

NOTE: MOUNT MODIFICATIONS REQUIRED.

SITE INFORMATION

PROPERTY OWNER:

AMERICAN TOWER CORPORATION

ADDRESS:

116 HUNTINGTON AVE.
BOSTON, MA 02116

TOWER OWNER:

AMERICAN TOWER CORPORATION

SITE CONTACT:

SARA BEHM
(781) 926-4596

COUNTY:

JACKSON

LATITUDE (NAD 83):

38° 51' 54.3" N
38.86509

LONGITUDE (NAD 83):

-94° 22' 37.7" W
-94.37714

ZONING JURISDICTION:

NA

ZONING DISTRICT:

NA

OCCUPANCY GROUP:

U

CONSTRUCTION TYPE:

V-B

POWER COMPANY:

KCP&L

TELEPHONE COMPANY:

AT&T

CONSTRUCTION MANAGER:

ALLEN ARTHUR
(636) 536-5860


SITE ACQUISITION MANAGER:

ANDREA BUNCH
(636) 536-5810

RF ENGINEER:

AMOR SIMEON
(636) 479-0138

LEE'S SUMMIT
10000414
KS4019

at&t

LTE 3C/4C/FIRSTNET 5C/2C BWE
RAD CENTER: 190'
300' - GUYED TOWER

VICINITY MAP

LOCAL MAP

NO SCALE

CONTACT INFORMATION

ENGINEER:

BLACK & VEATCH CORPORATION
6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211

CONTACT:

SCOTT KEFFER

PHONE:

(913) 458-2483

DRIVING DIRECTIONS

DIRECTIONS FROM NEAREST MAJOR INTERSTATE

HEAD EAST ON I-435 E. CONTINUE ONTO I-470 E. EXIT 7A TO MERGE ONTO US-50 E TOWARD SEDALIA. EXIT ONTO MO-291 S TOWARD HARRISONVILLE. TURN RIGHT (WEST) ONTO SW HOOK ROAD. DESTINATION WILL BE ON THE LEFT (SOUTH).

ENGINEERING

2012 INTERNATIONAL BUILDING CODE OR ADOPTED CODE
2011 NATIONAL ELECTRIC CODE OR ADOPTED CODE
TIA/EIA-222-G OR ADOPTED CODE

GENERAL NOTES

THE FACILITY IS UNMANNED AND NOT FOR HUMAN HABITATION. A TECHNICIAN WILL VISIT THE SITE AS REQUIRED FOR ROUTINE MAINTENANCE. THE PROJECT WILL NOT RESULT IN ANY SIGNIFICANT DISTURBANCE OR EFFECT ON DRAINAGE; NO SANITARY SEWER SERVICE, POTABLE WATER, OR TRASH DISPOSAL IS REQUIRED AND NO COMMERCIAL SIGNAGE IS PROPOSED.

DRAWING INDEX

SHEET NO:	SHEET TITLE
T-1	TITLE SHEET
C-1	SITE PLAN
C-1.1	EQUIPMENT LAYOUT
C-2	ELEVATIONS
C-3	ANTENNA LAYOUT AND SCHEDULE
C-4	EQUIPMENT DETAILS
C-5	EQUIPMENT DETAILS
RF-1	CABLE COLOR CODING
G-1	GROUNDING ONE-LINE ANTENNA EQUIPMENT
G-2	GROUNDING DETAILS
GN-1	LEGEND & ABBREVIATIONS
GN-2	GENERAL CONSTRUCTION NOTES
GN-3	GENERAL ELECTRICAL NOTES
S-1	ANTENNA MOUNT REINFORCEMENT (REFERENCE ONLY)

11"x17" PLOT WILL BE HALF SCALE UNLESS OTHERWISE NOTED

CONTRACTOR SHALL VERIFY ALL PLANS & EXISTING DIMENSIONS & CONDITIONS ON THE JOB SITE & SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK OR BE RESPONSIBLE FOR SAME

UNDERGROUND
SERVICE ALERT
UTILITIES PROTECTION CENTER, INC.
811
48 HOURS BEFORE YOU DIG

at&t
7801 FARLEY
OVERLAND PARK, KS 66204

BLACK & VEATCH
6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO: 129031
DRAWN BY: LGH
CHECKED BY: SK


REV	DATE	DESCRIPTION
0	05/21/18	ISSUED FOR CONSTRUCTION


05/24/2018
IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
TITLE SHEET

SHEET NUMBER
T-1

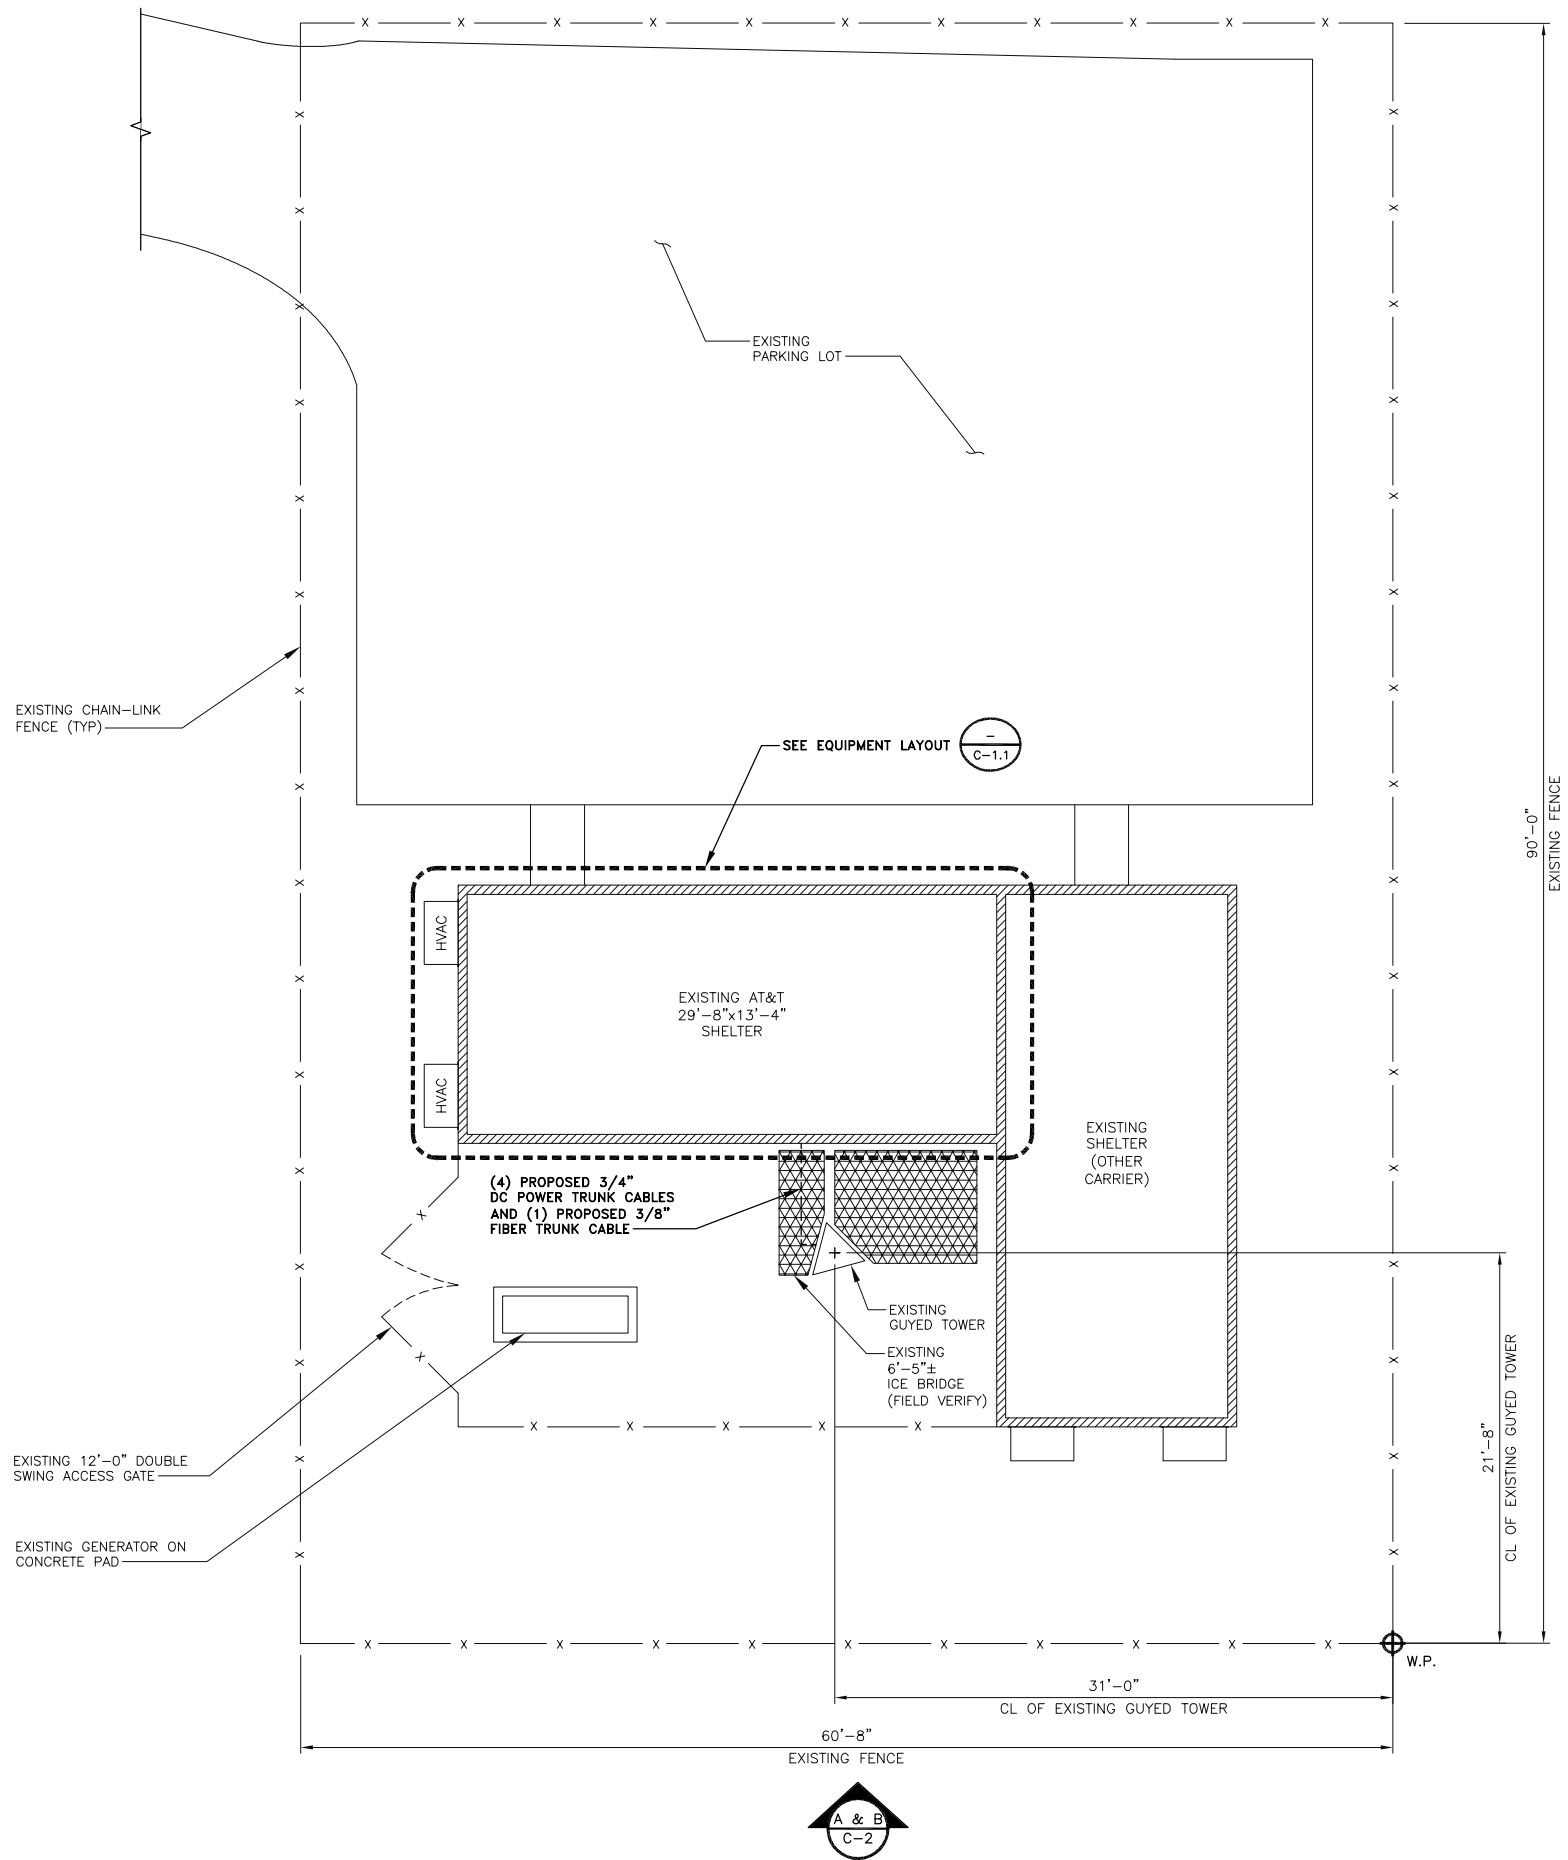

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS.
2. ANTENNAS & MOUNTS OMITTED FOR CLARITY.

NOTES



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION


STATE OF MISSOURI
SCOTT KEFFER
NUMBER PE-2018006013
05/24/2018
IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.


LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
SITE PLAN


SHEET NUMBER
C-1

SITE PLAN

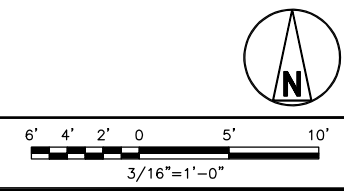


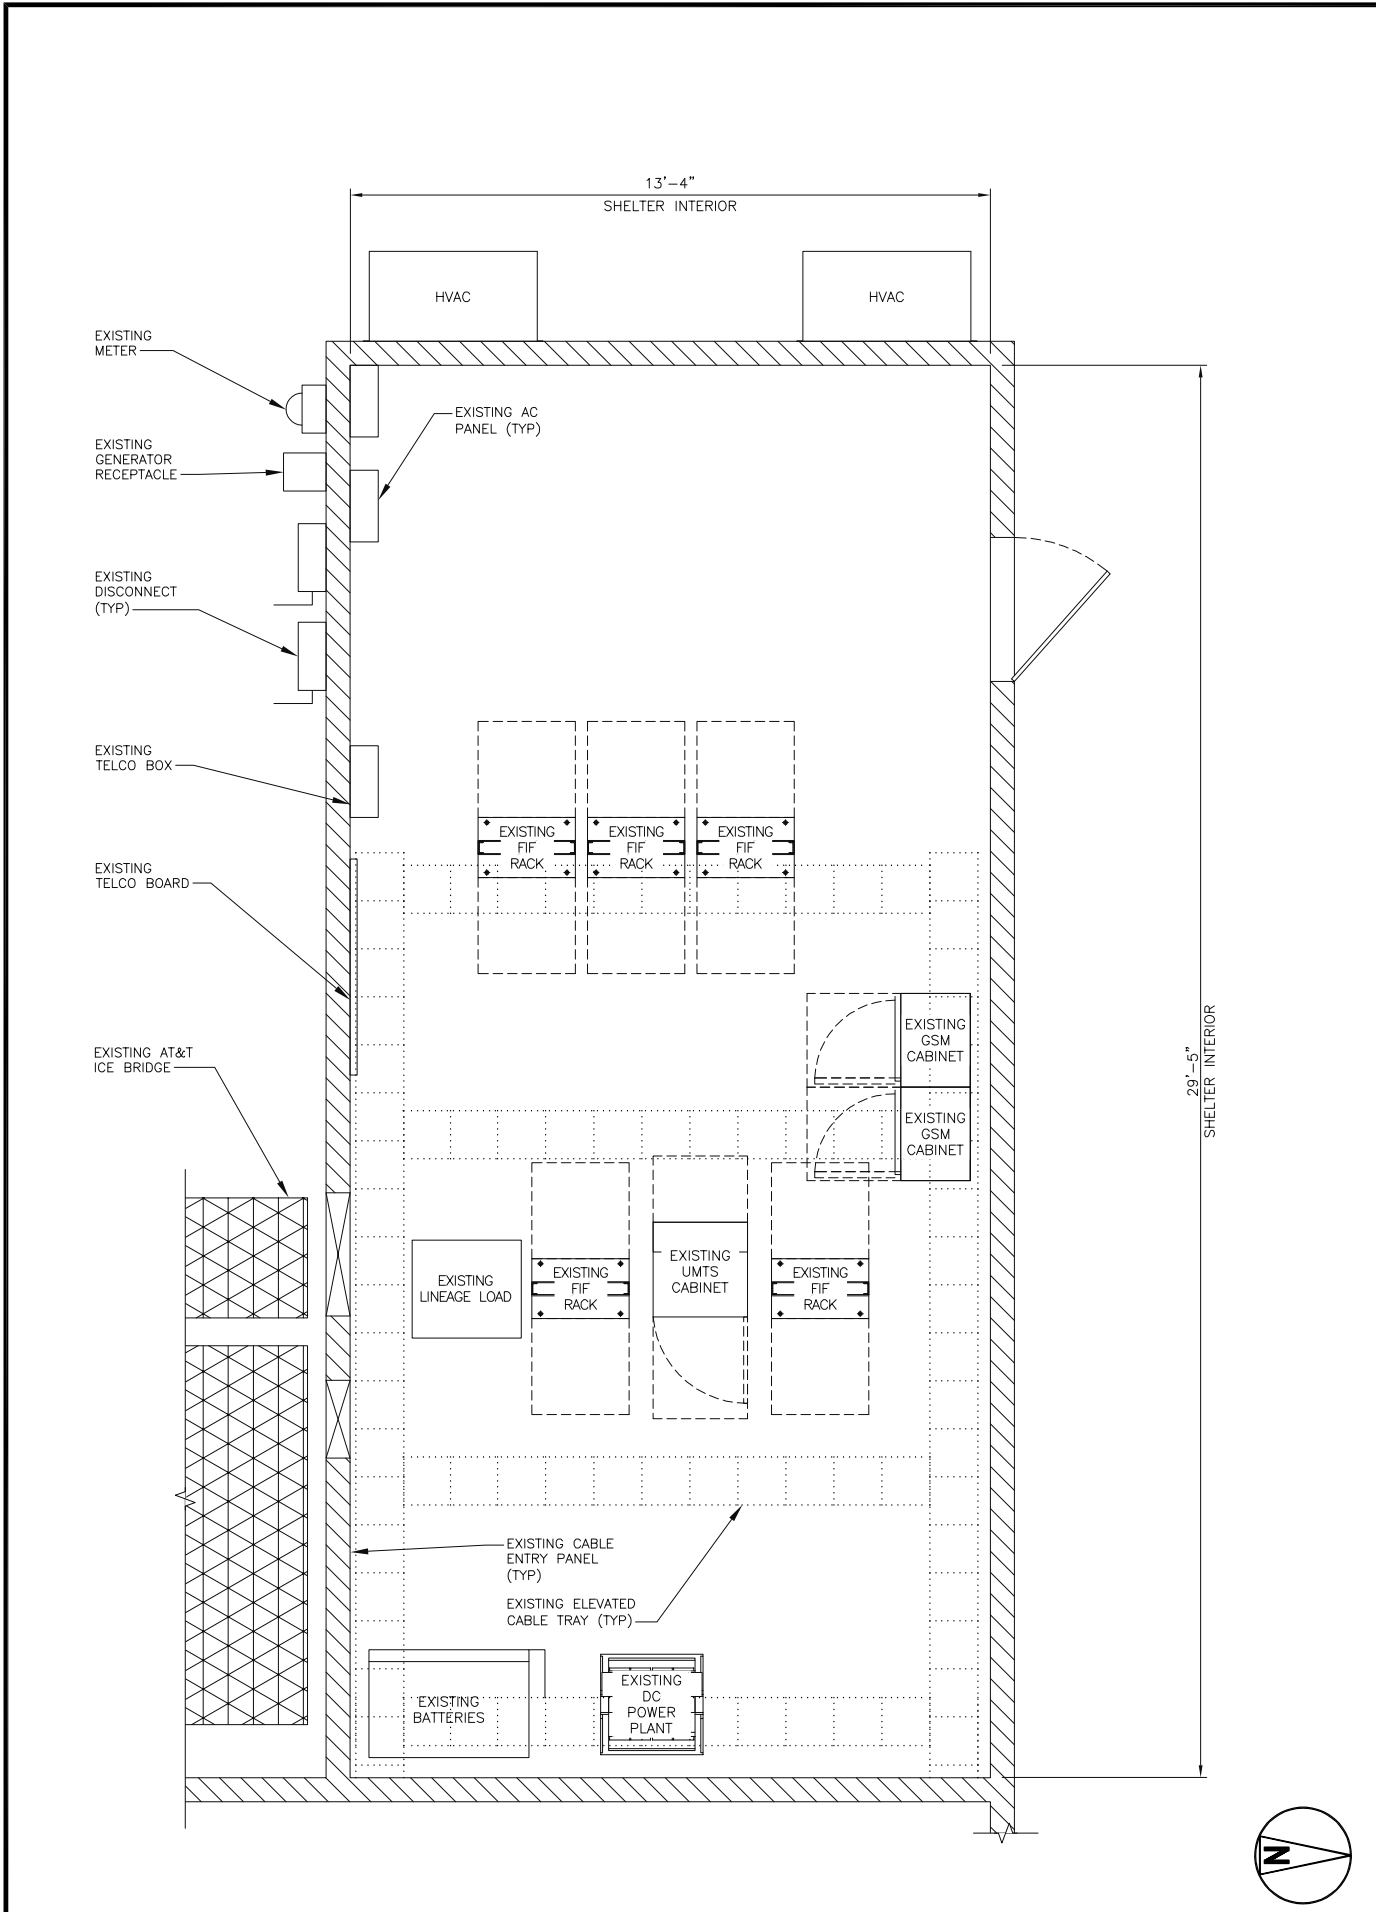


EXISTING EQUIPMENT LAYOUT



A

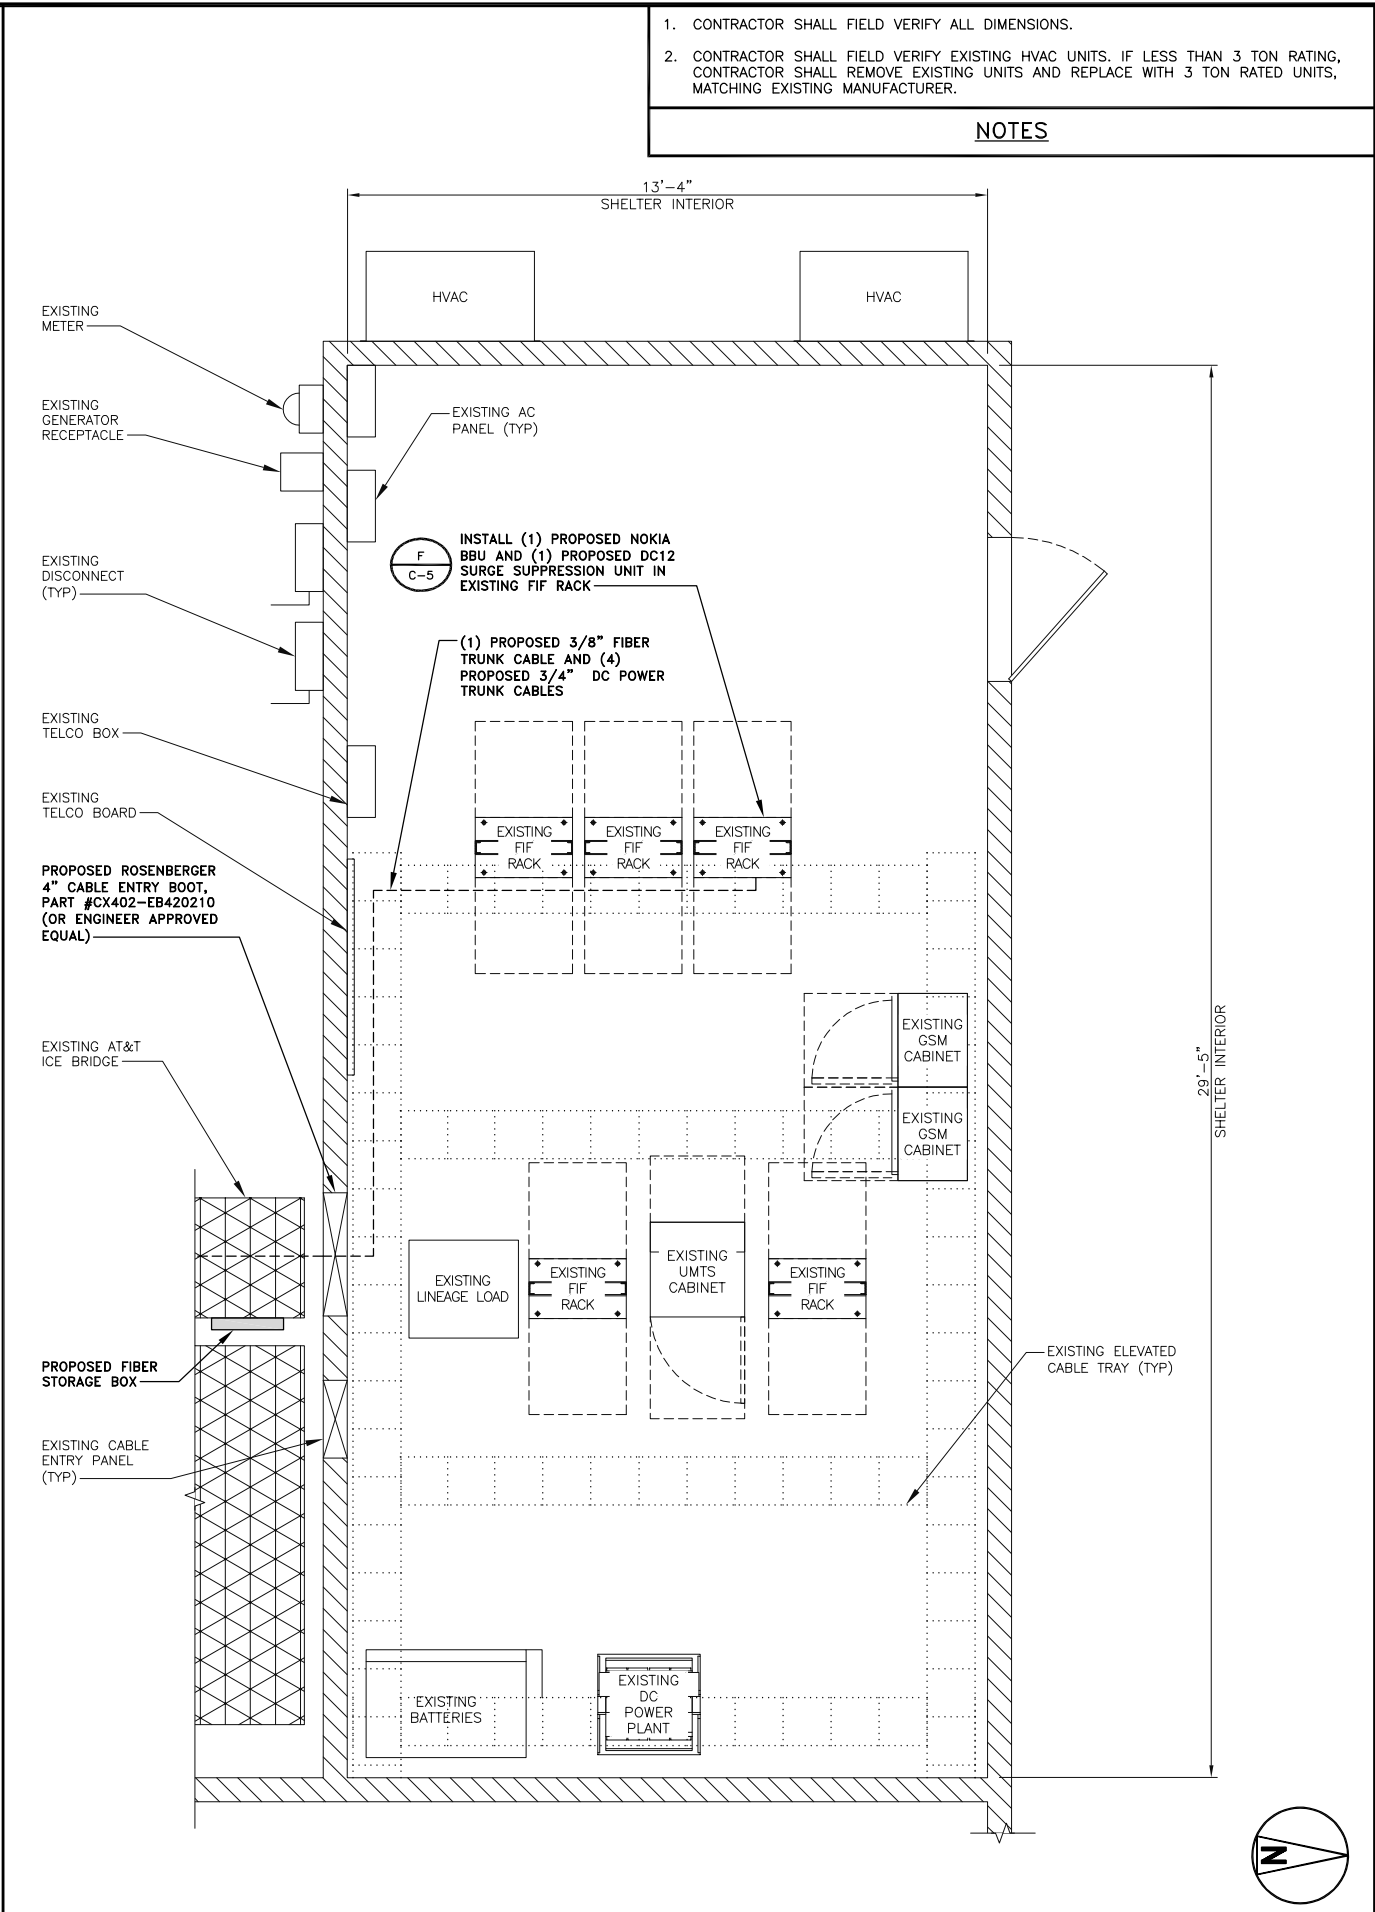

PROPOSED EQUIPMENT LAYOUT



B

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS.
2. CONTRACTOR SHALL FIELD VERIFY EXISTING HVAC UNITS. IF LESS THAN 3 TON RATING, CONTRACTOR SHALL REMOVE EXISTING UNITS AND REPLACE WITH 3 TON RATED UNITS, MATCHING EXISTING MANUFACTURER.

NOTES



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



05/24/2018


IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE


SHEET TITLE
EQUIPMENT LAYOUT

SHEET NUMBER


C-1.1

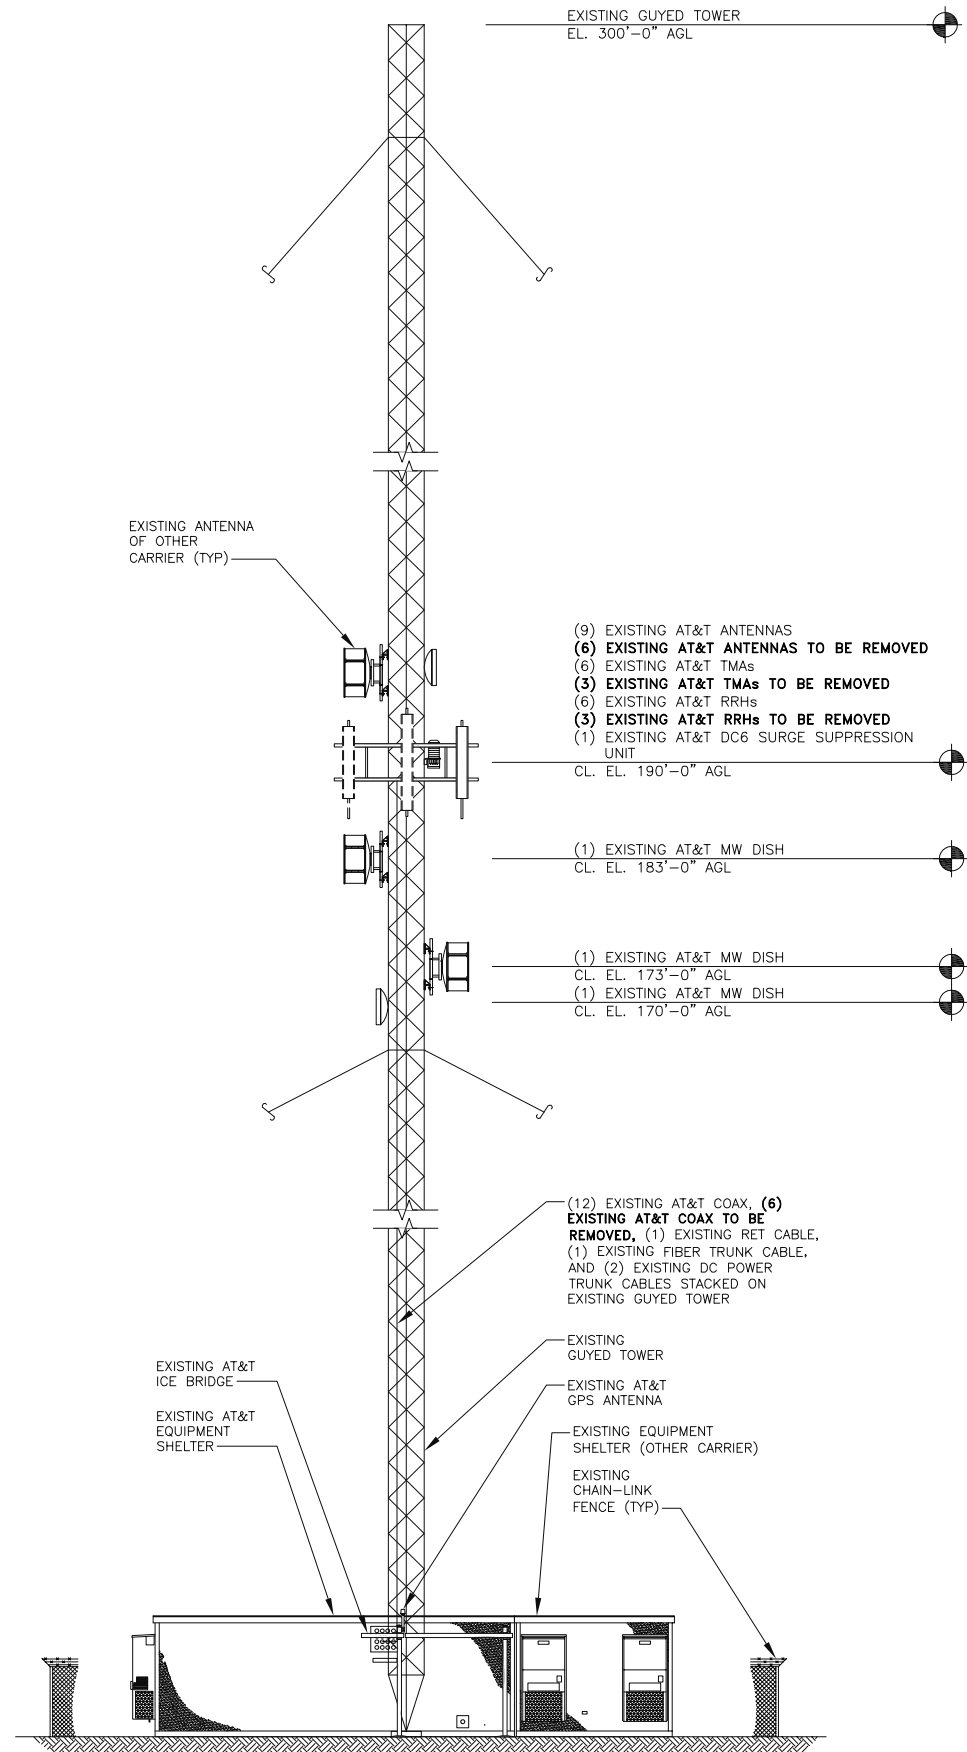


EXISTING ELEVATION
SEE DRAWING C-1



A

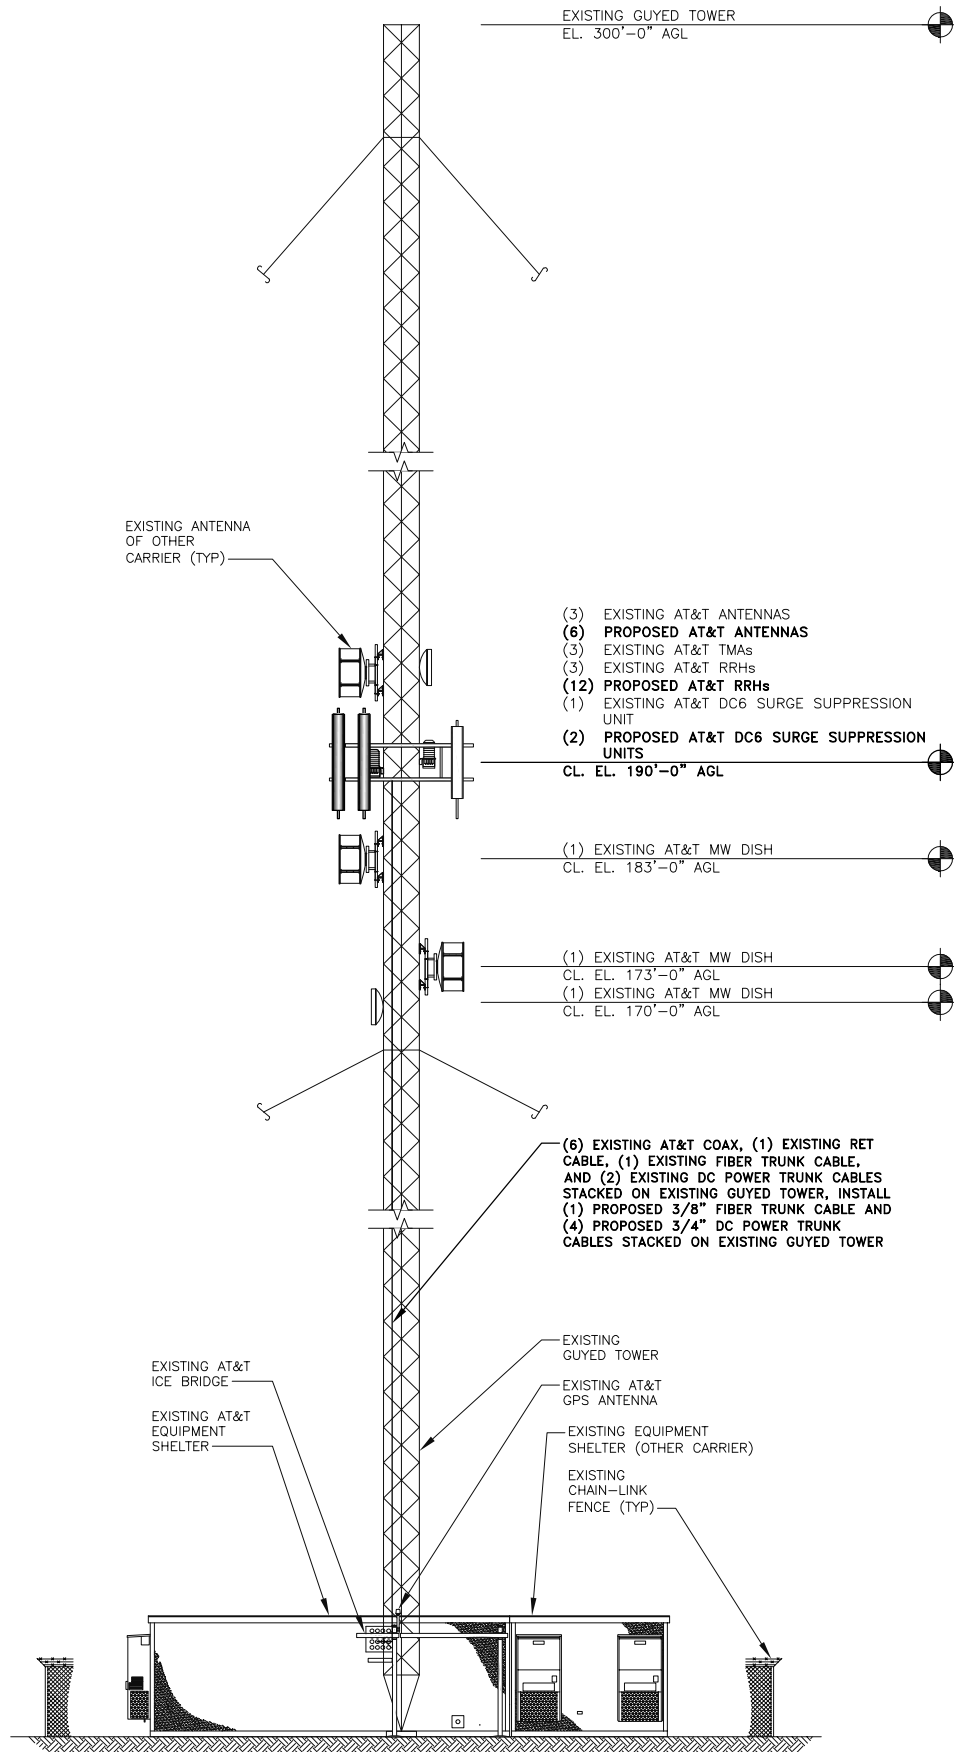

PROPOSED ELEVATION
SEE DRAWING C-1



B

NOTES

1. FENCE NOT ENTIRELY SHOWN FOR CLARITY.
2. THE EXISTING STRUCTURE IS OVERSTRESSED AND STRUCTURAL MODIFICATIONS AS PER STRUCTURE MODIFICATION DESIGN BY ATC ON 05/04/2018 MUST BE INSTALLED PRIOR TO INSTALLATION OF ANY AT&T EQUIPMENT.
3. THE EXISTING ANTENNA MOUNTS ARE OVERSTRESSED AND STRUCTURAL MODIFICATIONS AS PER ANTENNA MOUNT MODIFICATION DESIGN BY BLACK & VEATCH ON 10/06/2017 MUST BE INSTALLED PRIOR TO INSTALLATION OF ANY AT&T EQUIPMENT, AS SHOWN ON DRAWING SHEET S-1.
4. ANY ADDITIONAL EQUIPMENT NOTED ON THE STRUCTURAL ANALYSIS SHOULD BE CONSIDERED AS RESERVED LOADING, WHICH COULD BE INSTALLED AT A FUTURE DATE.



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

REV	DATE	DESCRIPTION
0	05/21/18	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.


LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
ELEVATIONS

SHEET NUMBER
C-2


SECTOR	EXISTING			FINAL			RAD CENTER, AGL	TMA MODEL NUMBER	RRH MODEL NUMBER	RRH MODEL NUMBER
	ANTENNA MODEL NUMBER	TECHNOLOGY	AZIMUTH	ANTENNA MODEL NUMBER	TECHNOLOGY	AZIMUTH				
A1	POWERWAVE P65-15-XLH-RR	UMTS	4	POWERWAVE P65-15-XLH-RR	UMTS	4	190'	POWERWAVE TT08-19DB111-001	-	-
A2	-	-	-	-	-	-	-	-	-	-
A3	* CCI HPA-65R-BUU-H8	LTE 1C/2C	4	-	-	-	-	-	-	-
A4	-	-	-	ANDREW JAH4-65C-R4	LTE 1C/2C/4C/5C FIRSTNET	4	190'	-	ALCATEL-LUCENT 9442 RRH2x40-07-L	ALCATEL-LUCENT B25 RRH4x30-4R
A5	* POWERWAVE P65-15-XLH-RR	GSM	4	ANDREW JAH4-65C-R4	LTE 3C	4	190'	-	ALCATEL-LUCENT RRH4x25-WCS-4R	ALCATEL-LUCENT FLEXI RRH 4T4R B14 160W
B1	POWERWAVE P65-16-XLH-RR	UMTS	124	POWERWAVE P65-16-XLH-RR	UMTS	124	190'	POWERWAVE TT08-19DB111-001	-	-
B2	-	-	-	-	-	-	-	-	-	-
B3	* CCI HPA-65R-BUU-H8	LTE 1C/2C	124	-	-	-	-	-	-	-
B4	-	-	-	ANDREW JAH4-65C-R4	LTE 1C/2C/4C/5C FIRSTNET	124	190'	-	ALCATEL-LUCENT 9442 RRH2x40-07-L	ALCATEL-LUCENT B25 RRH4x30-4R
B5	* POWERWAVE P65-16-XLH-RR	GSM	124	ANDREW JAH4-65C-R4	LTE 3C	124	190'	-	ALCATEL-LUCENT RRH4x25-WCS-4R	ALCATEL-LUCENT FLEXI RRH 4T4R B14 160W
C1	POWERWAVE P65-15-XLH-RR	UMTS	244	POWERWAVE P65-15-XLH-RR	UMTS	244	190'	POWERWAVE TT08-19DB111-001	-	-
C2	-	-	-	-	-	-	-	-	-	-
C3	* CCI HPA-65R-BUU-H8	LTE 1C/2C	244	-	-	-	-	-	-	-
C4	-	-	-	ANDREW JAH4-65C-R4	LTE 1C/2C/4C/5C FIRSTNET	244	190'	-	ALCATEL-LUCENT 9442 RRH2x40-07-L	ALCATEL-LUCENT B25 RRH4x30-4R
C5	* POWERWAVE P65-15-XLH-RR	GSM	244	ANDREW JAH4-65C-R4	LTE 3C	244	190'	-	ALCATEL-LUCENT RRH4x25-WCS-4R	ALCATEL-LUCENT FLEXI RRH 4T4R B14 160W
									ALCATEL-LUCENT B66 RRH4x45	-

RFDS VERSION: CONTRACTOR IS TO REFER TO AT&T'S MOST CURRENT RADIO FREQUENCY DATA SHEET (RFDS) PRIOR TO CONSTRUCTION.
* EXISTING ANTENNA AND TMA TO BE REMOVED.

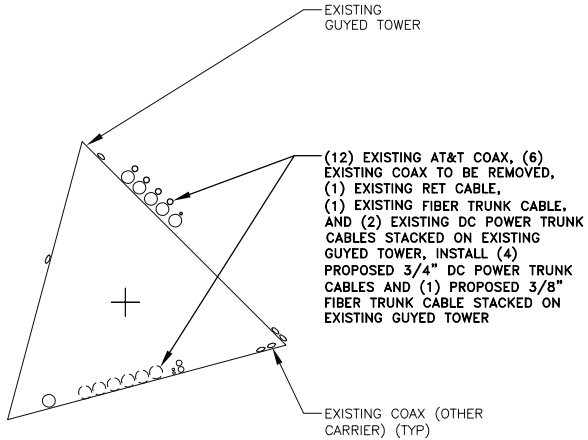

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

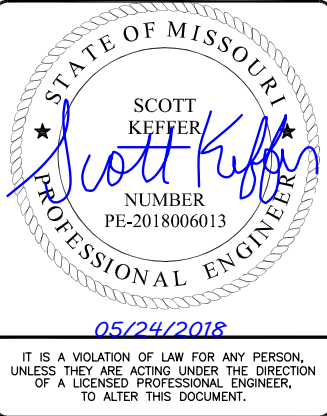

LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
ANTENNA LAYOUT
AND SCHEDULE

SHEET NUMBER
C-3

ANTENNA CONFIGURATION


NO SCALE

A

PROPOSED CABLE ROUTING LAYOUT

NO SCALE

B

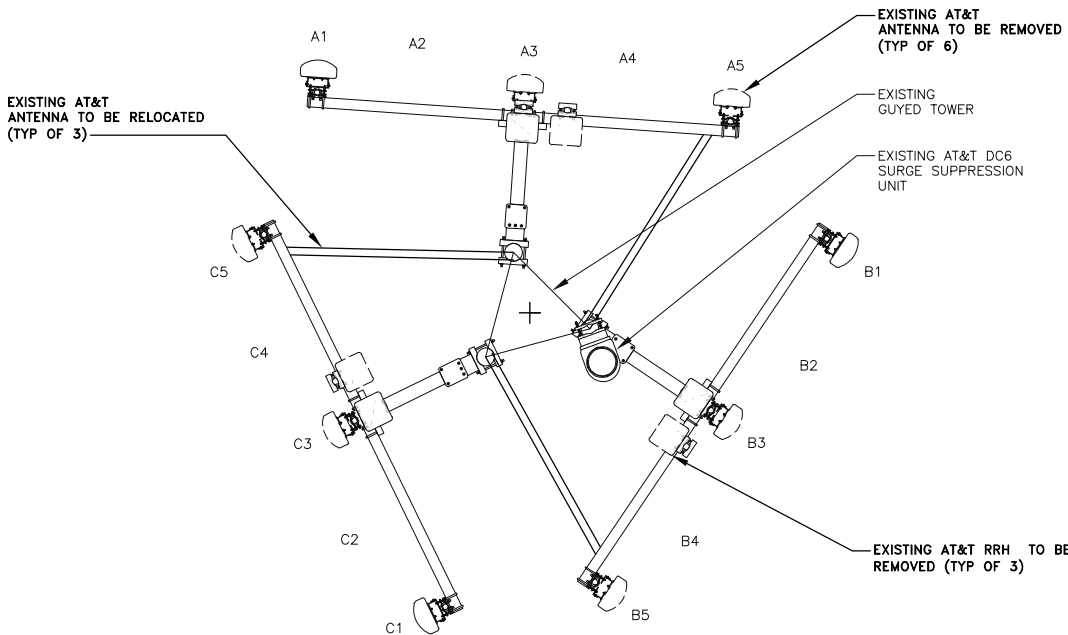

(B & C C-5) PROPOSED AT&T DC6 SURGE SUPPRESSION UNIT (TYP OF 2)


EXISTING RELOCATED STIFF ARM (TYP OF 3)

(E & F C-4) (2) PROPOSED AT&T RRHs ON PROPOSED DUAL RRH MOUNT (TYP OF 3)

(D & E C-5)

NOTES

- SEE ANTENNA CONFIGURATION FOR MODEL NUMBERS AND AZIMUTHS.
- EXACT PLACEMENT OF RRHs TO BE FIELD VERIFIED AND NOT EXCEED ANTENNA DIMENSIONS ON TOWER.
- PROPOSED EQUIPMENT MOUNTED TO THE TOWER LEG TO BE INSTALLED IN A MANNER THAT DOES NOT INTERFERE WITH CLIMBING APPARATUS.
- ANTENNAS SHALL BE LOCATED SPECIFICALLY AS SHOWN, PER THE ANTENNA MOUNT ANALYSIS, FOR LOAD DISTRIBUTION.

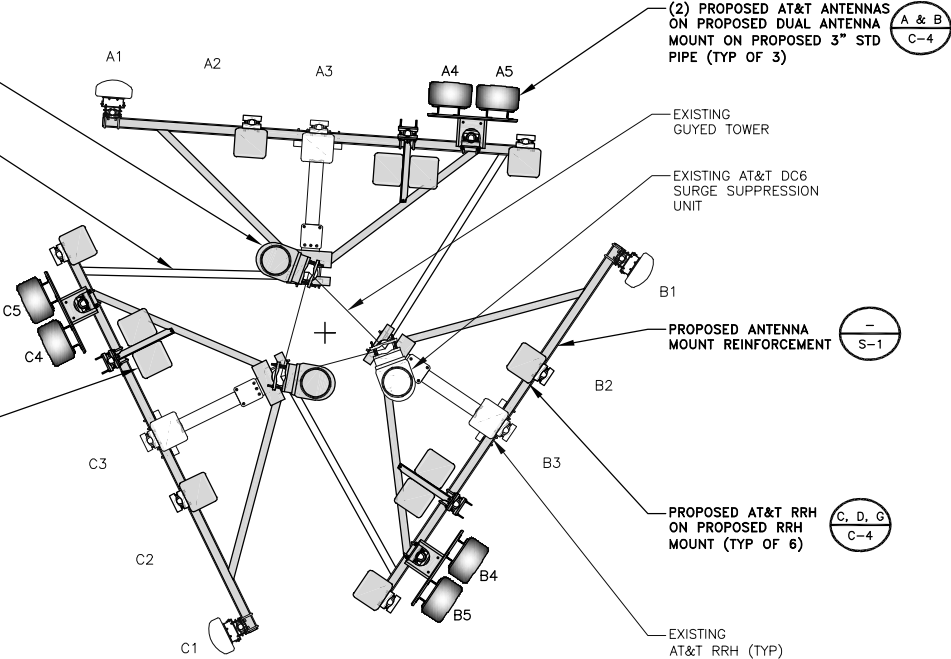

EXISTING ANTENNA LAYOUT

NO SCALE

C

PROPOSED ANTENNA LAYOUT

NO SCALE

D

ALPHA SECTOR

Technical drawing of the 1000 Series Single-Door Cabinet. The drawing includes a side view on the left and a front view on the right. The side view shows a height of 96.0" and a depth of 8.2". The front view shows a width of 13.8" and a door with a handle and lock mechanism.

BETA SECTOR

Technical drawing of the 1000 Series Vertical Radiator. The drawing includes a front view and a side view. The front view shows a vertical radiator with a height of 96.0" and a width of 8.2". The side view shows the radiator's profile with a depth of 13.8".

GAMMA SECTOR

NO SCALE

A

SEE NOTE #3

NO SCALE

RRH SPECIFICATIONS (B66)

NO SCALE

D


Technical drawing of a rectangular object. The vertical dimension is labeled 31.5" and the horizontal dimension is labeled 8.7".

NOTE:
FOLLOW MANUFACTURER'S
INSTRUCTIONS FOR WEATHERPROOFING
OF CONNECTIONS.

NO SCALE

NO SCALE


G



6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

DRAWN BY:	LGH
-----------	-----

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

SHEET TITLE

SHEET NUMBER

C-4

Sector A			
Cable #	SECTOR	FREQ	PORT
700 MHz TX1/RX1	RED	RED	RED
700 MHz TX2/RX2	RED	RED	ORANGE
850 MHz TX1/RX1	RED	ORANGE	RED
850 MHz TX2/RX2	RED	ORANGE	ORANGE
1900 MHz TX1/RX1	RED	YELLOW	RED
1900 MHz TX2/RX2	RED	YELLOW	ORANGE
1900 MHz TX3/RX3	RED	YELLOW	YELLOW
1900 MHz TX4/RX4	RED	YELLOW	WHITE
2100 MHz TX1/RX1	RED	WHITE	RED
2100 MHz TX2/RX2	RED	WHITE	ORANGE
2100 MHz TX3/RX3	RED	WHITE	YELLOW
2100 MHz TX4/RX4	RED	WHITE	WHITE
2300 MHz TX1/RX1	RED	BROWN	RED
2300 MHz TX2/RX2	RED	BROWN	ORANGE
2300 MHz TX3/RX3	RED	BROWN	YELLOW
2300 MHz TX4/RX4	RED	BROWN	WHITE

Sector B			
Cable #	SECTOR	FREQ	PORT
700 MHz TX1/RX1	BLUE	RED	RED
700 MHz TX2/RX2	BLUE	RED	ORANGE
850 MHz TX1/RX1	BLUE	ORANGE	RED
850 MHz TX2/RX2	BLUE	ORANGE	ORANGE
1900 MHz TX1/RX1	BLUE	YELLOW	RED
1900 MHz TX2/RX2	BLUE	YELLOW	ORANGE
1900 MHz TX3/RX3	BLUE	YELLOW	YELLOW
1900 MHz TX4/RX4	BLUE	YELLOW	WHITE
2100 MHz TX1/RX1	BLUE	WHITE	RED
2100 MHz TX2/RX2	BLUE	WHITE	ORANGE
2100 MHz TX3/RX3	BLUE	WHITE	YELLOW
2100 MHz TX4/RX4	BLUE	WHITE	WHITE
2300 MHz TX1/RX1	BLUE	BROWN	RED
2300 MHz TX2/RX2	BLUE	BROWN	ORANGE
2300 MHz TX3/RX3	BLUE	BROWN	YELLOW
2300 MHz TX4/RX4	BLUE	BROWN	WHITE

Sector C			
Cable #	SECTOR	FREQ	PORT
700 MHz TX1/RX1	GREEN	RED	RED
700 MHz TX2/RX2	GREEN	RED	ORANGE
850 MHz TX1/RX1	GREEN	ORANGE	RED
850 MHz TX2/RX2	GREEN	ORANGE	ORANGE
1900 MHz TX1/RX1	GREEN	YELLOW	RED
1900 MHz TX2/RX2	GREEN	YELLOW	ORANGE
1900 MHz TX3/RX3	GREEN	YELLOW	YELLOW
1900 MHz TX4/RX4	GREEN	YELLOW	WHITE
2100 MHz TX1/RX1	GREEN	WHITE	RED
2100 MHz TX2/RX2	GREEN	WHITE	ORANGE
2100 MHz TX3/RX3	GREEN	WHITE	YELLOW
2100 MHz TX4/RX4	GREEN	WHITE	WHITE
2300 MHz TX1/RX1	GREEN	BROWN	RED
2300 MHz TX2/RX2	GREEN	BROWN	ORANGE
2300 MHz TX3/RX3	GREEN	BROWN	YELLOW
2300 MHz TX4/RX4	GREEN	BROWN	WHITE

Sector D			
Cable #	SECTOR	FREQ	PORT
700 MHz TX1/RX1	ORANGE	RED	RED
700 MHz TX2/RX2	ORANGE	RED	ORANGE
850 MHz TX1/RX1	ORANGE	ORANGE	RED
850 MHz TX2/RX2	ORANGE	ORANGE	ORANGE
1900 MHz TX1/RX1	ORANGE	YELLOW	RED
1900 MHz TX2/RX2	ORANGE	YELLOW	ORANGE
1900 MHz TX3/RX3	ORANGE	YELLOW	YELLOW
1900 MHz TX4/RX4	ORANGE	YELLOW	WHITE
2100 MHz TX1/RX1	ORANGE	WHITE	RED
2100 MHz TX2/RX2	ORANGE	WHITE	ORANGE
2100 MHz TX3/RX3	ORANGE	WHITE	YELLOW
2100 MHz TX4/RX4	ORANGE	WHITE	WHITE
2300 MHz TX1/RX1	ORANGE	BROWN	RED
2300 MHz TX2/RX2	ORANGE	BROWN	ORANGE
2300 MHz TX3/RX3	ORANGE	BROWN	YELLOW
2300 MHz TX4/RX4	ORANGE	BROWN	WHITE

Sector E			
Cable #	SECTOR	FREQ	PORT
700 MHz TX1/RX1	YELLOW	RED	RED
700 MHz TX2/RX2	YELLOW	RED	ORANGE
850 MHz TX1/RX1	YELLOW	ORANGE	RED
850 MHz TX2/RX2	YELLOW	ORANGE	ORANGE
1900 MHz TX1/RX1	YELLOW	YELLOW	RED
1900 MHz TX2/RX2	YELLOW	YELLOW	ORANGE
1900 MHz TX3/RX3	YELLOW	YELLOW	YELLOW
1900 MHz TX4/RX4	YELLOW	YELLOW	WHITE
2100 MHz TX1/RX1	YELLOW	WHITE	RED
2100 MHz TX2/RX2	YELLOW	WHITE	ORANGE
2100 MHz TX3/RX3	YELLOW	WHITE	YELLOW
2100 MHz TX4/RX4	YELLOW	WHITE	WHITE
2300 MHz TX1/RX1	YELLOW	BROWN	RED
2300 MHz TX2/RX2	YELLOW	BROWN	ORANGE
2300 MHz TX3/RX3	YELLOW	BROWN	YELLOW
2300 MHz TX4/RX4	YELLOW	BROWN	WHITE

Sector F			
Cable #	SECTOR	FREQ	PORT
700 MHz TX1/RX1	WHITE	RED	RED
700 MHz TX2/RX2	WHITE	RED	ORANGE
850 MHz TX1/RX1	WHITE	ORANGE	RED
850 MHz TX2/RX2	WHITE	ORANGE	ORANGE
1900 MHz TX1/RX1	WHITE	YELLOW	RED
1900 MHz TX2/RX2	WHITE	YELLOW	ORANGE
1900 MHz TX3/RX3	WHITE	YELLOW	YELLOW
1900 MHz TX4/RX4	WHITE	YELLOW	WHITE
2100 MHz TX1/RX1	WHITE	WHITE	RED
2100 MHz TX2/RX2	WHITE	WHITE	ORANGE
2100 MHz TX3/RX3	WHITE	WHITE	YELLOW
2100 MHz TX4/RX4	WHITE	WHITE	WHITE
2300 MHz TX1/RX1	WHITE	BROWN	RED
2300 MHz TX2/RX2	WHITE	BROWN	ORANGE
2300 MHz TX3/RX3	WHITE	BROWN	YELLOW
2300 MHz TX4/RX4	WHITE	BROWN	WHITE

ANTENNA COLOR CODE TABLES

Frequency Colors	
RED	700 LTE
ORANGE	850 LTE
YELLOW	1900 LTE
WHITE	2100 LTE
BROWN	2300 LTE
BLUE	850 UMTS
GREEN	1900 UMTS
VIOLET	2nd LTE 2100
SLATE	2nd LTE 1900

Sector Colors	
Sector A	RED
Sector B	BLUE
Sector C	GREEN
Sector D	ORANGE
Sector E	YELLOW
Sector F	WHITE

Squid to RRH	
Sector A	RED
Sector B	BLUE
Sector C	GREEN
Sector D	ORANGE
Sector E	YELLOW
Sector F	WHITE

1st color	2nd color	Power Trunk	
RED		1st power cable	Black represents the jumper
RED	RED	2nd power cable	
BLUE		3rd power cable	Black represents the jumper
BLUE	BLUE	4th power cable	
GREEN		5th power cable	Black represents the jumper
GREEN	GREEN	6th power cable	

Fiber Color	Fiber
RED	1st fiber cable
BLUE	2nd fiber cable

GPS color	GPS cable
RED	1st GPS cable
BLUE	2nd GPS cable

	Squid (Internal)
Sector A	RED 1st Squid
Sector B	BLUE 2nd Squid
Sector C	GREEN 3rd Squid

RET frequency	
RED	700 LTE
ORANGE	850 LTE
YELLOW	1900 LTE
WHITE	2100 LTE
BROWN	2300 LTE
BLUE	850 UMTS
GREEN	1900 UMTS
VIOLET	2nd LTE 2100
SLATE	2nd LTE 1900

	RET sector
Sector A	RED
Sector B	BLUE
Sector C	GREEN
Sector D	ORANGE
Sector E	YELLOW
Sector F	WHITE

Port identifier	
RED	TX1/RX1
ORANGE	TX2/RX2
YELLOW	TX3/RX3
WHITE	TX4/RX4


Squid to RRH frequency	
RED	700 LTE
ORANGE	850 LTE
YELLOW	1900 LTE
WHITE	2100 LTE
BROWN	2300 LTE
BLUE	850 UMTS
GREEN	1900 UMTS
VIOLET	2nd LTE 2100
SLATE	2nd LTE 1900

COLOR CODE TABLES

CABLE MARKING LOCATIONS TABLE	
NO	LOCATIONS
①	EACH TOP-JUMPER SHALL BE COLOR CODED WITH (1) SET OF 3" WIDE BANDS.
②	EACH CABLE SHALL BE COLOR CODED WITH (1) SET OF 3" WIDE BANDS NEAR THE TOP OF MAIN LINE AND WITH (1) SET OF 3/4" WIDE COLOR BANDS JUST PRIOR TO ENTERING THE SHELTER/OUTDOOR EQUIPMENT
③	EACH CABLE SHALL BE COLOR CODED WITH (1) SET OF 3/4" WIDE BANDS JUST WITHIN THE SHELTER NEAR THE HATCH PLATE (ONLY INDOOR SITES)
④	EACH CABLE SHALL BE COLOR CODED WITH (1) SET OF 3/4" WIDE BANDS AT THE ENTRANCE OF THE EQUIPMENT

NOTES

1. COLORED TAPES MUST BE 3/4" WIDE & UV RESISTANT VINYL ELECTRICAL COLOR CODING TAPE AND SHOULD BE READILY AVAILABLE TO THE ELECTRICIAN OR CONTRACTOR ON SITE.
2. ALL COLOR CODE TAPE SHALL BE 3M-35 AND SHALL BE INSTALLED USING A MINIMUM OF (3) THREE WRAPS OF TAPE AND SHALL BE NEATLY TRIMMED AND SMOOTHED OUT SO AS TO AVOID UNRAVELING.
3. ALL COLOR BANDS, INSTALLED AT THE TOP OF THE TOWER SHALL BE A MINIMUM OF 3" WIDE, AND SHALL HAVE A MINIMUM OF 1" OF SPACE BETWEEN EACH COLOR, EXCEPT, AT RRH WHERE LABELED END OF JUMPERS CONNECTS, COLOR BANDS SHALL BE 3/4" WIDE WITH 3/4" SPACE. ALL COLOR BANDS INSTALLED AT THE BASE OF THE TOWER SHALL BE A MINIMUM OF 3/4" WIDE, AND SHALL HAVE A MINIMUM OF 3/4" OF SPACE BETWEEN EACH COLOR.
4. ALL COLOR CODES SHALL BE INSTALLED SO AS TO ALIGN NEATLY WITH ONE ANOTHER FROM SIDE-TO-SIDE.
5. IF EXISTING CABLES AT THE SITE ALREADY HAVE A COLOR CODING SCHEME AND THEY ARE NOT INTENDED TO BE REUSED OR SHARED, THE EXISTING COLOR CODING SCHEME SHALL REMAIN UNTOUCHED.
6. FACTORY MADE JUMPERS SHALL BE INSTALLED SO THE LABELS ARE AT THE RADIO END AND COLOR CODE TAPE SHALL BE INSTALLED SUCH THAT IT DOES NOT COVER THE FACTORY LABELS.

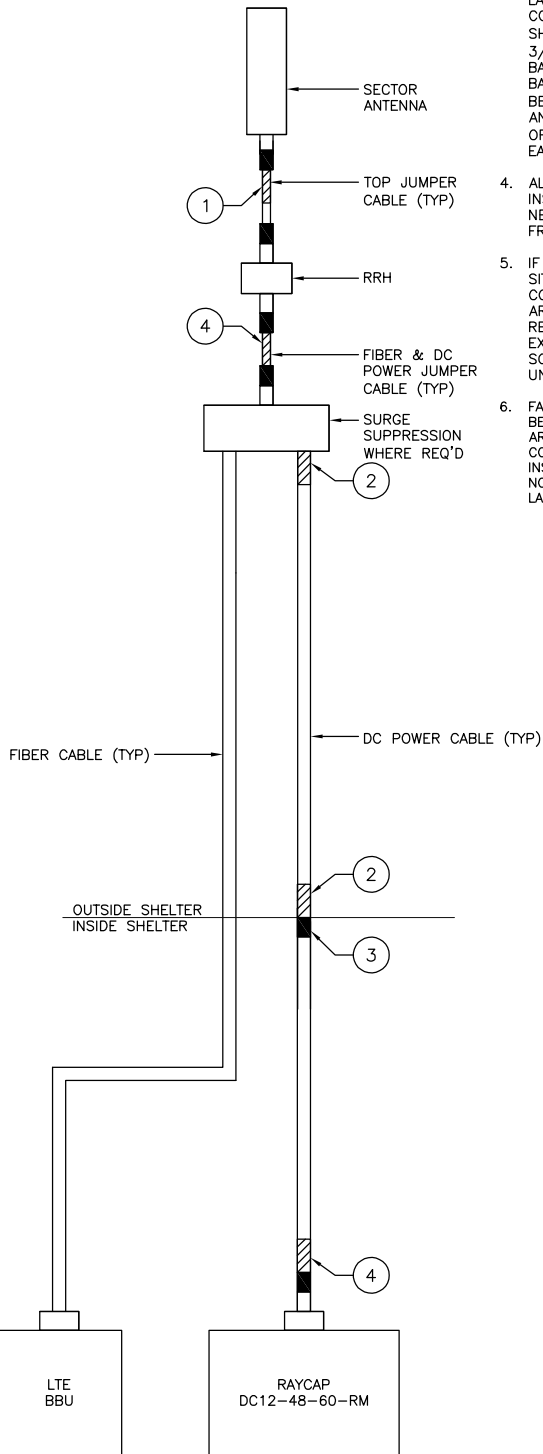


LTE DIAGRAM



PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

REV	DATE	DESCRIPTION
0	05/21/18	ISSUED FOR CONSTRUCTION

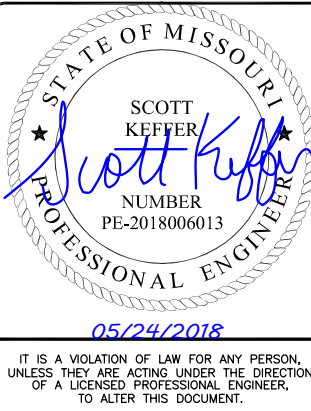


LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
CABLE COLOR CODING

SHEET NUMBER

RF-1

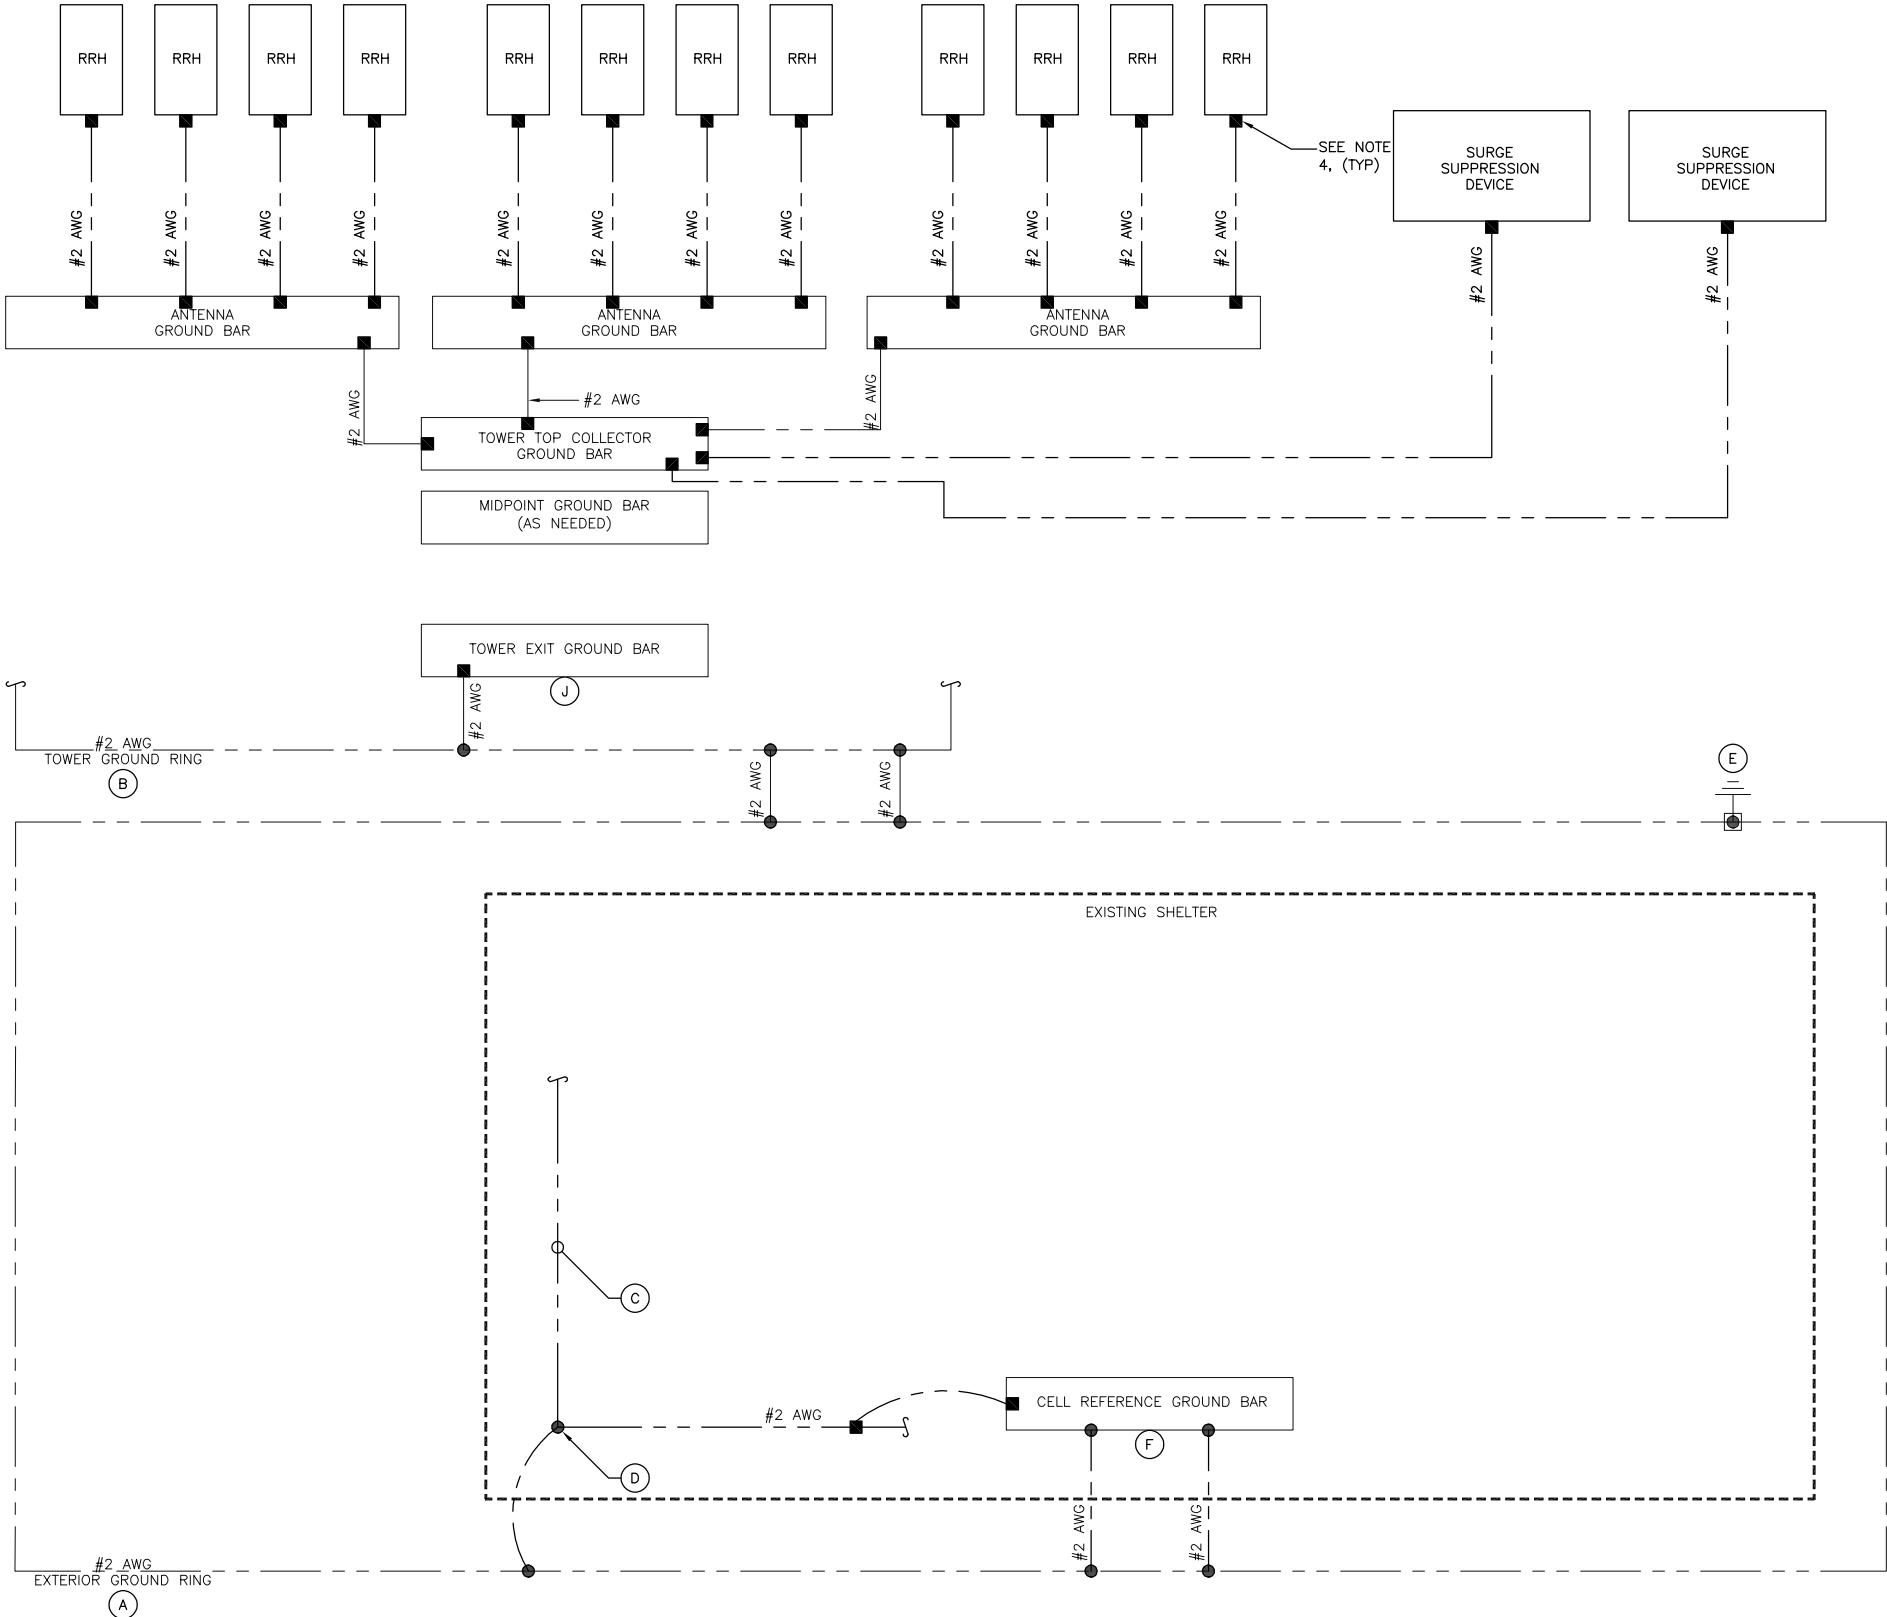

TOWER ANTENNA EQUIPMENT GROUNDING ONE-LINE

NO SCALE

A

- EXOTHERMIC CONNECTION
- MECHANICAL CONNECTION
- ⬮ GROUND ROD
- ⬮ TEST GROUND ROD WITH INSPECTION SLEEVE

LEGEND

1. GROUNDING IS SHOWN DIAGRAMMATICALLY ONLY.
2. CONTRACTOR SHALL GROUND ALL EQUIPMENT AS A COMPLETE SYSTEM. GROUNDING SHALL BE IN COMPLIANCE WITH NEC SECTION 250 AND AT&T GROUNDING AND BONDING REQUIREMENTS (ATT-TP-76416) AND MANUFACTURER'S SPECIFICATIONS.
3. ALL GROUND CONDUCTORS SHALL BE COPPER; NO ALUMINUM CONDUCTORS SHALL BE USED.
4. FOR ALCATEL-LUCENT 850 AND 1900 RRH's, TWO GROUNDS ARE REQUIRED (TOP AND BOTTOM).

NOTES

- (A) EXTERIOR GROUND RING: #2 AWG SOLID COPPER, BURIED AT A DEPTH OF AT LEAST 30 INCHES BELOW GRADE, OR 6 INCHES BELOW THE FROST LINE AND APPROXIMATELY 24 INCHES FROM THE EXTERIOR WALL OR FOOTING. (ATT-TP-76416 2.2.3.5/7.5.1)
- (B) TOWER GROUND RING: THE GROUND RING SYSTEM SHALL BE INSTALLED AROUND AN ANTENNA TOWER'S LEGS, AND/OR GUY ANCHORS. WHERE SEPARATE SYSTEMS HAVE BEEN PROVIDED FOR THE TOWER AND THE BUILDING, AT LEAST TWO BONDS SHALL BE MADE BETWEEN THE TOWER RING GROUND SYSTEM AND THE BUILDING RING GROUND SYSTEM USING MINIMUM #2 AWG SOLID COPPER CONDUCTORS. (ATT-TP-76416 7.5.1)
- (C) INTERIOR GROUND RING: #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTOR EXTENDED AROUND THE PERIMETER OF THE EQUIPMENT AREA. ALL NON-TELECOMMUNICATIONS RELATED METALLIC OBJECTS FOUND WITHIN A SITE SHALL BE GROUNDED TO THE INTERIOR GROUND RING WITH #6 AWG STRANDED GREEN INSULATED CONDUCTOR. (ATT-TP-76416 7.6.4)
- (D) BOND TO INTERIOR GROUND RING: #2 AWG SOLID TINNED COPPER WIRE PRIMARY BONDS SHALL BE PROVIDED AT LEAST AT FOUR POINTS ON THE INTERIOR GROUND RING, LOCATED AT THE CORNERS OF THE BUILDING. (ATT-TP-76416 7.5.2.2)
- (E) GROUND ROD: UL LISTED COPPER CLAD STEEL. MINIMUM 5/8" DIAMETER BY EIGHT FEET LONG. ALL GROUND RODS MAY BE INSTALLED WITH INSPECTION SLEEVES. GROUND RODS SHALL BE DRIVEN TO THE DEPTH OF GROUND RING CONDUCTOR. (ATT-TP-76416 1.4 / 2.2.3.10)
- (F) CELL REFERENCE GROUND BAR: POINT OF GROUND REFERENCE FOR ALL COMMUNICATIONS EQUIPMENT FRAMES. ALL BONDS ARE MADE WITH #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS. BOND TO GROUND RING WITH (2) #2 SOLID TINNED COPPER CONDUCTORS. (ATT-TP-76416 7.6.7)
- (G) HATCH PLATE GROUND BAR: BOND TO THE INTERIOR GROUND RING WITH TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS. WHEN A HATCH-PLATE AND A CELL REFERENCE GROUND BAR ARE BOTH PRESENT, THE CRGB MUST BE CONNECTED TO THE HATCH-PLATE AND TO THE INTERIOR GROUND RING USING TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS.
- (H) EXTERIOR CABLE ENTRY PORT GROUND BARS: LOCATED AT THE ENTRANCE TO THE CELL SITE BUILDING. BOND TO GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTORS WITH AN EXOTHERMIC WELD AND INSPECTION SLEEVE. (ATT-TP-76416 7.6.7.2)
- (J) TOWER EXIT GROUND BAR: #2 AWG SOLID TINNED COPPER BOND TO THE TOWER GROUND RING. (ATT-TP-76416 7.5.5)
- (K) TELCO GROUND BAR: BOND TO BOTH CELL REFERENCE GROUND BAR AND EXTERIOR GROUND RING. (ATT-TP-76416 7.6.8)
- (L) FRAME BONDING: THE BONDING POINT FOR TELECOM EQUIPMENT FRAMES SHALL BE THE GROUND BUS THAT IS NOT ISOLATED FROM THE EQUIPMENTS METAL FRAMEWORK. BOND THE FRAME GROUND BUS TO THE "I" SECTION OF THE CELL REFERENCE GROUND BAR. (ATT-TP-76416 7.8)
- (M) INTERIOR UNIT BONDS: METAL FRAMES, CABINETS AND INDIVIDUAL METALLIC UNITS LOCATED WITHIN THE AREA OF THE INTERIOR GROUND RING REQUIRE A #6 AWG STRANDED GREEN INSULATED COPPER BOND TO THE INTERIOR GROUND RING. (ATT-TP-76416 7.12.3.1)
- (N) FENCE AND GATE GROUNDING: METAL FENCES WITHIN 7 FEET OF THE EXTERIOR GROUND RING OR OBJECTS BONDED TO THE EXTERIOR GROUND RING SHALL BE BONDED TO THE GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTOR AT AN INTERVAL NOT EXCEEDING 25 FEET. BONDS SHALL BE MADE AT EACH GATE POST AND ACROSS GATE OPENINGS. (ATT-TP-76416 7.12.2.2)
- (P) EXTERIOR UNIT BONDS: METALLIC OBJECTS, EXTERNAL TO OR MOUNTED TO THE BUILDING, SHALL BE BONDED TO THE EXTERIOR GROUND RING. (ATT-TP-76416 7.12.2)
- (Q) ICE BRIDGE SUPPORTS: EACH ICE BRIDGE LEG SHALL BE BONDED TO THE GROUND RING WITH #2 AWG BARE TINNED COPPER CONDUCTOR. PROVIDE EXOTHERMIC WELDS AT BOTH THE ICE BRIDGE LEG AND BURIED GROUND RING. (ATT-TP-76416 7.4.2.6)
- (R) DURING ALL DC POWER SYSTEM CHANGES INCLUDING DC SYSTEM CHANGE OUTS, RECTIFIER REPLACEMENTS OR ADDITIONS, BREAKER DISTRIBUTION CHANGES, BATTERY ADDITIONS, BATTERY REPLACEMENTS AND INSTALLATIONS OR CHANGES TO DC CONVERTER SYSTEMS IT SHALL BE REQUIRED THAT SERVICES CONTRACTORS VERIFY ALL DC POWER SYSTEMS ARE EQUIPPED WITH A MASTER DC SYSTEM RETURN GROUND CONDUCTOR FROM THE DC POWER SYSTEM COMMON RETURN BUS DIRECTLY CONNECTED TO THE CELL SITE REFERENCE GROUND BAR (CRGB) PER TP76300 SECTION H 6 AND TP76416 FIGURE 7-11 REQUIREMENTS.

GROUNDING KEY NOTES



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



05/24/2018

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
GROUNDING ONE-LINE
ANTENNA EQUIPMENT

SHEET NUMBER

G-1

NEWTON INSTRUMENT COMPANY, INC. BUTNER, N.C.			
NO	REQUIRED	PART NUMBER	DESCRIPTION
①	1	1/4"x4"x30"	SOLID GROUND BAR
②	2	A-6056	WALL MOUNTING BRACKET
③	2	3061-4	INSULATORS
④	4	3012-1	5/8"-11x1" H.H.C.S.
⑤	4	3015-8	5/8" LOCKWASHER

EACH GROUND CONDUCTOR
TERMINATING ON ANY GROUND BAR
SHALL HAVE AN IDENTIFICATION TAG
ATTACHED AT EACH END THAT WILL
IDENTIFY ITS ORIGIN AND DESTINATION

SECTION "P" – SURGE PROTECTORS

(EC) CABLE ENTRY PORTS (HATCH PLATES) (#2)
(EC) TELCO GROUND BAR (#2)
(EC) COMMERCIAL POWER COMMON NEUTRAL/GROUND BOND (#2)
(AT&T) CELL SITE +24V POWER SUPPLY RETURN BAR (#2)
(AT&T) CELL SITE +48V POWER SUPPLY RETURN BAR (#2)
(EC) GENERATOR FRAMEWORK (IF AVAILABLE) (#2)
(AT&T) RECTIFIER FRAMES
(AT&T) ANTENNA SUPPRESSION


SECTION "A" – SURGE ABSORBERS

(EC) INTERIOR GROUND RING (#2)
(EC) EXTERNAL EARTH GROUND FIELD (BURIED GROUND RING) (#2)
(EC) METALLIC COLD WATER PIPE (IF AVAILABLE) (#2)
(EC) BUILDING STEEL (IF AVAILABLE) (#2)

SECTION "I" – ISOLATED GROUNDING ZONE
(AT&T) ALL CELL SITE COMMUNICATIONS EQUIPMENT FRAMES

DETAIL NOTES:

- EXOTHERMICALLY WELD #2 AWG BARE TINNED SOLID COPPER CONDUCTOR TO GROUND BAR. ROUTE CONDUCTOR TO BURIED GROUND RING AND PROVIDE PARALLEL EXOTHERMIC WELD.
- EC SHALL PERMANENTLY MARK THE LINES BETWEEN EACH SECTION AND LABEL EACH SECTION ("P", "A", "I") WITH 1" HIGH LETTERS.
- GROUND BAR SHALL BE ENGRAVED PER AT&T SPECIFICATIONS TO PREVENT THEFT.

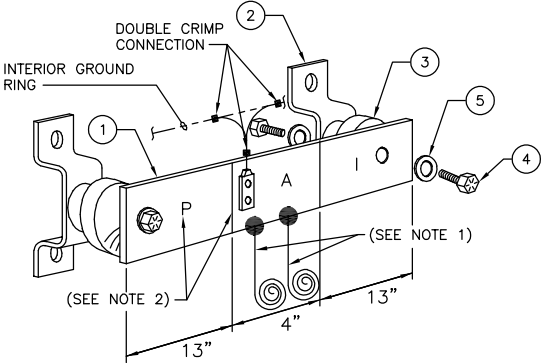



NOTES

- EXOTHERMIC WELD (2) TWO, #2 AWG BARE TINNED SOLID COPPER CONDUCTORS TO GROUND BAR. ROUTE CONDUCTORS TO BURIED GROUND RING AND PROVIDE PARALLEL EXOTHERMIC WELD.
- ALL GROUND BARS SHALL BE STAMPED IN TO THE METAL "IF STOLEN DO NOT RECYCLE." THE CONTRACTOR SHALL USE PERMANENT MARKER TO DRAW THE LINES BETWEEN EACH SECTION AND LABEL EACH SECTION ("P", "A", "I") WITH 1" HIGH LETTERS.
- ALL HARDWARE SHALL BE STAINLESS STEEL 3/8 INCH DIAMETER OR LARGER. ALL HARDWARE 18-8 STAINLESS STEEL INCLUDING LOCK WASHERS, COAT ALL SURFACES WITH AN ANTIOXIDANT COMPOUND BEFORE MATING.
- FOR GROUND BOND TO STEEL ONLY: INSERT A CADMIUM FLAT WASHER BETWEEN LUG AND STEEL, COAT ALL SURFACES WITH AN ANTIOXIDANT COMPOUND BEFORE MATING.
- DO NOT INSTALL CABLE GROUNDING KIT AT A BEND AND ALWAYS DIRECT GROUNDING CONDUCTOR DOWN TO GROUNDING BUS.
- NUT & WASHER SHALL BE PLACED ON THE FRONT SIDE OF THE GROUND BAR AND BOLTED ON THE BACK SIDE. INSTALL BLACK HEAT-SHRINKING TUBE, 600 VOLT INSULATION, ON ALL GROUNDING TERMINATIONS. THE INTENT IS TO WEATHERPROOF THE COMPRESSION CONNECTION.
- SUPPLIED AND INSTALLED BY CONTRACTOR.
- GROUND LUGS SHALL BE TWO-HOLE, LONG BARREL, AND BE SIZED FOR GROUND WIRE. DO NOT BREAK WIRE STANDS OR DEEPLY NICK GROUND WIRE WHEN CRIMPING.
- ENSURE THE WIRE INSULATION TERMINATION IS WITHIN 1/8" OF THE BARREL (NO SHINERS).
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLING ADDITIONAL GROUND BAR AS REQUIRED, PROVIDING 50% SPARE CONNECTION POINTS.
- INSPECTION WINDOWS REQUIRED ON ALL LUGS INSTALLED INDOORS.
- LUGS WITH INSPECTION WINDOWS ARE NOT ALLOWED IN OUTDOOR APPLICATIONS.

(CRGB) CELL REFERENCE GROUND BAR

NO SCALE

A

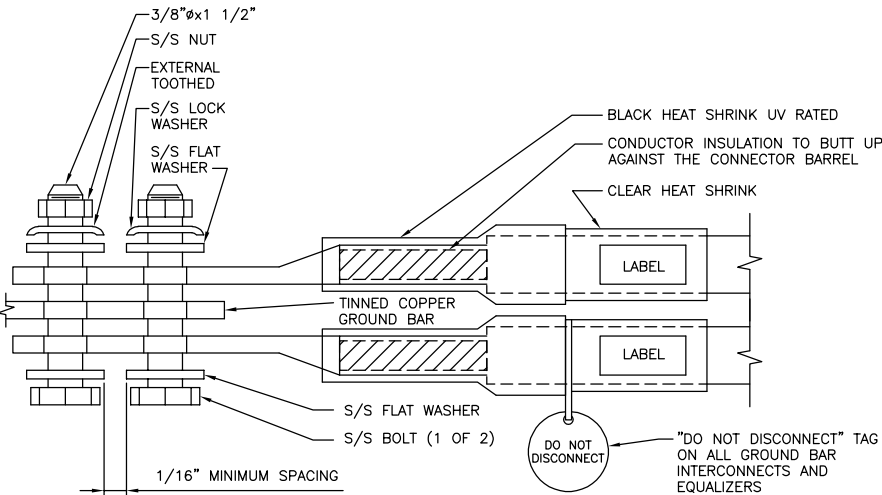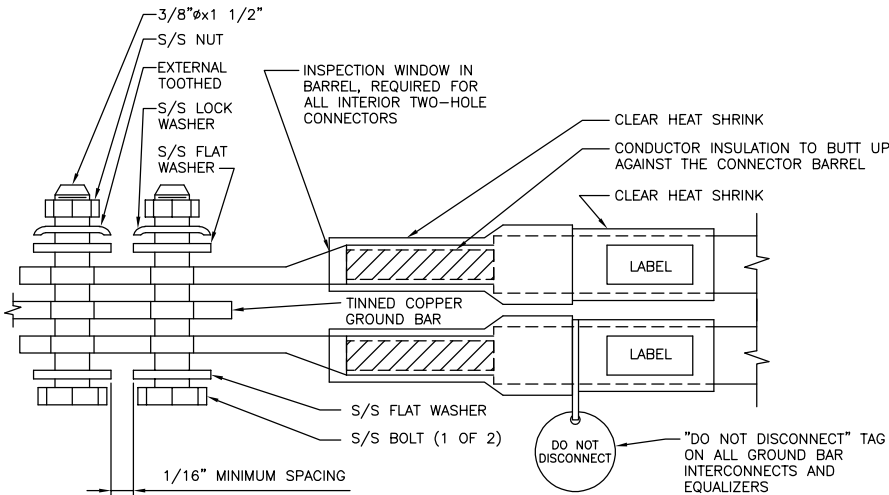

INTERIOR TWO HOLE LUG

NO SCALE

B

EXTERIOR TWO HOLE LUG


NO SCALE

C

NOT USED

NO SCALE

D

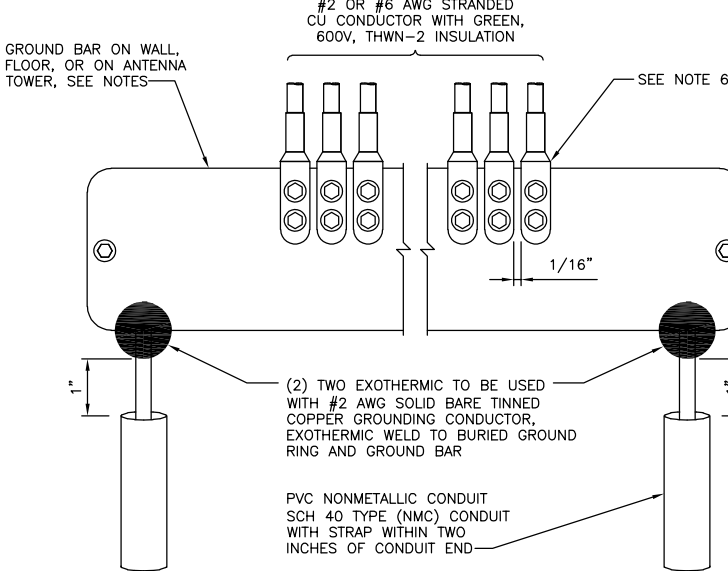

INSTALLATION OF GROUNDING
CONDUCTOR TO GROUND BAR

NO SCALE

E

NOT USED

NO SCALE

F

NOT USED

NO SCALE

G



7801 FARLEY
OVERLAND PARK, KS 66204




BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

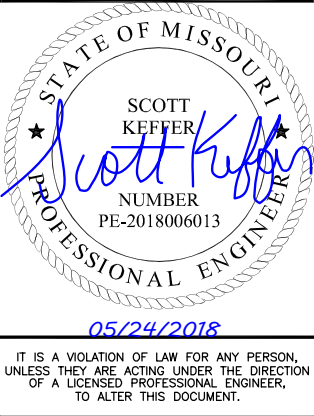

LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
GROUNDING DETAILS

SHEET NUMBER

G-2

GENERAL CONSTRUCTION NOTES

GENERAL CONSTRUCTION

1. FOR THE PURPOSE OF CONSTRUCTION DRAWINGS, THE FOLLOWING DEFINITIONS SHALL APPLY:
GENERAL CONTRACTOR – OVERLAND CONTRACTING INC. (B&V)
CONTRACTOR: (CONSTRUCTION)
OWNER – AT&T
2. ALL SITE WORK SHALL BE COMPLETED AS INDICATED ON THE DRAWINGS AND AT&T PROJECT SPECIFICATIONS.
3. GENERAL CONTRACTOR SHALL VISIT THE SITE AND SHALL FAMILIARIZE HIMSELF WITH ALL CONDITIONS AFFECTING THE PROPOSED WORK AND SHALL MAKE PROVISIONS. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR FAMILIARIZING HIMSELF WITH ALL CONTRACT DOCUMENTS, FIELD CONDITIONS, DIMENSIONS, AND CONFIRMING THAT THE WORK MAY BE ACCOMPLISHED AS SHOWN PRIOR TO PROCEEDING WITH CONSTRUCTION. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO THE COMMENCEMENT OF WORK.
4. ALL MATERIALS FURNISHED AND INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES. GENERAL CONTRACTOR SHALL ISSUE ALL APPROPRIATE NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY REGARDING THE PERFORMANCE OF WORK.
5. ALL WORK CARRIED OUT SHALL COMPLY WITH ALL APPLICABLE MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS AND LOCAL JURISDICTIONAL CODES, ORDINANCES, AND APPLICABLE REGULATIONS.
6. UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, APPURTENANCES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.
7. PLANS ARE NOT TO BE SCALED. THESE PLANS ARE INTENDED TO BE A DIAGRAMMATIC OUTLINE ONLY UNLESS OTHERWISE NOTED. DIMENSIONS SHOWN ARE TO FINISH SURFACES UNLESS OTHERWISE NOTED. SPACING BETWEEN EQUIPMENT IS THE MINIMUM REQUIRED CLEARANCE. THEREFORE, IT IS CRITICAL TO FIELD VERIFY DIMENSIONS, SHOULD THERE BE ANY QUESTIONS REGARDING THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING A CLARIFICATION FROM THE ENGINEER PRIOR TO PROCEEDING WITH THE WORK. DETAILS ARE INTENDED TO SHOW DESIGN INTENT. MODIFICATIONS MAY BE REQUIRED TO SUIT JOB DIMENSIONS OR CONDITIONS AND SUCH MODIFICATIONS SHALL BE INCLUDED AS PART OF WORK AND PREPARED BY THE ENGINEER PRIOR TO PROCEEDING WITH WORK.
8. THE CONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURER’S RECOMMENDATIONS UNLESS SPECIFICALLY STATED OTHERWISE.
9. IF THE SPECIFIED EQUIPMENT CANNOT BE INSTALLED AS SHOWN ON THESE DRAWINGS, THE CONTRACTOR SHALL PROPOSE AN ALTERNATIVE INSTALLATION SPACE FOR APPROVAL BY THE ENGINEER PRIOR TO PROCEEDING.
10. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF WORK AREA, ADJACENT AREAS AND BUILDING OCCUPANTS THAT ARE LIKELY TO BE AFFECTED BY THE WORK UNDER THIS CONTRACT. WORK SHALL CONFORM TO ALL OSHA REQUIREMENTS AND THE LOCAL JURISDICTION.
11. GENERAL CONTRACTOR SHALL COORDINATE WORK AND SCHEDULE WORK ACTIVITIES WITH OTHER DISCIPLINES.
12. ERECTION SHALL BE DONE IN A WORKMANLIKE MANNER BY COMPETENT EXPERIENCED WORKMAN IN ACCORDANCE WITH APPLICABLE CODES AND THE BEST ACCEPTED PRACTICE. ALL MEMBERS SHALL BE LAID PLUMB AND TRUE AS INDICATED ON THE DRAWINGS.
13. SEAL PENETRATIONS THROUGH FIRE RATED AREAS WITH UL LISTED MATERIALS APPROVED BY LOCAL JURISDICTION. CONTRACTOR SHALL KEEP AREA CLEAN, HAZARD FREE, AND DISPOSE OF ALL DEBRIS.
14. WORK PREVIOUSLY COMPLETED IS REPRESENTED BY LIGHT SHADED LINES AND NOTES. THE SCOPE OF WORK FOR THIS PROJECT IS REPRESENTED BY DARK SHADED LINES AND NOTES. CONTRACTOR SHALL NOTIFY THE GENERAL CONTRACTOR OF ANY EXISTING CONDITIONS THAT DEViate FROM THE DRAWINGS PRIOR TO BEGINNING CONSTRUCTION.
15. CONTRACTOR SHALL PROVIDE WRITTEN NOTICE TO THE CONSTRUCTION MANAGER 48 HOURS PRIOR TO COMMENCEMENT OF WORK.
16. THE CONTRACTOR SHALL PROTECT EXISTING IMPROVEMENTS, PAVEMENTS, CURBS, LANDSCAPING AND STRUCTURES. ANY DAMAGED PART SHALL BE REPAIRED AT CONTRACTOR’S EXPENSE TO THE SATISFACTION OF THE OWNER.
17. THE CONTRACTOR SHALL CONTACT UTILITY LOCATING SERVICES PRIOR TO THE START OF CONSTRUCTION.
18. GENERAL CONTRACTOR SHALL COORDINATE AND MAINTAIN ACCESS FOR ALL TRADES AND CONTRACTORS TO THE SITE AND/OR BUILDING.
19. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR SECURITY OF THE SITE FOR THE DURATION OF CONSTRUCTION UNTIL JOB COMPLETION.
20. THE GENERAL CONTRACTOR SHALL MAINTAIN IN GOOD CONDITION ONE COMPLETE SET OF PLANS WITH ALL REVISIONS, ADDENDA, AND CHANGE ORDERS ON THE PREMISES AT ALL TIMES.
21. THE GENERAL CONTRACTOR SHALL PROVIDE PORTABLE FIRE EXTINGUISHERS WITH A RATING OF NOT LESS THAN 2-A OT 2-A:10-B:C AND SHALL BE WITHIN 25 FEET OF TRAVEL DISTANCE TO ALL PORTIONS OF WHERE THE WORK IS BEING COMPLETED DURING CONSTRUCTION.
22. ALL EXISTING ACTIVE SEWER, WATER, GAS, ELECTRIC, AND OTHER UTILITIES SHALL BE PROTECTED AT ALL TIMES, AND WHERE REQUIRED FOR THE PROPER EXECUTION OF THE WORK, SHALL BE RELOCATED AS DIRECTED BY THE ENGINEER. EXTREME CAUTION SHOULD BE USED BY THE CONTRACTOR WHEN EXCAVATING OR DRILLING PIERS AROUND OR NEAR UTILITIES. CONTRACTOR SHALL PROVIDE SAFETY TRAINING FOR THE WORKING CREW. THIS SHALL INCLUDE BUT NOT BE LIMITED TO A) FALL PROTECTION, B) CONFINED SPACE, C) ELECTRICAL SAFETY, AND D) TRENCHING & EXCAVATION.
23. ALL EXISTING INACTIVE SEWER, WATER, GAS, ELECTRIC, AND OTHER UTILITIES, WHICH INTERFERE WITH THE EXECUTION OF THE WORK, SHALL BE REMOVED, CAPPED, PLUGGED OR OTHERWISE DISCONNECTED AT POINTS WHICH WILL NOT INTERFERE WITH THE EXECUTION OF THE WORK, AS DIRECTED BY THE RESPONSIBLE ENGINEER, AND SUBJECT TO THE APPROVAL OF THE OWNER AND/OR LOCAL UTILITIES.
24. THE AREAS OF THE OWNER’S PROPERTY DISTURBED BY THE WORK AND NOT COVERED BY THE TOWER, EQUIPMENT OR DRIVEWAY, SHALL BE GRADED TO A UNIFORM SLOPE, AND STABILIZED TO PREVENT EROSION.
25. CONTRACTOR SHALL MINIMIZE DISTURBANCE TO THE EXISTING SITE DURING CONSTRUCTION. EROSION CONTROL MEASURES, IF REQUIRED DURING CONSTRUCTION, SHALL BE IN CONFORMANCE WITH THE FEDERAL AND LOCAL JURISDICTION FOR EROSION AND SEDIMENT CONTROL.
26. NO FILL OR EMBANKMENT MATERIAL SHALL BE PLACED ON FROZEN GROUND. FROZEN MATERIALS, SNOW OR ICE SHALL NOT BE PLACED IN ANY FILL OR EMBANKMENT.
27. THE SUBGRADE SHALL BE BROUGHT TO A SMOOTH UNIFORM GRADE AND COMPACTED TO 95 PERCENT STANDARD PROCTOR DENSITY UNDER PAVEMENT AND STRUCTURES AND 80 PERCENT STANDARD PROCTOR DENSITY IN OPEN SPACE. ALL TRENCHES IN PUBLIC RIGHT OF WAY SHALL BE BACKFILLED WITH FLOWABLE FILL OR OTHER MATERIAL PRE-APPROVED BY THE LOCAL JURISDICTION.
28. ALL NECESSARY RUBBISH, STUMPS, DEBRIS, STICKS, STONES, AND OTHER REFUSE SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN A LAWFUL MANNER.
29. ALL BROCHURES, OPERATING AND MAINTENANCE MANUALS, CATALOGS, SHOP DRAWINGS, AND OTHER DOCUMENTS SHALL BE TURNED OVER TO THE GENERAL CONTRACTOR AT COMPLETION OF CONSTRUCTION AND PRIOR TO PAYMENT.
30. CONTRACTOR SHALL SUBMIT A COMPLETE SET OF AS-BUILT REDLINES TO THE GENERAL CONTRACTOR UPON COMPLETION OF PROJECT AND PRIOR TO FINAL PAYMENT.

31. CONTRACTOR SHALL LEAVE PREMISES IN A CLEAN CONDITION.
32. THE PROPOSED FACILITY WILL BE UNMANNED AND DOES NOT REQUIRE POTABLE WATER OR SEWER SERVICE, AND IS NOT FOR HUMAN HABITATION (NO HANDICAP ACCESS REQUIRED).
33. OCCUPANCY IS LIMITED TO PERIODIC MAINTENANCE AND INSPECTION, APPROXIMATELY 2 TIMES PER MONTH, BY AT&T TECHNICIANS.
34. NO OUTDOOR STORAGE OR SOLID WASTE CONTAINERS ARE PROPOSED.
35. ALL MATERIAL SHALL BE FURNISHED AND WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST REVISION AT&T MOBILITY GROUNDING STANDARD "TECHNICAL SPECIFICATION FOR CONSTRUCTION OF GSM/GPRS WIRELESS SITES" AND "TECHNICAL SPECIFICATION FOR FACILITY GROUNDING". IN CASE OF A CONFLICT BETWEEN THE CONSTRUCTION SPECIFICATION AND THE DRAWINGS, THE DRAWINGS SHALL GOVERN.
36. CONTRACTORS SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND INSPECTIONS REQUIRED FOR CONSTRUCTION. IF CONTRACTOR CANNOT OBTAIN A PERMIT, THEY MUST NOTIFY THE GENERAL CONTRACTOR IMMEDIATELY.
37. CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
38. INFORMATION SHOWN ON THESE DRAWINGS WAS OBTAINED FROM SITE VISITS AND/OR DRAWINGS PROVIDED BY THE SITE OWNER. CONTRACTORS SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIAL OR PROCEEDING WITH CONSTRUCTION.
39. NO WHITE STROBE LIGHTS ARE PERMITTED. LIGHTING, IF REQUIRED, WILL MEET FAA STANDARDS AND REQUIREMENTS.
40. ALL COAXIAL CABLE INSTALLATIONS TO FOLLOW MANUFACTURER’S INSTRUCTIONS AND RECOMMENDATIONS.
- ANTENNA MOUNTING
41. DESIGN AND CONSTRUCTION OF ANTENNA SUPPORTS SHALL CONFORM TO CURRENT ANSI/TIA-222 OR APPLICABLE LOCAL CODES.
42. ALL STEEL MATERIALS SHALL BE GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH ASTM A123 "ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL PRODUCTS", UNLESS NOTED OTHERWISE.
43. ALL BOLTS, ANCHORS AND MISCELLANEOUS HARDWARE SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153 "ZINC-COATING (HOT-DIP) ON IRON AND STEEL HARDWARE", UNLESS NOTED OTHERWISE.
44. DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED BY COLD GALVANIZING IN ACCORDANCE WITH ASTM A780.
45. ALL ANTENNA MOUNTS SHALL BE INSTALLED WITH LOCK NUTS, DOUBLE NUTS AND SHALL BE TORQUED TO MANUFACTURER’S RECOMMENDATIONS.
46. CONTRACTOR SHALL INSTALL ANTENNA PER MANUFACTURER’S RECOMMENDATION FOR INSTALLATION AND GROUNDING.
47. ALL UNUSED PORTS ON ANY ANTENNAS SHALL BE TERMINATED WITH A 50-OHM LOAD TO ENSURE ANTENNAS PERFORM AS DESIGNED. ONCE TERMINATED, APPLY A SINGLE LAYER OF BUTYL OR TWO WRAPS OF SELF-FUSING TAPE OVER THE CAP/NUT AND CONNECTOR NECK FOLLOWED BY A MINIMUM OF 2 WRAPS OF QUALITY BLACK VINYL TAPE OVER THE BUTYL OR SELF-FUSING TAPE. DO NOT COVER AND HEAT DISSIPATING SURFACES WITH WEATHERPROOFING.
48. PRIOR TO SETTING ANTENNA AZIMUTHS AND DOWNTILTS, ANTENNA CONTRACTOR SHALL CHECK THE ANTENNA MOUNT FOR TIGHTNESS AND ENSURE THAT THEY ARE PLUMB. ANTENNA AZIMUTHS SHALL BE SET FROM TRUE NORTH AND BE ORIENTED WITHIN +/- 5% AS DEFINED BY THE RFDS. ANTENNA DOWNTILTS SHALL BE WITHIN +/- 0.5% AS DEFINED BY THE RFDS. REFER TO ND-00246.
49. JUMPERS FROM THE TMA’S MUST TERMINATE TO OPPOSITE POLARIZATIONS IN EACH SECTOR.
50. CONTRACTOR SHALL RECORD THE SERIAL #, SECTOR, AND POSITION OF EACH ACTUATOR INSTALLED AT THE ANTENNAS AND PROVIDE THE INFORMATION TO AT&T.
51. TMA’S SHALL BE MOUNTED ON PIPE DIRECTLY BEHIND ANTENNAS AS CLOSE TO ANTENNA AS FEASIBLE IN A VERTICAL POSITION.
52. ANTENNAS SHALL HAVE A 2’-0" MIN. CENTER TO CENTER HORIZONTAL SEPARATION.

TORQUE REQUIREMENTS

53. ALL RF CONNECTIONS SHALL BE TIGHTENED BY A TORQUE WRENCH.
54. ALL RF CONNECTIONS, GROUNDING HARDWARE AND ANTENNA HARDWARE SHALL HAVE A TORQUE MARK INSTALLED IN A CONTINUOUS STRAIGHT LINE FROM BOTH SIDES OF THE CONNECTION.
A. RF CONNECTION BOTH SIDES OF THE CONNECTOR.
B. GROUNDING AND ANTENNA HARDWARE ON THE NUT SIDE STARTING FROM THE THREADS TO THE SOLID SURFACE. EXAMPLE OF SOLID SURFACE: GROUND BAR, ANTENNA BRACKET METAL.
55. ALL 8M ANTENNA HARDWARE SHALL BE TIGHTENED TO 9 LB-FT (12 NM).
56. ALL 12M ANTENNA HARDWARE SHALL BE TIGHTENED TO 43 LB-FT (58 NM).
57. ALL GROUNDING HARDWARE SHALL BE TIGHTENED UNTIL THE LOCK WASHER COLLAPSES AND THE GROUNDING HARDWARE IS NO LONGER LOOSE.
58. ALL DIN TYPE CONNECTIONS SHALL BE TIGHTENED TO 18-22 LB-FT (24.4 – 29.8 NM).
59. ALL N TYPE CONNECTIONS SHALL BE TIGHTENED TO 15-20 LB-IN (1.7 – 2.3 NM).

FIBER & POWER CABLE MOUNTING

60. THE FIBER OPTIC TRUNK CABLES SHALL BE INSTALLED INTO CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY. WHEN INSTALLING FIBER OPTIC TRUNK CABLES INTO A CABLE TRAY SYSTEM, THEY SHALL BE INSTALLED INTO AN INTER DUCT AND A PARTITION BARRIER SHALL BE INSTALLED BETWEEN THE 600 VOLT CABLES AND THE INTER DUCT IN ORDER TO SEGREGATE CABLE TYPES. OPTIC FIBER TRUNK CABLES SHALL HAVE APPROVED CABLE RESTRAINTS EVERY (60) SIXTY FEET AND SECURELY FASTENED TO THE CABLE TRAY SYSTEM. NFPA 70 (NEC) ARTICLE 770 RULES SHALL APPLY.
61. THE TYPE TC-ER CABLES SHALL BE INSTALLED INTO CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY AND SHALL BE SECURED AT INTERVALS NOT EXCEEDING (6) SIX FEET. AN EXCEPTION; WHERE TYPE TC-ER CABLES ARE NOT SUBJECT TO PHYSICAL DAMAGE, CABLES SHALL BE PERMITTED TO MAKE A TRANSITION BETWEEN CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY WHICH ARE SERVING UTILIZATION EQUIPMENT OR DEVICES, A DISTANCE (6) SIX FEET SHALL NOT BE EXCEEDED WITHOUT CONTINUOUS SUPPORTING. NFPA 70 (NEC) ARTICLES 336 AND 392 RULES SHALL APPLY.
62. WHEN INSTALLING OPTIC FIBER TRUNK CABLES OR TYPE TC-ER CABLES INTO CONDUITS, NFPA 70 (NEC) ARTICLE 300 RULES SHALL APPLY.

COAXIAL CABLE NOTES

63. TYPES AND SIZES OF THE ANTENNA CABLE ARE BASED ON ESTIMATED LENGTHS. PRIOR TO ORDERING CABLE, CONTRACTOR SHALL VERIFY ACTUAL LENGTH BASED ON CONSTRUCTION LAYOUT AND NOTIFY THE PROJECT MANAGER IF ACTUAL LENGTHS EXCEED ESTIMATED LENGTHS.
64. CONTRACTOR SHALL VERIFY THE DOWN-TILT OF EACH ANTENNA WITH A DIGITAL LEVEL.
65. CONTRACTOR SHALL CONFIRM COAX COLOR CODING PRIOR TO CONSTRUCTION. REFER TO "ANTENNA SYSTEM LABELING STANDARD" ND-00027 LATEST VERSION.
66. ALL JUMPERS TO THE ANTENNAS FROM THE MAIN TRANSMISSION LINE SHALL BE 1/2" DIA. LDF AND SHALL NOT EXCEED 6’-0".
67. ALL COAXIAL CABLE SHALL BE SECURED TO THE DESIGNED SUPPORT STRUCTURE, IN AN APPROVED MANNER, AT DISTANCES NOT TO EXCEED 4’-0" OC.
68. CONTRACTOR SHALL FOLLOW ALL MANUFACTURER’S RECOMMENDATIONS REGARDING BOTH THE INSTALLATION AND GROUNDING OF ALL COAXIAL CABLES, CONNECTORS, ANTENNAS, AND ALL OTHER EQUIPMENT.
69. CONTRACTOR SHALL WEATHERPROOF ALL ANTENNA CONNECTORS WITH SELF AMALGAMATING TAPE. WEATHERPROOFING SHALL BE COMPLETED IN STRICT ACCORDANCE WITH AT&T STANDARDS.
- GENERAL CABLE AND EQUIPMENT NOTES
70. CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY ANTENNA, TMAS, DIPLEXERS, AND COAX CONFIGURATION, MAKE AND MODELS PRIOR TO INSTALLATION.
71. ALL CONNECTIONS FOR HANGERS, SUPPORTS, BRACING, ETC. SHALL BE INSTALLED PER TOWER MANUFACTURER’S RECOMMENDATIONS.
72. CONTRACTOR SHALL REFERENCE THE TOWER STRUCTURAL ANALYSIS/DESIGN DRAWINGS FOR DIRECTIONS ON CABLE DISTRIBUTION/ROUTING.
73. ALL OUTDOOR RF CONNECTORS/CONNECTIONS SHALL BE WEATHERPROOFED, EXCEPT THE RET CONNECTORS, USING BUTYL TAPE AFTER INSTALLATION AND FINAL CONNECTIONS ARE MADE. BUTYL TAPE SHALL HAVE A MINIMUM OF ONE-HALF TAPE WIDTH OVERLAP ON EACH TURN AND EACH LAYER SHALL BE WRAPPED THREE TIMES. WEATHERPROOFING SHALL BE SMOOTH WITHOUT BUCKLING. BUTYL BLEEDING IS NOT ALLOWED.
74. IF REQUIRED TO PAINT ANTENNAS AND/OR COAX:
A. TEMPERATURE SHALL BE ABOVE 50° F.
B. PAINT COLOR MUST BE APPROVED BY BUILDING OWNER/LANDLORD.
C. FOR REGULATED TOWERS, FAA/FCC APPROVED PAINT IS REQUIRED.
D. DO NOT PAINT OVER COLOR CODING OR ON EQUIPMENT MODEL NUMBERS.

75. ALL CABLES SHALL BE GROUNDED WITH COAXIAL CABLE GROUND KITS. FOLLOW THE MANUFACTURER’S RECOMMENDATIONS.
A. GROUNDING AT THE ANTENNA LEVEL.
B. GROUNDING AT MID LEVEL, TOWERS WHICH ARE OVER 200’-0", ADDITIONAL CABLE GROUNDING REQUIRED.
C. GROUNDING AT BASE OF TOWER PRIOR TO TURNING HORIZONTAL.
D. GROUNDING OUTSIDE THE EQUIPMENT SHELTER AT ENTRY PORT.
E. GROUNDING INSIDE THE EQUIPMENT SHELTER AT THE ENTRY PORT.
76. ALL PROPOSED GROUND BAR DOWNLEADS ARE TO BE TERMINATED TO THE EXISTING ADJACENT GROUND BAR DOWNLEADS A MINIMUM DISTANCE OF 4’-0" BELOW GROUND BAR. TERMINATIONS MAY BE EXOTHERMIC OR COMPRESSION.
77. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ANTENNA AND THE COAX CONFIGURATION IS THE CORRECT MAKE AND MODELS, PRIOR TO INSTALLATION.
78. ALL CONNECTIONS FOR HANGERS, SUPPORTS, BRACING, ETC. SHALL BE INSTALLED PER TOWER MANUFACTURER’S SPECIFICATION & RECOMMENDATIONS.
79. ANTENNA CONTRACTOR SHALL FURNISH AND INSTALL A 12’-0" T-BOOM SECTOR ANTENNA MOUNT, IF APPLICABLE, INCLUDING ALL HARDWARE.
80. CLOSEOUT DELIVERABLES SHALL INCLUDE PHOTOS OF ALL MOUNTING HARDWARE INSTALLED TIGHT AND MARKED.
81. INSTALLATION MANUALS FOR RAYCAP REDLINED TO COMPLY WITH AT&T SPECIFICATIONS CAN BE ACCESSED IN THE BLACK & VEATCH TURF SOW LIBRARY VIA THE FOLLOWING URL:

https://blackandveatch.sharepoint.com/teams/ESS/Telecom/Projects/PublicNetworks/ATT/ATTturf/ATTturfScopeofworkdocuments/_layouts/15/start.aspx#/Shared%20Documents/Forms/AllItems.aspx



7801 FARLEY
OVERLAND PARK, KS 66204




BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129031
DRAWN BY:	LGH
CHECKED BY:	SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION

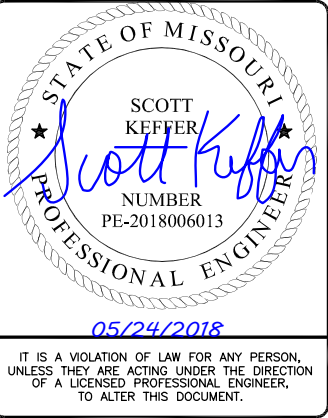

LEE’S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
**GENERAL CONSTRUCTION
NOTES**

SHEET NUMBER
GN-2

GENERAL ELECTRICAL NOTES

PART 1 – GENERAL

1.1 GENERAL CONDITIONS

- A. CONTRACTOR SHALL INSPECT THE EXISTING SITE CONDITIONS PRIOR TO SUBMITTING BID. ANY QUESTIONS ARISING DURING THE BID PERIOD IN REGARDS TO THE CONTRACTORS FUNCTIONS, THE SCOPE OF WORK, OR ANY OTHER ISSUE RELATED TO THIS PROJECT SHALL BE BROUGHT UP DURING THE BID PERIOD WITH THE PROJECT MANAGER FOR CLARIFICATION, NOT AFTER THE CONTRACT HAS BEEN AWARDED.
- B. THE CONTRACTOR SHALL OBTAIN PERMITS, LICENSES, MAKE ALL DEPOSITS, AND PAY ALL FEES REQUIRED FOR THE CONSTRUCTION PERFORMANCE FOR THE WORK UNDER THIS SECTION.
- C. DRAWINGS SHOW THE GENERAL ARRANGEMENT OF ALL SYSTEMS AND COMPONENTS COVERED UNDER THIS SECTION. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS. DRAWING SHALL NOT BE SCALED TO DETERMINE DIMENSIONS.

1.2 LAWS, REGULATIONS, ORDINANCES, STATUTES AND CODES.

- A. ALL WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, AND ALL APPLICABLE LOCAL LAWS, REGULATIONS, ORDINANCES, STATUTES AND CODES. CONDUIT BENDS SHALL BE THE RADIUS BEND FOR THE TRADE SIZE OF CONDUIT IN COMPLIANCE WITH THE LATEST EDITIONS OF NEC.

1.3 REFERENCES

- A. THE PUBLICATIONS LISTED BELOW ARE PART OF THIS SPECIFICATION. EACH PUBLICATION SHALL BE THE LATEST REVISION AND ADDENDUM IN EFFECT ON THE DATE. THIS SPECIFICATION IS ISSUED FOR CONSTRUCTION UNLESS OTHERWISE NOTED. EXCEPT AS MODIFIED BY THE REQUIREMENT SPECIFIED HEREIN OR THE DETAILS OF THE DRAWINGS, WORK INCLUDED IN THIS SPECIFICATION SHALL CONFORM TO THE APPLICABLE PROVISION OF THESE PUBLICATIONS.

1. ANSI/IEEE (AMERICAN NATIONAL STANDARDS INSTITUTE)
2. ASTM (AMERICAN SOCIETY FOR TESTING AND MATERIALS)
3. ICE (INSULATED CABLE ENGINEERS ASSOCIATION)
4. NEMA (NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION)
5. NFPA (NATIONAL FIRE PROTECTION ASSOCIATION)
6. OSHA (OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION)
7. UL (UNDERWRITERS LABORATORIES, INC.)
8. AT&T GROUNDING AND BONDING STANDARDS TP-76416

1.4 SCOPE OF WORK

- A. WORK UNDER THIS SECTION SHALL CONSIST OF FURNISHING ALL LABOR, MATERIAL, AND ASSOCIATED SERVICES REQUIRED TO COMPLETE REQUIRED CONSTRUCTION AND BE OPERATIONAL.
- B. ALL ELECTRICAL EQUIPMENT UNDER THIS CONTRACT SHALL BE PROPERLY TESTED, ADJUSTED, AND ALIGNED BY THE CONTRACTOR.
- C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL EXCAVATING, DRAINING, TRENCHES, BACKFILLING, AND REMOVAL OF EXCESS DIRT.
- D. THE CONTRACTOR SHALL FURNISH TO THE OWNER WITH CERTIFICATES OF A FINAL INSPECTION AND APPROVAL FROM THE INSPECTION AUTHORITIES HAVING JURISDICTION.
- E. THE CONTRACTOR SHALL PREPARE A COMPLETE SET OF AS-BUILT DRAWINGS, DOCUMENT ALL WIRING EQUIPMENT CONDITIONS, AND CHANGES WHILE COMPLETING THIS CONTRACT. THE AS-BUILT DRAWINGS SHALL BE SUBMITTED AT COMPLETION OF THE PROJECT.

PART 2 – PRODUCTS

2.1 GENERAL

- A. ALL MATERIALS AND EQUIPMENT SHALL BE UL LISTED, NEW, AND FREE FROM DEFECTS.
- B. ALL ITEMS OF MATERIALS AND EQUIPMENT SHALL BE ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION AS SUITABLE FOR THE USE INTENDED.
- C. ALL EQUIPMENT SHALL BEAR THE UNDERWRITERS LABORATORIES LABEL OF APPROVAL, AND SHALL CONFORM TO REQUIREMENT OF THE NATIONAL ELECTRICAL CODE.
- D. ALL OVERCURRENT DEVICES SHALL HAVE AN INTERRUPTING CURRENT RATING THAT SHALL BE GREATER THAN THE SHORT CIRCUIT CURRENT TO WHICH THEY ARE SUBJECTED, 10,000 AIC MINIMUM. VERIFY AVAILABLE SHORT CIRCUIT CURRENT DOES NOT EXCEED THE RATING OF ELECTRICAL EQUIPMENT IN ACCORDANCE WITH ARTICLE 110.24 NEC OR THE MOST CURRENT ADOPTED CODE PER THE GOVERNING JURISDICTION.

2.2 MATERIALS AND EQUIPMENT

A. CONDUIT

1. RIGID METAL CONDUIT (RMC) SHALL BE HOT-DIPPED GALVANIZED INSIDE AND OUTSIDE INCLUDING ENDS AND THREADS AND ENAMELED OR LACQUERED INSIDE IN ADDITION TO GALVANIZING.
2. LIQUIDTIGHT FLEXIBLE METAL CONDUIT SHALL BE UL LISTED.
3. CONDUIT CLAMPS, STRAPS AND SUPPORTS SHALL BE STEEL OR MALLEABLE IRON. ALL FITTINGS SHALL BE COMPRESSION AND CONCRETE TIGHT TYPE. GROUNDING BUSHINGS WITH INSULATED THROATS SHALL BE INSTALLED ON ALL CONDUIT TERMINATIONS.
4. NONMETALLIC CONDUIT AND FITTINGS SHALL BE SCHEDULE 40 PVC. INSTALL USING SOLVENT-CEMENT-TYPE JOINTS AS RECOMMENDED BY THE MANUFACTURER.

B. CONDUCTORS AND CABLE

1. AC CONDUCTORS SHALL BE FLAME-RETARDANT, MOISTURE AND HEAT RESISTANT THERMOPLASTIC, SINGLE CONDUCTOR, COPPER, TYPE THHN/THWN-2, 600 VOLT, SIZE AS INDICATED, #12 AWG SHALL BE THE MINIMUM SIZE CONDUCTOR USED.
2. #10 AWG AND SMALLER CONDUCTOR SHALL BE SOLID OR STRANDED AND #8 AWG AND LARGER CONDUCTORS SHALL BE STRANDED.
3. SOLDERLESS, COMPRESSION-TYPE CONNECTORS SHALL BE USED FOR TERMINATION OF ALL STRANDED CONDUCTORS.
4. STRAIN-RELIEF SUPPORTS GRIPS SHALL BE HUBBELL KELLEMS OR APPROVED EQUAL. CABLES SHALL BE SUPPORTED IN ACCORDANCE WITH THE NEC AND CABLE MANUFACTURER'S RECOMMENDATIONS.
5. ALL CONDUCTORS SHALL BE TAGGED AT BOTH ENDS OF THE CONDUCTOR, AT ALL PULL BOXES, J-BOXES, EQUIPMENT AND CABINETS AND SHALL BE IDENTIFIED WITH APPROVED PLASTIC TAGS (ACTION CRAFT, BRADY, OR APPROVED EQUAL).

C. DISCONNECT SWITCHES

1. DISCONNECT SWITCHES SHALL BE HEAVY DUTY, DEAD-FRONT, QUICK-MAKE, QUICK-BREAK, EXTERNALLY OPERABLE, HANDLE LOCKABLE AND INTERLOCK WITH COVER IN CLOSED POSITION, RATING AS INDICATED, UL LABELED FURNISHED IN NEMA 3R ENCLOSURE, SQUARE-D OR ENGINEERED APPROVED EQUAL.

D. CHEMICAL ELECTROLYTIC GROUNDING SYSTEM:

1. INSTALL CHEMICAL GROUNDING AS REQUIRED. THE SYSTEM SHALL BE ELECTROLYTIC MAINTENANCE FREE ELECTRODE CONSISTING OF RODS WITH A MINIMUM #2 AWG CU EXOTHERMALLY WELDED PIGTAIL, PROTECTIVE BOXES, AND BACKFILL MATERIAL. MANUFACTURER SHALL BE LYNCOLE XIT GROUNDING ROD TYPES K2-(*)CS OR K2L-(*)CS (*) LENGTH AS REQUIRED.

2. GROUND ACCESS BOX SHALL BE A POLYPLASTIC BOX FOR NON-TRAFFIC APPLICATIONS, INCLUDING BOLT DOWN FLUSH COVER WITH "BREATHER" HOLES, XIT MODEL #XB-22. ALL DISCONNECT SWITCHES AND CONTROLLING DEVICES SHALL BE PROVIDED WITH ENGRAVED LAMICOID NAMEPLATES INDICATING EQUIPMENT CONTROLLED, BRANCH CIRCUITS ID NUMBERING, AND THE ELECTRICAL POWER SOURCE.

3. BACKFILL MATERIAL SHALL BE LYNCONITE AND LYNCOLE GROUNDING GRAVEL.

E. SYSTEM GROUNDING:

1. ALL GROUNDING COMPONENTS SHALL BE TINNED AND GROUNDING CONDUCTOR SHALL BE #2 AWG BARE, SOLID, TINNED, COPPER, ABOVE GRADE GROUNDING CONDUCTORS SHALL BE SUNLIGHT RESISTANT TINNED STRANDED COPPER AND INSULATED WHERE NOTED.
2. GROUNDING BUSES SHALL BE BARE, TINNED, ANNEALED COPPER BARS OF RECTANGULAR CROSS SECTION. STANDARD BUS BARS MGB, SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. THEY SHALL NOT BE FABRICATED OR MODIFIED IN THE FIELD. ALL GROUNDING BUSES SHALL BE IDENTIFIED WITH MINIMUM 3/4" LETTERS BY WAY OF STENCILING OR DESIGNATION PLATE.
3. CONNECTORS SHALL BE HIGH-CONDUCTIVITY, HEAVY DUTY, LISTED AND LABELED AS GROUNDING CONNECTORS FOR THE MATERIALS USED. USE TWO-HOLE COMPRESSION LUGS WITH HEAT SHRINK FOR MECHANICAL CONNECTIONS. INTERIOR CONNECTIONS USE TWO-HOLE COMPRESSION LUGS WITH INSPECTION WINDOW AND CLEAR HEAT SHRINK.
4. EXOTHERMIC WELDED CONNECTIONS SHALL BE PROVIDED IN KIT FORM AND SELECTED FOR THE SPECIFIC TYPES, SIZES, AND COMBINATIONS OF CONDUCTORS AND OTHER ITEMS TO BE CONNECTED.
5. GROUND RODS SHALL BE ERICO #615800, COPPER-CLAD STEEL WITH HIGH-STRENGTH STEEL CORE AND ELECTROLYTIC-GRADE COPPER OUTER SHEATH, MOLTEN WELDED TO CORE, 5/8"x10'-0". ALL GROUNDING RODS SHALL BE INSTALLED WITH INSPECTION SLEEVES.
6. INSTALL AN EQUIPMENT GROUNDING CONDUCTOR IN ALL CONDUITS IN COMPLIANCE WITH THE AT&T SPECIFICATIONS AND NEC. THE EQUIPMENT GROUNDING CONDUCTORS SHALL BE BONDED AT ALL JUNCTION BOXES, PULLBOXES, DISCONNECT SWITCHES, STARTERS, AND EQUIPMENT CABINETS.

F. OTHER MATERIALS:

1. THE CONTRACTOR SHALL PROVIDE OTHER MATERIALS, THOUGH NOT SPECIFICALLY DESCRIBED, WHICH ARE REQUIRED FOR A COMPLETELY OPERATIONAL SYSTEM AND PROPER INSTALLATION OF THE WORK.
2. PROVIDE PULL BOXES AND JUNCTION BOXES WHERE SHOWN OR REQUIRED BY NEC.

G. PANELS AND LOAD CENTERS:

1. ALL PANEL DIRECTORIES SHALL BE TYPEWRITTEN.

PART 3 – EXECUTION

3.1 GENERAL:

- A. ALL MATERIAL AND EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- B. EQUIPMENT SHALL BE TIGHTLY COVERED AND PROTECTED AGAINST DIRT OR WATER, AND AGAINST CHEMICAL OR MECHANICAL INJURY DURING INSTALLATION AND CONSTRUCTION PERIODS.

3.2 LABOR AND WORKMANSHIP:

- A. ALL LABOR FOR THE INSTALLATION OF MATERIALS AND EQUIPMENT FURNISHED FOR THE ELECTRICAL SYSTEM SHALL BE INSTALLED BY EXPERIENCED WIREMEN, IN A NEAT AND WORKMAN-LIKE MANNER.
- B. ALL ELECTRICAL EQUIPMENT SHALL BE ADJUSTED, ALIGNED AND TESTED BY THE CONTRACTOR AS REQUIRED TO PRODUCE THE INTENDED PERFORMANCE.
- C. UPON COMPLETION OF WORK, THE CONTRACTOR SHALL THOROUGHLY CLEAN ALL EXPOSED EQUIPMENT, REMOVE ALL LABELS AND ANY DEBRIS, CRATING OR CARTONS AND LEAVE THE INSTALLATION FINISHED AND READY FOR OPERATION.

3.3 COORDINATION:

- A. THE CONTRACTOR SHALL COORDINATE THE INSTALLATION OF ELECTRICAL ITEMS WITH THE OWNER-FURNISHED EQUIPMENT DELIVERY SCHEDULE TO PREVENT UNNECESSARY DELAYS IN THE TOTAL WORK.

3.4 INSTALLATION:

A. CONDUIT:

1. ALL ELECTRICAL WIRING SHALL BE INSTALLED IN CONDUIT AS SPECIFIED. NO CONDUIT OR TUBING OF LESS THAN 3/4 INCH TRADE SIZE.
2. PROVIDE RIGID PVC SCHEDULE 80 CONDUITS FOR ALL RISERS, RMC OTHERWISE NOTED. EMT MAY BE INSTALLED FOR EXTERIOR CONDUITS WHERE NOT SUBJECT TO PHYSICAL DAMAGE.
3. INSTALL SCH. 40 PVC CONDUIT WITH A MINIMUM COVER OF 24" UNDER ROADWAYS, PARKING LOTS, STREETS, AND ALLEYS. CONDUIT SHALL HAVE A MINIMUM COVER OF 18" IN ALL OTHER NON-TRAFFIC APPLICATIONS (REFER TO 2008 NEC, TABLE 300.5).
4. USE GALVANIZED FLEXIBLE STEEL CONDUIT WHERE DIRECT CONNECTION TO EQUIPMENT WITH MOVEMENT, VIBRATION, OR FOR EASE OF MAINTENANCE. USE LIQUID TIGHT, FLEXIBLE METAL CONDUIT FOR OUTDOOR APPLICATIONS. INSTALL GALVANIZED FLEXIBLE STEEL CONDUIT AT ALL POINTS OF CONNECTION TO EQUIPMENT MOUNTED ON SUPPORT TO ALLOW FOR EXPANSION AND CONTRACTION.
5. A RUN OF CONDUIT BETWEEN BOXES OR EQUIPMENT SHALL NOT CONTAIN MORE THAN THE EQUIVALENT OF THREE QUARTER-BENDS. CONDUIT BEND SHALL BE MADE WITH THE UL LISTED BENDER OR FACTORY 90 DEGREE ELBOWS MAY BE USED.
6. FIELD FABRICATED CONDUITS SHALL BE CUT SQUARE WITH A CONDUIT CUTTING TOOL AND REAMED TO PROVIDE A SMOOTH INSIDE SURFACE.
7. PROVIDE INSULATED GROUNDING BUSHING FOR ALL CONDUITS.
8. CONTRACTOR IS RESPONSIBLE FOR PROTECTING ALL CONDUITS DURING CONSTRUCTION. TEMPORARY OPENINGS IN THE CONDUIT SYSTEM SHALL BE PLUGGED OR CAPPED TO PREVENT ENTRANCE OF MOISTURE OR FOREIGN MATTER. CONTRACTOR SHALL REPLACE ANY CONDUITS CONTAINING FOREIGN MATERIALS THAT CANNOT BE REMOVED.
9. ALL CONDUITS SHALL BE SWABBED CLEAN BY PULLING AN APPROPRIATE SIZE MANDREL THROUGH THE CONDUIT BEFORE INSTALLATION OF CONDUCTORS OR CABLES. CONDUIT SHALL BE FREE OF DIRT AND DEBRIS.
10. INSTALL PULL STRINGS IN ALL CLEAN EMPTY CONDUITS. IDENTIFY PULL STRINGS AT EACH END.
11. INSTALL 2" HIGHLY VISIBLE AND DETECTABLE TAPE 12" ABOVE ALL UNDERGROUND CONDUITS AND CONDUCTORS.
12. CONDUITS SHALL BE INSTALLED IN SUCH A MANNER AS TO ENSURE AGAINST COLLECTION OF TRAPPED CONDENSATION.
13. PROVIDE CORE DRILLING AS NECESSARY FOR PENETRATIONS TO ALLOW FOR RACEWAYS AND CABLES TO BE ROUTED THROUGH THE BUILDING. DO NOT PENETRATE STRUCTURAL MEMBERS. SLEEVES AND/OR PENETRATIONS IN FIRE RATED CONSTRUCTION SHALL BE EFFECTIVELY SEALED WITH FIRE RATED MATERIAL WHICH SHALL MAINTAIN THE FIRE RATING OF THE WALL OR STRUCTURE. FIRE STOPS AT FLOOR PENETRATIONS SHALL PREVENT PASSAGE OF WATER, SMOKE, FIRE, AND FUMES. ALL MATERIAL SHALL BE UL APPROVED FOR THIS PURPOSE.

B. CONDUCTORS AND CABLE

1. ALL POWER WIRING SHALL BE COLOR CODED AS FOLLOWS:

DESCRIPTION	208/240/120 VOLT SYSTEMS
PHASE A	BLACK
PHASE B	RED
PHASE C	BLUE
NEUTRAL	WHITE
GROUNDING	GREEN

2. SPLICES SHALL BE MADE ONLY AT OUTLETS, JUNCTION BOXES, OR ACCESSIBLE RACEWAY CONDULETS APPROVED FOR THIS PURPOSE.

3. PULLING LUBRICANTS SHALL BE UL APPROVED. CONTRACTOR SHALL USE NYLON OR HEMP ROPE FOR PULLING CONDUCTOR OR CABLES INTO THE CONDUIT.

4. CABLES SHALL BE NEATLY TRAINED, WITHOUT INTERLACING, AND BE OF SUFFICIENT LENGTH IN ALL BOXES & EQUIPMENT TO PERMIT MAKING A NEAT ARRANGEMENT. CABLES SHALL BE SECURED IN A MANNER TO AVOID TENSION ON CONDUCTORS OR TERMINALS. CONDUCTORS SHALL BE PROTECTED FROM MECHANICAL INJURY AND MOISTURE. SHARP BENDS OVER CONDUIT BUSHINGS IS PROHIBITED. DAMAGED CABLES SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.

C. DISCONNECT SWITCHES

1. INSTALL DISCONNECT SWITCHES LEVEL AND PLUMB. CONNECT TO WIRING SYSTEM AND GROUNDING SYSTEM AS INDICATED.

D. GROUNDING

1. ALL METALLIC PARTS OF ELECTRICAL EQUIPMENT WHICH DO NOT CARRY CURRENT SHALL BE GROUNDING IN ACCORDANCE WITH THE REQUIREMENTS OF THE BUILDING MANUFACTURER, AT&T GROUNDING AND BONDING STANDARDS TP-76416, ND-00135, AND THE NATIONAL ELECTRICAL CODE.
2. PROVIDE ELECTRICAL GROUNDING AND BONDING SYSTEM INDICATED WITH ASSEMBLY OF MATERIALS, INCLUDING GROUNDING ELECTRODES, BONDING JUMPERS AND ADDITIONAL ACCESSORIES AS REQUIRED FOR A COMPLETE INSTALLATION.
3. ALL GROUNDING CONDUCTORS SHALL PROVIDE A STRAIGHT DOWNWARD PATH TO GROUND WITH GRADUAL BEND AS REQUIRED. GROUNDING CONDUCTORS SHALL NOT BE LOOPED OR SHARPLY BENT. ROUTE GROUNDING CONNECTIONS AND CONDUCTORS TO GROUND IN THE SHORTEST AND STRAIGHTEST PATHS POSSIBLE TO MINIMIZE TRANSIENT VOLTAGE RISES.
4. BUILDINGS AND/OR NEW TOWERS GREATER THAN 75 FEET IN HEIGHT AND WHERE THE MAIN GROUNDING CONDUCTORS ARE REQUIRED TO BE ROUTED TO GRADE, THE CONTRACTOR SHALL ROUTE TWO GROUNDING CONDUCTORS FROM THE ROOFTOP, TOWERS, AND WATER TOWERS GROUND RING, TO THE EXISTING GROUNDING SYSTEM, THE GROUNDING CONDUCTORS SHALL NOT BE SMALLER THAN 2/0 AWG COPPER. ROOFTOP GROUND RING SHALL BE BONDED TO THE EXISTING GROUNDING SYSTEM, THE BUILDING STEEL COLUMNS, LIGHTNING PROTECTION SYSTEM, AND BUILDING MAIN WATER LINE (FERROUS OR NONFERROUS METAL PIPING ONLY). SEE STANDARD 6.3.2.2.
5. TIGHTEN GROUNDING AND BONDING CONNECTORS, INCLUDING SCREWS AND BOLTS, IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED TORQUE TIGHTENING VALUES FOR CONNECTORS AND BOLTS. WHERE MANUFACTURER'S TORQUING REQUIREMENTS ARE NOT AVAILABLE, TIGHTEN CONNECTIONS TO COMPLY WITH TIGHTENING TORQUE VALUES SPECIFIED IN UL TO ENSURE PERMANENT AND EFFECTIVE GROUNDING.
6. CONTRACTOR SHALL VERIFY THE LOCATIONS OF GROUNDING TIE-IN-POINTS TO THE EXISTING GROUNDING SYSTEM. ALL UNDERGROUND GROUNDING CONNECTIONS SHALL BE MADE BY THE EXOTHERMIC WELD PROCESS AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
7. ALL GROUNDING CONNECTIONS SHALL BE INSPECTED FOR TIGHTNESS. EXOTHERMIC WELDED CONNECTIONS SHALL BE APPROVED BY THE INSPECTOR HAVING JURISDICTION BEFORE BEING PERMANENTLY CONCEALED.
8. APPLY CORROSION-RESISTANCE FINISH TO FIELD CONNECTIONS AND PLACES WHERE FACTORY APPLIED PROTECTIVE COATINGS HAVE BEEN DESTROYED. USE KOPR-SHIELD ANTI-OXIDATION COMPOUND ON ALL COMPRESSION GROUNDING CONNECTIONS.
9. A SEPARATE, CONTINUOUS, INSULATED EQUIPMENT GROUNDING CONDUCTOR SHALL BE INSTALLED IN ALL FEEDER AND BRANCH CIRCUITS.
10. BOND ALL INSULATED GROUNDING BUSHINGS WITH A BARE 6 AWG GROUNDING CONDUCTOR TO A GROUND BUS.
11. DIRECT BURIED GROUNDING CONDUCTORS SHALL BE INSTALLED AT A NOMINAL DEPTH OF 36" MINIMUM BELOW GRADE, OR 6" BELOW THE FROST LINE, USING THE GREATER OF THE TWO DISTANCES.
12. ALL GROUNDING CONDUCTORS EMBEDDED IN OR PENETRATING CONCRETE SHALL BE INSTALLED IN SCHEDULE 40 PVC CONDUIT.
13. THE INSTALLATION OF CHEMICAL ELECTROLYTIC GROUNDING SYSTEM IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. REMOVE SEALING TAPE FROM LEACHING AND BREATHER HOLES. INSTALL PROTECTIVE BOX FLUSH WITH GRADE.
14. DRIVE GROUND RODS UNTIL TOPS ARE A MINIMUM DISTANCE OF 36" DEPTH OR 6" BELOW FROST LINE, USING THE GREATER OF THE TWO DISTANCES.
15. IF COAX ON THE ICE BRIDGE IS MORE THAN 6 FT. FROM THE GROUND BAR AT THE BASE OF THE TOWER, A SECOND GROUND BAR WILL BE NEEDED AT THE END OF THE ICE BRIDGE, TO GROUND THE COAX CABLE GROUNDING KITS AND IN-LINE ARRESTORS.
16. CONTRACTOR SHALL REPAIR, AND/OR REPLACE, EXISTING GROUNDING SYSTEM COMPONENTS DAMAGED DURING CONSTRUCTION AT THE CONTRACTORS EXPENSE.

3.5 ACCEPTANCE TESTING

- A. CERTIFIED PERSONNEL USING CERTIFIED EQUIPMENT SHALL PERFORM REQUIRED TESTS AND SUBMIT WRITTEN TEST REPORTS UPON COMPLETION.
- B. WHEN MATERIAL AND/OR WORKMANSHIP IS FOUND NOT TO COMPLY WITH THE SPECIFIED REQUIREMENTS, THE NON-COMPLYING ITEMS SHALL BE REMOVED FROM THE PROJECT SITE AND REPLACED WITH ITEMS COMPLYING WITH THE SPECIFIED REQUIREMENTS PROMPTLY AFTER RECEIPT OF NOTICE FOR NON-COMPLIANCE.
- C. TEST PROCEDURES
1. ALL FEEDERS SHALL HAVE INSULATION TESTED AFTER INSTALLATION, BEFORE CONNECTION TO DEVICES. THE CONDUCTORS SHALL TEST FREE FROM SHORT CIRCUITS AND GROUNDS. TESTING SHALL BE FOR ONE MINUTE USING 1000V DC. PROVIDE WRITTEN DOCUMENTATION FOR ALL TEST RESULTS.
2. PRIOR TO ENERGIZING CIRCUITRY, TEST WIRING DEVICES FOR ELECTRICAL CONTINUITY AND PROPER POLARITY CONNECTIONS.
3. MEASURE AND RECORD VOLTAGES BETWEEN PHASES AND BETWEEN PHASE CONDUCTORS AND NEUTRALS. SUBMIT A REPORT OF MAXIMUM AND MINIMUM VOLTAGES.
4. PERFORM GROUNDING TEST TO MEASURE GROUNDING RESISTANCE OF GROUNDING SYSTEM USING THE IEEE STANDARD 3-POINT "FALL-OFF-POTENTIAL" METHOD. PROVIDE PLOTTED TEST VALUES AND LOCATION SKETCH. NOTIFY THE ENGINEER IMMEDIATELY IF MEASURED VALUE IS OVER 5 OHMS.



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO: 129031

DRAWN BY: LGH

CHECKED BY: SK

0	05/21/18	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
LTE 3C/4C/FIRSTNET 5C/2C BWE

SHEET TITLE
**GENERAL
ELECTRICAL NOTES**


SHEET NUMBER

GN-3

NOTE:

1. AZIMUTHS ARE APPROXIMATE.
2. STIFF-ARMS SHALL BE LEVEL AND PARALLEL TO THE GROUND.

THIS SHEET IS
FOR REFERENCE ONLY

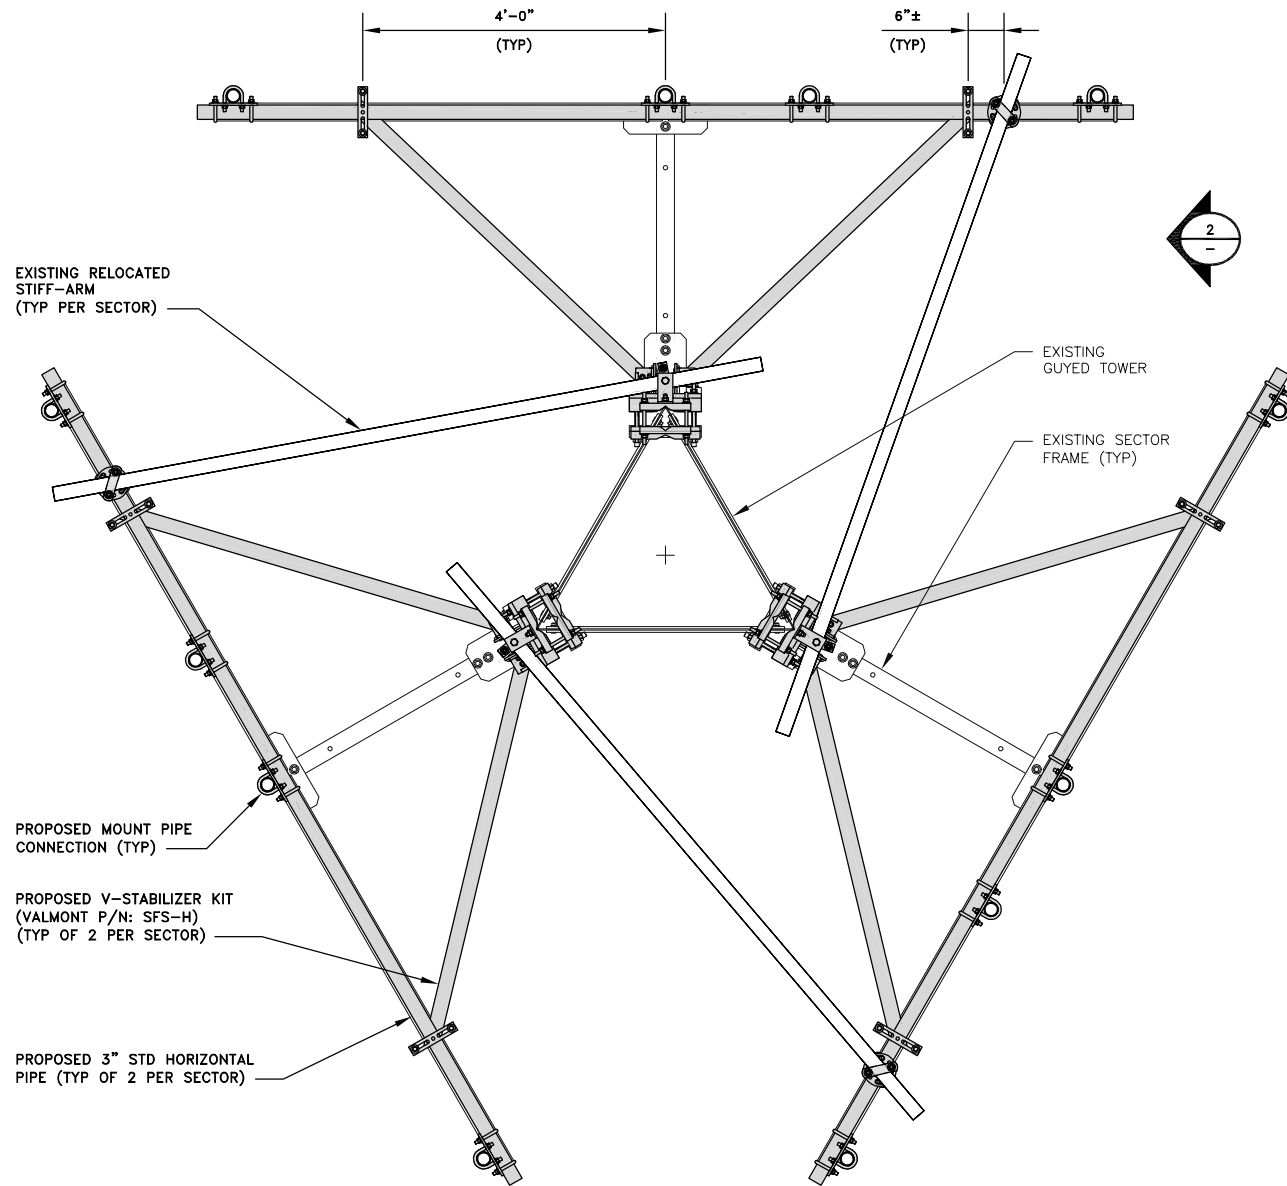

SECTOR FRAME MODIFICATION PLAN

NO SCALE

1


CONTRACTOR SHALL FIELD VERIFY AND MEASURE DIMENSIONS OF THE SITE STRUCTURE BEFORE FABRICATION OF MATERIALS FOR ALL MODIFICATIONS.

1. CONTRACTOR SHALL FIELD VERIFY EXISTING PLATFORM OR SECTOR FRAME MEMBER SIZES AND REPORT TO ENGINEER IF DIFFERENT THAN NOTED ON PLAN.
2. ALL STEEL WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION. STEEL SECTIONS SHALL BE IN ACCORDANCE WITH ASTM AS INDICATED BELOW:

W-SHAPES: ASTM A992, 50 KSI
ANGLES, BARS, CHANNELS: ASTM A36, 36 KSI
HSS SECTIONS: ASTM 500, 48 KSI
PIPE SECTIONS: ASTM A53 Gr. B
3. ALL WELDING, IF CALLED OUT ON PLAN, SHALL BE PERFORMED USING E70XX ELECTRODES AND WELDING SHALL CONFORM TO AISC. WHERE FILLET WELD SIZES ARE NOT SHOWN, PROVIDE THE MINIMUM SIZE PER TABLE J2.4 IN THE AISC "MANUAL OF STEEL CONSTRUCTION". PAINTED SURFACES SHALL BE TOUCHED UP.
4. BOLTED CONNECTIONS SHALL BE SLIP CRITICAL BOLT CONNECTION WITH 5/8"Ø BOLTS BETWEEN SLIDE MOUNT PLATE AND EXISTING CONNECTED PARTS AND SHALL HAVE MINIMUM OF TWO BOLTS UNLESS NOTED OTHERWISE. THE FAYING SURFACE OF THE SLIP CRITICAL CONNECTION SHALL BE ROUGHENED BY MEANS OF HAND WIRE BRUSHING. POWER WIRE BRUSHING SHALL NOT BE PERMITTED. INORGANIC ZINC (2 TO 3 MILS) OR ORGANIC ZINC (3 TO 5 MILS) PRIMER COAT TO MEET CLASS B SLIP COEFFICIENT AND CREEP TESTING REQUIREMENTS PER ASTM A490.
5. MAINTAIN MINIMUM 1-1/8" EDGE DISTANCE FROM CENTER OF ANY HOLE TO NEAREST EDGE OF ANY PLATE OR ANGLE, UNLESS NOTED OTHERWISE.
6. IN THE EVENT OF AN EMERGENCY, CONTRACTOR SHALL CONTACT BLACK & VEATCH PERSONNEL TO REPORT ANY EVENT OR EMERGENCY INCIDENT AT ANY AT&T TOWER SITE PER ATTACHED CONTACT INFORMATION TABLE.
7. CONTRACTOR SHALL PROVIDE ADEQUATE TEMPORARY SUPPORT AS REQUIRED TO COMPLETE WORK.
8. EXISTING STRUCTURAL COMPONENTS OF THIS PROJECT SITE/FACILITY ARE NOT TO BE ALTERED BY THIS CONSTRUCTION PROJECT UNLESS OTHERWISE NOTED. CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT NO DAMAGE IS DONE TO THE TOWER DURING THE CONSTRUCTION PROCESS. THE TOWER SHOULD BE ADEQUATELY SUPPORTED AND BRACED AT ALL TIMES.
9. THESE DRAWINGS DO NOT INDICATE THE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK AND SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION METHODS, MEANS, TECHNIQUES, SEQUENCES AND PROCEDURES.
10. CONTRACTOR SHALL SUPPLY ALL NECESSARY CONNECTION HARDWARE.
11. ALL NEW CONNECTIONS SHALL USE ASTM A153 GALVANIZED, A307-X BOLTS, A325-X BOLTS, NUTS AND LOCKING DEVICES UNLESS NOTED OTHERWISE. "X" INDICATES BEARING-TYPE CONNECTION "SNUG TIGHT FIT" WITH THREADS EXCLUDED FROM SHEAR PLANE.
12. U-BOLTS SHALL BE A307 AND ALL THREADED RODS SHALL BE ASTM A449 UNLESS NOTED OTHERWISE.
13. STRUCTURAL BOLTS SPACING AND EDGE DISTANCE SHALL MEET 2005 AISC SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS REQUIREMENTS UNLESS NOTED OTHERWISE.
14. ALL STRUCTURAL STEEL ROLLED SHAPES AND PLATES SHALL CONFORM TO ASTM A123 GALVANIZED UNLESS OTHERWISE NOTED.
15. MOUNTING PIPE TO PLATFORM OR SECTOR FRAME CONNECTION WILL BE PROVIDED BY OTHERS, UNLESS NOTED OTHERWISE. MINIMUM TWO (2) CONNECTIONS REQUIRED FOR EACH MOUNTING PIPE.
16. CONTRACTOR SHALL TOUCH UP ANY DAMAGED PAINT AREAS WITH ZINC RICH PAINT. ALL AREAS OF FIELD DRILLING, WELDING, OR CUTTING SHALL BE TOUCHED UP WITH ZINC RICH PAINT. PAINT SHALL BE APPLIED BY BRUSH ONLY (SPRAY APPLICATION PROHIBITED).
17. ALL FIELD CUT HOLES SHALL BE CUT WITH A GRINDER OR DRILLED. HOLES SHALL NOT BE FLAME CUT THRU STEEL UNLESS APPROVED BY THE ENGINEER OF RECORD.
18. CONSTRUCTION SHALL BE IN ACCORDANCE WITH APPLICABLE OSHA REGULATIONS AND SHALL BE PERFORMED ONLY IN "GOOD WEATHER". GOOD WEATHER MEANS LITTLE OR NO WIND AND RAIN AND MINIMUM TEMPERATURE OF 50 DEGREES F WHEN WELDING IS INVOLVED. CONTACT ENGINEER FOR ADDITIONAL INSTRUCTIONS IF "GOOD WEATHER" CANNOT BE ACHIEVED.
19. ALL CHANGES/ALTERNATES/REVISIONS TO THESE DRAWINGS SHALL BE DOCUMENTED BY REQUEST FOR INFORMATION (RFI) FORM APPROVED BY ENGINEER OF RECORD. FINAL WORK AUTHORIZATION AND ALL CHANGE ORDERS SHALL BE APPROVED BY CLIENT AND/OR CLIENT REPRESENTATIVE PRIOR TO PROCEEDING WITH ANY WORK THAT DEVIATES FROM THE ORIGINAL DESIGN, SCOPE, PRICE AND/OR SCHEDULE.

Black & Veatch Contacts and Phone Numbers			
Name	Title	Office Phone	E-Mail
Barbara Monroy	Lead Project Engineer	913-458-6514	MonroyB@bv.com
Jason Wong	Lead Design Engineer	913-458-9263	WongJ@bv.com

GENERAL NOTES

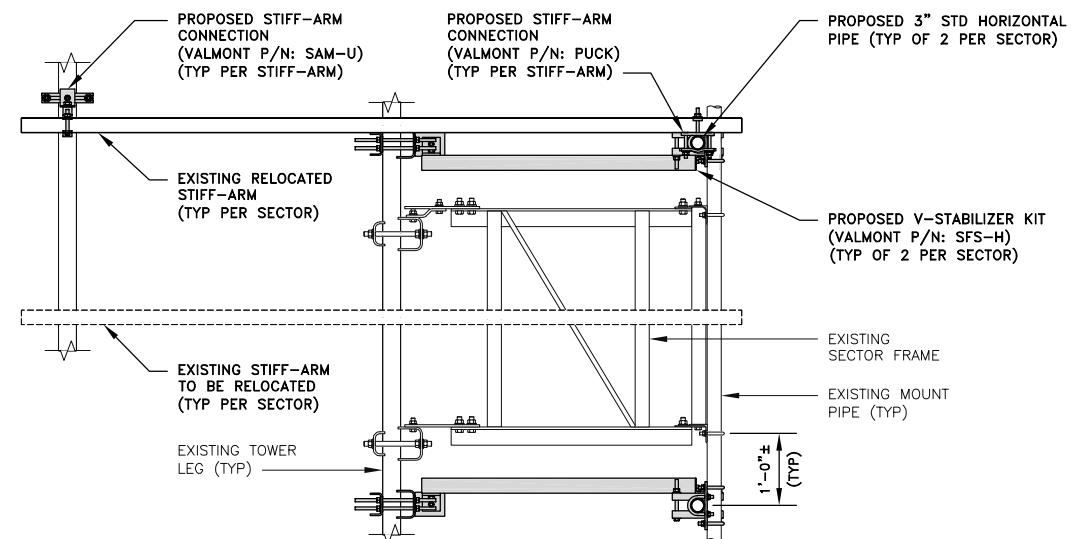

MODIFICATION ELEVATION

NO SCALE

2



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT NO:	129039
DRAWN BY:	WLL
CHECKED BY:	EFT

0	10/06/17	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



10/06/2017
IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

LEE'S SUMMIT
KS4019
111 SW HOOK ROAD
LEES SUMMIT, MO 64082
FIRSTNET 5C/4C/3C

SHEET TITLE
**ANTENNA MOUNT
REINFORCEMENT**

SHEET NUMBER

S-1