

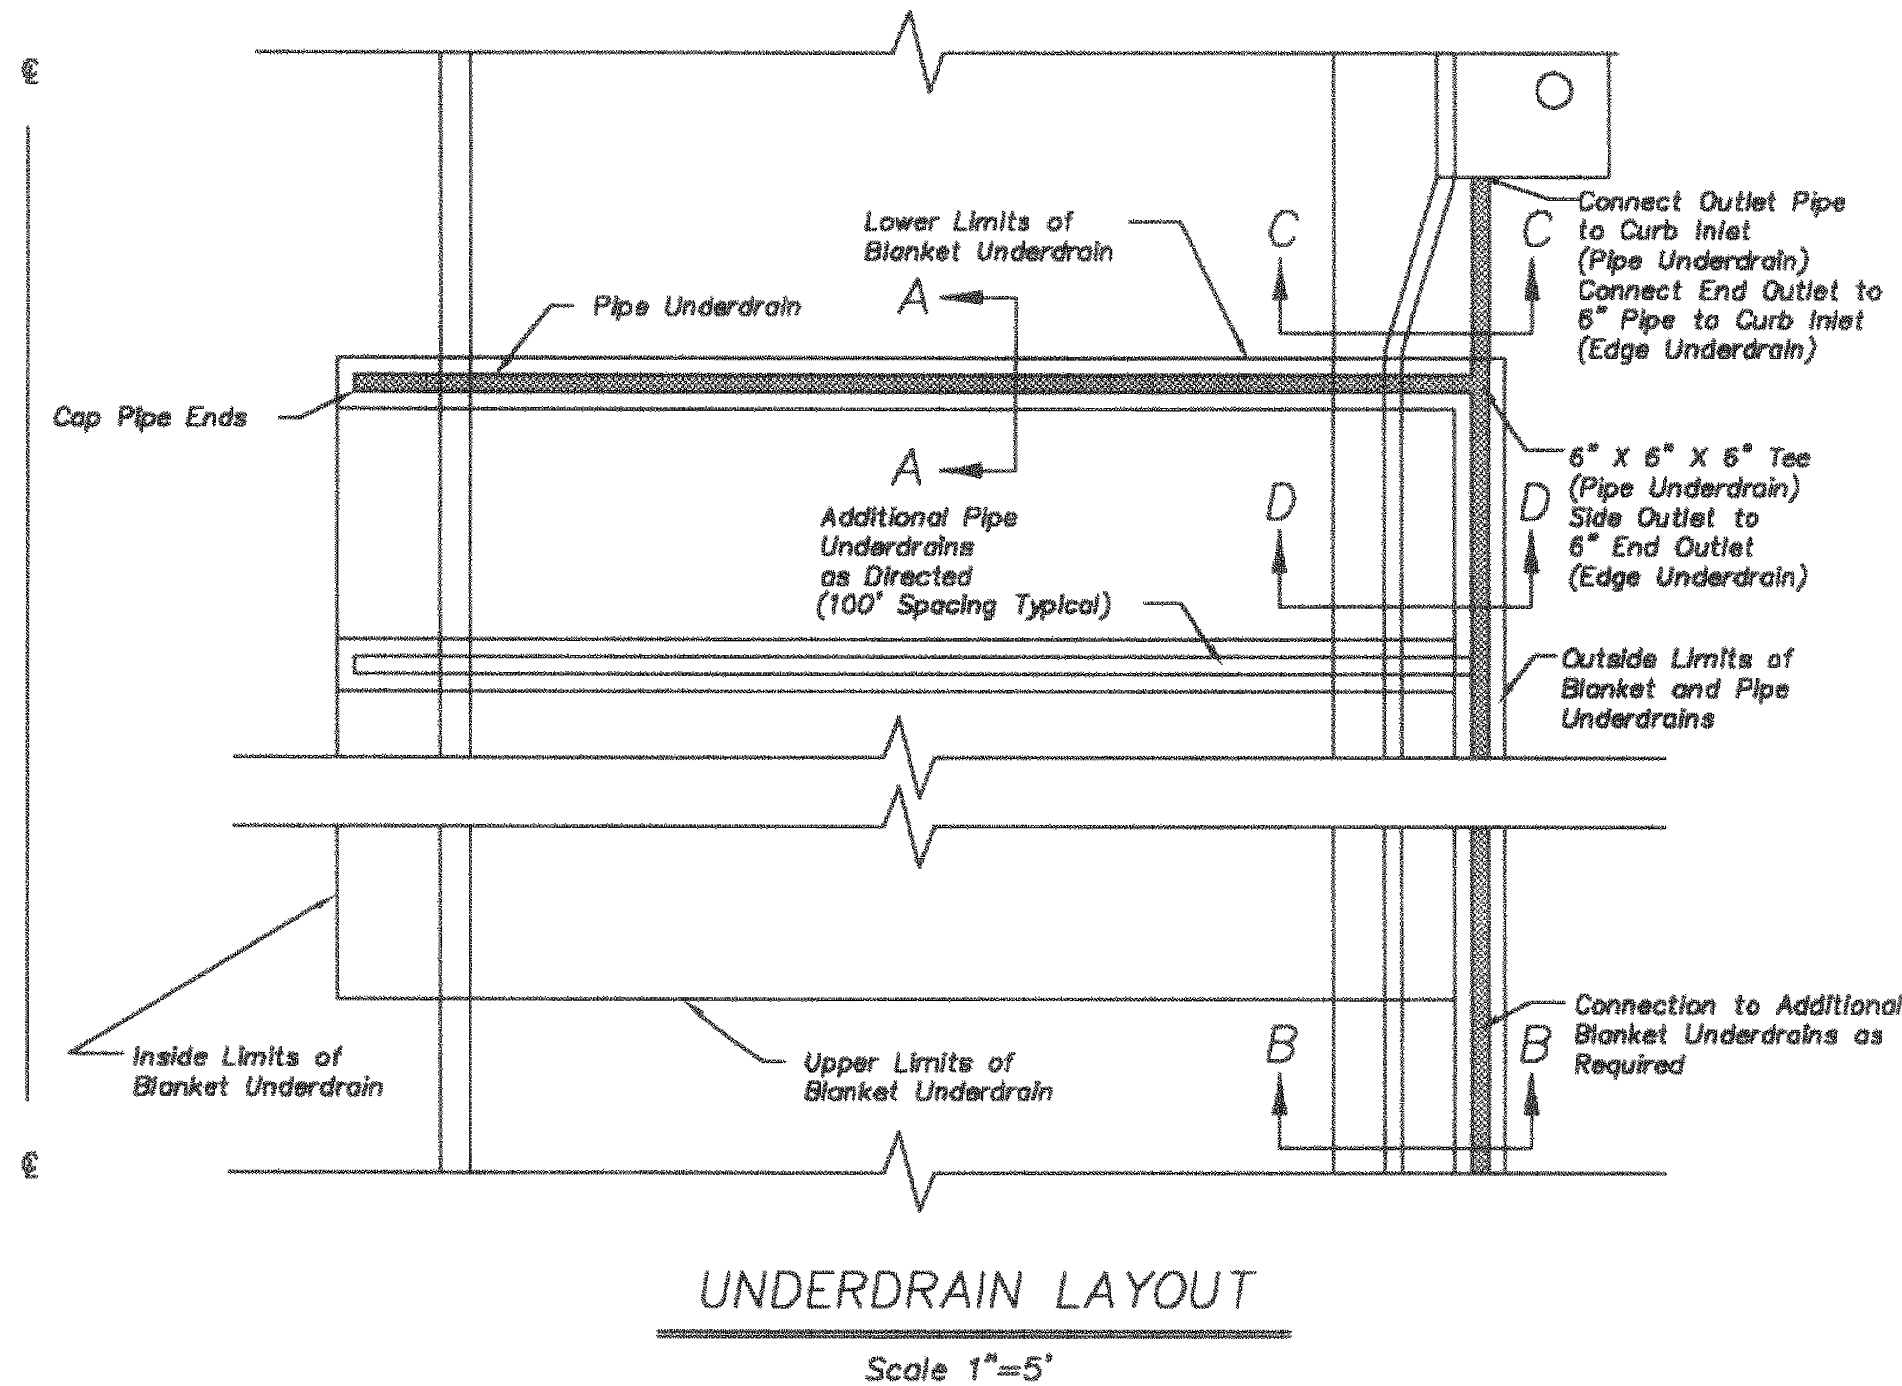


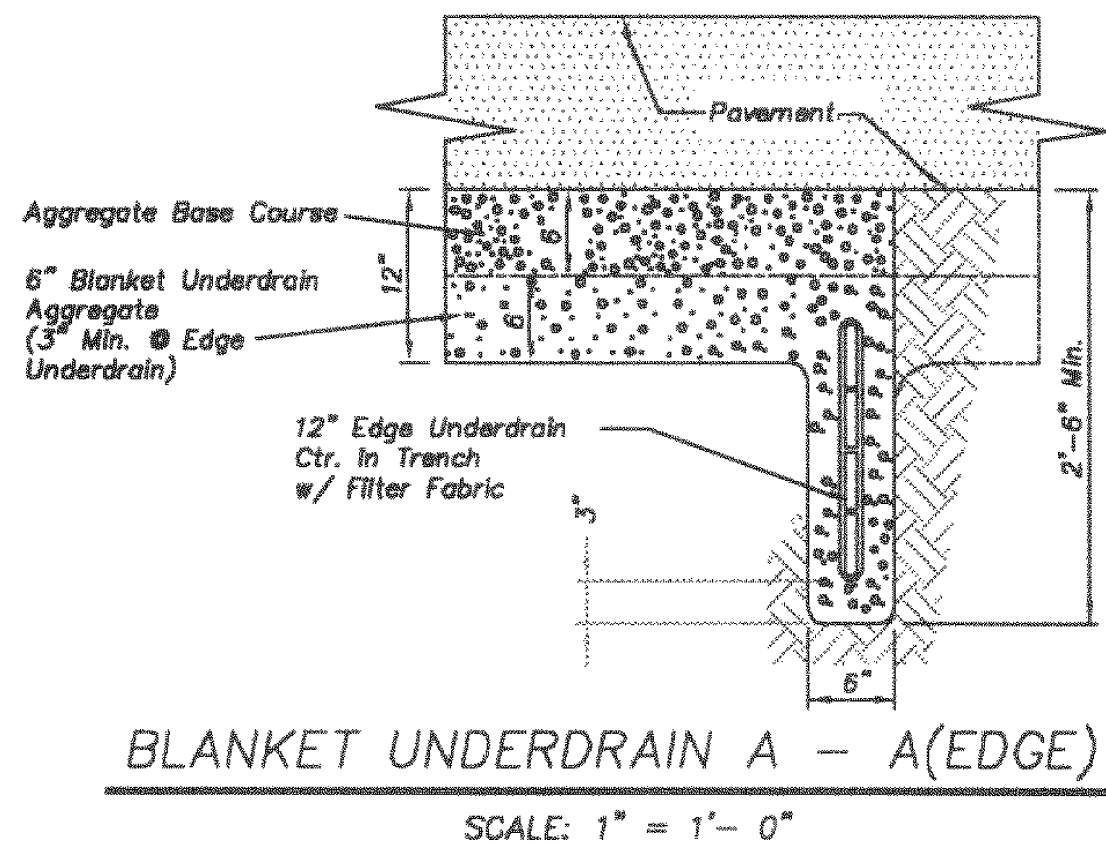

Underdrain Notes:

1. All roadway excavation in rock will be undercut no less than 15" for the full width of the roadway as shown.
2. In areas where underdrains are not required, undercut and overbreakage in limestone and shale shall be brought to within 6" of the subgrade line with properly compacted crushed stone, shot rock, and/or rock rubble. The remaining 6" shall conform to Standard Specifications Section 2202.
3. Layers of earth or shale shall not be permitted for backfill up to the bottom of the crushed stone.
4. A minimum of 12" of select soil (topsoil) shall be placed on exposed rock cut or fill slopes outside the limits of the roadway. All rock and shale slopes shall be benched @ maximum 2' vertical intervals prior to placement of select soil.
5. Proposed underdrain pipe layout, flowline elevations, inlet connection points, and details shall be approved prior to construction by the City Engineer.
6. Where pipe underdrains are used, all underdrain outlet pipes shall be solid wall with watertight joints. All outlet pipes shall be tied into the nearest storm sewer inlet as approved. Where edge underdrains are used, all underdrain outlet pipes shall be solid wall with manufacturer joints approved by the City Engineer. All connections between pipes and edge connectors or curb inlets shall be made with 2' minimum length of pipe.
7. All underdrain pipes shall be installed at a minimum slope of 1%. Underdrain pipe shall be installed with the perforations placed down.
8. Blanket underdrains shall be placed on bedrock unless otherwise directed by the City Engineer. Undercut and overbreakage in limestone and shale shall be brought to within 12" of the subgrade line with properly compacted crushed stone, shot rock and/or rock rubble.
9. All filter fabric used for pipe underdrain construction shall conform to Standard Specifications Section 2203.6.
10. The Contractor may, at his option, use either pipe underdrain or edge underdrain, but shall not mix underdrain types within any underdrain system.
11. All edge underdrain shall be held in the center of the trench by mechanical methods while placing granular backfill. See detail this sheet. Alternate methods may be used with prior approval by the City Engineer.
12. Blanket underdrain aggregate, pipe underdrain aggregate, pipe underdrain, edge underdrain and outlet pipe shall conform to Standard Specifications Section 2203.6.

AMERICAN PUBLIC WORKS ASSOCIATION

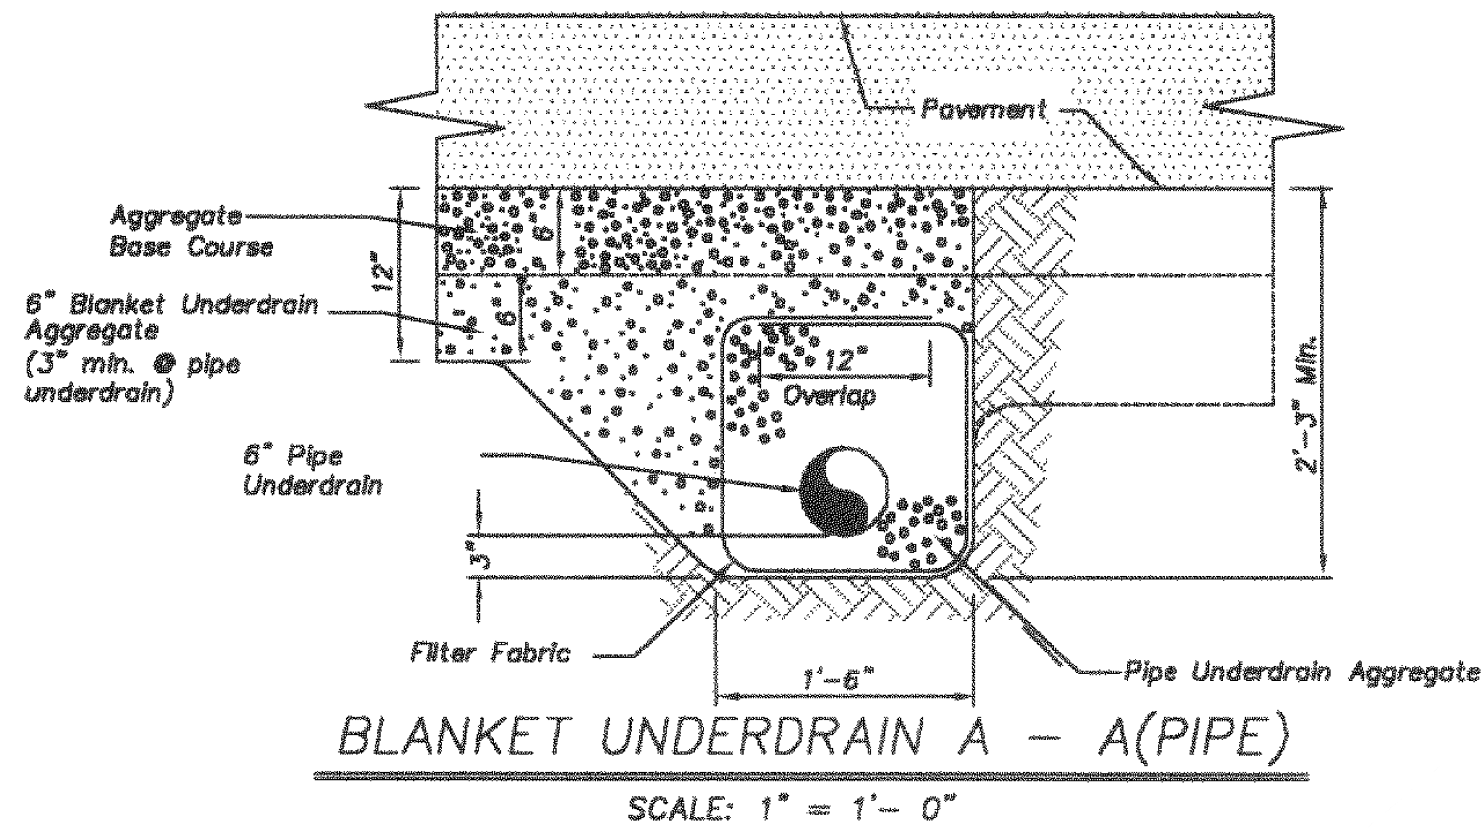

KANSAS CITY
METROPOLITAN CHAPTER

UNDERDRAIN DETAILS

STANDARD DRAWING
UD-1

ADOPTED:
MAY 23, 2001

WHISPERING WOODS
LEE'S SUMMIT, JACKSON COUNTY, MO
STREET & STORM SEWER PLANS
UNDERDRAIN DETAILS

DESIGNED
BLG
DRAWN
BLG
SCALE
Noted
DATE
09-01-2017
JOB NO.
04078
SHEET

39 OF 40

REVISION

BRIAN L. GLENN
REGISTERED PROFESSIONAL ENGINEER
STATE OF MISSOURI
NO. 2010011667
EXPIRATION DATE 08-10-2018

PHOENIX ENGINEERING
& SURVEYING, LLC
3833 S. NORTHERN BLVD.
INDEPENDENCE, MO 64602
(816) 743-9000 FAX: (816) 743-9700
ENGINEERING CERTIFICATE NO: MO E-2000151302-D
SURVEYING CERTIFICATE NO: MO LS-2000151303-D

THE SEAL(S) AND SIGNATURE(S) APPLY ONLY TO THE DOCUMENT TO WHICH THEY ARE AFFIXED. ANY OTHER SEAL(S) OR SIGNATURE(S) ARE THE PROPERTY OF THE ENGINEER OR SURVEYOR AND EXPRESSLY DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS, ESTIMATES, REPORTS, OR OTHER DOCUMENTS OR INSTRUMENTS RELATING TO OR INTENDED TO BE USED FOR ANY PART OR PARTS OF THE ENGINEERING OR SURVEYING PROJECT.