September 19, 2018

Missouri Department of Natural Resources Public Drinking Water Branch P.O. Box 176 Jefferson City, MO 65102-0176

Re: Creekside at Raintree, Lee's Summit, MO1010459, Review No. 1000046-17 Statement of Work Completed, As-Builts LandRock Development, L.L.C.

Dear Mr. Jaafari,


Please find enclosed the following to support the closeout of the Creekside at Raintree Water Line Extension Permit:

- Statement of Work Completed form, sealed, signed, and dated.
- One (1) hard copy and one (1) CD containing as-built PDF's of the water line extension.

Please contact me at (816) 347-1136 or <u>William.Neds@hdrinc.com</u> should you have any questions. Sincerely,

William Neds
Engineer in Training


Cc: John Roberts, LandRock Development, LLC



STATEMENT OF WORK COMPLETED

Public Water Supply Name: City of Lee's Summit, MO, Jackson County
PWS ID No.: MO
Project Description: Creekside at Raintree- 1,556 If of 8" main
The undersigned certifies based on periodic observations of construction and upon reports submitted by others, the herein described waterworks authorized by Construction Permit Number (Plan Review Number) 1000046-17, have been, to the best of my knowledge and belief, completed substantially in accordance with plans and specifications approved by the Missouri Department of Natural Resources.
Document all changes or significant deviations and date approved by the Department of Natural Resources: (use additional sheets if necessary).
SIMON SUN SUN PE-2017037511
Engineers Seal, Signature and Date
Engineer: Simon Sun
Firm: HDR, Inc.
Address: 3741 NE Troon Drive
or Water Santana
Water System Official:

Return Completed Form to the Department of Natural Resources, Public Drinking Water Branch, P.O. Box 176, Jefferson City, MO 65102 Immediately Upon Completion of Work.

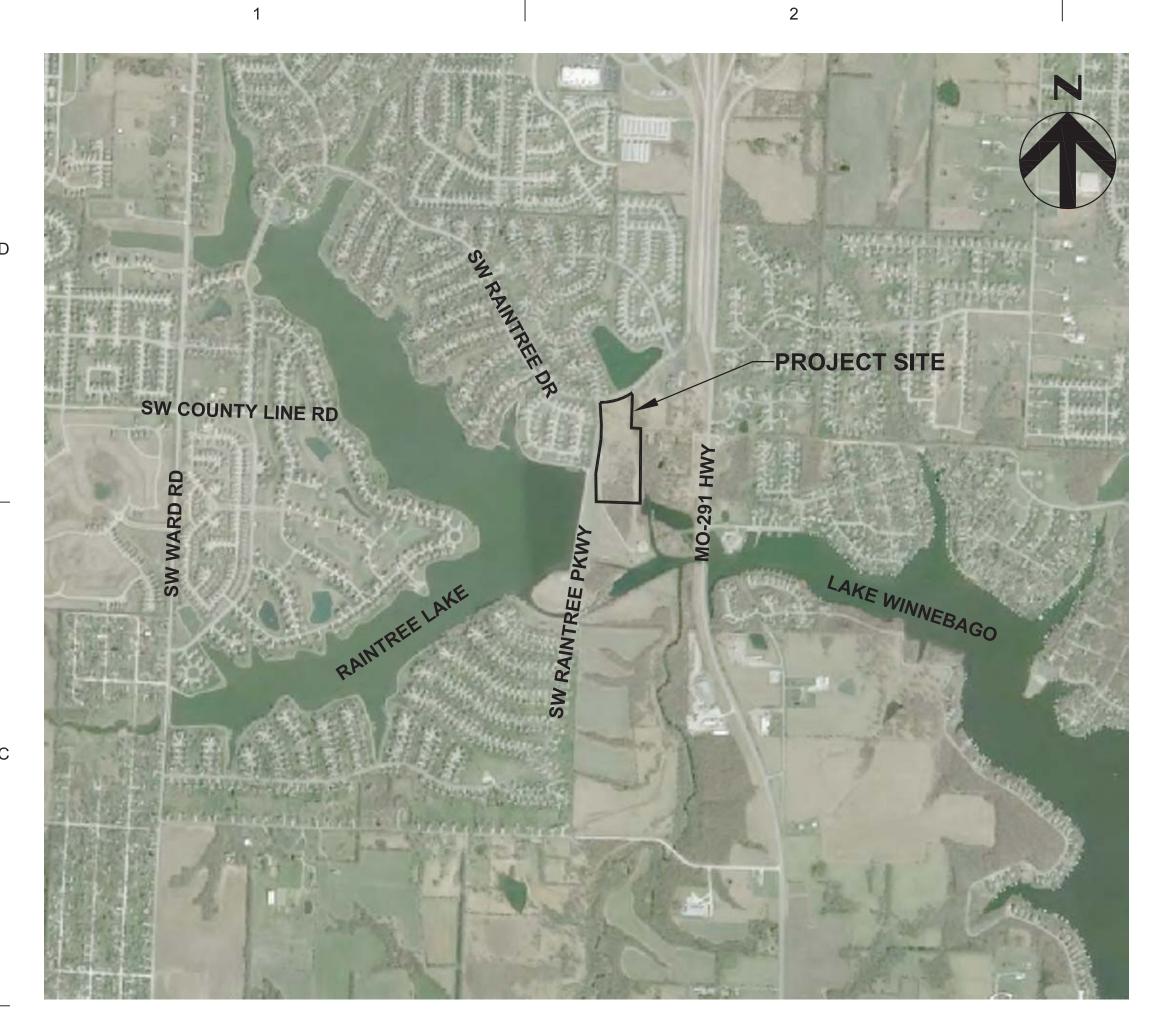

Permit Review Drawings For

CREEKSIDE AT RAINTREE LOTS 1 THRU 31 AND TRACTS A THRU F

WATER MAIN PLANS

IN THE CITY OF LEE'S SUMMIT JACKSON & CASS COUNTY, MISSOURI

SECTION 31, TOWNSHIP 47 N, RANGE 31 W SECTION 32, TOWNSHIP 47 N, RANGE 31 W SECTION 5, TOWNSHIP 46 N, RANGE 31 W

HDR Project No. 10028402-276408 Lee's Summit, MO February 2017

PLAN SHEET INDEX

01C-CR-WA-00 COVER SHEET

01C-CR-WA-01 GENERAL LAYOUT AND NOTES

01C-CR-WA-02 WATER MAIN PLAN & PROFILE LINE 1-1 AND 1-2

01C-CR-WA-03 WATER MAIN PLAN & PROFILE LINE 1-2

01C-CR-WA-04 WATER MAIN DETAILS

01C-CR-WA-05 WATER MAIN DETAILS

3741 NE TROON DR LEE'S SUMMIT, MO 6406 816.347.1100

MO STATE CERTIFICATE OF AUTHORITY #000856

PROJECT FOR

LANDROCK DEVELOPMENT, LLC

CREEKSIDE AT RAINTREE LOTS 1 THRU 31 LEE'S SUMMIT, MISSOURI

B 04/14/2017 CITY RESUBMITTAL
A 03/08/2017 CITY SUBMITTAL
MARK DATE DESCRIPTION

PROJECT NUMBER 10028825-276408
ORIGINAL ISSUE MARCH 7, 2017

PROJECT MANAGER SIMON SUN
PROJECT ENGINEER WILL NEDS, E.I.T.



SHEET NAME

COVER SHEET

SCALE

NO SCALE

SHEET NUMBER

01C-CR-WA-00

FILE NAME 01C-CR-WA-00.dwg

PERMIT REVIEW DRAWINGS

OWNER CONTACT

J.P. Roberts
Landrock Development, LLC
4335 McGee St
Kansas City, MO 64111
jp@landrocksignaturehomes.com
(816) 863-5588

CONSULTANT CONTACT

Simon Sun
HDR Engineering, Inc.
4435 Main St, Suite 1000
Kansas City, MO 64111
simon.sun@hdrinc.com
(816) 360-2765


UTILITIES


ELECTRIC: KCP&L 816-471-5275 GAS: LACLEDE GAS, MISSOURI GAS ENERGY DIVISION 816-756-5252 TELEPHONE: AT&T 816-325-5607 CABLE: TIME WARNER 816-358-8833 816-969-1900 WATER: LEE'S SUMMIT WATER UTILITIES SEWER: LEE'S SUMMIT PUBLIC WORKS 816-969-1800 INTERCEPTOR SEWER: LITTLE BLUE 816-796-7660 VALLEY SEWER DISTRICT





UTILITY NOTES:


VISUAL INDICATIONS OF UTILITIES ARE AS SHOWN. UNDERGROUND LOCATIONS SHOWN, AS FURNISHED BY THEIR LESSORS, ARE APPROXIMATE AND SHOULD BE VERIFIED IN THE FIELD AT THE TIME OF CONSTRUCTION. FOR ACTUAL FIELD LOCATIONS OF UNDERGROUND UTILITIES IN MISSOURI, CALL 1-800-344-7483.

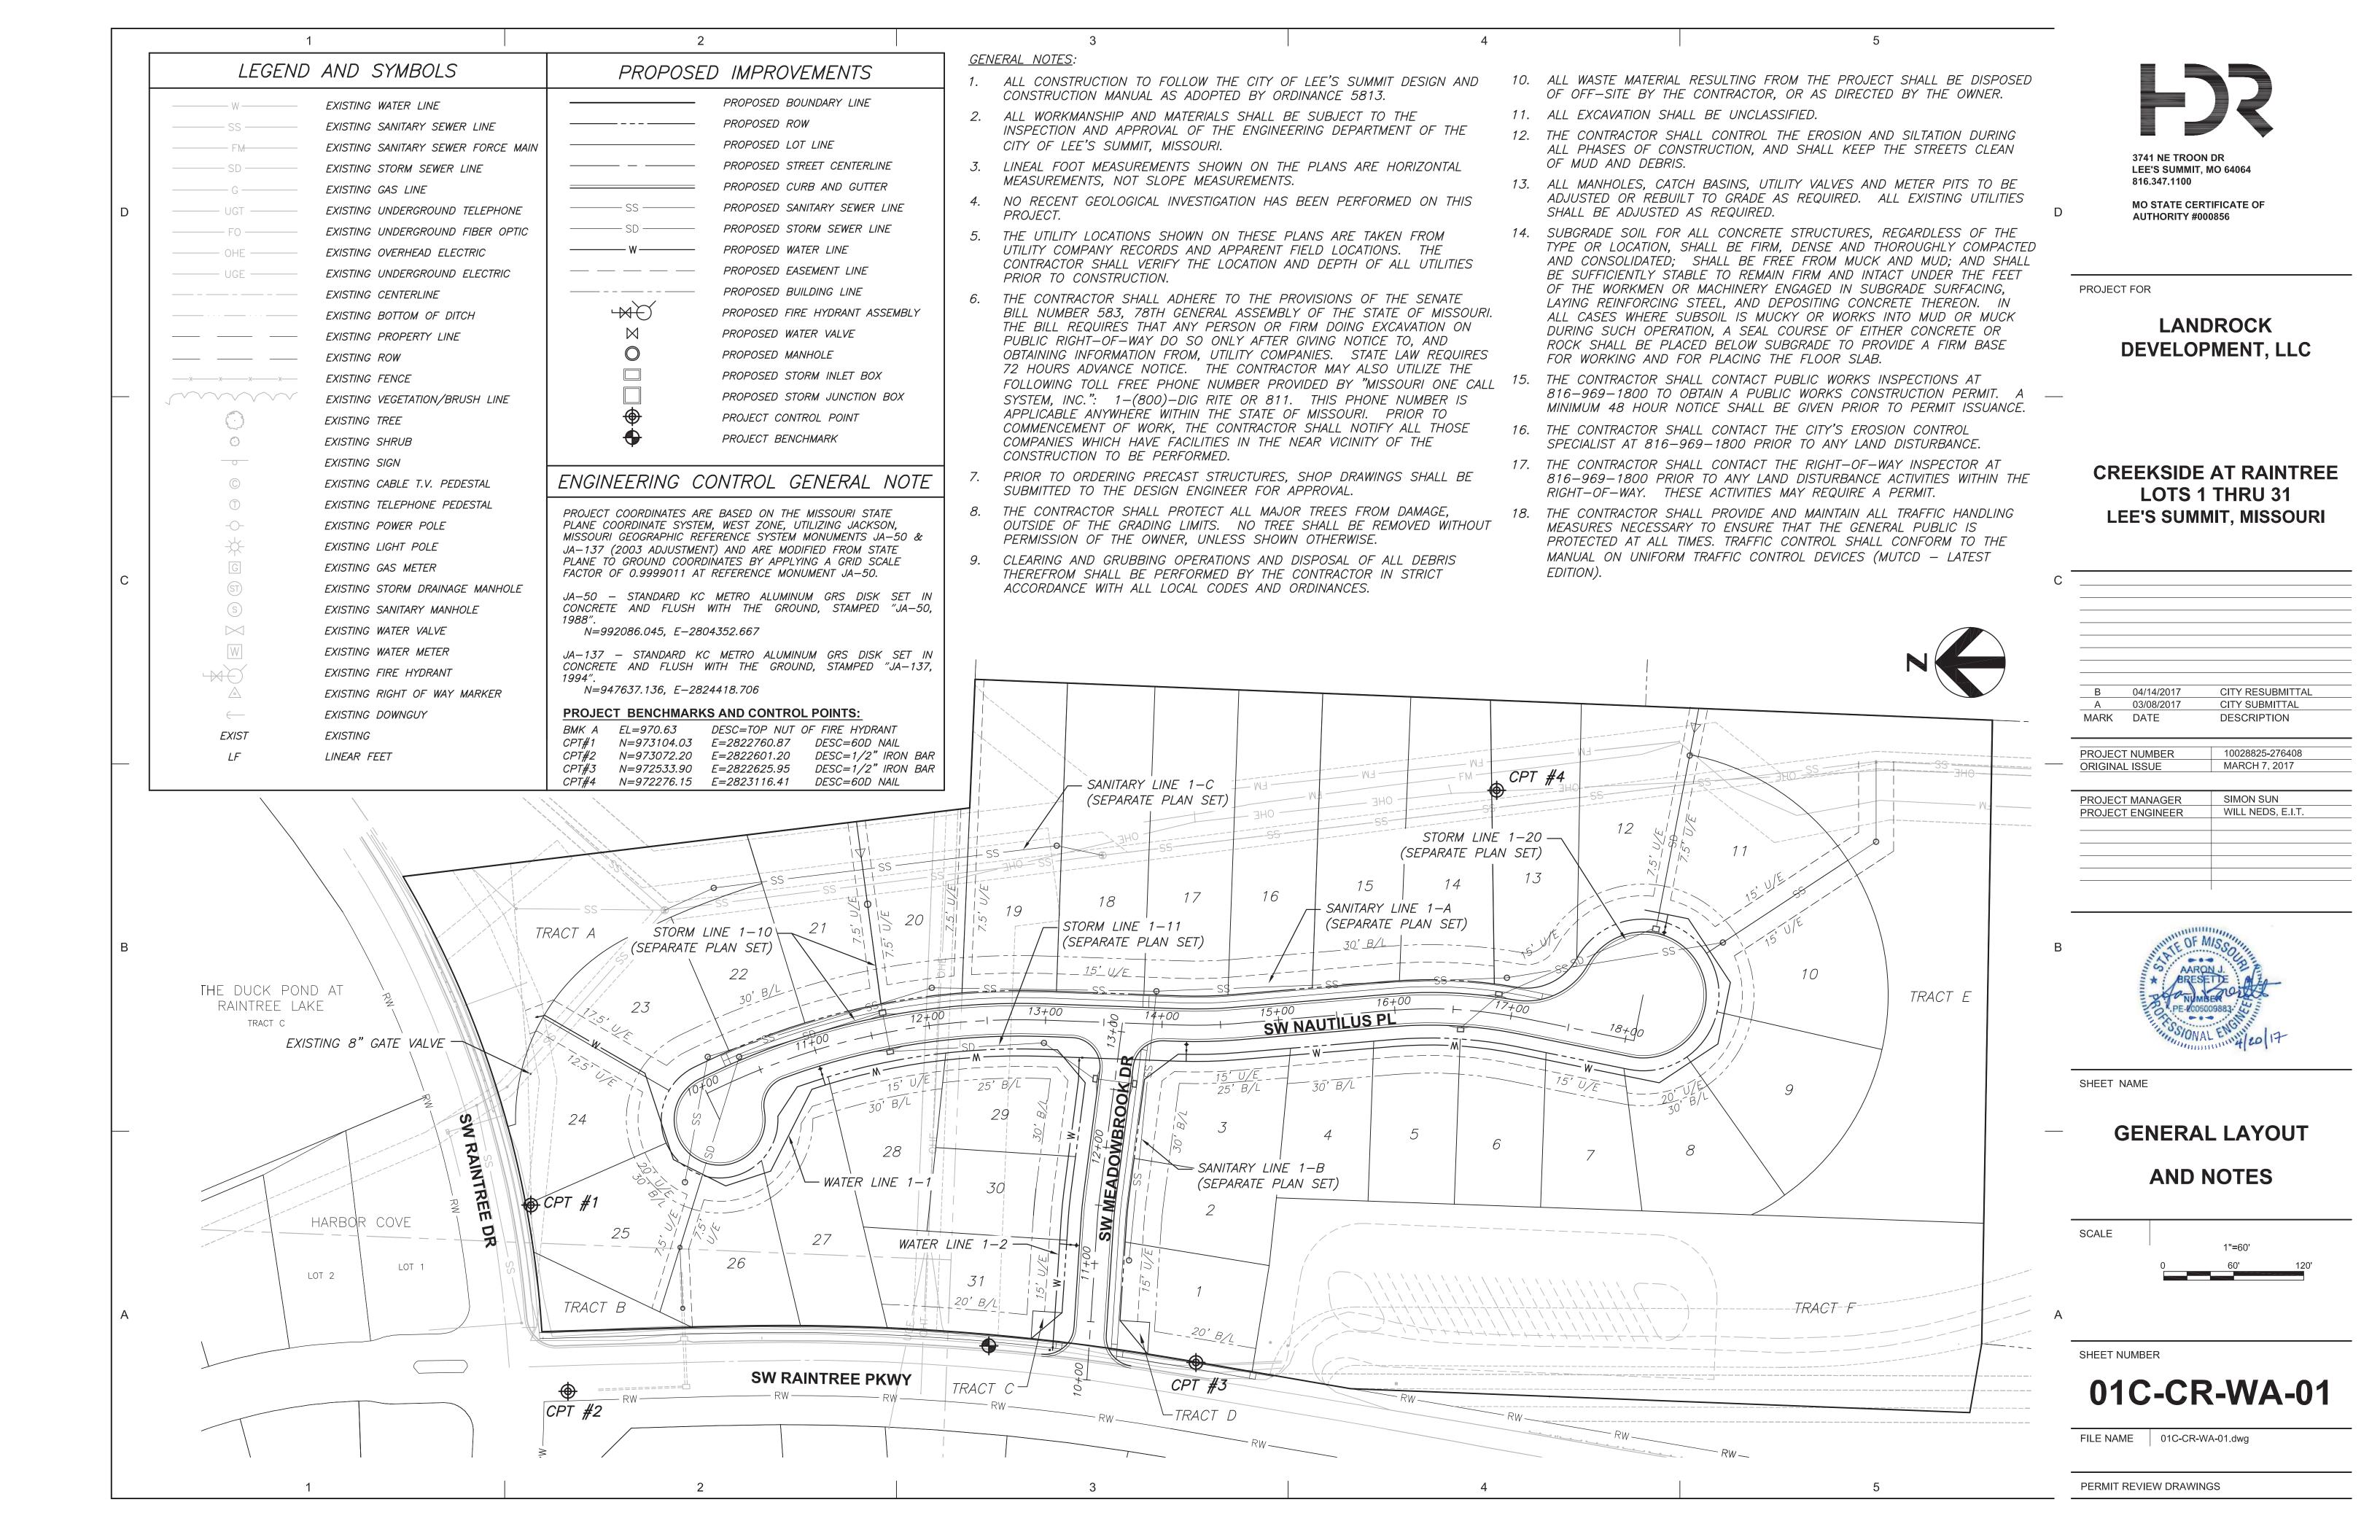

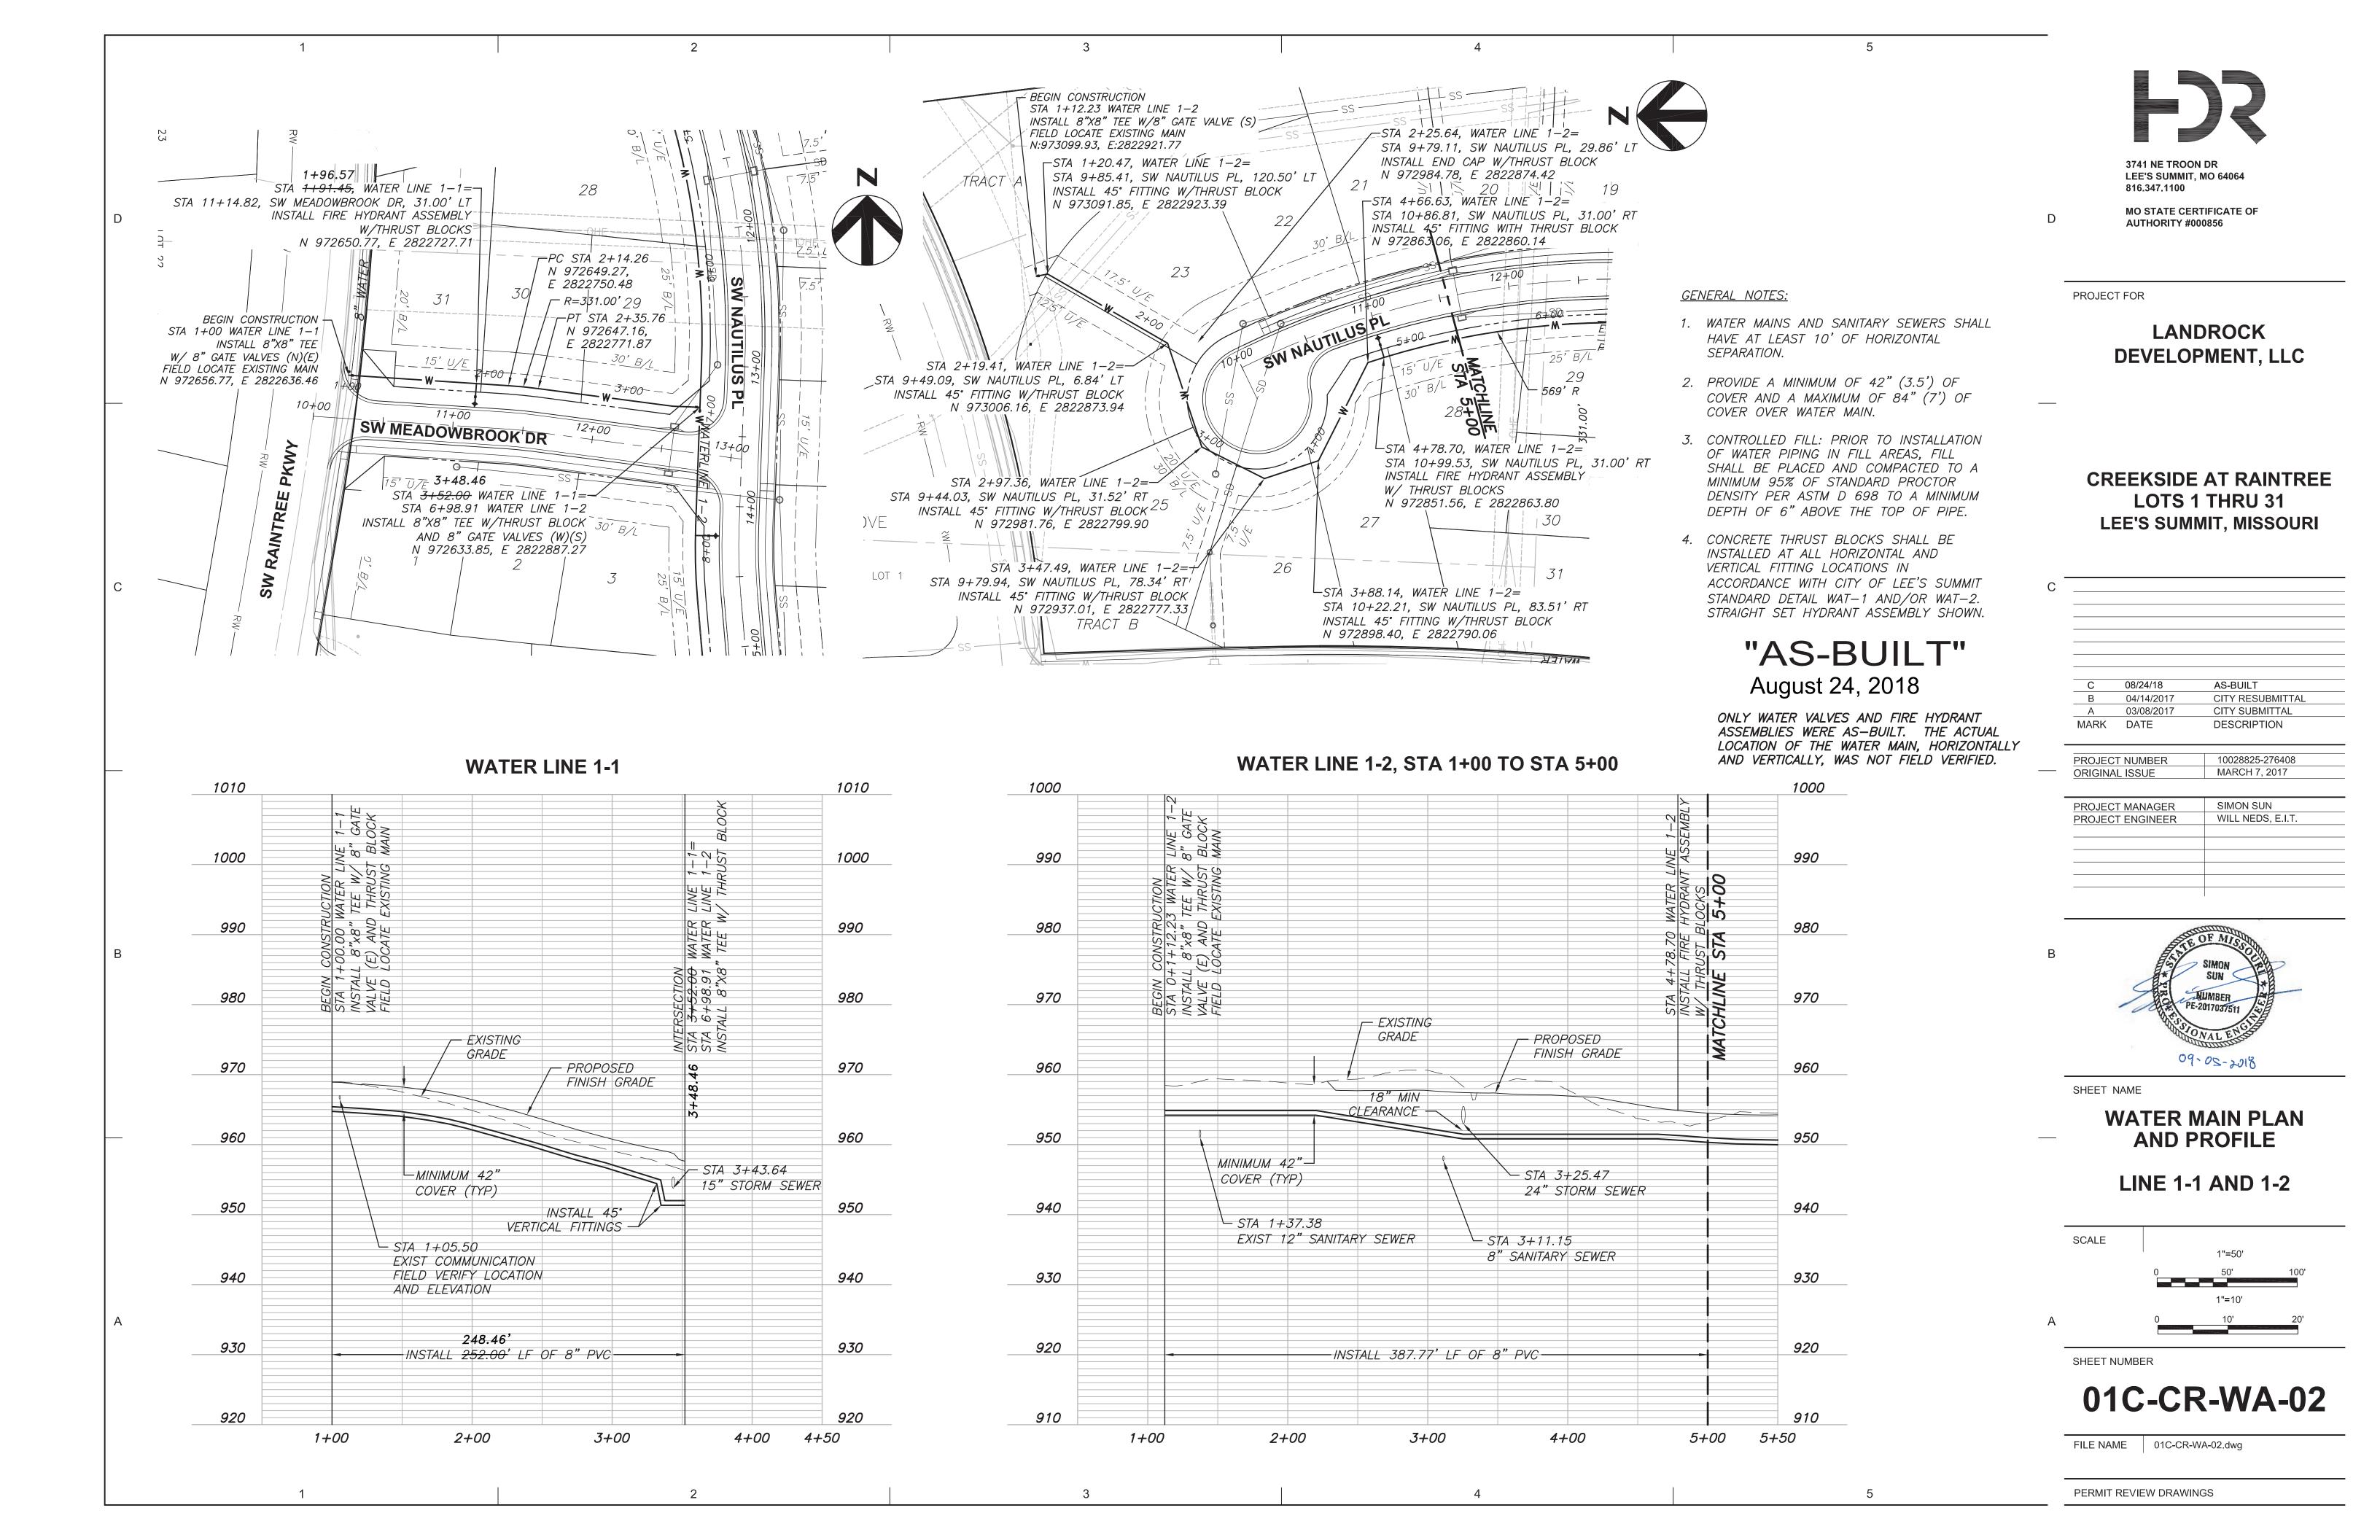


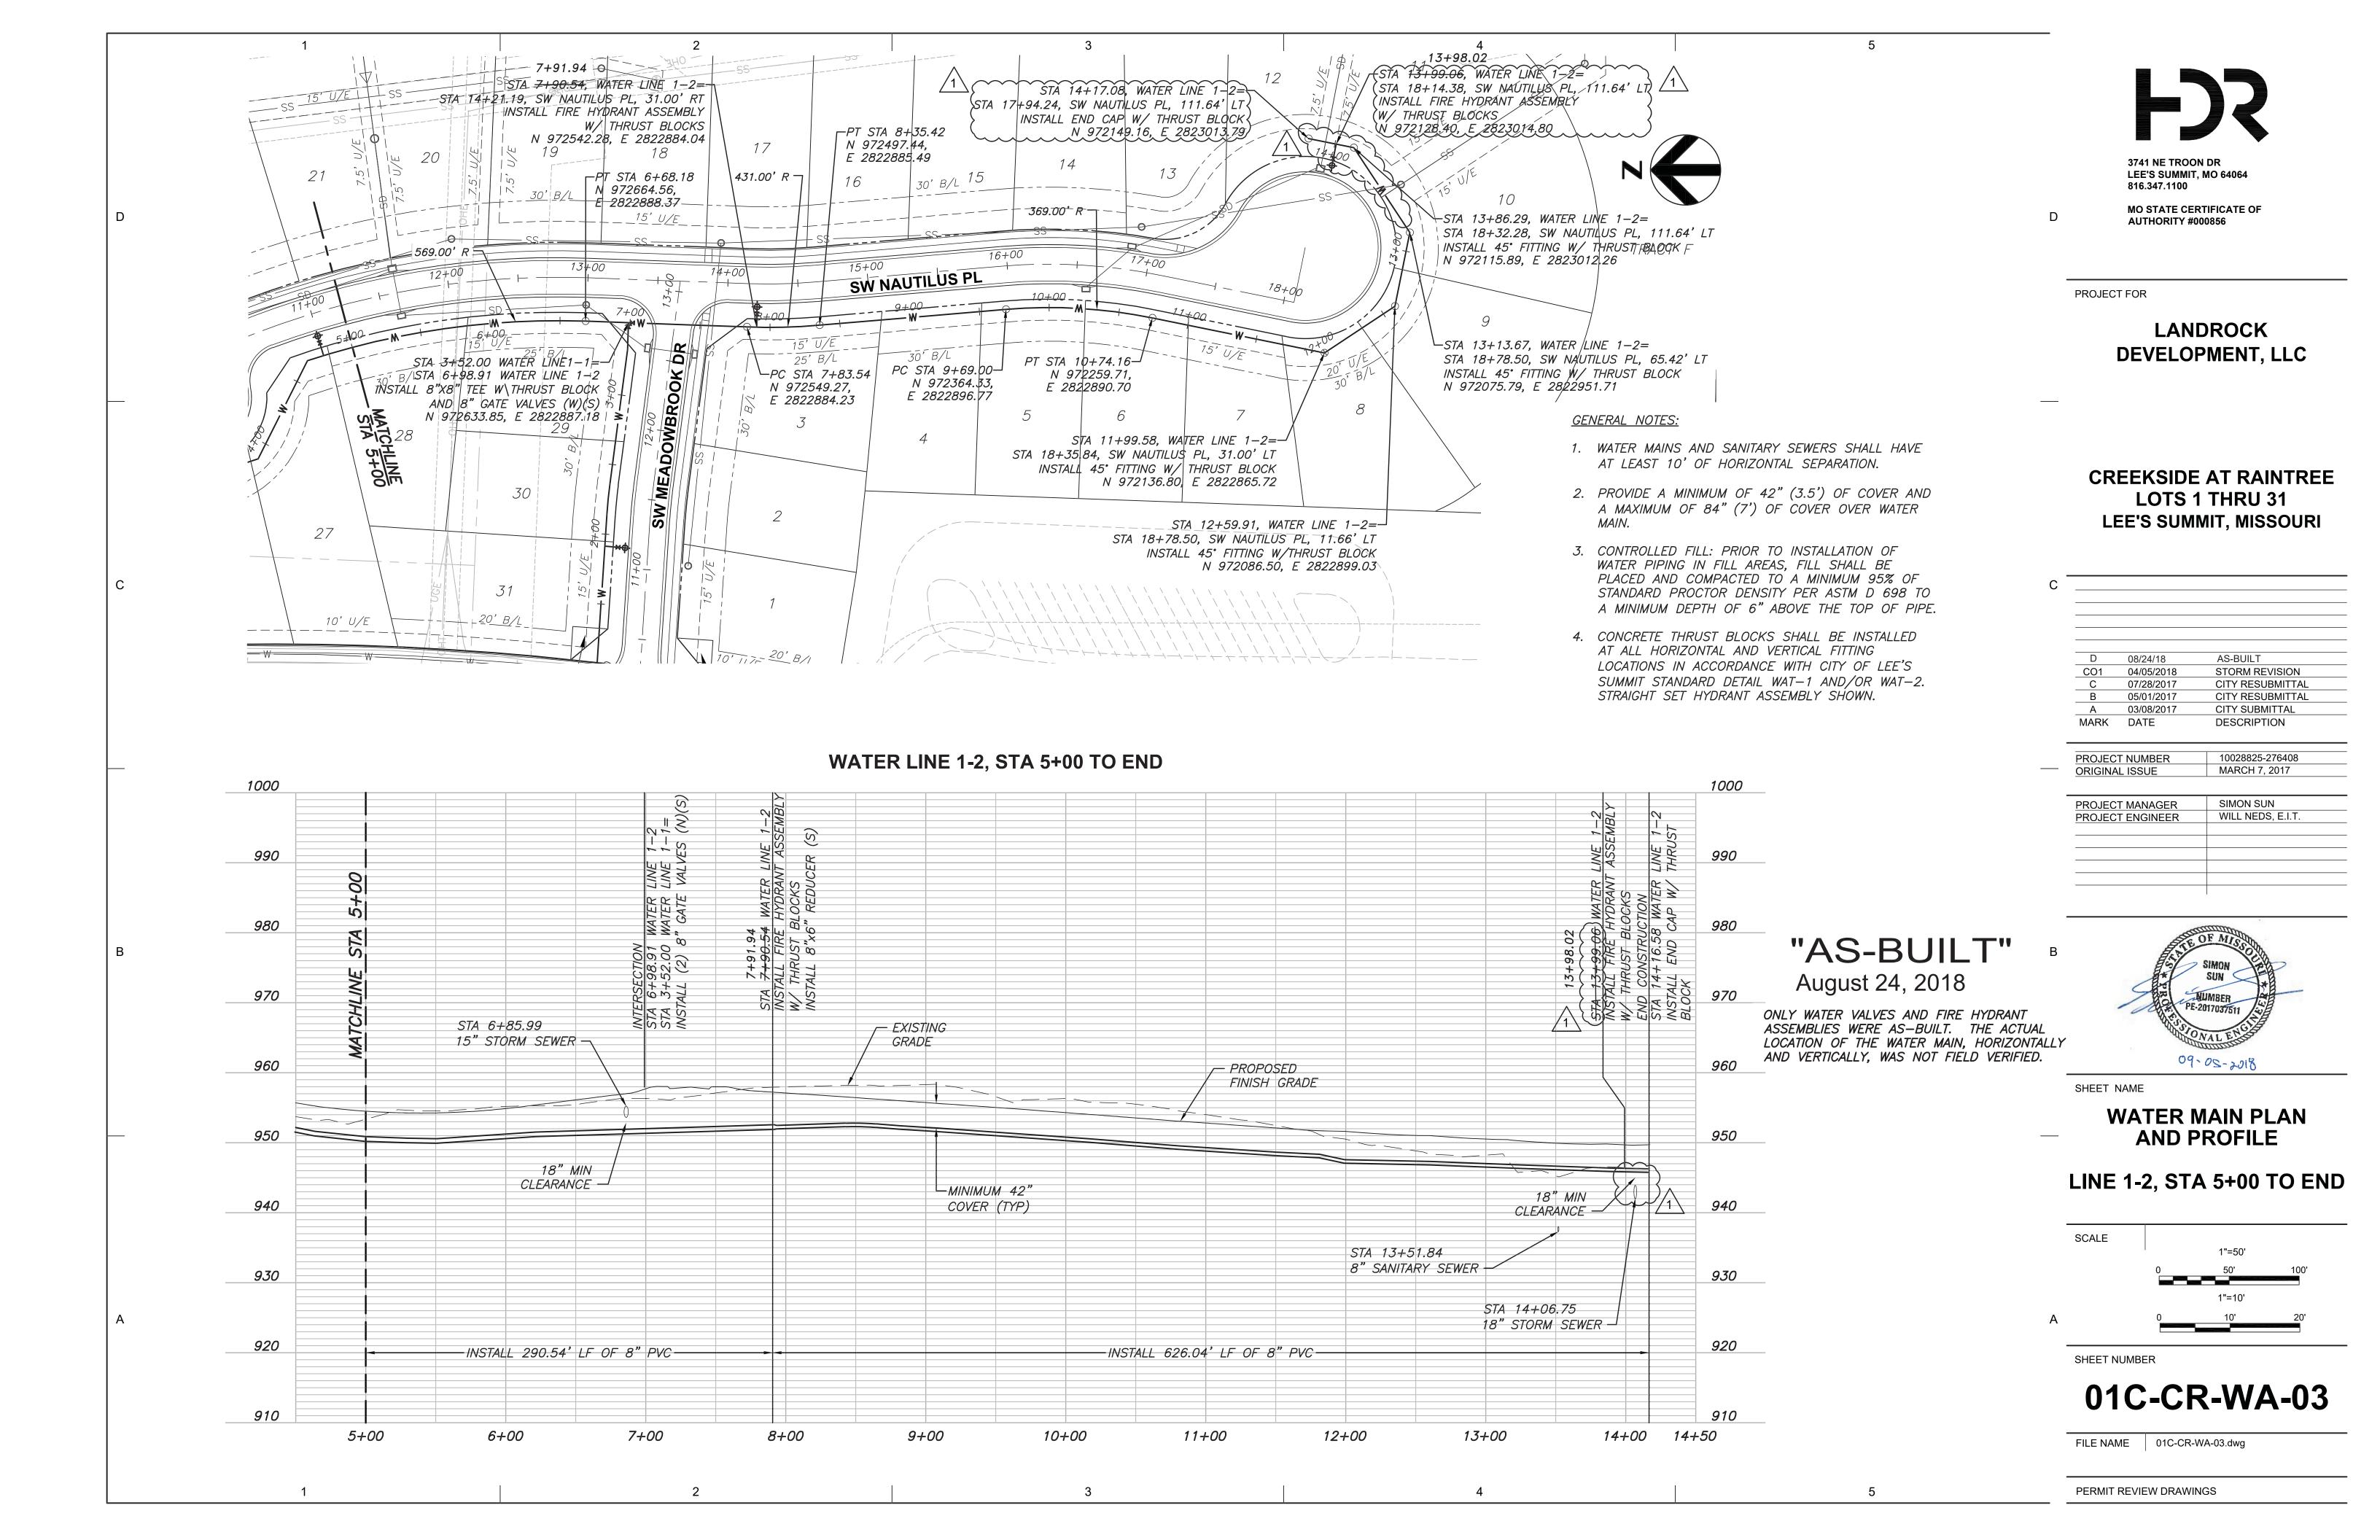

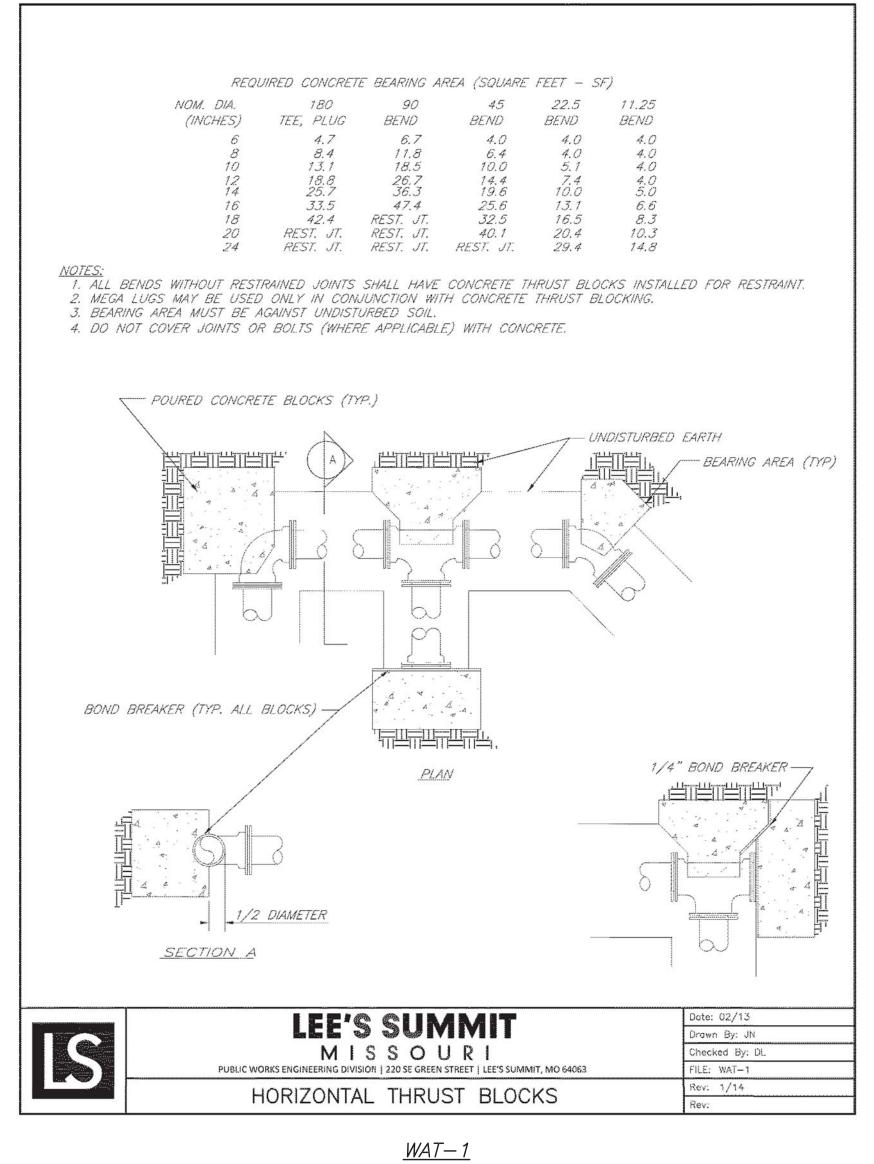

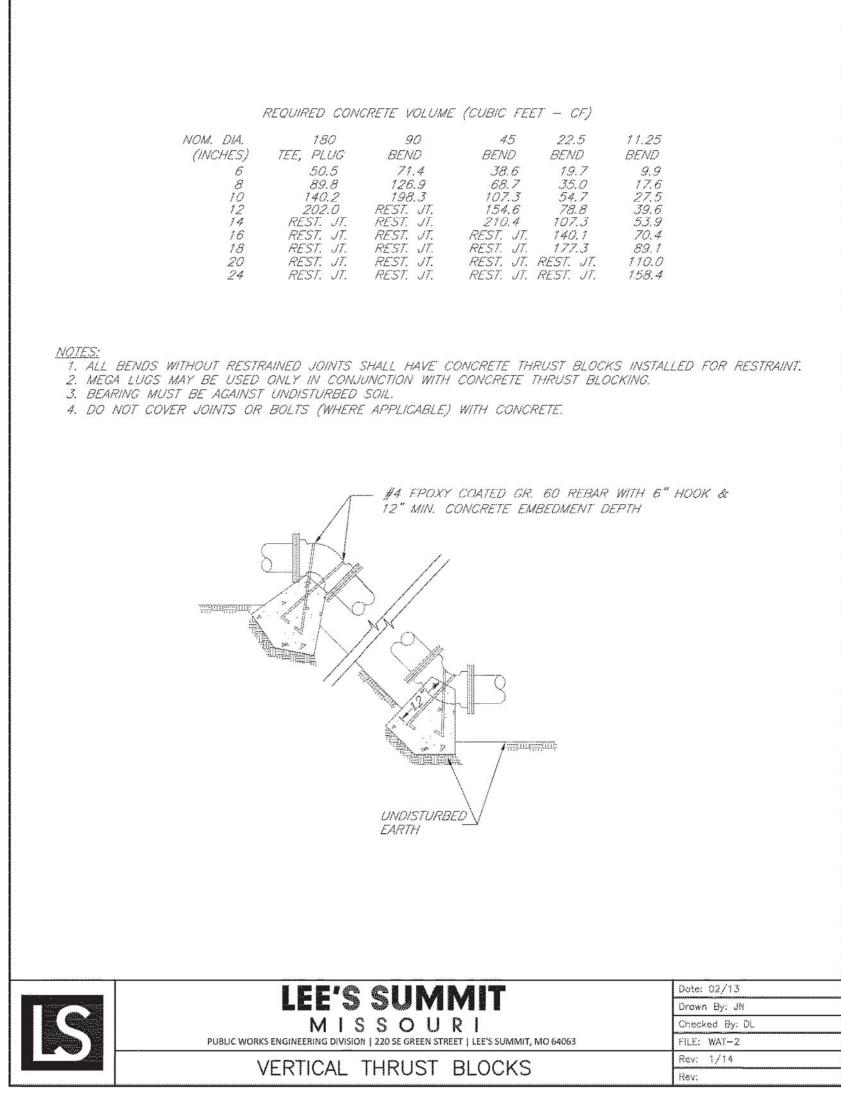

<u>WAT-2</u>

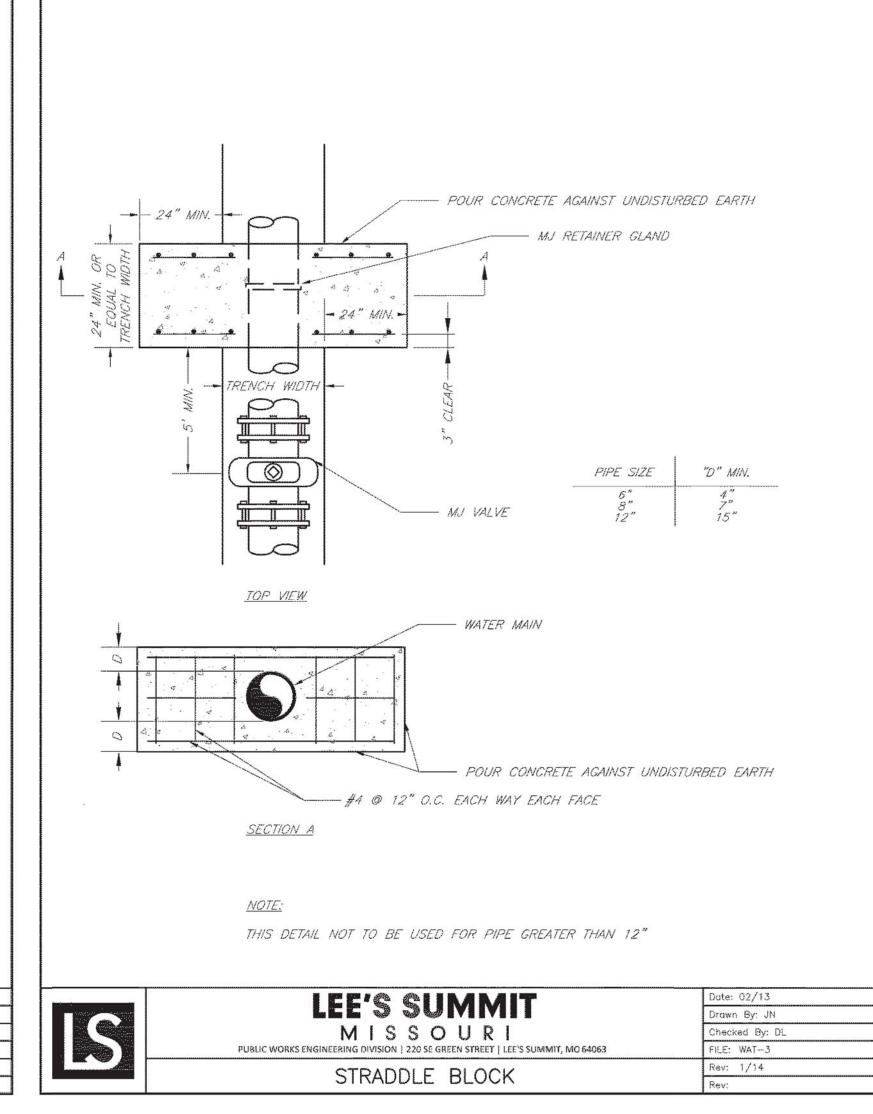

<u>WAT-3</u>

3741 NE TROON DR LEE'S SUMMIT, MO 64064

AUTHORITY #000856

MO STATE CERTIFICATE OF

LANDROCK

DEVELOPMENT, LLC

CREEKSIDE AT RAINTREE

LOTS 1 THRU 31

LEE'S SUMMIT, MISSOURI

CITY RESUBMITTAL

10028825-276408

MARCH 7, 2017

SIMON SUN

WILL NEDS, E.I.T.

CITY SUBMITTAL

DESCRIPTION

816.347.1100

PROJECT FOR

SHEET NAME

MARK

PROJECT NUMBER

PROJECT MANAGER

PROJECT ENGINEER

ORIGINAL ISSUE

WATER MAIN DETAILS

SCALE

NO SCALE

SHEET NUMBER

01C-CR-WA-04

FILE NAME 01C-CR-WA-04.dwg



MINIMUM TRENCH WIDTHS AND PIPE CLEARANCES (IN) PIPE BOTTOM PIPE SIDE CLEARANCE CLEARANCE NOMINAL PIPE TRENCH (SOIL/ROCK) (SOIL/ROCK) DIAMETER WIDTH 22 6/6 6/6 22 6/6 6/6 8 10 24 6/6 6/6

6/6

12 27 NOTES: 1. BACKFILL SHALL BE IN ACCORDANCE WITH SECTION 2100 OF THE KCMETRO APWA

2. BEDDING MATERIAL SHALL BE 1/2" TO 3/4" CLEAN CRUSHED ROCK.

3. TRENCH BANKS SHALL BE CUT BACK ON SLOPES IN ACCORDANCE WITH CURRENT OSHA REGULATIONS. SLOPES MUST NOT EXTEND BELOW 6. MAXIMUM TRENCH WIDTH SHALL NOT EXCEED TOP OF BEDDING.

C900. 5. ALL WATER LINES SHALL HORIZONTALLY CLEAR STORM SEWER STRUCTURES BY 5' AND SANITARY

4. ALL PUBLIC WATER MAINS SHALL BE 6" PVC,

6/6

SEWER STRUCTURES BY 10'. WATER MAINS SHALL VERTICALLY CLEAR STORM SEWER STRUCTURES AND SANITARY SEWER STRUCTURES BY 18".

MANUFACTURER'S RECOMMENDATIONS. MAXIMUM TRENCH WIDTH IS DEFINED AS THE HORIZONTAL PLANE MEASURED 6" ABOVE THE TOP OF PIPE, PERPENDICULAR TO THE WATER ALIGNMENT.

UNDERGROUND PIPE INSTALLATION FOR WATER MAIN LINES NOT TO SCALE

SPECIFICATIONS.

SEE TABLE

6" MIN. IN SOIL

TYP PIPE ENVELOPE (PVC)

SEE TABLE FOR ROCK

TRENCH BOTTOM-

—1/2" TO 3/4"

CLEAN CRUSHED

PERMIT REVIEW DRAWINGS

3741 NE TROON DR LEE'S SUMMIT, MO 64064 816.347.1100 MO STATE CERTIFICATE OF **AUTHORITY #000856**

PROJECT FOR

VALVE COVER

— FINAL GRADE

CUT A NOTCH IN TOP OF VALVE

BOX AND PLACE 2' OF TRACER WIRE COILED

STANDARD 2" SQUARE VALVE OPERATING NUT

WELD (TYP. 8 PLACES)

ALIGNMENT WASHER 1/8" MIN. STEEL 4-1/2"0

— 1°Ø COLD ROLLED STEEL

SOCKET FROM 1/4" STEEL INSIDE

DIMENSIONS 2-3/16" X 3" DEEP DO NOT TIGHTEN SET SCREW TO 2"

OUTSIDE SURFACE OF VALVE BOX

Drawn By: JN

FILE: WAT-9

Rev: 1/14

Checked By: DL

- INSTALL TRACER WIRE ALONG

MIN. 5"0 FERROUS

METAL VALVE BOX

OPERATING NUT

LEE'S SUMMIT

MISSOURI

VALVE STEM EXTENSION AND VALVE BOX

<u>WAT-9</u>

INSIDE VALVE COVER BOX

LANDROCK

DEVELOPMENT, LLC

CREEKSIDE AT RAINTREE LOTS 1 THRU 31 LEE'S SUMMIT, MISSOURI

CITY RESUBMITTAL 04/14/2017 CITY SUBMITTAL

MARK DATE DESCRIPTION 10028825-276408 PROJECT NUMBER MARCH 7, 2017 ORIGINAL ISSUE

PROJECT MANAGER SIMON SUN WILL NEDS, E.I.T. PROJECT ENGINEER

SHEET NAME

WATER MAIN

NO SCALE

DETAILS


SCALE

SHEET NUMBER

01C-CR-WA-05

FILE NAME 01C-CR-WA-05.dwg

PERMIT REVIEW DRAWINGS

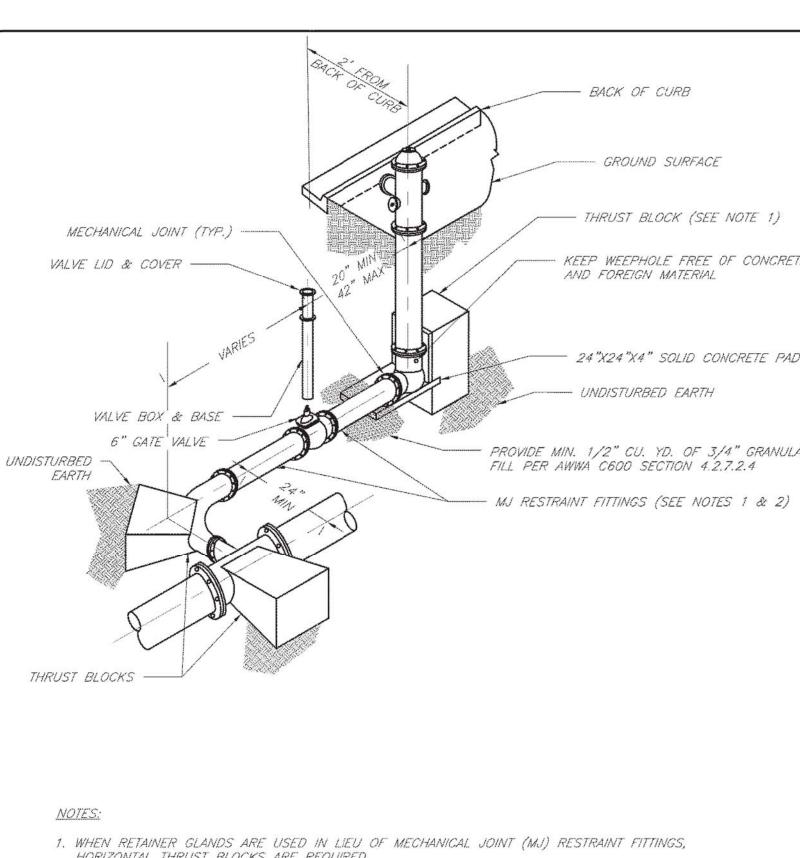



- KEEP WEEPHOLE FREE OF CONCRETE AND FOREIGN MATERIAL - 24"X24"X4" SOLID CONCRETE PAD - PROVIDE MIN. 1/2" CU. YD. OF 3/4" GRANULAR FILL PER AWWA C600 SECTION 4.2.7.2.4 UNDISTURBED -EARTH HORIZONTAL THRUST BLOCKS ARE REQUIRED.

2. GATE VALVE MAY BE BOLTED DIRECTLY TO MJ RESTRAINT TEE.

3. SEE APPROVED PRODUCTS LIST FOR WATER UTILITIES FOR FIRE HYDRANT, VALVES, VALVE BOX LID, 4. BOTTOM HYDRANT FLANGE SHALL BE 2" TO 6" ABOVE FINISHED GRADE. 5. FOR STREETS WITHOUT CURBS FIRE HYDRANTS SHALL BE PLACED WITHIN 1 FOOT OF THE R/W LINE, BUT NOT MORE THAN 10' FROM EDGE OF PAVEMENT. FIRE HYDRANT SHALL NOT BE PLACED IN 6. HYDRANT SHALL BE ROTATED AS DIRECTED BY INSPECTOR.

Date: 02/13

Drawn By: JN

FILE: WAT-4

Rev: 1/14

Checked By: DL

- LENGTH AS SHOWN ON PLANS ----

1. INTERMEDIATE BELLS SHALL BE ENCASED.

--- CONCRETE ENCASEMENT ---

2. REINFORCING STEEL SHALL BE #4 @ 12" O.C. EACH WAY WITH A MINIMUM REBAR LAP OF 12".

LEE'S SUMMIT

MISSOURI

WATER PIPE ENCASEMENT

<u>WAT-4</u>

<u>WAT-8</u>