PRELIMINARY STORMWATER DRAINAGE STUDY FOR LEE'S SUMMIT SENIOR LIVING COMMUNITY

SE Oldham Parkway Lee Summit, Missouri

South Prairie Lee Watershed

Prepared for:

Lee's Summit Senior Community, LLC 5051 S. National Avenue, Ste. 4-110 Springfield, Missouri Phone: 417-893-6006



Original Report Date: January 2019 2nd Submittal: February 19, 2019

Prepared By: Trevor Drake
Reviewed By: Ryan Jeppson, P.E.
Olsson, Inc.
550 St. Louis St.
Springfield, MO 65806

Missouri Engineering Certificate of Authority #001592



TABLE OF CONTENTS

1.	General Information	1
2.	Methodology	2
3.	Existing Conditions Analysis	3
4.	Proposed Conditions Analysis	4
5.	Conclusions & Recommendations	7
LI	IST OF FIGURES	
Fiç	gure 1. EXISITING CONDITION DRAINAGE AREA MAP	8
Fig	gure 2. PROPOSED CONDITION DRAINAGE AREA MAP	9
LI	IST OF TABLES	
Та	ble 1. SITE SOIL CLASSIFICATION	2
Та	ble 2. RAINFALL PRECIPITAION	2
Та	ble 3A. EXISTING CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #1	3
Та	ble 3B. EXISTING CONDITIONS ANALYSIS SUMMARY POINTOF INTEREST #2	4
Та	ble 4A. DEVELOPED CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #1	5
Та	ble 4B. DEVELOPED CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #2	5
Та	ble 5A. DRY DETENTION SUMMARY	5
Та	ble 5B. BIODETENTION #1 SUMMARY	6
Та	ble 5C. BIODETENTION #2 SUMMARY	6
Та	ble 6A. POINT OF INTEREST #1 SUMMARY	6
Та	ble 6B. POINT OF INTEREST #2 SUMMARY	6

018-1450

January 2019

APF	PENI	DICES
------------	------	-------

APPENDIX A:	Hydrology & Detention Calculations
APPENDIX B:	Water Quality Calculations
APPENDIX C:	APWA \ MARC BMP Level of Service Calculations

018-1450

1. GENERAL INFORMATION

The following stormwater report is for the Lee's Summit Senior Living Community located on the south side of Oldham Parkway approximately 0.4 miles east of Todd George Parkway. The proposed 157,515-sqft facility will be on a 10.45 acre± site that is currently vacant pasture land. In the existing condition the site generally flows from south to the north towards Oldham Parkway. A subtle ridge line splits the site into two sub-drainage areas. The western onsite drainage area discharges to the Oldham Parkway drainage swale at the northwest corner of the site (POI #1). The swale drains to a 5'x5' RCB culvert that flows north underneath the Oldham Parkway, US Route 50, and Blue Parkway to the E. Fork Little Blue River through an unnamed tributary. The eastern onsite drainage area intercepts offsite runoff from approximately 5-acres of agricultural land from the east. Runoff continues to flow north and northeast to an existing 30" RCP culvert (POI #2) that discharges north underneath Oldham Parkway, US Route 50, and Blue Parkway. Storm water continues north to an existing wet detention facility located south of Shenandoah Drive.

Stormwater runoff from the proposed Lee's Summit Senior Living Community will be collected and conveyed through onsite storm sewer, that is routed to proposed bioretention and extended dry detention facilities. These facilities will discharge the water in compliance with the City of Lee Summit's design standards to the existing outfall locations previously discussed.

According the FEMA Flood Map Service Center the site is in an area of minimal flood hazard, Zone X, per map #29095C049G dated 01/20/2017. Zone X is the FEMA flood insurance rate zone that corresponds to "areas of 0.2% annual chance flood; areas of 1% chance flood with average depths less than 1 foot or within drainage areas of less than 1 square mile; and areas protected by levees from 1% annual chance flood." The FEMA FIRMette has been included in Appendix A.

Per the National Wetlands Inventory, the site has no "blue line" streams or wetlands located on site.

018-1450 1

Soil data was taken from the USDA Natural Resources Conservation Service – Web Soil Survey of Jackson, County Missouri. The Web soil survey categorize soils on the proposed Lee's Summit Senior Living Community as:

TABLE 1. SITE SOIL CLASSIFICATION

Map Unit	Map Unit Name	Percent Slopes	Rating	Area in AOI (acres)	Percent of AOI
10000	Arisburg Silt Loam	1 to 5	С	15.9	85.9%
10082	Arisburg-Urban land complex	1 to 5	С	2.6	14.1%

^{*}see Web Soil Survey pdf located in Appendix A

2. METHODOLOGY

This Preliminary Stormwater Drainage Study has been prepared to evaluate the hydrologic impact generated by the development of the Lee's Summit Senior Living Community. The base data for models prepared for this report have been obtained through topographic surveys, online maps, and aerial imagery.

The following method was used to study and model existing and proposed conditions for stormwater runoff:

- TR-55 Unit Hydrograph Method
 - o 2-year, 10-year, 100-year Return Frequency Storms
 - 24-Hour SCS Type II Rainfall Distribution
 - SCS Runoff Curve Numbers Per SCS TR-55
 - SCS TR-55 Methods for determining Time of Concentration and Travel Time

Rainfall depth & duration data were taken from the National Oceanic and Atmospheric Administration (NOAA). A summary of the rainfall data used in the calculations are presented in Table 2.

TABLE 2. RAINFALL PRECIPITATION

Annual Exceedance Probability (AEP)	Rainfall Depth (inches)
1-year	3.71
10-year	5.66
100-year	9.25

^{*}Preliminary Hydraflow reports have been provided in Appendix A

018-1450

3. EXISTING CONDITIONS ANALYSIS

Existing conditions where modeled assuming pasture in good condition. This assumption was used to calculate existing condition flow rates and the level service required for proposed BMP implementation. Discharge from the proposed development will adhere to APWA and Lee's Summit discharge requirements. Refer to Figure 1 for existing condition sub-drainage area locations, runoff curve numbers, and sub-drainage area acreage.

In the existing condition the site generally flows from south to the north towards Oldham Parkway. A subtle ridge line splits the site into two sub-drainage areas. The western onsite drainage area (EX10) discharges to the Oldham Parkway drainage swale at the northwest corner of the site (POI #1). The swale drains to a 5'x5' RCB culvert that flows north underneath the Oldham Parkway, US Route 50, and Blue Parkway to the E. Fork Little Blue River through an unnamed tributary.

The eastern onsite drainage area (EX20) intercepts offsite runoff from approximately 5-acres of pasture land from the east (OFF20). Runoff continues to flow north and northeast to an existing 30" RCP culvert (POI #2) that discharges north underneath Oldham Parkway, US Route 50, and Blue Parkway. Storm water continues north to an existing wet detention facility located south of Shenandoah Drive.

The following table(s), Table 3A & 3B, summarizes the results of the existing conditions analysis:

TABLE 3A. EXISTING CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #1

Subarea	Drainage Area (acres)	Curve Number	Tc (Minutes)	Existing Q _{2-year} (cfs)	Existing Q _{10-year} (cfs)	Existing Q _{100-year} (cfs)
EX 10 (POI #1)	3.98	75	26.3	5.46	11.58	23.85

018-1450

TABLE 3B. EXISTING CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #2

Subarea	Drainage Area (acres)	Curve Number	Tc (Minutes)	Existing Q _{2-year} (cfs)	Existing Q _{10-year} (cfs)	Existing Q _{100-year} (cfs)
EX 20	8.27	74	25.1	10.77	23.27	48.62
OFF 20	4.94	75	28.9	6.31	13.39	27.64
PO1 #2				17.04	36.54	75.69

4. PROPOSED CONDITIONS ANALYSIS

The proposed conditions section of this analysis assumes completion of the Lee's Summit Senior Living Community. As in the existing conditions, the proposed conditions stormwater runoff model was created and ran for the 2, 10, and 100-year storm events. The complete output for the Hydraflow model has been included in Appendix A. Refer to Figure 2 for developed sub-drainage area locations, runoff curve numbers, and sub-drainage area acreage.

In the developed condition drainage area DEV 10 flows into Bio Detention Facility #1 before flowing into the proposed dry detention basin. Drainage area DEV 30 is conveyed into the dry detention basin through an underground storm sewer system. The detention facility discharges to Point of Interest #1, along with some of the existing flow from SE Oldham Parkway.

Point of Interest #2 accepts flow from the eastern half of the site. Drainage area DEV 20 is routed through Bio Detention Facility #2 before it is discharged to the point of interest. While drainage area DEV 21, which is the proposed public roadway to be constructed on the eastern edge of the site, is collected in an underground storm sewer system and conveyed to Point of Interest #2.

The following tables contain input data and summarize the computed results of the developed conditions analysis:

018-1450 4

TABLE 4A. DEVELOPED CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #1

Subarea	Drainage Area (acres)	Curve Number	Tc (Minutes)	Developed Q _{2-year} (cfs)	Developed Q _{10-year} (cfs)	Developed Q _{100-year} (cfs)
DEV 10	3.09	92	5	13.97	22.55	38.09
DEV 30	4.17	88	5	16.89	28.62	49.83
ALLOWABLE DISCHARGE	7.26			1.197	3.14	18.68
DA 11 (R/W)	1.06	87	5	4.161	7.144	12.58

TABLE 4B. DEVELOPED CONDITIONS ANALYSIS SUMMARY POINT OF INTEREST #2

Subarea	Drainage Area (acres)	Curve Number	Tc (Minutes)	Developed Q _{2-year} (cfs)	Developed Q _{10-year} (cfs)	Developed Q _{100-year} (cfs)
DEV 20	2.53	90	5	10.86	17.94	30.78
ALLOWABLE DISCHARGE	2.53			0.70	4.78	6.01
DA 21 (R/W)	1.78	86	5	6.763	11.77	20.92
OFF 22 (R/W)	0.56	87	5	2.198	3.774	6.646
OFF 20	4.94	75	28.9	6.31	13.39	27.64

TABLE 5A. DRY DETENTION FACILITY SUMMARY

Return Frequency	Developed Q _{DEV} (cfs)	Detention Volume (cf)	WSE (ft)
2	1.197	33,040	1019.74
10	3.142	51,919	1020.48
100	18.68	67,289	1021.03

018-1450 5

TABLE 5B. BIO DETENTION #1 FACILITY SUMMARY

Return Frequency	Developed Q _{DEV} (cfs)	Detention Volume (cf)	WSE (ft)
2	2.326	11,278	1021.25
10	8.272	17,339	1021.90
100	10.22	30,074	1022.97

TABLE 5C. BIO DETENTION #2 FACILITY SUMMARY

Return Frequency	Developed Q _{DEV} (cfs)	Detention Volume (cf)	WSE (ft)
2	0.702	11,652	1020.51
10	4.782	17,438	1021.11
100	6.010	30,379	1022.23

TABLE 6A. POINT OF INTEREST #1 SUMMARY

Return Frequency	Existing Q _{pre} (cfs)	Developed Q _{DEV} (cfs)
2	5.462	5.130
10	11.58	8.266
100	23.85	22.80

TABLE 6B. POINT OF INTEREST #2 SUMMARY

Return Frequency	Existing Q _{pre} (cfs)	Developed Q _{DEV} (cfs)
2	17.04	12.73
10	36.54	25.51
100	75.69	49.19

Water quality volume treatment calculations were determined using the 2012 APWA/MARC BMP manual level of surface calculations. The level of surface calculation considered all onsite development. Existing offsite right-of-way and proposed public right-of-way will not be

018-1450

conveyed through onsite BMPs. Water quality level of service and water quality volume calculations are provided in Appendix B.

5. CONCLUSIONS & RECOMMENDATIONS

The Lee's Summit Senior Living Community has been evaluated in this report to show that the stormwater discharge from the site will remain within the acceptable levels. A new detention basin and two new biodetention basins are to be constructed to handle the increased runoff created from the development.

In conclusion, all peak discharges for the points of interest for all events area at or below the established limits. See Appendix C for City of Lee's Summit BMP Level of Service Worksheet.

It is therefore requested that Lee's Summit, Missouri approve this "Lee's Summit Senior Living Community Preliminary Stormwater Drainage Study." This study will be verified with the final construction documents for the construction with the development.

018-1450

EX 20 -1015.80

1016.92

1026.04

LENGTH= 442 LF @ 2.1%

LENGTH= 300 LF @ 2.0%

1031.21

LENGTH= 300 LF @ 2.0%

EX 30

LENGTH= 436 LF @ 2.4%

EX 10

1026.18

LENGTH= 300 LF @ 1.7%

-1022.44

-1021.00


1030.09

LENGTH= 148 LF @ 0.6%

-1029.17

EX 21

LEGEND



DRAINAGE AREA BOUNDARY

TC ROUTE

FLOW DIRECTION

1031.26


-1028.89

EX OFF 20

LENGTH= 205 LF @ 3.8%


POINT OF INTEREST

SUMMARY TABLE									
\$ SUBBASIN	AREA (AC)	CN	TC (MIN.)						
EX 10	3.98	75	26.30						
EX 20	8.27	74	25.10						
EX 21	0.31	74	18.81						
EX30	0.69	74	19.75						
EX OFF 20	4.94	75	28.90						

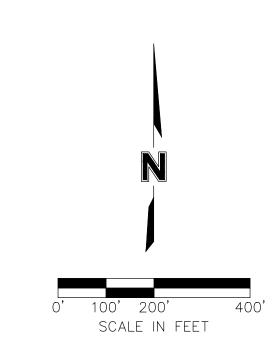

PROJECT: 018-1450 DRAWN BY: TDD DATE: 02/19/2019

olsson

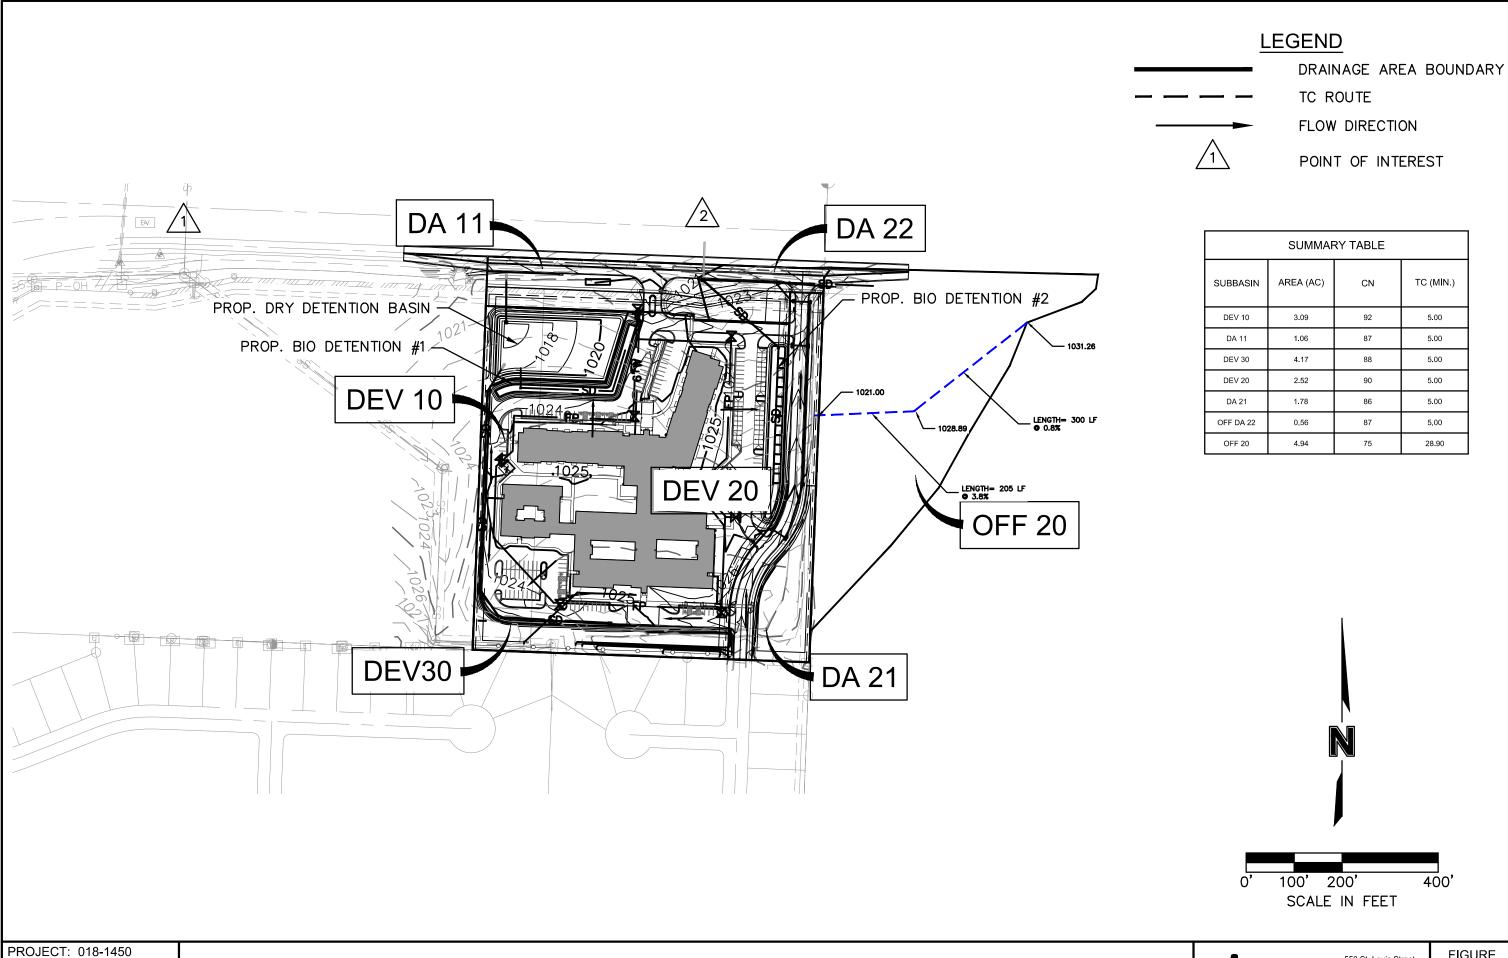

DEVELOPED CONDITIONS DRAINAGE AREA MAP

DRAWN BY: TDD

DATE: 02/19/2019

FIGURE 550 St. Louis Street Springfield, MO 65806 TEL 417.890.8802 FAX 401.890.8805

APPENDIX A

Hydrology & Detention Calculations


Hydraflow Table of Contents

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

watersned Model Schematic	1
Hydrograph Return Period Recap	2
2 - Year	
Summary Report	3
Hydrograph Reports	
Hydrograph No. 1, SCS Runoff, EX 20	4
TR-55 Tc Worksheet	
Hydrograph No. 2, SCS Runoff, EX 10 (POI 1)	6
TR-55 Tc Worksheet	
Hydrograph No. 3, SCS Runoff, OFF 20	
TR-55 Tc Worksheet	
Hydrograph No. 4, Combine, EX POI 2 (AT CULVERT)	
Hydrograph No. 5, SCS Runoff, DEV 10	
Hydrograph No. 6, SCS Runoff, DEV 30	
Hydrograph No. 7, Reservoir, BIO 1	
Pond Report - BIORETENTION 1	
Hydrograph No. 8, Combine, COMBINE	
Hydrograph No. 9, Reservoir, DETENTION POND 1	16
Pond Report - DRY DETENTION 1	17
Hydrograph No. 10, SCS Runoff, DA 11 (US ROUTE 50)	18
Hydrograph No. 11, Combine, DEV POI 1	
Hydrograph No. 12, SCS Runoff, DEV 20	20
Hydrograph No. 13, Reservoir, BIORETENTION 2	21
Pond Report - BIORETENTION 2	
Hydrograph No. 14, SCS Runoff, DA 21 (PR. PUBLIC ACCESS ROAD)	23
Hydrograph No. 15, SCS Runoff, OFF 20	
Hydrograph No. 16, SCS Runoff, OFF DA 22 (US ROUTE 50)	
Hydrograph No. 17, Combine, DEV POI 2 (AT CULVERT)	26
10 - Year	
Summary Report	27
Hydrograph Reports	
Hydrograph No. 1, SCS Runoff, EX 20	
Hydrograph No. 2, SCS Runoff, EX 10 (POI 1)	29
Hydrograph No. 3, SCS Runoff, OFF 20	30
Hydrograph No. 4, Combine, EX POI 2 (AT CULVERT)	31
Hydrograph No. 5, SCS Runoff, DEV 10	
Hydrograph No. 6, SCS Runoff, DEV 30	
Hydrograph No. 7, Reservoir, BIO 1	
Hydrograph No. 8, Combine, COMBINE	
Hydrograph No. 9, Reservoir, DETENTION POND 1	
Hydrograph No. 10, SCS Runoff, DA 11 (US ROUTE 50)	
Hydrograph No. 11, Combine, DEV POI 1	
Hydrograph No. 12, SCS Runoff, DEV 20	
Hydrograph No. 13, Reservoir, BIORETENTION 2	40
Hydrograph No. 14, SCS Runoff, DA 21 (PR. PUBLIC ACCESS ROAD)	41

Hydrograph No. 15, SCS Runoff, OFF 20	42
Hydrograph No. 16, SCS Runoff, OFF DA 22 (US ROUTE 50)	43
Hydrograph No. 17, Combine, DEV POI 2 (AT CULVERT)	
, 3 1 , - , - , - , - , - , - , - , - , - ,	
100 - Year	
Summary Report	45
Hydrograph Reports	
Hydrograph No. 1, SCS Runoff, EX 20	
Hydrograph No. 2, SCS Runoff, EX 10 (POI 1)	
Hydrograph No. 3, SCS Runoff, OFF 20	
Hydrograph No. 4, Combine, EX POI 2 (AT CULVERT)	
Hydrograph No. 5, SCS Runoff, DEV 10	
Hydrograph No. 6, SCS Runoff, DEV 30	
Hydrograph No. 7, Reservoir, BIO 1	
Hydrograph No. 8, Combine, COMBINE	
Hydrograph No. 9, Reservoir, DETENTION POND 1	
Hydrograph No. 10, SCS Runoff, DA 11 (US ROUTE 50)	55
Hydrograph No. 11, Combine, DEV POI 1	
Hydrograph No. 12, SCS Runoff, DEV 20	
Hydrograph No. 13, Reservoir, BIORETENTION 2	
Hydrograph No. 14, SCS Runoff, DA 21 (PR. PUBLIC ACCESS ROAD)	
Hydrograph No. 15, SCS Runoff, OFF 20	
Hydrograph No. 16, SCS Runoff, OFF DA 22 (US ROUTE 50)	
Hydrograph No. 17. Combine. DEV POI 2 (AT CULVERT)	

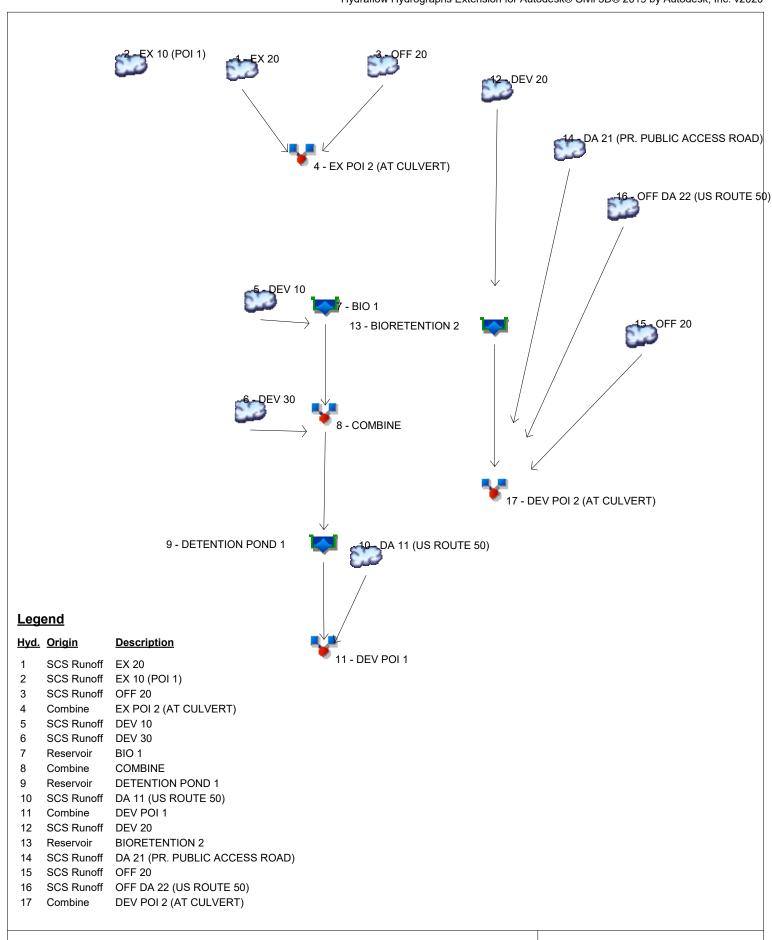

Hydrograph Return Period Recap Hydraffow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

-	Hydrograph	Inflow	Peak Outflow (cfs)						Hydrograph		
lo.	type (origin)	hyd(s)	1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr	Description
1	SCS Runoff			10.77			23.27			48.62	EX 20
2	SCS Runoff			5.462			11.58			23.85	EX 10 (POI 1)
3	SCS Runoff			6.315			13.39			27.64	OFF 20
4	Combine	1, 3		17.04			36.54			75.69	EX POI 2 (AT CULVERT)
5	SCS Runoff			13.97			22.55			38.09	DEV 10
6	SCS Runoff			16.89			28.62			49.93	DEV 30
7	Reservoir	5		2.326			8.272			10.22	BIO 1
8	Combine	6, 7		18.92			31.96			59.12	COMBINE
9	Reservoir	8		1.197			3.142			18.68	DETENTION POND 1
10	SCS Runoff			4.161			7.144			12.58	DA 11 (US ROUTE 50)
11	Combine	9, 10		5.130			8.266			22.80	DEV POI 1
12	SCS Runoff			10.86			17.94			30.78	DEV 20
13	Reservoir	12		0.702			4.782			6.010	BIORETENTION 2
14	SCS Runoff			6.763			11.77			20.92	DA 21 (PR. PUBLIC ACCESS ROAD
15	SCS Runoff			6.315			13.39			27.64	OFF 20
16	SCS Runoff			2.198			3.774			6.646	OFF DA 22 (US ROUTE 50)
17	Combine	13, 14, 15, 16		12.73			25.51			49.19	DEV POI 2 (AT CULVERT)

Proj. file: 81450_24-HR ANALYSIS.gpw

Friday, 02 / 15 / 2019

Page 14

Hydrograph Summary Report Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

						Hydrallow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Auto			1
Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	10.77	2	730	40,985				EX 20
2	SCS Runoff	5.462	2	730	20,656				EX 10 (POI 1)
3	SCS Runoff	6.315	2	732	26,046				OFF 20
4	Combine	17.04	2	730	67,031	1, 3			EX POI 2 (AT CULVERT)
5	SCS Runoff	13.97	2	716	29,845				DEV 10
6	SCS Runoff	16.89	2	716	34,924				DEV 30
7	Reservoir	2.326	2	726	29,832	5	1021.25	11,278	BIO 1
8	Combine	18.92	2	716	64,756	6, 7			COMBINE
9	Reservoir	1.197	2	868	64,753	8	1019.74	33,040	DETENTION POND 1
10	SCS Runoff	4.161	2	716	8,557				DA 11 (US ROUTE 50)
11	Combine	5.130	2	716	73,310	9, 10			DEV POI 1
12	SCS Runoff	10.86	2	716	22,774				DEV 20
13	Reservoir	0.702	2	754	22,758	12	1020.51	11,652	BIORETENTION 2
14	SCS Runoff	6.763	2	716	13,843				DA 21 (PR. PUBLIC ACCESS ROAD)
15	SCS Runoff	6.315	2	732	26,046				OFF 20
16	SCS Runoff	2.198	2	716	4,521				OFF DA 22 (US ROUTE 50)
17	Combine	12.73	2	718	67,167	13, 14, 15, 16			DEV POI 2 (AT CULVERT)
814	150_24-HR A	NALYSIS	.gpw		Return F	Period: 2 Ye	ear	Friday, 02 /	15 / 2019 Page 15

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 1

EX 20

Hydrograph type = SCS Runoff Peak discharge = 10.77 cfsStorm frequency = 2 yrsTime to peak $= 12.17 \, hrs$ Time interval = 2 min Hyd. volume = 40.985 cuft = 8.270 ac Curve number Drainage area = 74* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 25.10 min = TR55 Total precip. = 3.71 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.110 \times 98) + (8.160 \times 74)] / 8.270$

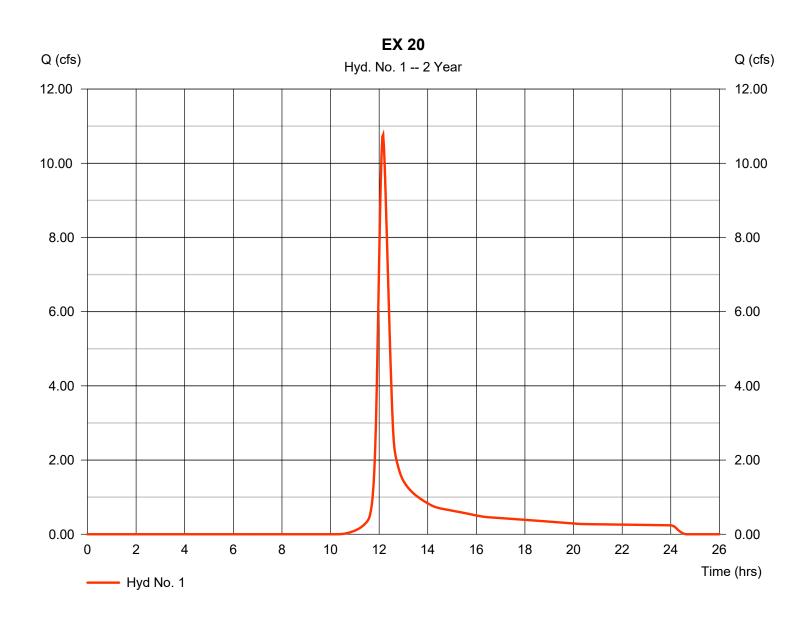

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No. 1

EX 20

<u>Description</u>	<u>A</u>		<u>B</u>		<u>C</u>		<u>Totals</u>
Sheet Flow Manning's n-value Flow length (ft) Two-year 24-hr precip. (in) Land slope (%)	= 0.150 = 300.0 = 3.71 = 2.00		0.011 0.0 0.00 0.00		0.011 0.0 0.00 0.00		
Travel Time (min)	= 21.91	+	0.00	+	0.00	=	21.91
Shallow Concentrated Flow Flow length (ft) Watercourse slope (%) Surface description Average velocity (ft/s)	= 440.00 = 2.00 = Unpaved =2.28	t	0.00 0.00 Paved 0.00		0.00 0.00 Paved 0.00		
Travel Time (min)	= 3.21	+	0.00	+	0.00	=	3.21
Channel Flow X sectional flow area (sqft) Wetted perimeter (ft) Channel slope (%) Manning's n-value Velocity (ft/s)	= 0.00 = 0.00 = 0.00 = 0.015 =0.00		0.00 0.00 0.00 0.015 0.00		0.00 0.00 0.00 0.015		
Flow length (ft)	({0})0.0		0.0		0.0		
Travel Time (min)	= 0.00	+	0.00	+	0.00	=	0.00
Total Travel Time, Tc							

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 2

EX 10 (POI 1)

Hydrograph type = SCS Runoff Peak discharge = 5.462 cfsStorm frequency = 2 yrsTime to peak $= 12.17 \, hrs$ Time interval = 2 min Hyd. volume = 20.656 cuft Curve number = 75* Drainage area = 3.980 acBasin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 26.30 min = TR55 Total precip. Distribution = Type II = 3.71 inStorm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.090 \times 98) + (3.890 \times 74)] / 3.980$

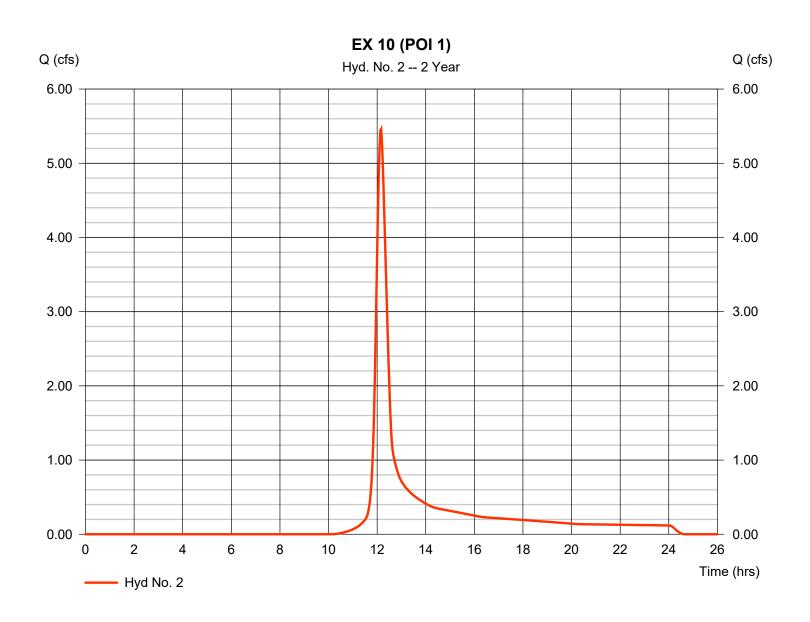

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No. 2

EX 10 (POI 1)

<u>Description</u>	<u>A</u>		<u>B</u>		<u>C</u>		<u>Totals</u>
Sheet Flow Manning's n-value Flow length (ft) Two-year 24-hr precip. (in) Land slope (%)	= 0.150 = 300.0 = 3.71 = 1.70		0.011 0.0 0.00 0.00		0.011 0.0 0.00 0.00		
Travel Time (min)	= 23.39	+	0.00	+	0.00	=	23.39
Shallow Concentrated Flow Flow length (ft) Watercourse slope (%) Surface description Average velocity (ft/s)	= 435.00 = 2.40 = Unpaved =2.50	I	0.00 0.00 Paved 0.00		0.00 0.00 Paved 0.00		
Travel Time (min)	= 2.90	+	0.00	+	0.00	=	2.90
Channel Flow X sectional flow area (sqft) Wetted perimeter (ft) Channel slope (%) Manning's n-value Velocity (ft/s)	= 0.00 = 0.00 = 0.00 = 0.015 =0.00		0.00 0.00 0.00 0.015 0.00		0.00 0.00 0.00 0.015		
Flow length (ft)	({0})0.0		0.0		0.0		
Travel Time (min)	= 0.00	+	0.00	+	0.00	=	0.00
Total Travel Time, Tc							

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 3

OFF 20

Hydrograph type = SCS Runoff Peak discharge = 6.315 cfsStorm frequency = 2 yrsTime to peak = 12.20 hrsTime interval = 2 min Hyd. volume = 26.046 cuft Curve number = 75* Drainage area = 4.940 acBasin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 28.90 min = TR55 Total precip. Distribution = Type II = 3.71 inStorm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.140 \times 98) + (4.800 \times 74)] / 4.940$

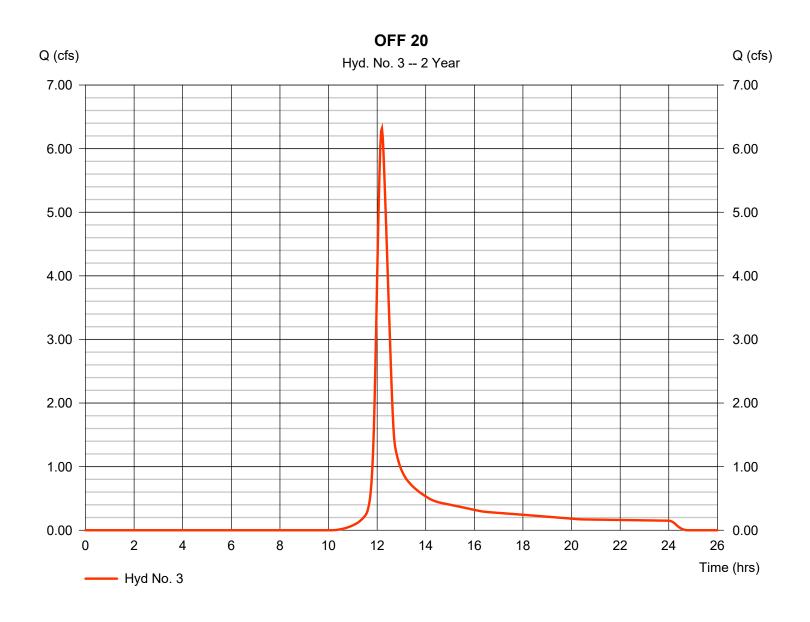

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No. 3

OFF 20

<u>Description</u>	<u>A</u>		<u>B</u>		<u>C</u>		<u>Totals</u>
Sheet Flow Manning's n-value Flow length (ft) Two-year 24-hr precip. (in) Land slope (%)	= 0.150 = 300.0 = 3.71 = 1.10		0.011 0.0 0.00 0.00		0.011 0.0 0.00 0.00		
Travel Time (min)	= 27.83	+	0.00	+	0.00	=	27.83
Shallow Concentrated Flow Flow length (ft) Watercourse slope (%) Surface description Average velocity (ft/s)	= 205.00 = 3.80 = Unpaved =3.15	I	0.00 0.00 Paved 0.00		0.00 0.00 Paved 0.00		
Travel Time (min)	= 1.09	+	0.00	+	0.00	=	1.09
Channel Flow X sectional flow area (sqft) Wetted perimeter (ft) Channel slope (%) Manning's n-value Velocity (ft/s)	= 0.00 = 0.00 = 0.00 = 0.015 =0.00		0.00 0.00 0.00 0.015 0.00		0.00 0.00 0.00 0.015		
Flow length (ft)	({0})0.0		0.0		0.0		
Travel Time (min)	= 0.00	+	0.00	+	0.00	=	0.00
Total Travel Time, Tc							28.90 min


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 4

EX POI 2 (AT CULVERT)

Hydrograph type = Combine Peak discharge = 17.04 cfsTime to peak Storm frequency = 2 yrs $= 12.17 \, hrs$ Time interval = 2 min Hyd. volume = 67,031 cuftInflow hyds. = 1, 3 Contrib. drain. area = 13.210 ac

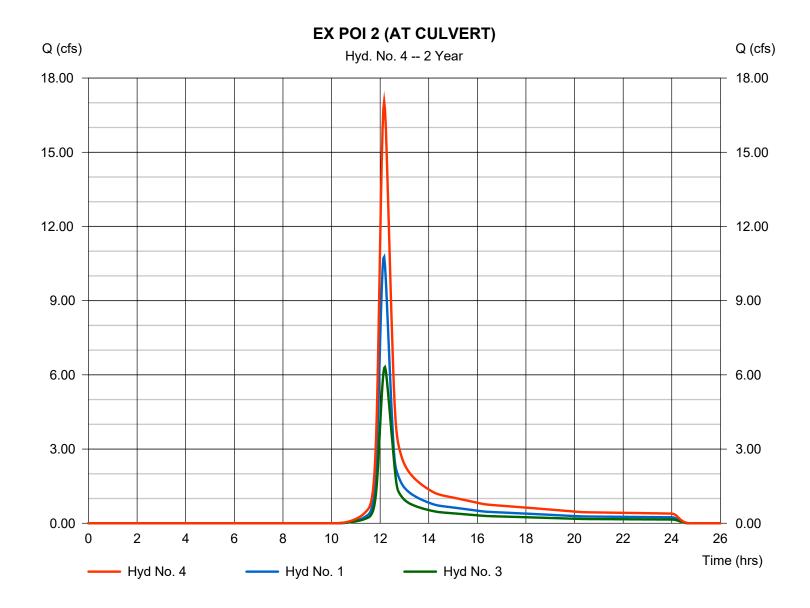

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 5

DEV 10

Hydrograph type = SCS Runoff Peak discharge = 13.97 cfsStorm frequency = 2 yrsTime to peak = 11.93 hrsTime interval = 2 min Hyd. volume = 29.845 cuft Curve number Drainage area = 3.090 ac= 92* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 3.71 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(2.050 \times 98) + (1.040 \times 80)] / 3.090$

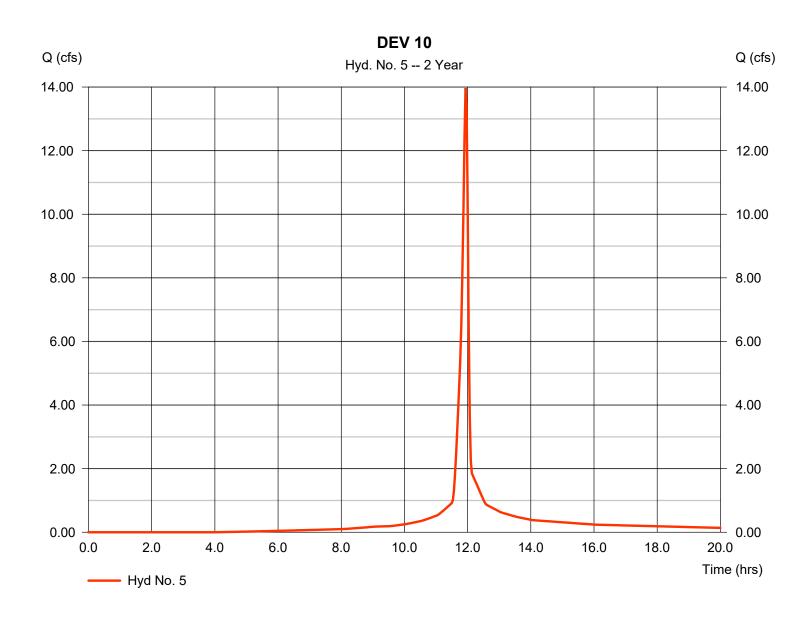

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 6

DEV 30

Hydrograph type = SCS Runoff Peak discharge = 16.89 cfsStorm frequency = 2 yrsTime to peak = 11.93 hrsTime interval = 2 min Hyd. volume = 34.924 cuft = 4.170 ac Curve number Drainage area = 88* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 3.71 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = [(1.850 x 98) + (1.510 x 80) + (0.810 x 80)] / 4.170

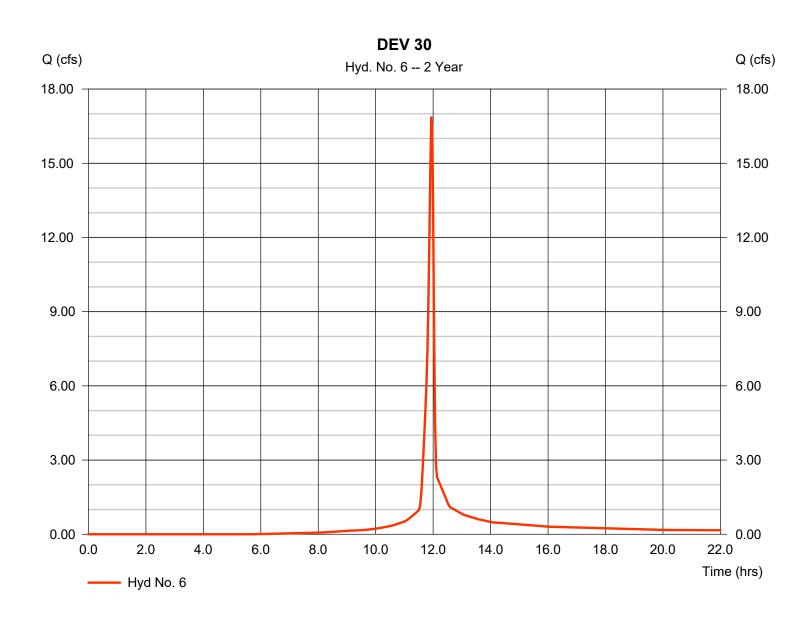

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 7

BIO₁

Hydrograph type = Reservoir Peak discharge = 2.326 cfsStorm frequency = 2 yrsTime to peak = 12.10 hrsTime interval = 2 min Hyd. volume = 29,832 cuft Inflow hyd. No. = 5 - DEV 10 Max. Elevation = 1021.25 ft= BIORETENTION 1 Reservoir name Max. Storage = 11,278 cuft

Storage Indication method used.

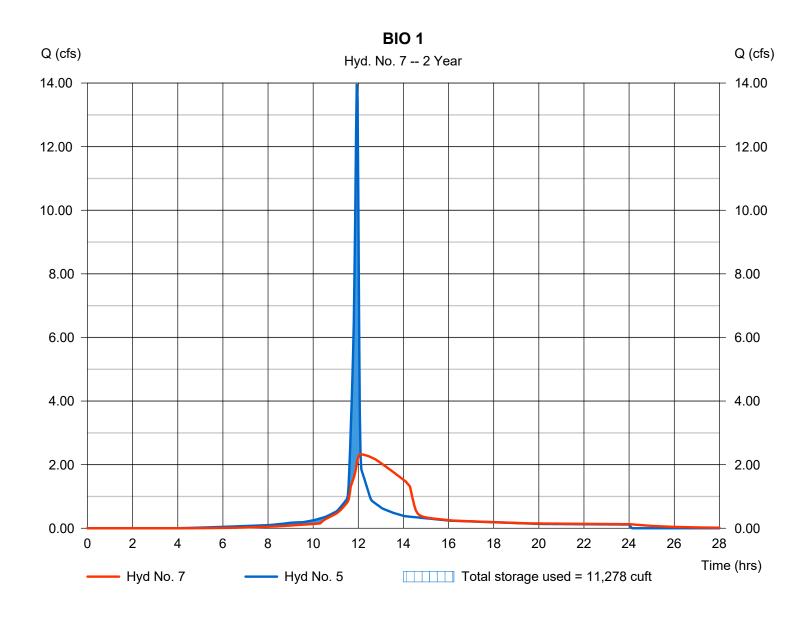

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Pond No. 2 - BIORETENTION 1

Pond Data


Contours -User-defined contour areas. Conic method used for volume calculation. Begining Elevation = 1019.00 ft

Stage / Storage Table

Stage (ft)	Stage (ft) Elevation (ft) Co		Incr. Storage (cuft)	Total storage (cuft)
0.00	1019.00	00	0	0
1.00	1020.00	5,796	1,932	1,932
2.00	1021.00	8,214	6,969	8,901
3.00	1022.00	10,869	9,510	18,411
4.00	1023.00	13,220	12,024	30,435
5.00	1024.00	13,220	13,219	43,653

Culvert / Orifice Structures Weir Structures [A] [B] [C] [PrfRsr] [A] [B] [C] [D] = 12.00 8.00 0.00 = 9.00 Rise (in) 0.00 Crest Len (ft) 353.00 0.00 0.00 Span (in) = 12.00 8.00 0.00 0.00 Crest El. (ft) = 1021.50 1023.00 0.00 0.00 No. Barrels 0 Weir Coeff. = 3.332.60 3.33 3.33 Invert El. (ft) = 1019.00 1019.00 0.00 0.00 Weir Type = Rect Broad Length (ft) = 10.000.50 0.00 0.00 Multi-Stage No = Yes No No Slope (%) = 2.001.00 0.00 n/a N-Value = .013 .013 .013 n/a = 0.600.60 0.60 0.60 Exfil.(in/hr) = 0.000 (by Wet area) Orifice Coeff. Multi-Stage = n/aNo No No TW Elev. (ft) = 0.00

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

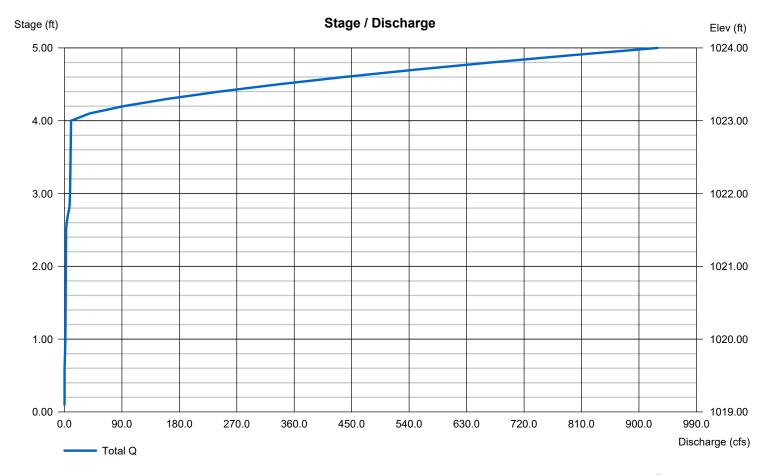


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 8

COMBINE

Hydrograph type = Combine Peak discharge = 18.92 cfsTime to peak Storm frequency = 2 yrs $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 64,756 cuft Inflow hyds. = 6, 7 Contrib. drain. area = 4.170 ac

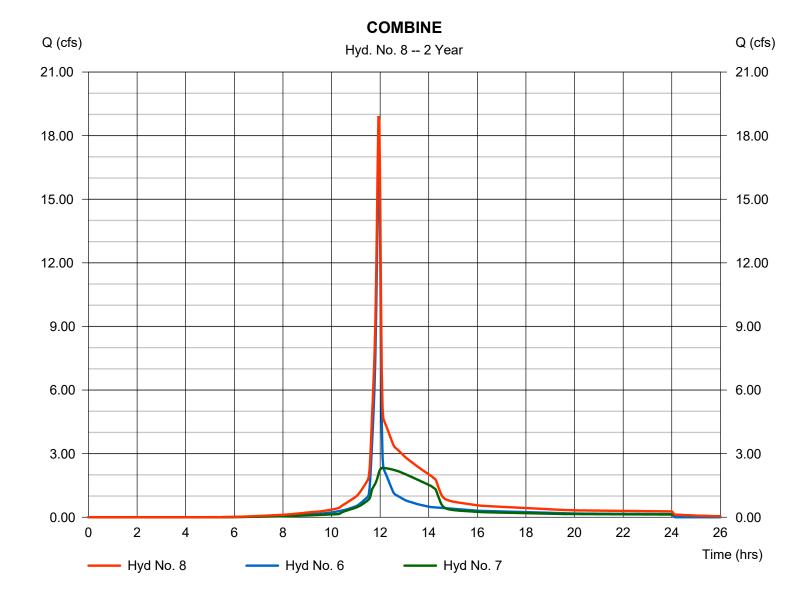

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 9

DETENTION POND 1

Hydrograph type = Reservoir Peak discharge = 1.197 cfsStorm frequency = 2 yrsTime to peak $= 14.47 \, hrs$ Time interval = 2 min Hyd. volume = 64,753 cuftInflow hyd. No. Max. Elevation = 8 - COMBINE = 1019.74 ft= DRY DETENTION 1 Reservoir name Max. Storage = 33,040 cuft

Storage Indication method used.

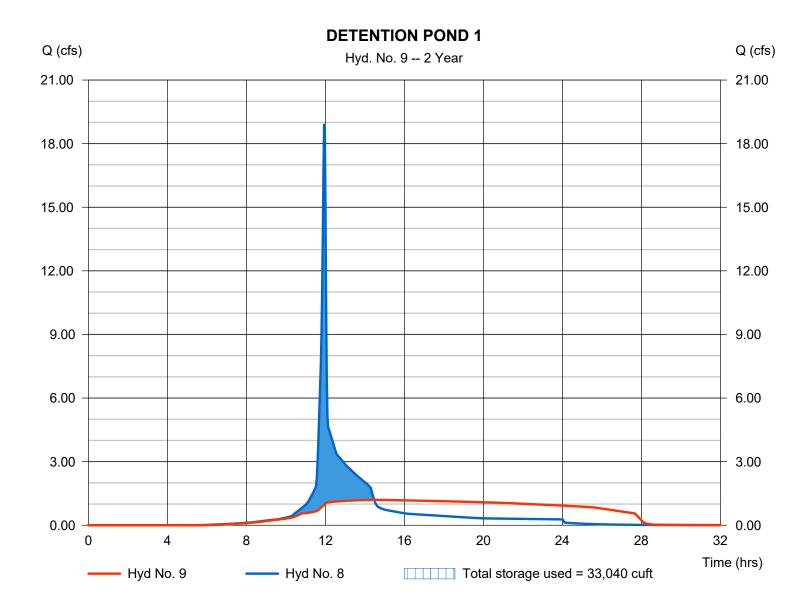

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Pond No. 1 - DRY DETENTION 1

Pond Data

Contours -User-defined contour areas. Conic method used for volume calculation. Begining Elevation = 1016.00 ft

Stage / Storage Table


Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	1016.00	00	0	0
1.00	1017.00	2,042	681	681
2.00	1018.00	8,847	5,046	5,727
3.00	1019.00	16,278	12,374	18,100
4.00	1020.00	24,535	20,264	38,364
5.00	1021.00	31,558	27,970	66,334
6.00	1022.00	35,419	33,467	99,801

Culvert / Orifice Structures

Weir Structures

	[A]	[B]	[C]	[PrfRsr]		[A]	[B]	[C]	[D]
Rise (in)	= 30.00	5.00	0.00	0.00	Crest Len (ft)	= 9.00	0.00	0.00	0.00
Span (in)	= 30.00	5.00	0.00	0.00	Crest El. (ft)	= 1020.33	0.00	0.00	0.00
No. Barrels	= 1	1	0	0	Weir Coeff.	= 3.33	3.33	3.33	3.33
Invert El. (ft)	= 1016.00	1016.00	0.00	0.00	Weir Type	= Rect			
Length (ft)	= 200.00	0.50	0.00	0.00	Multi-Stage	= Yes	No	No	No
Slope (%)	= 0.50	1.00	0.00	n/a					
N-Value	= .013	.013	.013	n/a					
Orifice Coeff.	= 0.60	0.60	0.60	0.60	Exfil.(in/hr)	= 0.000 (by Contour)			
Multi-Stage	= n/a	Yes	No	No	TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

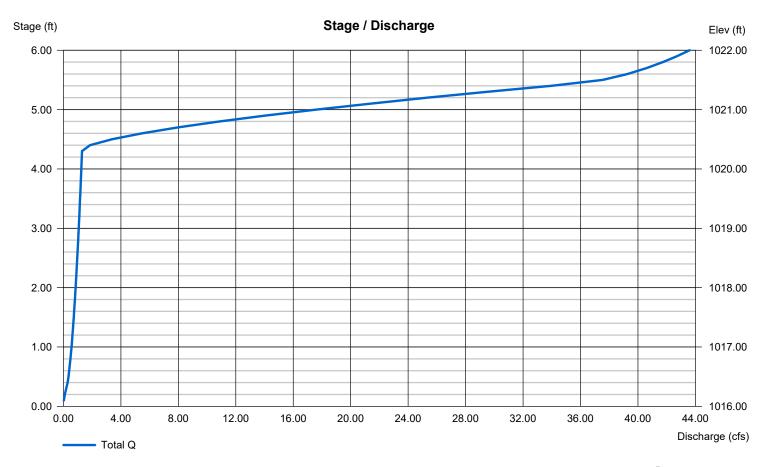

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 10

DA 11 (US ROUTE 50)

Hydrograph type = SCS Runoff Peak discharge = 4.161 cfsStorm frequency Time to peak $= 11.93 \, hrs$ = 2 yrsTime interval = 2 min Hyd. volume = 8,557 cuft Drainage area = 1.060 acCurve number = 87* Basin Slope = 0.0 %Hydraulic length = 0 ft= 5.00 min Tc method = User Time of conc. (Tc) Total precip. = 3.71 inDistribution = Type II Shape factor Storm duration = 484 = 24 hrs

^{*} Composite (Area/CN) = [(0.400 x 98) + (0.660 x 80)] / 1.060

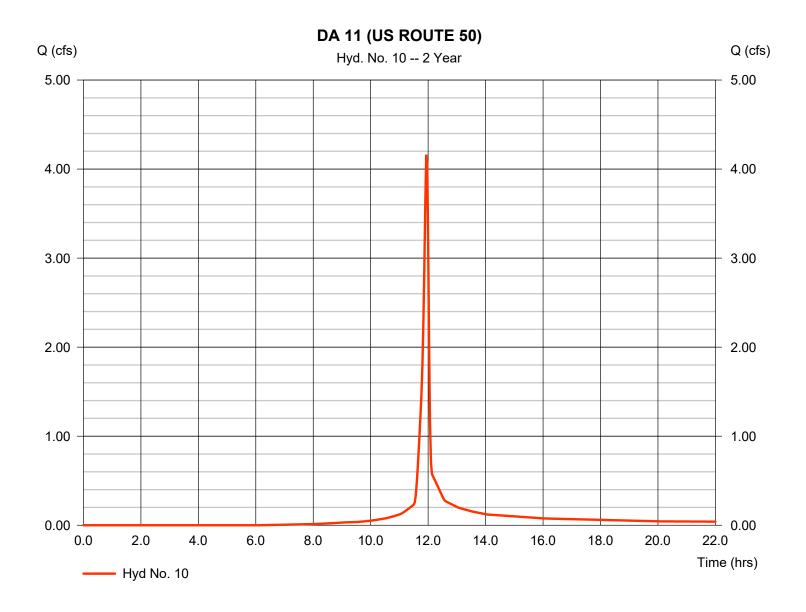


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 11

DEV POI 1

Hydrograph type = Combine Peak discharge = 5.130 cfsStorm frequency = 2 yrsTime to peak $= 11.93 \, hrs$ = 2 min Time interval Hyd. volume = 73,310 cuftInflow hyds. = 9, 10 Contrib. drain. area = 1.060 ac

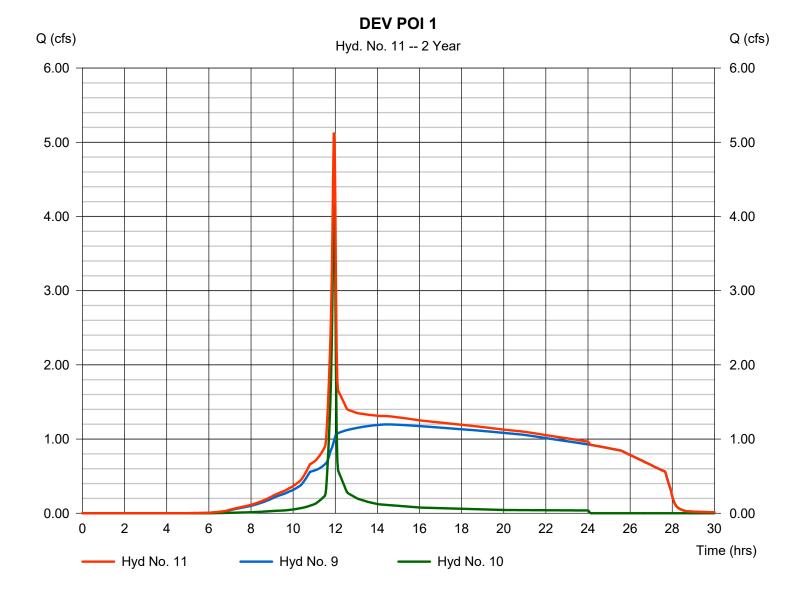

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 12

DEV 20

Hydrograph type = SCS Runoff Peak discharge = 10.86 cfsStorm frequency = 2 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 22.774 cuft Curve number Drainage area = 2.530 ac= 90* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 3.71 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(1.370 x 98) + (1.160 x 80)] / 2.530

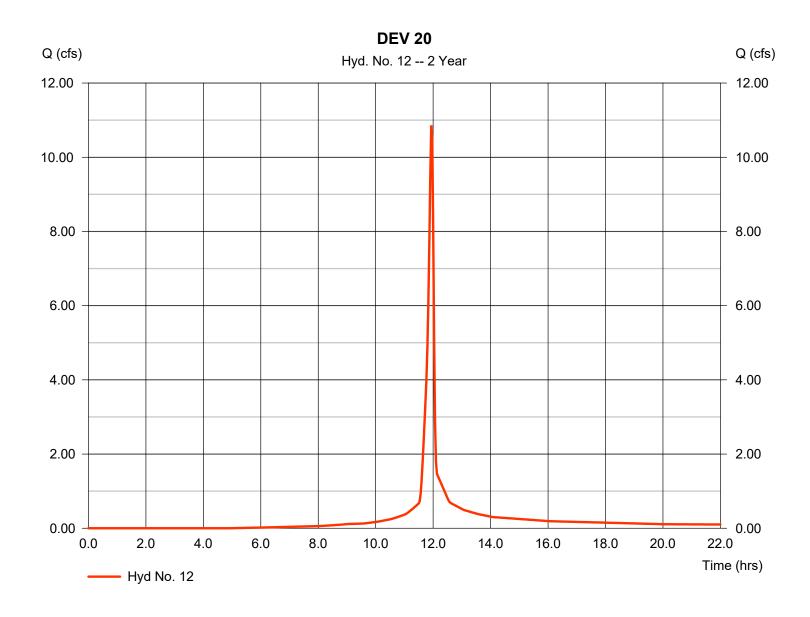

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 13

BIORETENTION 2

Hydrograph type = Reservoir Peak discharge = 0.702 cfsStorm frequency = 2 yrsTime to peak $= 12.57 \, hrs$ Time interval = 2 min Hyd. volume = 22,758 cuft Inflow hyd. No. Max. Elevation = 12 - DEV 20 $= 1020.51 \, \text{ft}$ = BIORETENTION 2 Reservoir name Max. Storage = 11,652 cuft

Storage Indication method used.

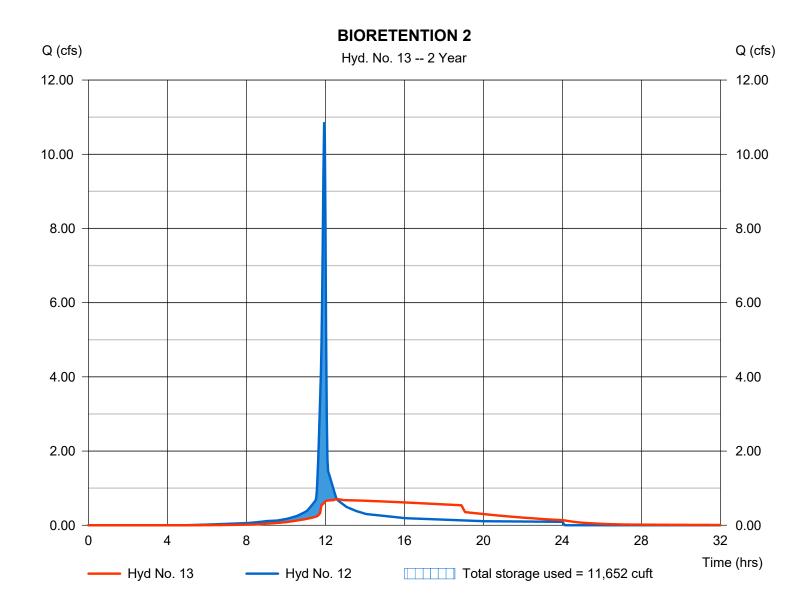

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Pond No. 3 - BIORETENTION 2

Pond Data


Pond storage is based on user-defined values.

Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	1017.50	n/a	0	0
1.00	1018.50	n/a	3,248	3,248
2.00	1019.50	n/a	203	3,451
3.00	1020.50	n/a	8,121	11,572
4.00	1021.50	n/a	9,629	21,201
5.00	1022.50	n/a	12,697	33,898

Culvert / Orifice Structures Weir Structures [A] [B] [C] [PrfRsr] [A] [B] [C] [D] Rise (in) = 12.004.00 0.00 0.00 0.00 0.00 0.00 Crest Len (ft) = 3.00Span (in) = 12.00 4.00 0.00 0.00 Crest El. (ft) = 1020.500.00 0.00 0.00 No. Barrels Weir Coeff. 3.33 = 1 0 = 3.333.33 3.33 Invert El. (ft) = 1017.50 1017.50 0.00 0.00 Weir Type = Rect = 100.00 0.50 0.00 0.00 Length (ft) Multi-Stage = Yes No No No 0.00 n/a = 0.501.00 Slope (%) N-Value = .013 .013 .013 n/a Orifice Coeff. 0.60 0.60 0.60 = 0.000 (by Wet area) = 0.60Exfil.(in/hr) TW Elev. (ft) Multi-Stage = n/aYes No No = 0.00

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

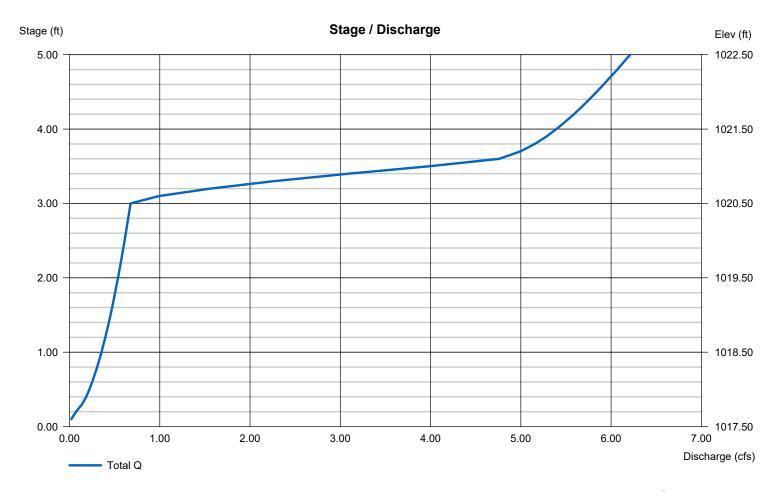

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 14

DA 21 (PR. PUBLIC ACCESS ROAD)

Hydrograph type = SCS Runoff Peak discharge = 6.763 cfsStorm frequency Time to peak = 11.93 hrs= 2 yrsTime interval = 2 min Hyd. volume = 13.843 cuft Curve number Drainage area = 1.780 ac= 86* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User = 3.71 inTotal precip. Distribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(0.630 x 98) + (1.150 x 80)] / 1.780

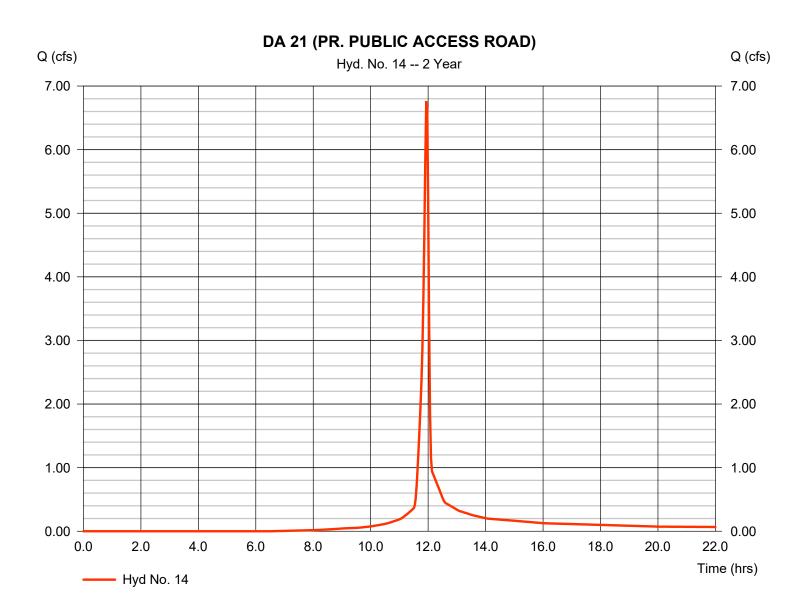

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 15

OFF 20

Hydrograph type = SCS Runoff Peak discharge = 6.315 cfsStorm frequency = 2 yrsTime to peak = 12.20 hrsTime interval = 2 min Hyd. volume = 26.046 cuft Curve number = 75* Drainage area = 4.940 acBasin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 28.90 min = User Total precip. = 3.71 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.190 \times 98) + (4.750 \times 74)] / 4.940$

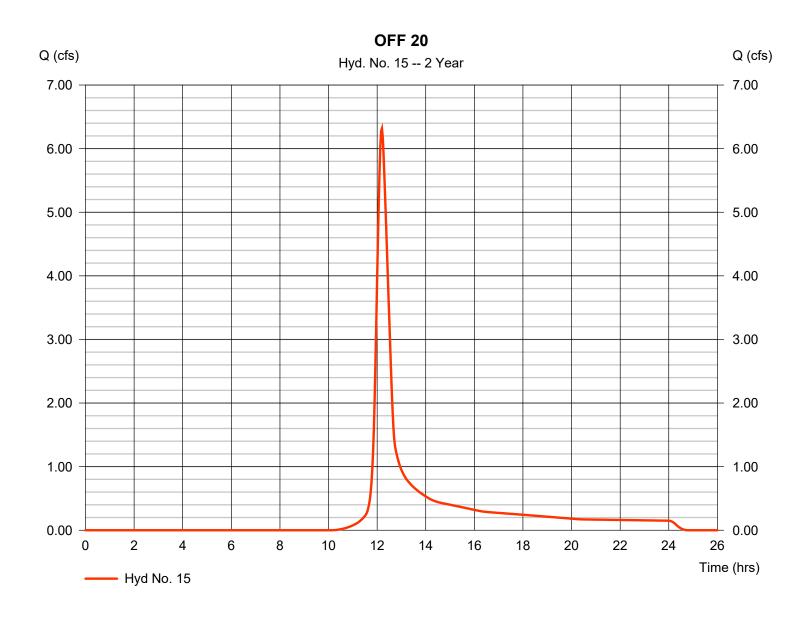

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 16

OFF DA 22 (US ROUTE 50)

Hydrograph type = SCS Runoff Peak discharge = 2.198 cfsStorm frequency Time to peak $= 11.93 \, hrs$ = 2 yrsTime interval = 2 min Hyd. volume = 4,521 cuftDrainage area = 0.560 acCurve number = 87* Basin Slope = 0.0 %Hydraulic length = 0 ft= 5.00 min Tc method = User Time of conc. (Tc) Total precip. = 3.71 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(0.210 x 98) + (0.350 x 80)] / 0.560

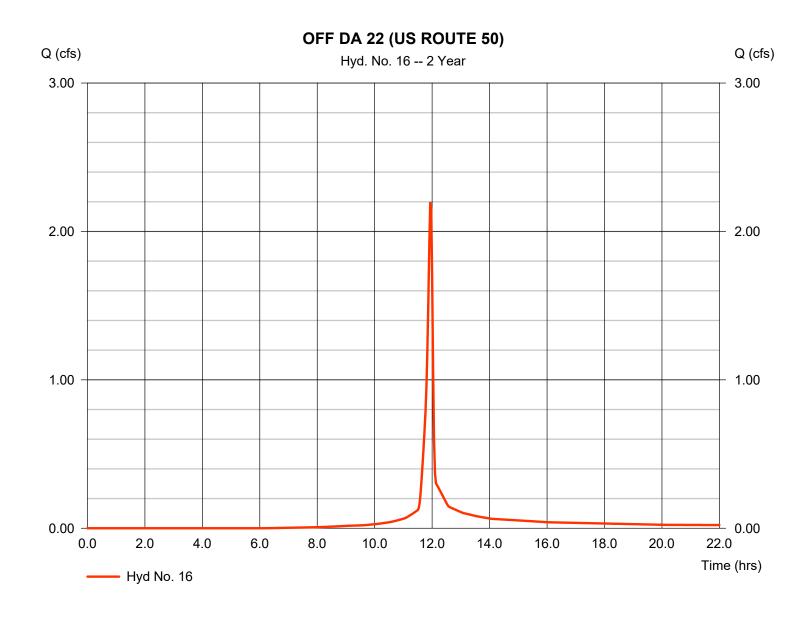


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 17

DEV POI 2 (AT CULVERT)

Hydrograph type = Combine Peak discharge = 12.73 cfsStorm frequency = 2 yrsTime to peak $= 11.97 \, hrs$ Time interval = 2 min Hyd. volume = 67,167 cuft Contrib. drain. area = 7.280 acInflow hyds. = 13, 14, 15, 16

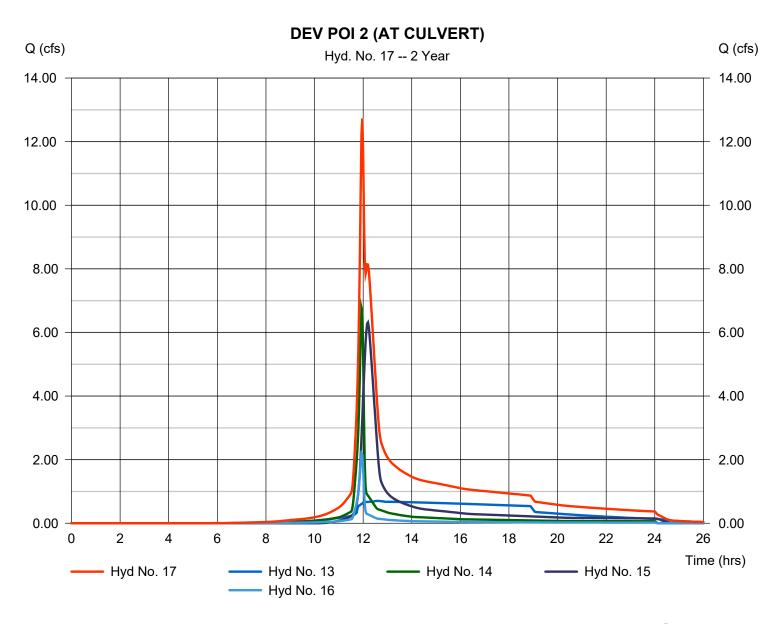

Hydrograph Summary Report Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description	
1	SCS Runoff	23.27	2	728	85,731				EX 20	
2	SCS Runoff	11.58	2	728	42,585				EX 10 (POI 1)	
3	SCS Runoff	13.39	2	730	53,696				OFF 20	
4	Combine	36.54	2	730	139,427	1, 3			EX POI 2 (AT CULVERT)	
5	SCS Runoff	22.55	2	716	49,797				DEV 10	
6	SCS Runoff	28.62	2	716	61,008				DEV 30	
7	Reservoir	8.272	2	722	49,784	5	1021.90	17,339	BIO 1	
3	Combine	31.96	2	718	110,792	6, 7			COMBINE	
9	Reservoir	3.142	2	816	110,789	8	1020.48	51,919	DETENTION POND 1	
10	SCS Runoff	7.144	2	716	15,124				DA 11 (US ROUTE 50)	
11	Combine	8.266	2	716	125,913	9, 10			DEV POI 1	
12	SCS Runoff	17.94	2	716	38,875				DEV 20	
13	Reservoir	4.782	2	724	38,859	12	1021.11	17,438	BIORETENTION 2	
14	SCS Runoff	11.77	2	716	24,758				DA 21 (PR. PUBLIC ACCESS ROAD	
15	SCS Runoff	13.39	2	730	53,696				OFF 20	
16	SCS Runoff	3.774	2	716	7,990				OFF DA 22 (US ROUTE 50)	
17	Combine	25.51	2	718	125,303	13, 14, 15, 16			DEV POI 2 (AT CULVERT)	
81450_24-HR ANALYSIS.gpw				Return F	Return Period: 10 Year			Friday, 02 / 15 / 2019 Page 39		

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 1

EX 20

Hydrograph type = SCS Runoff Peak discharge = 23.27 cfsStorm frequency = 10 yrsTime to peak = 12.13 hrsTime interval = 2 min Hyd. volume = 85.731 cuft Curve number Drainage area = 8.270 ac= 74* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 25.10 min = TR55 Total precip. Distribution = Type II = 5.66 inStorm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.110 \times 98) + (8.160 \times 74)] / 8.270$

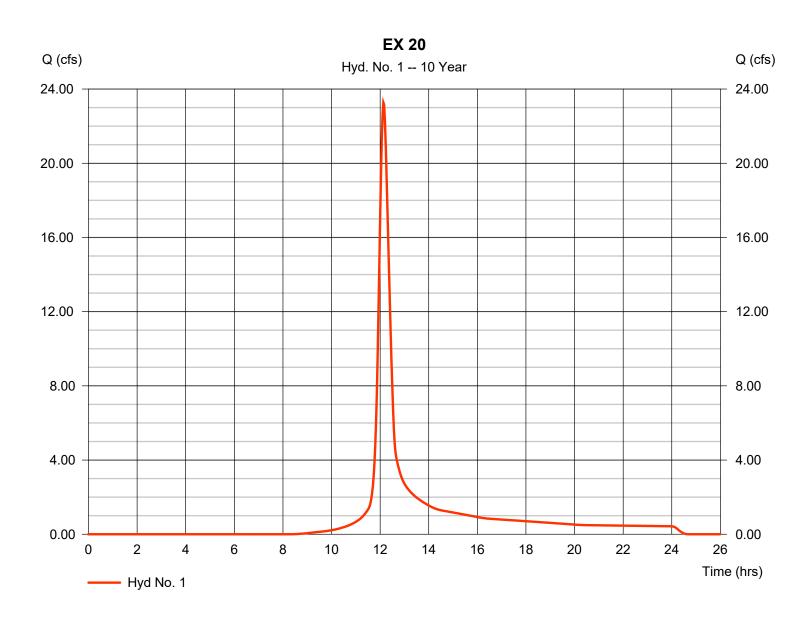

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 2

EX 10 (POI 1)

Hydrograph type = SCS Runoff Peak discharge = 11.58 cfsStorm frequency = 10 yrsTime to peak = 12.13 hrsTime interval = 2 min Hyd. volume = 42.585 cuft Curve number Drainage area = 3.980 ac= 75* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 26.30 min = TR55 Total precip. Distribution = Type II = 5.66 inShape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = $[(0.090 \times 98) + (3.890 \times 74)] / 3.980$

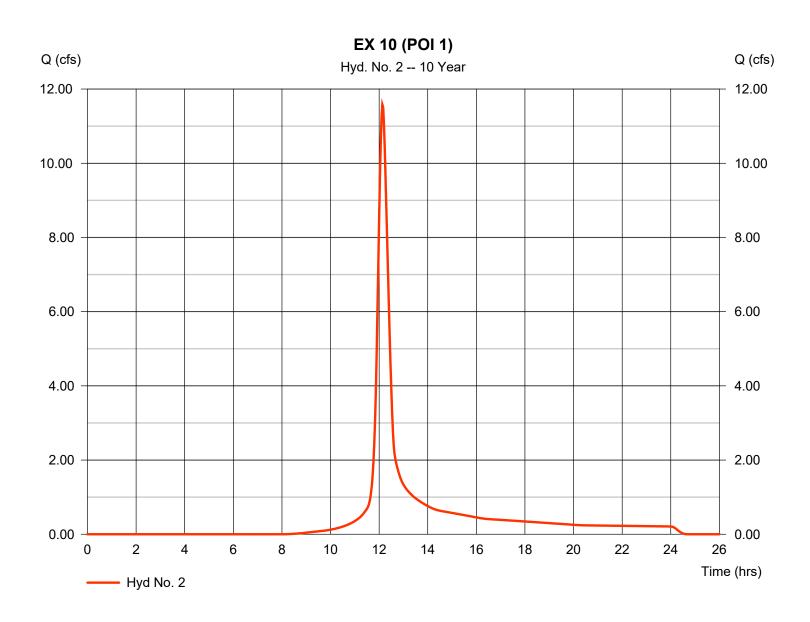

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 3

OFF 20

Hydrograph type = SCS Runoff Peak discharge = 13.39 cfsStorm frequency = 10 yrsTime to peak = 12.17 hrsTime interval = 2 min Hyd. volume = 53.696 cuft Curve number = 75* Drainage area = 4.940 acBasin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 28.90 min = TR55 Total precip. Distribution = Type II = 5.66 inShape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = $[(0.140 \times 98) + (4.800 \times 74)] / 4.940$

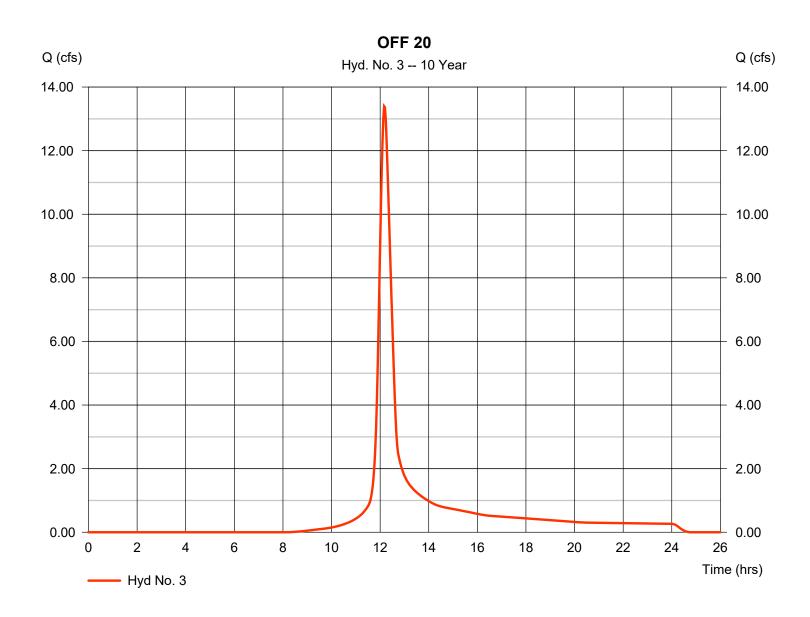


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 4

EX POI 2 (AT CULVERT)

Hydrograph type = Combine Peak discharge = 36.54 cfsStorm frequency = 10 yrsTime to peak $= 12.17 \, hrs$ Time interval = 2 min Hyd. volume = 139,427 cuft Inflow hyds. = 1, 3 Contrib. drain. area = 13.210 ac

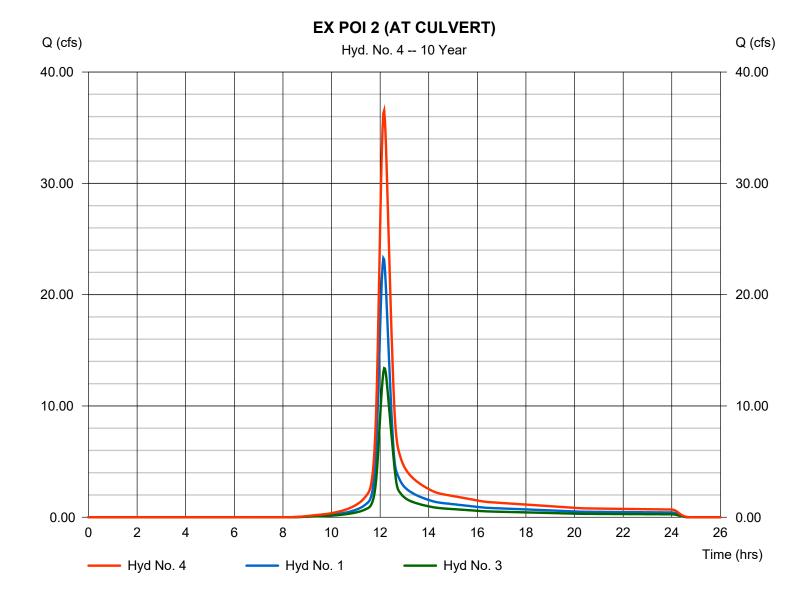

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 5

DEV 10

Hydrograph type = SCS Runoff Peak discharge = 22.55 cfsStorm frequency = 10 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 49.797 cuft Curve number Drainage area = 3.090 ac= 92* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 5.66 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = $[(2.050 \times 98) + (1.040 \times 80)] / 3.090$

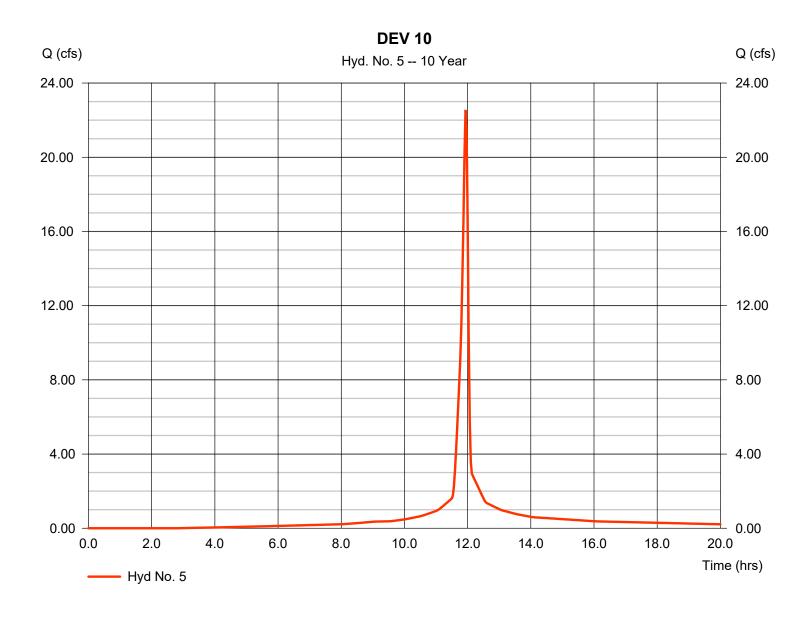

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 6

DEV 30

Hydrograph type = SCS Runoff Peak discharge = 28.62 cfsStorm frequency = 10 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 61.008 cuft = 4.170 ac Curve number Drainage area = 88* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) $= 5.00 \, \text{min}$ = User Total precip. = 5.66 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = $[(1.850 \times 98) + (1.510 \times 80) + (0.810 \times 80)] / 4.170$

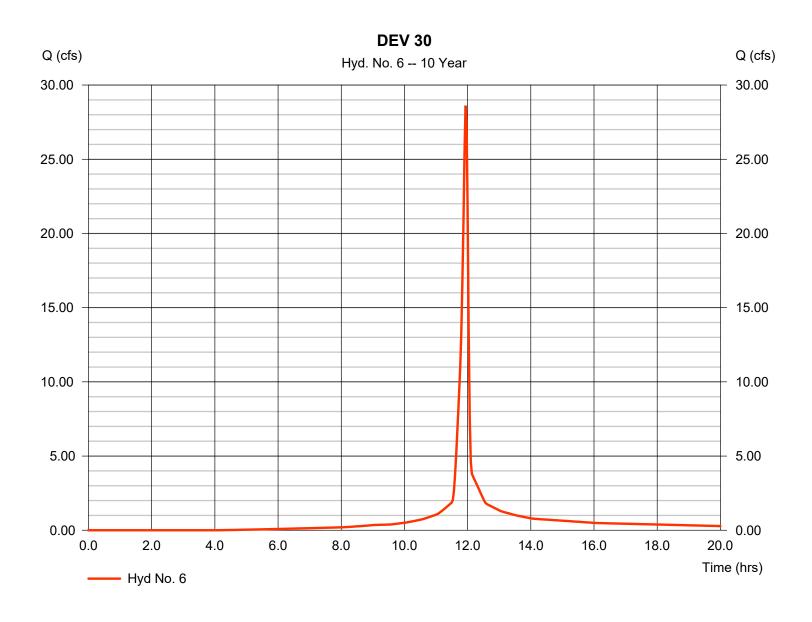

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 7

BIO 1

Hydrograph type = Reservoir Peak discharge = 8.272 cfsStorm frequency = 10 yrsTime to peak $= 12.03 \, hrs$ Time interval = 2 min Hyd. volume = 49,784 cuft Max. Elevation Inflow hyd. No. = 5 - DEV 10 = 1021.90 ftReservoir name = BIORETENTION 1 Max. Storage = 17,339 cuft

Storage Indication method used.

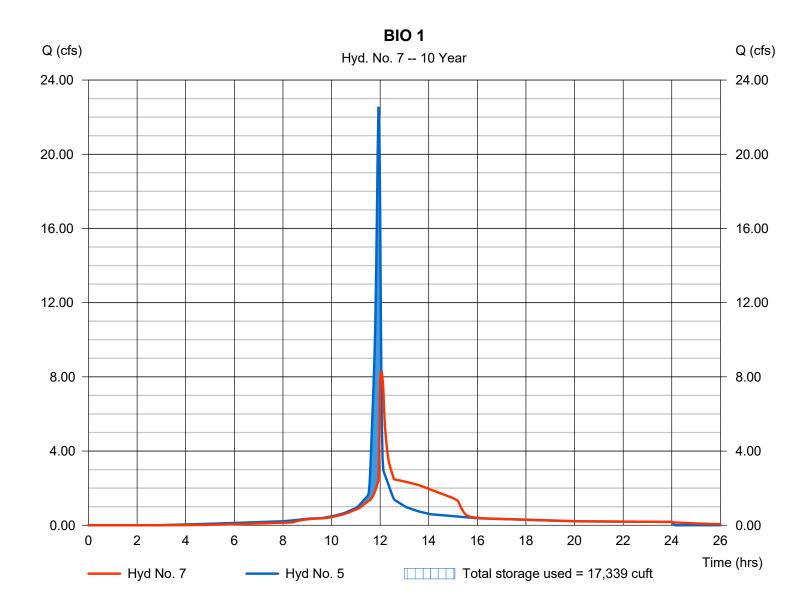


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 8

COMBINE

Hydrograph type = Combine Peak discharge = 31.96 cfsTime to peak Storm frequency = 10 yrs $= 11.97 \, hrs$ Time interval = 2 min Hyd. volume = 110,792 cuft Inflow hyds. = 6, 7 Contrib. drain. area = 4.170 ac

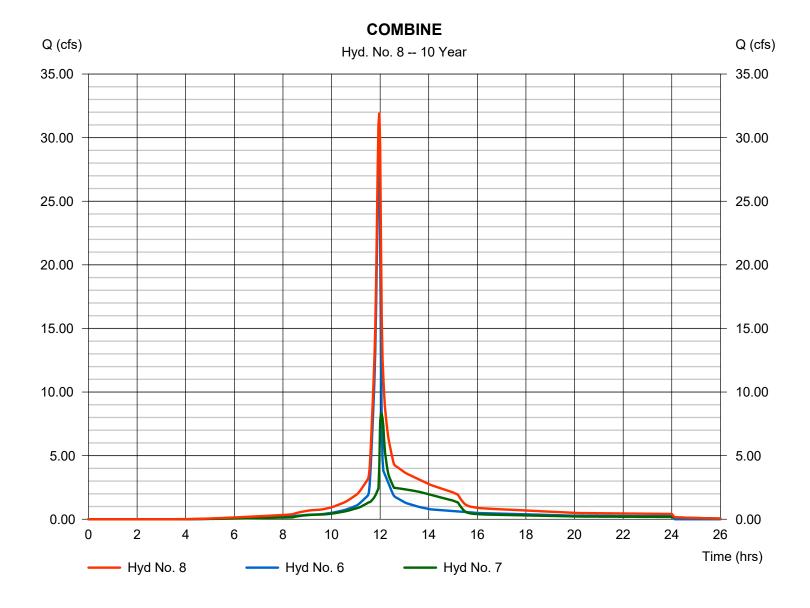

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 9

DETENTION POND 1

Hydrograph type = Reservoir Peak discharge = 3.142 cfsStorm frequency = 10 yrsTime to peak $= 13.60 \, hrs$ Time interval = 2 min Hyd. volume = 110,789 cuftInflow hyd. No. Max. Elevation = 8 - COMBINE = 1020.48 ftReservoir name = DRY DETENTION 1 Max. Storage = 51,919 cuft

Storage Indication method used.

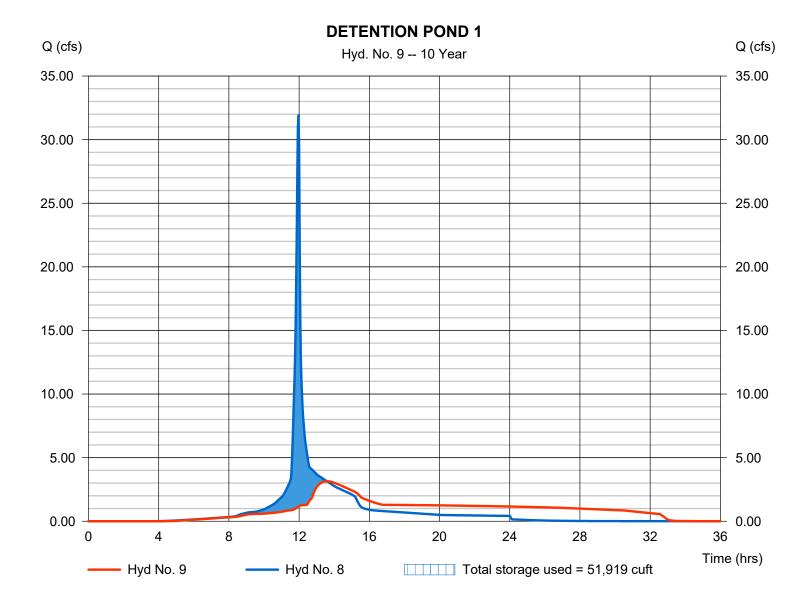

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 10

DA 11 (US ROUTE 50)

Hydrograph type = SCS Runoff Peak discharge = 7.144 cfsStorm frequency = 10 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 15,124 cuft Curve number Drainage area = 1.060 ac= 87* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 5.66 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(0.400 x 98) + (0.660 x 80)] / 1.060

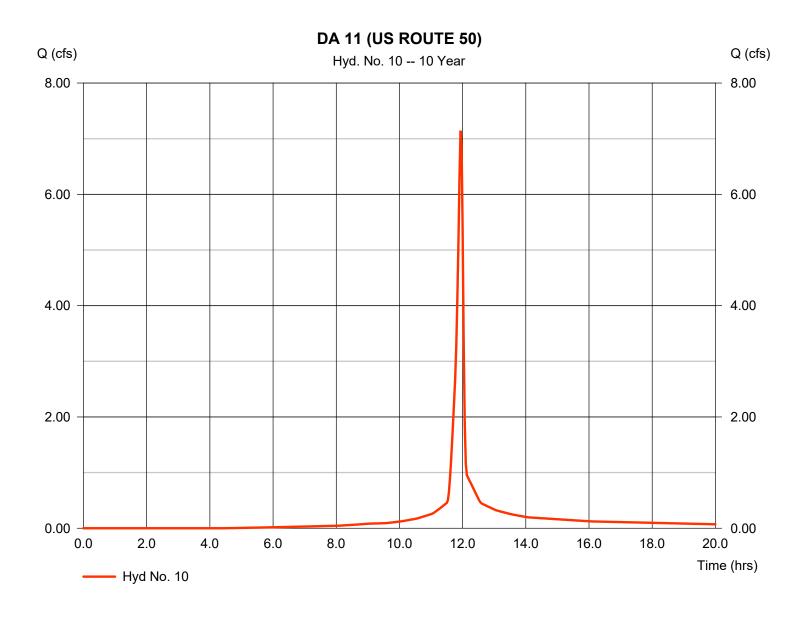


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 11

DEV POI 1

Hydrograph type = Combine Peak discharge = 8.266 cfsStorm frequency = 10 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 125,913 cuft Inflow hyds. = 9, 10 Contrib. drain. area = 1.060 ac

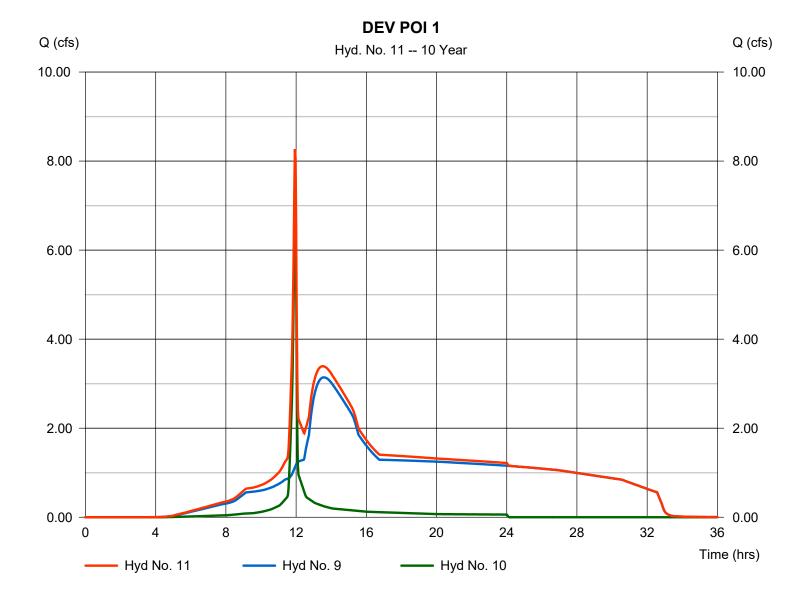

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 12

DEV 20

Hydrograph type = SCS Runoff Peak discharge = 17.94 cfsStorm frequency = 10 yrsTime to peak = 11.93 hrsTime interval = 2 min Hyd. volume = 38.875 cuft Curve number Drainage area = 2.530 ac= 90* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 5.66 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = $[(1.370 \times 98) + (1.160 \times 80)] / 2.530$

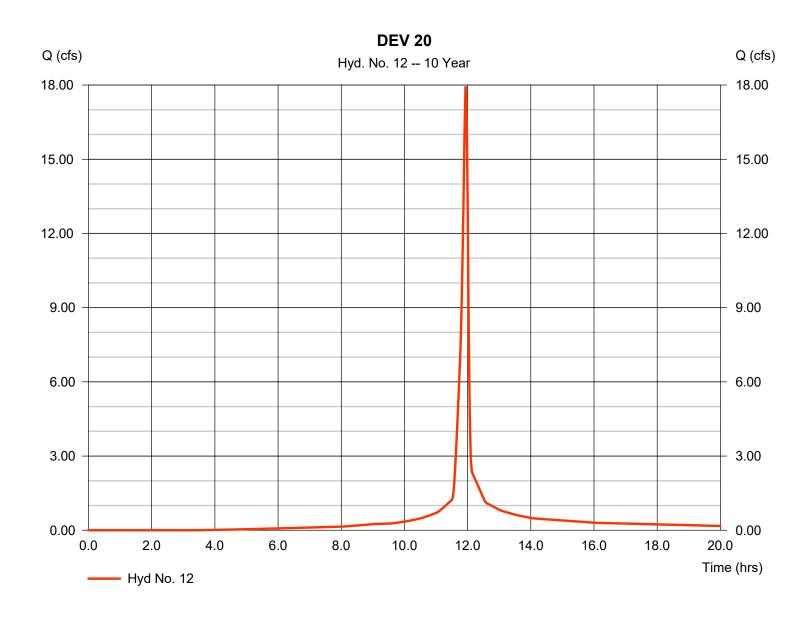

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 13

BIORETENTION 2

Hydrograph type = Reservoir Peak discharge = 4.782 cfsStorm frequency = 10 yrsTime to peak = 12.07 hrsTime interval = 2 min Hyd. volume = 38,859 cuftMax. Elevation = 1021.11 ft Inflow hyd. No. = 12 - DEV 20 = BIORETENTION 2 Reservoir name Max. Storage = 17,438 cuft

Storage Indication method used.

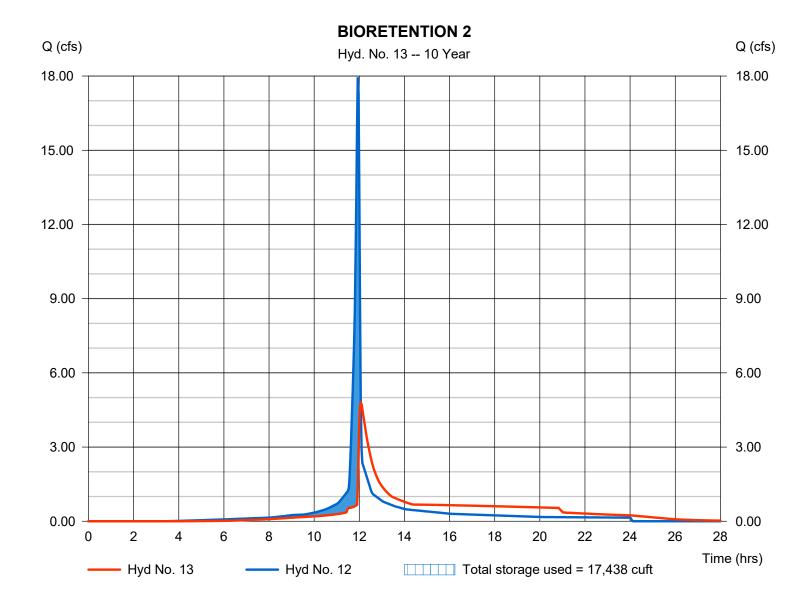

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 14

DA 21 (PR. PUBLIC ACCESS ROAD)

Hydrograph type = SCS Runoff Peak discharge = 11.77 cfsStorm frequency = 10 yrsTime to peak = 11.93 hrsTime interval = 2 min Hyd. volume = 24.758 cuft Curve number Drainage area = 1.780 ac= 86* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) $= 5.00 \, \text{min}$ = User Total precip. = 5.66 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = [(0.630 x 98) + (1.150 x 80)] / 1.780

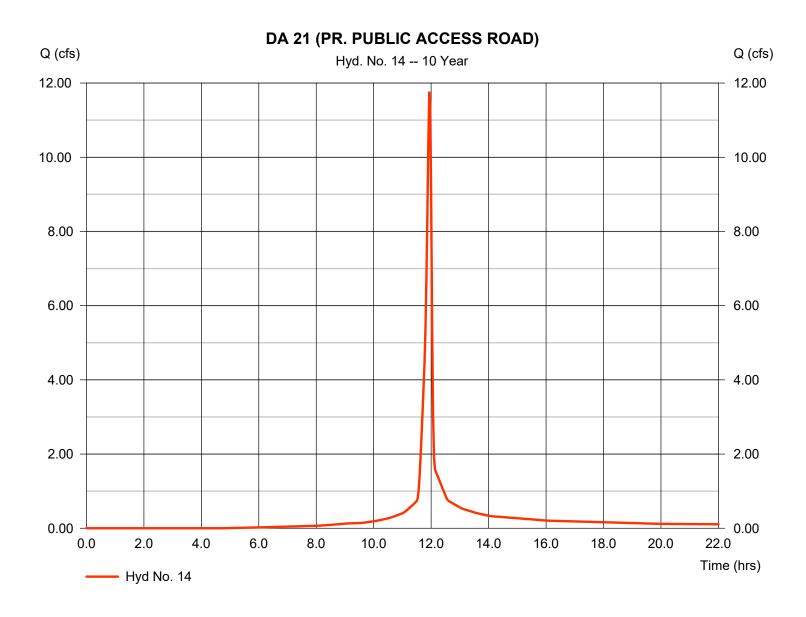

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 15

OFF 20

Hydrograph type = SCS Runoff Peak discharge = 13.39 cfsStorm frequency = 10 yrsTime to peak = 12.17 hrsTime interval = 2 min Hyd. volume = 53.696 cuft Curve number = 75* Drainage area = 4.940 acBasin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 28.90 min = User Total precip. = 5.66 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.190 \times 98) + (4.750 \times 74)] / 4.940$

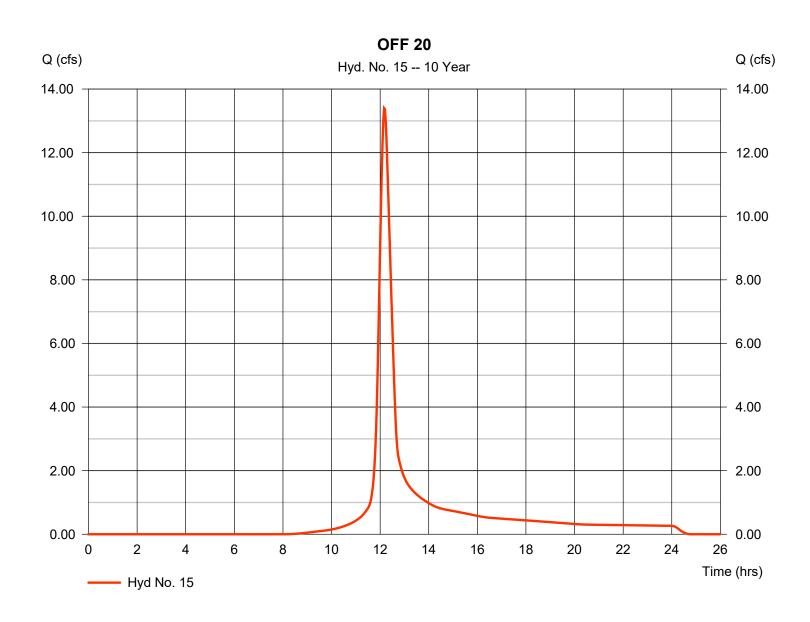

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 16

OFF DA 22 (US ROUTE 50)

Hydrograph type = SCS Runoff Peak discharge = 3.774 cfsStorm frequency = 10 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 7,990 cuftCurve number Drainage area = 0.560 ac= 87* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 5.66 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(0.210 x 98) + (0.350 x 80)] / 0.560

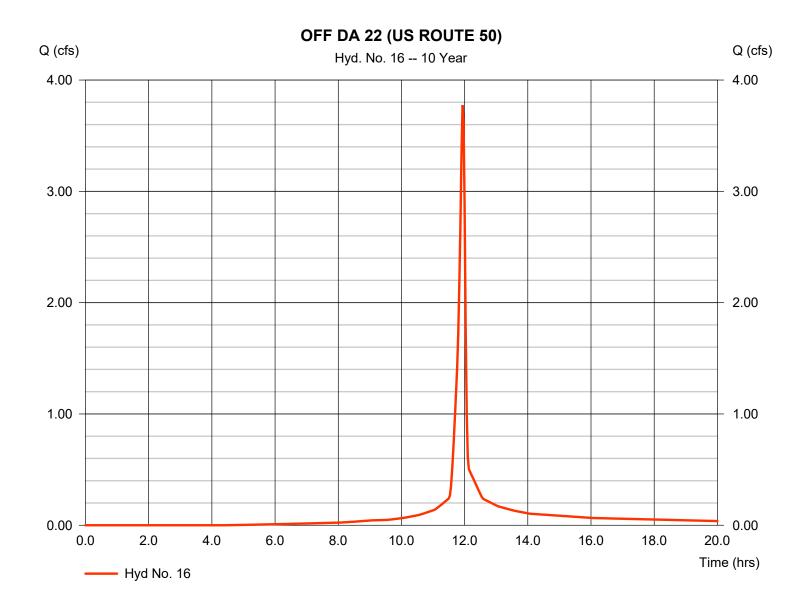


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 17

DEV POI 2 (AT CULVERT)

Hydrograph type = Combine Peak discharge = 25.51 cfsStorm frequency = 10 yrsTime to peak $= 11.97 \, hrs$ Time interval = 2 min Hyd. volume = 125,303 cuft Contrib. drain. area = 7.280 acInflow hyds. = 13, 14, 15, 16

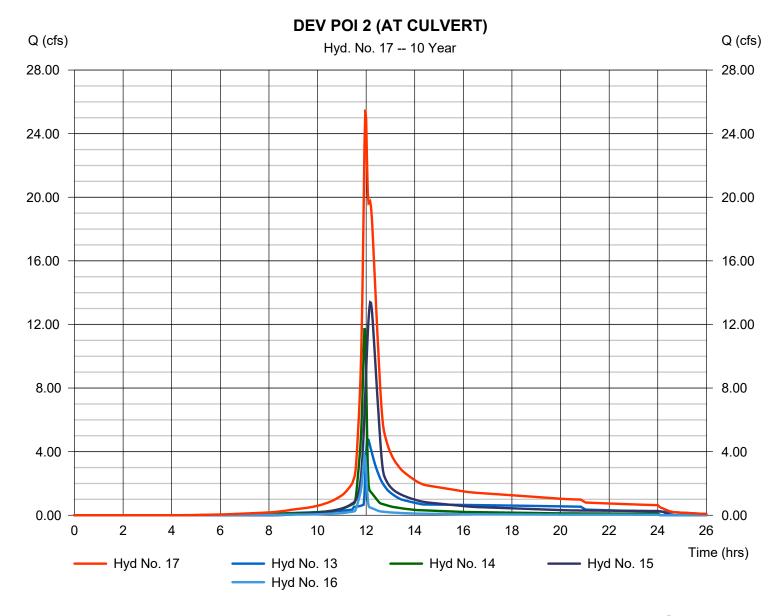

Hydrograph Summary Report Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	48.62	2	728	179,000				EX 20
2	SCS Runoff	23.85	2	728	87,924				EX 10 (POI 1)
3	SCS Runoff	27.64	2	730	110,864				OFF 20
4	Combine	75.69	2	728	289,864	1, 3			EX POI 2 (AT CULVERT)
5	SCS Runoff	38.09	2	716	87,096				DEV 10
6	SCS Runoff	49.93	2	716	110,597				DEV 30
7	Reservoir	10.22	2	724	87,083	5	1022.97	30,074	BIO 1
8	Combine	59.12	2	716	197,680	6, 7			COMBINE
9	Reservoir	18.68	2	726	197,678	8	1021.03	67,289	DETENTION POND 1
10	SCS Runoff	12.58	2	716	27,670				DA 11 (US ROUTE 50)
11	Combine	22.80	2	722	225,348	9, 10			DEV POI 1
12	SCS Runoff	30.78	2	716	69,210				DEV 20
13	Reservoir	6.010	2	726	69,194	12	1022.23	30,379	BIORETENTION 2
14	SCS Runoff	20.92	2	716	45,720				DA 21 (PR. PUBLIC ACCESS ROAD
15	SCS Runoff	27.64	2	730	110,864				OFF 20
16	SCS Runoff	6.646	2	716	14,618				OFF DA 22 (US ROUTE 50)
17	Combine	49.19	2	718	240,396	13, 14, 15, 16			DEV POI 2 (AT CULVERT)
81450_24-HR ANALYSIS.gpw				Return F	Return Period: 100 Year			Friday, 02 / 15 / 2019 Page 57	

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019


Hyd. No. 1

EX 20

Hydrograph type = SCS Runoff Peak discharge = 48.62 cfsStorm frequency = 100 yrsTime to peak $= 12.13 \, hrs$ Time interval = 2 min Hyd. volume = 179,000 cuftDrainage area = 8.270 acCurve number = 74* Basin Slope = 0.0 %Hydraulic length = 0 ft

Tc method = TR55 Time of conc. (Tc) = 25.10 min
Total precip. = 9.25 in Distribution = Type II
Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.110 \times 98) + (8.160 \times 74)] / 8.270$

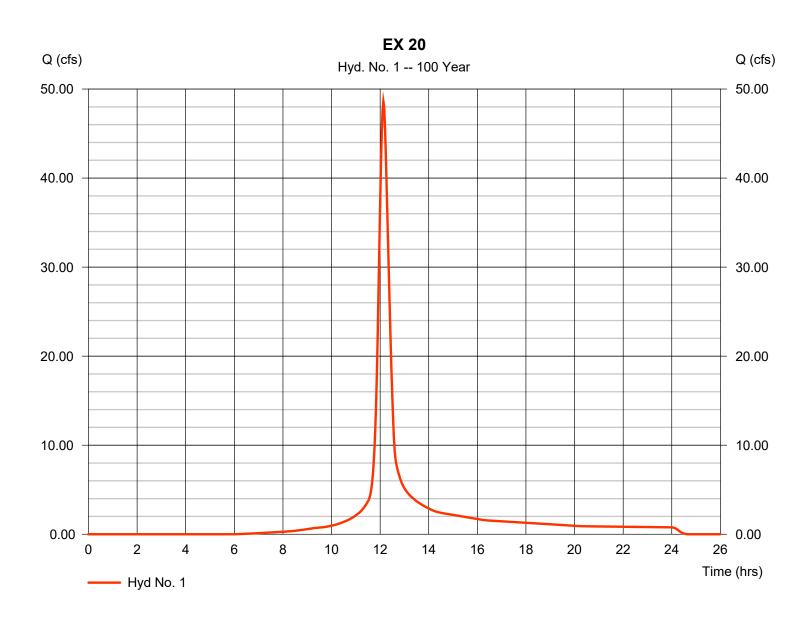

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 2

EX 10 (POI 1)

Hydrograph type = SCS Runoff Peak discharge = 23.85 cfsStorm frequency = 100 yrsTime to peak = 12.13 hrsTime interval = 2 min Hyd. volume = 87.924 cuft Curve number Drainage area = 3.980 ac= 75* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 26.30 min = TR55 Total precip. = 9.25 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = $[(0.090 \times 98) + (3.890 \times 74)] / 3.980$

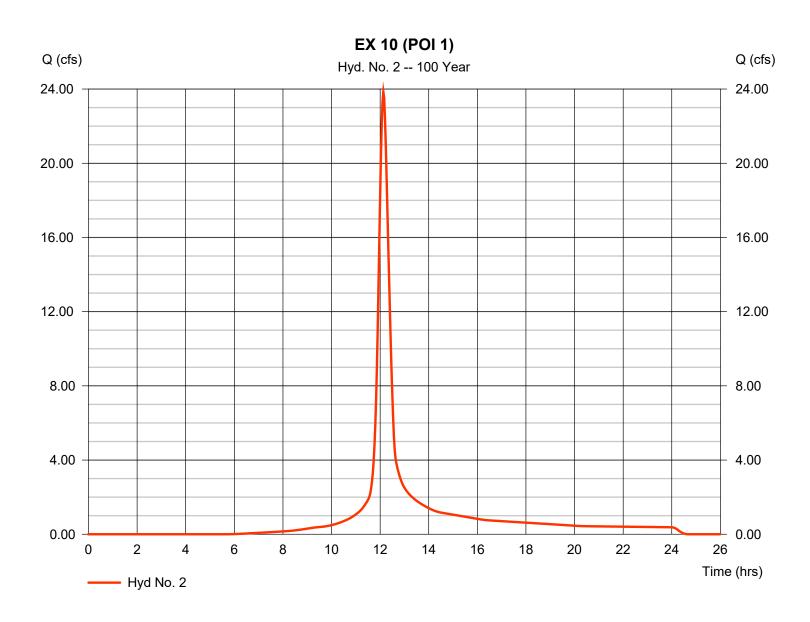

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019


Hyd. No. 3

OFF 20

Hydrograph type = SCS Runoff Peak discharge = 27.64 cfsStorm frequency = 100 yrsTime to peak = 12.17 hrsTime interval = 2 min Hyd. volume = 110.864 cuft Curve number = 75* Drainage area = 4.940 ac

Tc method= TR55Time of conc. (Tc)= 28.90 minTotal precip.= 9.25 inDistribution= Type IIStorm duration= 24 hrsShape factor= 484

^{*} Composite (Area/CN) = $[(0.140 \times 98) + (4.800 \times 74)] / 4.940$

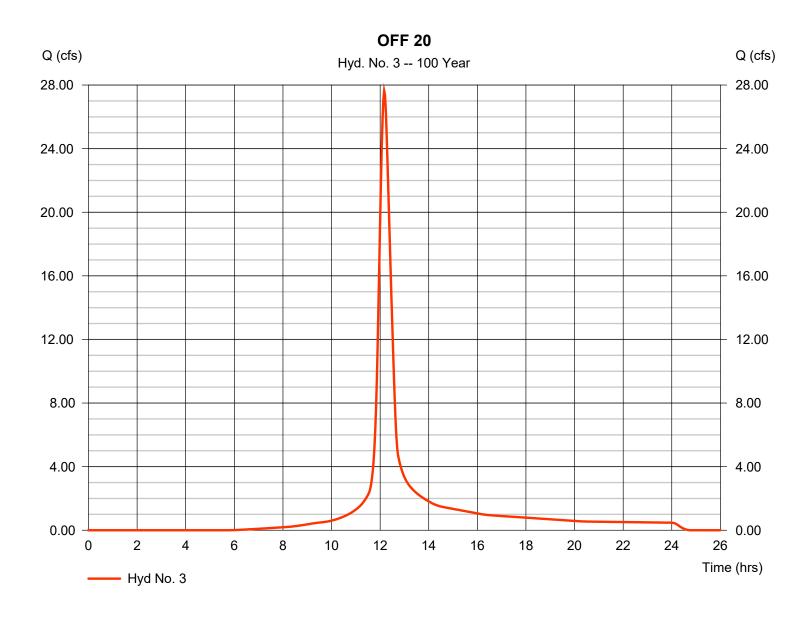


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 4

EX POI 2 (AT CULVERT)

Hydrograph type = Combine = 75.69 cfsPeak discharge Storm frequency = 100 yrsTime to peak $= 12.13 \, hrs$ Time interval = 2 min Hyd. volume = 289,864 cuft = 1, 3 Contrib. drain. area Inflow hyds. = 13.210 ac

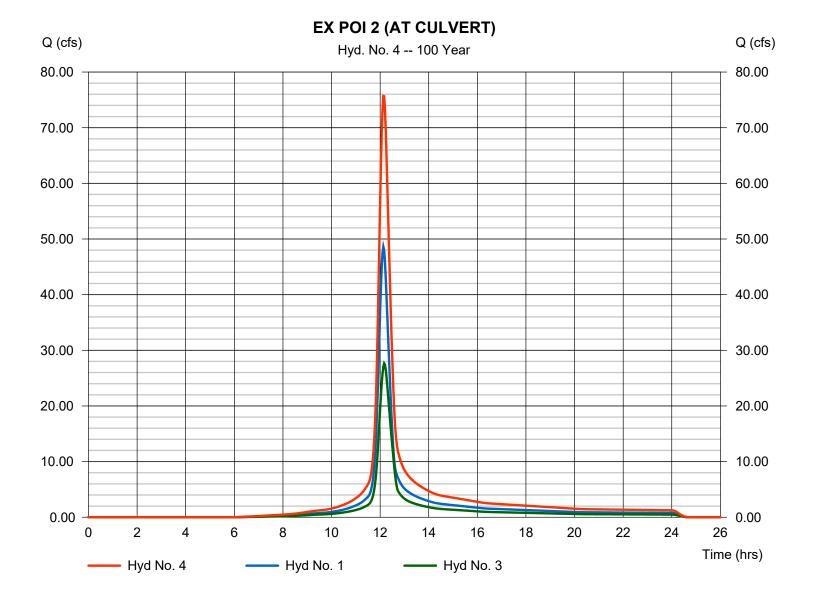

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 5

DEV 10

Hydrograph type = SCS Runoff Peak discharge = 38.09 cfsStorm frequency = 100 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 87.096 cuft Curve number Drainage area = 3.090 ac= 92* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) $= 5.00 \, \text{min}$ = User Total precip. = 9.25 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(2.050 \times 98) + (1.040 \times 80)] / 3.090$

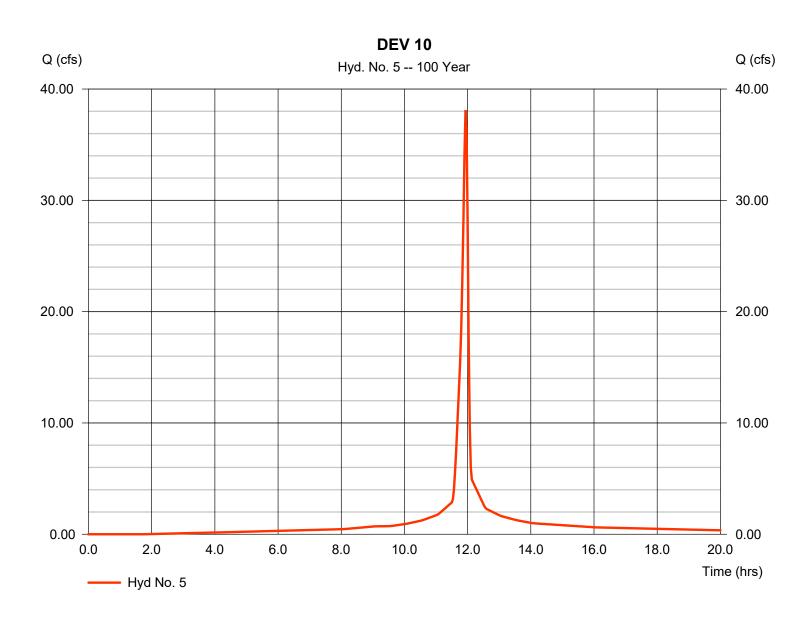

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

= 24 hrs

* Composite (Area/CN) = $[(1.850 \times 98) + (1.510 \times 80) + (0.810 \times 80)] / 4.170$

Friday, 02 / 15 / 2019

= 484


Hyd. No. 6

Storm duration

DEV 30

Hydrograph type = SCS Runoff Peak discharge = 49.93 cfsStorm frequency = 100 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 110,597 cuft= 4.170 acCurve number Drainage area = 88* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 9.25 inDistribution = Type II

Shape factor

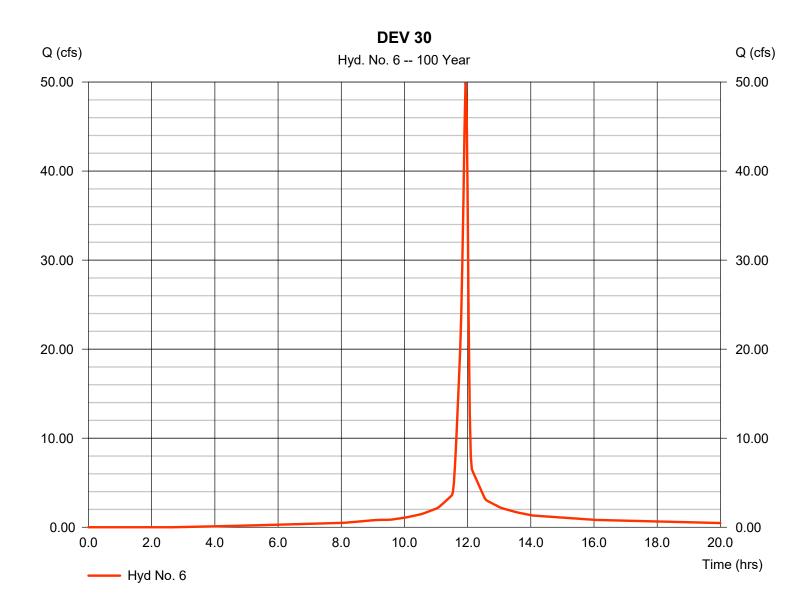

[·]

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 7

BIO₁

Hydrograph type = Reservoir Peak discharge = 10.22 cfsStorm frequency = 100 yrsTime to peak = 12.07 hrsTime interval = 2 min Hyd. volume = 87,083 cuft Inflow hyd. No. Max. Elevation = 1022.97 ft= 5 - DEV 10 = BIORETENTION 1 Reservoir name Max. Storage = 30,074 cuft

Storage Indication method used.

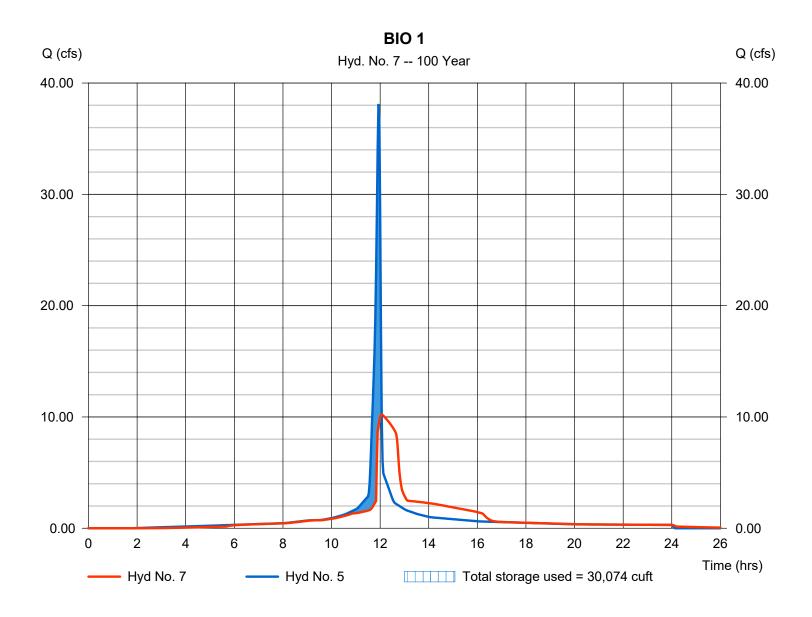


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 8

COMBINE

Hydrograph type = Combine Peak discharge = 59.12 cfsTime to peak Storm frequency = 100 yrs $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 197,680 cuft Inflow hyds. = 6, 7 Contrib. drain. area = 4.170 ac

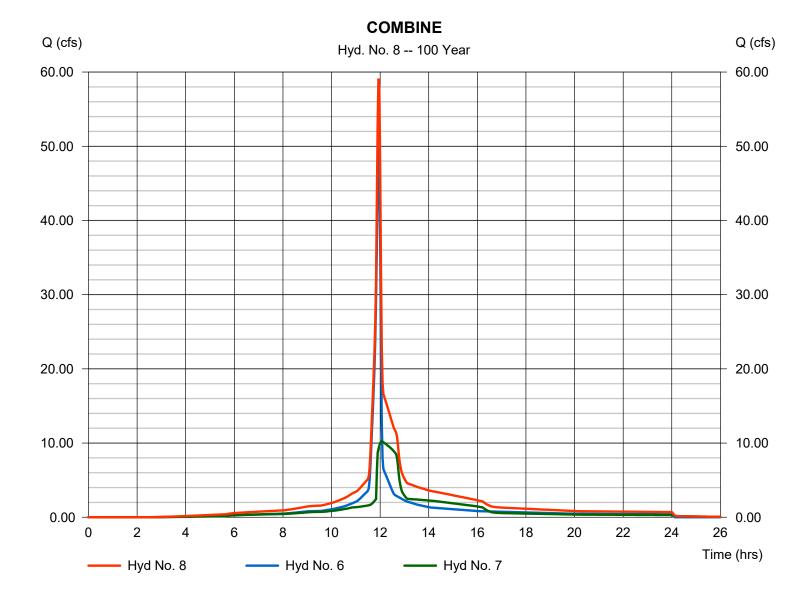

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 9

DETENTION POND 1

Hydrograph type = Reservoir Peak discharge = 18.68 cfsStorm frequency = 100 yrsTime to peak = 12.10 hrsTime interval = 2 min Hyd. volume = 197,678 cuft Inflow hyd. No. Max. Elevation = 1021.03 ft= 8 - COMBINE Reservoir name = DRY DETENTION 1 Max. Storage = 67,289 cuft

Storage Indication method used.

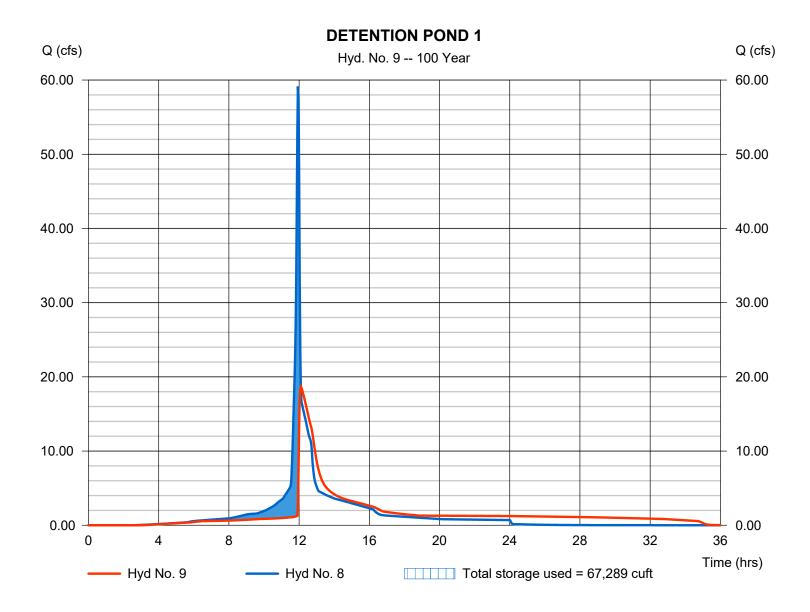

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 10

DA 11 (US ROUTE 50)

Hydrograph type = SCS Runoff Peak discharge = 12.58 cfsStorm frequency Time to peak $= 11.93 \, hrs$ = 100 yrsTime interval = 2 min Hyd. volume = 27.670 cuftCurve number Drainage area = 1.060 ac= 87* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 9.25 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(0.400 x 98) + (0.660 x 80)] / 1.060

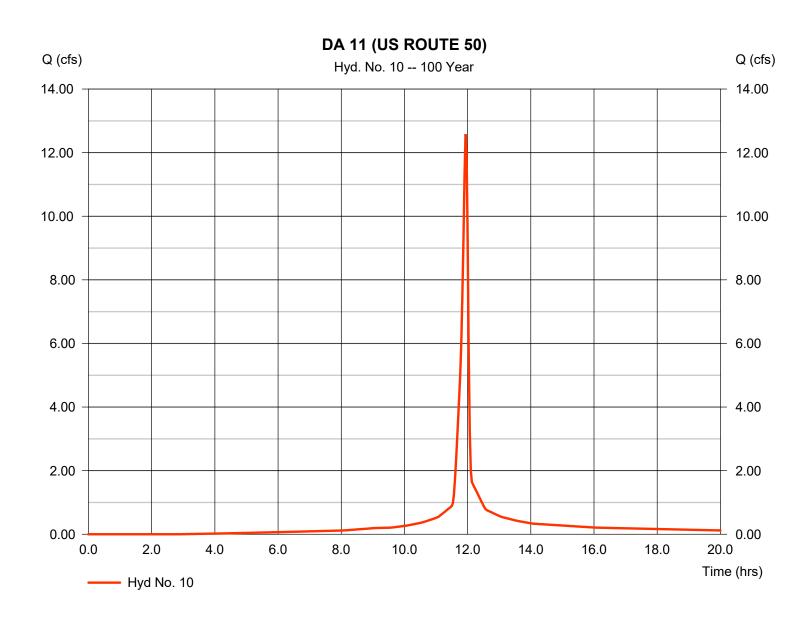


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 11

DEV POI 1

Hydrograph type = Combine Peak discharge = 22.80 cfsTime to peak Storm frequency = 100 yrs $= 12.03 \, hrs$ Time interval = 2 min Hyd. volume = 225,348 cuft Inflow hyds. = 9, 10 Contrib. drain. area = 1.060 ac

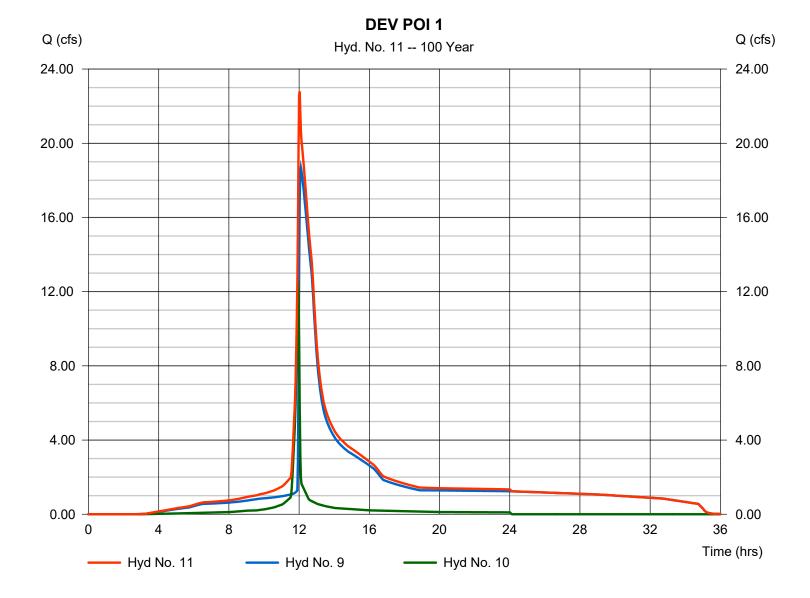

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 12

DEV 20

Hydrograph type = SCS Runoff Peak discharge = 30.78 cfsStorm frequency = 100 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 69.210 cuftDrainage area = 2.530 acCurve number = 90* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 9.25 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = [(1.370 x 98) + (1.160 x 80)] / 2.530

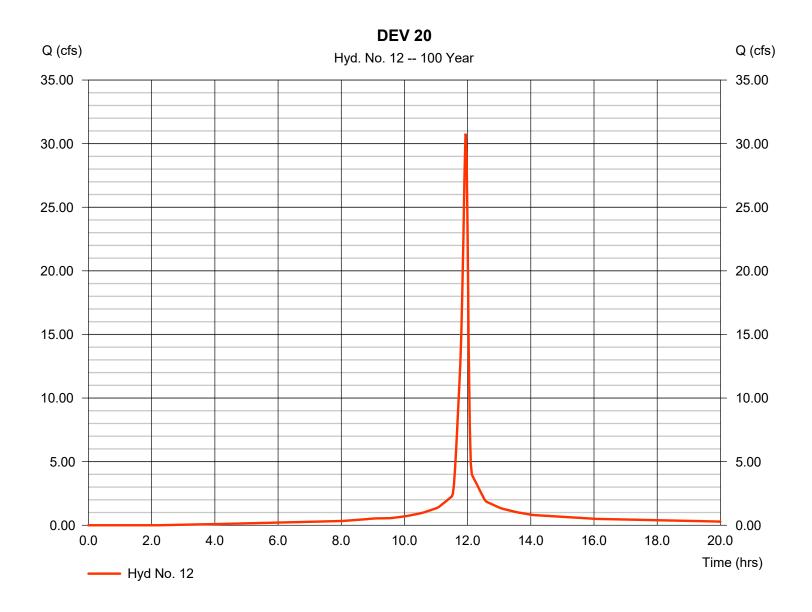

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 13

BIORETENTION 2

Hydrograph type = Reservoir Peak discharge = 6.010 cfsStorm frequency = 100 yrsTime to peak = 12.10 hrsTime interval = 2 min Hyd. volume = 69,194 cuft Max. Elevation Inflow hyd. No. = 12 - DEV 20 = 1022.23 ftReservoir name = BIORETENTION 2 Max. Storage = 30,379 cuft

Storage Indication method used.

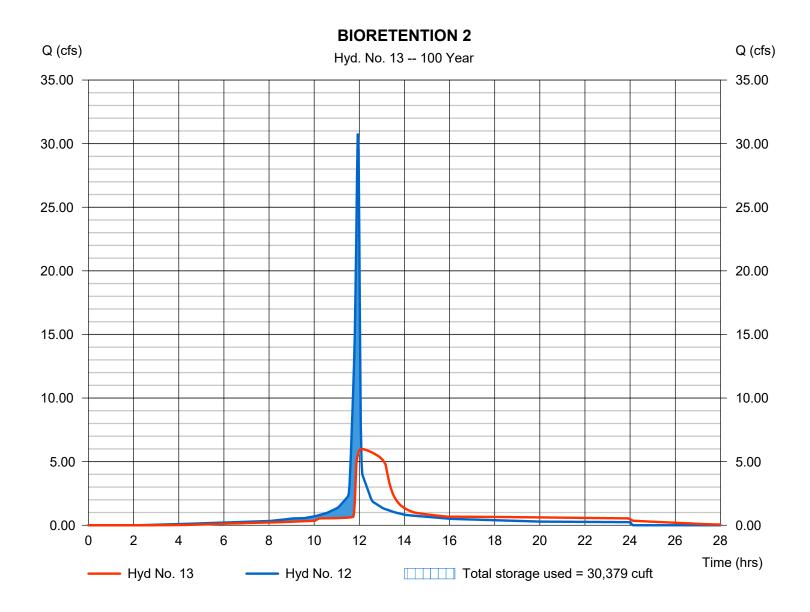

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 14

DA 21 (PR. PUBLIC ACCESS ROAD)

Hydrograph type = SCS Runoff Peak discharge = 20.92 cfsStorm frequency = 100 yrsTime to peak $= 11.93 \, hrs$ Time interval = 2 min Hyd. volume = 45.720 cuft= 1.780 ac Curve number Drainage area = 86* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 9.25 inDistribution = Type II Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.630 \times 98) + (1.150 \times 80)] / 1.780$

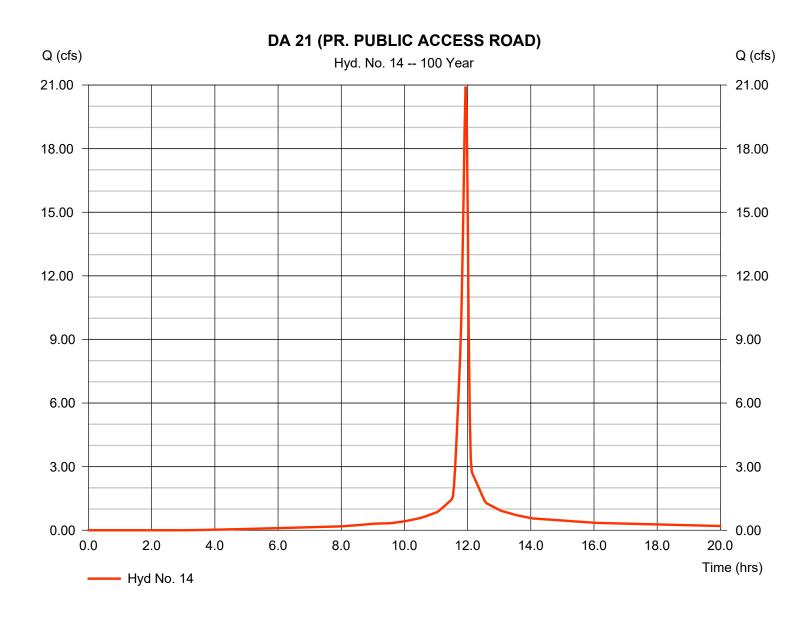

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 15


OFF 20

Hydrograph type = SCS Runoff Peak discharge = 27.64 cfsStorm frequency = 100 yrsTime to peak = 12.17 hrsTime interval = 2 min Hyd. volume = 110.864 cuft Curve number = 75* Drainage area = 4.940 ac

Basin Slope = 0.0 % Hydraulic length = 0 ft
Tc method = User Time of conc. (Tc) = 28.9

Tc method= UserTime of conc. (Tc)= 28.90 minTotal precip.= 9.25 inDistribution= Type IIStorm duration= 24 hrsShape factor= 484

^{*} Composite (Area/CN) = $[(0.190 \times 98) + (4.750 \times 74)] / 4.940$

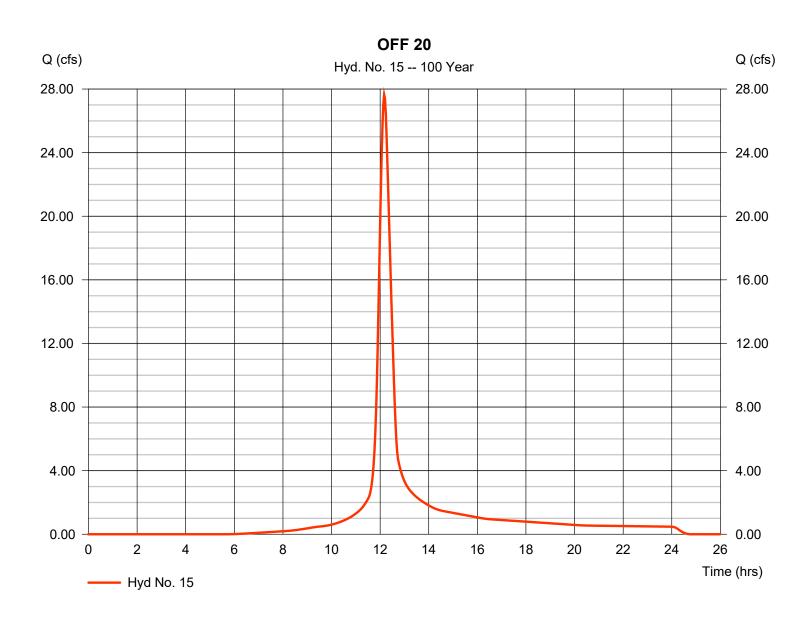

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020


Friday, 02 / 15 / 2019

Hyd. No. 16

OFF DA 22 (US ROUTE 50)

Hydrograph type = SCS Runoff Peak discharge = 6.646 cfsStorm frequency = 100 yrsTime to peak = 11.93 hrsTime interval = 2 min Hyd. volume = 14.618 cuft Curve number Drainage area = 0.560 ac= 87* Basin Slope = 0.0 %Hydraulic length = 0 ftTc method Time of conc. (Tc) = 5.00 min = User Total precip. = 9.25 inDistribution = Type II Shape factor Storm duration = 24 hrs = 484

^{*} Composite (Area/CN) = [(0.210 x 98) + (0.350 x 80)] / 0.560

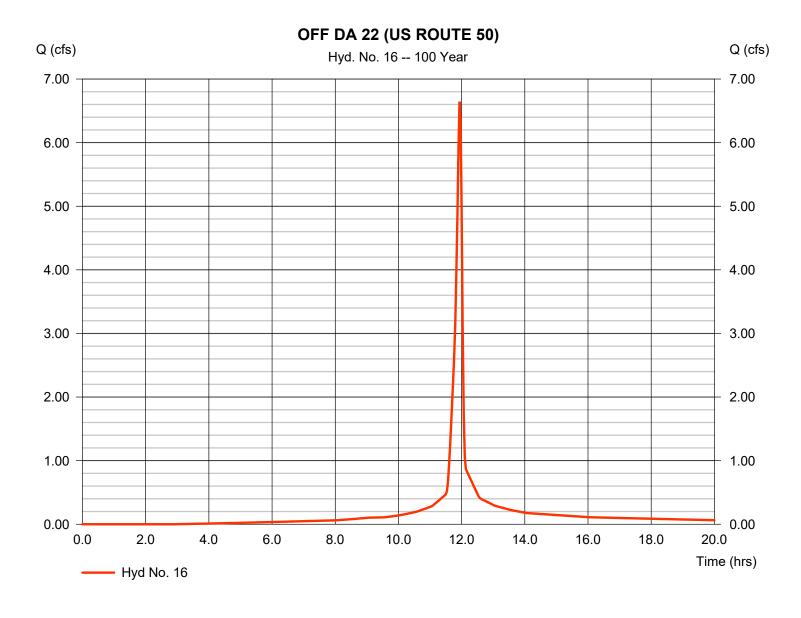


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Friday, 02 / 15 / 2019

Hyd. No. 17

DEV POI 2 (AT CULVERT)

Hydrograph type = Combine Peak discharge = 49.19 cfsStorm frequency = 100 yrsTime to peak $= 11.97 \, hrs$ Time interval = 2 min Hyd. volume = 240,396 cuft Contrib. drain. area = 7.280 acInflow hyds. = 13, 14, 15, 16

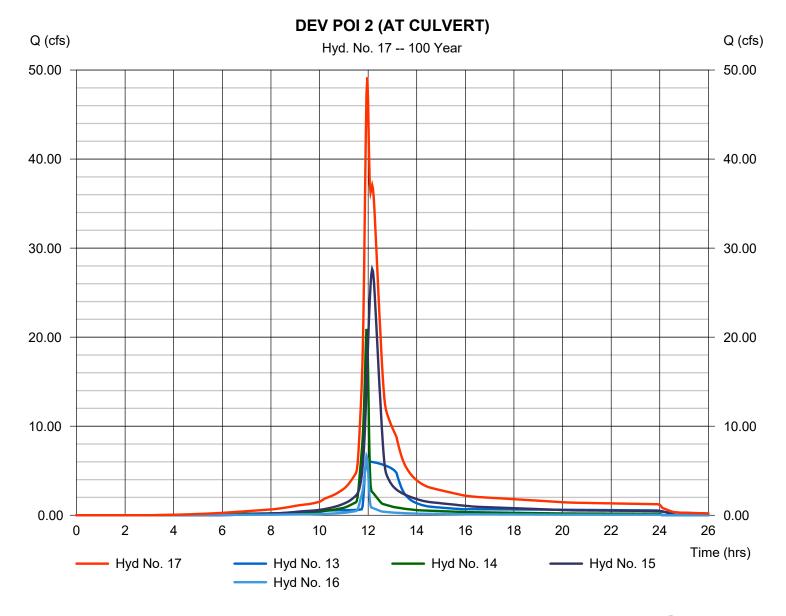

38° 54' 6" N



Web Soil Survey National Cooperative Soil Survey

1/7/2019 Page 1 of 4



38° 53' 55" N

National Cooperative Soil Survey Web Soil Survey

compiled and digitized probably differs from the background

imagery displayed on these maps. As a result, some minor

ΑD

B/D

В

shifting of map unit boundaries may be evident.

This product is generated from the USDA-NRCS certified data as Maps from the Web Soil Survey are based on the Web Mercator distance and area. A projection that preserves area, such as the Date(s) aerial images were photographed: Jun 11, 2017—Sep contrasting soils that could have been shown at a more detailed misunderstanding of the detail of mapping and accuracy of soil The orthophoto or other base map on which the soil lines were Enlargement of maps beyond the scale of mapping can cause projection, which preserves direction and shape but distorts Soil map units are labeled (as space allows) for map scales Source of Map: Natural Resources Conservation Service Albers equal-area conic projection, should be used if more line placement. The maps do not show the small areas of The soil surveys that comprise your AOI were mapped at Please rely on the bar scale on each map sheet for map accurate calculations of distance or area are required. Coordinate System: Web Mercator (EPSG:3857) MAP INFORMATION Warning: Soil Map may not be valid at this scale. Survey Area Data: Version 19, Sep 13, 2018 Jackson County, Missouri of the version date(s) listed below. Web Soil Survey URL: Soil Survey Area: 1:50,000 or larger. measurements. 1:24,000. scale. Not rated or not available Streams and Canals Interstate Highways Aerial Photography Major Roads Local Roads US Routes Rails C/D Water Features **Transportation** Background MAP LEGEND ŧ Not rated or not available Not rated or not available Area of Interest (AOI) Soil Rating Polygons Area of Interest (AOI) Soil Rating Points Soil Rating Lines C/D B/D C/D ΑD B/D ΑD Δ ပ В ⋖ ⋖ Soils



Hydrologic Soil Group

Map unit symbol Map unit name		Rating	Acres in AOI	Percent of AOI						
10000	Arisburg silt loam, 1 to 5 percent slopes	С	14.9	80.7%						
10082	Arisburg-Urban land complex, 1 to 5 percent slopes	С	3.6	19.3%						
Totals for Area of Intere	est	18.4	100.0%							

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition
Component Percent Cutoff: None Specified

Tie-break Rule: Higher



NOAA Atlas 14, Volume 8, Version 2 Location name: Lees Summit, Missouri, USA* Latitude: 38.9004°, Longitude: -94.3314° Elevation: 1024.15 ft** * source: ESRI Maps ** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Deborah Martin, Sandra Pavlovic, Ishani Roy, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Michael Yekta, Geoffery Bonnin

NOAA, National Weather Service, Silver Spring, Maryland

PF tabular | PF graphical | Maps & aerials

PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches) ¹												
Duration		Average recurrence interval (years)										
Duration	1	2	5	10	25	50	100	200	500	1000		
5-min	0.415 (0.324-0.529)	0.484 (0.378-0.618)	0.599 (0.466-0.767)	0.696 (0.539-0.894)	0.832 (0.625-1.10)	0.938 (0.691-1.25)	1.05 (0.748-1.43)	1.16 (0.798-1.62)	1.31 (0.871-1.87)	1.42 (0.926-2.07)		
10-min	0.607 (0.474-0.775)	0.709 (0.553-0.905)	0.877 (0.682-1.12)	1.02 (0.789-1.31)	1.22 (0.916-1.61)	1.37 (1.01-1.84)	1.53 (1.10-2.09)	1.70 (1.17-2.37)	1.92 (1.27-2.75)	2.08 (1.36-3.03)		
15-min	0.740 (0.578-0.945)	0.864 (0.674-1.10)	1.07 (0.832-1.37)	1.24 (0.962-1.60)	1.49 (1.12-1.96)	1.68 (1.23-2.24)	1.87 (1.34-2.55)	2.07 (1.43-2.89)	2.34 (1.56-3.35)	2.54 (1.65-3.69)		
30-min	1.02 (0.800-1.31)	1.20 (0.939-1.54)	1.50 (1.17-1.92)	1.75 (1.35-2.24)	2.09 (1.57-2.76)	2.36 (1.74-3.15)	2.63 (1.88-3.59)	2.91 (2.00-4.07)	3.28 (2.18-4.70)	3.57 (2.32-5.18)		
60-min	1.34 (1.05-1.71)	1.57 (1.23-2.01)	1.97 (1.53-2.52)	2.30 (1.78-2.95)	2.76 (2.08-3.66)	3.13 (2.31-4.20)	3.51 (2.51-4.80)	3.90 (2.69-5.46)	4.43 (2.95-6.35)	4.83 (3.14-7.02)		
2-hr	1.66 (1.30-2.10)	1.95 (1.53-2.47)	2.43 (1.91-3.09)	2.85 (2.22-3.63)	3.44 (2.61-4.53)	3.91 (2.90-5.20)	4.39 (3.16-5.97)	4.89 (3.40-6.81)	5.57 (3.74-7.94)	6.10 (4.00-8.80)		
3-hr	1.87 (1.48-2.36)	2.20 (1.74-2.78)	2.76 (2.17-3.49)	3.24 (2.54-4.11)	3.93 (3.00-5.16)	4.48 (3.35-5.95)	5.06 (3.67-6.86)	5.66 (3.95-7.85)	6.48 (4.38-9.22)	7.13 (4.70-10.3)		
6-hr	2.26 (1.80-2.82)	2.66 (2.12-3.34)	3.37 (2.67-4.22)	3.98 (3.14-5.01)	4.88 (3.76-6.37)	5.60 (4.22-7.39)	6.36 (4.65-8.57)	7.16 (5.05-9.89)	8.27 (5.63-11.7)	9.15 (6.07-13.1)		
12-hr	2.66 (2.13-3.30)	3.16 (2.54-3.93)	4.04 (3.23-5.03)	4.81 (3.83-6.02)	5.94 (4.62-7.72)	6.86 (5.21-9.00)	7.83 (5.77-10.5)	8.86 (6.30-12.2)	10.3 (7.06-14.5)	11.4 (7.64-16.2)		
24-hr	3.11 (2.51-3.82)	3.71 (2.99-4.57)	4.74 (3.82-5.86)	5.66 (4.54-7.02)	7.00 (5.48-9.03)	8.10 (6.20-10.5)	9.25 (6.88-12.3)	10.5 (7.51-14.3)	12.2 (8.44-17.0)	13.5 (9.14-19.1)		
2-day	3.66 (2.98-4.47)	4.31 (3.50-5.26)	5.43 (4.41-6.66)	6.43 (5.19-7.91)	7.90 (6.24-10.1)	9.10 (7.03-11.8)	10.4 (7.77-13.7)	11.7 (8.47-15.9)	13.6 (9.50-18.9)	15.1 (10.3-21.2)		
3-day	4.06 (3.33-4.94)	4.71 (3.85-5.73)	5.84 (4.76-7.12)	6.85 (5.55-8.38)	8.33 (6.61-10.6)	9.55 (7.41-12.3)	10.8 (8.16-14.3)	12.2 (8.87-16.5)	14.1 (9.92-19.5)	15.7 (10.7-21.9)		
4-day	4.40 (3.61-5.33)	5.05 (4.14-6.12)	6.17 (5.05-7.50)	7.18 (5.84-8.76)	8.65 (6.89-11.0)	9.87 (7.68-12.7)	11.1 (8.42-14.6)	12.5 (9.12-16.8)	14.4 (10.2-19.9)	16.0 (10.9-22.2)		
7-day	5.21 (4.30-6.27)	5.89 (4.86-7.10)	7.07 (5.82-8.53)	8.09 (6.62-9.80)	9.56 (7.64-12.0)	10.8 (8.41-13.7)	12.0 (9.11-15.6)	13.3 (9.74-17.7)	15.1 (10.7-20.6)	16.5 (11.4-22.9)		
10-day	5.90 (4.89-7.07)	6.66 (5.52-7.99)	7.93 (6.55-9.53)	9.00 (7.40-10.9)	10.5 (8.43-13.1)	11.7 (9.20-14.8)	13.0 (9.87-16.7)	14.2 (10.5-18.9)	16.0 (11.3-21.7)	17.3 (12.0-23.9)		
20-day	7.87 (6.58-9.35)	8.89 (7.43-10.6)	10.5 (8.78-12.6)	11.9 (9.85-14.2)	13.7 (11.0-16.8)	15.1 (11.9-18.7)	16.4 (12.5-20.9)	17.7 (13.1-23.2)	19.4 (13.9-26.1)	20.7 (14.5-28.3)		
30-day	9.51 (7.99-11.3)	10.8 (9.03-12.7)	12.7 (10.7-15.1)	14.3 (11.9-17.1)	16.4 (13.2-19.9)	17.9 (14.1-22.1)	19.3 (14.9-24.5)	20.8 (15.4-27.0)	22.5 (16.1-30.1)	23.7 (16.7-32.4)		
45-day	11.6 (9.80-13.7)	13.1 (11.1-15.5)	15.5 (13.0-18.3)	17.3 (14.5-20.6)	19.7 (15.9-23.8)	21.4 (17.0-26.3)	23.0 (17.7-28.9)	24.5 (18.2-31.6)	26.3 (18.9-34.9)	27.5 (19.4-37.3)		
60-day	13.4 (11.4-15.7)	15.1 (12.8-17.8)	17.8 (15.0-21.0)	19.9 (16.7-23.5)	22.5 (18.2-27.0)	24.3 (19.3-29.7)	26.0 (20.1-32.5)	27.5 (20.5-35.4)	29.3 (21.1-38.7)	30.5 (21.6-41.3)		


Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).

Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

Back to Top

PF graphical

PDS-based depth-duration-frequency (DDF) curves Latitude: 38.9004°, Longitude: -94.3314°

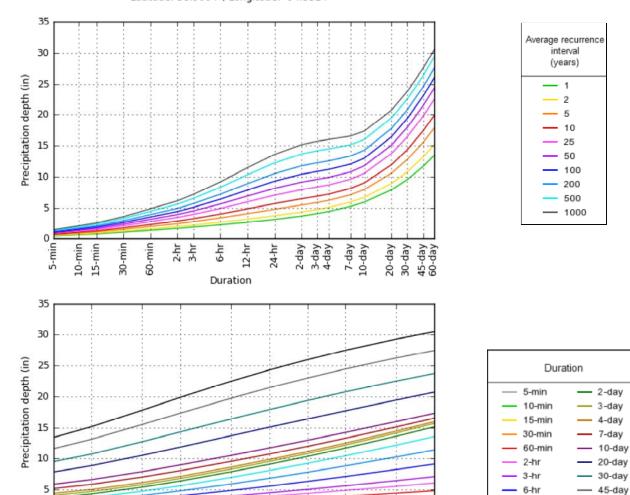

NOAA Atlas 14, Volume 8, Version 2

01

Created (GMT): Mon Jan 7 21:25:41 2019

500

1000

Back to Top

100

50

200

25

Average recurrence interval (years)

10


12-hr


24-hr


- 60-day

Maps & aerials



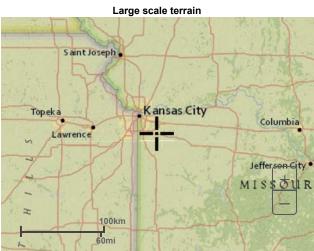

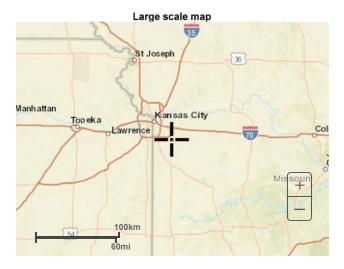

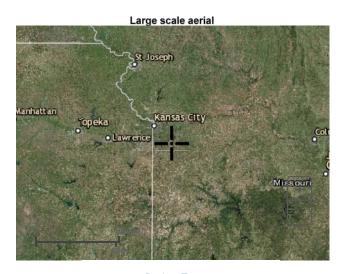

Back to Top

US Department of Commerce
National Oceanic and Atmospheric Administration
National Weather Service
National Water Center
1325 East West Highway
Silver Spring, MD 20910
Questions?: HDSC.Questions@noaa.gov

Disclaimer

APPENDIX B

Water Quality Calculations

DA 10 - Water Quality Volume Calculation Worksheet

Short Cut Method (Claytor and Schueler, 1996)

Date: 01/10/2019

Project Name: Lee's Summit Senior Living Facility

Description: DA 10 Water Quality Volume

Drainage Areas to Pond 1

$$WQV (ft^3) = (P/12)(R_v)(A*43,560)$$

Where

P = rainfall depth = 1.37 inches

 R_v = volumetric runoff coefficient = 0.05 + 0.009I

I = percent impervious cover (in percent, e.g. 80% = 80)

A = total site area in acres

P= 1.37 inch

A= 3.09 acres

Impervious Area= 2.05 acres

I= 66 % Rv= 0.644

WQV= 9896 cubic feet

0.227 ac-ft

DA 20 - Water Quality Volume Calculation Worksheet

Short Cut Method (Claytor and Schueler, 1996)

Date:

Project Name:

Description: DA 20 Water Quality Volume

WQV (ft³) =
$$(P/12)(R_v)(A*43,560)$$

Where

P = rainfall depth = 1 1.37 inches

 R_v = volumetric runoff coefficient = 0.05 + 0.009I

I = percent impervious cover (in percent, e.g. 80% = 80)

A = total site area in acres

P= 1.37 inch

A= 2.53 acres

Impervious Area = 1.37 acres

I= 54 % Rv= 0.536

WQV= 6744 cubic feet

0.155 ac-ft

DA 30 - Water Quality Volume Calculation Worksheet

Short Cut Method (Claytor and Schueler, 1996)

Date:

Project Name:

Description: DA 30 Water Quality Volume

WQV (ft³) =
$$(P/12)(R_v)(A^*43,560)$$

Where

P = rainfall depth = 1 1.37 inches

 R_v = volumetric runoff coefficient = 0.05 + 0.009I

I = percent impervious cover (in percent, e.g. 80% = 80)

A = total site area in acres

P= 1.37 inch A= 4.17 acres

Impervious Area = 1.85 acres

I= 44 % Rv= 0.446

WQV= 9249 cubic feet

0.212 ac-ft

APPENDIX C

APWA\MARC BMP Level of Service Calculations

Date: Project: By: Location: Checked: Date: 1. **Runoff Curve Number Predevelopment CN** CN from Product of Cover Description Soil HSG Table 1 Area (ac.) CN x Area Pasture (GOOD) 9.78 C 74 Totals: Area-Weighted CN = total product/total area = (Round to integer) 74 **Postdevelopment CN** CN from Product of Soil HSG1 Table 1 Area (ac.) CN x Area Cover Description PAVEMENT/ROOFS 98 510.58 NA 5.21 OPEN SPACE (TURF.GOOD) 80 4.57 365.6 Totals: 9.78 876.18 Postdevelopment CN is one HSG higher for all cover types except preserved vegetation, absent documentation showing how postdevelopment soil structure will be preserved. Area-Weighted CN = total product/total area = (Round to integer) 90 Level of Service (LS) Calculation Change in CN LS 8 Predevelopment CN: 74 17+ 7 to 16 7 Postdevelopment CN: 90 4 to 6 6 1 to 3 5 Difference: 4 0 16 3 -7 to -1

WORKSHEET 1: REQUIRED LEVEL OF SERVICE - UNDEVELOPED SITE

-8 to -17

-18 to -21

-22 -

LS Required (see scale at right):

2

1

0

WORKSHEET 2: DEVELOP MITIGATION PACKAGE(S) THAT MEET THE REQUIRED LS Project: By: Date: Location: Checked: Date: Sheet __ of __ Required LS (New Development, Wksht 1) or Total VR (Redevelopment, Wksht 1A): Note: Various BMPs may alter CN of proposed development, and LS; recalculate both if applicable. 2. Proposed BMP Option Package No. ____ VR from Table 4.4 Product of VR Treatment or 4.6¹ Cover/BMP Description Area x Area **Extended Dry Detention Area** 1.11 4.0 4.44 Bioretention 1 DA10 3.09 8.5 26.26 Bioretention 2 DA 20 21.42 8.5 Bioretention 3 DA 30 3.06 26.01 Total² Total: 9.78 78.13 *Weighted VR: 7.99 = total product/total a VR calculated for final BMP only in Treatment Train. Total treatment area cannot exceed 100 percent of the actual site area. Blank In Redevelopment Meets required LS (Yes/No)? YES (If No, or if additional options are being tested, proceed below.) 3. Proposed BMP Option Package No. ____ VR from Table 4.4 Product of VR Treatment or 4.6¹ Cover/BMP Description Area x Area Extended Dry Detention Area 3.36 13.44 Bioretention 1 DA10 8.5 26.26 3.09 Bioretention 2 DA 20 8.5 21.42 2.52 Native Vegetation Establish 0.81 7.69 9.5

APWA / MARC BMP Manual 4-18 October 2012

Total:

move to next sheet.)

*Weighted VR:

68.81

7.03

(If No, or if additional options are being tested,

= total product/total a

Total²:

VR calculated for final BMP only in Treatment Train.

Blank In Redevelopment

Meets required LS (Yes/No)?

9.78

Total treatment area cannot exceed 100 percent of the actual site area.

YES

LEE'S SUMMIT SENIOR LIVING COMMUNITY

Lee's Summit, MO - 2019

January 2019

Olsson Project No. 018-1450