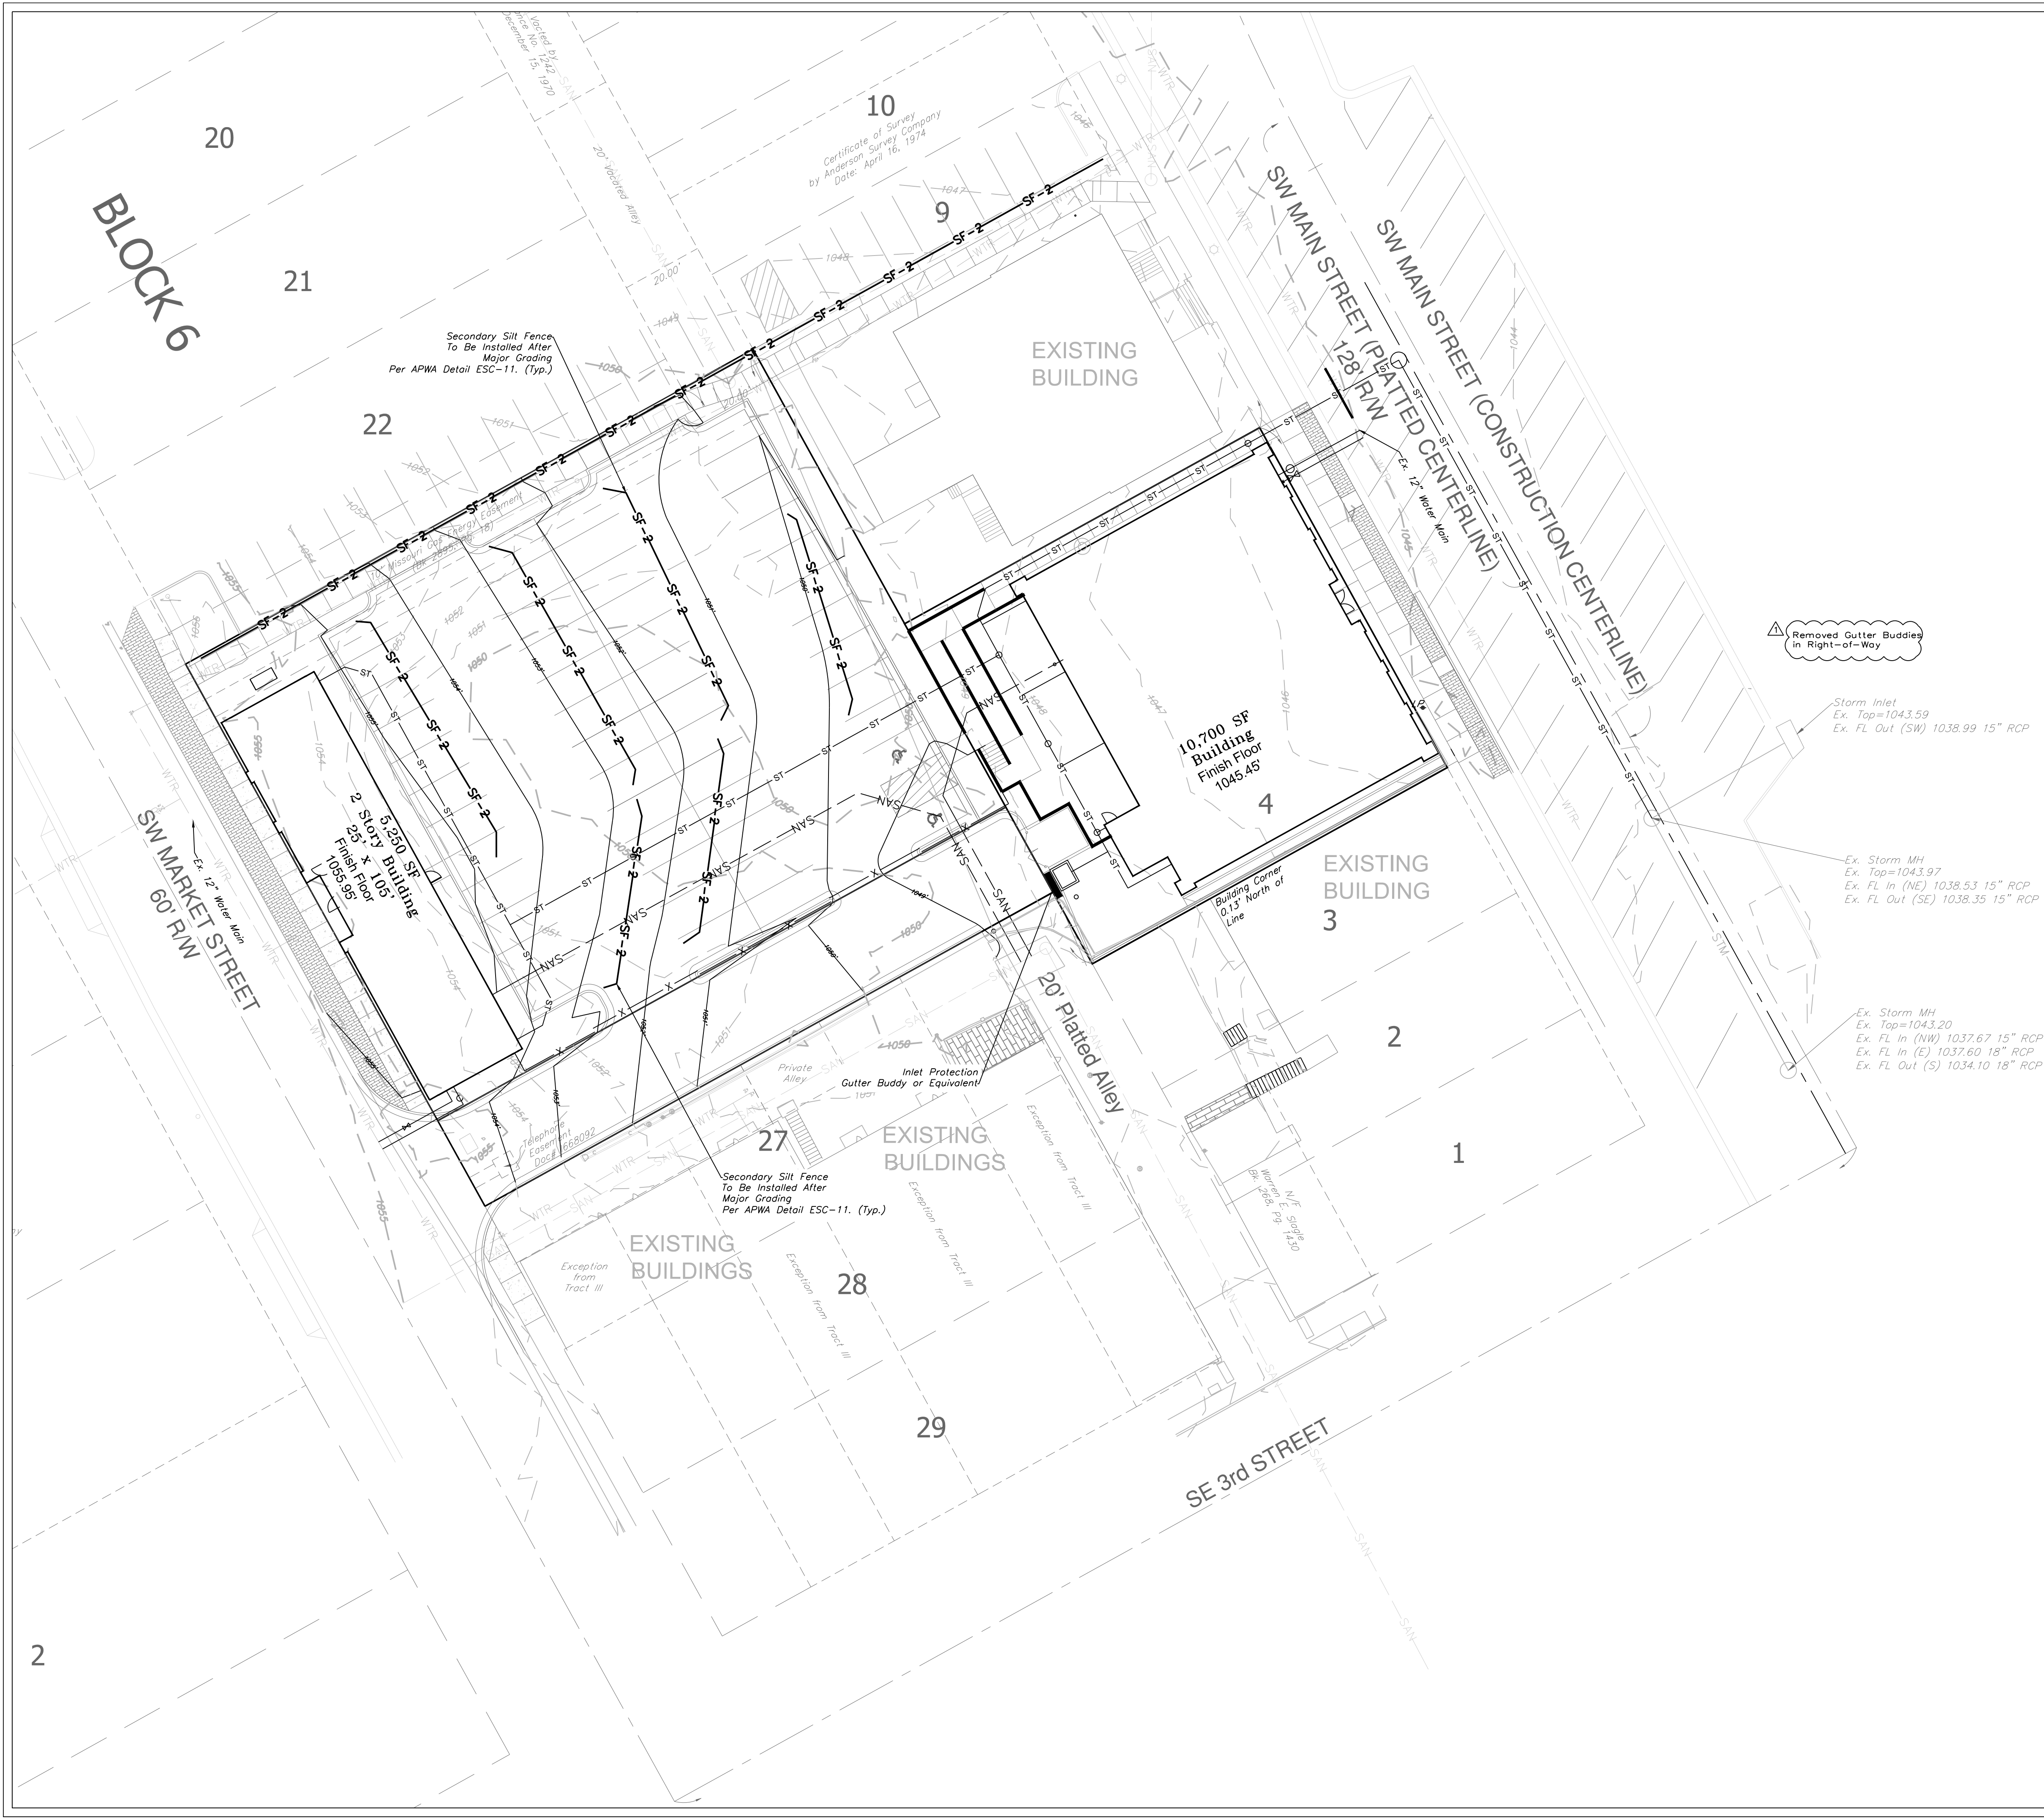


 SILT FENCE PROTECTION
TO BE MAINTAINED BY CONTRACTOR

LEGEND

PHASE 1 SILT FENCE ——— SF-1 ——— SF-1 ———

PHASE 2 SILT FENCE ——— SF-2 ——— SF-2 ———

INLET PROTECTION ———

DURING ALL PHASES OF CONSTRUCTION, INACTIVE
AREA STABILIZATION METHODS AS DESCRIBED IN
APWA SECTION 5111.3 SHALL BE USED TO CONTROL
EROSION AND SILTATION.

NOTES: The Land Disturbance Plans indicates the Final
placement of erosion control devices. The contractor(s)
may proceed with construction prior to the final
placement of these devices by providing additional
devices to control erosion on their items of work.
These devices shall be maintained until the final devices
are in place.

SEED AND MULCH NOTES:

All areas disturbed by construction activities shall be
seeded and mulched. Seeding shall be done before the
proposed seedbed becomes eroded, crusted over, or
dried out and shall not be done when the ground is
frozen, or covered with snow. The seed shall comply
with the requirements of the Missouri Seed Law and the
Federal Seed Act. Also, it shall contain no seed of any
plant on the Federal Noxious Weed List. Other weed
seeds shall not exceed one percent by weight of mix.

Seed and Fertilizer Rate:

Mix I - Rye Grass / Blue Grass -----
100 lbs. per Acre

Mix II - Tall Fescue / Blue Grass ----- 195
lbs. per Acre

Lime -----

lbs per Acre (50 Fertilizer	lbs. per 1000 sq. ft.)
-----	-----2000
to 1200 lbs per	Acre (25 lbs per 1000 sq.
ft.)	ft.)

During the dates December 15th through May 31 ALL
lime fertilizer, seed and mulch shall be applied to
finished slopes of disturbed areas. During the months
of June, July, October and November 1st through
December 15th, lime fertilizer, seed and mulch shall be
applied at the following rates:

Lime - 100% of specified quantity
Fertilizer - 75% of the specified quantity
Seed - 50% of the specified quantity
Mulch - 100% of the specified quantity

Mulch shall be Vegetative type, cereal straw from stalks
of oats, rye, or barley, or approved equal. The straw
shall be free of prohibited weed seed and relatively free
of all other noxious and undesirable seed. Mulch shall
be applied at the rate of 2 tons per acre, (70 to 90
lbs per 1000 sq. ft.). Mulch shall be embedded by a
mulch anchoring tool or disk type roller having fluted
serrated disks spaced not more than 10 inches apart
and cleaning scrapers shall be provided

ONCE SITE IS 90% VEGETATED ALL ESC
DEVICES SHALL BE REMOVED AND ANY
DISTURBED AREAS SHALL BE RESTORED