
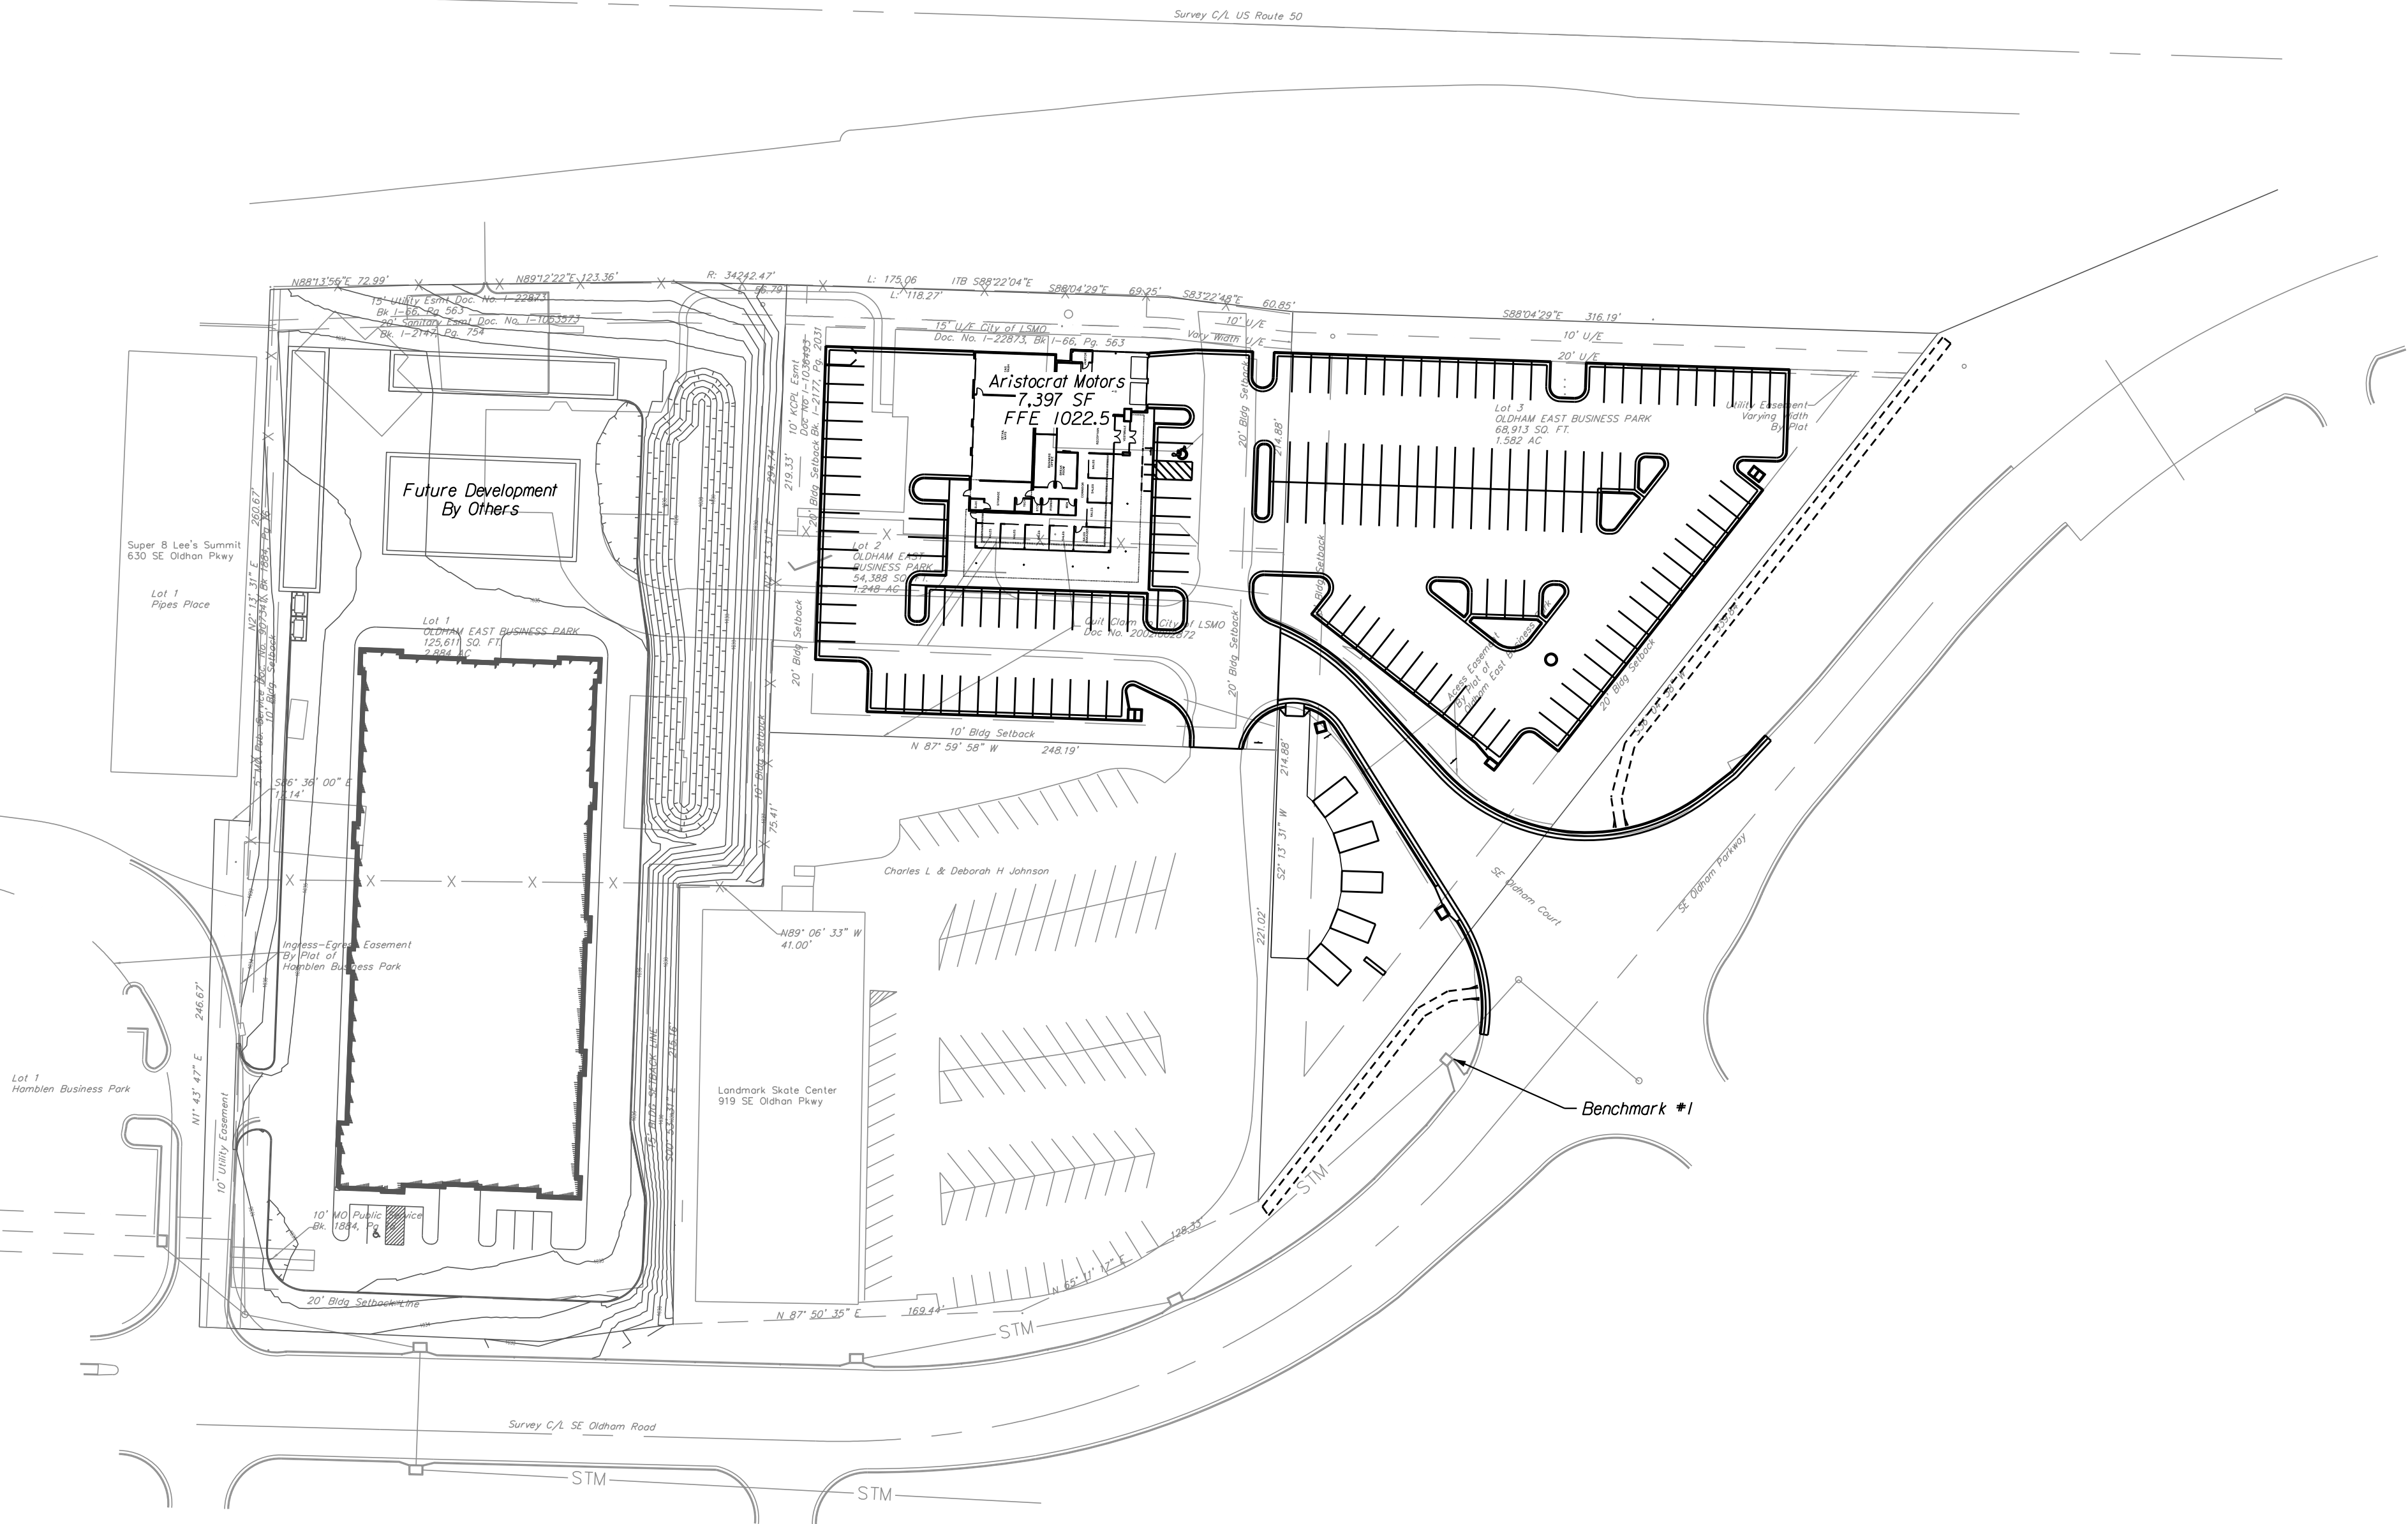


INDEX

- 1 COVER SHEET
- 2 DEMOLITION PLAN
- 3 DIMENSION PLAN
- 4 GRADING PLAN
- 5 ADA RAMP DETAIL
- 6 STORM SEWER PLAN
- 7 DRAINAGE AREA MAP
- 8 UTILITY PLAN
- 9 EROSION CONTROL PLAN
- 10-14 DETAIL SHEETS

APPENDIX:
ARCHITECTURAL FLOORPLANS AND ELEVATIONS
LANDSCAPING PLANS
LIGHTING PLANS AND SPECS
ADS STORM TECH DETENTION PLANS


ARISTOCRAT MOTORS
LOTS 2 AND 3
OLDHAM EAST BUSINESS PARK
LEE'S SUMMIT - JACKSON COUNTY MO
FINAL DEVELOPMENT PLAN

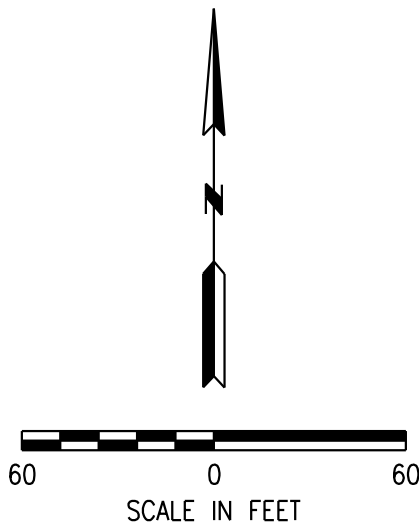

UTILITIES

- City of Lee's Summit
Department of Public Works
220 SE Green
Lee's Summit, Mo.
816-969-1800
- KCPL
130 SE Hamblen Road
Lee's Summit, Mo.
816-347-4320
- Missouri Gas Energy
3025 SE Clover Road
Lee's Summit, Mo.
816-537-4681
- AT&T
215 N. Spring
Independence, Mo.
816-325-5610
- Time Warner
6550 Winchester Avenue
Kansas City, Mo.
913-643-1901
- Missouri One Call
1-800-344-7483

VICINITY MAP

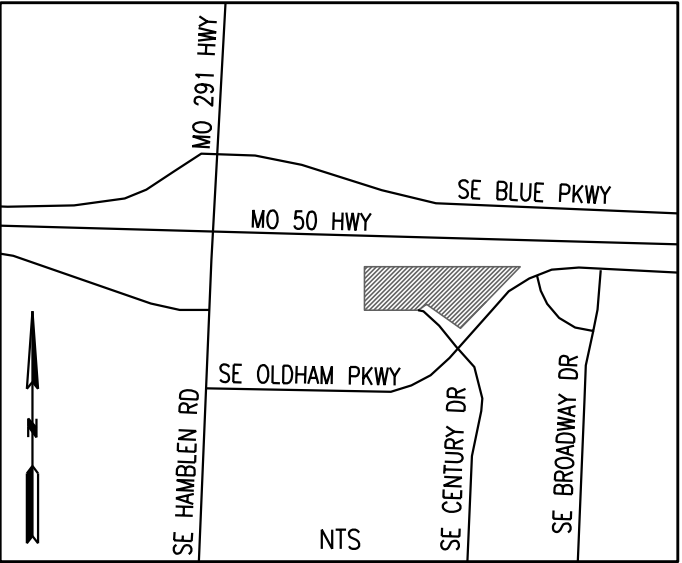

PREPARED FOR
ARISTOCRAT MOTORS
6102 West 65th Street
Merriam, KS 66203
Attn: Kevin Killilea

PROJECT BENCHMARK

#1 SE Corner of Existing Field Inlet
N: 995728.08
E: 2828733.64
Elev: 1013.12

DATE	REVISION	NO.	BY	CHK/APP
9/3/19				
7/16/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
6/14/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
	PDP Submittal	1	RAM	RKS
IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.				



consult inc engineers planners

1,1010 Haskell St., Ste 210 Kansas City, KS 66109 816-759-2285 CORPORATE LICENSE NO. E2010005873

COVER SHEET		ARISTOCRAT MOTORS		LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	
X-REF NO.		XXX			
DRAWING NO.		XXX			
DATE		September 2019			
JOB NO.		19.006.01			
SHEET OF		1 14			

The site plan illustrates three lots within the Oldham East Business Park. Lot 1, located on the left, is 125,611 sq. ft. (2.884 AC). Lot 2, in the center, is 54,388 sq. ft. (1.248 AC). Lot 3, on the right, is 68,913 sq. ft. (1.582 AC). The plan includes topographic contour lines, utility lines (gas, water, sewer, storm), and property boundaries. Annotations indicate removals: 'Remove Exist. Vinyl Fence' and 'Remove Exist. 15' CMPs' are shown on Lot 2, while 'Remove Exist. Sanitary Service, See Utility Plan.' and 'Remove Exist. 15' CMP' are shown on Lot 1. A plan legend in the bottom left corner defines the symbols for removals and asphalt/concrete removal. A north arrow and a scale bar (0 to 30 feet) are located in the bottom right corner.

PLAN LEGEND

- X Removals
- Asphalt/Concrete Removal

Lot 1
OLDHAM EAST BUSINESS PARK
125,611 SQ. FT.
2.884 AC

Lot 2
OLDHAM EAST BUSINESS PARK
54,388 SQ. FT.
1.248 AC

Lot 3
OLDHAM EAST BUSINESS PARK
68,913 SQ. FT.
1.582 AC

Remove Exist. Vinyl Fence

Remove Exist. 15' CMPs

Remove Exist. Sanitary Service, See Utility Plan.

Remove Exist. 15' CMP

SE Oldham Court

SE Oldham Parkway

SCALE IN FEET

0 30

× *Removals*

Asphalt/Concrete Removal

Lot 3
OLDHAM EAST BUSINESS PARK
68,913 SQ. FT.
1.582 AC

Lot 2
OLDHAM EAST BUSINESS PARK
54,388 SQ. FT.
1.248 AC

Lot 1
OLDHAM EAST BUSINESS PARK
125,611 SQ. FT.
2.884 AC

Remove Exist. Vinyl Fence

Remove Exist. 15' CMPs

~~Remove Exist. Sanitary
Service, See Utility Plan.~~

Remove Exist. 15" CMP -

~~Remove Exist. Vinyl Fence~~

~~Remove Exist. 15" CMP~~

DATE	REVISION	NO.	BY	CK/APP
9/3/19	Addressed bid questions In regards to ME-201	3	RAM	
7/16/19	Addressed City Comment Letter dated 6/28/19	2	RAM	
6/14/19	PPP Submittal	1	RAM	

IF THIS IS NOT A BLUE INK SEAL, THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS, THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.

9/3/19

**Consult
Inc**
engineers
planners



DEMOLITION PLAN

ARISTOCRAT MOTORS

LEE'S SUMMIT - JACKSON COUNTY - MISSOURI

X-REF NO.

DRAWING N

September 2019

JOB NO.
19.006.01

2

SHEET 14
OF

REV.

GENERAL NOTES:

- The recorded plat, Oldham East Business Park was used in preparation of this Final Development Plan.
- Cross Access easements for common driveways and adjoining parking lots will be provided on the Final Plat.
- There is no visible evidence of abandoned oil or gas wells located within the plot boundary, as identified in "Environmental Impact Study of Abandoned Oil and Gas Wells in Lee's Summit, Missouri", Edward Alton May, Jr., P.E., 1995.
- Mechanical units shall be totally screened from view in accordance with Article 8 of the UDO.
- All materials, colors, and architecture of buildings to meet the requirements of Article 8 of the current UDO.
- Contractor to locate and relocate any existing utilities that may conflict with construction as necessary.
- The development shall meet the requirements of the Unified Development Ordinance, Design and Construction Manual, Access Management Code and other ordinance for development including, but not limited to, parking setbacks and spaces, ADA requirements, site lighting, landscaping and screening, utilities, and zoning requirements.
- Every ADA accessible parking space shall be identified by a sign, mounted on a pole or other structure, located between 36 inches and 60 inches above the ground, measured from the bottom of the sign, and the head of the parking space.
- All identifying signs shall be 12 inches wide by 18 inches in height and meet the requirement set forth in the Manual on Uniform Traffic Control Devices, as referenced in the Lee's Summit General Code of Ordinances.
- All Landscaping to meet Article 8 of the UDO.
- There shall be two way traffic movement.
- See architectural submittal for all building dimensions, monument signs and lighting details.
- Parking lot screening to meet UDO.
- See Lighting Plans and Specs for all information related to parking lot lighting.
- All curb to be CG-I curb, unless otherwise noted.
- Easements are provided for ingress/egress as shown and per the recorded plat.
- Parking Spaces shall be 9' x 19' (perimeter w/ curb), 9' x 19' (interior center), and 9' x 20' (interior w/ no curb).
- Watershed: East Fork-Little Blue River (to Prairie Lee Lake)
- A minor plat will be prepared to combine the two lots into 1 lot. A private easement for the sanitary sewer service for the Landmark Skate Center building will be dedicated on the plat.
- All dimensions are to back of curb unless otherwise noted.
- All curb radii within parking lot are 5' unless otherwise noted.

STREETS:

- Improvements to the main entrance off of SE Oldham Parkway shall consist of curb & gutter addition only. In regards to sidewalk along frontage, payment shall be made to the City of Lee's Summit for construction cost in lieu of actual construction of sidewalk.

BUILDING LINES:

- Minimum required building line is 20 feet from all property lines.

PARKING SETBACK LINES:

- Minimum required parking setback line is 20 feet on 50 Hwy & SE Oldham Pkwy frontages, 6 feet is required from all other property lines.

SIDEWALKS:

- Interior sidewalks are 5' as shown. Sidewalks to be 5' PCC on 4' of compacted gravel.

PROJECT DATA:

The site is Zoned CS
Project Area - 2.83 acres
Number of Lots - 2

PHASING:

- The project infrastructure as shown shall be completed in 1 phase.


PARKING:

- Parking Spaces Required/Provided - 23/23 (149 Total)
Garage - 3/bay x 4 bays = 12
Sales Area - 2/1000sf - 4.7 x 2 = 9.4 (10)
Outside Display Area - 1/2500sf, 5 display pads at 200sf each - 1000sf = 0.4 (1)
ADA Spaces Required/Provided - 1/1

SITE ADDRESS:

704 SE Oldham Court, Lee's Summit, MO 64081

City Esmt Doc. No. 1-22813
-66, Pg. 563
Sanitary Esmt Doc. No. 1-1035573
-2147, Pg. 754

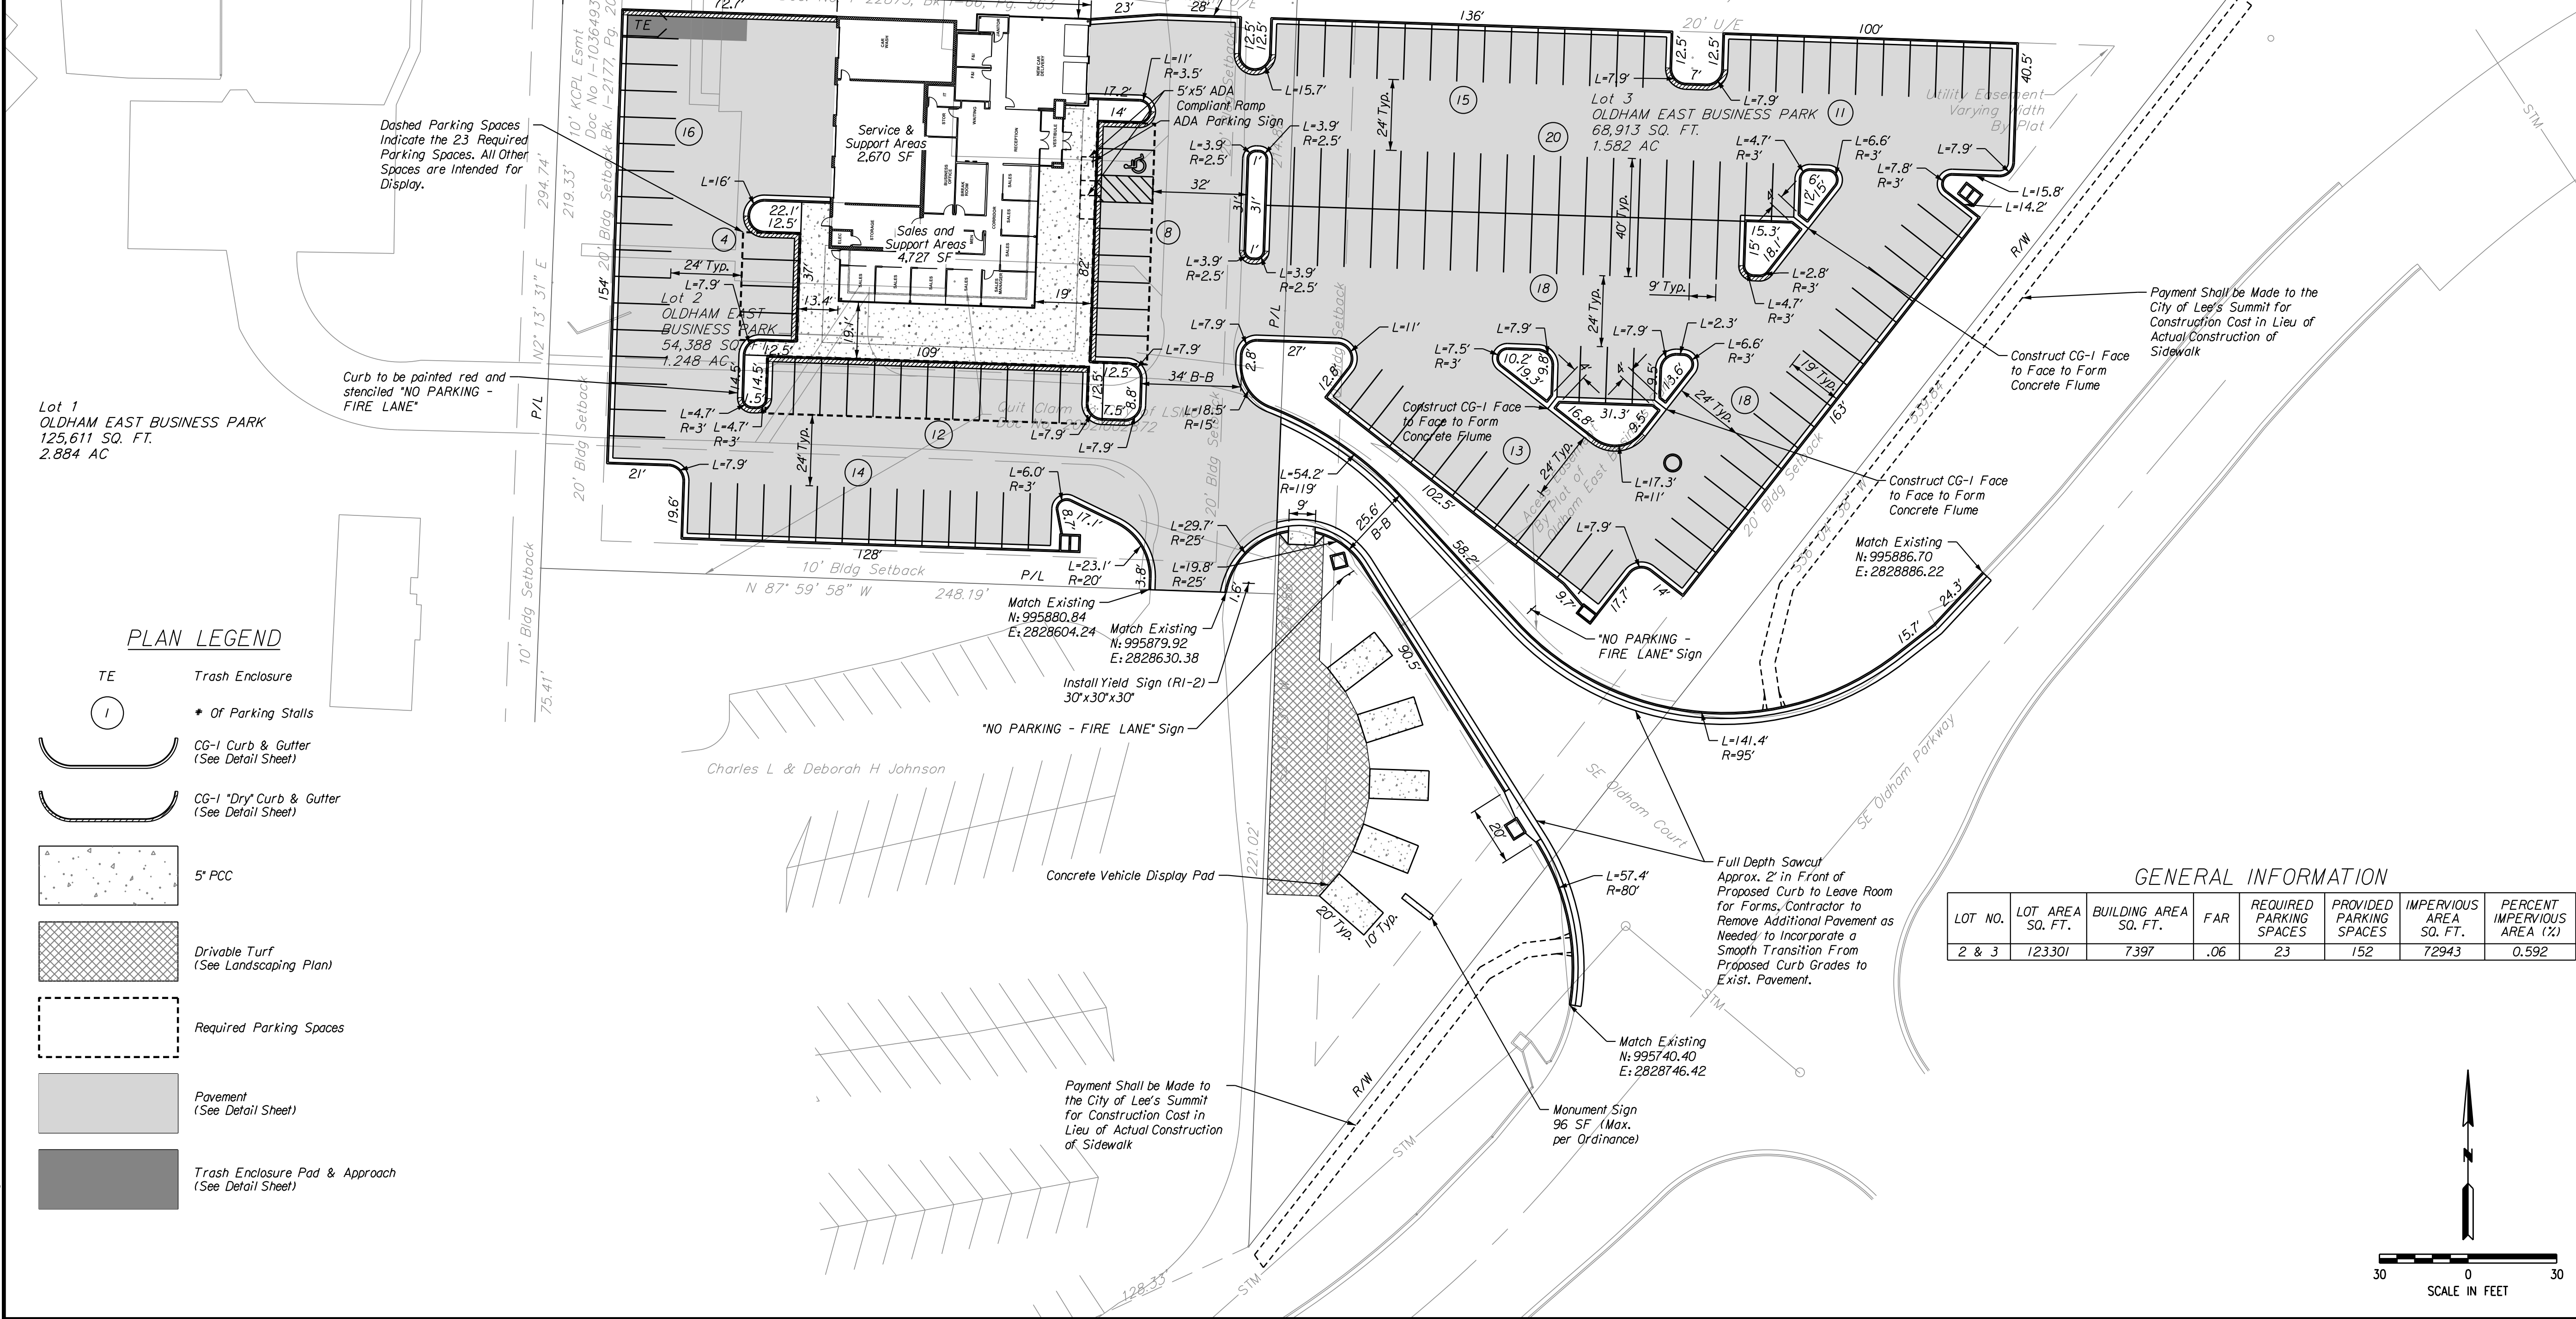

DATE	REVISION	NO.	BY	CHK/APP
9/3/19				
7/16/19		3	RAM	RKS
6/14/19		2	RAM	RKS
		1	RAM	RKS



consult inc engineers planners


11010 Haskell St., Ste. 210 Kansas City, KS 66109 816-759-2285
CORPORATE LICENSE NO. E2010005873

DIMENSION PLAN		ARISTOCRAT MOTORS		LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	
X-REF NO.		XXX		DATE	
DRAWING NO.		XXX		September 2019	
JOB NO.		19.006.01		SHEET OF	
3		14			

9/3/2019
FDP-GradingPlan.dgn




GENERAL NOTES:

1. See detail sheet for pavement section and details.
2. All slopes to be 3:1 max.
3. See ADA Ramp Detail sheet for elevations.

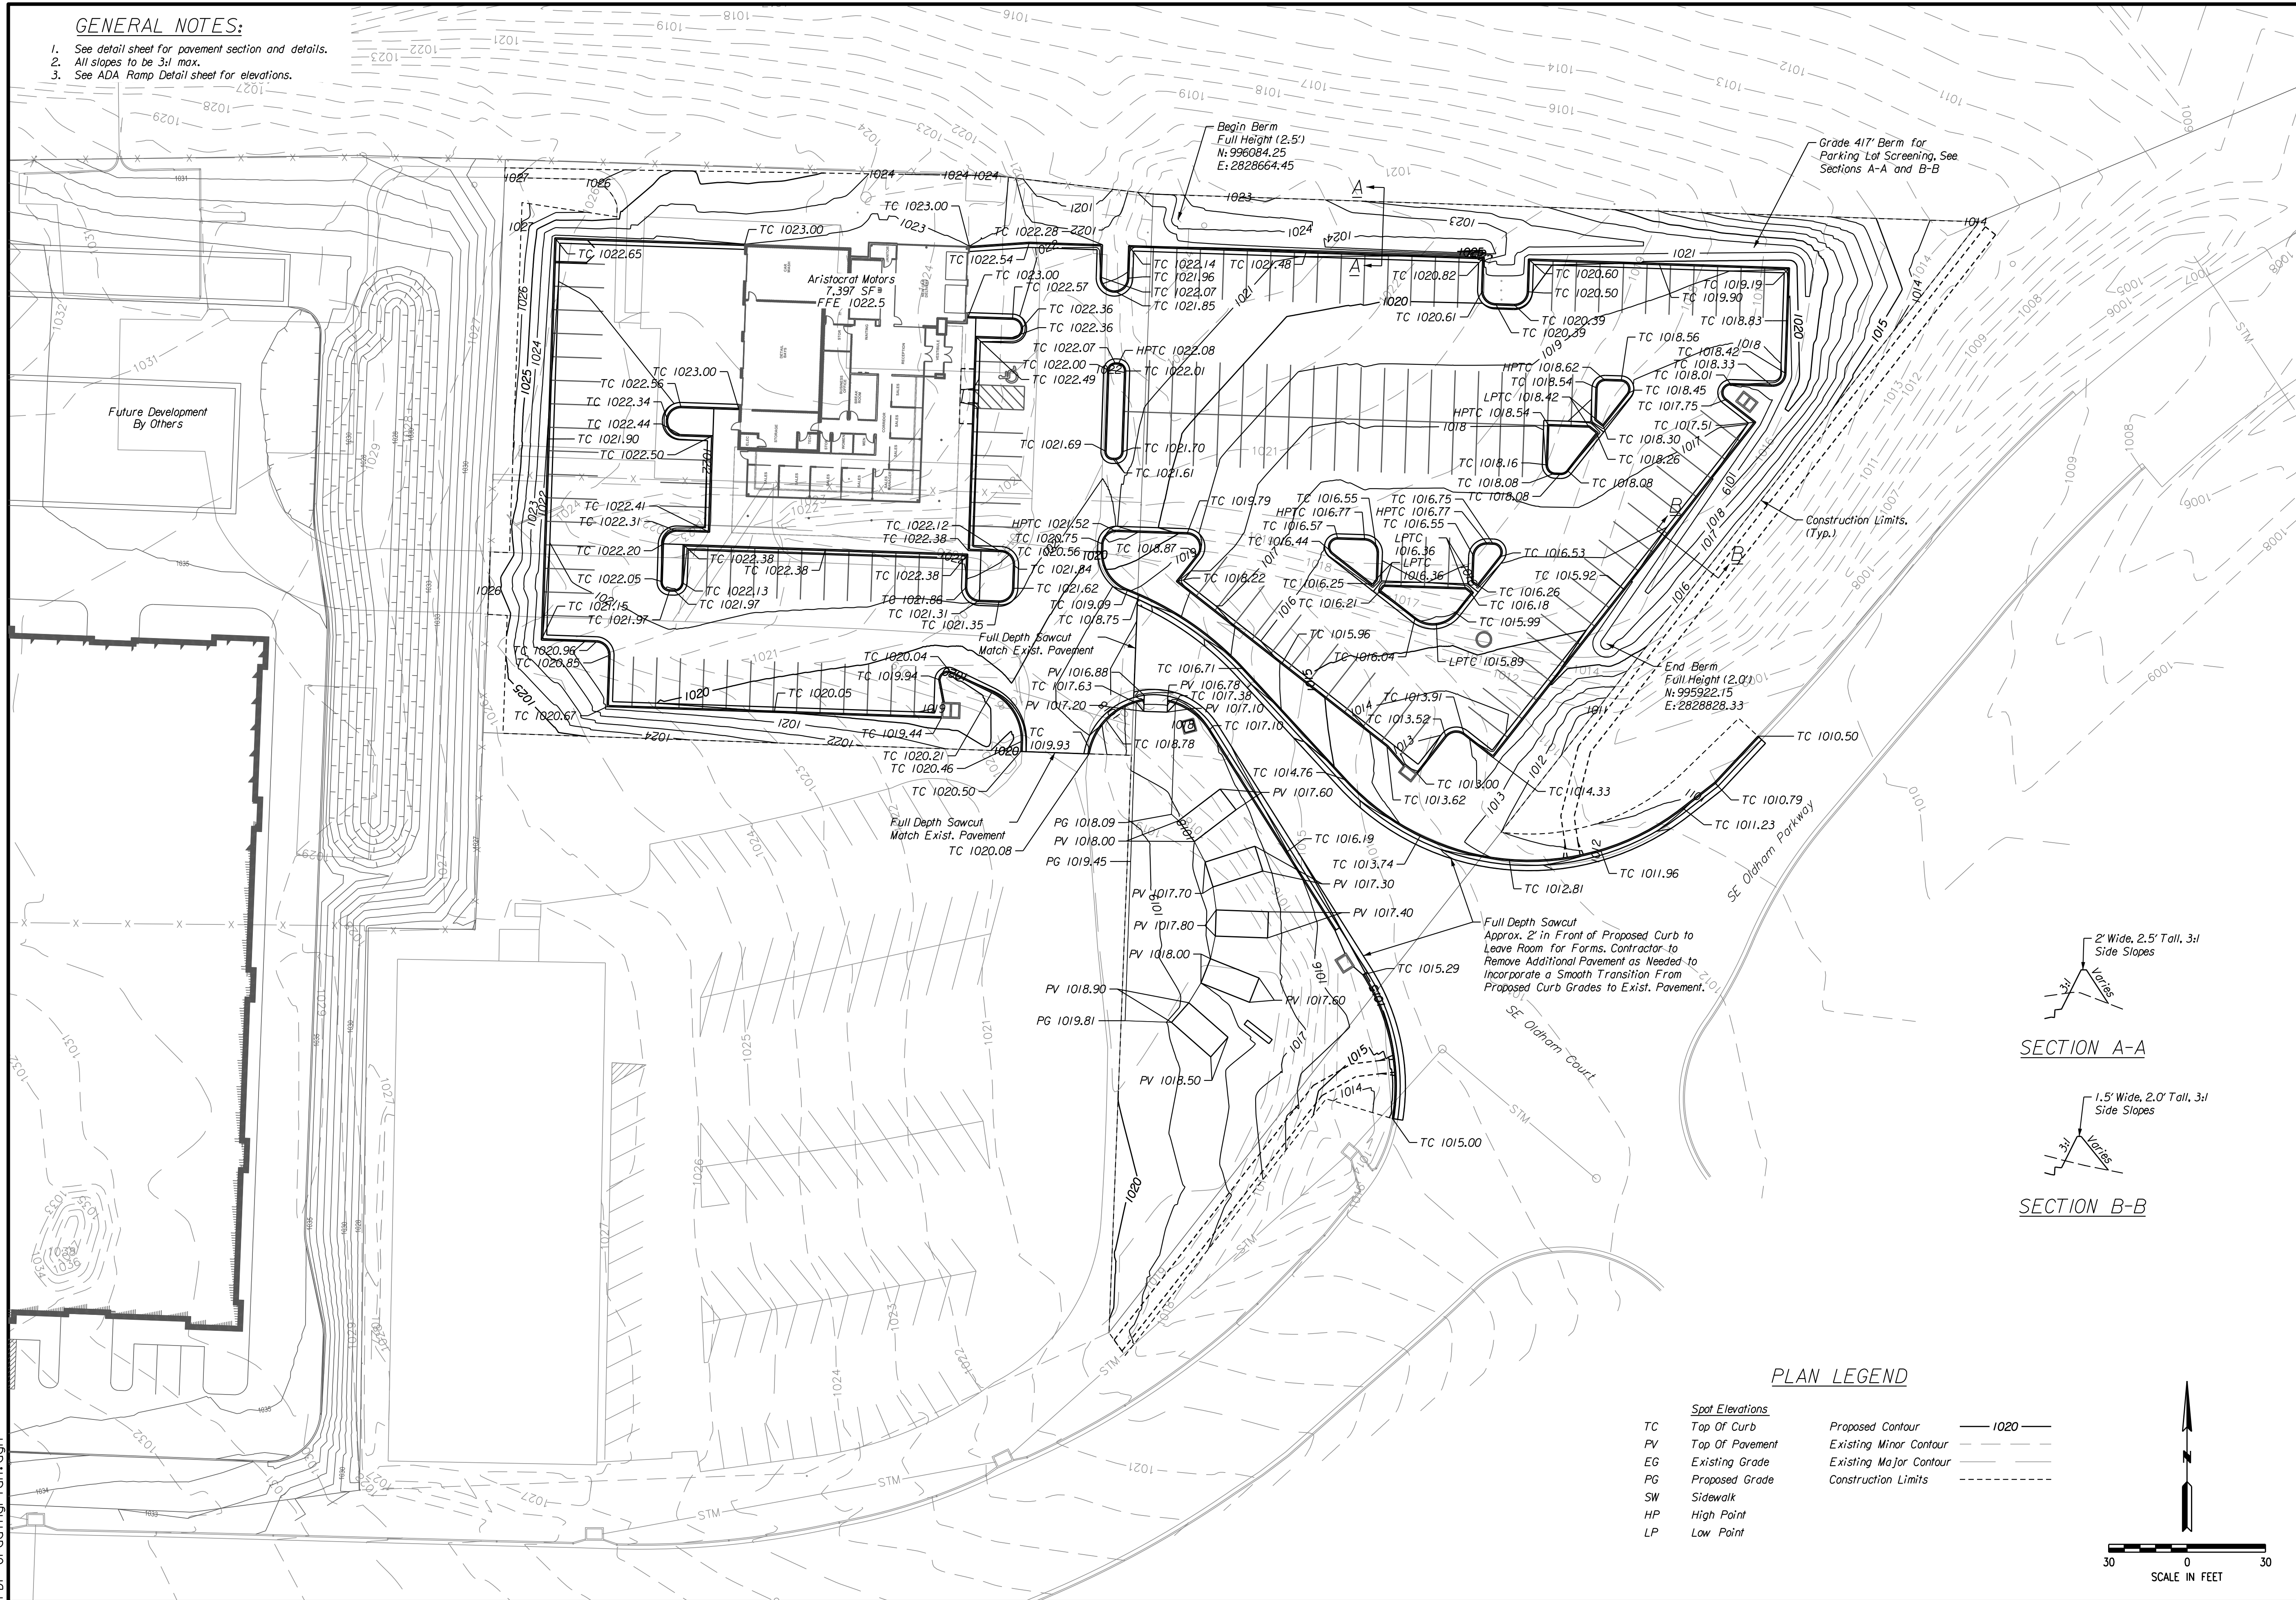

PLAN LEGEND

TC	Spot Elevations	Proposed Contour	1020
PV	Top Of Pavement	Existing Minor Contour	
EG	Existing Grade	Existing Major Contour	
PG	Proposed Grade	Construction Limits	
SW	Sidewalk		
HP	High Point		
LP	Low Point		

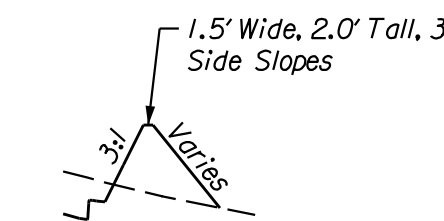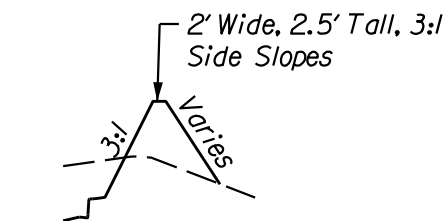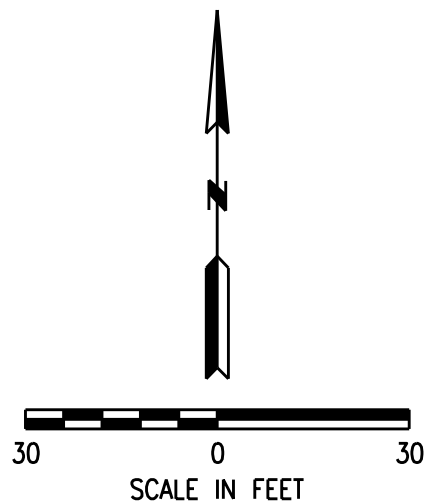


DATE	REVISION	NO.	BY	CHK/APP
9/3/19				
7/16/19		3	RAM	RNS
6/14/19		2	RAM	RNS
		1	RAM	RNS

Addressed bid questions in regards to ME-201
Addressed City Comment Letter dated 6/28/19
PDP Submittal
IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.



consult inc engineers planners
11010 Haskell St., Ste 210 Kansas City, KS 66109 816-759-2285
CORPORATE LICENSE NO. E2010005873




GRADING PLAN	ARISTOCRAT MOTORS
LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	
X-REF NO. XXX	
DRAWING NO. XXX	
DATE September 2019	
JOB NO. 19.006.01	
4 SHEET OF 14	

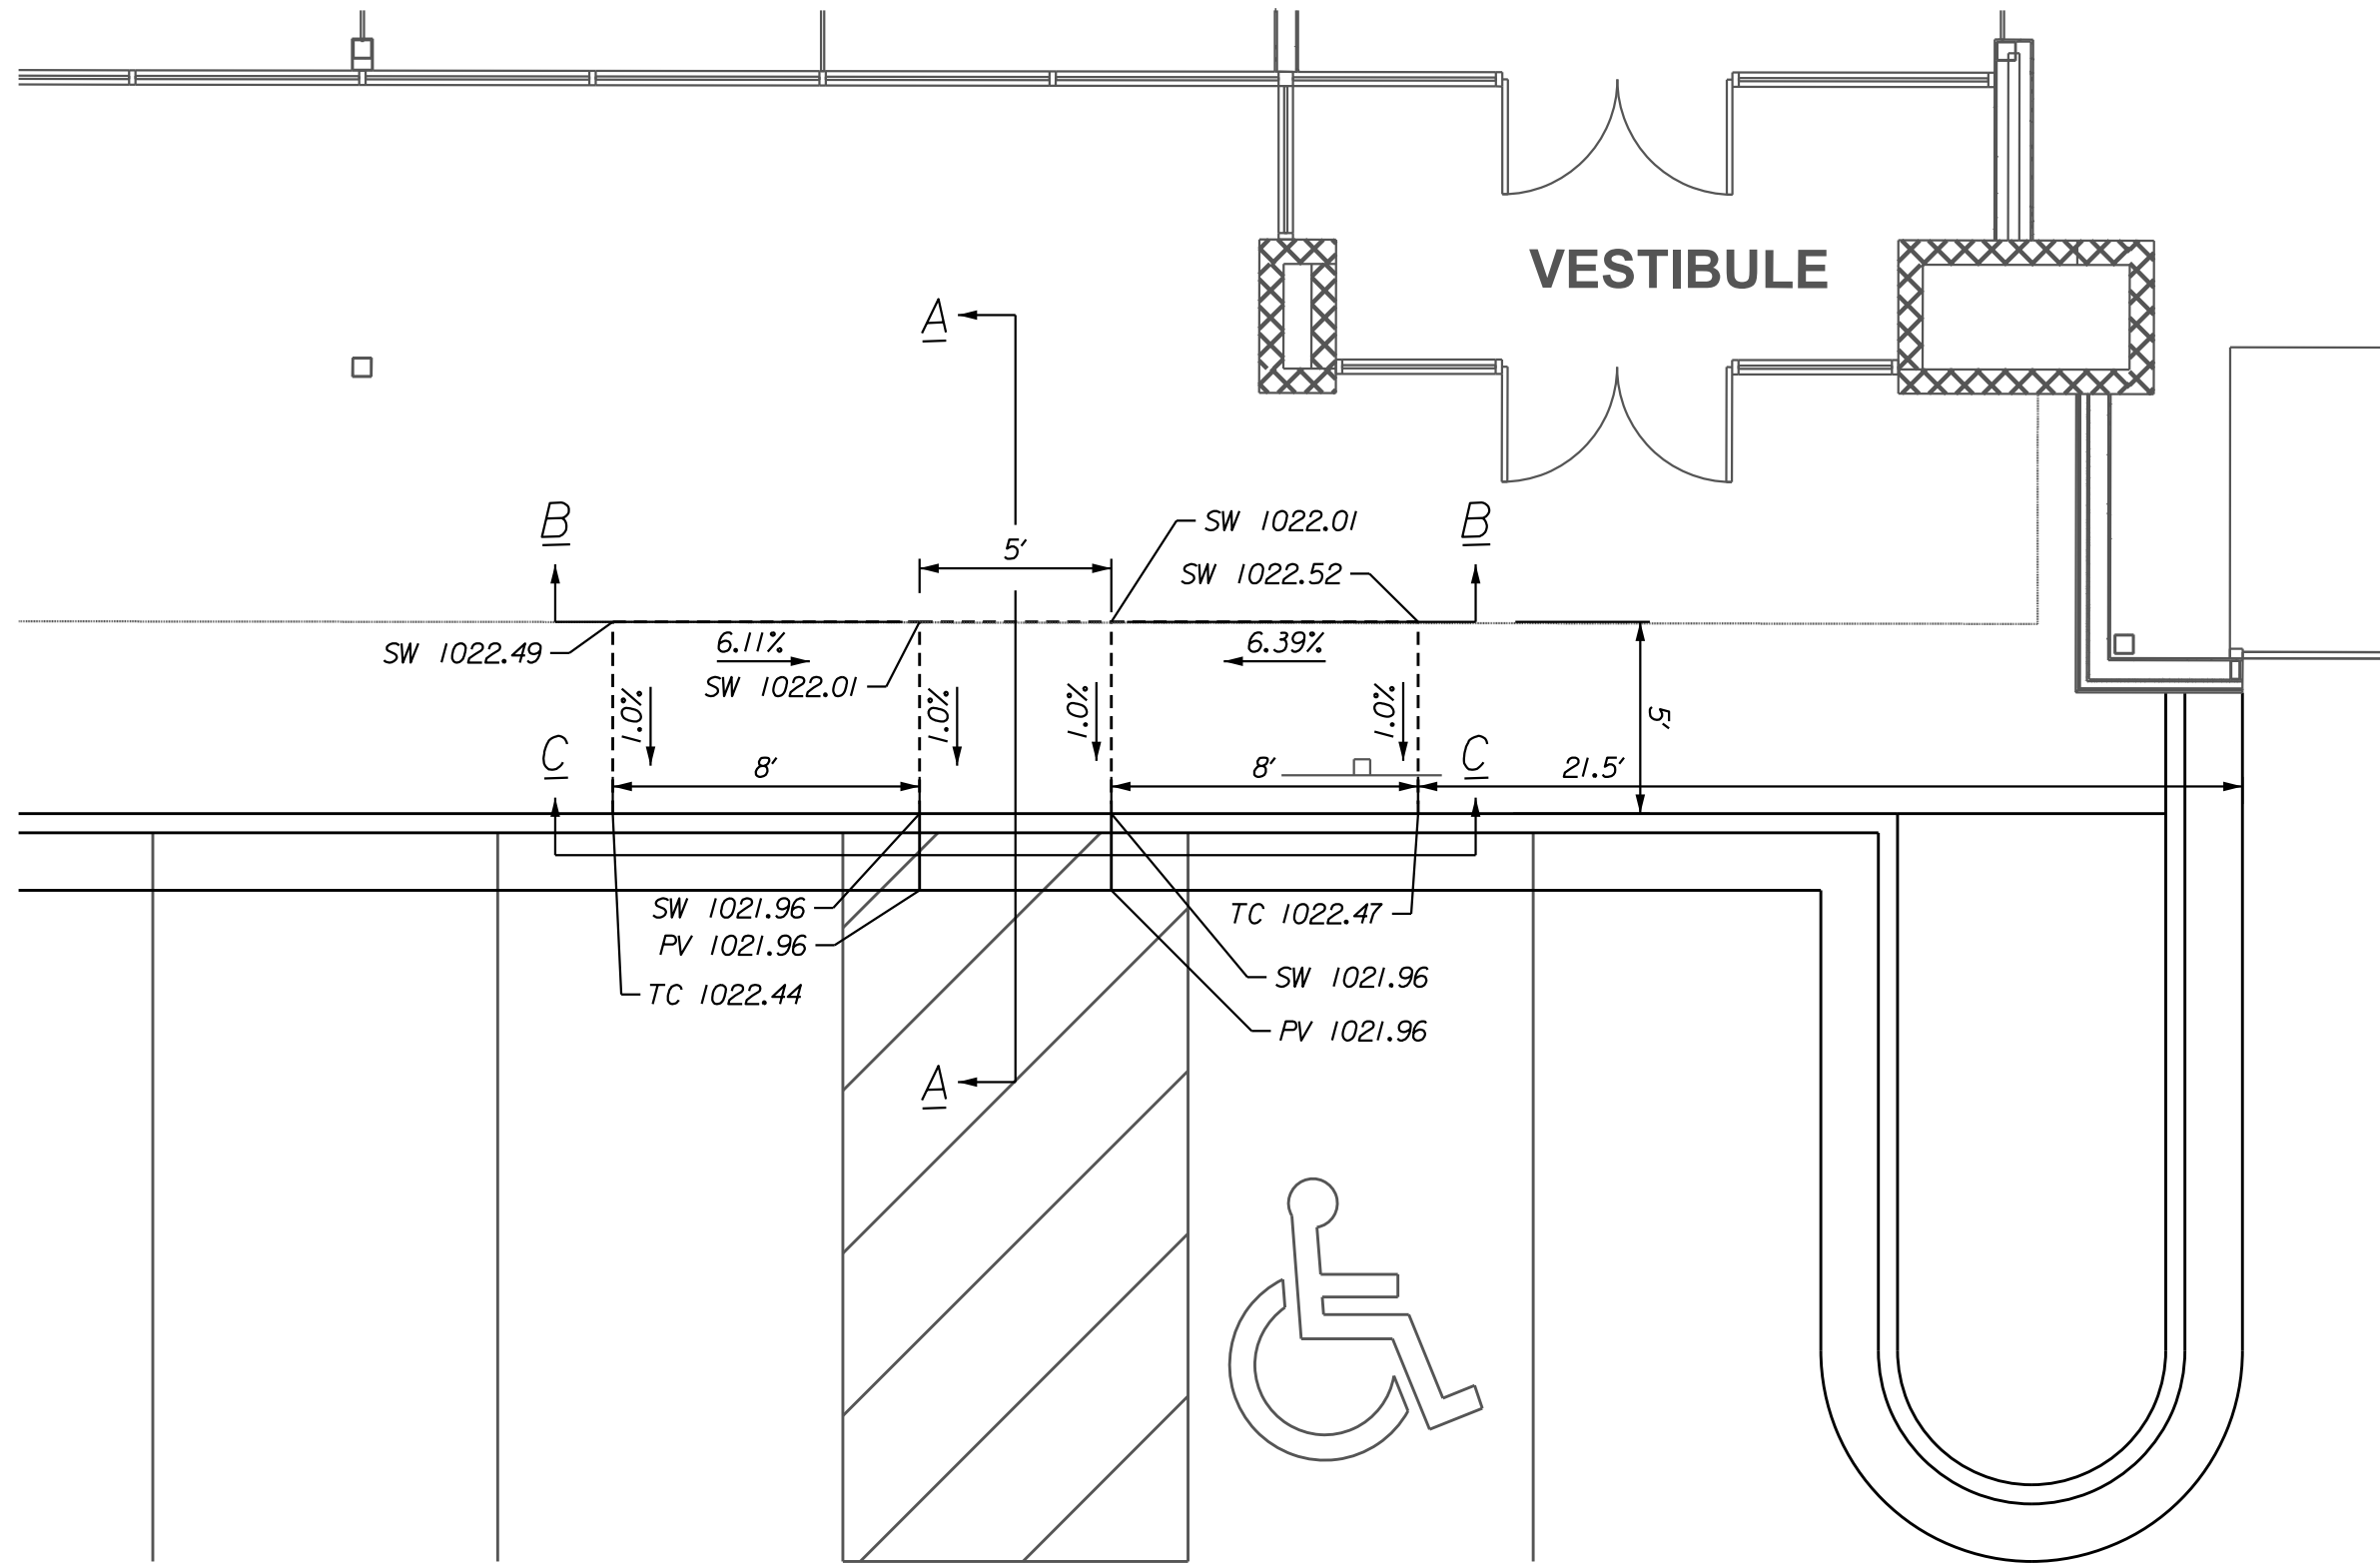

SIDEWALK/SHARED-USE PATH & SIDEWALK/SHARED-USE RAMP NOTES:

1. CURB RAMP OPENING, NOT INCLUDING FLARES, SHALL MATCH EXISTING SIDEWALK WIDTH AND OPENING SHALL BE AT LEAST 48" WIDE.
2. USE 18" LONG #4 EPOXY COATED TIE BARS @ 24" O.C. EMBED TIE BARS 9" IN EACH DIRECTION.
3. ALL RAMPS, SIDEWALKS, SHARED-USE PATHS SUBGRADE MUST BE OF STABLE, COMPACTED EARTH AND SHALL BE OVERLAYED WITH 4" COMPACTED DENSE GRADED AGGREGATE BASE.
4. LONGITUDINAL JOINT SPACING TO MATCH WIDTH OF SIDEWALK.
5. ISOLATION JOINTS SHALL BE PLACED WHERE WALK ABUTS DRIVEWAYS AND SIMILAR STRUCTURES, AND 150' CENTERS MAX.
6. ADA MAXIMUM RAMP SLOPE = 8.33%
ADA MAXIMUM CROSS SLOPE = 2.0%


*ROADWAY EXCEPTION: WHERE EXISTING ROAD PROFILE GRADE DOES NOT ALLOW RAMP TO MEET RAMP SLOPE REQUIREMENT OF 8.33% OR LESS, THE RAMP SHALL BE EXTENDED TO A LENGTH OF 15 FEET TO MATCH EXISTING SIDEWALK. CROSS SLOPE OF RAMP SHALL BE 1.5%, $\pm 0.5\%$.
7. TURNING SPACES SHALL BE 1.5%, $\pm 0.5\%$ SLOPE IN ANY DIRECTION. TURNING SPACES SHALL HAVE A MINIMUM 4'x4' TURNING AREA. TURNING SPACES, WITH A SIDEWALK CURB, SHALL HAVE A 5' TURNING AREA PERPENDICULAR TO THE SIDEWALK CURB.
8. FOR RETROFIT WORK, SLOPES TO BE DETERMINED IN FIELD BY CONTRACTOR AND APPROVED BY CITY INSPECTOR
9. RAMP EXTENSION AREA SHALL NOT BE USED AS TRANSITION TO EXISTING SIDEWALK. ANY TRANSITIONS REQUIRED TO MATCH RAMPS TO EXISTING SIDEWALK SHALL REQUIRE REMOVAL AND REPLACEMENT OF ADDITIONAL SIDEWALK BEYOND THE RAMP AREA. SIDEWALK TRANSITION LENGTH SHALL BE EQUAL TO OR GREATER THAN THE WIDTH OF THE EXISTING SIDEWALK. RAMP EXTENSIONS SHALL BE A CONTINUOUS SLOPE.
10. ALL SIDEWALK AND RAMP CONSTRUCTION SHALL MEET CURRENT PUBLIC RIGHT OF WAY ACCESSIBILITY GUIDELINES (PROWAG).

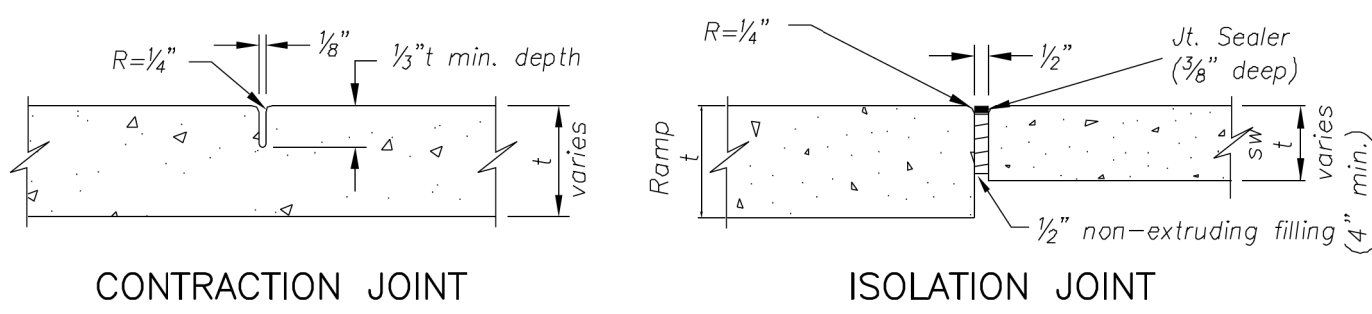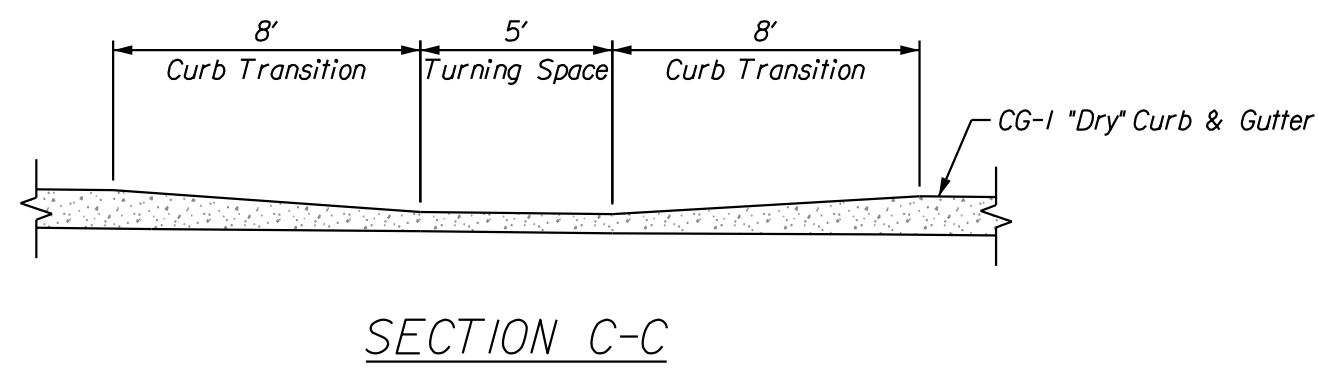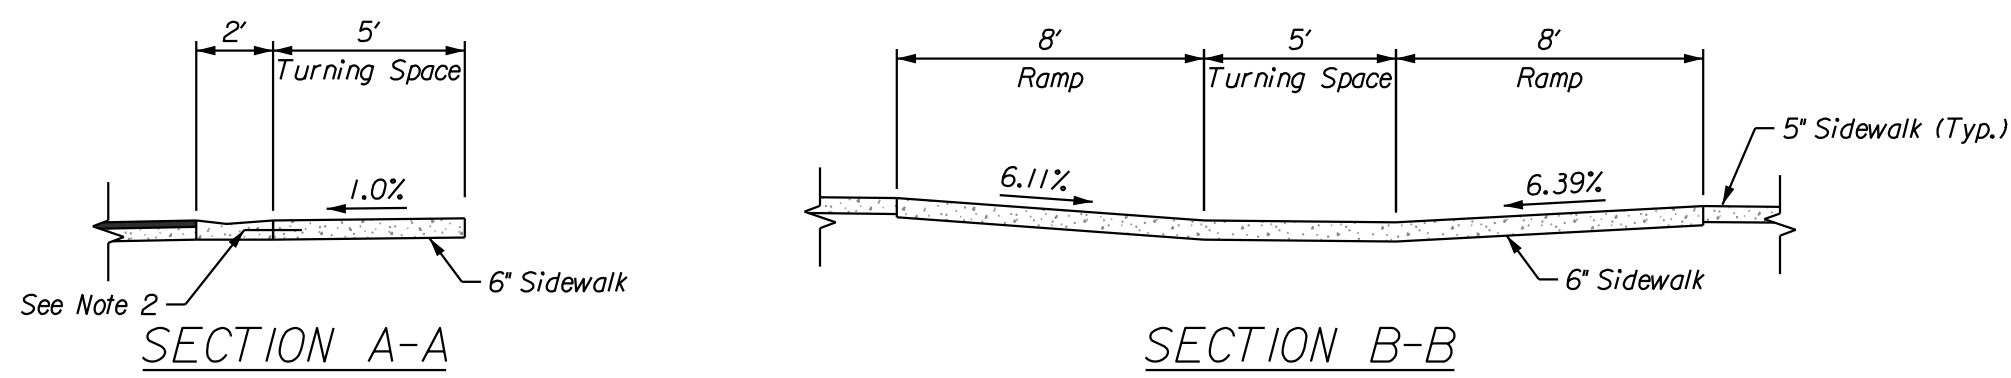

JOINT DETAILS
Not to Scale

PLAN LEGEND

	<u>Spot Elevations</u>
TC	Top Of Curb
PV	Top Of Pavement
EG	Existing Grade
PG	Proposed Grade
SW	Sidewalk
HP	High Point
LP	Low Point

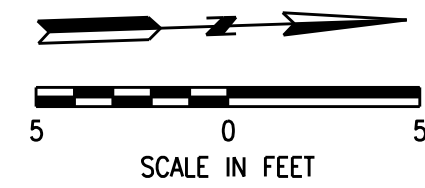

DATE	REVISION	NO.	BY	CK/APP
9/3/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
7/16/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
6/14/19	PDF Submittal	1	RAM	RKS

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.

9/3/19

R. KEVIN STERRETT, MO E-26440

Consultants Inc.
engineers
planners

1010 Haskell St., Ste. 210 Kansas City, KS 66109 816-759-2285
CORPORATE LICENSE NO. E2010003873

11010 Haskell St. Ste 210 Kansas City, KS 66109 816-759-2285 CORPORATE LICENSE No. E20100005873

ADA RAMP DETAIL

ARISTOCRAT MOTORS

LEE'S SUMMIT - JACKSON COUNTY - MISSOURI

X-REF NO.
XXX

DRAWING NO.
XXX


DATE

JOB NO.
19 006 01


5 SHEET OF 14

GENERAL NOTES:

1. All storm sewer pipe to be HDPE w/ smooth interior.

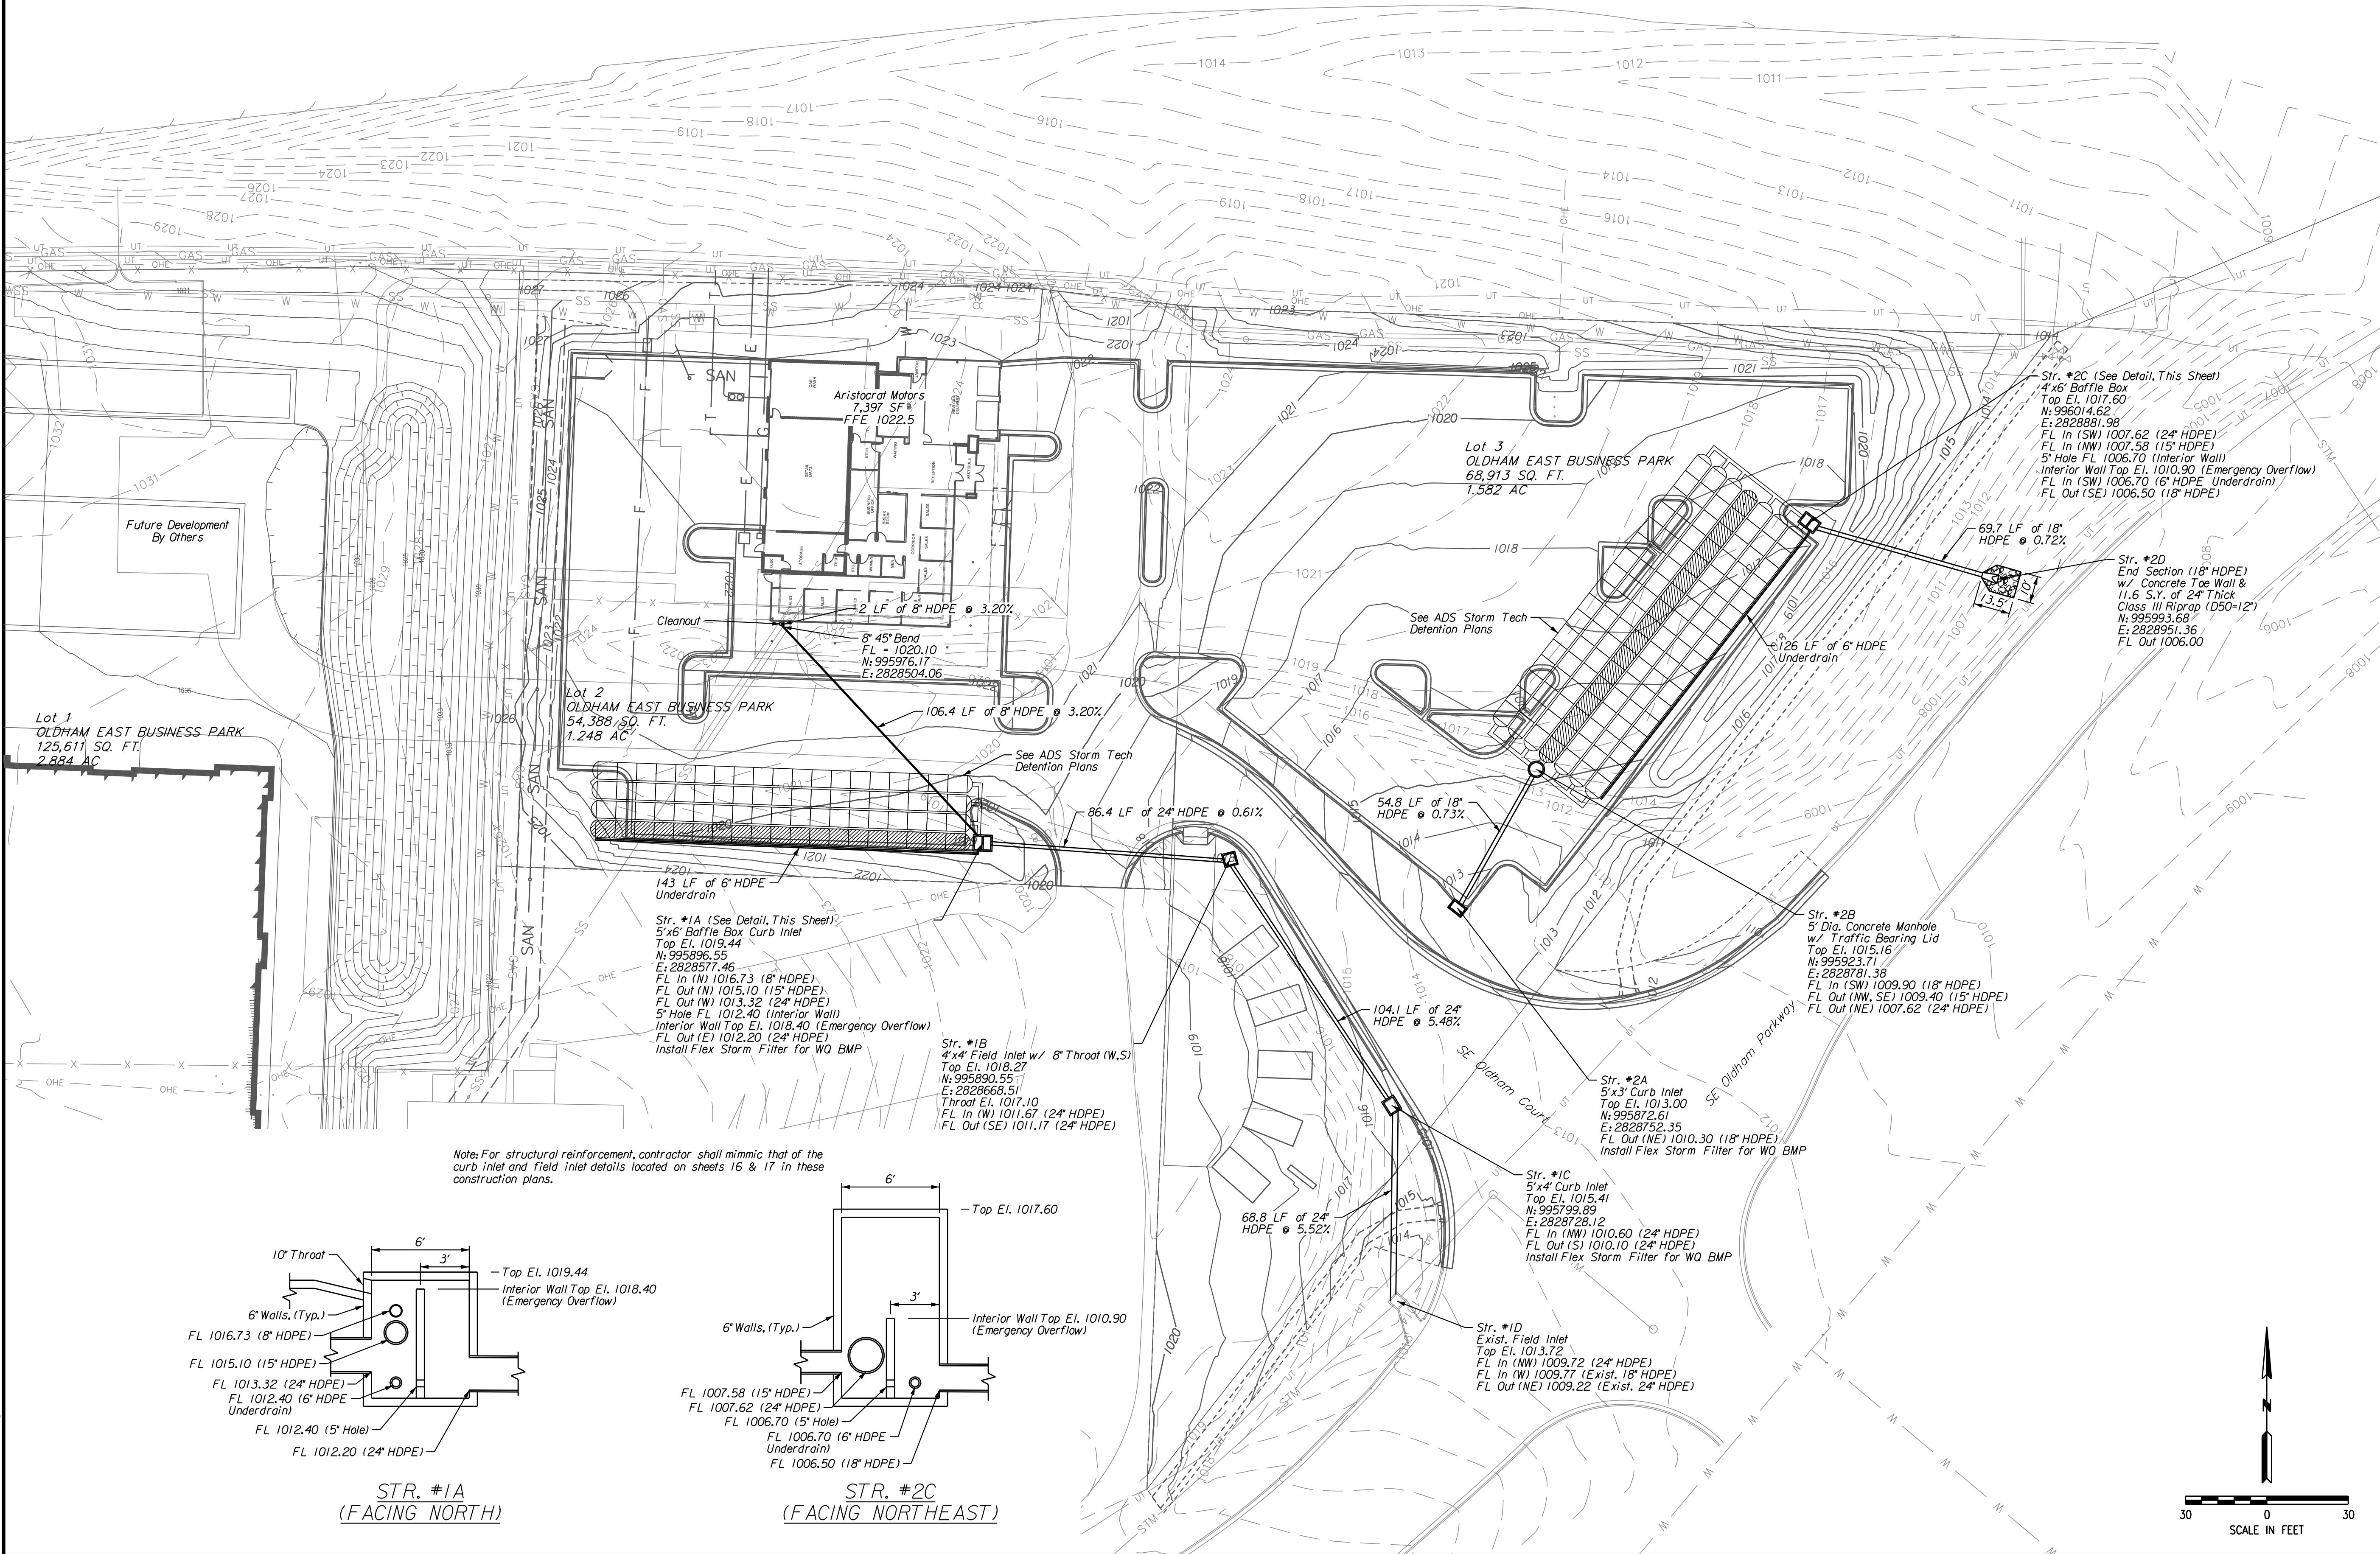

DATE	REVISION	NO.	BY	CHK/APP
9/3/19				
7/16/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
6/14/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
	PDP Submittal	1	RAM	RKS
IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.				

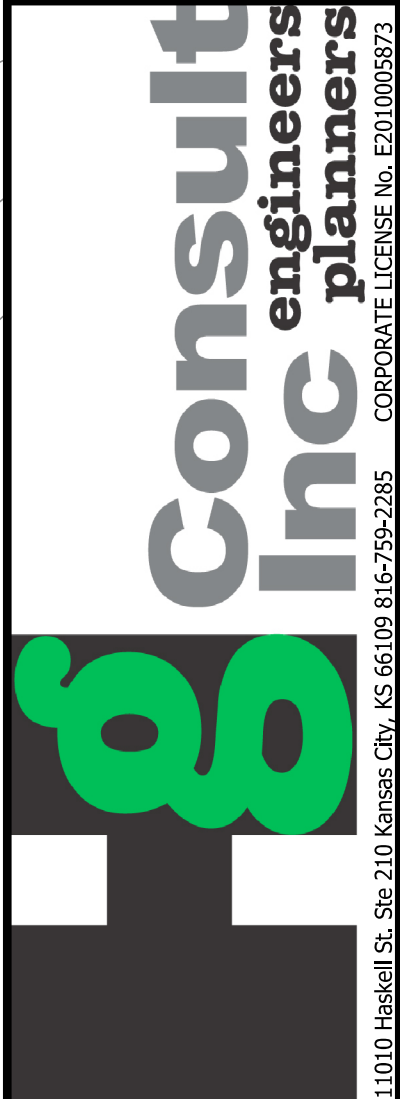


STORM SEWER PLAN	
ARISTOCRAT MOTORS	
LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	
X-REF NO.	XXX
DRAWING NO.	XXX
DATE	September 2019
JOB NO.	19.006.01
SHEET OF	14
REV.	6

DRAINAGE SUMMARY:

After analyzing the upstream drainage area (Area 1 1.112 acres, Area 2 0.941 acres), with an AASHTO soil rating (C rating) and the slope of the finish grade (3%), it is determined that the outlet structures detailed in the plan sheets, the post developed rate of discharge for both areas (4.29 cfs) is less than the pre-developed drainage flow (14.99 cfs). The detention ponds would be capable of detaining 0.466 acre-feet with a bottom elevation of 1014.4 in Area 1 detention and a bottom elevation of 1006.7 in Area 2 detention. The detention areas would have a maximum 100 year storm event elevation of 1018.9 in Area 1 detention and 1011.4 in Area 2 detention. This elevation would occur at maximum volume. For more information, see Storm Water Drainage Analysis that was submitted along with these construction plans.

STORM SEWER CALCULATIONS															
Storm Line	Sewer Location		Tributary Area (AC.)			Composite Runoff Coefficient	100-Year Design (k=1.25)		Pipe Design						
	From Structure No.	To Structure No.	Area Designation Acres				Total	Intensity (in/hr) i(100)	Runoff (cfs) Q(100)	Pipe Size (in)	Pipe Slope (%)	Pipe Type	Rough. Coeff. (Mannings)	Full Velocity (fps)	Full Flow (cfs)
Line 1	1A	1B	1	1.112	1.112	0.57	10.32	8.18	24	0.61	HDPE	0.01	7.31	22.97	
	1B	1C	3	0.141	1.253	0.80	10.32	9.63	24	5.48	HDPE	0.01	21.90	68.84	
	1C	1D	4	0.336	1.589	0.80	10.32	13.10	24	5.52	HDPE	0.01	21.99	69.09	
Line 2	2A	2B	2	0.941	0.941	0.76	10.32	9.23	18	0.73	HDPE	0.01	6.60	11.67	
	2C	2D	2	0.000	0.941	0.30	10.32	9.23	18	0.72	HDPE	0.01	6.56	11.59	

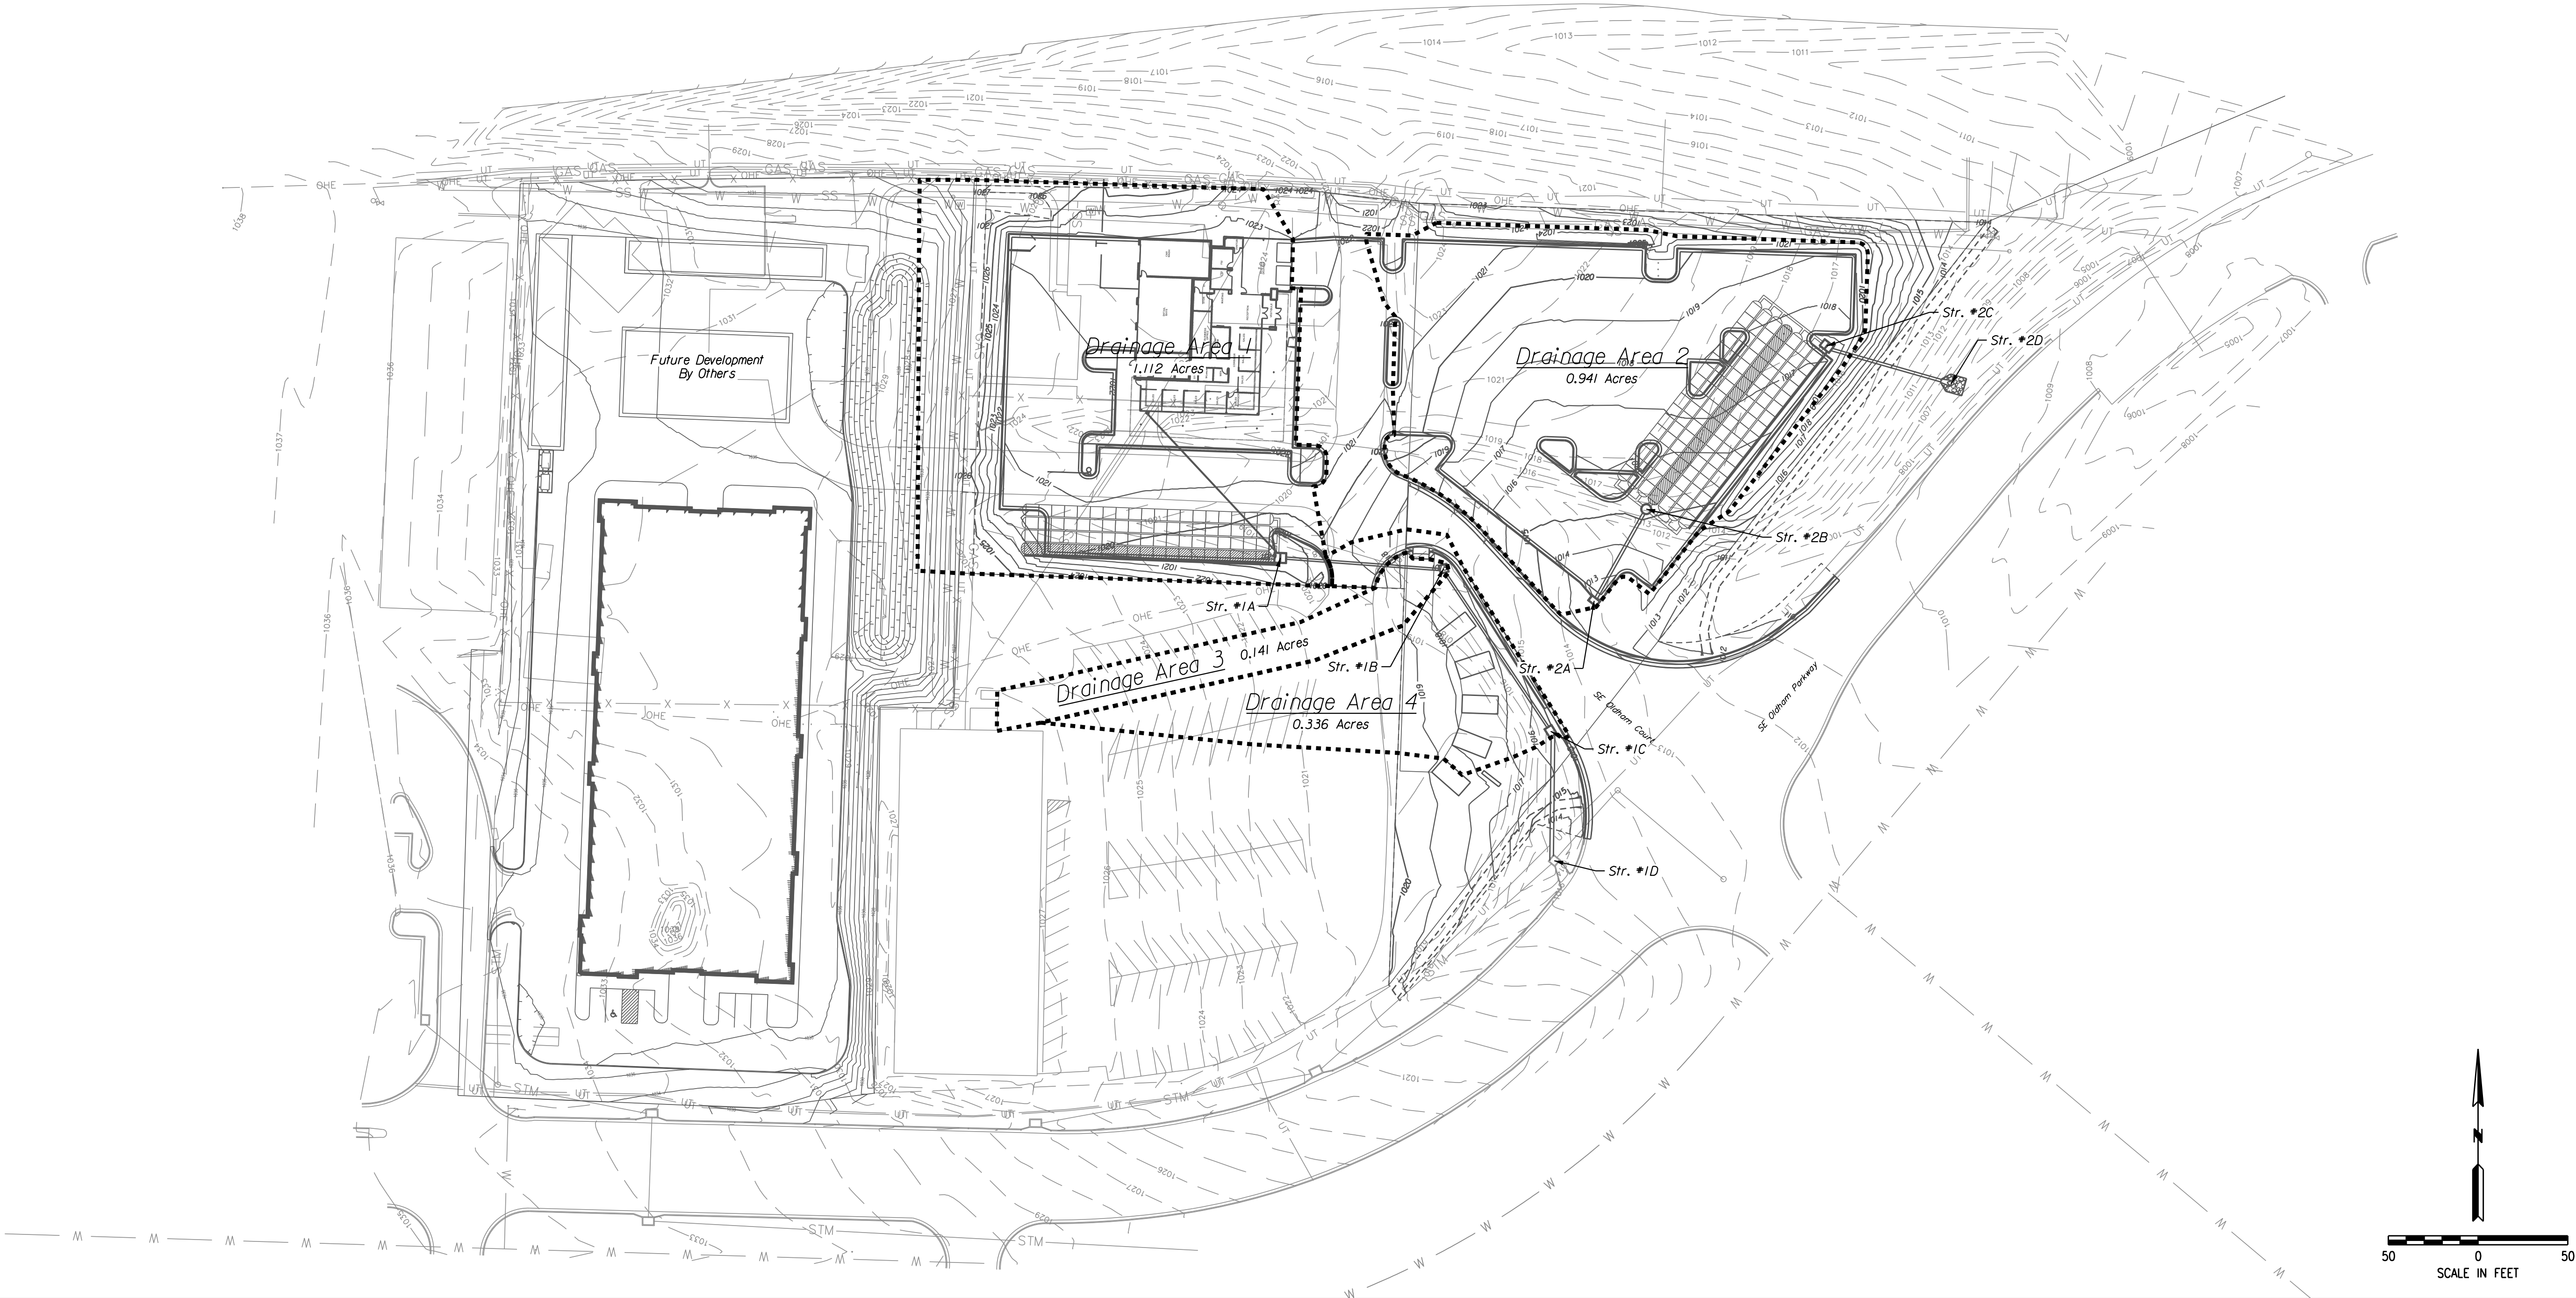

DATE	REVISION	BY	CHK/APP
9/3/19			
7/16/19			
6/14/19			

Addressed bid questions in regards to ME-201

Addressed City Comment Letter dated 6/28/19

PDP Submittal

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES

3

RAM

RKS

2

RAM

RKS

1

RAM

RKS

9/3/19

R. KEVIN STERRETT, NO E-26440

11010 Haskell St, Ste 210 Kansas City, KS 66109 816-759-2285 CORPORATE LICENSE NO. E2010005873

DRAINAGE AREA MAP

ARISTOCRAT MOTORS

LEE'S SUMMIT - JACKSON COUNTY - MISSOURI

X-REF NO. XXX

DRAWING NO. XXX

DATE September 2019



JOB NO. 19.006.01

7



SHEET OF 14

GENERAL NOTES:

1. All utility installation to be in accordance to Lee's Summit "DESIGN AND CONSTRUCTION MANUAL" per Ordinance 5813. See manual for specifications and standard details.
2. Reuse existing sanitary as shown. Abandon existing gas and water services as shown and replace w/ new services connections.
3. Water service line to be 1" K Copper.
4. Sanitary sewer service to be 4" Schedule 40 or SDR-26 PVC at 2% minimum slope.
5. Trench checks are to be provided on all service laterals "Y" within 5 feet of the sanitary sewer line.
6. Contractor to contact the Water Utilities Department, Operations Division, at (816) 969-7606 to schedule water main taps and cut-ins, 48 hours in advance.
7. Gas service line to be sized per MEP plans.
8. Contractor to coordinate electrical service with KCP&L.

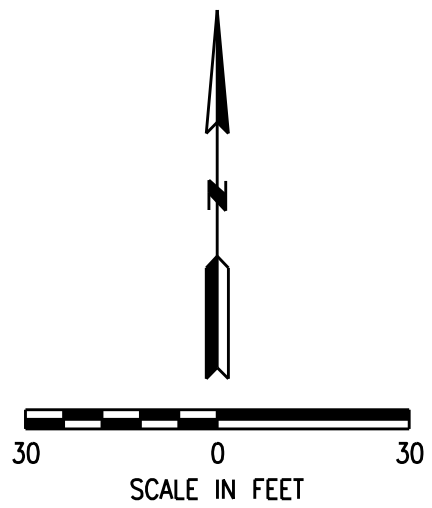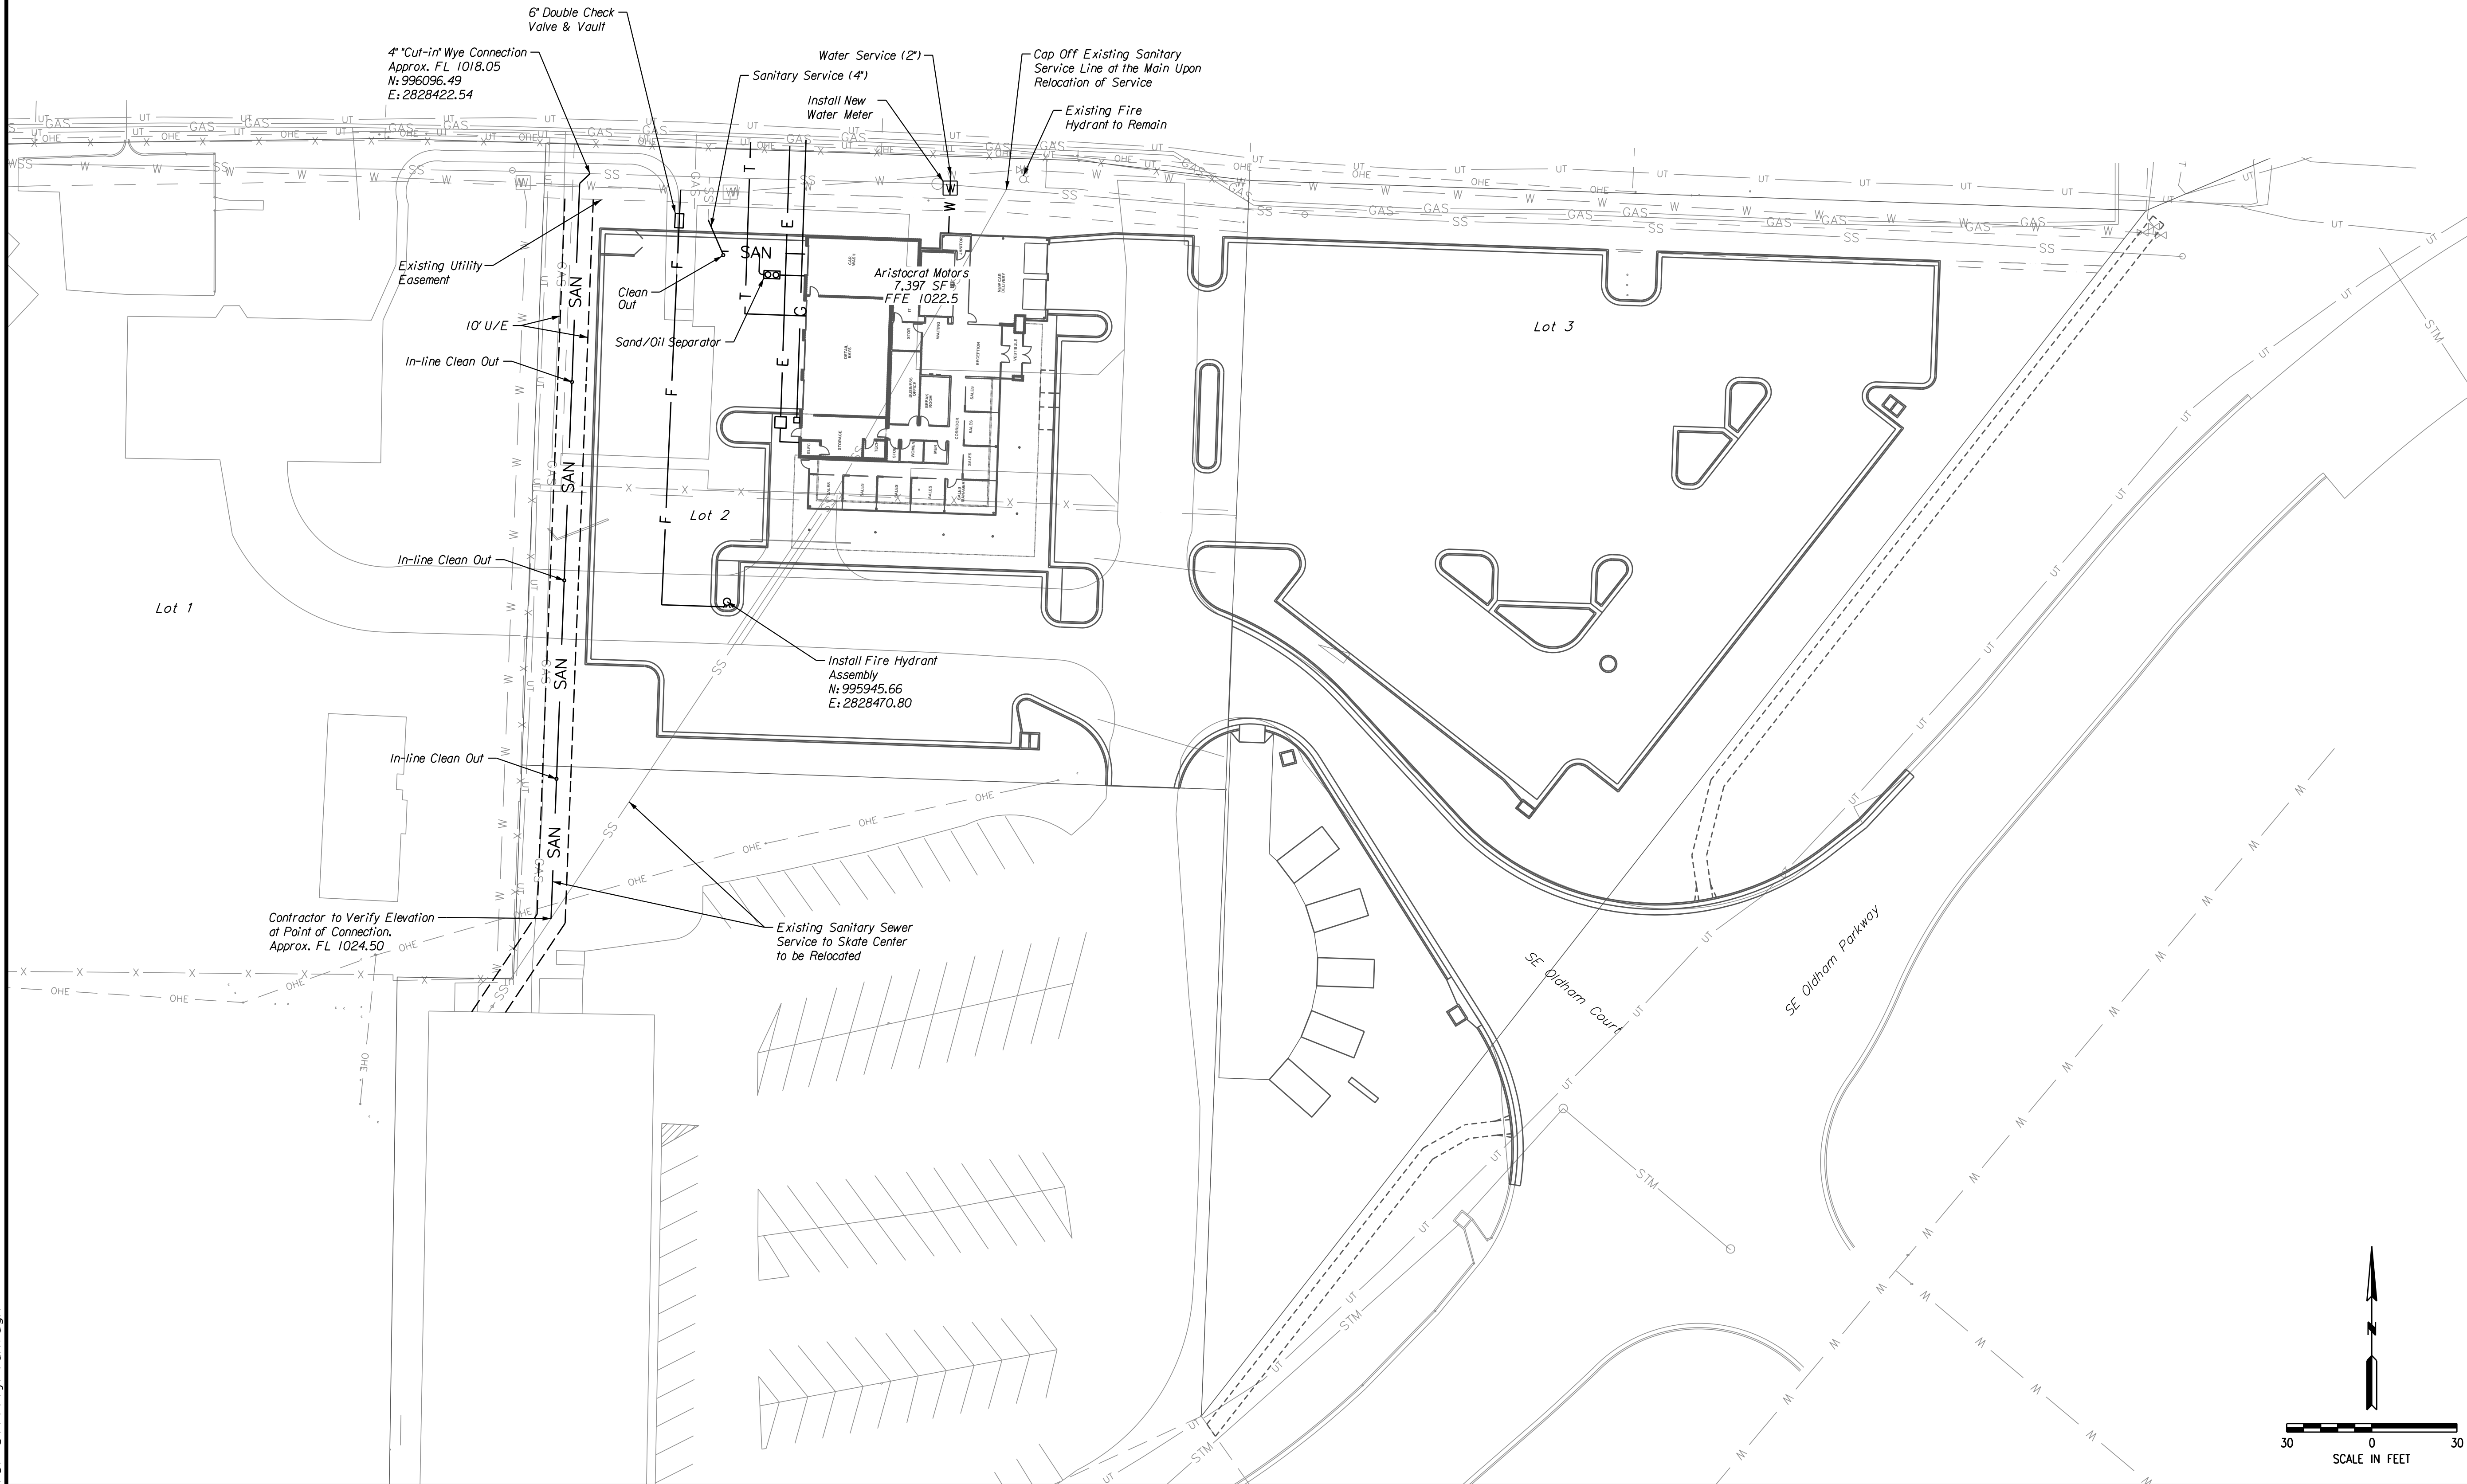


DATE	REVISION	NO.	BY	CHK/APP
9/3/19				
7/16/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
6/14/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
	PDP Submittal	1	RAM	RKS
IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES				

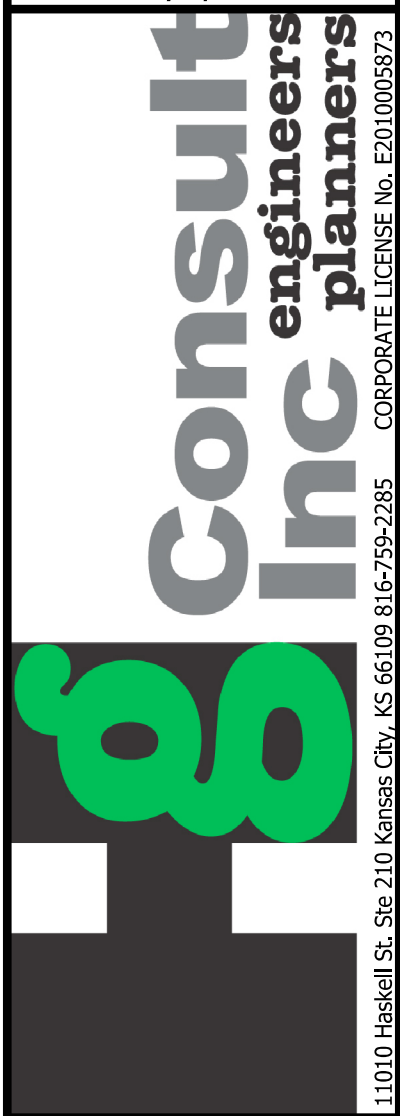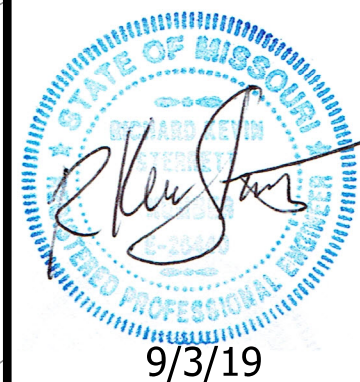

UTILITY PLAN	
ARISTOCRAT MOTORS	
LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	
X-REF NO.	XXX
DRAWING NO.	XXX
DATE	September 2019
JOB NO.	19.006.01
SHEET OF	8 14

1. The Developer shall be responsible for erosion control within the boundaries of this development. Erosion control shall be the responsibility of said Developer until all development work on site is complete, and all appropriate permits have been released and/or terminated. The Developer is responsible for seeing that all Development Contractor's comply with the requirements of any and all land disturbance permits, grading permits and storm water discharge permits.
2. Erosion Control and Siltation Control methods shall be in place prior to commencement of any grading and/or excavation of the site. All erosion control measures shall remain in place until final grade and sod is completed by the Builder, and shall be maintained throughout the project until the acceptance of the work by the City.
3. No grading shall be steeper than 3H:1V. All areas graded should have the soil surface lightly roughened and loosened to a depth of 2 to 4 inches prior to seeding. Areas that have been graded and will not be stabilized immediately shall be roughened to reduce runoff velocity until seeding takes place.
4. Sediment Fences shall be inspected periodically and after every rain event for damage and for the amount of sediment which has accumulated. Removal of sediment will be required when it reaches one-third (1/3) the height of the sediment fence. Sediment fences to be repaired or replaced as necessary.
5. Parking on non-surfaced areas is prohibited in order to eliminate the condition whereby mud and debris from construction and employee vehicles is tracked onto existing pavement. The Contractor shall keep the existing roadways free of mud, rock and debris at all times. The site shall have a temporary construction access installed to prevent mud and debris from being tracked onto the public street.
6. Permanently stabilize all graded areas immediately after final grading is complete on each area in the Grading Plan. If clearing and/or grading operations are suspended for a period of thirty (30) days or longer, temporary stabilization measures are required. These measures may include seeding, periodic weeding, mulching or other suitable measures.
7. If cut and fill operations occur during a season not favorable for immediate establishment of permanent ground cover, a fast germinating annual such as rye grasses or sudan grasses shall be utilized to retard erosion, if adequate stormwater detention and erosion control methods have not been established.
8. All trash and debris located on the project site, either existing or as a result of construction, shall be removed and properly disposed of in accordance with all local, state and federal regulations.
9. Upon completion of the project, Contractor shall seed, mulch and fertilize all areas disturbed by construction.
10. Silt fence shall be installed per APWA ESC-03 standard drawing.
11. Temporary construction entrance shall be installed per APWA ESC-01 standard drawing.

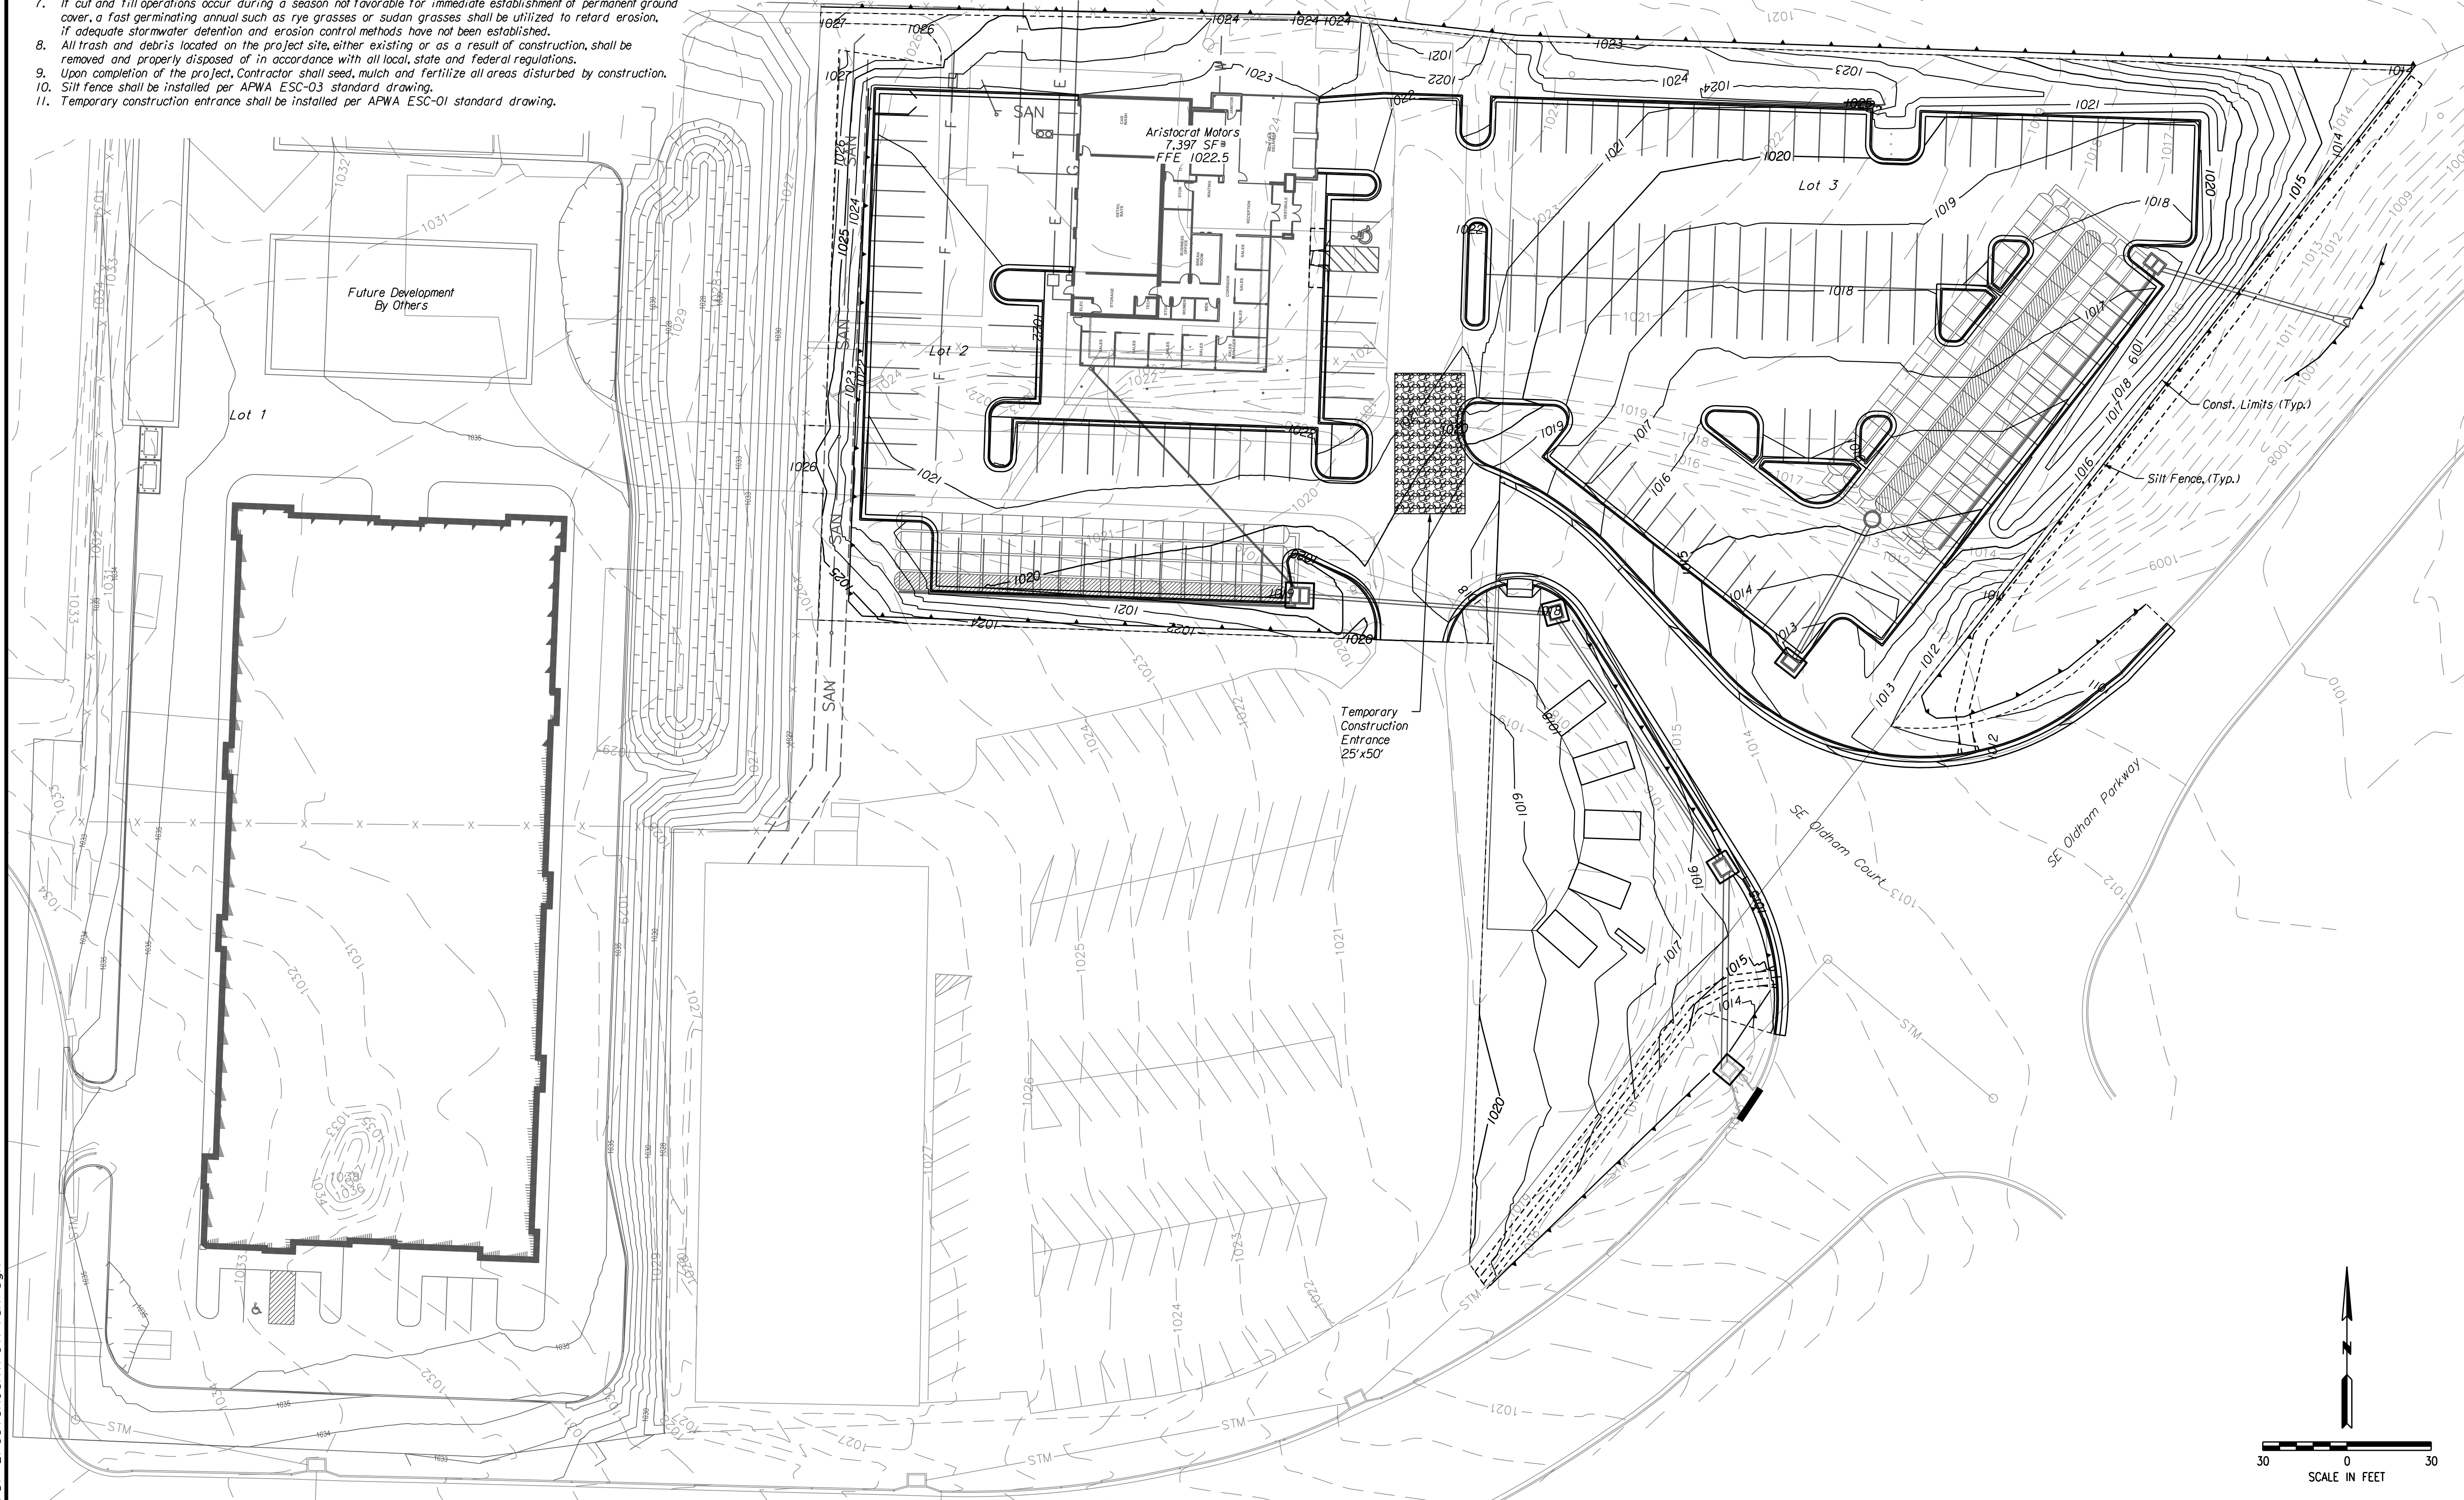

 Temporary Stone Construction Entrance (APWA ESC-01)

 Silt Fence (APWA ESC-03)

 Storm Drain Inlet Protection (APWA ESC-06 & ESC-07 or approved equal)

DATE	REVISION	NO.	BY	CA/APP
9/3/19	Addressed bid questions in regards to ME-201	3	RAM	RNS
7/16/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RNS
6/14/19	PDF Submittal	1	RAM	RNS

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.



9/3/19



**Consult
Inc
engineers
planners**

CORPORATE LICENSE NO. E2010005873
SHE 210 Kanawha City, KS 66109 816-759-2285

R. KEVIN STERRETT, MO E-26440

1010 Haskell St. Ste 210 Kansas City, KS 66109 816-759-2285 CORPORATE LICENSE No. E2010005873

EROSION CONTROL PLAN













ARISTOCRAT MOTORS

EE'S SUMMIT - JACKSON COUNTY - MISSOURI

X-REF NO.	XXX
DRAWING NO.	XXX
DATE	September 20
JOB NO.	19.006.01

9 SHEET OF 14


9

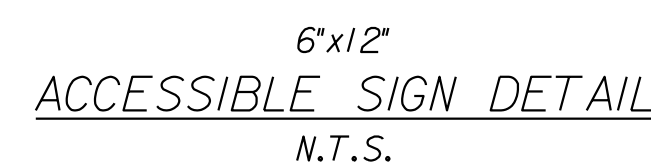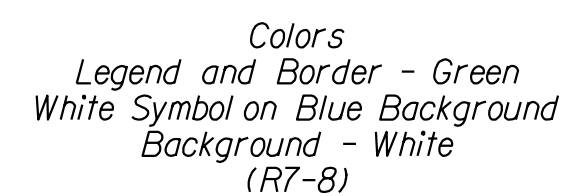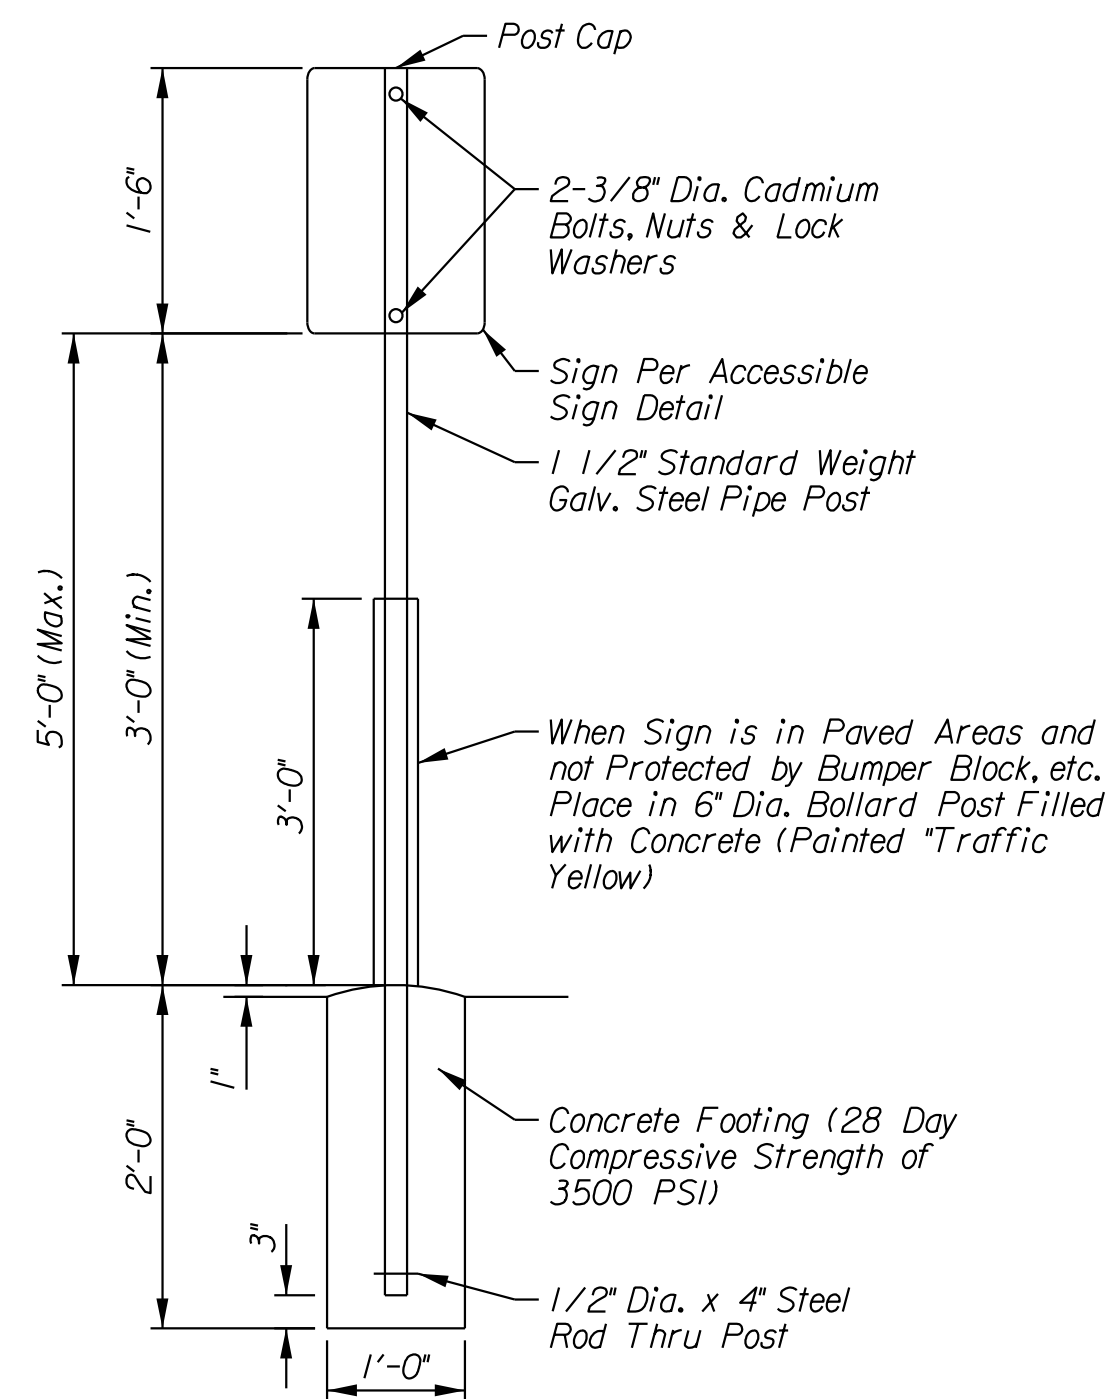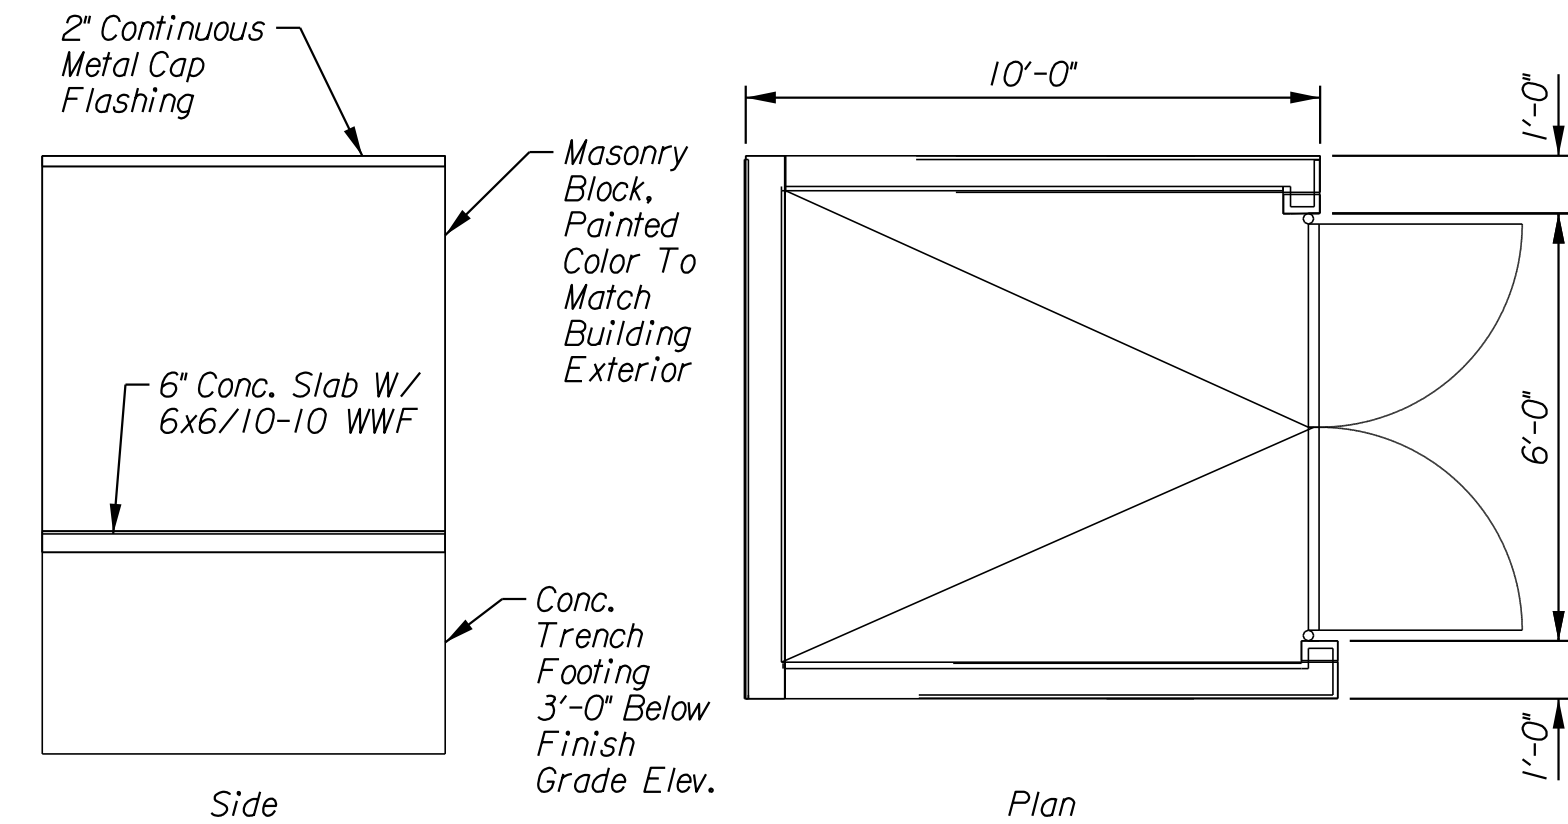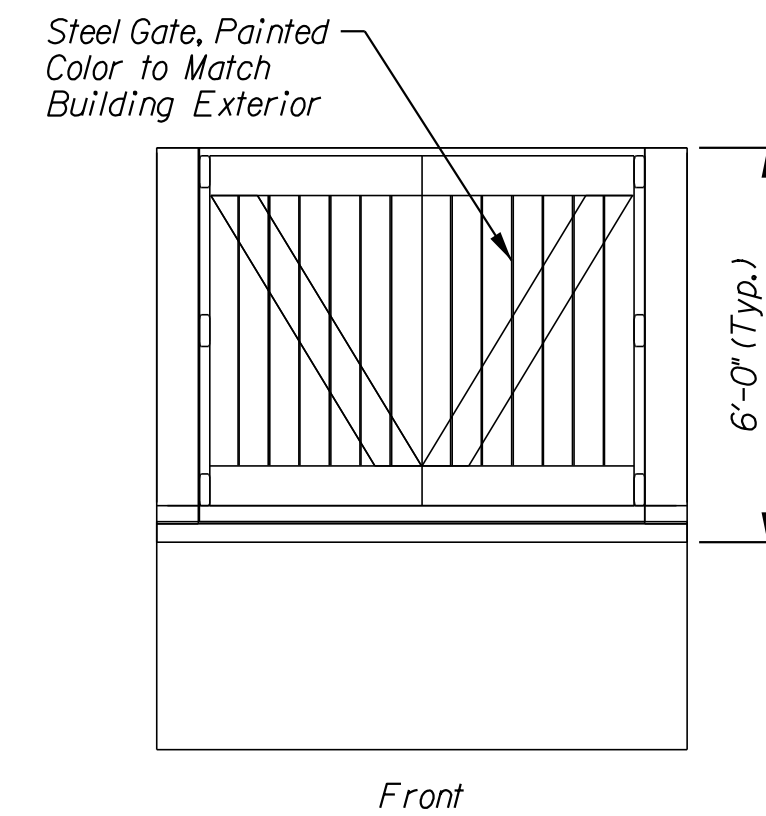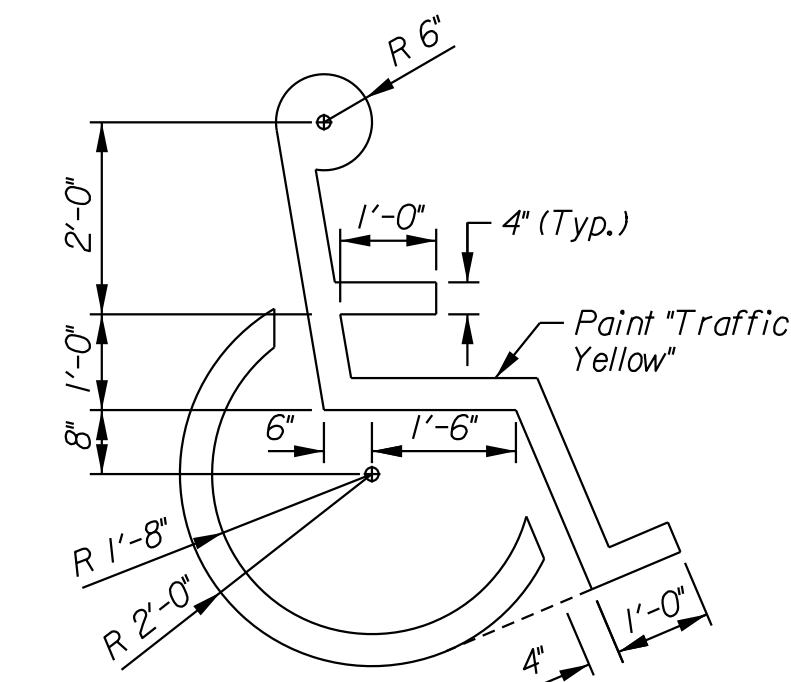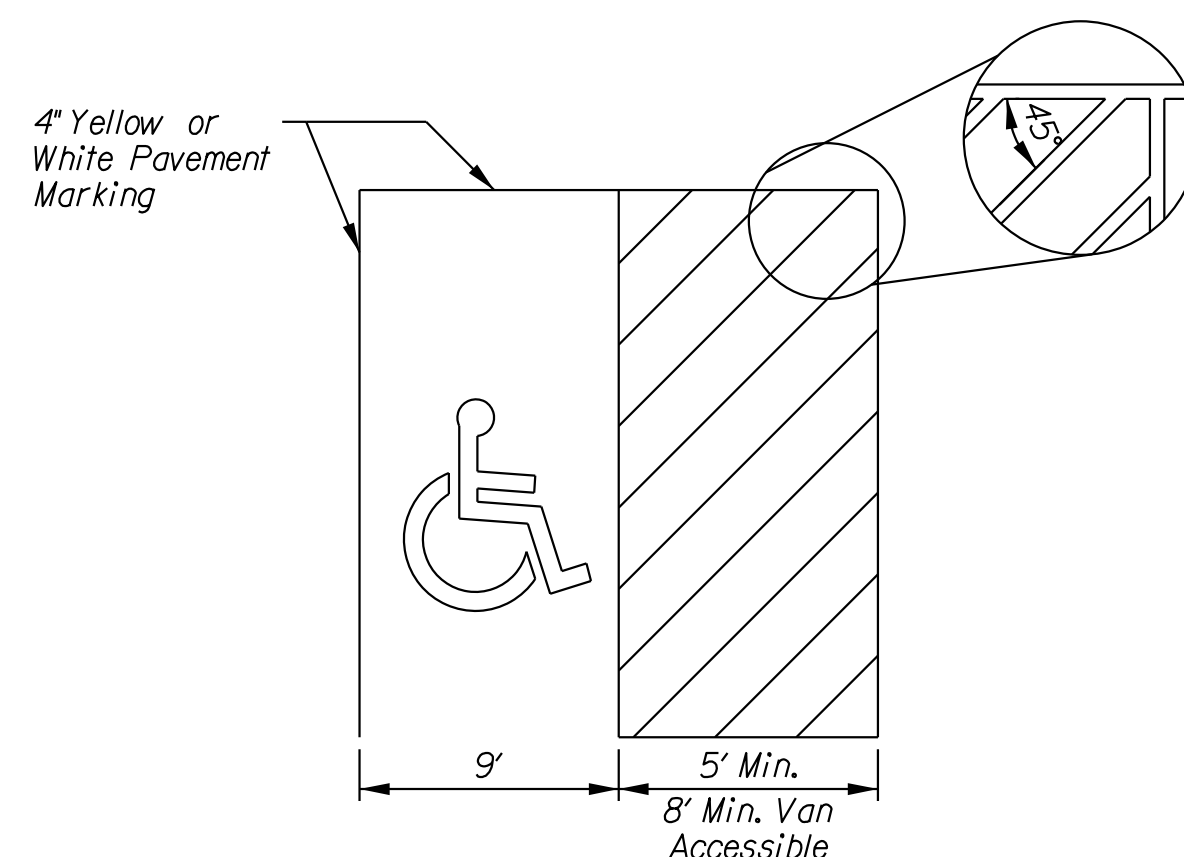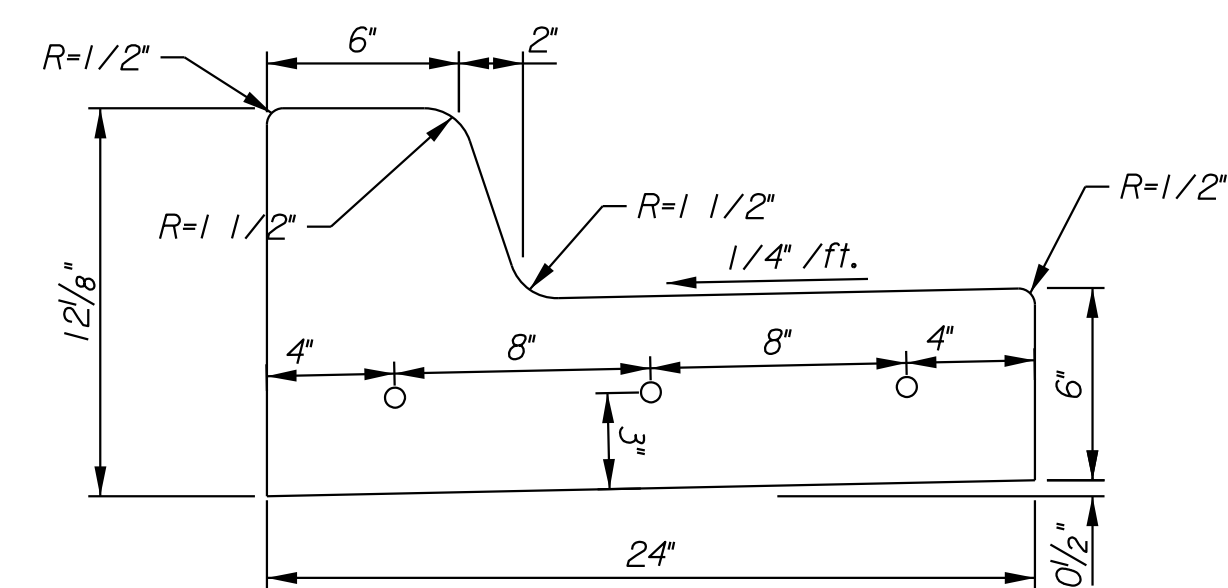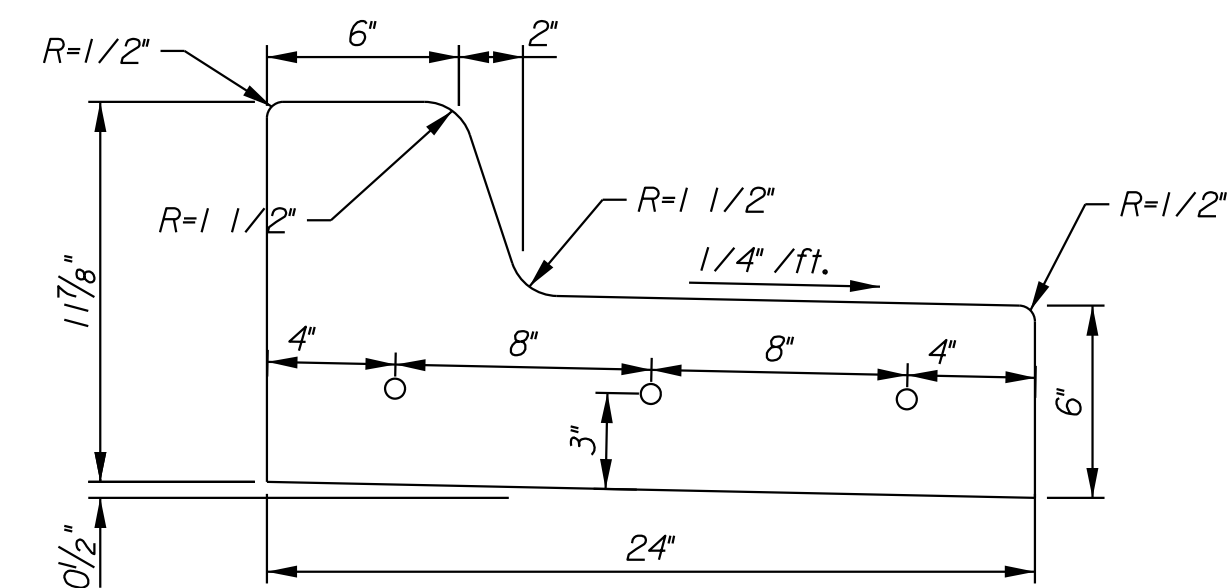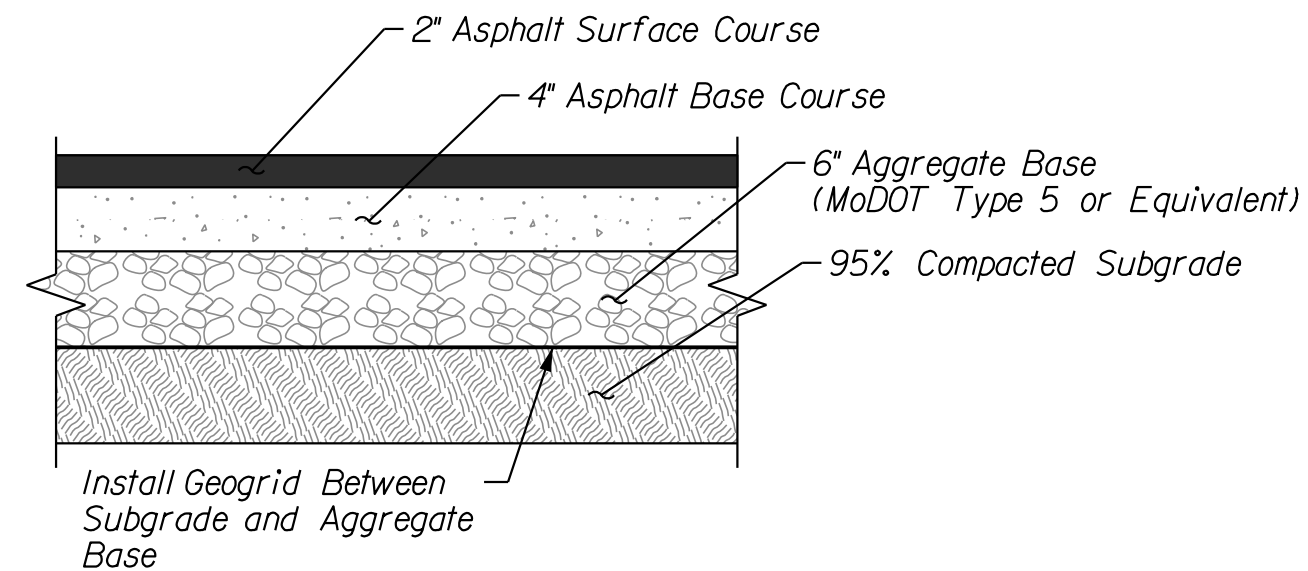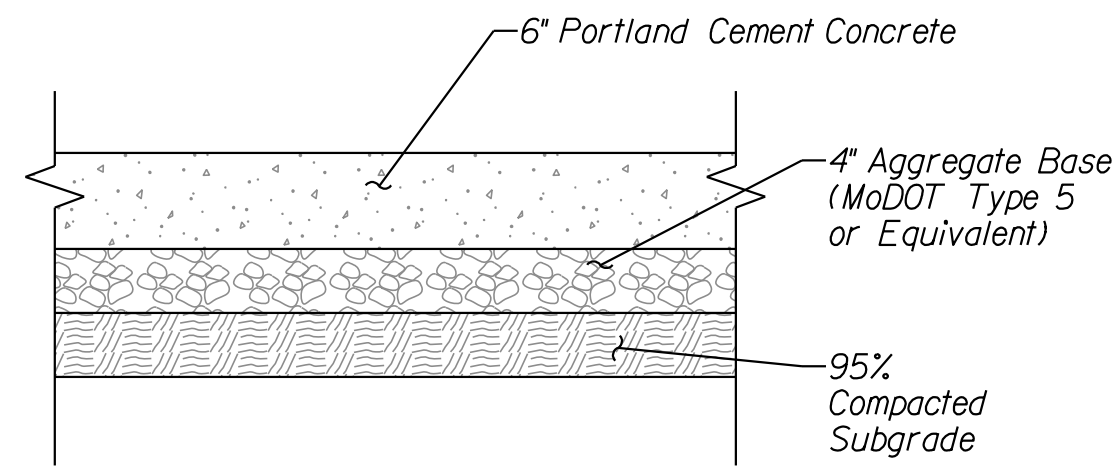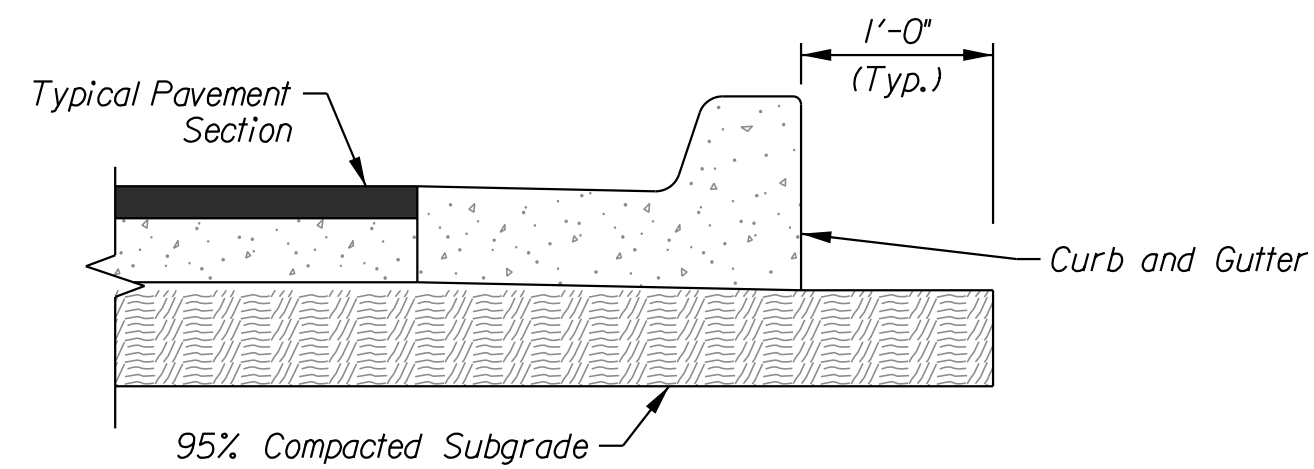


1. All signs should comply with U.S. Department of Transportation Federal Highway Administration's "Uniform Traffic Control Devices", and local codes as specified. Mount signs in accordance with manufacturer's instructions.

DATE	REVISION	NO.	BY	CK/APP
9/3/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
7/16/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
6/14/19	PDF Submittal	1	RAM	RKS

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.

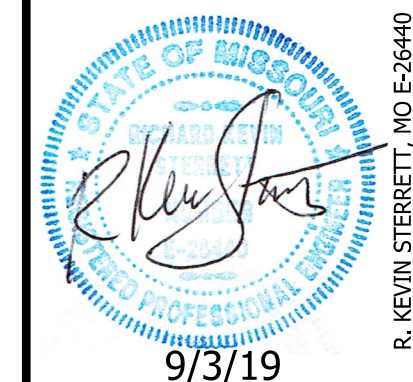


DETAIL SHEET ARISTOCRAT MOTORS LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	X-REF NO. XXX
	DRAWING NO. XXX
	DATE September 2019
	JOB NO. 19.006.01
	10 SHEET OF 14

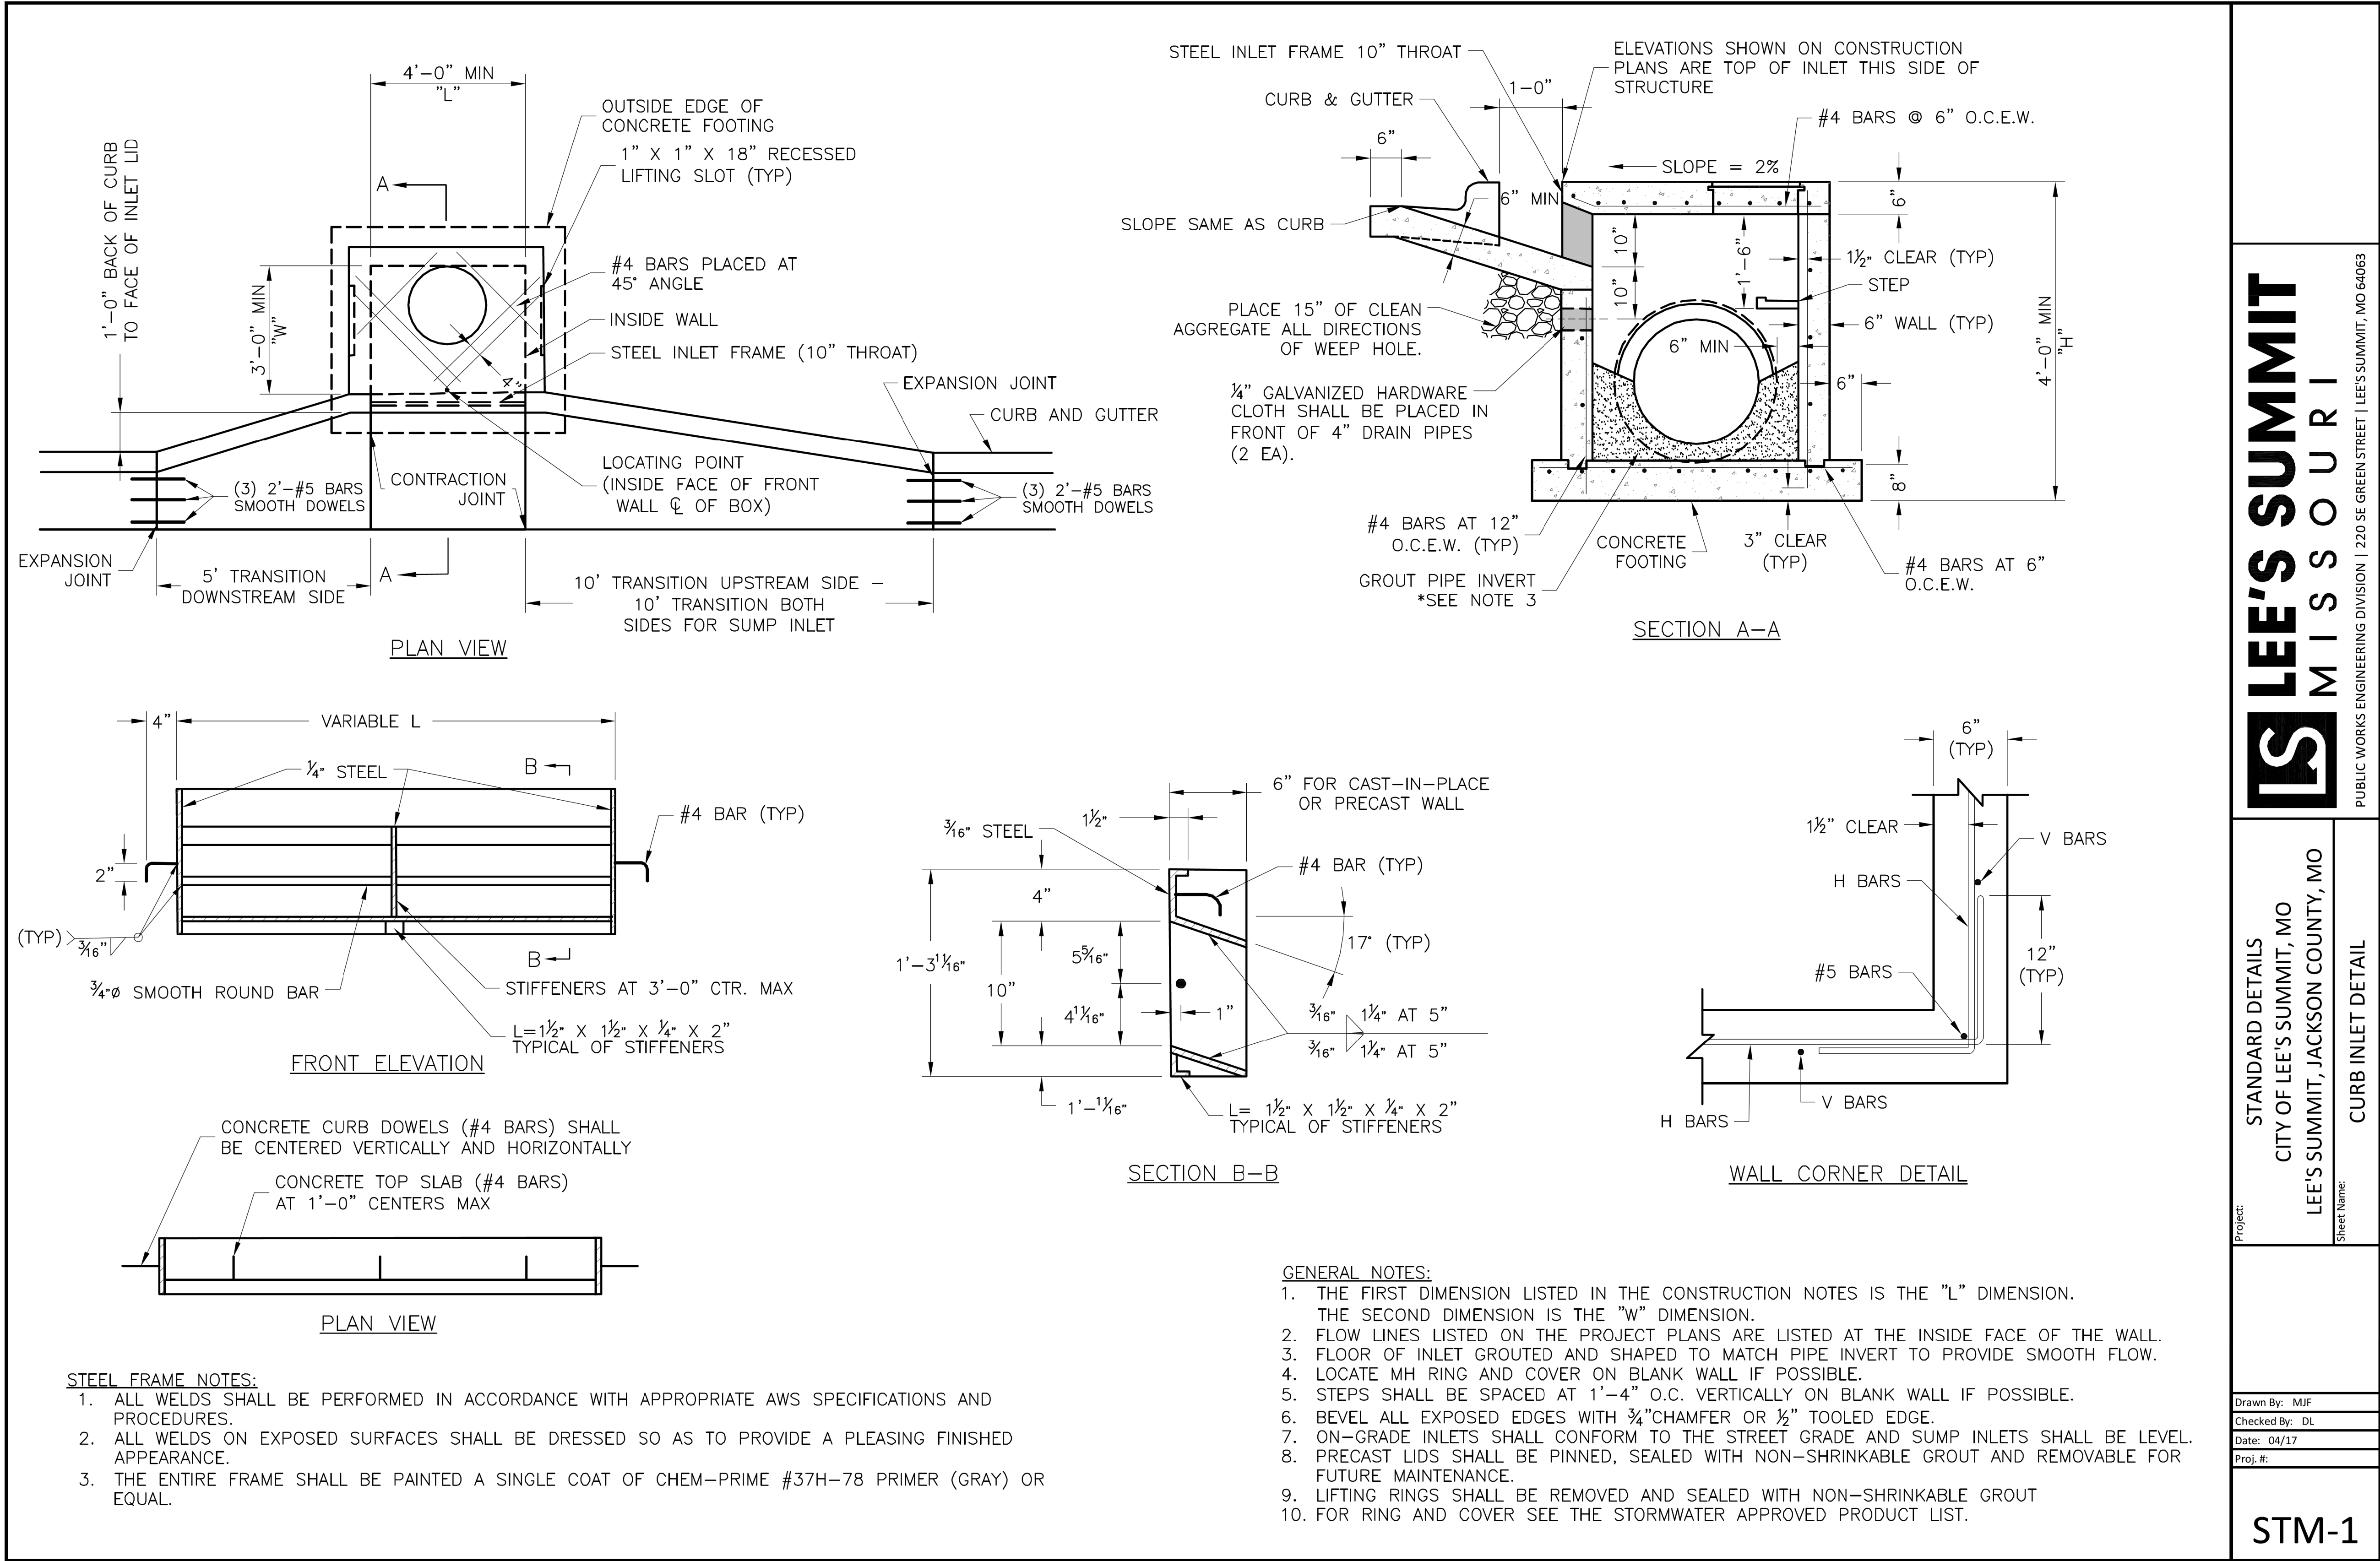



NO.	BY	DATE	REVISION
1	RAM	9/3/19	Addressed bid questions in regards to ME-201
2	RAM	7/16/19	Addressed City Comment Letter dated 6/28/19
3	RAM	6/14/19	PDP Submittal

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.

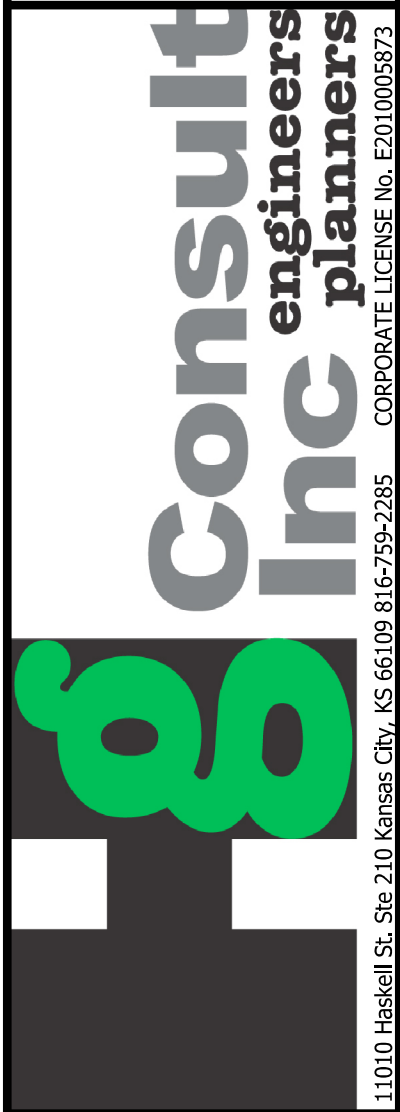


DETAIL SHEET	ARISTOCRAT MOTORS
LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	


X-REF NO. XXX
DRAWING NO. XXX
DATE September 2019
JOB NO. 19.006.01
SHEET 11 OF 14

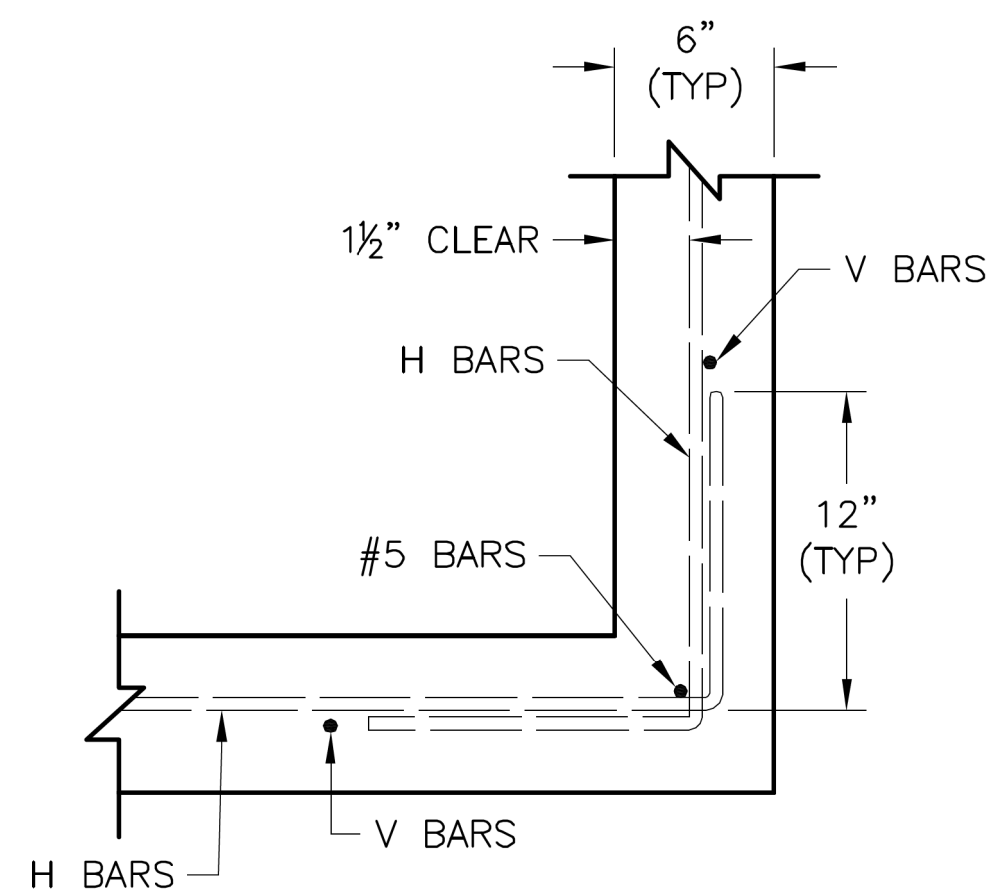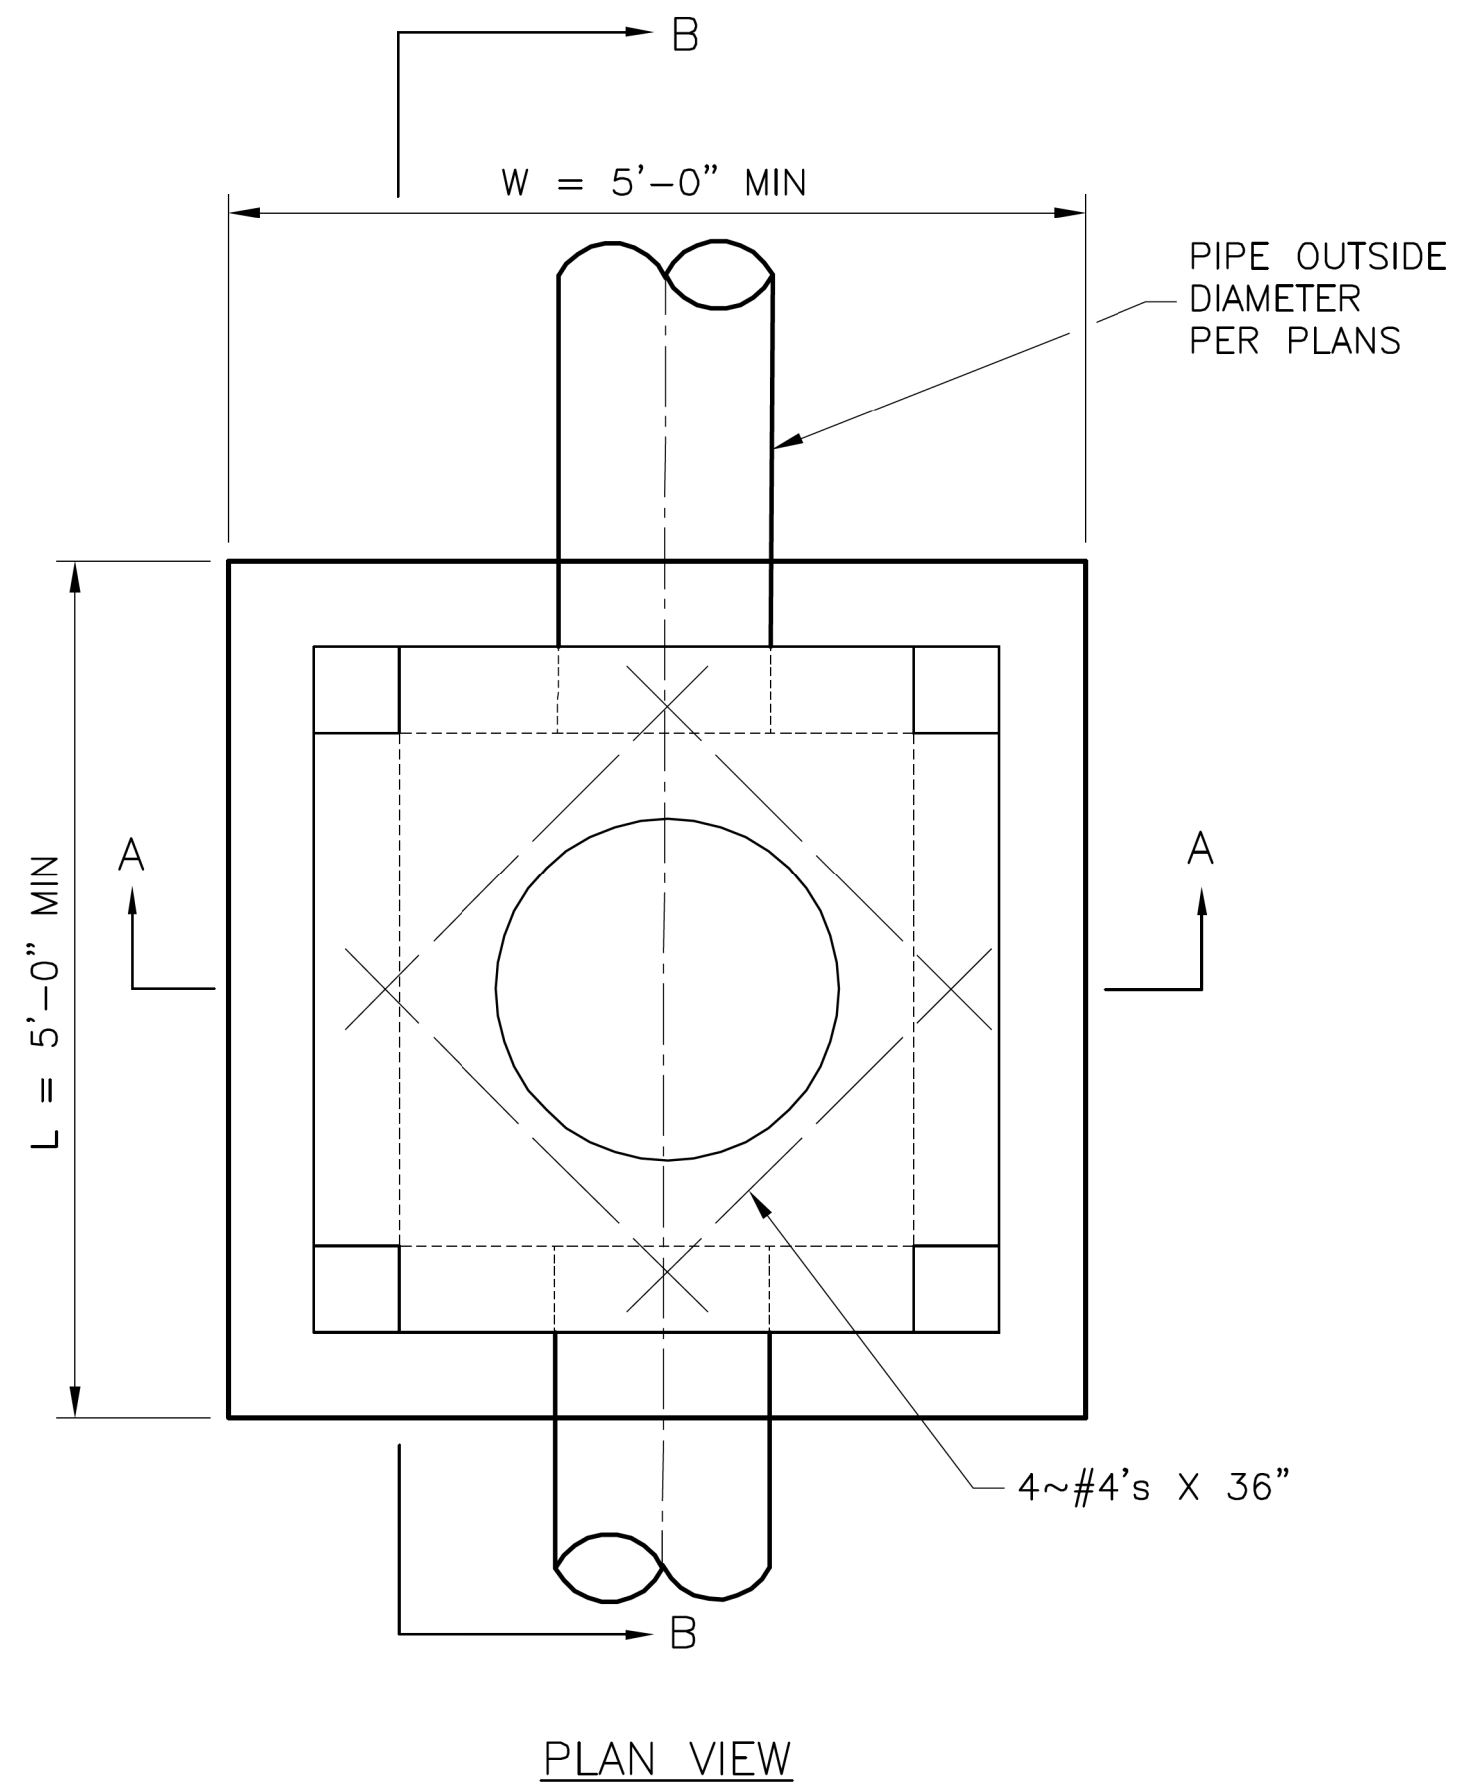

WALL CORNER DETAIL

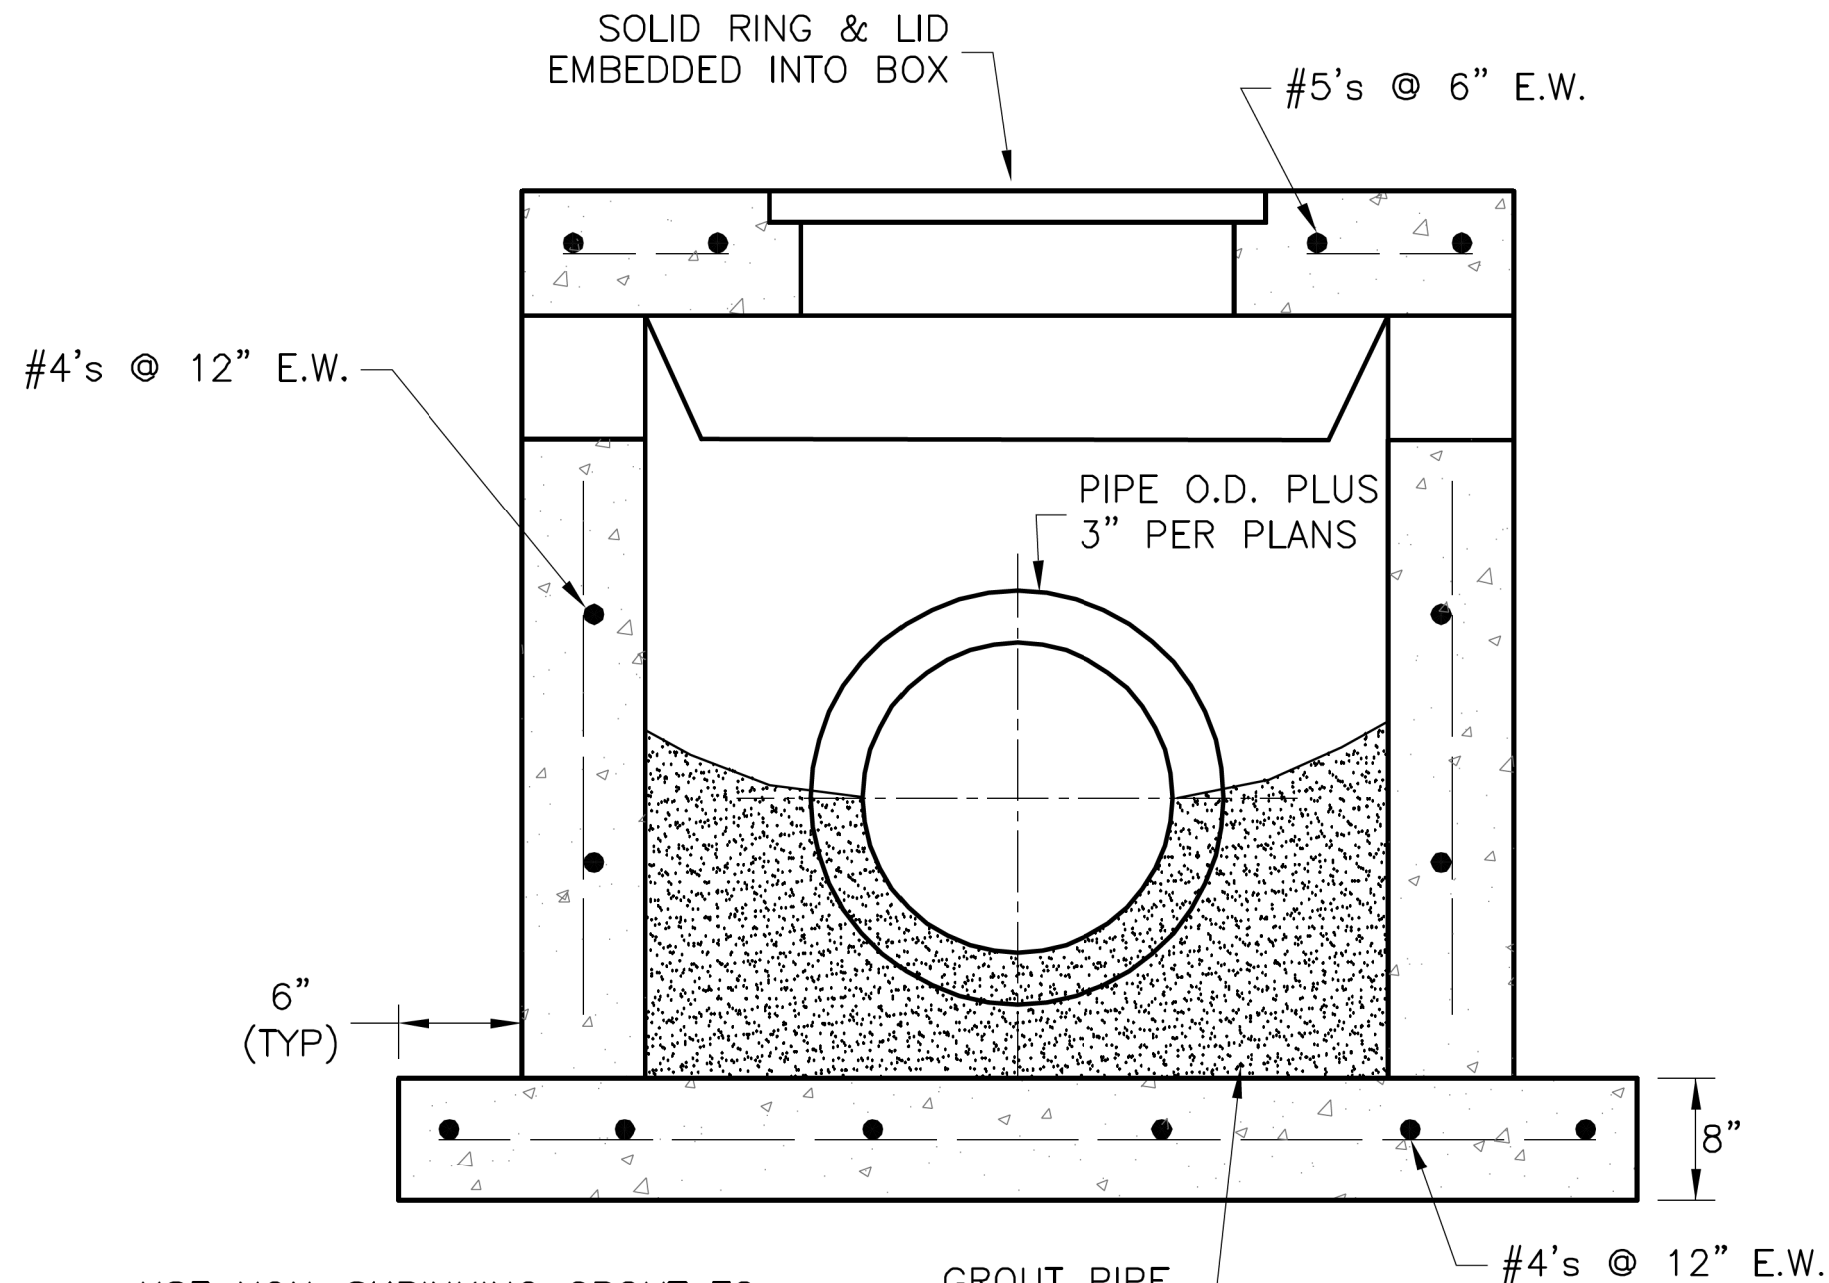

SECTION A-A

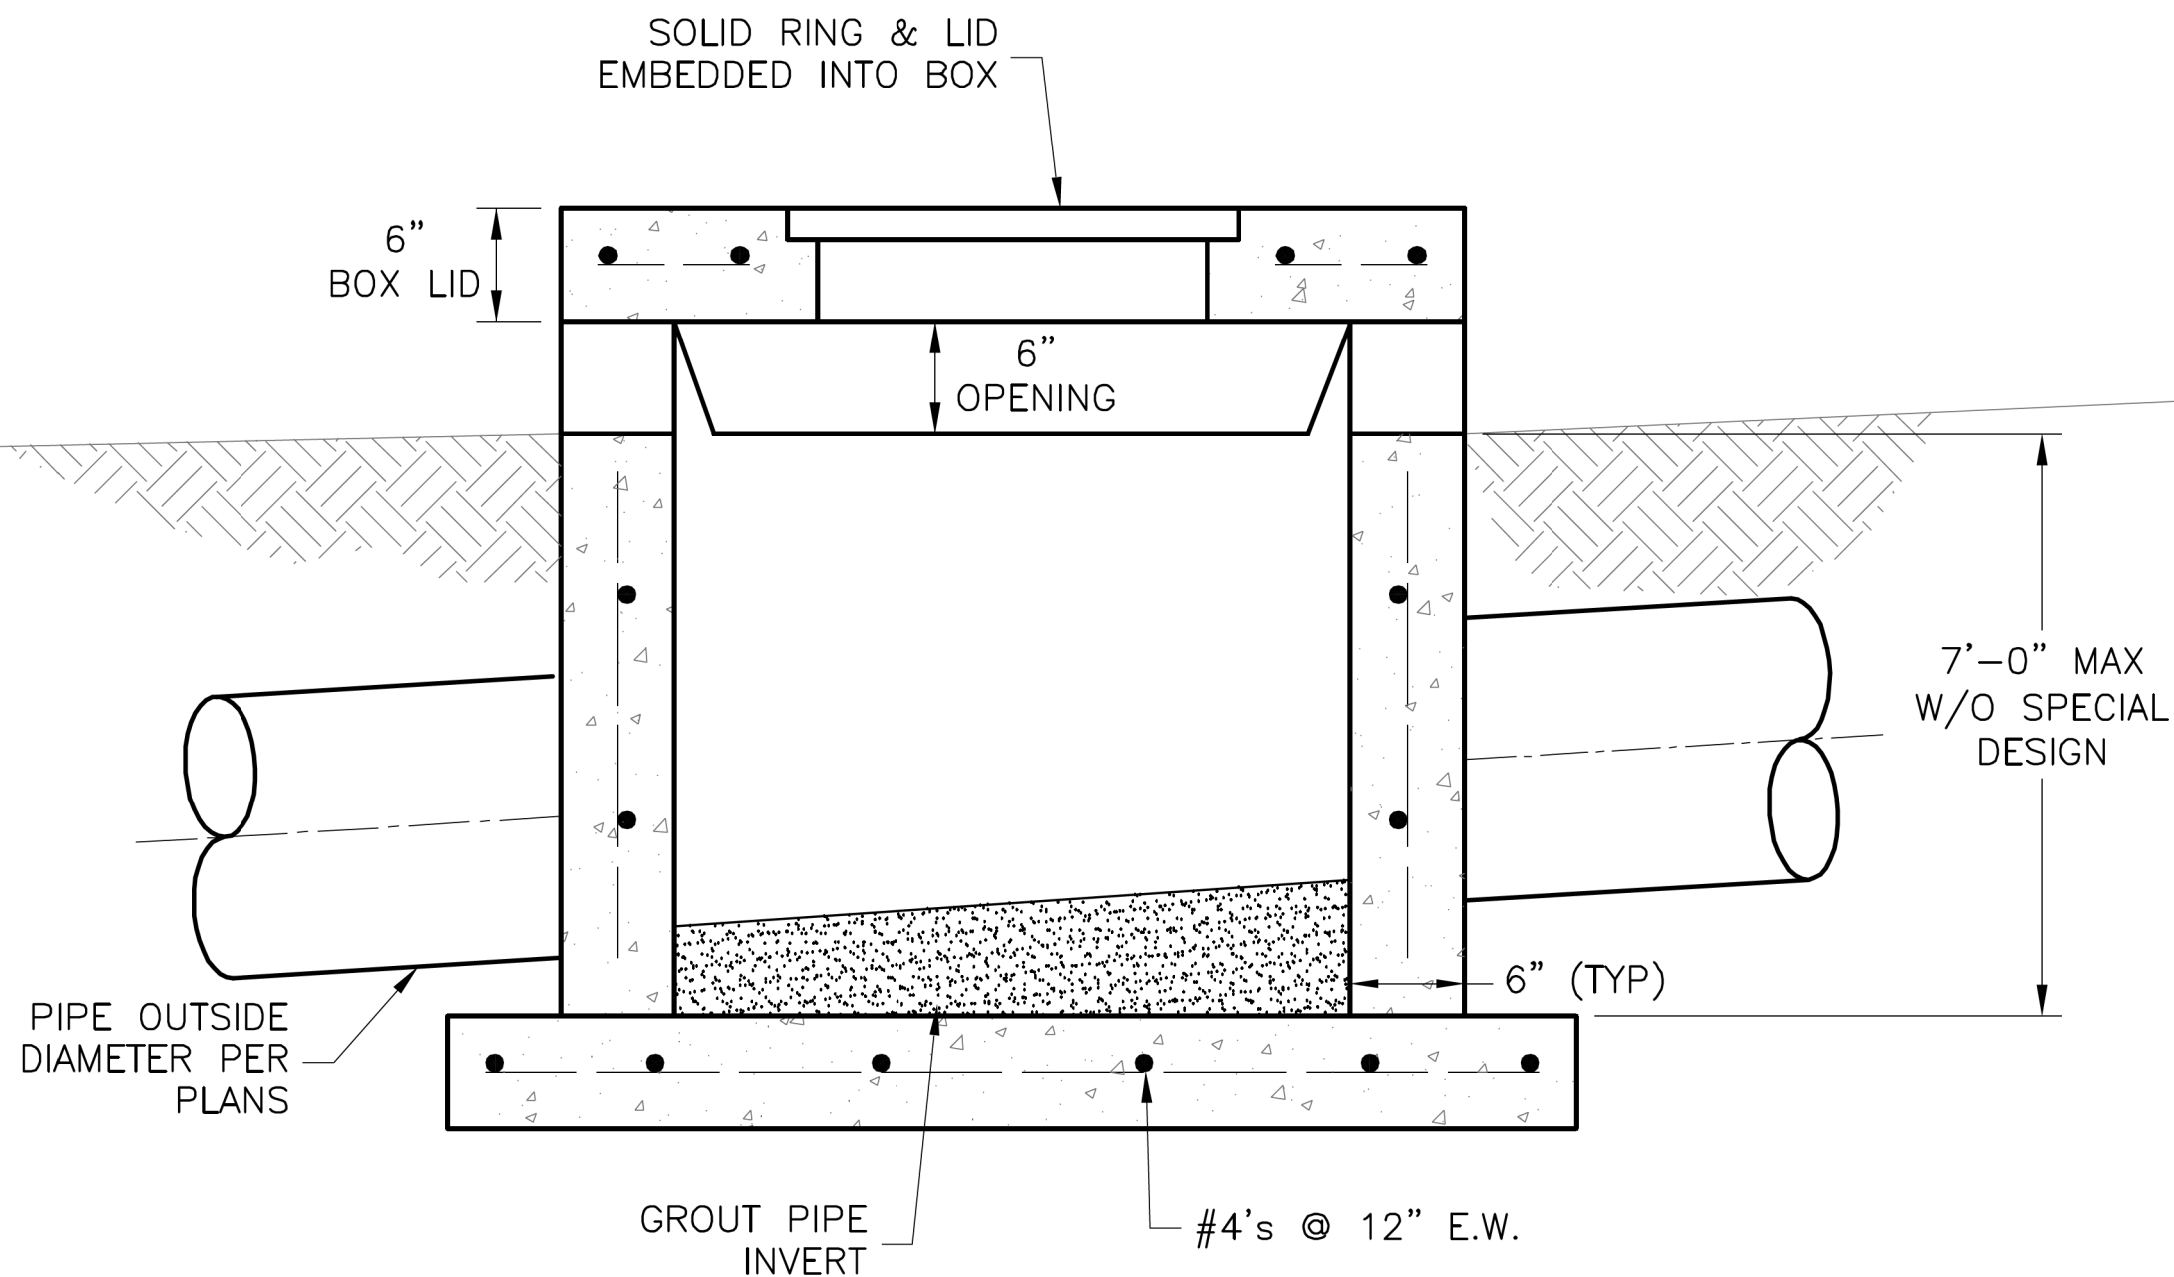

SECTION B-B

GENERAL NOTES:

1. LOCATE RING AND COVER OVER OUTLET ON BLANK WALL.
2. USE $\frac{3}{4}$ " CHAMFER ON ALL EXPOSED CONCRETE CORNERS.
3. FLOOR OF INLET GROUTED AND SHAPED TO MATCH PIPE INVERT TO PROVIDE SMOOTH FLOW.
4. STEPS REQUIRED AT 16" O.C. WHEN DEPTH FROM TOP OF CASTING TO INVERT EXCEEDS 3' ON BLANK WALL IF POSSIBLE.
5. BOXOUTS WILL NOT BE ALLOWED TO PROJECT THROUGH THE CORNERS OF THE STRUCTURE.
6. THE MINIMUM REINFORCING SHALL BE 1 H-BAR OVER A CAST-IN-PLACE PIPE AND 2 H-BARS OVER A PRECAST BOXOUT.
7. SHOW FIELD INLET ORIENTATION ON PLANS PLUS NUMBER AND SIDE OF OPENINGS.
8. PRECAST LIDS SHALL BE PINNED, SEALED WITH NON-SHRINKABLE GROUT AND REMOVABLE FOR FUTURE MAINTENANCE.
9. FOR RING AND COVER SEE THE STORMWATER APPROVED PRODUCT LIST.

LEE'S SUMMIT
MISSOURI


PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64063

STANDARD DETAILS
CITY OF LEE'S SUMMIT, MO
LEE'S SUMMIT, JACKSON COUNTY, MO

FIELD INLET DETAIL

Drawn By: MJF
Checked By: DL
Date: 04/17
Proj. #:

STM-2

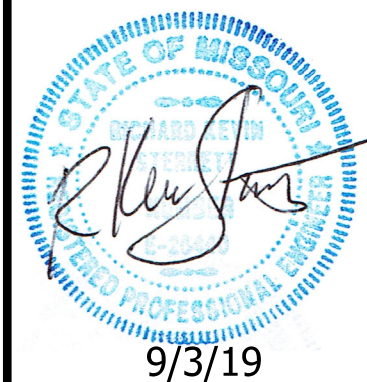

DETAIL SHEET

ARISTOCRAT MOTORS


LEE'S SUMMIT - JACKSON COUNTY - MISSOURI

X-REF NO.	XXX
DRAWING NO.	XXX
DATE	September 2019
JOB NO.	19.006.01

12 SHEET OF 14

REV.

9/3/2019
FDP-DetailSheet-06.dgn





LEE'S SUMMIT
MISSOURI

PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64063

FLARED END SECTION SUPPORT DETAIL

Date: 04/17
Drawn By: MJF
Checked By: DL

STM-5

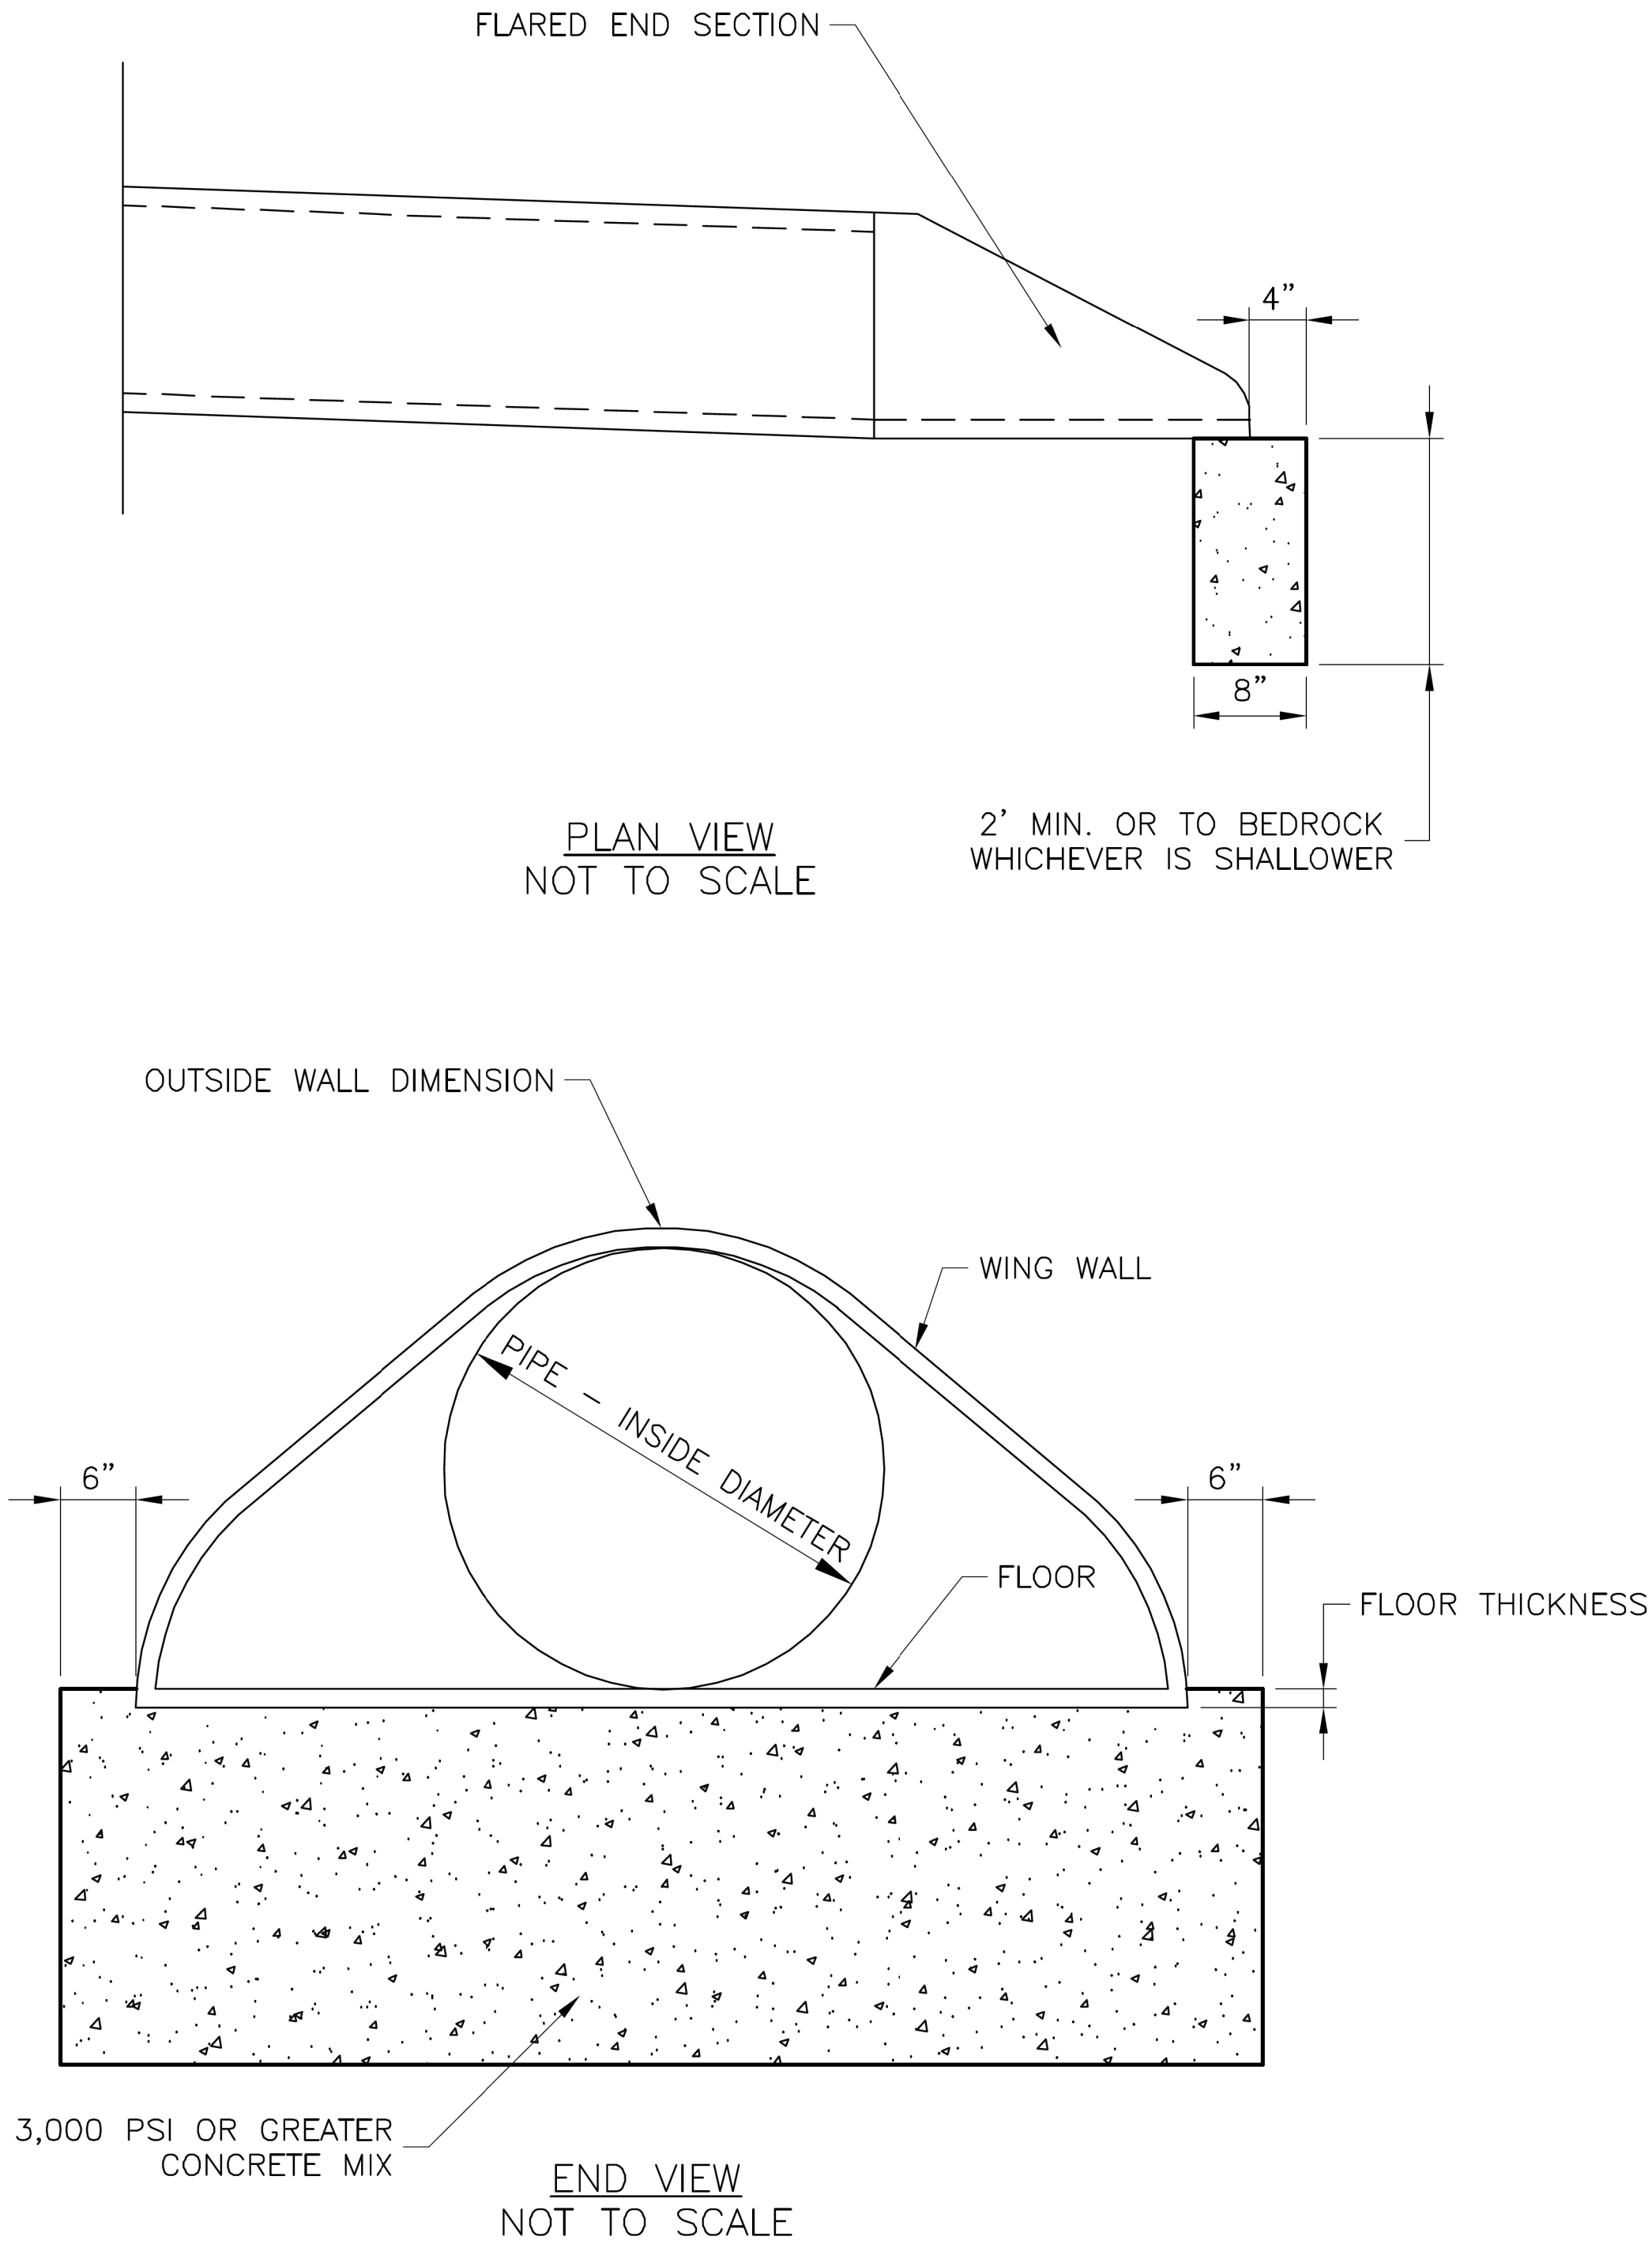

LEE'S SUMMIT
MISSOURI


PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64063

STORM MANHOLE COVER DETAIL


Date: 04/17
Drawn By: MJF
Checked By: DL

STM-6

1-1/2" LETTERS
EQUALLY SPACED

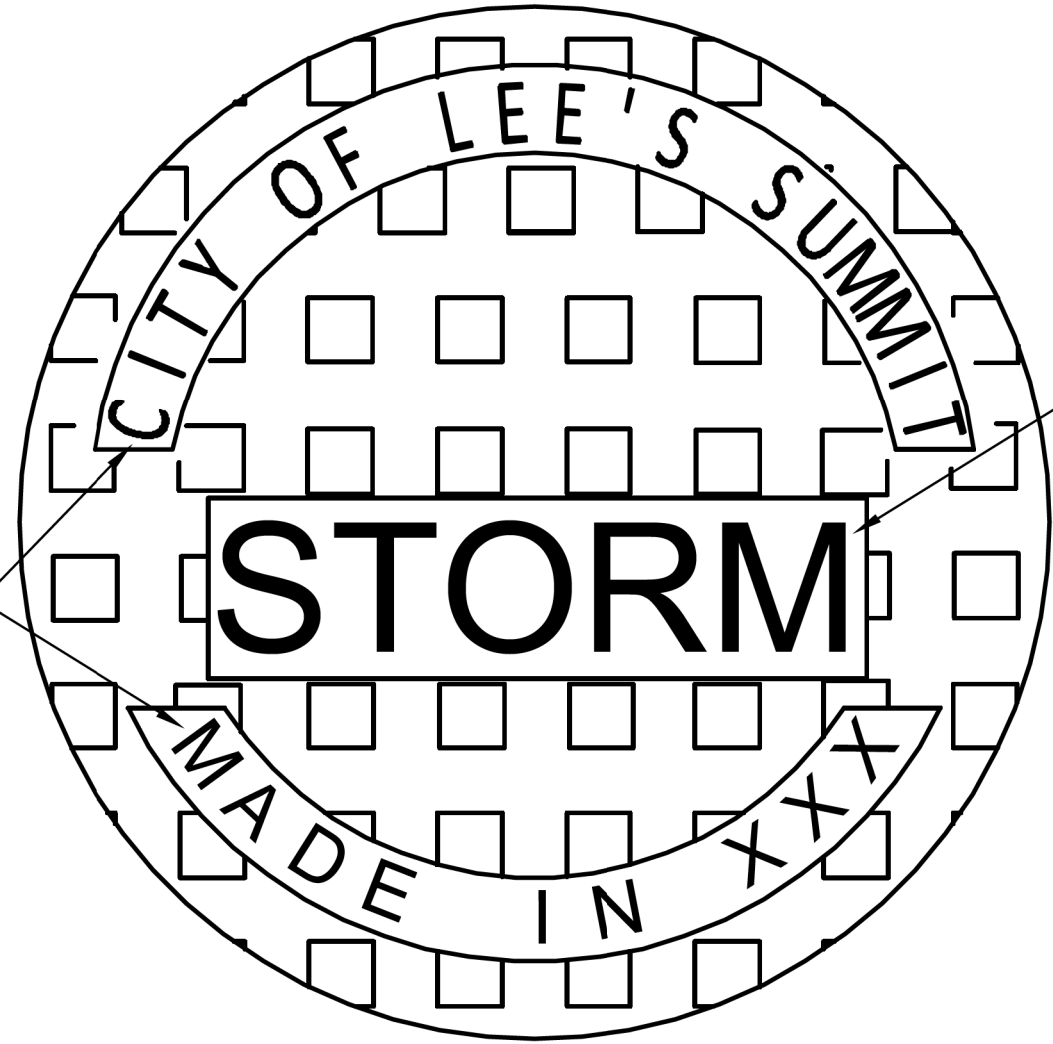


3" LETTERS
EQUALLY PLACED

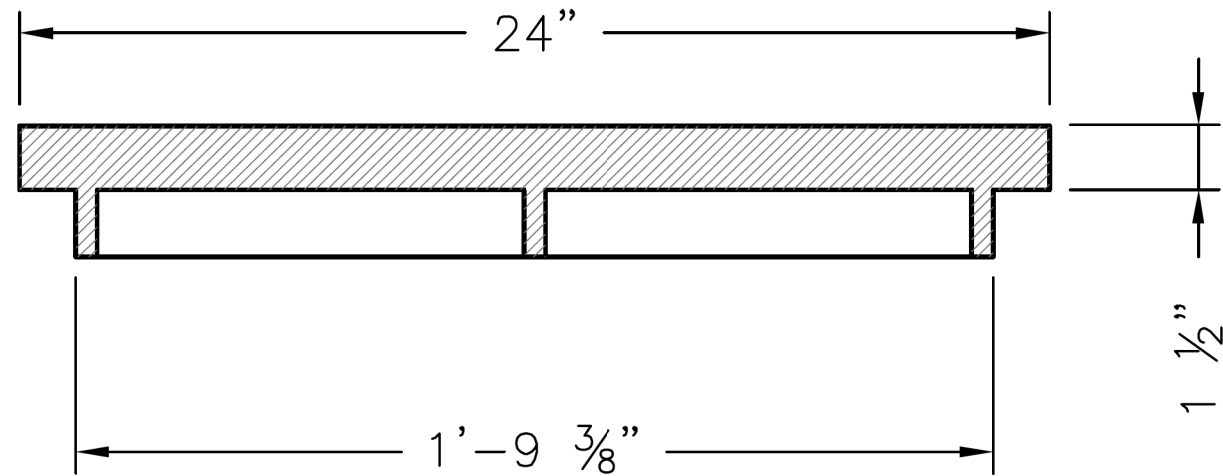

STANDARD 24" MANHOLE COVER
MINIMUM WEIGHT = 160 LB
NOTE: PICK HOLES NOT SHOWN

*COVER AND FRAME MODEL INFORMATION REFER TO
THE STORMWATER APPROVED PRODUCT LIST.

DATE	REVISION	NO.	BY	CHK/APP
9/3/19				
7/16/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
6/14/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
	PDP Submittal	1	RAM	RKS

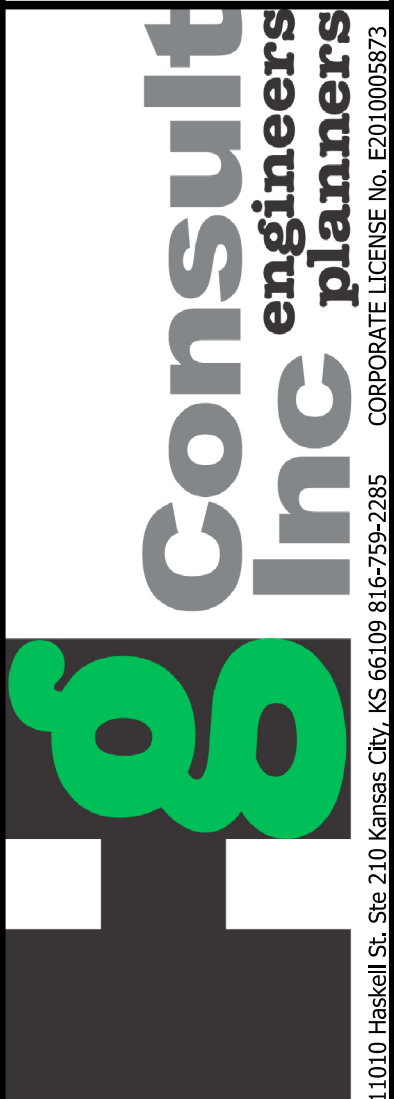


DETAIL SHEET	ARISTOCRAT MOTORS
LEE'S SUMMIT - JACKSON COUNTY - MISSOURI	


X-REF NO.	XXX
DRAWING NO.	XXX
DATE	September 2019
JOB NO.	19.006.01
SHEET	13
OF	14

REV.

9/3/2019
FDP-DetailSheet-07.dgn

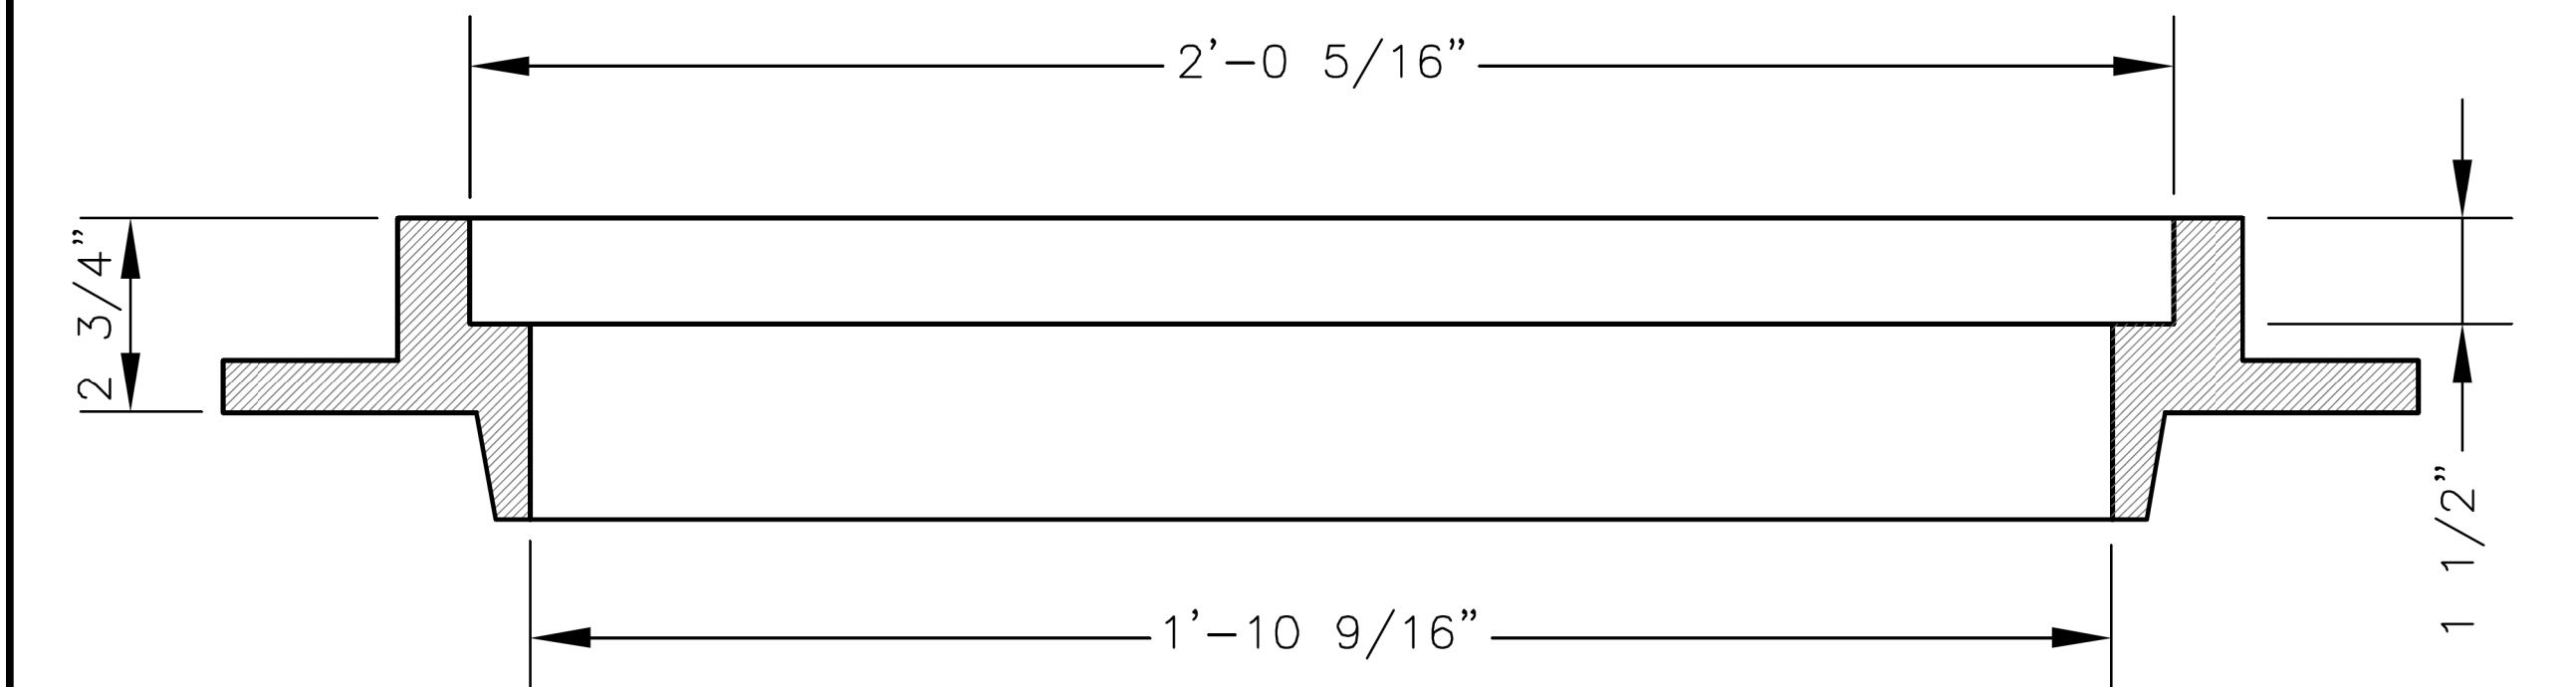

SLAB MANHOLE FRAME
LEE'S SUMMIT PART NO.: LS103A
MINIMUM WEIGHT = 145 LB

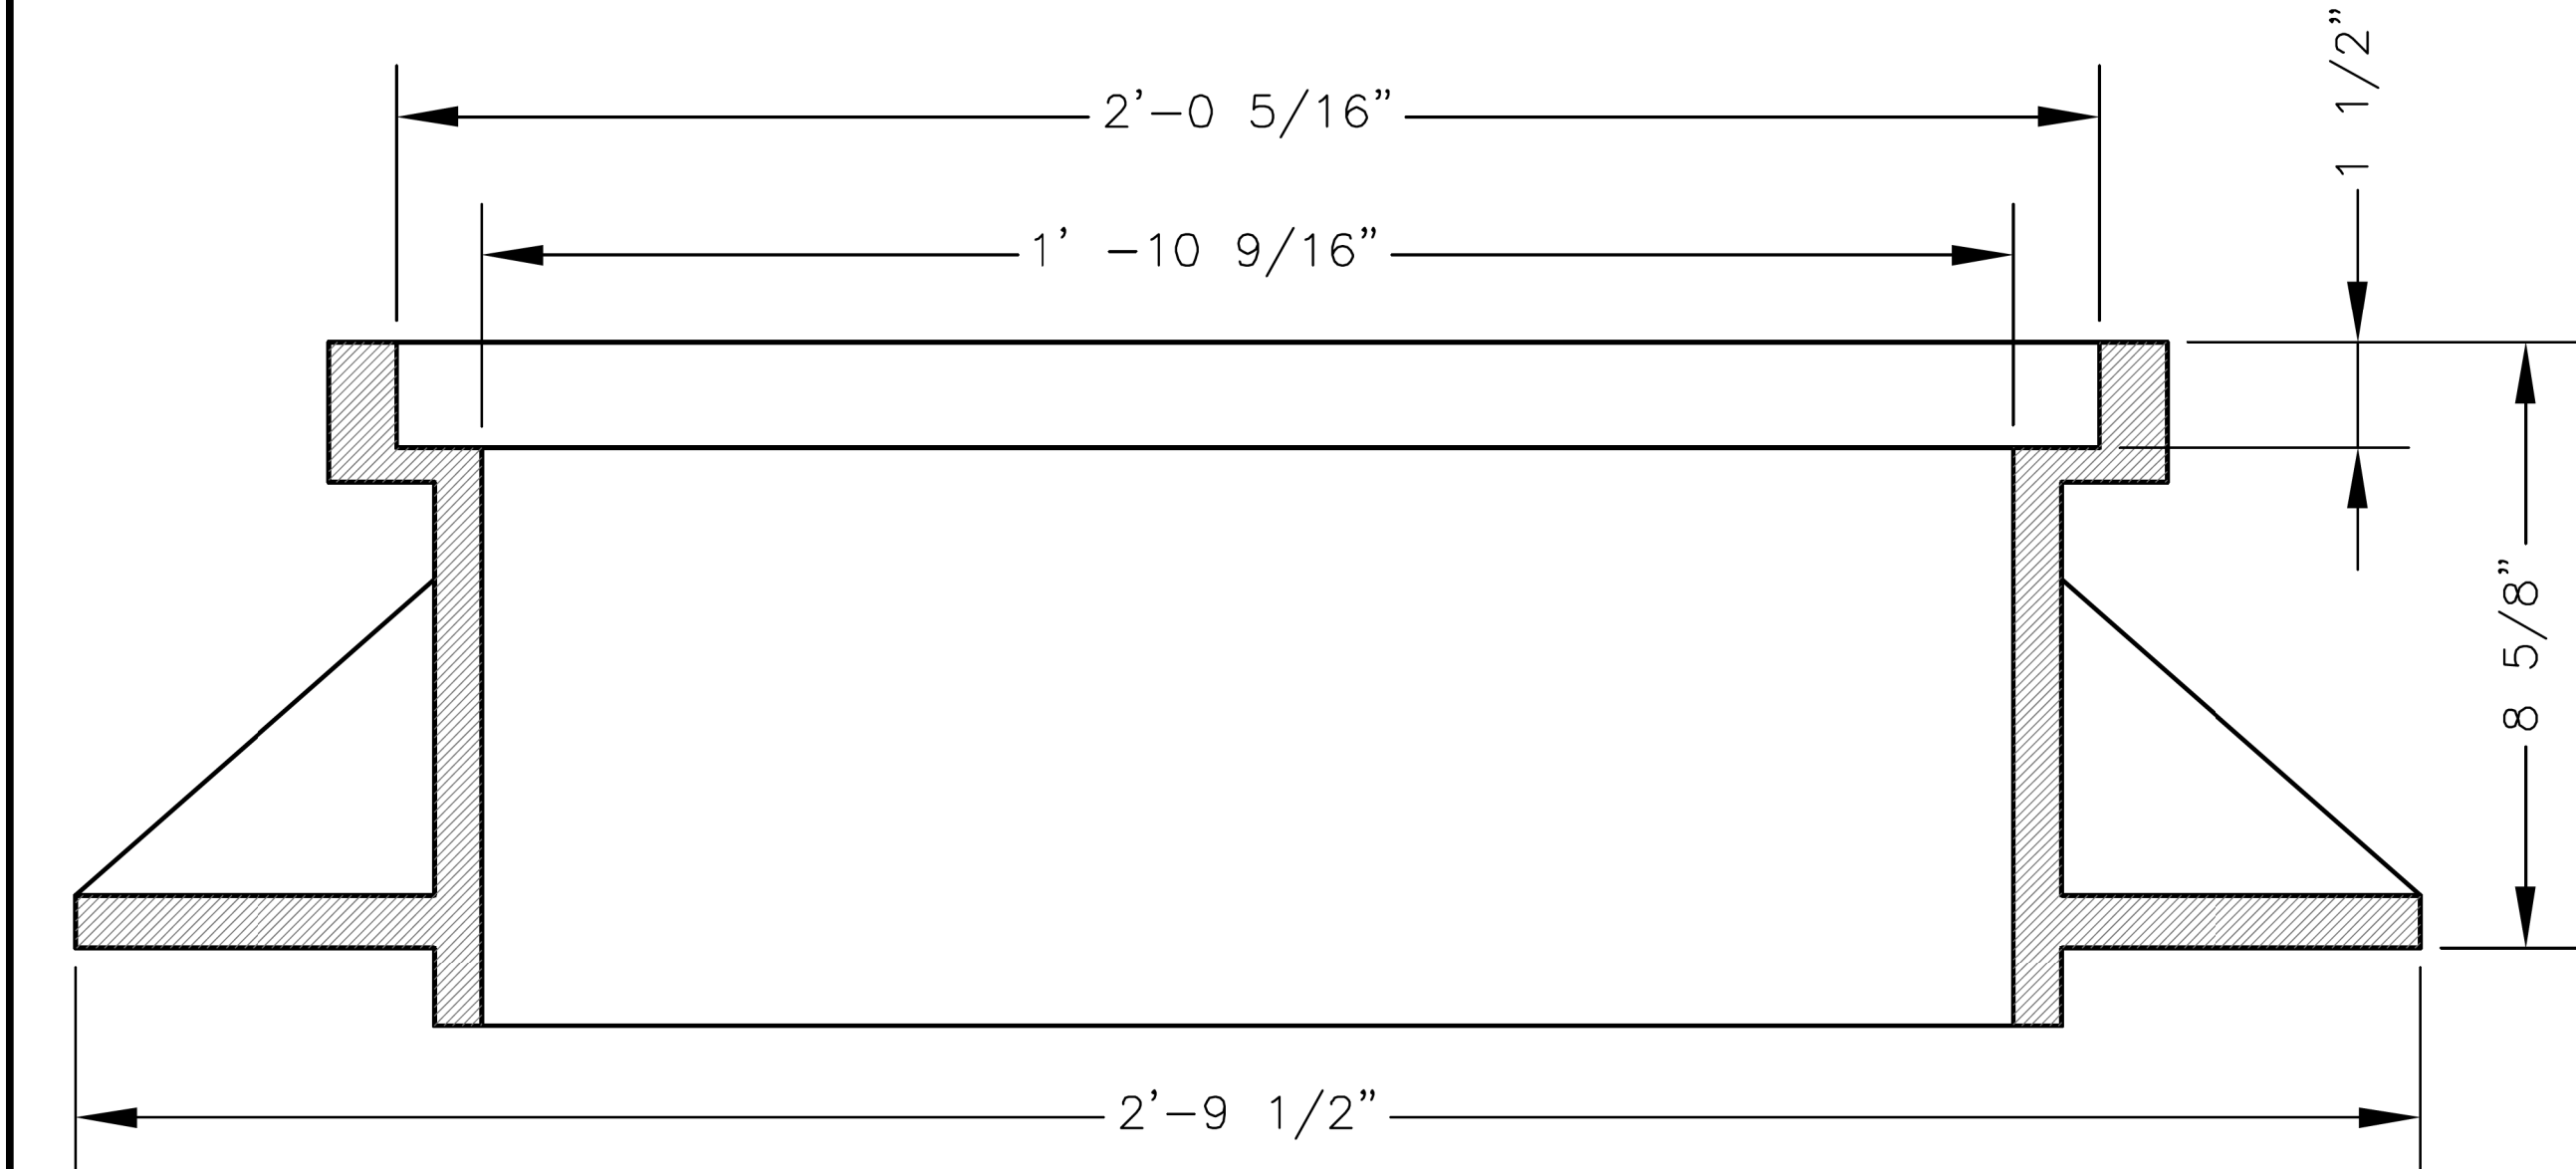

STANDARD 24" MANHOLE FRAME
LEE'S SUMMIT PART NO.: LS101A
MINIMUM WEIGHT = 250 LB

*COVER AND FRAME MODEL INFORMATION REFER TO
THE STORMWATER APPROVED PRODUCTS LIST.

LS

LEE'S SUMMIT

MISSOURI


PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64063

Date: 04/17


Drawn By: MJF

Checked By: DL

STM-7

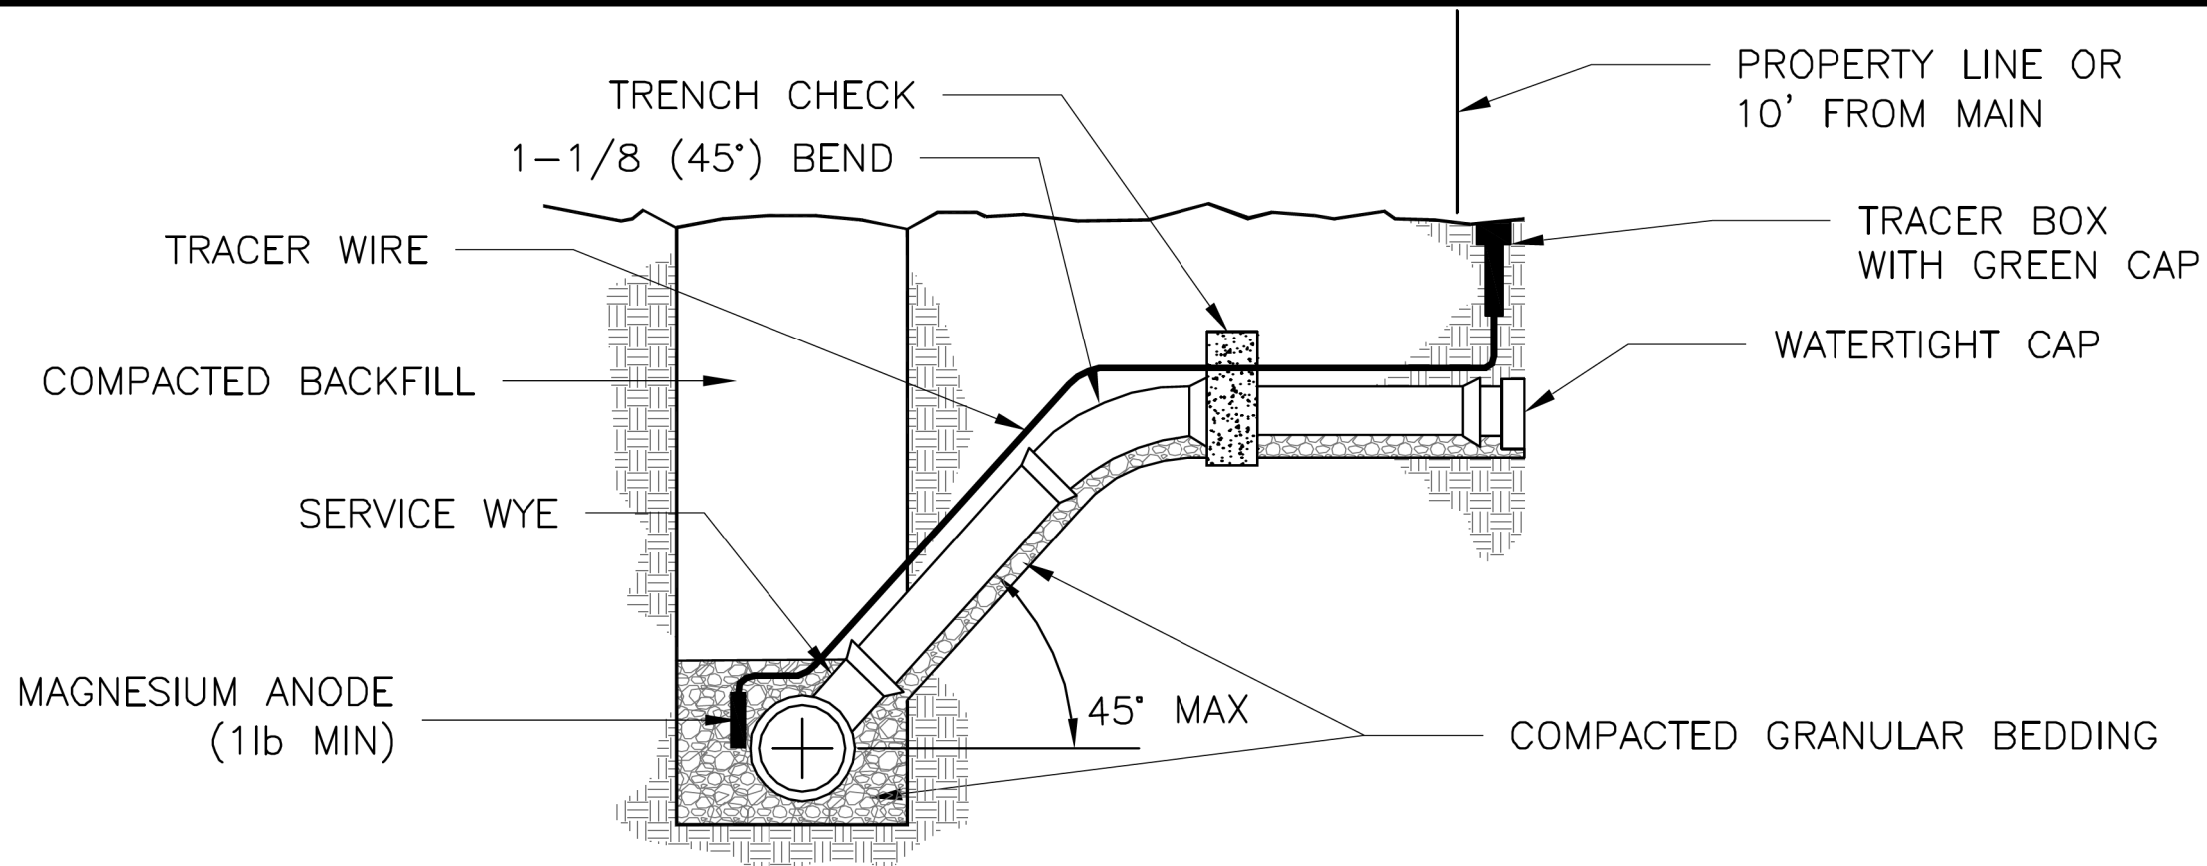

STANDARD INSTALLATION
NOT TO SCALE

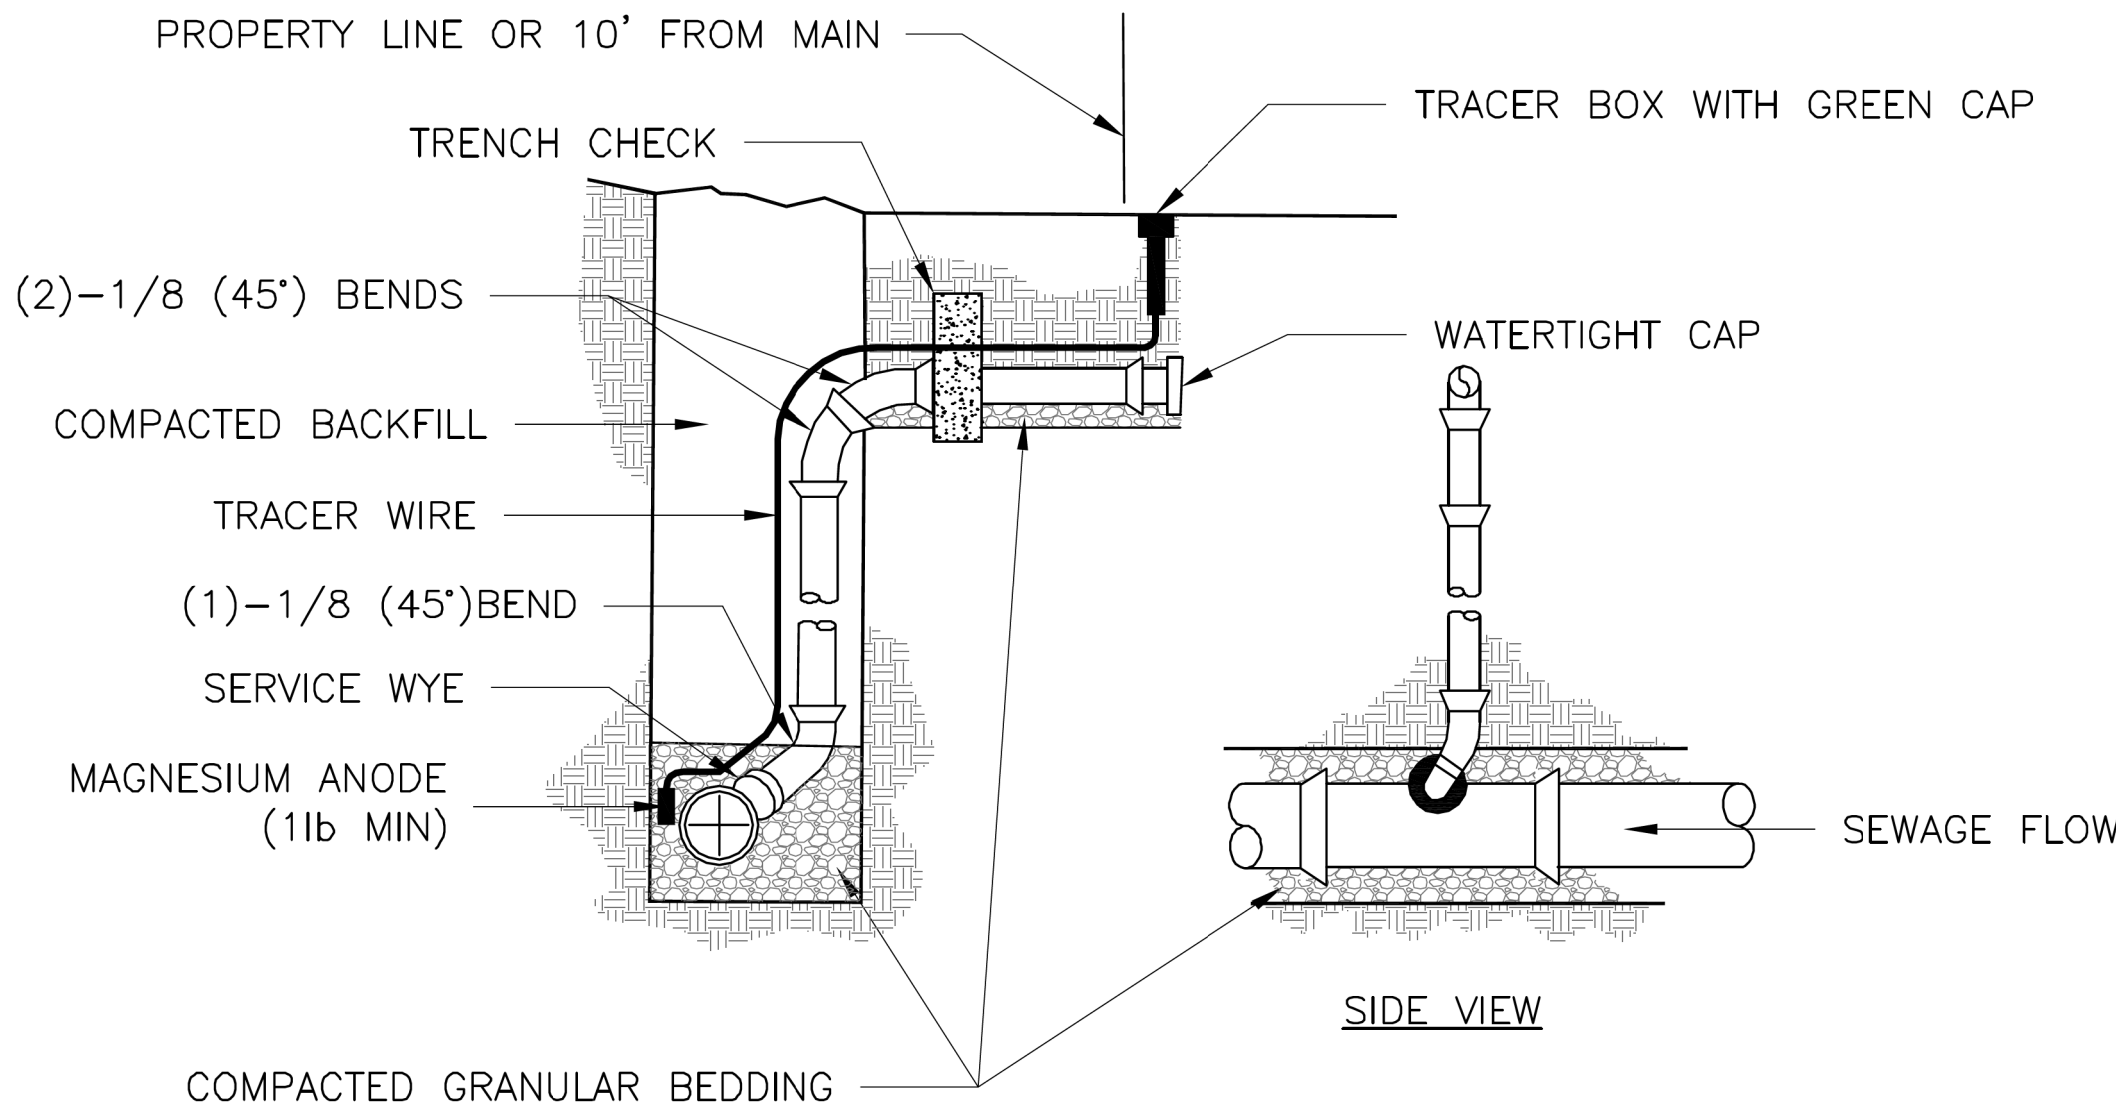

VERTICAL RISER
NOT TO SCALE

NOTES:

1. ALL SEWER STUBS SHALL BE CONSTRUCTED TO PROPERTY LINE OR 10' MINIMUM FROM THE MAIN. WHERE SIDEWALKS ARE PRESENT, CONTRACTOR SHALL EXTEND SERVICE LINE UNDER EXISTING SIDEWALK TO TWO FEET BEYOND.
2. ALL NEW CONSTRUCTION OFF SEWER STUBS SHALL BE TEMPORARILY MARKED WITH A MARKING STAKE, 36" ABOVE GROUND AND PAINTED GREEN.
3. IMPERVIOUS TRENCH CHECKS SHALL BE PLACED ON BUILDING SEWER STUBS (AT LEAST 5' AWAY FROM THE SANITARY SEWER MAIN).
4. TRENCH CHECKS ON THE BUILDING SEWER STUBS SHALL EXTEND 6" BELOW THE BOTTOM OF THE PIPE. LENGTH SHALL BE A MINIMUM OF 12". THE HEIGHT OF THE TRENCH CHECK SHALL EXTEND 12" ABOVE THE TOP OF THE PIPE. THE WIDTH OF THE TRENCH CHECK SHALL BE THE WIDTH OF THE TRENCH.
5. SEE SPECIFICATION SECTION 2100 FOR SEWER MAIN BEDDING AND BACKFILL.
6. #12 GAUGE GREEN INSULATED COPPER TRACER WIRE SHALL BE INSTALLED. TRACER WIRE TERMINAL BOXES SHALL BE INSTALLED DIRECTLY ABOVE THE SEWER SERVICE OR AS DETERMINED BY THE ENGINEER.
7. FOR SERVICES, TRACER WIRE SHALL RUN FROM THE WYE AND TERMINATE IN A FLUSH MOUNTED TRACER BOX WITH A GREEN CAST IRON LOCKABLE TOP. WIRE SHALL BE TAPED OR TIED TO THE PIPE AT 5' INTERVALS.
8. TRACER WIRE BOX SHALL BE INSTALLED WITHIN 1.0' OF PROPERTY LINE.
9. THE TRACER WIRE SHALL REMAIN CONTINUOUS TO THE GREATEST EXTENT POSSIBLE. SPLICES IN THE TRACER WIRE SHOULD BE MADE WITH SPLIT BOLT CONNECTORS. WIRE NUTS SHALL NOT BE USED. A WATER-PROOF CONNECTION IS NECESSARY TO PREVENT CORROSION.

LS

LEE'S SUMMIT

MISSOURI

PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64063

Date: 04/17

Drawn By: MJF

Checked By: DL

SAN-1

DATE	REVISION	NO.	BY	CHK/APP
9/3/19	Addressed bid questions in regards to ME-201	3	RAM	RKS
7/16/19	Addressed City Comment Letter dated 6/28/19	2	RAM	RKS
6/14/19	PDP Submittal	1	RAM	RKS



consult
Inc
engineers
planners

11010 Haskell St, Ste 210 Kansas City, KS 66109 816-799-2285

CORPORATE LICENSE NO. E2010005873

DETAIL SHEET

ARISTOCRAT MOTORS

LEE'S SUMMIT - JACKSON COUNTY - MISSOURI

X-REF NO.	XXX
DRAWING NO.	XXX
DATE	September 2019
JOB NO.	19.006.01
SHEET OF	14





REV.

New Construction
Soave Automotive Group
Lee's Summit, MO

Final Development Plan
09/04/2019

A1



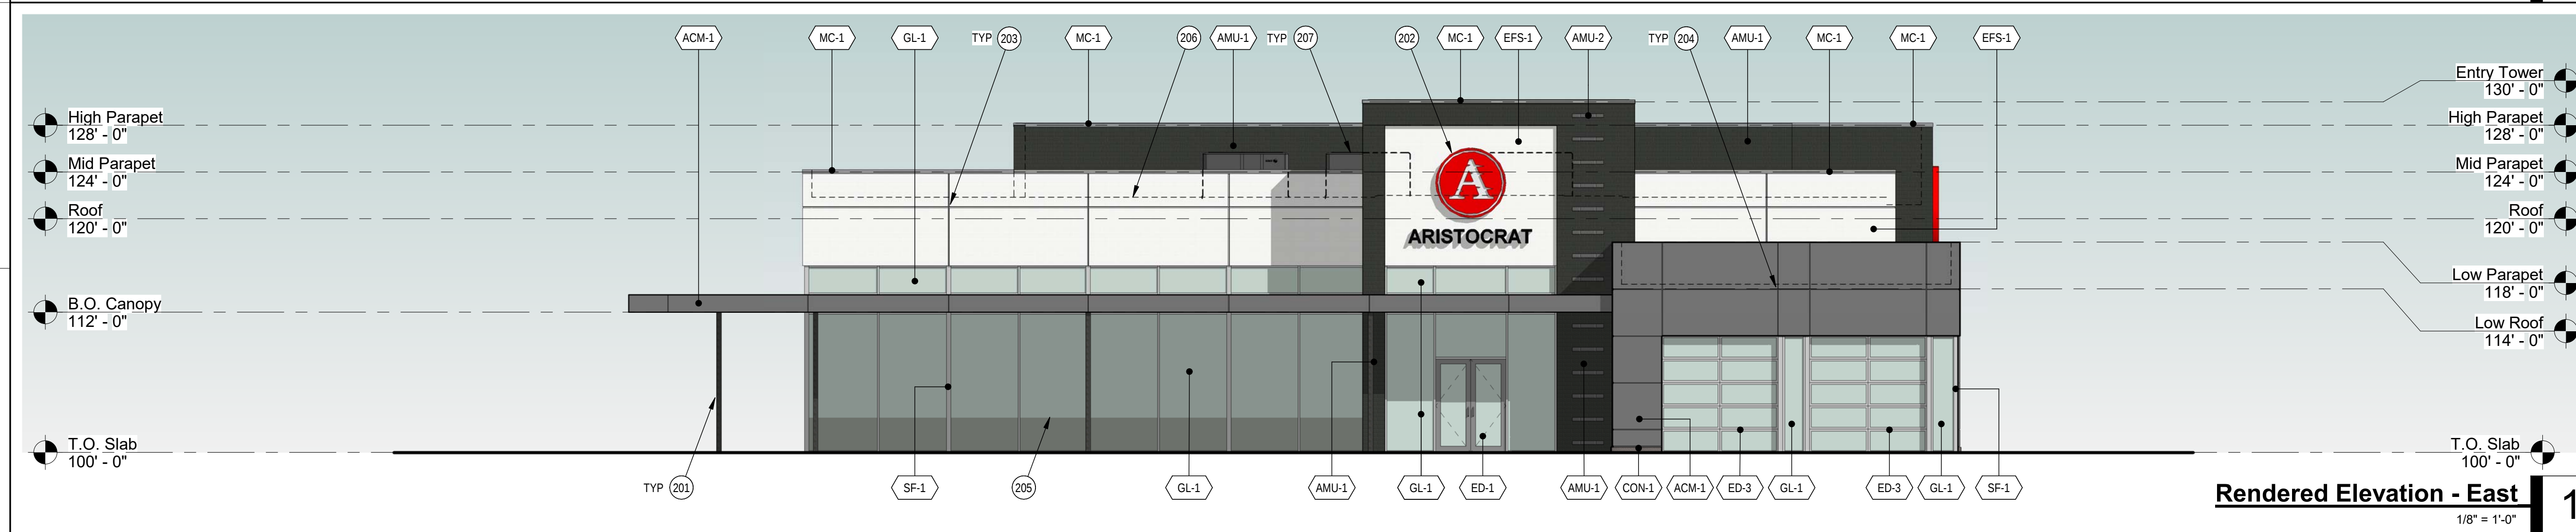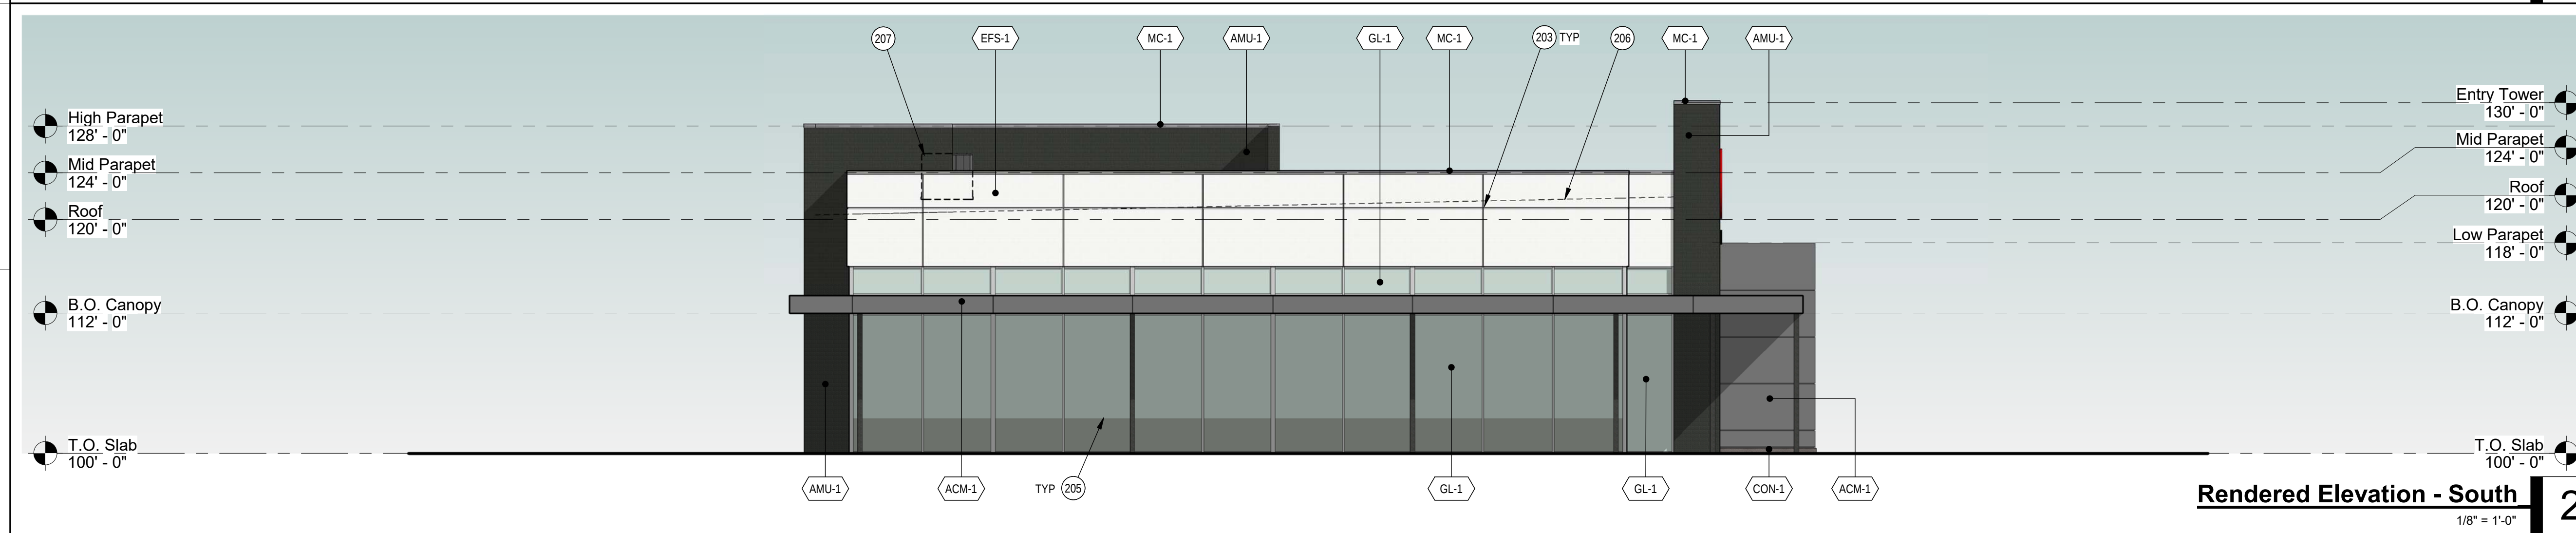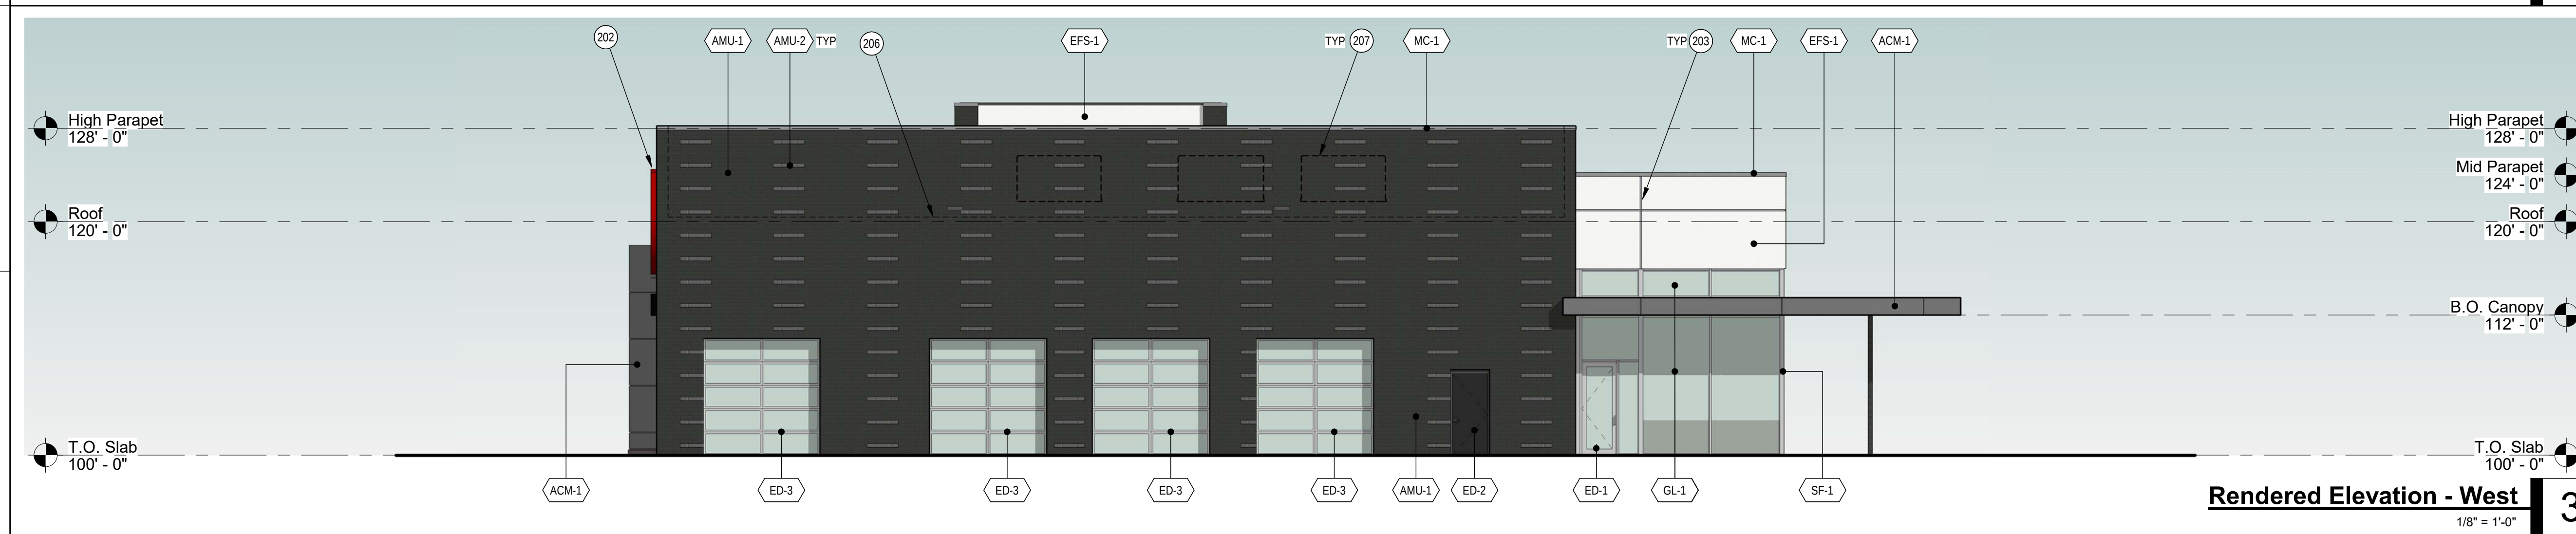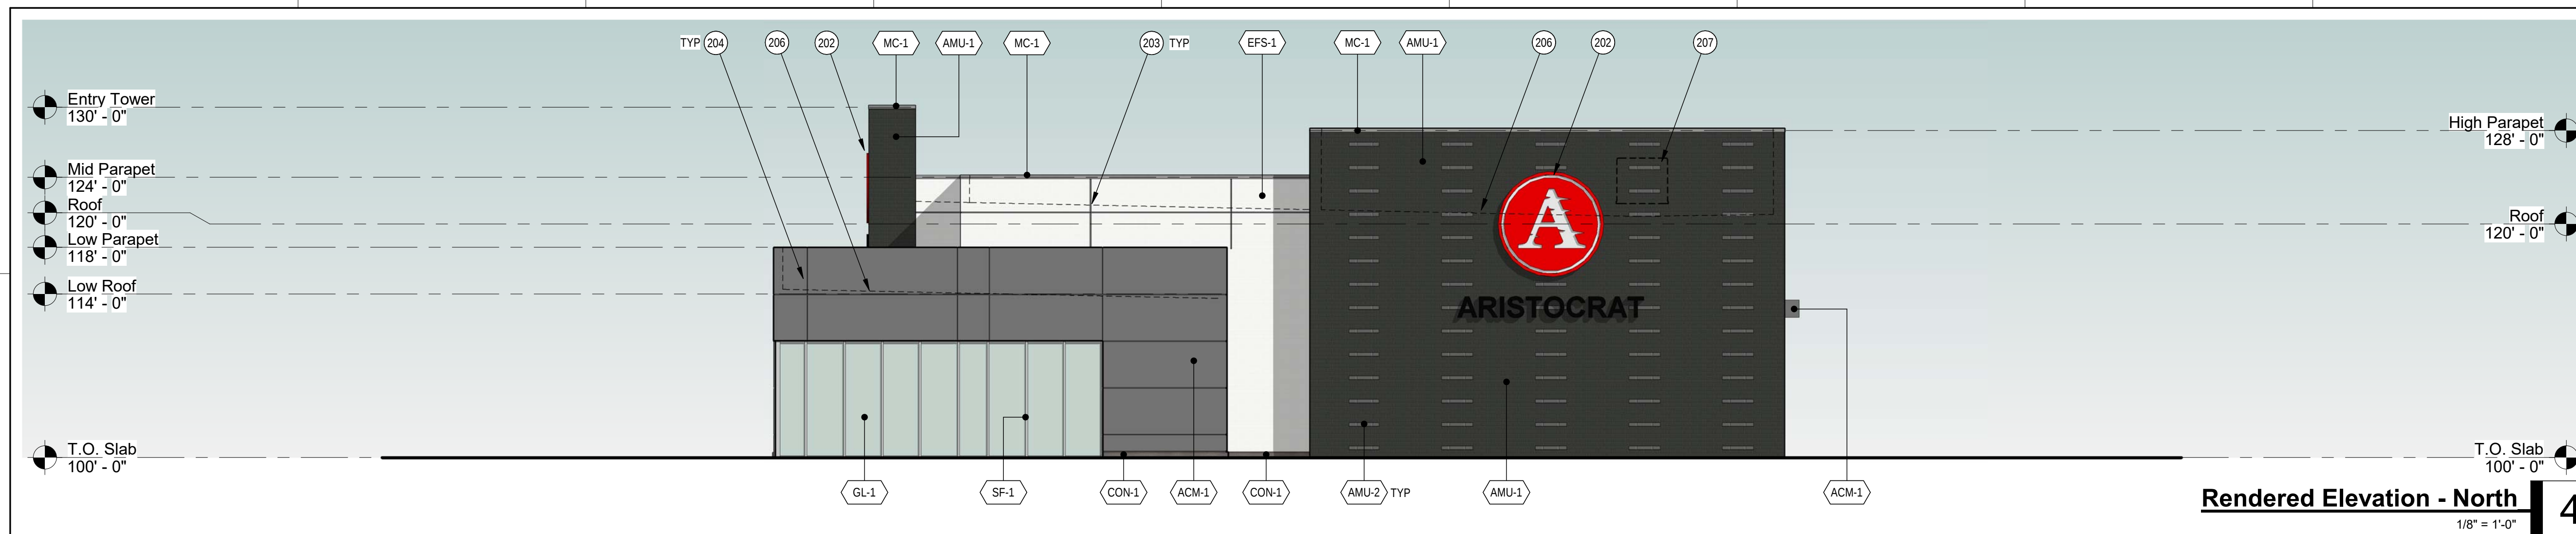


MATERIALS

ACM-1	ALUMINUM WALL PANEL MANUFACTURER: ALPOIC COLOR/FINISH: MICA M5 GREY
AMU-1	ARCHITECTURAL MASONRY UNIT 4 X 16 RUNNING BOND MANUFACTURER: YORK BUILDING PRODUCTS COLOR/FINISH: GEMSTONE - MINK (GLOSSY)
AMU-2	ARCHITECTURAL MASONRY UNIT 4 X 16 RUNNING BOND MANUFACTURER: YORK BUILDING PRODUCTS COLOR/FINISH: GEMSTONE - MINK (MATTE)
CON-1	CAST IN PLACE CONCRETE WALL CURB COLOR/FINISH: TBD
ED-1	WIDES STYLE ALUMINUM STOREFRONT DOOR MANUFACTURER: KAWNEER COLOR/FINISH: (MATCH SF-1 AND GL-1)
ED-2	FLUSH HOLLOW CORE STEEL DOOR W/ HIGH PERFORMANCE COATING COLOR/FINISH: TBD
ED-3	OVERHEAD GLASS AND ALUMINUM FRAME SECTIONAL DOOR MANUFACTURER: TBD COLOR/FINISH: (MATCH SF-1 AND GL-1)
EFS-1	EXTERIOR INSULATED FINISH SYSTEM (EIFS) MANUFACTURER: TBD COLOR/FINISH: FINE TEXTURE - 612 MOULIGHT
GL-1	CLEAR INSULATED LOW-E GLAZING MANUFACTURER: AGC ENERGY SELECT 40
MC-1	PRE-FINISHED METAL COPING MANUFACTURER: BERTRIDGE MFG. COLOR/FINISH: LEAD COOTE
SF-1	ALUMINUM STOREFRONT SYSTEM MANUFACTURER: KAWNEER COLOR/FINISH: CLEAR ANODIZED

○ **KEYNOTES**

201	STRUCTURAL COLUMN WITH HIGH PERFORMANCE COATING COLOR/FINISH: TBD
202	WALL MOUNTED BUILDING SIGNAGE BY OWNER
203	EIFS 'V' GROOVE REVEAL
204	ACM JOINT / REVEAL
205	TRANSLUCENT FILM APPLIED TO LOWER PORTION OF GLAZING
206	LINE OF ROOF BEYOND PARAPET
207	ROOF TOP UNIT (RTU) BEYOND PARAPET

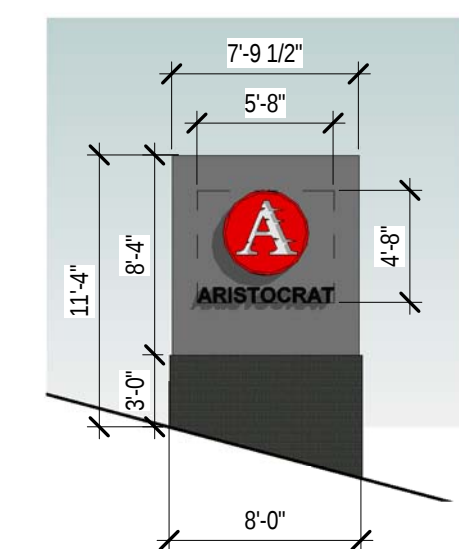

Monument Sign
1/8" = 1'-0"

SLAGGIE



ARCHITECTS

SLAGGIE ARCHITECTS, INC. © 2019
Kansas City, Missouri • Omaha, Nebraska
888-756-1958
slaggie.com

Aristocrat Pre-Owned Sales Building

New Construction

Soave Automotive Group

Lee's Summit, MO

#	Revisions:	
Project #:	180508	

Final Development Plan
09/04/2019

EXTERIOR ELEVATIONS

A2



SLAGGIE



ARCHITECTS

SLAGGIE ARCHITECTS, INC. © 2019
Kansas City, Missouri • Omaha, Nebraska
888-756-1958
slaggie.com

Aristocrat Pre-Owned Sales Building

New Construction

Soave Automotive Group

Lee's Summit, MO



Revisions:

Project #:

180508

Final Development Plan
09/04/2019

EXTERIOR EXHIBITS

A3


Aristocrat Pre-Owned Sales Building
New Construction
Soave Automotive Group
Lee's Summit, MO

Revisions:

Project #: 180508

Preliminary Development
Plan
06/14/2019
SITE PLAN -
PHOTOMETRIC

LP101

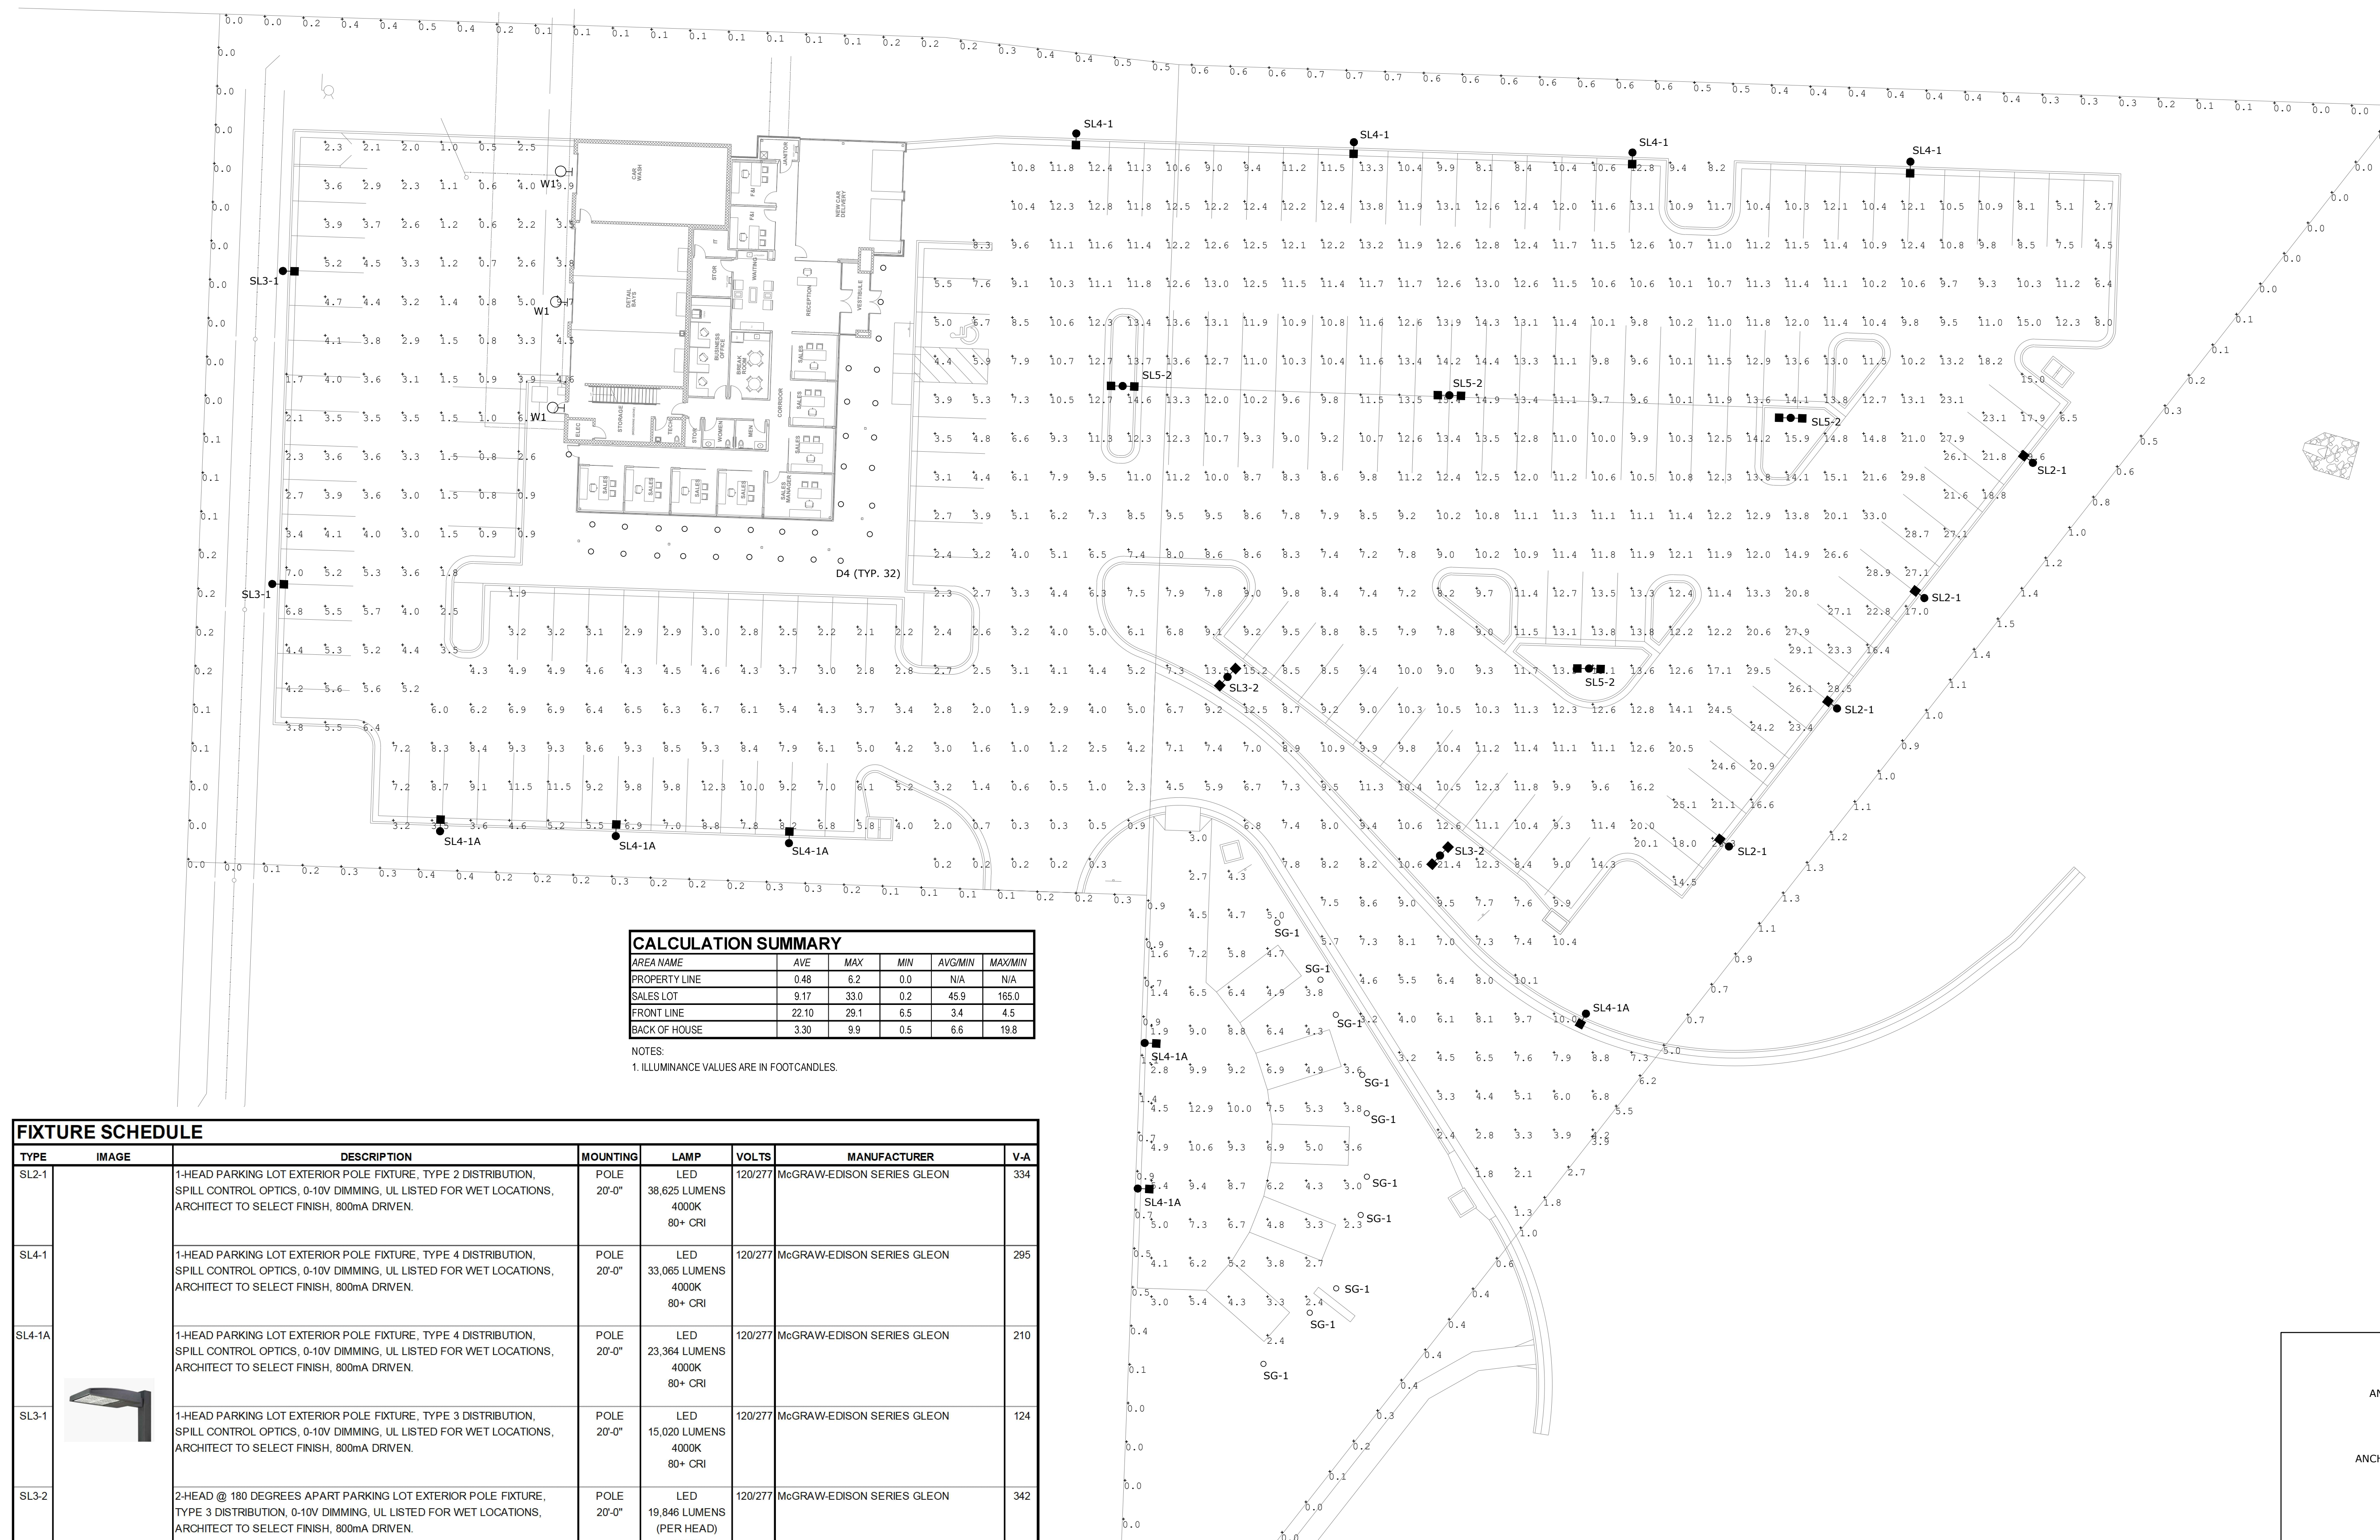

SITE PLAN - PHOTOMETRIC
SCALE: 1"=20'-0"

PROJECT INFORMATION	
ENGINEERED PRODUCT MANAGER:	GARRETT KLINGLER 816-401-7559 GARRETT.KLINGLER@ADS-PIPE.COM
ADS SALES REP:	JOHN WHITWOOD 816-805-5570 JOHN.WHITWOOD@ADS-PIPE.COM
PROJECT NO:	181081



KANSAS CITY MOTORS

LEE'S SUMMIT, MO

STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH MC-3500.
- CHAMBERS SHALL BE MADE FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORT PANELS THAT WOULD IMPEDE FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1) LONG-DURATION DEAD LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
- CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F2418-16, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- CHAMBERS SHALL BE DESIGNED AND ALLOWABLE LOADS DETERMINED IN ACCORDANCE WITH ASTM F2787, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER WILL BE ALLOWED. THE CHAMBER MANUFACTURER SHALL SUBMIT THE FOLLOWING UPON REQUEST TO THE SITE DESIGN ENGINEER FOR APPROVAL BEFORE DELIVERING CHAMBERS TO THE PROJECT SITE:
 - A STRUCTURAL EVALUATION SEALED BY A REGISTERED PROFESSIONAL ENGINEER THAT DEMONSTRATES THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.95 FOR DEAD LOAD AND 1.75 FOR LIVE LOAD, THE MINIMUM REQUIRED BY ASTM F2787 AND BY AASHTO FOR THERMOPLASTIC PIPE.
 - A STRUCTURAL EVALUATION SEALED BY A REGISTERED PROFESSIONAL ENGINEER THAT DEMONSTRATES THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET. THE 50 YEAR CREEP MODULUS DATA SPECIFIED IN ASTM F2418 MUST BE USED AS PART OF THE AASHTO STRUCTURAL EVALUATION TO VERIFY LONG-TERM PERFORMANCE.
 - STRUCTURAL CROSS SECTION DETAIL ON WHICH THE STRUCTURAL EVALUATION IS BASED.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.

IMPORTANT - NOTES FOR THE BIDDING AND INSTALLATION OF MC-3500 CHAMBER SYSTEM

- STORMTECH MC-3500 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE INSTALLERS.
- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR AN EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 BACKFILL METHODS:
 - STONESHOOTER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE BUILT USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM OUTSIDE THE EXCAVATION USING A LONG BOOM HOE OR EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEATED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM - 9" (230 mm) SPACING BETWEEN THE CHAMBER ROWS.
- INLET AND OUTLET MANIFOLDS MUST BE INSERTED A MINIMUM OF 12" (300 mm) INTO CHAMBER END CAPS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE 3/4-2" (20-50 mm) MEETING THE AASHTO M43 DESIGNATION OF #3 OR #4.
- STONE MUST BE PLACED ON THE TOP CENTER OF THE CHAMBER TO ANCHOR THE CHAMBERS IN PLACE AND PRESERVE ROW SPACING.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIALS BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "FLEXSTORM CATCH IT" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.

NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH MC-3500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- THE USE OF EQUIPMENT OVER MC-3500 CHAMBERS IS LIMITED:
 - NO EQUIPMENT IS ALLOWED ON BARE CHAMBERS.
 - NO RUBBER TIRED LOADER, DUMP TRUCK, OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
 - WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT CAN BE FOUND IN THE "STORMTECH MC-3500/MC-4500 CONSTRUCTION GUIDE".
- FULL 36" (900 mm) OF STABILIZED COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR DUMP TRUCK TRAVEL OR DUMPING.


USE OF A DOZER TO PUSH EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO CHAMBERS AND IS NOT AN ACCEPTABLE BACKFILL METHOD. ANY CHAMBERS DAMAGED BY USING THE "DUMP AND PUSH" METHOD ARE NOT COVERED UNDER THE STORMTECH STANDARD WARRANTY.

CONTACT STORMTECH AT 1-888-892-2694 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

PROPOSED LAYOUT: WEST	
76	STORMTECH MC-3500 CHAMBERS
8	STORMTECH MC-3500 END CAPS
12	STONE ABOVE (in)
9	STONE BELOW (in)
40	% STONE VOID
14,865	INSTALLED SYSTEM VOLUME (CF) (PERIMETER STONE INCLUDED)
4,445	SYSTEM AREA (ft²)
354	SYSTEM PERIMETER (ft)

MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):	1024.90
MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):	1019.40
MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):	1018.90
MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):	1018.90
MINIMUM ALLOWABLE GRADE (TOP OF RIGID PAVEMENT):	1018.90
TOP OF STONE:	1017.90
TOP OF MC-3500 CHAMBER:	1016.90
15" TOP MANIFOLD INVERT:	1015.10
24" ISOLATOR ROW INVERT:	1013.32
BOTTOM OF MC-3500 CHAMBER:	1013.15
UNDERDRAIN INVERT:	1012.40
BOTTOM OF STONE:	1012.40

- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH SHEET #7 FOR MANIFOLD SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.

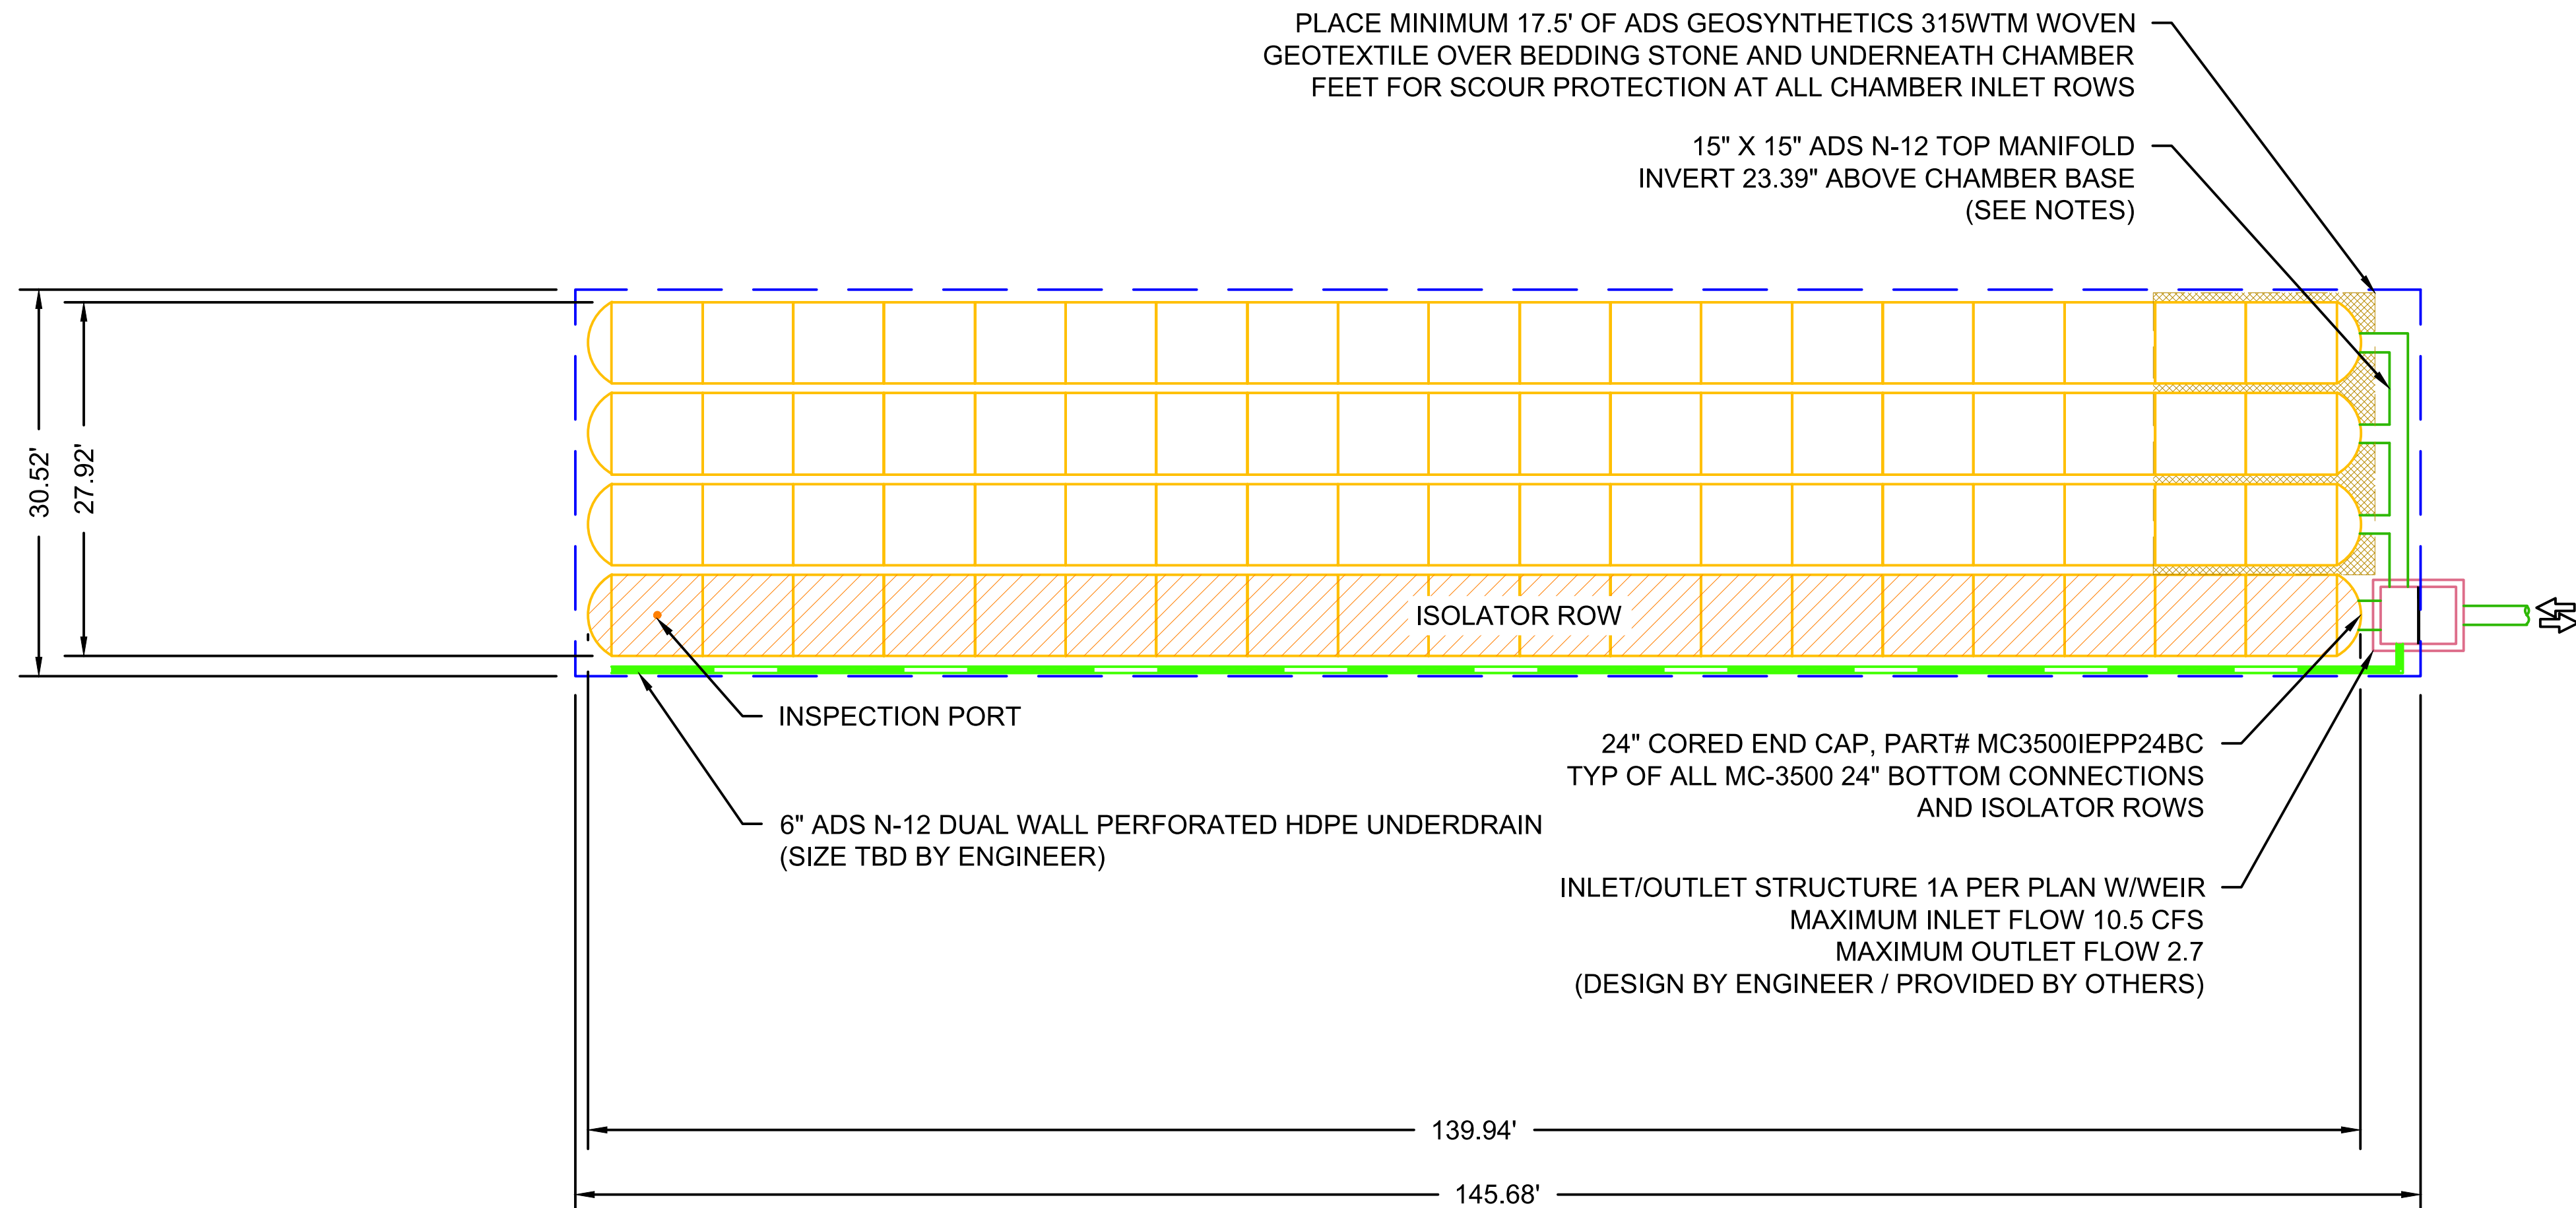

---	--

PROPOSED LAYOUT: EAST


85	STORMTECH MC-3500 CHAMBERS
10	STORMTECH MC-3500 END CAPS
12	STONE ABOVE (in)
9	STONE BELOW (in)
40	% STONE VOID
17,060	INSTALLED SYSTEM VOLUME (CF) (PERIMETER STONE INCLUDED)
5,165	SYSTEM AREA (ft²)
349	SYSTEM PERIMETER (ft)

PROPOSED ELEVATIONS: EAST

MAXIMUM ALLOWABLE GRADE (TOP OF PAVEMENT/UNPAVED):	1019.20
MINIMUM ALLOWABLE GRADE (UNPAVED WITH TRAFFIC):	1013.70
MINIMUM ALLOWABLE GRADE (UNPAVED NO TRAFFIC):	1013.20
MINIMUM ALLOWABLE GRADE (BASE OF FLEXIBLE PAVEMENT):	1013.20
MINIMUM ALLOWABLE GRADE (TOP OF RIGID PAVEMENT):	1013.20
TOP OF STONE:	1012.20
TOP OF MC-3500 CHAMBER:	1011.20
15" TOP MANIFOLD INVERT:	1009.40
24" ISOLATOR ROW INVERT:	1007.62
15" BOTTOM CONNECTION INVERT:	1007.58
15" BOTTOM MANIFOLD INVERT:	1007.58
BOTTOM OF MC-3500 CHAMBER:	1007.45
UNDERDRAIN INVERT:	1006.70
BOTTOM OF STONE:	1006.70

NOTES

- MANIFOLD SIZE TO BE DETERMINED BY SITE DESIGN ENGINEER. SEE TECH SHEET #7 FOR MANIFOLD SIZING GUIDANCE.
- DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND COUPLE ADDITIONAL PIPE TO STANDARD MANIFOLD COMPONENTS IN THE FIELD.
- THE SITE DESIGN ENGINEER MUST REVIEW ELEVATIONS AND IF NECESSARY ADJUST GRADING TO ENSURE THE CHAMBER COVER REQUIREMENTS ARE MET.

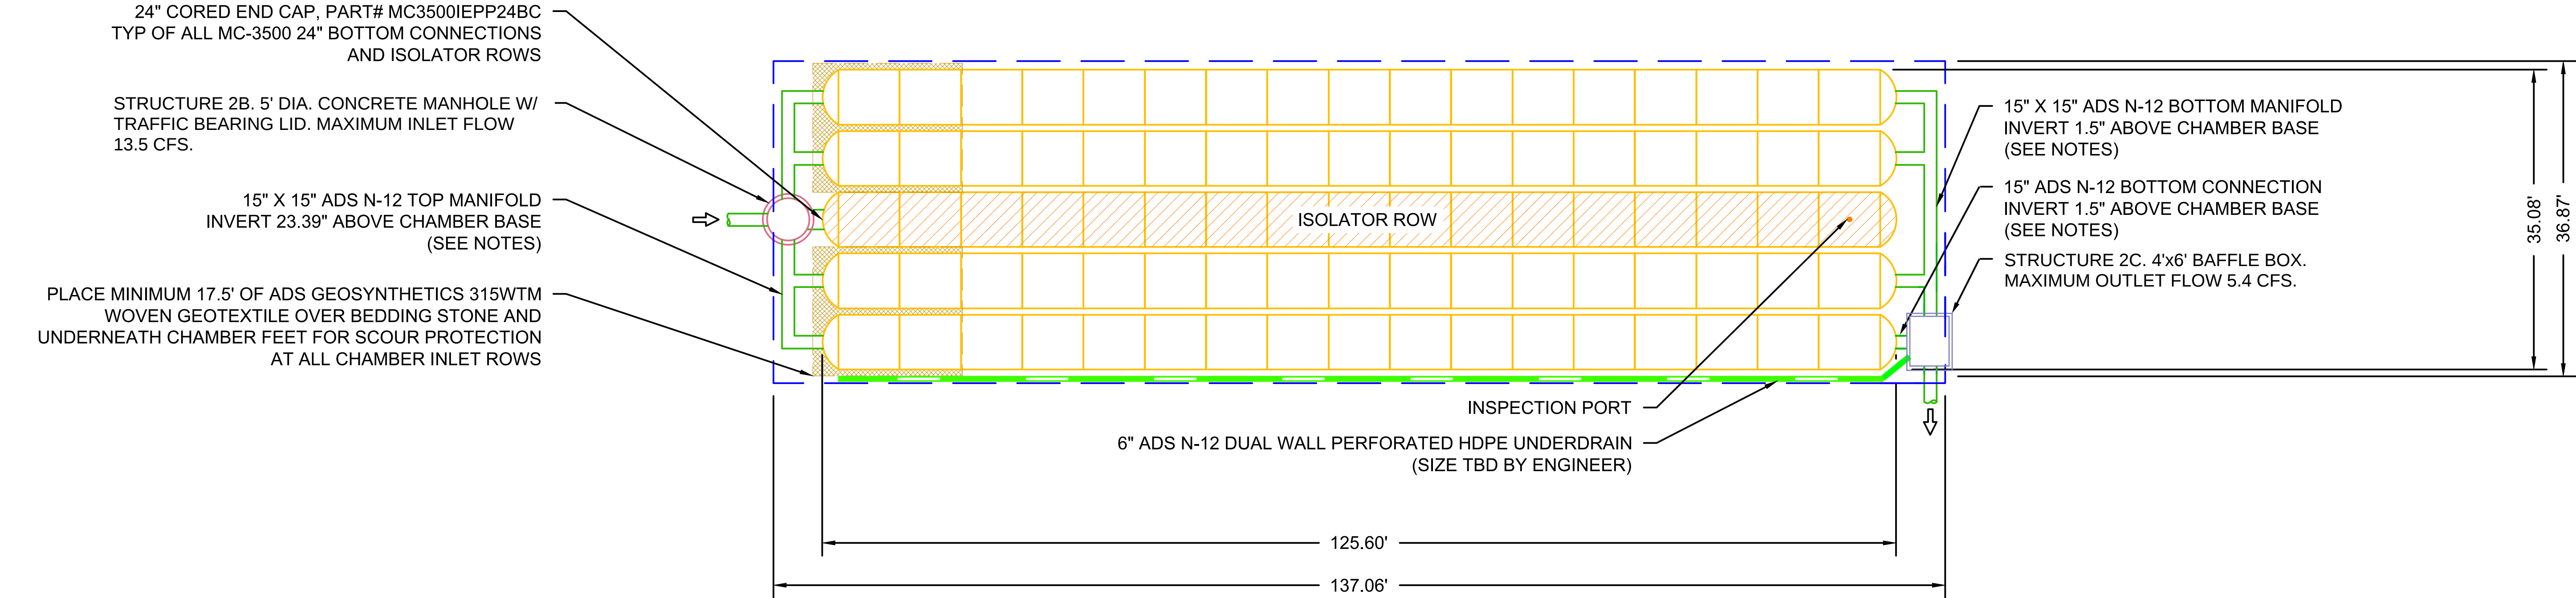

KANSAS CITY MOTORS

LEE'S SUMMIT, MO

DATE: 03-16-17

DRAWN: AMD

PROJECT #: 181081

CHECKED: GFI

DESCRIPTION

CKD

DWN

REV



StormTech®

Detention • Retention • Water Quality

70 INWOOD ROAD, SUITE 3 | ROCKY HILL, CT | 06067
860-528-8168 | 888-892-2694 | WWW.STORMTECH.COM

ADS

ADVANCED DRAINAGE SYSTEMS, INC.

4640 TRUEEMAN BLVD
HILLIARD, OH 43026

020'40'

020'40'

3

SHEET

OF

6


THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

MATERIAL LOCATION		DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL: FILL MATERIAL FOR LAYER 'D' STARTS FROM THE TOP OF THE 'C' LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE ABOVE. NOTE THAT PAVEMENT SUBBASE MAY BE PART OF THE 'D' LAYER	ANY SOIL/ROCK MATERIALS, NATIVE SOILS, OR PER ENGINEER'S PLANS. CHECK PLANS FOR PAVEMENT SUBGRADE REQUIREMENTS.	N/A	PREPARE PER SITE DESIGN ENGINEER'S PLANS. PAVED INSTALLATIONS MAY HAVE STRINGENT MATERIAL AND PREPARATION REQUIREMENTS.
C	INITIAL FILL: FILL MATERIAL FOR LAYER 'C' STARTS FROM THE TOP OF THE EMBEDMENT STONE ('B' LAYER) TO 24" (600 mm) ABOVE THE TOP OF THE CHAMBER. NOTE THAT PAVEMENT SUBBASE MAY BE A PART OF THE 'C' LAYER.	GRANULAR WELL-GRADED SOIL/AGGREGATE MIXTURES, <35% FINES OR PROCESSED AGGREGATE. MOST PAVEMENT SUBBASE MATERIALS CAN BE USED IN LIEU OF THIS LAYER.	AASHTO M145' A-1, A-2-4, A-3 OR AASHTO M43' 3, 357, 4, 467, 5, 56, 57, 6, 67, 68, 7, 78, 8, 89, 9, 10	BEGIN COMPACTIONS AFTER 24" (600 mm) OF MATERIAL OVER THE CHAMBERS IS REACHED. COMPACT ADDITIONAL LAYERS IN 12" (300 mm) MAX LIFTS TO A MIN. 95% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND 95% RELATIVE DENSITY FOR PROCESSED AGGREGATE MATERIALS.
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE ('A' LAYER) TO THE 'C' LAYER ABOVE.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43' 3, 4	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER.	CLEAN, CRUSHED, ANGULAR STONE	AASHTO M43' 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. ^{2 3}

PLEASE NOTE:


1. THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR. FOR EXAMPLE, A SPECIFICATION FOR #4 STONE WOULD STATE: "CLEAN, CRUSHED, ANGULAR NO. 4 (AASHTO M43) STONE".
2. STORMTECH COMPACTION REQUIREMENTS ARE MET FOR 'A' LOCATION MATERIALS WHEN PLACED AND COMPACTED IN 9" (230 mm) (MAX) LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR.
3. WHERE INFILTRATION SURFACES MAY BE COMPROMISED BY COMPACTION, FOR STANDARD DESIGN LOAD CONDITIONS, A FLAT SURFACE MAY BE ACHIEVED BY RAKING OR DRAGGING WITHOUT COMPACTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.

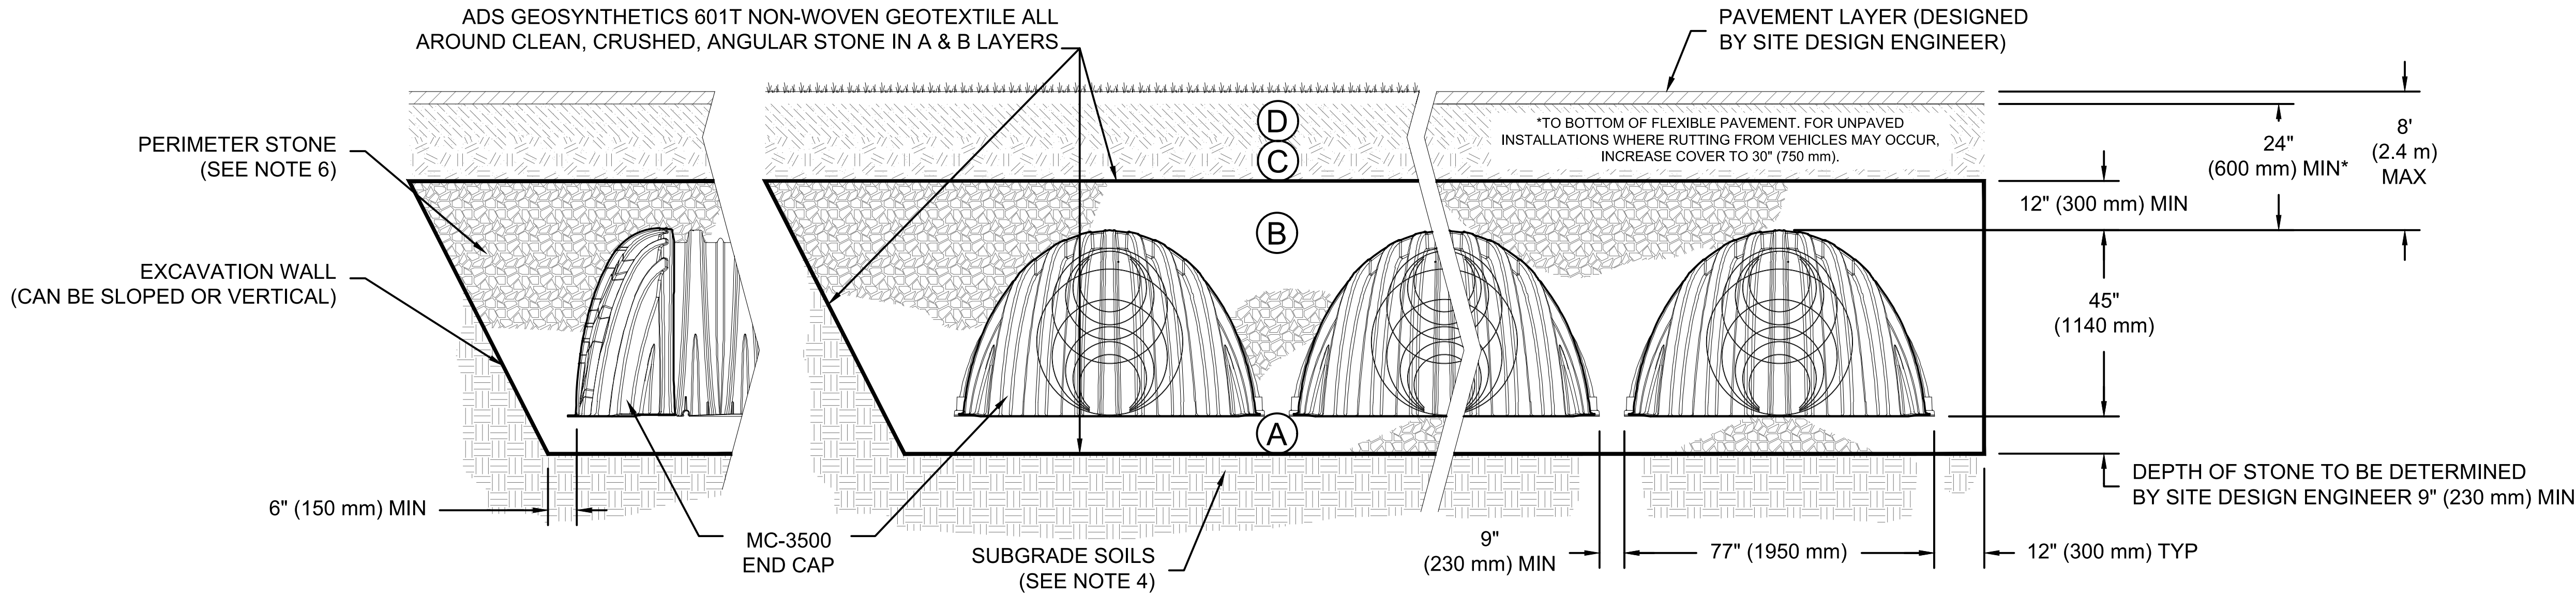

NOTES:

1. MC-3500 CHAMBERS SHALL CONFORM TO THE REQUIREMENTS OF ASTM F2418 "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
2. MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
3. "ACCEPTABLE FILL MATERIALS" TABLE ABOVE PROVIDES MATERIAL LOCATIONS, DESCRIPTIONS, GRADATIONS, AND COMPACTION REQUIREMENTS FOR FOUNDATION, EMBEDMENT, AND FILL MATERIALS.
4. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING RESISTANCE (ALLOWABLE BEARING CAPACITY) OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
5. ONCE LAYER 'C' IS PLACED, ANY SOIL/MATERIAL CAN BE PLACED IN LAYER 'D' UP TO THE FINISHED GRADE. MOST PAVEMENT SUBBASE SOILS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER 'C' OR 'D' AT THE SITE DESIGN ENGINEER'S DISCRETION.
6. PERIMETER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.

 ADVANCED DRAINAGE SYSTEMS, INC.	4640 TRUEMAN BLVD HILLIARD, OH 43026	 StormTech® Detention • Retention • Water Quality 70 INWOOD ROAD, SUITE 3 ROCKY HILL CT 06067 860-529-8188 888-892-2694 WWW.STORMTECH.COM				REV	DWN	CKD	DESCRIPTION	KANSAS CITY MOTORS	
										LEE'S SUMMIT, MO	
		DATE:		03-16-17		DRAWN: AMD					
		PROJECT #:		181081		CHECKED: GFI					
THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DETICED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.											

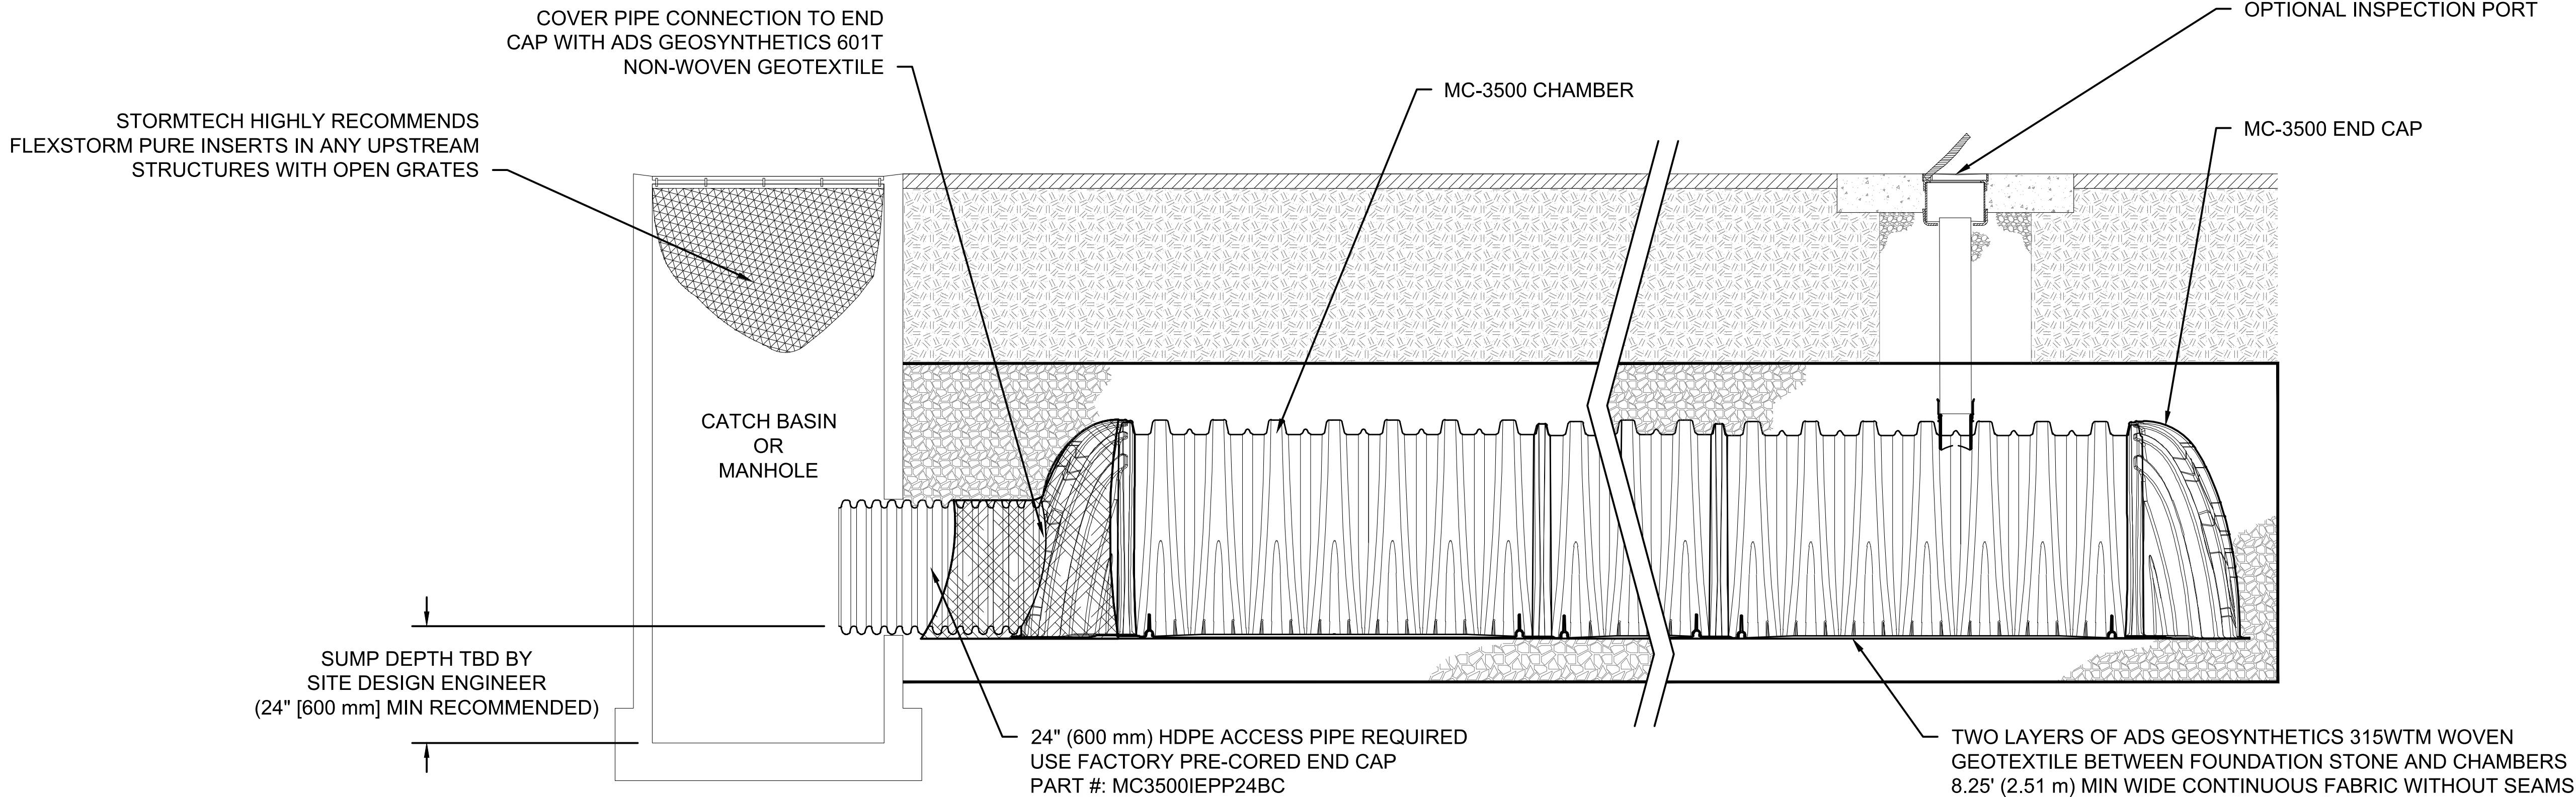


MC-3500 ISOLATOR ROW DETAIL
NTS

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW FOR SEDIMENT
- A. INSPECTION PORTS (IF PRESENT)
- A.1. REMOVE/OPEN LID ON NYLOPLAST INLINE DRAIN
 - A.2. REMOVE AND CLEAN FLEXSTORM FILTER IF INSTALLED
 - A.3. USING A FLASHLIGHT AND STADIA ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG
 - A.4. LOWER A CAMERA INTO ISOLATOR ROW FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL)
 - A.5. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- B. ALL ISOLATOR ROWS
- B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW
 - B.2. USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW THROUGH OUTLET PIPE
 - i) MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
 - ii) FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
 - B.3. IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW USING THE JETVAC PROCESS
- A. A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
 - B. APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
 - C. VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.

NOTES


1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
2. CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

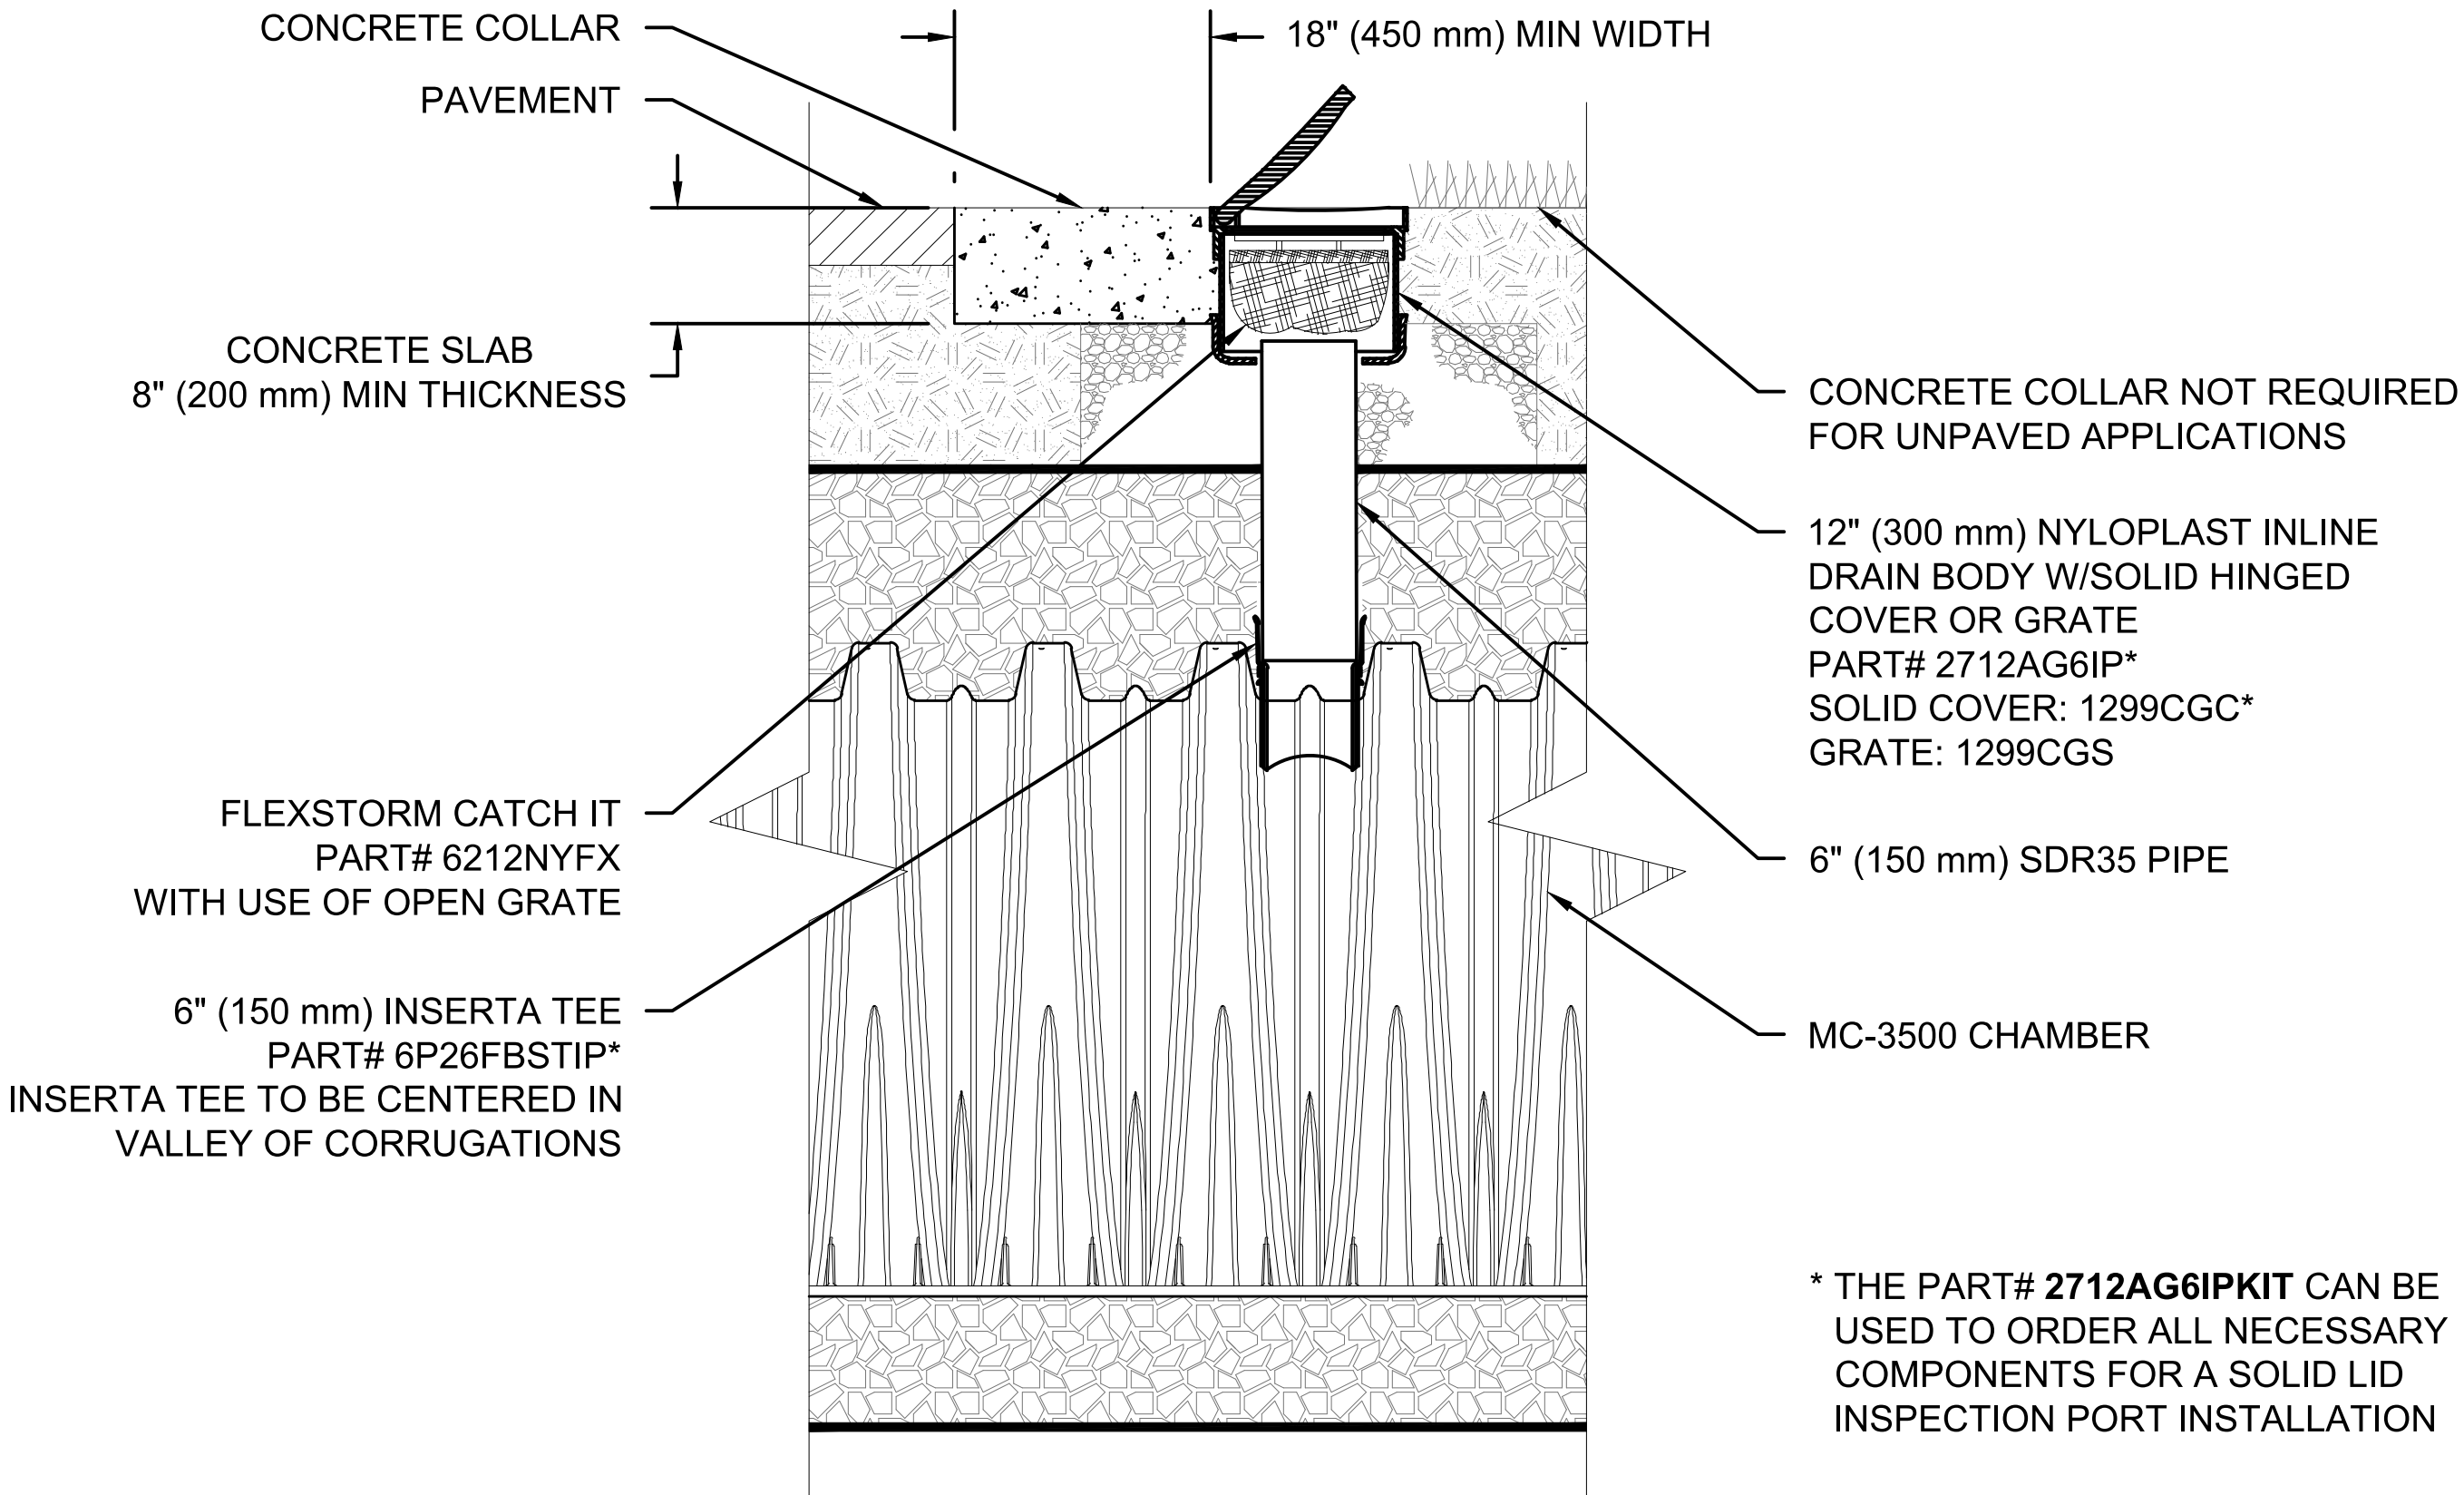

MC-3500 6" INSPECTION PORT DETAIL
NTS


 DESIGN • RETENTION • WATER QUALITY 70 INWOOD ROAD, SUITE 3 ROCKY HILL CT 06067 860-528-8188 888-892-2694 WWW.STORMTECH.COM	KANSAS CITY MOTORS	
	LEE'S SUMMIT, MO	
	DATE: 03-16-17	DRAWN: AMD
	PROJECT #: 181081	CHECKED: GFI
4640 TRUEJMAN BLVD HILLIARD, OH 43026  ADVANCED DRAINAGE SYSTEMS, INC.	DESCRIPTION	
	REV	DWN CKD
THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.		
5	SHEET OF	6

MC-SERIES END CAP INSERTION DETAIL

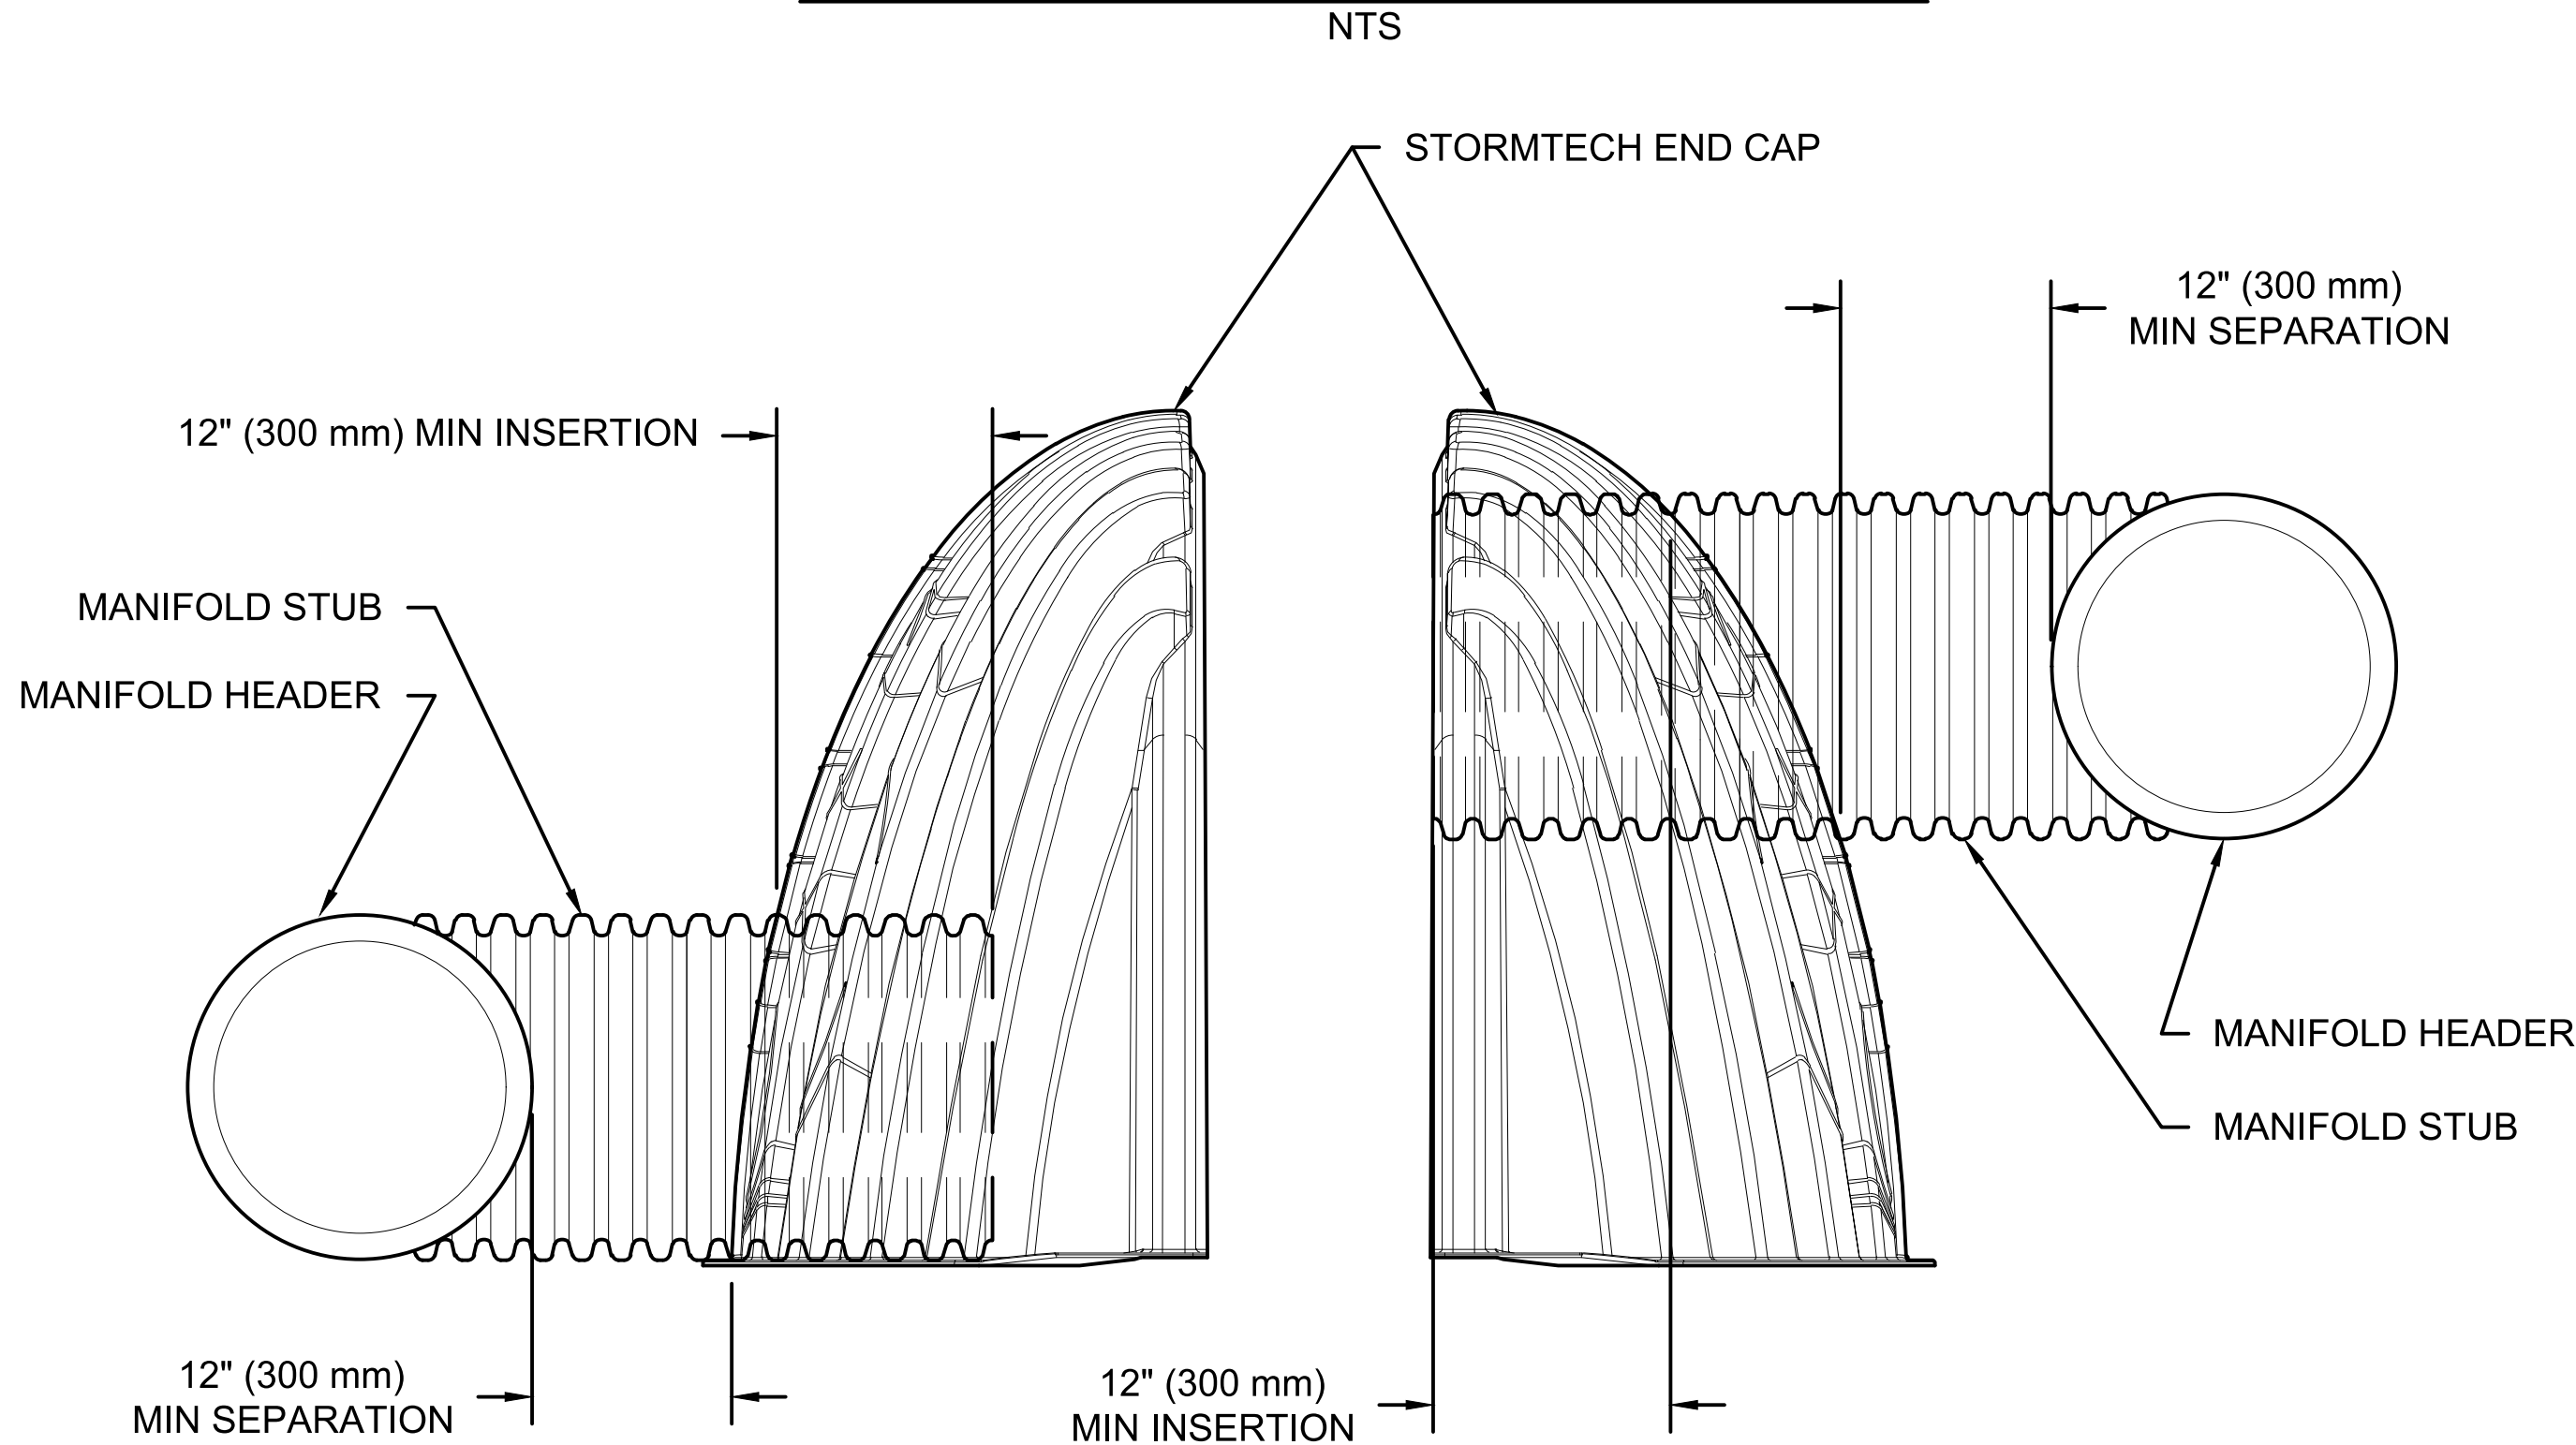


NOTE: MANIFOLD STUB MUST BE LAID HORIZONTAL FOR A PROPER FIT IN END CAP OPENING.

UNDERDRAIN DETAIL

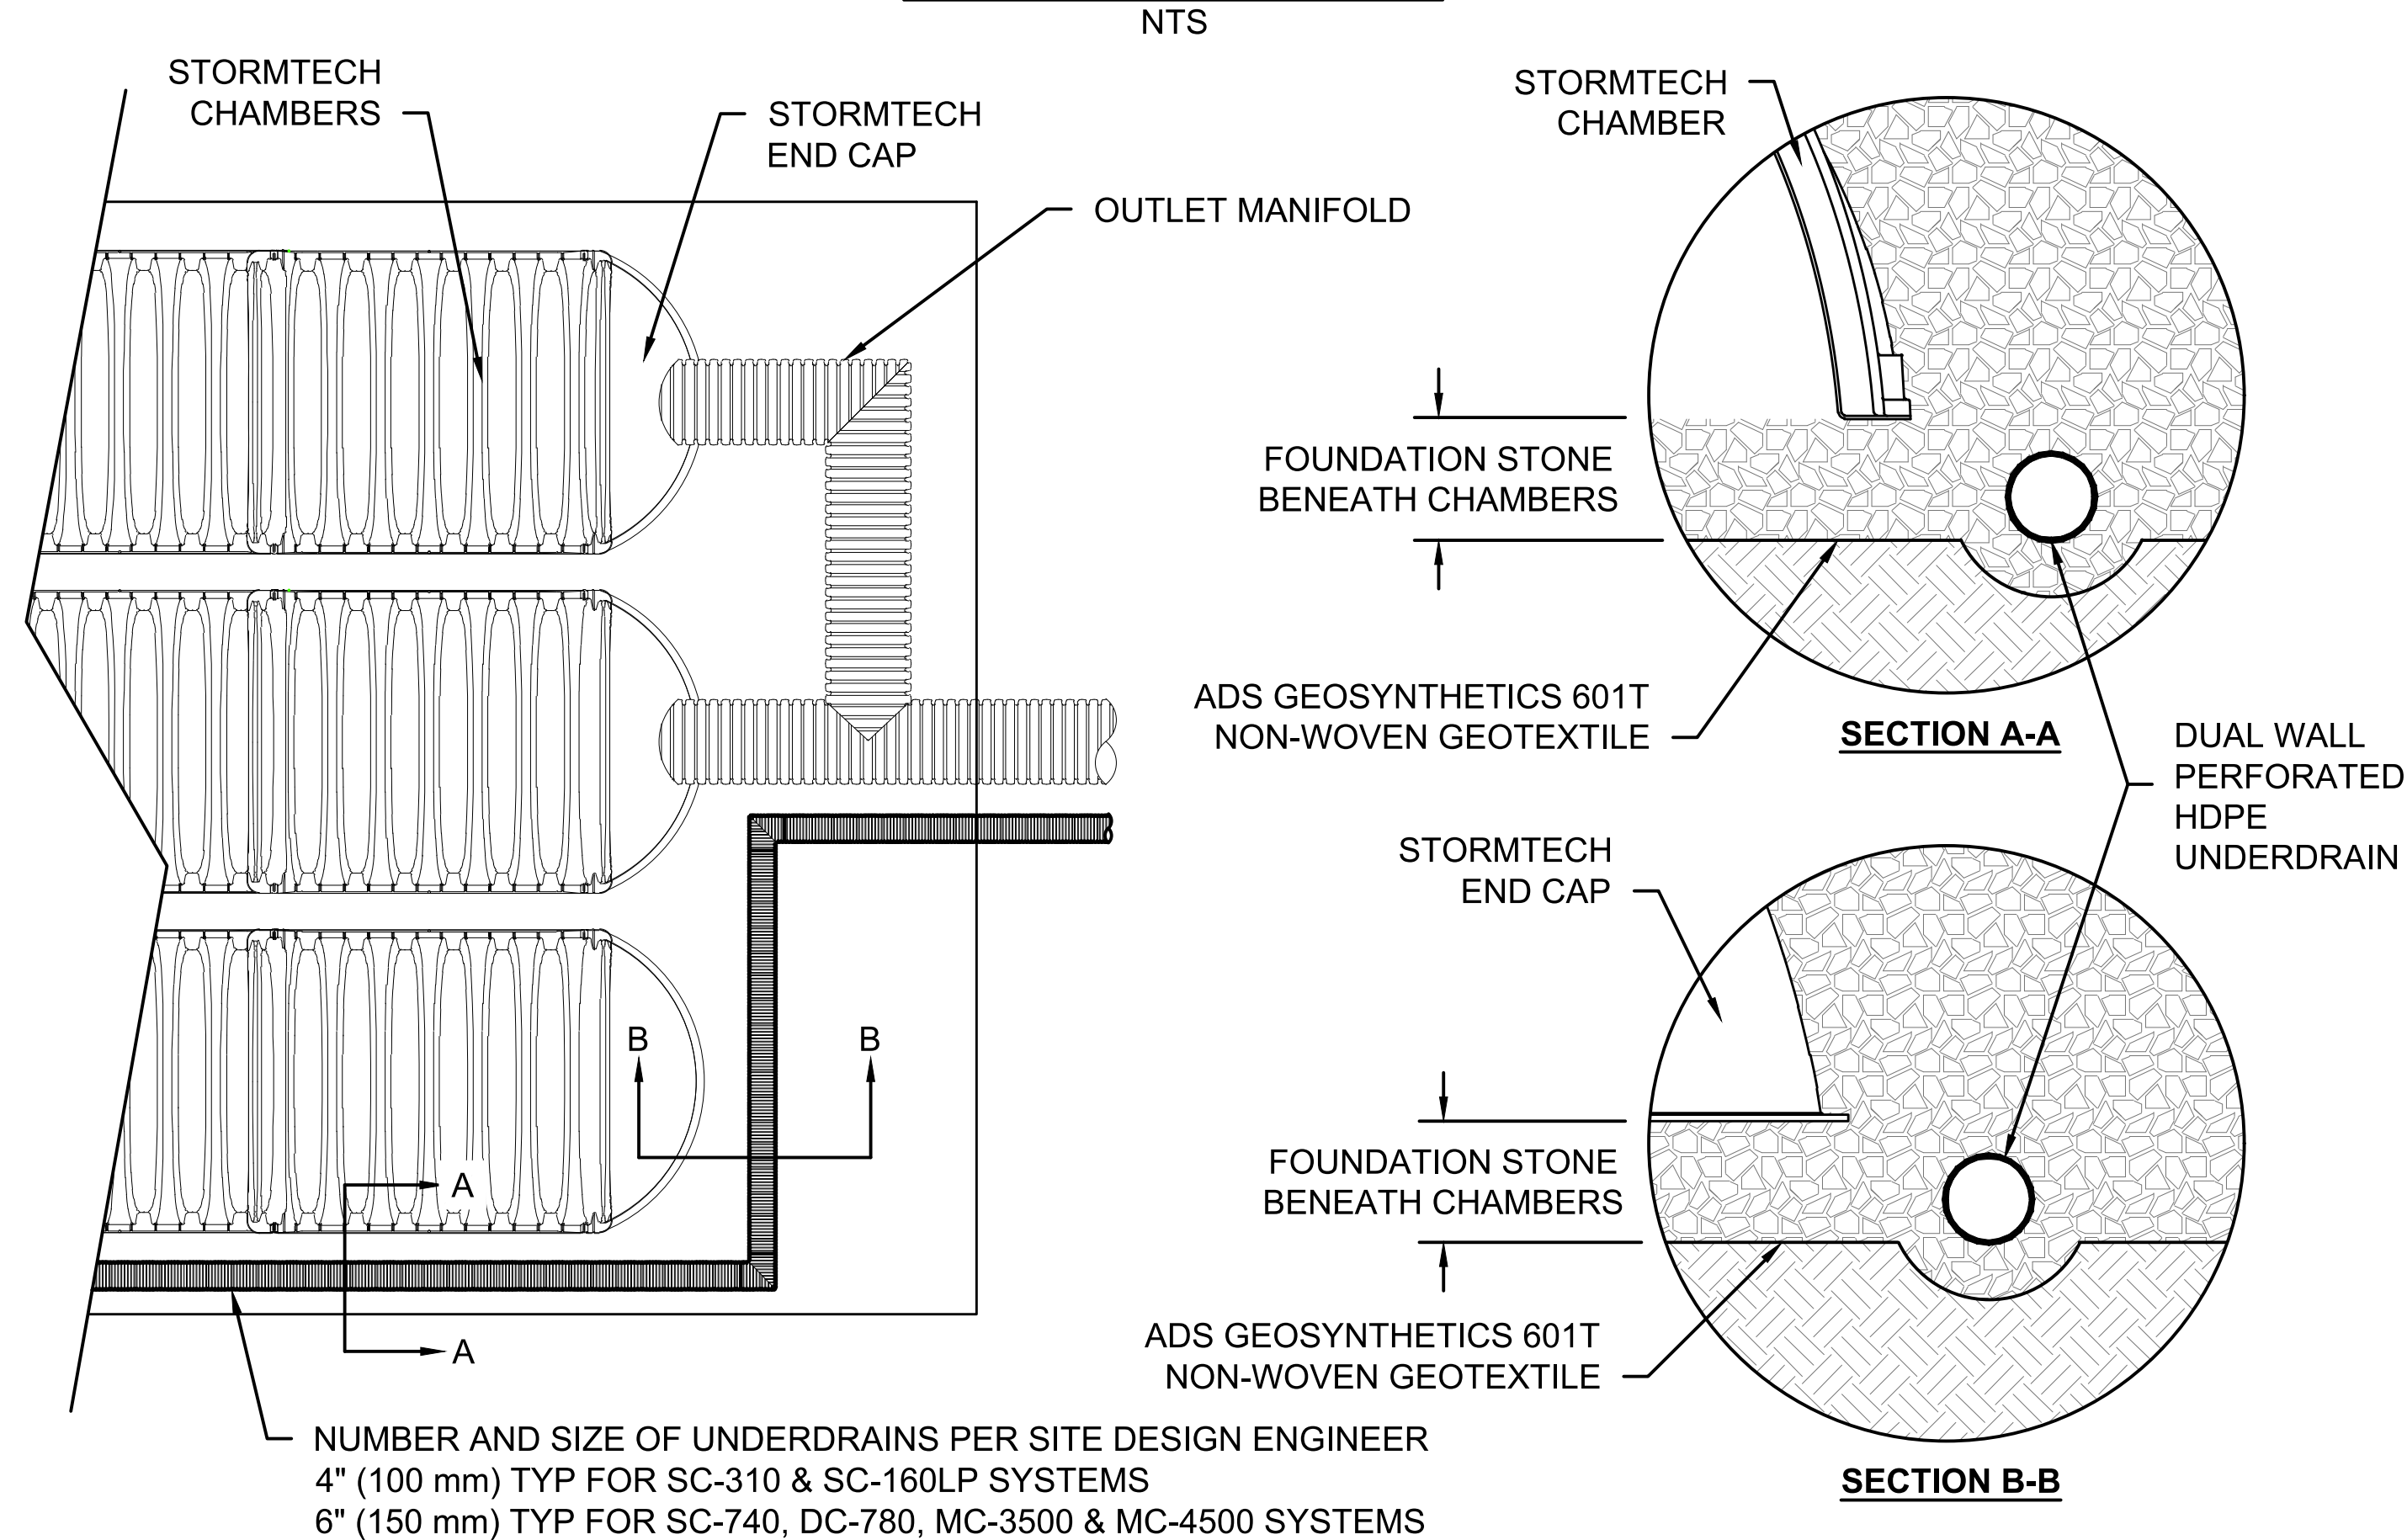

MC-3500 TECHNICAL SPECIFICATION

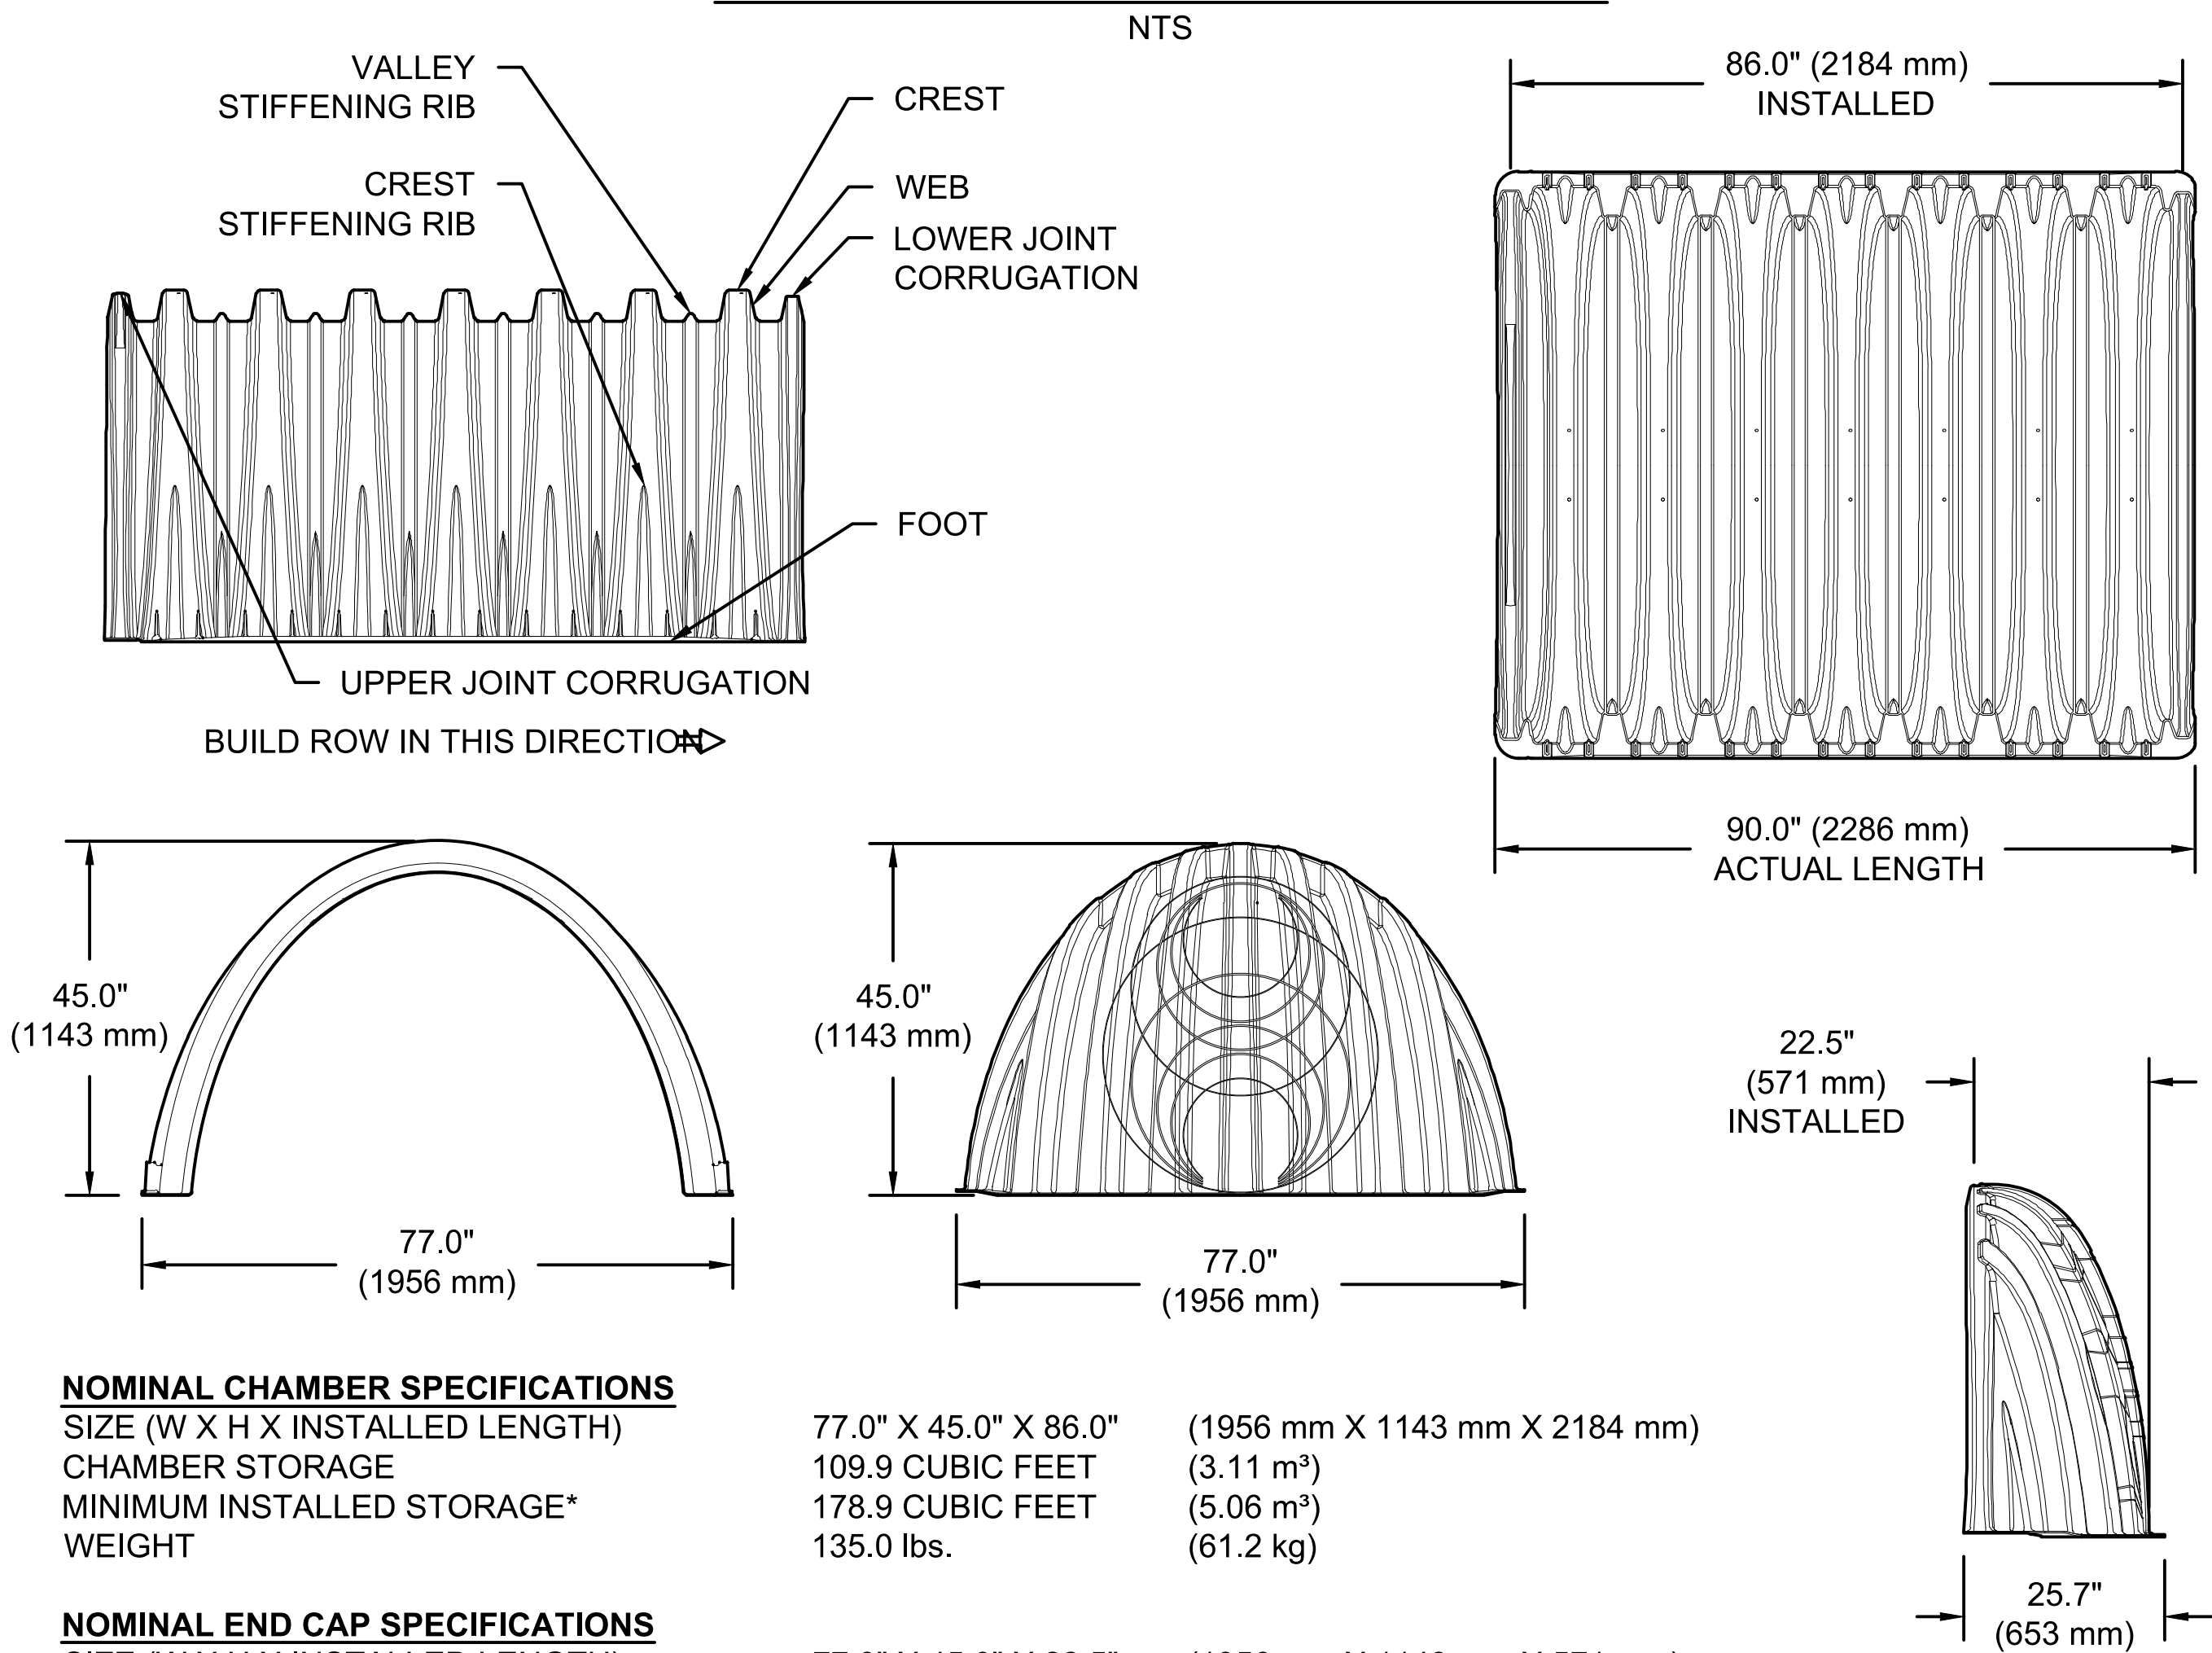

NOMINAL CHAMBER SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	77.0" X 45.0" X 86.0"	(1956 mm X 1143 mm X 2184 mm)
CHAMBER STORAGE	109.9 CUBIC FEET	(3.11 m ³)
MINIMUM INSTALLED STORAGE*	178.9 CUBIC FEET	(5.06 m ³)
WEIGHT	135.0 lbs.	(61.2 kg)

NOMINAL END CAP SPECIFICATIONS

SIZE (W X H X INSTALLED LENGTH)	77.0" X 45.0" X 22.5"	(1956 mm X 1143 mm X 571 mm)
END CAP STORAGE	14.9 CUBIC FEET	(0.42 m ³)
MINIMUM INSTALLED STORAGE*	46.0 CUBIC FEET	(1.30 m ³)
WEIGHT	50.0 lbs.	(22.7 kg)

*ASSUMES 12" (305 mm) STONE ABOVE, 9" (229 mm) STONE FOUNDATION AND BETWEEN CHAMBERS, 12" (305 mm) STONE PERIMETER IN FRONT OF END CAPS AND 40% STONE POROSITY

STUBS AT BOTTOM OF END CAP FOR PART NUMBERS ENDING WITH "B"
STUBS AT TOP OF END CAP FOR PART NUMBERS ENDING WITH "T"

PART #	STUB	B	C
MC3500IEPP06T	6" (150 mm)	33.21" (844 mm)	---
MC3500IEPP06B		---	0.66" (17 mm)
MC3500IEPP08T	8" (200 mm)	31.16" (791 mm)	---
MC3500IEPP08B		---	0.81" (21 mm)
MC3500IEPP10T	10" (250 mm)	29.04" (738 mm)	---
MC3500IEPP10B		---	0.93" (24 mm)
MC3500IEPP12T	12" (300 mm)	26.36" (670 mm)	---
MC3500IEPP12B		---	1.35" (34 mm)
MC3500IEPP15T	15" (375 mm)	23.39" (594 mm)	---
MC3500IEPP15B		---	1.50" (38 mm)
MC3500IEPP18TC	18" (450 mm)	20.03" (509 mm)	---
MC3500IEPP18BC		---	1.77" (45 mm)
MC3500IEPP24TC	24" (600 mm)	14.48" (368 mm)	---
MC3500IEPP24BC		---	2.06" (52 mm)
MC3500IEPP30BC	30" (750 mm)	---	---

NOTE: ALL DIMENSIONS ARE NOMINAL

CUSTOM PRECORED INVERTS ARE AVAILABLE UPON REQUEST. INVENTORIED MANIFOLDS INCLUDE 12-24" (300-600 mm) SIZE ON SIZE AND 15-48" (375-1200 mm) ECCENTRIC MANIFOLDS. CUSTOM INVERT LOCATIONS ON THE MC-3500 END CAP CUT IN THE FIELD ARE NOT RECOMMENDED FOR PIPE SIZES GREATER THAN 10" (250 mm) THE INVERT LOCATION IN COLUMN 'B' ARE THE HIGHEST POSSIBLE FOR THE PIPE SIZE.



70 INWOOD ROAD, SUITE 3 | ROCKY HILL | CT | 06067
860-528-8168 | 866-892-2694 | WWW.STORMTECH.COM



4640 TRUEJMAN BLVD
HILLIARD, OH 43026