




# PHOTOMETRICS COMPLETED BY CAPITOL LIGHT

CAPITOL LIGHT  
www.capitollight.com

JOB: TACO BELL LOCATION: WOODS CHAPEL

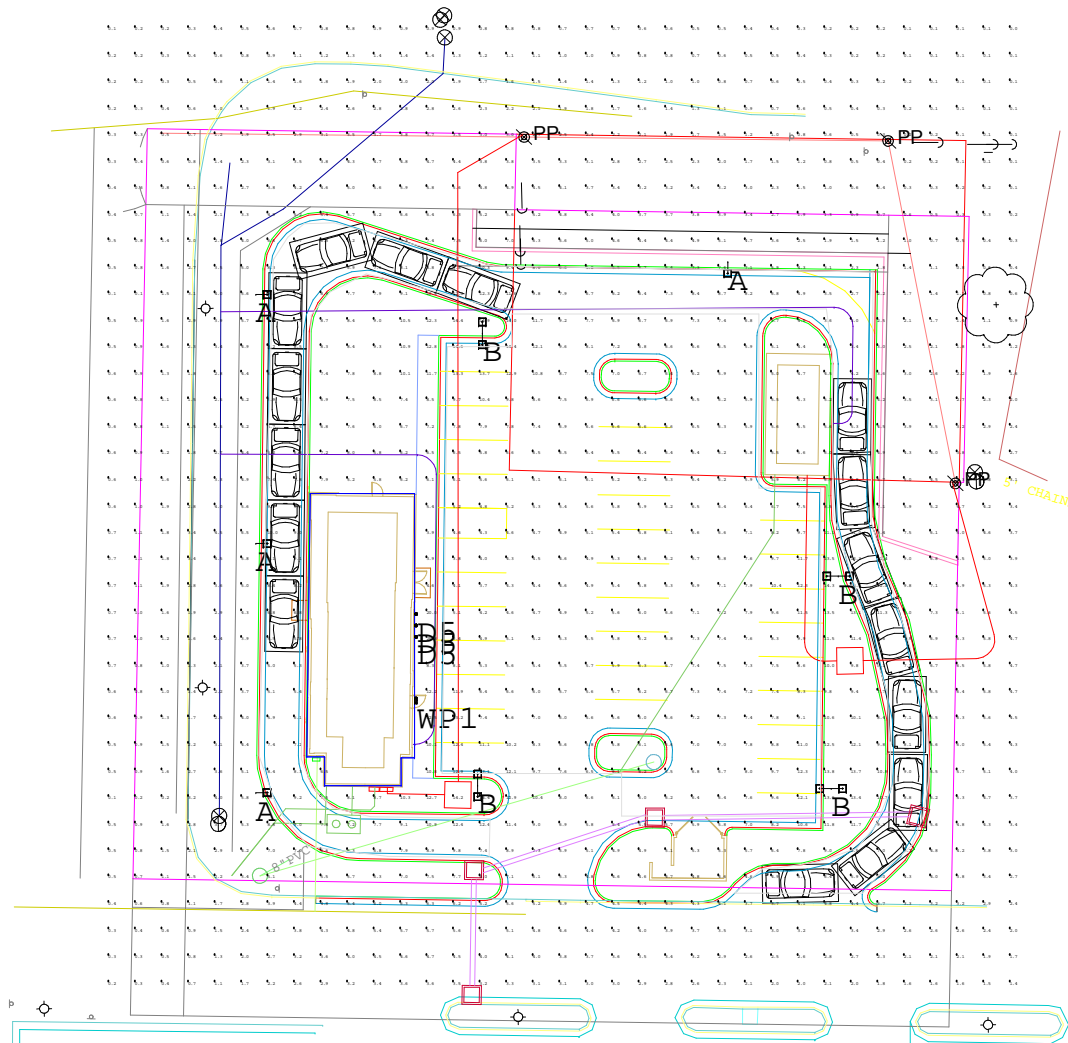

Luminaire Schedule				
Symbol	Qty	Label	Description	
	4	A	MRM-LED-30L-SIL-FT-40-70CRI MOUNTED AT 25'	
	4	B	MRM-LED-30L-SIL-FT-40-70CRI MOUNTED AT 25'	
	3	D5	PROGRESS P5642 WITH 17W LED PAR28 LAMP	
	1	WP1	LDWP-GL-3B-120V	

Calculation Summary					
Label	Avg	Max	Min	Avg/Min	Max/Min
-	N.A.	N.A.	N.A.	N.A.	N.A.
DRIVE THRU SURFACE	7.69	13.3	2.7	2.85	4.93
PARKING LOT SURFACE	7.03	13.7	3.7	1.90	3.70

Based on the information provided, all dimensions and luminaire locations show represent recommended positions or positions provided by third party. The engineer and/or architect have the sole responsibility to determine applicability of the layout to existing or future field conditions.  
This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with IES approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.