LOCATION MAP SECTION 35-48-32 Scale 1" = 2000'

UTILITIES

WATER & SANITARY SEWER City of Lee's Summit Water Utilities 1200 SE Hamblen Road Lee's Summit, MO Phone:816.969.1900

ELECTRICITY Kansas City Power and Light Phone: 816.471.5275

Missouri Gas Energy PO Box 219255 Kansas City, Missouri 64141 Phone: 816.756.5252

TELEPHONE AT&T

Phone: 800.288.2020

Time Warner Cable Phone: 816.222.5952

CABLE TV Comcast Phone: 816.795.1100


Time Warner Cable Phone: 816.358.8833

Oil / Gas Well Note:

There is no visible evidence, this date, of abandoned oil or gas wells located within the property boundary, as identified in "Environmental Impact Study of Abandoned Oil and Gas Wells in Lee's Summit, Missouri", by Edward Alton May.

Flood Plain Note

We have reviewed the F.E.M.A. Flood Insurance Rate Map Number 29095C0417G, revised January 20, 2017, this tract graphically lies in OTHER AREAS, ZONE X, defined as areas determined to be outside the 0.2% annual chance floodplain.

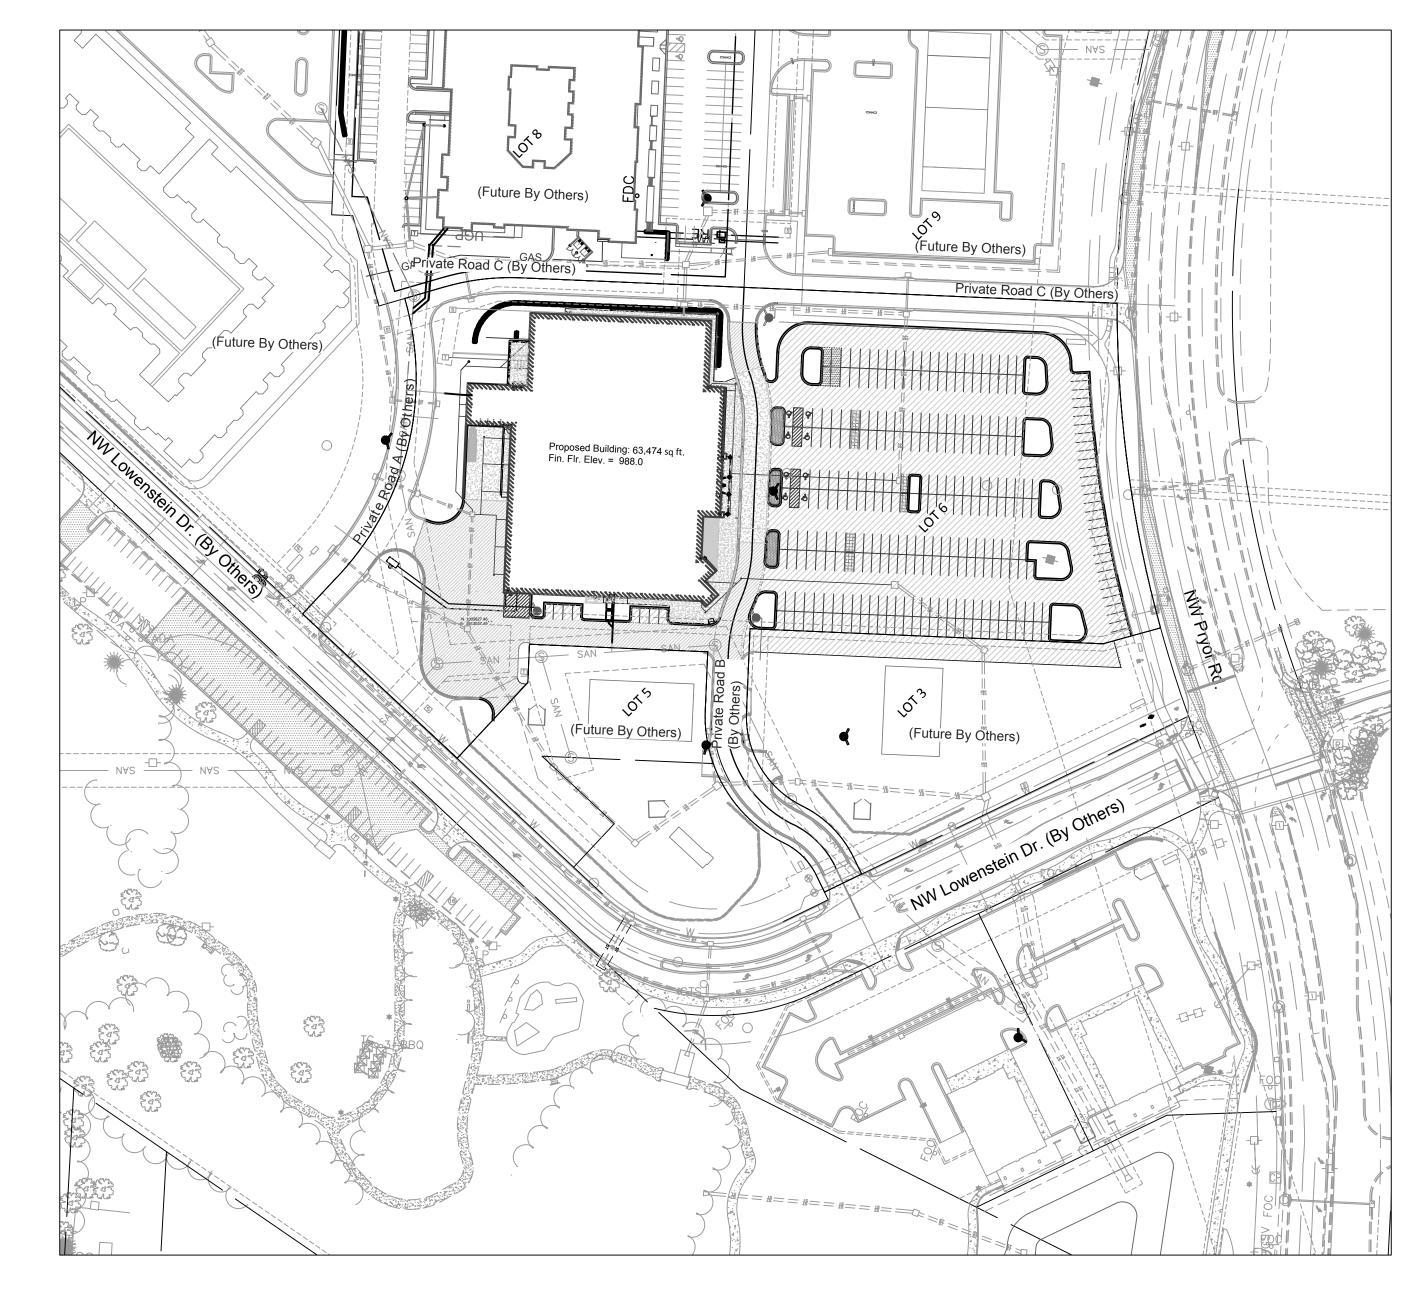

Final Development Plans For

McKeever's Market & Eatery #950

840 NW Pryor Road

Lee's Summit, Jackson County, Missouri

DATUM BENCHMARK: VERTICAL DATUM IS NAVD 88 ESTABLISHED USING OPUS PROJECTS ON PROJECT CONTROL.

BENCHMARKS: BM #1: CHISELED "SQUARE" ON TOP OF CURB POINT OF INTERSECTION OF WEST PARK PARKING LOT AT EAST DRIVE ENTRANCE. ELEV=985.05

BM #2: CHISELED "SQUARE" ON NORTHWEST CORNER AREA INLET, 25'± EAST OF CURB LINE AND ON-LINE WITH SOUTH CURB OF NW LOWENSTEIN DRIVE AT 90° BEND IN ROAD. ELEV=971.06



LEGEND

	Existing Section Line		Proposed Right-of-Way
	Existing Right-of-Way Line		Proposed Property Line
	Existing Lot Line		Proposed Lot Line
	Existing Easement Line	— U/E —	Proposed Easement
	Existing Curb & Gutter		Proposed Curb & Gutter
	Existing Sidewalk		Proposed Sidewalk
	Existing Storm Sewer		Proposed Storm Sewer
	Existing Storm Structure		Proposed Storm Structure
√L —— W/L —	Existing Waterline	A	Proposed Fire Hydrant
AS —— GAS —	Existing Gas Main		Proposed Waterline
- SAN	Existing Sanitary Sewer	ss	Proposed Sanitary Sewer
S	Existing Sanitary Manhole	©	Proposed Sanitary Manhole
	Existing Contour Major		Proposed Contour Major
	Existing Contour Minor		Proposed Contour Minor
			Future Curb and Gutter

DEVELOPER/APPLICANT

Sheet Number Sheet Title Super Market Developers, Inc. Attn: Joel Riggs C01 Title Sheet 5000 Kansas Avenue **General Layout** Kansas City, Kansas 66106 C04 Site Plan

CONSULTANT

Renaissance Infrastructure Consulting Dustin Burton, P.E. 1815 McGee Street, Suite 200 Kansas City, MO 64108

Improvements By Others Grading Plan **Grading Details Grading Details** Site Utility Plan Site Drainage - Roof Drains Site Drainage - Roof Drains Profiles Site Drainage - Roof Drains Profiles C11 Drainage Area Map C12 C13 **Erosion Control Phase I** C14 Erosion Control Phase II C15 **Erosion Control Phase III** C16 TYPICAL DETAILS- GENERAL C17 TYPICAL DETAILS-GENERAL TYPICAL DETAILS-WATER L01 - L07 Landscape Plans

INDEX OF SHEETS

GENERAL NOTES

All construction shall be in accordance with the current City of Lee's Summit "Design and Construction Manual" as adopted by Ordinance 5813. Where discrepancies exist between the Final Development Plan and the Design and Construction Manual, the Design and Construction Manual shall govern.


- 1. The Contractor shall be responsible for obtaining insurance and securing all bonds, as required by the Contract Documents, the City of Lee's Summit, Mo., and all other governing agencies (including local, county, state, and federal authorities) having jurisdiction over the work proposed by these Construction Documents. The cost for all bonds, and insurance shall be the contractor's responsibility and shall be included in the bid for the work.
- All existing utilities indicated on the drawings are according to the best information available to the engineer; however, all utilities actually existing may not be shown. The contractor shall be responsible for contacting all utility companies for an exact field location of each utility prior to any construction. All utilities, shown and not shown, damaged through the negligence of the contractor shall be repaired or replaced by the contractor at his/her
- The contractor shall be responsible for all damages to existing utilities, pavement, fences, structures, and other features caused by construction activities not designated for removal. The contractor shall repair all damages at his/her expense.
- 4. The demolition of existing pavement, curbs, structures, and all other features necessary to construct the proposed improvements, shall be performed by the contractor. All waste material removed during construction shall be disposed off the project site. The contractor shall be responsible for all permits for hauling and disposing of waste material. The disposal of waste material shall be in accordance with all local, state, and federal
- By use of these construction documents the contractor hereby agrees that he shall be solely responsible for the safety of the construction workers and the public. The contractor agrees to hold the engineer and owner harmless for any and all injuries, claims, losses, or damages related to the project.
- The contractor shall be responsible for providing all signage, barricades, lighting, etc., as required for temporary traffic control during the construction of this project. Maintenance of the temporary traffic control devices will be the contractor's responsibility. All traffic control in conduction with construction in the right-of-way shall be in conformance with the City Traffic Control Requirements.
- 7. Contractor shall furnish evidence that his/her insurance meets the requirements of the City of Lee's Summit, Missouri Municipal Code.
- 8. Prior to installing, constructing, or performing any work on the public storm sewer line (including connecting private drainage systems to the storm sewer), contact the City of Lee's Summit Development Engineering Inspections.
- 9. Connections to the public storm sewers between structures shall not be permitted.
- 10. Contractor shall verify and accept existing topography shown herein. Contractor shall notify Engineer of any discrepancies found prior to any earthwork activities. 11. Planning and Codes Administration require retaining wall design by a registered engineer in
- 12. Geogrid, footings, or other elements of the retaining wall(s) shall not encroach into the right
- of way or public easements.
- 13. All building and life safety issues shall comply with the 2018 International Fire Code and local amendments as adopted by the City of Lee's Summit.



Sheet C01





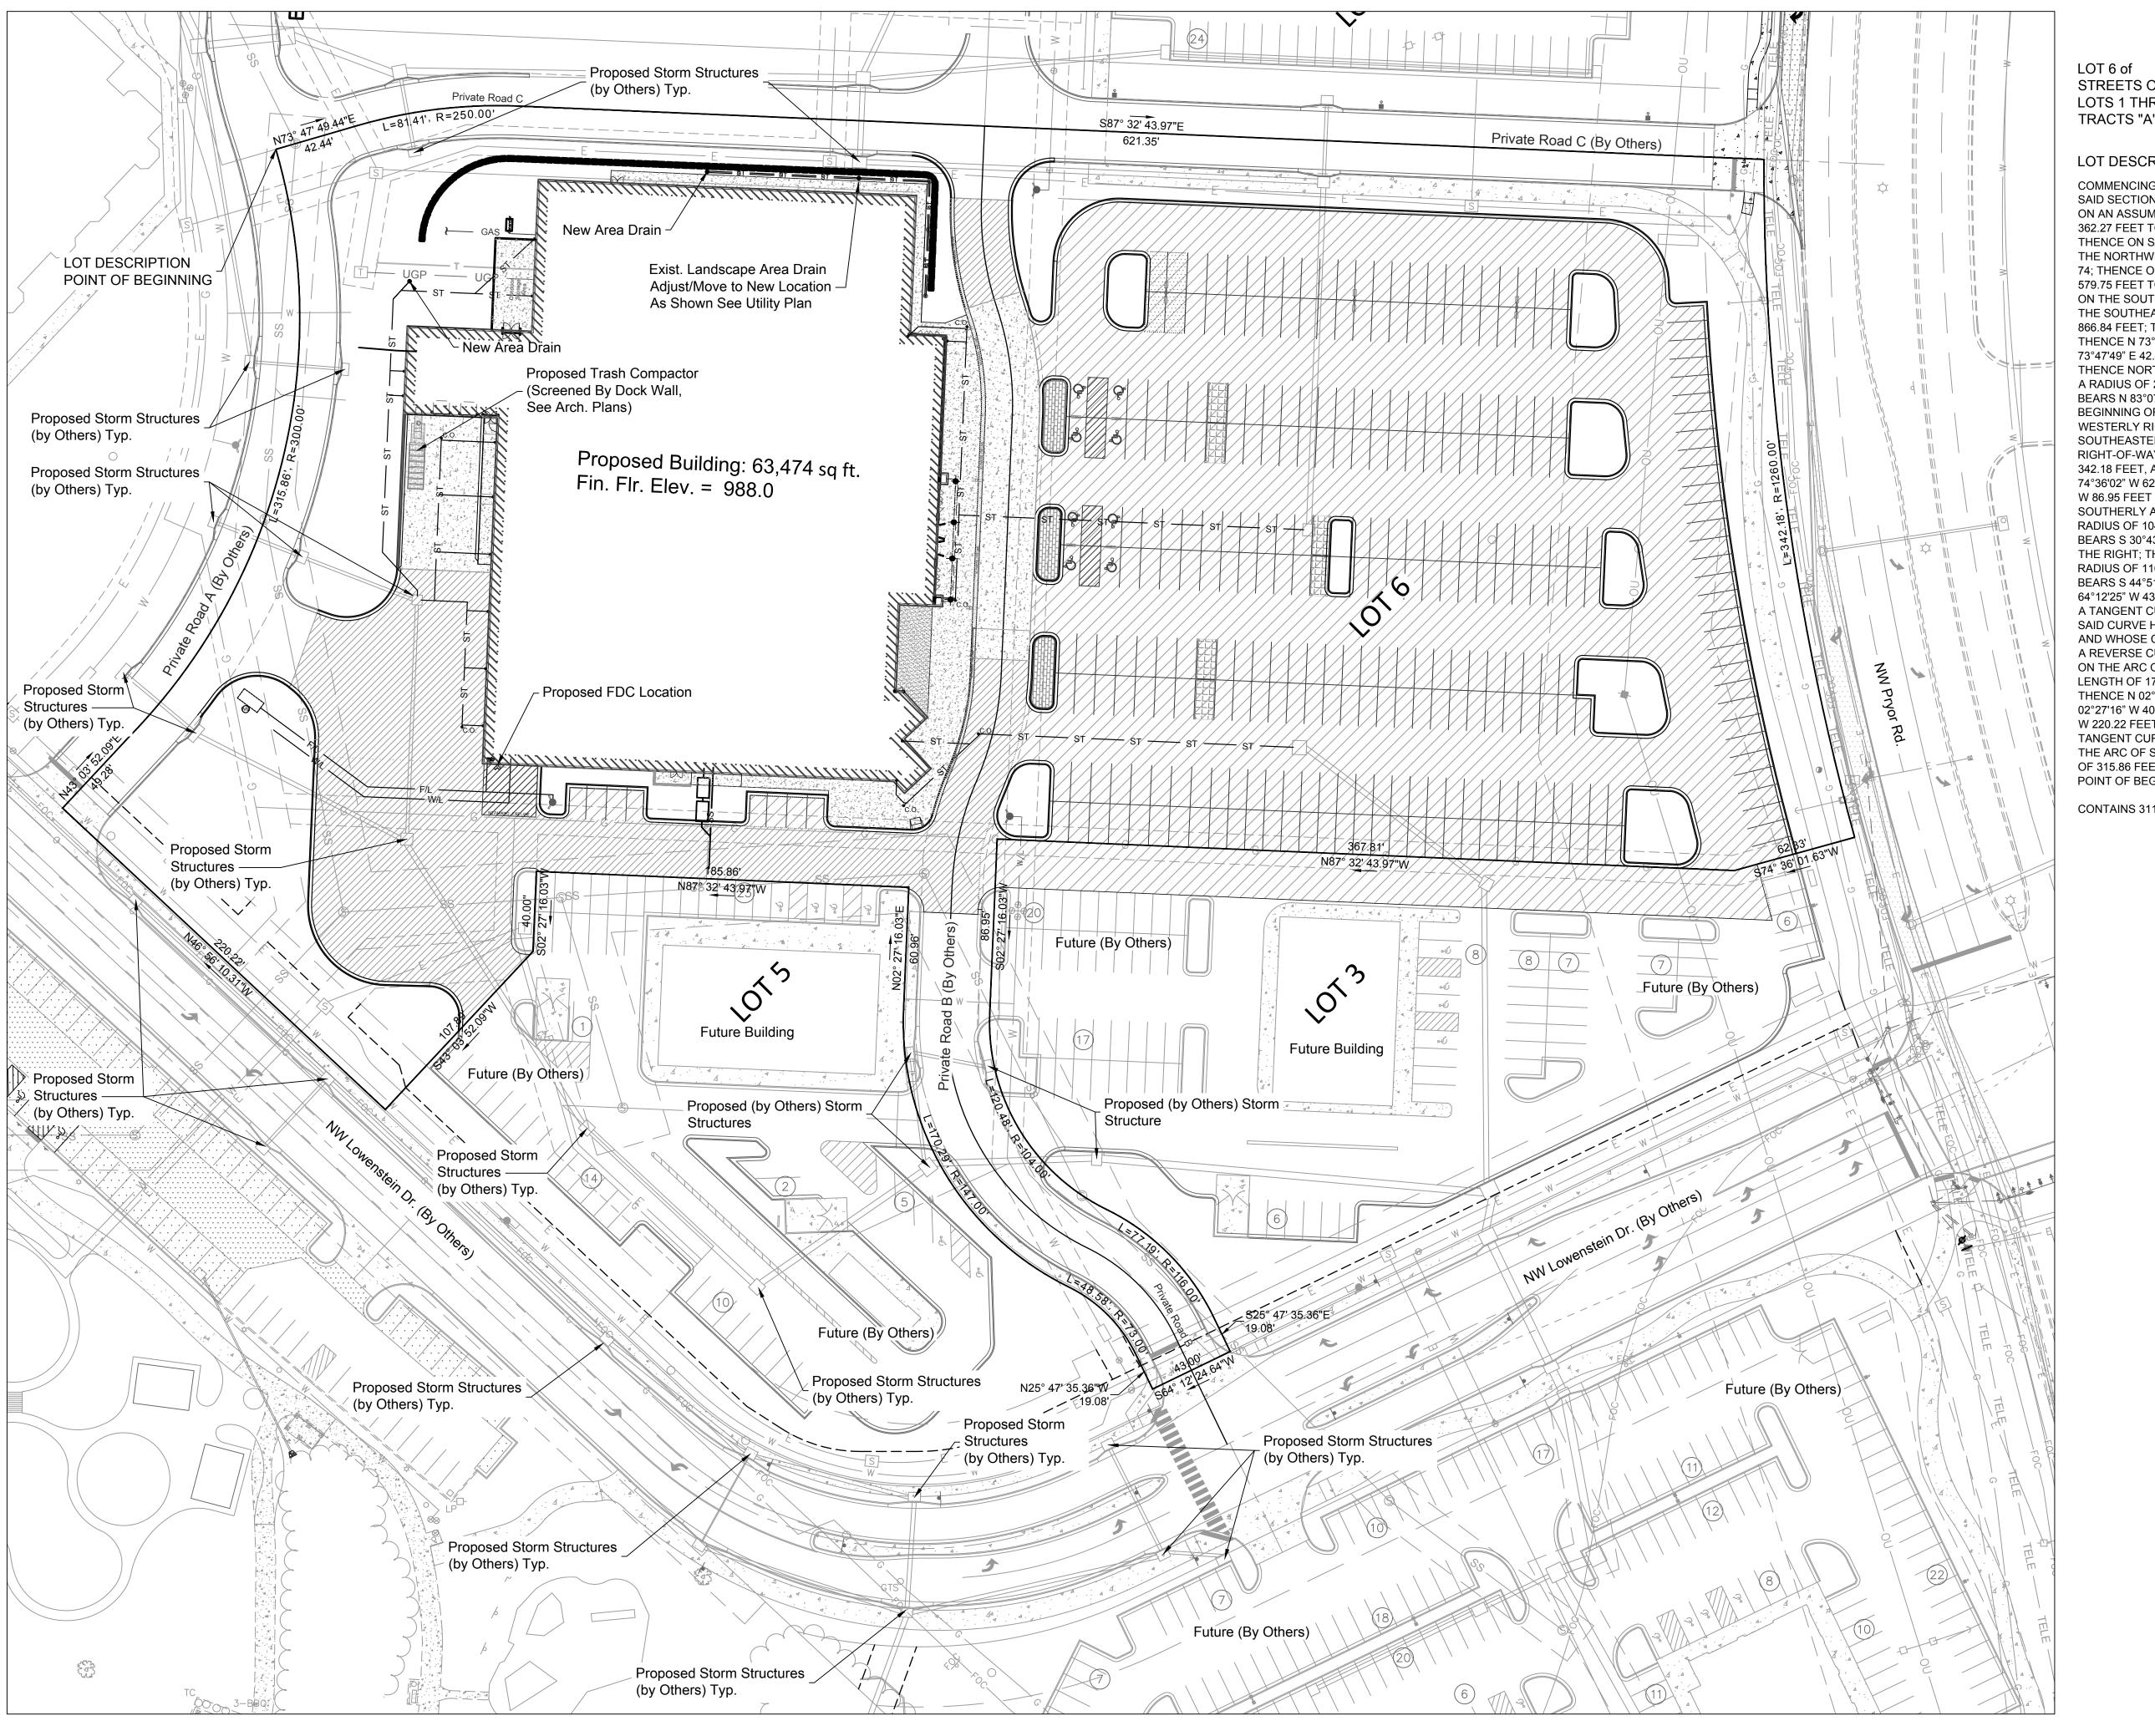

STREETS OF WEST PRYOR LOTS 1 THRU 14, TRACTS "A", "B", "C", & "D"

LOT DESCRIPTION:

COMMENCING AT THE NORTHWEST CORNER OF THE SOUTHEAST QUARTER OF SAID SECTION 35; THENCE ON THE WEST LINE OF SAID SOUTHEAST QUARTER, ON AN ASSUMED BEARING OF S 02°27'18" W 332.72 FEET; THENCE N 31°23'08" E 362.27 FEET TO THE SOUTHERLY RIGHT-OF-WAY LINE OF INTERSTATE 470: THENCE ON SAID SOUTHERLY RIGHT-OF-WAY LINE, S 85°14'51" E 359.55 FEET TO THE NORTHWEST CORNER OF GERBER HEIGHTS RECORDED IN BOOK 151, PAGE 74; THENCE ON THE WESTERLY LINE OF SAID GERBER HEIGHTS, S 24°49'45" E 579.75 FEET TO THE SOUTHWEST CORNER OF SAID GERBER HEIGHTS; THENCE ON THE SOUTH LINE OF SAID GERBER HEIGHTS, S 85°07'20" E 511.36 FEET TO THE SOUTHEAST CORNER OF SAID GERBER HEIGHTS; THENCE S 02°27'18" W 866.84 FEET; THENCE S 87°32'44" E 21.89 FEET; THENCE S 16°12'11' E 97.91 FEET; THENCE N 73°47'49" E 28.02 FEET TO THE POINT OF BEGINNING; THENCE N 73°47'49" E 42.44 FEET TO THE BEGINNING OF A TANGENT CURVE THE RIGHT; THENCE NORTHEASTERLY AND EASTERLY ON THE ARC OF SAID CURVE HAVING A RADIUS OF 250.00 FEET, AN ARC LENGTH OF 81.41 FEET, AND WHOSE CHORD BEARS N 83°07'33" E 81.05 FEET; THENCE S 87°32'44" E 621.35 FEET TO THE BEGINNING OF A NON-TANGENT CURVE TO THE LEFT, ALSO BEING ON THE WESTERLY RIGHT-OF-WAY LINE OF NW PRYOR ROAD; THENCE SOUTHEASTERLY ON THE ARC OF SAID CURVE AND SAID WESTERLY RIGHT-OF-WAY LINE, HAVING A RADIUS OF 1260.00 FEET, AN ARC LENGTH OF 342.18 FEET, AND WHOSE CHORD BEARS S 07°37'10" E 341.13 FEET; THENCE S 74°36'02" W 62.33 FEET; THENCE N 87°32'44" W 367.81 FEET; THENCE S 02°27'16" W 86.95 FEET TO THE BEGINNING OF A TANGENT CURVE TO THE LEFT; THENCE SOUTHERLY AND SOUTHEASTERLY ON THE ARC OF SAID CURVE HAVING A RADIUS OF 104.00 FEET, AN ARC LENGTH OF 120.48 FEET, AND WHOSE CHORD BEARS S 30°43'59" E 113.86 FEET TO THE BEGINNING OF A REVERSE CURVE TO THE RIGHT; THENCE SOUTHEASTERLY ON THE ARC OF SAID CURVE HAVING A RADIUS OF 116.00 FEET, AN ARC LENGTH OF 77.19 FEET, AND WHOSE CHORD BEARS S 44°51'25" E 75.78 FEET; THENCE S 25°47'35" E 19.08 FEET; THENCE S 64°12'25" W 43.00 FEET; THENCE N 25°47'35" W 19.08 FEET TO THE BEGINNING OF A TANGENT CURVE TO THE LEFT; THENCE NORTHWESTERLY ON THE ARC OF SAID CURVE HAVING A RADIUS OF 73.00 FEET, AN ARC LENGTH OF 48.58 FEET, AND WHOSE CHORD BEARING N 44°51'25" W 47.69 FEET TO THE BEGINNING OF A REVERSE CURVE TO THE RIGHT; THENCE NORTHWESTERLY AND NORTHERLY ON THE ARC OF SAID CURVE HAVING A RADIUS OF 147.00 FEET, AN ARC LENGTH OF 170.29 FEET, AND WHOSE CHORD BEARS, N 30°43'59" W 160.93 FEET; THENCE N 02°27'16" E 60.96 FEET; THENCE N 87°32'44" W 185.86 FEET; THENCE S 02°27'16" W 40.00 FEET; THENCE S 43°03'52" W 107.89 FEET; THENCE N 46°56'08" W 220.22 FEET; THENCE N 43°03'52" E 49.28 FEET TO THE BEGINNING OF A TANGENT CURVE TO THE LEFT; THENCE NORTHEASTERLY AND NORTHERLY ON THE ARC OF SAID CURVE HAVING A RADIUS OF 300.00 FEET, AN ARC LENGTH OF 315.86 FEET, AND WHOSE CHORD BEARS N 13°57'34" E 301.47 FEET TO THE POINT OF BEGINNING.

CONTAINS 311,668 SQUARE FEET, 7.15 ACRES MORE OR LESS.








Sheet

C02

<u>~</u> ∞

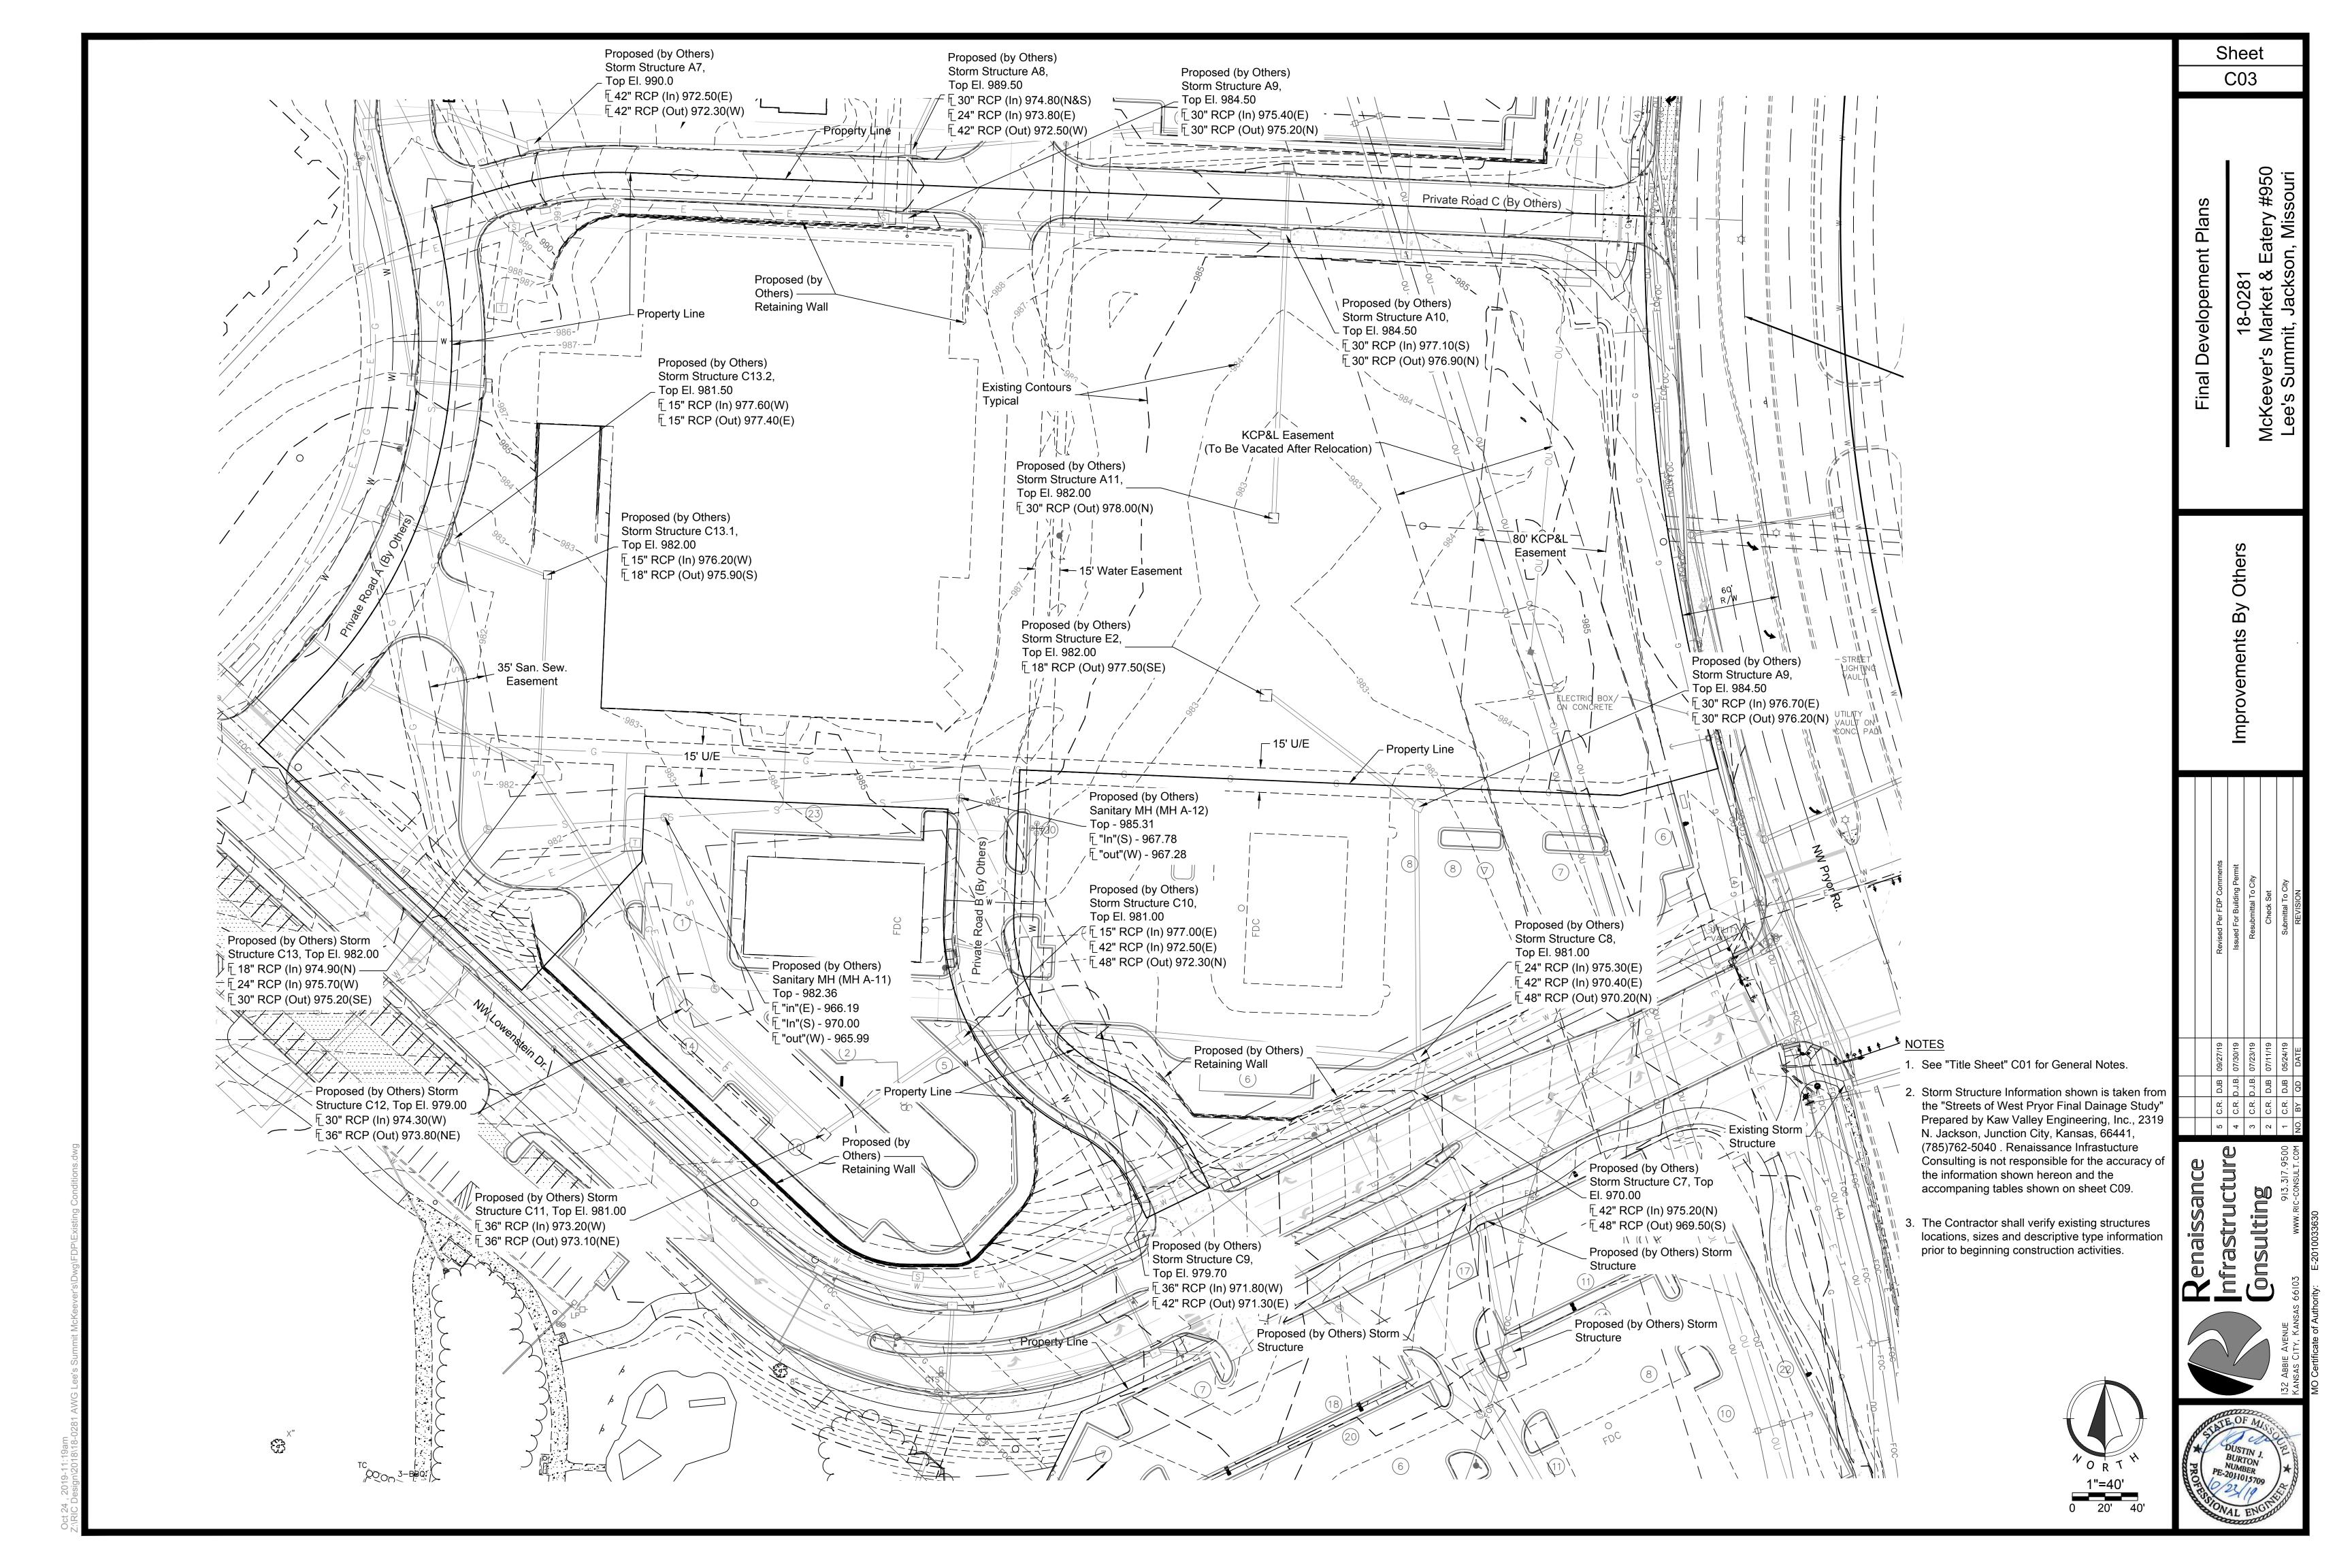

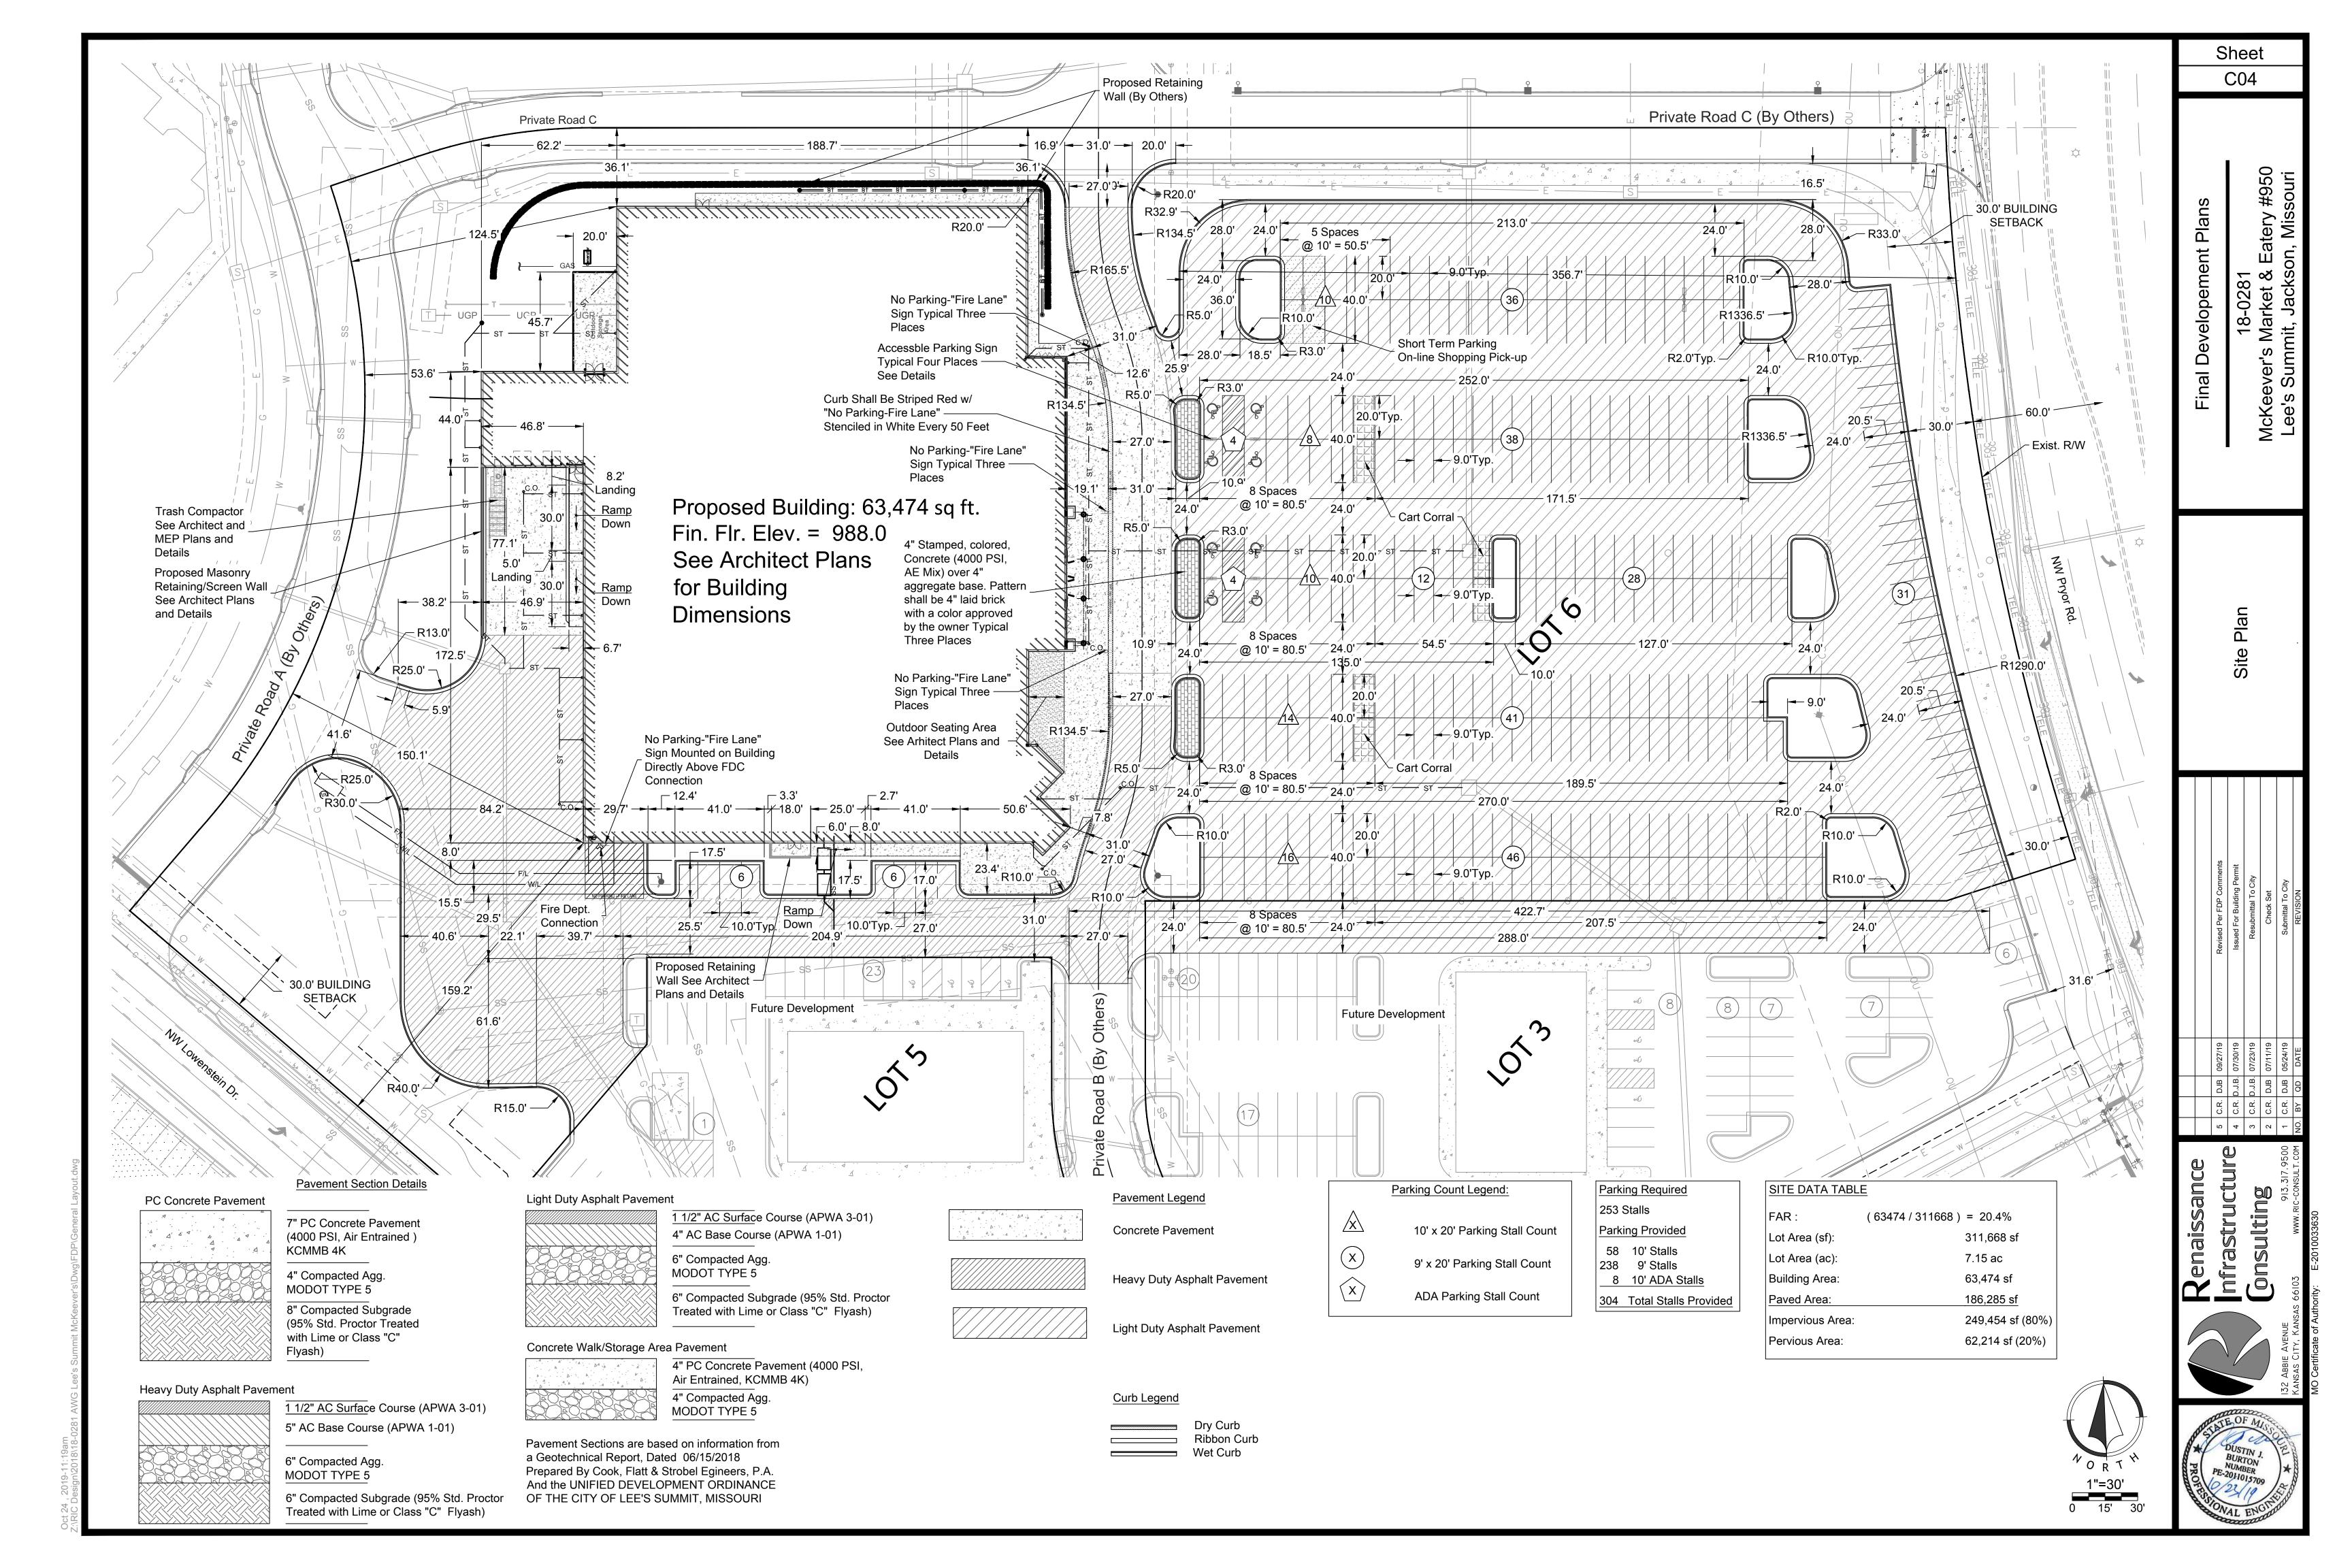

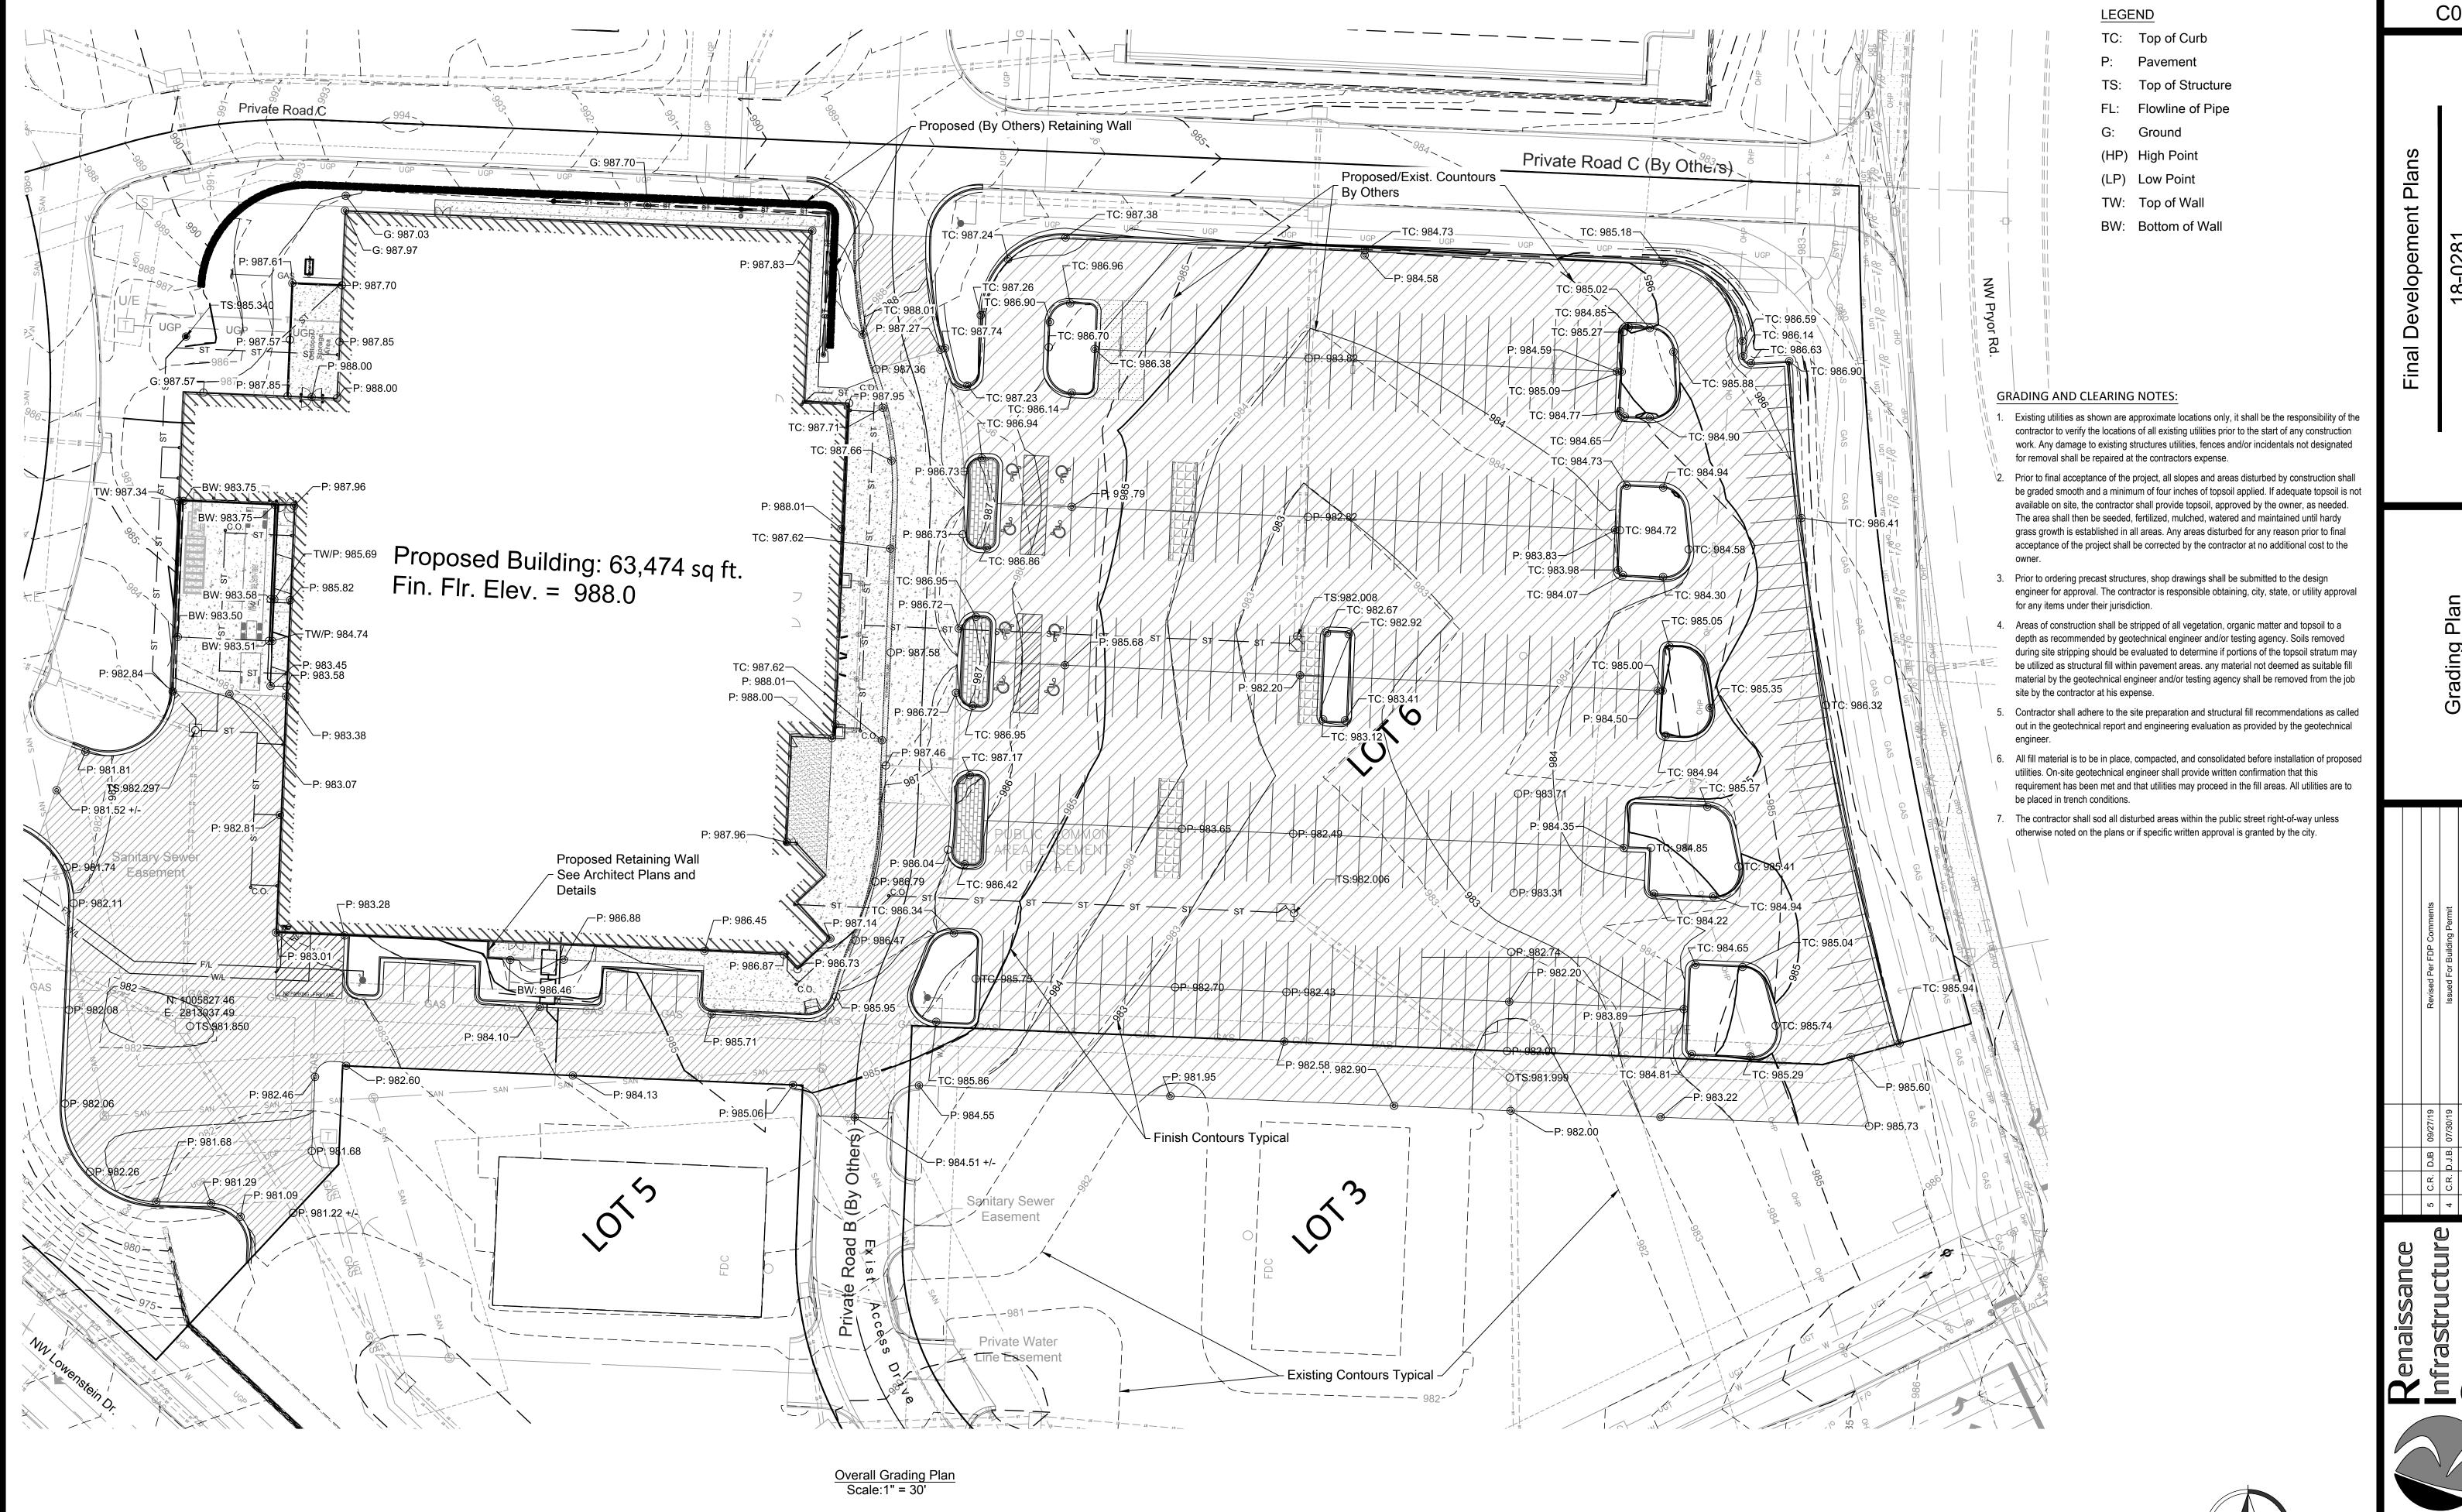


Sheet C05

ading



1"=30' 0 15' 30'

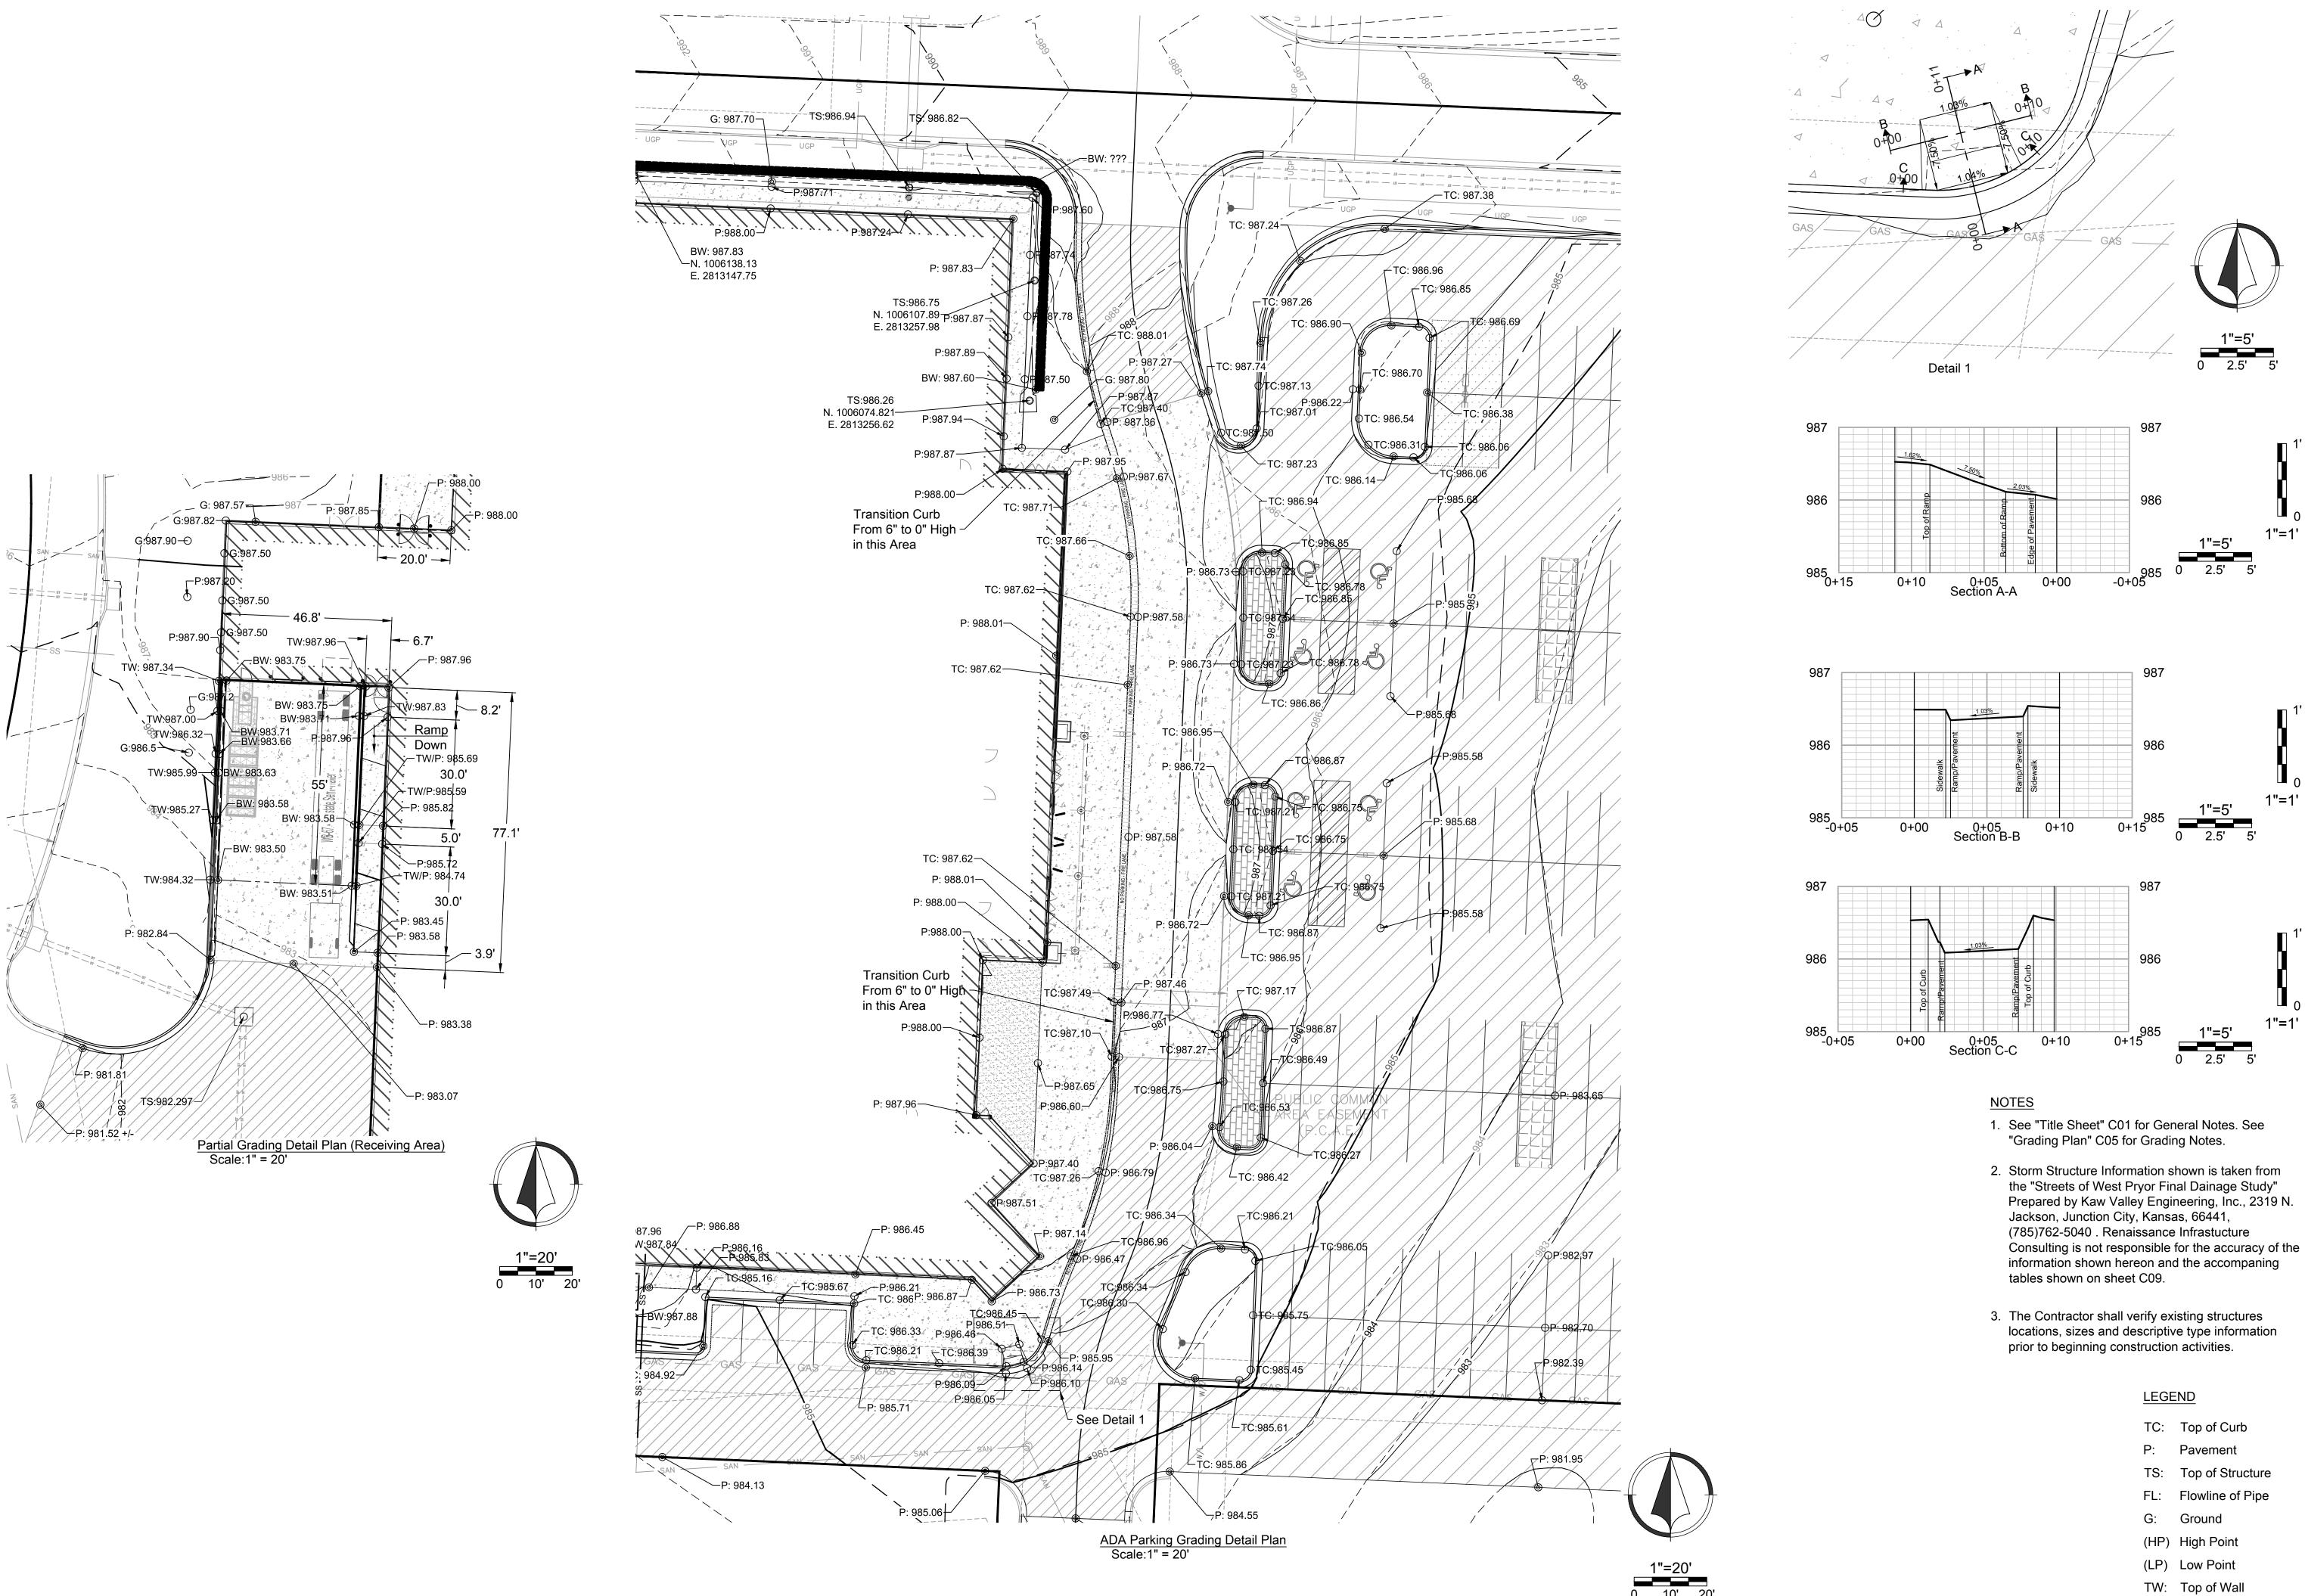

Sheet C06







TS: Top of Structure

FL: Flowline of Pipe

(HP) High Point

BW: Bottom of Wall

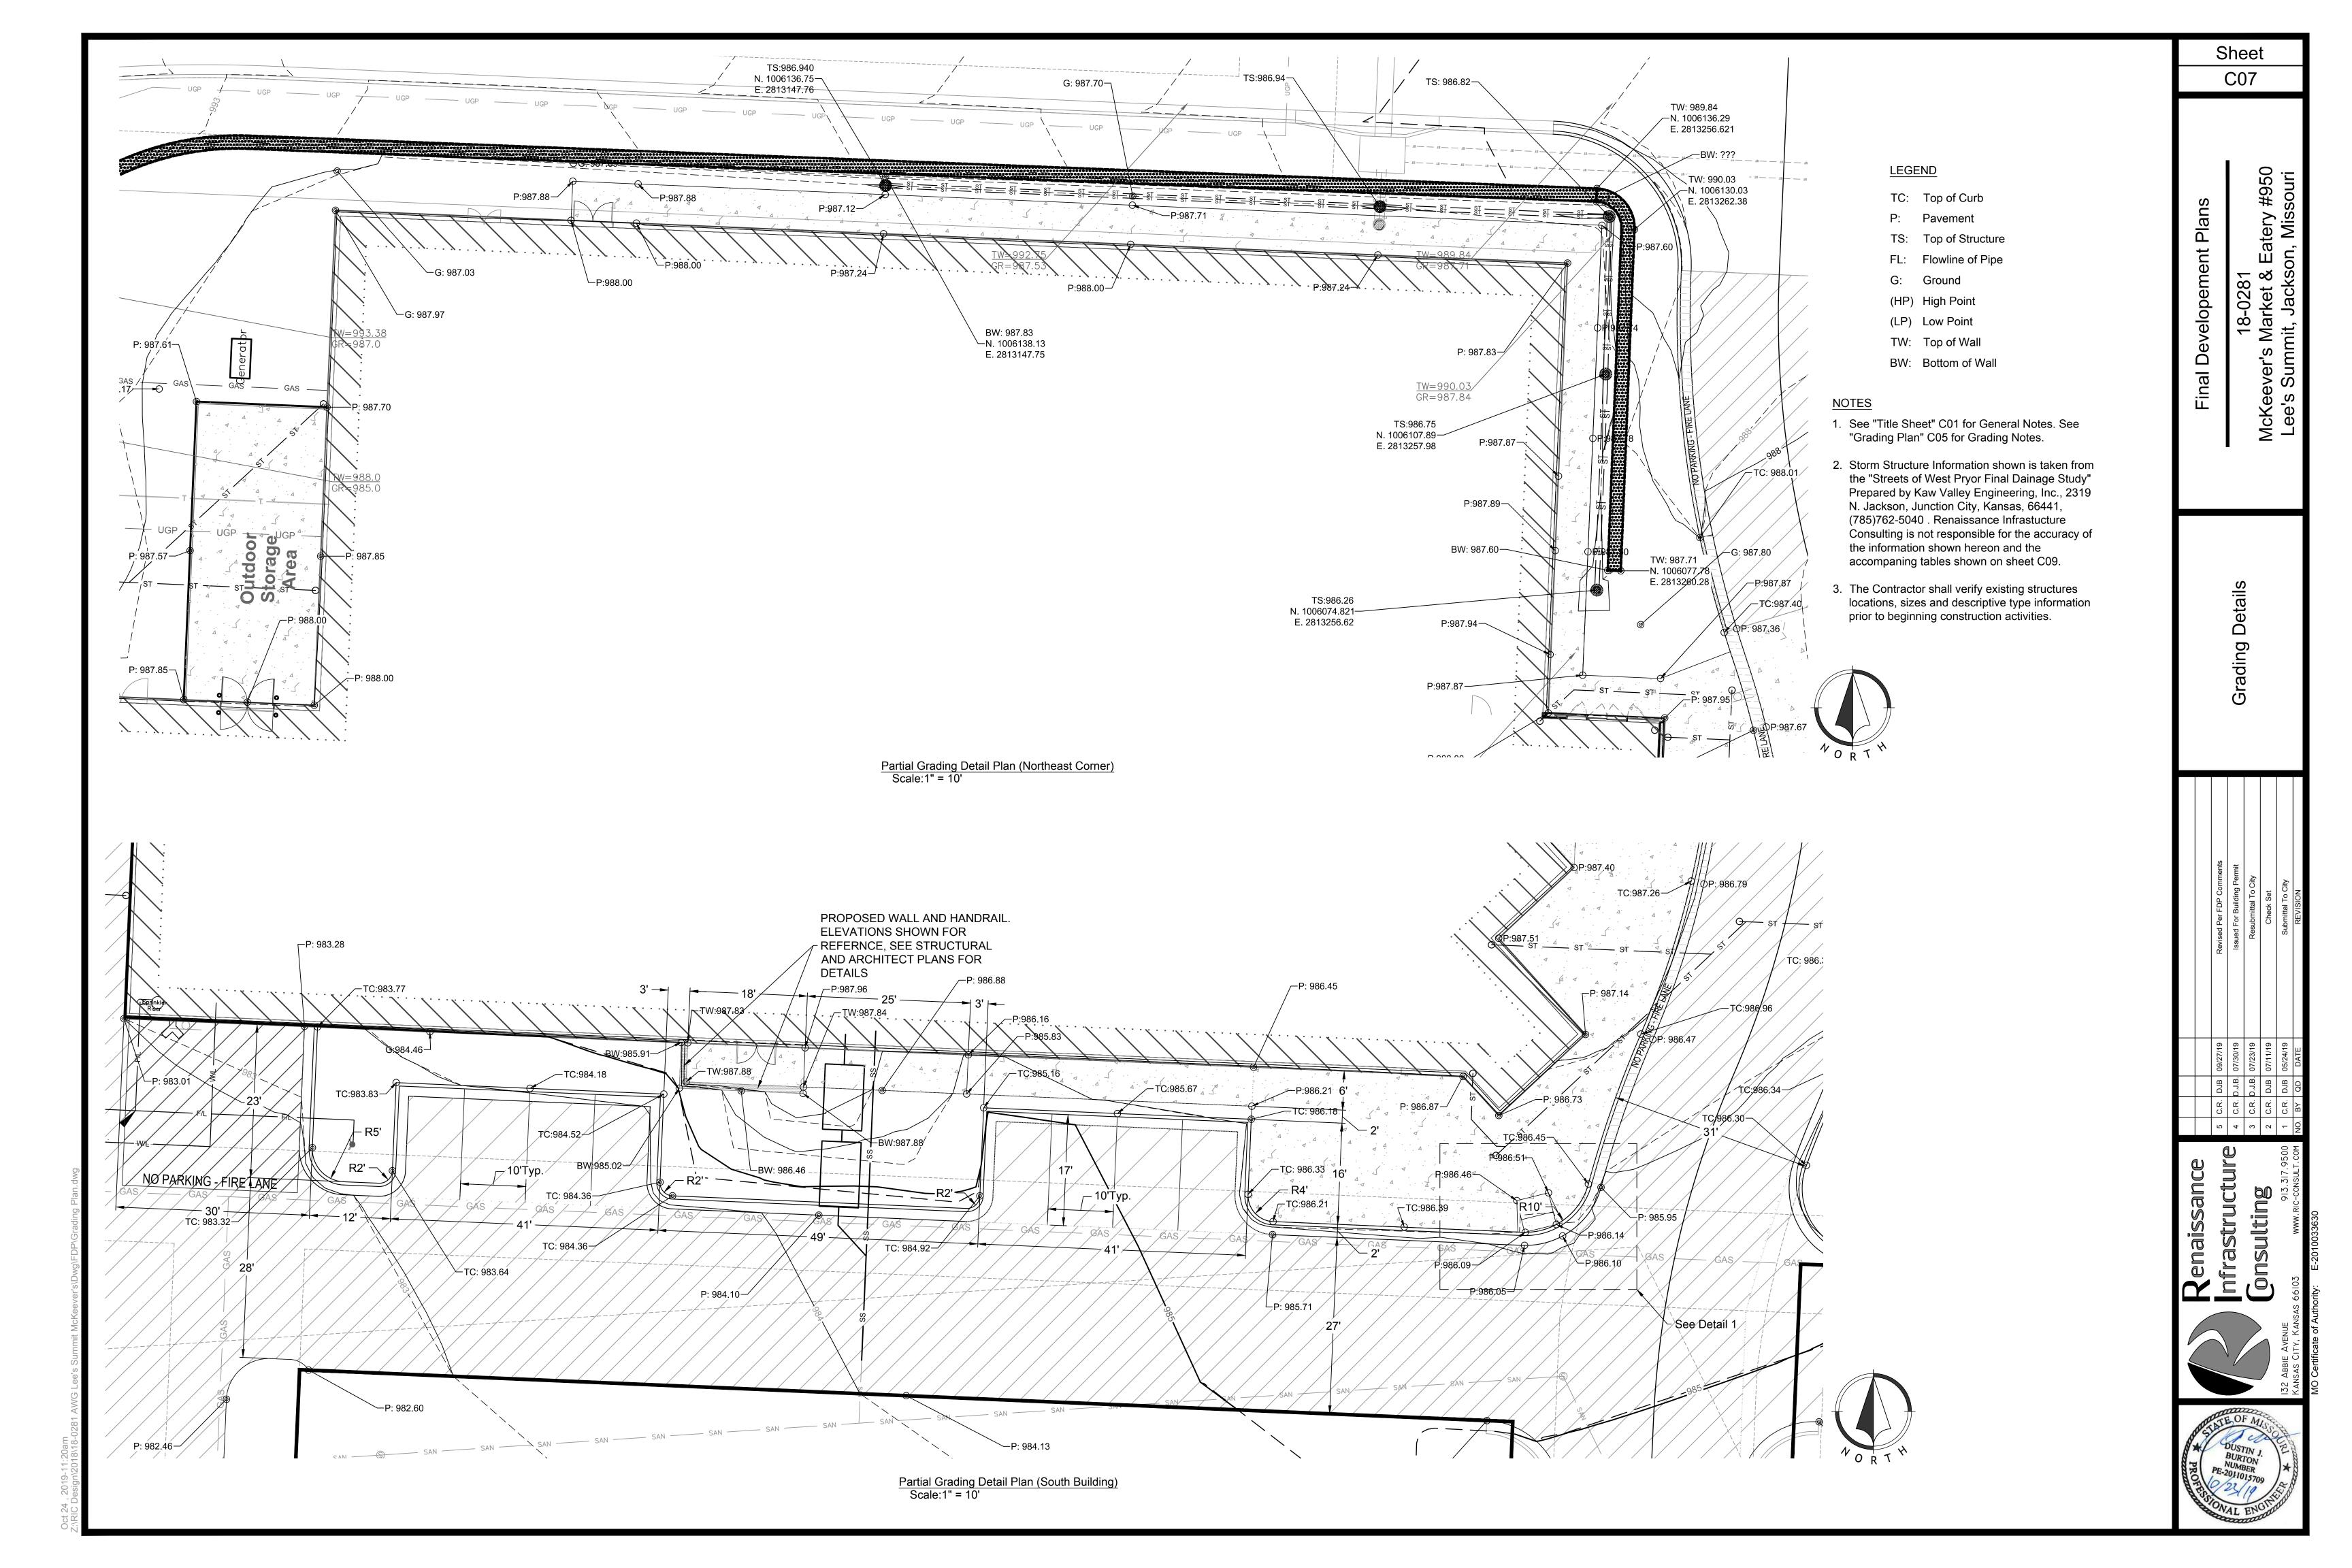

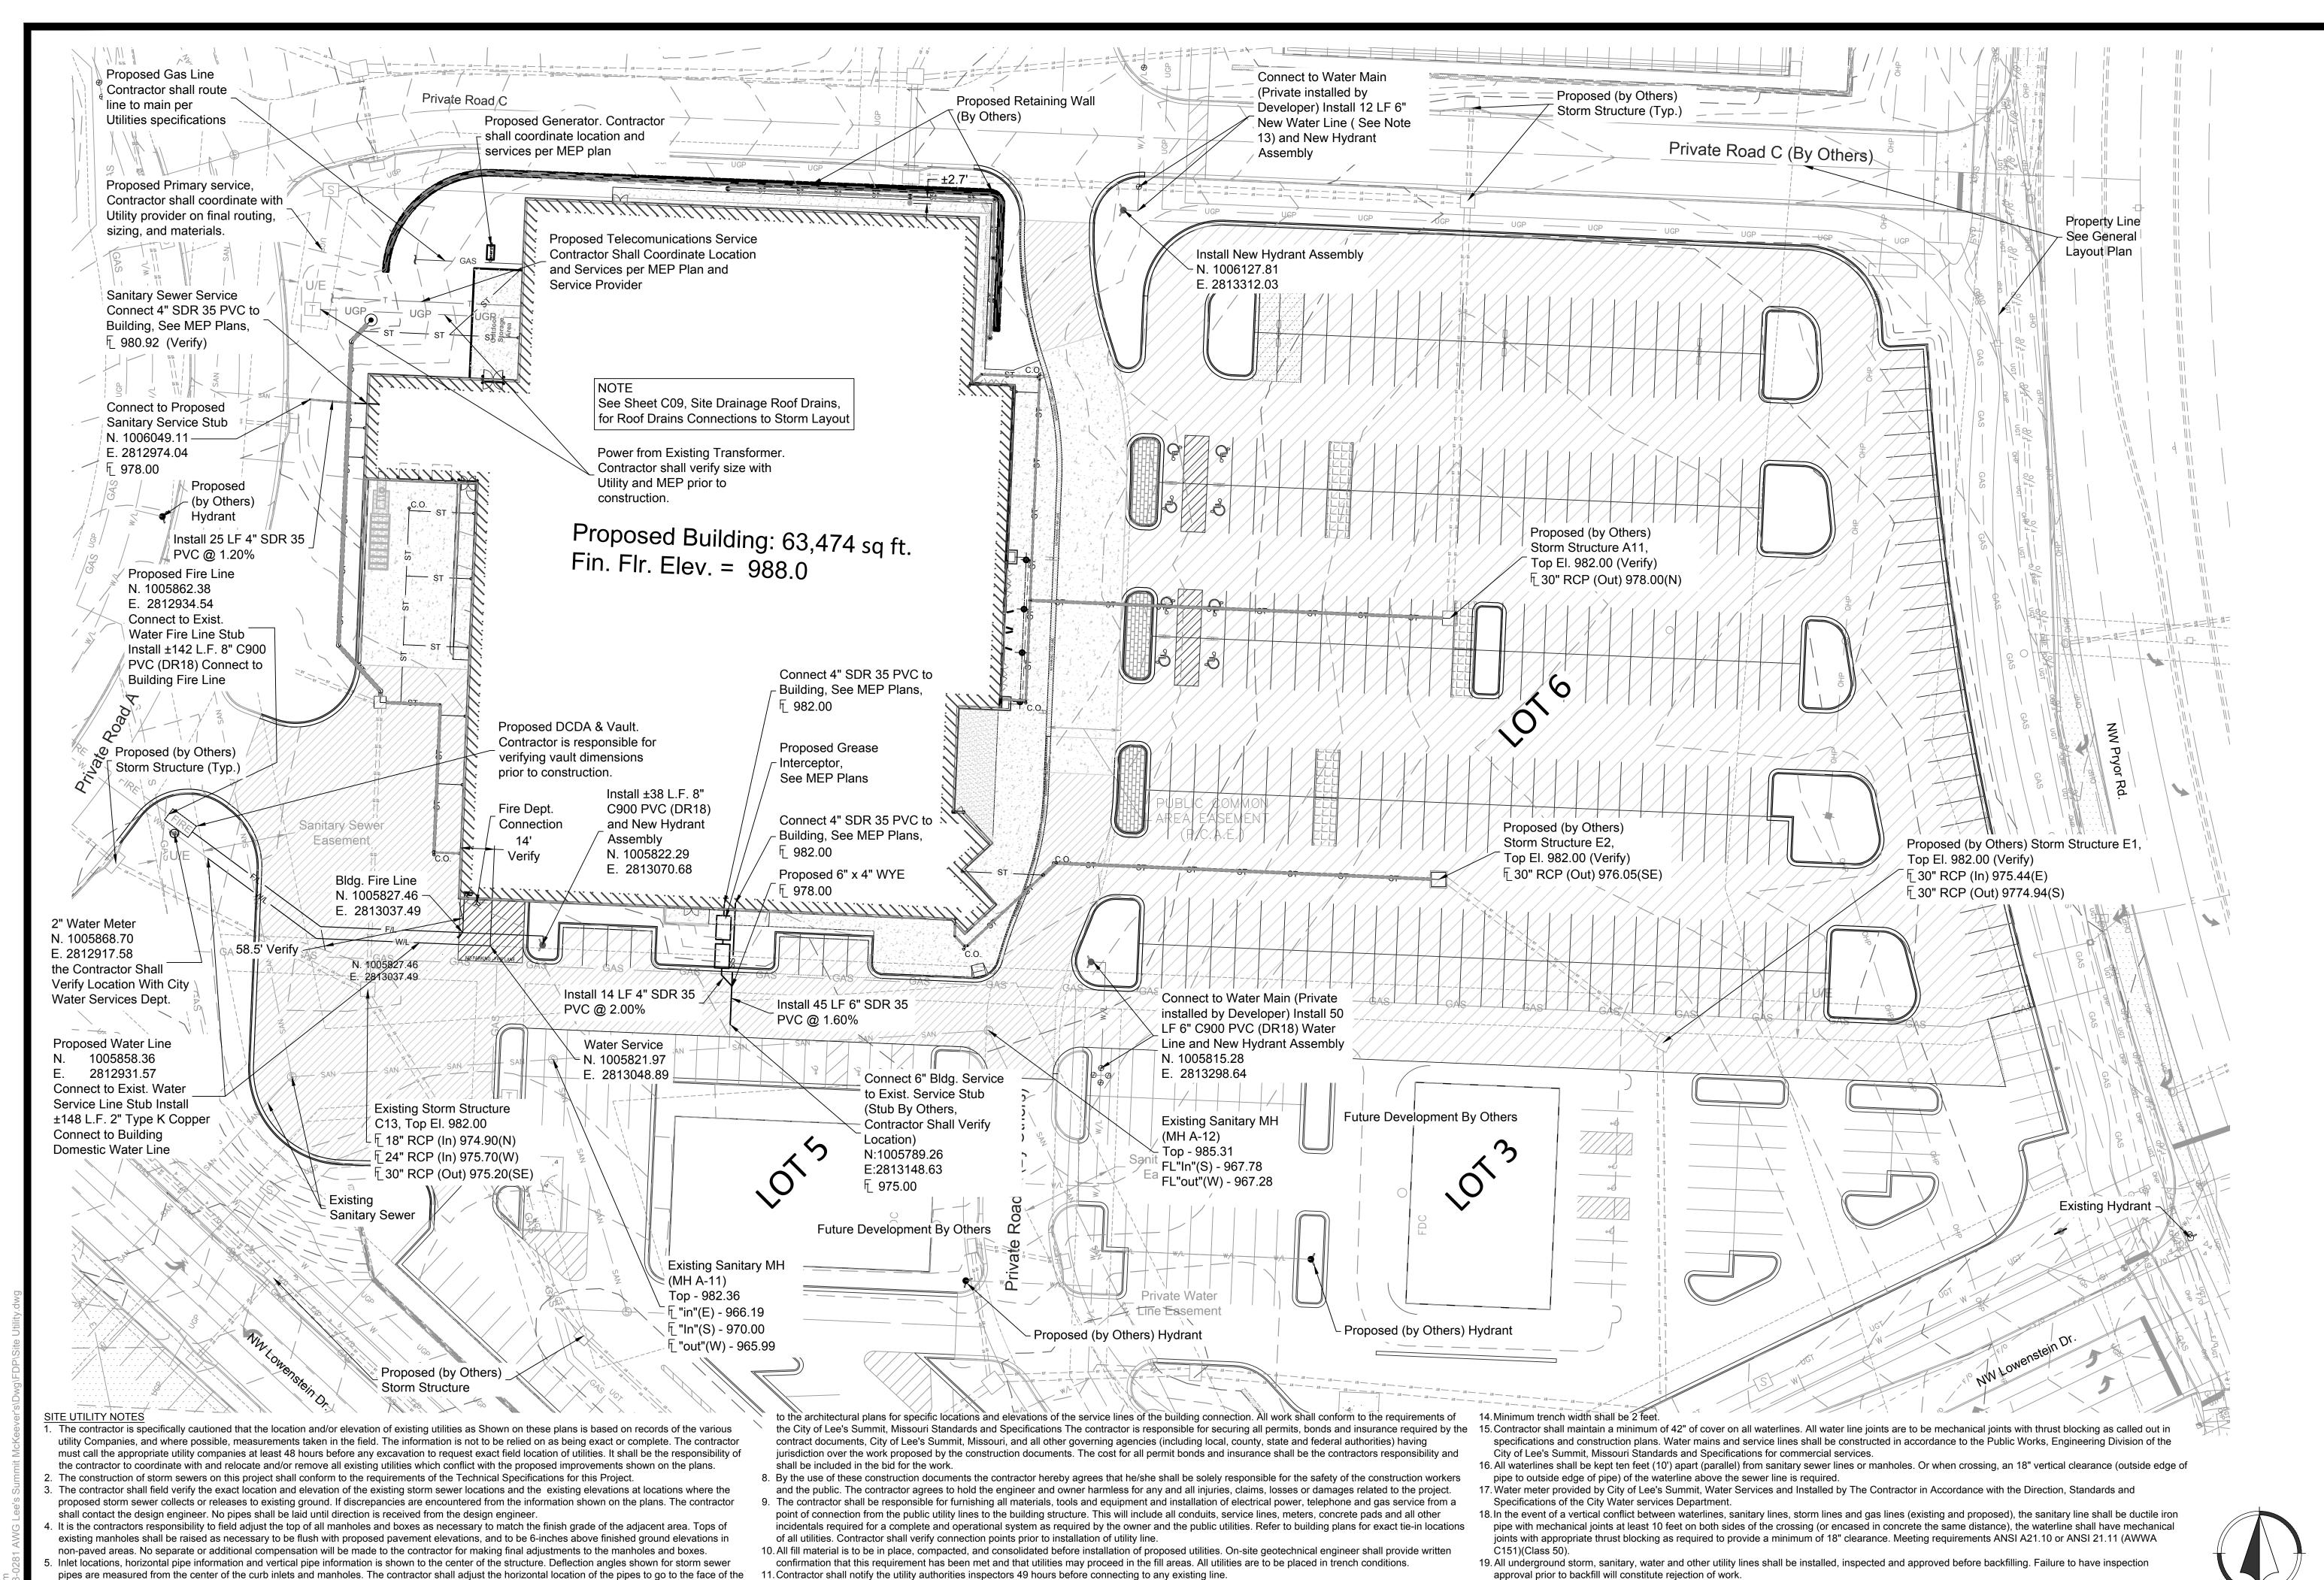

boxes. All roof drains shall be connected to storm sewer structures. Provide cleanouts on roof drain lines at 100' max. spacing and at all bend points. Do not 12. Storm sewer roof drains(st) shall be as follows (unless otherwise shown on plans).

incidentals required for a complete operable fire protection and domestic water system, if not furnished or installed by the Water Utility. The Contractor shall 13. Waterlines shall be as follows (unless otherwise shown on plans):

The contractor shall be responsible for furnishing and installing all fire and domestic water lines, meters, back flow devices, pits, valves and all other

shall conform to the requirements of the City of Lee's Summit, Missouri Standards and Specifications

Coordinate with the Water Utility. All costs associated with the complete water system for the building shall be the responsibility of the contractor. All work

The contractor shall be responsible for furnishing and installing all sanitary sewer service lines from the building to the public line. The contractor shall refer

-PVC SDR 35 per ASTM D3034, for pipes less than 12' deep.

-PVC SDR 26 per ASTM D3034, for pipes 12' to 20' deep.

-For smaller than 2":copper tube Type "K" per ANSI 816.22

-for 8" and larger: ductile iron pipe per AWWA C150

-between 3" and 6": DR14 PVC per AWWA C900

connect roof drains directly to storm sewer pipes.

Sheet C08

<u>~</u> ≪





0 15' 30


20. All necessary inspections and/or certifications required by codes and/or utility service companies shall be performed prior to announced building possession

21.Refer to building plans for site lighting electrical plan, irrigation, parking lot security system and associated conduit requirements. Coordinate with Owner

22. When a building utility Connection from site utilities leading up to the building cannot be made immediately, temporarily mark all such utility terminations.

and the final connection of service. Contractor shall coordinate with all utility companies for installation requirements and specifications.


that all required conduits are in place and tested prior to paving.

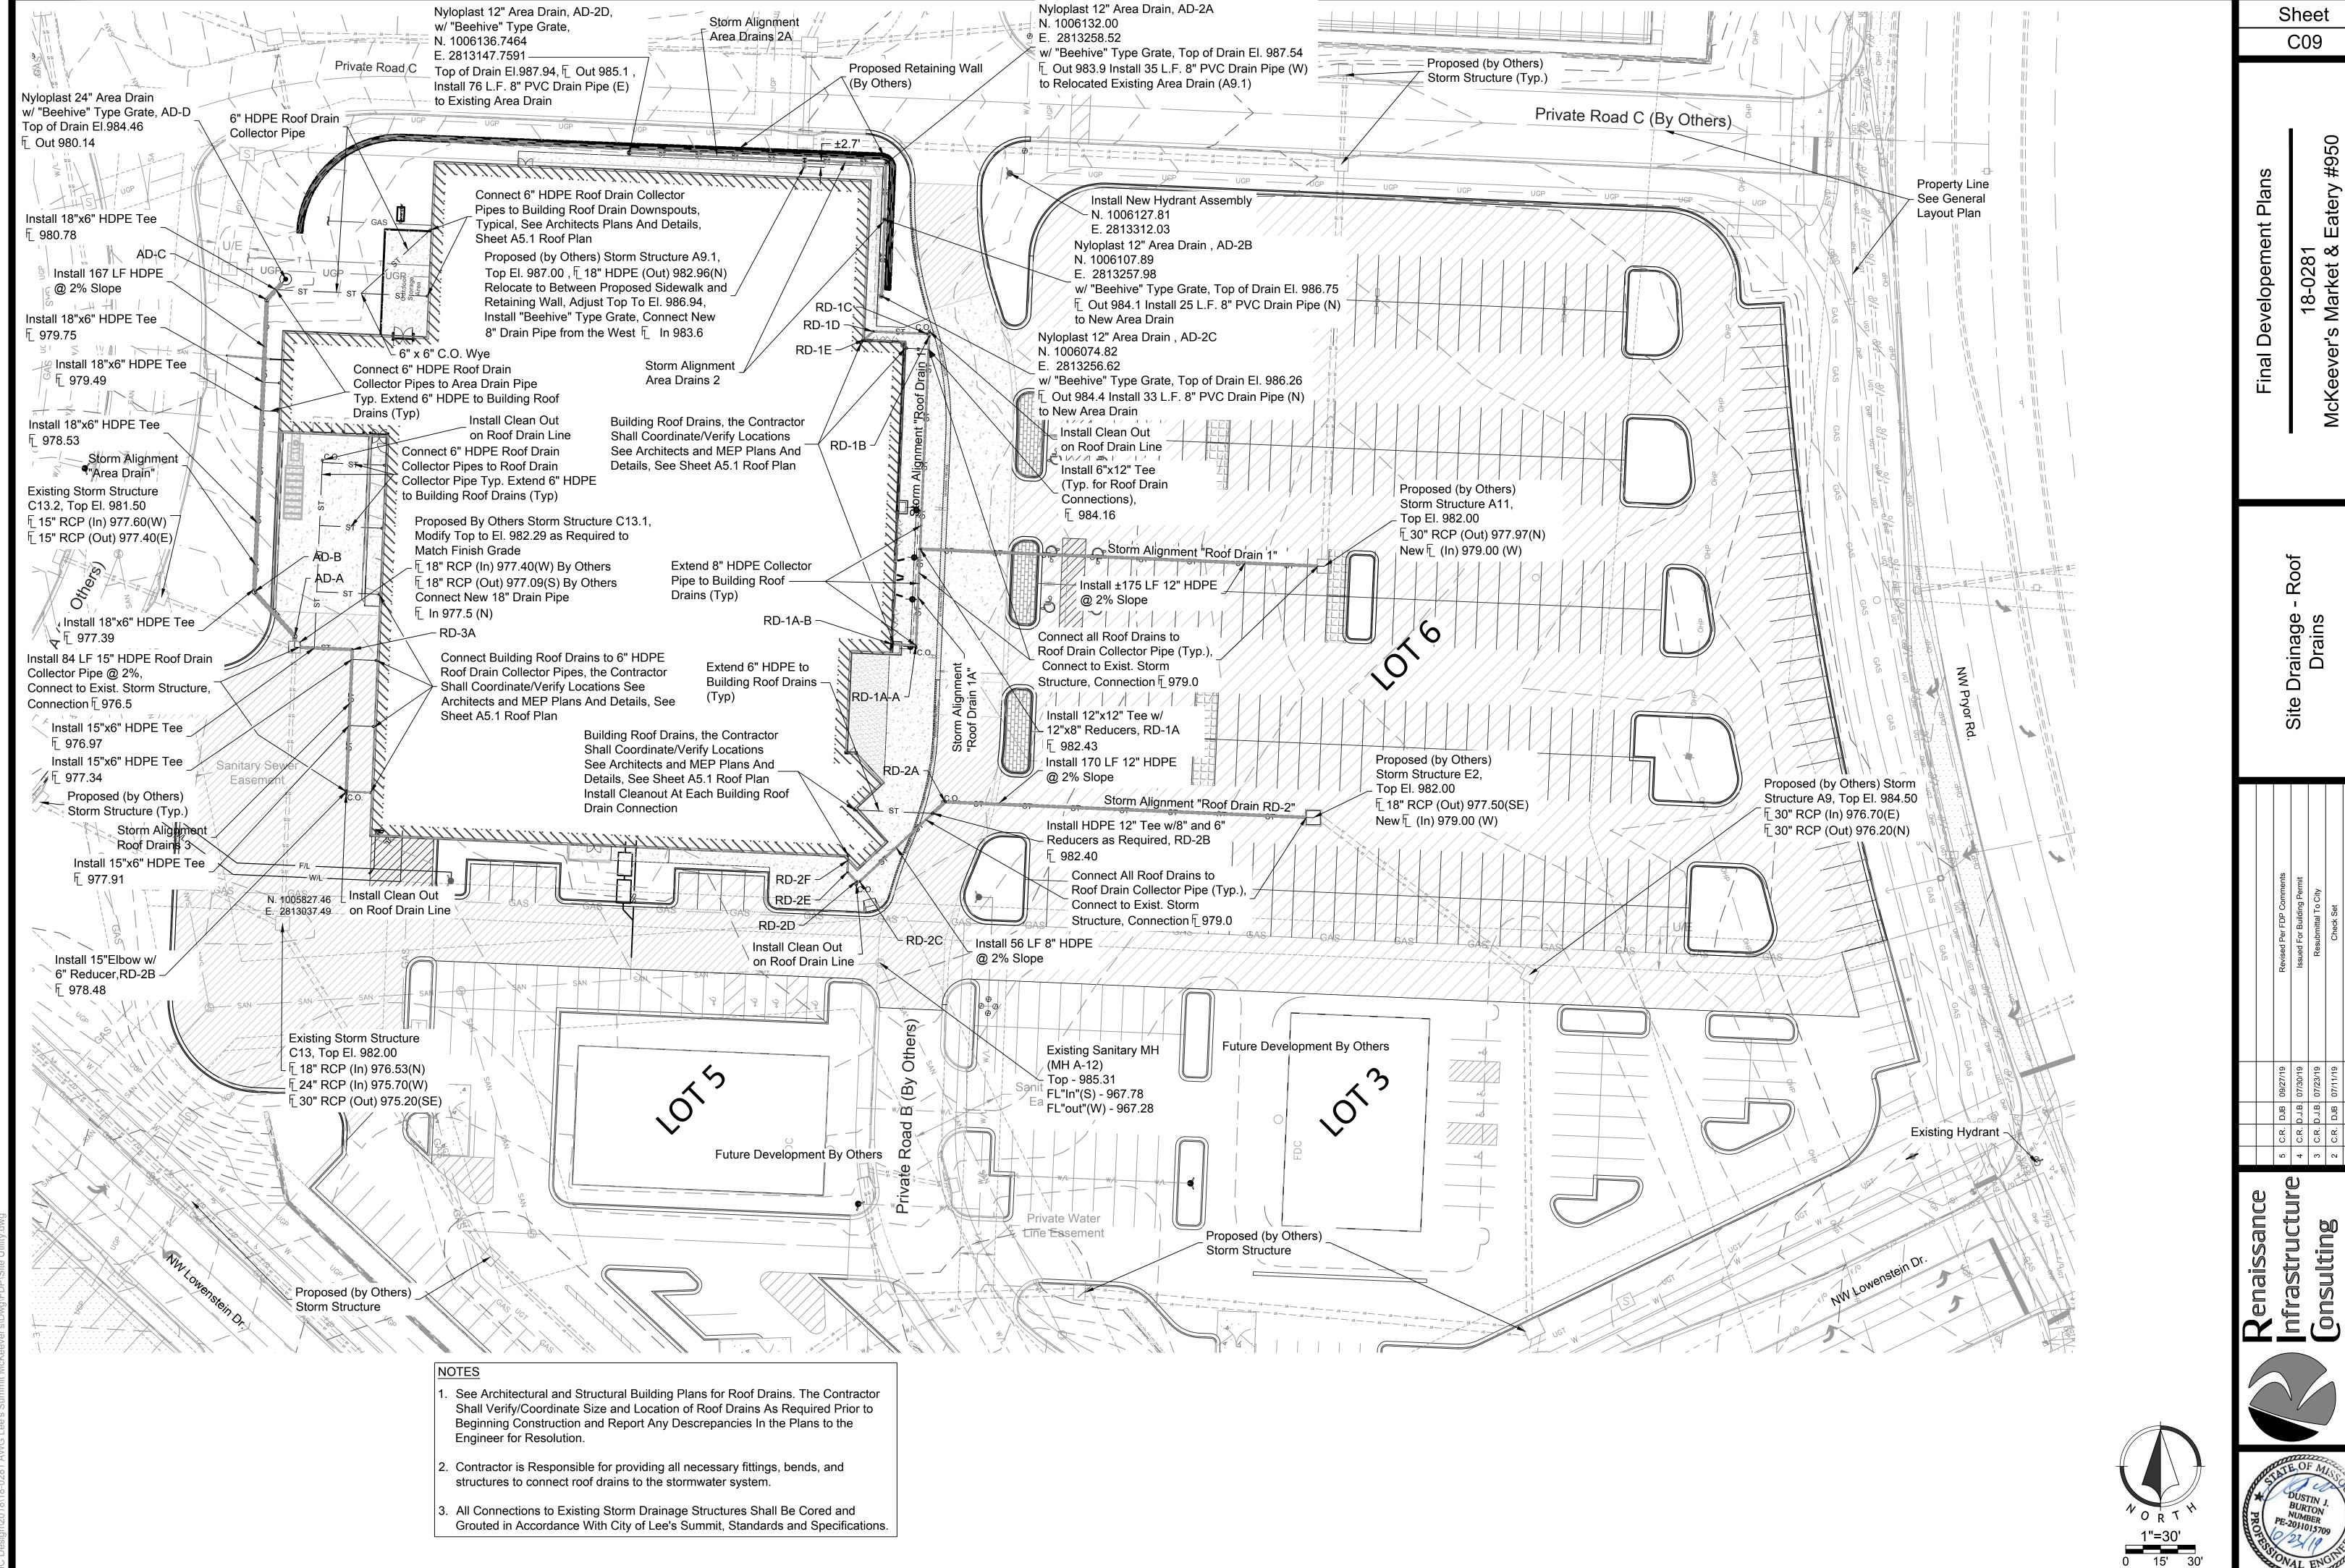


√ ∞






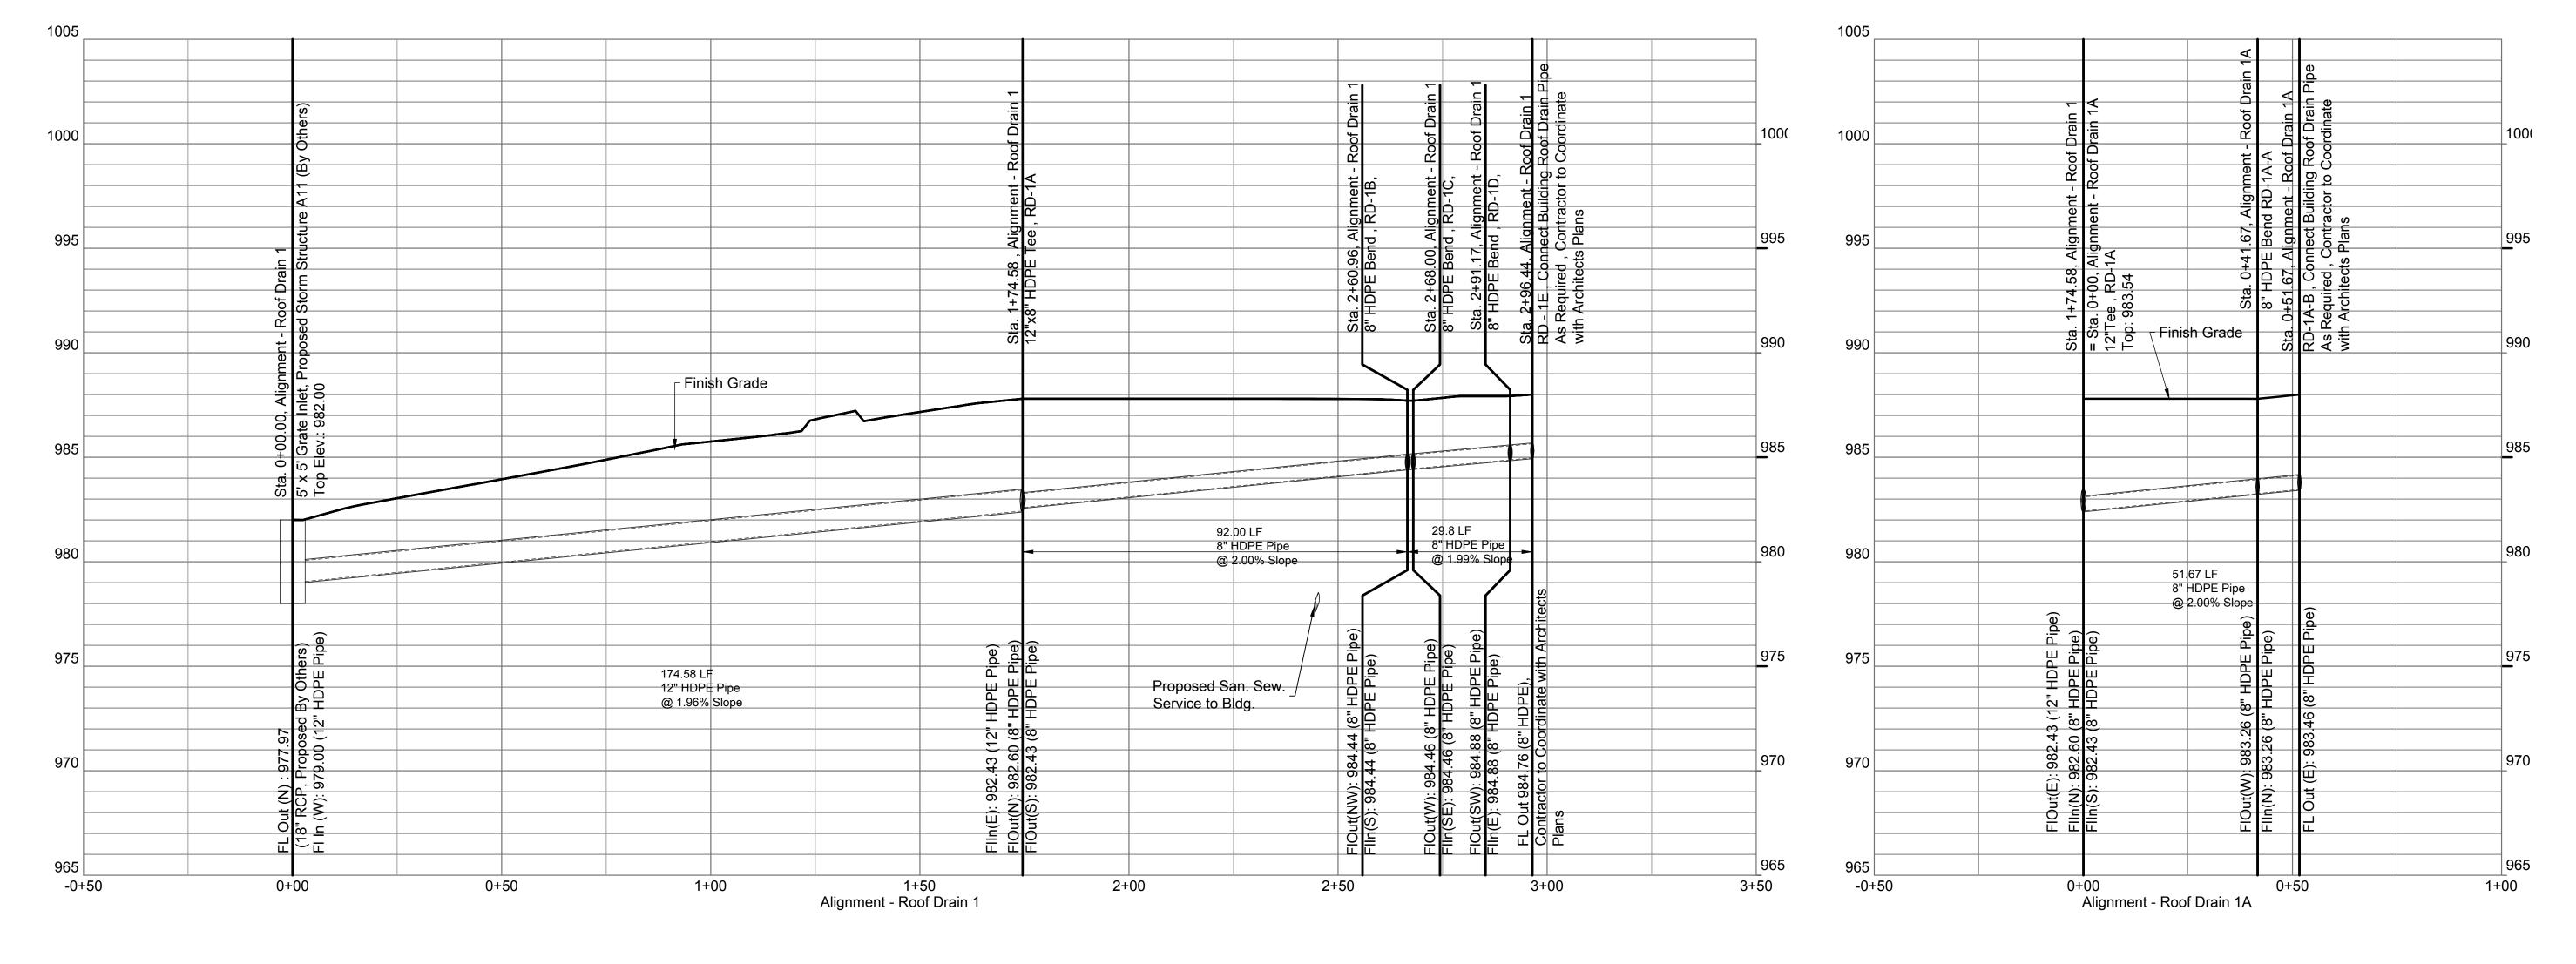

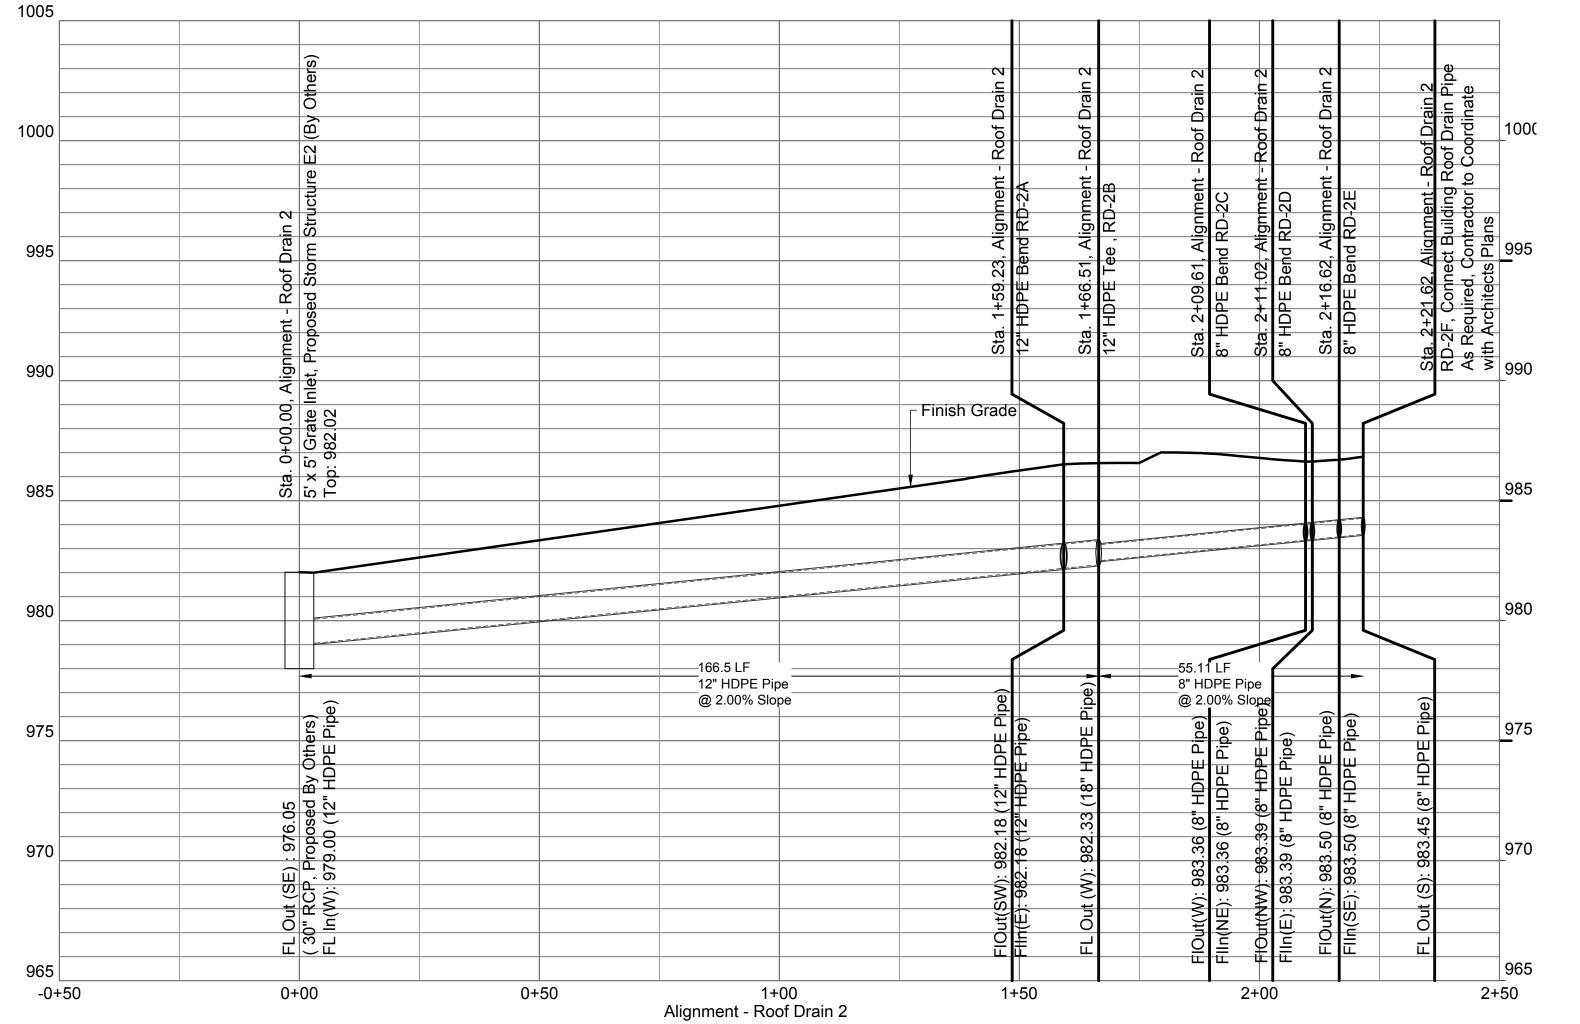

NOTES

- See Architectural and Structural Building Plans for Roof Drains. The Contractor Shall Verify/Coordinate Size and Location of Roof Drains As Required Prior to Beginning Construction and Report Any Descrepancies In the Plans to the Engineer for Resolution.
- 2. Contractor is Responsible for providing all necessary fittings, bends, and structures to connect roof drains to the stormwater system.
- 3. All Connections to Existing Storm Drainage Structures Shall Be Cored and Grouted in Accordance With City of Lee's Summit, Standards and Specifications.




Sheet


C10


18-0281 Market & mit, Jackso

Final


Site Drainage - Roof Drains Profiles

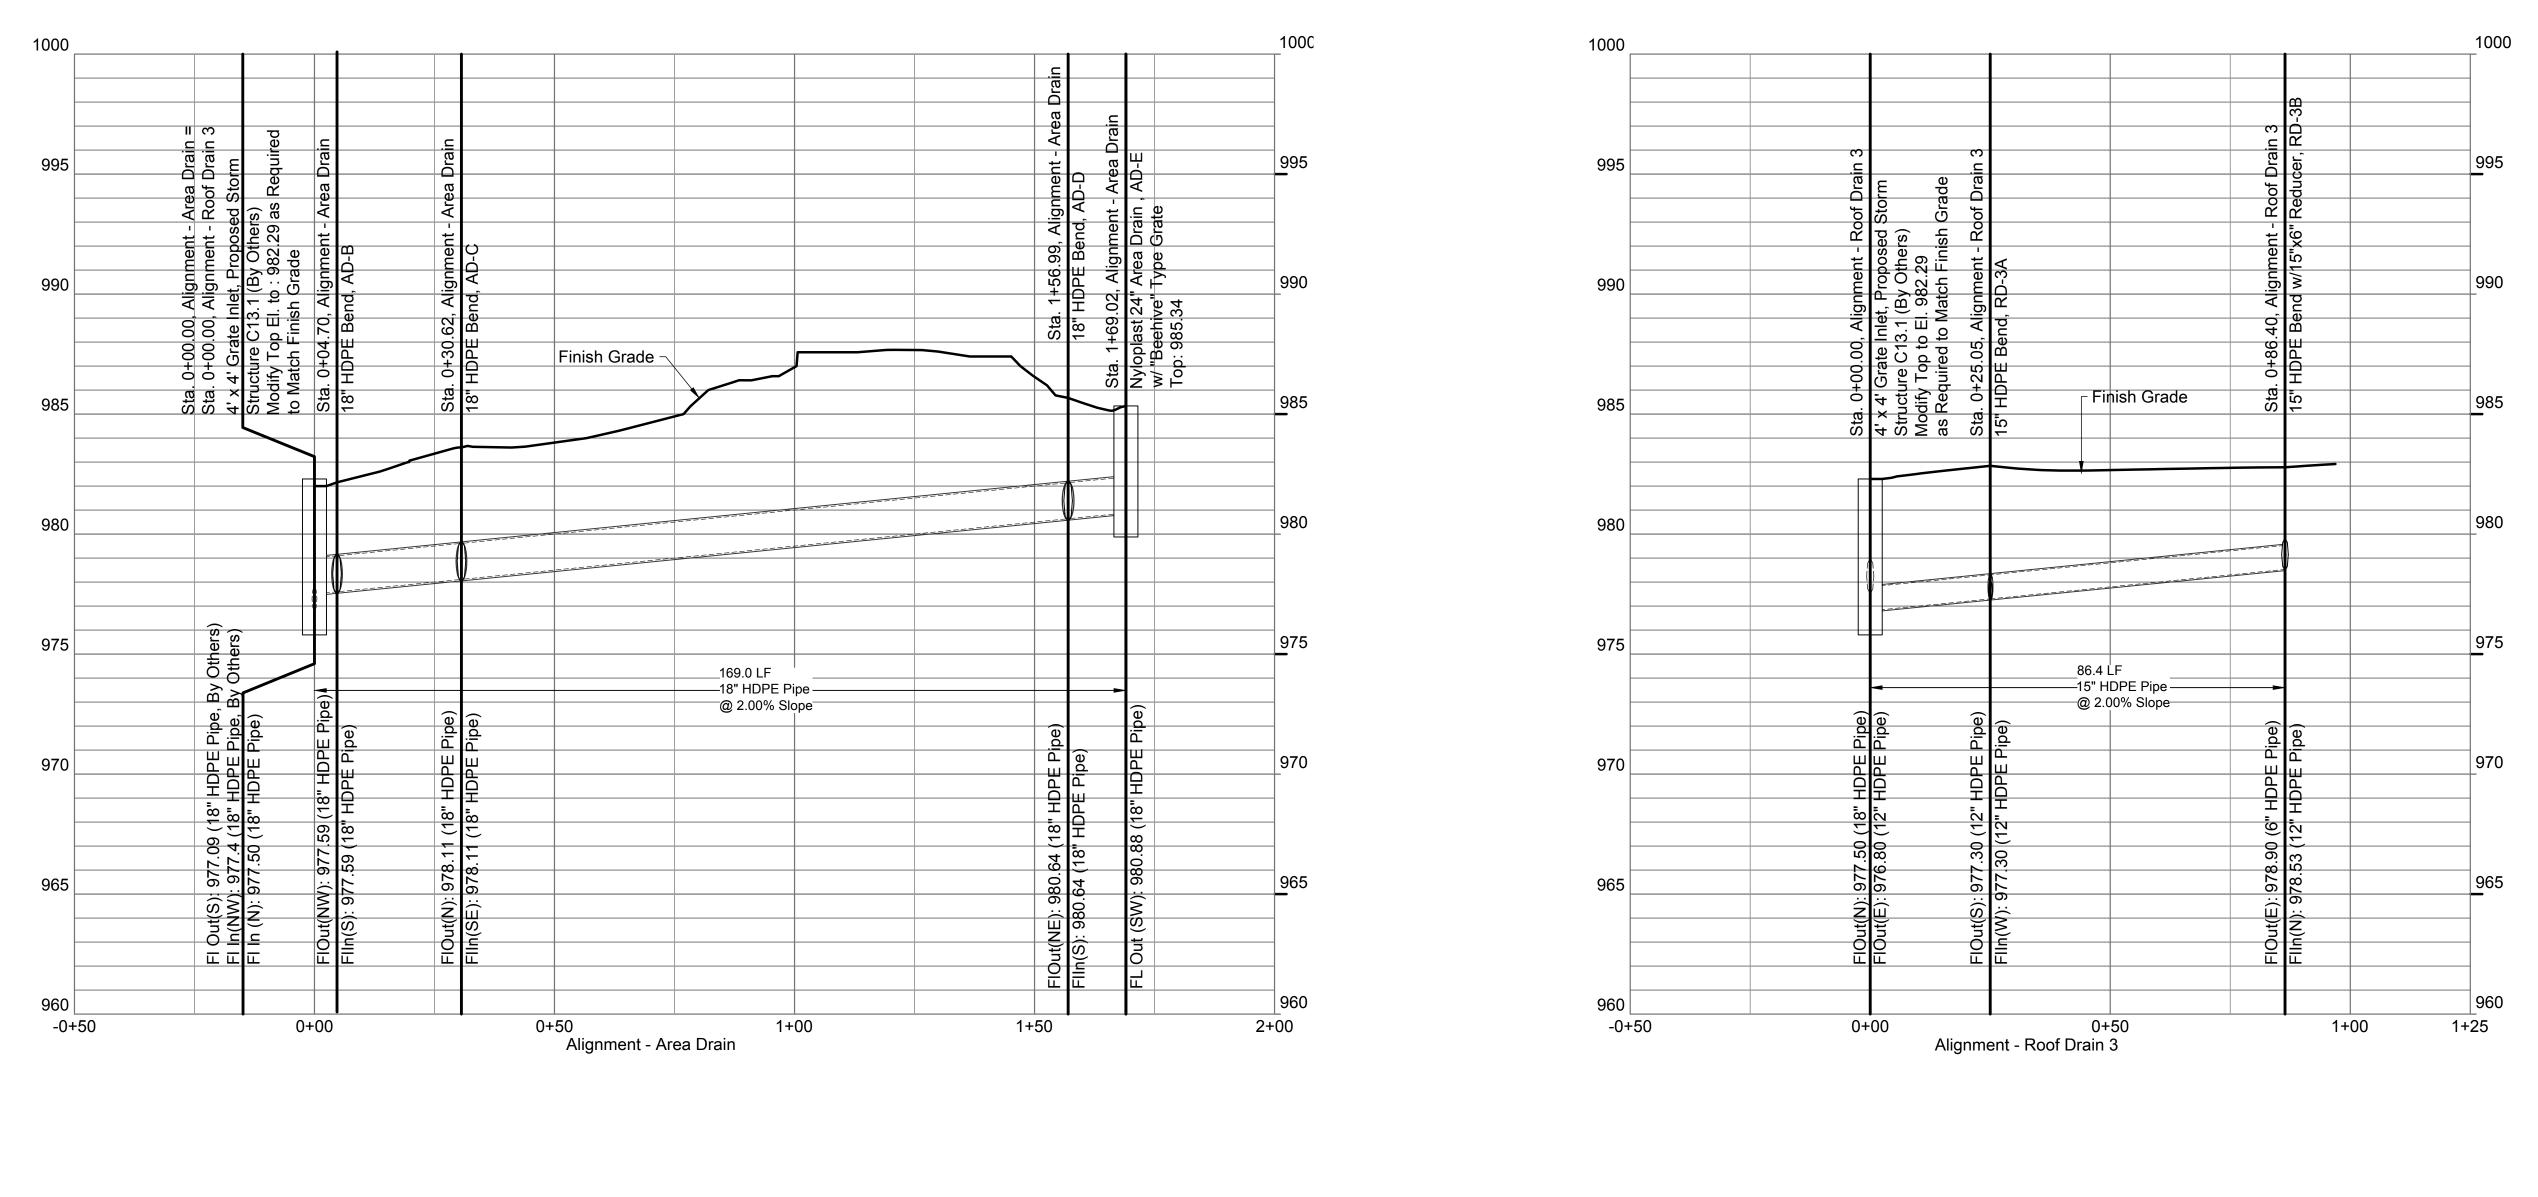

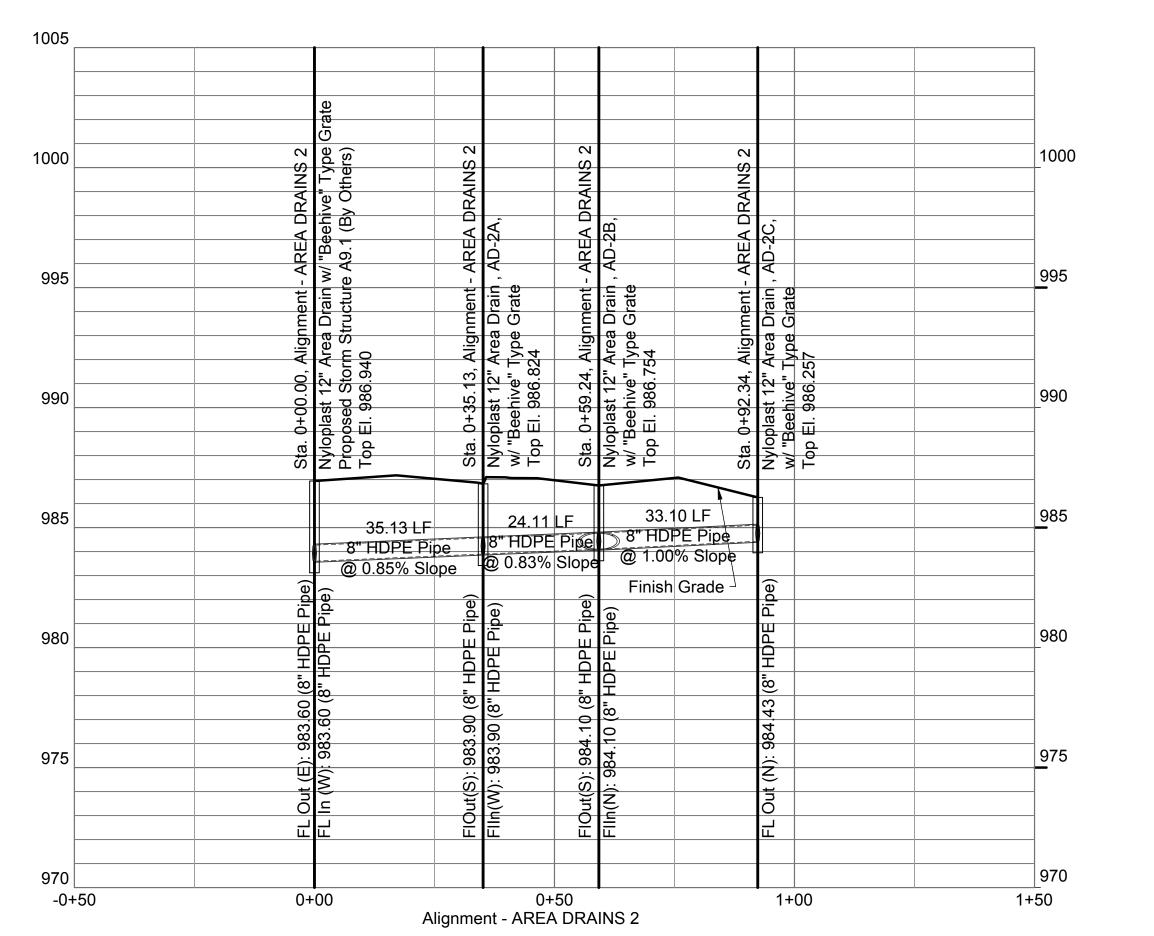

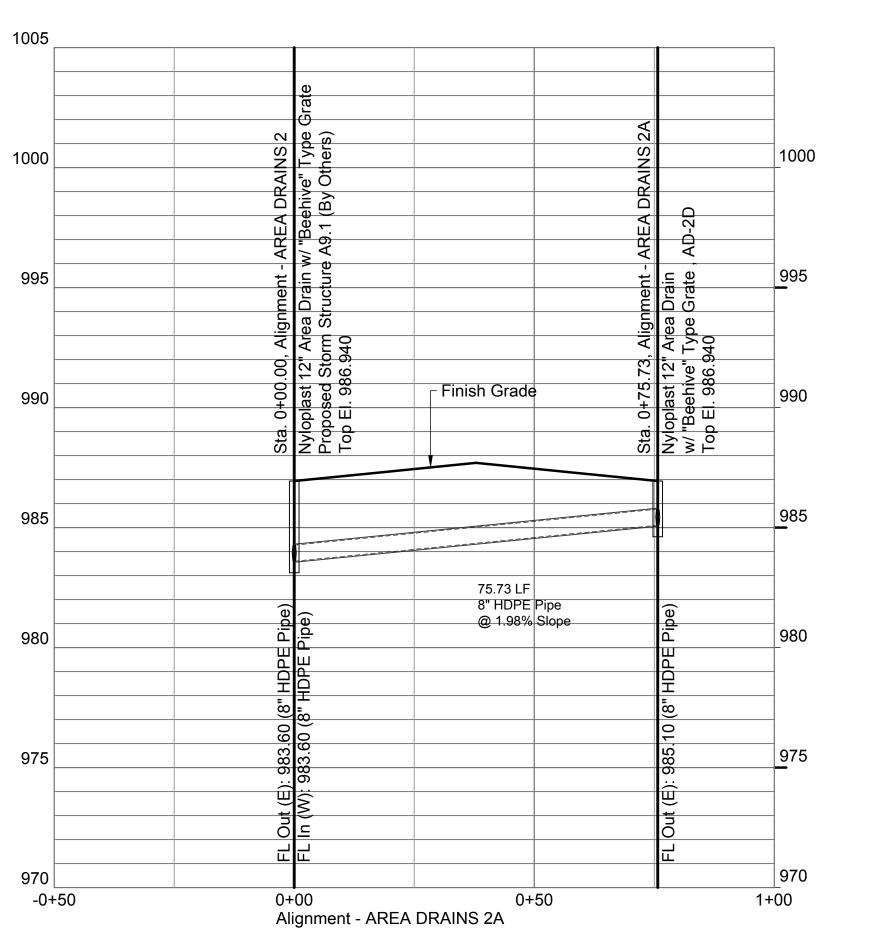

- . See Architectural and Structural Building Plans for Roof Drains. The Contractor Shall Verify/Coordinate Size and Location of Roof Drains As Required Prior to Beginning Construction and Report Any Descrepancies In the Plans to the Engineer for Resolution.
- 2. Contractor is Responsible for providing all necessary fittings, bends, and structures to connect roof drains to the stormwater system.
- 3. All Connections to Existing Storm Drainage Structures Shall Be Cored and Grouted in Accordance With City of Lee's Summit, Standards and Specifications.




Sheet

18-0281 McKeever's Market & E Lee's Summit, Jackso

Site Drainage - Roof Drains Profiles



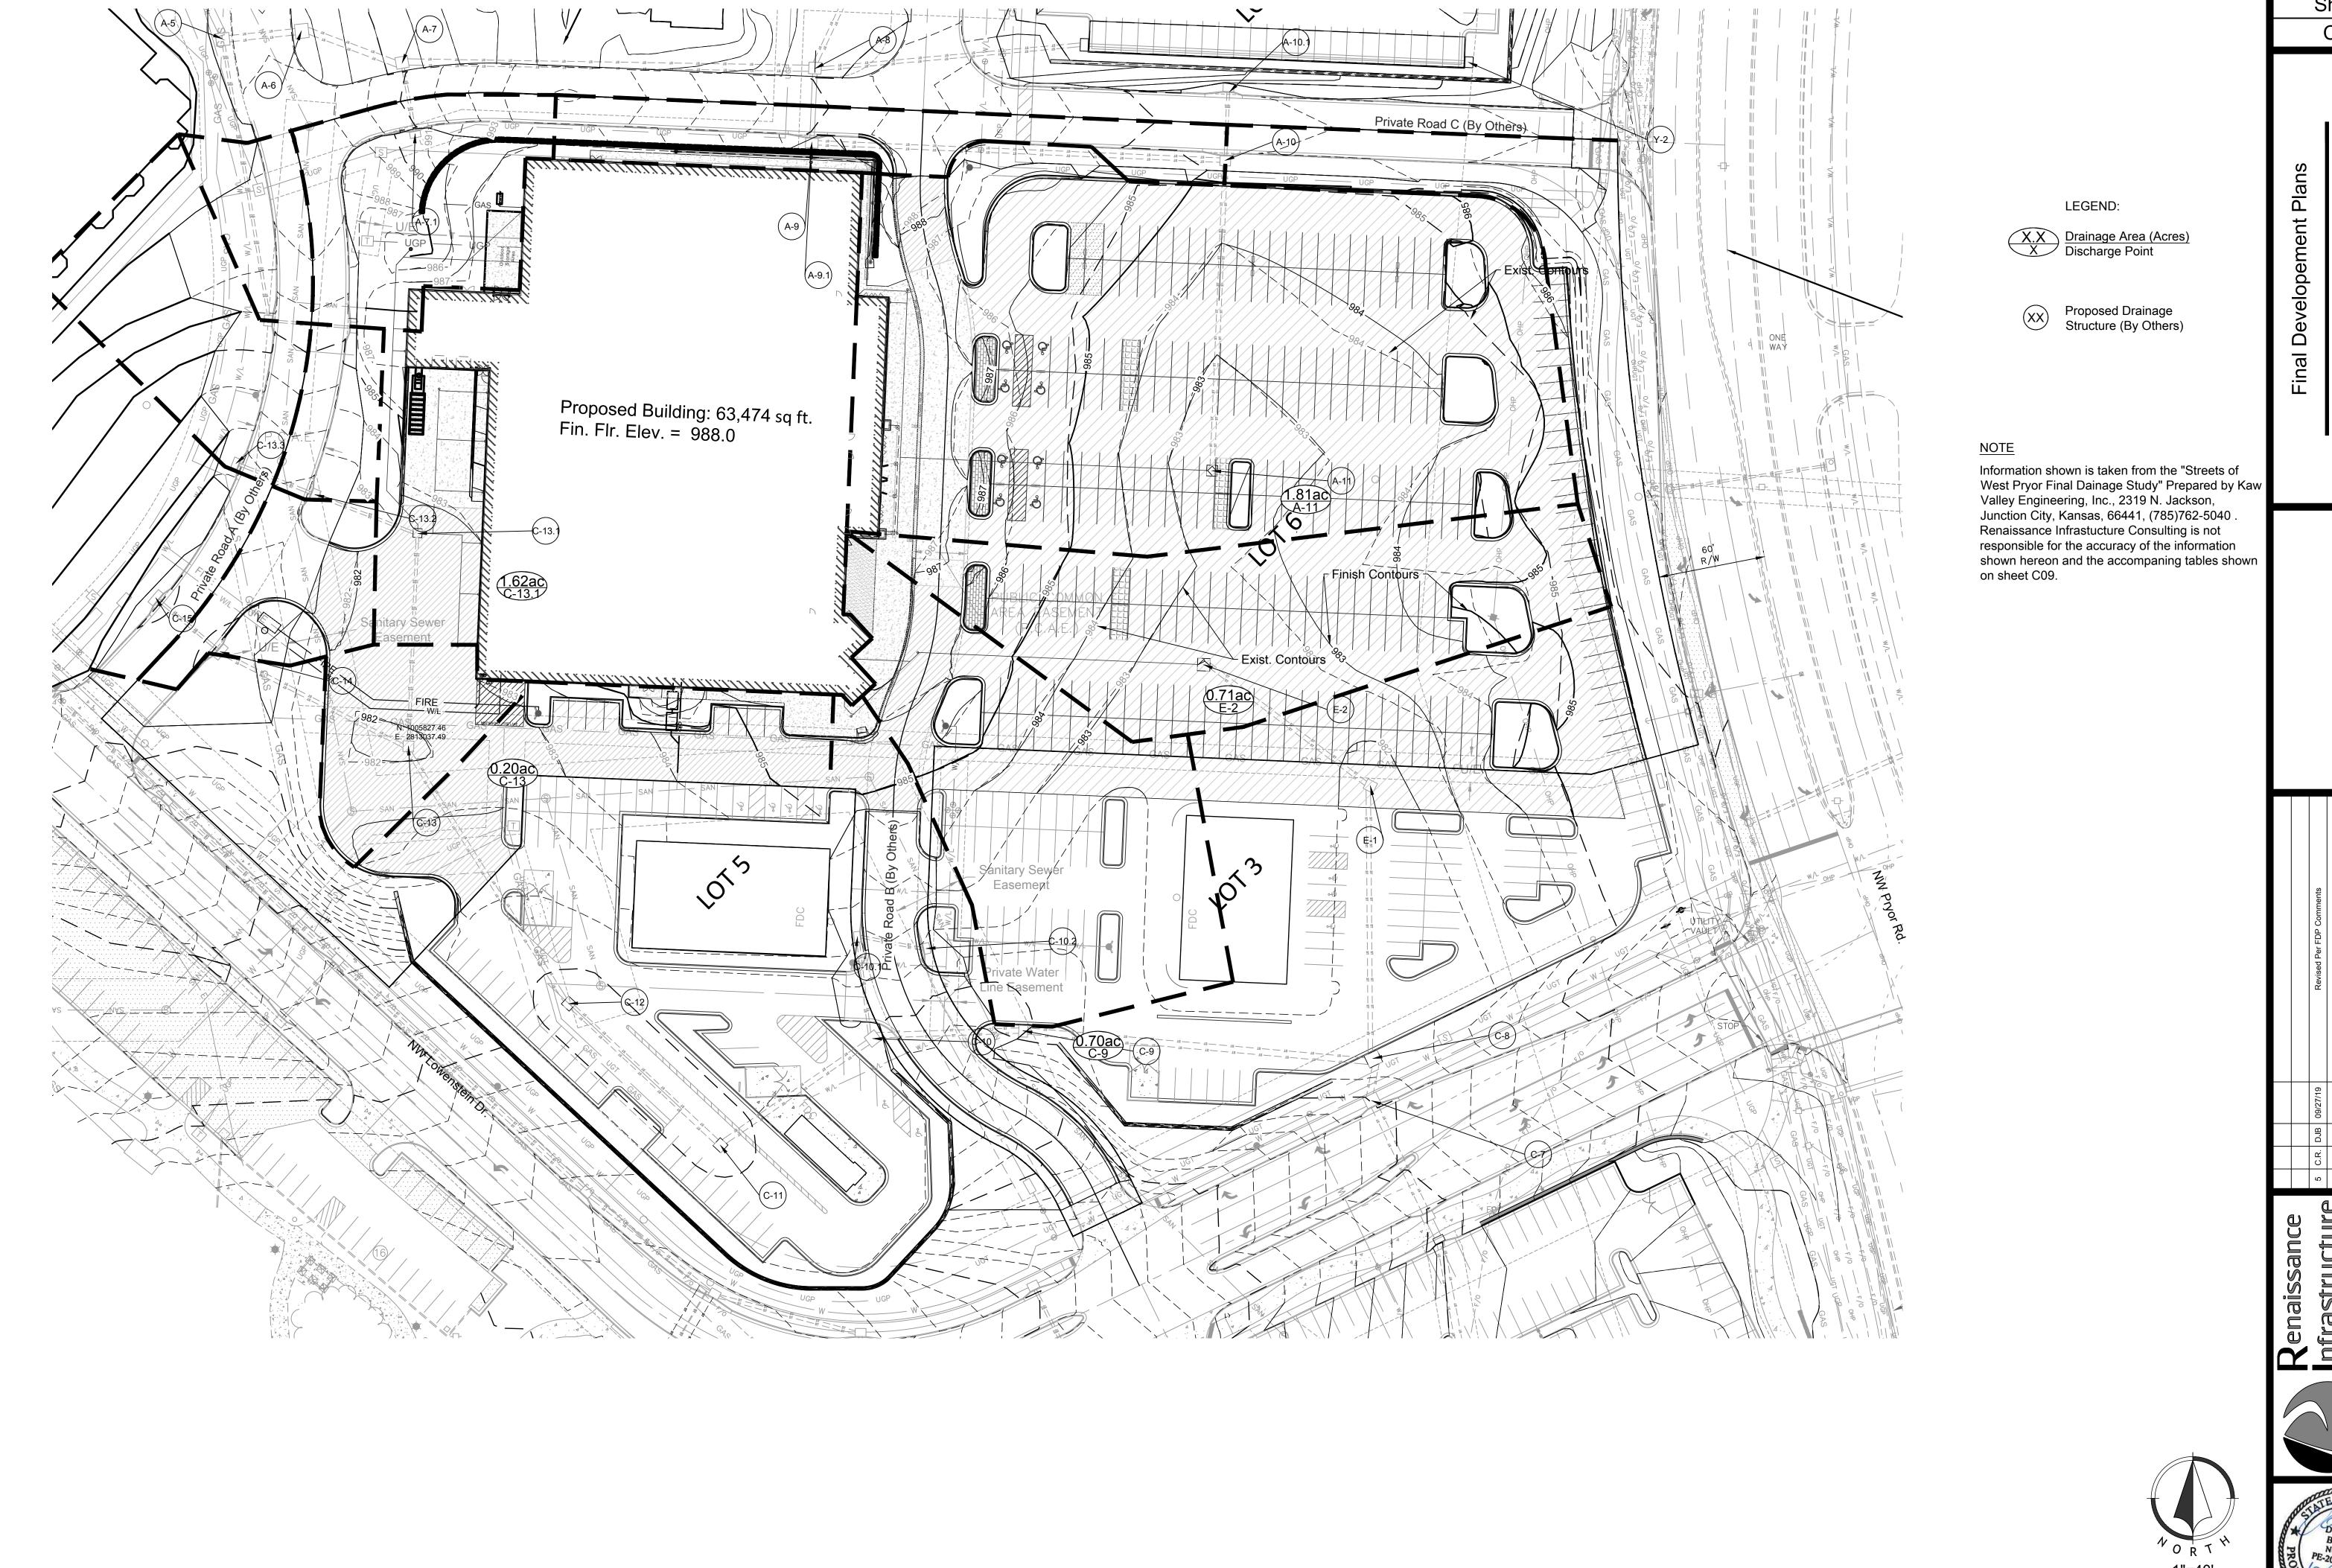


Sheet

C12





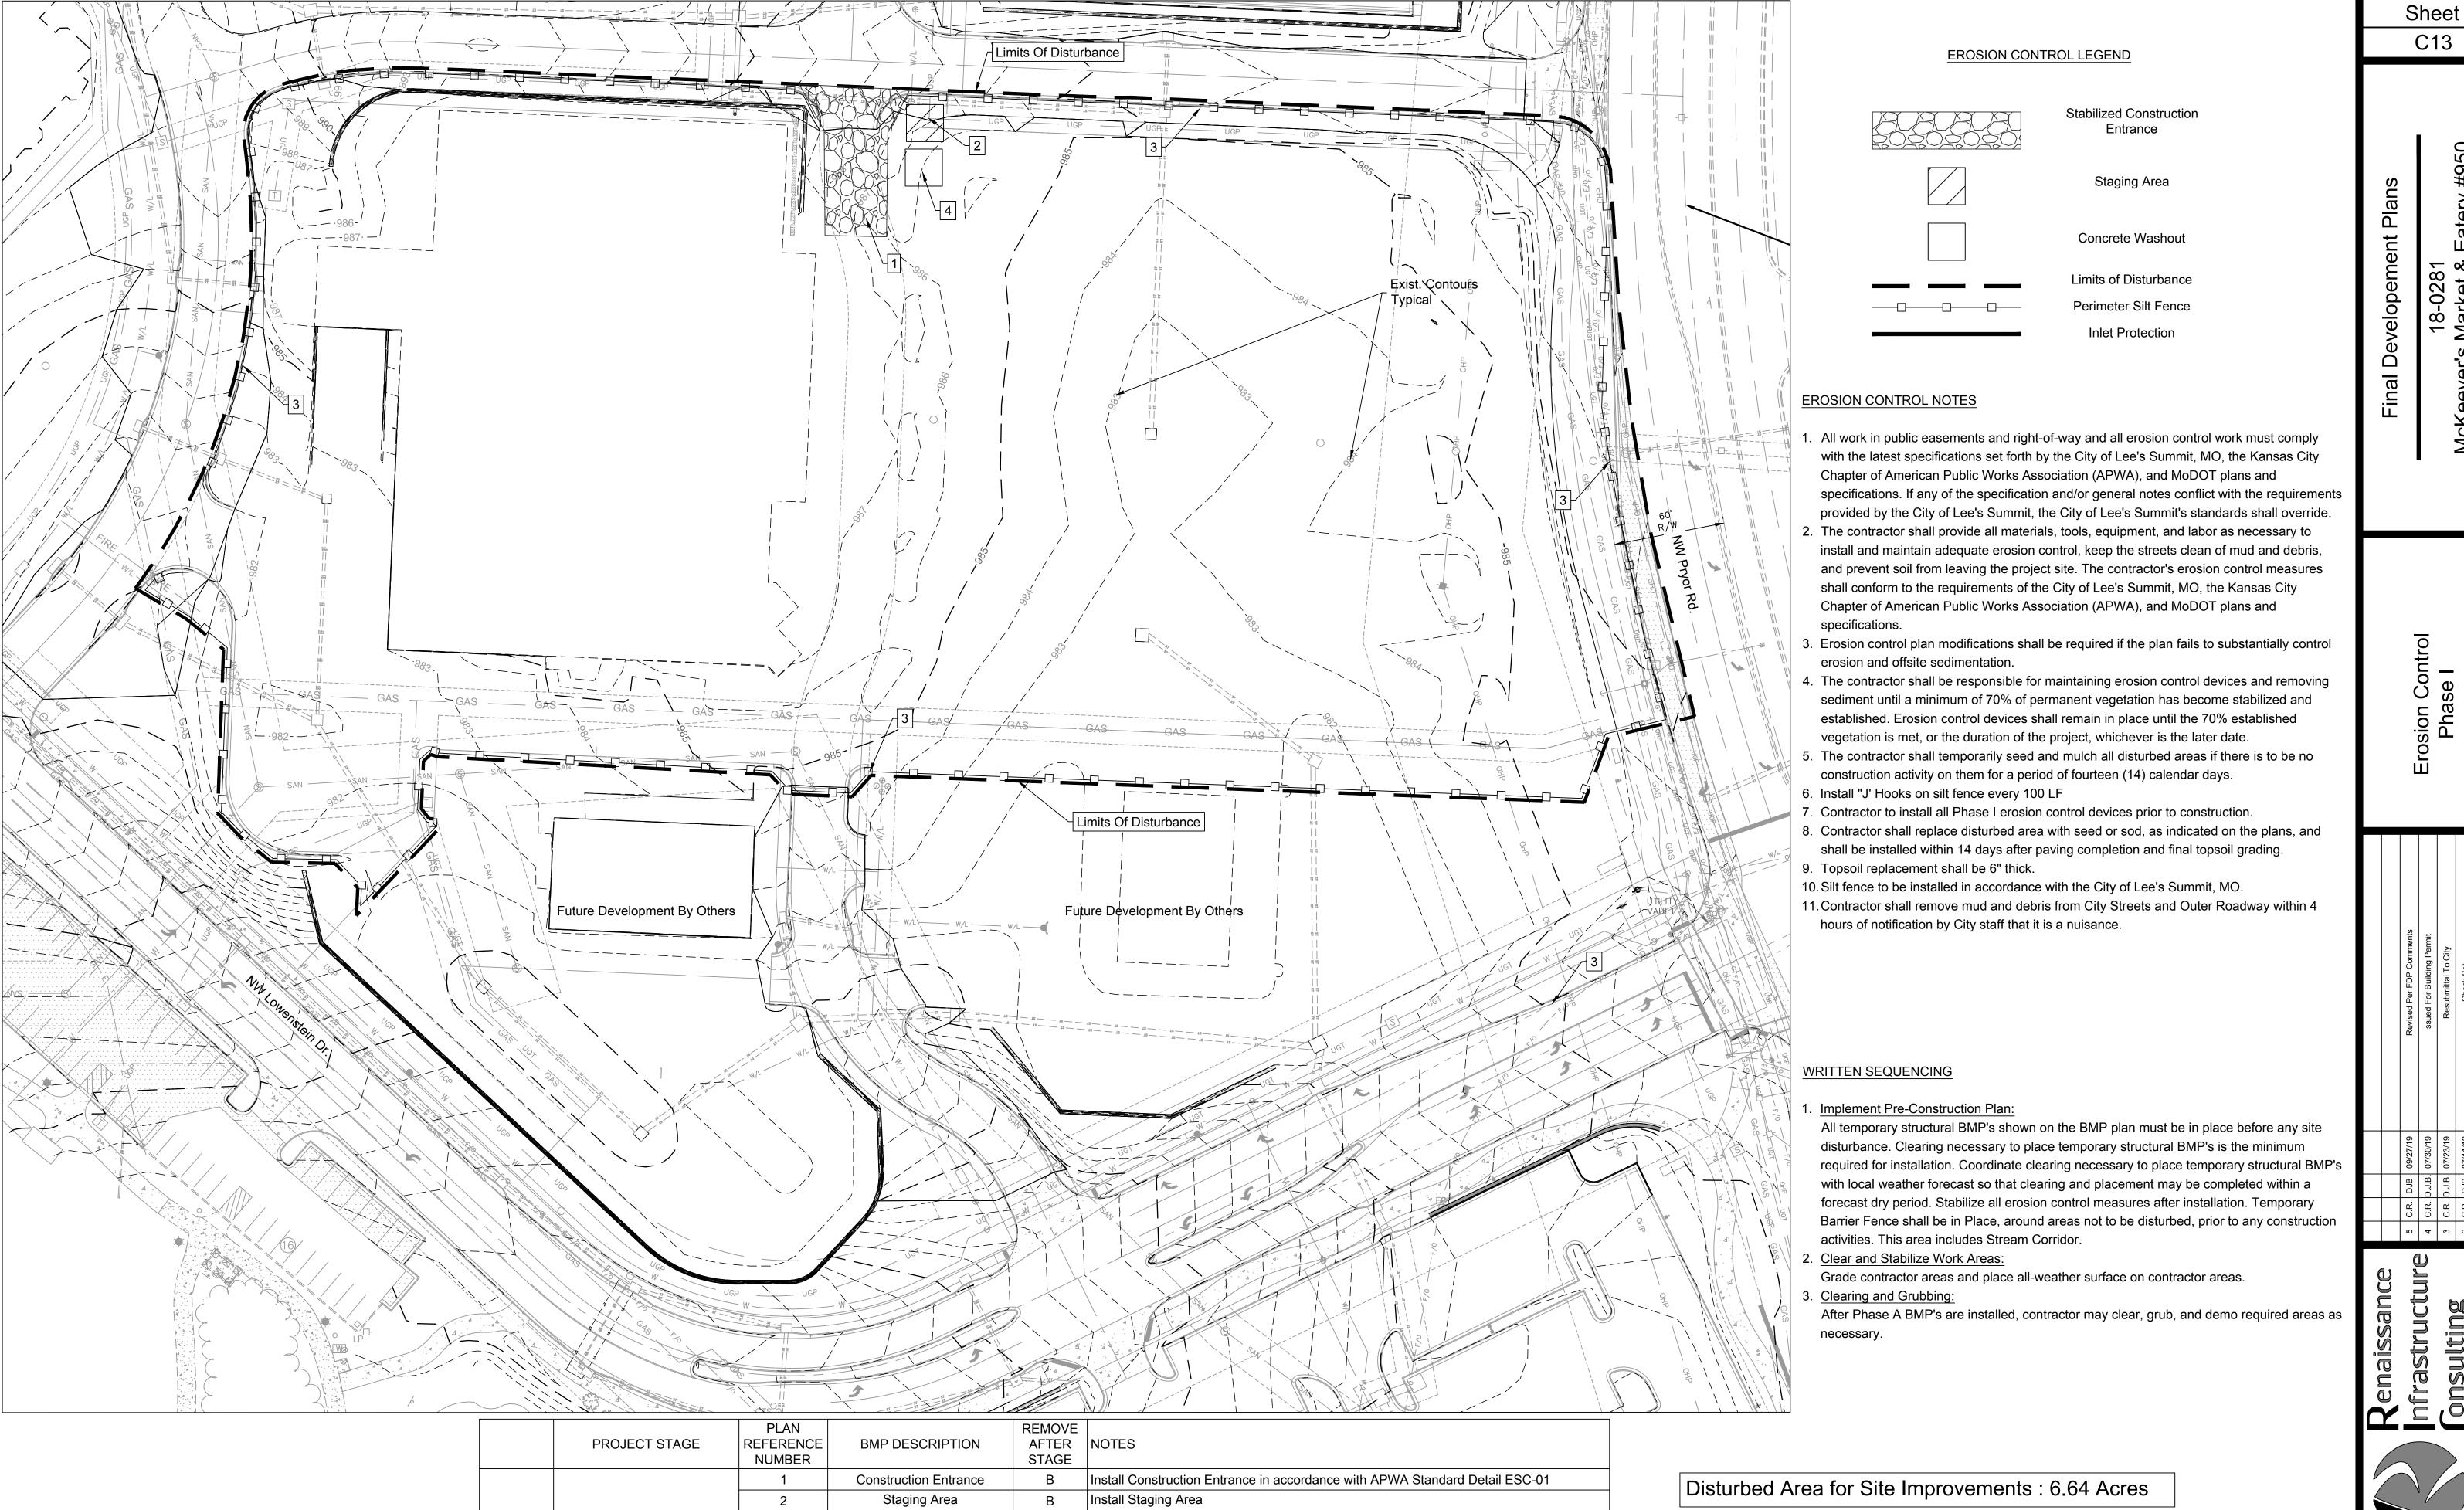

Install Silt Fence in accordance with APWA Standard Detail ESC-03

accordance with APWA Standard Detail ESC-01

Install Filter Bags Prior to Construction

Install Concrete Washout as Shown on Plans Prior to Pouring Any Concrete in

Redistribute Topsoil and Seed and Mulch all Disturbed Area. Stabilization Complete when

100% of Disturbed Area is Established with Perennial Vegetation with a Density of 70%

Phase I

Phase II

Phase III

A-Prior to Construction

B-During Land Disturbance

and Storm Infrastructure

Installation

C-Final Stabilization

Perimeter Silt Fence

Concrete Washout


Inlet Protection

Establish Perennial Vegetation

С





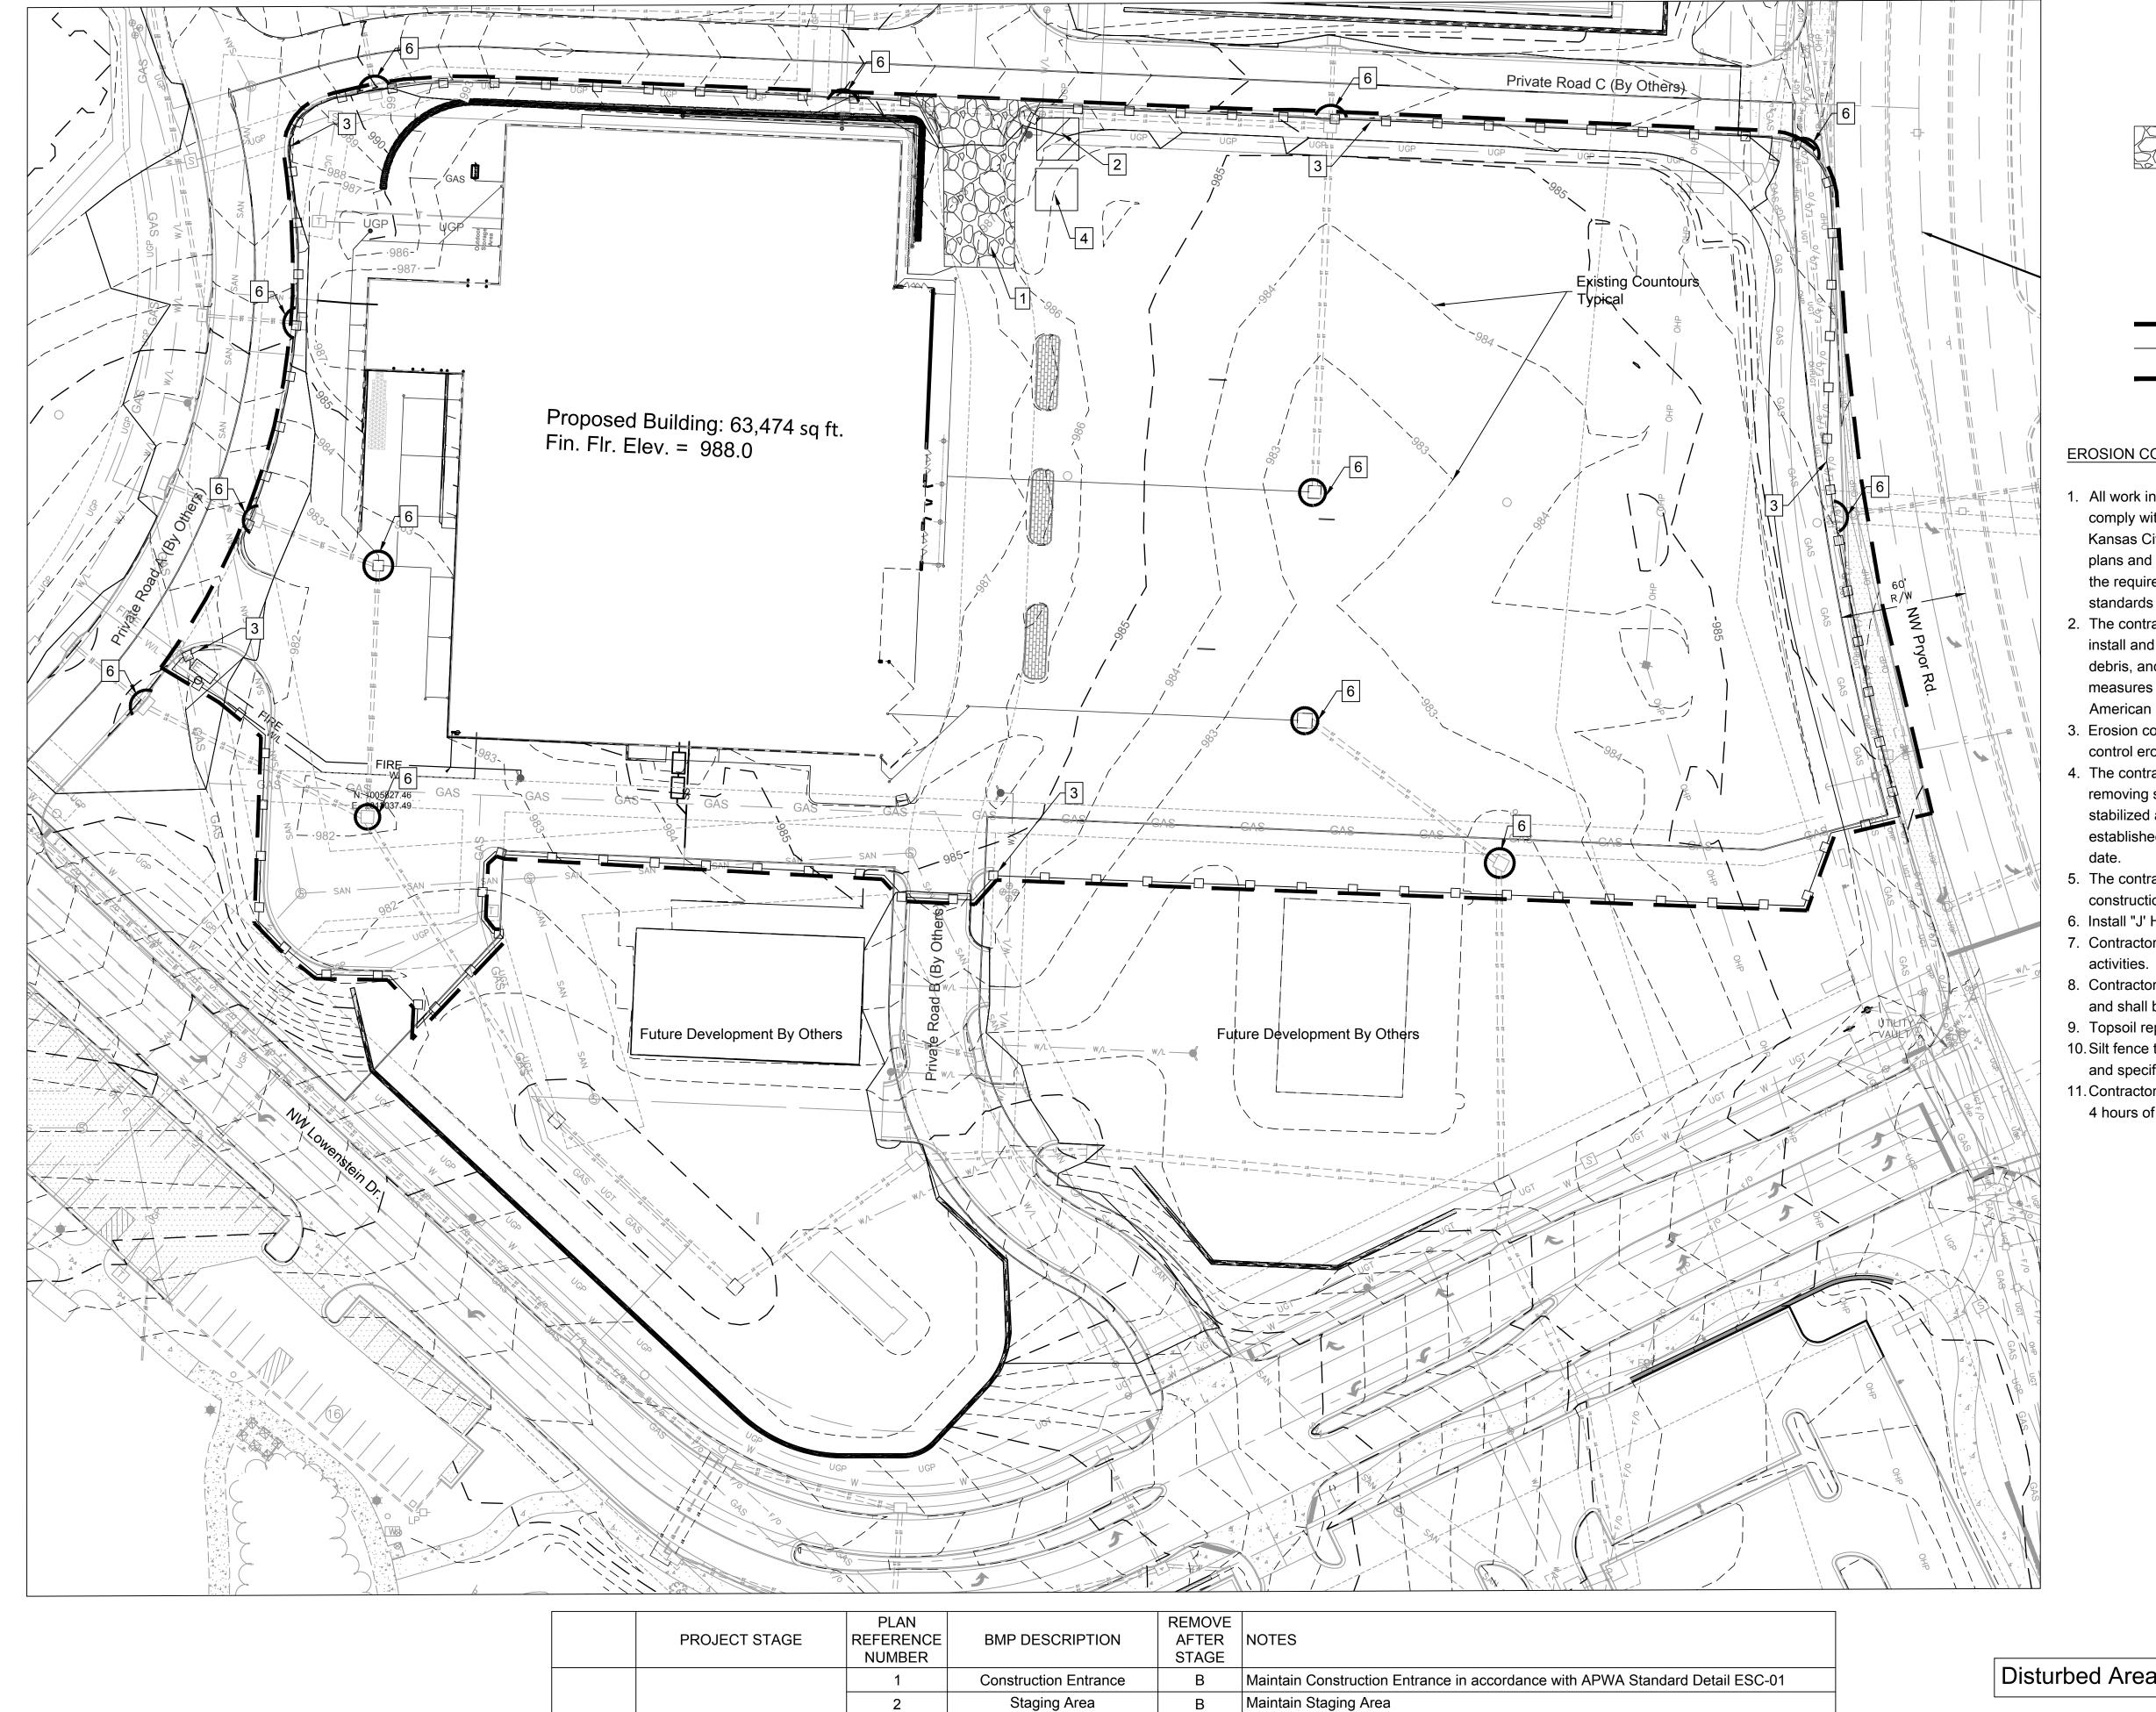

Perimeter Silt Fence

Concrete Washout

Inlet Protection

Establish Perennial Vegetation

Maintain Silt Fence in accordance with APWA Standard Detail ESC-03

accordance with APWA Standard Detail ESC-01

Install Filter Bags Prior to Construction

Maintain Concrete Washout as Shown on Plans Prior to Pouring Any Concrete in

Redistribute Topsoil and Seed and Mulch all Disturbed Area. Stabilization Complete when

100% of Disturbed Area is Established with Perennial Vegetation with a Density of 70%

A-Prior to Construction

B-During Land Disturbance


and Storm Infrastructure

Installation

C-Final Stabilization

Phase II

EROSION CONTROL LEGEND

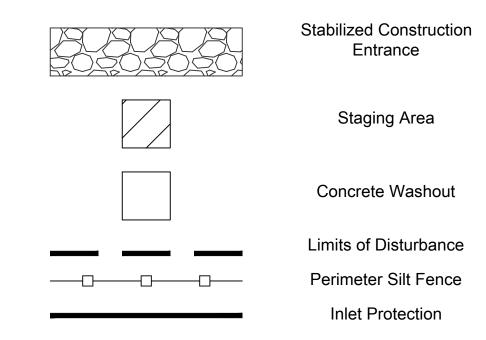

EROSION CONTROL NOTES

- 1. All work in public easements and right-of-way and all erosion control work must comply with the latest specifications set forth by the City of Lee's Summit, MO, the Kansas City Chapter of American Public Works Association (APWA), and MoDOT plans and specifications. If any of the specification and/or general notes conflict with the requirements provided by the City of Lee's Summit, the City of Lee's Summit standards shall override.
- 2. The contractor shall provide all materials, tools, equipment, and labor as necessary to install and maintain adequate erosion control, keep the streets clean of mud and debris, and prevent soil from leaving the project site. The contractor's erosion control measures shall conform to the City of Lee's Summit, MO, the Kansas City Chapter of American Public Works Association (APWA), and MoDOT plans and specifications.
- 3. Erosion control plan modifications shall be required if the plan fails to substantially control erosion and offsite sedimentation.
- 4. The contractor shall be responsible for maintaining erosion control devices and removing sediment until a minimum of 70% of permanent vegetation has become stabilized and established. Erosion control devices shall remain in place until the 70% established vegetation is met, or the duration of the project, whichever is the later
- 5. The contractor shall temporarily seed and mulch all disturbed areas if there is to be no construction activity on them for a period of fourteen (14) calendar days.
- 6. Install "J' Hooks on silt fence every 100 LF
- 7. Contractor to install all Phase I erosion control devices prior to beginning construction
- 8. Contractor shall replace disturbed area with seed or sod, as indicated on the plans, and shall be installed within 14 days after paving completion and final topsoil grading.
- 9. Topsoil replacement shall be 6" thick. 10. Silt fence to be installed in accordance with the City of Lee's Summit, MO. standards

Contractor sha	ll remove mud	and debris from	n City Streets	and Outer	Roadway within	
4 hours of notif	ication by City	staff that it is a	nuisance.			


Disturbed Area for Site Improvements: 6.64 Acres





Sheet

C14

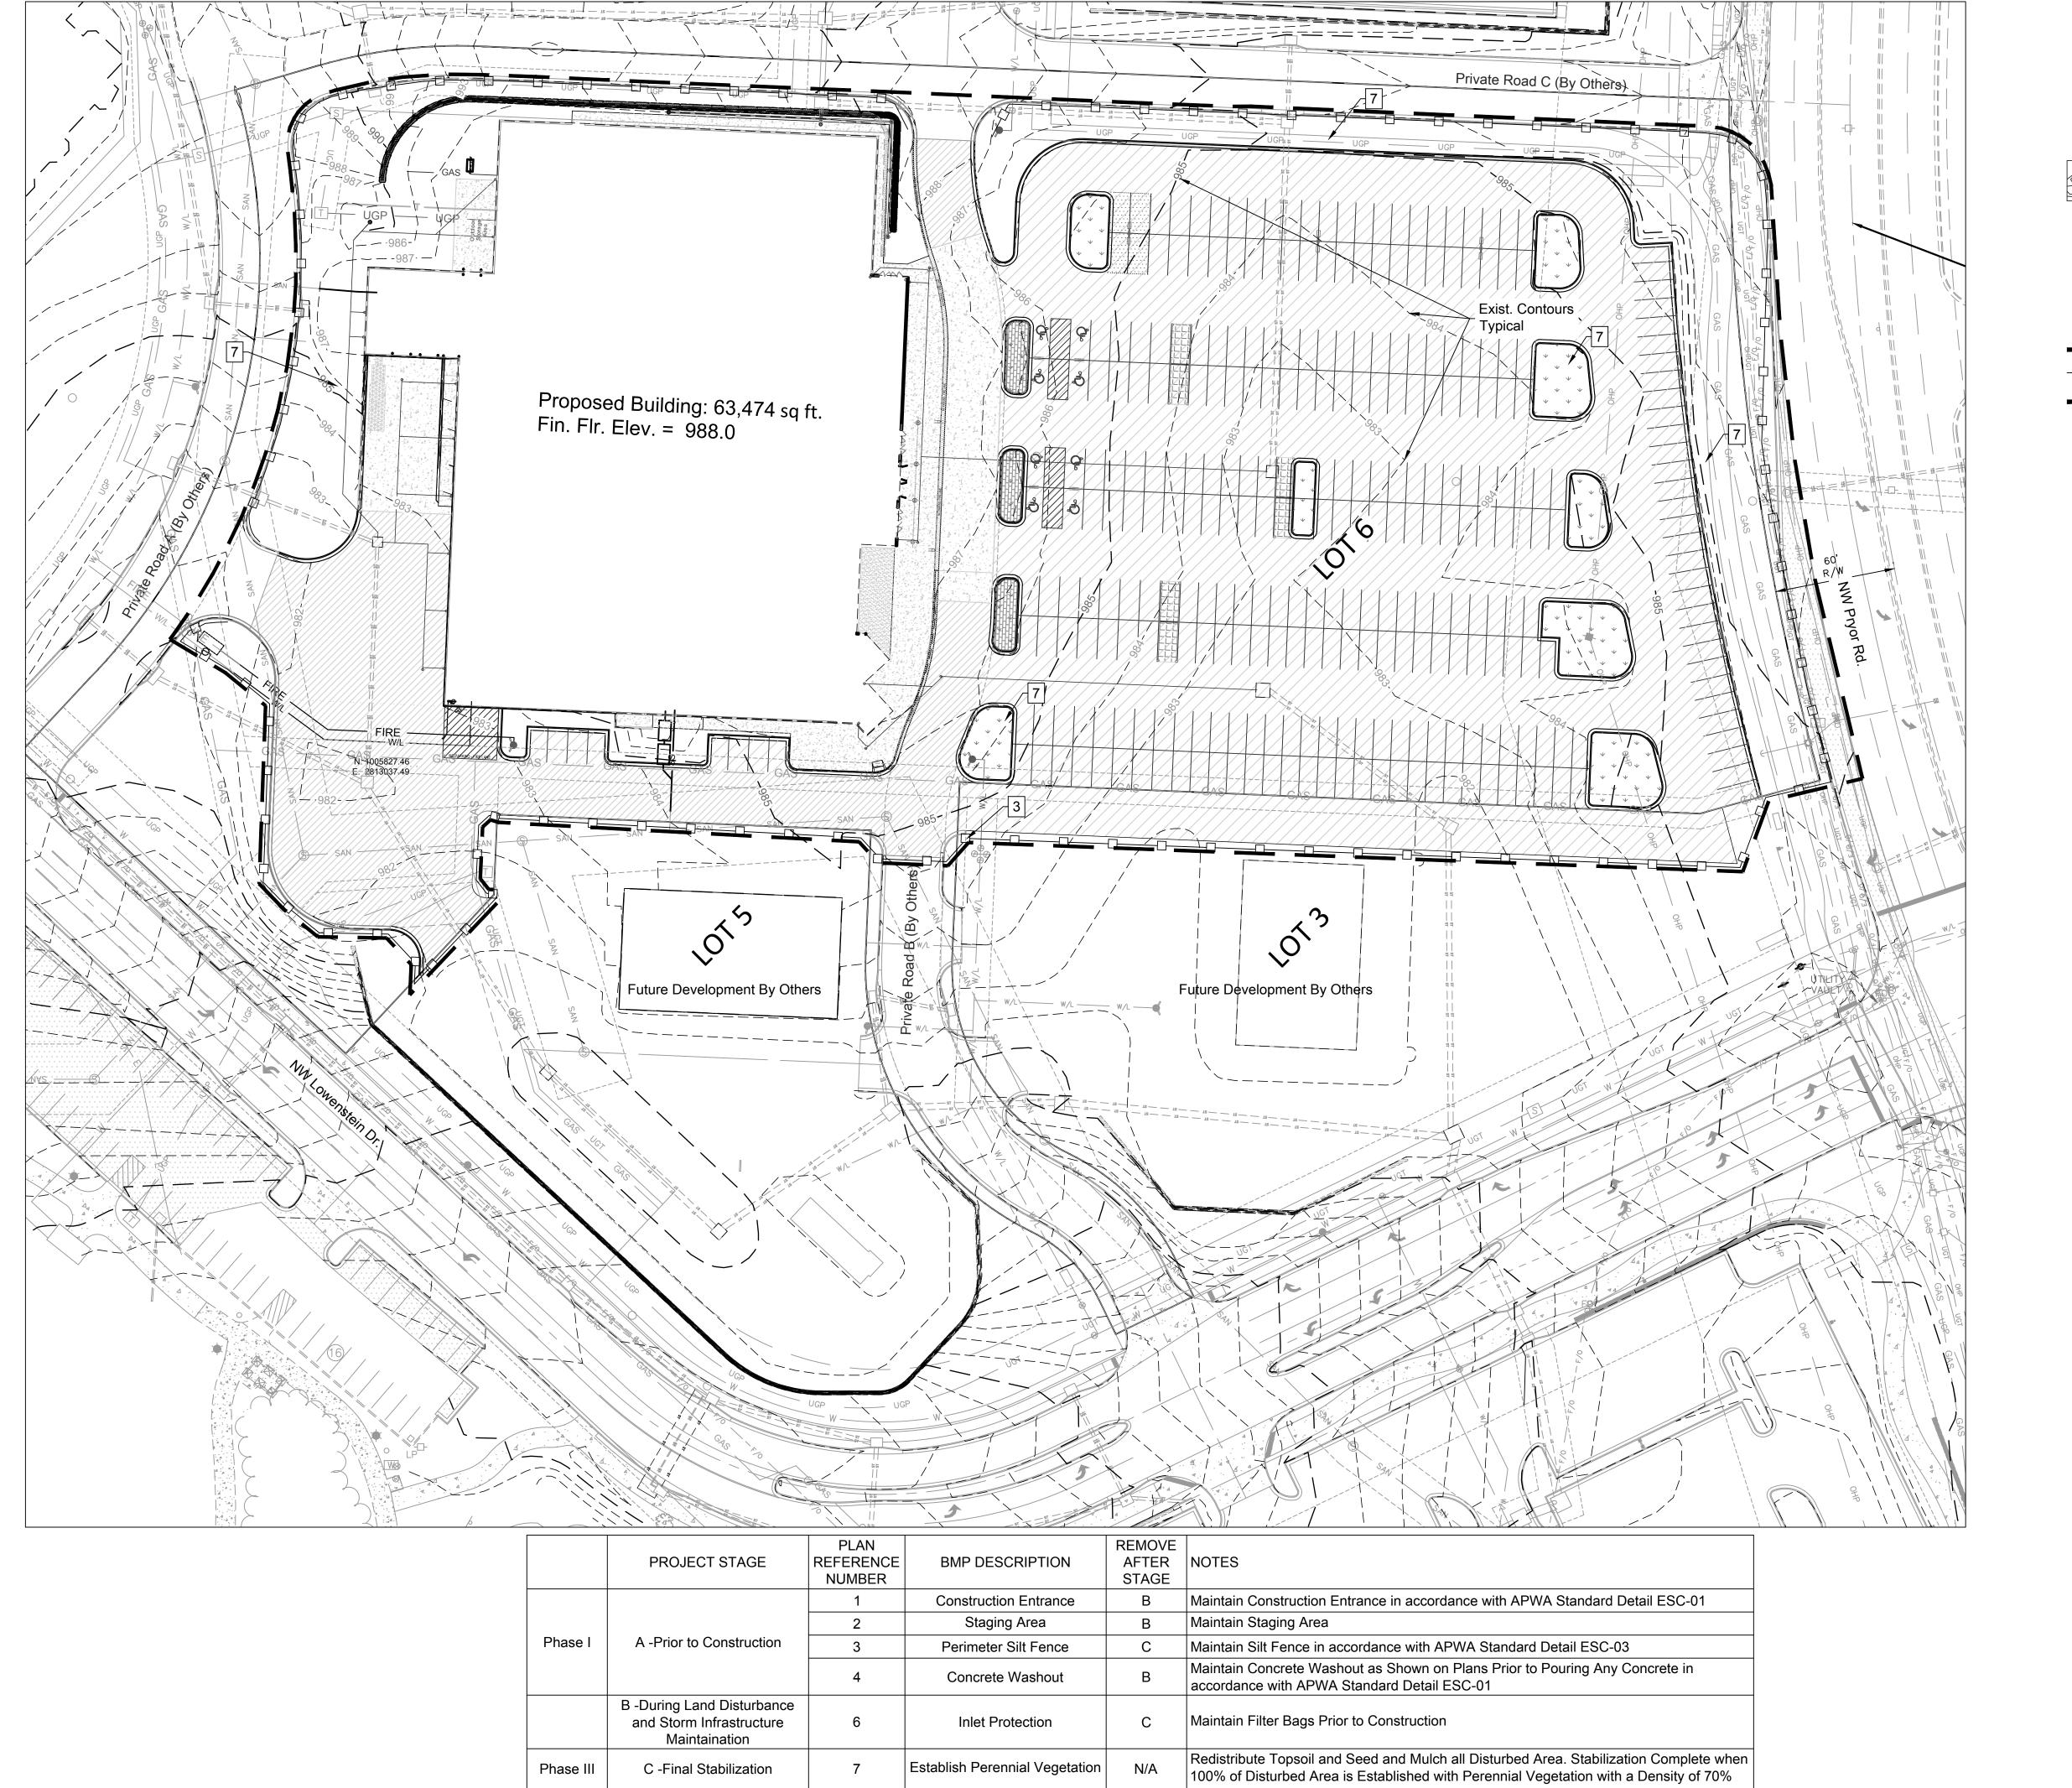



Stabilized Construction


Entrance

Staging Area

Concrete Washout

Limits of Disturbance Perimeter Silt Fence Inlet Protection

<u>LEGEND</u>




Sod/Seed Areas (See Landscpe Plans)


Sheet

C15







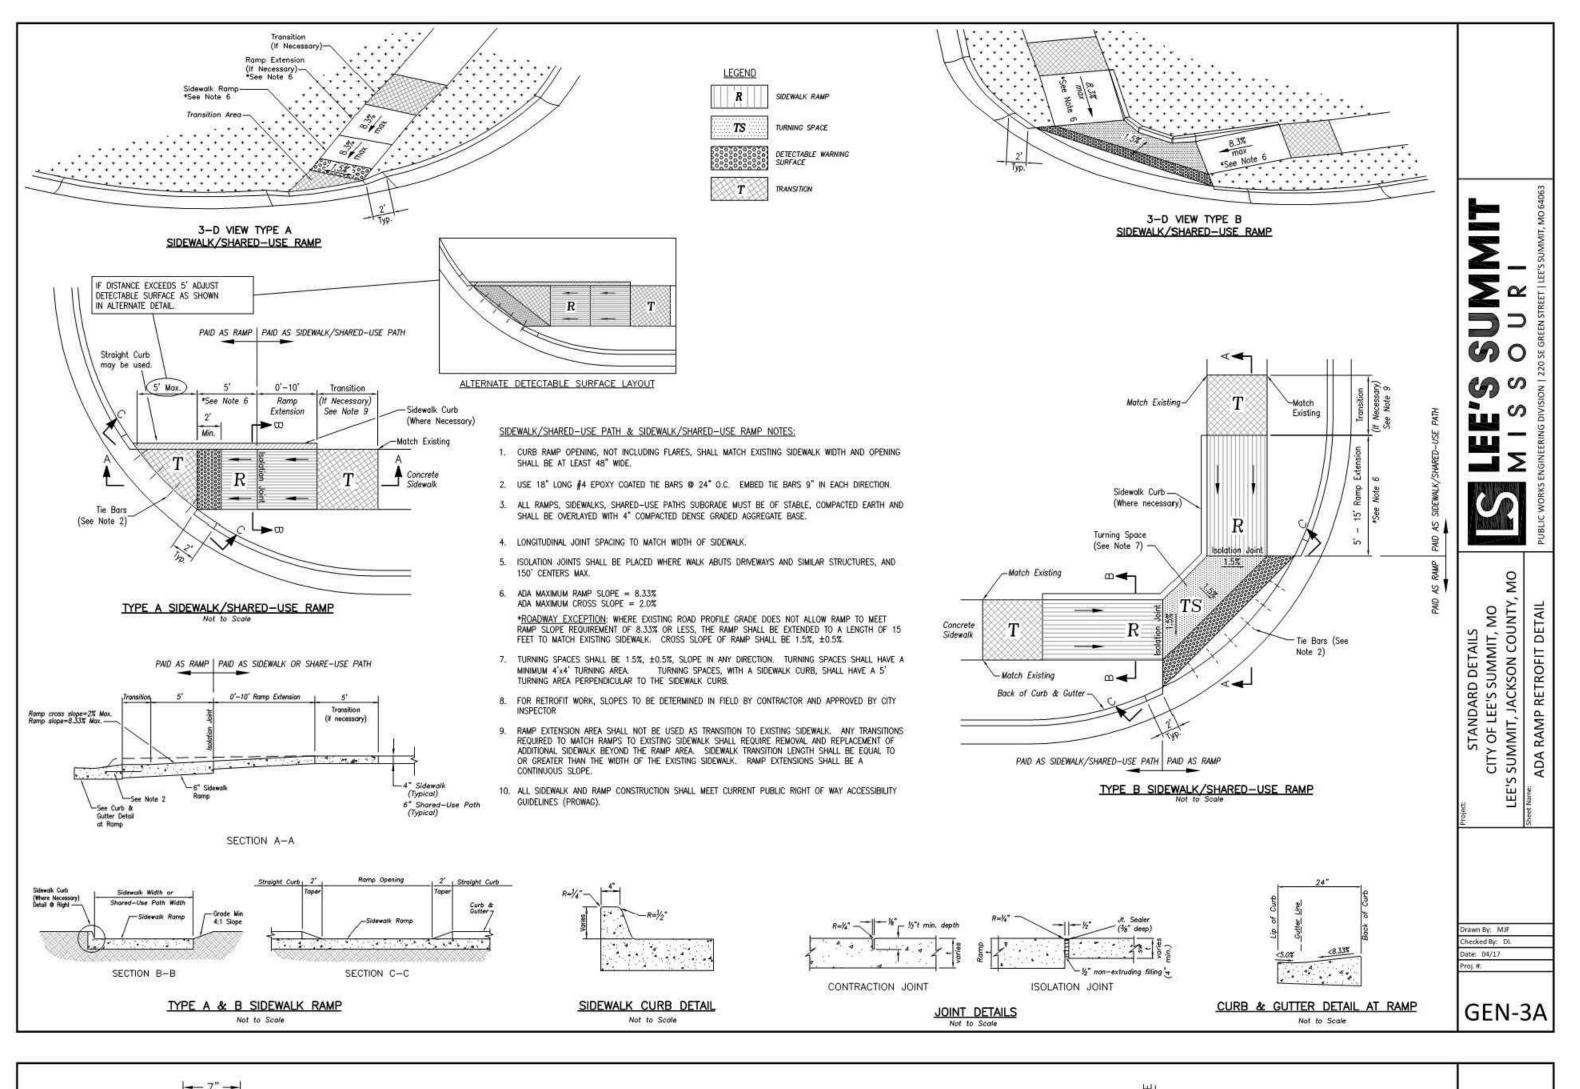

- TOP OF SURFACE COURSE

- TOP OF BASE COURSE

DOWELLED CURB

(TYPE DC)

ROLL BACK CURB & GUTTER

(TYPE CG-2)

ROLL BACK DRY CURB &

(TYPE CG-2 DRY)

PAVEMENT SURFACE

- 2'-#5 BAR SMOOTH DOWEL

STRAIGHT CURB

(TYPE C-1)

STRAIGHT BACK CURB &

(TYPE CG-1)

STRAIGHT BACK DRY CURB &

(TYPE CG-1 DRY)

<8.33%

0

CURB & GUTTER DETAIL AT RAMP

(ADA SLOPE REQUIREMENTS)

2" ASPHALTIC CONCRETE SURFACE COURSE

CURB REPLACEMENT DETAIL

THE ENTIRE CURB SECTION.

GENERAL NOTES

- CURB & GUTTER

COMPACTED STABLE SUBGRADE CONCRETE FILL (DEPTH

VARIES, 4" MINIMUM)

VARIES

1. 34" ISOLATION JOINTS WITH 3 (2'-#5 BAR) SMOOTH DOWELS SHALL BE PLACED AT RADIUS POINTS AND AT 150' INTERVALS. THESE DOWEL BARS SHALL BE GREASED AND WRAPPED ON ONE END WITH EXPANSION TUBES.

APROXIMATELY 10' INTERVALS. THESE JOINTS SHALL PASS ACROSS

2. 3" DEEP CONTRACTION JOINTS SHALL BE INSTALLED AT

3. CONCRETE FILL SHALL HAVE UNIFORM AND SMOOTH FINISH

5. ASPHALTIC CONCRETE SURFACE COURSE SHALL CONFORM TO

6. CURBS FOR NEW STREETS SHALL BE BUILT ON ASPHALT OR AGGREGATE BASE AS SHOWN IN TYPICAL SECTION DETAIL.

7. WHITE CURING COMPOUND MUST BE APPLIED UNIFORMLY TO THE CONCRETE SURFACE IMMEDIATELY AFTER FINAL FINISHING.


4. KCMMB 4K CONCRETE SHALL BE USED FOR ALL CURB.


STANDARD SPECIFICATIONS SECTION 2205.2.


- SAW CUT TO AGGREGATE

BASE OR SUBGRADE

- EXISTING PAVEMENT

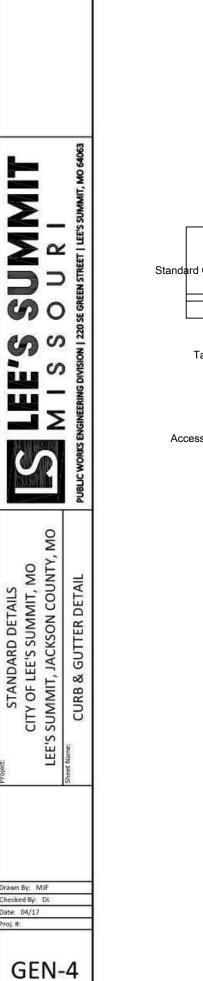

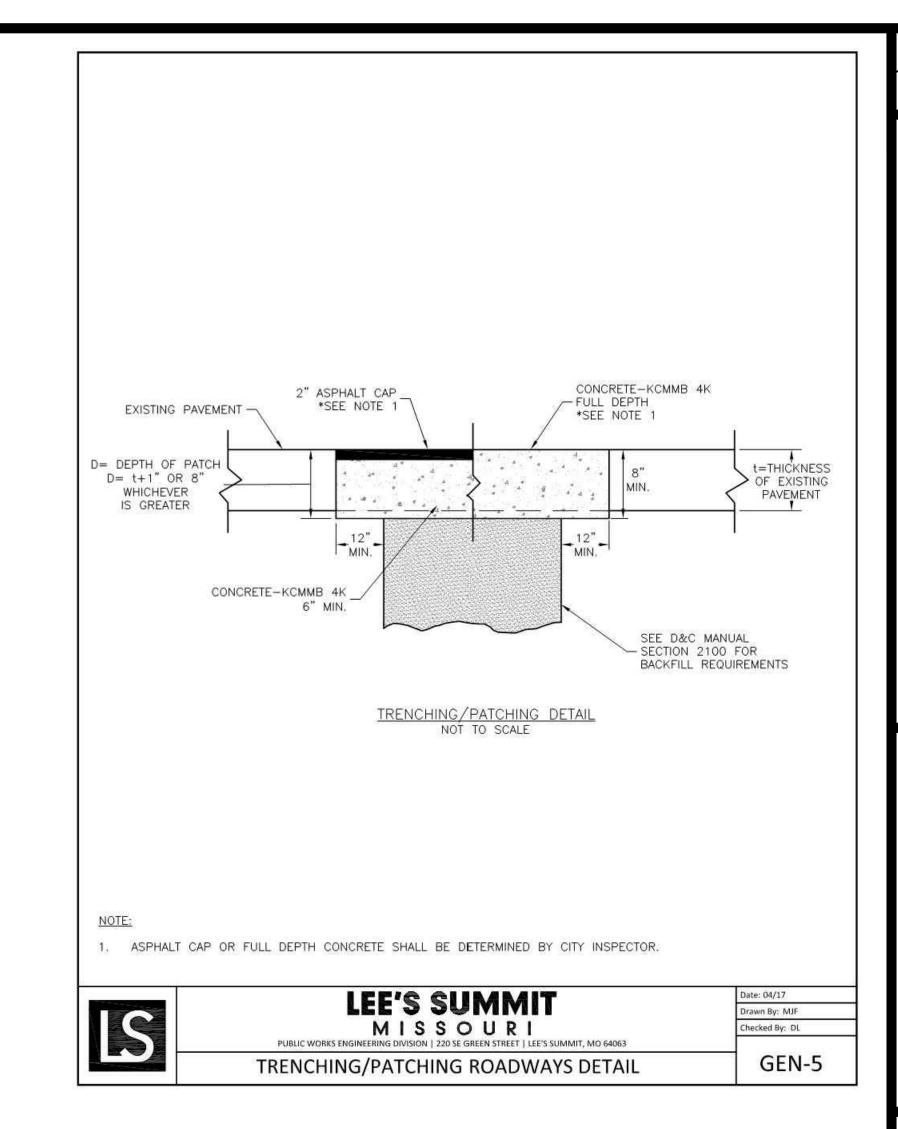

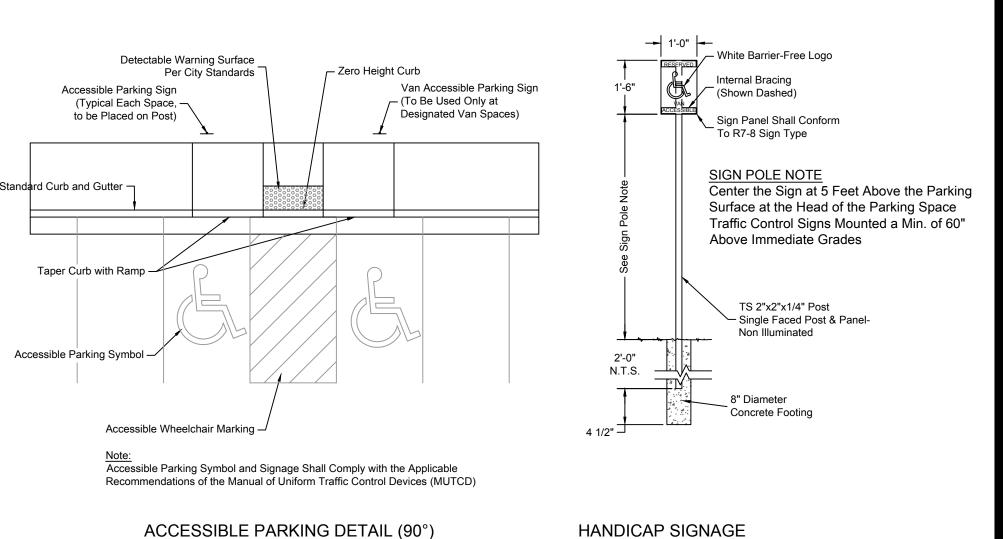

Not to Scale


Not to Scale




Sheet

TYPICAL DETAILS-GENERAL





Threaded Plug Threaded Cleanout Adapter Fitting shall match Service Line pipe size and Pipe Stub Section Detail

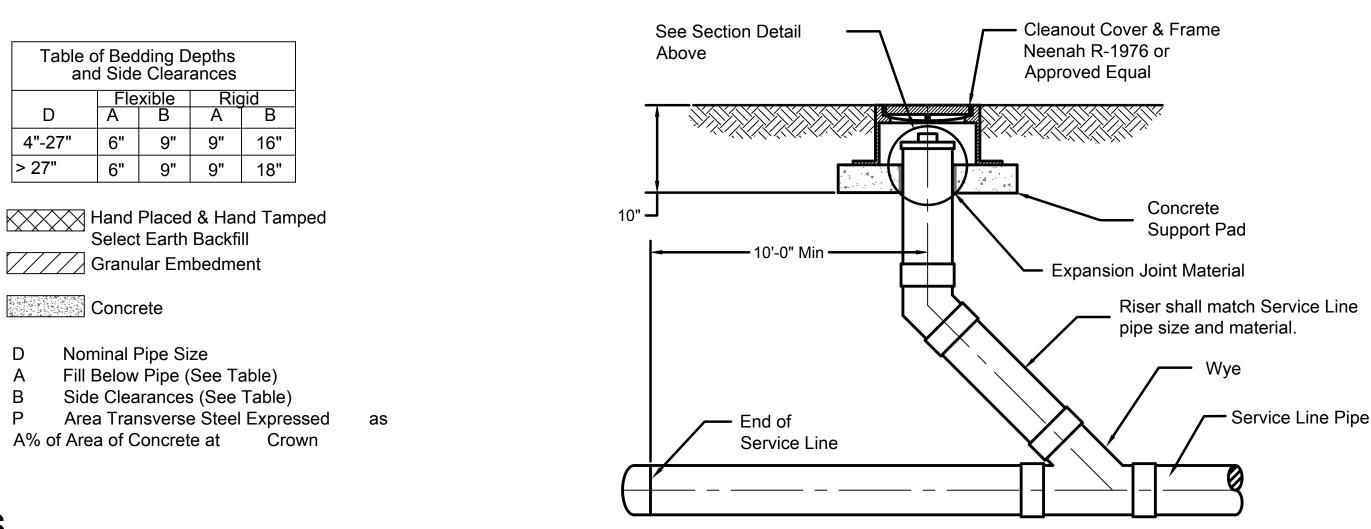

STANDARD EMBEDMENTS


Flexible Pipe Embedment

(Pipe: PVC, DIP, Fiberglass, HDPE)

Class "C" Embedment

Class "B" Embedment

(Pipe: RCP Optional)

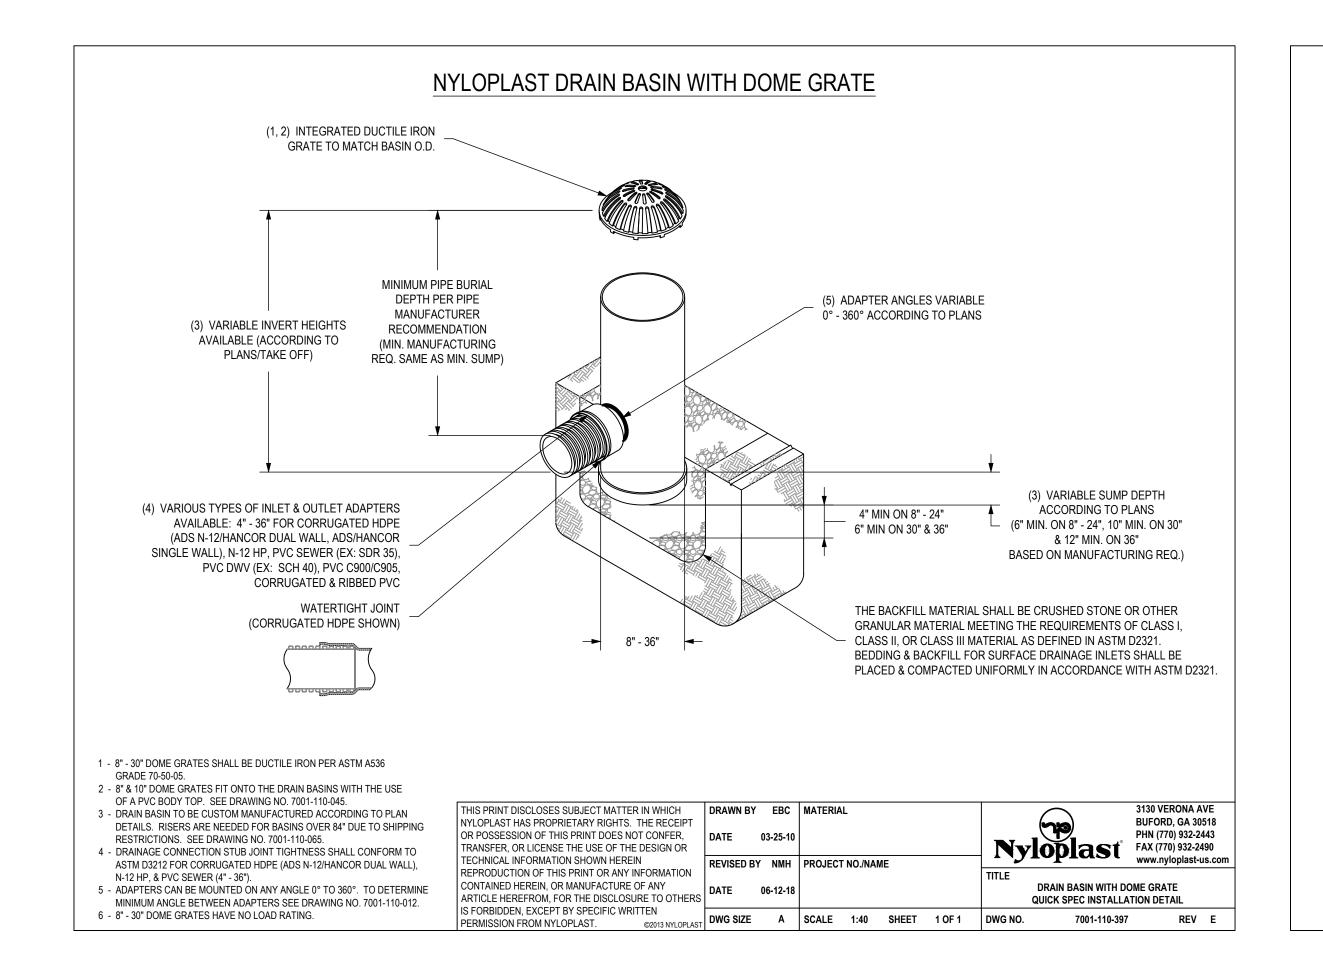

Section 2721

CLEANOUT DETAIL

Engineered Surface Drainage Products

PVC surface drainage inlets shall include the drain basin type as indicated on the contract drawing and referenced within the contract specifications. The ductile

iron grates for each of these fittings are to be considered an integral part of the surface drainage inlet and shall be furnished by the same manufacturer. The surface drainage inlets shall be as manufactured by Nyloplast a division of Advanced Drainage Systems, Inc., or prior approved equal.

MATERIALS


The drain basins required for this contract shall be manufactured from PVC pipe stock, utilizing a thermoforming process to reform the pipe stock to the specified configuration. The drainage pipe connection stubs shall be manufactured from PVC pipe stock and formed to provide a watertight connection with the specified pipe system. This joint tightness shall conform to ASTM D3212 for joints for drain and sewer plastic pipe using flexible elastomeric seals. The flexible elastomeric seals shall conform to ASTM F477. The pipe bell spigot shall be joined to the main body of the drain basin or catch basin. The raw material used to manufacture the pipe stock that is used to manufacture the main body and pipe stubs of the surface drainage inlets shall conform to ASTM D1784 cell class 12454.


The grates and frames furnished for all surface drainage inlets shall be ductile iron for structure sizes 8", 10", 12", 15", 18", 24", 30" and 36" and shall be made specifically for each basin so as to provide a round bottom flange that closely matches the diameter of the surface drainage inlet. Grates for drain basins shall be capable of supporting various wheel loads as specified by Nyloplast. 12" and 15" square grates will be hinged to the frame using pins. Ductile iron used in the manufacture of the castings shall conform to ASTM A536 grade 70-50-05. Grates and covers shall be provided painted black.

INSTALLATION


The specified PVC surface drainage inlet shall be installed using conventional flexible pipe backfill materials and procedures. The backfill material shall be crushed stone or other granular material meeting the requirements of class 1, class 2, or class 3 material as defined in ASTM D2321. Bedding and backfill for surface drainage inlets shall be well placed and compacted uniformly in accordance with ASTM D2321. The drain basin body will be cut at the time of the final grade. No brick, stone or concrete block will be required to set the grate to the final grade height. For load rated installations, a concrete slab shall be poured under and around the grate and frame. The concrete slab must be designed taking into consideration local soil conditions, traffic loading, and other applicable design factors. For other installation considerations such as migration of fines, ground water, and soft foundations refer to ASTM D2321 guidelines.

THIS PRINT DISCLOSES SUBJECT MATTER IN WHICH NYLOPLAST HAS PROPRIETARY RIGHTS. THE RECEIPT OR POSSESSION OF THIS PRINT DOES NOT CONFER, TRANSFER, OR LICENSE THE USE OF THE DESIGN OR	DRAWN BY	CJA 3-10-00	MATERIA	L			Nylon) dast	3130 VERONA AVE BUFORD, GA 30518 PHN (770) 932-2443 FAX (770) 932-2490
TECHNICAL INFORMATION SHOWN HEREIN	REVISED B	Y NMH	PROJECT	NO./NAI	ΛE				www.nyloplast-us.cor
REPRODUCTION OF THIS PRINT OR ANY INFORMATION							TITLE		
CONTAINED HEREIN, OR MANUFACTURE OF ANY ARTICLE HEREFROM, FOR THE DISCLOSURE TO OTHERS	DATE	02-21-18						DRAIN BASIN S	PECIFICATIONS
IS FORBIDDEN, EXCEPT BY SPECIFIC WRITTEN PERMISSION FROM NYLOPLAST. ©2013 NYLOPLAST	DWG SIZE	Α	SCALE	1:1	SHEET	1 OF 1	DWG NO.	7001-110-011	REV J

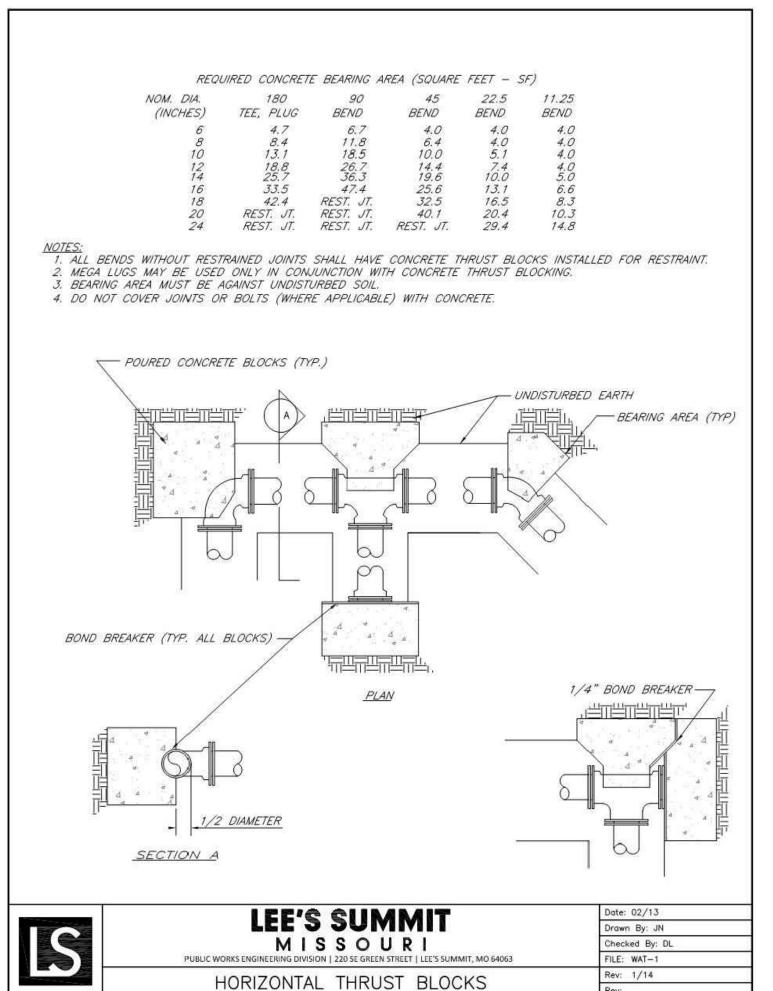


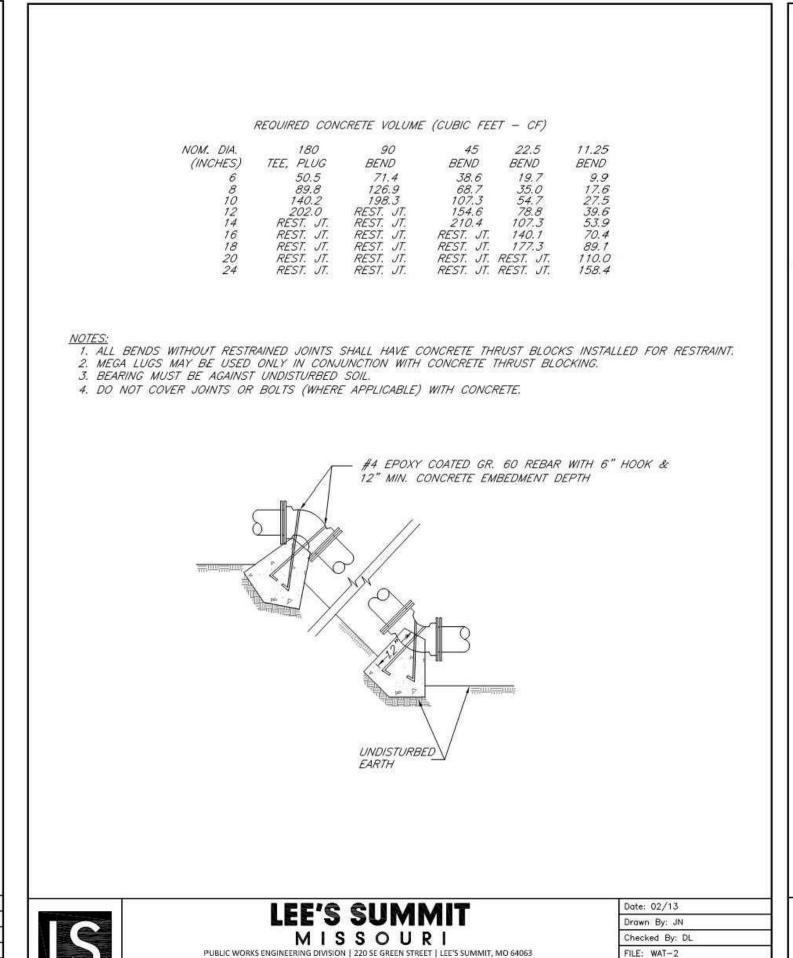


VERTICAL THRUST BLOCKS

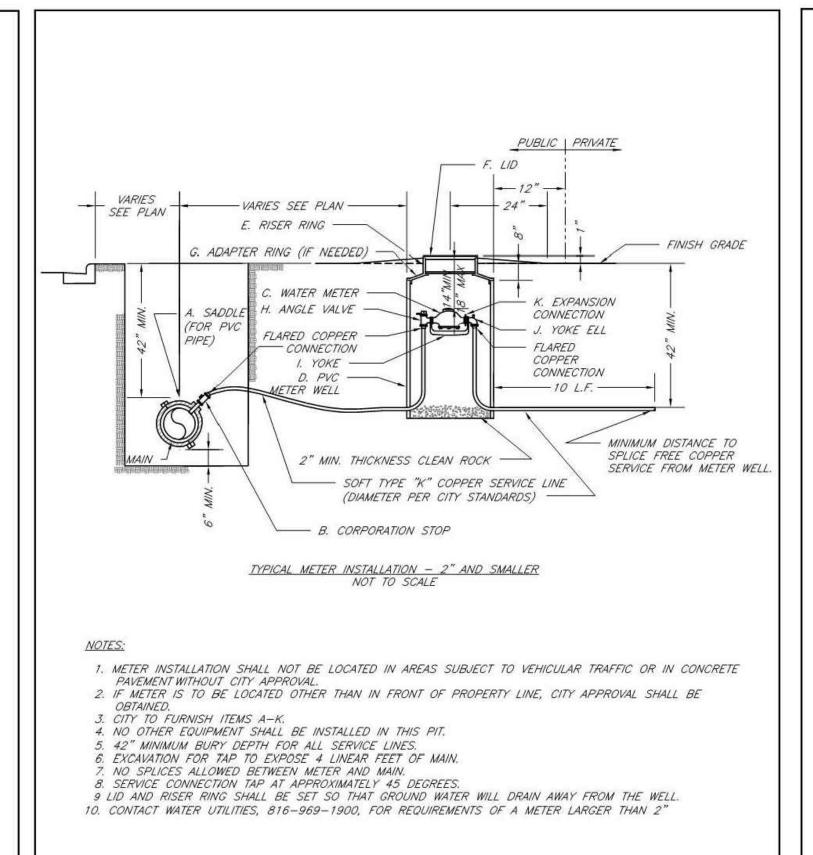

S	I EE'O OHAAAIT	Date: 02/13
	LEE'S SUMMIT	Drawn By: JN
	MISSOURI	Checked By: DL
	PUBLIC WORKS ENGINEERING DIVISION 220 SE GREEN STREET LEE'S SUMMIT, MO 64063	FILE: WAT-11
	SERVICE CONNECTION/METER WELL	Rev: 1/14
	SERVICE CONNECTION/ METER WELL	Rev:

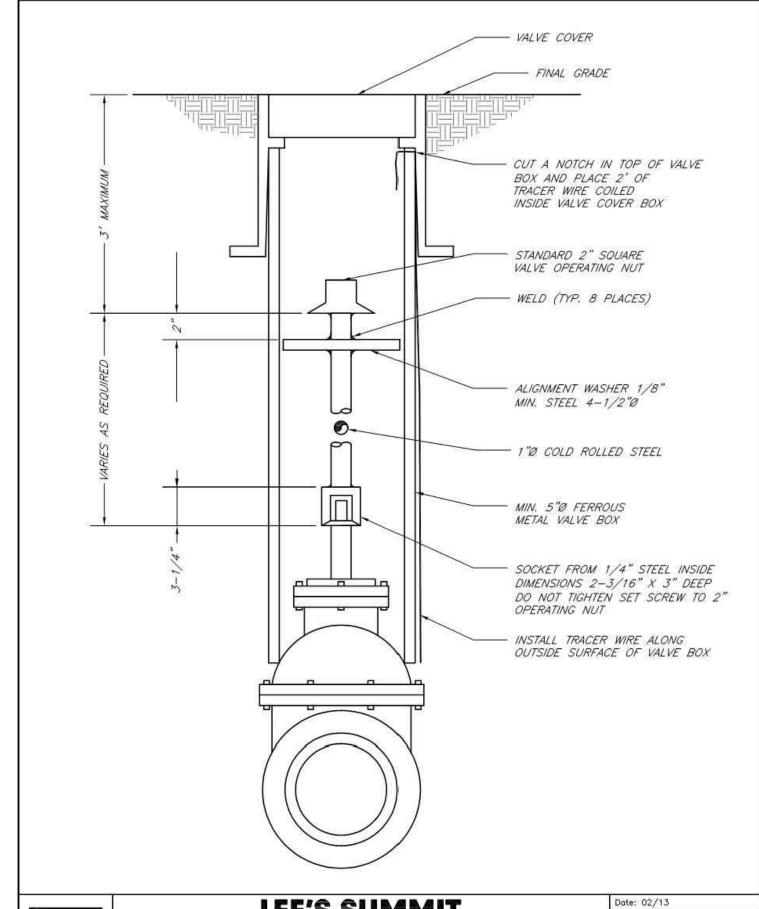

 IEE'C CHAAAIT	Date: 02/13
LEE'S SUMMIT	Drawn By: JN
MISSOURI	Checked By: DL
PUBLIC WORKS ENGINEERING DIVISION 220 SE GREEN STREET LEE'S SUMMIT, MO 64063	FILE: WAT-9
VALVE CTEM EXTENSION AND VALVE DOV	Rev: 1/14
VALVE STEM EXTENSION AND VALVE BOX	Rev:

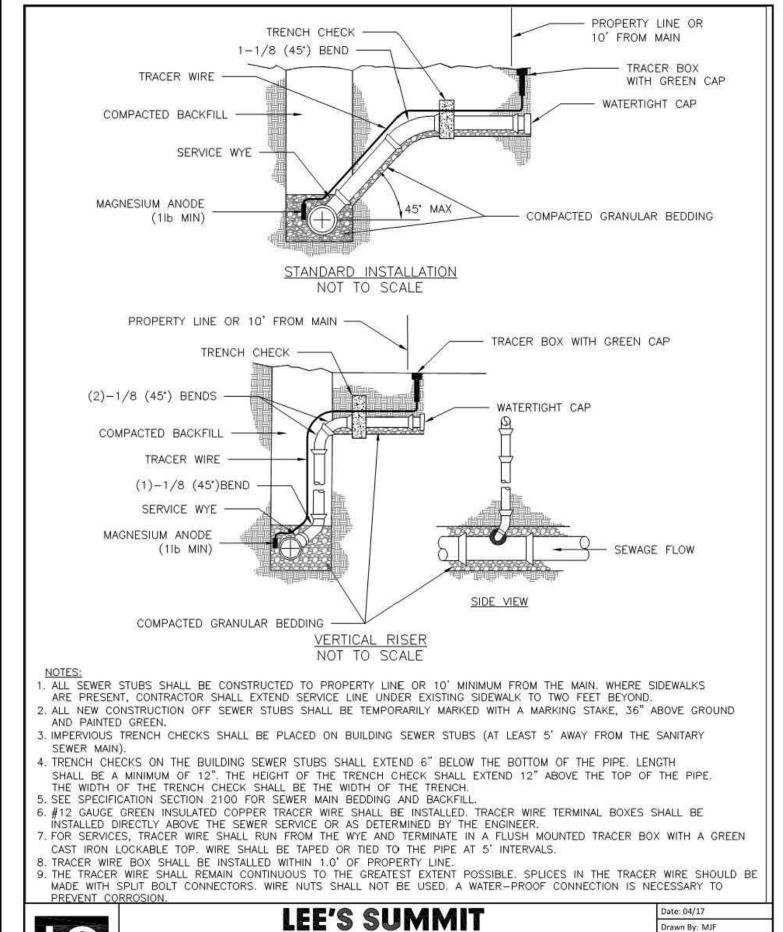


MISSOURI

BUILDING SEWER STUB AND RISER

hecked By: DL

SAN-1

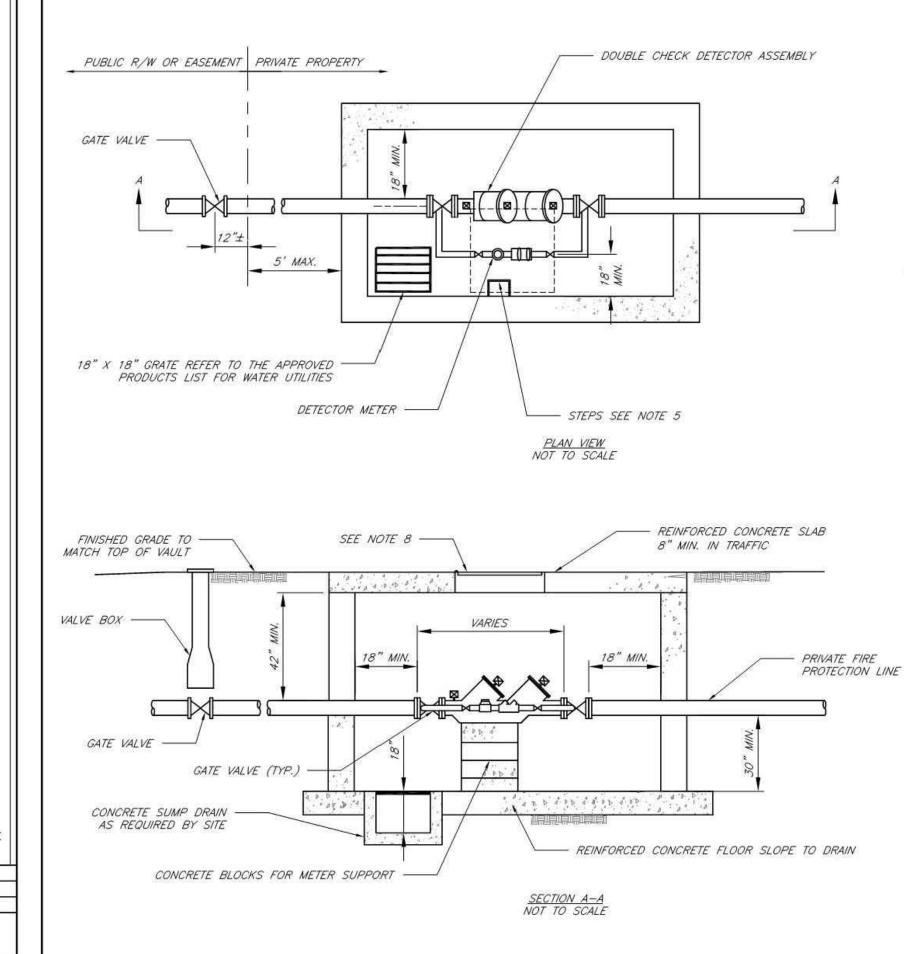

Rev: 1/14

GENERAL NOTES:

1. METER VAULT WALLS TO BE POURED OR PRECAST CONCRETE. METER VAULT ROOF TO BE REINFORCED CONCRETE WITH OPENING CENTERED OVER DETECTOR METER. REINFORCED WALLS AND SLABS ARE TO BE

DESIGNED BY THE OWNER'S ENGINEER OR PRECAST ENGINEER. 2. METER VAULT TO BE LOCATED, WHEN POSSIBLE, OUTSIDE TRAFFIC AREA AND WHERE SURFACE WATER WILL NOT DRAIN INTO IT. PROVIDE CONCRETE SUMP TO DRAIN TO AN ABOVE GROUND DISCHARGE POINT.


3. ALL PIPE AND FITTINGS FROM THE CITY WATER MAIN THROUGH THE VAULT SHALL BE PROVIDED WITH RESTRAINED JOINT FITTINGS. 4. ALL FITTINGS FOR THE DETECTOR METER TO BE BRASS. 5. STEPS SHALL BE IN ACCORDANCE WITH THE APPROVED PRODUCTS LIST

FOR WATER UTILITIES AND SHALL BE ON 16" CENTERS. 6. A DEPARTMENT OF NATURAL RESOURCES APPROVED DOUBLE CHECK DETECTOR ASSEMBLY BACKFLOW PREVENTER MUST BE USED. FOR A COPY OF THE MISSOURI DEPARTMENT OF NATURAL RESOURCES APPROVED BACKFLOW PREVENTION ASSEMBLIES, CONTACT WATER UTILITIES AT

816-969-1900. 7. ALL VALVES SHALL HAVE RISING STEMS. 8. MANHOLE COVER SHALL BE A BILCO K-1 MODEL UNLESS IN A VEHICLE TRAFFIC AREA. SEE THE APPROVED PRODUCTS LIST FOR WATER UTILITIES FOR TRAFFIC CONDITIONS. THE COVER SHALL HAVE A 1-3/4" Ø HOLE

DRILLED FOR A TOUCH/READ DEVICE. 9. A MINIMUM OF 18" CLEARANCE SHALL BE PROVIDED AROUND ALL PIPING, VALVES, APPURTENANCES, ETC. 10. CONTACT PUBLIC WORKS ENGINEERING FOR VAULTS THAT INCLUDE A FIRE

DEPARTMENT CONNECTION OR A 3" OR LARGER METER.

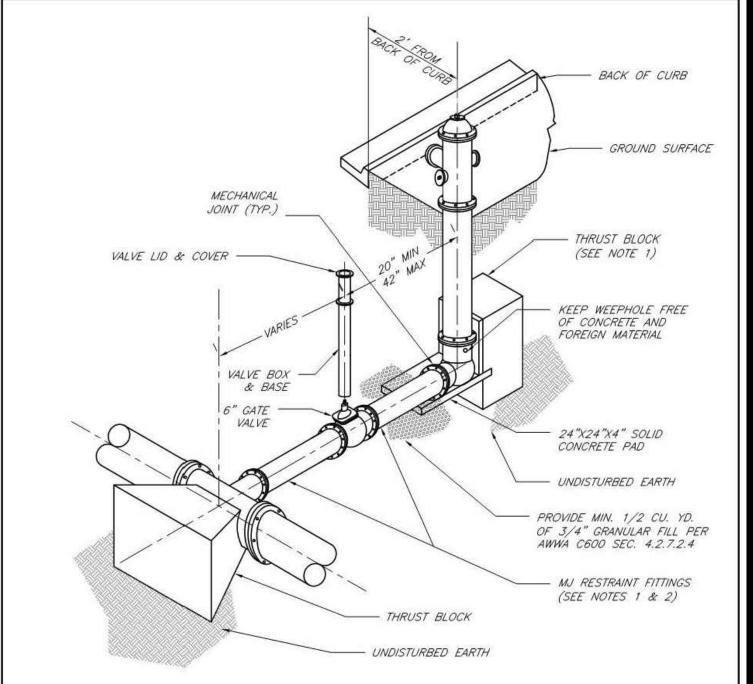

1. WHEN RETAINER GLANDS ARE USED IN LIEU OF MECHANICAL JOINT (MJ) RESTRAINT FITTINGS, HORIZONTAL THRUST BLOCKS ARE REQUIRED.

GATE VALVE MAY BE BOLTED DIRECTLY TO MJ RESTRAINT TEE. 3. SEE APPROVED PRODUCTS LIST FOR WATER UTILITIES FOR FIRE HYDRANT, VALVES, VALVE BOX LID, 4. BOTTOM HYDRANT FLANGE SHALL BE 2" TO 6" ABOVE FINISHED GRADE.

5. FOR STREETS WITHOUT CURBS FIRE HYDRANTS SHALL BE PLACED WITHIN 1 FOOT OF THE R/W LINE, BUT NOT MORE THAN 10' FROM EDGE OF PAVEMENT. FIRE HYDRANT SHALL NOT BE PLACED IN

6. HYDRANT SHALL BE ROTATED AS DIRECTED BY INSPECT

Checked By: .DL Date: 1/14 Rev: 1/14

Y	LEE'S SUMMIT	Date: 02/13
	FEE 9 30 MIMIL	Drawn By: JN
	MISSOURI	Checked By: DL
	PUBLIC WORKS ENGINEERING DIVISION 220 SE GREEN STREET LEE'S SUMMIT, MO 64063	FILE: WAT-7
	HYDRANT INSTALLATION - STRAIGHT SET	Rev: 1/14
	HYDRANT INSTALLATION — STRAIGHT SET	Rev:

Sheet

18-028 Market

