




- NOTE:
1. ADA ACCESSIBLE RAMPS SHALL BE CONSTRUCTED ALONG WITH SUBDIVISION IMPROVEMENTS.

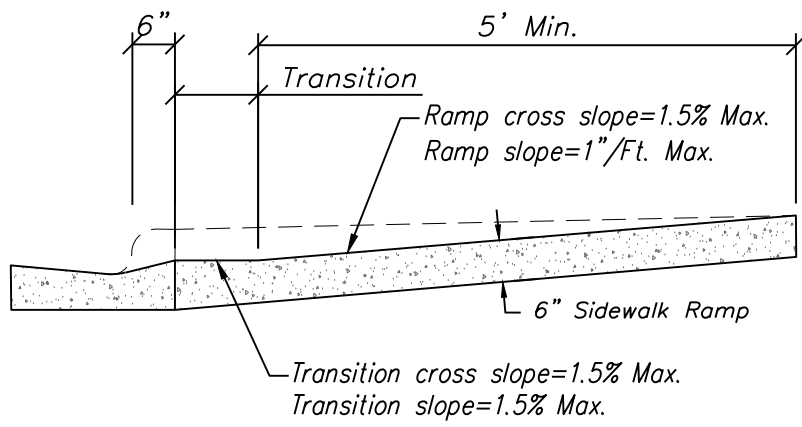



Section A-A
NOT TO SCALE

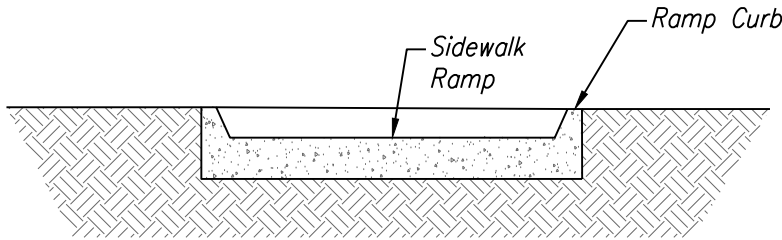



Section B-B
NOT TO SCALE

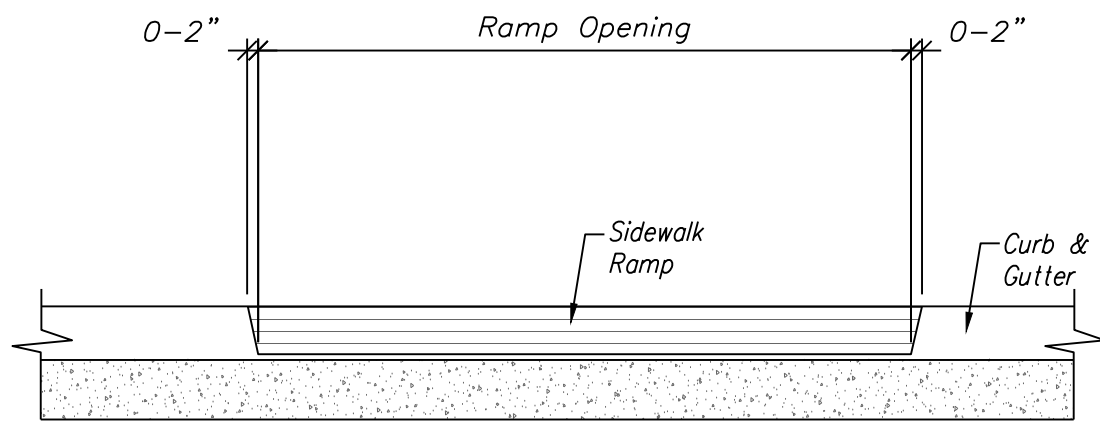

Section C-C
NOT TO SCALE

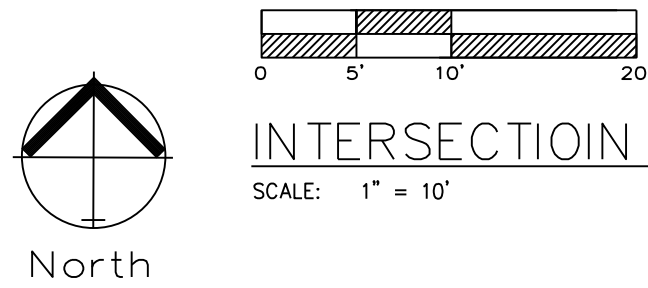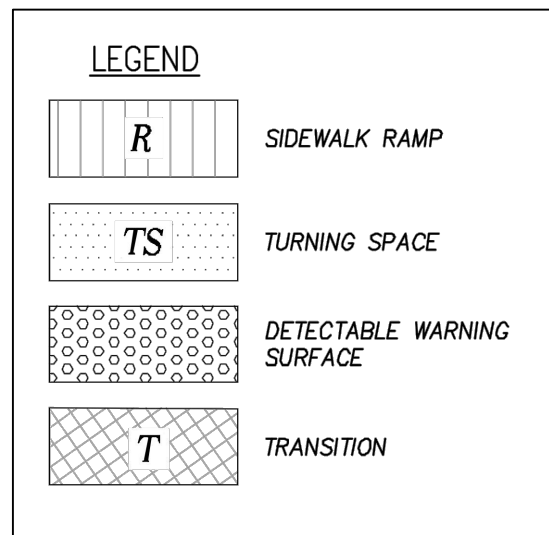


INTERSECTION / ADA RAMP ELEVATIONS

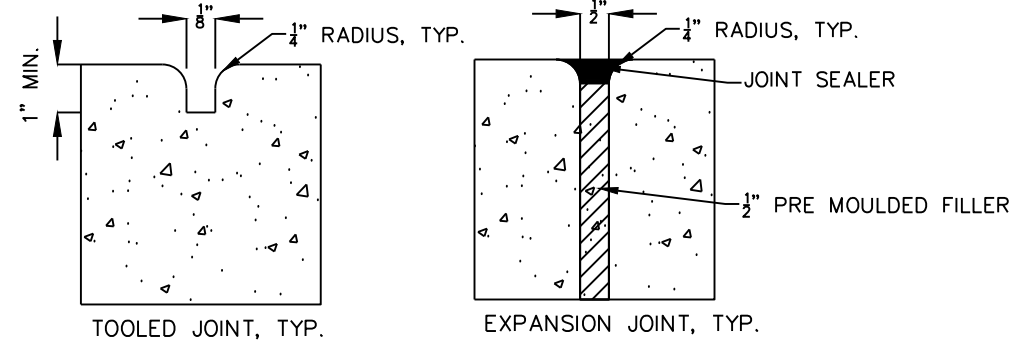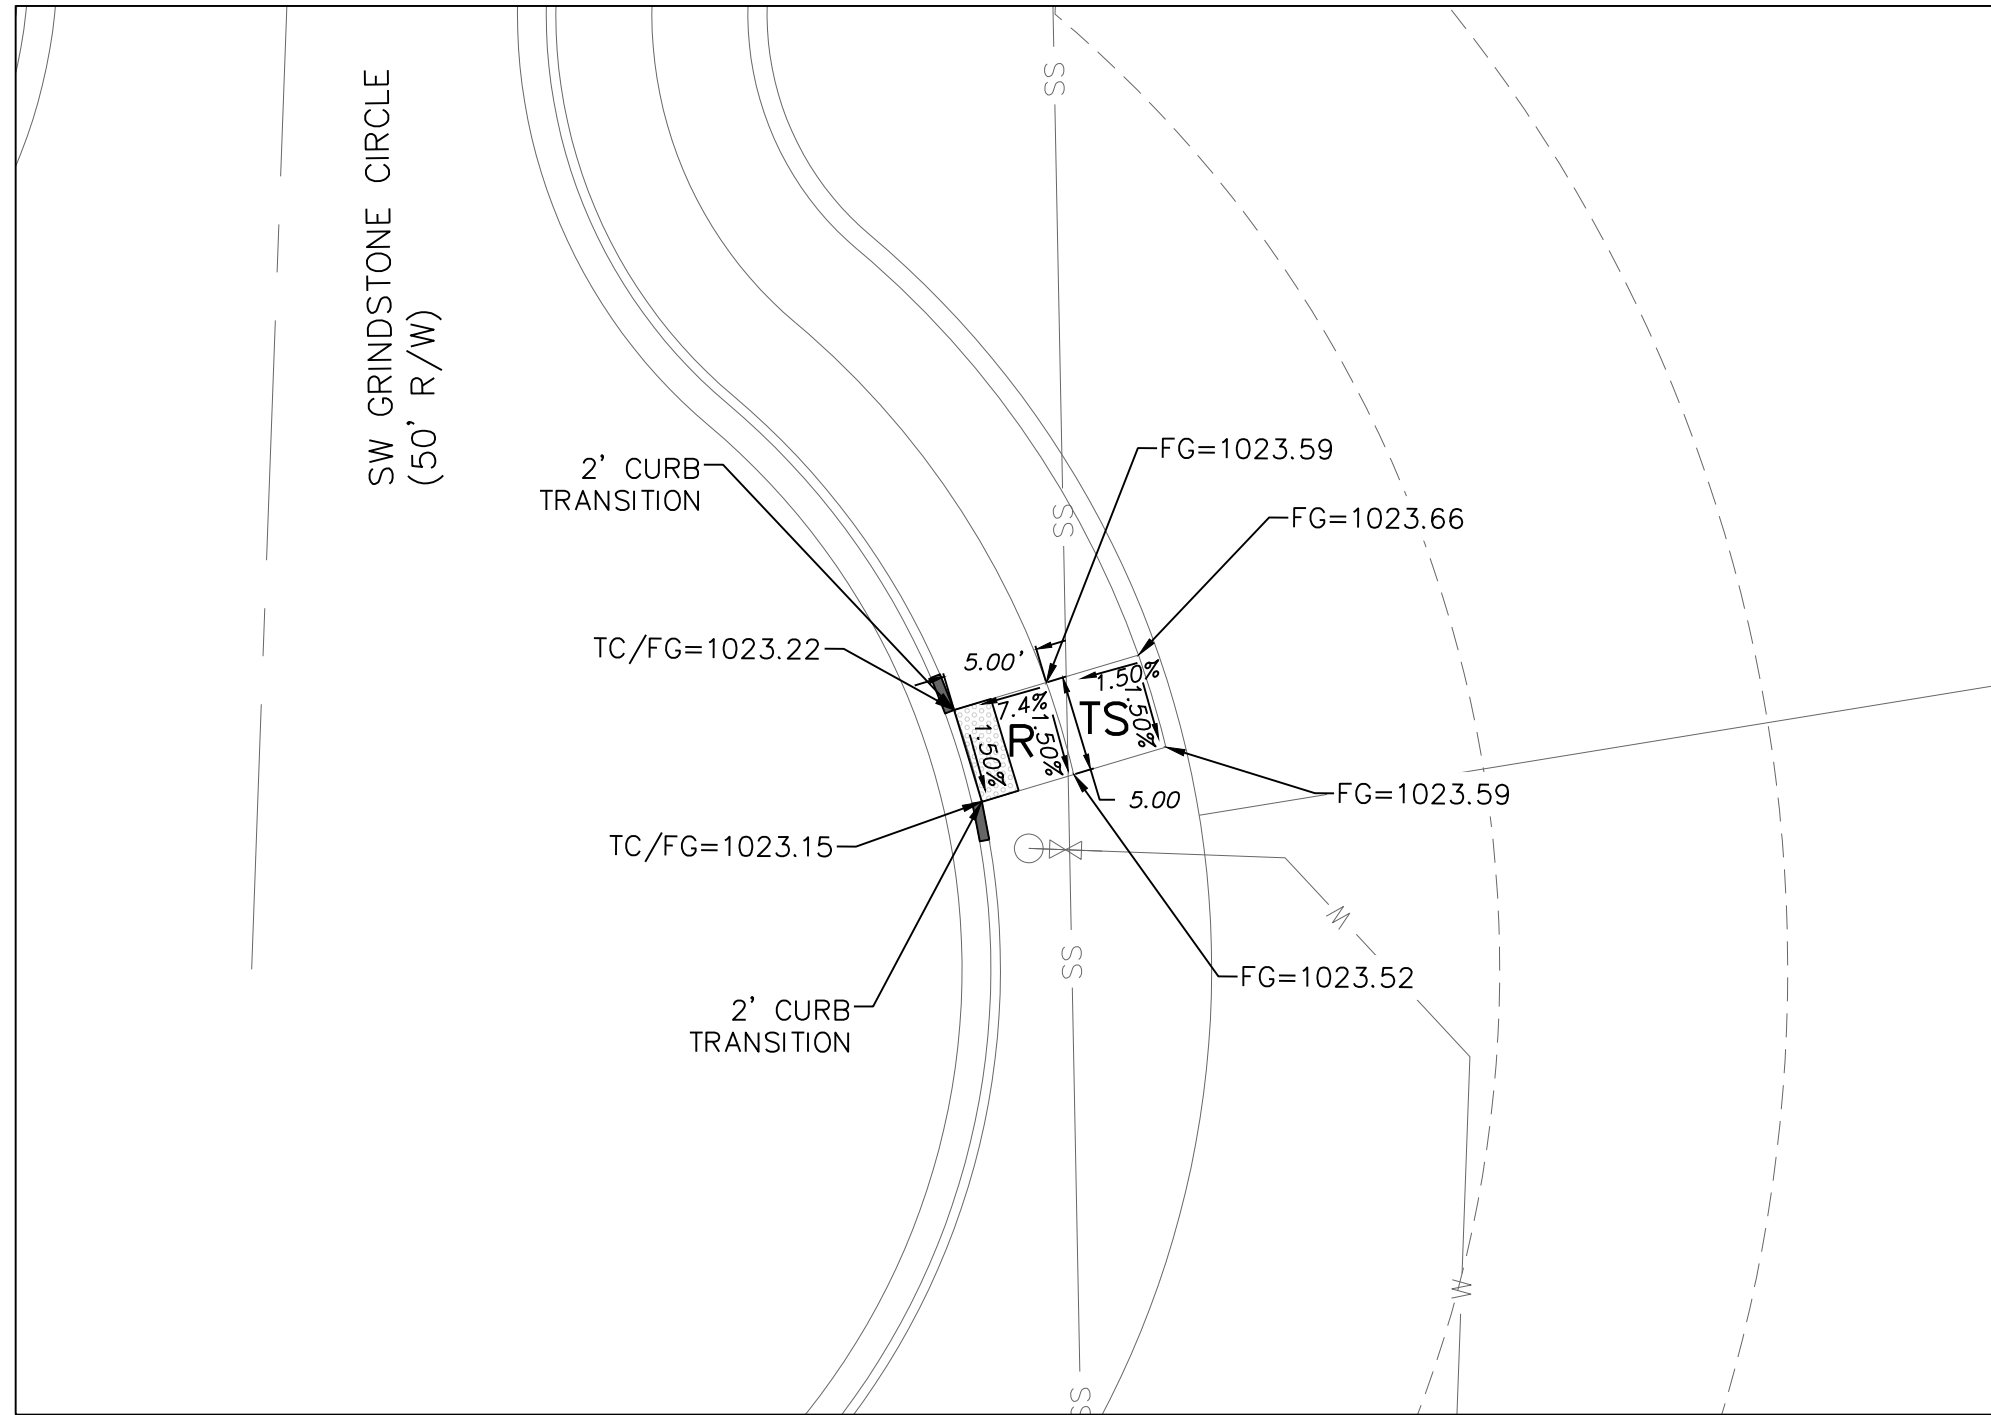

SIDEWALK NOTES:

1. CONCRETE SHALL BE CLASS A CONCRETE AIR ENTRAINED AGGREGATE SPECIFICATIONS PROVIDE 3000LB AIR ENTRAINED CONCRETE (6% AIR PLUS OR MINUS 1%)
2. 3" PRE MOULDED EXPANSION JOINTS SHALL BE PLACED AT 30'-0" CENTERS OR WHEN ABUTTING EXISTING CONCRETE/BRICK. PROVIDE SELF LEVELING SEALANT ABOVE JOINT
3. 1/8" x 1" CONTRACTION JOINTS SHALL BE PLACED AS SHOWN ON THE DRAWINGS OR AT DISTANCE NOT EXCEEDING THE WIDTH OF THE SIDEWALK IF NOT SHOWN, SAW CUT ALL JOINTS AND PROVIDE A SMOOTH FINISH.
4. KEY ALL CONSTRUCTION JOINTS.

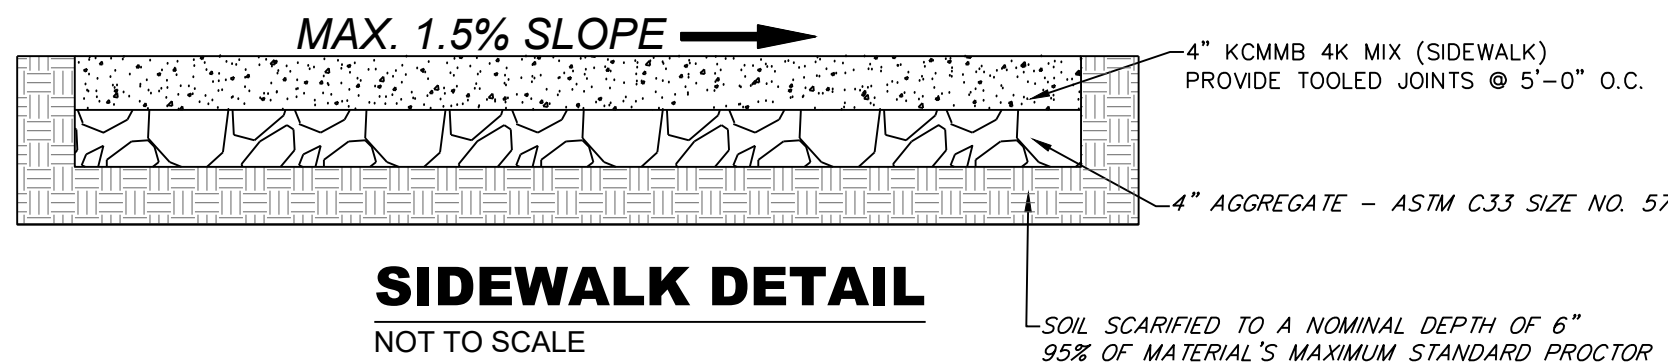

REVISIONS	
△	REV. 1-4-19
△	REV. 2-11-19
△	REV. 5-10-19
△	REV. 5-30-19
△	REV. 11-6-19