
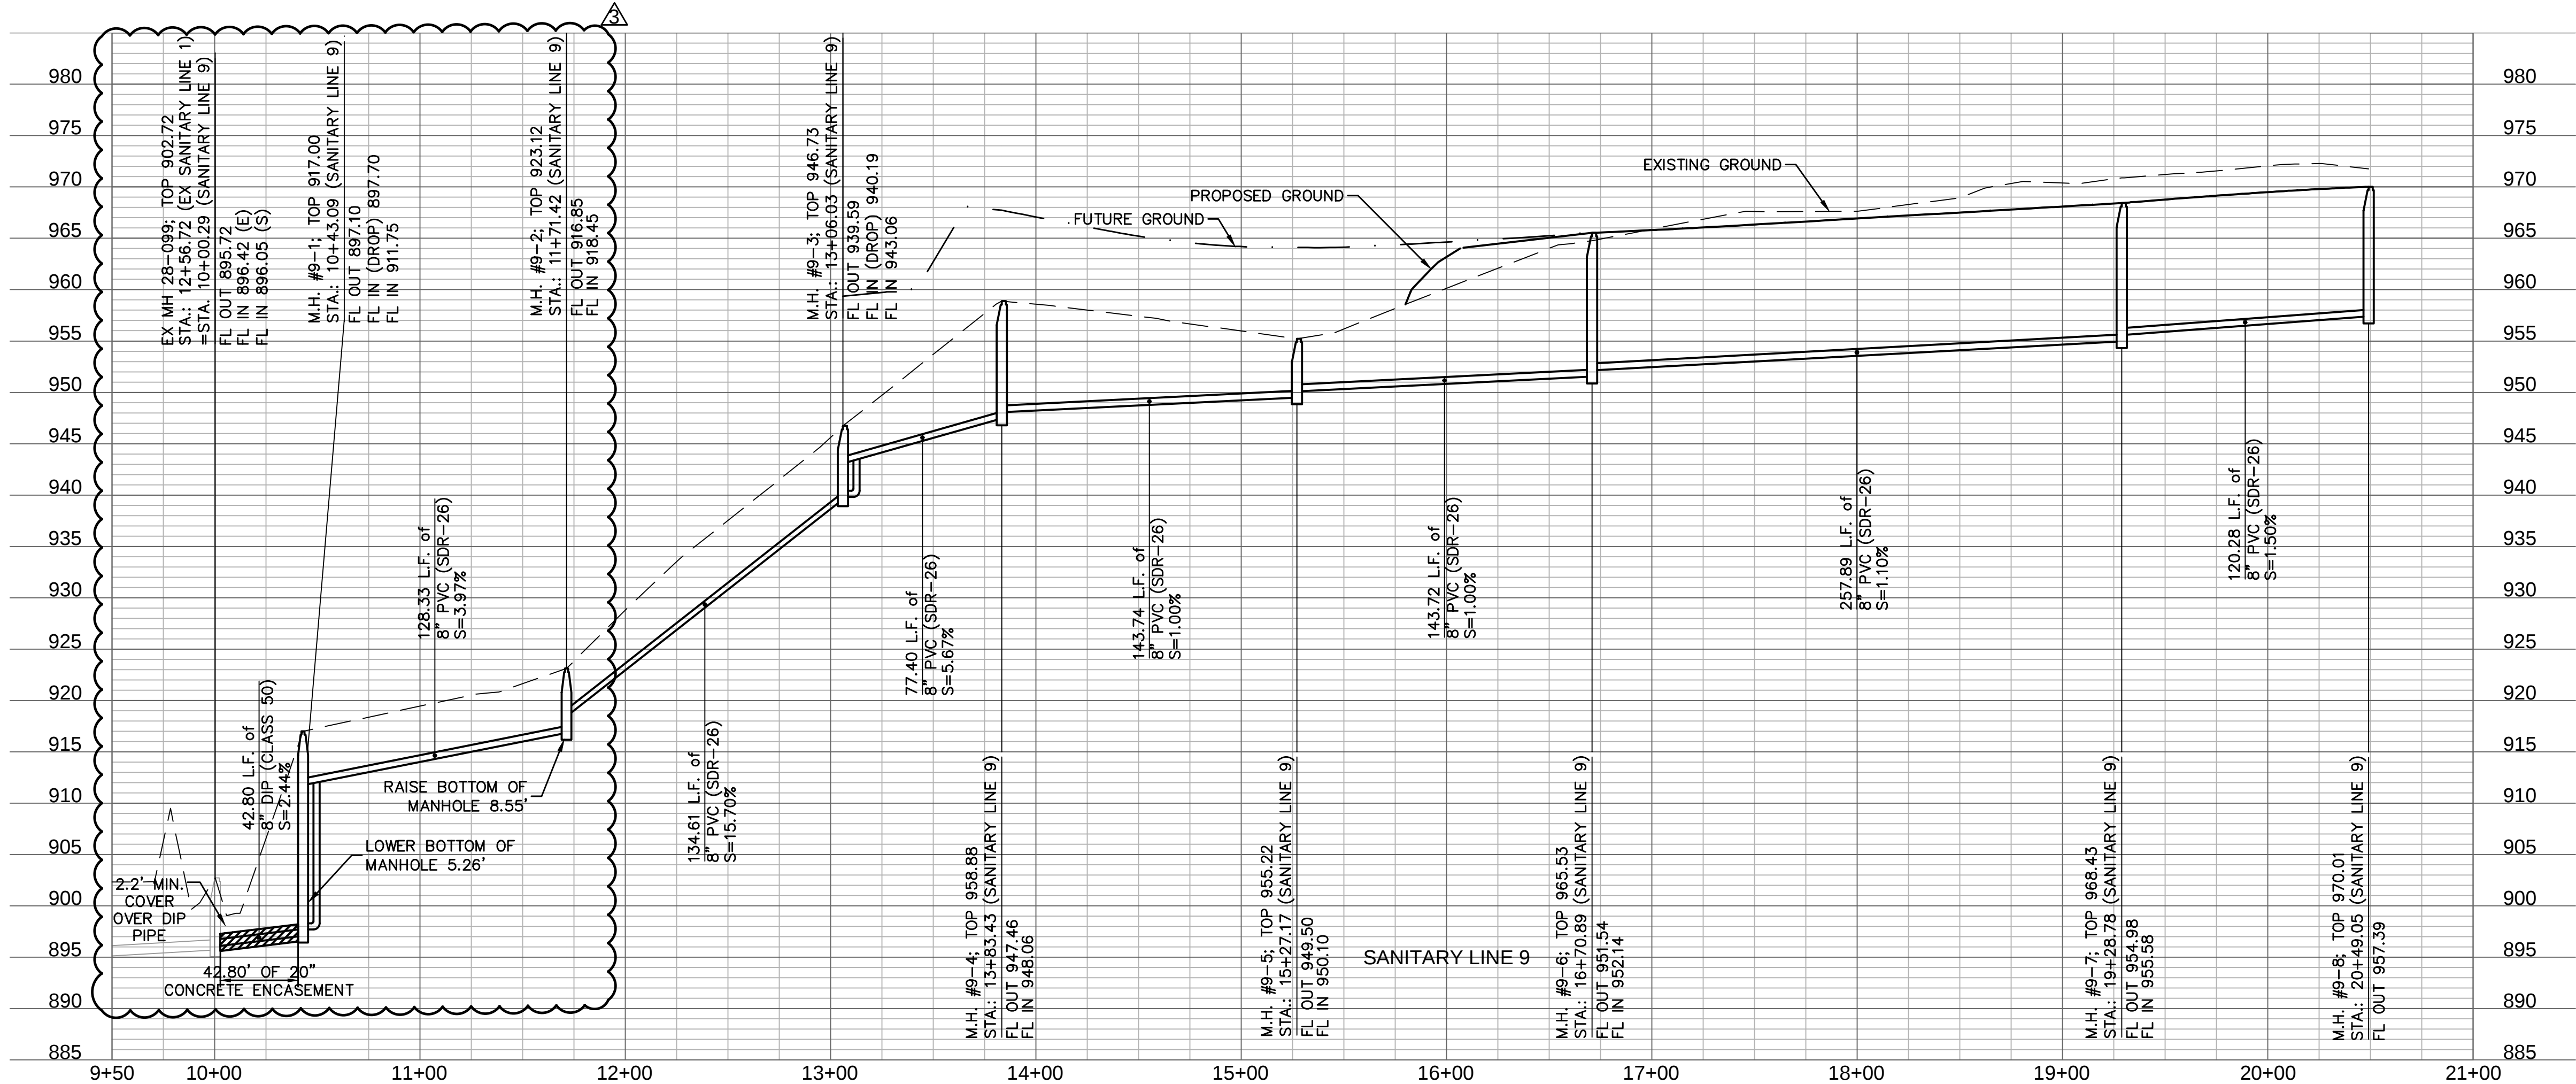
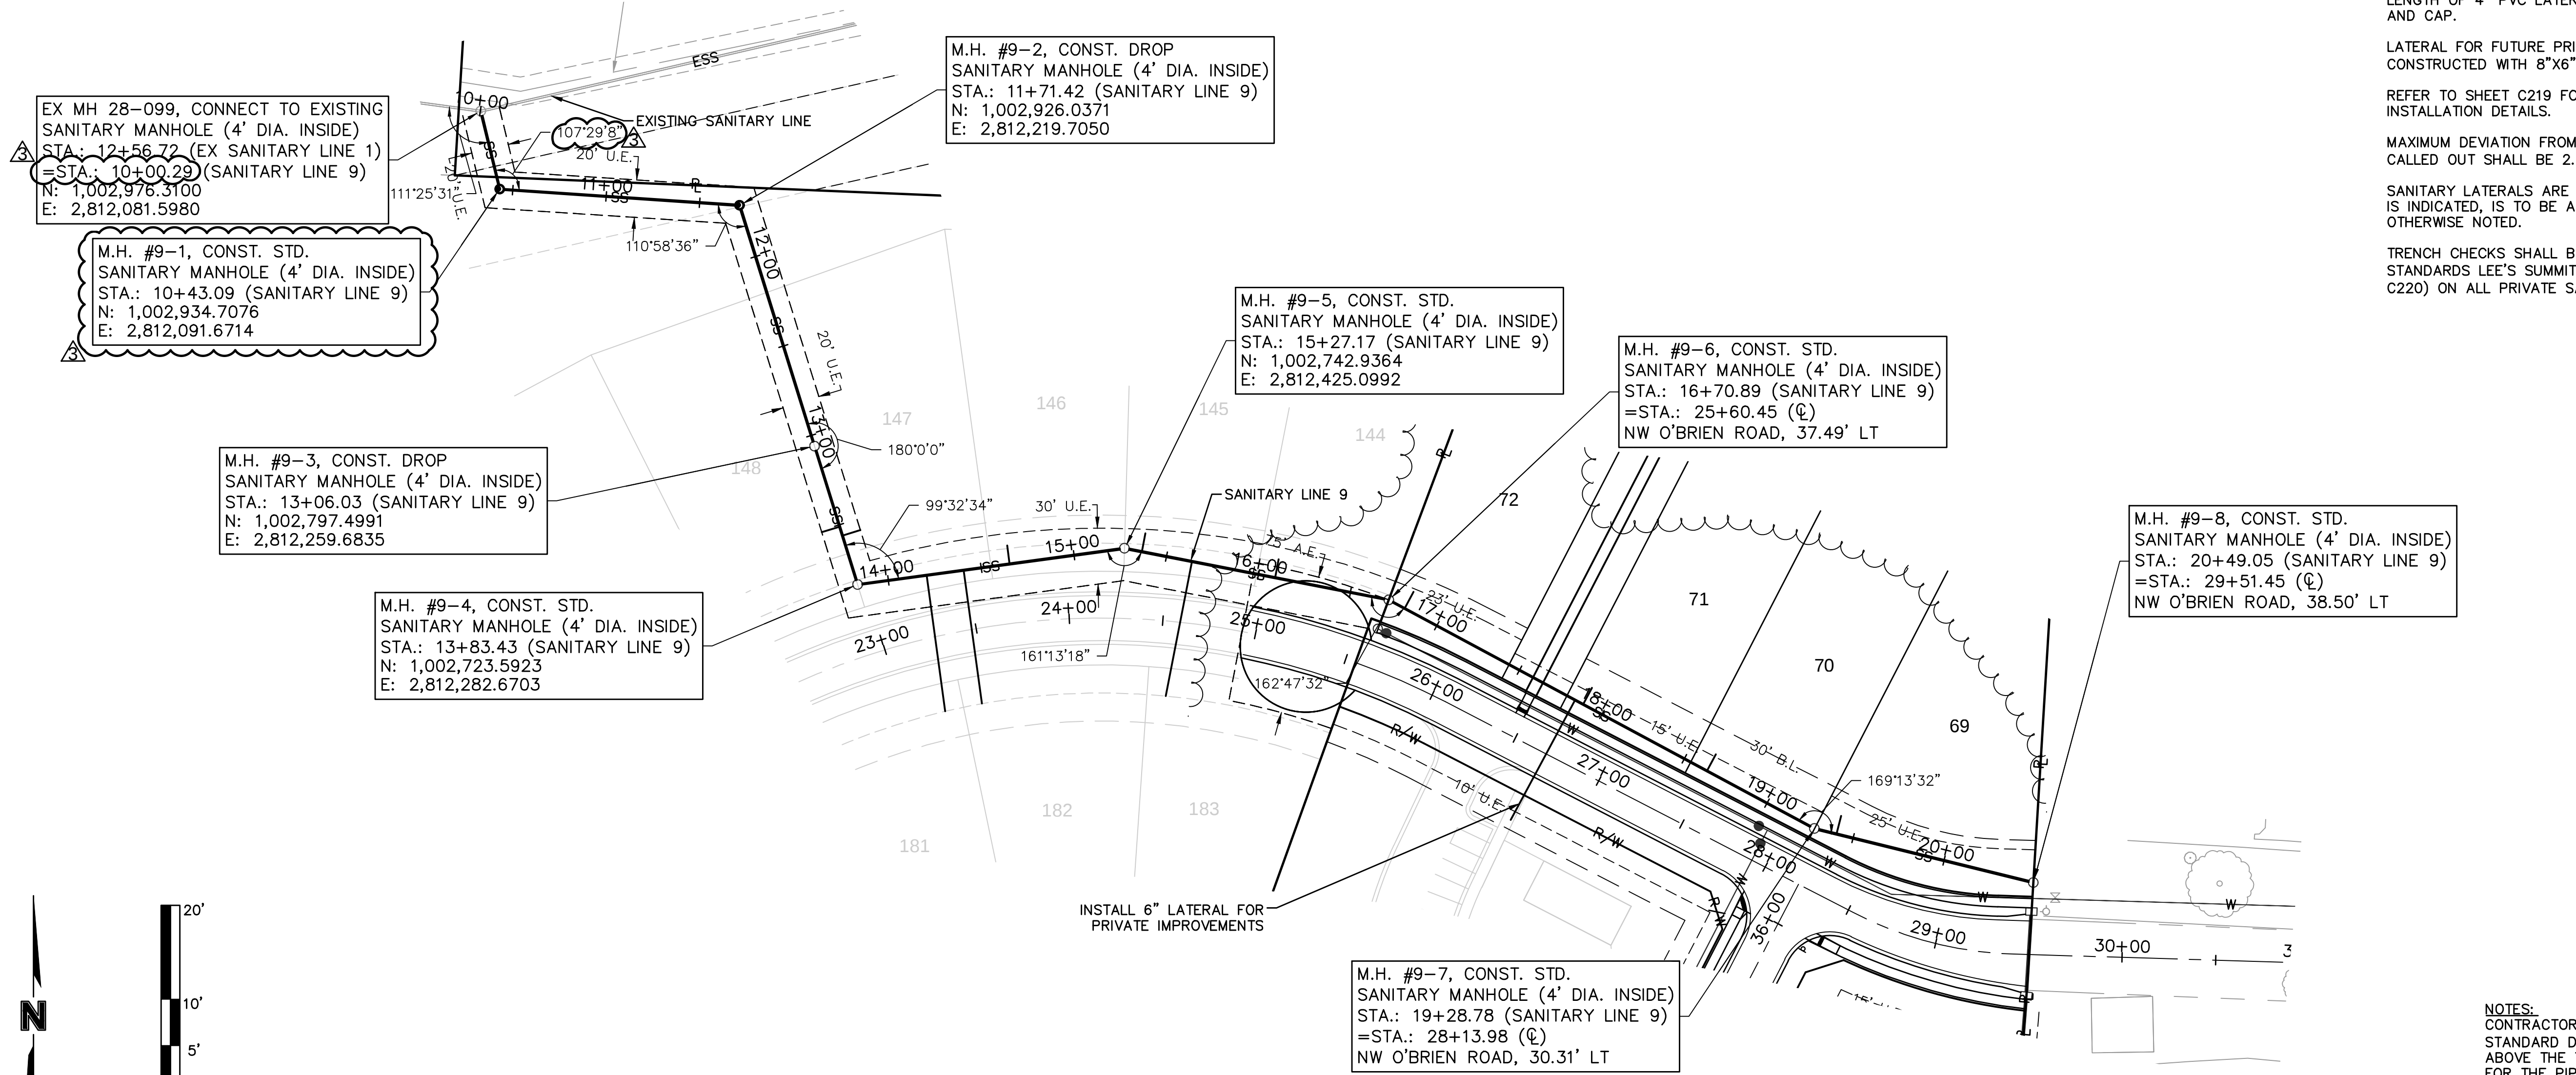


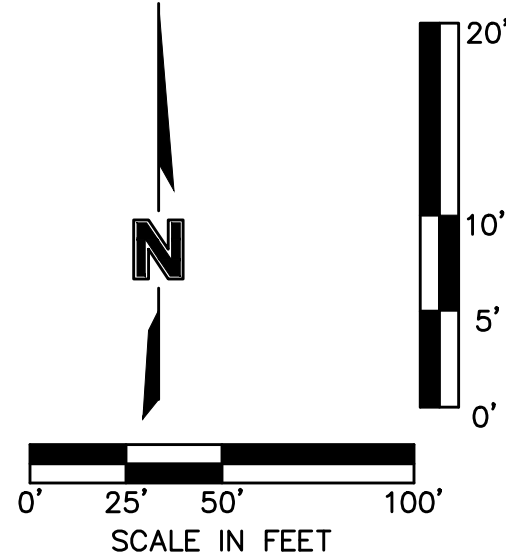

NOTES:
ALL SERVICE LINE CONNECTIONS SHALL BE MADE WITH AN 8"x4" PVC WYE, 4" PVC 45° BEND, AND THE APPROPRIATE LENGTH OF 4" PVC LATERAL (UNLESS OTHERWISE SHOWN) AND CAP.
LATERAL FOR FUTURE PRIVATE IMPROVEMENTS SHALL BE CONSTRUCTED WITH 8"x6" FITTING AND 6" PVC.
REFER TO SHEET C219 FOR SANITARY DESIGN AND LATERAL INSTALLATION DETAILS.
MAXIMUM DEVIATION FROM LATERAL STATION LOCATIONS AS CALLED OUT SHALL BE 2.0' TO AVOID PIPE JOINT.
SANITARY LATERALS ARE DESIGNED @ 2.00% SLOPE. IF RISER IS INDICATED, IS TO BE AT THE SANITARY MAIN, UNLESS OTHERWISE NOTED.
TRENCH CHECKS SHALL BE PROVIDED IN ACCORDANCE WITH STANDARDS LEE'S SUMMIT TRENCH CHECK DETAIL (SHEET C220) ON ALL PRIVATE SANITARY SEWER SERVICE LATERALS.

NOTES:
CONTRACTOR SHALL FILL AND COMPACT TO 95% STANDARD DENSITY TO A POINT 36" MINIMUM ABOVE THE TOP OF PIPE PRIOR TO EXCAVATION FOR THE PIPE.

BY

NO. REV.

DATE

REVISIONS DESCRIPTION

10/31/2019

11/25/2019

REVISED PER CITY COMMENTS

REVISED PER CITY COMMENTS

SANITARY SEWER PLAN & PROFILE
SANITARY SEWER PLANS

WOODSIDE RIDGE
FIRST PLAT

LEE'S SUMMIT, MO

drawn by: D.A.H.O.
checked by: J.E.S.
designed by: S.M.S.
QA/QC by: M.G.D.
project no.: A18-1140
date: 2019.11.25

SHEET
C215

2019

REVISIONS

olsson

NO. 0000000000
Professional Engineer
SAYLOR
NUMBER
PE-2018021246
NORTH KANSAS CITY, MO 64116
TEL. 816.861.1177
www.olsson.com