




A development for Detail Facility – Balderston

Section 29, Township 48 North, Range 31 West
City of Lee's Summit, Jackson County, Missouri

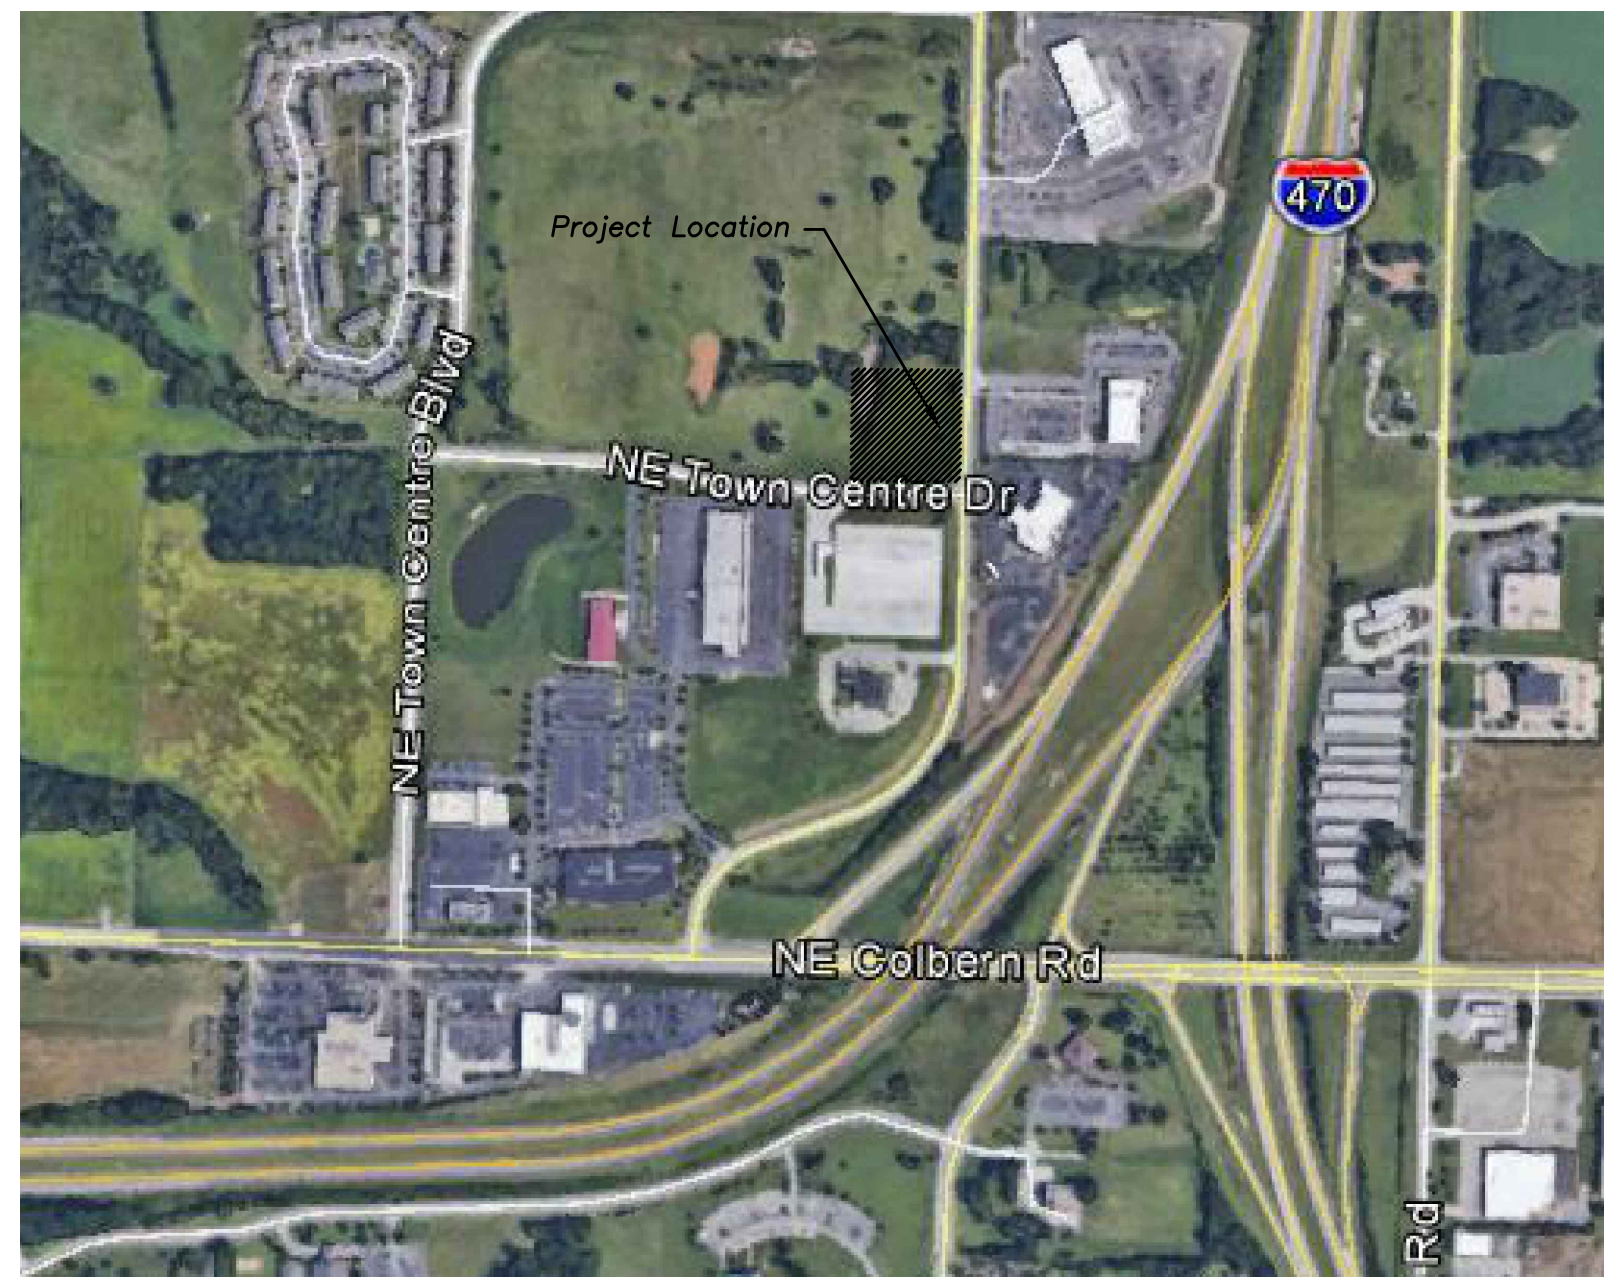

2 Vicinity Map
1" = 500'
0 250 500 1000

Local Benchmarks: BM-#

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Floodplain Note:

The site lies entirely within 'Zone X', areas determined to be outside the 0.2% annual chance floodplain as depicted on the FEMA Flood Insurance Rate Map (FIRM) no. 29095C04306, Revision Date: January 20, 2017.

Property Legend

- right of way
- - - property lines
- - - easements
- - - setbacks

Grading Legend

- - - existing minor contour
- - - existing major contour
- - - proposed minor contour
- - - proposed major contour

Utility Legend

- existing
- - - proposed

Linetypes


- sanm sanitary main
- sans sanitary service
- ssm storm sewer (existing)
- ssms storm sewer (solid wall, proposed)
- slm storm sewer (solid wall, proposed)
- ssmf storm sewer (perforated, proposed)
- wlm water main
- wlrf water service (fire)
- wlrd water service (domestic)
- wlri water service (irrigation)
- gasm natural gas main
- gass natural gas service schematic
- elpu underground primary electric
- elss underground secondary electric
- elpo overhead electric
- datu underground cable/phone/data
- datss underground cable/phone/data service
- fence-chainlink
- fence-wood
- fence-barbed wire
- treeline

Utility Contacts

- Sanitary – City of Lee's Summit – phone (816) 969-1900
- Water – City of Lee's Summit – phone (816) 969-1900
- Storm Sewer – City of Lee's Summit – phone (816) 969-1900
- Electric – Evergy – phone (888) 471-5275
- Gas – Spire – phone (816) 756-5252
- Telephone – AT&T – phone (800) 464-7928
- Cable – Spectrum – phone (816) 358-8833

Symbols

- ⊙ sanitary manhole
- ⊙ service cleanout
- ⊙ force main release valve
- rectangular structure
- circular structure
- ⊕ fire hydrant
- ⊙ water valve
- ⊙ water meter
- ⊙ backflow preventer
- ⊙ natural gas meter
- ⊙ service transformer (pad mount)
- ⊙ primary switch gear
- ⊙ light pole
- ⊙ cable/phone/data junction box
- ⊙ street light
- ⊙ pedestrian street light
- ⊙ electric pole
- guy wire
- ⊙ end section

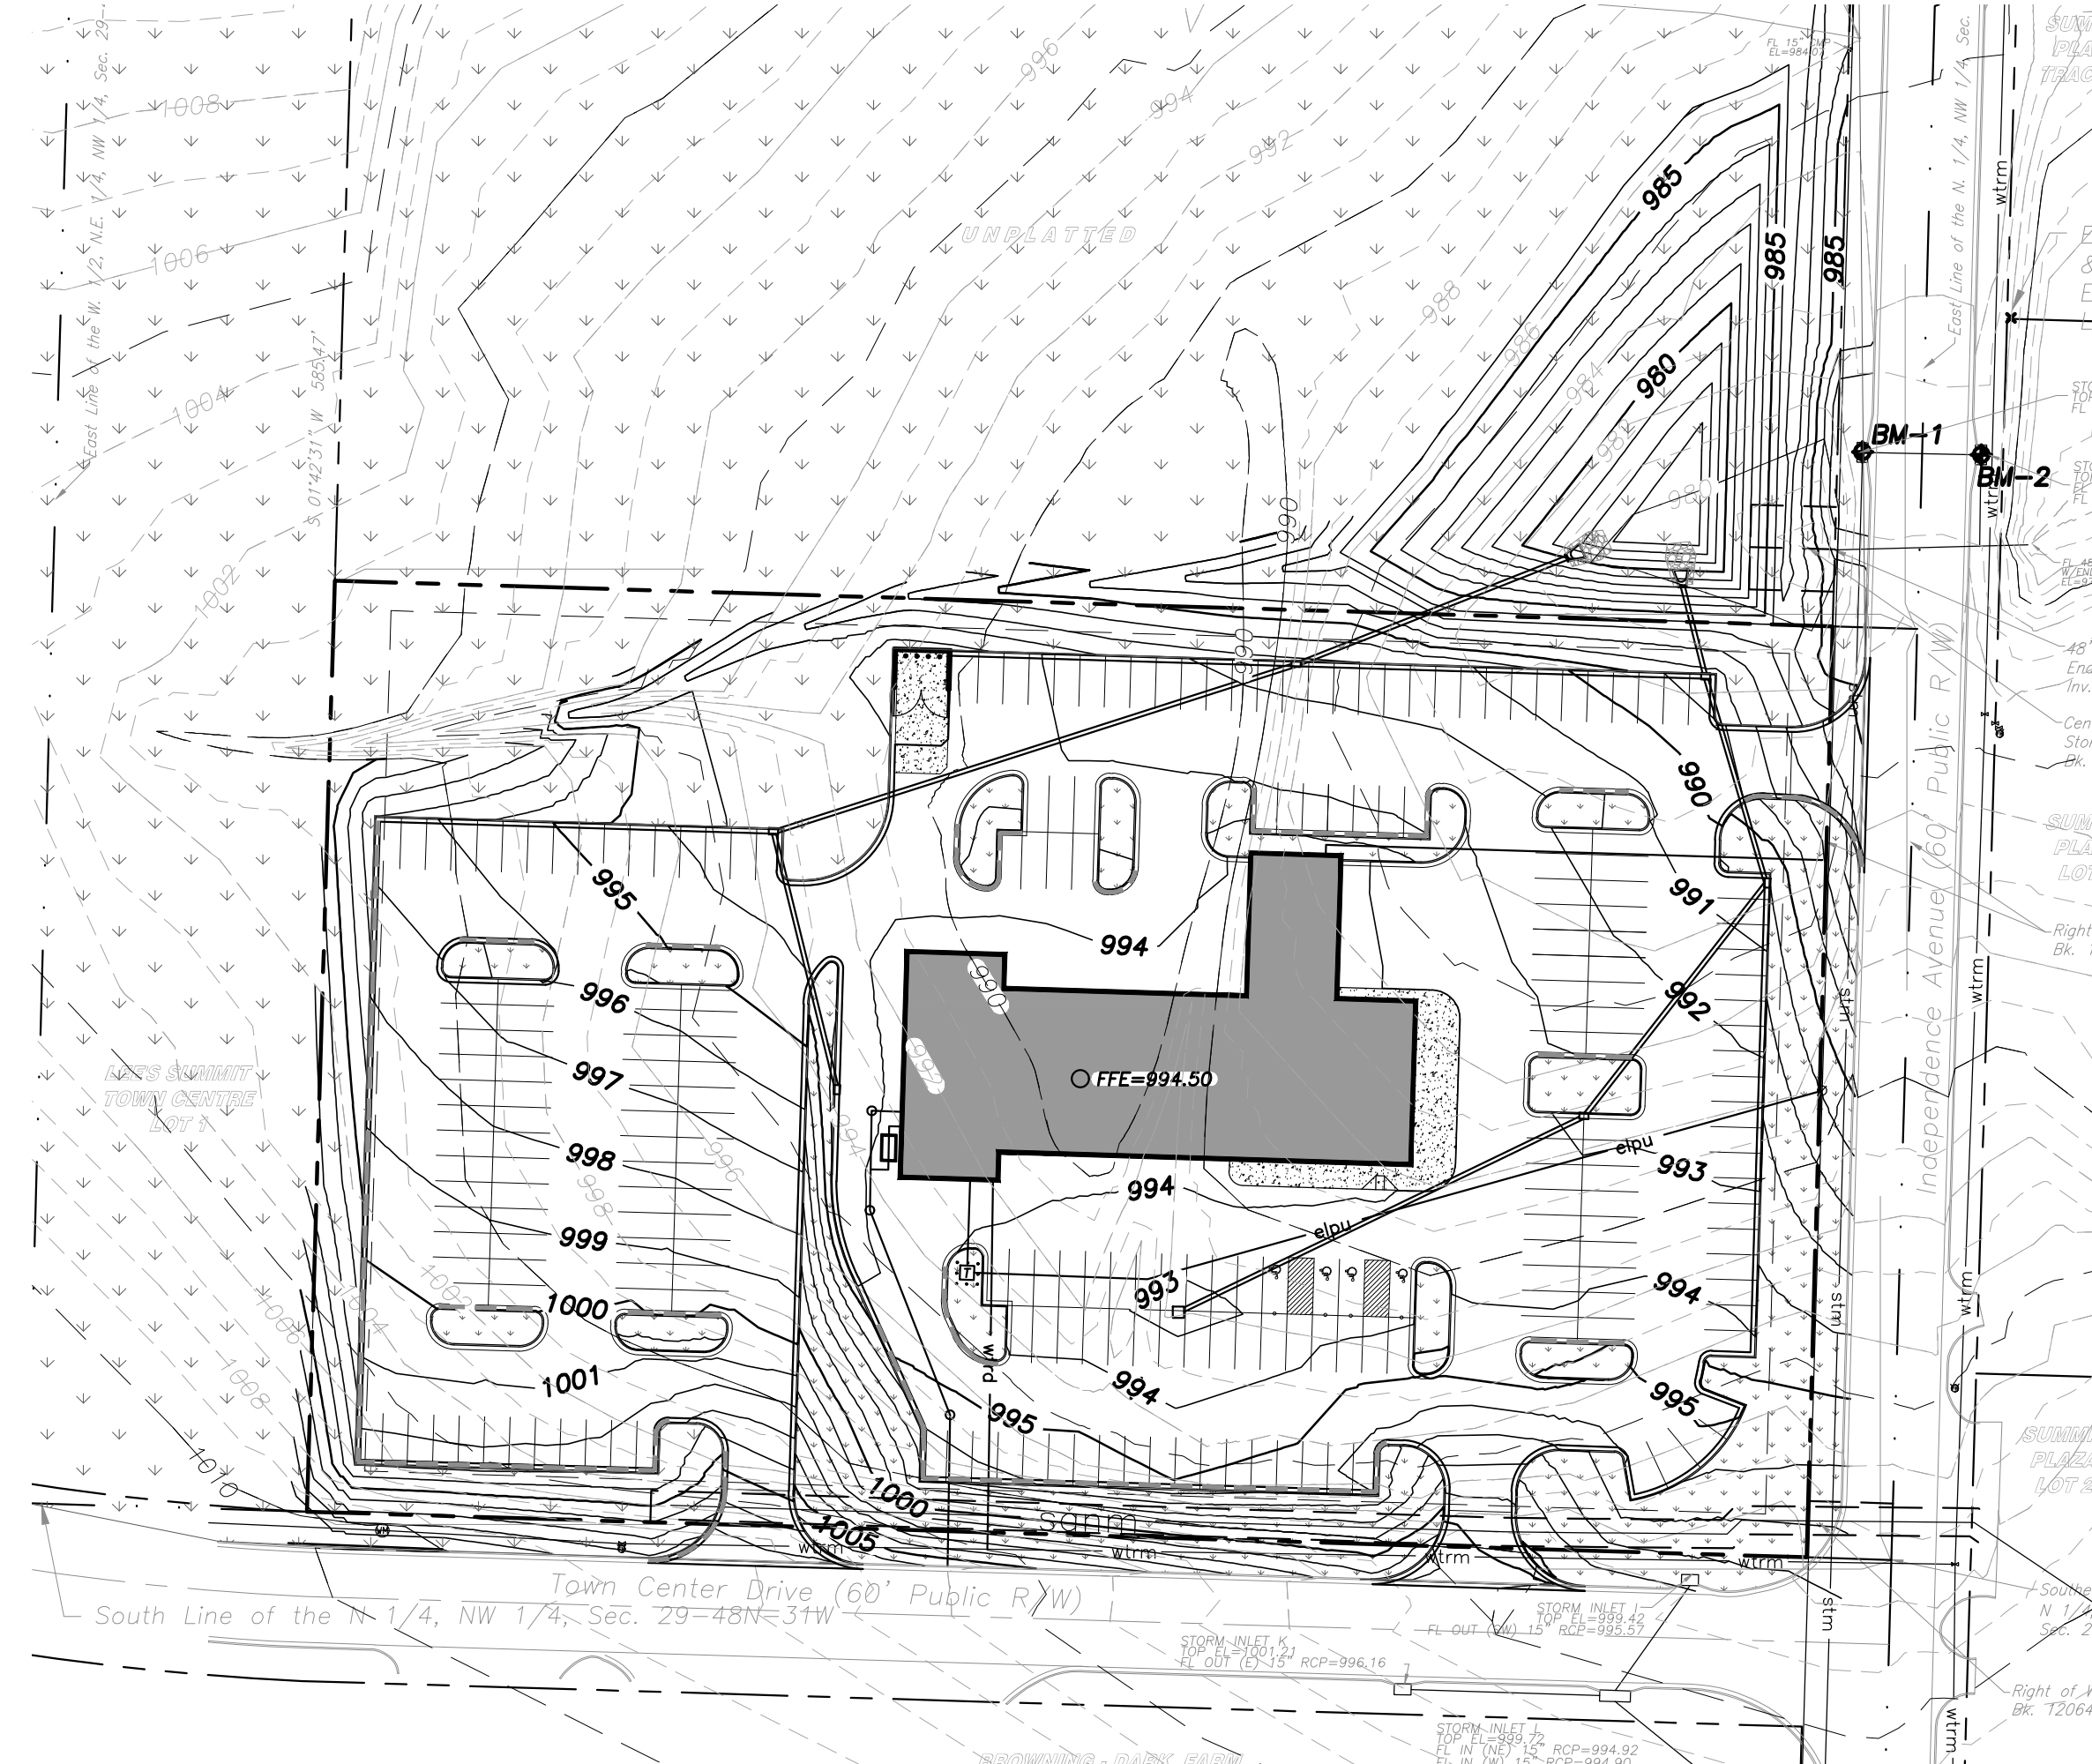

1 Location Map
1" = 100'
0 50 100 200

General Notes

- All work within the road right-of-way shall conform to the technical specifications and design criteria for public improvement projects of the city of Lee's Summit, MO.
- Erosion Control shall be per the Erosion and Sediment Control Program Manual of the City of Lee's Summit, MO.
- All work and materials shall be subject to inspection and approval by the owner or the owner's representative. Any change or deviation from these plans must be authorized by the owner or the owner's representative.
- All traffic control in connection with construction in the right-of-way shall be in conformance with the Manual of Uniform Traffic Control Devices.
- The contractor shall be required to provide a stabilized construction entrance to prevent mud from being deposited onto adjacent roads.
- The contractor shall be responsible for obtaining all required permits, paying all fees, and otherwise complying with all applicable regulations governing the project.
- The contractor shall protect from damage or injury all property including survey monuments, property markers, benchmarks, etc. Items damaged shall be reset by a professional land surveyor licensed in the state of Missouri, at the contractor's expense.
- The contractor shall be responsible for the restoration of the right-of-way and for damaged improvements such as curbs, sidewalks, street light and traffic signal junction boxes, traffic signal loop lead-ins, signal poles, etc. Damaged improvements shall be repaired in conformance with the latest city standards and to the city's satisfaction.
- The contractor shall sod all disturbed areas within the public street right-of-way.
- Paving shall conform to the soils report, and these drawings, any identified discrepancies shall be brought to the attention of the engineer.
- Contractor shall provide 48-hour notification to the city engineering division to schedule all required inspections.
- All concrete for public improvements shall comply with the Standards and Specifications of the Kansas City Metropolitan Materials Board (KCMMB). Structural concrete shall be 5,000 psi and nonstructural concrete shall be 4,000 psi.
- A right-of-way work permit and/or street excavations permit shall be obtained by the contractor to complete all utility work within the public street right-of-way.

Sheet Index

- C1.0 – Cover Sheet
- C1.1 – Civil Notes
- C1.2 – Site Plan
- C1.3 – Utility Plan
- C2.1 – Grading Plan
- C2.2 – Phase I Erosion Control Plan
- C2.3 – Phase II Erosion Control Plan
- C2.4 – Spot Elevation Plan
- C3.1 – Drainage Area Map
- C3.2 – Storm Sewer Plan & Profile
- C4.1 – Details
- C4.2 – Details
- C4.3 – Details
- C4.4 – Details

Civil Engineer:

Davidson Architecture & Engineering, LLC
Mr. Paul A. Miller, P.E.
4301 Indian Creek Pkwy.
Overland Park, KS 66207
Phone: (913) 451-9390
Email: Paul@davidsonae.com

Owner Information

Lee's Summit Town Center, LLC
Bob Balderston
3200 NW South Outer Road
Lee's Summit, MO 64105

Utility Notes

- Boundary information, existing utilities and topographic features shown are based on information supplied by owner, surveyor, and others.
- The existing utility locations shown on these plans are approximate and may not include all utility lines present. The contractor shall be responsible to make One Call and coordinate field location of all existing underground utilities prior to beginning excavation/construction activities.
- The contractor shall be responsible for any damage to any utilities or their structures during excavation/construction activities.
- The contractor shall coordinate and be responsible for connection fees, system development fees, taxes, etc. for all main connections and/or extensions with and from the city and/or respective utility unless otherwise coordinated with the Owner. All utility services for this project shall be coordinated with respective utility company by contractor.
- The contractor shall be responsible for adjusting all at-grade utilities such as manhole covers, valve box covers, etc. to finish grade, whether specifically indicated in these plans or not.
- Utilities shown on the plan with specific elevations and/or structure locations are SUE quality level "B", ie: storm sewer, sanitary sewer, water hydrants & valves, utility poles, etc. All other existing utility information shown is SUE quality level "D", primarily retracement of one-call and city records.

Project Information

- governing municipality: Lee's Summit, Missouri
- zoning: CP-2
- site area: ~175,306 s.f. or ~4.02 acres
- impervious area: 124,303 s.f. 71% < 80%
- green area: 51,003 s.f. 29% > 20%
- total building area: 15,993 s.f.
- required parking: service establishment
5 parking spaces per 1,000 s.f.
5 x 16,000 s.f. = 80 parking spaces
- actual parking on site: 232 parking spaces

Legal description:

A part of the Northeast Quarter of the Northwest Quarter, Section 29, Township 48 North, Range 31 West, Lee's Summit, Jackson County, Missouri, described as follows:
Commencing at the Northeast corner of the Northwest Quarter of said Section 29; thence S 1°35'52"W along the East line of the Northeast Quarter of the Northwest Quarter for 991.63 feet to the Point of Beginning; thence S 1°35'52"W continuing along said East line for 330.00 feet to the Southeast corner of the Northeast Quarter of the Northwest Quarter; thence N 88°15'22"W along the South line of the Northeast Quarter of the Northwest Quarter for 561.55 feet to the Southeast corner of LEE'S SUMMIT TOWN CENTRE, LOT 1 & LOT 2, a subdivision of record; thence N 1°42'31"E along the East line of said subdivision for 330.00 feet; thence S 88°15'22"E for 560.91 feet to the Point of Beginning. Subject to the road right-of-way of Independence Avenue. Containing 4.25 acres more or less.

A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date: 02.21.2020
drawn by: SLM
checked by: PAM
revisions:

sheet number

C1.0

drawing type: preliminary
project number: 19076

General Notes:


- The Contractor shall be responsible for obtaining all required permits, paying all fees, and otherwise complying with all applicable regulations governing the project.
 - All materials, workmanship, and construction shall meet or exceed the city standards. Where there is conflict between these plans and standards, the higher quality standard as determined by the engineer shall apply. All work shall be inspected and approved by contractor.
 - All work and materials shall be subject to inspection and approval by the owner or the owner's representative. Any change or deviation from these plans must be authorized in writing by the owner or the owner's representative prior to work being completed.
 - The work associated with and based on these plans, shall be subject to the requirements of, and conform to, the Municipal Code of Lee's Summit, MO, and the standards and specifications in current use. The standards, specifications, details, and procedures sub-referenced therein are hereby incorporated by reference.
 - Lineal foot measurements shown on the plans are horizontal measurements, not slope measurements. All payments shall be made on horizontal measurements.
 - No geological information is shown in these plans.
 - Prior to commencement of work, the contractor shall notify all utility companies which have facilities in the near vicinity of the construction to be performed.
 - All waste material resulting from the project shall be disposed of off-site in an approved landfill. All excavation shall be unclassified. No separate payment will be made for rock excavation. Contractor is responsible for all haul off material.
 - The Contractor shall be required to provide a stabilized construction entrance to prevent mud from being deposited onto adjacent roads.
 - All mud, dirt, and debris tracked onto the parking lot or any roadway shall be removed immediately by the contractor.
 - The Contractor shall be responsible for keeping the public streets in the vicinity of the job site clean and free of rocks, soil and debris. Streets and/or parking areas will be scraped and swept on a daily basis by the general contractor.
 - The Contractor shall protect from damage all survey monuments, property markers, benchmarks, etc. Items damaged shall be reset by a professional land surveyor licensed in the state of Missouri, at the contractor's expense.
 - Paving shall conform to the geotechnical report and these drawings, any identified discrepancies shall be brought to the attention of the engineer immediately. If no geotech. report is provided for the project, the contractor shall use the minimum design standards as required by the city.
 - The Contractor shall provide 48-hour notification to the city engineering division or proper city staff to schedule all required inspections.
 - All concrete for public improvements shall comply with the city standards and specifications. If no city standards and specifications are provided, then the contractor shall comply with the standards and specifications of the Kansas City Metropolitan Materials Board (KCMMB) unless otherwise noted. Structural concrete shall be 5,000 psi and nonstructural concrete shall be 4,000 psi.
 - The contractor shall be responsible for the restoration of the right-of-way and for damaged improvements such as curbs, sidewalks, street light and traffic signal junction boxes, traffic signal loop lead-ins, signal poles, etc (offsite and onsite). Damaged improvements shall be repaired in conformance with the latest city standards and to the city's satisfaction.
 - All work within the road right-of-way shall conform to the technical specifications and design criteria for public improvement projects of the city of Lee's Summit, MO or the transportation department of Missouri. A right-of-way work permit and/or street excavations permit shall be obtained by the contractor if required to complete all work within the public right-of-way.
 - All traffic control in connection with construction in the right-of-way shall be in conformance with the Manual of Uniform Traffic Control Devices and/or the jurisdictional authority. It is the contractor's responsibility to obtain a traffic control permit if required.
 - All waste materials, trash and construction debris shall be collected and stored in dumpsters. No construction waste shall be buried on site. All hazardous waste materials will be disposed of in the manner specified by local, state and federal regulations. Site personnel shall be instructed in these practices, and the construction manager shall be responsible for seeing that these practices are followed.
 - Recommendations made by the geotechnical engineer, to be retained by the owner, and contained in the geotechnical report shall govern project conditions unless noted otherwise. Paving shall conform to the geotechnical report. Any discrepancies shall be brought to the attention of the engineer.
 - The Contractor shall grade areas to provide positive drainage.
 - The contractor shall be responsible for the coordination of work between suppliers and subcontractors involved in the project, including staging of construction details.
 - All disturbed areas shall be maintained for dust control. Sprinkling tank trucks shall be available at all times & used on on-site disturbed areas, and other areas where dust becomes a problem as a result of construction activity.
 - Nothing indicated on these drawings shall relieve the contractor from complying with appropriate safety regulations.
- #### Utility Notes:
- Boundary information, existing utilities and topographic features shown are based on information supplied by owner, surveyor, and others.
 - The existing utility locations shown on these plans are approximate and may not include all utility lines present. The contractor shall be responsible to contract "One Call" and coordinate field location of all existing underground utilities prior to beginning excavation/construction activities.
 - The contractor shall be responsible for any damage to any utilities or their structures during excavation/construction activities. Utilities include but are not limited to a service such as electricity, communication, water, public transportation (including traffic signals), storm systems, and items provided by a public utility.
 - The contractor shall coordinate and be responsible for connection fees, system development fees, taxes, etc. for all main connections and/or extensions with and from the city and/or respective utility unless otherwise coordinated with the Owner. All utility services for this project shall be coordinated with respective utility company by contractor.
 - The contractor shall be responsible for adjusting all at-grade utilities such as manhole covers, valve box covers, etc. to finish grade, whether specifically indicated in these plans or not.
 - Utilities shown on the plan with specific elevations and/or structure locations are SUE quality level "B", ie: storm sewer, sanitary sewer, water hydrants & valves, utility poles, etc. All other existing utility information shown is SUE quality level "D", primarily retracement of one-call and city records.
 - Refer to mechanical, electrical, and plumbing (MEP) plans for utility service sizes and exact locations. Refer to site electric plans for electric construction details.
 - Provide temporary support for existing utility lines that are encountered during construction until backfilling is complete.
 - Backfill all utility trenches according to the most recent edition of the jurisdictional standards.
 - All utilities shall be brought within 5' of the building to connect to plumbing contractors work unless otherwise specified.
 - The Contractor shall adjust all utility fixtures, manholes and inlets to finished grade as required.
 - The Contractor shall maintain 18" minimum vertical clearance between storm sewer and sanitary sewer pipes and 18" minimum vertical clearance between sanitary sewer and water main unless otherwise specified.
 - Contractor shall prevent entry of mud, dirt, debris, and other material into new and existing storm sewer systems. Should any contamination occur during construction, the contractor shall clean at contractor's expense. Upon completion of all storm sewer improvements, all new and existing pipe and structures shall be cleaned out.
 - Electrical, lighting, and data conduit layout shown is for graphical purposes only. See MEP plans for more detail.
 - The Contractor shall provide all temporary power, process, and utility service bypasses and connections as required.

Erosion Control Notes:

- The installation of the silt fencing, the maintenance of the drainage swales, and the construction of the stabilized entrance shall be completed prior to any clearing and grading of any portions of the site. Disturbed portions of the site where construction activities have permanently ceased shall be stabilized with permanent seeding no later than 14 days after the last construction activity, refer to SWPPP. Roadway swales shall be stabilized with Erosion Control Devices. Once construction activity ceases permanently in an area, that area shall be stabilized with permanent seed and mulch. Only after the entire site has been stabilized, the silt fencing shall be removed.
 - The general contractor, or designated Erosion Control Contractor, shall be responsible for construction and maintenance of erosion control devices and practices. The contractor shall be responsible for implementation of, and ensuring compliance of, the project Storm Water Pollution Prevention Plan (SWPPP), a copy of which shall be obtained from the Design Engineer. The SWPPP shall be maintained on site per NPDES requirements and shall be available for review at any time, by any authorized Federal, State, or local review official, as well as the Design Engineer. The general contractor, or designated Erosion Control Contractor, shall also be responsible for ensuring compliance with, and paying any fees associated with, the State of Missouri General Permit for Stormwater Runoff associated with construction activities, a copy of which shall be maintained in the aforementioned SWPPP.
 - This project shall be constructed in compliance with the soil erosion and sedimentation control permit, and conform to the standards and specifications of the city of Lee's Summit, MO, prior to any land disturbance changes.
 - Erosion and any sedimentation from work on this site shall be contained on the site and not allowed to collect on any offsite areas or in waterways. Waterways include both natural and man-made open ditches, streams, storm drains, lakes and ponds. Refer to erosion control plans for more information.
 - The contractor shall be responsible to control downstream erosion and siltation during all phases of construction. Erosion Control work and procedures shall be in place prior to beginning excavation/construction activities. To ensure progressive stabilization of disturbed earth, Erosion control devices shall be staged, installed and maintained throughout land disturbance activities as directed in the drawings, project manual and in accordance with all federal, state and local standards until the site is stabilized.
 - The contractor shall implement and maintain Erosion Control Devices as shown in the drawings and project manual before, and at all times during the construction of this project. Any modifications to the devices due to construction or changed conditions shall be complied with as required or as directed by the city of Lee's Summit, MO.
 - The contractor shall be responsible for installation and maintenance of all Erosion Control Devices. This includes providing berms, silt fence, or other means to prevent erosion from reaching the right of way and offsite boundaries. In the event the prevention measures are not effective, the contractor shall remove any debris and erosion, restoring the right of way to original or better condition.
 - Contractor is to provide erosion protection for all storm sewer inlets.
 - If any of the Erosion Control Devices on the site are deemed inadequate or ineffective, the city of Lee's Summit, MO has the right to require additional Erosion Control measures at the expense of the general contractor.
 - If any pump-driven dewatering is needed, it shall be discharged through a filter bag over a well-vegetated area. The pump must discharge at a non-erosive velocity. If necessary, an approved energy dissipater may be used.
 - Permanent BMP's for any disturbed land area shall be completed by the general contractor within 5 calendar days after final grading or the final earth change has been completed. When it is not possible to permanently stabilize a disturbed area after land disturbance activity ceases, temporary Erosion control devices shall be implemented immediately. All temporary Erosion Control Devices shall be maintained until permanent BMP devices are implemented. All permanent BMP's will be implemented and established before a certificate of compliance is issued.
 - Strip topsoil only from those areas that will be disturbed by excavation, filling, road building, or compaction by equipment. Refer to the geotechnical report for depths of stripping. Put sediment basins, diversions, and other controls into place before stripping.
 - When topsoiling, maintain needed erosion control practices such as diversions, grade stabilization structures, berm, dikes, level spreaders, waterways and sediment basins.
 - Grades on the areas to be topsoiled which have been previously established shall be maintained.
 - Bonding – Immediately prior to dumping and spreading of topsoil, loosen the subgrade by discing or scarifying to a depth of at least 4", to permit bonding of the topsoil and subsoil.
 - The general contractor shall inspect the Erosion Control Devices once every 14 days under any circumstances, within 24 hours of rainfall, and daily during a prolonged rain event unless otherwise noted in the SWPPP or by the jurisdictional authority. A log of inspection report shall be maintained and accessible in accordance with National Pollution Discharge Elimination System (NPDES) requirements. Any required maintenance shall be provided within 72 hours.
 - Install silt fence, inlet filters, and other Erosion Control Devices as indicated in the drawings, per APWA and authority regulations, and at additional affected areas as necessary. Build-up of sediment shall be removed promptly per authorities regulations. If silt fence decomposes or becomes ineffective prior to the end of expected usable life and the barrier is still required, the silt fence shall be replaced promptly. Sediment shall be removed from sediment traps or basins when design capacity has been reduced to 50%. Contractor shall flare the ends of the silt fence uphill in order to temporarily impound runoff.
 - Earthen berms shall be regularly inspected, and inspected after each rainfall event. Repairs to earthen berms shall be made immediately. If the earthen berm shows signs of erosion, and it is determined that material must be added to fix the berm, the material shall be properly placed, compacted and reseeded. The berm shall be reseeded and stabilized, as needed, to maintain its soundness whether or not there has been any rainfall.
 - Drainage swales shall be inspected regularly and after every rainfall event. Repairs to drainage swales shall be made immediately. If the flow channel and/or outlets show signs of deficiency, the damaged area(s) shall be restabilized and reseeded, as needed, to prevent further damage. If additional measures are needed to eliminate issues, contractor shall notify the engineer for possible modifications.
 - Refer to the jurisdictional authority for temporary gravel construction entrance details. If not specified, refer to APWA standards. The entrance and exit areas of the project shall be cleared of all vegetation, roots, and other objectionable material. The gravel shall be placed to the proper dimensions and graded to a smooth and even slope. Construction entrance drainage shall be provided to carry water to a sediment trap or other suitable outlet.
- #### Stockpiling Notes:
- Select stockpile location to avoid slopes and natural drainageways, avoiding traffic routes. On large sites, re-spreading is easier and more economical where topsoil is stockpiled in small piles located near areas where they will be used.
 - Sediment Barriers – Use sediment fences or other barriers where necessary to retain sediment.
 - Temporary Seeding – Protect topsoil stockpiles by temporarily seeding as soon as possible, not to exceed 14 days, weather permitting, after the formation of the stockpile.
 - Permanent Vegetation – If stockpiles will not be used within 12 months, they must be stabilized with permanent vegetation to control erosion and weed growth.
 - All stockpiled soils shall be maintained in such a way as to prevent erosion from leaving the site. Silt fence must be installed around the perimeter of the stockpile.

Seeding Notes:

- Seeding shall be as follows unless otherwise stated in the landscape plans.
 - Annual rye grass, wheat, or oats should be used for temporary seeding. Apply rye grass at 120lbs. per acre, wheat or oats at 100lbs. per acre.
 - A mixture of 65% kentucky bluegrass and 35% chewing fescue or creeping red fescue should be used for permanent seeding. Apply the mixture at 2lbs. per 1000ft².
 - Seedbed preparation—Install necessary mechanical erosion and sedimentation control practices before seeding, and complete grading according to the approved plan. Lime and fertilizer needs should be determined by soil test. Apply the lime and fertilizer evenly and incorporate into the top 4"–6" of soil by discing or other suitable means.
 - All seeding shall be performed during favorable weather conditions and only during normal and accepted planting seasons when satisfactory growing conditions exist. The planting operations shall not be performed during times of extreme drought, when ground is frozen or during times of other unfavorable climatic conditions unless otherwise approved by owner's representative. The contractor assumes full and complete responsibility for all such plantings and operations.
 - Seed should be labeled in accordance with U.S. Department of Agriculture rules and regulations under the federal seed act and comply with the requirements of the Missouri seed law. Labels contain important information on seed purity, germination, and presence of weeds. Weed seed should not exceed 1.0% by weight of the mixture.
 - Apply seed uniformly with a cyclone seeder, drill, cultipacker seeder, or hydroseeder. Small grains should be planted no more than 1" deep, and grasses and legumes no more than ½".
 - Generally, a permanent stand of vegetation cannot be determined to be fully established until soil cover has been maintained for one full year from planting. Inspect seeded areas for failure and make necessary repairs and re-seedings within the same season, if possible.
 - The Contractor shall seed all disturbed areas unless otherwise noted by landscape plans. Immediately after seeding, mulch all seeded areas with unweathered small grain straw, spread uniformly at the rate of 1–2 tons per acre or 100lbs (2–3 bales) per 1000ft². The mulch should be anchored with disc type mulch anchoring tool or other means as approved by the jurisdictional authority. Mulch matting may be used in lieu of loose mulch.
 - The Contractor shall sod all disturbed areas within the public street right-of-way. Refer to city and state standards for proper installation.
- #### Demolition Notes:
- At the site, the Contractor shall maintain the required documents for immediate review, included but not limited to: Site Safety Plan, Demolition Permits, Street Closure Permits, Contract Documents, Demolition Plans, Salvage Verification Forms, SWPPP Etc.
 - The Contractor shall notify all utility companies for field verification and disconnection of utilities prior to any work. Coordination is required for both temporary and permanent utility services that serve the site including, but not limited to: water lines, power, telephone, cable, storm sewer, sanitary sewer with the city and/or respective utility.
 - The Contractor is specifically cautioned that the locations and/or elevation of existing utilities as shown on these plans are based on records of the various utility companies, and where possible, measurements taken in the field. The information is not to be relied on as being exact or complete. Contractor shall contact One Call utility information service for utility locates. The Contractor must call the appropriate utility companies at least 72 hours before any excavation to request exact field location of utilities. The Contractor shall also coordinate and allow access for utility companies to perform any disconnection or relocation activities. It shall be the responsibility of the Contractor to relocate all existing utilities which conflict with the proposed improvements shown on the plans.
 - Remaining building structures and remaining utility services shall be protected from damage. Damage to any existing features to remain will be replaced at the Contractor's expense.
 - Areas disturbed during demolition shall be thoroughly evaluated by the geotechnical engineer responsible for site preparation prior to placement of structural fill. All disturbed soils shall be undercut prior to placement of structural fill, per the geotechnical recommendations. Contractor shall notify the geotechnical engineer at least 72 hours prior to placement of structural fill.
 - Excavations created by the removal of any existing utility lines that extend below design grades shall be cut wide enough to allow use of heavy construction equipment to compact the fill. Base of the excavations shall be thoroughly evaluated by the geotechnical engineer prior to placement of fill. If existing utilities are to be left in-place, existing trench backfill shall be evaluated in accordance with the recommendations of evaluation of existing fill.
 - The Contractor shall be responsible for obtaining all Federal, State, and local permits, obtaining all inspections, and shall conform to all governing codes and regulations required to perform necessary abatement during demolition, should hazardous materials be encountered.
 - Contractor is responsible for legally disposing of all materials and associated cost of interim storage facilities.
 - For tree & stump removal, the Contractor shall remove all root systems from the site not designated to be saved. Materials disturbed during removal of stumps shall be undercut and replaced with structural fill. A zone of desiccated soils may exist in the vicinity of the trees. The desiccated soils have a higher swell potential and shall be undercut and replaced with structural fill.
 - No construction waste shall be buried on site. All hazardous waste materials will be disposed of in the manner specified by local, state and federal regulations.
- #### Retaining Wall Notes:
- Site retaining wall improvements shall be designed by a licensed professional engineer retained by the contractor. The wall engineer and contractor shall satisfy themselves of the conditions of the surrounding site features and any interactions with the proposed improvements.
 - Retaining wall design drawings and specifications shall be provided to the owner and owner's representative for review and approval. All retaining wall designs shall be signed and sealed by a registered Professional Engineer licensed in the state of Missouri. Design services shall be included in retaining wall pricing.
 - Refer to Retaining Wall drawings for wall information. Civil plan set shall only be used for general location and spot elevations.
 - The Contractor is responsible for coordinating all inspections, certifications, permits, fees and close out of the wall unless otherwise determined. Contractor shall notify wall design engineer for final inspection. Contractor shall include in construction cost for all of the above items related to the installation of the retaining wall.
 - Any wall shown is a schematic representation of the proposed walls. The spot elevations denoting retaining walls are provided on the site grading plan.
 - If the wall is greater than 30" and is in an accessible area, guard rails are required per code.
- #### Americans with Disabilities Act (ADA) Notes:
- The running and cross slopes for all sidewalks, accessible paths, ramps, designated parking stalls, etc., shall be in compliance with latest Federal ADA guidelines, in addition to any accessibility standards adopted by the governing municipality. Prior to installation/construction, if any discrepancies are found within the plans, the Engineer shall be notified.

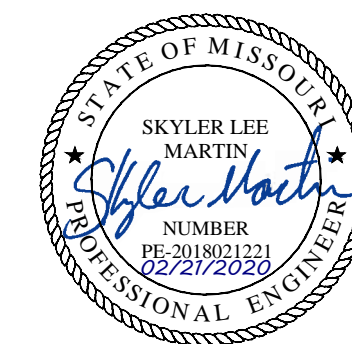



Local Benchmarks: BM-#

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Floodplain Note:

The site lies entirely within 'Zone X', areas determined to be outside the 0.2% annual chance floodplain as depicted on the FEMA Flood Insurance Rate Map (FIRM) no. 29095C0430G, Revision Date: January 20, 2017.

Fire Protection Notes:

- Plans and specifications, in accordance with NFPA 24, for the private fire line shall be submitted for review and approval prior to installation.
- Underground fire line installation including thrust blocks shall be inspected prior to being backfilled.
- Hydrostatic testing and flushes shall be completed with the fire department as a witness.

Utility Legend

	existing
	proposed
Linetypes	
	sanitary main
	sanitary service
	storm sewer (existing)
	storm sewer (solid wall, proposed)
	storm sewer (solid wall, proposed)
	storm sewer (perforated, proposed)
	water main
	water service (fire)
	water service (domestic)
	water service (irrigation)
	natural gas main
	natural gas service schematic
	underground primary electric
	underground secondary electric
	overhead electric
	undgrnd cable/phone/data
	undgrnd cable/phone/data service
	fence-chainlink
	fence-wood
	fence-barbed wire
	treeline

Symbols

	sanitary manhole
	service cleanout
	force main release valve
	rectangular structure
	circular structure
	fire hydrant
	water valve
	water meter
	backflow preventer
	natural gas meter
	service transformer (pad mount)
	primary switch gear
	light pole
	cable/phone/data junction box
	street light
	pedestrian street light
	electric pole
	guy wire
	end section

Demolition Notes

- Contractor will coordinate with respective utility all existing utilities that extend below design grades but not limited to water lines, power, telephone, cable, storm sewer, sanitary sewer.
- The Contractor is specifically cautioned that the locations and/or elevation of existing utilities as shown on these plans are based on records of the various utility companies, and where possible, measurements taken in the field. The information is not to be relied on as being exact or complete. The Contractor must call the appropriate utility companies at least 72 hours before any excavation to request exact field location of utilities. It shall be the responsibility of the Contractor to relocate all existing utilities which conflict with the proposed improvements shown on the plans.
- The Contractor shall protect offsite improvements (including but not limited to sidewalks, drives, utilities, existing streets, curbs and paving) surrounding the project boundary from demolition damage.
- The Contractor shall notify all utility companies for field verification and disconnection of utilities prior to any work. The Contractor shall contact the One Call utility information service & utility companies for utility locates. The Contractor shall coordinate and allow access for utility companies to perform any disconnection or relocation activities.
- The Contractor shall maintain at the demolition site the required documents for immediate review (IE. Site Safety Plan, Demolition Permits, Street Closure Permits, Contract Documents, Demolition Plans, Salvage Verification Forms, SWPPP Etc.). Inspections of erosion control devices after any rainfall event that causes runoff. Engineering Division of Public Works requires copies of the inspections after the site is stabilized.
- Prior to demolition, all applicable erosion control devices are to be installed.
- Damage to any existing features to remain will be replaced at the Contractors expense to exiting or better condition.
- All broken concrete and other debris from demolition shall be removed from the site. Areas disturbed during demolition shall be thoroughly evaluated by the geotechnical engineer responsible for site preparation prior to placement of structural fill. All disturbed soils shall be undercut prior to placement of structural fill, per the geotechnical recommendations.
- The Contractor shall strip all remaining vegetation, topsoil, debris and other unsuitable materials from the proposed construction areas. Stripping depths shall be adjusted to remove all vegetation and root systems. The actual stripping depth shall be based on visual examination by the Geotechnical Engineer. Topsoil removed during stripping operations can be used for final site grading within the landscaped areas. Care shall be exercised to separate these materials to avoid incorporation of the organic matter in structural fill sections.
- For tree & stump removal, the Contractor shall remove all root systems from the site not designated to be saved. Materials disturbed during removal of stumps shall be undercut and replaced with structural fill. A zone of desiccated soils may exist in the vicinity of the trees. The desiccated soils have a higher swell potential and shall be undercut and replaced with structural fill.
- Excavations created by the removal of any existing utility lines that extend below design grades shall be cut wide enough to allow use of heavy construction equipment to compact the fill. Base of the excavations shall be thoroughly evaluated by the geotechnical engineer prior to placement of fill. If existing utilities are to be left in-place, existing trench backfill shall be evaluated in accordance with the recommendations of evaluation of existing fill.

Construction Legend

	concrete pavement
	standard asphalt
	heavy duty asphalt
	concrete sidewalk
	standard curb & gutter
	standard dry curb & gutter

Demolition Legend


	Remove curb
--	-------------

Property Legend

	right of way
	property lines
	easements
	setbacks

Grading Legend

	existing minor contour
	existing major contour
	proposed minor contour
	proposed major contour

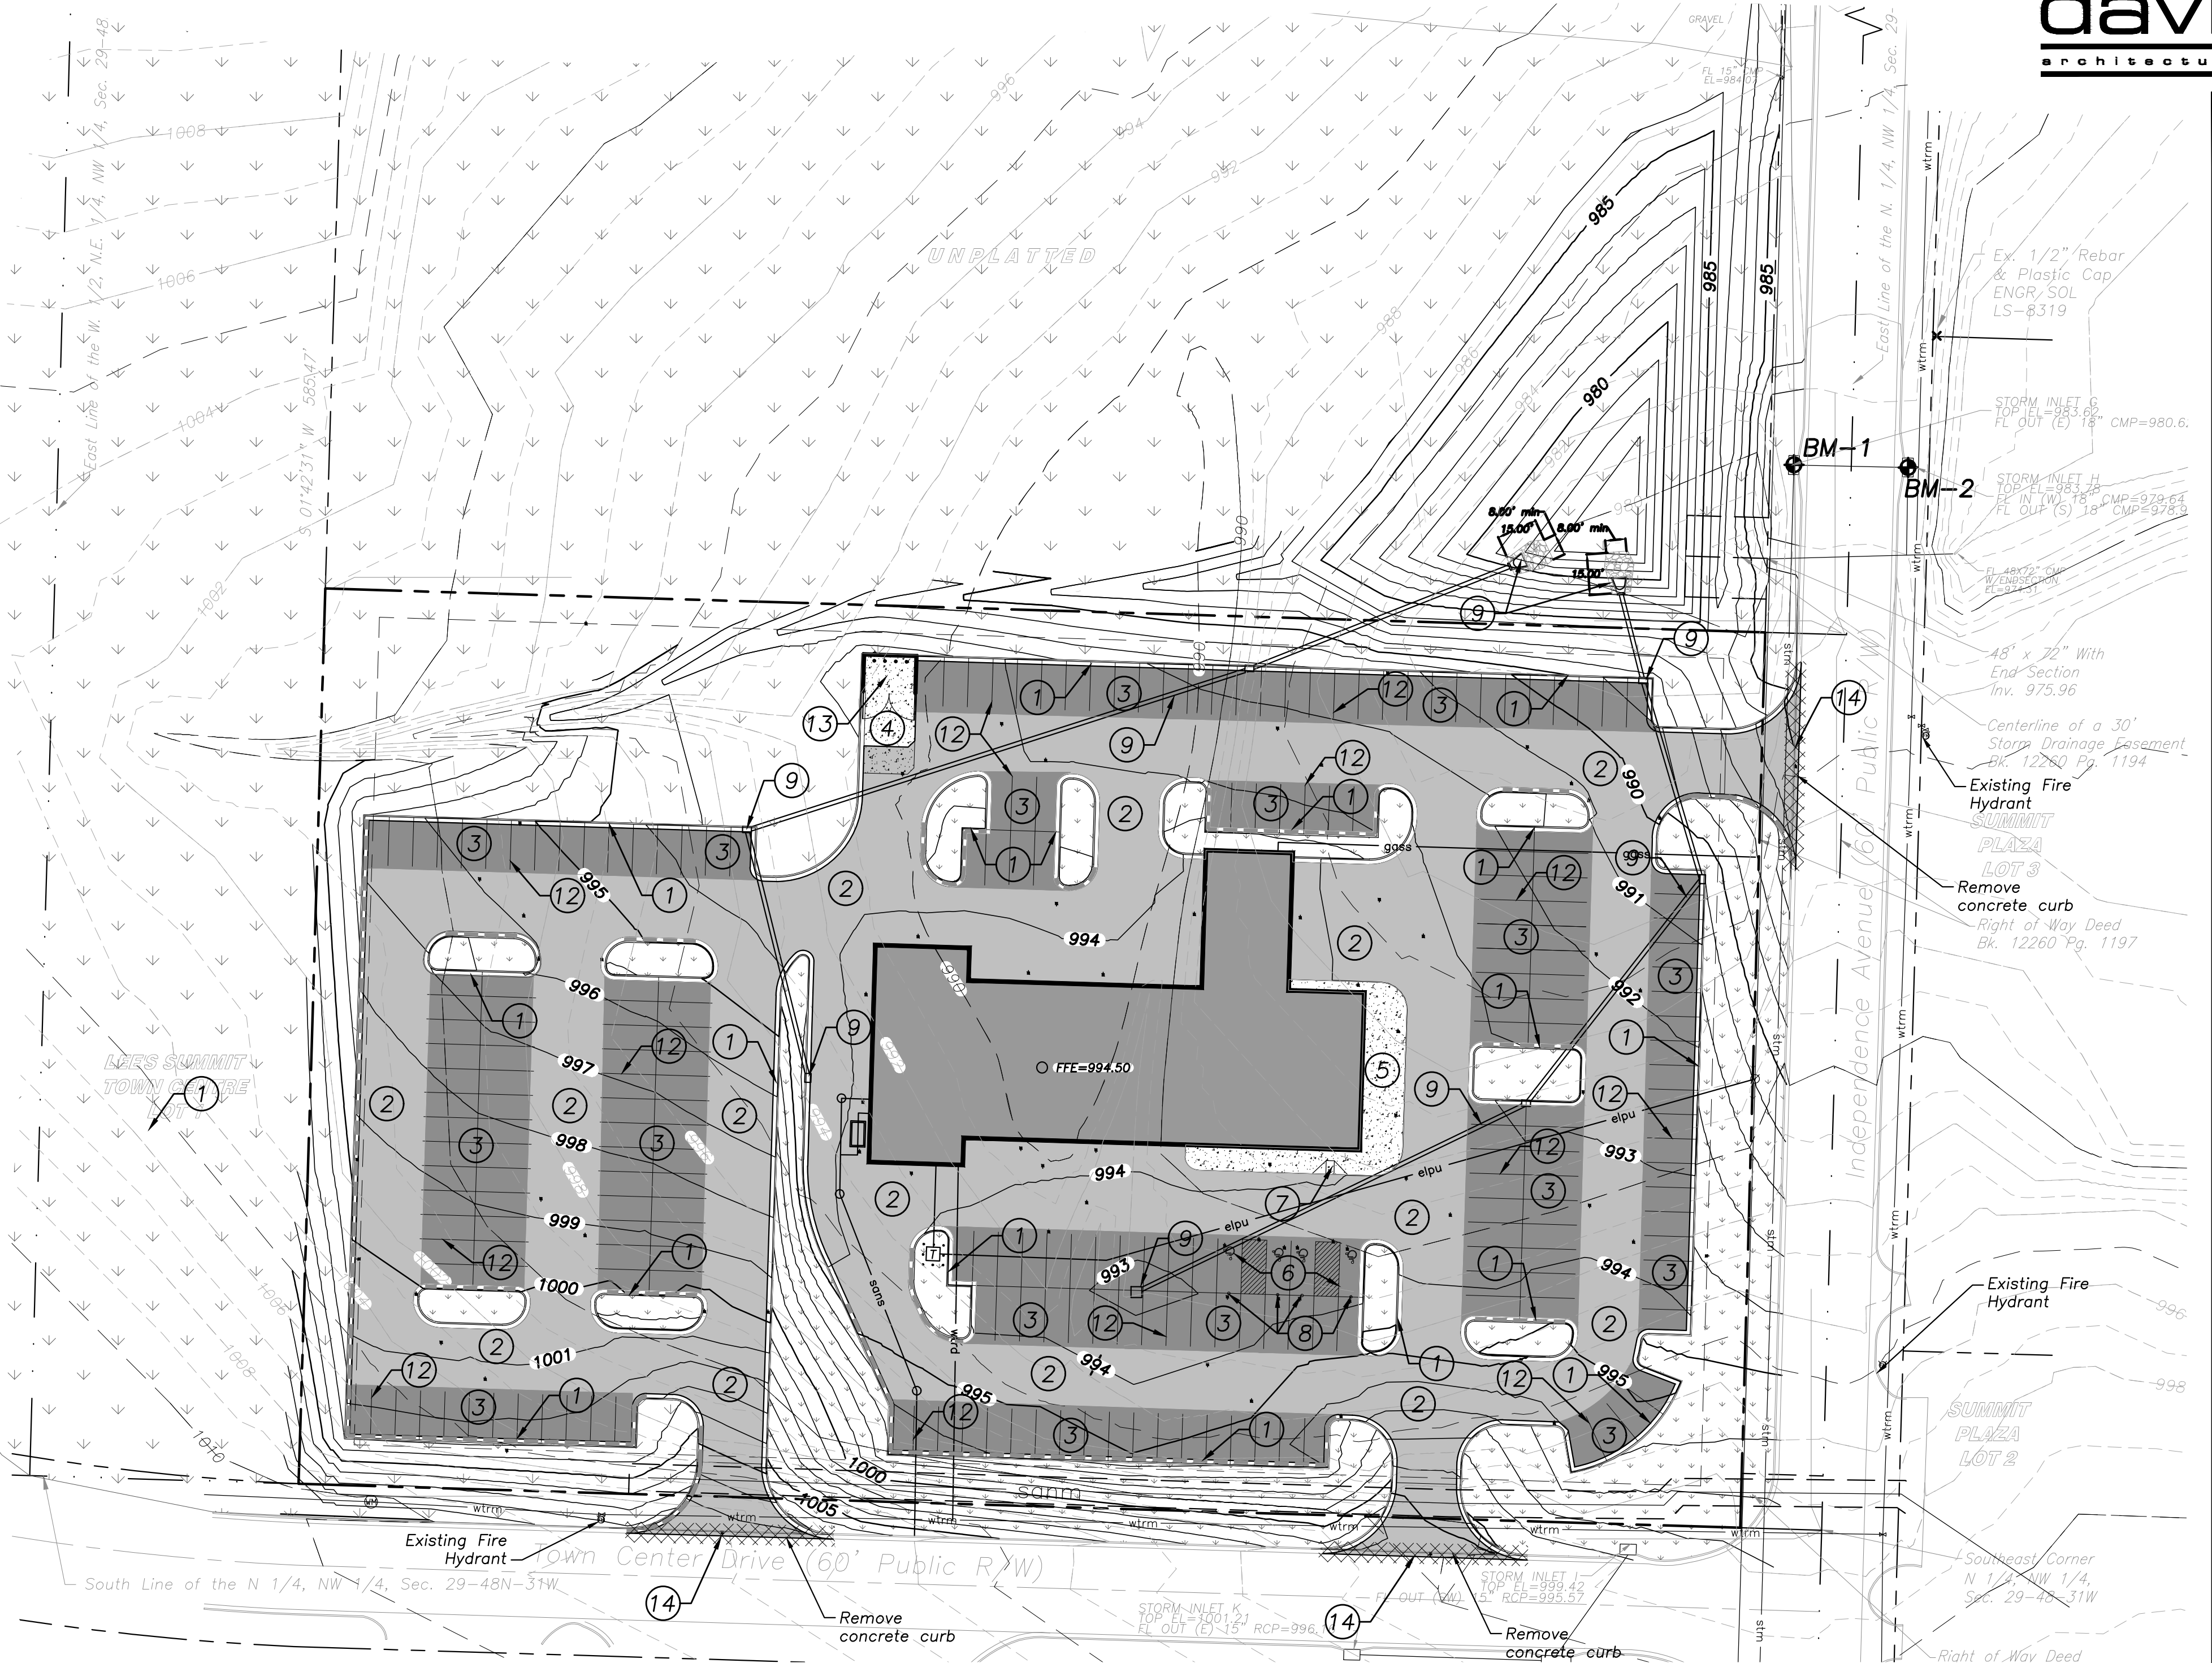

Construction Notes:


- Construct standard wet or dry concrete curb & gutter per City of Lee's Summit, MO where indicated (see legend). Dry curb is pitched out to not hold water, Re: C4.1.
- Construct standard-duty asphalt pavement, Re: C4.1. (see legend)
- Construct heavy-duty asphalt pavement, Re: C4.1 (see legend)
- Construct concrete pavement, Re: C4.1. (see legend)
- Construct concrete sidewalk, Re: C4.1. (see legend)
- Parking, hatching, accessible aisles, and universal symbol to be painted white with 4" stroke as applicable, typ.
- Construct ADA accessible sidewalk ramp, ramps shall comply with Cirt Standards and Details. Re: C2.2.
- Install ADA parking signage.
- Proposed private storm sewer, plan and profiles, re: C3.3
- Proposed private water service line, see Sheet C1.3 for details.
- Proposed private sanitary sewer services lines, see Sheet C1.3 for details.
- Proposed striping: parking, etc., typ., per arch plans.
- Trash enclosure, Re: Arch. Plans.
- Match existing pavement elevation
- Proposed site lighting by others. See Lighting Plan for location.

Americans with Disabilities Act (ADA) Notes:

- The running and cross slopes for all sidewalks, accessible paths, ramps, designated parking stalls, etc., shall be in compliance with latest Federal ADA guidelines, in addition to any accessibility standards adopted by the governing municipality. Prior to installation/construction, if any discrepancies are found within the plans, the Engineer shall be notified.

General Notes

- All work within the road right-of-way shall conform to the technical specifications and design criteria for public improvement projects of the city of Shawnee, Kansas.
- Erosion Control shall be per the Erosion and Sediment Control Program Manual of the City of Shawnee, Kansas.
- All work and materials shall be subject to inspection and approval by the owner or the owner's representative. Any change or deviation from these plans must be authorized by the owner or the owner's representative.
- All traffic control in connection with construction in the right-of-way shall be in conformance with the Manual of Uniform Traffic Control Devices.
- The contractor shall be required to provide a stabilized construction entrance to prevent mud from being deposited onto adjacent roads.
- The contractor shall be responsible for obtaining all required permits, paying all fees, and otherwise complying with all applicable regulations governing the project.
- The contractor shall protect from damage or injury all property including survey monuments, property markers, benchmarks, etc. Items damaged shall be reset by a professional land surveyor licensed in the state of Kansas, at the contractor's expense.
- The contractor shall be responsible for the restoration of the right-of-way and for damaged improvements such as curbs, sidewalks, street light and traffic signal junction boxes, traffic signal loop lead-ins, signal poles, etc. Damaged improvements shall be repaired in conformance with the latest city standards and to the city's satisfaction.
- The contractor shall sod all disturbed areas within the public street right-of-way.
- Paving shall conform to the soils report, and these drawings, any identified discrepancies shall be brought to the attention of the engineer.
- Contractor shall provide 48-hour notification to the city engineering division to schedule all required inspections.
- All concrete for public improvements shall comply with the Standards and Specifications of the Kansas City Metropolitan Materials Board (KCMMB). Structural concrete shall be 5,000 psi and nonstructural concrete shall be 4,000 psi.
- A right-of-way work permit and/or street excavations permit shall be obtained by the contractor to complete all utility work within the public street right-of-way.

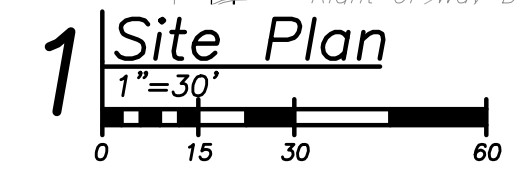

A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date 02.21.2020
drawn by SLM
checked by PAM
revisions

sheet number
C1.2
drawing type
preliminary
project number
19076



Local Benchmarks: BM-#

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Floodplain Note:

The site lies entirely within 'Zone X', areas determined to be outside the 0.2% annual chance floodplain as depicted on the FEMA Flood Insurance Rate Map (FIRM) no. 29095C0430G, Revision Date: January 20, 2017.

Fire Protection Notes:

- Plans and specifications, in accordance with NFPA 24, for the private fire line shall be submitted for review and approval prior to installation.
- Underground fire line installation including thrust blocks shall be inspected prior to being backfilled.
- Hydrostatic testing and flushes shall be completed with the fire department as a witness.

Utility Legend

	existing
	proposed
Linetypes	
	sanitary main
	sanitary service
	storm sewer (existing)
	storm sewer (solid wall, proposed)
	storm sewer (solid wall, proposed)
	storm sewer (perforated, proposed)
	water main
	water service (fire)
	water service (domestic)
	water service (irrigation)
	natural gas main
	natural gas service schematic
	underground primary electric
	underground secondary electric
	overhead electric
	underground cable/phone/data
	underground cable/phone/data service
	fence-chainlink
	fence-wood
	fence-barbed wire
	treeline

Symbols

	sanitary manhole
	service cleanout
	force main release valve
	rectangular structure
	circular structure
	fire hydrant
	water valve
	water meter
	backflow preventer
	natural gas meter
	service transformer (pad mount)
	primary switch gear
	light pole
	cable/phone/data junction box
	street light
	pedestrian street light
	electric pole
	guy wire
	end section

Property Legend

	right of way
	property lines
	easements
	setbacks


Grading Legend

	existing minor contour
	existing major contour
	proposed minor contour
	proposed major contour

Sanitary Sewer Service Notes:


- Abandonment of 4" PVC lateral stubs must be witnessed and inspected by the City of Lee's Summit.
- Service line from building to 6" private main sewer line to be 4" PVC SDR-26.
- Connections between 4" laterals from dwelling units to 6" private main must be by WYE fitting.
- Tracer wire must be installed in accordance with City Standard Detail "SAN-1".

Field Survey identified no evidence suggesting presence of any active, inactive or capped oil and/or gas wells on the property

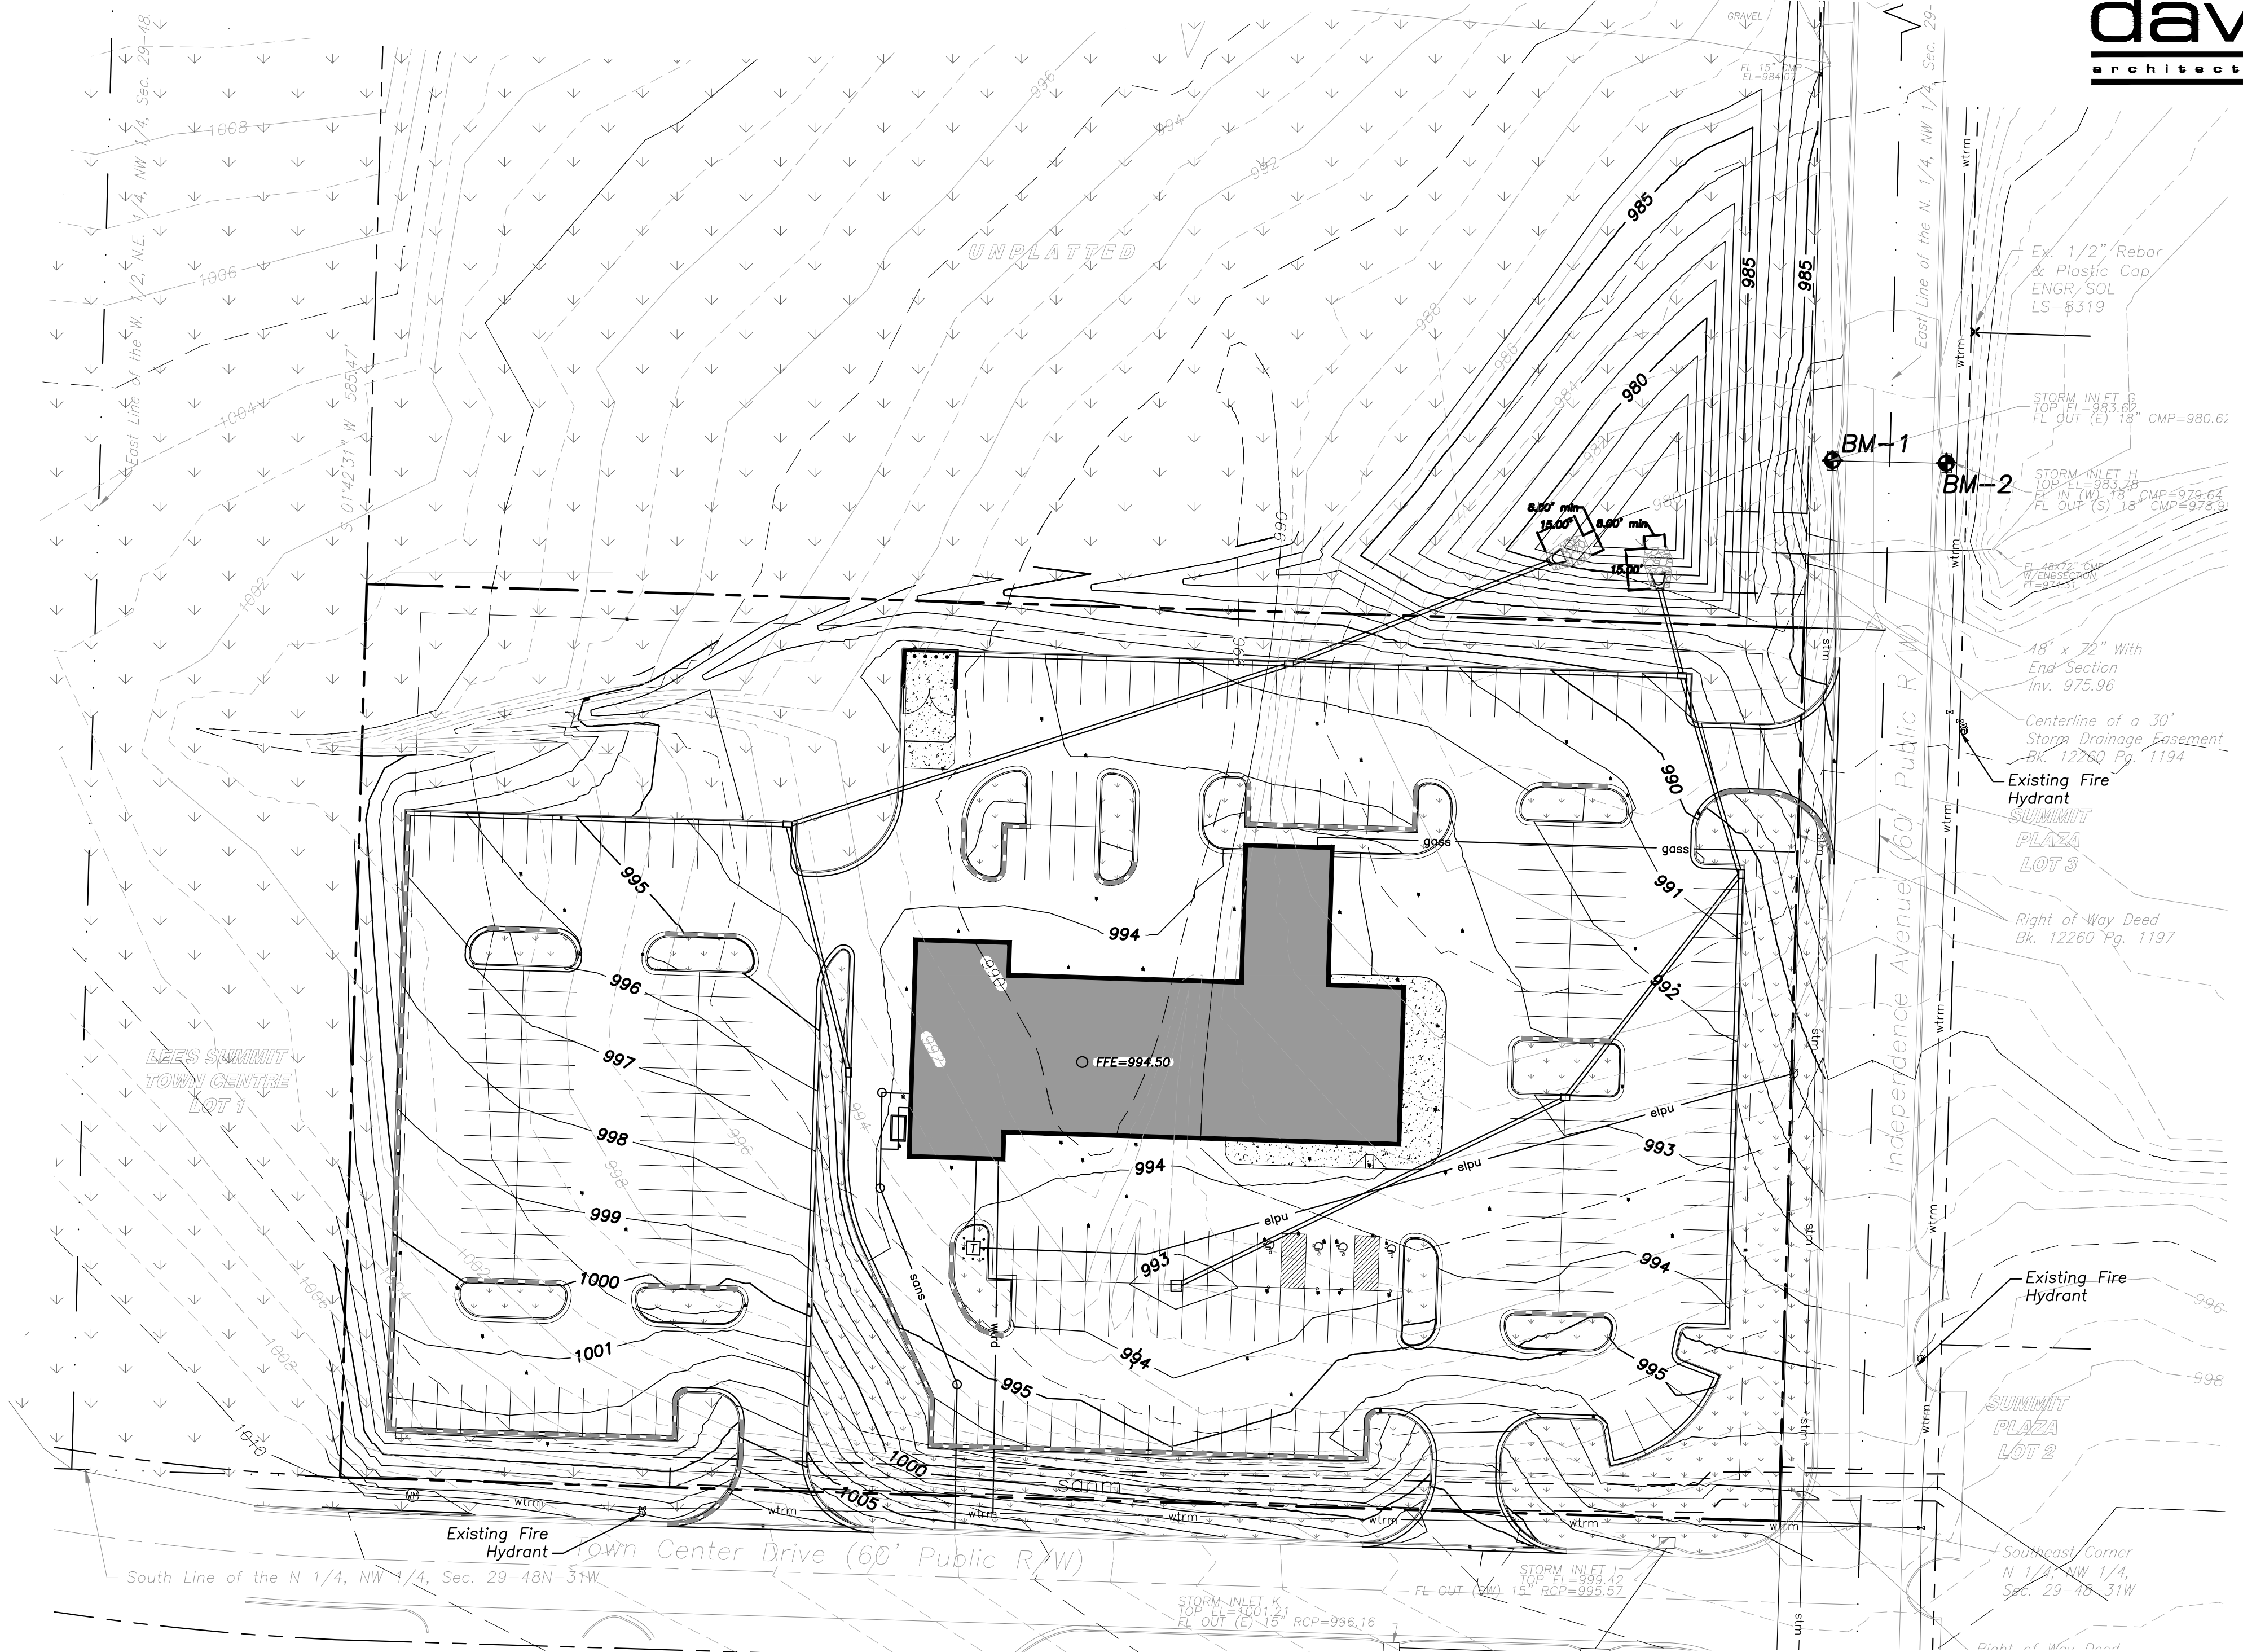

Utility Notes:

- Proposed storm sewer see sheet C3.3 for detail (private).
- Proposed sanitary sewer service, connected to existing service force main. Install approx. 177 L.F. 6" PVC SDR-26 sanitary sewer service pipe at 2.0% minimum slope, with (2) 45° horiz. elbows (1x 90° bends), WYE (for grease line junction), and sampling cleanout, from building to existing main.
F/L at Bldg = 991.50'
F/L at service connection = unknown, to be field verified by Contractor.
- Proposed grease/oil interceptor. Install 1,000 gallon precast grease interceptor that meets the requirements set by the City of Lee's Summit Public Works Department. Install approx. 5 L.F. 4" PVC SDR-26 at 2.0% min., from building to grease interceptor. From interceptor, install approx. 1 L.F. 4" PVC SDR-26 at 2.0% min. to WYE on primary waste service line. Install 2" PVC vent pipe from sampling cleanout back to building, see MEP plans for continuation.
F/L at Bldg = 991.50'
F/L at GI (In) = 991.40'
F/L at GI (Out) = 991.20'
- Coordinate with City of Lee's Summit 2" domestic service taps (8"x8"x2" tapping sleeve and valve connection with two 8" solid sleeves on each side of the tee on the 8" existing main) by City.
 - Service lines from water main shall be 2" Type K soft copper (ASTM B 88).
 - Install 3/4" HDPE pipe from service main to service connection.
 - Copper pipe to be used a minimum of 10' outside of proposed building wall.
 - Re: MEP Plans for continuation at building.
- Install 1-1/2" water meter and backflow preventer as shown in meter pit. (private). Re: MEP Plans for continuation at building.
 - Construct pit below BFP vault to allow for drainage. 12" diameter by 18" deep (from bottom of vault), fill with 1/2" clean gravel.
- Proposed electrical service. Install approx. 310 L.F. of primary conduit from existing line to transformer pad and 31 L.F. of secondary conduit from transformer to building as shown, per City Standards. Contractor to coordinate with Evergy for electrical service.
- Proposed natural gas service. Contractor to coordinate with Spire for gas service. Contractor to field verify location of gas main, location shown is approximate.
- Coordinate telephone and data service with Utility.

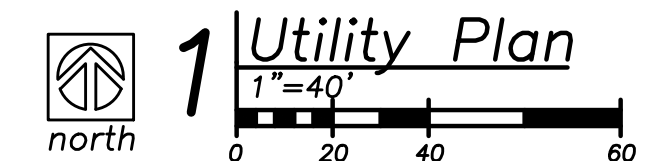

A Preliminary Concept for
Detail Center
 Town Center Drive & Independence Avenue
 Lee's Summit, Missouri

date 02.21.2020
 drawn by SLM
 checked by PAM
 revisions

sheet number
C1.3
 drawing type preliminary
 project number 19076



Local Benchmarks:

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Grading Legend

- existing minor contour
- existing major contour
- proposed minor contour
- proposed major contour

Utility Legend

- existing
- proposed

Property Legend



- right of way
- property lines
- easements
- setbacks

Linetypes

- sanm sanitary main
- sans sanitary service
- storm sewer (existing)
- storm sewer (solid wall, proposed)
- storm sewer (solid wall, proposed)
- storm sewer (perforated, proposed)
- wtrm water main
- wtrf water service (fire)
- wtrd water service (domestic)
- wtri water service (irrigation)
- gasm natural gas main
- gass natural gas service schematic
- elpu underground primary electric
- elsu underground secondary electric
- elpc overhead electric
- datu underground cable/phone/data
- datsu underground cable/phone/data service
- fence-chainlink
- fence-wood
- fence-barbed wire
- treeline

Symbols

- sanitary manhole
- service cleanout
- force main release valve
- rectangular structure
- circular structure
- fire hydrant
- water valve
- water meter
- backflow preventer
- natural gas meter
- service transformer (pad mount)
- primary switch gear
- light pole
- cable/phone/data junction box
- street light
- pedestrian street light
- electric pole
- guy wire
- end section

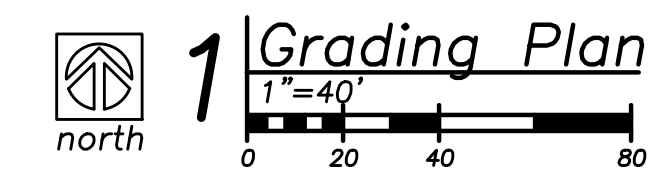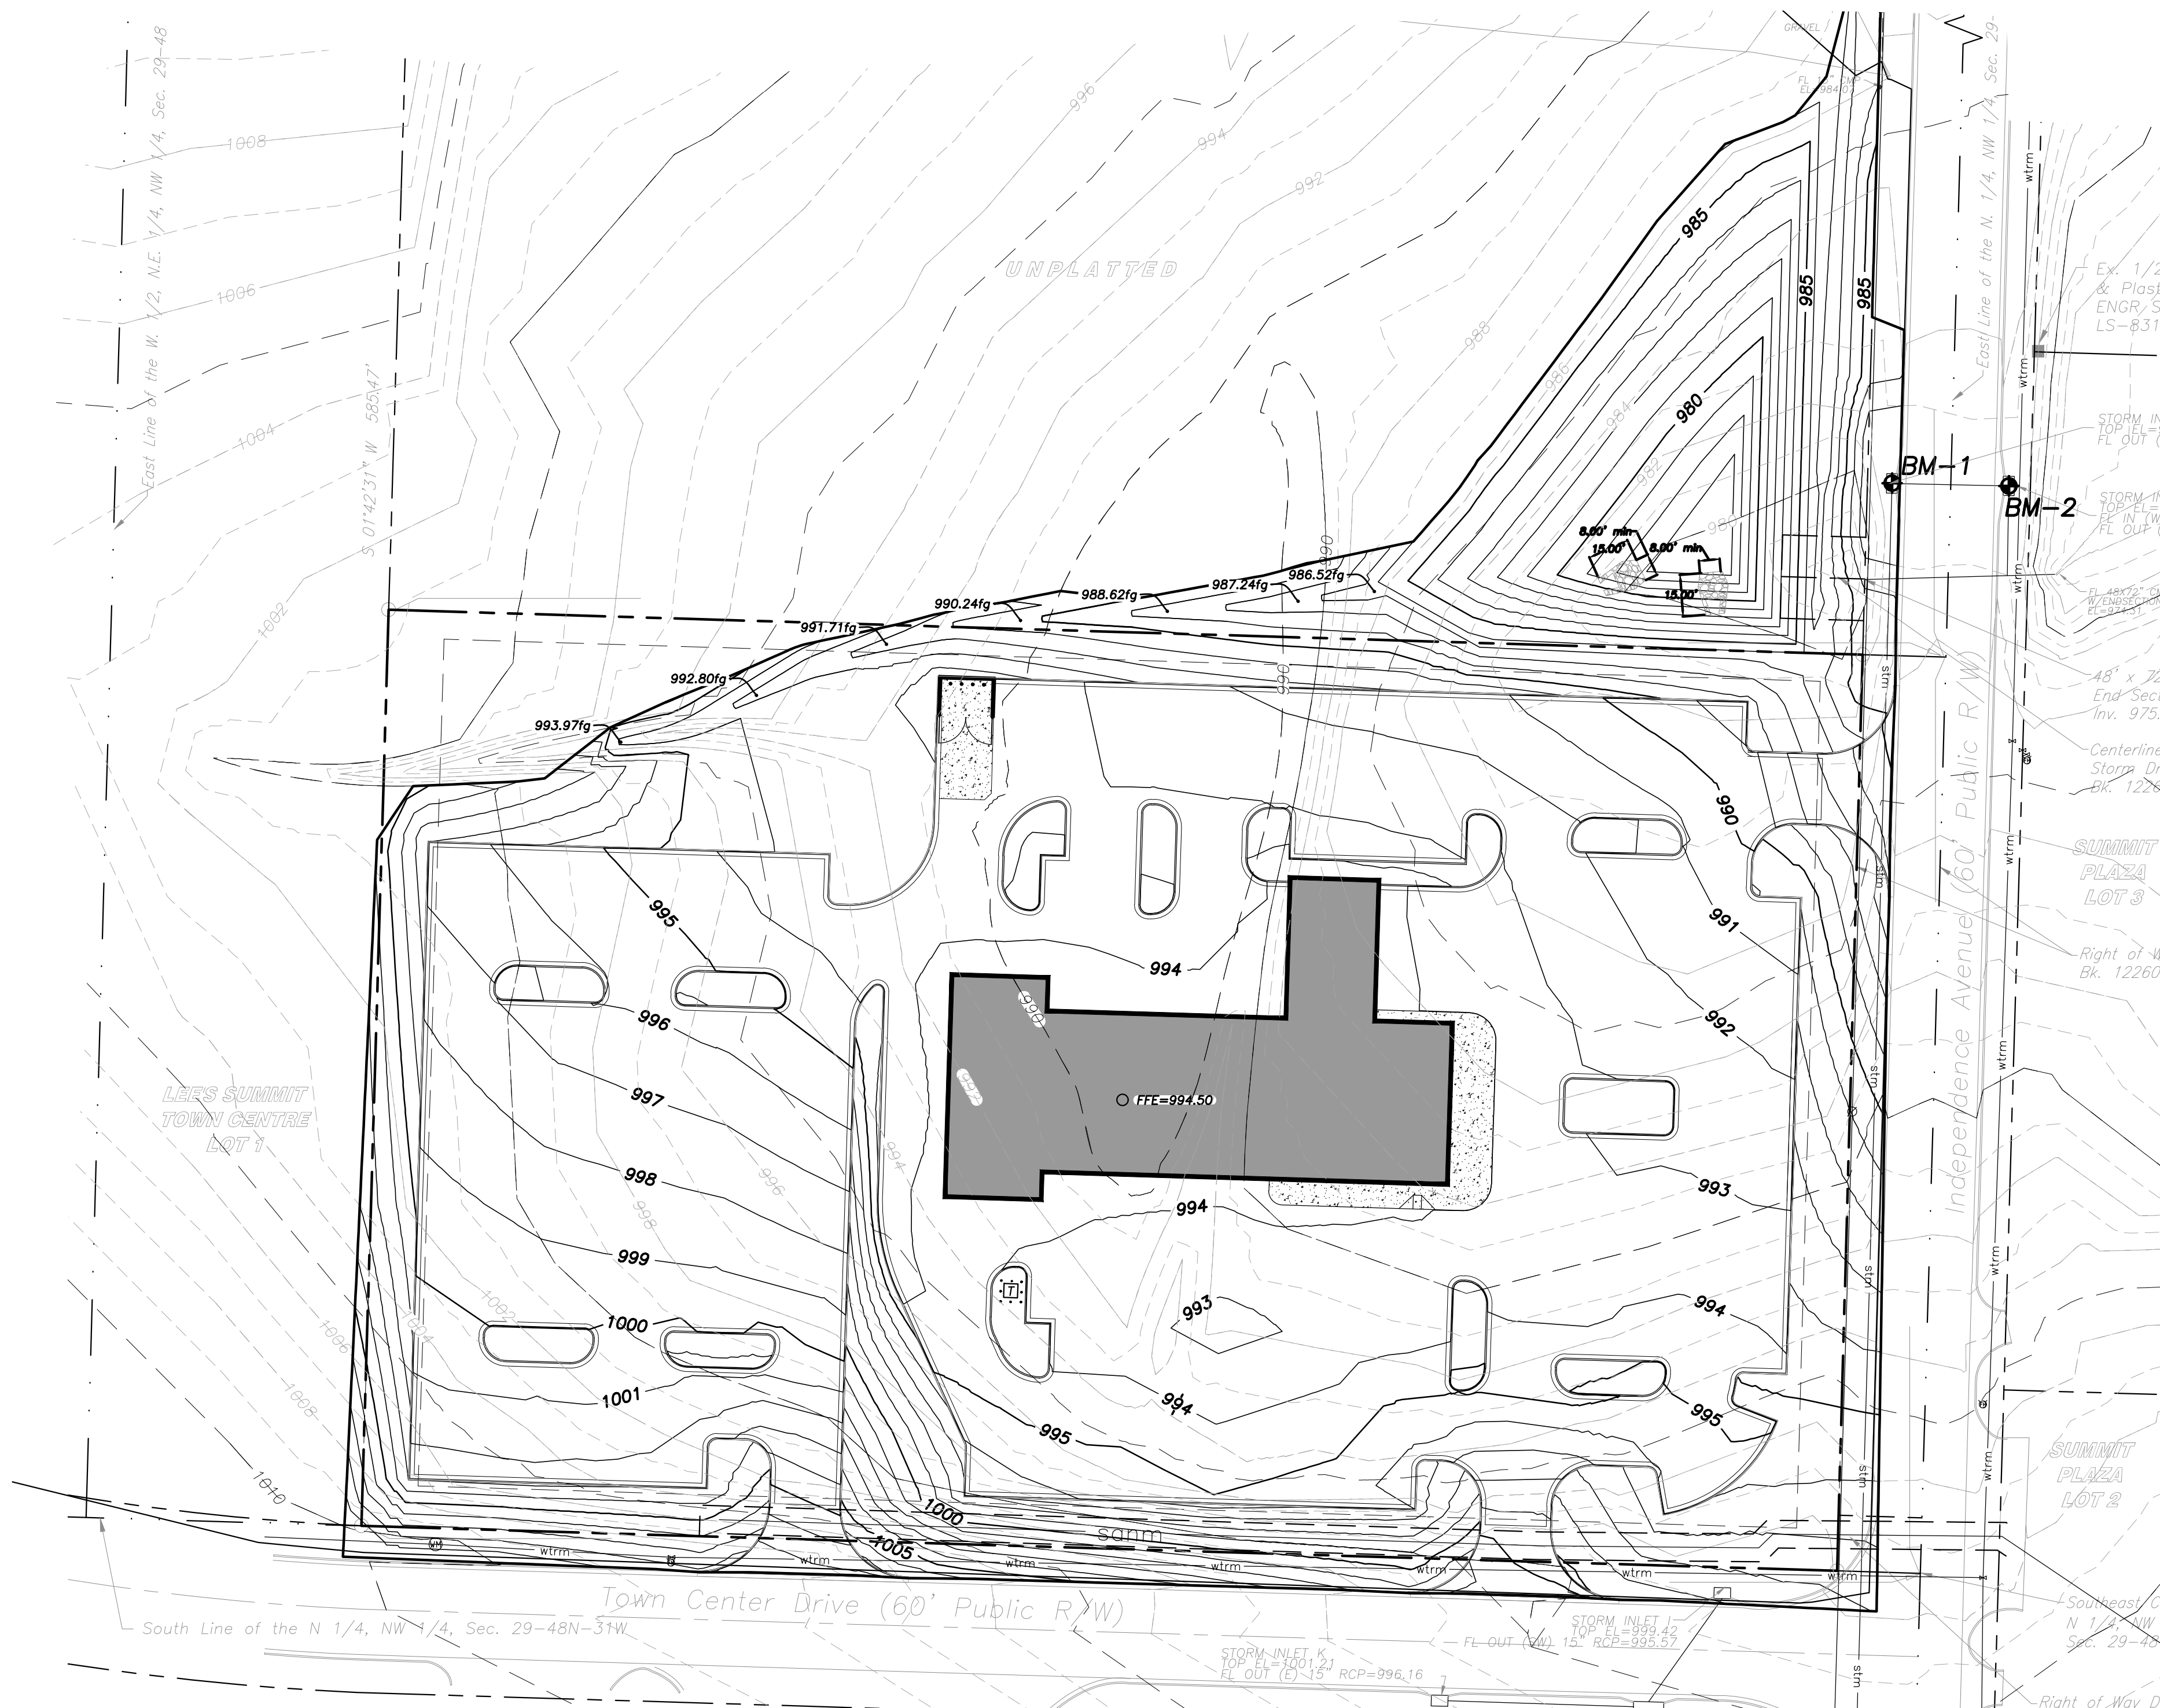

A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date XX.XX.XXXX
drawn by SLM
checked by PAM
revisions

sheet number
C2.1
drawing type preliminary
project number 19076



Local Benchmarks:

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Grading Legend

- existing minor contour
- existing major contour
- proposed minor contour
- proposed major contour

Utility Legend

- existing
- proposed

Linetypes

- sanm sanitary main
- sans sanitary service
- sans (existing) storm sewer (existing)
- stm storm sewer (solid wall, proposed)
- stm (proposed) storm sewer (solid wall, proposed)
- wtrm storm sewer (perforated, proposed)
- wtrm water main
- wtrf water service (fire)
- wtrd water service (domestic)
- wtri water service (irrigation)
- gasm natural gas main
- gass natural gas service schematic
- elpu underground primary electric
- elau underground secondary electric
- elpo overhead electric
- datu underground cable/phone/data
- datu underground cable/phone/data service
- fence-chainlink fence-chainlink
- fence-wood fence-wood
- fence-barbed wire fence-barbed wire
- treeline treeline

Symbols


- ⊙ sanitary manhole
- ⊙ service cleanout
- ⊙ fmv force main release valve
- ⊙ rectangular structure
- ⊙ circular structure
- ⊙ fire hydrant
- ⊙ wv water valve
- ⊙ w water meter
- ⊙ BFP backflow preventer
- ⊙ natural gas meter
- ⊙ T service transformer (pad mount)
- ⊙ S primary switch gear
- ⊙ light pole
- ⊙ C cable/phone/data junction box
- ⊙ street light
- ⊙ pedestrian street light
- ⊙ electric pole
- guy wire
- ⊙ end section

Erosion Control Legend

- Phase I Silt fence
- ⊙ Phase I Inlet protection
- limits of disturbance
- construction entrance
- topsoil stockpile area
- concrete washout area

Property Legend

- right of way
- property lines
- easements
- setbacks

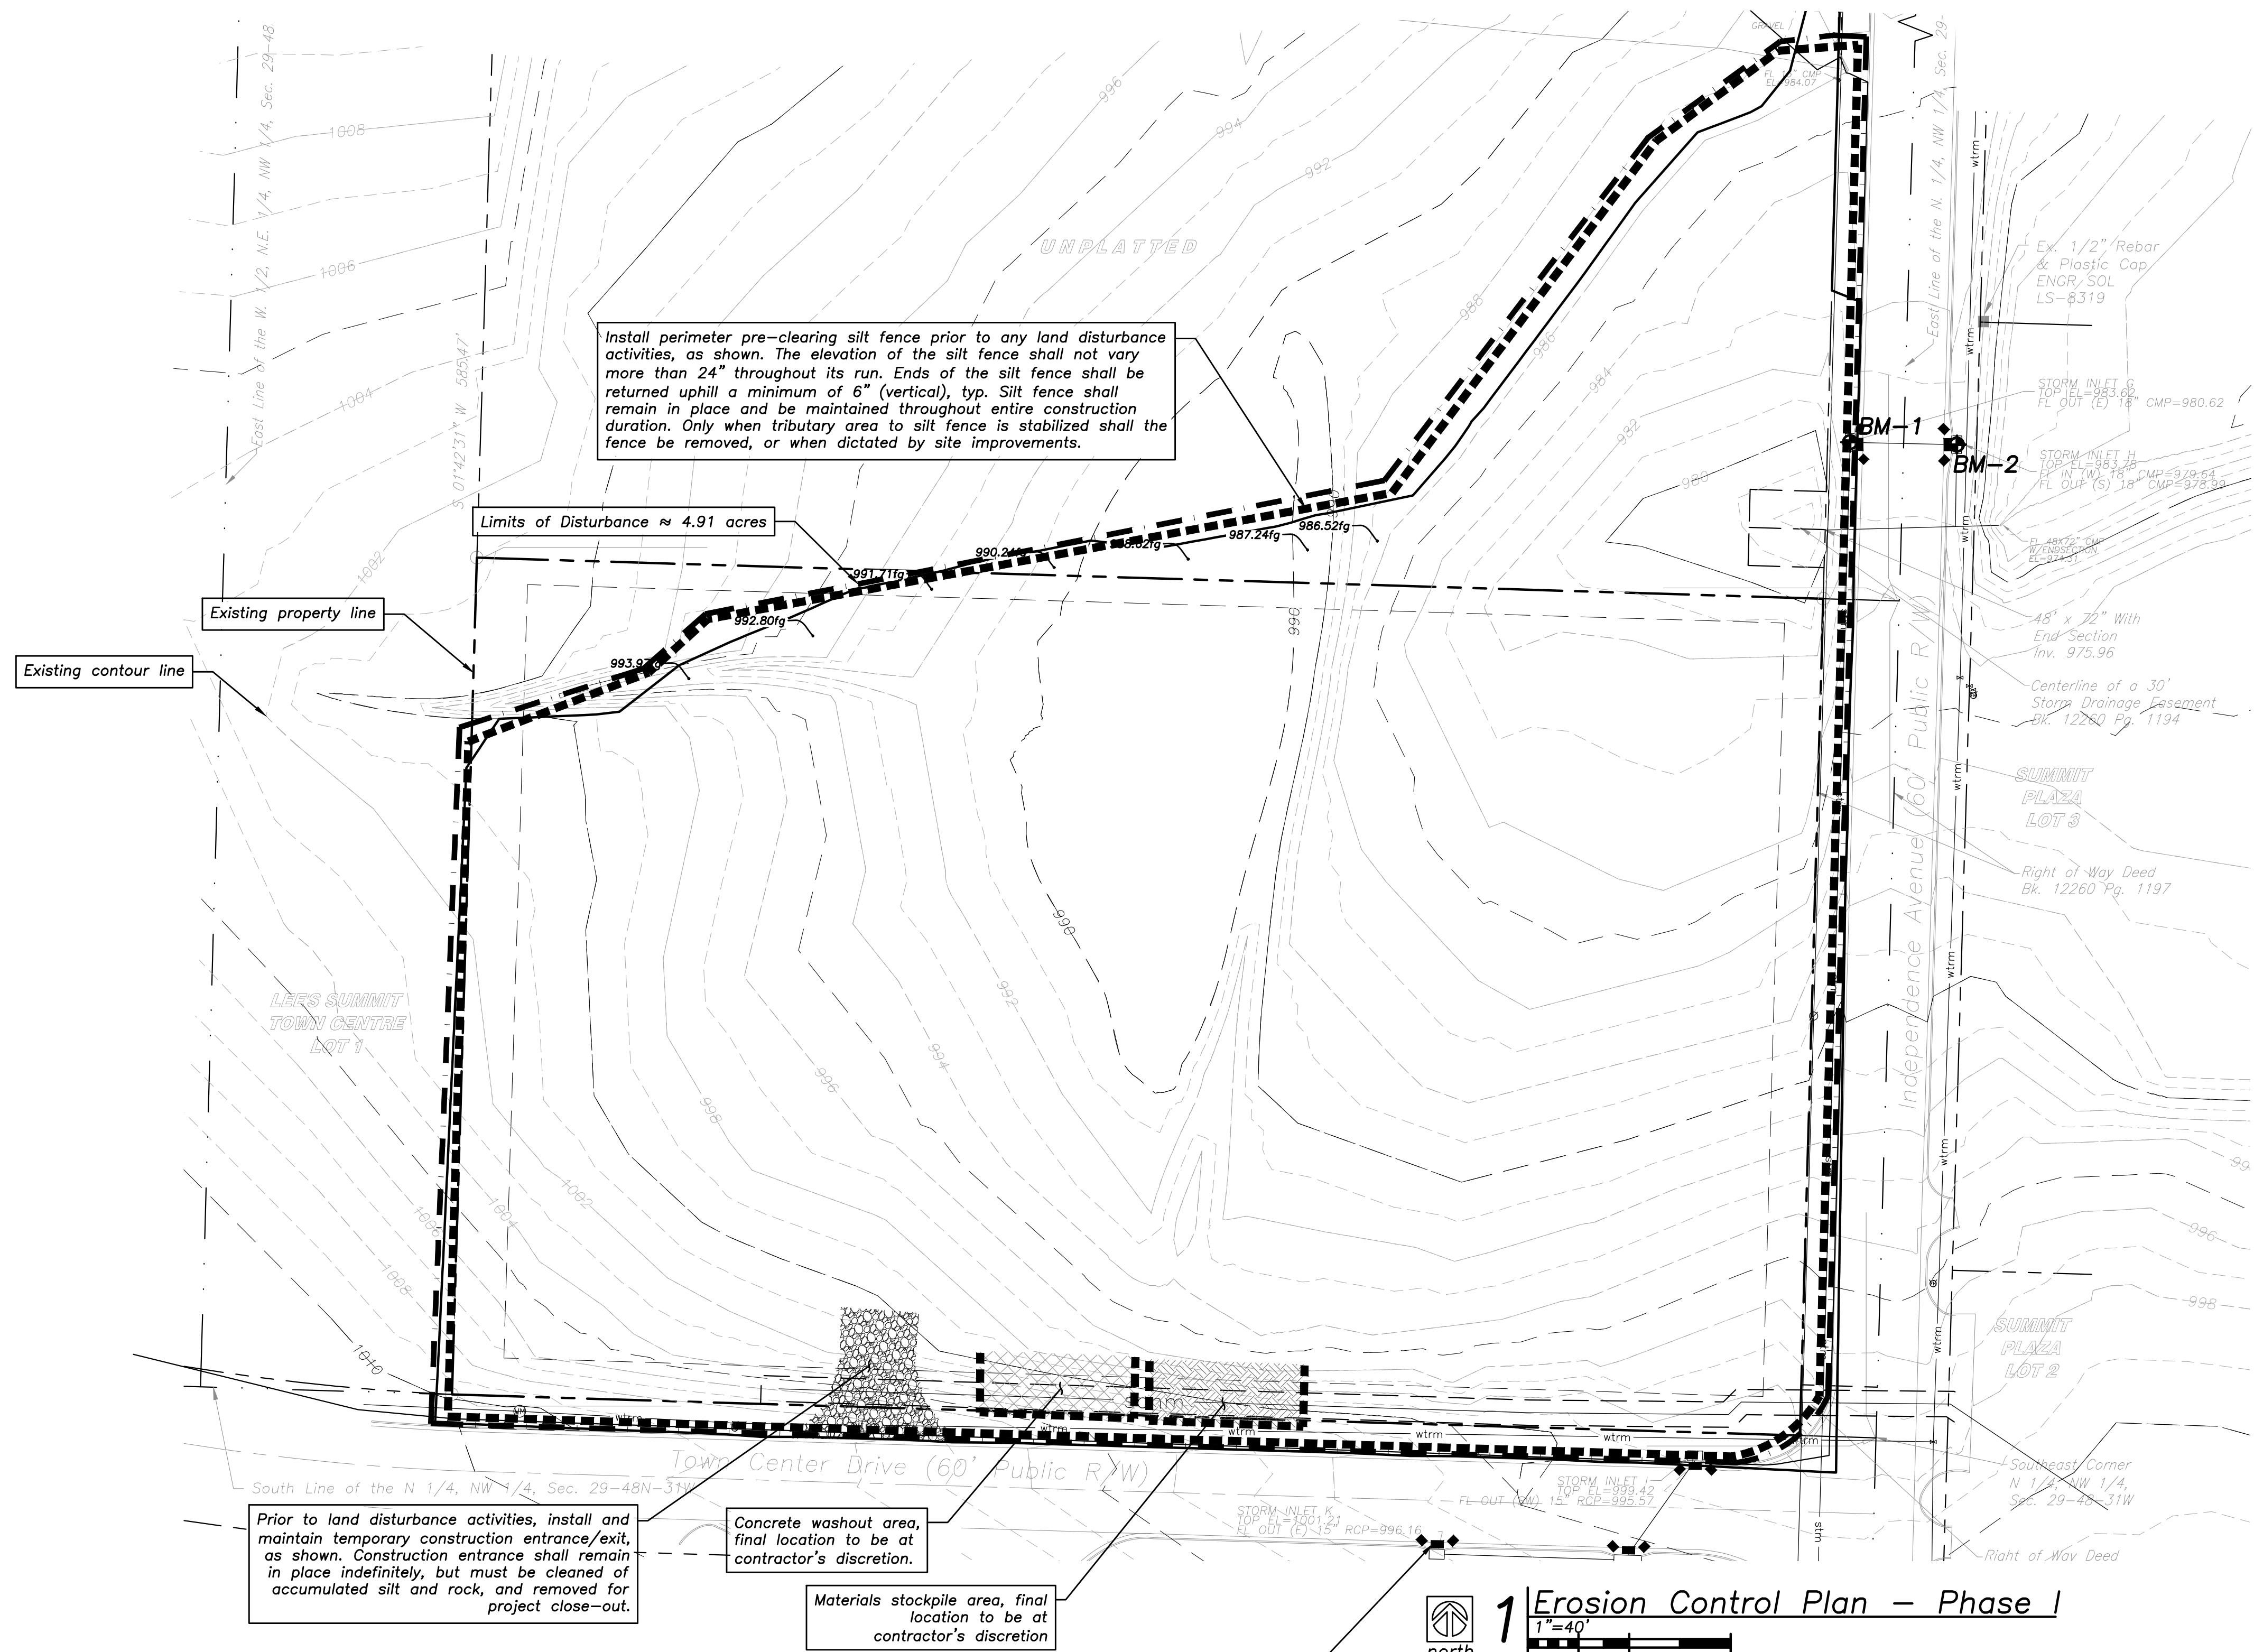

1 Erosion Control Plan - Phase I
1" = 40'
0 20 40 80

A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date XX.XX.XXXX
drawn by SLM
checked by PAM
revisions

sheet number
C2.2
drawing type preliminary
project number 19076



Local Benchmarks:

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Grading Legend

- existing minor contour
- - - existing major contour
- proposed minor contour
- - - proposed major contour

Utility Legend

- existing
- - - proposed

Linetypes

- sanm sanitary main
- sans sanitary service
- sans storm sewer (existing)
- stm storm sewer (solid wall, proposed)
- stm storm sewer (solid wall, proposed)
- wtrm storm sewer (perforated, proposed)
- wtrm water main
- wtrf water service (fire)
- wtrd water service (domestic)
- wtri water service (irrigation)
- gasm natural gas main
- gass natural gas service schematic
- elpu underground primary electric
- elsu underground secondary electric
- elpo overhead electric
- datu underground cable/phone/data
- datu underground cable/phone/data service
- fence-chainlink
- fence-wood
- fence-barbed wire
- treeline

Symbols


- ⊙ sanitary manhole
- co service cleanout
- fmv force main release valve
- rectangular structure
- circular structure
- ♂ fire hydrant
- ⊕ water valve
- Ⓜ water meter
- BFP backflow preventer
- ⊕ natural gas meter
- T service transformer (pad mount)
- S primary switch gear
- ⊛ light pole
- C cable/phone/data junction box
- ⊙ street light
- ⊙ pedestrian street light
- ⊕ electric pole
- guy wire
- ▭ end section

Erosion Control Legend

- Phase I Silt fence
- Phase I Inlet protection
- Phase II Silt fence
- Phase II Inlet protection
- limits of disturbance

Property Legend

- right of way
- property lines
- easements
- setbacks

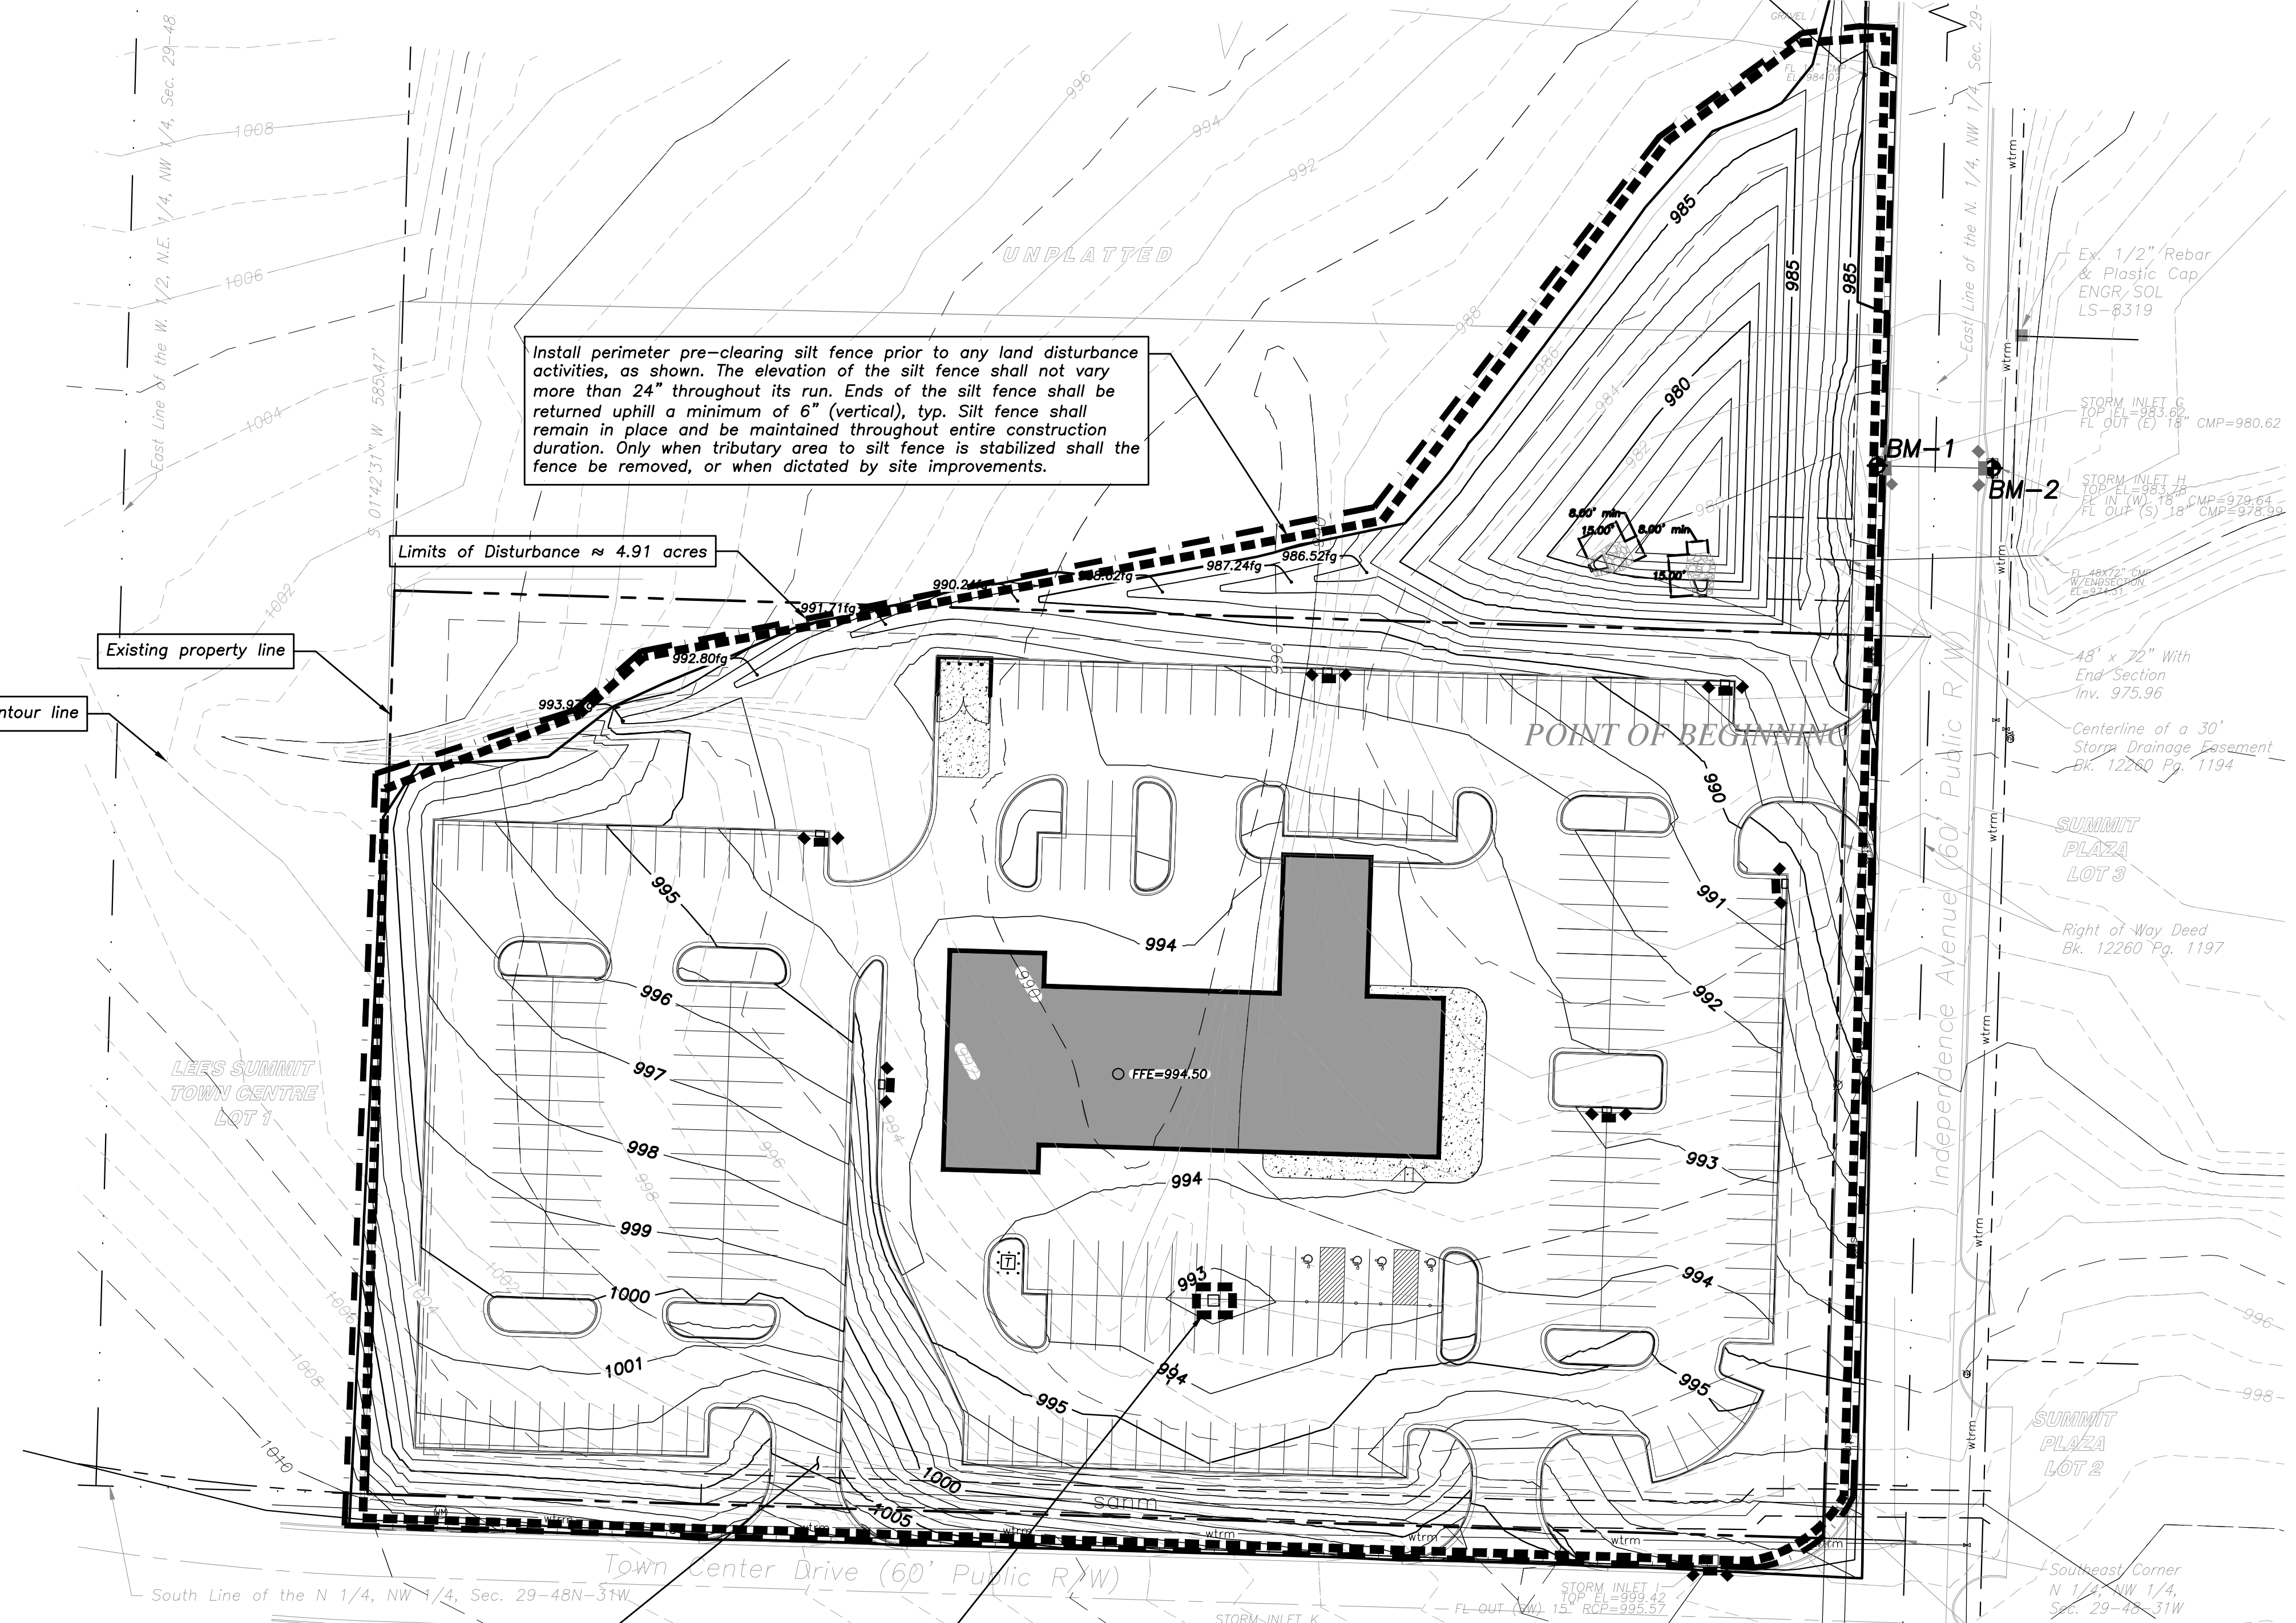

1 Erosion Control Plan - Phase II
1"=30'
0 15 30 60
north



A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date XX.XX.XXXX
drawn by SLM
checked by PAM
revisions

sheet number
C2.3
drawing type preliminary
project number 19076



Local Benchmarks:

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Linetypes

sanm	sanitary main
sans	sanitary service
ssm	storm sewer (existing)
ssns	storm sewer (solid wall, proposed)
sspm	storm sewer (solid wall, proposed)
sspf	storm sewer (perforated, proposed)
wrm	water main
wtrf	water service (fire)
wtrd	water service (domestic)
wtri	water service (irrigation)
gasm	natural gas main
gass	natural gas service schematic
elpu	underground primary electric
elsu	underground secondary electric
elpo	overhead electric
datu	undgrnd cable/phone/data
datu	undgrnd cable/phone/data service
fc	fence-chainlink
fw	fence-wood
fbw	fence-barbed wire
tr	treeline

Grading Legend

---	existing minor contour
---	existing major contour
---	proposed minor contour
---	proposed major contour

Utility Legend


---	existing
---	proposed

Property Legend


---	right of way
---	property lines
---	easements
---	setbacks

Americans with Disabilities Act (ADA) Notes:

- The running and cross slopes for all sidewalks, accessible paths, ramps, designated parking stalls, etc., shall be in compliance with latest Federal ADA guidelines, in addition to any accessibility standards adopted by the governing municipality. Prior to installation/construction, if any discrepancies are found within the plans, the Engineer shall be notified.

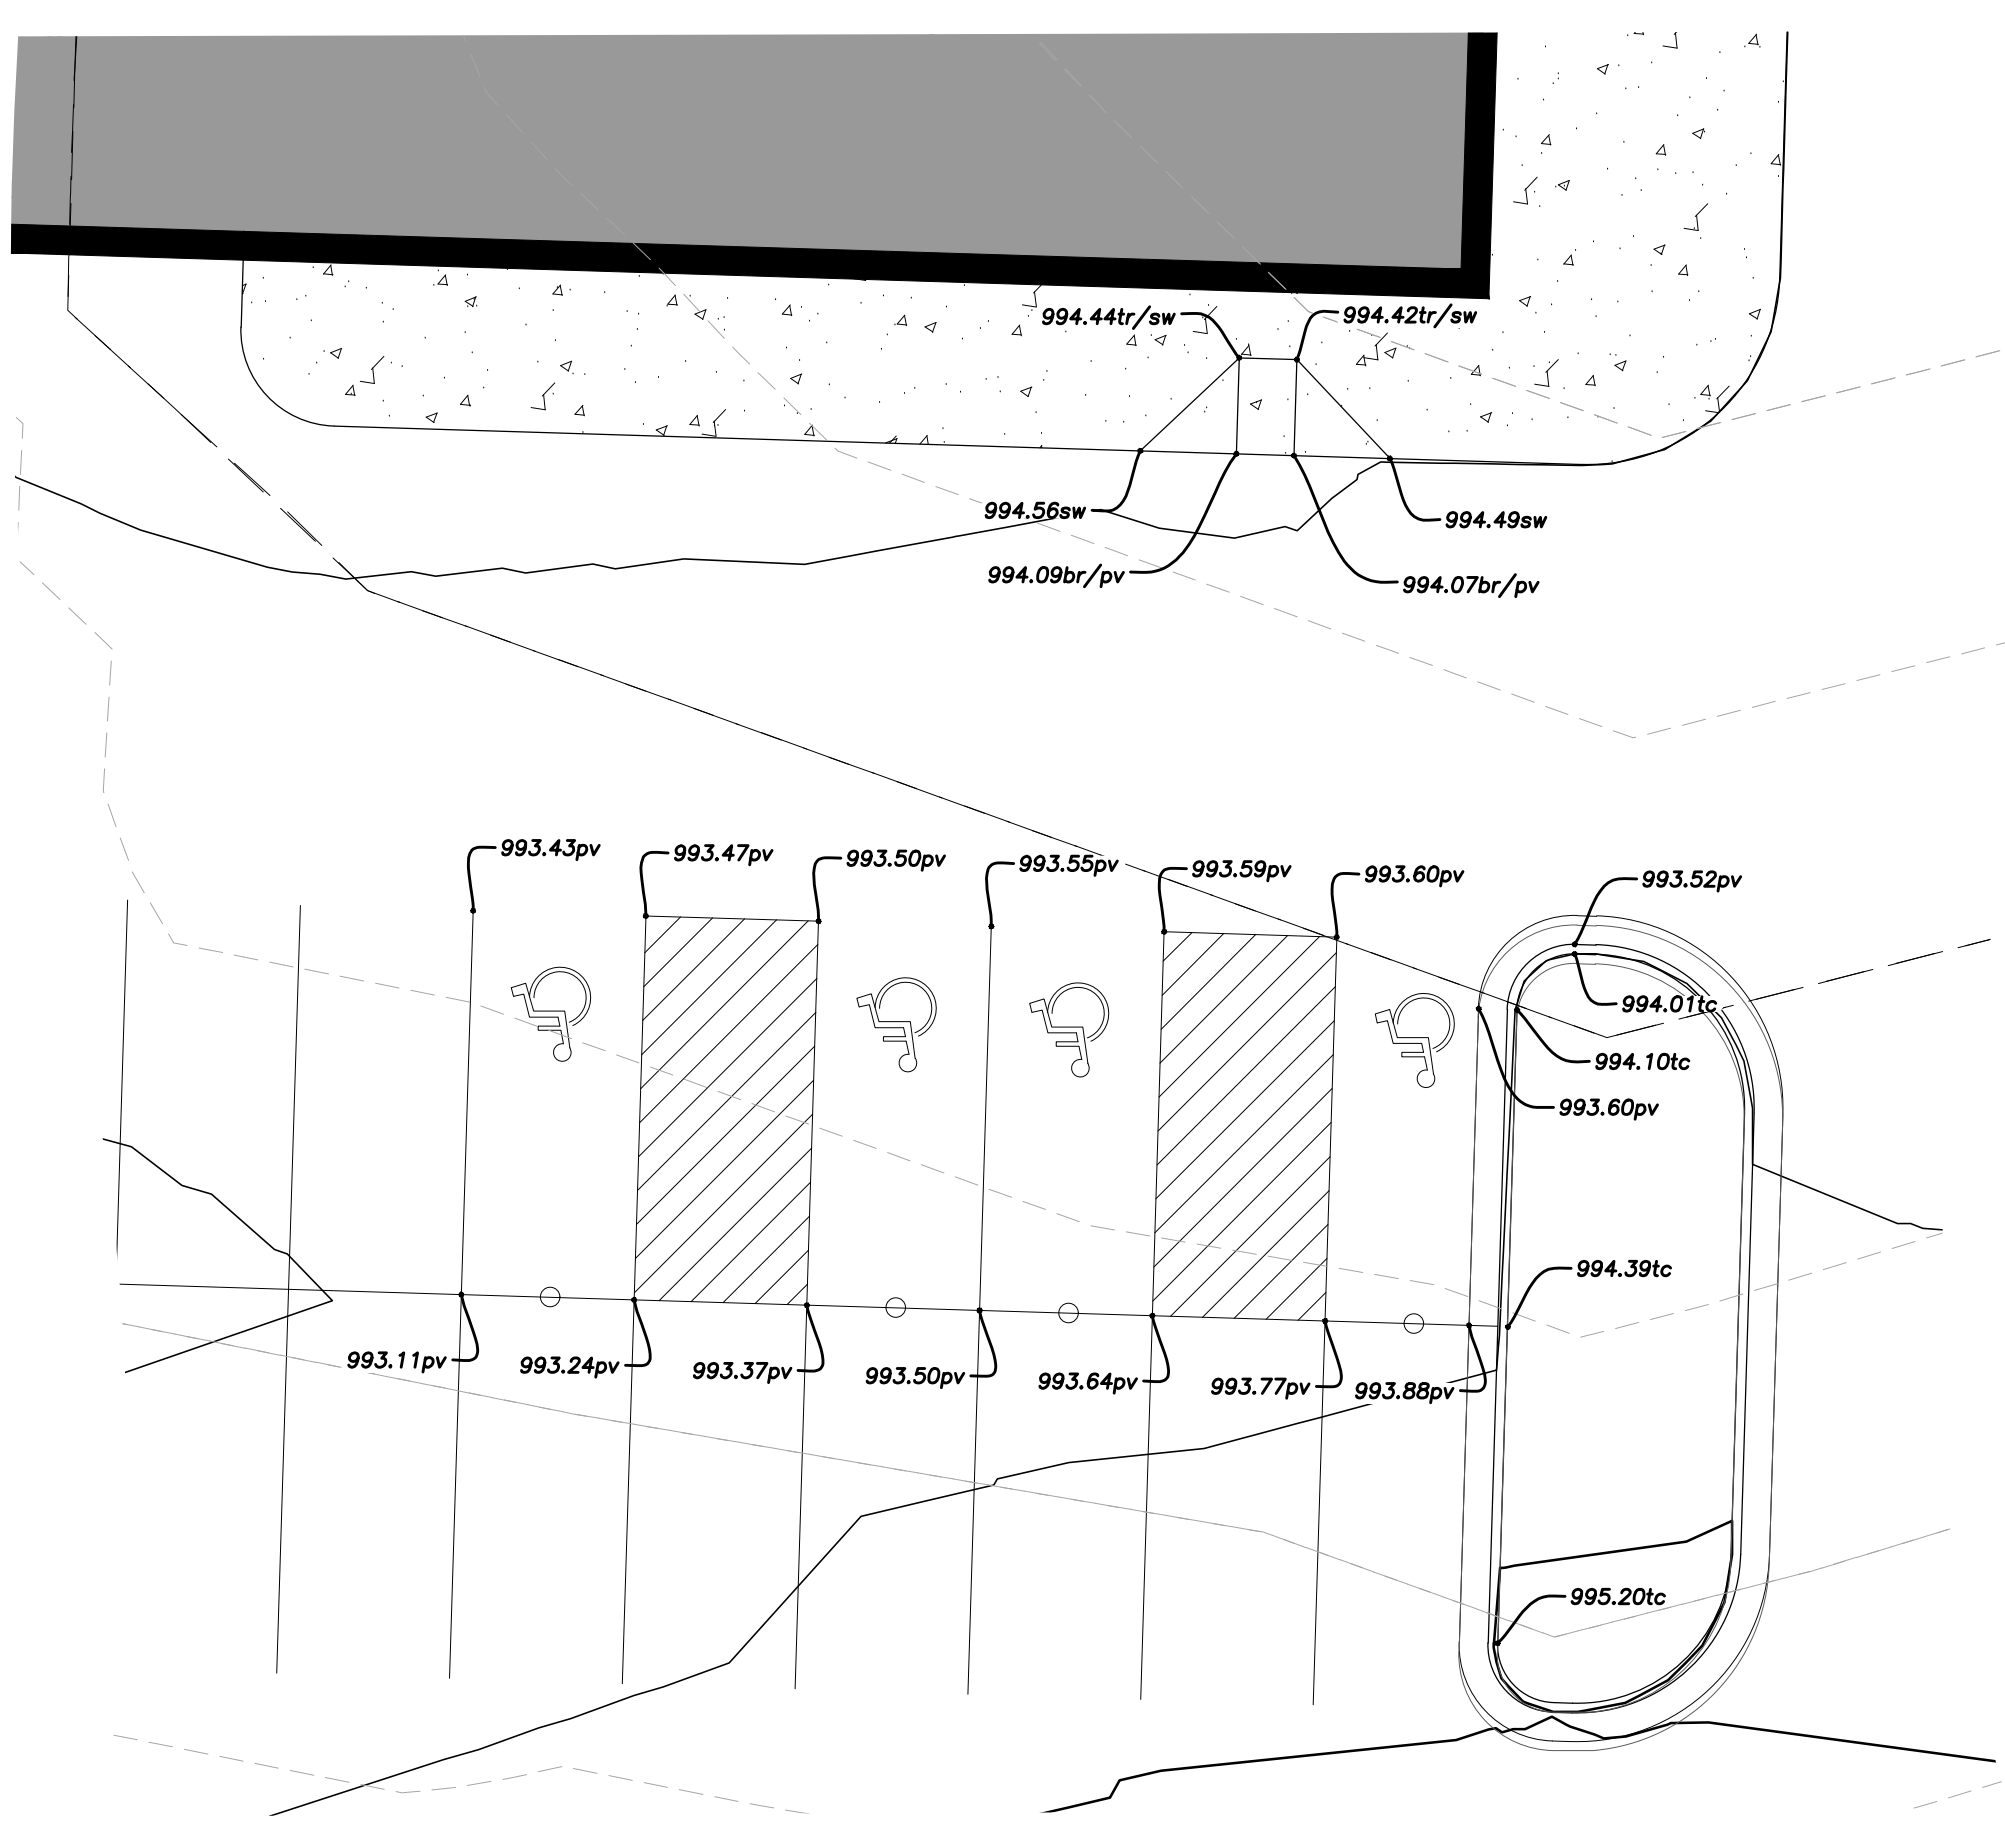

2 ADA Spot Elevation Plan
1"=10'
0 5 10 20

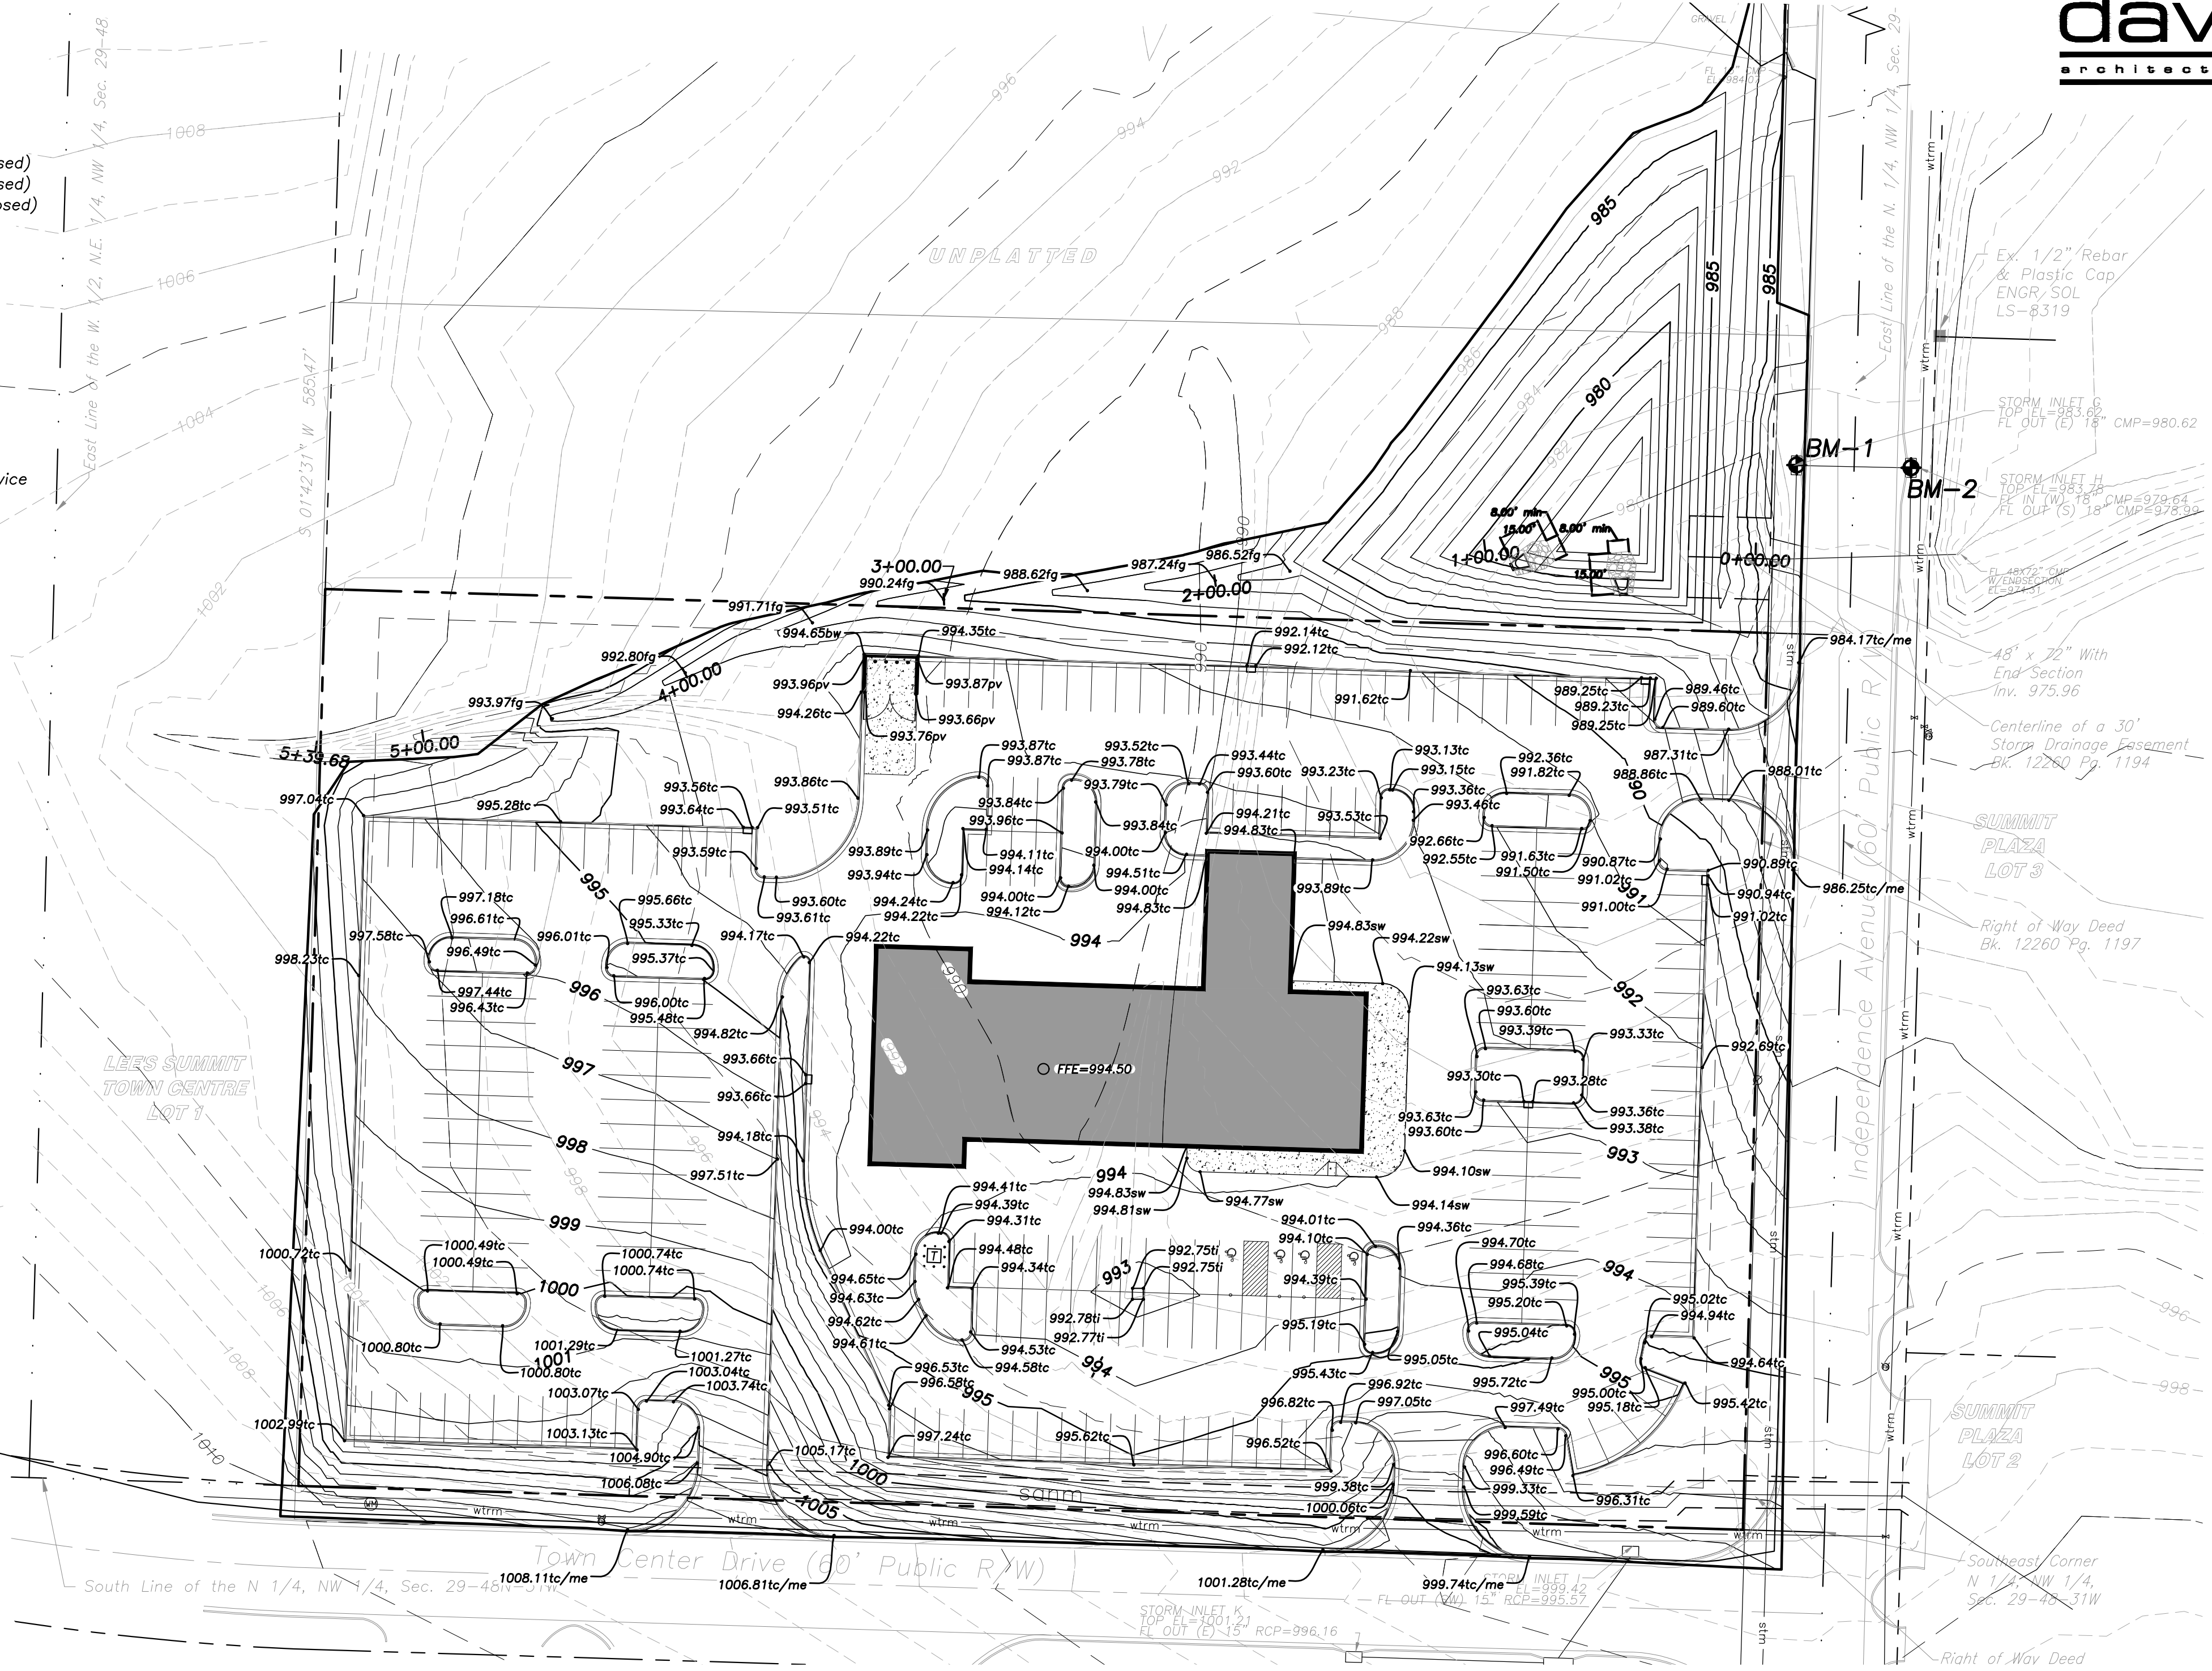


Symbols

⊙	sanitary manhole	⊗	natural gas meter
⊙	service cleanout	⊞	service transformer (pad mount)
⊗	force main release valve	⊞	primary switch gear
⊞	rectangular structure	⊞	light pole
⊞	circular structure	⊞	cable/phone/data junction box
⊞	fire hydrant	⊞	street light
⊞	water valve	⊞	pedestrian street light
⊞	water meter	⊞	electric pole
⊞	backflow preventer	⊞	guy wire
		⊞	end section

Spot Elevation Legend

br	= bottom of ramp	ti	= top of inlet
tr	= top of ramp	mi	= mid-point
me	= match existing	hp	= high-point
pv	= pavement	lp	= low-point
bw	= bottom of wall	pc	= point of curvature
tw	= top of wall	pt	= point of tangency
tc	= top of curb	blgd	= building
sw	= sidewalk	FFE	= finished floor elevation
		ex	= existing
		mp	= match pavement

1 Spot Elevation Plan
1"=30'
0 15 30 60

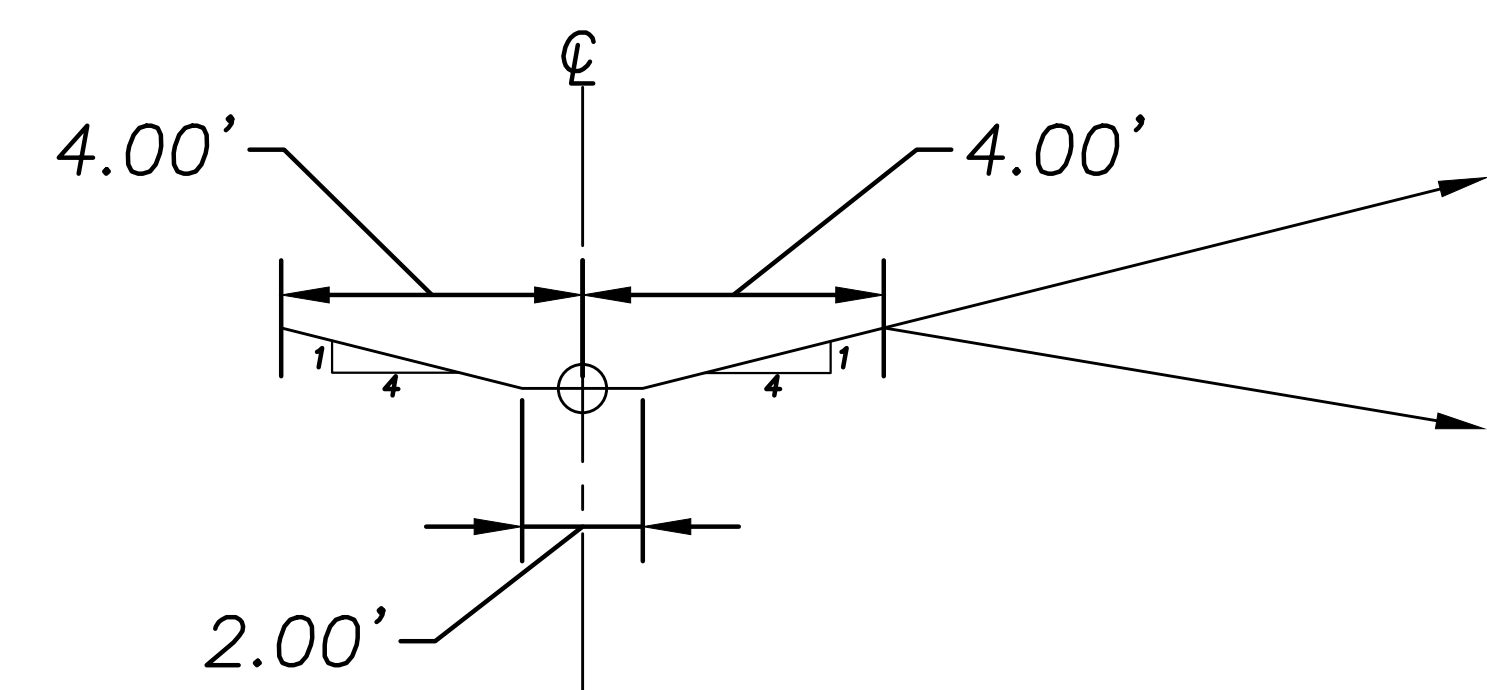

3 Drainage Swale Cross-Section
not to scale

Flat Cut Slope: 4.00:1
Flat Cut Max Height: 1.00'
Medium Cut Slope: 4.00:1
Medium Cut Max Height: 5.00'
Steep Cut Slope: 3.00:1

Flat Fill Slope: 6.00:1
Flat Fill Max Height: 5.00'
Medium Fill Slope: 4.00:1
Medium Fill Max Height: 10.00'
Steep Fill Slope: 3.00:1



A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date
XX.XX.XXXX
drawn by
SLM
checked by
PAM
revisions

sheet number
C2.4
drawing type
preliminary
project number
19076



Local Benchmarks: BM-#

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Floodplain Note:

The site lies entirely within 'Zone X', areas determined to be outside the 0.2% annual chance floodplain as depicted on the FEMA Flood Insurance Rate Map (FIRM) no. 29095C0430G, Revision Date: January 20, 2017.

Drainage Legend

--- drainage area

Property Legend

--- right of way
--- property lines
--- easements
--- setbacks

Grading Legend


--- existing minor contour
--- existing major contour
--- proposed minor contour
--- proposed major contour

Utility Legend


--- existing
--- proposed

Linetypes

--- sanm --- sanitary main
--- sans --- sanitary service
--- ssm --- storm sewer (existing)
--- ssm --- storm sewer (solid wall, proposed)
--- ssm --- storm sewer (solid wall, proposed)
--- ssm --- storm sewer (perforated, proposed)
--- wtm --- water main
--- wtrf --- water service (fire)
--- wtrd --- water service (domestic)
--- wtri --- water service (irrigation)
--- gasm --- natural gas main
--- gass --- natural gas service schematic
--- elpu --- underground primary electric
--- elsu --- underground secondary electric
--- elpo --- overhead electric
--- datu --- underground cable/phone/data
--- datsu --- underground cable/phone/data service
--- fence-chainlink
--- fence-wood
--- fence-barbed wire
--- treeline

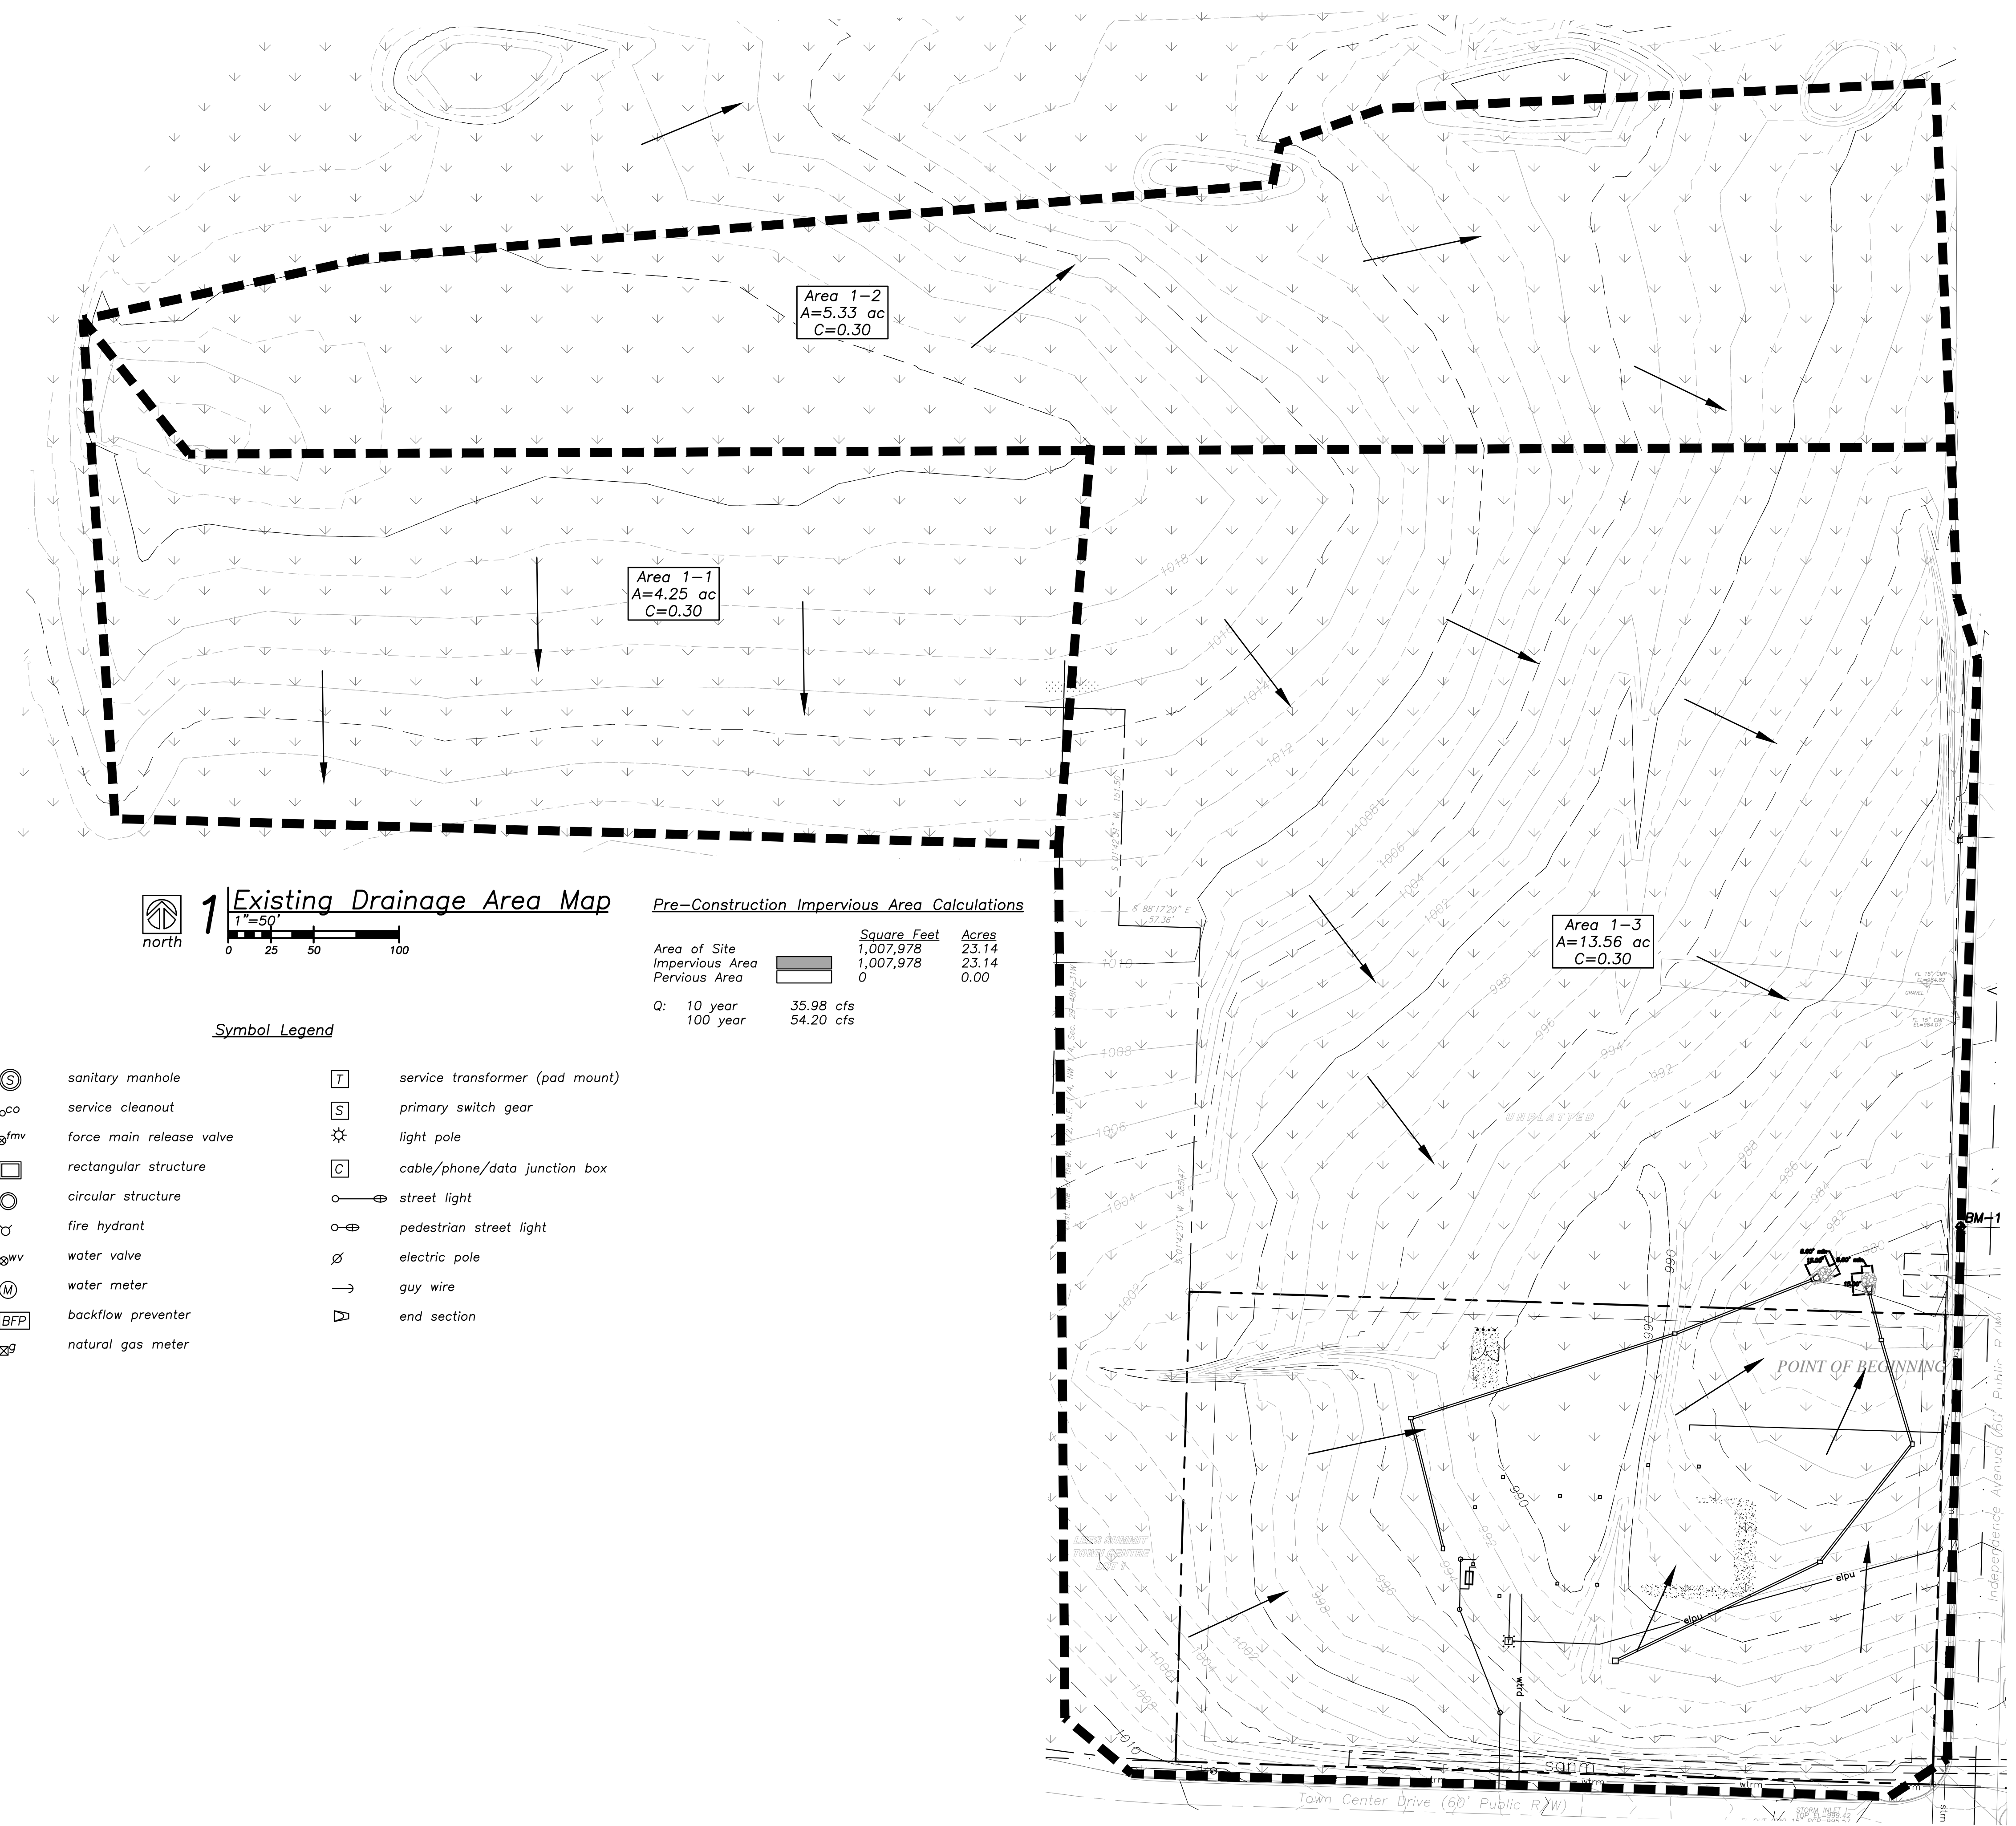

Existing Drainage Area Map



Pre-Construction Impervious Area Calculations

	Square Feet	Acres
Area of Site	1,007,978	23.14
Impervious Area	1,007,978	23.14
Pervious Area	0	0.00

Q: 10 year 35.98 cfs
100 year 54.20 cfs

Symbol Legend

- ⊙ sanitary manhole
- ⊙ service cleanout
- ⊙ force main release valve
- rectangular structure
- circular structure
- ⊕ fire hydrant
- ⊕ water valve
- ⊕ water meter
- ⊕ backflow preventer
- ⊕ natural gas meter
- ⊕ service transformer (pad mount)
- ⊕ primary switch gear
- ⊕ light pole
- ⊕ cable/phone/data junction box
- ⊕ street light
- ⊕ pedestrian street light
- ⊕ electric pole
- ⊕ guy wire
- ⊕ end section



A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date
drawn by SLM
checked by PAM
revisions

sheet number
C3.1
drawing type
Preliminary
project number



Local Benchmarks: BM-#

BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100

Floodplain Note:

The site lies entirely within 'Zone X', areas determined to be outside the 0.2% annual chance floodplain as depicted on the FEMA Flood Insurance Rate Map (FIRM) no. 29095C0430G, Revision Date: January 20, 2017.

Drainage Legend

--- drainage area

Property Legend

--- right of way
--- property lines
--- easements
--- setbacks

Grading Legend

--- existing minor contour
--- existing major contour
--- proposed minor contour
--- proposed major contour

Utility Legend


--- existing
--- proposed

Linetypes

--- sanm --- sanitary main
--- sans --- sanitary service
--- ssm --- storm sewer (existing)
--- stms --- storm sewer (solid wall, proposed)
--- stmp --- storm sewer (perforated, proposed)
--- wtm --- water main
--- wtf --- water service (fire)
--- wrd --- water service (domestic)
--- wrir --- water service (irrigation)
--- gasm --- natural gas main
--- goss --- natural gas service schematic
--- elpu --- underground primary electric
--- elsu --- underground secondary electric
--- elpo --- overhead electric
--- datu --- underground cable/phone/data
--- dats --- underground cable/phone/data service
--- fence-chainlink
--- fence-wood
--- fence-barbed wire
--- treeline

Symbol Legend

⊙ sanitary manhole
⊙ service cleanout
⊙ fmv force main release valve
□ rectangular structure
○ circular structure
⊕ fire hydrant
⊕ wv water valve
⊕ M water meter
⊕ BFP backflow preventer
⊕ natural gas meter
T service transformer (pad mount)
S primary switch gear
⊙ light pole
C cable/phone/data junction box
⊕ street light
⊕ pedestrian street light
⊕ electric pole
⊕ guy wire
D end section

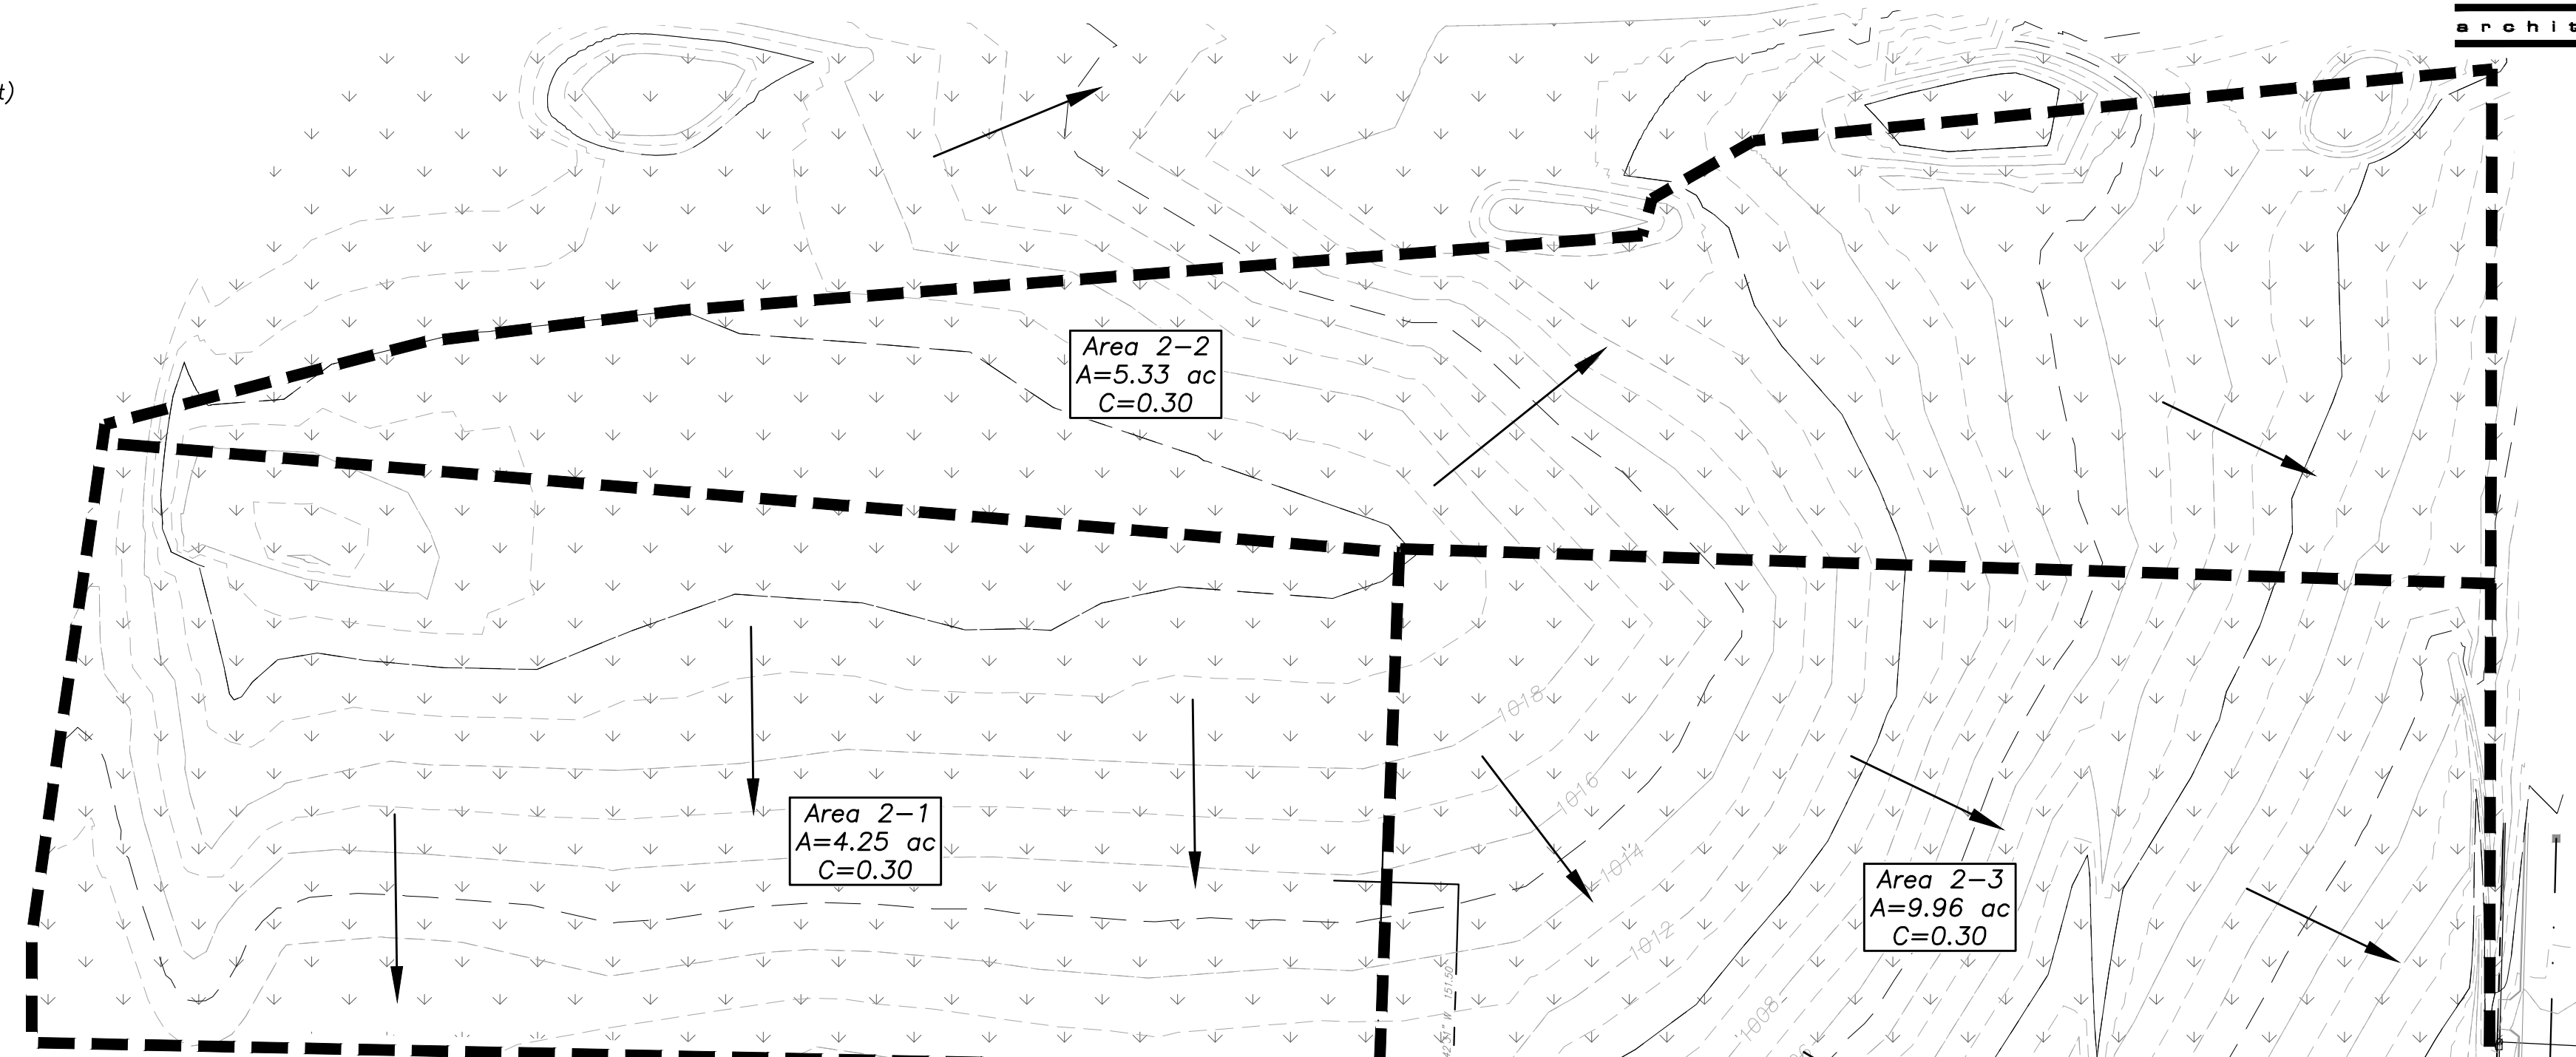


1 Proposed Drainage Area Map
1"=80'
0 40 80 160

Post-Construction Impervious Area Calculations

	Square Feet	Acres
Area of Site	1,007,978	23.14
Impervious Area	124,303	2.85
Pervious Area	883,832	20.29

Q: 10 year 6.268 cfs
100 year 9.247 cfs

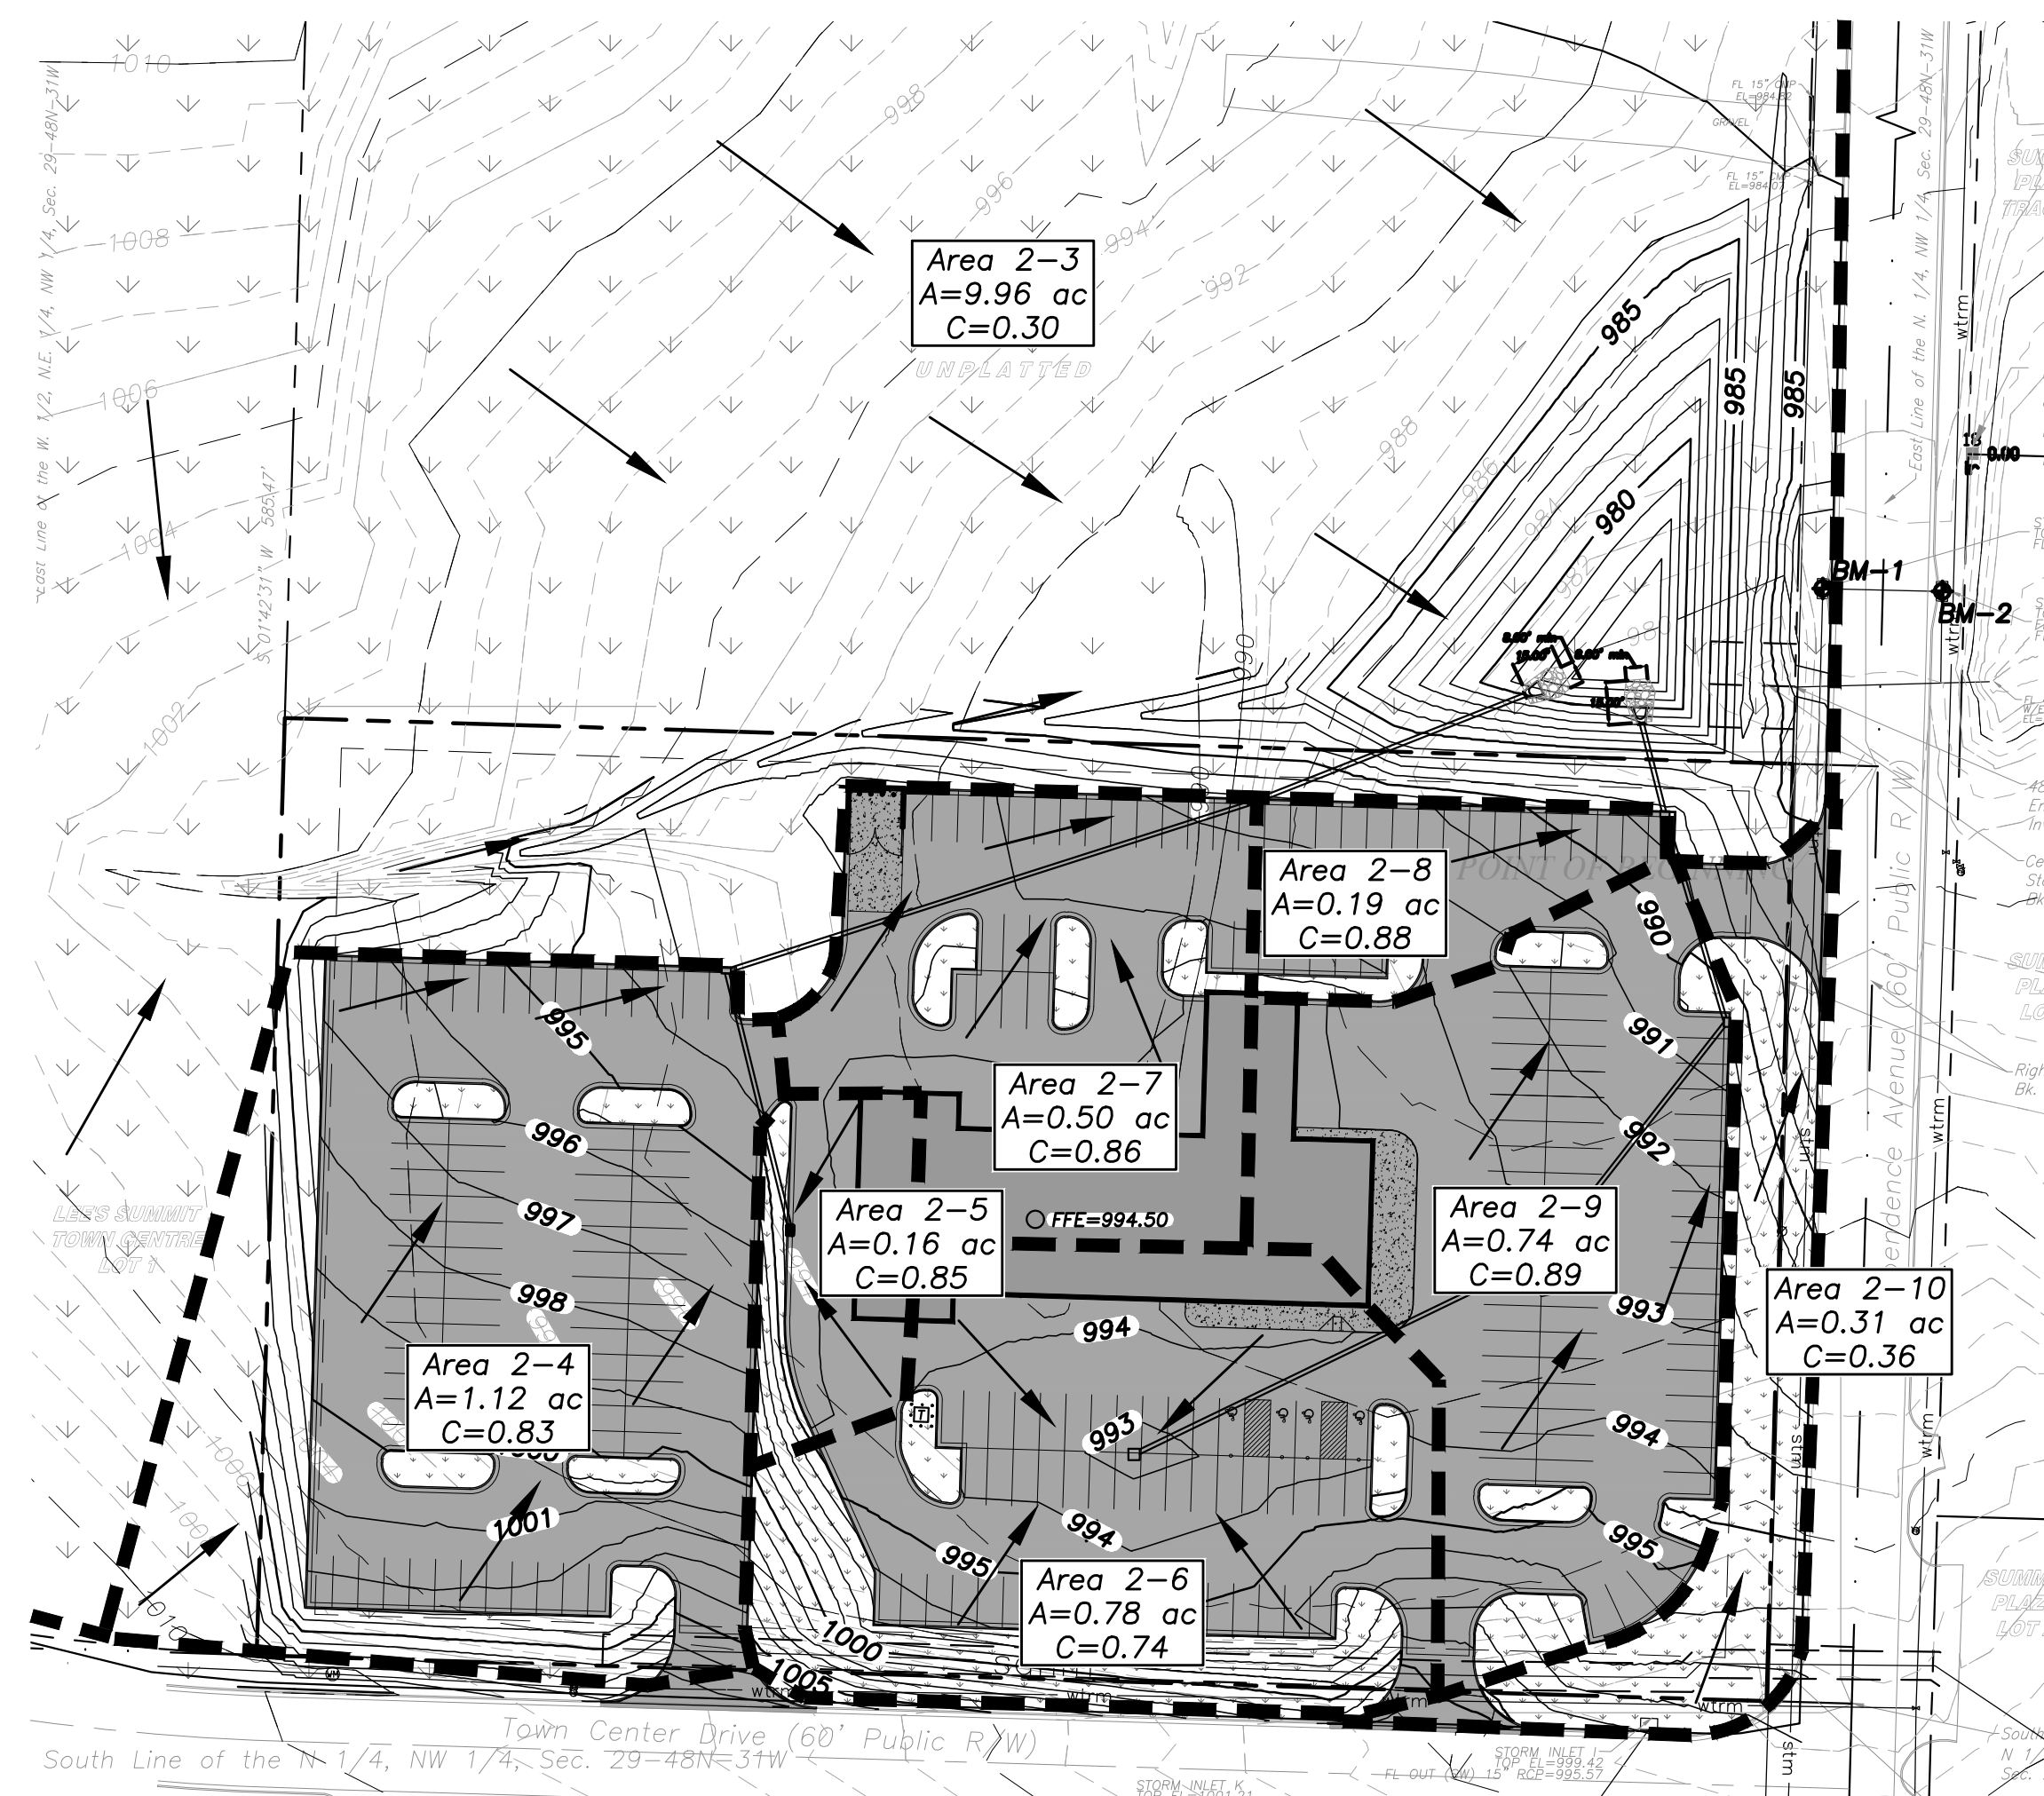

2 Proposed Drainage Area Map Detail
1"=50'
0 25 50 100



A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date
drawn by SLM
checked by PAM
revisions

sheet number
C3.2
drawing type Preliminary
project number




Local Benchmarks: BM-#


BM-1: Storm Structure, Manhole Cover
Elevation: 982.05'
N: 1013823.1378
E: 2827361.8656

BM-2: Storm Structure, Manhole Cover
Elevation: 982.06'
N: 101382.1725
E: 2827403.8100


Property Legend

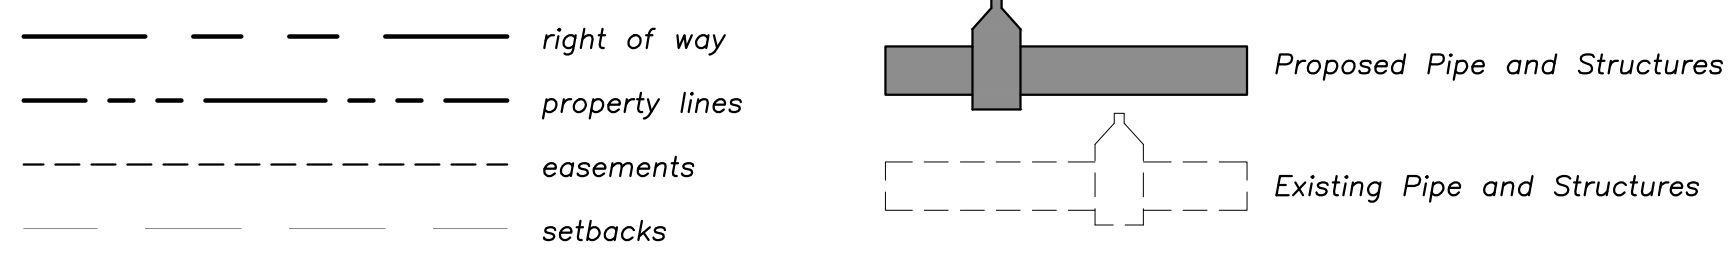


Grading Legend

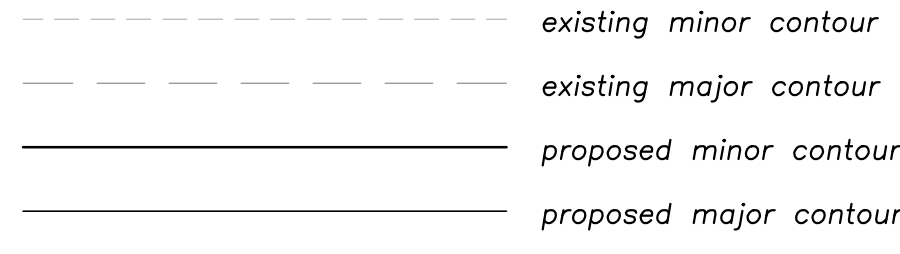


Utility Legend



Linetypes

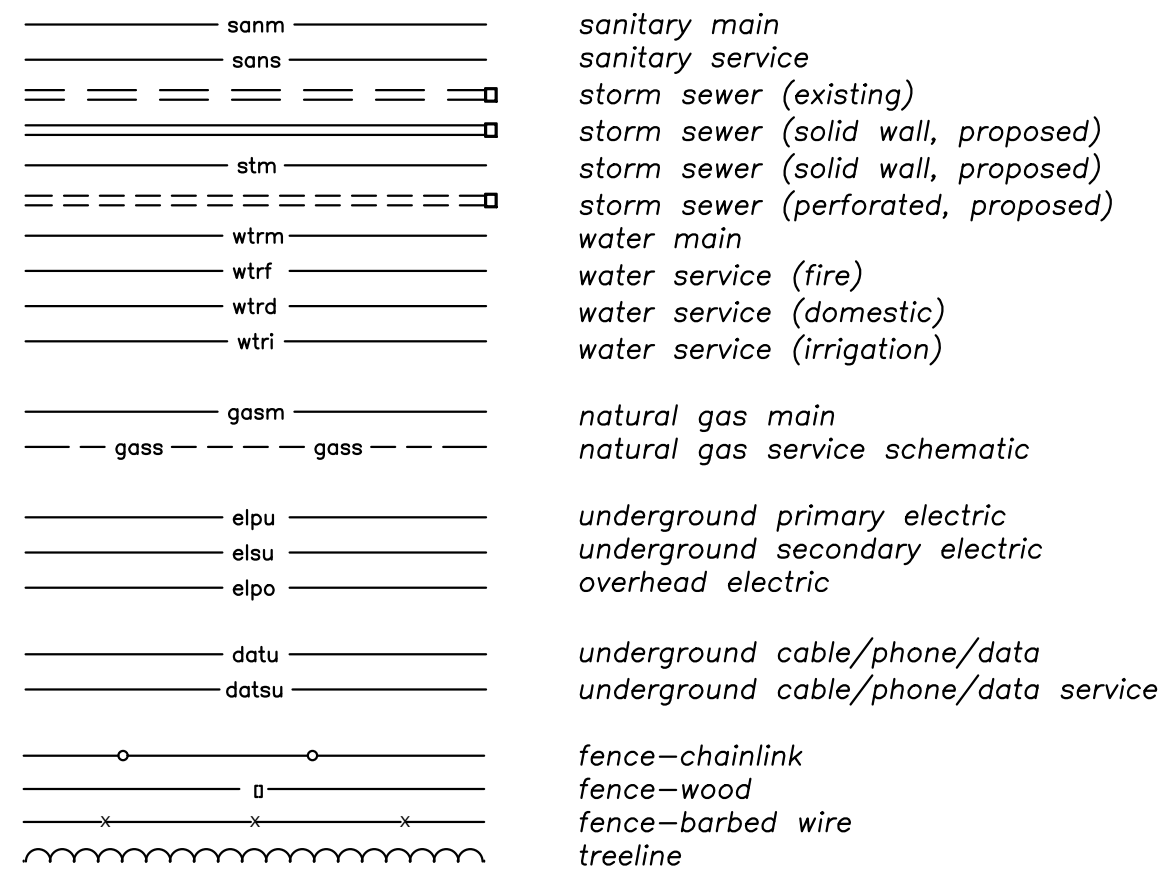



Symbols

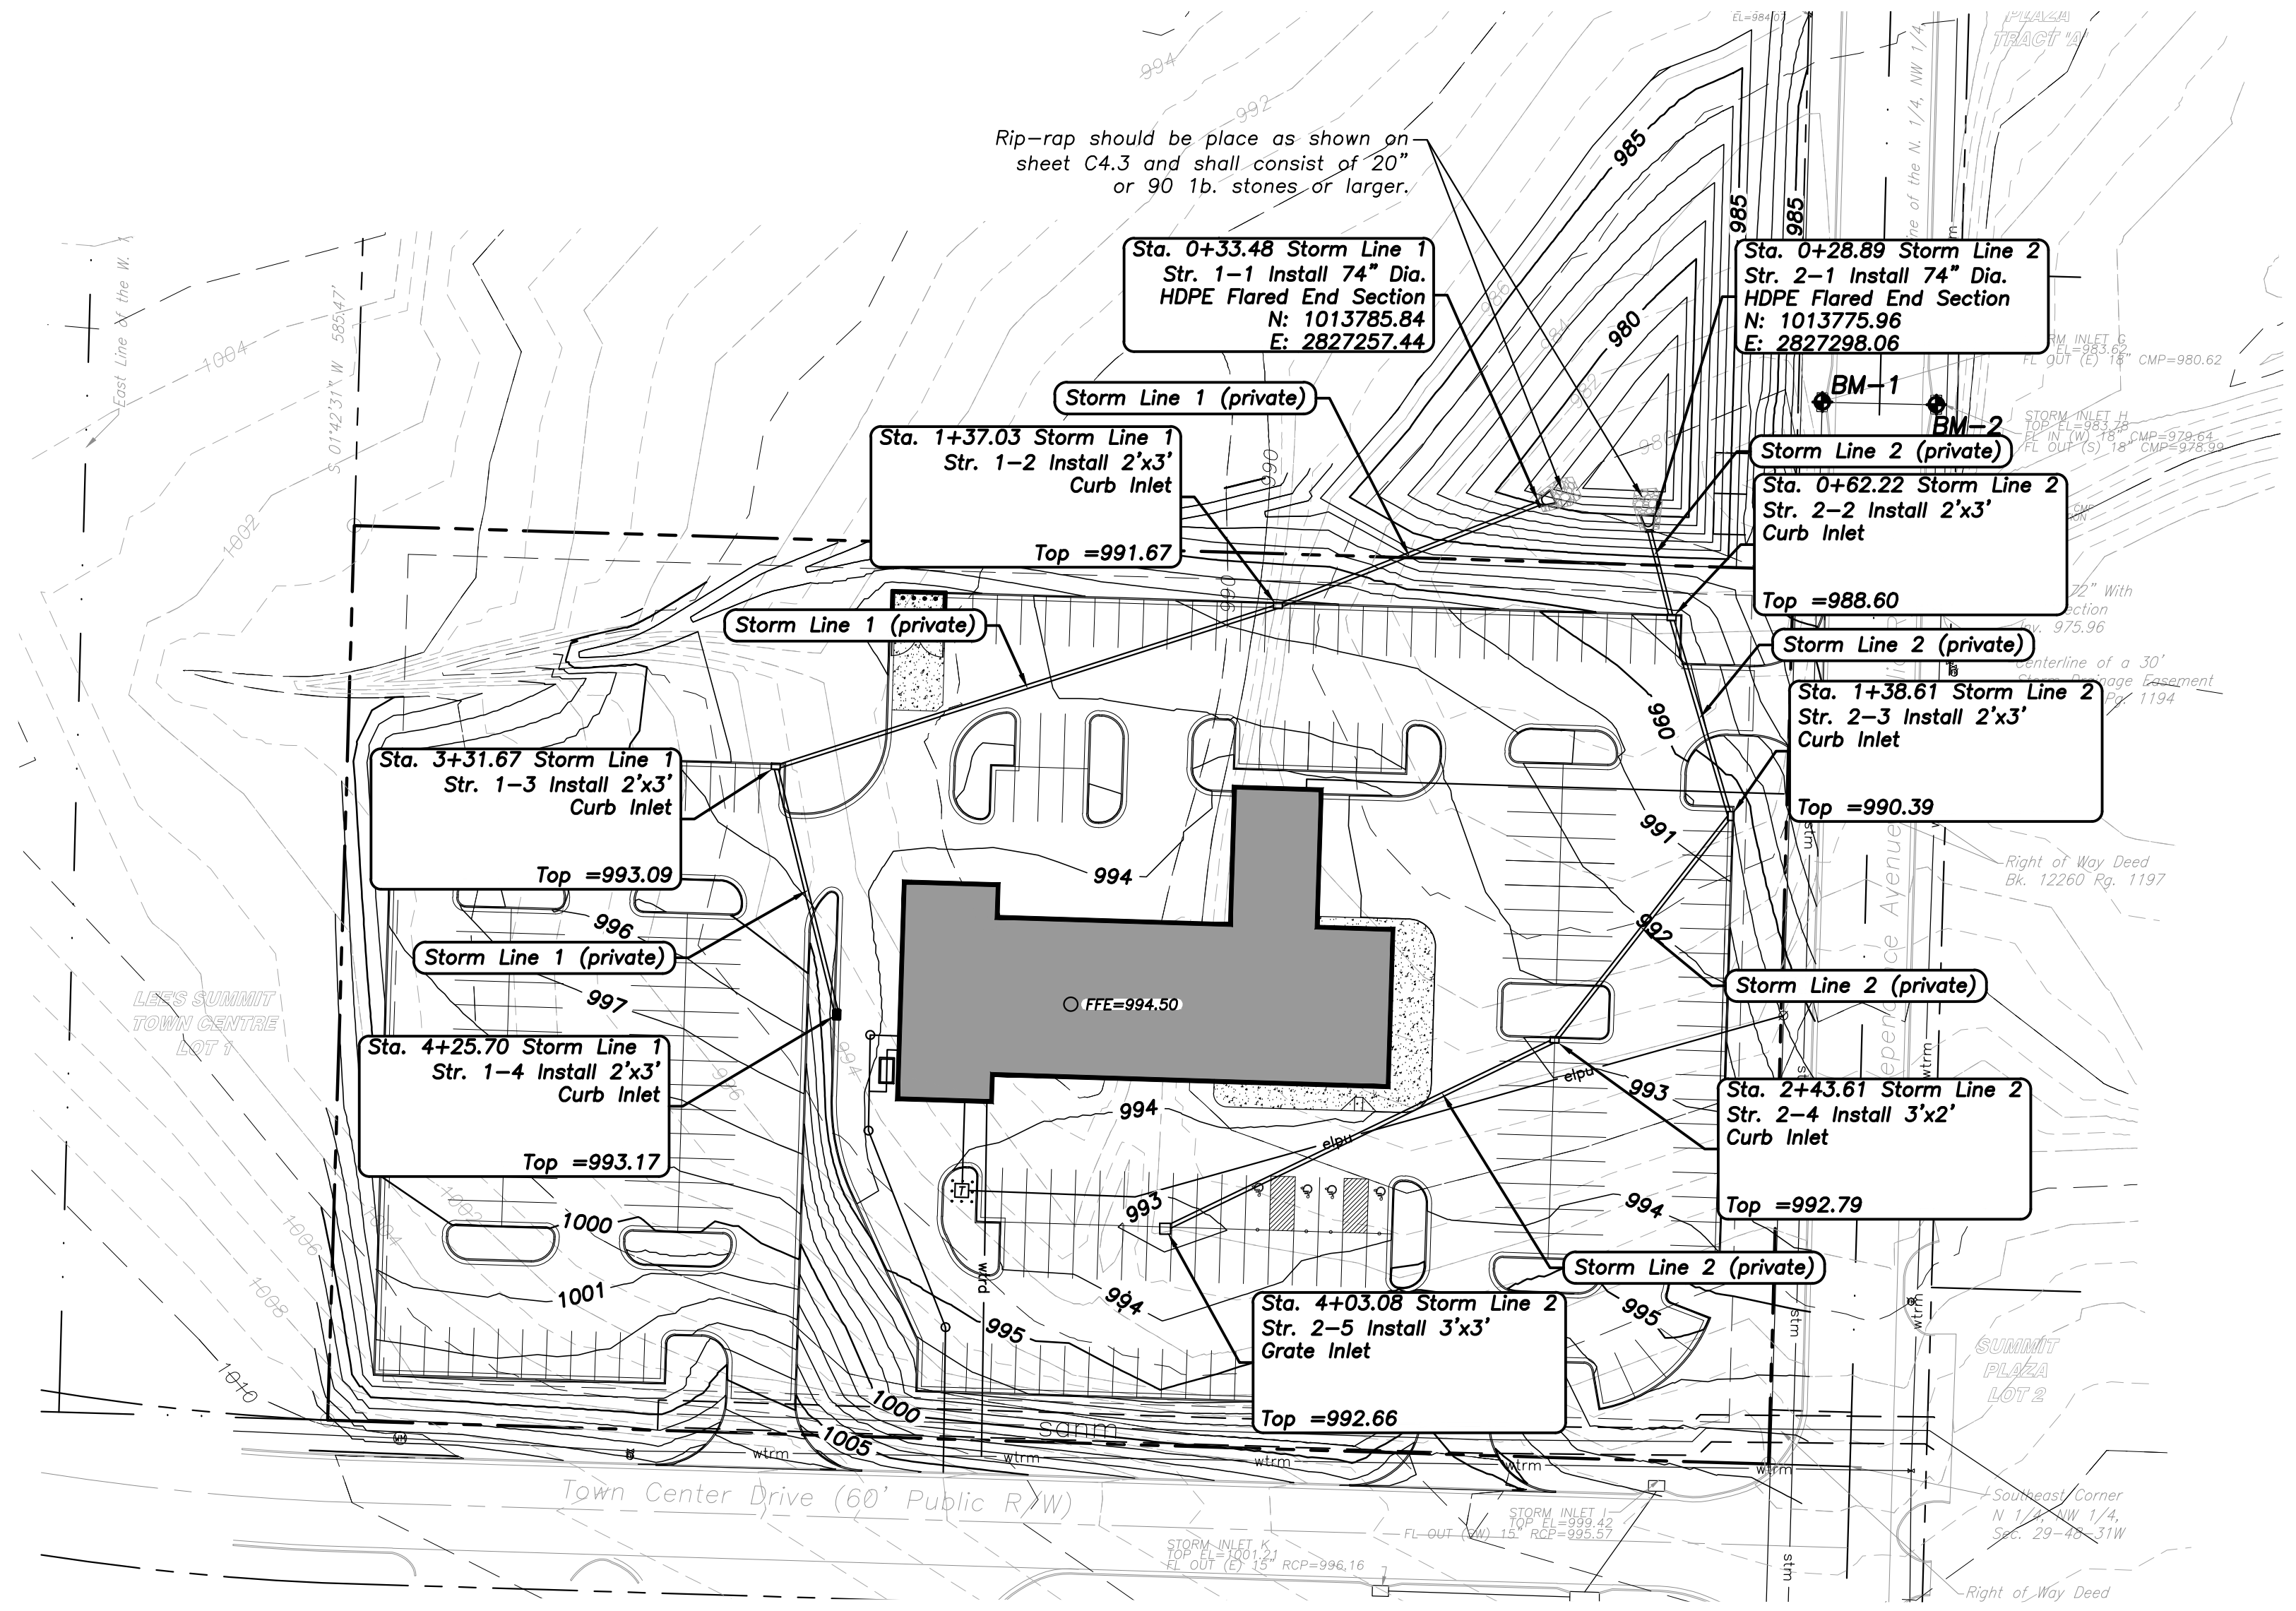

Storm Line 1

Storm Plan and Profile
V: 1"=10' H: 1"=50'

Storm Line 2

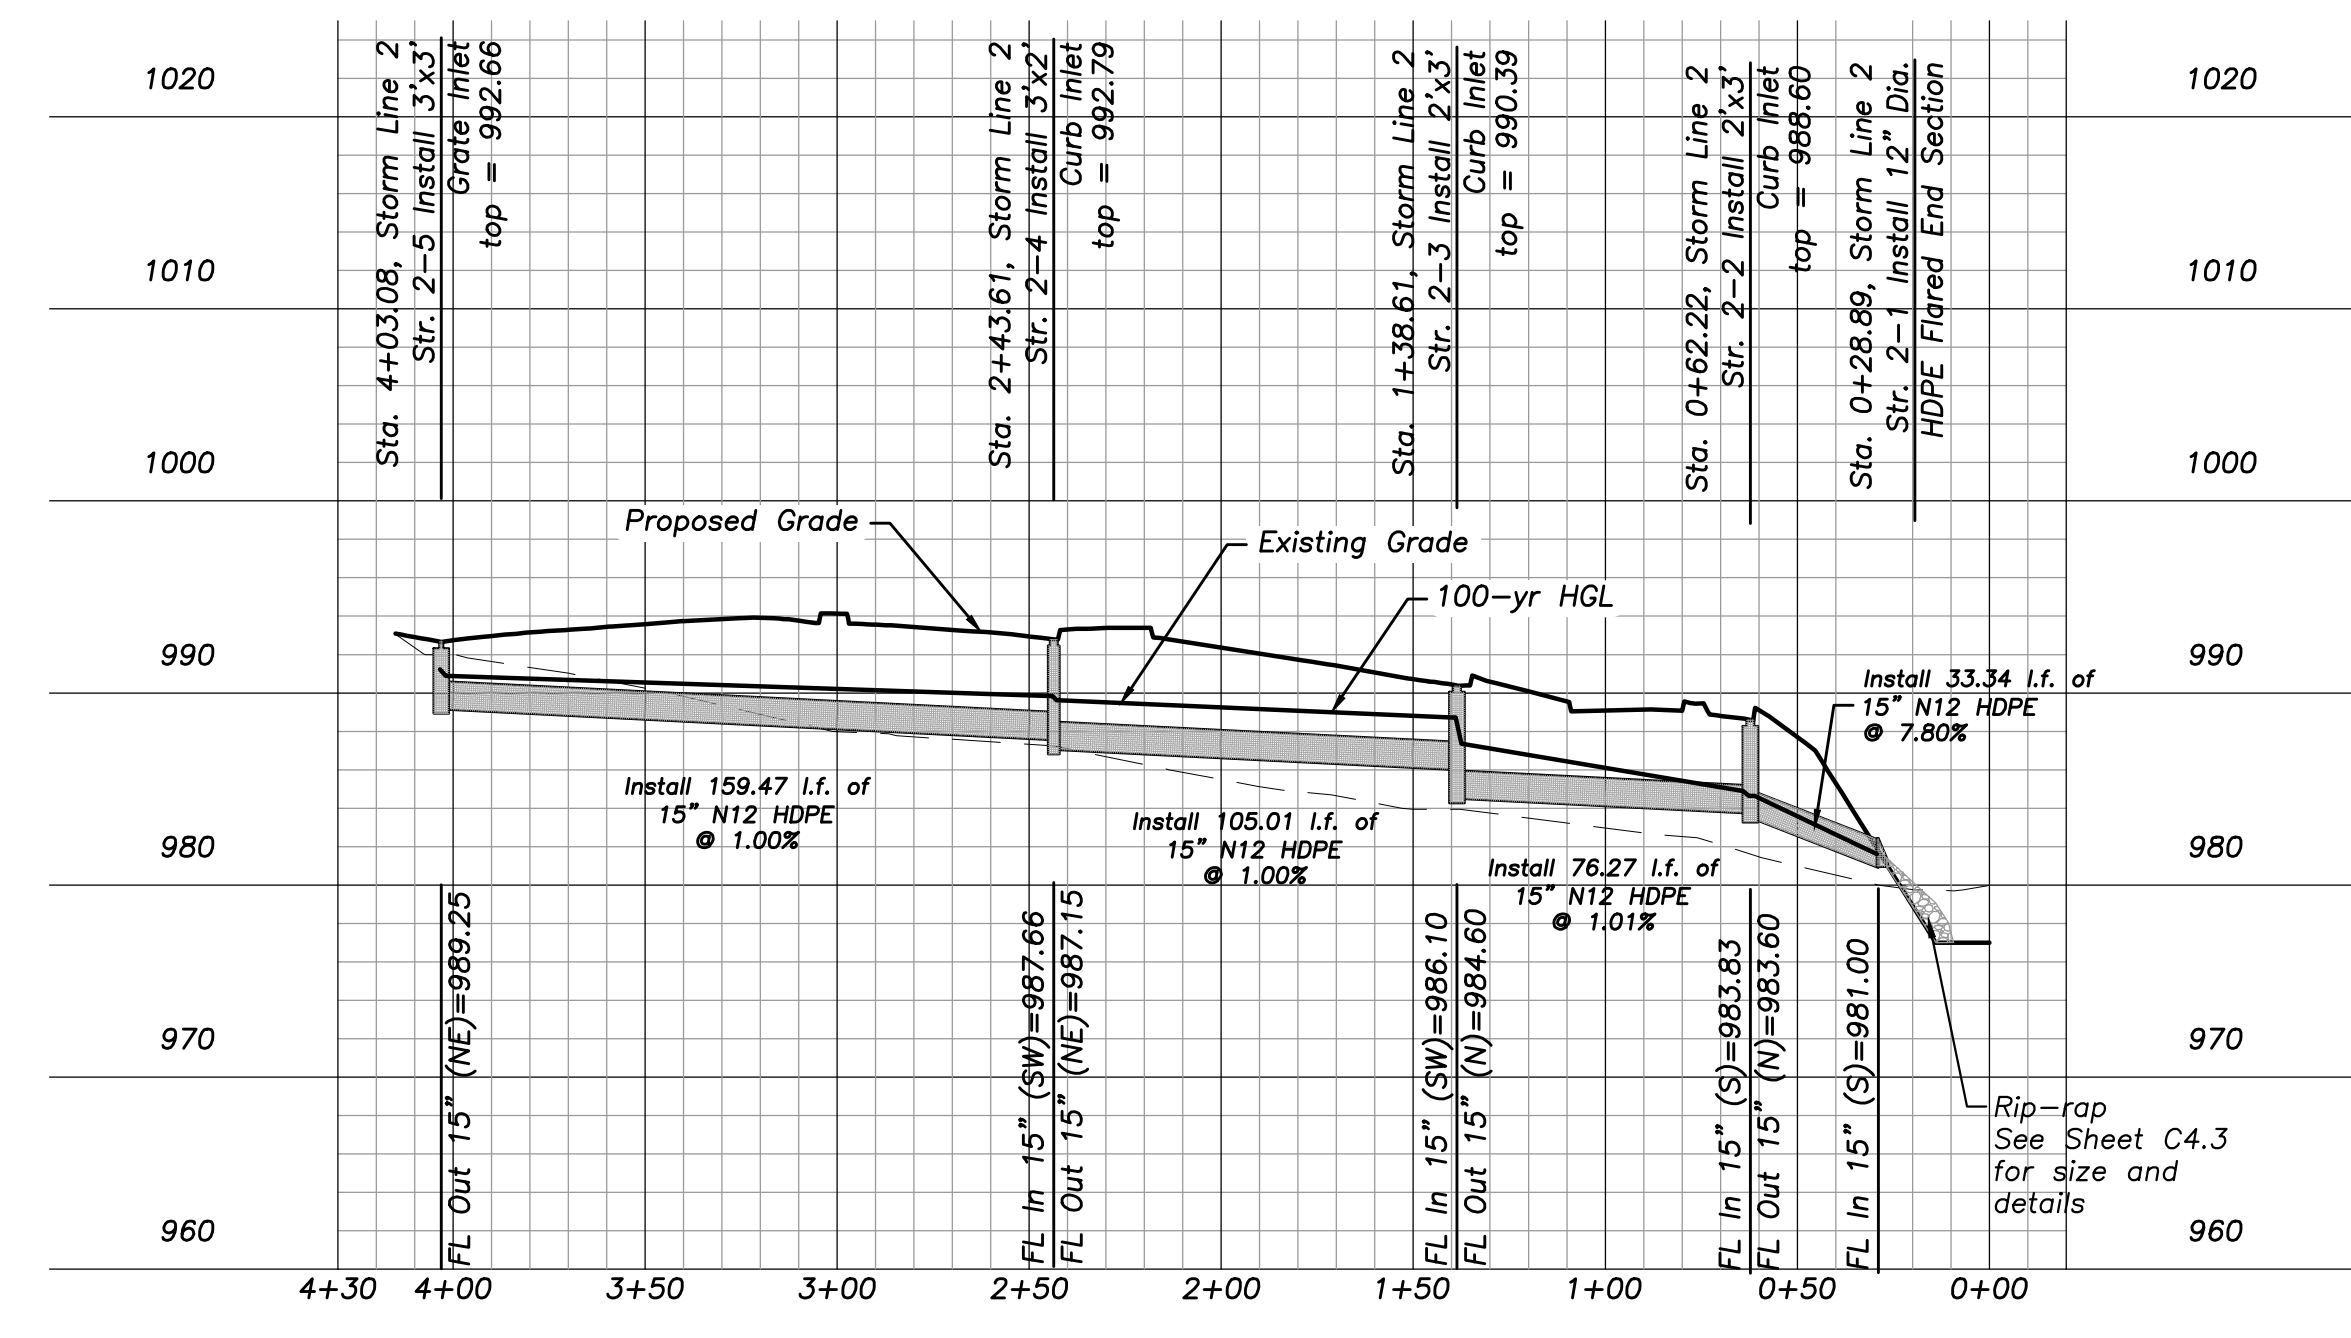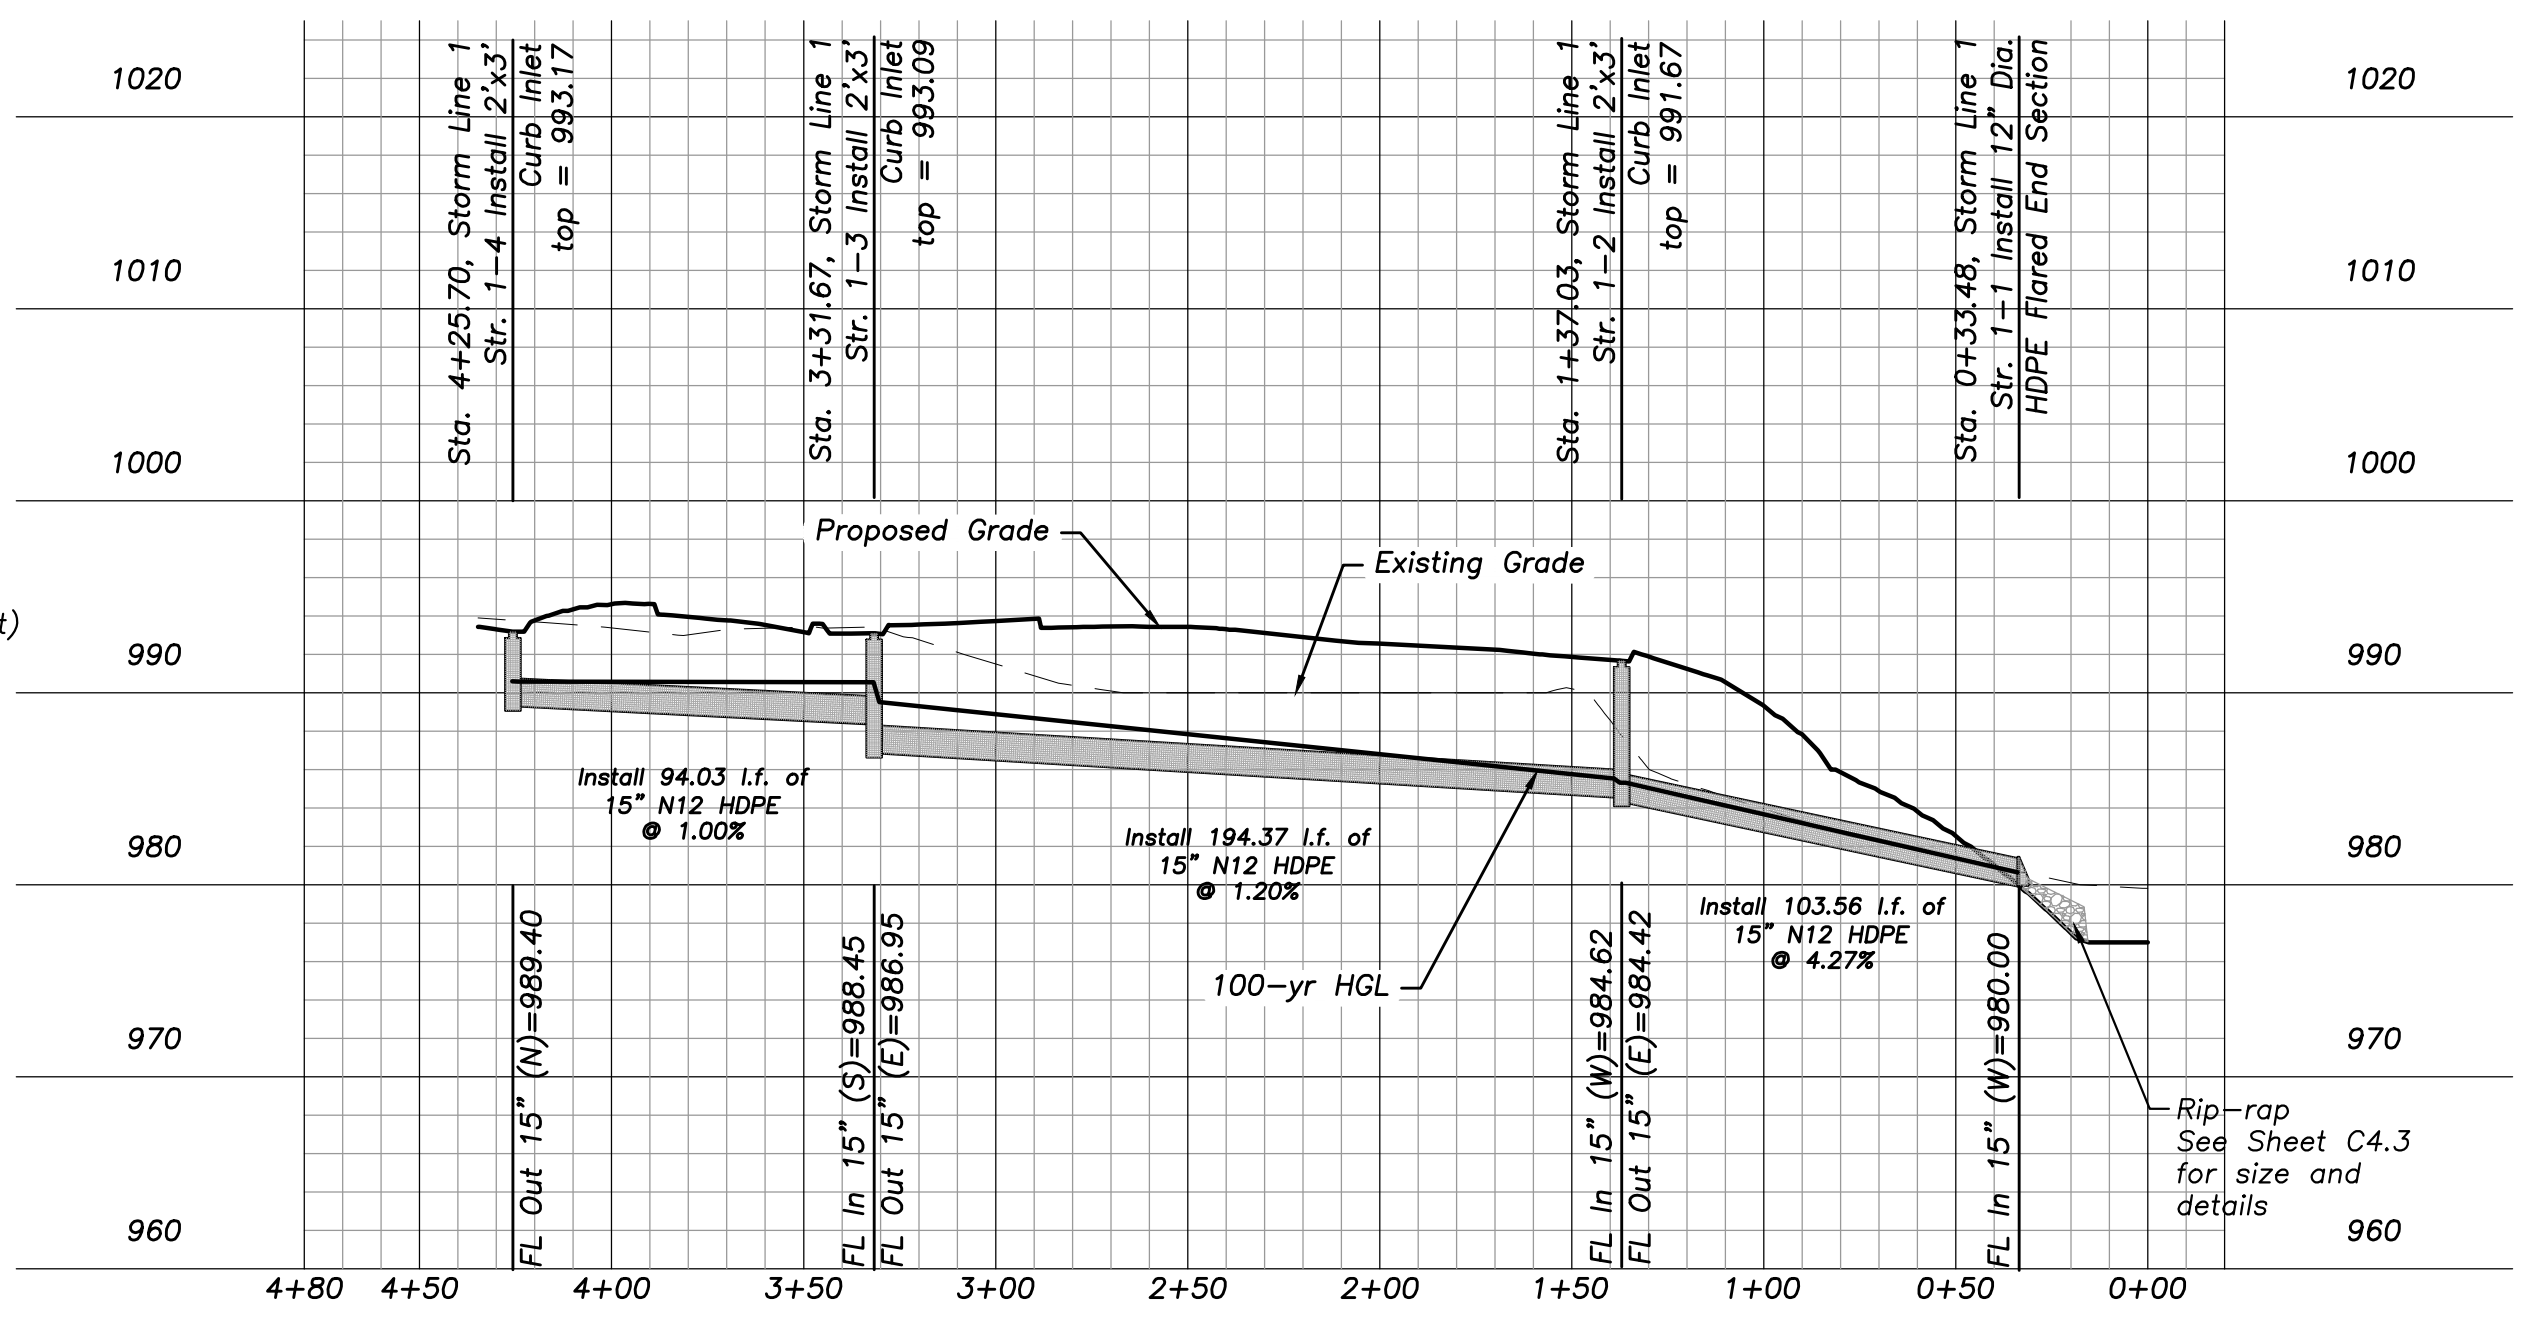

Pipe Segment	Drainage Area (ac)	Runoff Coeff (C)	Inlet Time (min)	Incr Q (cfs)	Total CxA	iSys (in/hr)	Total Runoff (cfs)	Line Size (in)	Line Slope (%)	n-value Pipe	Capacity Full (cfs)	Depth Dn (ft)	Depth Up (ft)	HGL Dn (ft)	HGL Up (ft)	Vel Ave (ft/s)	EGL Dn (ft)	EGL Up (ft)	Energy Loss (ft)	Line Length (ft)	Pipe Travel (min)	Rim-Hw (ft)
1-1 to 1-2	0.50	0.86	5.0	4.23	1.5	9.23	13.80	15	4.27	0.012	14.40	0.98	1.23**	980.98	985.65	12.36	982.97	987.64	0.000	103.559	0.14	6.02
1-2 to 1-3	1.12	0.83	5.0	9.14	1.07	9.35	9.97	15	1.20	0.012	7.63	1.25	1.25	985.87	989.84	8.14	986.90	990.88	3.975	194.370	0.40	2.22
1-3 to 1-4	0.16	0.85	5.0	1.34	0.14	9.83	1.34	15	1.01	0.012	7.01	1.25	1.25	990.88	990.91	1.09	990.89	990.93	0.035	94.027	1.43	2.24
2-1 to 2-2	0.19	0.88	5.0	1.64	1.48	9.48	14.06	15	7.80	0.012	19.47	0.79	1.23**	981.79	984.83	14.42	983.85	986.90	0.000	33.341	0.04	3.77
2-2 to 2-3	0.73	0.89	5.0	6.39	1.32	9.52	12.53	15	1.01	0.012	7.00	1.25	1.25	985.08	987.54	10.24	986.71	989.17	2.466	76.266	0.12	1.48
2-3 to 2-4	0.10	0.89	5.0	0.88	0.67	9.64	6.42	15	1.00	0.012	6.97	1.25	1.25	988.91	989.80	5.25	989.34	990.23	0.891	105.005	0.33	2.77
2-4 to 2-5	0.78	0.74	5.0	5.68	0.58	9.83	5.68	15	1.00	0.012	6.96	1.25	1.25	990.02	991.08	4.64	990.35	991.41	1.057	159.472	0.57	1.25



A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date 02.02.2020
drawn by SLM
checked by PAM
revisions

sheet number
C3.2
drawing type preliminary
project number 19076



Notes for Concrete Washout:

- Concrete washout areas shall be installed prior to any concrete placement on site.
- Concrete washout areas shall include a filter substrate all steel relative to the amount of concrete to be placed on site. The slope leading out of the substrate pit shall be 2:1. The entire trapping area shall be sloped towards the concrete washout area.
- Vehicle tracking control is required at the access point to all concrete washout areas.
- Slopes shall be placed at the construction site entrance, washout area and elsewhere as necessary to ensure the flow of all concrete washout areas to operators of concrete truck and pump rig.
- A one-piece impervious liner may be required along the bottom and sides of the substrate pit in areas or gravity wash.

Maintenance for Concrete Washout:

- Concrete washout materials shall be removed once the materials have filled the washout to approximately 75% full.
- Concrete washout areas shall be enlarged as necessary to maintain capacity for washed concrete.
- Concrete washout water, washed pieces of concrete and all other debris in the substrate pit shall be transported from the job site in a water-tight container and disposed of properly.
- Concrete washout areas shall remain in place until all concrete for the project is placed.
- When concrete washout areas are removed, excavations shall be filled with suitable compacted backfill and facing, any disturbed areas associated with the installation, maintenance, use, or removal of the concrete washout areas shall be established.

Notes for Construction Entrance:

- Avoid loading on steep slopes, at curves on public roads, or amount of disturbed area.
- Remove all vegetation and other undesirable material from the foundation area, grade, and clear for positive drainage.
- If slope towards the public road exceeds 2%, construct a 6- to 8-inch high ridge with 3/4" x 1/4" wire mesh across the foundation approximately 15 feet from the edge of the public road to divert runoff from it.
- Install pipe under the entrance if needed to maintain drainage ditches along public roads.
- Place stone to dimensions and grade as shown on plans. Leave surface sloped for drainage.
- Divert all surface runoff and drainage from the entrance to a sediment control device.
- If conditions warrant, place geotextile fabric on the graded foundation to improve stability.

Maintenance for Construction Entrance:

- Re-stage entrance as needed to maintain function and integrity of installation. Top dress with clean aggregate as needed.

CONCRETE WASHOUT

AMERICAN PUBLIC WORKS ASSOCIATION
APWA KANSAS CITY METRO CHAPTER
CONSTRUCTION ENTRANCE AND CONCRETE WASHOUT
STANDARD DRAWING NUMBER ESC-01
ADOPTED: 10/24/2016

Construction Entrance modified from 2015 Overland Park Standard Details for Erosion and Sediment Control, Concrete Washout modified from 2009 City of Great Bend Standard Drawings.

Notes:

- Contractor shall field verify that Pounded Water Depth will not cause unintended flooding.
- Immediately following inlet construction and prior to construction of curb and inlet throat, protect inlet opening by installing 2" x 10" (min.) board wrapped in silt fence. Structures shall have excavated storage area on all four sides to allow settling of sediment (Early Stage Curb Inlet).
- When inlet is completed and curb poured, filter socks or approved equal should be used (Late Stage Curb Inlet). Straw wattles are not approved for curb inlet use.
- Contractor to field verify ponding water shall not create a traffic hazard.

Maintenance:

- Remove deposited sediment from excavated storage areas when available storage has been reduced by 20%.
- Remove deposited sediment from filter socks or similar when any accumulation of sediment is visible.
- Repair or replace as necessary to maintain function and integrity of installation.

On Grade Curb Inlet Protection

EARLY STAGE CURB INLET
(Open Box and Prior to Pouring Curb and Inlet Throat)

AMERICAN PUBLIC WORKS ASSOCIATION
APWA KANSAS CITY METRO CHAPTER
CURB INLET PROTECTION
STANDARD DRAWING NUMBER ESC-06
ADOPTED: 10/24/2016

Modified from 2015 Overland Park Standard Details for Erosion and Sediment Control.

Notes:

- In order to contain water, the ends of the silt fence must be turned uphill (Figure A).
- Long perimeter runs of silt fence must be limited to 100'. Runs should be broken up into several smaller segments to minimize water concentrations (Figure A).
- Long slopes should be broken up with intermediate rows of silt fence to slow runoff velocities.
- Attach fabric to upstream side of post.
- Install posts a minimum of 2' into the ground.
- Trenching will only be allowed for small or difficult installation, where sloping machine cannot be reasonably used.

Maintenance:

- Remove and dispose of sediment deposits when the deposit approaches 1/2 the height of silt fence.
- Repair as necessary to maintain function and structure.

AMERICAN PUBLIC WORKS ASSOCIATION
APWA KANSAS CITY METRO CHAPTER
SILT FENCE
STANDARD DRAWING NUMBER ESC-03
ADOPTED: 10/24/2016

Modified from 2015 Overland Park Standard Details for Erosion and Sediment Control.

Notes:

- Contractor shall field verify that Pounded Water Depth will not cause unintended flooding.
- Immediately following inlet construction and prior to construction of curb and inlet throat, protect inlet opening by installing 2" x 10" (min.) board wrapped in silt fence. Structures shall have excavated storage area on all four sides to allow settling of sediment (Early Stage Curb Inlet).
- When inlet is completed and curb poured, filter socks or approved equal should be used (Late Stage Curb Inlet). Straw wattles are not approved for curb inlet use.
- Contractor to field verify ponding water shall not create a traffic hazard.

Maintenance:

- Remove deposited sediment from excavated storage areas when available storage has been reduced by 20%.
- Remove deposited sediment from filter socks or similar when any accumulation of sediment is visible.
- Repair or replace as necessary to maintain function and integrity of installation.

On Grade Curb Inlet Protection

EARLY STAGE CURB INLET
(Open Box and Prior to Pouring Curb and Inlet Throat)

AMERICAN PUBLIC WORKS ASSOCIATION
APWA KANSAS CITY METRO CHAPTER
CURB INLET PROTECTION
STANDARD DRAWING NUMBER ESC-06
ADOPTED: 10/24/2016


Modified from 2015 Overland Park Standard Details for Erosion and Sediment Control.

A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date XX.XX.XXXX
drawn by DAE
checked by DAE
revisions

sheet number

C4.1
drawing type Prel/Permit
project number XXXXX

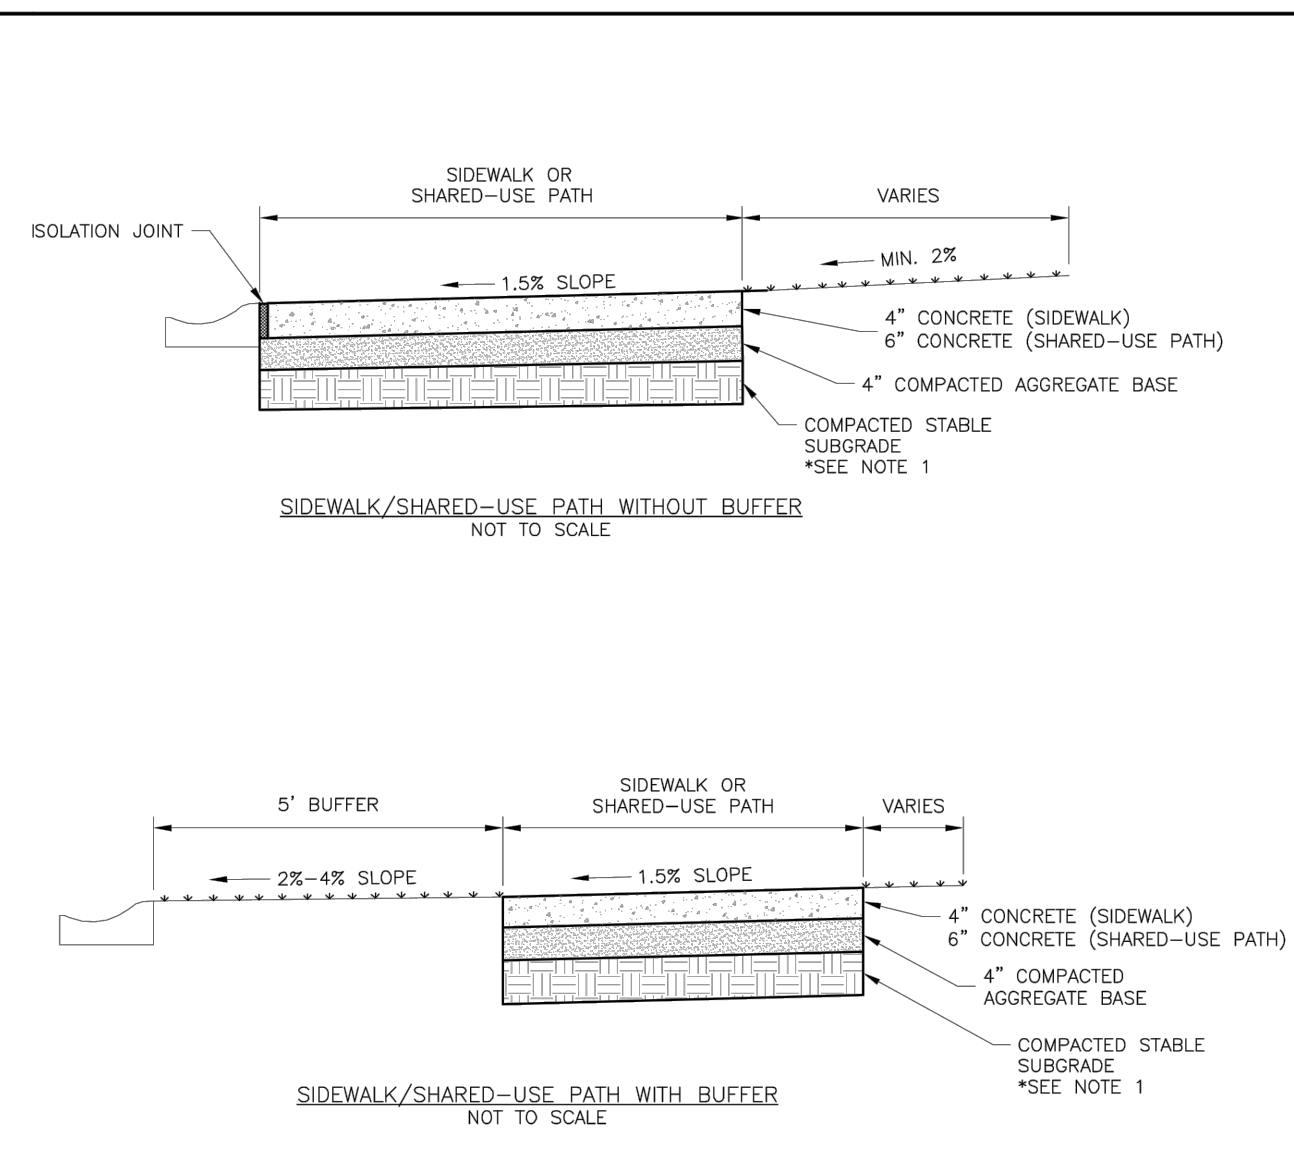


- GENERAL NOTES:**
- SUBGRADE MUST BE OF STABLE, COMPACTED EARTH AND SHALL BE OVERLAIN WITH 4\"/>

LEE'S SUMMIT MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64083

LS **GEN-2**

SIDEWALK/SHARED-USE PATH DETAIL

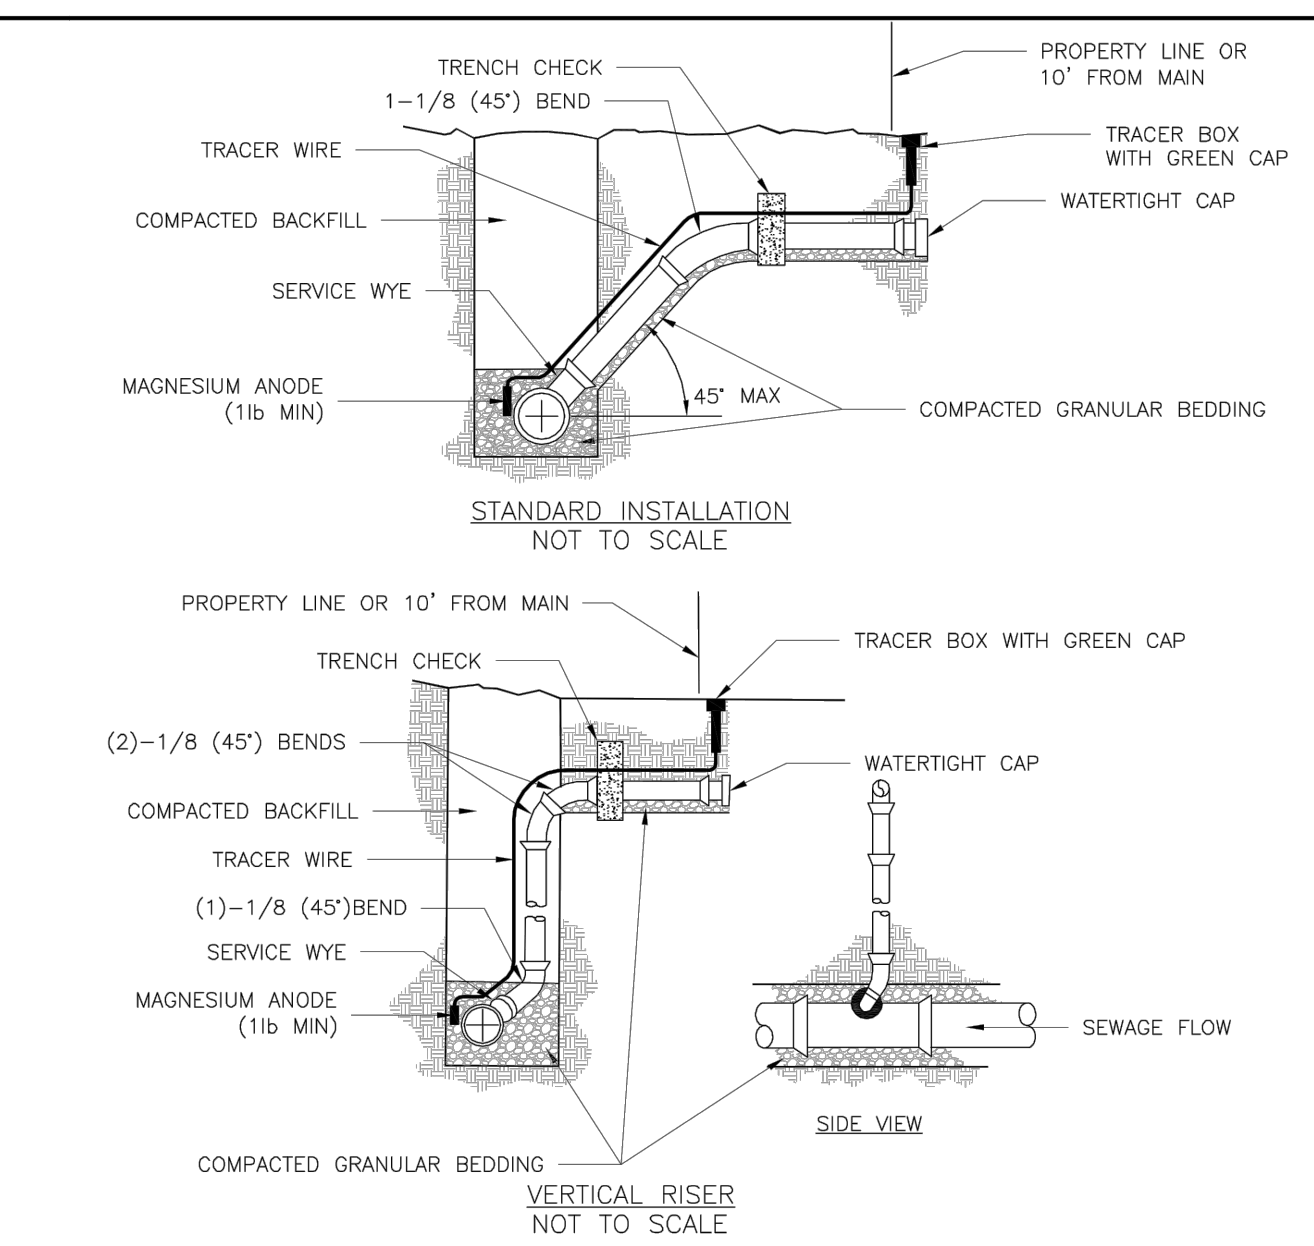


- NOTES:**
- ALL SEWER STUBS SHALL BE CONSTRUCTED TO PROPERTY LINE OR 10' MINIMUM FROM THE MAIN, WHERE SIDEWALKS ARE PRESENT, CONTRACTOR SHALL EXTEND SERVICE LINE UNDER EXISTING SIDEWALK TO TWO FEET BEYOND.
 - ALL NEW CONSTRUCTION OFF SEWER STUBS SHALL BE TEMPORARILY MARKED WITH A MARKING STAKE, 36\"/>

LEE'S SUMMIT MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64083

LS **SAN-1**

BUILDING SEWER STUB AND RISER

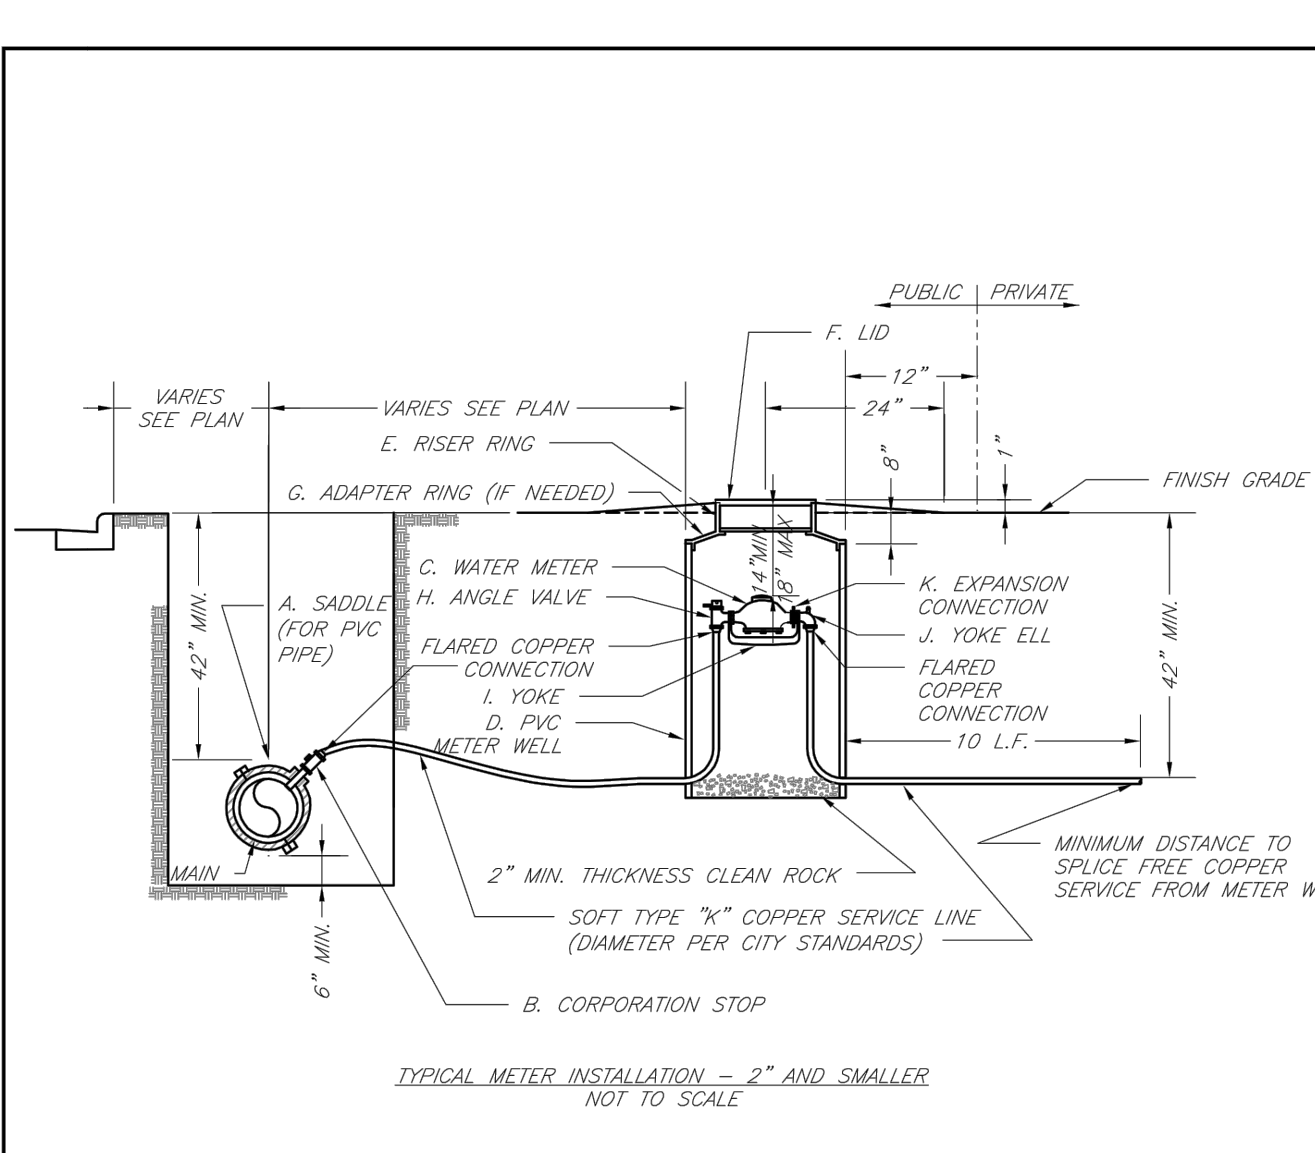


- NOTES:**
- METER INSTALLATION SHALL NOT BE LOCATED IN AREAS SUBJECT TO VEHICULAR TRAFFIC OR IN CONCRETE PAVEMENT WITHOUT CITY APPROVAL.
 - IF METER IS TO BE LOCATED OTHER THAN IN FRONT OF PROPERTY LINE, CITY APPROVAL SHALL BE OBTAINED.
 - CITY TO FURNISH ITEMS A-K.
 - NO OTHER EQUIPMENT SHALL BE INSTALLED IN THIS PIT.
 - 42\"/>

LEE'S SUMMIT MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64083

LS **REC-1**

SERVICE CONNECTION/METER WELL

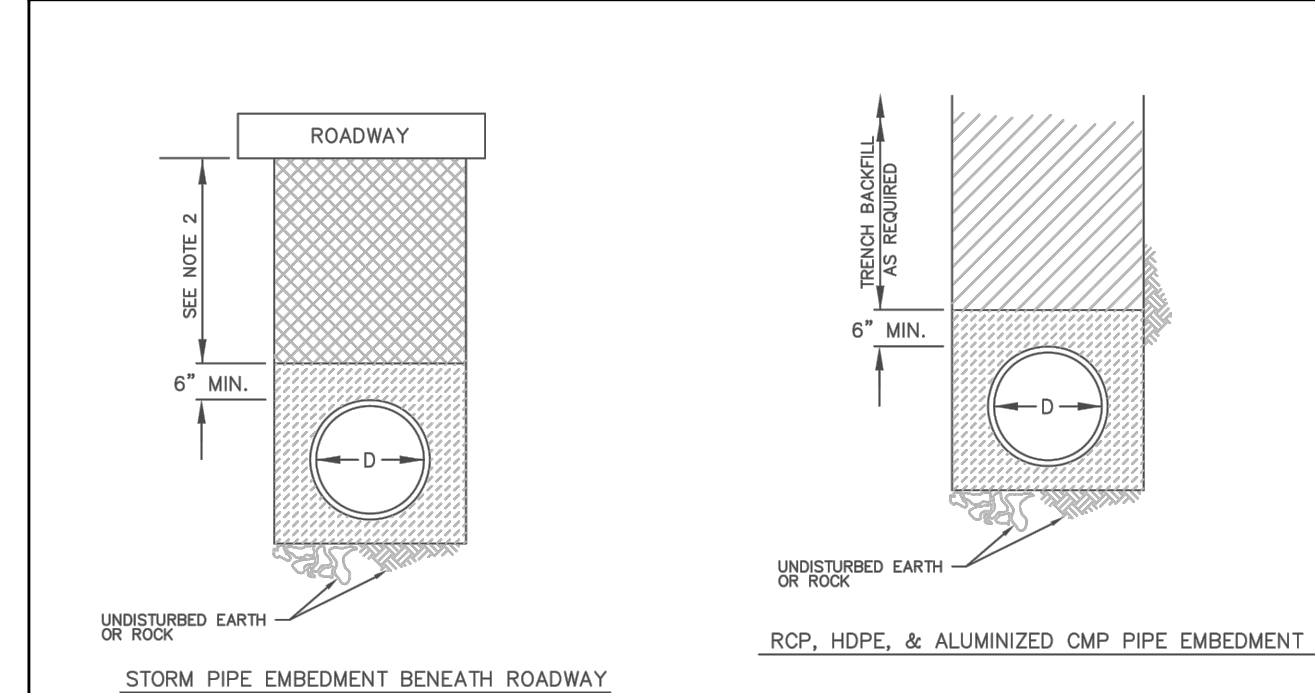


LEGEND			
D	NOMINAL PIPE DIAMETER	PIPE SIDE CLEARANCE ² (SOIL/ROCK)	PIPE BOTTOM CLEARANCE (SOIL/ROCK)
	TRENCH BACKFILL		
	TAMPED GRANULAR BACKFILL (AB-3)		
	GRANULAR BEDDING		

D	PIPE SIDE CLEARANCE ² (SOIL/ROCK)	PIPE BOTTOM CLEARANCE (SOIL/ROCK)
0\"/>		

- NOTES:**
- GRANULAR BEDDING SHALL BE 1/2\"/>

4 HDPE Pipe Embedment
not to scale

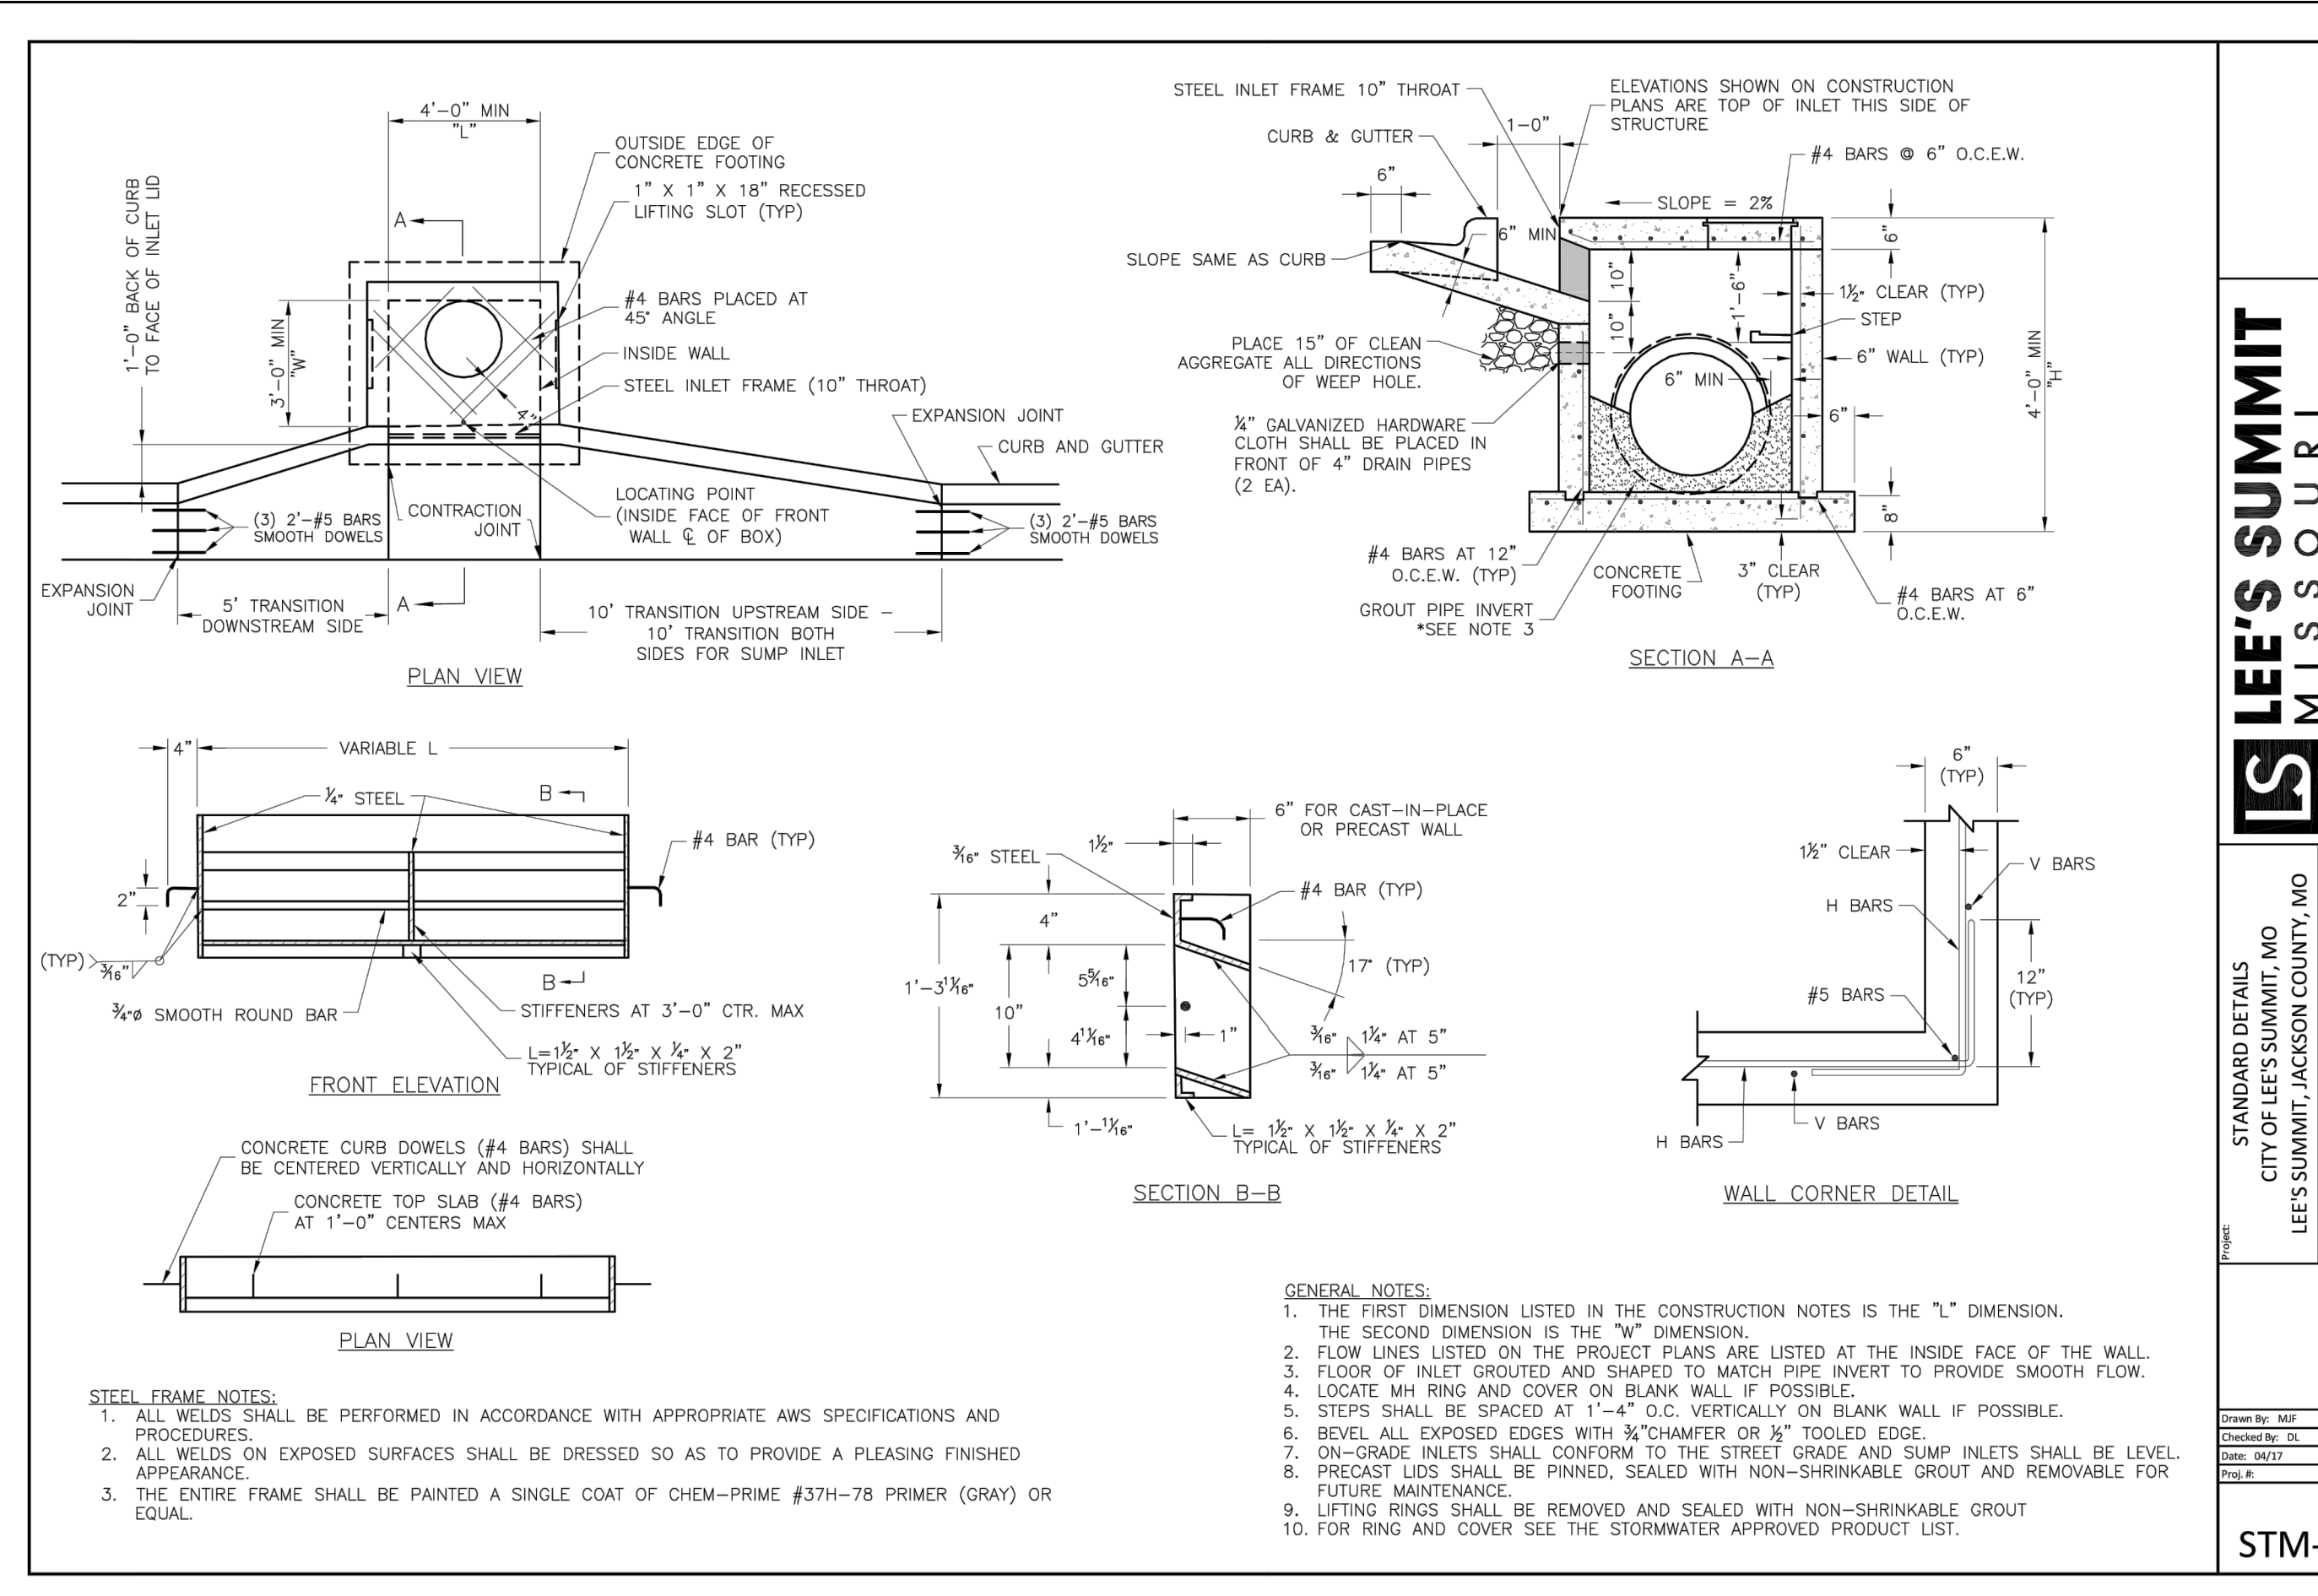


- GENERAL NOTES:**
- THE FIRST DIMENSION LISTED IN THE CONSTRUCTION NOTES IS THE "L" DIMENSION. THE SECOND DIMENSION IS THE "W" DIMENSION.
 - FLOW LINES LISTED ON THE PROJECT PLANS ARE LISTED AT THE INSIDE FACE OF THE WALL.
 - FLOOR OF INLET GROUDED AND SHAPED TO MATCH PIPE INVERT TO PROVIDE SMOOTH FLOW.
 - LOCATE MH RING AND COVER ON BLANK WALL IF POSSIBLE.
 - STEPS SHALL BE SPACED AT 1'-4\"/>

LEE'S SUMMIT MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64083

LS **STM-1**

CURB INLET DETAIL

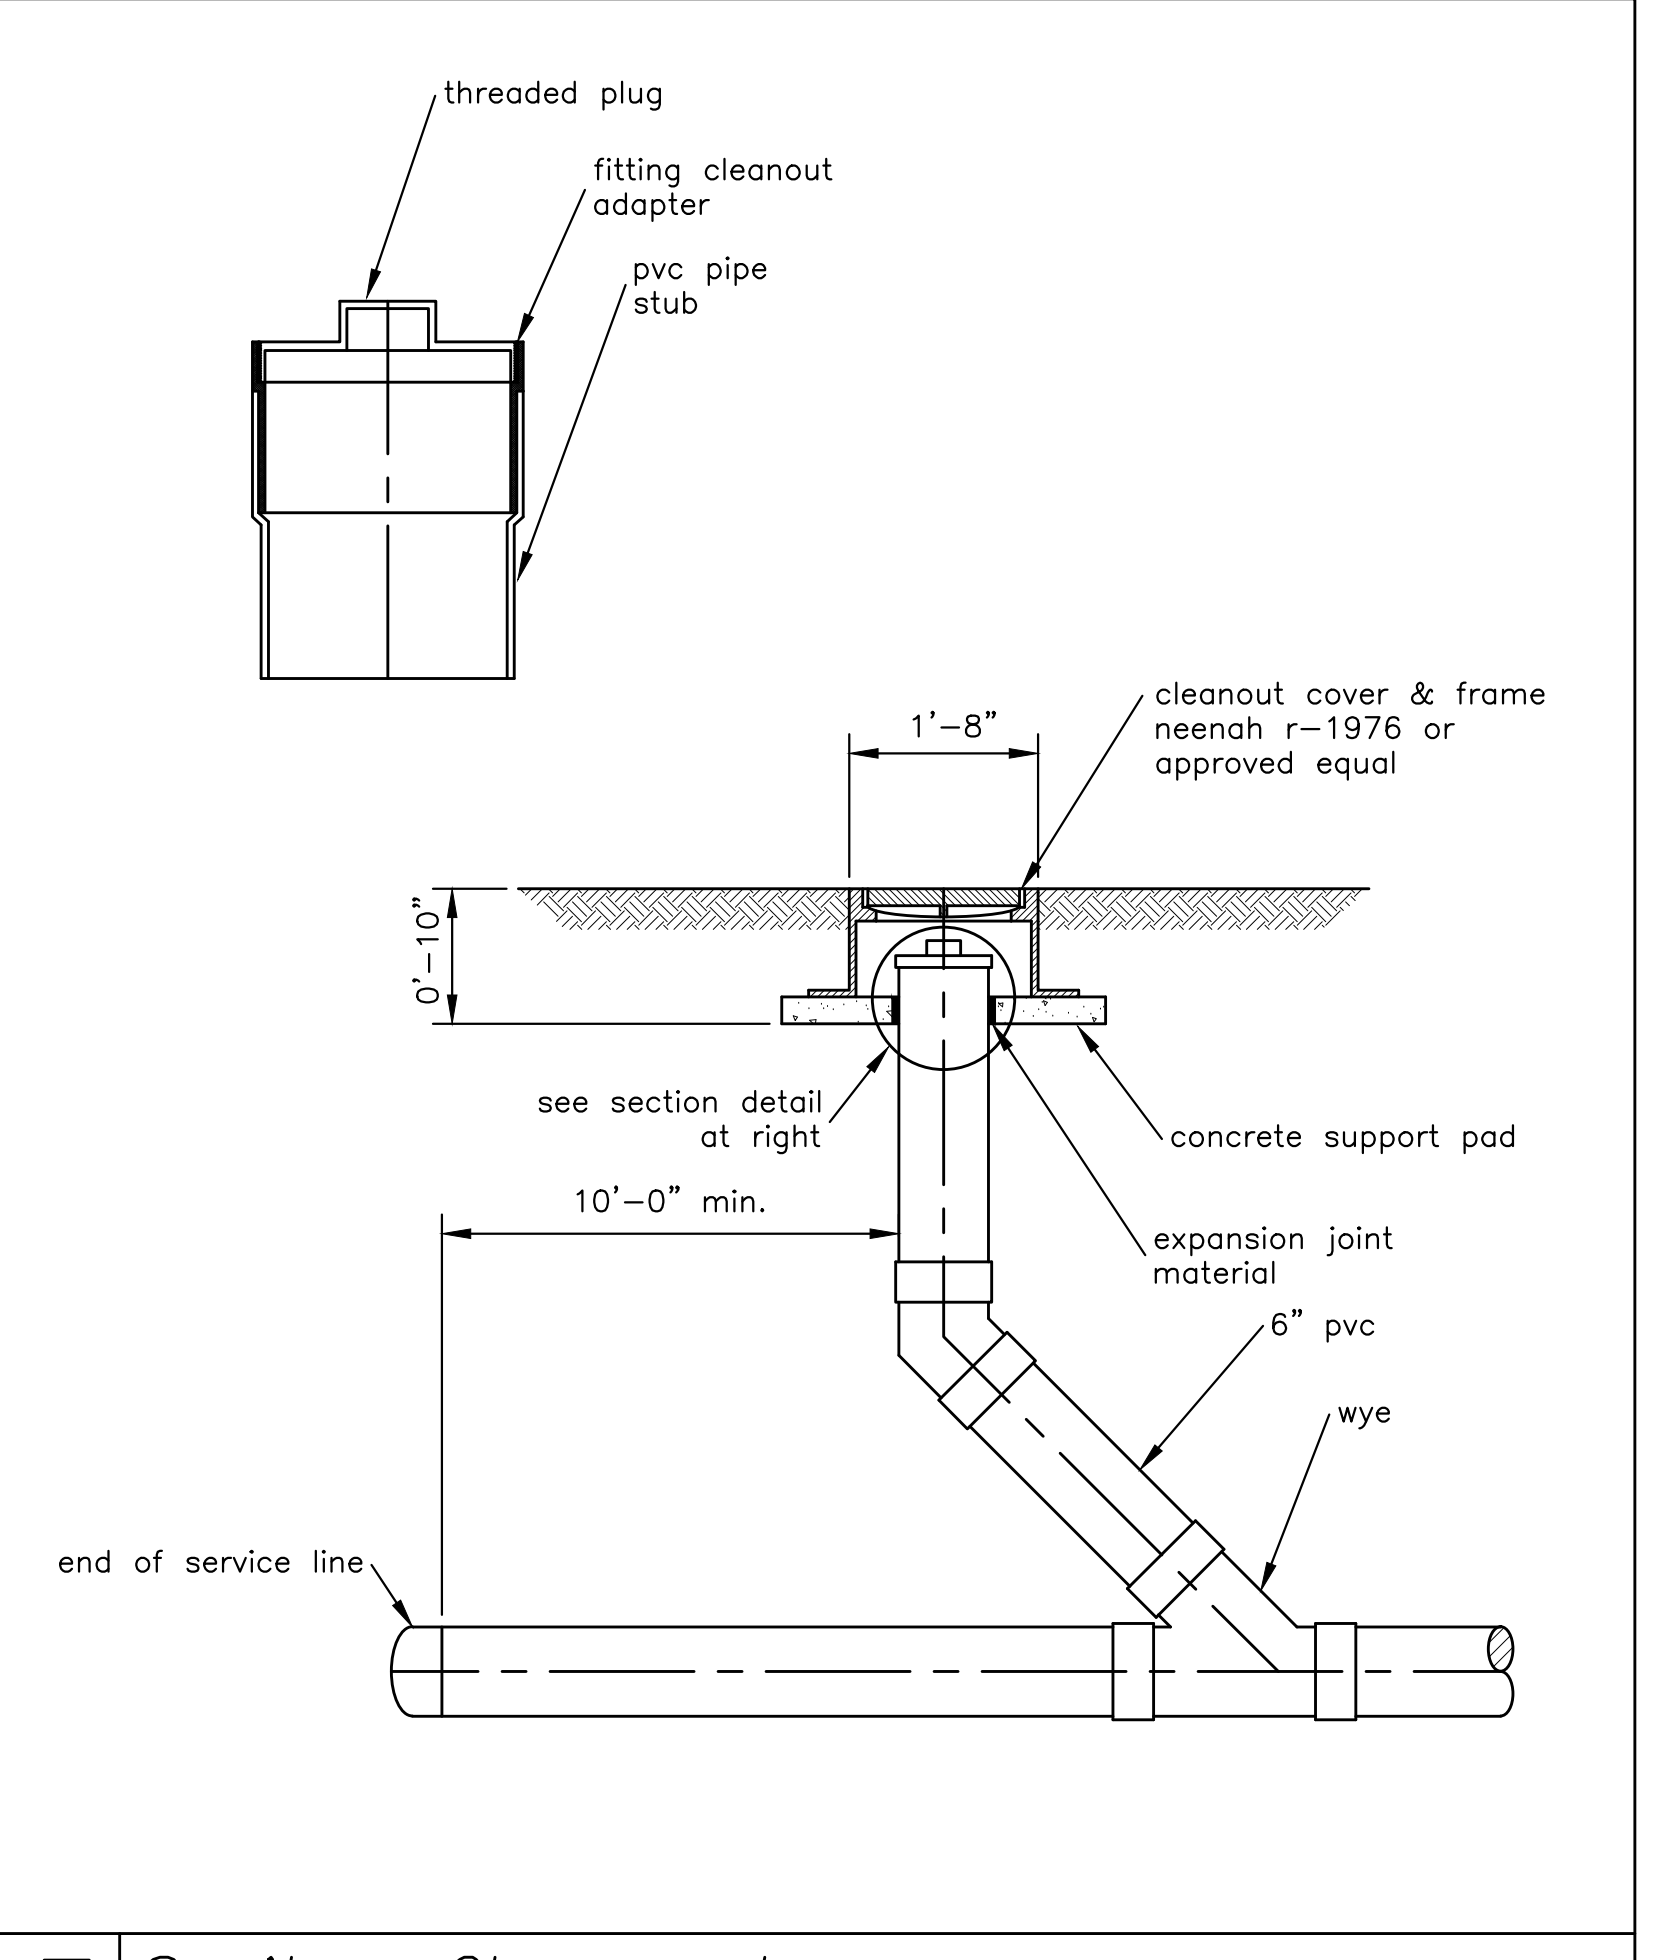

3 Sanitary Clean-out
not to scale

A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date
XX.XX.XXXX
drawn by
DAE
checked by
DAE
revisions





sheet number
C4.2
drawing type
Prel/Permit
project number
XXXXX




A Preliminary Concept for
Detail Center
Town Center Drive & Independence Avenue
Lee's Summit, Missouri

date
XX.XX.XXXX
drawn by
DAE
checked by
DAE
revisions

sheet number
C4.3
drawing type
Prel/Permit
project number
XXXXX

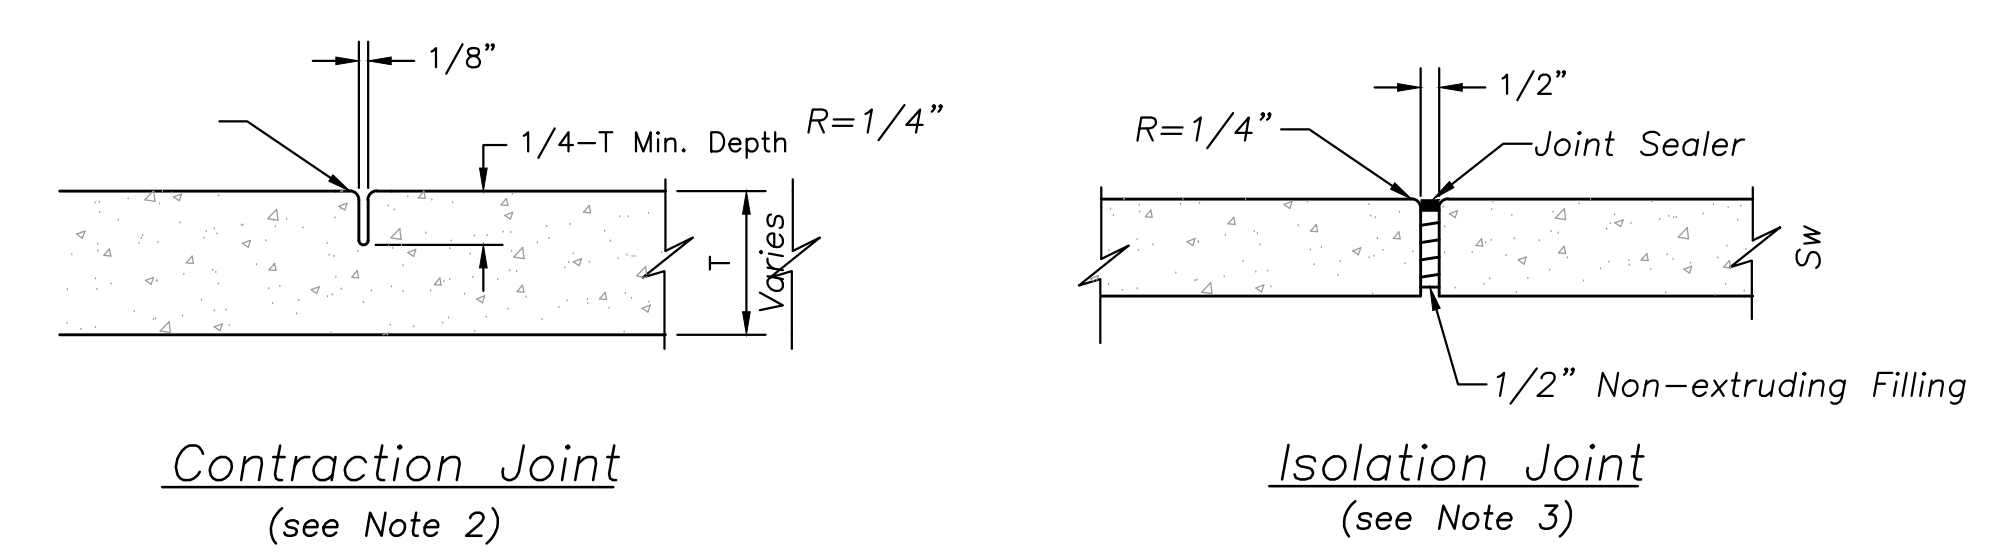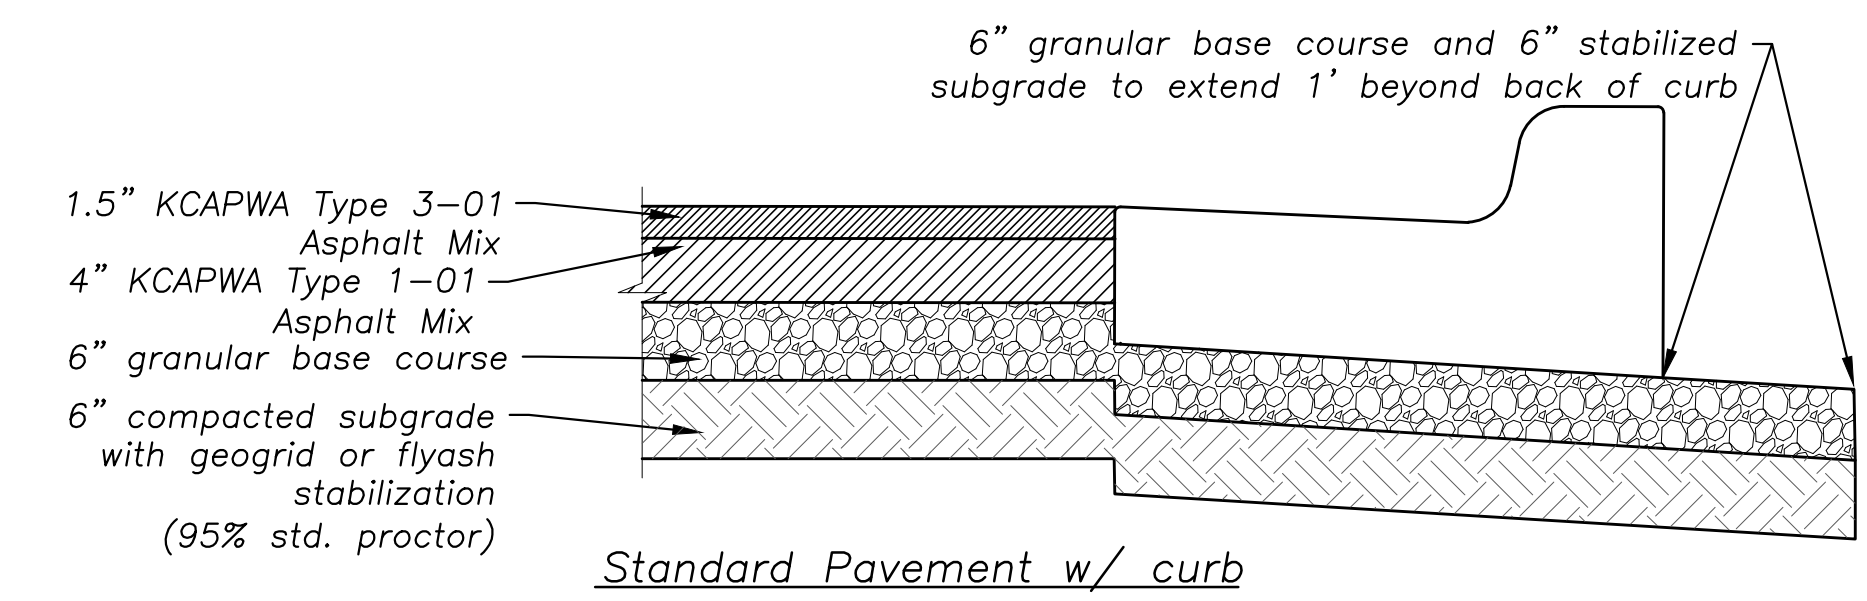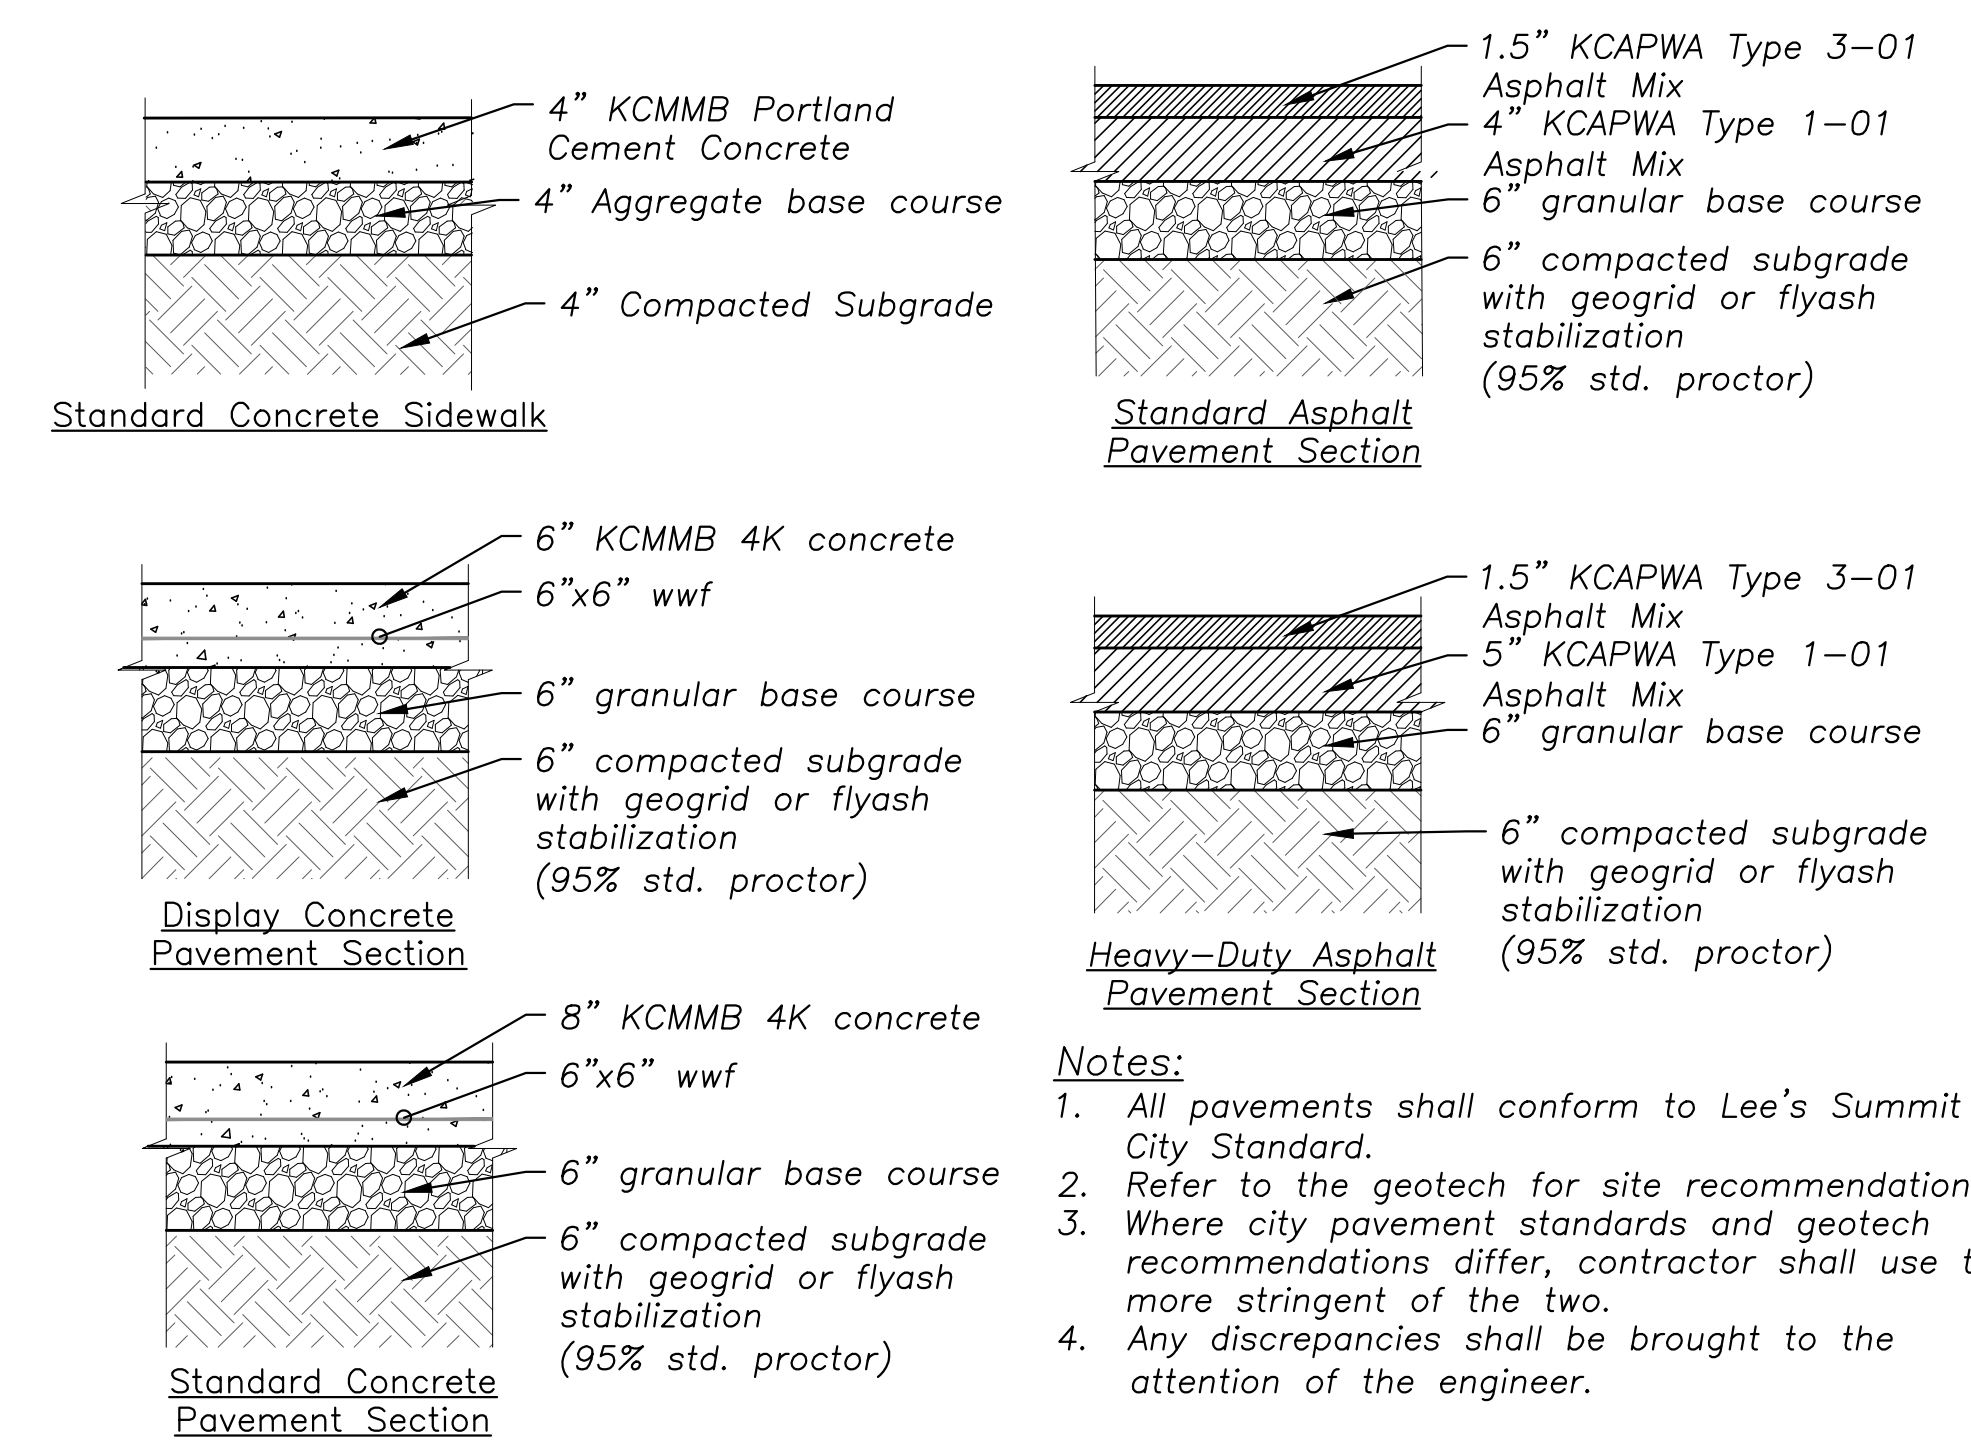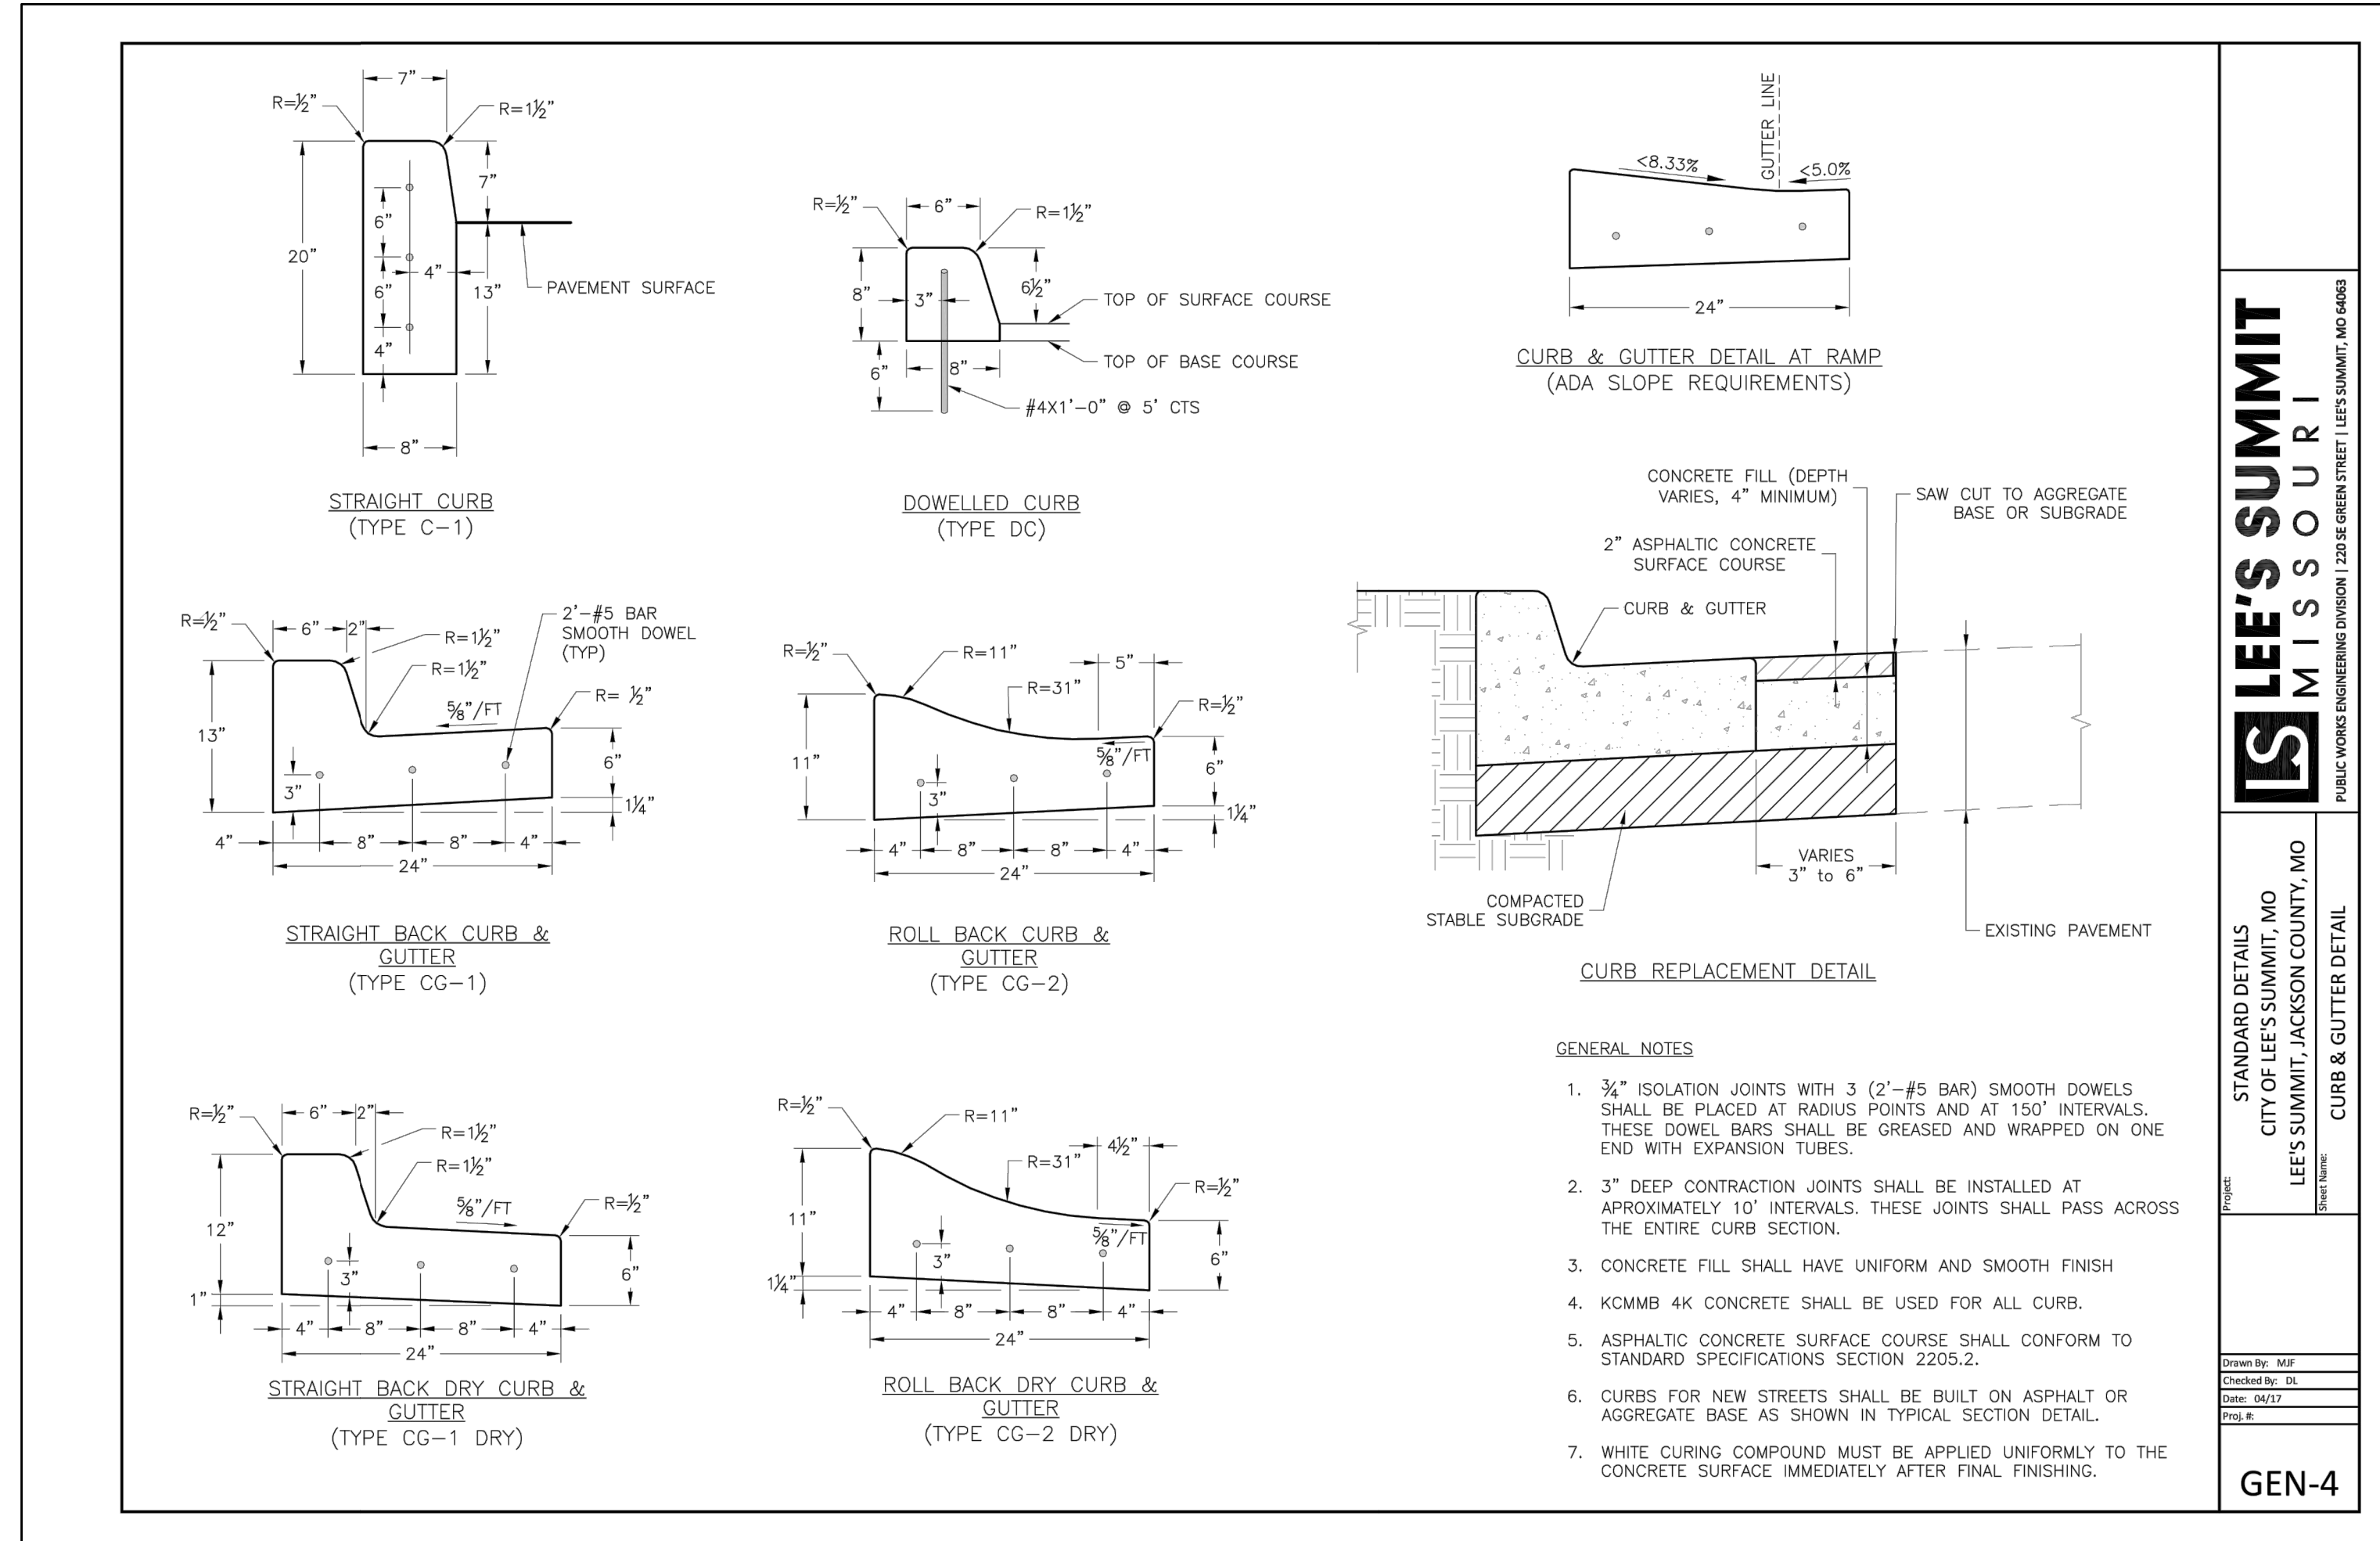

- Notes**
- Concrete shall be KCMMB-4K unless otherwise noted.
 - Key all construction joints or use tie bars #4 Epoxy coated @ 12" o.c.
 - Longitudinal joint spacing to match width of sidewalk.
 - Isolation joints shall be placed where walk abuts driveways and similar structures, and 250' centers max.
 - Install 18" tie bars #4 Epoxy coated @ 18" o.c.

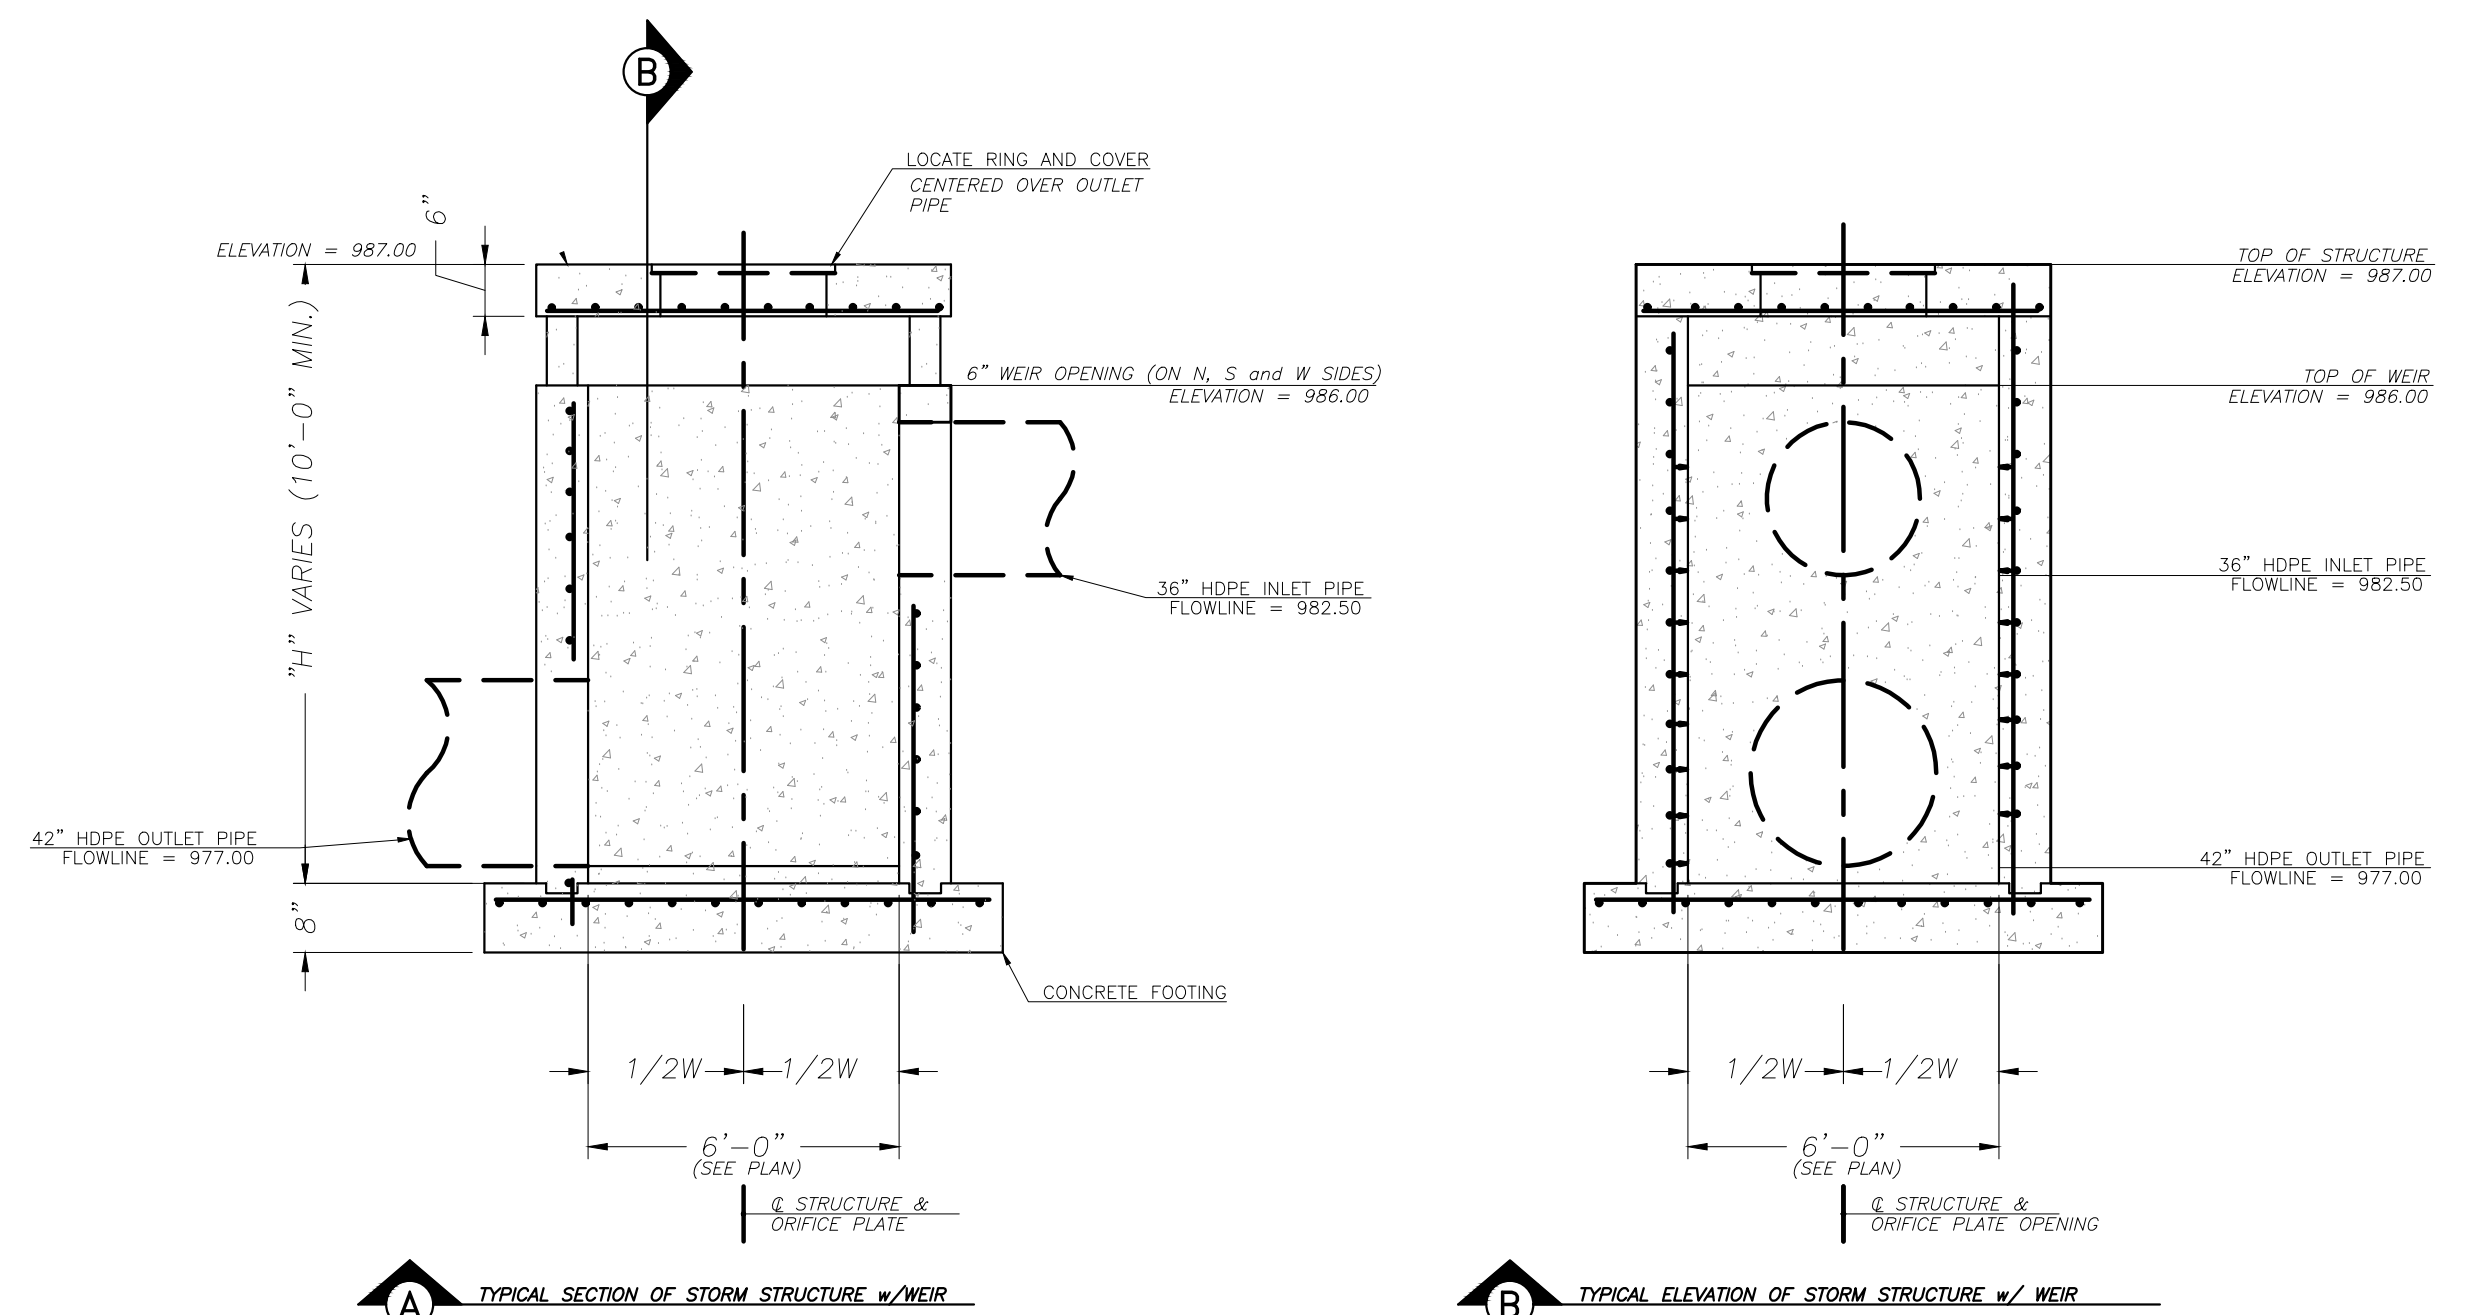

Detention Basin Discharge Structure
not to scale

Pavement Details
Not To Scale