



Mid-Continent Public Library East Lee's Summit Branch Final Stormwater Study

*BATTERY DRIVE AND
SOUTHEAST BLUE PARKWAY
LEE'S SUMMIT, MISSOURI*

January 25, 2019

Revised: February 26, 2020

Note: Report has been revised to meet As-Built
Conditions. Revisions are noted in red.

Prepared for:

Mid-Continent Public Libraries (MCPL)


Prepared by:

Olsson

7301 W. 133rd Street, Suite 200

Overland Park, KS 66213

TEL 913.381.1170

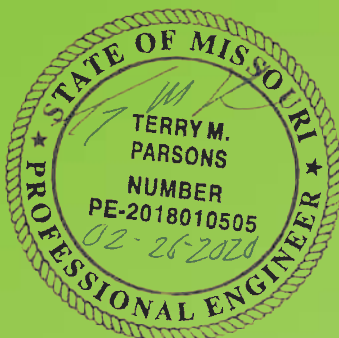

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

TABLES

Table 1 – Pre-Development Curve Number Analysis

Table 2 – Existing Peak Flows

Table 3 – Post-Development Curve Number Analysis

Table 4 – Proposed Peak Flows

Table 5 – Detention Basin, WSE's, and Peak Flows

Table 6 – Peak Flow Change Analysis

APPENDICES

Appendix A: Maps

Appendix B: FEMA Flood Classification Firms

Appendix C: Soil Map

Appendix D: Drainage and Detention Calculations

Appendix E: Water Treatment Calculations

Public Library – SE Blue Pkwy and Battery Dr
Stormwater Management Study

TABLE OF CONTENTS

GENERAL INFORMATION	1
PROJECT LOCATION AND DESCRIPTION	1
STUDY PURPOSE	1
SOILS DESCRIPTIONS	2
METHODOLOGY	2
GENERAL CRITERIA AND REFERENCES	2
HYDROLOGIC/HYDRAULIC ANALYSES	3
EXISTING CONDITIONS ANALYSIS	3
PROPOSED CONDITIONS ANALYSIS.....	4
STORMWATER DETENTION REQUIREMENTS.....	6
STORMWATER TREATMENT REQUIREMENTS	8
CLEAN WATER ACT SECTION 404 PERMITTING REQUIREMENTS	8
FEMA/DWR PERMIT REQUIREMENTS	8
CONCLUSIONS AND RECOMMENDATIONS	8

Public Library – SE Blue Pkwy and Battery Dr Stormwater Management Study

GENERAL INFORMATION

This Stormwater Management Study is being submitted on behalf of the Mid-Continent Public Library (MCPL) for the proposed library facility located at the northeast corner of SE Blue Parkway and Battery Drive.

Project Location and Description

The proposed site is located on Lot 2 of the Magnolia Place at Charleston Park, 1st Plat in the Northeast ¼ of Section 10, Township 47 North, Range 31 West, in Jackson County, Lee's Summit, Missouri and includes approximately 3.8 acres. The site is located at the northeast corner of the SE Blue Parkway and Battery Drive intersection and is generally bounded by Village Cooperative of Lee's Summit to the north, SE Battery Dr to the west, SE Blue Parkway to the south, and an undeveloped lot to the east (See Figure 2). The Church of Jesus Christ of Latter-Day Saints lies east of the undeveloped lot. The proposed development includes a 18,500 S.F. library facility with associated parking lots, landscaping, grading, and utilities. The entirety of the site is located outside of the 100-Year FEMA Floodplain.

Study Purpose

The purpose of this study is to provide a Stormwater Management Plan for the proposed development in accordance with the American Public Works Association (APWA) *Standard Specifications and Design Criteria* Section 5600 "Storm Drainage Systems and Facilities", APWA Manual of Best Management Practices (BMP) for Stormwater Quality, and applicable City of Lee's Summit, Missouri guidelines.

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

Soils Descriptions

Soil classifications were obtained from the Natural Resource Conservation Service's website by utilizing the Web Soil Survey feature. The site soil composition and classification are listed below:

10082 – Arisburg-Urban Land Complex, 1 to 5 percent slopes – HSG Type C.

10180 – Udarents-Urban Land-Sampsel Complex, 2 to 5 percent slopes - HSG Type C.

*HSG – Hydrologic Soils Group

See Soils Map in Appendix B.

METHODOLOGY

General Criteria and References

Analytical and design criteria conform to those of Division V - *Section 5600 – “Storm Drainage Systems and Facilities”* of the Kansas City Metropolitan Chapter of the American Public Works Association's *“Standard Specifications and Design Criteria”*. Based on these criteria, Post-development discharge rates for 2, 10, and 100-year storm events will be limited to provisions in section 5608.4-C1 *Performance Criteria – “Comprehensive Control”*. Post-development discharge rates are limited to 0.5 cfs per acre for the 2-Year event, 2.0 cfs per acre for the 10-year event, and 3.0 cfs per acre for 100-year storm event. Pre and post-development flows from the site are shown below and were calculated using HEC-HMS for the 2, 10 and 100-year storm events. Existing and proposed hydrographs were calculated using the 24-hour SCS Type II rainfall distribution. Given the size of the site, all times of concentration were set a minimum of 5 minutes, the defined minimum per Section 5600.

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

HYDROLOGIC/HYDRAULIC ANALYSES

Existing Conditions Analysis

The existing site is an undeveloped parcel of land that consist of native vegetation. The site is bounded by SE Battery Drive to the west, The Village Cooperative Apartments to the north, undeveloped property to the east, and SE Blue Parkway to the South. Currently, Blue Parkway lies within MoDOT's US-50 right of way.

The existing drainage for the site is split by a ridge into two outfalls, "A" and "B". The east section drains to outfall "A" and the west section drains to outfall "B". Outfall "A" drains northwest over the curb into the gutter. The gutter drains to an existing public curb inlet on Battery Drive. Outfall "B" drains overland to the northeast. This area drains over the back of the curb to an existing storm structure in the parking lot of the Village Cooperative Apartments.

South of the property there is an existing ditch that lies within US-50 right of way. The ditch drains run-off from Blue Parkway. There is no curb and gutter on Blue Parkway, just a graveled shoulder that allows run-off to drain into the existing ditch. There is an existing 18x24 arch culvert that drains to the ditch from under Battery Drive flows east along the north side of Blue Parkway.

As stated previously, there is an undeveloped lot to the east of the property that is owned by Richard D. Link. Mr. Link is also the person who sold Lot 2, Magnolia place to MCPL. The proposed development did not require all of the property for Lot 2. The east 81' of the property was excluded from the sale and remains the property of Richard D. Link. The proposed drive from the south will be a common access drive that will serve both the MCPL property and the future developed lot to the east. The east half of this drive will be constructed on the undeveloped lot under a mutual understanding with Mr. Link.

This property generally drains to the east to an existing swale away from the library property. None of this area drains to the proposed collection system for the library.

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

For the purposes of the drainage calculations moving forward this area will be included, therefore the studied area will increase from 3.8 acres to 4.5 acres.

A composite curve number was generated for the site by referencing the Web Soil Survey available in Appendix C, APWA Section 5600 and considered the following factors:

- Existing impervious area
- Existing pervious area
- Hydrologic soil group

The following tables summarize the pre-development composite curve number generation.

Table 1: Pre-Development Curve Number Analysis

Sub-Area	Area (AC)	Soil Group	Curve Number
Pasture (Good)	3.0	C	74
Pasture (Good)	1.5	C	74

The existing peak discharge rates for the 2-year, 10-year, and 100-year storm events from the site are shown in Table 2 below:

Table 2: Existing Peak Flows

Sub-Area / Outfall	Area (acres)	Q (2-Year Storm) (cfs)	Q (10-Year Storm) (cfs)	Q (100-Year Storm) (cfs)
A	3	4.8	7.4	12.8
B	1.5	2.4	3.6	6.4

Proposed Conditions Analysis

The proposed Public Library will include a 18,500 SF library with associated parking lots, landscaping, grading, and utilities. A site plan has been included in Appendix A. The site will generally continue to drain in the same pattern as existing. Drainage from the site will

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

enter into an enclosed storm sewer system that will be constructed with the development. The proposed system will collect drainage from the parking area and building. The increase in impervious area will increase runoff from the site. To mitigate the increase in runoff, the following strategy will be implemented.

The site will be graded so that Drainage Areas A & B, noted in the Existing Conditions, will drain north and directed into a detention basin. A proposed drainage map is included in Appendix A.

A post-development composite curve number was generated using the same methodology implemented during the pre-development curve number analysis. Table 3 below summarizes the post-development composite curve number generation.

Table 3: Post-Development Curve Number Analysis

Sub-Area	Area (AC)	Soil Group	Curve Number
Pavement, Buildings, Impervious	2.0	C	98
Turf (Good)	2.5	C	85

A peak flow analysis of the post-development site was conducted using HEC-HMS, the composite curve number, and rainfall and distribution information acquired from APWA section 5600. Post-development peak to the outfall are summarized in the Table 4. Detailed reports from HEC-HMS are available in Appendix D

Table 4: Proposed Peak Flows

Sub-Area / Outfall	Tributary Area (acres)	Q (2-Year Storm) (cfs)	Q (10-Year Storm) (cfs)	Q (100-Year Storm) (cfs)
Detention Basin	4.5	13.7	21.1	33.4

The existing ditch to the south will remain essentially unchanged. The drainage area, for the ditch, lies within the existing right of way. An embankment will need to be constructed across the ditch for the southern entrance. A culvert will be installed under the entrance to

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

maintain flow in the ditch. The 30" culvert will receive the flow from the existing 18x24 (24" equivalent) local drainage from Blue Parkway.

Stormwater Detention Requirements

One proposed detention pond will be utilized to mitigate the increase in flow due to an increase in impervious area. The Detention Basin will be located on the northern part of the property. It will collect runoff from the 4.5-acre property. The pond has an outlet pipe that connects to an orifice plate within a junction box structure that will be within the dam.

The outlet for the detention basin will be a flared end section with a trash rack connected by a 15" pipe to a control structure. The control structure will have an internal control plate. The control plate will have a series of 6 - 1" holes arranged in a single vertical row beginning at Elevation 1006.5. There will be a 2 stage cuts into the control plate.

The series of 1" vertical holes are designed for the water treatment requirements. the water quality volume (WQv) will be controlled by the vertical holes at the bottom of the plate. The 1" holes will release the water quality volume over a 40-hour period to allow pollutants to settle out of this precipitation event.

The weir will be located above the WQv surface elevation and will control the release of the 2, 10 and 100-year storm events. A 1'-0" wide weir (ie 1008.4) weir located at control plate will control the 2-year flow. A 2'-2" weir (I.E. 1009.00) will control the 10-year flow. There will be a 24" inlet pipe into the control structure that will ultimately control the 100-year flow. Finally, an 18" outlet pipe will be connect to an existing city storm structure that will route the flow into the public storm system These storms have been analyzed through the control structure and will release below the pre-existing storm events and below the Comprehensive Control release rates defined in APWA section 5600. A Storage-Discharge Table has been provided in Appendix D that details the flows through the outlet structure. The dam will have an emergency spillway to control the 100-year overflow should the outlet become blocked.

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

Table 5 provides the water surface elevations (WSE's) and peak flows for the proposed detention basin.

Table 5: Detention Basin, WSE's and Peak Flows

Description	Statistics
Bottom of Basin	1006.70
Total Storage Volume	1.2 ac-ft
Emergency Spillway (IE, 100-Yr WSE)	1011.12, 1011.75
Top of Dam Elevation	1012.20
WQv Perf. Plate (IE Elevation, Perf and Spacing)	1005.28, 1-3/8" Vertical Holes 4" C to C (6 - Holes)
Water Quality Volume WSE, Storage, Peak Outflow	1008.60 , 0.3 ac-ft, 0.6 cfs
2 nd Stage Weirs (IE, Width)	1008.60 , 1.00 ft 1009.20 , 2.17 ft
10-Year Storm WSE, Storage, Peak Outflow	1009.63 , 0.41 ac-ft, 5.2 cfs
100-Year Storm WSE, Storage, Peak Outflow	1010.55 , 0.63 ac-ft, 13.4 cfs

Table 6 shows the overall peak flows for the site for both pre and post-construction. In addition, it also shows the allowable Comprehensive control release rate. Note that peak flow for post-construction has been lowered in all storm events.

Table 6: Peak Flow Change Analysis

Site	Q (2-Year Storm) (cfs)	Q (10-Year Storm) (cfs)	Q (100-Year Storm) (cfs)
Pre-Construction	7.2	11	19.2
Section 5600 Allowable Comprehensive Release Rate	2.3 (0.5 cfs per acre)	9 (2.0 cfs per acre)	13.5 (3.0 cfs per acre)
Post Construction	2.2	5.2	13.4
Post Const Less Than Allowable	Yes	Yes	Yes

Public Library – SE Blue Pkwy and Battery Dr

Stormwater Management Study

STORMWATER TREATMENT REQUIREMENTS

As stated previously, the proposed detention is designed to act an extended dry bottom detention facility will be used to treat stormwater per MARC water quality standards. The orifice plate for the basin will be sized to release the water quality volume (1.37") over a 40-hour period to allow pollutants to settle from runoff before entering the public stormwater system. The maximum storage for the water quality event in the basin will be 0.3 acre-ft reaching a peak water surface of elevation 1008.40 feet.

CLEAN WATER ACT SECTION 404 PERMITTING REQUIREMENTS

No jurisdictional Waters of the United States have been identified on the study site. Therefore, a Section 404 permit is not required.

FEMA/DWR PERMIT REQUIREMENTS

No FEMA permitting or submittals will be required on this site because there are no FEMA delineated floodplains on the site. A copy of the FIRM map for this area has been included in Appendix B.

CONCLUSIONS AND RECOMMENDATIONS

As outlined in the preceding report, increased runoff rates in the post-development conditions are mitigated by the detention basins. Drainage patterns on the site remain relatively unchanged. An extended dry detention basin has been designed to maintain or improve storm water quality. Based on these facts and other information provided herein, we request that this stormwater study be approved.


Appendix A

Map Exhibits

MCPL - EAST LEE'S SUMMIT BRANCH
APPENDIX A - EXISTING CONDITIONS




DWG: F:\2018\0001-0500\018-0330-B\40-Design\AutoCAD\Final Plans\Sheets\GNC\WORK PACKAGE 4\LEES SUMMIT\C_DRN_80330.dwg USER: tparsons
DATE: Feb 26, 2020 5:06pm XREFS: C_4LS.TBLK_80330 C_PBASE_80330 C_PSURF_80330 C_XBASE_80330 V_XBOL_80330 L_PBASE_61023

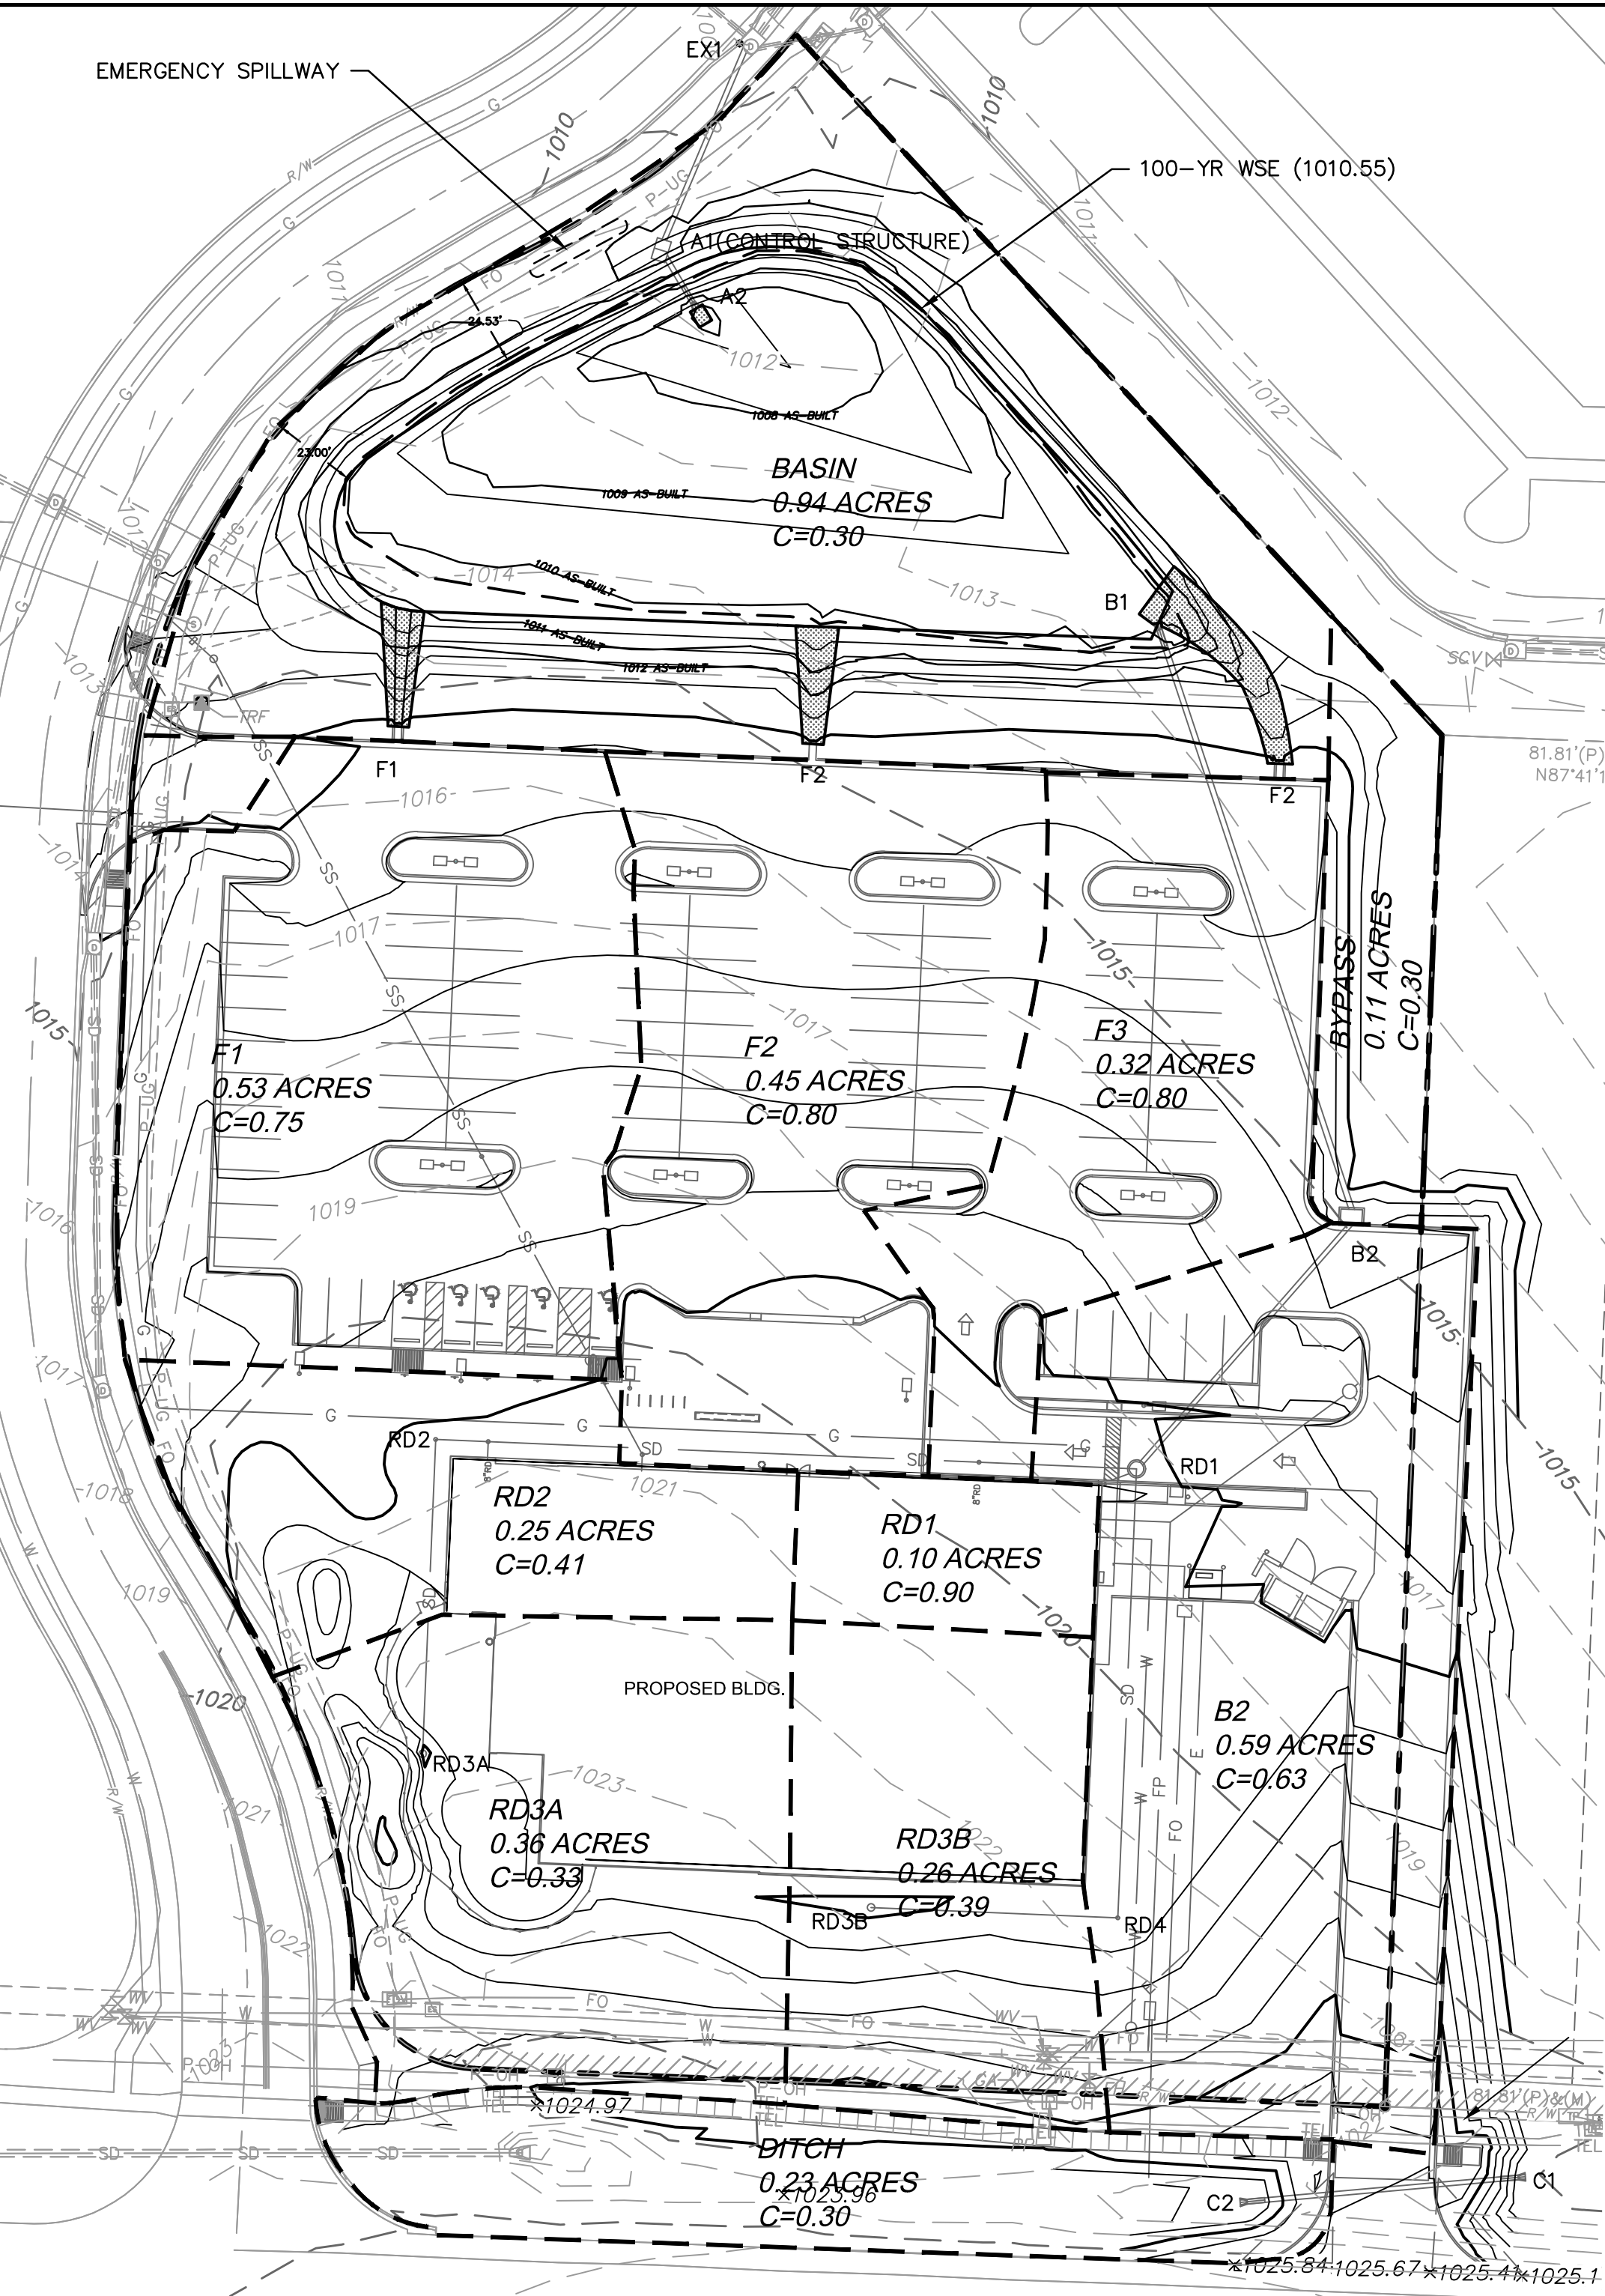



DRAINAGE PLAN

STORM SEWER PIPE AND STRUCTURE TABLE																			
DESIGN CONDITIONS: 10 YEAR STORM EVENT																			
STRUCTURES		RUNOFF CALCULATIONS																	
FROM	TO	DIRECT AREA (ACRES)	TOTAL AREA (ACRES)	C	KC (K=1.0)	Ts (MIN)	Q (CFS)	DESIGN Q (CFS)	DESCRIPTION	PIPE LENGTH (L.F.)	PIPE SLOPE (%)	PIPE DIA (IN)	Q FULL (CFS)	PIPE AREA (SQ.FT)	V FULL (F/SEC)	DESIGN V (F/SEC)	HWD	MM+1 ELEVATION	UPSTREAM FLOWLINE
RD3A	RD2	0.36	0.33	0.33	0.33	5.0	1.35	0.87	ADS BASINS/ROOF DRAINS	88.00	1.00	8	1.21	0.35	3.47	3.80	1.04	1016.70	1016.62
RD2	RD1	0.25	0.36	0.33	0.33	5.0	1.35	0.87	ADS BASINS/ROOF DRAINS	163.00	1.00	10	2.20	0.55	4.03	4.53	1.24	1015.82	1015.80
RD1	B2	0.10	0.61	0.42	0.42	5.0	1.35	0.87	10 in. HOPE JUNCTION BOX	62.14	4.00	15	12.96	1.23	10.98	0.15	0.97	1015.72	1015.02
B2	B1	0.59	0.97	0.63	0.63	5.0	1.35	2.73	15 in. HOPE CURB INLET	173.65	1.00	18	10.53	1.77	5.98	6.50	1.17	1017.66	1017.72
RD3B	RD4	0.26	0.36	0.33	0.33	5.0	1.35	0.87	ADS BASINS/ROOF DRAINS	67.00	1.00	8	1.21	0.35	3.47	3.84	0.94	1016.70	1016.01
RD4	RD1	0.00	0.36	0.33	0.33	5.0	1.35	0.87	ADS BASINS/ROOF DRAINS	125.00	1.00	8	1.21	0.35	3.47	3.84	0.94	1016.01	1014.76
F1	BAS	0.53	0.53	0.75	0.75	5.0	1.35	2.92	FLUME										
F2	BAS	0.45	0.45	0.80	0.80	5.0	1.35	2.85	FLUME										
F3	BAS	0.32	0.32	0.80	0.80	5.0	1.35	1.88	FLUME										

STORM SEWER PIPE AND STRUCTURE TABLE																			
DESIGN CONDITIONS: 100 YEAR STORM EVENT																			
STRUCTURES		RUNOFF CALCULATIONS																	
FROM	TO	DIRECT AREA (ACRES)	TOTAL AREA (ACRES)	C	KC (K=1.25)	Ts (MIN)	Q (CFS)	DESIGN Q (CFS)	DESCRIPTION	PIPE LENGTH (L.F.)	PIPE SLOPE (%)	PIPE DIA (IN)	Q FULL (CFS)	PIPE AREA (SQ.FT)	V FULL (F/SEC)	DESIGN V (F/SEC)	HWD	MM+1 ELEVATION	UPSTREAM FLOWLINE
RD3A	RD2	0.36	0.33	0.33	0.41	5.0	1.35	1.06	ADS BASINS/ROOF DRAINS	88.00	1.00	8	1.21	0.35	3.47	3.94	1.25	1016.70	1015.62
RD2	RD1	0.25	0.36	0.33	0.51	5.0	1.35	0.94	ADS BASINS/ROOF DRAINS	163.00	1.00	12	3.67	0.79	4.55	4.86	1.03	1015.82	1013.89
RD1	B2	0.10	0.61	0.42	0.53	5.0	1.35	2.35	12 in. HOPE JUNCTION BOX	62.14	4.00	15	12.96	1.23	10.98	0.72	1.14	1015.72	1012.02
B2	B1	0.59	0.97	0.63	0.79	5.0	1.35	3.41	15 in. HOPE CURB INLET	173.65	1.00	18	10.53	1.77	5.98	6.74	1.45	1017.66	1016.08
RD3B	RD4	0.26	0.36	0.33	0.48	5.0	1.35	0.93	ADS BASINS/ROOF DRAINS	67.00	1.00	8	1.21	0.35	3.47	3.84	1.10	1016.70	1016.01
RD4	RD1	0.00	0.36	0.33	0.48	5.0	1.35	0.93	ADS BASINS/ROOF DRAINS	125.00	1.00	8	1.21	0.35	3.47	3.84	1.10	1016.01	1014.76
F1	BAS	0.53	0.53	0.75	0.94	5.0	1.35	3.65	FLUME										
F2	BAS	0.45	0.45	0.80	1.00	5.0	1.35	3.31	FLUME										
F3	BAS	0.32	0.32	0.80	1.00	5.0	1.35	2.35	FLUME										

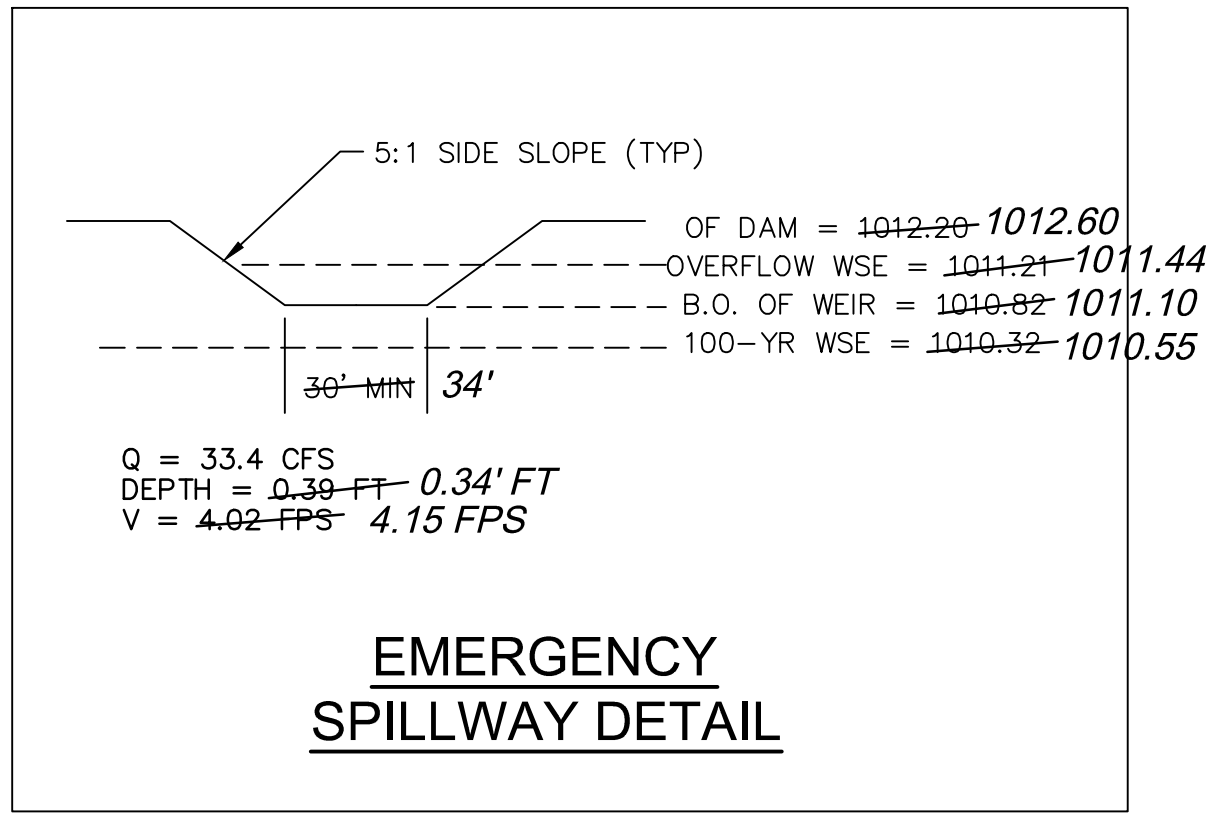


EMERGENCY SPILLWAY DETAIL

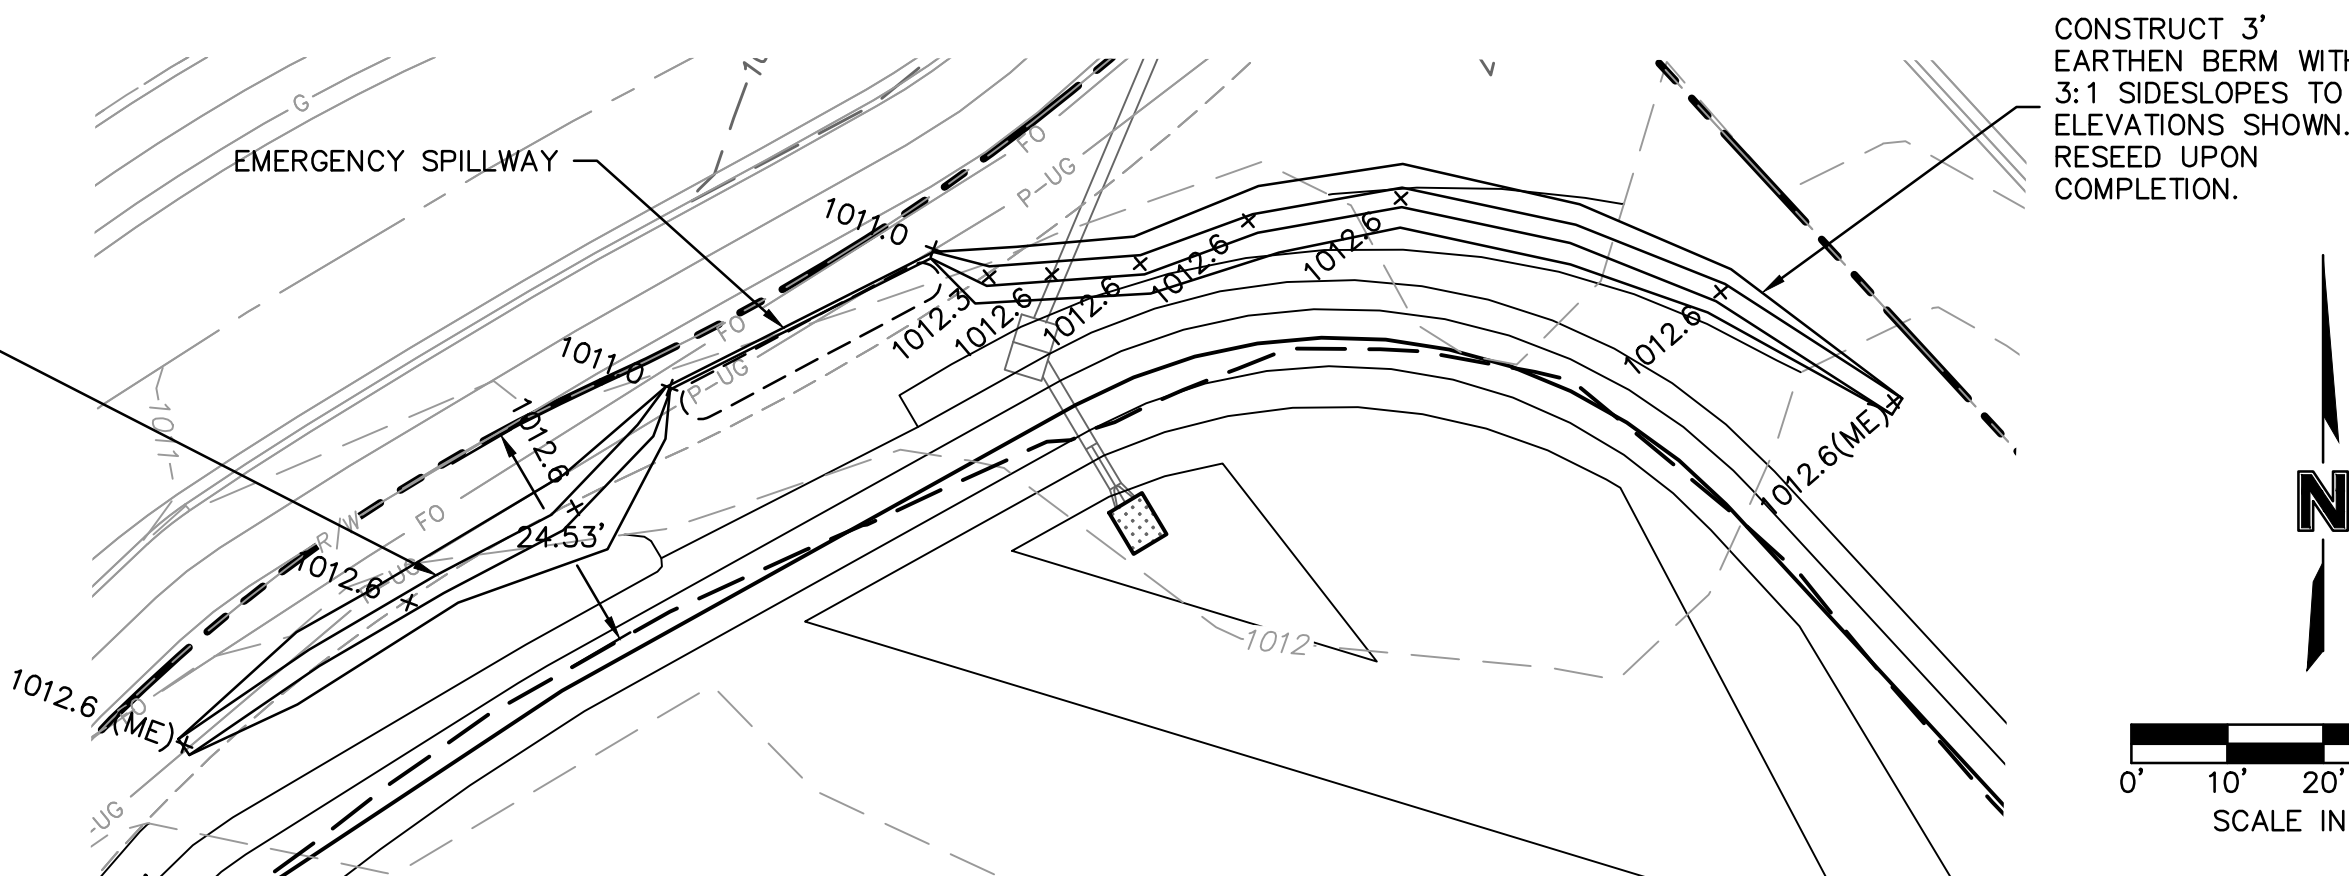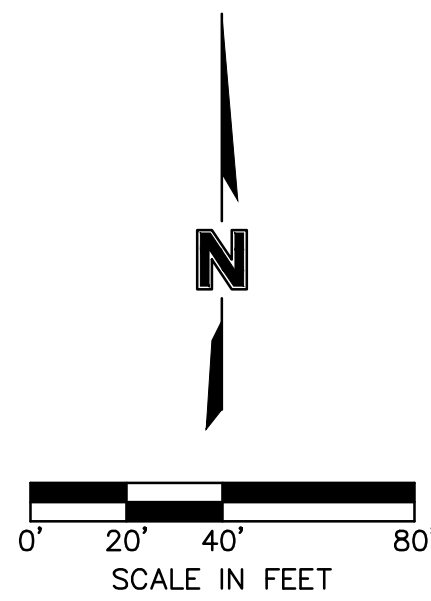

EMERGENCY SPILLWAY & BERM DETAIL PER AS-BUILT CONDITONS

MCPL EAST LEES SUMMIT BRANCH
STAGE STORAGE CURVE
DESIGN VS AS-BUILT

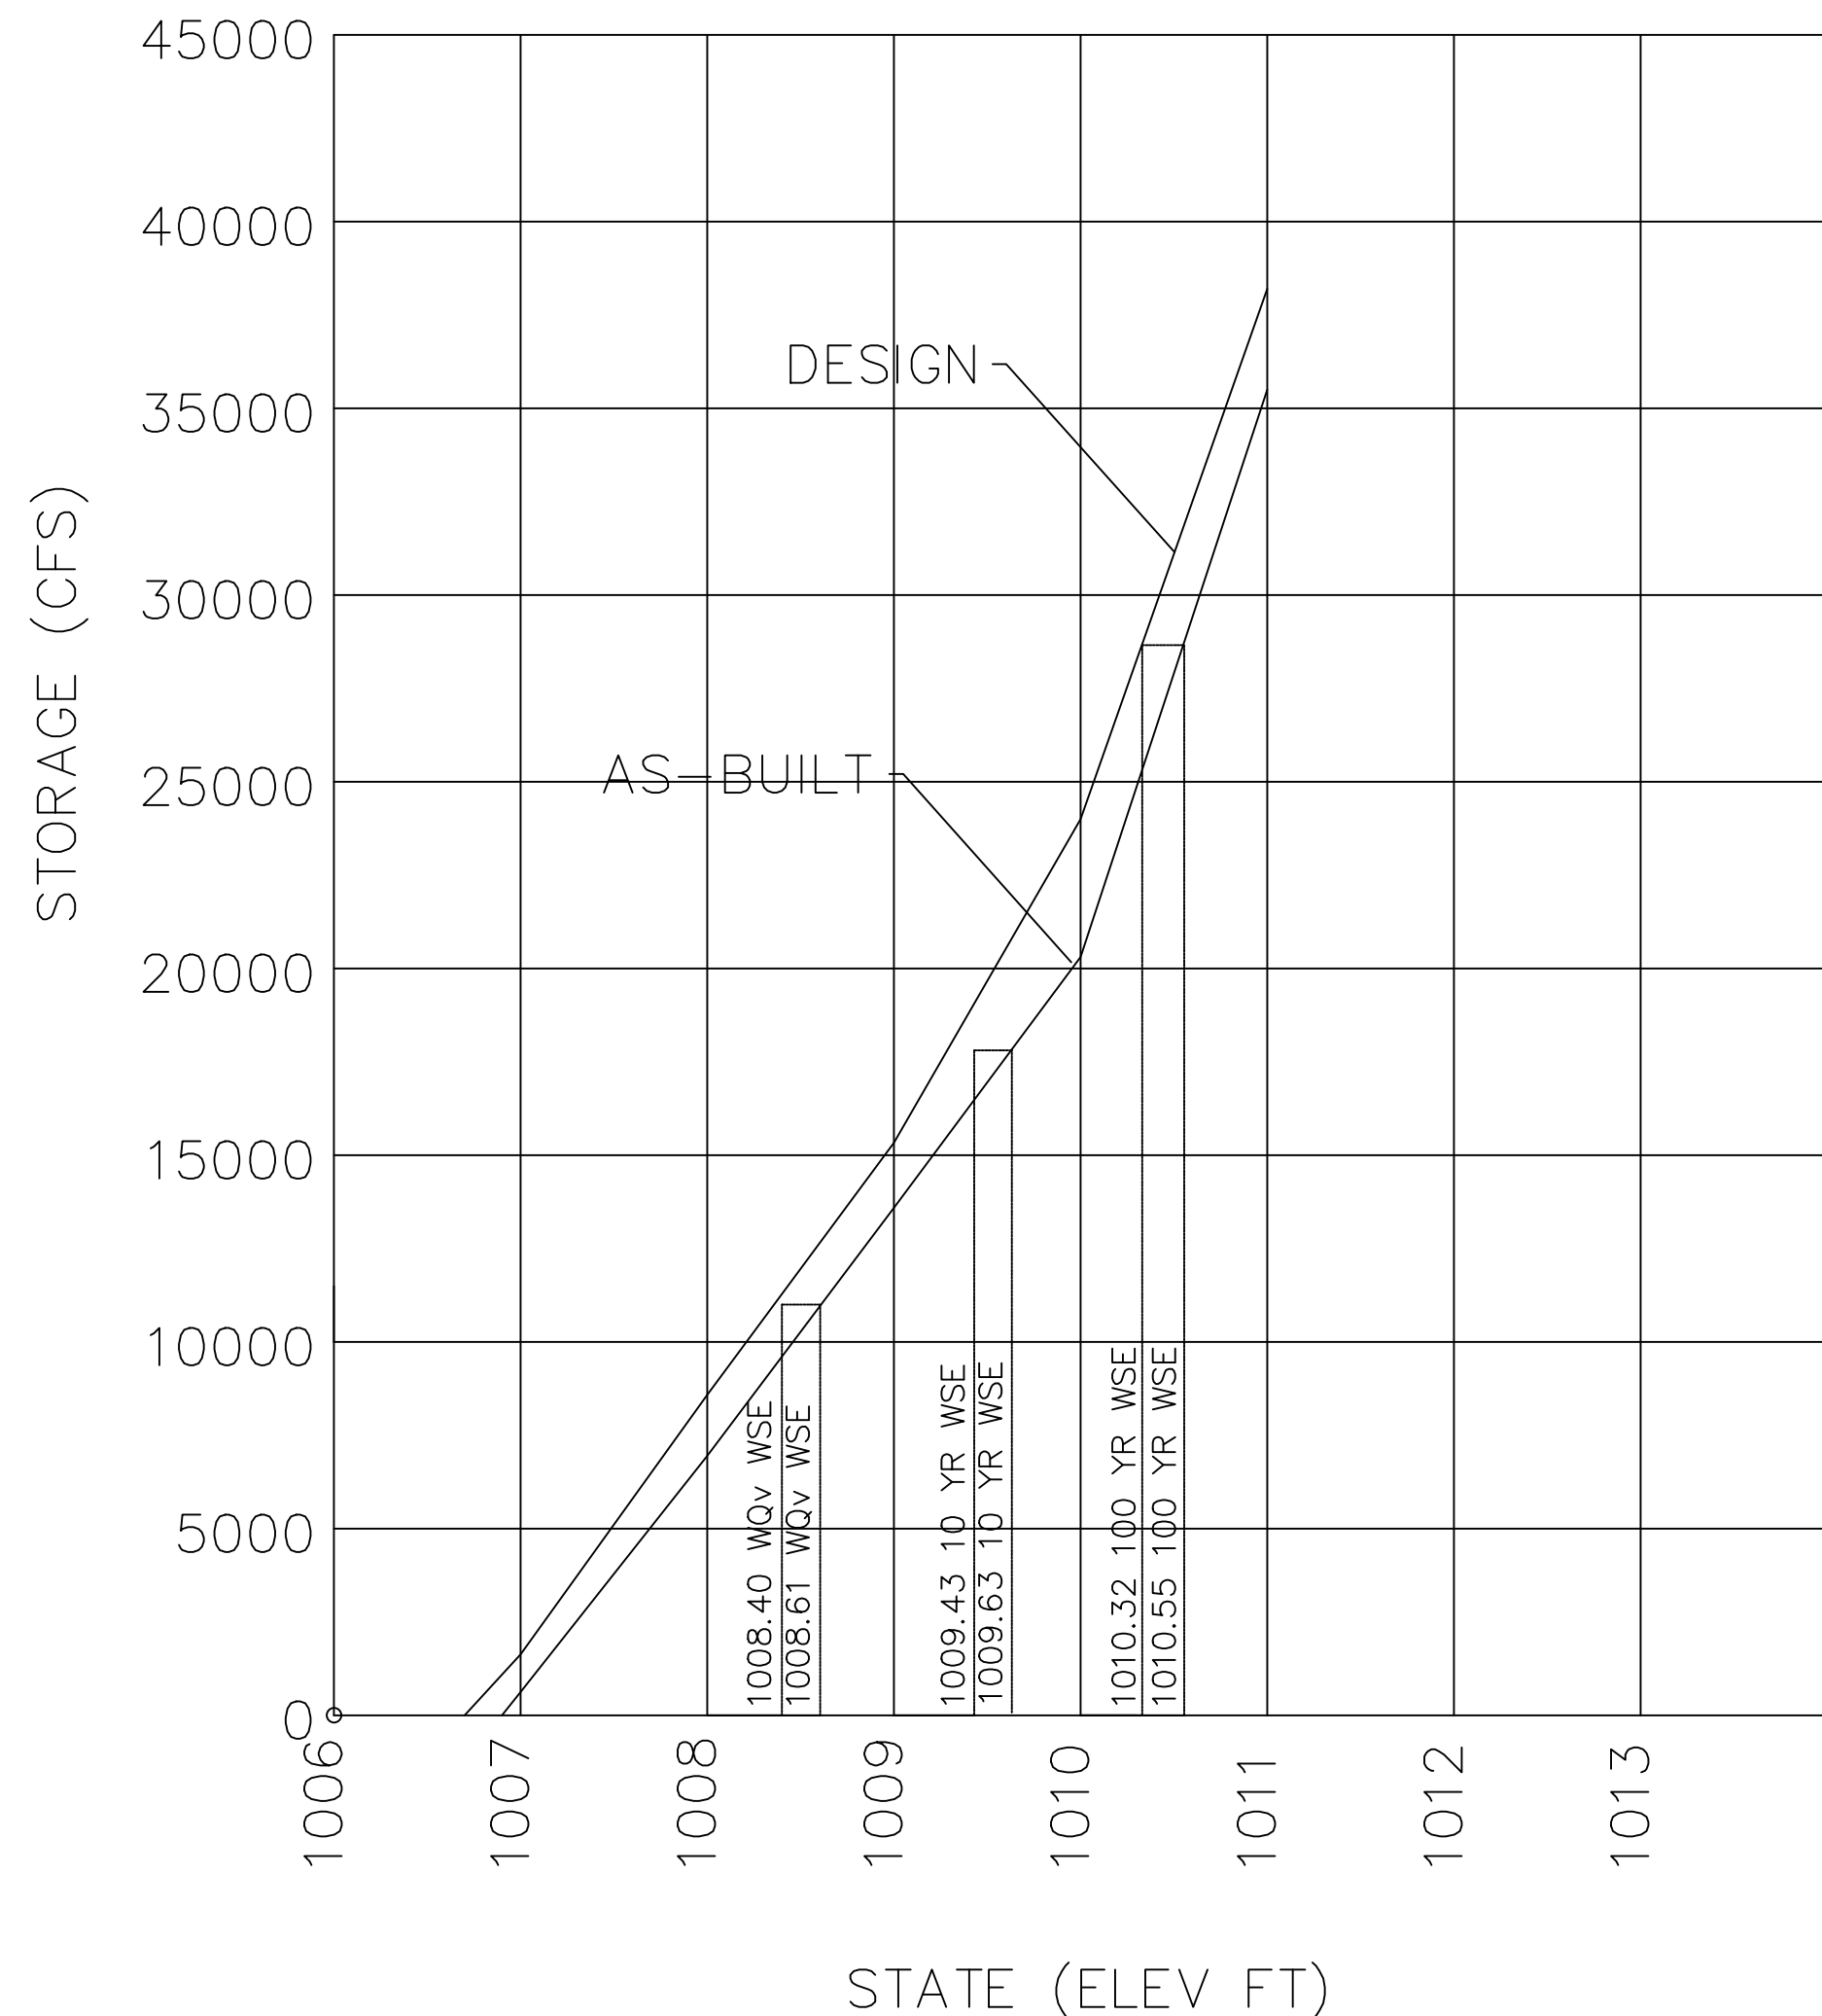

SAPP DESIGN ARCHITECTS

3750 S. Fremont Ave.
Springfield, MO 65804 417.877.9600

Sapp Design Associates Architects, P.C.
Missouri State Certificate of Authority #000607

helix

1629 Walnut
Kansas City, MO 64108 816.300.0300

SPECIAL NOTICES

In the event the client consents to allow, authorize or approve of changes to any plans, specifications or other construction documents, and these changes are not approved in writing by the design professional, the client recognizes that such changes and the results thereof are not the responsibility of the design professional. Therefore, the design professional shall not be held responsible for any liability arising from the construction, use or result of such changes. In addition, the client agrees to the fullest extent permitted by law, to indemnify and hold the design professional harmless from any damage, liability or cost (including reasonable attorney's fees and costs of defense) arising from such changes.

The personal seal of the registered Architect or Engineer shall be the legal equivalent of his signature wherever & whenever used, and the owner of the seal shall authorize its use and the specification sections pertaining to this sheet. Responsibility shall be disclaimed for all other plans, specifications, estimates, reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural project.

Mid-Continent Public Library
CONSTRUCTION DOCUMENT PLANS FOR
EAST LEE'S SUMMIT BRANCH
2240 SE BLUE PARKWAY
LEE'S SUMMIT, MO 64063
JACKSON COUNTY

PACKAGE **04**

Engineer of Record
Terry M Parsons, Engineer MO PE-2018010505

olsson

7301 West 133rd Street, Suite 200
Overland Park, KS 66213
TEL 913.381.1170
FAX 913.381.1174
www.olsson.com


Olsson
Missouri State Certificate of Authority #001592

Revision No.	Description	Date
1	AS-BUILT DETENTION MODIFICATIONS	02.18.19
2		02.26.20


Project No.	Date	Drawn
B18-0330	12.07.18	RLK

Drawing No. **C8.0**
DRAINAGE PLAN

© Copyright 2018 - Sapp Design Associates, Architects, P.C.

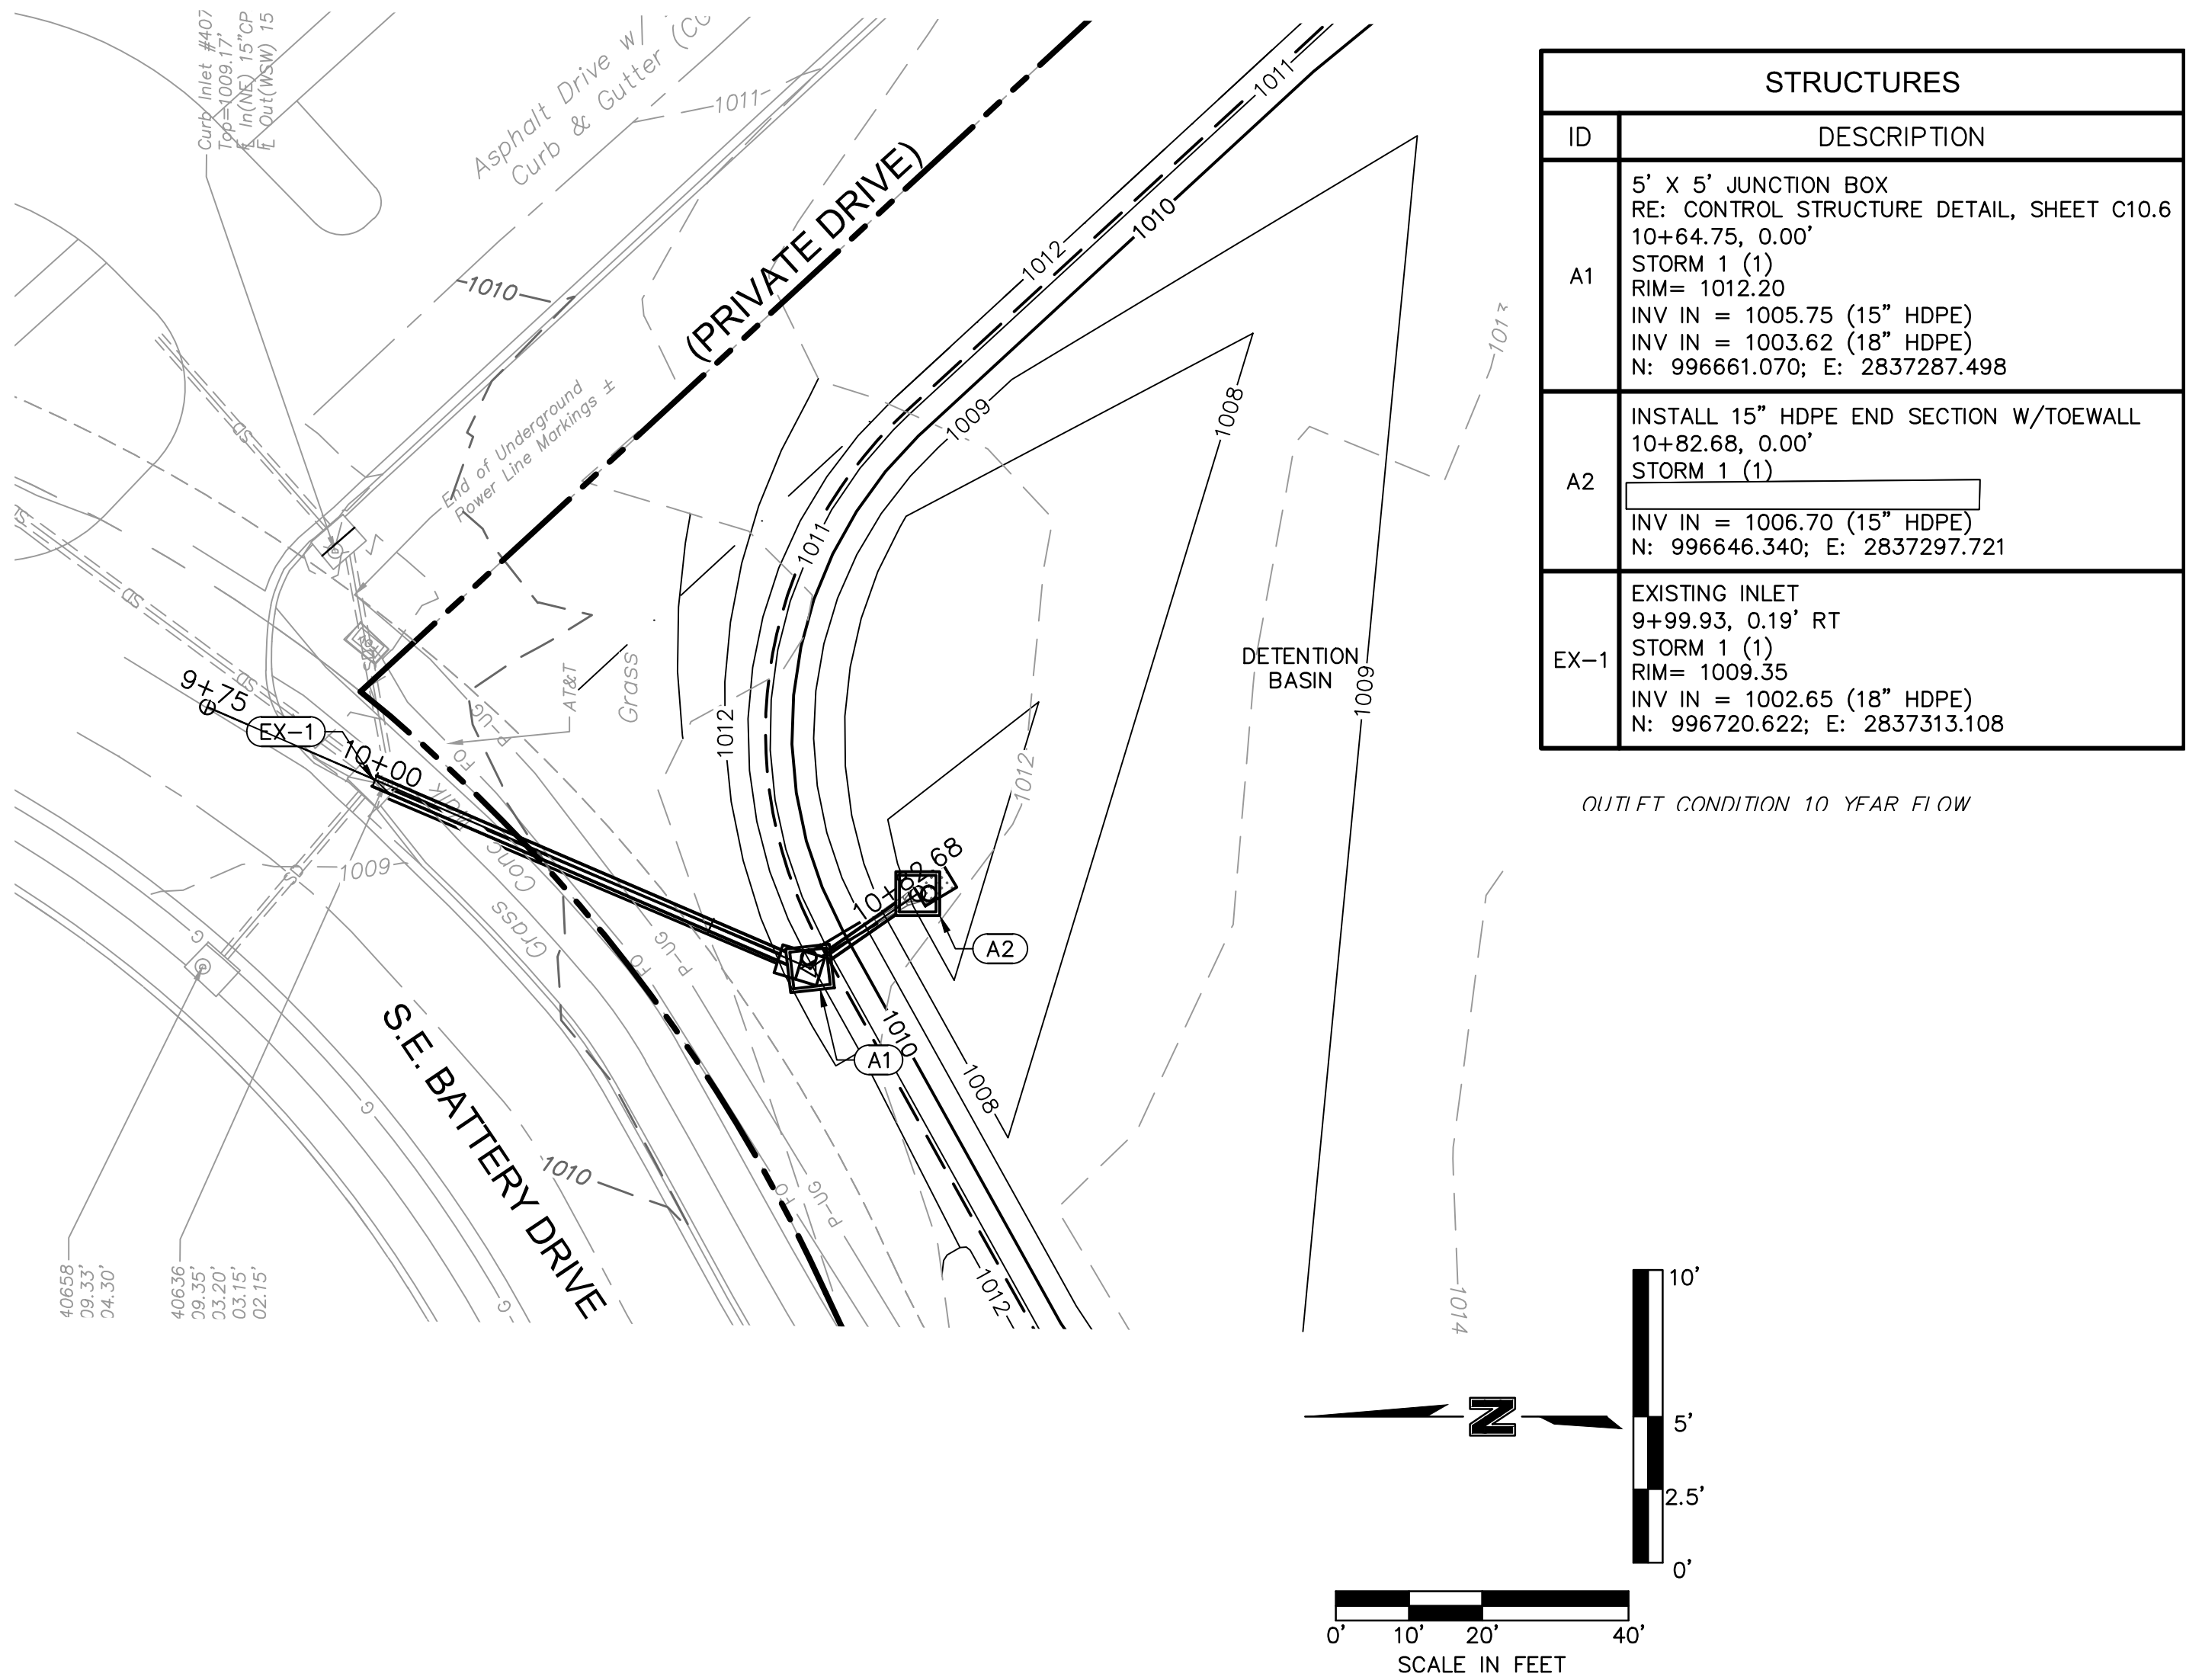


STORM 1 (1) (9+75 - 11+00)

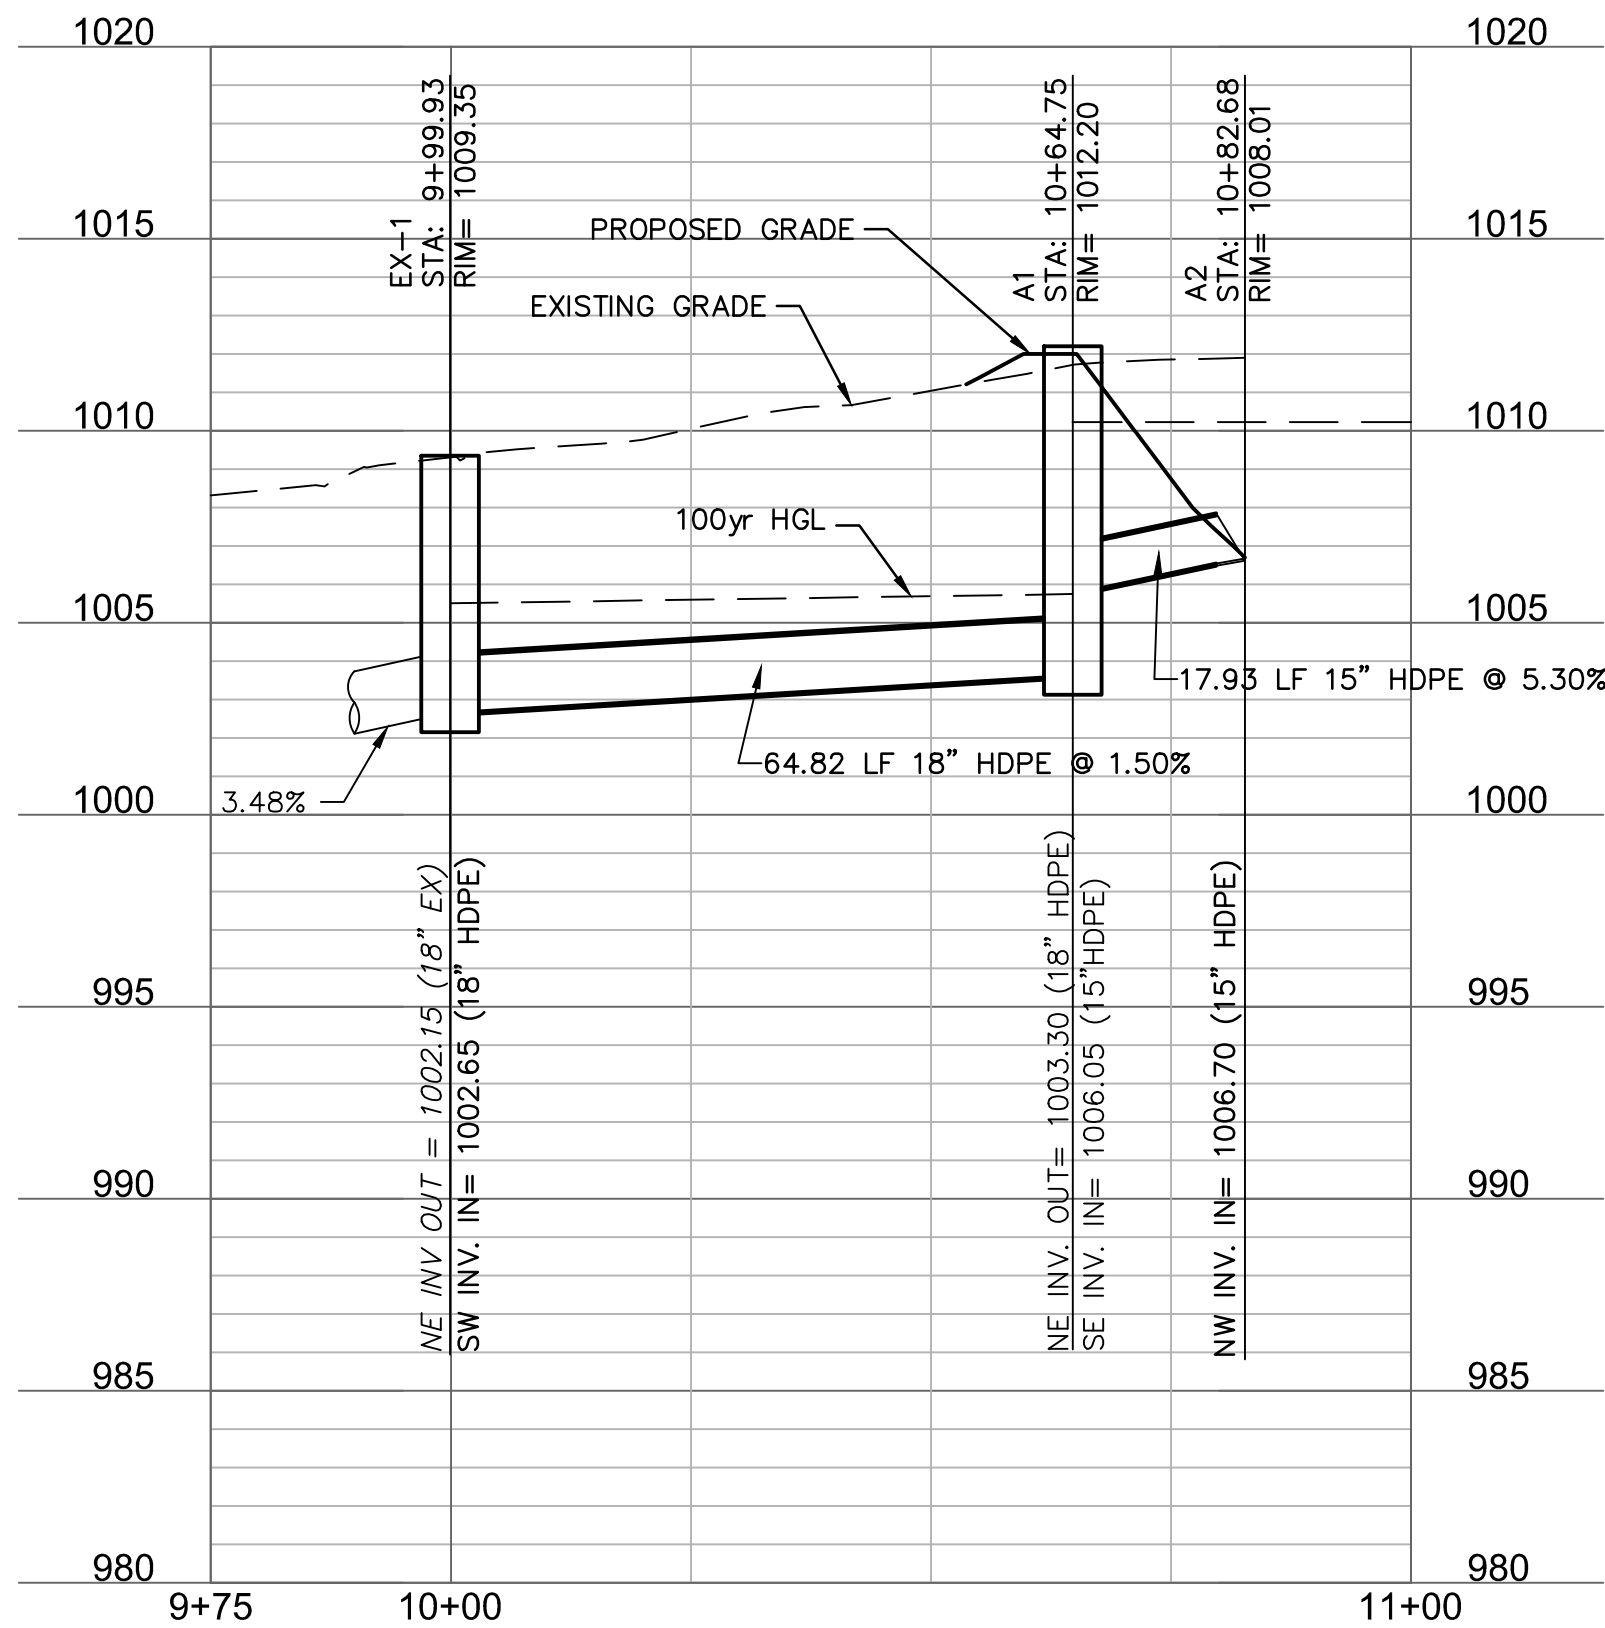

OUTLET CONDITION 10 YEAR FLOW
10_YR OUTLET FLOW = 4.6 CFS
PROPOSED
CAPACITY FOR 15" HDPE @ 5.30% = 15.0 CFS (31% FULL)
CAPACITY FOR 18" HDPE @ 1.50% = 12.9 CFS (33% FULL)
EXISTING
CAPACITY FOR 18" HDPE @ 3.48% = 19.2 CFS (24% FULL)

OUTLET CONDITION 100 YEAR FLOW
100_YR OUTLET FLOW = 11.9 CFS
PROPOSED
CAPACITY FOR 15" HDPE @ 5.30% = 15.0 CFS (79% FULL)
CAPACITY FOR 18" HDPE @ 1.50% = 12.9 CFS (92% FULL)
EXISTING
CAPACITY FOR 18" HDPE @ 3.48% = 19.2 CFS (61% FULL)

STORM 4 (9+50 - 10+70)

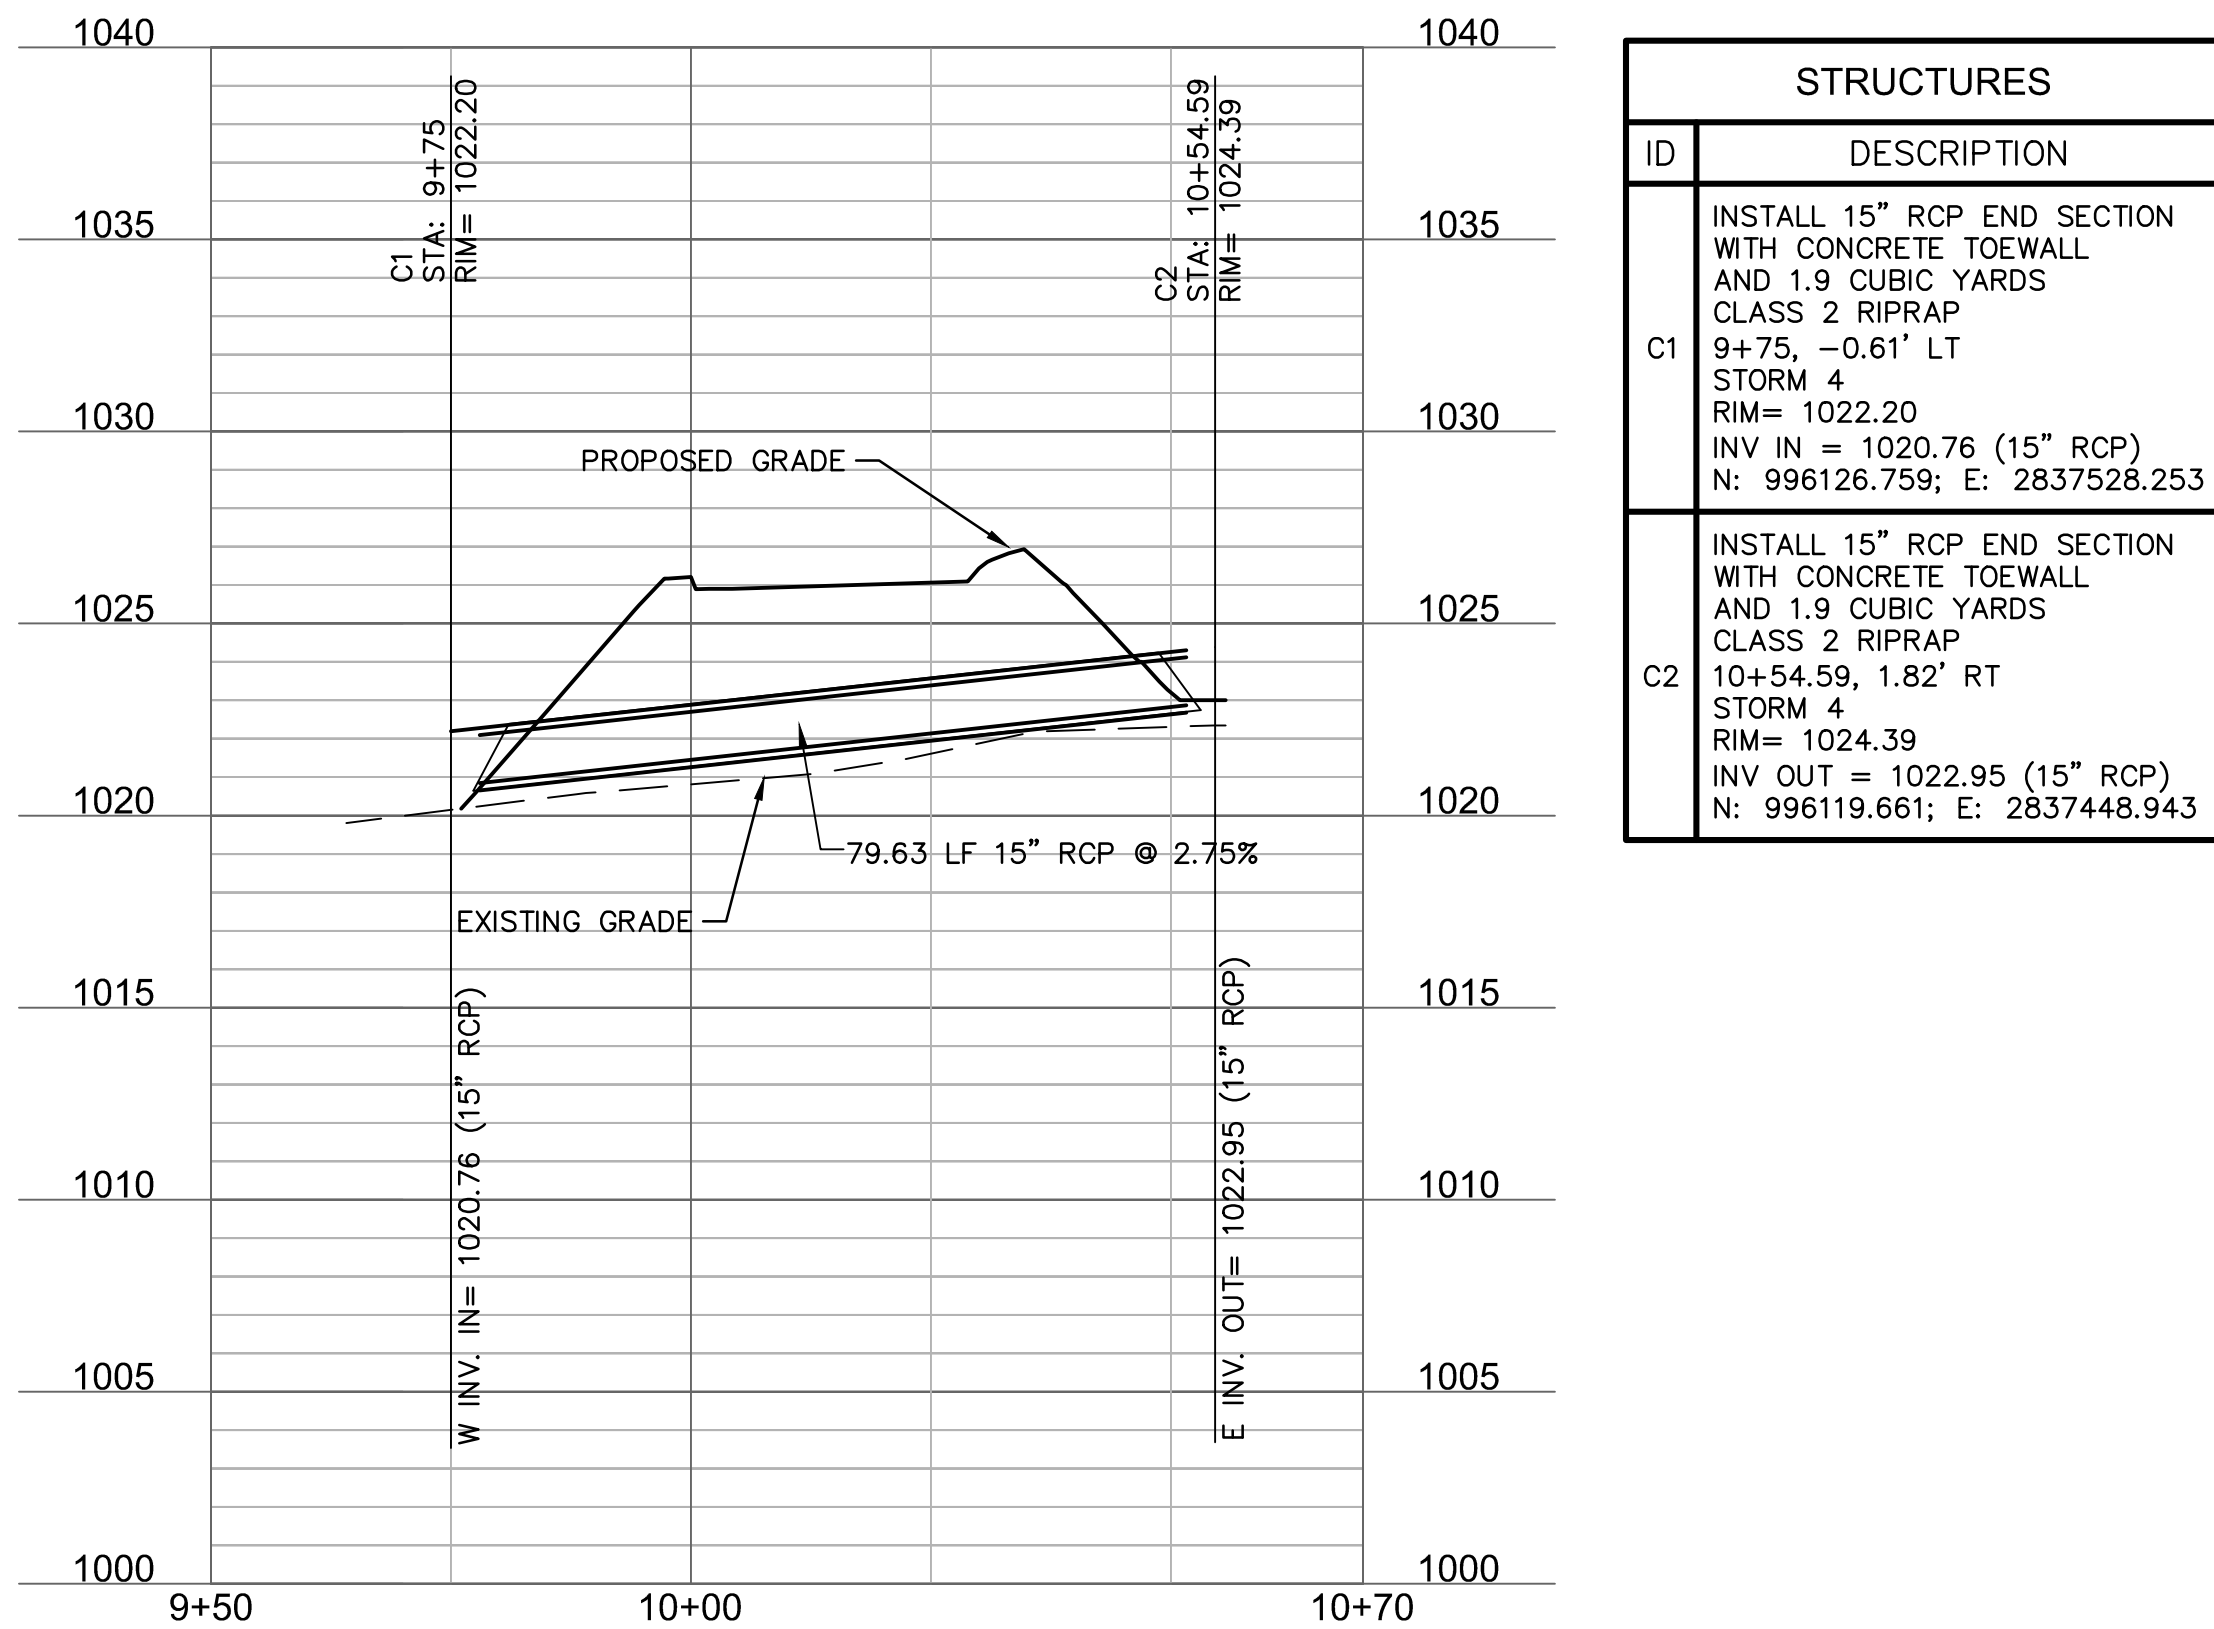

SPECIAL NOTICES

In the event the client consents to allow, authorize or approves of changes to any plans, specifications or other construction documents, and these changes are not approved in writing by the design professional, the client recognizes that such changes and the results thereof are not the responsibility of the design professional. Therefore, the client agrees to release the design professional from any liability arising from the construction, use or result of such changes. In addition, the client agrees to the fullest extent permitted by law, to indemnify and hold the design professional harmless from any damage, liability or cost (including reasonable attorney's fees and costs of defense) arising from such changes.

The personal seal of the registered Architect or Engineer shall be the legal equivalent of his signature whenever & wherever used, and the owner of the seal shall authenticate this sheet and the specification sections pertaining to this sheet. Responsibility shall be disclaimed for all other plans, specifications, estimates, reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural project.

Engineer of Record

Terry M Parsons, Engineer MO PE-2018010505

7301 West 133rd Street, Suite 200
Overland Park, KS 66213
TEL 913.381.1170
FAX 913.381.1174
www.olsson.com


Olsson
Missouri State Certificate of Authority #001592

Revision No.	Description	Date
1	ASI#1	02.18.19

Project No.	Date	Drawn
B18-0330	12.07.18	RLK

Drawing No. **C7.0**

STORM SEWER PLAN & PROFILE

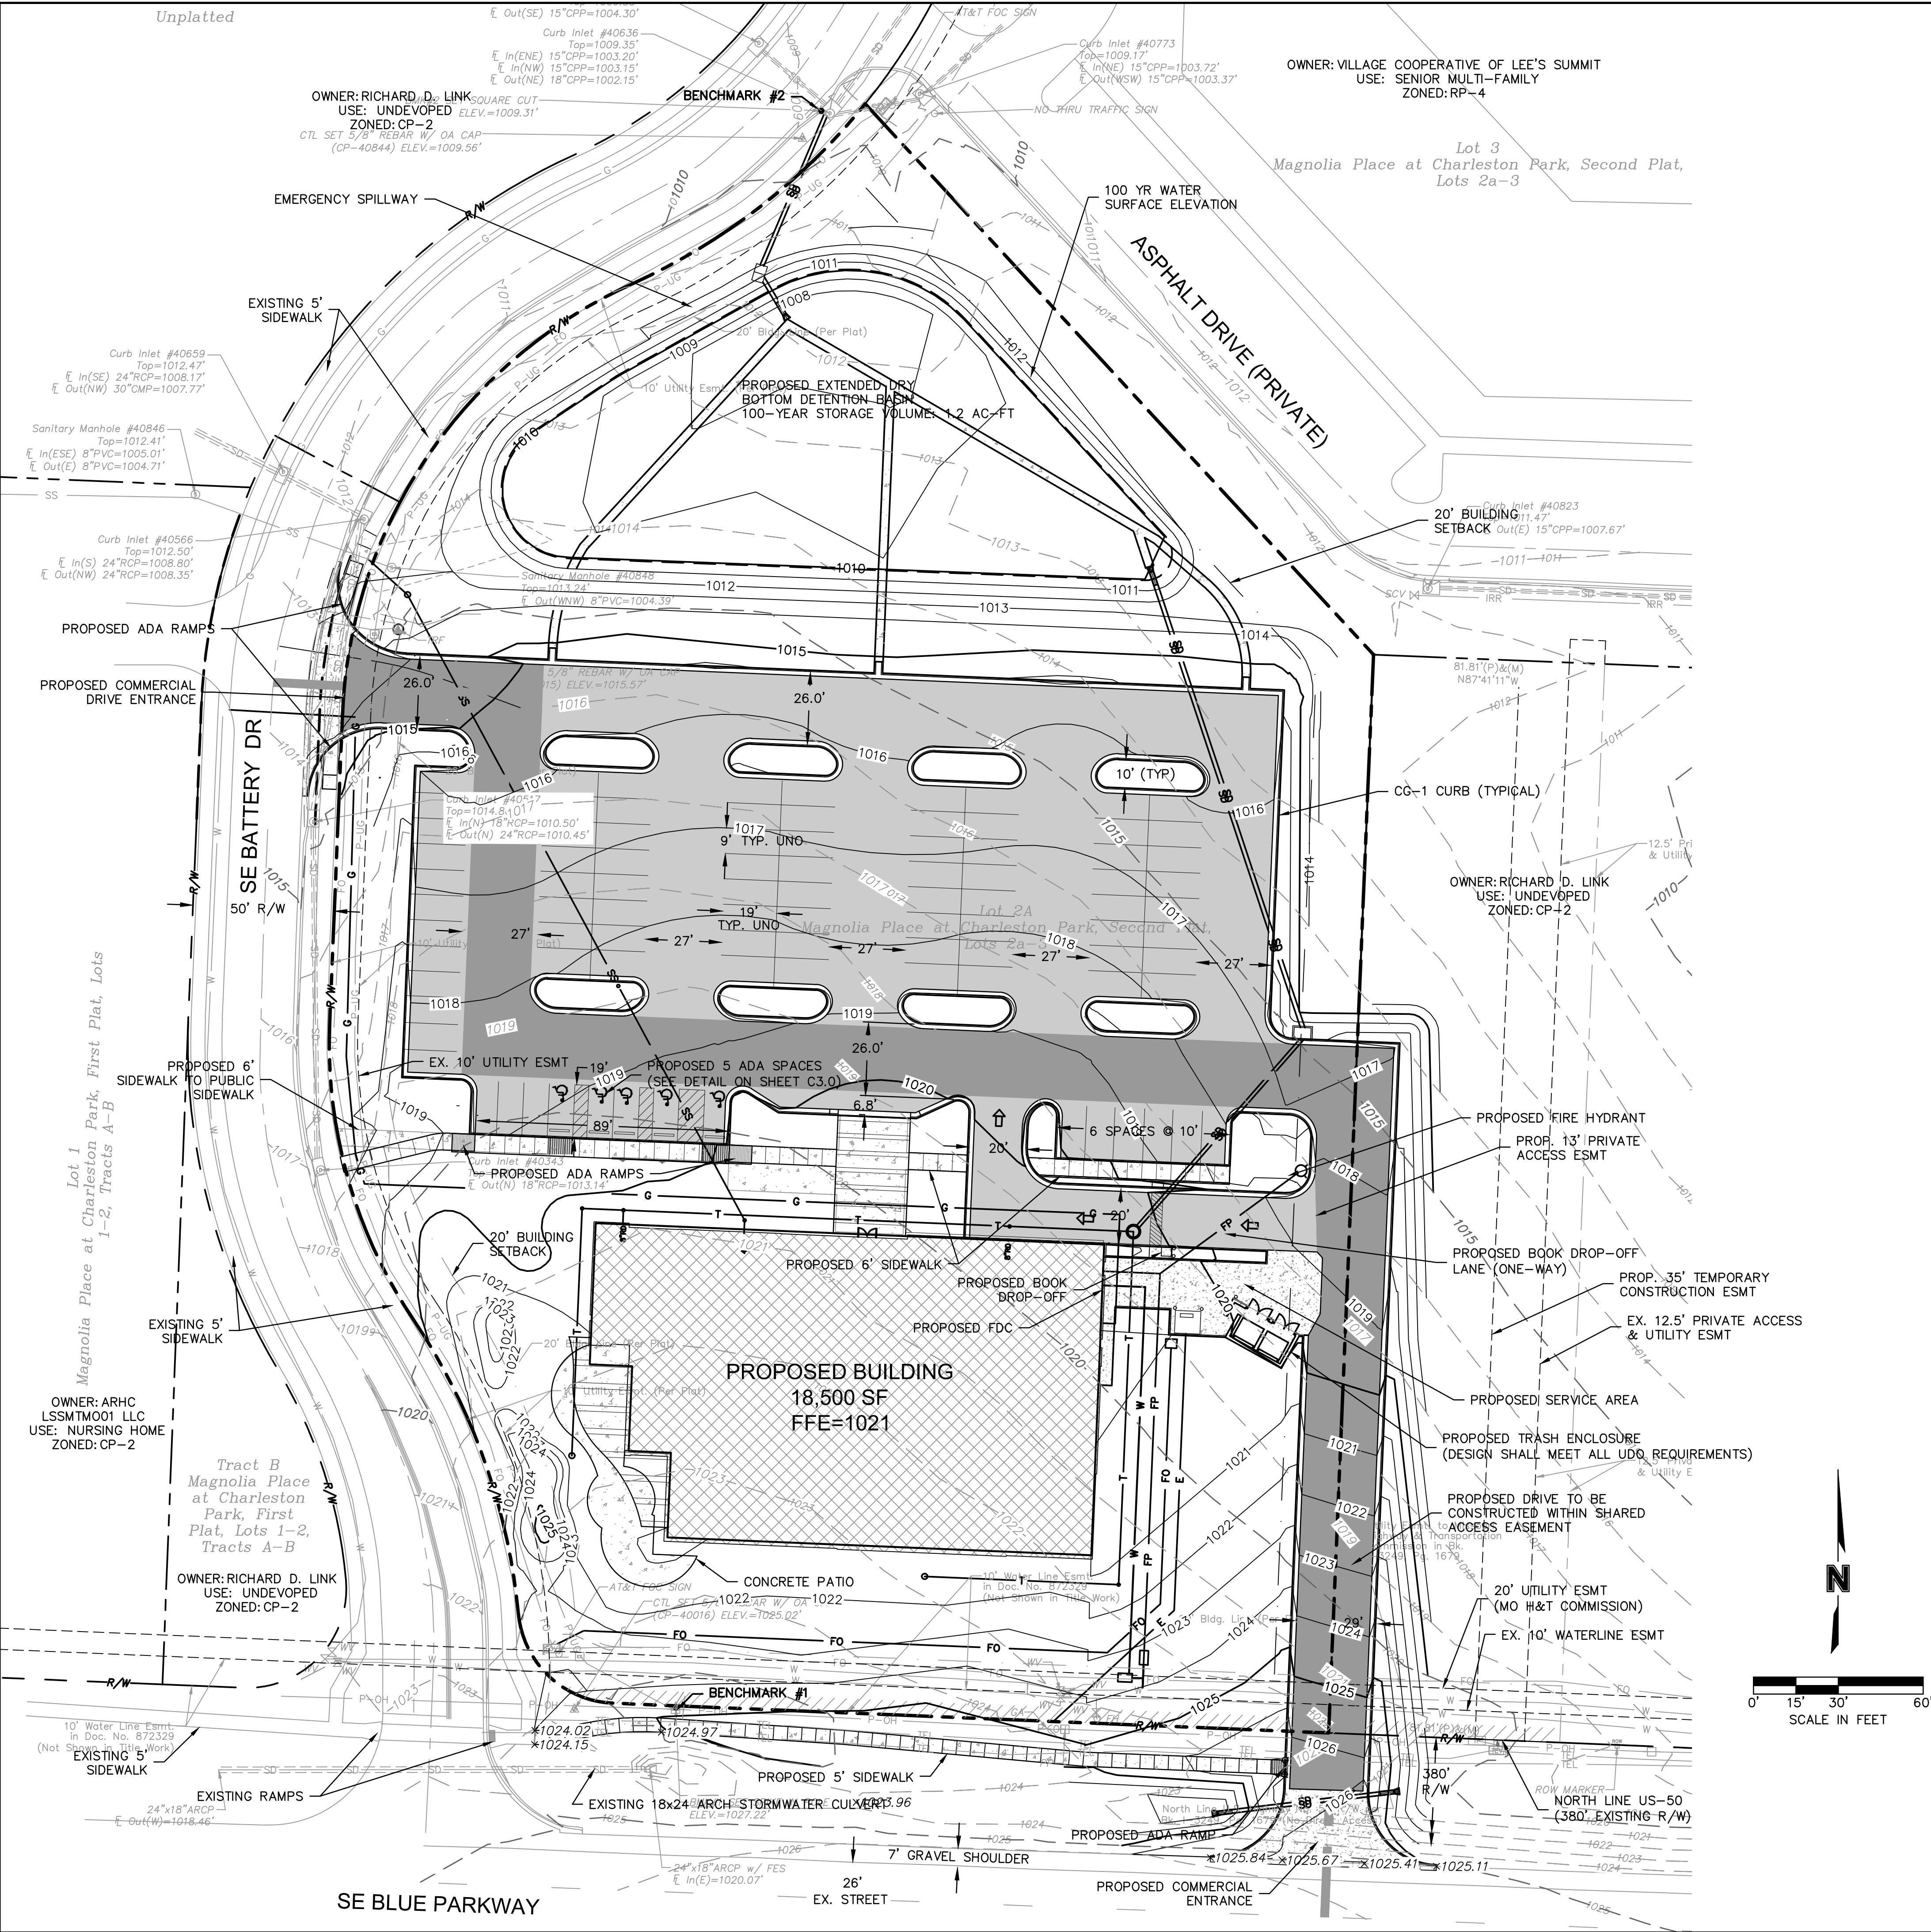

SITE DATA		
ZONING & SITE AREA		
PROPOSED USE:	PUBLIC LIBRARY	
	SITE AREA	ZONING
LOT 2 (AS DECRIBED):	3.80 ACRES (165,528 SF)	CP-2
IMPERVIOUS:	1.71 ACRES (74,488 SF) (45%)	
PERVIOUS:	2.09 ACRES (91,040 SF) (55%)	
FAR (0.55 MAX):	0.15	
BUILDING AREA		
BUILDING TYPE	# STORIES	SQUARE FOOTAGE
BUILDING	1	18,500 SF
PARKING		
USE	REQUIRED	PROVIDED
LIBRARY	4 PER 1000 SF = 74	83
ADA	3 (PER CITY TABLE)	5
TOTAL	74	88 (INCLUDING ADA)

NOTE:
ACCORDING TO MDNR STATE OIL & GAS COUNSEL THERE ARE NO OIL AND GAS WELLS LOCATED WITHIN OR ADJACENT TO THE PROPERTY.

EXISTING CONDITIONS LEGEND

---	PROPERTY LINES
---	RIGHT-OF-WAY LINES
---	EASEMENT LINES
---	BUILDING SETBACK LINES
P-OH	OVERHEAD ELECTRIC
P-UG	UNDERGROUND ELECTRIC
TEL	UNDERGROUND TELEPHONE
FO	UNDERGROUND FIBER OPTIC
G	GAS LINE
W	WATER LINE
SS	STORM SEWER LINE
SS	SANITARY SEWER LINE
85+	GRADE CONTOURS

PROPOSED CONDITIONS LEGEND

E	PROPOSED UNDERGROUND ELECTRIC
FO	PROPOSED FIBER OPTIC
W	PROPOSED WATER LINE
FP	PROPOSED FIRE PROTECTION LINE
SD	PROPOSED STORM SEWER LINE
T	PROPOSED TURF DRAIN LINE
SS	PROPOSED SANITARY SEWER SERVICE
---	CONCRETE CURB & GUTTER
---	PROPOSED BUILDING
---	PROPOSED CONCRETE SIDEWALK
---	PROPOSED LIGHT DUTY ASPHALT
85+	PROPOSED GRADE CONTOURS
---	PROPOSED FIRE ACCESS ROAD


BENCHMARKS:

BENCHMARK #1:
ELEVATION=1027.22'
SET RAILROAD SPIKE IN THE NORTH SIDE OF A POWER POLE, 66'± NORTH OF THE C. OF SE BLUE PARKWAY, 86' EAST OF THE C. OF SE BATTERY DRIVE.

BENCHMARK #2:
ELEVATION=1009.31'
SET CHISELED "C" CUT ON THE SOUTHWESTERLY CORNER OF A CONCRETE CURB INLET #40636, 630'± NORTH OF THE C. OF SE BLUE PARKWAY, 15' EAST OF THE C. OF SE BATTERY DRIVE.

LEGAL DESCRIPTION:

LOT 2A, MAGNOLIA PLACE AT CHARLESTON PARK, SECOND PLAT, LOTS 2A-3, A SUBDIVISION IN LEE'S SUMMIT, JACKSON COUNTY, MISSOURI, EXCEPT THE EAST 81.81 FEET THEREOF, CONTAINING 165,561 SQUARE FEET OR 3.8008 ACRES, MORE OR LESS.

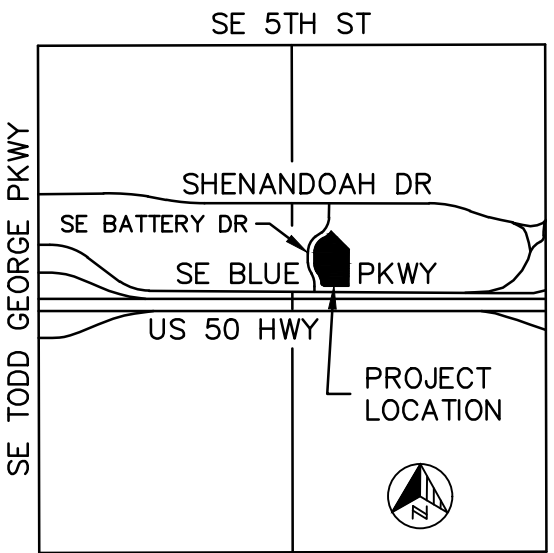

SECTION 10, T.47N., R.31W.
VICINITY MAP
SCALE: 1" = 2000'


SPECIAL NOTICES

In the event the client consents to, allows, authorizes or approves of changes to any plans, specifications or other construction documents, and these changes are not approved in writing by the design professional, the client recognizes that such changes and the results thereof are not the responsibility of the design professional. Therefore, the client agrees to release the design professional from any liability arising from the construction, use or result of such changes. In addition, the client agrees to the fullest extent permitted by law, to indemnify and hold the design professional harmless from any damage, liability or cost (including reasonable attorney's fees and costs of defense) arising from such changes.

The personal seal of the registered Architect or Engineer shall be the legal equivalent of his signature wherever & whenever used, and the owner of the seal shall authenticate this sheet and the specification sections pertaining to this sheet. Responsibility shall be disclaimed for all other plans, specifications, estimates, reports or other documents or instruments relating to or intended to be used for any part or parts of the architectural project.

SHEET ADDED PER AS-BUILT
CONDITIONS (FEBRUARY 2020)



MCPL EAST LEES SUMMIT
AS-BUILT SURVEY - FEB 2020

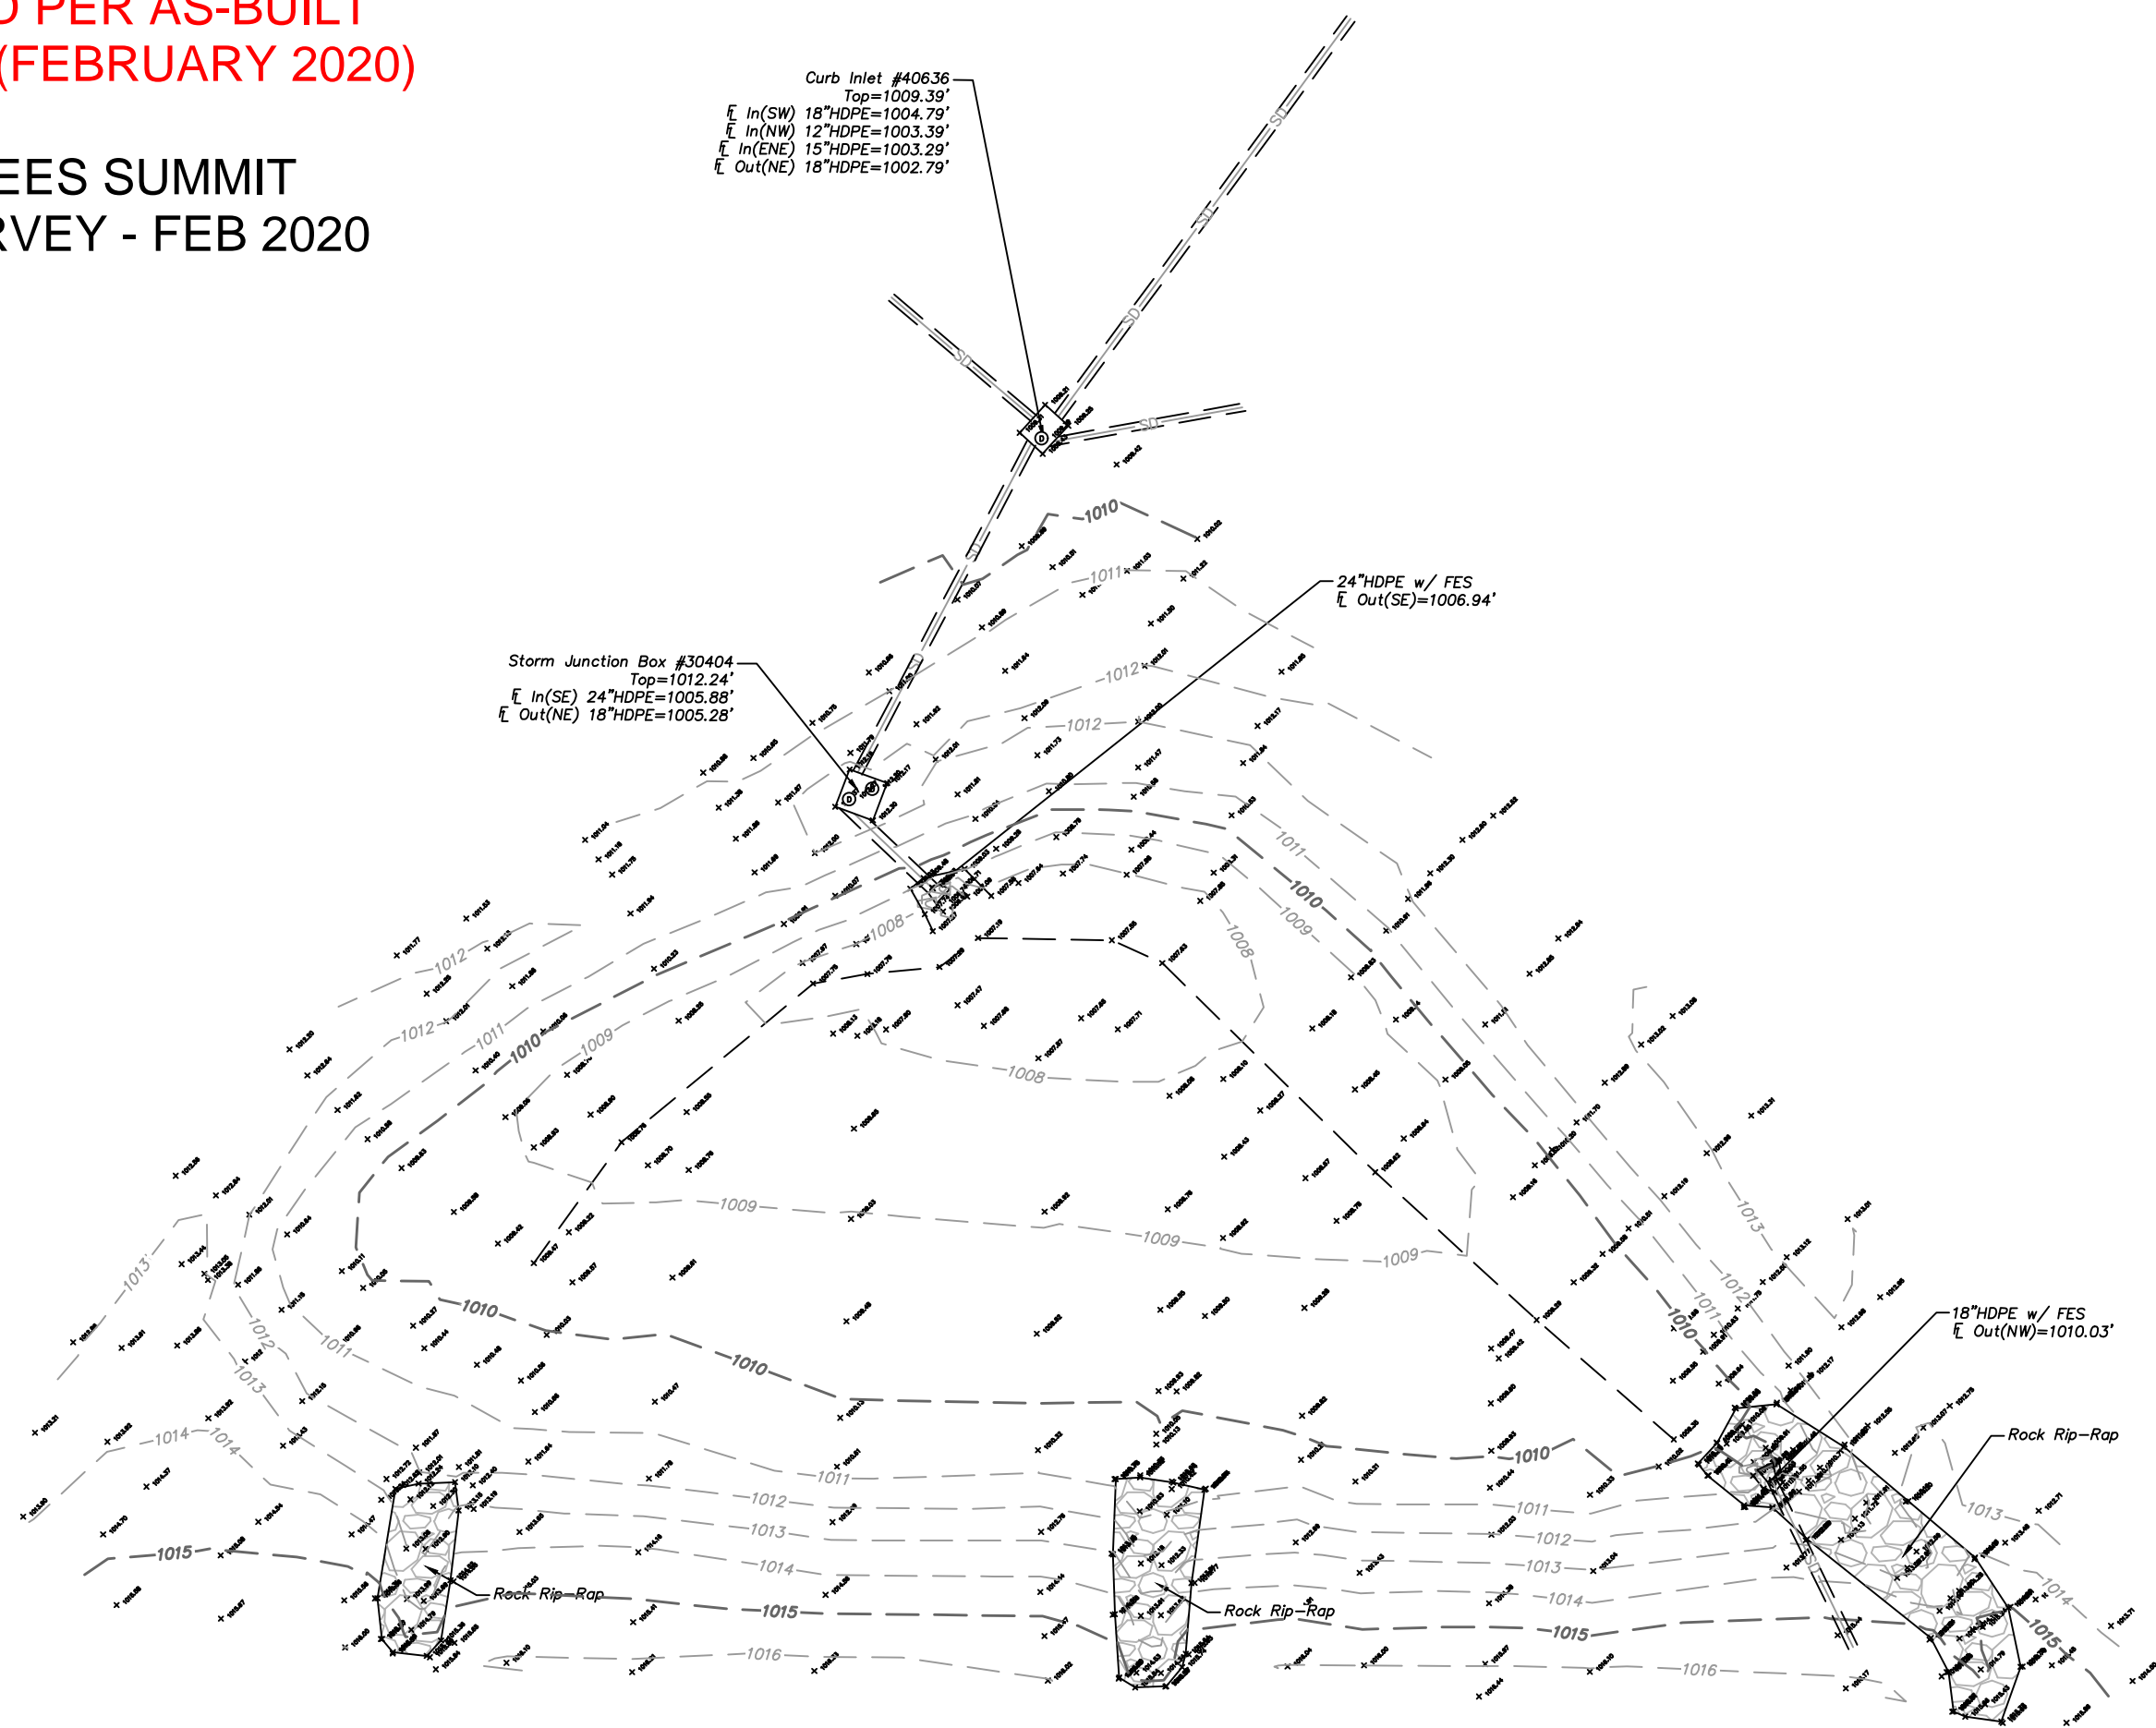



STORM SEWER PIPE AND STRUCTURE TABLE																																
TITLE: EAST LEE'S SUMMIT LIBRARY JOB # 017-1468																																
DESIGN CONDITIONS: 10 YEAR STORM EVENT																																
RUNOFF CALCULATIONS																																
FROM	TO	DRECT AREA (ACRES)	TOTAL AREA (ACRES)	C	KC (K+1.00)	Tc (MIN)	FLOW TIME (MIN)	INTENSITY (INHR)	DESIGN Q (CFS)	DESCRIPTION	PIPE LENGTH (L.F.)	PIPE SLOPE (%)	PIPE DIA (IN)	Q FULL (CFS)	PIPE AREA (SQ.FT)	V FULL (FPS)	DESIGN V (FPS)	HWD	MH TOP ELEVATION	UPSTREAM FLOWLINE	DOWNSTEAM FLOWLINE	DOWNSTEAM WATER ELEVATION	FRICTION HEAD (F)	ENTRY LOSS COEFFICIENT (K)	ACTUAL ENTRY LOSS (F)	ENTRY LOSS (H.M)	h + h m (FT)	HW INLET CONTROL	HW OUTLET CONTROL	HYDRAULIC GRADE ELEV. (MAX)	HYDRAULIC GRADE ELEV. (MIN)	Comments
R00A	R02	0.36	0.33	0.33	5.0	-	1.35	0.87	0.87	ADS BASINS/ROOF DRAINS	88.00	1.00	8	1.21	0.35	3.47	3.80	1.04	1020.20	1016.70	1015.82	1016.85	0.47	1.00	1.00	0.22	0.69	1017.40	1017.54	1017.54	1016.20	
R02	R01	0.25	0.61	0.41	5.0	-	1.35	0.78	0.78	ADS BASINS/ROOF DRAINS	103.00	1.00	10	2.30	0.56	4.03	4.53	1.24	1020.20	1015.82	1013.69	1013.48	1.48	0.40	0.40	0.13	1.57	1016.85	1015.82	1016.85	1019.20	
R01	B2	0.10	0.97	0.50	5.0	-	1.35	0.98	0.98	JUNCTION BOX	92.14	4.00	15	12.95	1.23	10.96	9.15	0.97	1020.20	1015.72	1012.02	1017.54	0.32	0.30	0.30	0.30	0.71	1016.94	1016.25	1016.25	1019.20	
B2	B1	0.59	0.97	0.63	0.63	5.0	-	1.35	2.73	CURB INLET	173.85	1.00	18	10.53	1.77	5.99	6.50	1.17	1017.86	1011.72	1000.88	1000.52	0.94	0.50	0.50	0.33	1.27	1013.48	1011.72	1013.48	1016.85	END SECTION TO BASIN
			1.56	0.67	5.0	-	1.35	7.66		18 in HDPE																						
R00B	R04	0.26	0.39	0.39	5.0	-	1.35	0.78	0.78	ADS BASINS/ROOF DRAINS	67.00	1.00	8	1.21	0.35	3.47	3.84	0.94	1020.20	1016.70	1016.01	1016.39	0.28	1.00	1.00	0.21	0.48	1017.33	1017.06	1017.33	1019.20	
R04	R01	0.00	0.39	0.39	5.0	-	1.35	0.90	0.90	ADS BASINS/ROOF DRAINS	125.00	1.00	8	1.21	0.35	3.47	3.94	0.94	1020.20	1016.01	1014.76	1017.54	0.48	0.40	1.00	0.21	0.69	1016.94	1016.23	1016.23	1019.20	
			0.26	0.39	5.0	-	1.35	0.75		8 in HDPE																						
F1	BAS	0.53	0.53	0.75	0.75	5.0	-	1.35	2.90	FLUME																						
F2	BAS	0.45	0.45	0.80	0.80	5.0	-	1.35	2.65	FLUME																						
F3	BAS	0.32	0.32	0.80	0.80	5.0	-	1.35	1.88	FLUME																						

STORM SEWER PIPE AND STRUCTURE TABLE																																
TITLE: EAST LEE'S SUMMIT LIBRARY JOB # 017-1468																																
DESIGN CONDITIONS: 10 YEAR STORM EVENT																																
RUNOFF CALCULATIONS																																
FROM	TO	DRECT AREA (ACRES)	TOTAL AREA (ACRES)	C	KC (K+1.25)	Tc (MIN)	FLOW TIME (MIN)	INTENSITY (INHR)	DESIGN Q (CFS)	DESCRIPTION	PIPE LENGTH (L.F.)	PIPE SLOPE (%)	PIPE DIA (IN)	Q FULL (CFS)	PIPE AREA (SQ.FT)	V FULL (FPS)	DESIGN V (FPS)	HWD	MH TOP ELEVATION	UPSTREAM FLOWLINE	DOWNSTEAM FLOWLINE	DOWNSTEAM WATER ELEVATION	FRICTION HEAD (F)	ENTRY LOSS COEFFICIENT (K)	ACTUAL ENTRY LOSS (F)	ENTRY LOSS (H.M)	h + h m (FT)	HW INLET CONTROL	HW OUTLET CONTROL	HYDRAULIC GRADE ELEV. (MAX)	HYDRAULIC GRADE ELEV. (MIN)	Comments
R00A	R02	0.36	0.36	0.33	4.1	5.0	-	1.35	1.06	ADS BASINS/ROOF DRAINS	88.00	1.00	9	1.21	0.35	3.47	3.94	1.25	1020.20	1016.70	1015.82	1016.85	0.73	1.00	1.00	0.24	0.97	1017.54	1017.82	1017.82	1016.20	
R02	R01	0.25	0.61	0.41	5.0	-	1.35	0.84	0.84	ADS BASINS/ROOF DRAINS	103.00	1.00	12	3.57	0.79	4.95	4.98	1.03	1020.20	1015.82	1013.69	1013.48	0.85	0.40	0.40	0.15	1.01	1016.85	1015.82	1016.85	1019.20	
R01	B2	0.10	0.97	0.50	5.0	-	1.35	0.83	0.83	JUNCTION BOX	92.14	4.00	15	12.95	1.23	10.96	9.12	1.14	1020.20	1015.72	1012.02	1017.82	0.50	0.30	0.30	0.44	0.94	1017.15	1016.76	1016.76	1019.20	
B2	B1	0.59	0.97	0.63	0.63	5.0	-	1.35	4.72	CURB INLET	173.85	1.00	18	10.53	1.77	5.99	6.41	1.45	1017.86	1011.72	1000.88	1010.12	1.47	0.50	0.50	0.35	1.82	1013.90	1011.94	1013.90	1016.65	END SECTION TO BASIN
			1.56	0.87	5.0	-	1.35	9.80		18 in HDPE																						
R00B	R04	0.26	0.39	0.49	5.0	-	1.35	0.93	0.93	ADS BASINS/ROOF DRAINS	67.00	1.00	8	1.21	0.35	3.47	3.84	1.10	1020.20	1016.70	1016.01	1016.68	0.40	1.00	1.00	0.23	0.63	1017.43	1017.31	1017.43	1019.20	
R04	R01	0.00	0.39	0.49	5.0	-	1.35	0.90	0.90	ADS BASINS/ROOF DRAINS	125.00	1.00	8	1.21	0.35	3.47	3.84	1.10	1020.20	1016.01	1014.76	1017.82	0.76	0.40	1.00	0.23	0.68	1016.74	1016.80	1016.80	1019.20	
			0.26	0.39	5.0	-	1.35	0.83		8 in HDPE																						
F1	BAS	0.53	0.53	0.75	0.84	5.0	-	1.35	3.66	FLUME																						
F2	BAS	0.45	0.45	0.80	1.00	5.0	-	1.35	3.31	FLUME																						
F3	BAS	0.32	0.32	0.80	1.00	5.0	-	1.35	2.38	FLUME																						

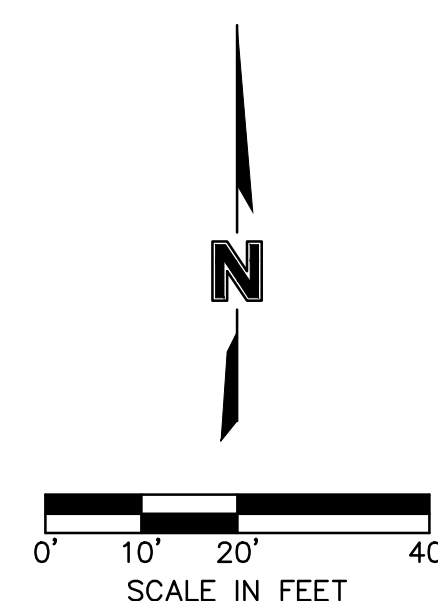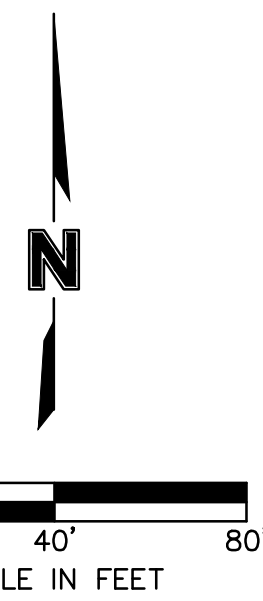

Appendix B

FEMA Flood Classification Firm

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Elevation Elevation Tables contained within the Flood Insurance Study (FIS) Report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS Report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study Report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study Report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Missouri State Plane West Zone (FIPS zone 2403). The **horizontal datum** was NAD 83, GRS 1980 spheroid. Differences in datum, spheroid, projection or UTM zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988. These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov> or contact the National Geodetic Survey at the following address:

NGS Information Services
N/A, N/A0312
National Geodetic Survey
3500 C. R. Smith
1315 East West Highway
Silver Spring, Maryland 20910-3282
(301) 713-3242

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242, or visit its website at <http://www.ngs.noaa.gov>.

Base map information shown on this FIRM was derived from the U.S. Department of Agriculture National Agriculture Imagery Program (NAIP) dated 2014. Produced at scale of 1:24,000.

The **profile baselines** depicted on this map represent the hydraulic modeling baselines that match the flood profiles in the FIS report. As a result of improved topographic data, the **profile baseline**, in some cases, may deviate significantly from the channel centerline or appear outside the SFHZA.

Based on updated topographic information, this map reflects more detailed and up-to-date **stream channel configurations** and **floodplain delineations** than those shown on the previous FIRM for this jurisdiction. As a result, the Flood Profiles and Floodway Data tables for multiple streams in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on the map. Also, the road to floodplain relationships for unimproved streams may differ from what is shown on previous maps.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

For information on available products associated with this FIRM visit the **Map Service Center (MSC)** website at <http://msc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. Many of these products can be ordered or obtained directly from the MSC website.



LEGEND



NFIP

PANEL 6439G

FIRM

FLOOD INSURANCE RATE MAP

JACKSON COUNTY, MISSOURI AND INCORPORATED AREAS

PANEL 439 OF 625
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

COMMUNITY	NUMBER	PANEL	DATE
JACKSON COUNTY, Incorporated	29095C	0439G	0
VEE'S CORP., CITY OF	29095C	0439G	0

Notice to User: The **Map Number** shown below should be used when placing map orders, the **Community Number** shown above should be used on insurance applications for the subject community.

MAP NUMBER
29095C0439G

MAP REVISED
JANUARY 20, 2017

Federal Emergency Management Agency

Soil Map—Jackson County, Missouri
(MCPL - East Lees Summit)



Appendix C

Soil Map

MAP LEGEND

Area of Interest (AOI)

Area of Interest (AOI)

Soils



Soil Map Unit Polygons



Soil Map Unit Lines



Soil Map Unit Points

Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

Water Features



Streams and Canals

Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

Background



Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Jackson County, Missouri

Survey Area Data: Version 18, Sep 16, 2017

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 11, 2017—Sep 22, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
10082	Arisburg-Urban land complex, 1 to 5 percent slopes	3.3	79.5%
10180	Udarents-Urban land-Sampsel complex, 2 to 5 percent slopes	0.9	20.5%
Totals for Area of Interest		4.2	100.0%

Jackson County, Missouri

10082—Arisburg-Urban land complex, 1 to 5 percent slopes

Map Unit Setting

National map unit symbol: 2w7ld

Elevation: 750 to 1,130 feet

Mean annual precipitation: 39 to 45 inches

Mean annual air temperature: 50 to 55 degrees F

Frost-free period: 177 to 220 days

Farmland classification: All areas are prime farmland

Map Unit Composition

Arisburg and similar soils: 61 percent

Urban land: 30 percent

Minor components: 9 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Arisburg

Setting

Landform: Interfluves

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Interfluve

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Loess

Typical profile

Ap - 0 to 6 inches: silt loam

A - 6 to 13 inches: silt loam

Bt - 13 to 19 inches: silty clay loam

Btg - 19 to 56 inches: silty clay loam

BCg - 56 to 79 inches: silty clay loam

Properties and qualities

Slope: 1 to 5 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Somewhat poorly drained

Capacity of the most limiting layer to transmit water (Ksat):

Moderately high (0.20 to 0.60 in/hr)

Depth to water table: About 18 to 30 inches

Frequency of flooding: None

Frequency of ponding: None

Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water storage in profile: High (about 11.5 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: C
Ecological site: Loess Upland Prairie (R107BY007MO)
Hydric soil rating: No

Description of Urban Land

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 8
Hydric soil rating: No

Minor Components

Sharpsburg

Percent of map unit: 3 percent
Landform: Ridges
Landform position (two-dimensional): Summit
Landform position (three-dimensional): Interfluve
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: Loess Upland Prairie (R109XY002MO)
Hydric soil rating: No

Sampsel

Percent of map unit: 3 percent
Landform: Hills
Landform position (two-dimensional): Backslope
Landform position (three-dimensional): Side slope
Down-slope shape: Convex
Across-slope shape: Concave
Ecological site: Interbedded Sedimentary Upland Savanna
(R109XY010MO)
Hydric soil rating: Yes

Greenton

Percent of map unit: 3 percent
Landform: Hillslopes
Landform position (two-dimensional): Shoulder
Landform position (three-dimensional): Side slope
Down-slope shape: Convex
Across-slope shape: Convex
Ecological site: Loess Upland Prairie (R109XY002MO)
Hydric soil rating: No

Data Source Information

Soil Survey Area: Jackson County, Missouri
Survey Area Data: Version 18, Sep 16, 2017

Jackson County, Missouri

10180—Udarents-Urban land-Sampsel complex, 2 to 5 percent slopes

Map Unit Setting

National map unit symbol: 1n85h

Elevation: 600 to 900 feet

Mean annual precipitation: 33 to 43 inches

Mean annual air temperature: 50 to 57 degrees F

Frost-free period: 175 to 220 days

Farmland classification: All areas are prime farmland

Map Unit Composition

Udarents and similar soils: 41 percent

Urban land: 39 percent

Sampsel and similar soils: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Udarents

Setting

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Crest

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Mine spoil or earthy fill

Typical profile

C1 - 0 to 5 inches: silt loam

C2 - 5 to 80 inches: silty clay loam

Properties and qualities

Slope: 2 to 5 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Somewhat poorly drained

Runoff class: Very high

Capacity of the most limiting layer to transmit water (Ksat):

Moderately low to moderately high (0.14 to 0.57 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water storage in profile: Moderate (about 9.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 6e

Hydrologic Soil Group: C

Ecological site: Deep Loess Upland Prairie (R107BY002MO)

Other vegetative classification: Mixed/Transitional (Mixed Native Vegetation)

Hydric soil rating: No

Description of Urban Land

Setting

Landform: Interfluves

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Interfluve

Across-slope shape: Convex

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 8

Hydric soil rating: No

Description of Sampsel

Setting

Landform: Hillslopes

Landform position (two-dimensional): Footslope

Landform position (three-dimensional): Base slope

Down-slope shape: Concave

Across-slope shape: Convex

Parent material: Residuum weathered from shale

Typical profile

Ap - 0 to 13 inches: silty clay loam

Bt - 13 to 80 inches: silty clay

Properties and qualities

Slope: 2 to 5 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Somewhat poorly drained

Runoff class: Very high

Capacity of the most limiting layer to transmit water (Ksat):

Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: About 0 to 18 inches

Frequency of flooding: None

Frequency of ponding: None

Salinity, maximum in profile: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water storage in profile: Moderate (about 8.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: C/D

Ecological site: Wet Footslope Prairie (R112XY041MO)

Other vegetative classification: Grass/Prairie (Herbaceous Vegetation)

Appendix D

Drainage and Detention Calculations

SHEET REVISED PER AS-BUILT CONDITIONS (FEBRUARY 2020)

MID CONTINENT PUBLIC LIBRARY - EAST LEE'S SUMMIT BRANCH
DETENTION BASIN STAGE DISCHARGE
11-Apr-19

STAGE	ELEV	TOTAL DISCHARGE	18" OUTLET PIPE FROM STRUCTURE WSE FOR DESIGN RELEASE RATE		FLOW AND ELEVATION AT OUTLET CONTROL PLATE			24" INLET PIPE FROM POND TO STRUCTURE WSE FOR DESIGN RELEASE RATE		REMARK
					FLOW THROUGH 1" PERF HOLES	FLOW THROUGH WEIR	WSE			
	elev ft	cfs	cfs	elev ft	cfs	cfs	elev ft	cfs	elev ft	
0	1003.30	0	0	1003.38	0	0	1003.30	0	1006.7	INVERT OF OUTLET STRUCTURE
+0.70	1004.00	0.03	0.03	1003.46	0.03	0	1004.00	0.03	1006.78	
+1.70	1005.00	0.11	0.11	1003.91	0.11	0	1005.00	0.11	1006.86	
+2.70	1006.00	0.22	0.22	1003.9	0.22	0	1006.00	0.22	1006.88	
+3.70	1007.00	0.34	0.34	1003.91	0.34	0	1007.00	0.34	1007.23	
+4.70	1008.00	0.49	0.49	1003.91	0.49	0	1008.00	0.49	1007.54	
+5.10	1008.40	0.56	0.56	1003.93	0.56	0	1008.40	0.56	1008.35	BOTTOM OF WEIR
+5.69	1008.99	2.2	2.2	1004.06	0.92	1.28	1008.98	2.2	1008.99	2-Yr WSE
+5.70	1009.00	2.32	2.32	1004.48	0.65	1.67	1008.99	2.32	1009	
+6.13	1009.43	5.5	5.5	1004.62	0.98	4.52	1009.36	5.5	1009.43	10-Yr WSE
+6.70	1010.00	12.2	12.2	1006.56	1.02	11.18	1009.69	12.2	1010	
+7.02	1010.32	13.4	13.4	1006.26	1.08	12.32	1009.92	13.4	1010.32	100-Yr WSE
+7.70	1011.00	19.9	19.9	1008.35	1.11	18.79	1010.13	19.9	1011	

REVISED PER AS-BUILT INFORMATION AND PROPOSED MODIFICATIONS TO THE WEIR/ORIFICE PLATE (FEB 2020)

STAGE	ELEV	TOTAL DISCHARGE	18" OUTLET PIPE FROM STRUCTURE WSE FOR DESIGN RELEASE RATE (CAPACITY)		FLOW AND ELEVATION AT			24" INLET PIPE FROM POND TO STRUCTURE WSE FOR DESIGN RELEASE RATE		REMARK
					FLOW THROUGH 1" PERF HOLES	FLOW THROUGH WEIR	WSE			
	elev ft	cfs	cfs	elev ft	cfs	cfs	elev ft	cfs	elev ft	
-	1003.30	-	-	-	-	-	-	-	-	
-	1004.00	-	-	-	-	-	-	-	-	
0	1005.30	END	0	1005.28	0	0	1005.28	0	1006.94 (IE)	INVERT OF OUTLET STRUCTURE
+0.70	1006.00	0.12	0.22 (2)	1005.36	0.12	0	1006.00	0.12	1007.03	
+1.70	1007.00	0.26	0.34 (8)	1005.44	0.26	0	1007.00	0.26	1007.11	
+2.70	1008.00	0.32	0.49 (12)	1003.48	0.32	0	1008.00	0.32	1007.13	
+3.10	1008.60	0.56	0.34	1003.56	0.56	0	1008.60	0.56	1007.21	BOTTOM OF WEIR
+3.70	1009.00	1.94	2.32 (15)	1005.81	0.56	1.38	1009.00	1.94	1009.03	
+3.74	1009.04	2.18	2.18	1005.84	0.67	1.51	1009.04	2.18	1009.06	2-Yr WSE
+3.90	1009.20	2.32	2.32	1005.98	0.69	1.63	1009.21	2.32	1009.27	BOTTOM OF WEIR
+4.13	1009.47	5.2	5.2	1006.16	0.92	4.28	1009.52	5.2	1009.63	10-Yr WSE
+4.70	1010.00	12.1	12.1 (17)	1006.60	0.95	11.15	1009.55	12.1	1010.00	
+5.02	1010.33	13.4	13.4	1006.26	0.98	12.42	1010.21	13.4	1010.55	100-Yr WSE
+5.70	1011.00	19.9	19.9 (20)	1008.35	1.02	18.88	1010.13	19.9	1011.00	

MCPL EAST LEE'S SUMMIT INFLOW HYDROGRAPH - 2 YEAR


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Wednesday, 02 / 13 / 2019

Hyd. No. 1

ELS MCPL

Hydrograph type	= SCS Runoff	Peak discharge	= 13.72 cfs
Storm frequency	= 2 yrs	Time to peak	= 11.93 hrs
Time interval	= 2 min	Hyd. volume	= 27,834 cuft
Drainage area	= 4.500 ac	Curve number	= 90
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 5.00 min
Total precip.	= 3.27 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

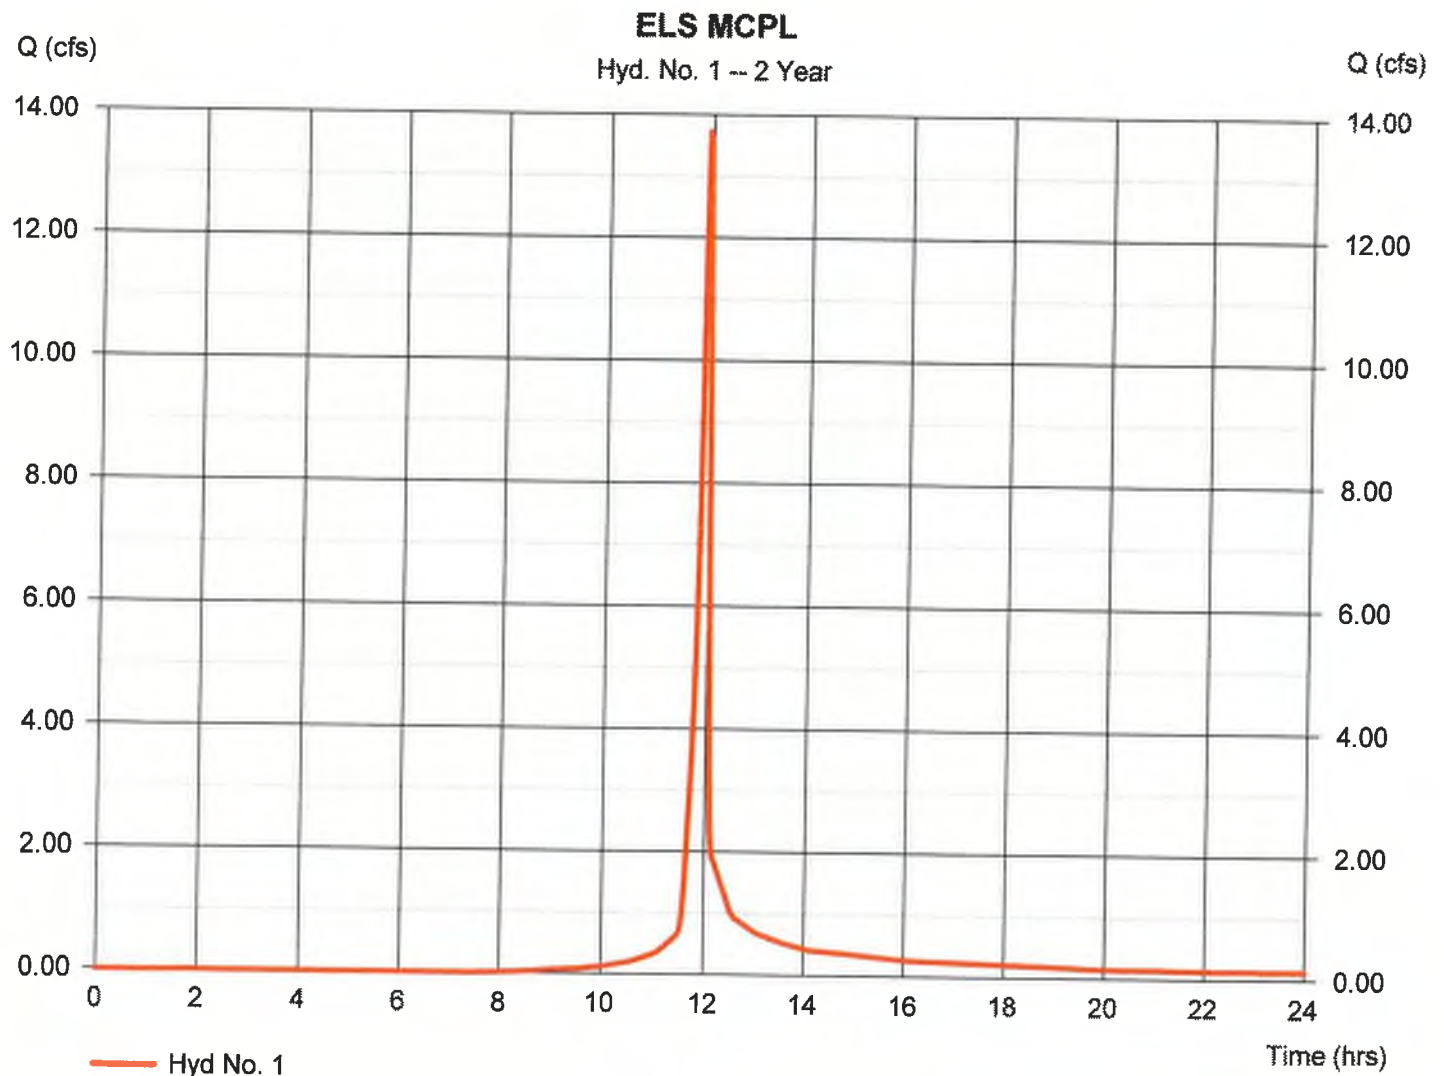

MCPL EAST LEE'S SUMMIT
INFLOW HYDROGRAPH - 10 YEAR


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Wednesday, 02 / 13 / 2019

Hyd. No. 1

ELS MCPL

Hydrograph type	= SCS Runoff	Peak discharge	= 21.11 cfs
Storm frequency	= 10 yrs	Time to peak	= 11.93 hrs
Time interval	= 2 min	Hyd. volume	= 43,436 cuft
Drainage area	= 4.500 ac	Curve number	= 90
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 5.00 min
Total precip.	= 4.42 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

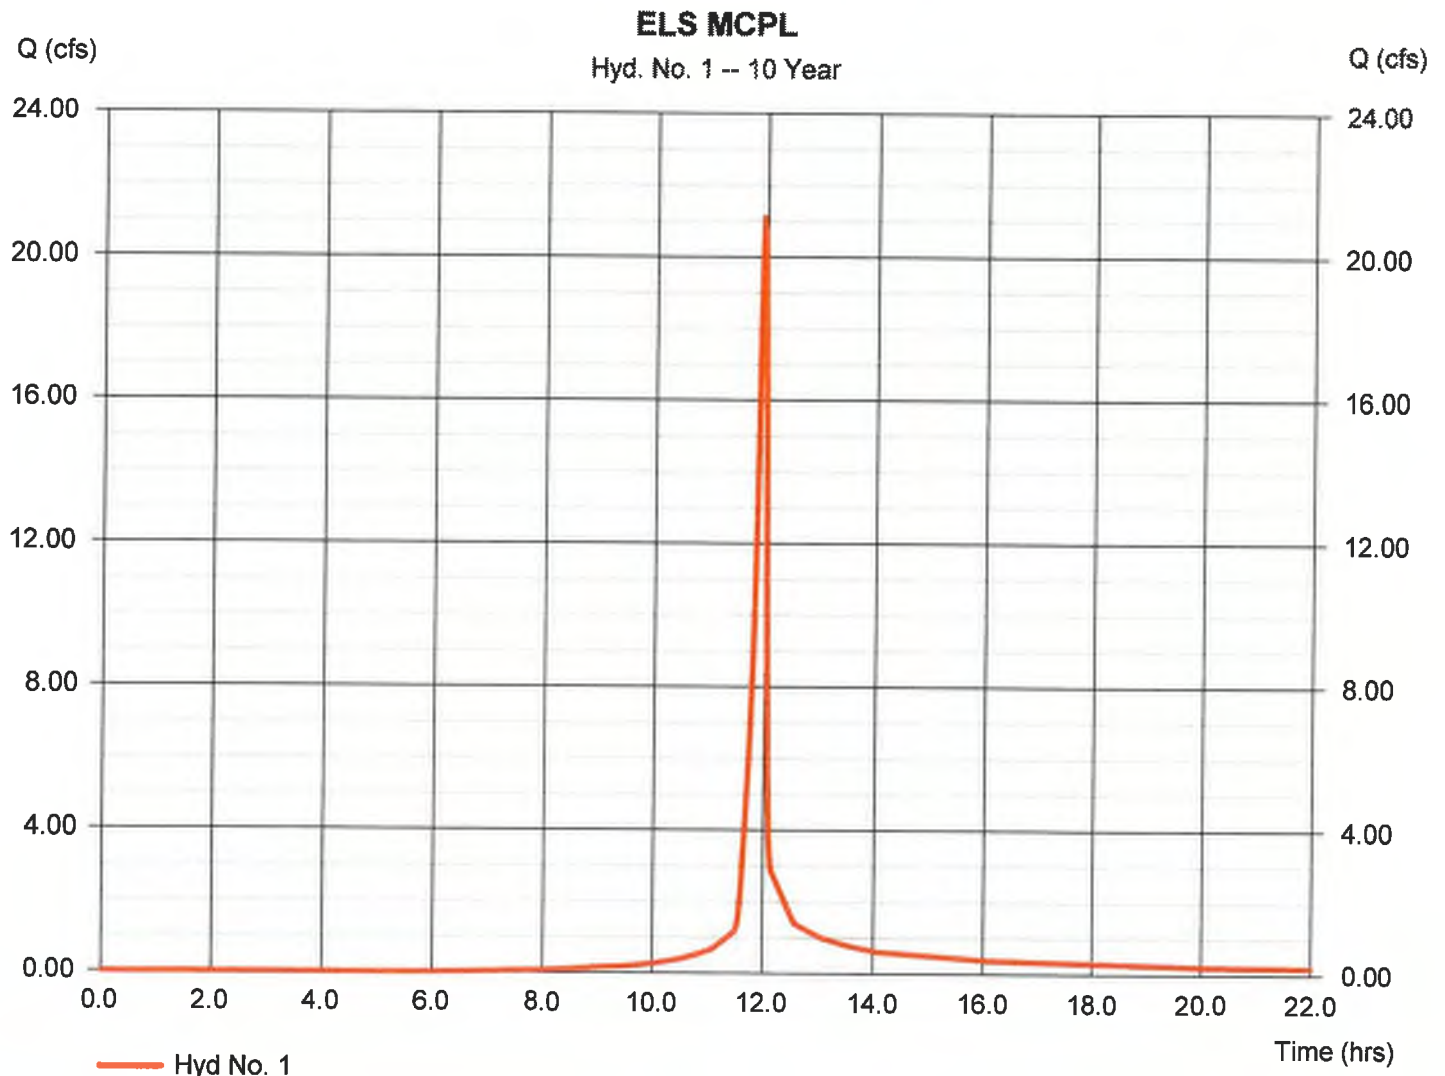

MCPL EAST LEE'S SUMMIT INFLOW HYDROGRAPH - 100 YEAR


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Wednesday, 02 / 13 / 2019

Hyd. No. 1

ELS MCPL

Hydrograph type	= SCS Runoff	Peak discharge	= 33.45 cfs
Storm frequency	= 100 yrs	Time to peak	= 11.93 hrs
Time interval	= 2 min	Hyd. volume	= 70,523 cuft
Drainage area	= 4.500 ac	Curve number	= 90
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= User	Time of conc. (Tc)	= 5.00 min
Total precip.	= 6.32 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

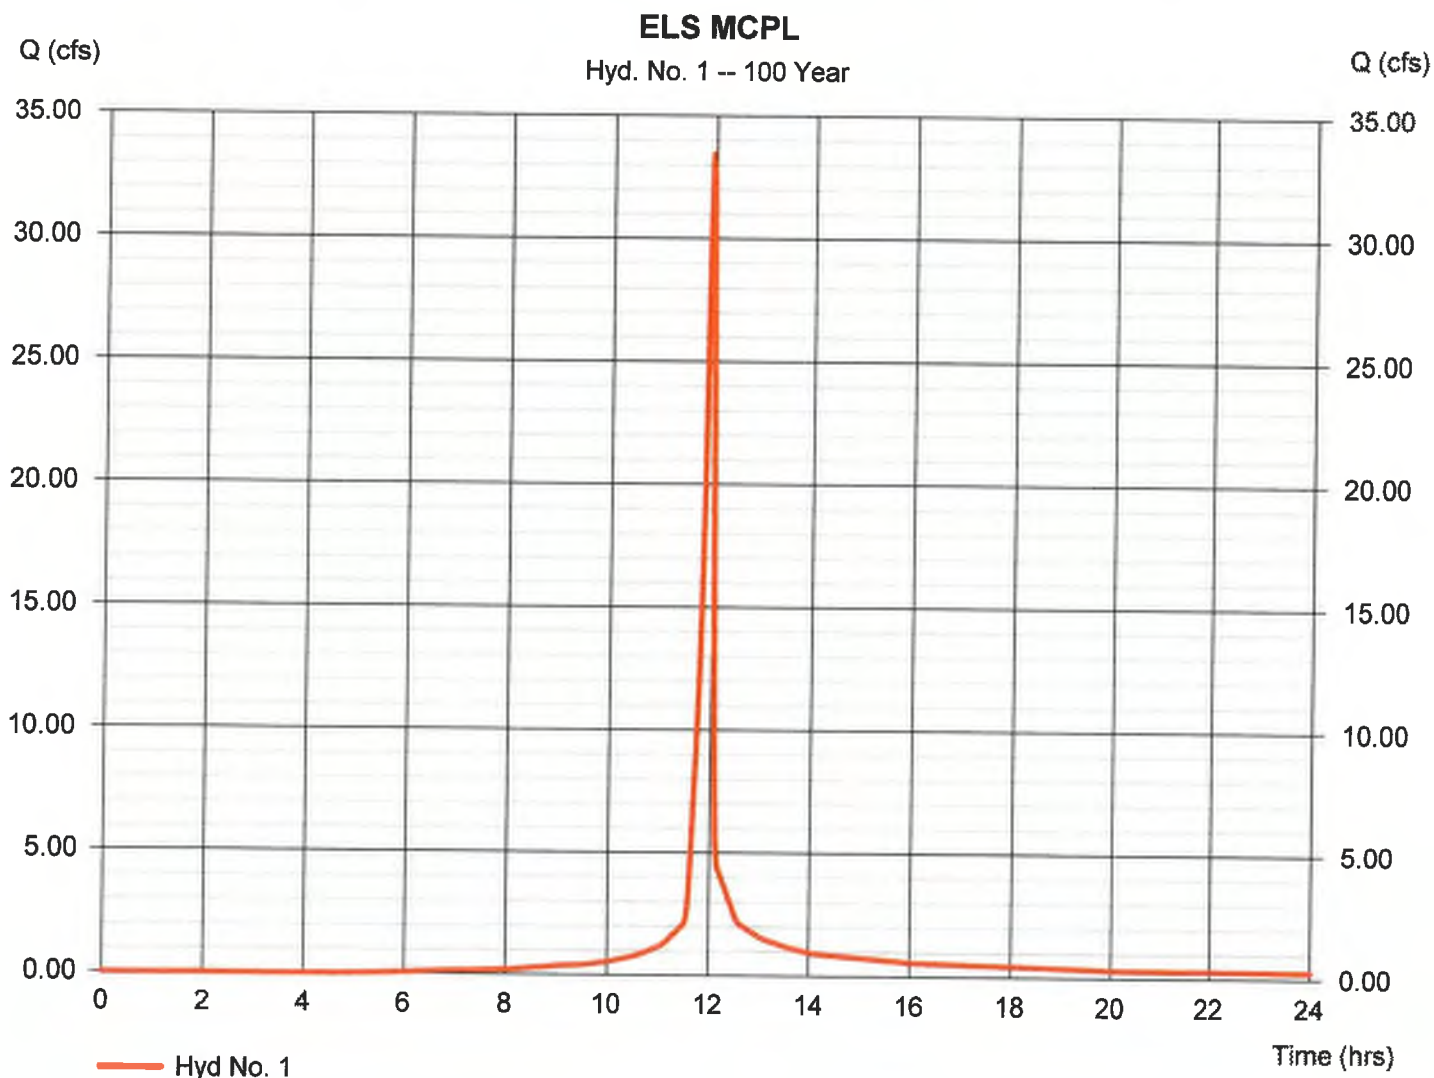

Hydrograph Report


Hyd. No. 2

MCPL- ELS-POND

Hydrograph type	= Reservoir	Peak discharge	= 2.142 cfs
Storm frequency	= 2 yrs	Time to peak	= 12.13 hrs
Time interval	= 1 min	Hyd. volume	= 29,122 cuft
Inflow hyd. No.	= 1 - MCPL - ELS	Max. Elevation	= 1008.98 ft
Reservoir name	= Dry Bottom Pond	Max. Storage	= 11,845 cuft

Storage Indication method used.

WSE 1008.99 AT 24"
INLET PIPE

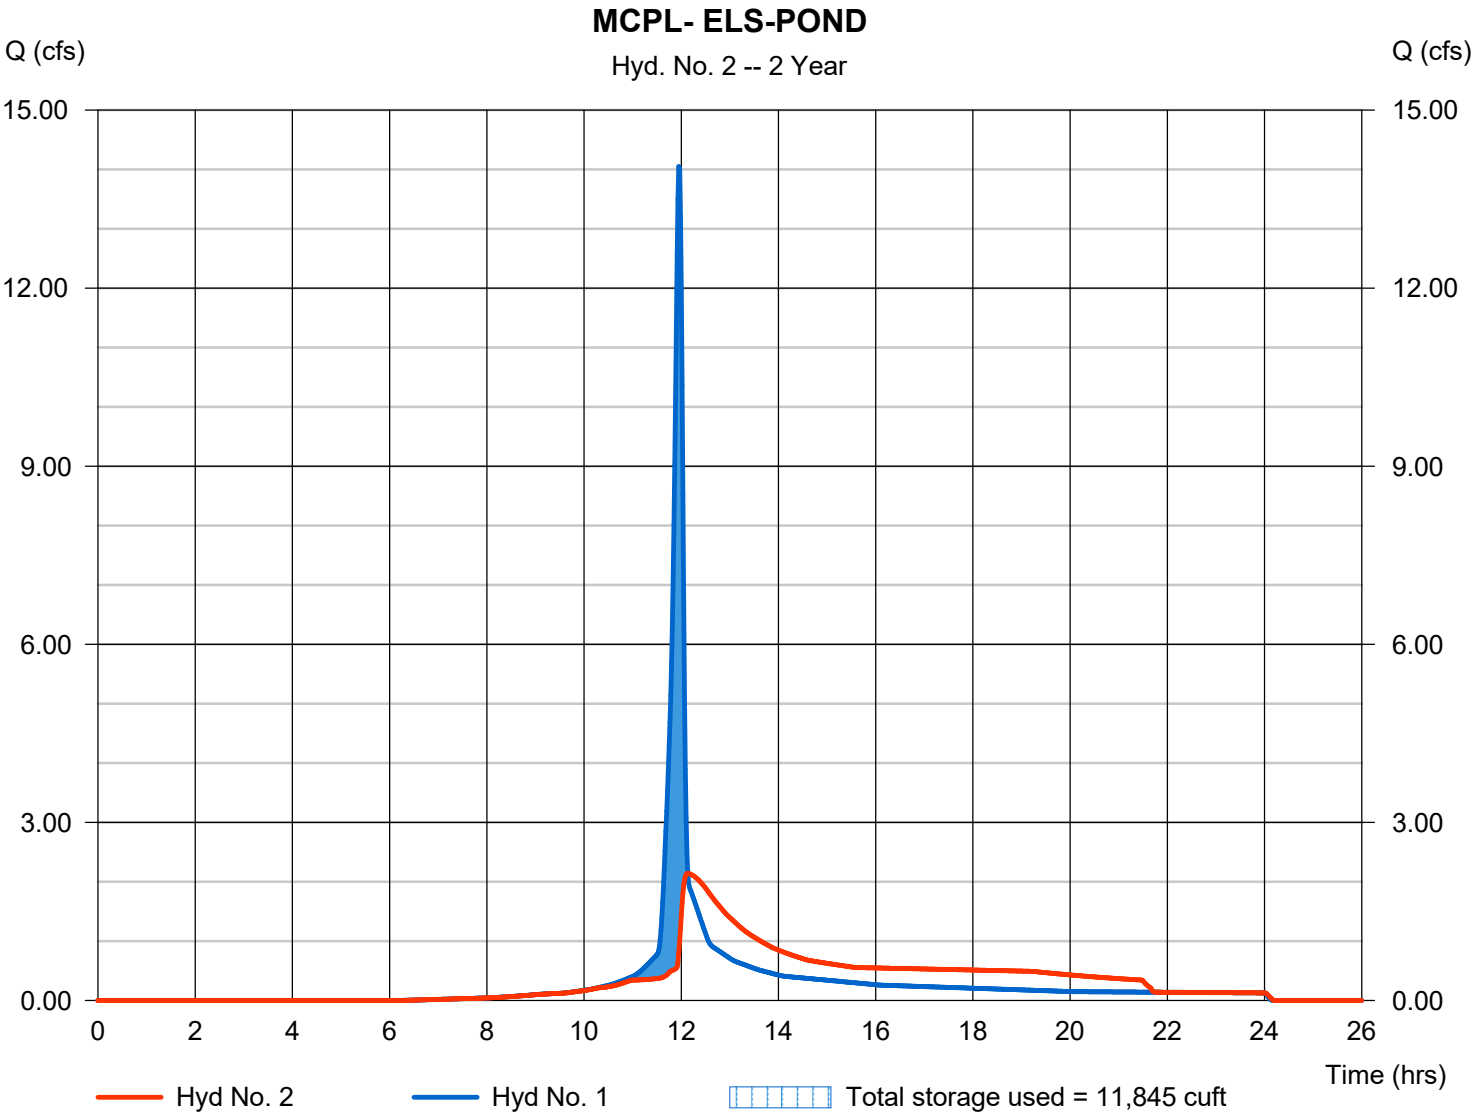

Hydrograph Report


Hyd. No. 2

MCPL- ELS-POND

Hydrograph type	= Reservoir	Peak discharge	= 5.474 cfs
Storm frequency	= 10 yrs	Time to peak	= 12.08 hrs
Time interval	= 1 min	Hyd. volume	= 45,193 cuft
Inflow hyd. No.	= 1 - MCPL - ELS	Max. Elevation	= 1009.36 ft
Reservoir name	= Dry Bottom Pond	Max. Storage	= 18,066 cuft

Storage Indication method used.

WSE 1009.43 AT 24"
INLET PIPE

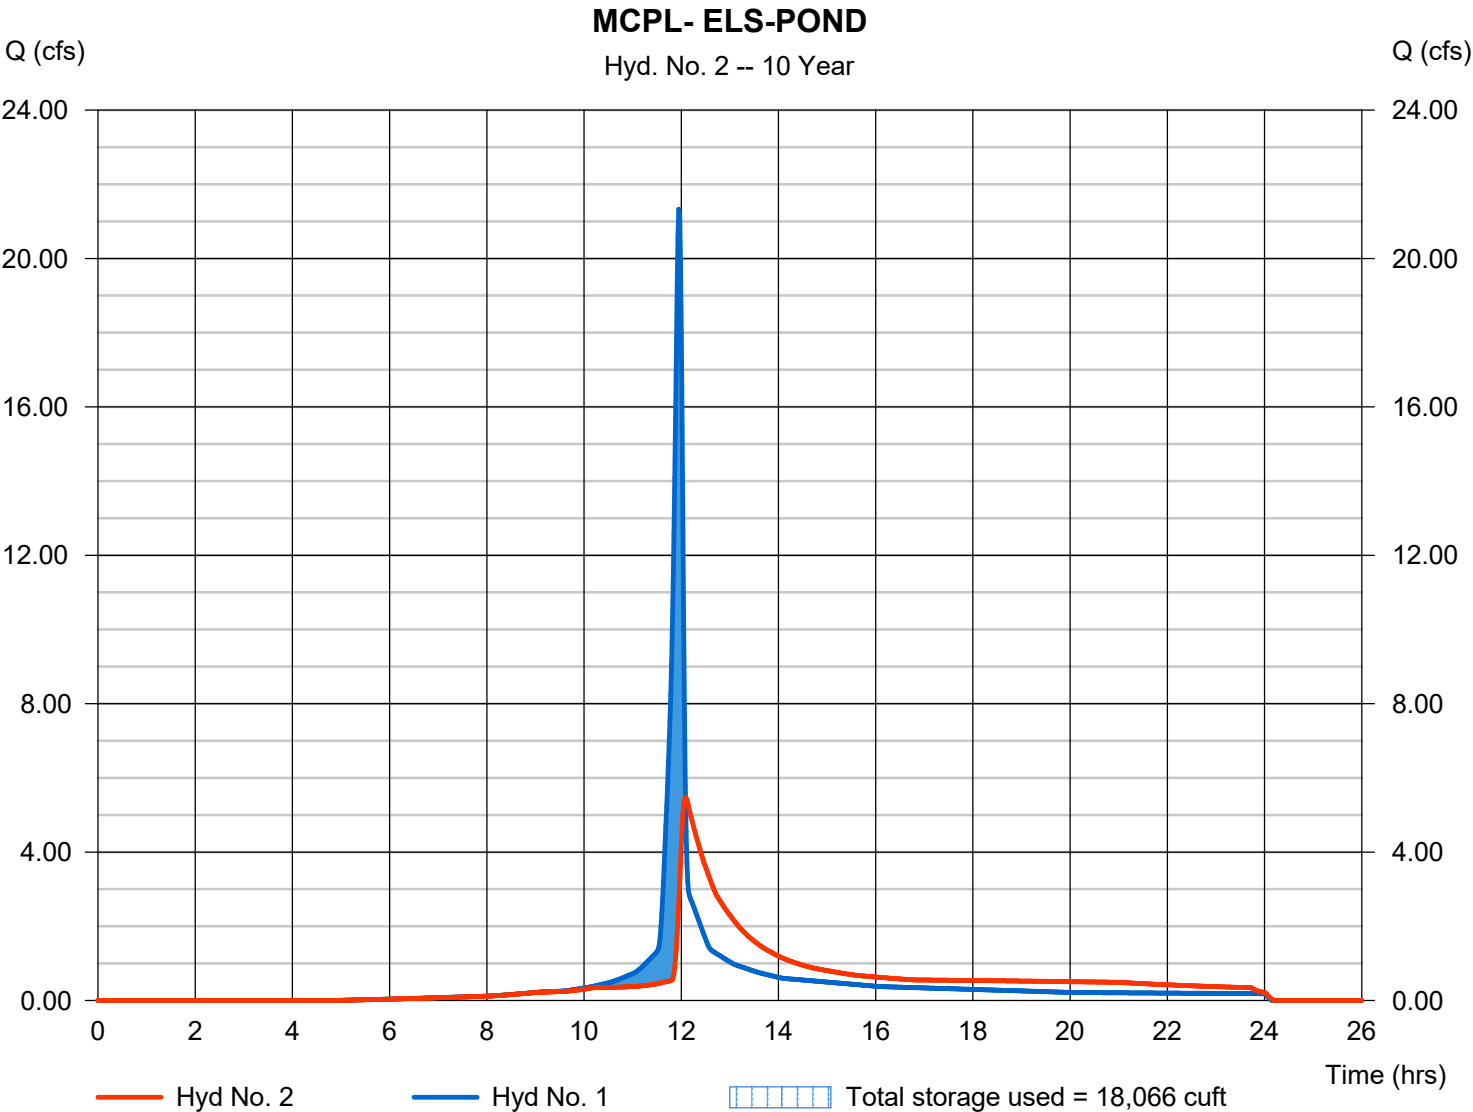

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® 2019 by Autodesk, Inc. v2020

Tuesday, 04 / 16 / 2019


Hyd. No. 2

MCPL- ELS-POND


Hydrograph type	= Reservoir	Peak discharge	= 13.39 cfs
Storm frequency	= 100 yrs	Time to peak	= 12.07 hrs
Time interval	= 1 min	Hyd. volume	= 72,628 cuft
Inflow hyd. No.	= 1 - MCPL - ELS	Max. Elevation	= 1009.92 ft
Reservoir name	= Dry Bottom Pond	Max. Storage	= 27,267 cuft

Storage Indication method used.

WSE 1010.32 AT 24"
INLET PIPE

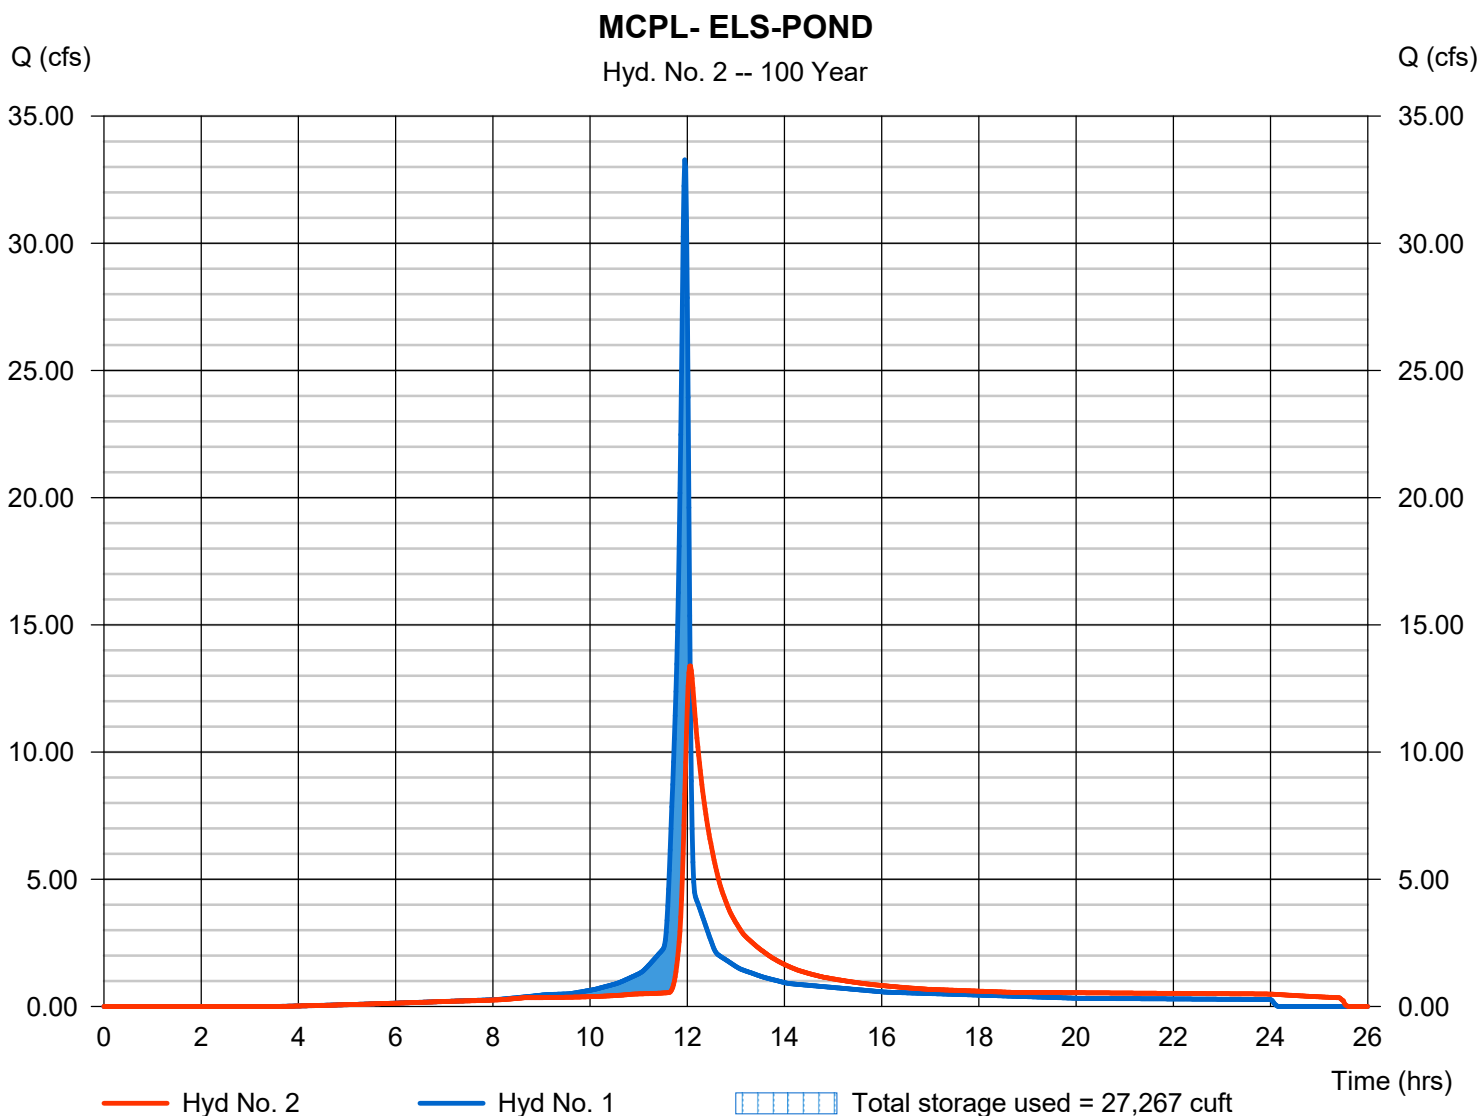

*MCPL EAST LEES SUMMIT BRANCH
STAGE STORAGE CURVE
DESIGN VS AS-BUILT*

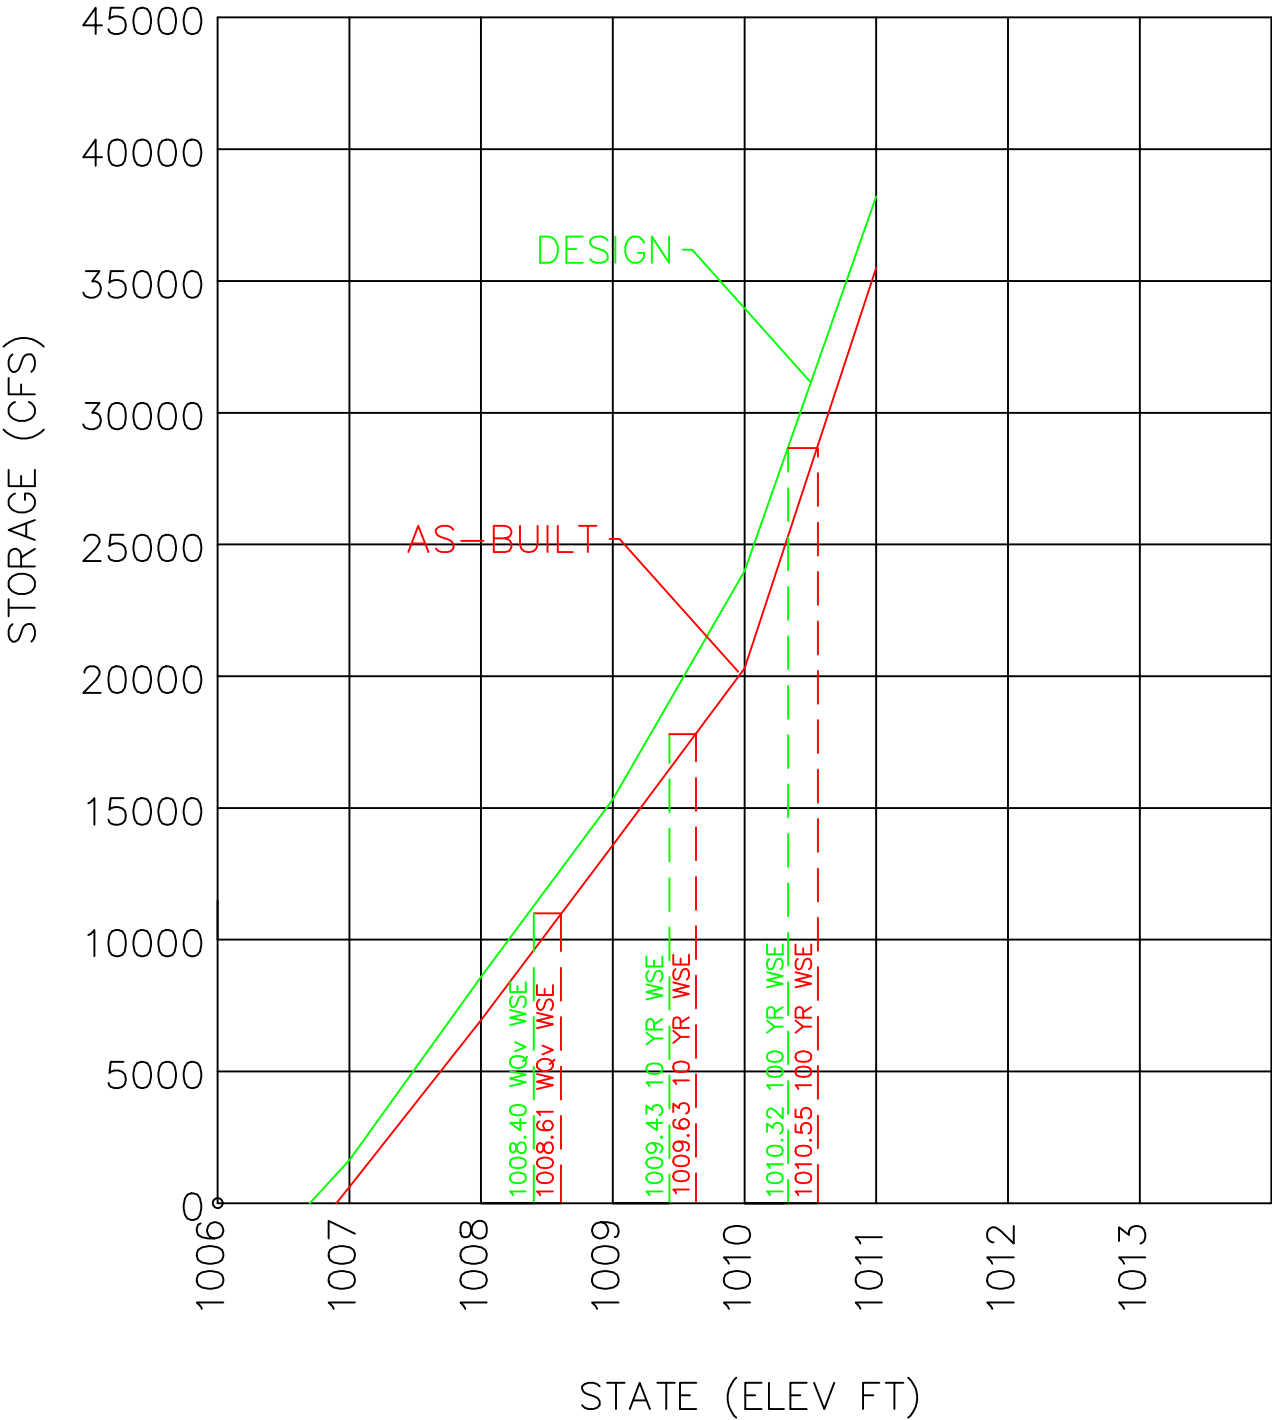

Appendix E

Water Treatment Calculations

Design Procedure Form: Extended Dry Detention Basin (EDDB)
Main Worksheet - EDD-1

Project: MCPL East Lee's Summit
Location: Lee's Summit
Designer: TMP

Date: 01/18/2019
Company: Olsson
Checked: LWM

I. Basin Water Quality Volume

Step 1: Tributary area to EDDB, A_T (ac.) A_T (ac) = 4.50

Step 2: Calculate WQ_V using methodology in Section 6 WQ_V (ac-ft) = 0.29

Step 3: Add 20 percent to account for silt and sediment deposition in the basin V_{DESIGN} (ac-ft) = 0.34

14911.83

Ila. Water Quality Outlet Type

Step 1: Set water quality outlet type: Outlet Type = 2

Type 1 = Single Orifice
Type 2 = Perforated Riser or Plate
Type 3 = V-Notch Weir

Step 2: Proceed to part IIb, IIc, or IId based on water quality outlet type selected

IIb. Water Quality Pool Outlet, Single Orifice

Step 1: Depth of water quality volume at outlet, Z_{WQ} (ft) Z_{WQ} (ft) = 2.40

Step 2: Average head of water quality volume over invert of orifice, H_{WQ} (ft) H_{WQ} (ft) = 1.20

$H_{WQ} = 0.5 * Z_{WQ}$

Step 3: Average water quality outflow rate, Q_{WQ} (cfs) Q_{WQ} (cfs) = 0.09

$Q_{WQ} = (WQ_V * 43,560) / (40 * 3,600)$

Step 4: Set value of orifice discharge coefficient, C_O C_O = 0.66

$C_O = 0.66$ when thickness of riser/weir plate is = or < orifice diameter
 $C_O = 0.80$ when thickness of riser/weir plate is > orifice diameter

Step 5: Water quality outlet orifice diameter (minimum of 1/2 inch), D_O (in) D_O (in) = 1.65

$D_O = 12 * 2 * (Q_{WQ} / (C_O * p * (2 * g * H_{WQ})^{0.5}))^{0.5}$
(if orifice diameter < 4 inches use outlet type 2 or 3)

Step 6: To size outlet orifice for EDDB with an irregular stage-volume relationship use the Single Orifice Worksheet

Design Procedure Form: Extended Dry Detention Basin (EDDB)
Main Worksheet

Project: MCPL East Lee's Summit
 Location: Lee's Summit
 Designer: TMP

Date: 01/18/2019
 Company: Olsson
 Checked: LWM

IIc. Water Quality Outlet, Peforated Riser (Continued)

Step 1: Depth of water quality volume at outlet, Z_{WQ} (ft) Z_{WQ} (ft) = 2.40

Step 2: Recommended maximum outlet area per row, A_O (in²) A_O (in²) = 0.57
 $A_O = WQ_V / (0.013 * Z_{WQ}^2 + 0.22 * Z_{WQ} - 0.10)$

Step 3: Circular perforation diameter per row assuming a single column, D_I (in) D_I (in) = 1.00
 Use 1"

Step 4: Numbers of columns, n_c n_c = 1.00

Step 5: Design circular perforation diameter (from 1 to 2 inches), D_{Perf} (in) D_{Perf} (in) = 1.00

Step 6: Horizontal peforation column spacing when $n_c > 1$, center to center, S_c S_c = NA
 If D_{Perf} is not $> \text{or} = 1$, $S_c = 4$

Step 7: Number of rows, 4" vertical spacing between perforations, center to center, n_r = 7

IIc. Water Quality Outlet, V-Notch Weir

Step 1: Depth of water quality volume above permanent pool, Z_{WQ} (ft) Z_{WQ} (ft) = NA

Step 2: Average head of water quality pool volume over invert of v-notch H_{WQ} (ft) H_{WQ} (ft) = NA
 $H_{WQ} = 0.5 * Z_{WQ}$

Step 3: Average water quality pool outflow rate, Q_{WQ} (cfs) Q_{WQ} (cfs) = NA
 $Q_{WQ} = (WQ_V * 43,560) / (40 * 3,600)$

Step 4: V-notch weir coefficient, C_v C_v = NA

Step 5: V-notch weir angle, q (deg) q (deg) = NA
 $\theta = 2 * (180 / \pi) * \arctan(Q_{WQ} / (C_v * H_{WQ}^{5.2}))$
 V-notch angle should be at least 20 degrees. Set to 20 degrees if calculated angle is smaller.

Step 6: V-notch weir top width, W_v (ft) W_v (ft) = NA
 $W_v = 2 * Z_{WQ} * \tan(\theta/2)$

Step 7: To calculate v-notch angle for EDW with an irregular stage-volume relationship, use the V-notch Weir Worksheet

Design Procedure Form: Extended Dry Detention Basin (EDDB)
Main Worksheet

Project: MCPL East Lee's Summit
Location: Lee's Summit
Designer: TMP

Date: 01/18/2019
Company: Olsson
Checked: LWM

III. Flood Control

Refer to APWA Specifications Section 5608

IV. Trash Racks

Step 1: Total outlet area, A_{ot} (in²) A_{ot} (in²) = 5.46

Step 2: Required trash rack open area, A_t (in²) A_t (in²) = 60.83

$A_t = A_{ot} * 77 * e^{(-0.124 * D)}$ for single orifice outlet

$A_t = (A_{ot} / 2) * 77 * e^{(-0.124 * D)}$ for orifice plate or perforated riser outlet

$A_t = 4 * A_{ot}$ for v-notch weir outlet

V. Basin Shape

Step 1: Length to width ratio should be at least 3:1 (L:W) wherever practicable (L:W) = 10:1 Plus

Step 2: Low flow channel side lining Concrete: Yes
Soil/Riprap: NA
No low flow channel: NA

Step 3: Top stage floor drainage slope (toward low flow channel), S_{TS} (%) S_{TS} (%) = 2.00
Top stage depth, D_{TS} (ft) D_{TS} (ft) = 5.00

Step 4: Bottom stage volume, V_{BS} (ac-ft) V_{BS} (% of WQ_V) = 0.33
 V_{BS} (ac-ft) = 1.03

VI. Forebay (Optional)

Step 1: Volume should be greater than 10% of WQ_V Min Vol_{FB} (ac-ft) = NA

Step 2: Forebay depth, Z_{FB} (ft) Z_{FB} (ft) = NA

Step 3: Forebay surface area, A_{FB} (ac) A_{FB} (ac) = NA

Step 2: Paved/hard bottom and sides? NA