

SECTION 23, TOWNSHIP 47 N, RANGE 32 W
IN LEE'S SUMMIT, JACKSON COUNTY, MISSOURI



☐ NOT FOR CONSTRUCTION

☒ REVIEWED FOR CONSTRUCTION



A tract of land in the Southeast Quarter of Section 23, Township 47 North, Range 32 West of the 5th Principal Meridian in Lee's Summit, Jackson County, Missouri being bounded and described by or under the direct supervision of Jason S Roudsbush, P.L.S. 2002014092 as follows: Commencing at the Southeast corner of said Southeast Quarter; thence North 02°45'34" East, on the East line of said Southeast Quarter, 2,635.08 feet to the Northeast corner of said Southeast Quarter; thence North 87°45'24" West, on the North line of said Southeast Quarter, 50.00 feet to the Southeast corner of Lot 3, EAGLE CREEK—FIRST PLAT, a subdivision in said Lee's Summit recorded as Instrument Number 110409 in Book 165 at Page 01 in Jackson County Recorder of Deeds Office, also being the Northwest corner of SW Pryor Road as described in the Right of Way Deed recorded as Instrument Number 200510087407 in said Jackson County Recorder of Deeds Office, also being Point of Beginning of the tract of land to be herein described; thence South 02°45'34" West, on the existing Westerly right-of-way line of said SW Pryor Road said Right of Way Deed, 1,220.74 feet; thence leaving said existing Westerly right-of-way line, North 87°00'50" West, 245.56 feet; thence North 02°59'10" East, 25.00 feet; thence North 87°00'50" West, 438.50 feet; thence North 60°49'13" West, 252.48 feet; thence North 67°11'53" West, 74.21 feet; thence North 27°18'12" East, 138.17 feet; thence Westerly, on a curve to the left, having an initial tangent bearing of North 62°41'48" West with a radius of 275.00 feet, a central angle of 11°57'16" and an arc distance of 57.38 feet; thence North 15°20'56" East, 50.00 feet; thence North 29°10'47" East, 375.17 feet; thence North 07°19'52" East, 64.17 feet; thence South 87°00'50" East, 126.12 feet; thence North 02°59'10" East, 116.00 feet; thence North 42°00'50" West, 19.80 feet; thence North 02°59'10" East, 50.00 feet; thence South 87°00'50" East, 36.00 feet; thence North 02°59'10" East, 277.38 feet to a point on the South line of said EAGLE CREEK—FIRST PLAT and said North line of said Southeast Quarter; thence South 87°45'24" East, on said South and said North line, 643.83 feet to the Point of Beginning. Containing 953,270 square feet or 21.88 acres, more or less.

REVIEWED BY:


CITY OF LEE'S SUMMIT

DATE _____

4/20/2020
DATE


JULIE E. SELLERS, P.E.
CIVIL ENGINEER
MO# PE-2017000367

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116

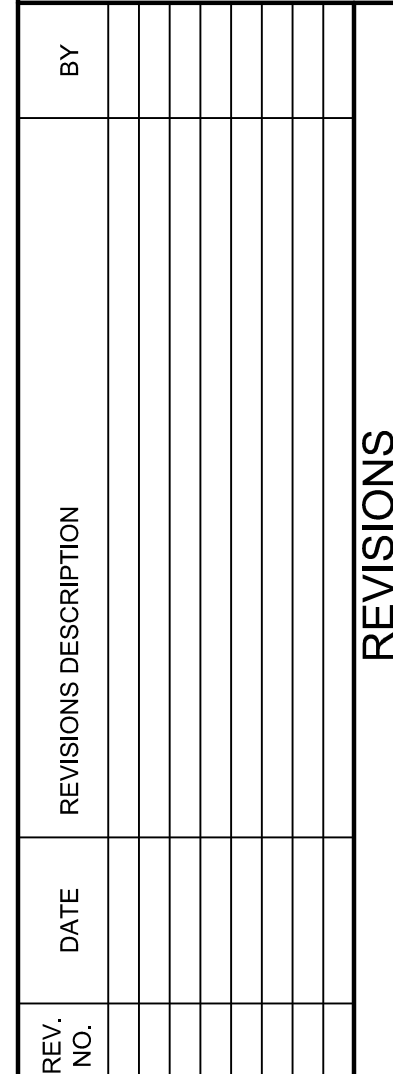

TITLE SHEET
STREET AND STORM SEWER PLANS

HOOK FARMS FIRST PLAT

LEE'S SUMMIT, MO

drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020

SHEET
C101

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheets\GNCV\Street and Storm Plans\VC_ITL01_0194061.dwg
DATE: Apr 20, 2020 1:55pm
XREFS: C_PBLK_0194061_34x22
USER: nhaiser

GENERAL NOTES

1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT THE PLANS IN THEIR POSSESSION ARE THE MOST CURRENT VERSION ISSUED, ARE FULLY COORDINATED WITH ALL SUBCONTRACTORS, AND PRESENT ON SITE AT ALL TIMES. CURRENT PLANS PREPARED BY OLSSON MAY BE OBTAINED AT THE DIRECTION OF OLSSON'S CLIENT. DIRECT REQUESTS TO OLSSON MAY REQUIRE ADDITIONAL AUTHORIZATIONS, AGREEMENTS, AND/OR FEES. PLEASE CONTACT THE ENGINEER FOR INFORMATION.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DEVIATIONS FROM THESE PLANS UNLESS WRITTEN APPROVAL FROM ENGINEER, OWNER, AND DEVELOPER.
3. ALL WORK AND MATERIALS SHALL BE SUBJECT TO INSPECTION AND APPROVAL BY THE OWNER OR THE OWNER'S REPRESENTATIVE.
4. ALL ESTIMATES OF QUANTITIES ARE FOR INFORMATIONAL PURPOSES ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING QUANTITIES AND ITEMS OF WORK.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL LABOR, MATERIALS, AND EQUIPMENT REQUIRED TO COMPLETE THE WORK SHOWN IN THE PLANS.
6. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL REQUIRED PERMITS, PAYING ALL FEES, AND FOR OTHERWISE COMPLYING WITH ALL APPLICABLE REGULATIONS GOVERNING THE WORK.
7. THE CONTRACTOR SHALL NOT ENGAGE IN ACTIVITIES THAT MAY ENCROACH ON WATERS OF THE U.S., INCLUDING WETLANDS, UNTIL ANY NECESSARY PERMITS MAY BE OBTAINED. THE CONTRACTOR SHALL REVIEW AND COMPLY WITH ALL CONDITIONS DESCRIBED IN THE PERMIT.
8. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, THE SAFETY OF ALL PERSONS INCLUDING VISITORS AND THE GENERAL PUBLIC, AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY THROUGHOUT THE PROJECT AND NOT BE LIMITED BY WORKING HOURS. ANY CONSTRUCTION OBSERVATION BY THE ENGINEER OF THE CONTRACTOR'S PERFORMANCE IS NOT INTENDED TO INCLUDE REVIEW OF THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES.
9. PRIOR TO COMMENCEMENT OF WORK THE CONTRACTOR SHALL NOTIFY AND COORDINATE WITH ALL UTILITY COMPANIES AND OBTAIN ANY RELEVANT INFORMATION. NOTIFY ENGINEER OF ANY DISCREPANCIES.
10. THE CONTRACTOR IS RESPONSIBLE FOR THE PROTECTION OF ALL BOUNDARY CORNERS AND SECTION CORNERS. ANY BOUNDARY CORNER AND/OR SECTION CORNER DISTURBED OR DAMAGED BY CONSTRUCTION ACTIVITIES SHALL BE RESET BY A LAND SURVEYOR LICENSED IN THE STATE OF MISSOURI, AT THE CONTRACTOR'S EXPENSE.
11. THE CONTRACTOR IS RESPONSIBLE FOR THE PROTECTION OF ADJACENT PROPERTIES AND SHALL TAKE ALL PRECAUTIONS NECESSARY TO PREVENT DAMAGE DURING CONSTRUCTION. THE CONTRACTOR IS ALSO RESPONSIBLE FOR REPAIRING ANY DAMAGE RESULTING FROM CONSTRUCTION ACTIVITIES.
12. PRIOR TO MOVING OFF THE JOB THE CONTRACTOR SHALL NOTIFY THE OWNER AND ENGINEER TO PERFORM A FINAL WALK-THROUGH OF THE CONSTRUCTION SITE.

REFERENCES

1. ARCHITECTURAL AND STRUCTURAL ELEMENTS SHOWN IN THESE PLANS ARE FOR REFERENCE ONLY. CONTRACTORS AND SURVEYORS SHALL REFERENCE THEIR RESPECTIVE PLANS FOR DESIGN INFORMATION.
2. THE CONTRACTOR SHALL ADHERE TO THE SITE PREPARATION AND STRUCTURAL FILL RECOMMENDATIONS IN THE GEOTECHNICAL REPORT AS PROVIDED BY THE GEOTECHNICAL ENGINEER INCLUDING ALL CURRENT ADDENDUMS. THE STANDARDS AND SPECIFICATIONS OF LEE'S SUMMIT, MISSOURI SHALL ALSO APPLY AND TAKE PRECEDENCE WHEN STRICTER THAN THE GEOTECHNICAL REPORT OR WHEN NO GEOTECHNICAL REPORT IS GIVEN.
3. UNLESS EXPLICITLY DESCRIBED OTHERWISE WITHIN THESE PLANS THE FOLLOWING SHALL APPLY:
 - A. ALL CONSTRUCTION, INCLUDING THOSE LISTED BELOW, SHALL CONFORM TO THE LATEST CODES AND ORDINANCES OF LEE'S SUMMIT, MISSOURI.
 - B. ALL CONSTRUCTION IN MISSOURI DEPARTMENT OF TRANSPORTATION RIGHT-OF-WAY SHALL CONFORM TO THE LATEST SPECIFICATIONS ADOPTED BY U.S. DEPARTMENT OF TRANSPORTATION AND MISSOURI DEPARTMENT OF TRANSPORTATION.
 - C. ALL TRAFFIC CONTROL SIGNAGE SHALL CONFORM WITH THE CURRENT EDITION OF THE MANUAL FOR UNIFORM TRAFFIC CONTROL DEVICES (MUTCD).
 - D. ALL UTILITY EXTENSIONS AND CONSTRUCTION SHALL CONFORM TO THE STANDARDS AND SPECIFICATIONS OF THE UTILITY COMPANIES..
 - E. ALL EXTERIOR PAVEMENT (PCC, ASPHALT, ETC.) SHALL BE IN CONFORMANCE WITH THE SPECIFICATIONS OF LEE'S SUMMIT, MISSOURI AND THE RECOMMENDATIONS OF THE GEOTECHNICAL REPORT.
4. THE CONTRACTOR IS RESPONSIBLE FOR CONTACTING THE DELIVERY MANAGER AND COORDINATING ANY MAILBOXES THAT MAY BE DISTURBED. FAILURE TO DO SO MAY SUBJECT THE CONTRACTOR TO PROSECUTION BY THE FEDERAL GOVERNMENT.

EXISTING CONDITIONS

1. THE CONTRACTOR SHALL VISIT THE SITE AND BECOME FAMILIAR WITH THE EXISTING CONDITIONS OF THE PROJECT AREA.
2. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PERFORMING THEIR OWN INVESTIGATIONS AND MAKING THEIR OWN ASSUMPTIONS REGARDING SITE SURFACE AND SUBSURFACE CONDITIONS. THIS INCLUDES THE LOCATION AND CONSISTENCY OF ANY EXISTING ROCK LAYERS UNDERLYING THE PROJECT SITE. CONTACT THE ENGINEER REGARDING ANY DISCREPANCIES THAT MAY AFFECT THE ABILITY TO CONSTRUCT FROM THESE PLANS AS DESIGNED.
3. EXISTING CONDITIONS WERE DETERMINED THROUGH A VARIETY OF METHODS THAT MAY INCLUDE SURVEY, AERIAL IMAGERY, AVAILABLE RECORDS, GIS DATA, ETC. SUBSURFACE CONDITIONS ARE APPROXIMATE AND MAY NOT INCLUDE ALL UTILITIES AND OTHER SITE IMPROVEMENTS PRESENT ON SITE. THE CONTRACTOR SHALL MAKE EXPLORATION EXCAVATIONS AND LOCATE EXISTING UNDERGROUND UTILITIES SUFFICIENTLY AHEAD OF CONSTRUCTION TO PERMIT REVISIONS TO PLANS WHEN CONFLICTS AND DISCREPANCIES ARE FOUND.

CONSTRUCTION

1. THE CONTRACTOR SHALL INSTALL TRAFFIC CONTROL WHILE WORKING IN THE PUBLIC RIGHT-OF-WAY AS SHOWN IN THESE PLANS. IF PLANS ARE NOT PROVIDED, CONTRACTOR SHALL COORDINATE AND PROVIDE CONTROLS TO THE SATISFACTION OF THE RIGHT-OF-WAY OWNER.
2. THE CONTRACTOR SHALL PROTECT ALL TREES OVER 3" CALIPER FROM DAMAGE. NO TREE SHALL BE REMOVED WITHOUT PERMISSION OF THE OWNER, UNLESS SHOWN OTHERWISE ON THESE PLANS.
3. IN ADDITION TO THE CONDITIONS OF THE GEOTECHNICAL REPORT AND AS A MINIMUM THE CONTRACTOR SHALL PERFORM THE GRADING AS FOLLOWS:
 - A. THE CONSTRUCTION AREA SHALL BE CLEARED, GRUBBED, AND STRIPPED OF TOPSOIL AND ORGANIC MATTER FROM ALL AREAS TO BE OCCUPIED BY BUILDING AND PAVING. STRIPPING EXISTING TOPSOIL AND ORGANIC MATTER SHALL BE TO A MINIMUM DEPTH OF 6 INCHES. TOPSOIL FOR REPLACEMENT ON SLOPES MAY BE STOCKPILED ON SITE IN AREAS DESIGNATED BY THE OWNER. CONTRACTOR SHALL REMOVE EXCESS STRIPPINGS AND EXCESS EXCAVATION WITHIN 30 DAYS OF COMPLETION OF GRADING OPERATIONS.
 - B. AREAS TO RECEIVE FILL AND AREAS CUT TO SUBGRADE LEVEL SHALL BE SCARIFIED AND THE TOP 8-INCH DEPTH COMPACTED TO 95% STANDARD PROCTOR DENSITY. THE SUBGRADE SHALL BE PROOF ROLLED WITH A MODERATELY HEAVY LOADED DUMP TRUCK OR SIMILAR APPROVED CONSTRUCTION EQUIPMENT TO DETECT UNSUITABLE SOIL CONDITIONS. ANY UNSUITABLE AREAS SHALL BE UNDERCUT AND REPLACED WITH SUITABLE MATERIAL BEFORE ANY FILL MATERIAL CAN BE APPLIED.
 - C. FILL SHALL BE PLACED IN MAXIMUM OF 8 INCH LIFTS.
 - D. TOPSOIL SHALL BE PLACED TO A MINIMUM DEPTH OF 6 INCHES OVER ALL AREAS DISTURBED BY THE WORK. LARGE STONES, STICKS AND LUMPS SHALL BE REMOVED OR BROKEN UP, AND THE TOPSOIL SHALL BE LEVELED AND RAKED. ALL DISTURBED AREAS SHALL BE LANDSCAPED PER LANDSCAPE PLANS OR SHALL BE SEEDED, FERTILIZED, MULCHED, WATERED AND MAINTAINED UNTIL HARDY GRASS GROWTH IS ESTABLISHED.
 - E. CONTRACTOR SHALL PROVIDE COMPACTION TEST RESULTS AS REQUIRED.
4. THE CONTRACTOR SHALL DISPOSE ALL WASTE MATERIAL RESULTING FROM THE PROJECT OFF-SITE AND IN STRICT CONFORMANCE WITH ALL LOCAL CODES AND ORDINANCES.
5. ALL MANHOLES, CATCH BASINS, UTILITY VALVES AND METER PITS ARE TO BE ADJUSTED OR REBUILT TO GRADE AS REQUIRED. NOT ALL ADJUSTMENTS ARE INDICATED IN THE PLANS.
6. THE CONTRACTOR SHALL STREET SWEEP OR OTHERWISE CLEAN ALL ACCESS ROUTES TO THE SITE AT CONCLUSION OF THE PROJECT.

SHOP DRAWINGS

1. THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS A MINIMUM OF 7 DAYS PRIOR TO THE REQUESTED DATE OF APPROVAL. ENGINEER SHALL REVIEW SHOP DRAWINGS OR SAMPLES CONFORMANCE WITH THE DESIGN FOR THIS PROJECT AS DESCRIBED IN THE PLANS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ERRORS OR OMISSIONS IN SHOP DRAWINGS. THE ENGINEER'S REVIEW SHALL NOT EXTEND TO MEANS OR METHODS OF CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY VARIATION FROM THE REQUIREMENTS OF THE CONTRACT DOCUMENTS UNLESS CONTRACTOR HAS NOTIFIED ENGINEER OF EACH SUCH VARIATION AT THE TIME OF SUBMISSION, AND OBTAINED ENGINEER'S WRITTEN APPROVAL OF EACH SUCH VARIATION. PRIOR TO SUBMITTING EACH SHOP DRAWING OR SAMPLE, CONTRACTOR SHALL HAVE REVIEWED AND VERIFIED:
 - A. ALL FIELD MEASUREMENTS, QUANTITIES, DIMENSIONS, SPECIFIED PERFORMANCE CRITERIA, INSTALLATION REQUIREMENTS, MATERIALS, CATALOG NUMBERS AND SIMILAR INFORMATION WITH RESPECT THERETO;
 - B. ALL MATERIALS WITH RESPECT TO INTENDED USE, FABRICATION, SHIPPING, HANDLING, STORAGE, ASSEMBLY AND INSTALLATION PERTAINING TO THE PERFORMANCE OF THE WORK;
 - C. ALL INFORMATION RELATIVE TO MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES OF CONSTRUCTION AND SAFETY PRECAUTIONS AND PROGRAMS INCIDENT THERETO;
 - D. CONTRACTOR SHALL ALSO HAVE REVIEWED AND COORDINATED EACH SHOP DRAWING OR SAMPLE WITH OTHER SHOP DRAWINGS AND SAMPLES, AND WITH THE REQUIREMENTS OF THE WORK AND THE CONTRACT DOCUMENTS.
 - E. ALL SUBMITTED SHOP DRAWINGS SHALL BEAR A STAMP OR SPECIFIC WRITTEN INDICATION AND SIGNATURE THAT CONTRACTOR HAS FULLY COMPLETED THE ABOVE TASKS.
2. SHOP DRAWINGS AS DESCRIBED ABOVE ARE REQUIRED FOR, BUT NOT LIMITED TO, THE FOLLOWING:
 - A. ALL STORM SEWER STRUCTURES TO BE INSTALLED WITH THIS PROJECT.
 - B. ALL SANITARY SEWER STRUCTURES TO BE INSTALLED WITH THIS PROJECT.
 - C. ALL SITE FENCING AND RAILING INCLUDING ANY GATES.
 - D. ALL LANDSCAPE AND RETAINING WALLS.
 - E. ANY ITEMS IN THESE PLANS THAT ALLOW FOR AN "APPROVED EQUAL" ALTERNATIVE.

STORM SEWER PLAN NOTES

1. PRIOR TO COMMENCEMENT OF WORK THE CONTRACTOR SHALL NOTIFY AND COORDINATE CONSTRUCTION WITH LEE'S SUMMIT, MISSOURI.
2. ALL PIPE LENGTHS AND ELEVATIONS ARE CALCULATED LINEARLY FROM CENTER OF STRUCTURE TO CENTER OF STRUCTURE.
3. COORDINATES ARE PROVIDED AT THE CENTER OF STRUCTURE. ADDITIONAL COORDINATES PROVIDED ARE PER LOCAL CODES AND ORDINANCES OR AS AN AID WHEN ORIENTING THE BOX DURING INSTALLATION.
4. THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICT AND POINTS OF CONNECTION PRIOR TO ANY CONSTRUCTION OF STORM SEWER.
5. STORM SEWER TRENCHES SHALL BE CONSTRUCTED SUCH THAT UNDISTURBED EXISTING SOIL OR FILL COMPACTED TO 95% PROCTOR DENSITY IS AT A DEPTH THAT IS 18" ABOVE TOP OF PROPOSED PIPE.
6. STRUCTURE INVERT CHANNELS SHALL BE SMOOTH, CIRCULAR, AND CONFORMING TO ½ THE ADJACENT PIPE SECTION (INVERT TO CENTER). CHANGES IN DIRECTION OF FLOW SHALL BE MADE WITH A SMOOTH CURVE AND MAINTAIN SHAPE THROUGHOUT. CHANGES IN GRADE OF ADJACENT PIPES SHALL BE TRANSITIONED SMOOTHLY AND EVENLY THROUGH THE STRUCTURE.
7. PIPE PENETRATIONS SHALL BE GROUTED TO ENSURE WATERTIGHT SEALS.

ESTIMATE OF QUANTITIES				
ITEM NO.	DESCRIPTION	UNIT	QUANTITY	AS-BUILT
STREET				
1	EXCAVATION	C.Y.	5,854	
2	EMBANKMENT	C.Y.	15,100	
3	SUBGRADE STABILIZATION (6" FLYASH TREATMENT)	S.Y.	11,866	
4	6" ASPHALT PAVEMENT	S.Y.	9,612	
5	CONCRETE CURB & GUTTER (CG-2)	L.F.	6,335	
6	CONCRETE CURB & GUTTER (CG-1 DRY)	L.F.	245	
7	5' CONCRETE SIDEWALK	L.F.	143	
8	ADA RAMP	EA.	11	
9	STOP SIGNS	EA.	5	
10	STREET NAME SIGNS	EA.	10	
11	TYPE IV OBJECT MARKERS	EA.	2	
STORM				
12	STD. CURB INLET (5'x3' INSIDE)	EA.	19	
13	STD. CURB INLET (6'x3' INSIDE)	EA.	3	
14	STD. FIELD INLET (4'x4' INSIDE)	EA.	6	
15	STD. MANHOLE (5' DIA. INSIDE)	EA.	1	
16	WATER QUALITY BASIN OUTLET STRUCTURE	EA.	1	
17	6" PVC	L.F.	175.99	
18	15" HDPE	L.F.	419.42	
19	18" HDPE	L.F.	1552.87	
20	24" HDPE	L.F.	436.49	
21	30" HDPE	L.F.	284.64	
22	36" HDPE	L.F.	94.79	
23	18" FLARED END SECTION	L.F.	2	
24	24" FLARED END SECTION	L.F.	1	
25	30" FLARED END SECTION	EA.	1	
26	36" FLARED END SECTION	EA.	1	
27	15" HDPE PLUG	EA.	1	
28	RIPRAP	S.Y.	55.1	



BY		REV.		NO.		DATE		REVISIONS DESCRIPTION	

GENERAL NOTES		2020	
STREET AND STORM SEWER PLANS		HOOK FARMS FIRST PLAT	
LEE'S SUMMIT, MO			


drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020

SHEET
C102

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com


DWG: F: A
DATE:

TYPICAL ROADWAY SECTION

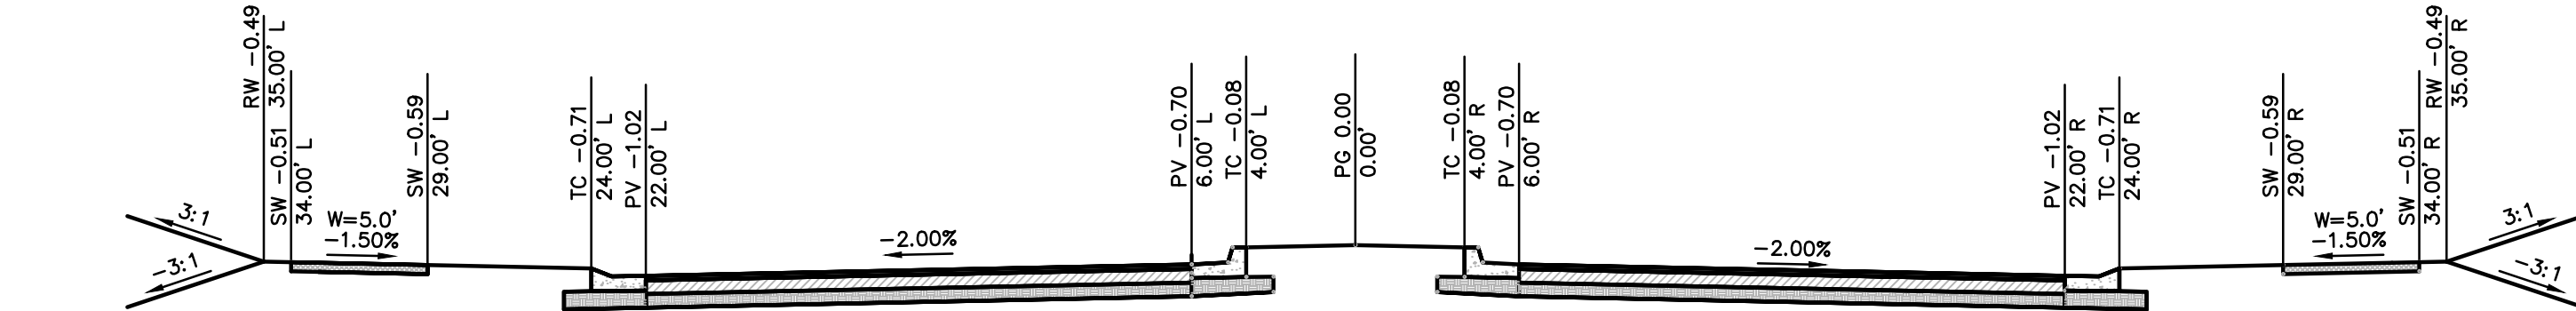

RESIDENTIAL LOCAL STREET - ENTRANCE (48' BK-BK)
SW 26TH TERRACE

CG-2 CURB & GUTTER
CG-1 DRY CURB & GUTTER AT MEDIAN
2" TYPE 6 ASPHALTIC CONCRETE SURFACE
4" TYPE 5 ASPHALTIC CONCRETE BASE COURSE
6" MIN. MODOT TYPE 5 STONE BASE
6" FLYASH STABILIZED SUBGRADE

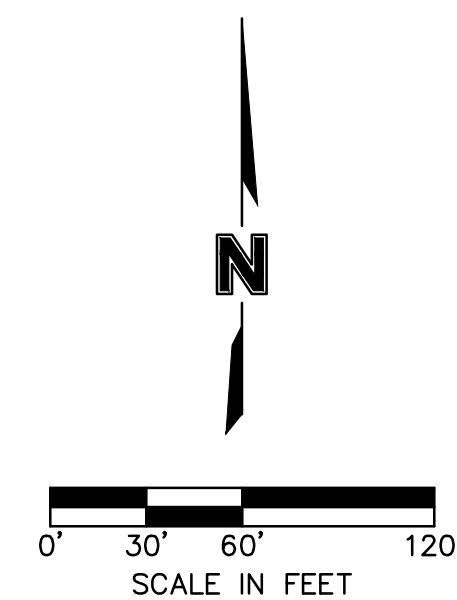

GENERAL LAYOUT STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020

SHEET
C103

[illegible]

REVISIONS



Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116

olsson

Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\GV\Street and Storm Plans\VC GRD01_0194061.dwg USER: rneiser C:\P\TIL_0194061 C:\P\BASE_0194061
DATE: Apr 20, 2020 1:55pm XREFS: C:\P\BLK_0194061_34x22 C:\P\NDY_0194061 C:\P\BASE_0194061

GENERAL NOTES:


1. CONTRACTOR SHALL ADHERE TO THE "DESIGN AND CONSTRUCTION MANUAL" SECTION 2100 AS ADOPTED BY THE CITY OF LEE'S SUMMIT (LATEST EDITION), FOR EXCAVATION AND EMBANKMENT WORK WITHIN THE PROPOSED RIGHT-OF-WAY.
2. AREAS OF CONSTRUCTION SHALL BE STRIPPED OF ALL VEGETATION, ORGANIC MATTER AND TOPSOIL TO A DEPTH AS RECOMMENDED BY GEOTECHNICAL ENGINEER AND OR TESTING AGENCY. SOILS REMOVED DURING SITE STRIPPING SHOULD BE EVALUATED TO DETERMINE IF PORTIONS OF THE TOPSOIL STRATUM MAY BE UTILIZED AS STRUCTURAL FILL WITHIN PAVEMENT AREAS. ANY MATERIAL NOT DEEMED AS SUITABLE FILL MATERIAL BY THE GEOTECHNICAL ENGINEER AND OR TESTING AGENCY SHALL BE REMOVED FROM THE JOB SITE BY THE CONTRACTOR AT HIS EXPENSE.
3. ALL EMBANKMENT OUTSIDE OF RIGHT-OF-WAY SHOULD BE PLACED IN CONTROLLED LIFTS HAVING A MAXIMUM LOOSE LIFT THICKNESS OF 8". EMBANKMENT SHOULD BE COMPACTED TO A MINIMUM OF 95% OF THE MATERIALS MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-698 (STANDARD PROCTOR COMPACTION). MOISTURE CONTENT OF THE FILL AT THE TIME OF COMPACTION SHALL BE WITHIN A RANGE OF -0 TO +4 PERCENT OF OPTIMUM MOISTURE CONTENT.

LEGEND	
-100-	EXISTING INDEX CONTOURS
-100-	EXISTING INTERMEDIATE CONTOURS
-100-	PROPOSED INDEX CONTOURS
-100-	PROPOSED INTERMEDIATE CONTOURS

EARTHWORK QUANTITIES		
LOCATION	CUT (C.Y.)	FILL (C.Y.)
STREET	5,854	15,100
SITE	39,039	57,214
TOTAL	44,893	72,314

EARTHWORK QUANTITIES NOTES:

1. EARTHWORK QUANTITIES BASED ON FINISHED GRADE SURFACE AND DO NOT INCLUDE ADJUSTMENTS FOR TOPSOIL AND SHRINKAGE.
2. EARTHWORK QUANTITIES DO NOT TAKE INTO CONSIDERATION EXCAVATION, REMOVAL AND DISPOSAL OF MATERIAL DEEMED UNSUITABLE BY A GEOTECHNICAL ENGINEER. THE EARTHWORK CONTRACTOR IS RESPONSIBLE FOR EXCAVATION, REMOVAL AND DISPOSAL OF UNSUITABLE MATERIAL AND FOR REPLACING IT WITH SUITABLE MATERIAL.
3. EARTHWORK QUANTITIES DO NOT TAKE INTO CONSIDERATION THE IMPORTED STOCKPILE (APPROX. 20,000 CY) FROM KESSLER RIDGE 2ND PLAT.

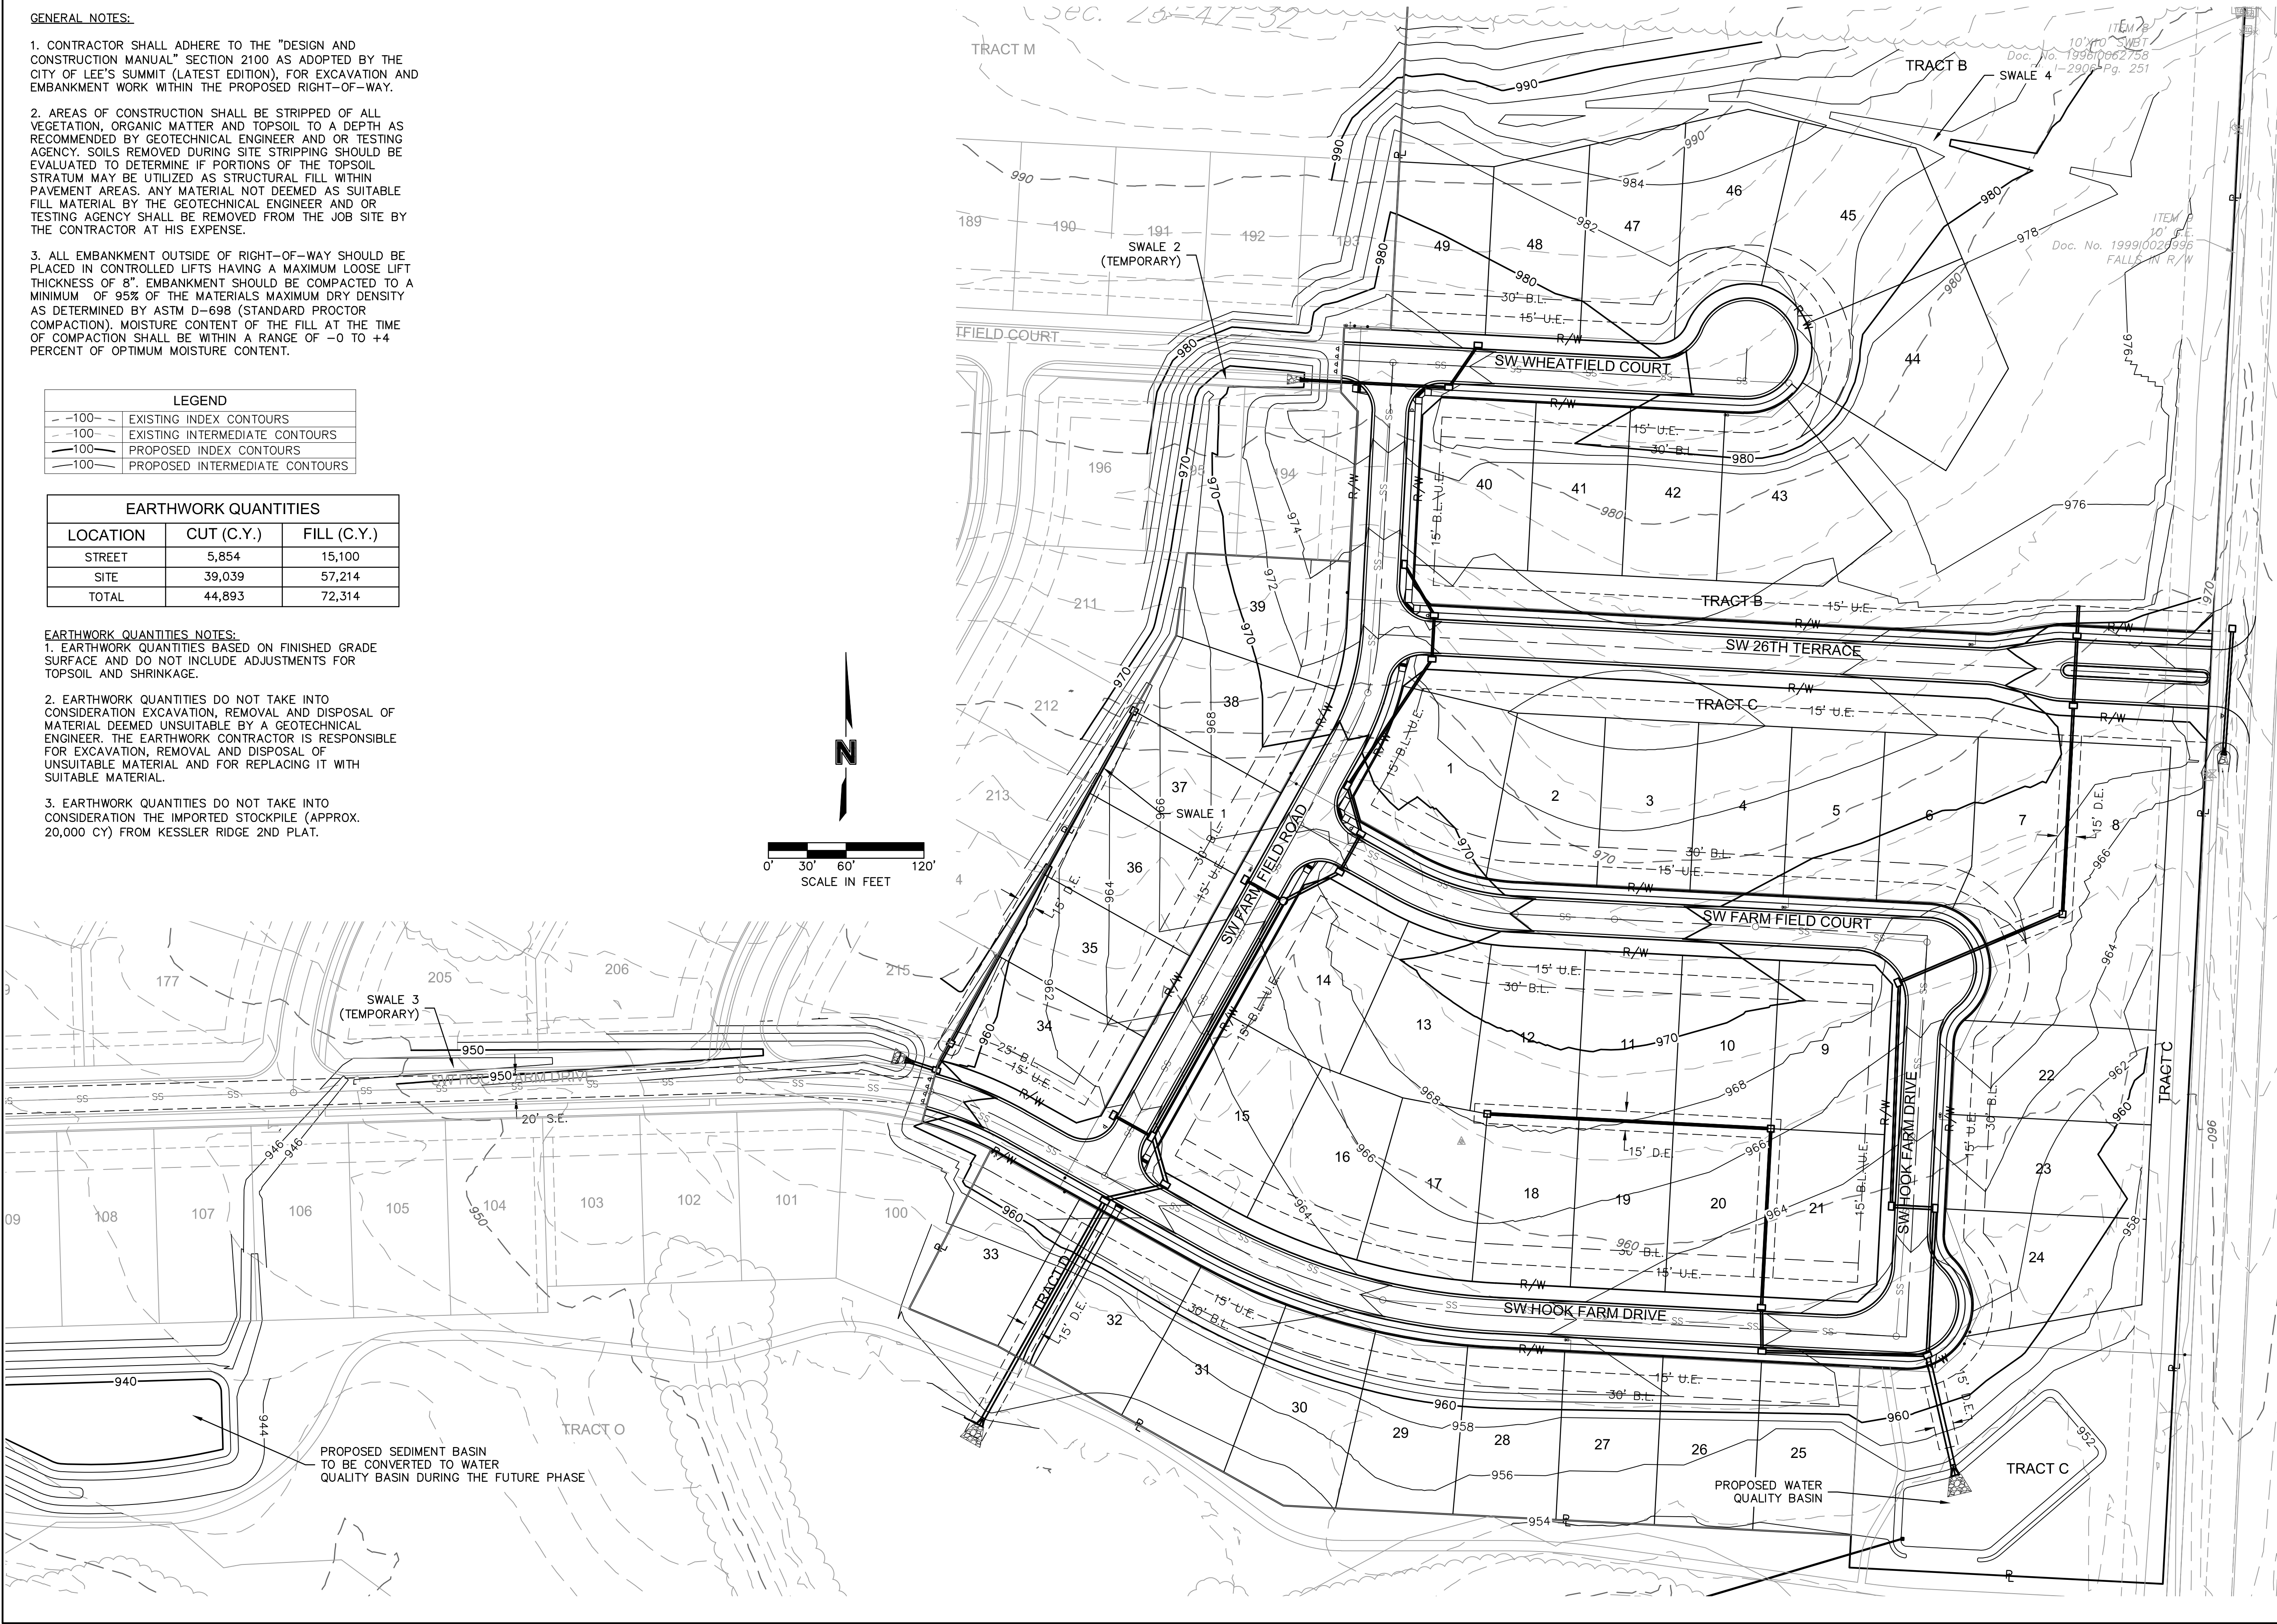

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER


BY
REVISIONS DESCRIPTION
DATE
REV. NO.

GRADING PLAN
STREET AND STORM SEWER PLANS
HOOK FARMS
FIRST PLAT
LEE'S SUMMIT, MO
2020

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020

SHEET
C104

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Storm Plans\SW_01_0194061.dwg
DATE: Apr 20, 2020 1:55pm
XREFS: C_P\BLK_0194061_34x22 C_P\BASE_0194061 C_P\BASE_0194061 C_P\PSURF_0194061 C_P\UTIL_0194061
USER: nheiser

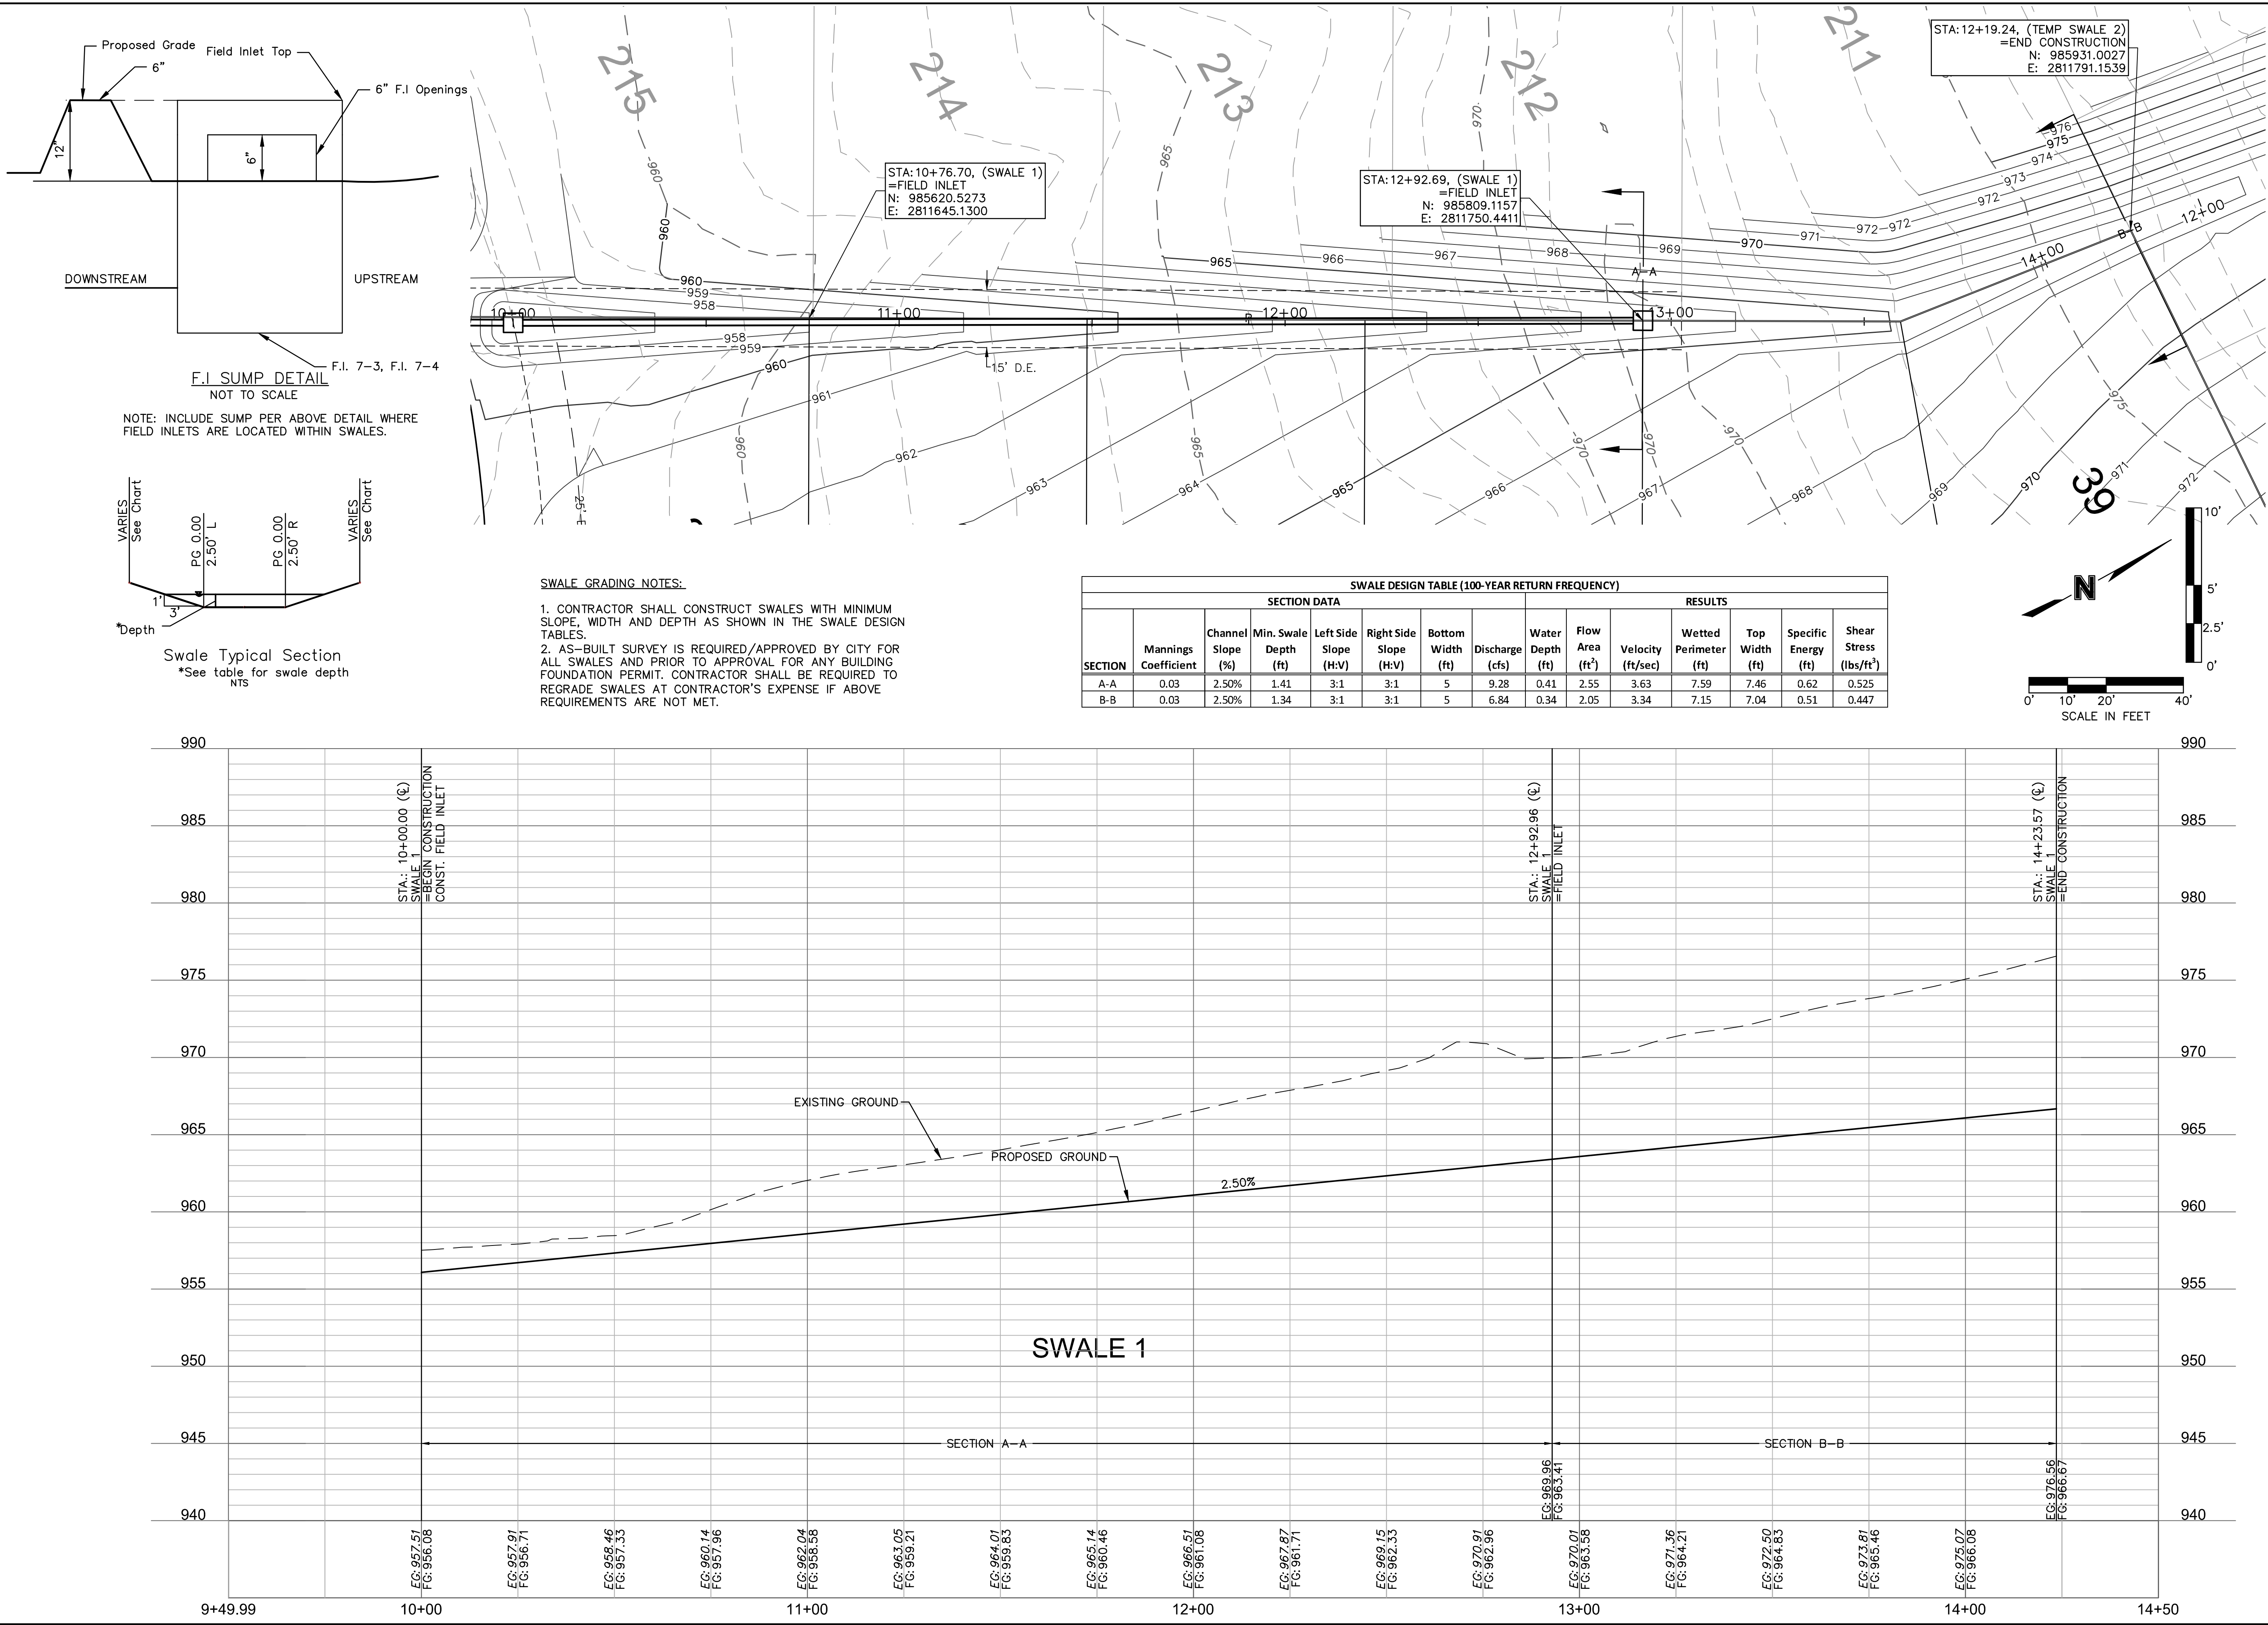

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER


BY
REV. NO.
DATE
REVISIONS DESCRIPTION

SWALE 1 PLAN & PROFILE
STREET AND STORM SEWER PLANS
HOOK FARMS
FIRST PLAT
LEE'S SUMMIT, MO
2020

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020




SHEET
C105

61\40-Design\AutoCAD\Final Plans\Sheets\GNC\A Street and Storm Plans\C_SWL01_0194061.dwg USER: nheiser
XREFS: C:\PTB\K_0194061_34x22 C:\PBDY_0194061 C:\XBASE_0194061 C:\FB_0194061

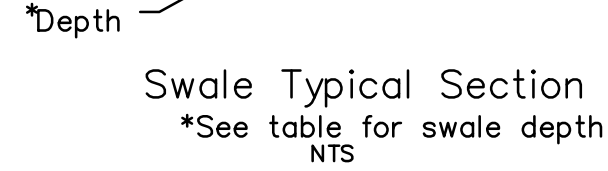

SECTION DATA								RESULTS						
SECTION	Mannings Coefficient	Channel Slope (%)	Min. Swale Depth (ft)	Left Side Slope (H:V)	Right Side Slope (H:V)	Bottom Width (ft)	Discharge (cfs)	Water Depth (ft)	Flow Area (ft²)	Velocity (ft/sec)	Wetted Perimeter (ft)	Top Width (ft)	Specific Energy (ft)	Shear Stress (lbs/ft²)
C-C	0.03	1.06%	1.77	3:1	3:1	5	19.60	0.77	5.63	3.48	9.87	9.62	0.96	0.377

1. CONTRACTOR SHALL CONSTRUCT SWALES WITH MINIMUM SLOPE, WIDTH AND DEPTH AS SHOWN IN THE SWALE DESIGN TABLES.
2. AS-BUILT SURVEY IS REQUIRED/APPROVED BY CITY FOR ALL SWALES AND PRIOR TO APPROVAL FOR ANY BUILDING FOUNDATION PERMIT. CONTRACTOR SHALL BE REQUIRED TO REGRADE SWALES AT CONTRACTOR'S EXPENSE IF ABOVE REQUIREMENTS ARE NOT MET.

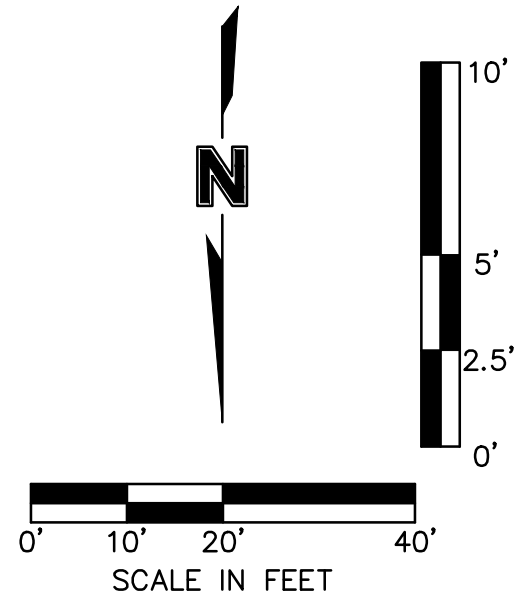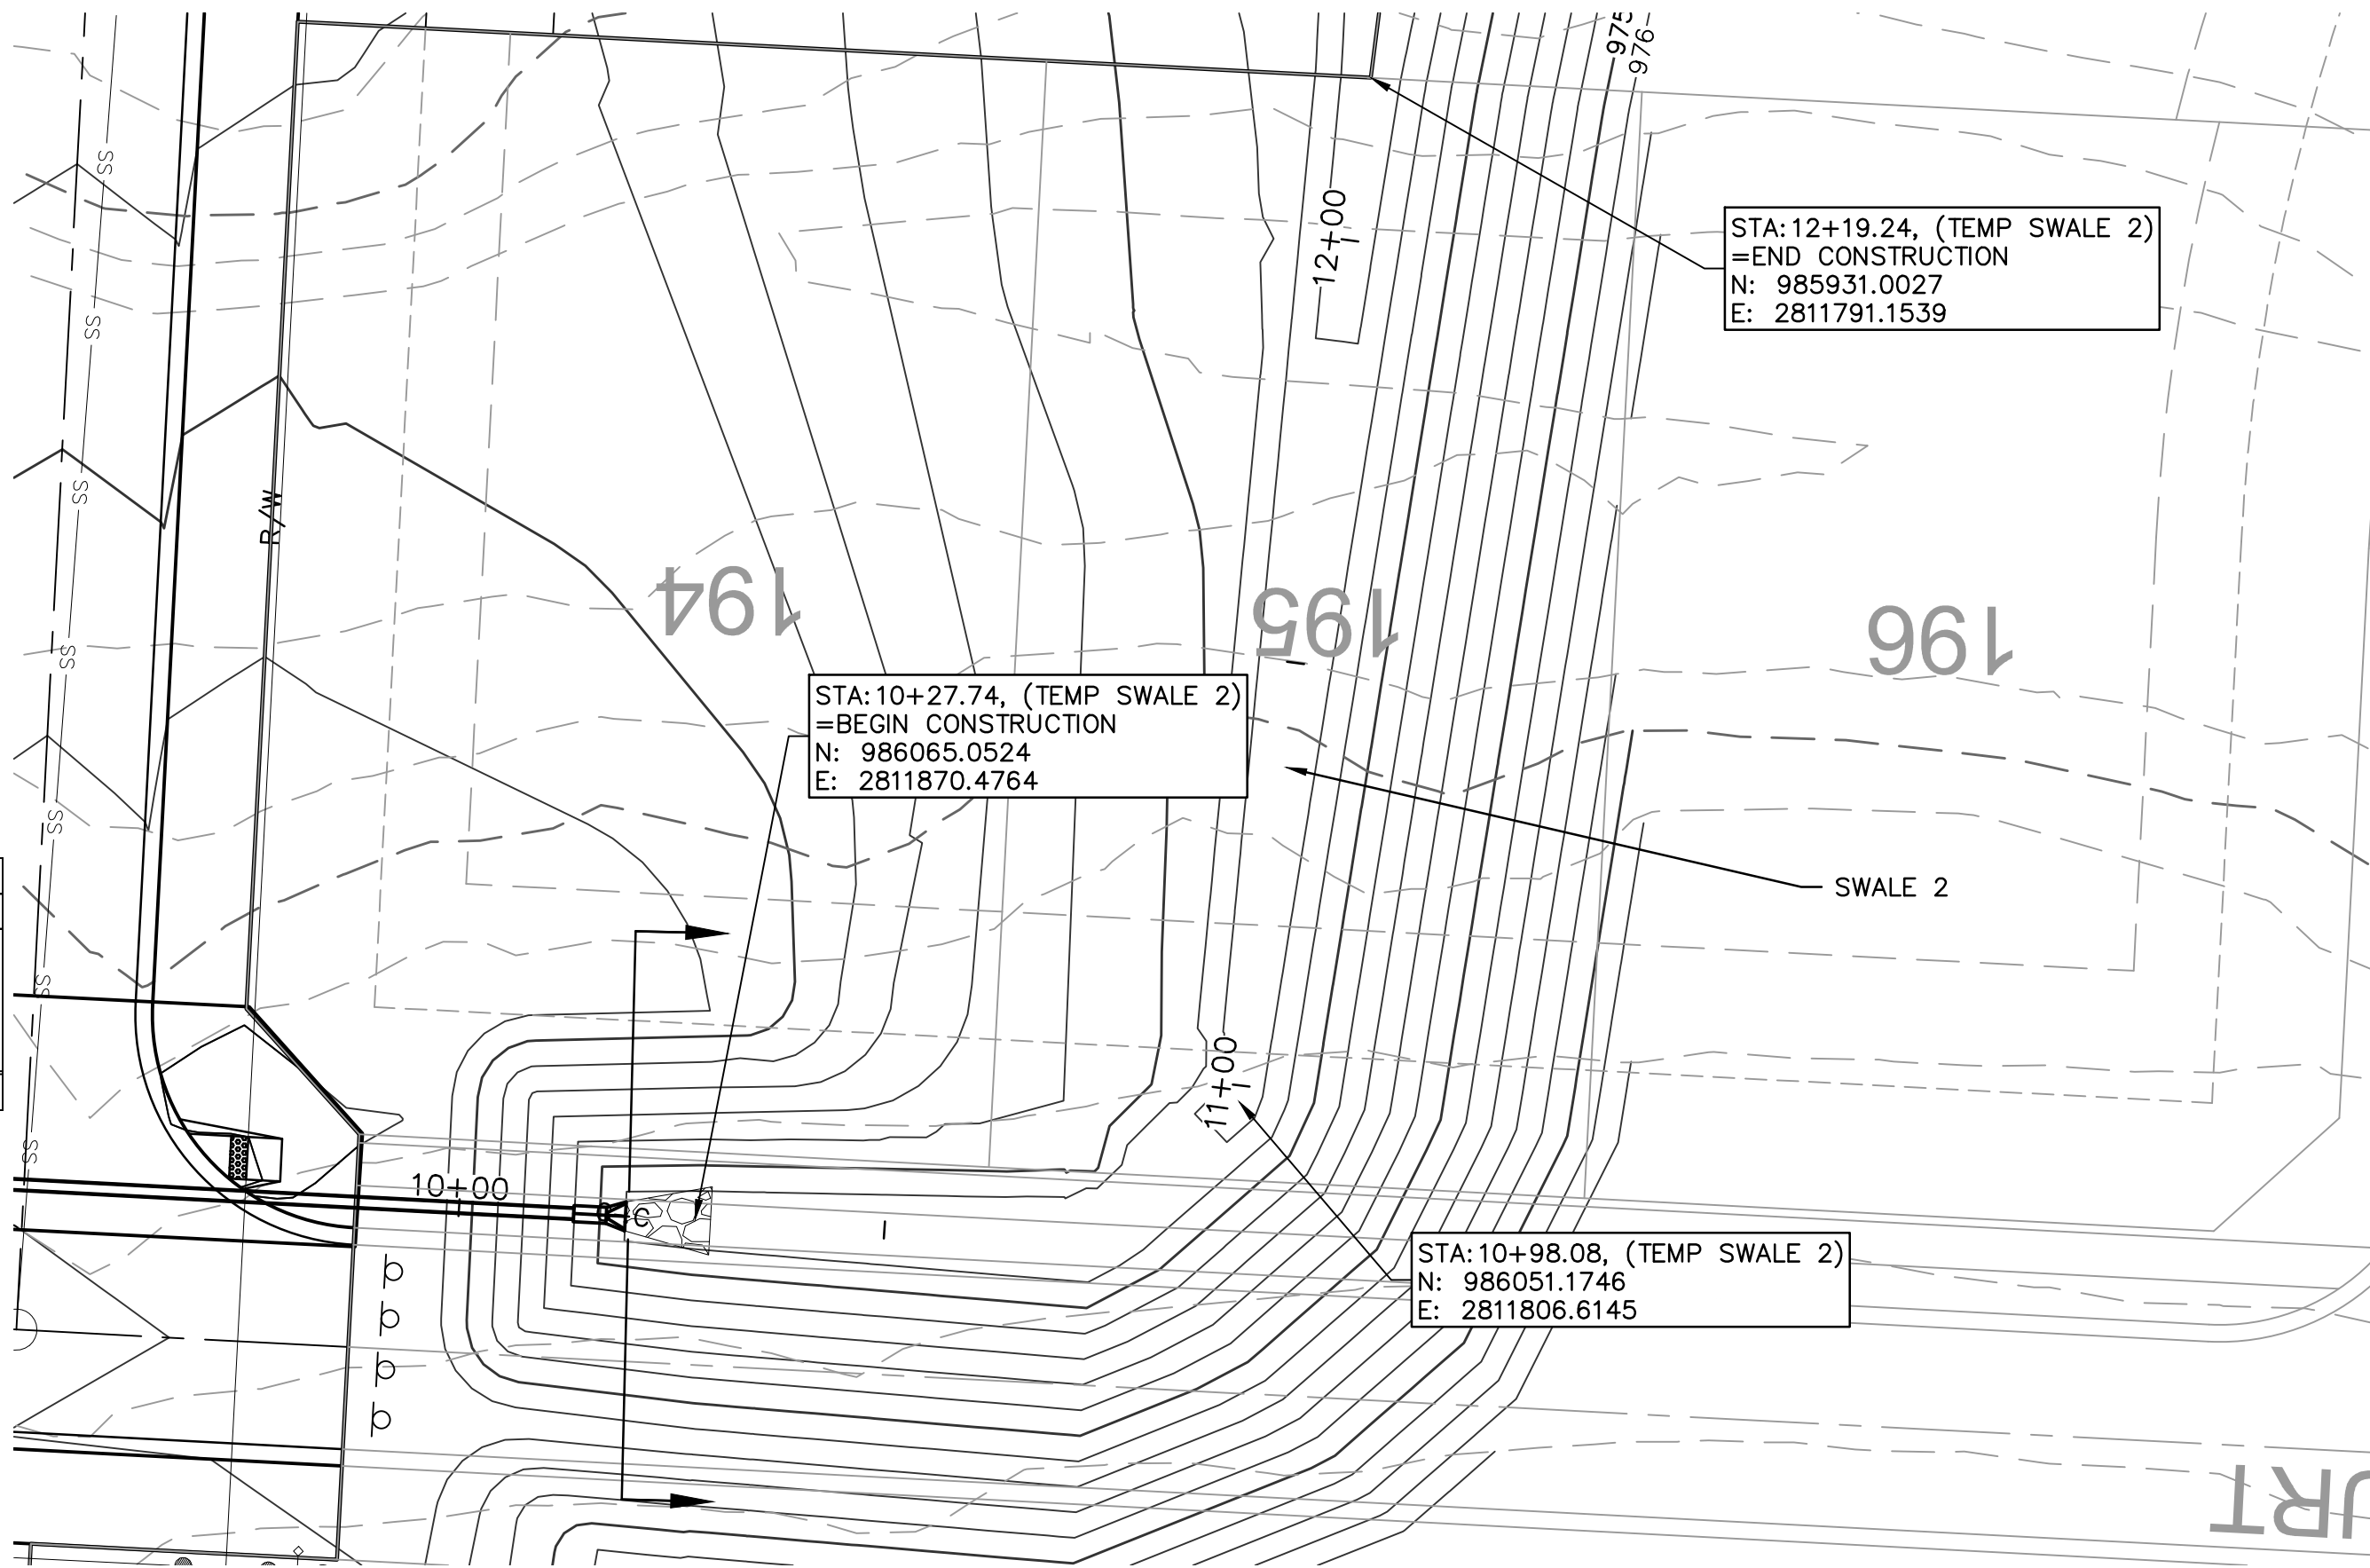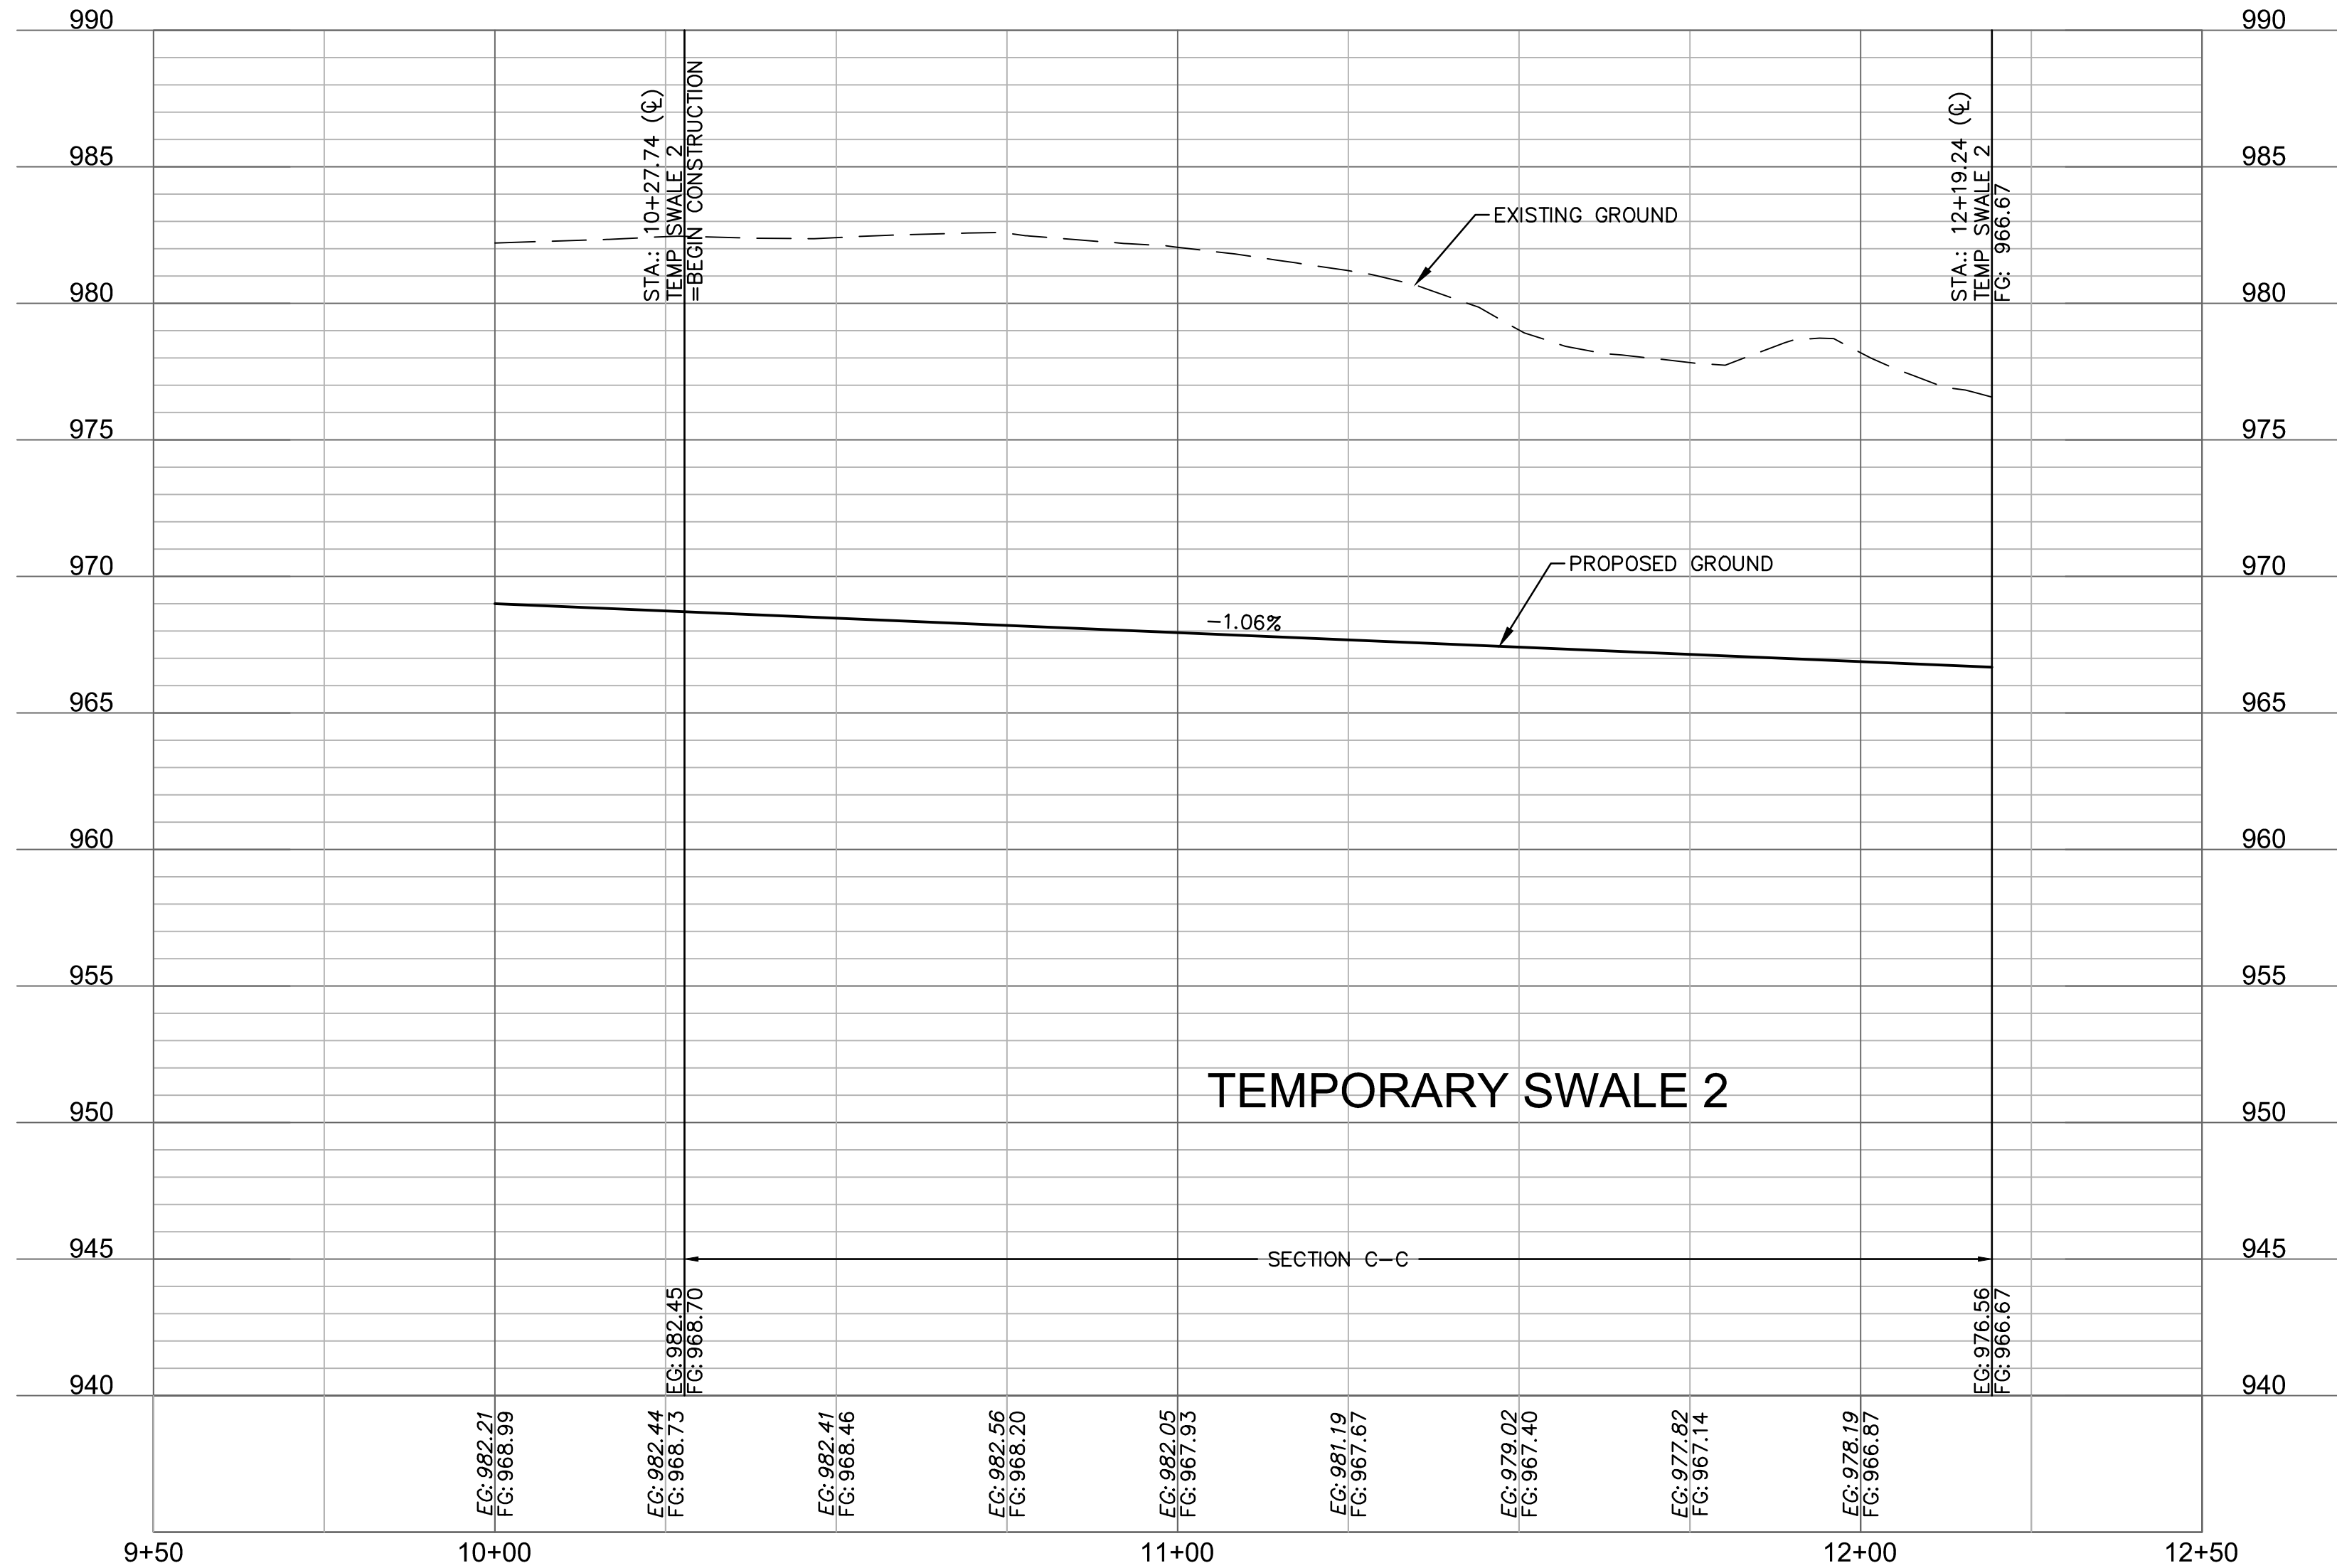

SWALE 2 PLAN & PROFILE STREET AND STORM SEWER PLANS	HOOK FARMS FIRST PLAT
drawn by: _____ checked by: _____ approved by: _____ QA/QC by: _____ project no.: _____ drawing no.: _____ date: _____	CSW JES NDH JES 019-4061 2020 LEE'S SUMMIT, MO 2020

SHEET

C106

[illegible]



olsson

Olsson - Civil/Engineering
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.351.1177
FAX 816.351.1888
www.olsson.com

USER: nheiser
061 C_FB,



1. CONTRACTOR SHALL CONSTRUCT SWALES WITH MINIMUM SLOPE, WIDTH AND DEPTH AS SHOWN IN THE SWALE DESIGN TABLES.
2. AS-BUILT SURVEY IS REQUIRED/APPROVED BY CITY FOR ALL SWALES AND PRIOR TO APPROVAL FOR ANY BUILDING FOUNDATION PERMIT. CONTRACTOR SHALL BE REQUIRED TO REGRADE SWALES AT CONTRACTOR'S EXPENSE IF ABOVE REQUIREMENTS ARE NOT MET.

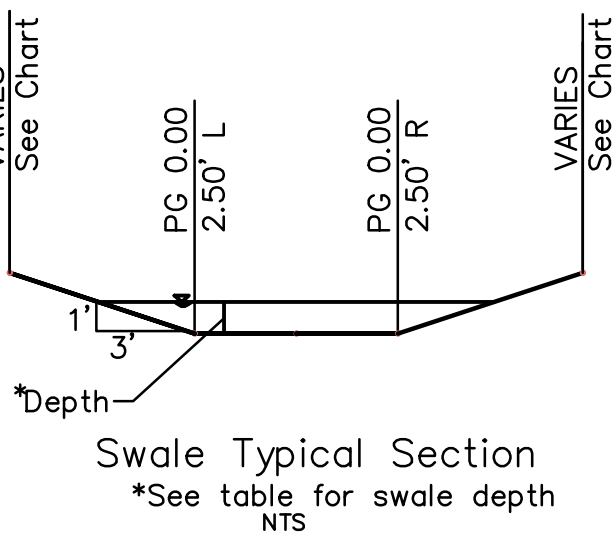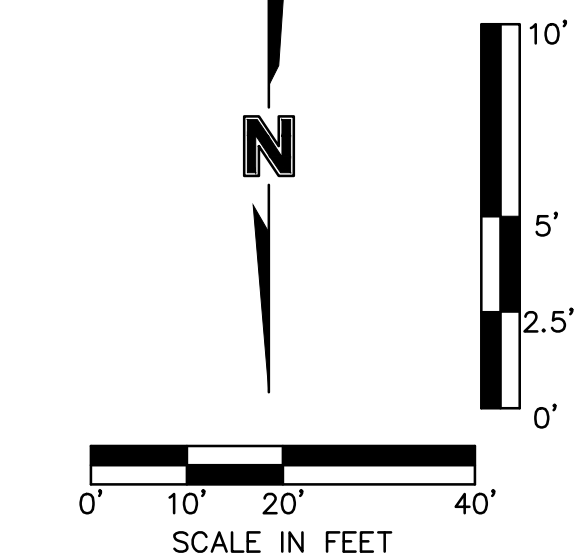

STATE OF MISSOURI
JULIE ELAINE SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER

[illegible]



SWALE 3 PLAN & PROFILE STREET AND STORM SEWER PLANS	2020
HOOK FARMS FIRST PLAT	
EE'S SUMMIT MO	2020

drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020


SHEET
C107

olsor

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

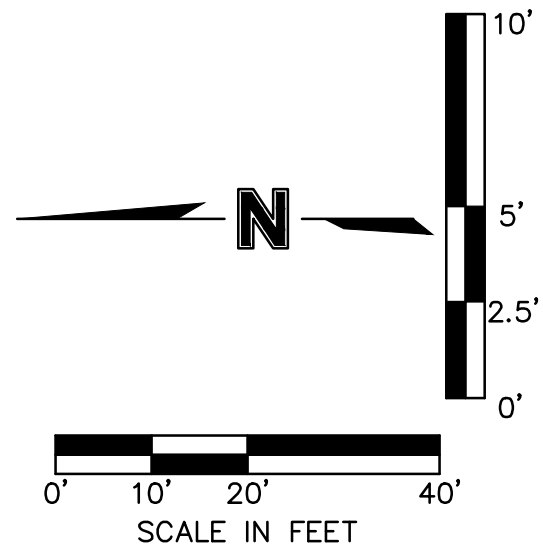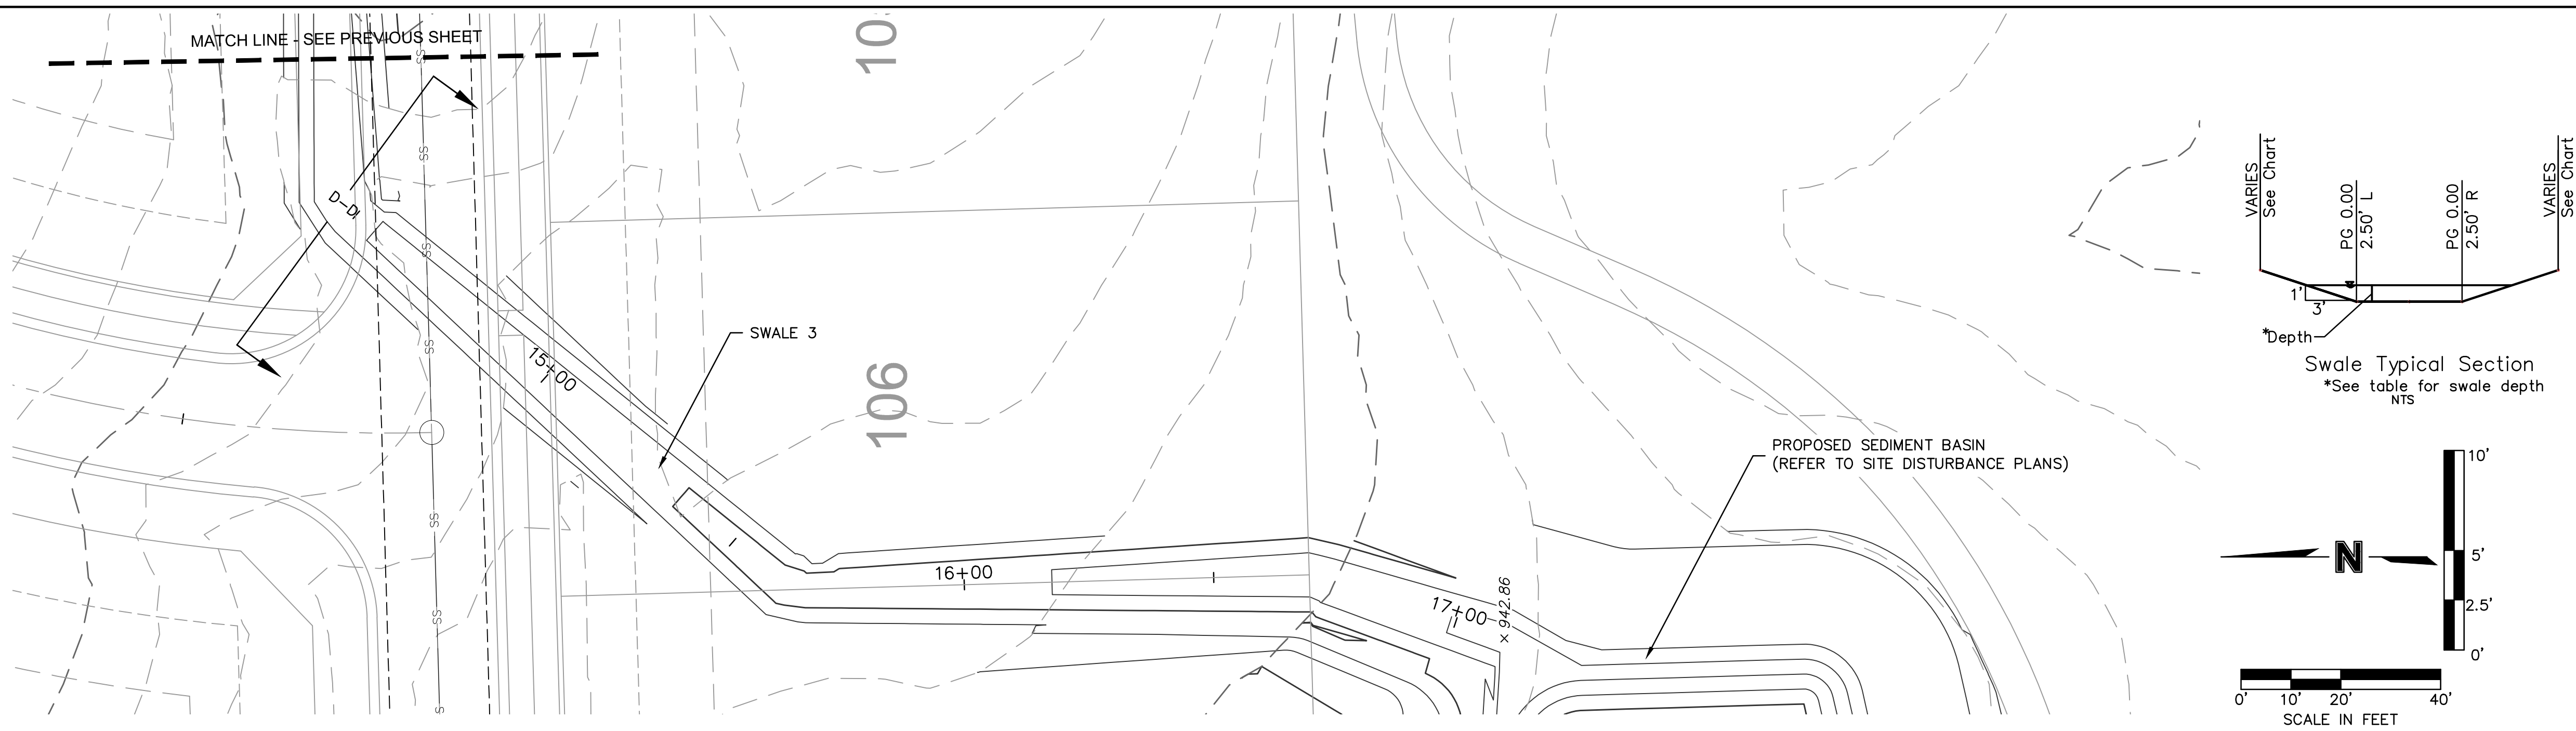

SWALE DESIGN TABLE (100-YEAR RETURN FREQUENCY)														
SECTION DATA								RESULTS						
SECTION	Mannings Coefficient	Channel Slope (%)	Min. Swale Depth (ft)	Left Side Slope (H:V)	Right Side Slope (H:V)	Bottom Width (ft)	Discharge (cfs)	Water Depth (ft)	Flow Area (ft²)	Velocity (ft/sec)	Wetted Perimeter (ft)	Top Width (ft)	Specific Energy (ft)	Shear Stress (lbs/ft²)
D-D	0.03	1.23%	2.03	3:1	3:1	5	36.35	1.03	8.33	4.36	11.51	11.18	1.33	0.556

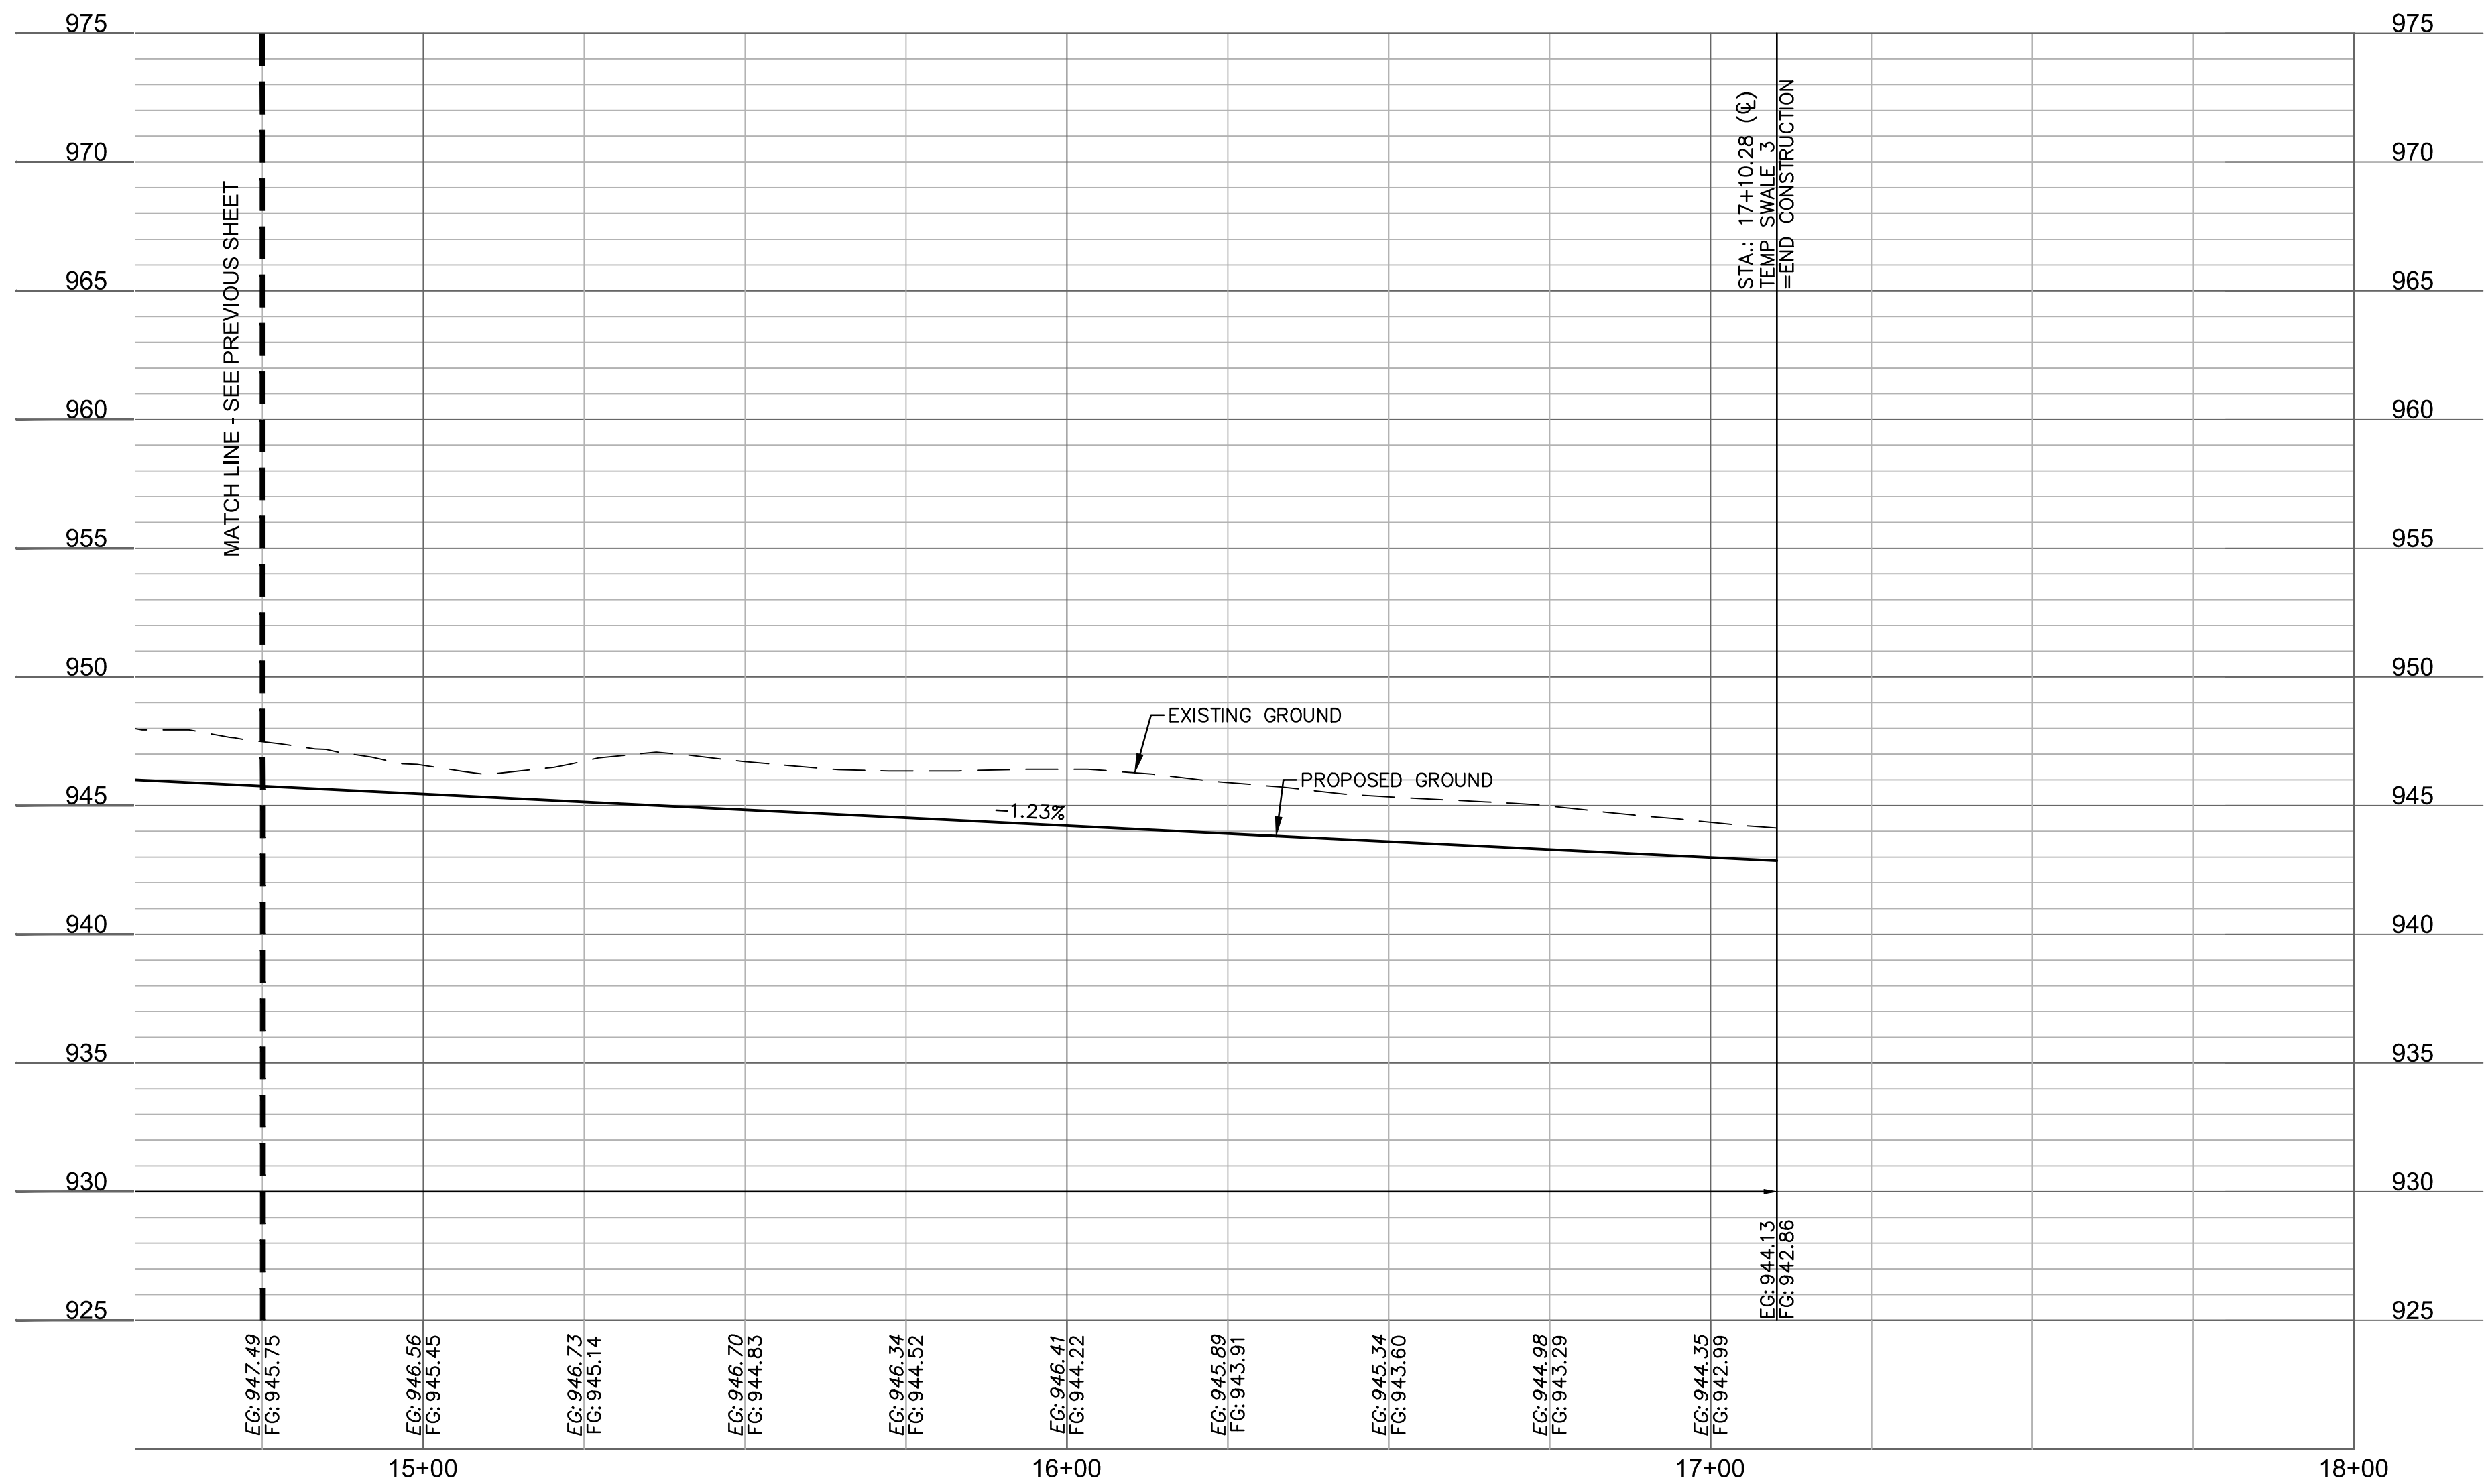


SWALE GRADING NOTES:

1. CONTRACTOR SHALL CONSTRUCT SWALES WITH MINIMUM SLOPE, WIDTH AND DEPTH AS SHOWN IN THE SWALE DESIGN TABLES.
2. AS-BUILT SURVEY IS REQUIRED/APPROVED BY CITY FOR ALL SWALES AND PRIOR TO APPROVAL FOR ANY BUILDING FOUNDATION PERMIT. CONTRACTOR SHALL BE REQUIRED TO REGRADE SWALES AT CONTRACTOR'S EXPENSE IF ABOVE REQUIREMENTS ARE NOT MET.

2. AS-BUILT SURVEY IS REQUIRED/APPROVED BY CITY FOR ALL SWALES AND PRIOR TO APPROVAL FOR ANY BUILDING FOUNDATION PERMIT. CONTRACTOR SHALL BE REQUIRED TO REGRADE SWALES AT CONTRACTOR'S EXPENSE IF ABOVE REQUIREMENTS ARE NOT MET.



DWG: F:\2019\4001-4500\019-4061-Design\AutoCAD\Final Plans\SW\01_0194061.dwg USER: nheiser
DATE: Apr 20, 2020 1:56pm XREFS: C:\PTBLK_0194061_34x22 C:\PBASE_0194061 C:\PSURE_0194061 C:\PUTIL_0194061

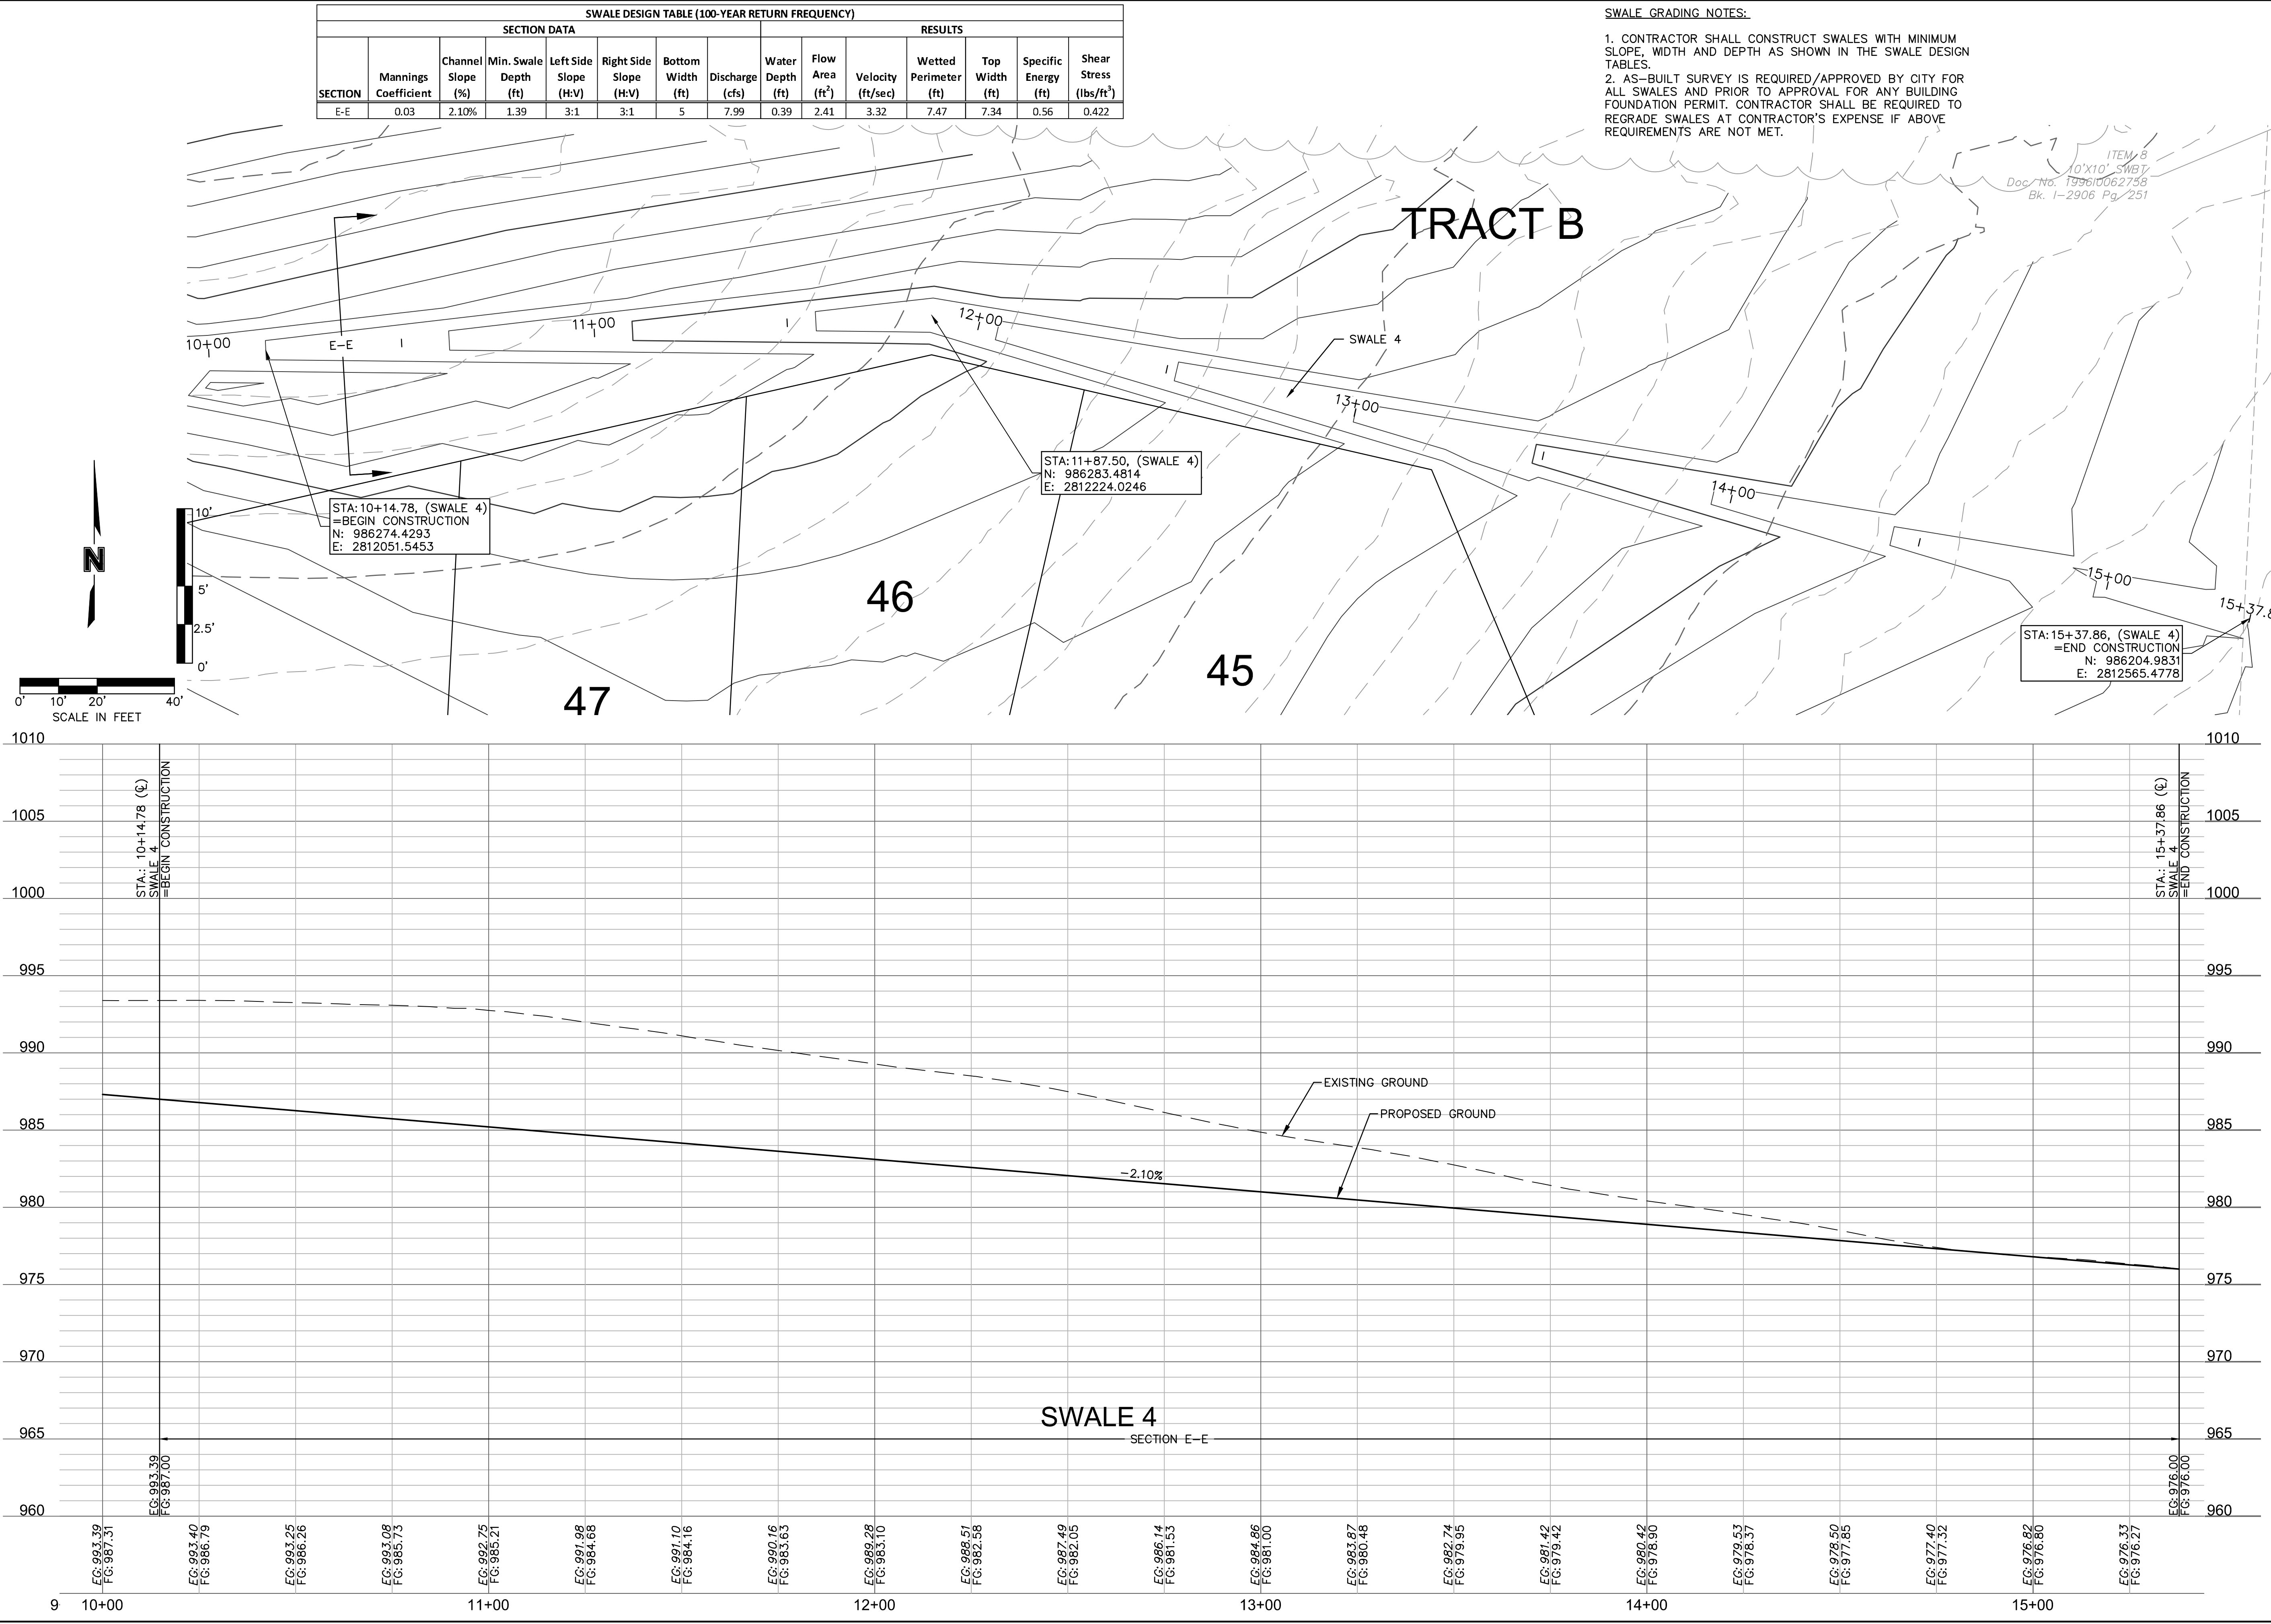

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
Professional Engineer
NUMBER
PE-2017000367
4/20/2020

BY
DATE
REV. NO.
REVISIONS DESCRIPTION

SWALE 4 PLAN & PROFILE
STREET AND STORM SEWER PLANS
HOOK FARMS
FIRST PLAT
LEE'S SUMMIT, MO
2020


drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020

SHEET
C109

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\GNCV\Street and Storm Plans\C_DBP01_0194061.dwg
 USER: nheiser
 xREFS: C:\PTBLK_0194061_34x22 C_XBASE_0194061 C_FBASE_0194061 C_PBASE_0194061 C_PENDY_0194061
 DATE: Apr 20, 2020 1:56pm C_PUTIL_0194061


Riprap Calculations							
End Section	Q ₁₀₀ (cfs)	Pipe Diameter (ft)	Class*	D50* (in)	Apron Length (ft)	Apron Depth (ft)	Area (SY)
WQv Outlet	0.93	0.5	1	5	2	1.46	0.5

*Per Table 10.1 HEC 14-FHWA-Energy Dissipators Pg. 10-18


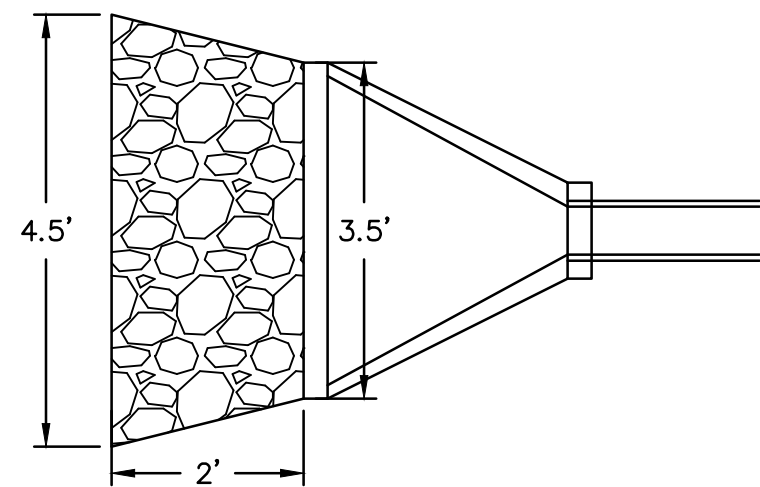


Scale: 1"=2'

02 RIPRAP OUTLET PROTECTION

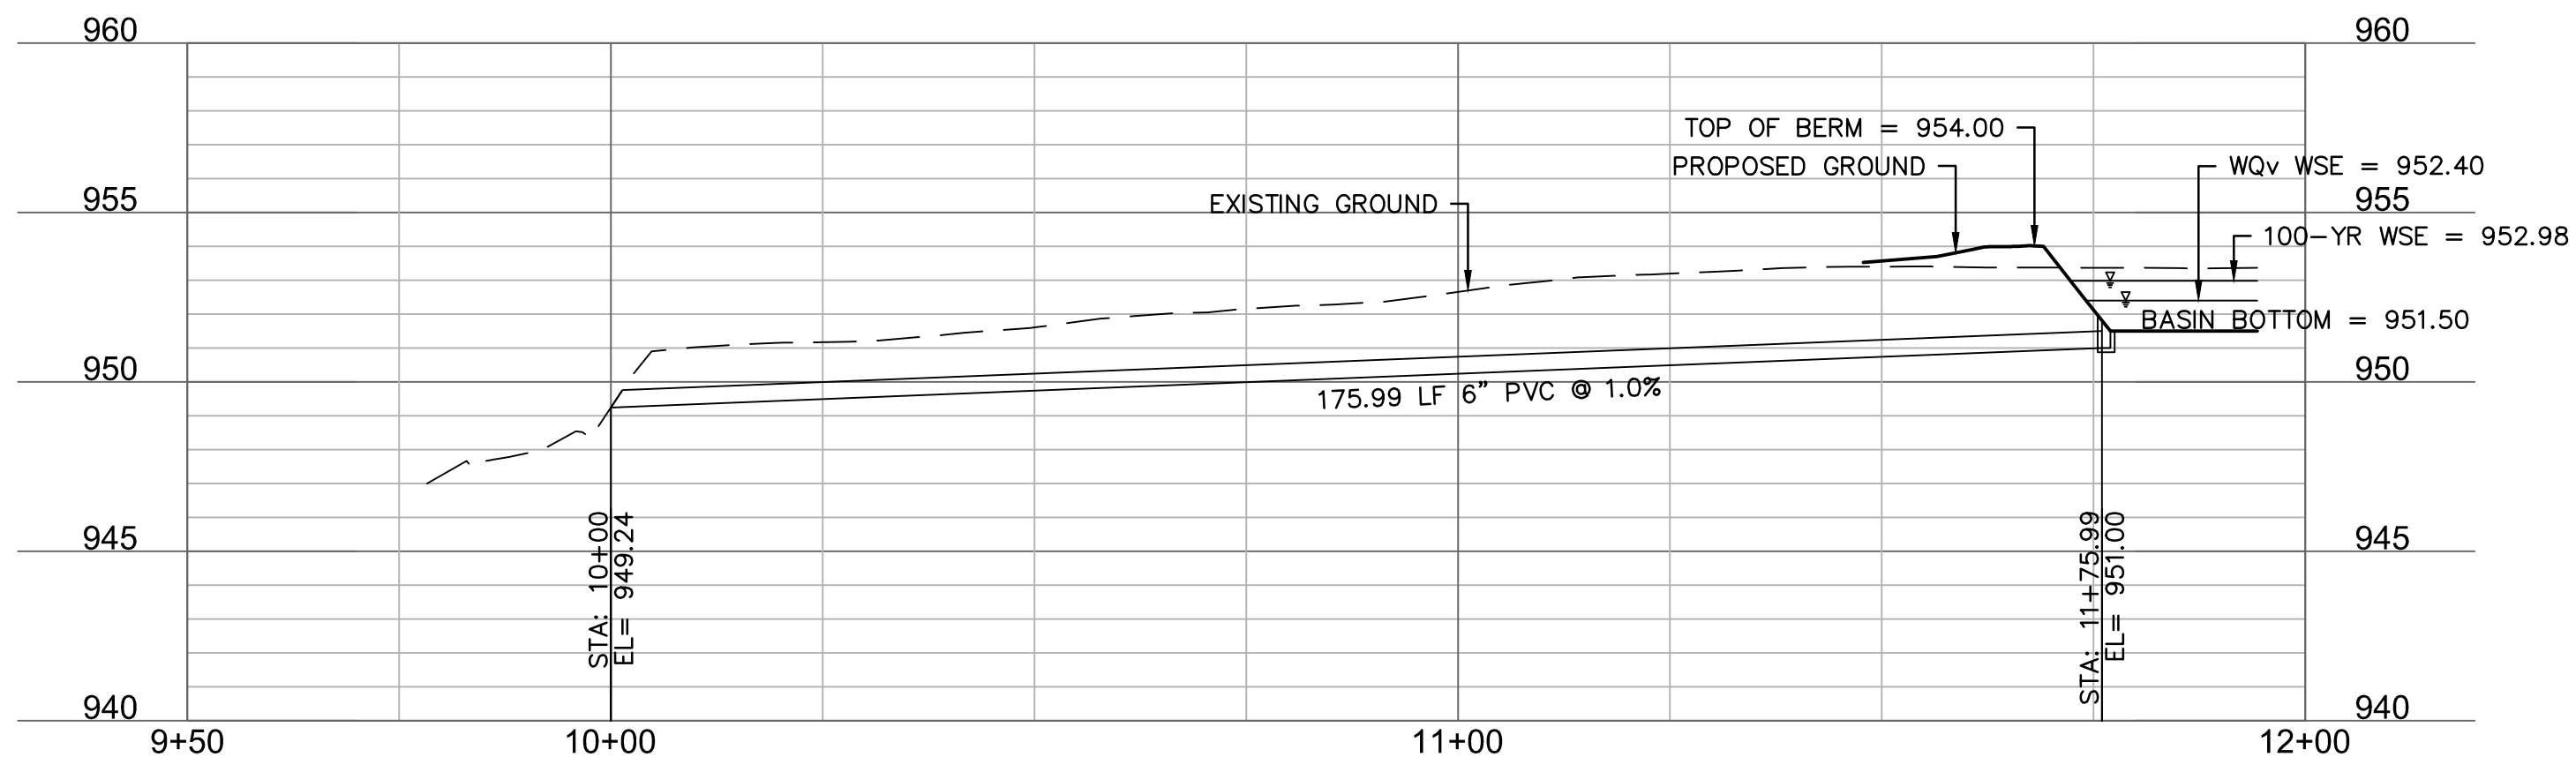

WATER QUALITY OUTLET (9+50 - 12+00)

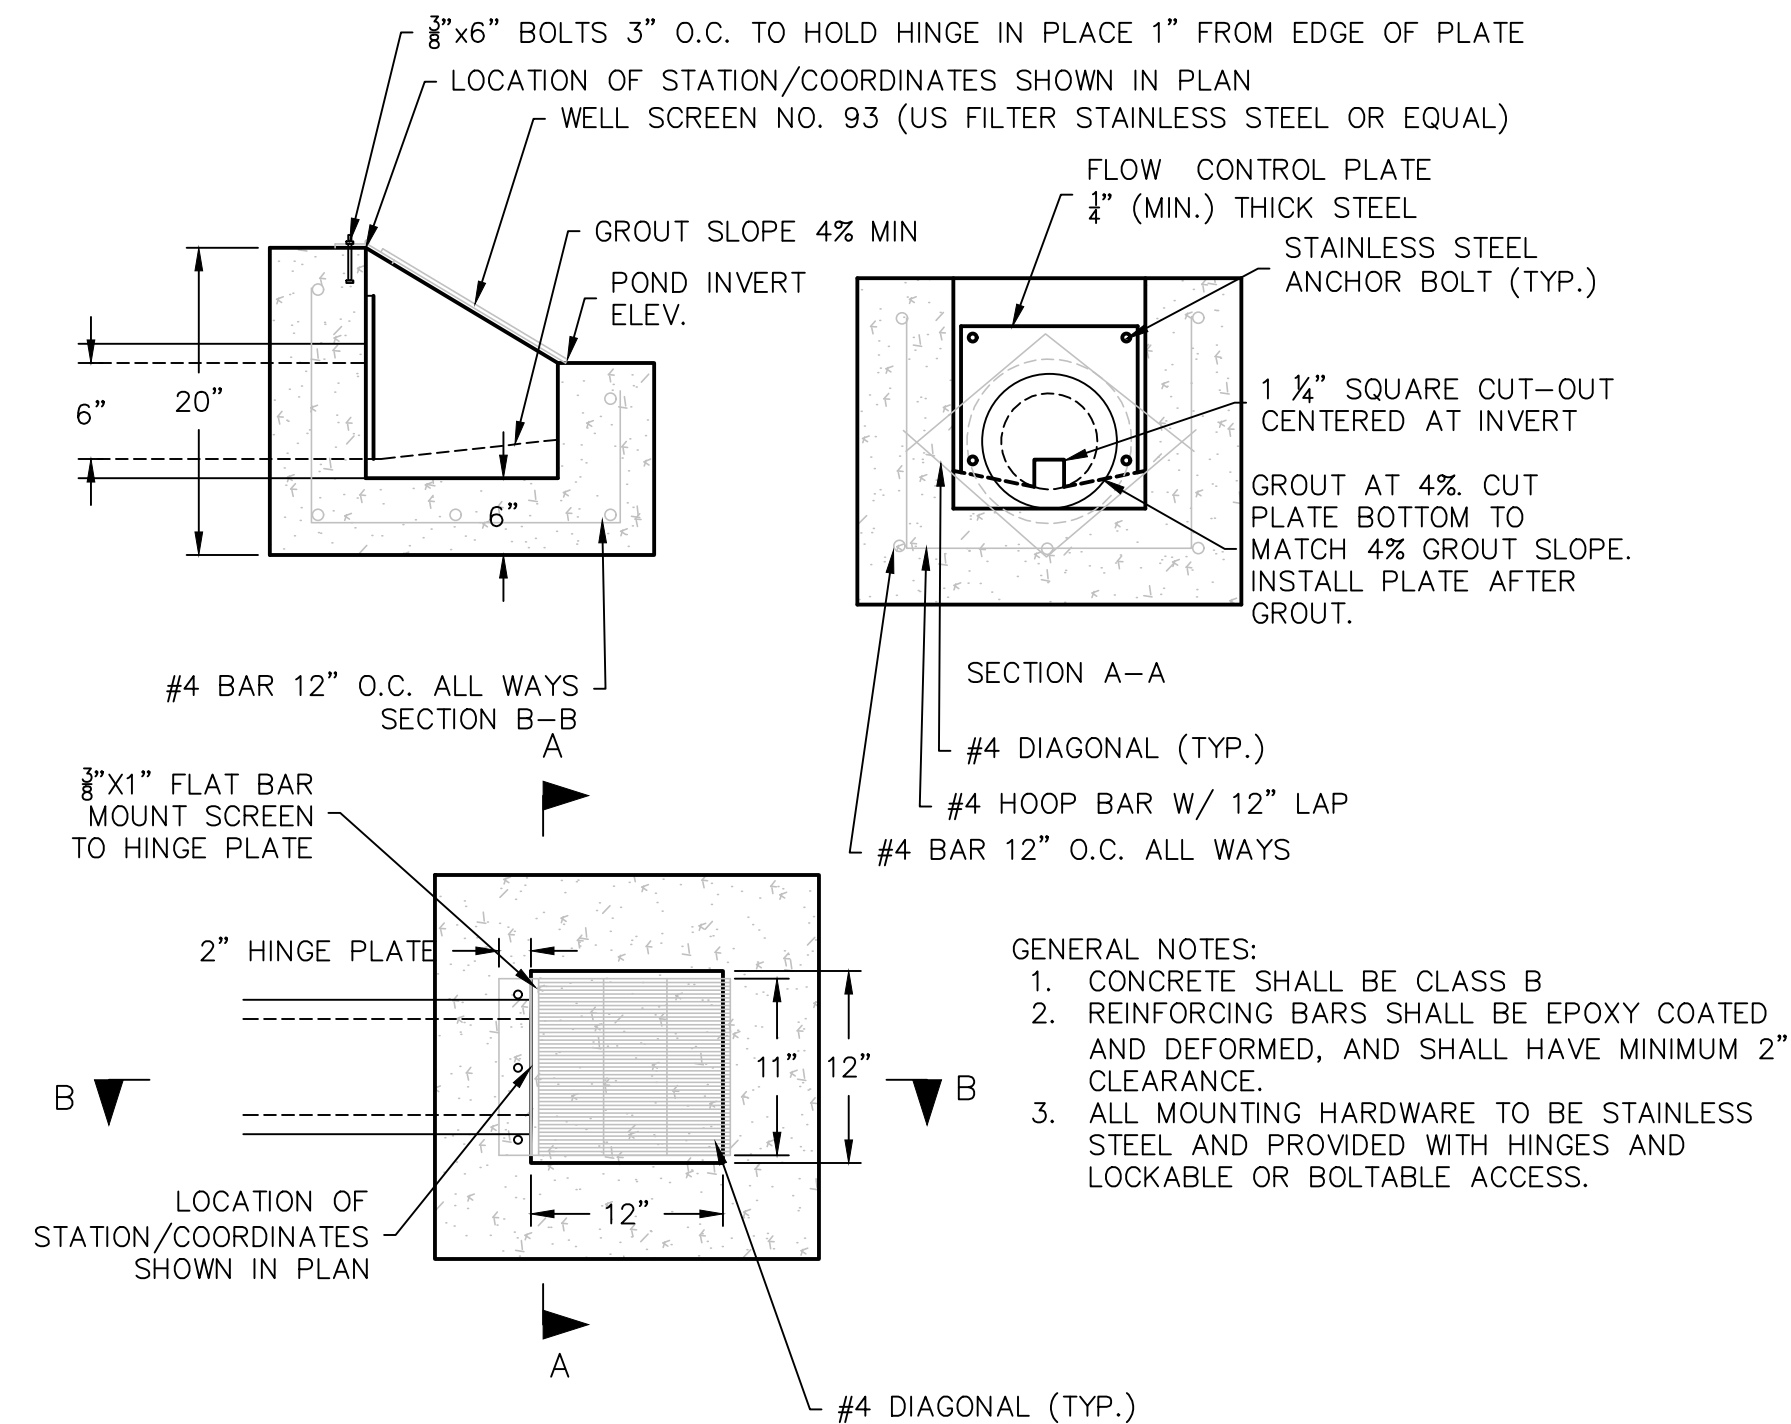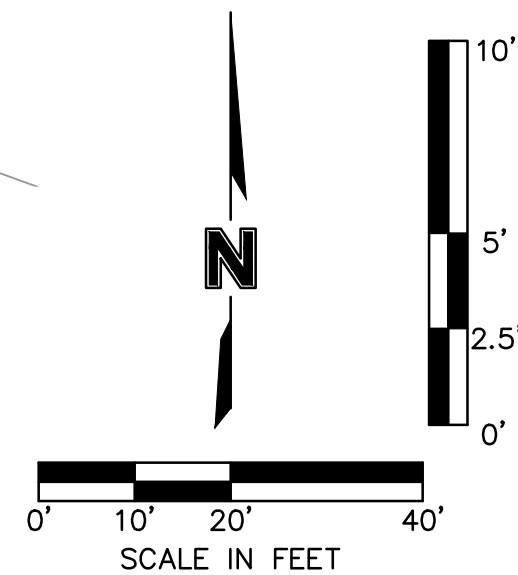

Scale: 1"=1'


01 WATER QUALITY BASIN OULET STRUCTURE

WATER QUALITY BASIN PLAN
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO




2020


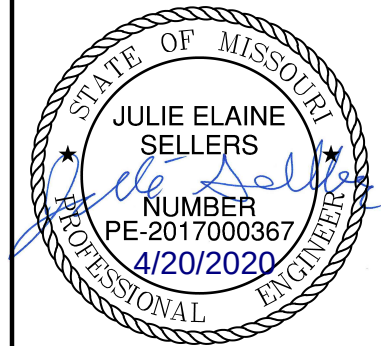
[illegible]




olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

SHEET
C110

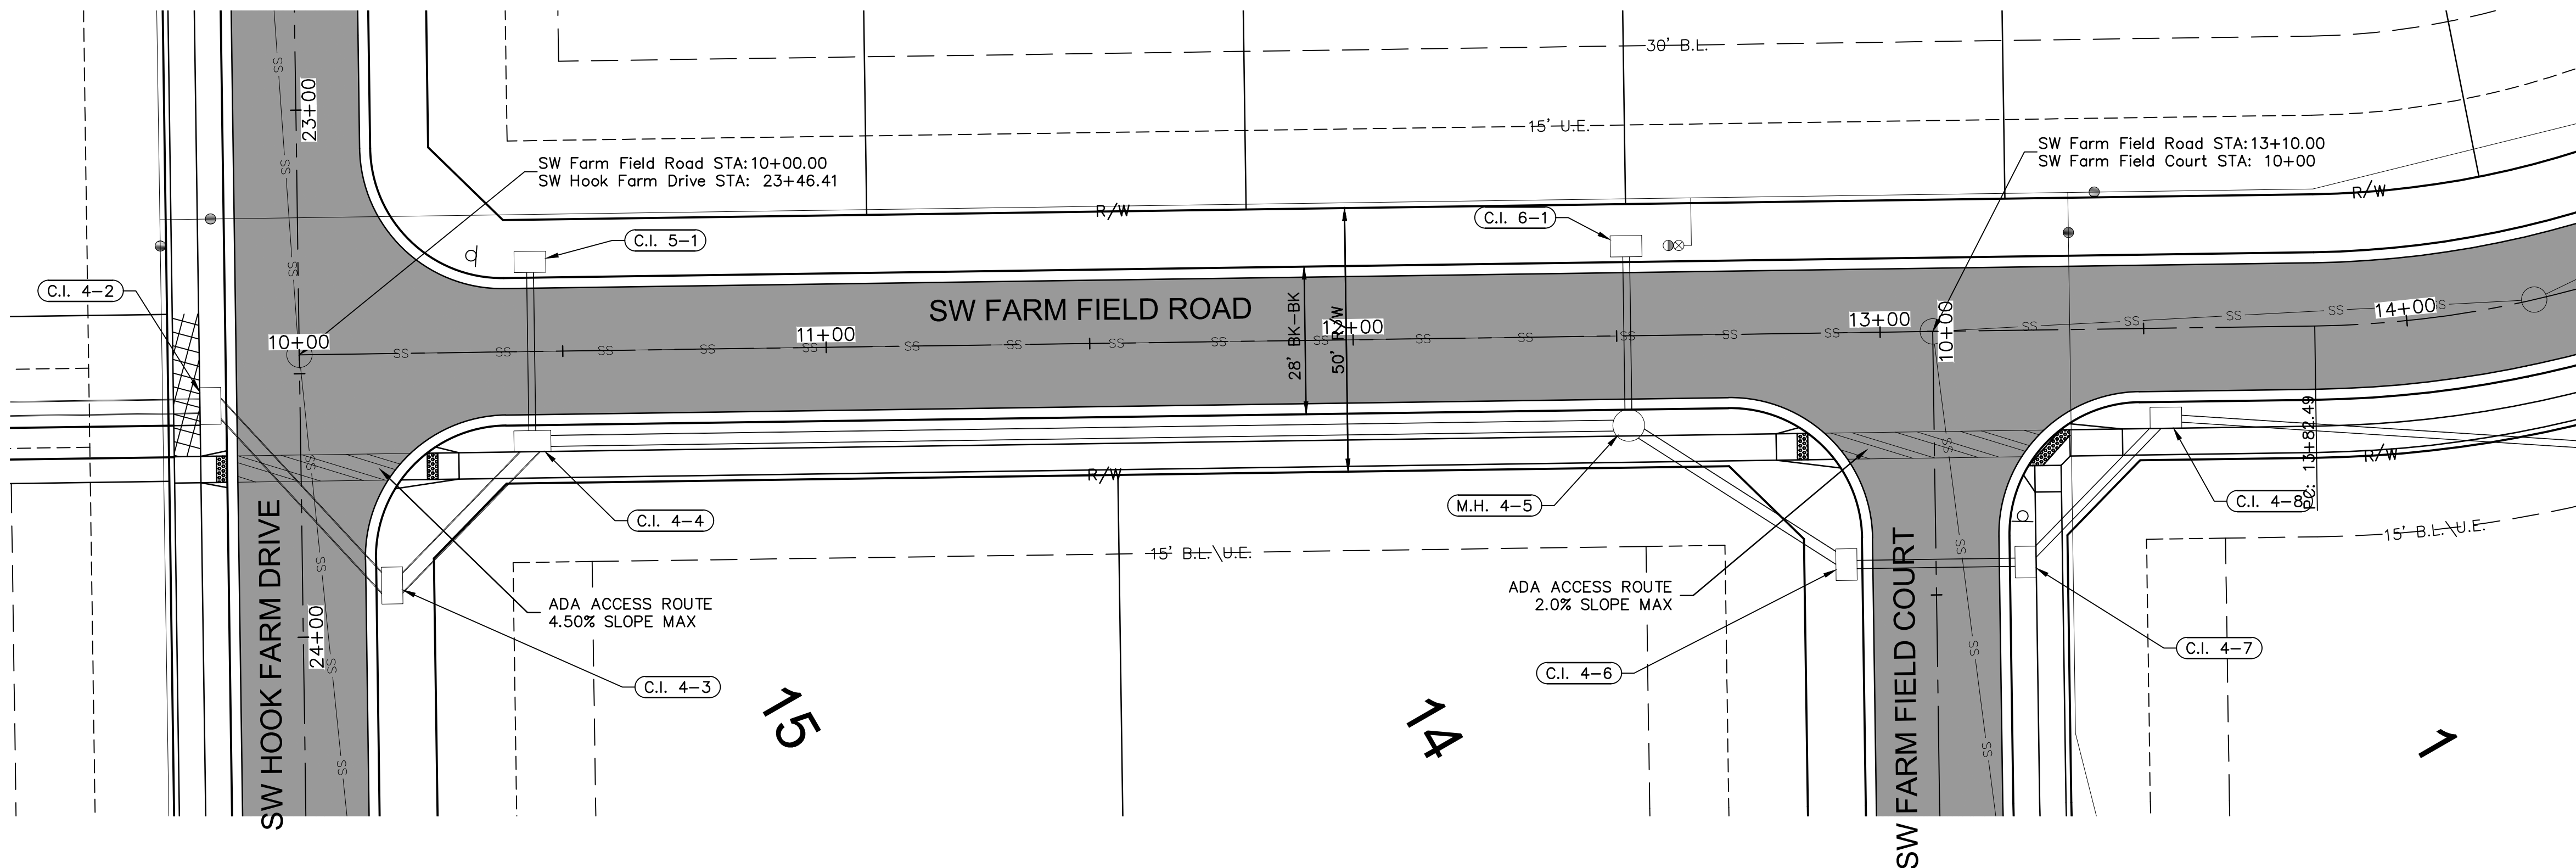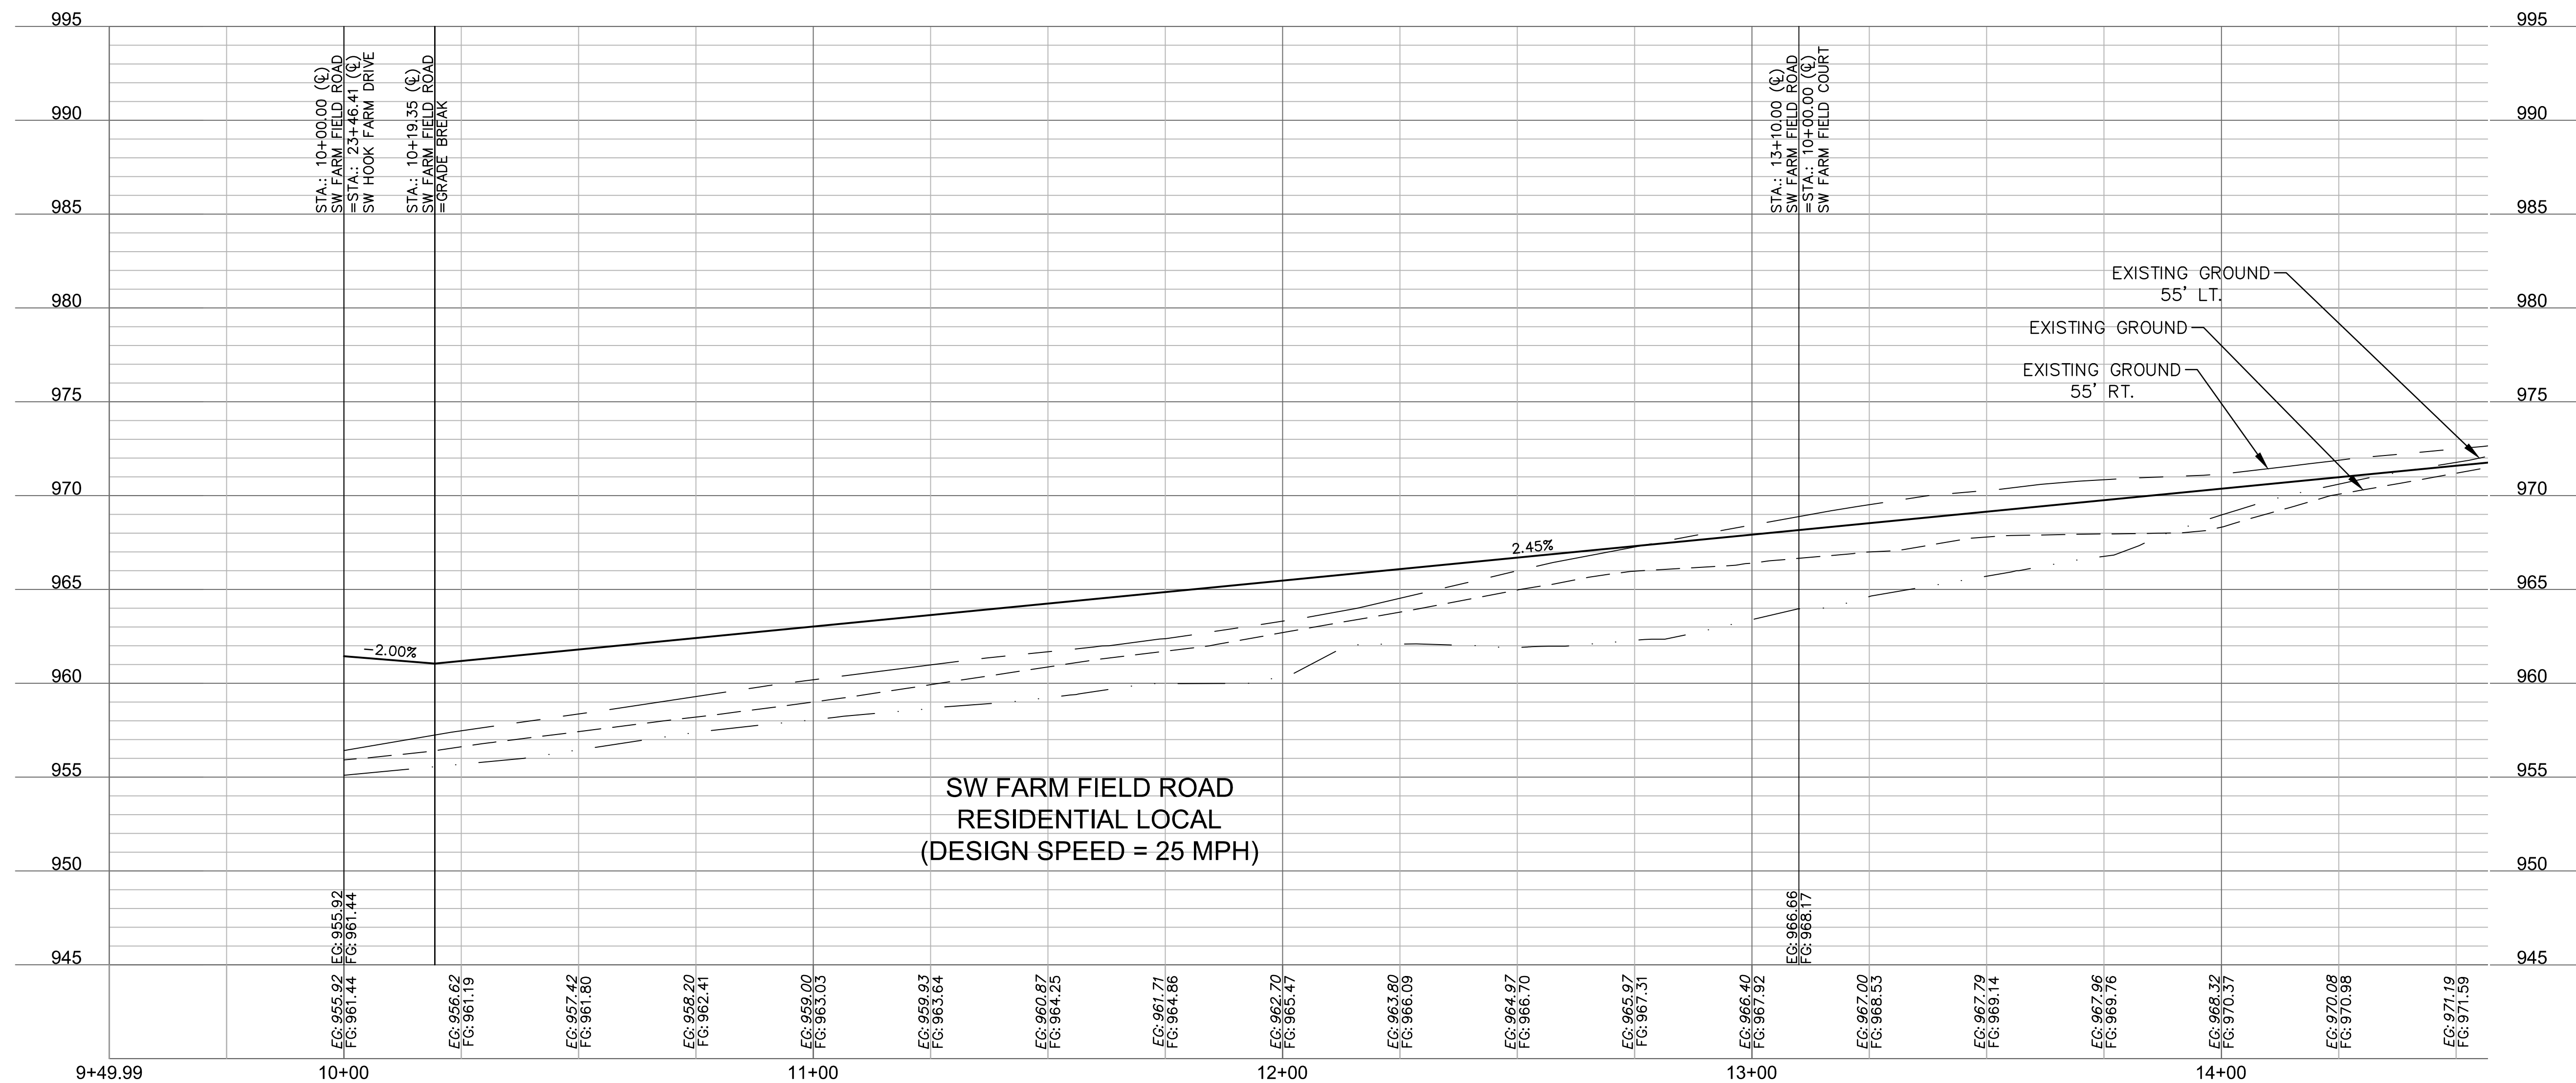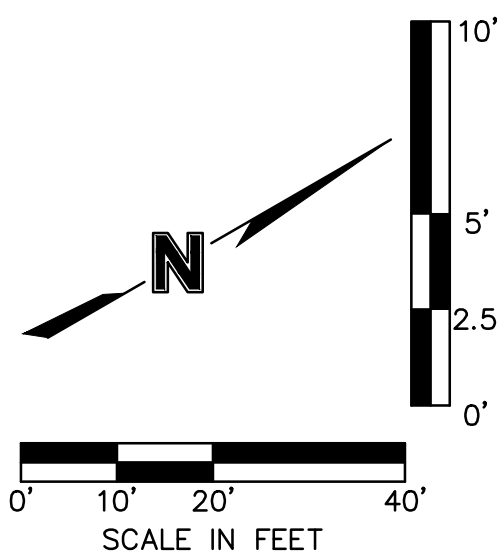

LEGEND	
	ADA ACCESS ROUTE
	ASPHALT PAVEMENT
	CG-2 CURB & GUTTER

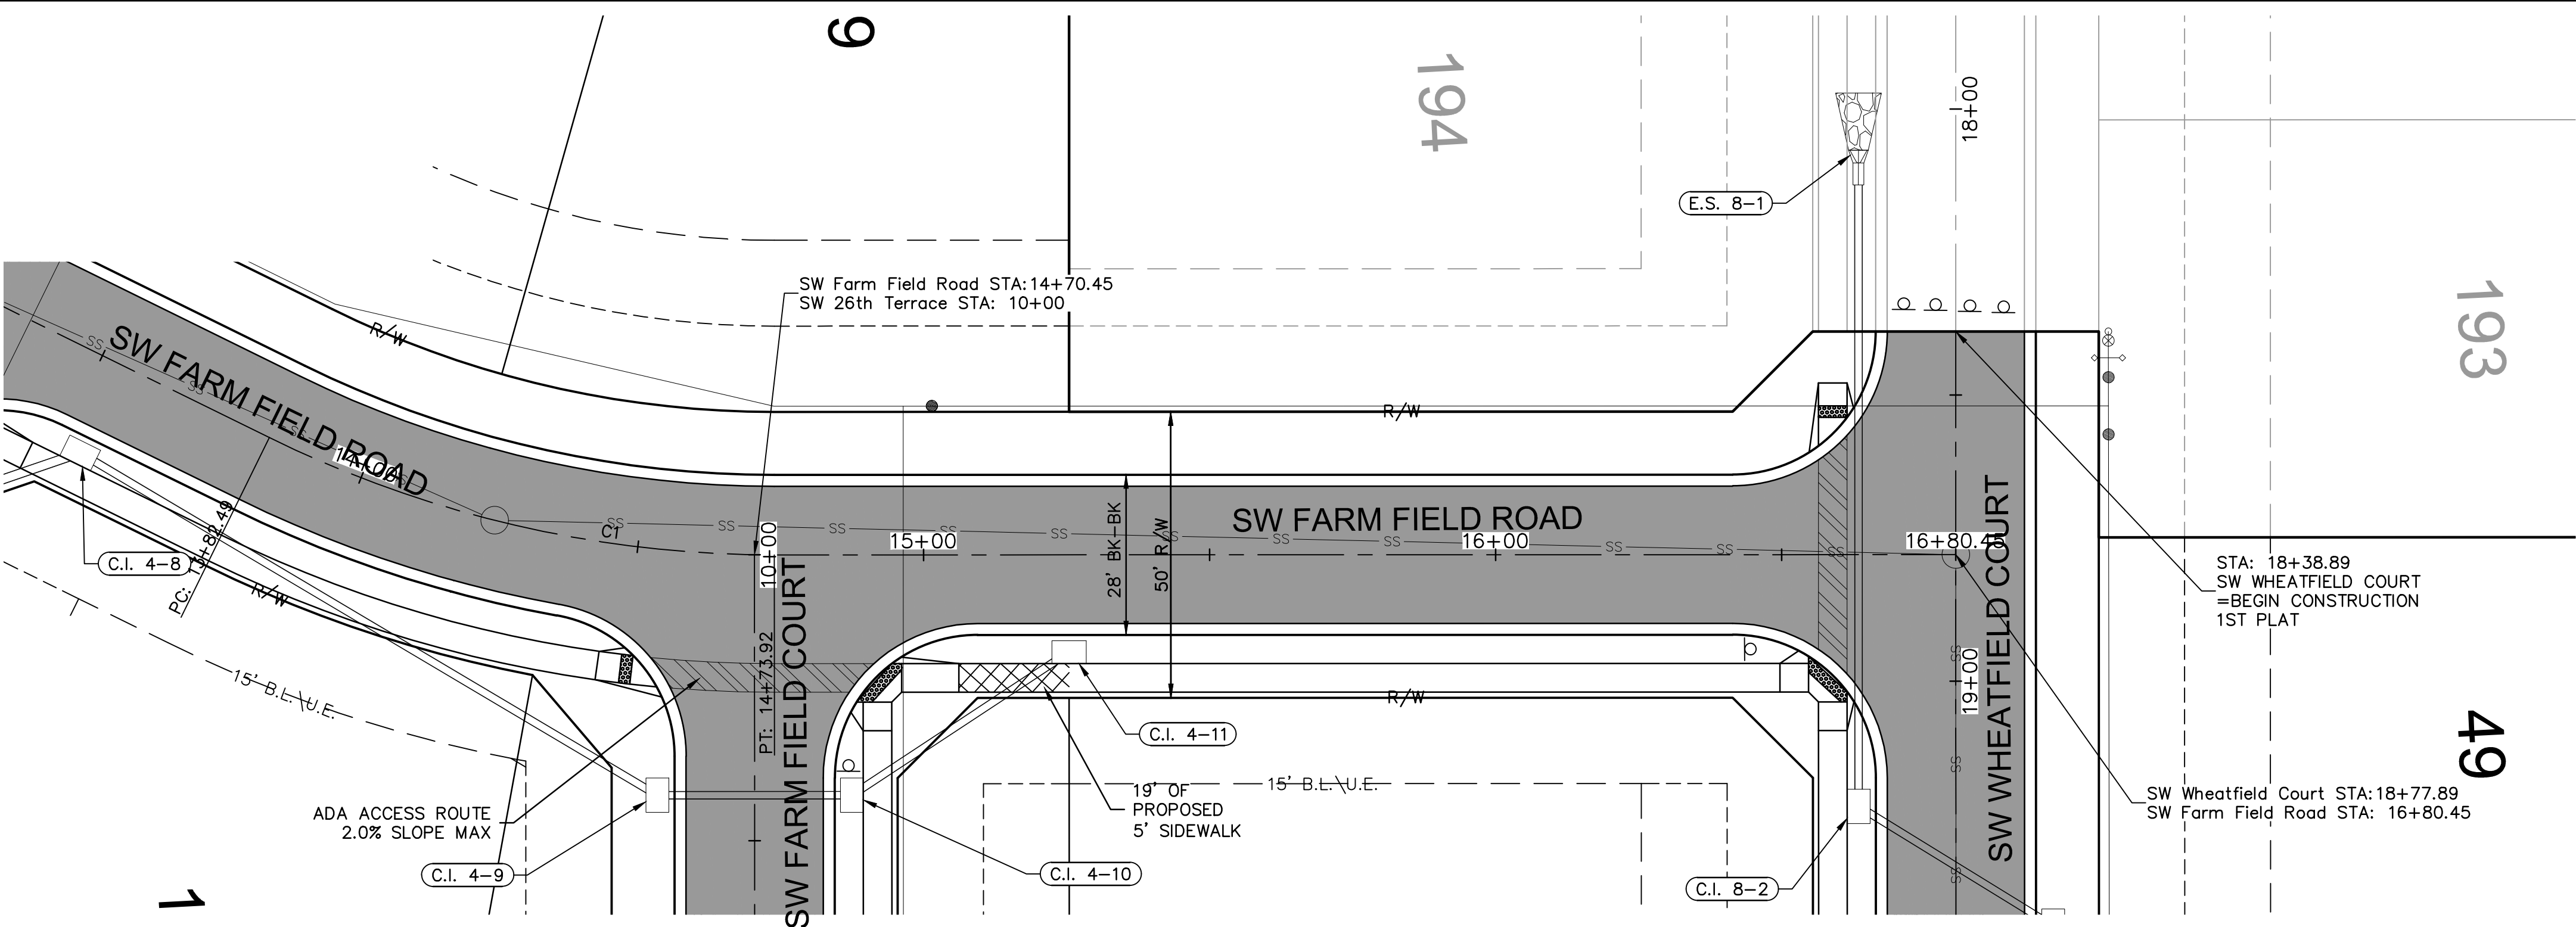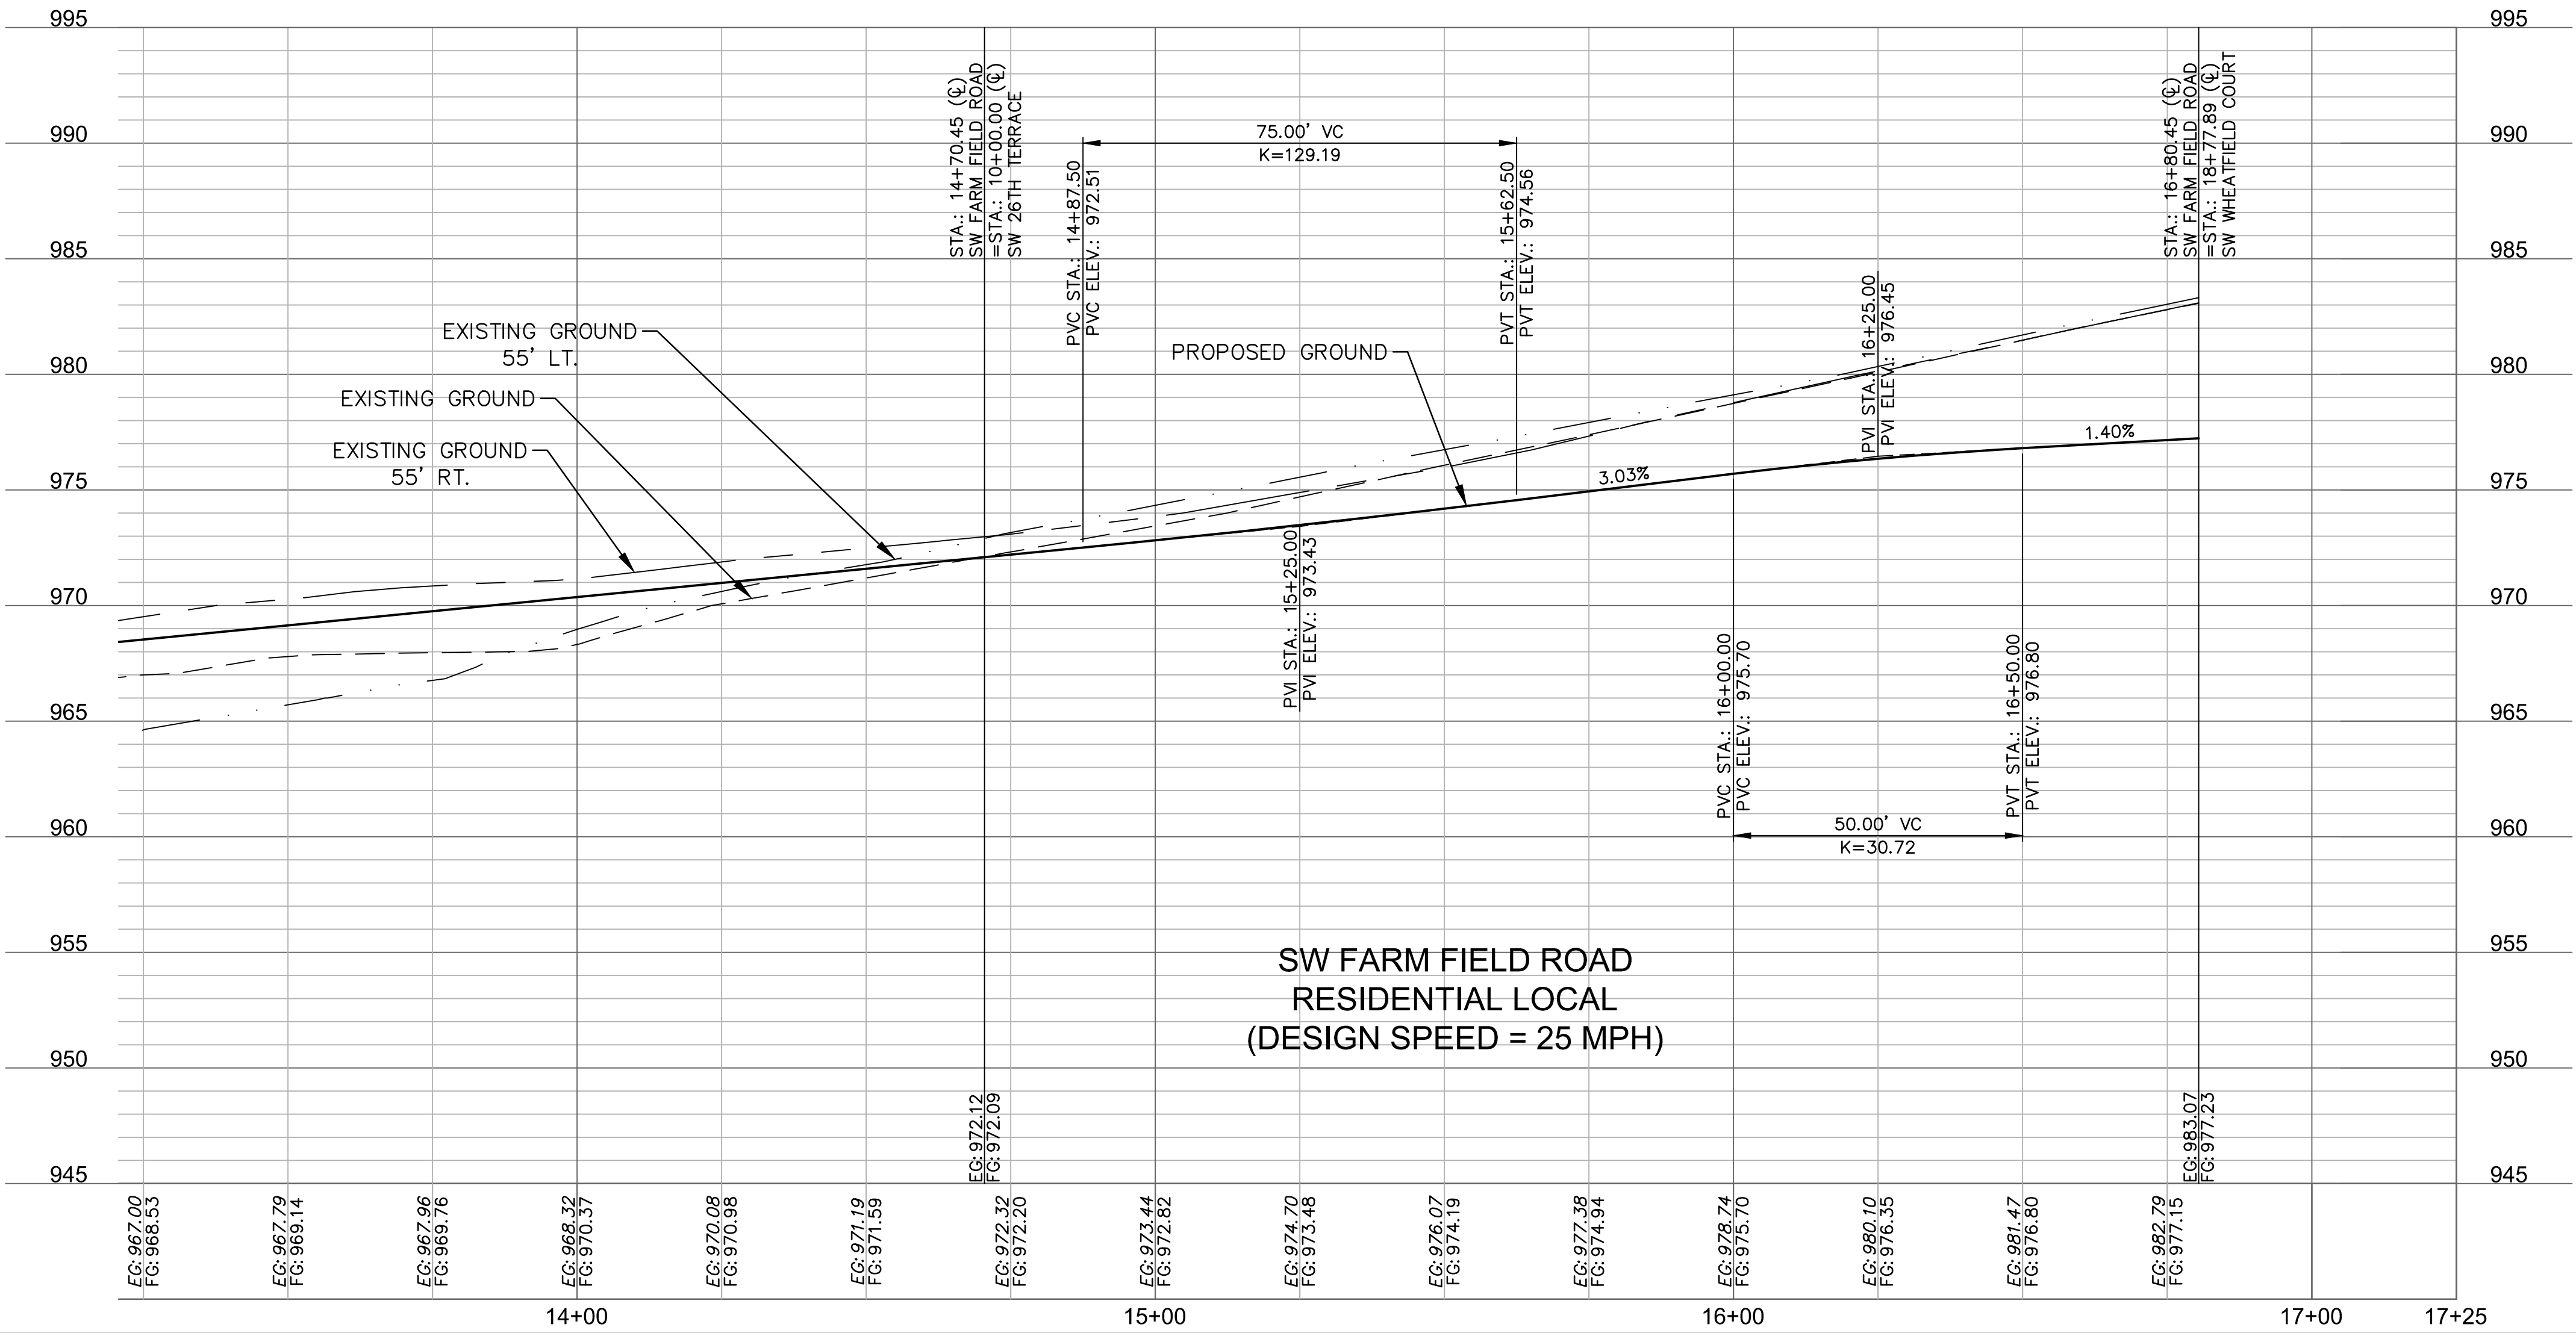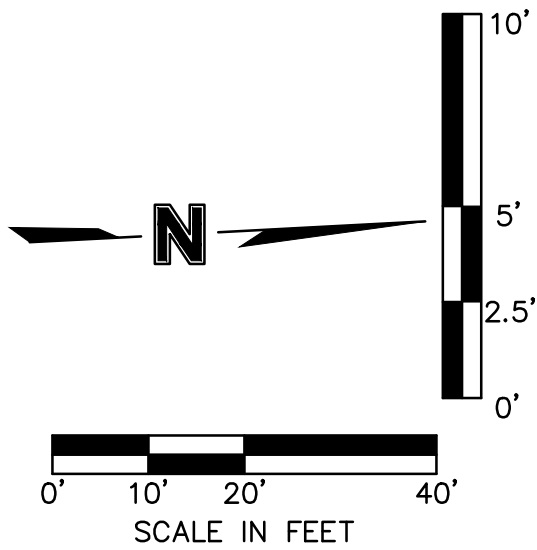

ALIGNMENT CURVES								
CURVE ID #	STATION RANGE	START COORD.	END COORD.	RADIUS (FT)	LENGTH (FT)	DELTA	TANGENT	P.I. STATION (BACK)
C1	13+82.49 14+73.92	N: 985784.58 E: 2811914.27	N: 985871.67 E: 2811939.38	200.00	91.43	026°11'37"	46.53	14+27.39

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER

BY	
REV.	
NO.	
DATE	
REVISIONS DESCRIPTION	

ROADWAY PLAN & PROFILE (SW FARM FIELD ROAD)
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO



drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020



SHEET
C113

2020

REVISIONS

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\GNCV\Street and Storm Plans\VC_RPP01_0194061.dwg
DATE: Apr 20, 2020 1:56pm
XREFS: C_P\BLK_0194061_34x22 C_P\BNDY_0194061 C_P\BASE_0194061 C_P\BASE_0194061 C_P\PSURF_0194061 C_P\UTIL_0194061 C_P\PAVT_0194061 C_P\STRM_0194061
USER: rneiser

LEGEND	
	ADA ACCESS ROUTE
	ASPHALT PAVEMENT
	CG-2 CURB & GUTTER
	PROPOSED SIDEWALK

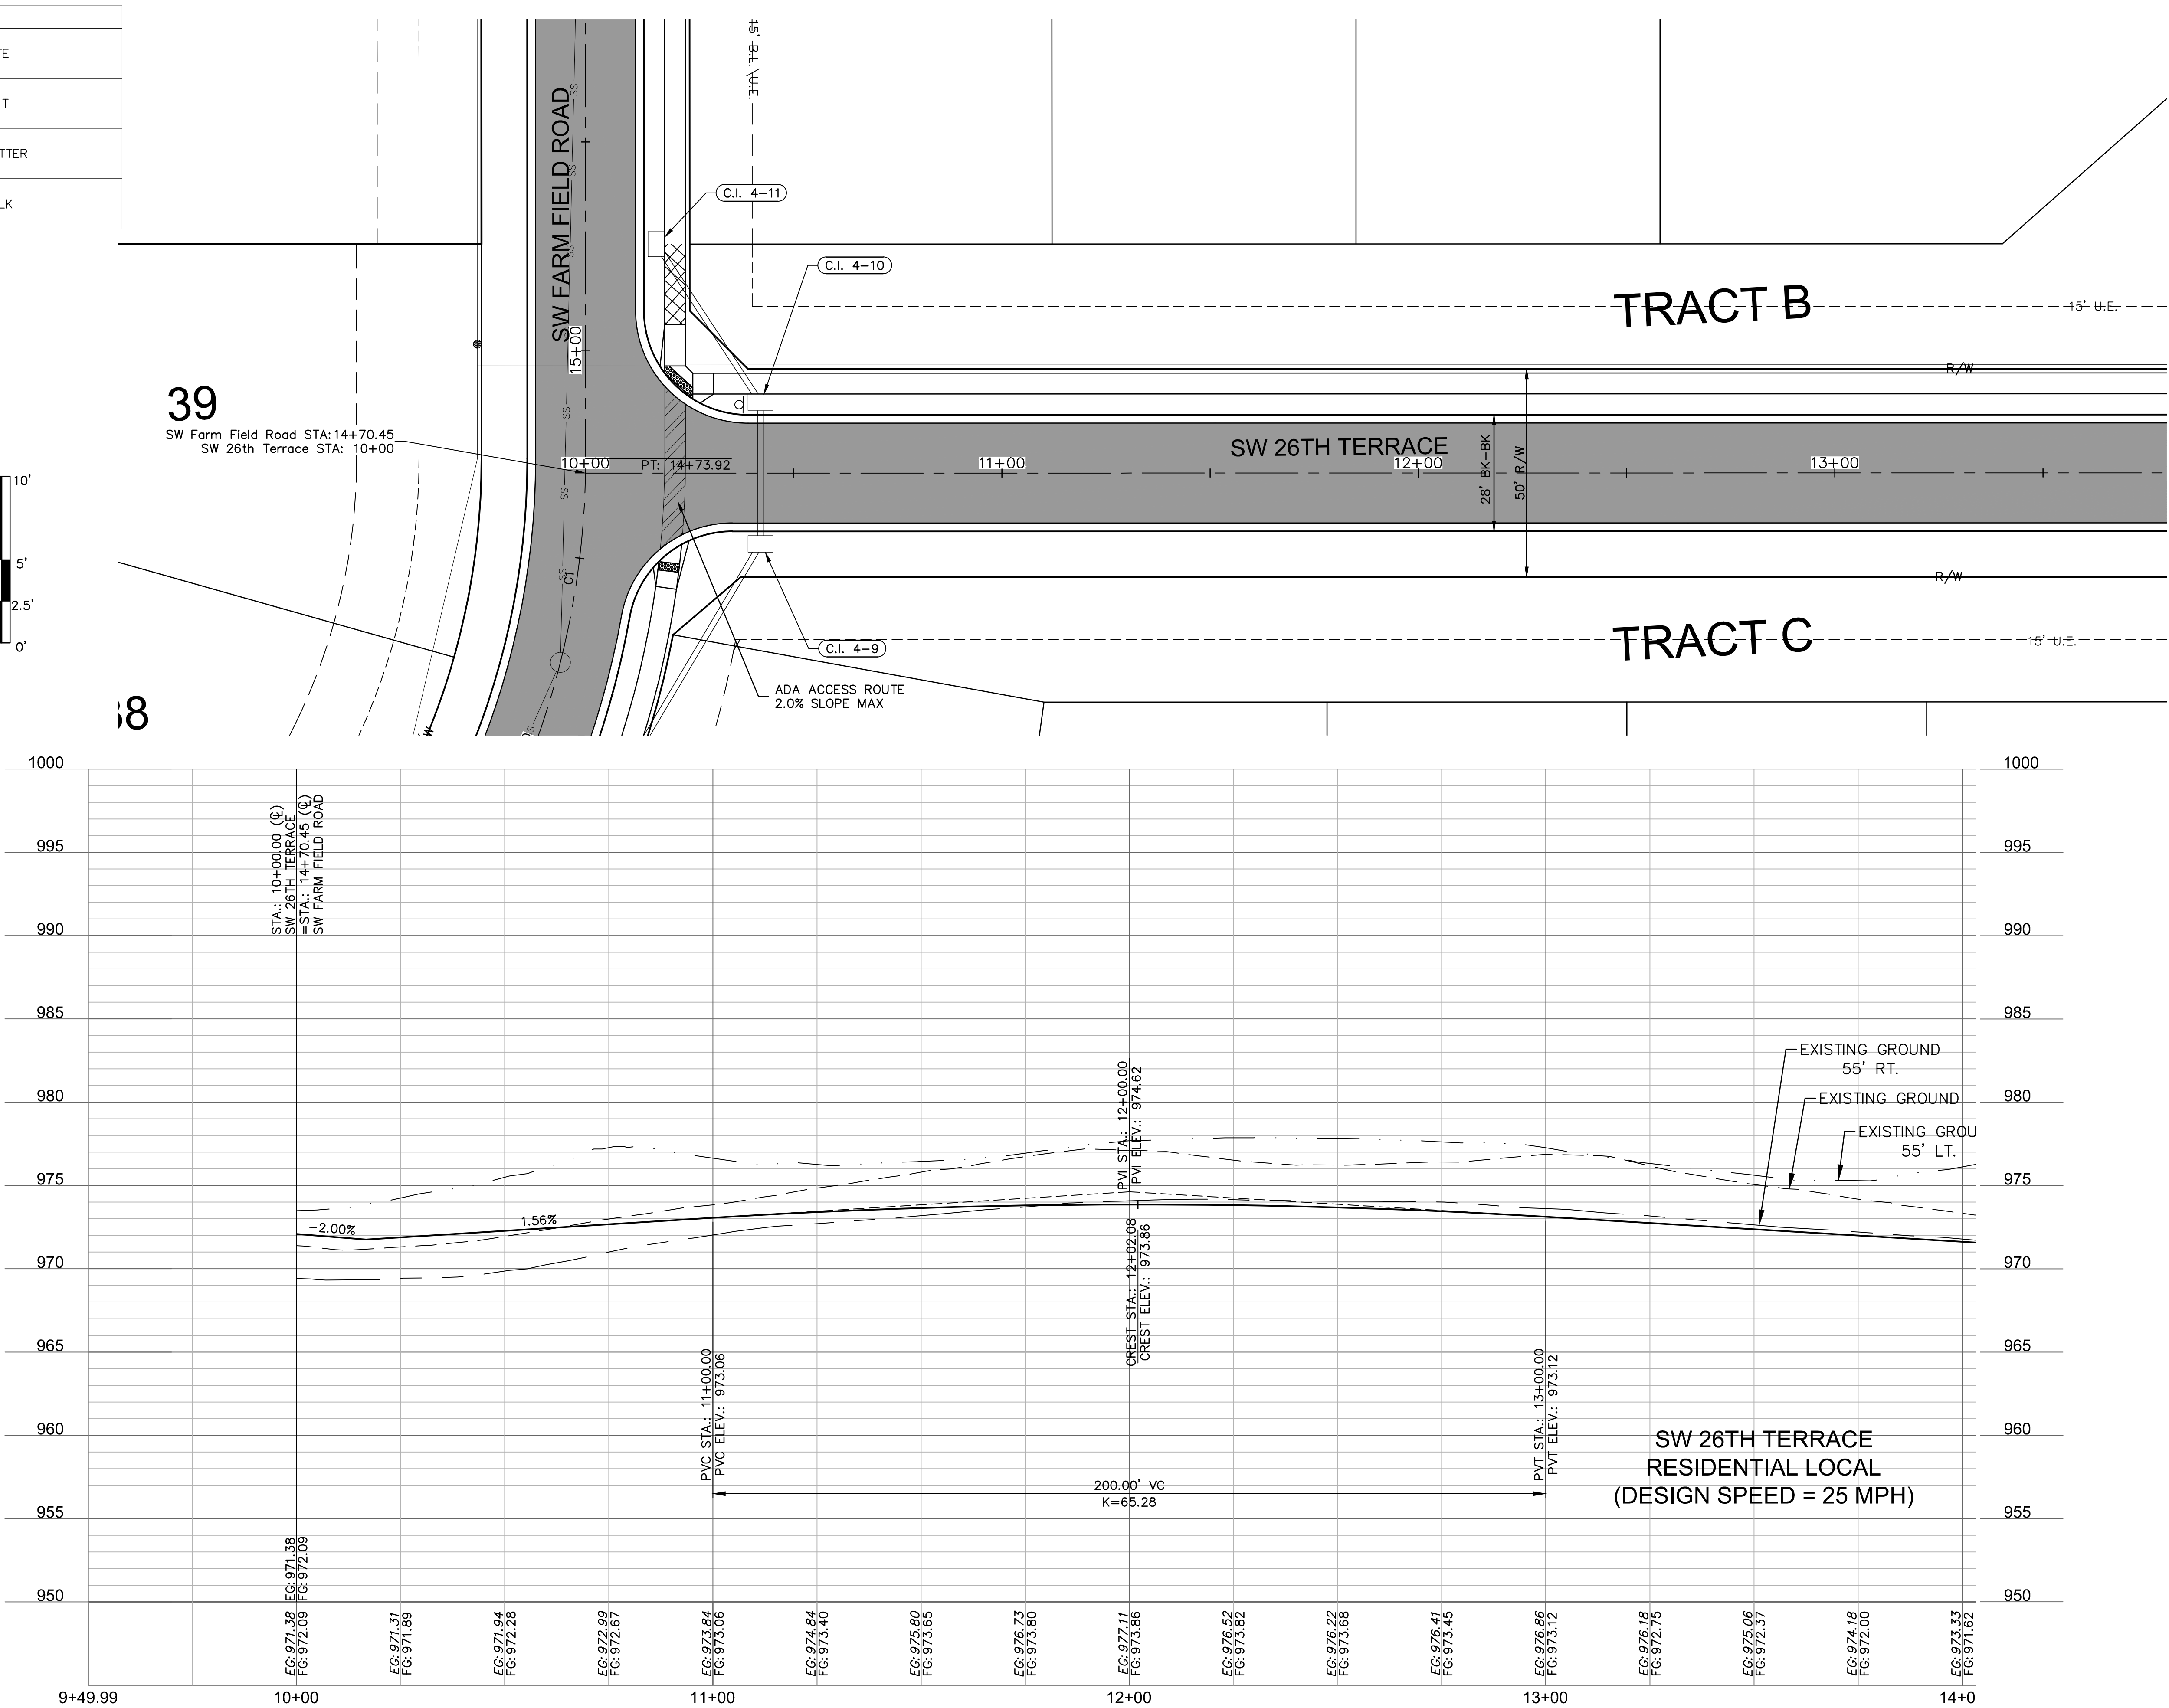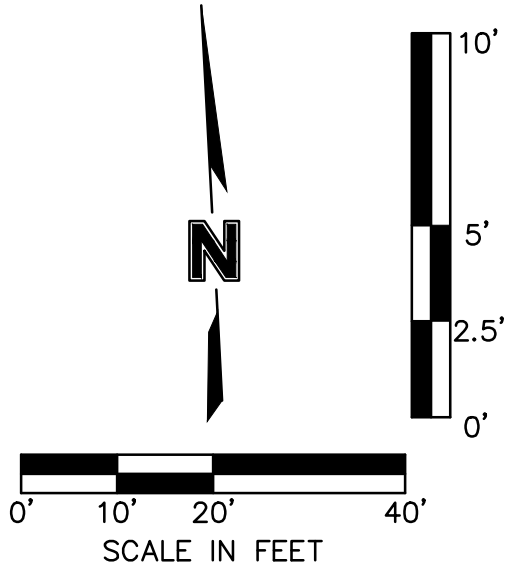

ROADWAY PLAN & PROFILE (SW 26TH TERRACE)
STREET AND STORM SEWER PLANS

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

2020

REVISIONS


REV. NO.	DATE	REVISIONS DESCRIPTION	BY




olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com




SHEET
C114

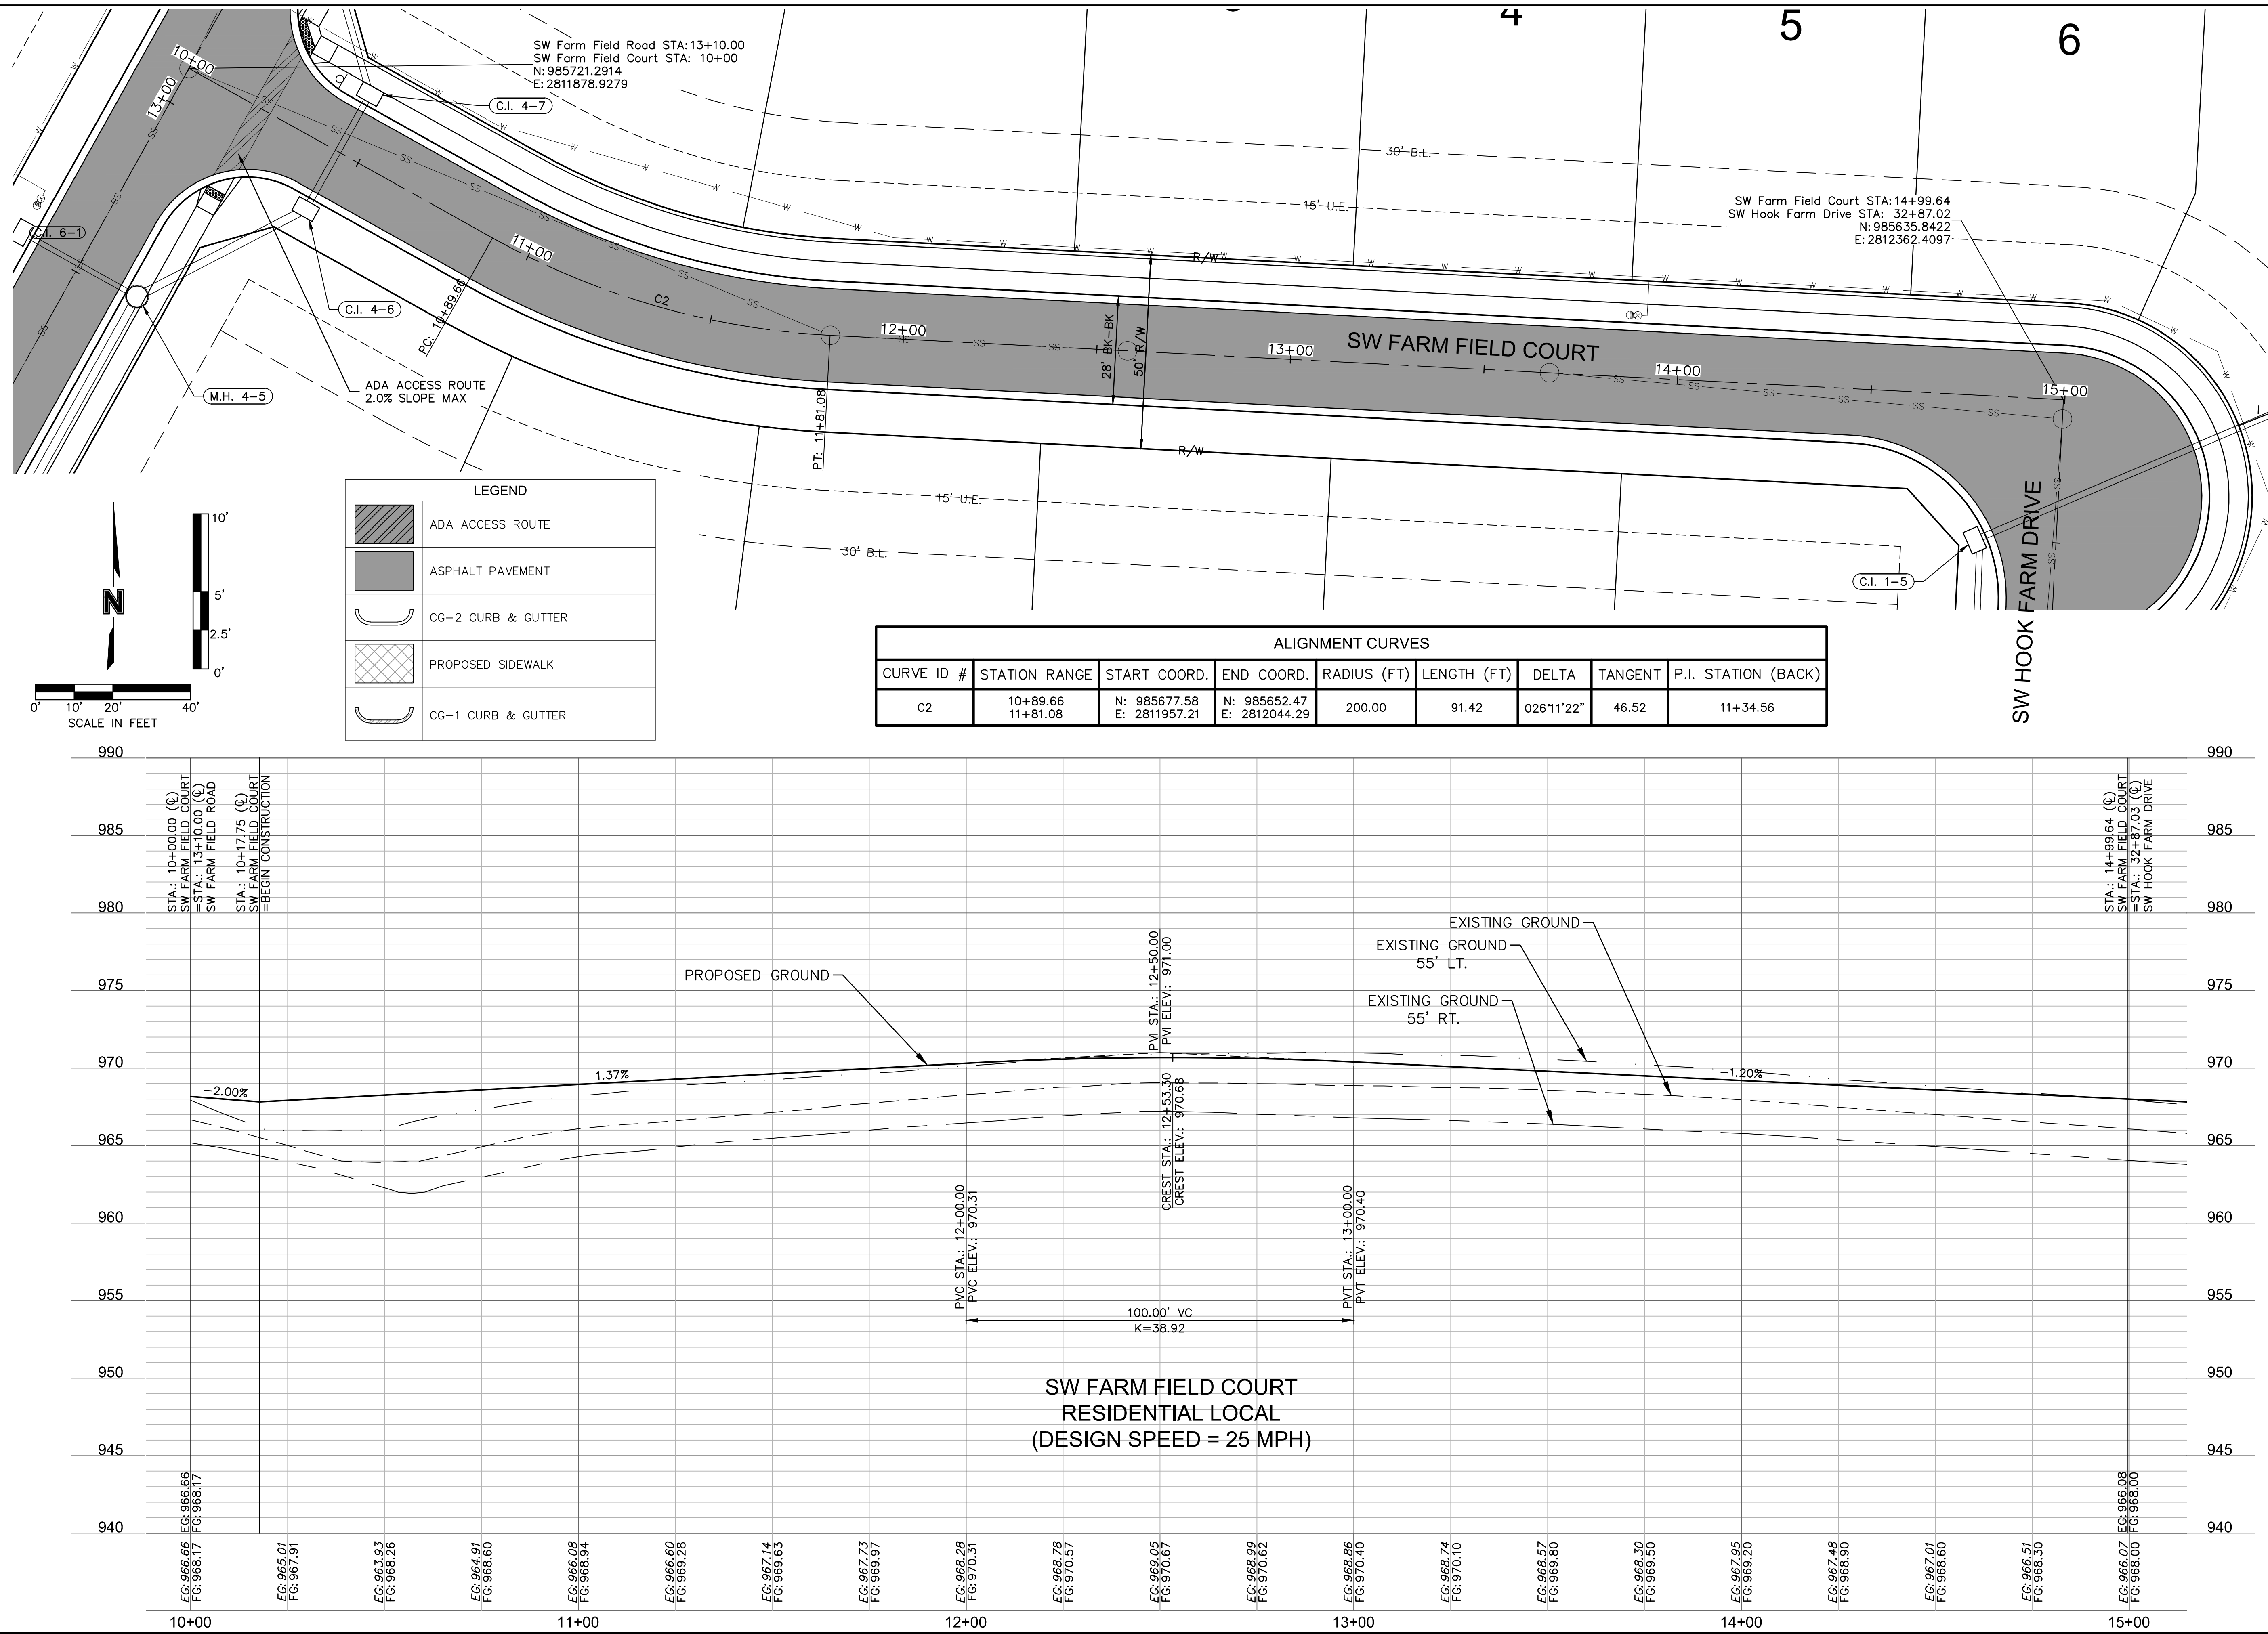

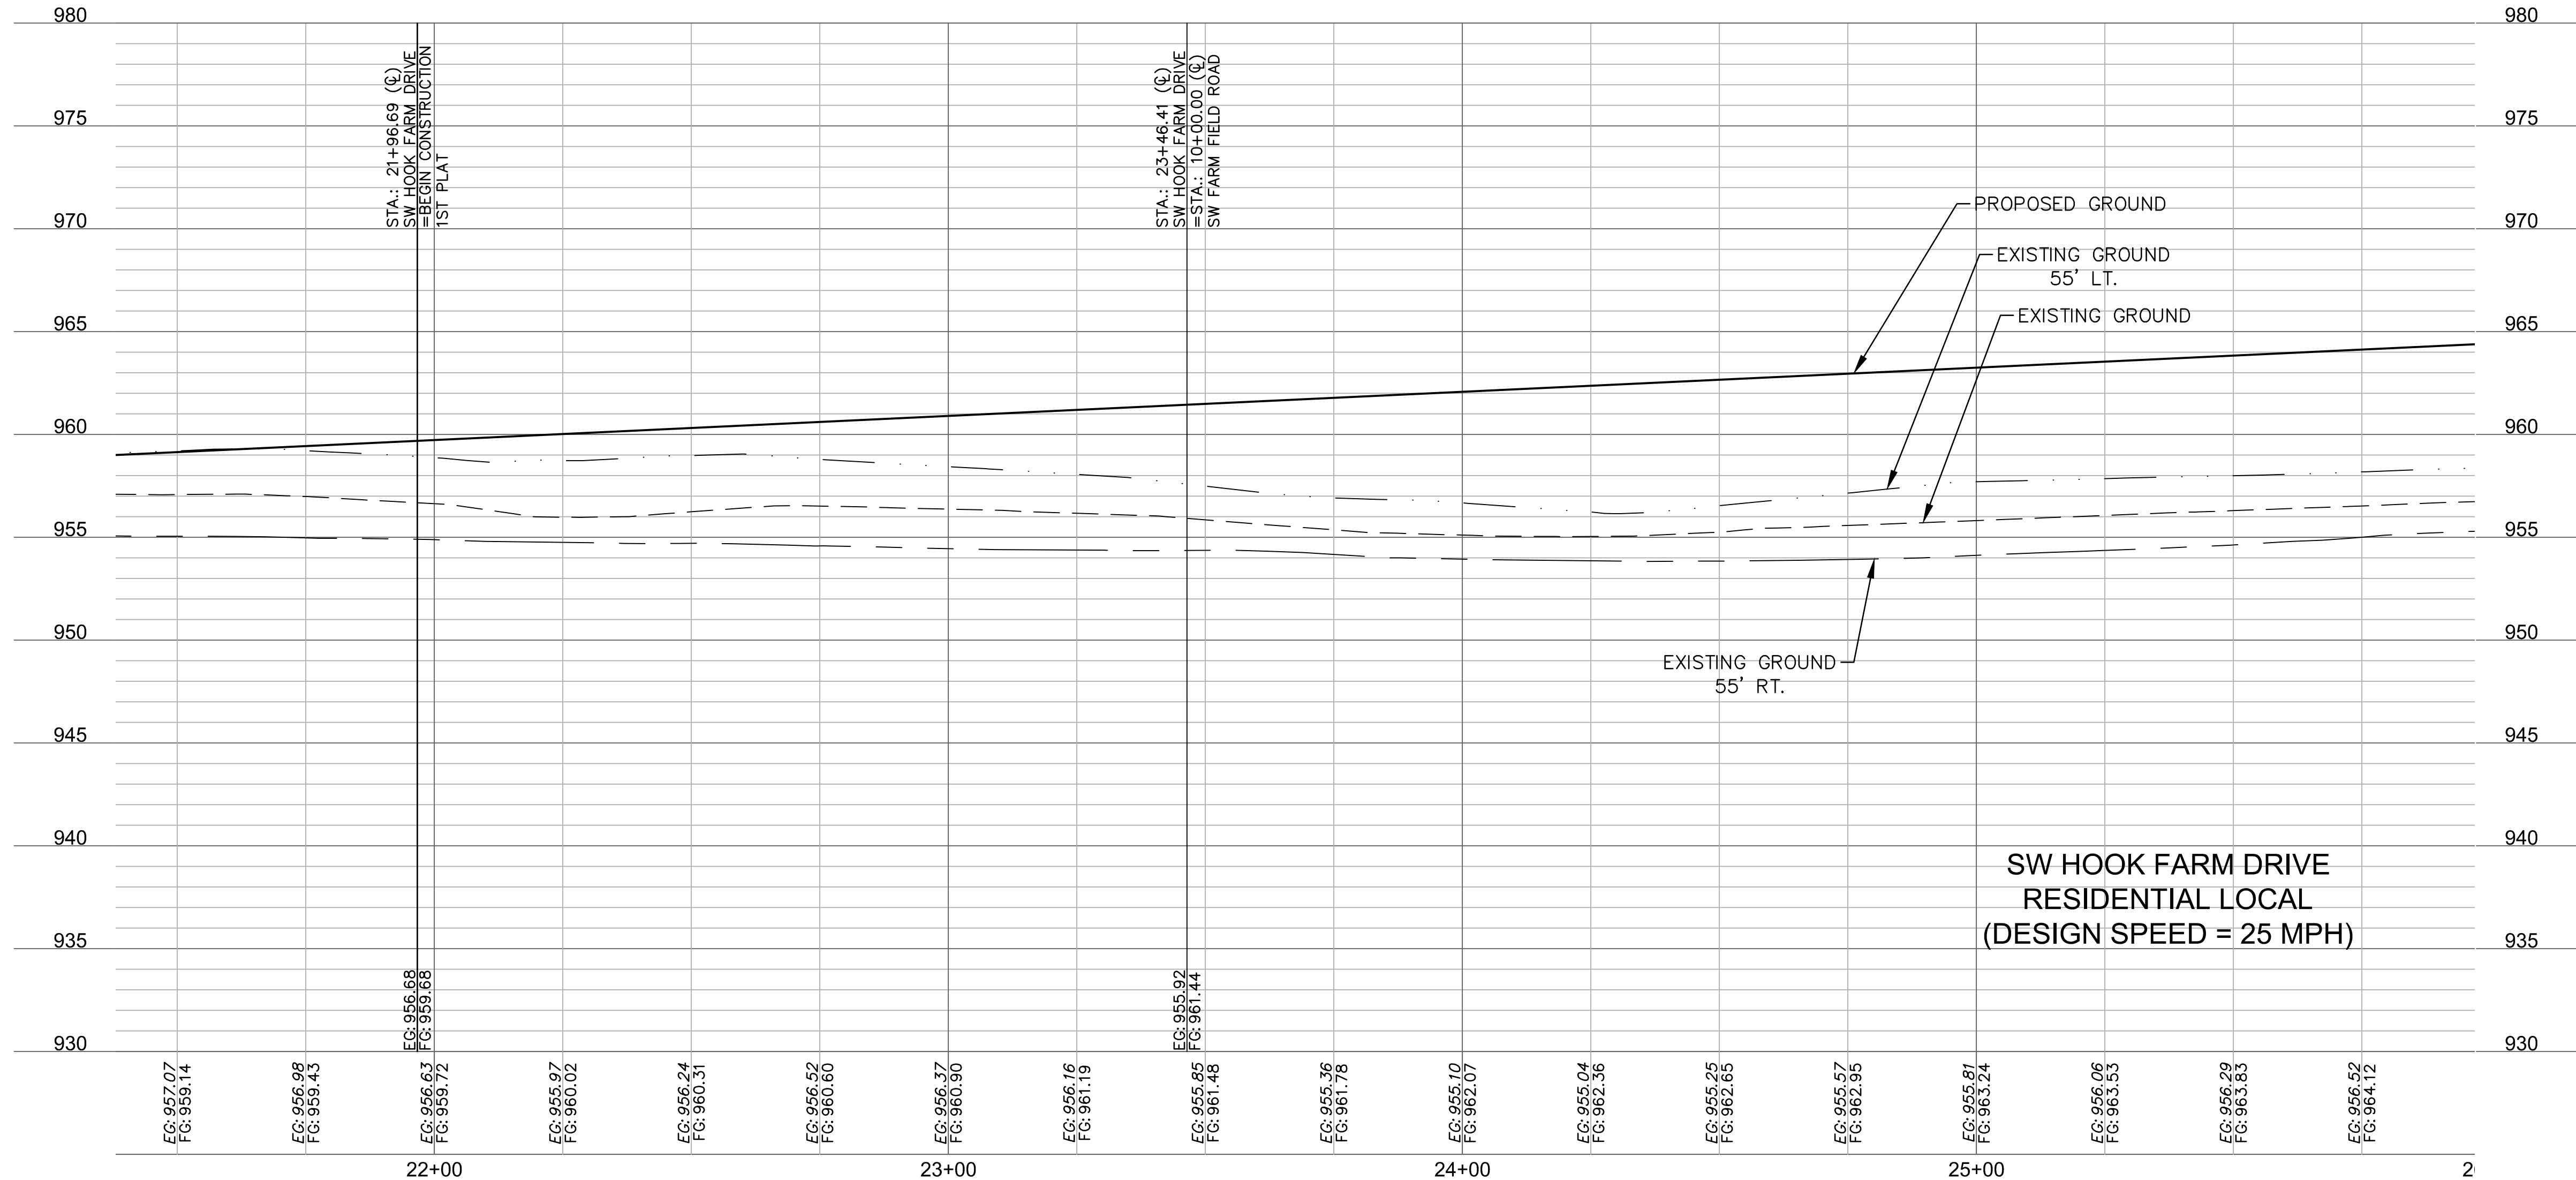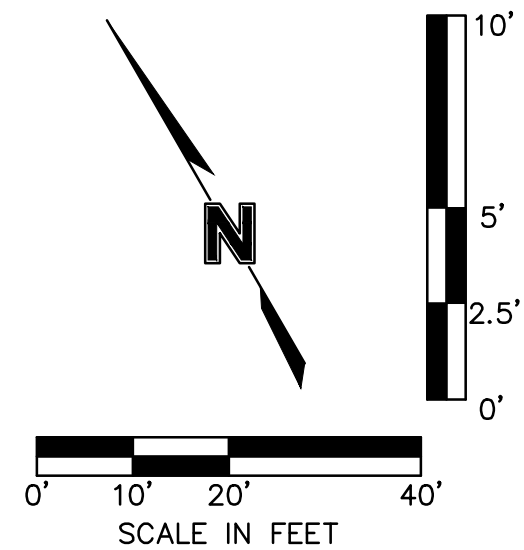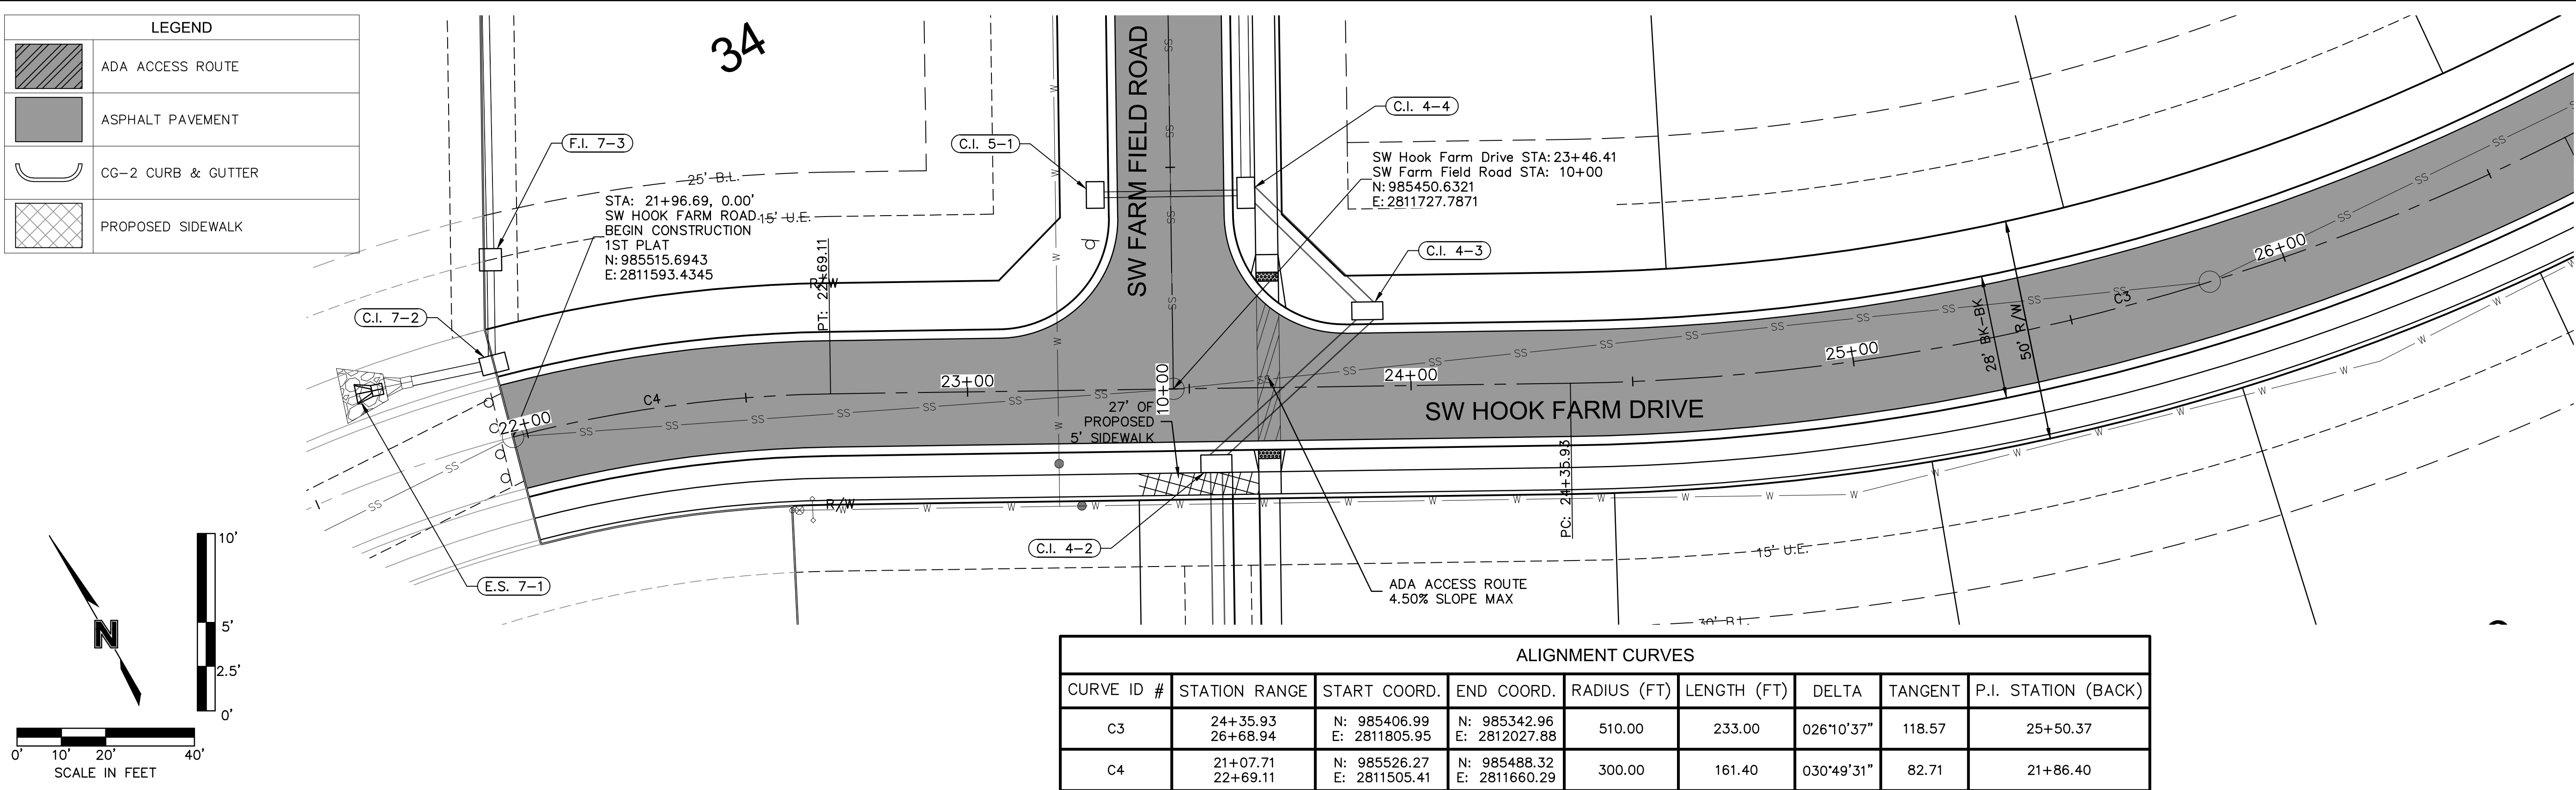



ALIGNMENT CURVES								
CURVE ID #	STATION RANGE	START COORD.	END COORD.	RADIUS (FT)	LENGTH (FT)	DELTA	TANGENT	P.I. STATION (BACK)
C3	24+35.93 26+68.94	N: 985406.99 E: 2811805.95	N: 985342.96 E: 2812027.88	510.00	233.00	026°10'37"	118.57	25+50.37
C4	21+07.71 22+69.11	N: 985526.27 E: 2811505.41	N: 985488.32 E: 2811660.29	300.00	161.40	030°49'31"	82.71	21+86.40


SE_0194061	C_PSURF_0194061	C_PPATT_0194061	C_PUTIL_0194061	C_PSTRM_0194061

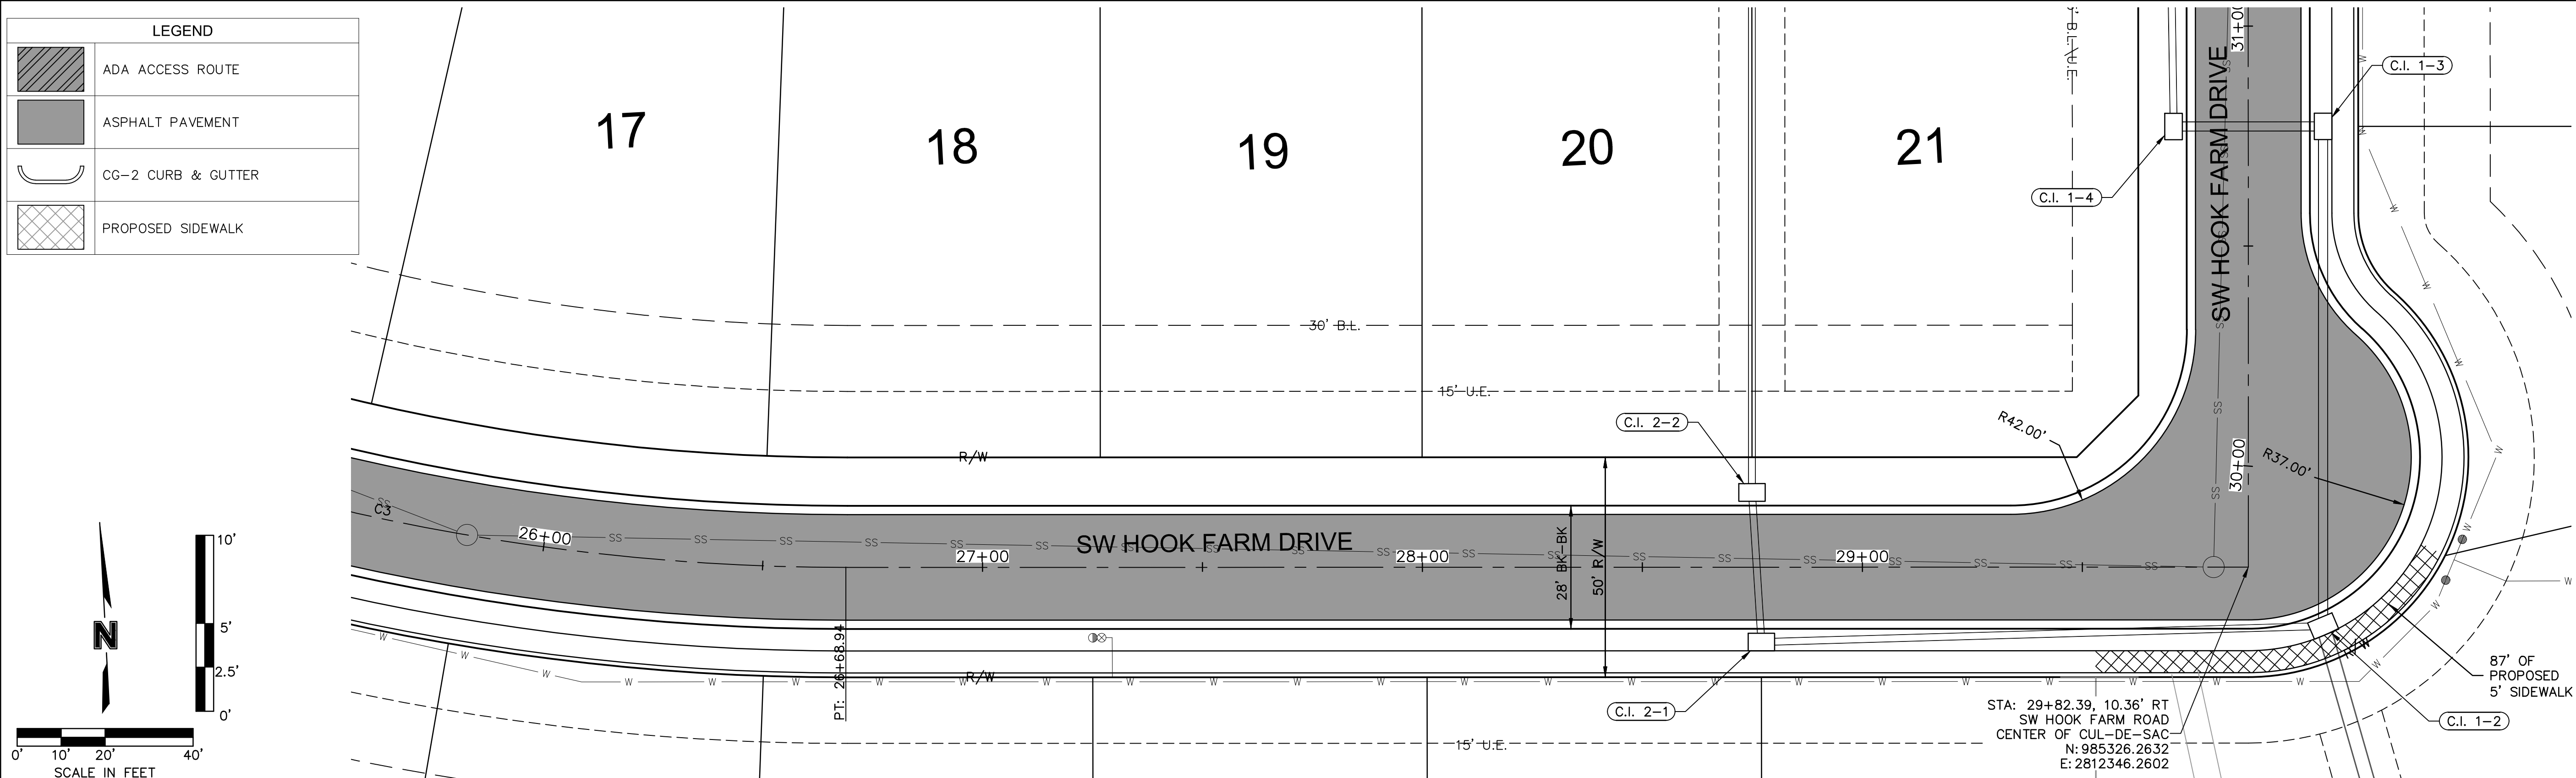

	BY			Olsson - Civil Engineering Missouri Certificate of Authority #001592 1301 Burlington Street North Kansas City, MO 64116 TEL 816.361.1177 FAX 816.361.1688 www.olson.com

LEGEND	
	ADA ACCESS ROUTE
	ASPHALT PAVEMENT
	CG-2 CURB & GUTTER
	PROPOSED SIDEWALK

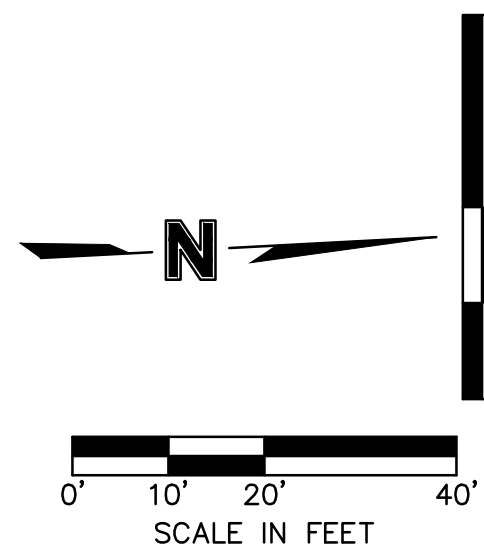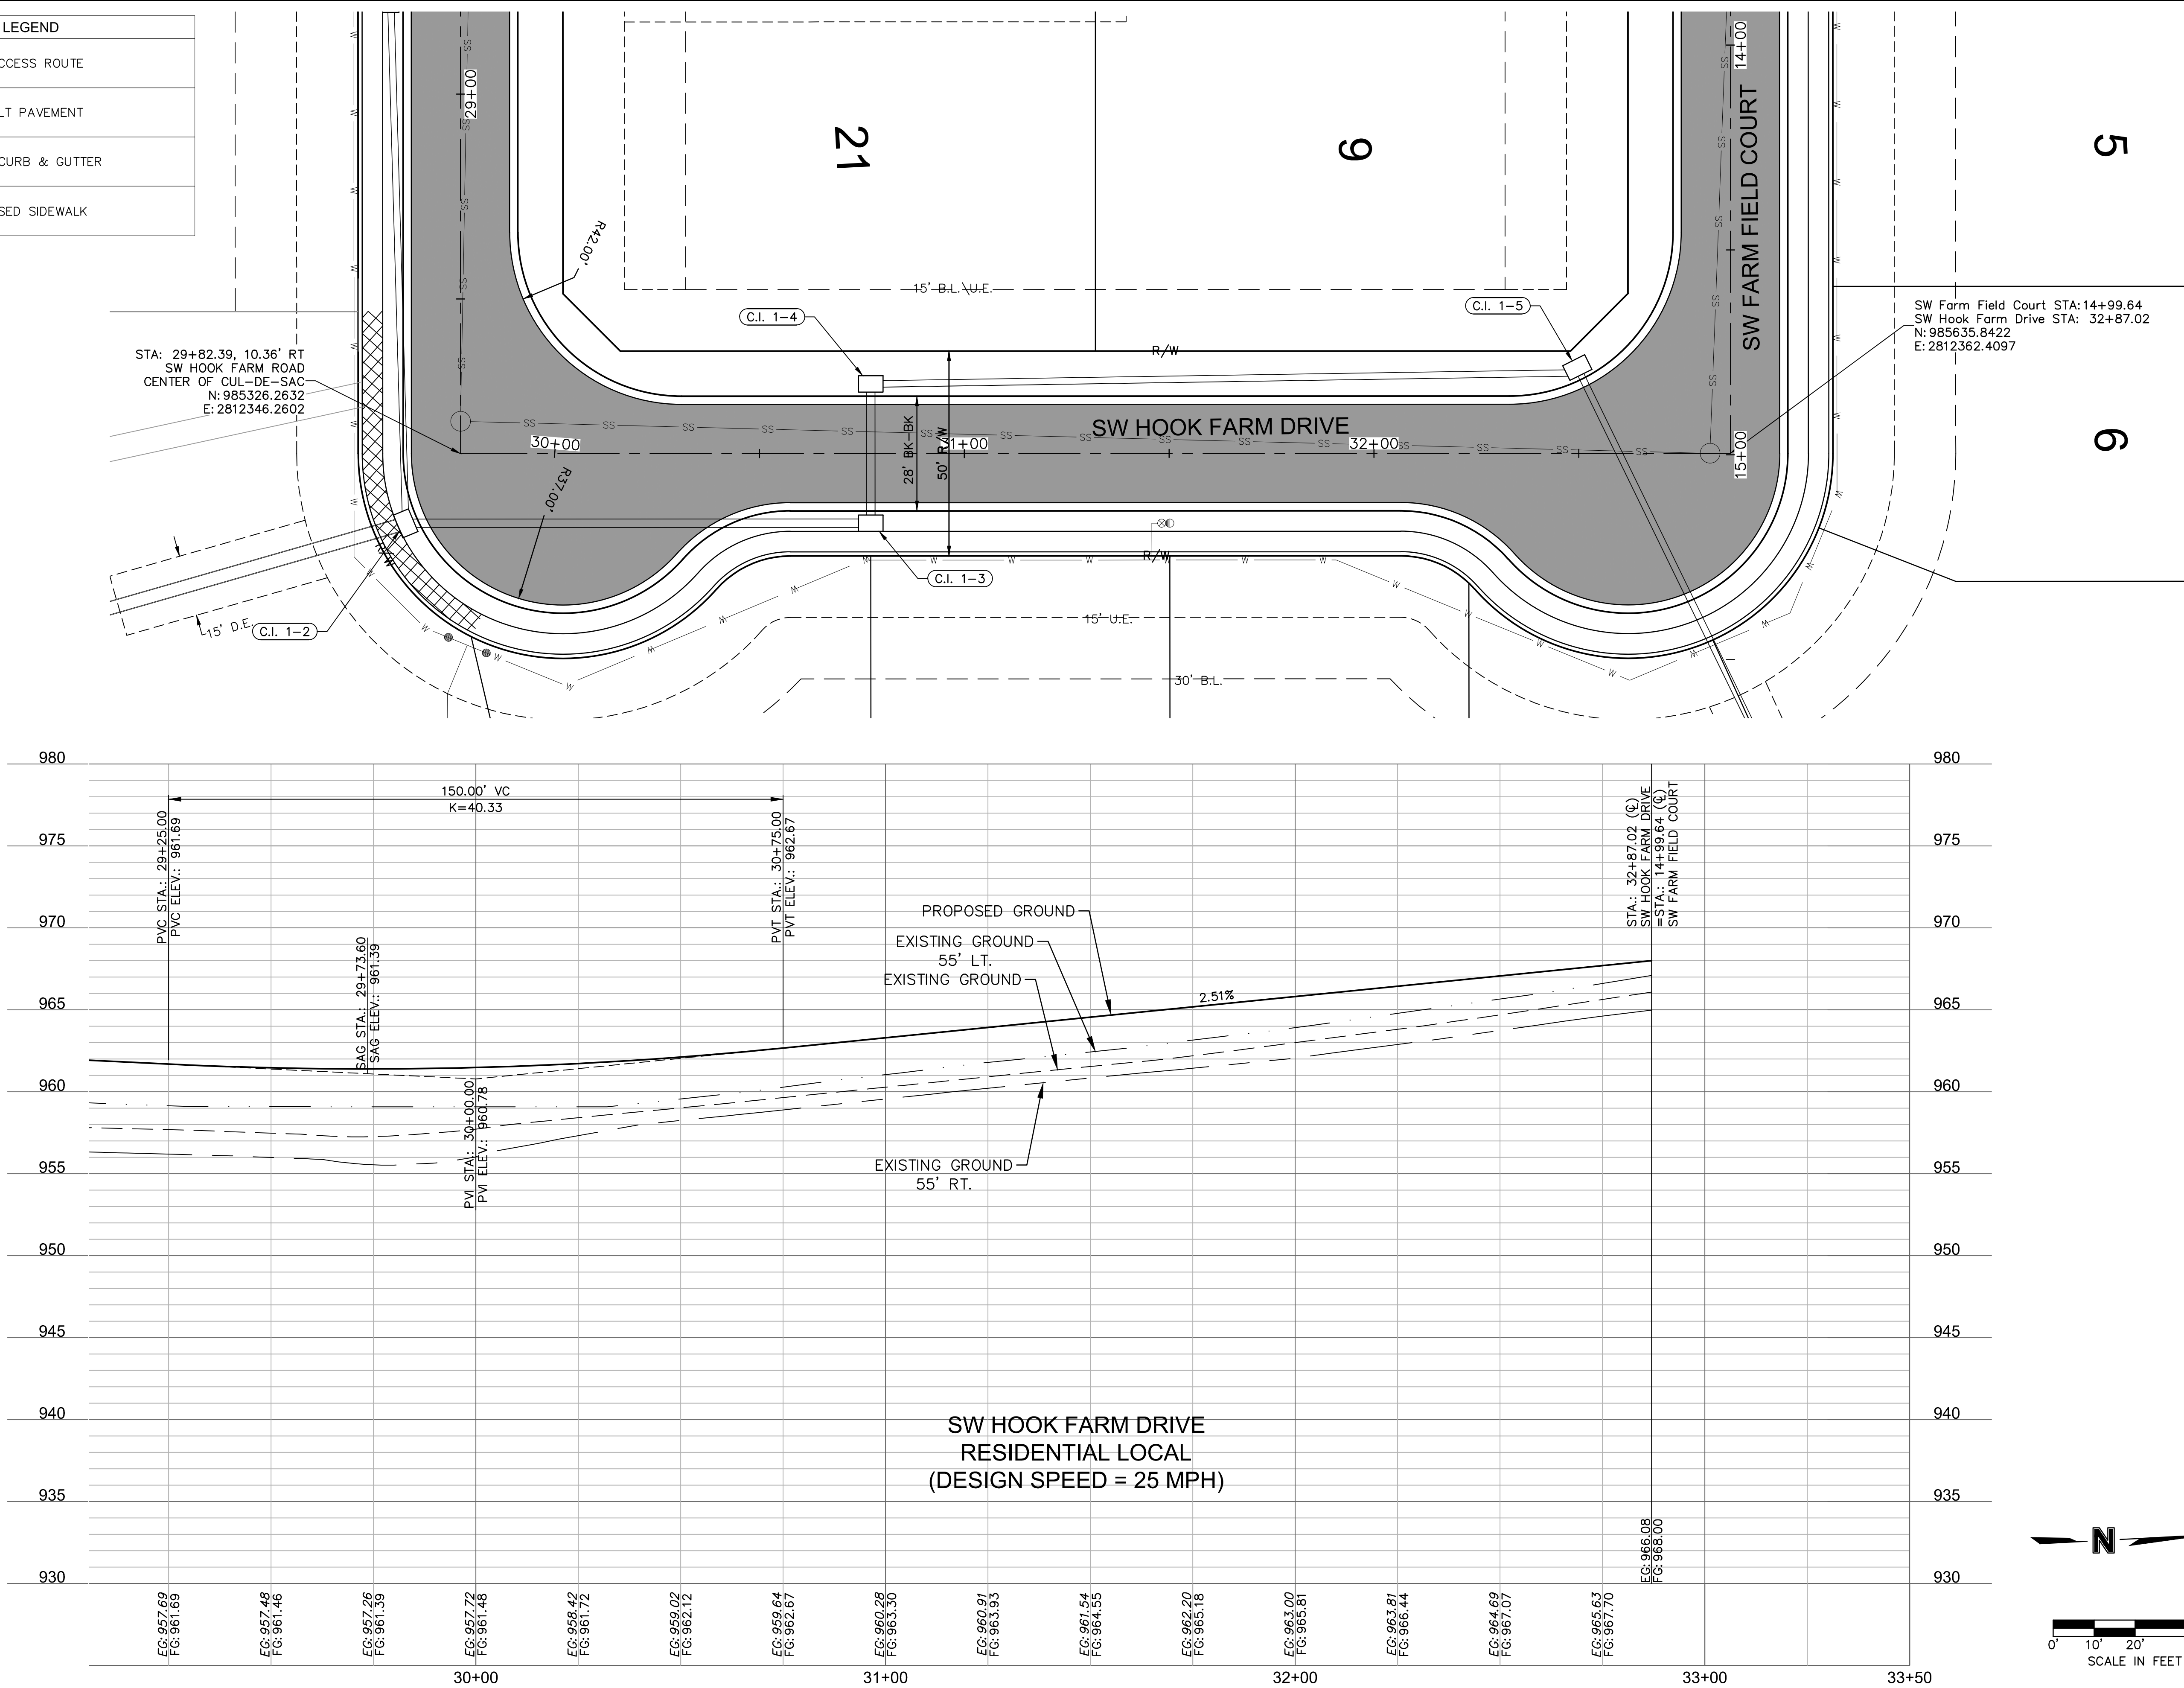

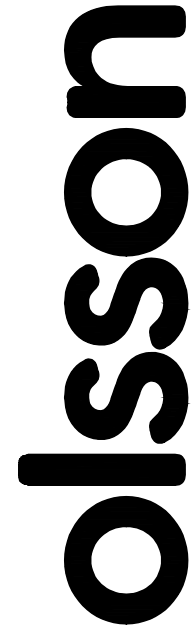

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olson.com



REVISIONS			
REV. NO.	DATE	REVISIONS DESCRIPTION	BY

ROADWAY PLAN & PROFILE (SW HOOK FARM DRIVE)
STREET AND STORM SEWER PLANS



HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020

SHEET
C119

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheet\GNCV\Street and Storm Plans\VC_TCP01_0194061.dwg USER: rneiser
DATE: Apr 20, 2020 1:59pm XREFS: C_PTBK_0194061_34x22 C_PBASE_0194061 C_PBASE_0194061 C_PBASE_0194061

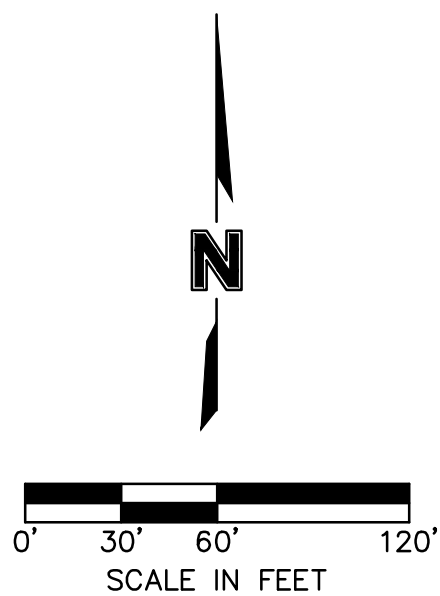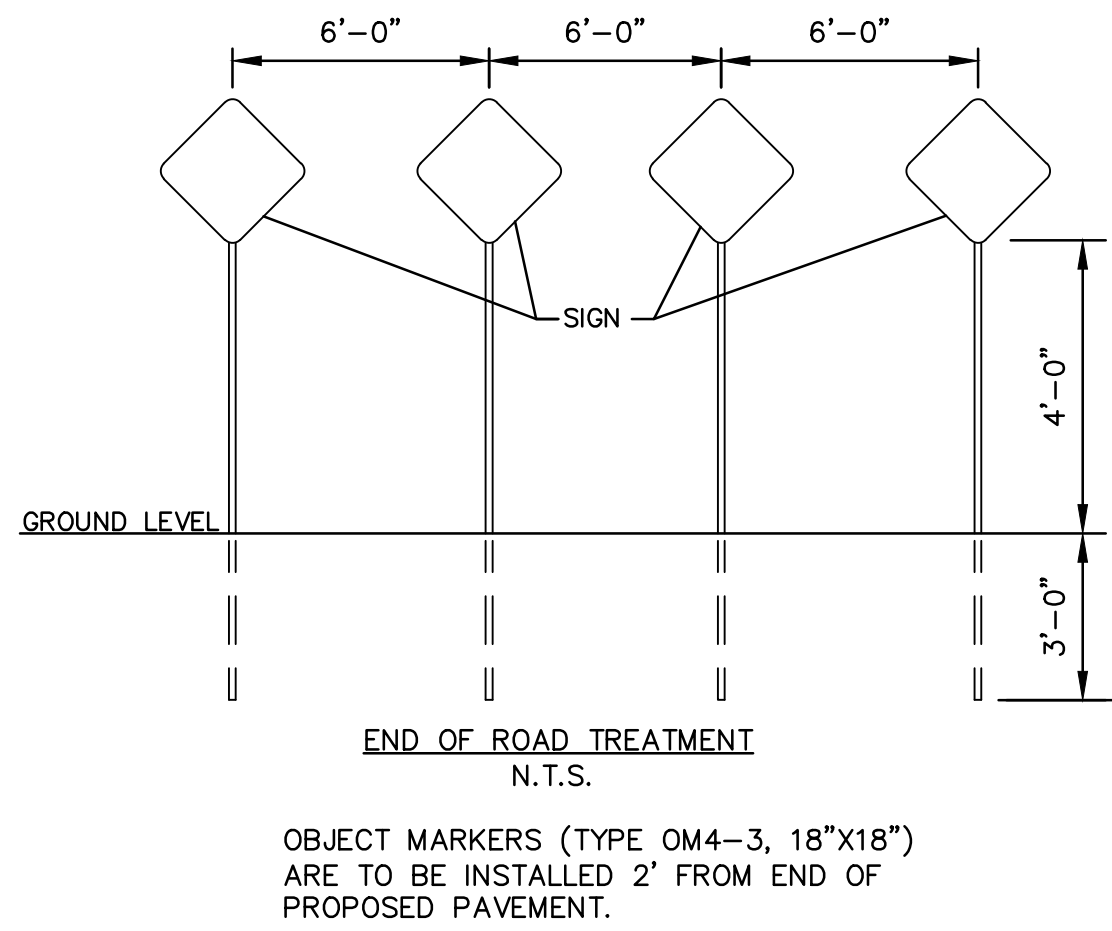

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER

BY

REVISIONS DESCRIPTION

DATE

REV. NO.

2020

TRAFFIC CONTROL PLAN
STREET AND STORM SEWER PLANS



HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020


SHEET
C120

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\GNCV\Street and Storm Plans\C_INT01_0194061.dwg
 XREFS: C:\PTBLK_0194061_34x22 C_PBN DY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_PUTIL_0194061
 DATE: Apr 20, 2020 2:01pm USER: nheiser

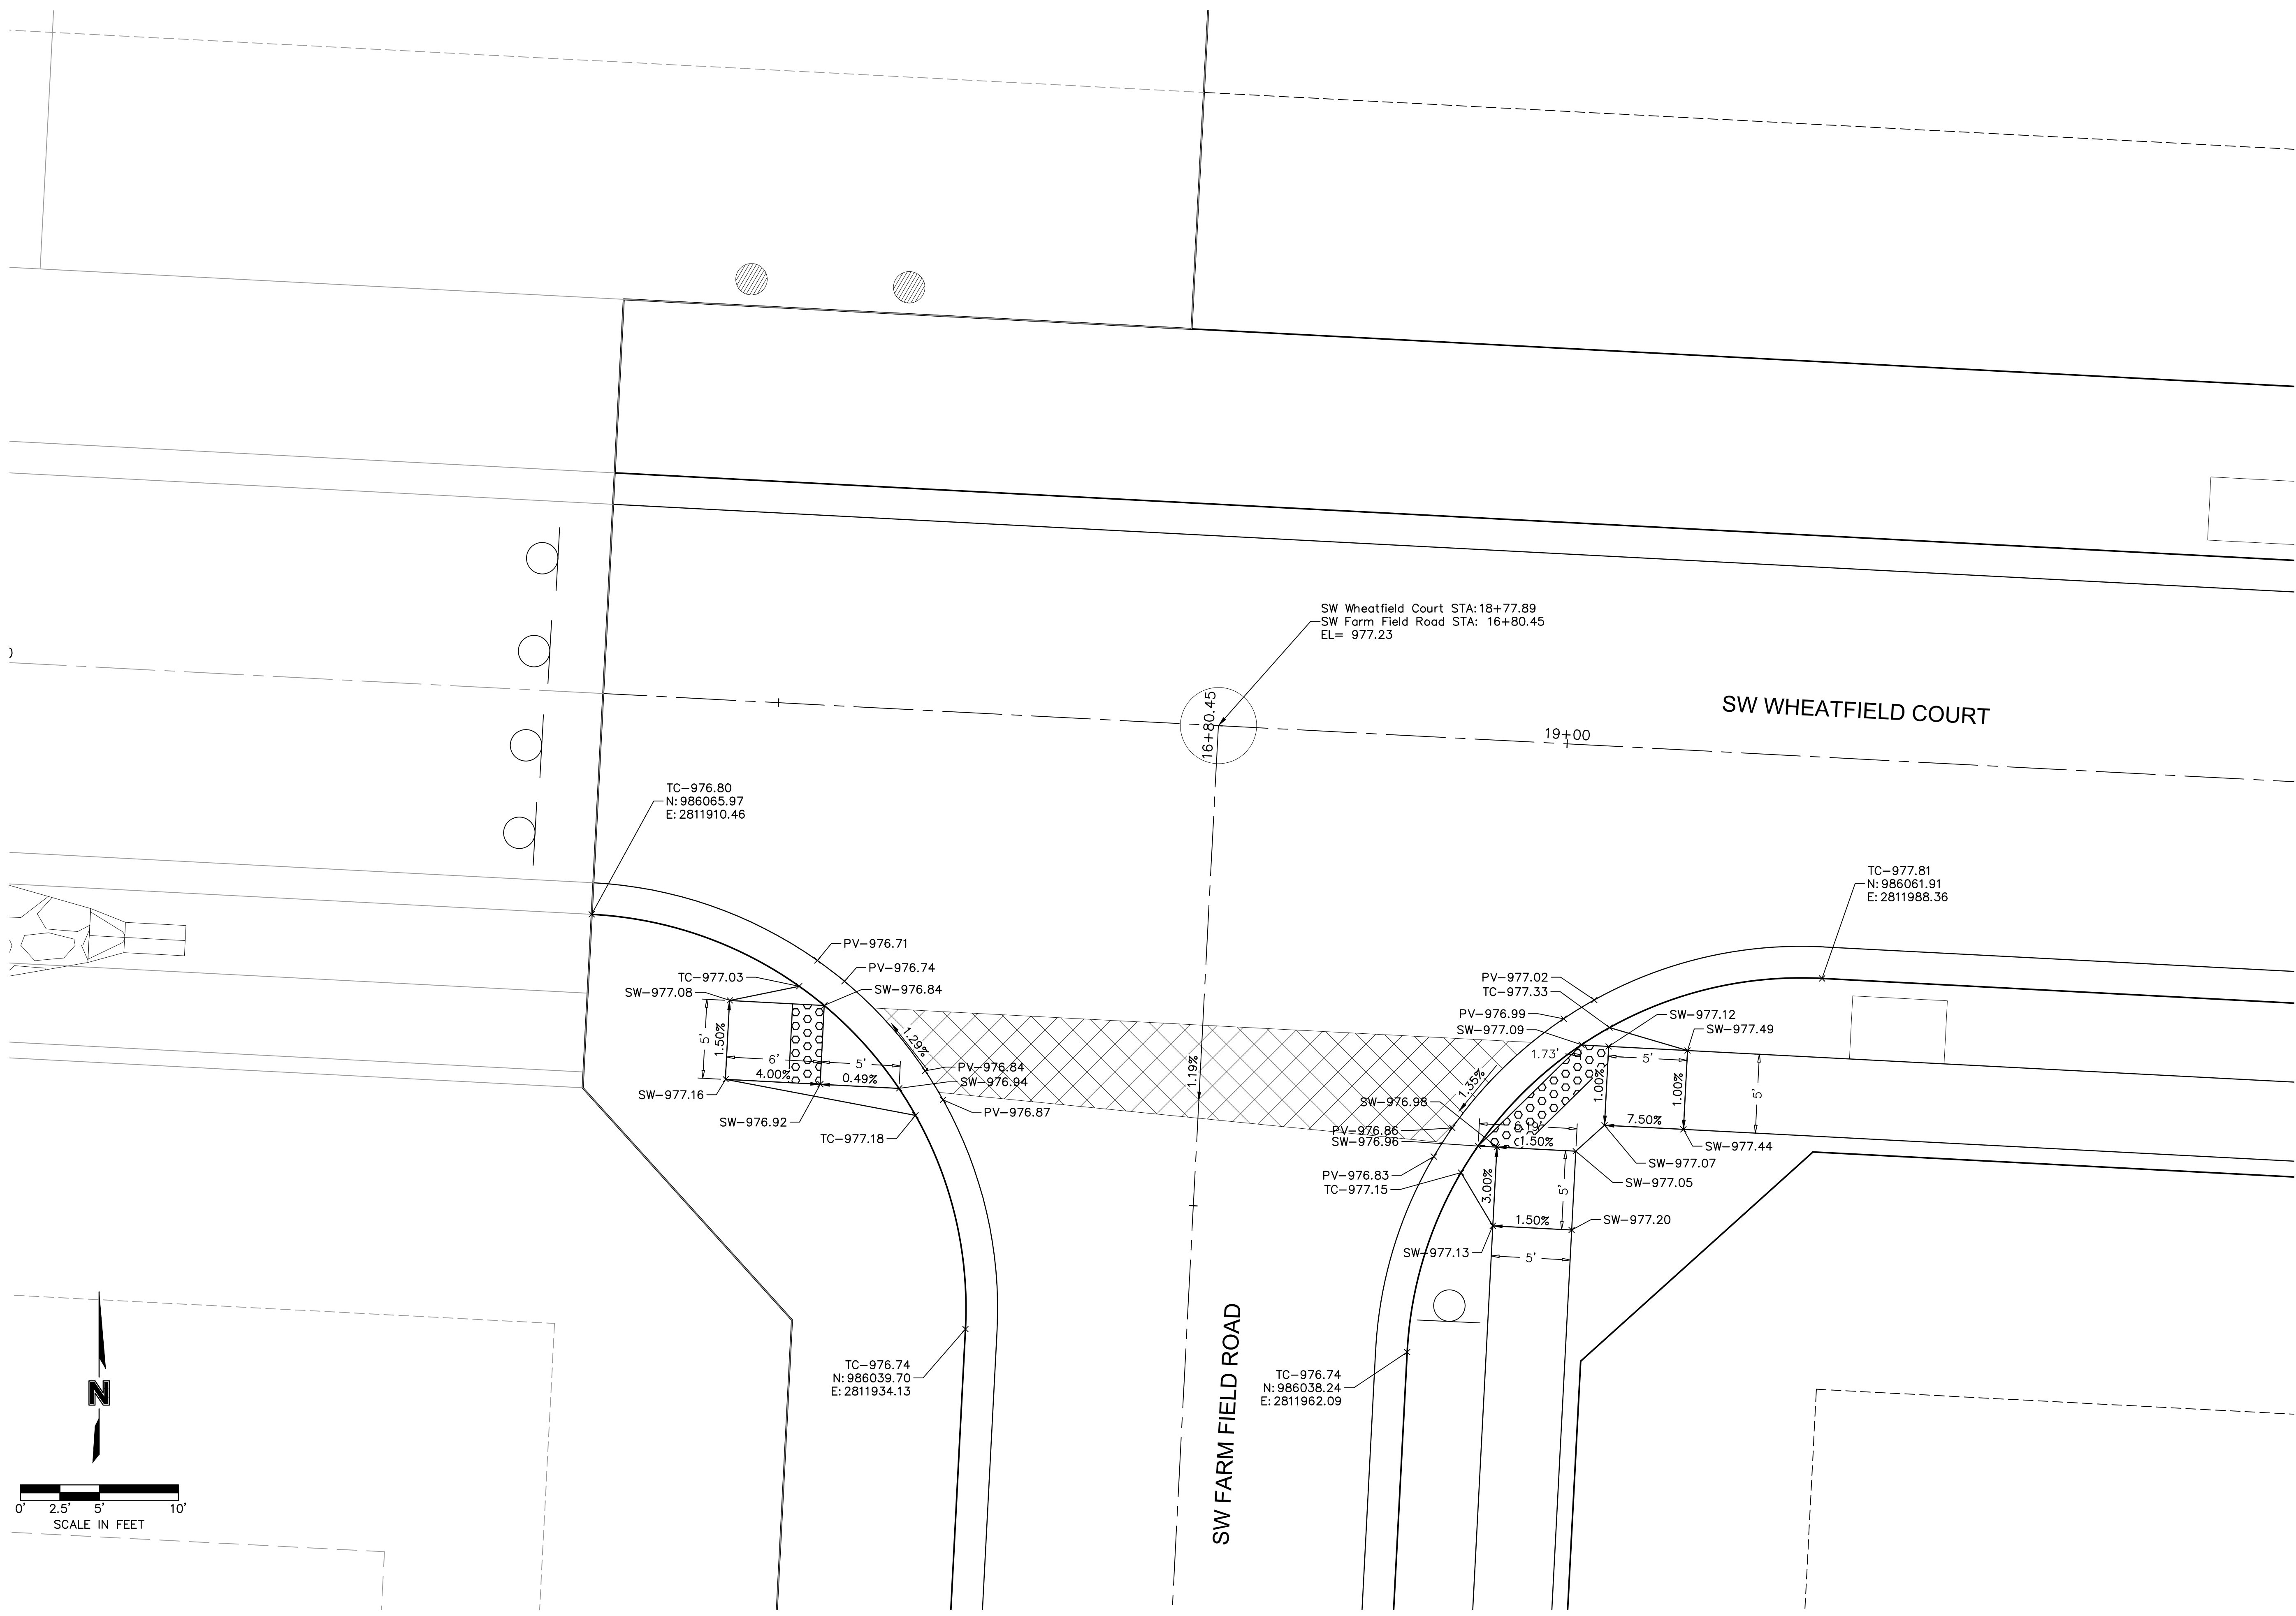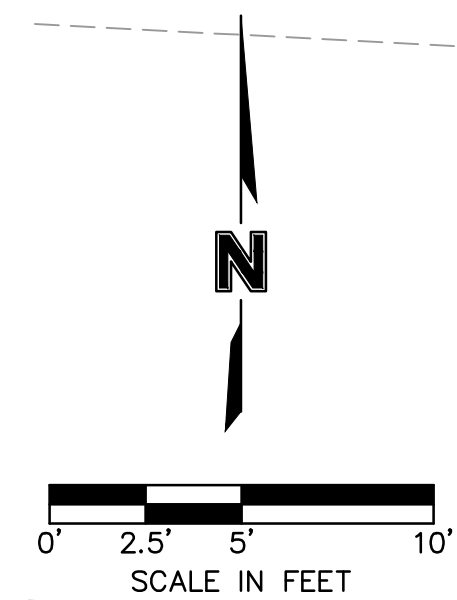SW WHEATFIELD COURT & SW FARM FIELD ROAD
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

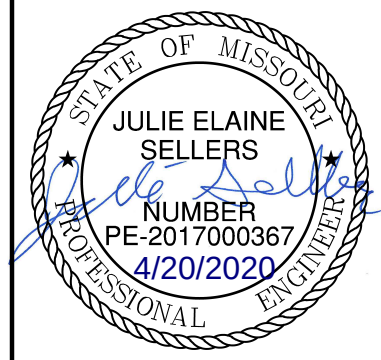2020[illegible]

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020

SHEET
C121

USER: nheiser



SW PRYOR ROAD

SW 26TH TERRACE
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

SHEET
C123



[illegible]

REVISIONS

olson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheets\GNCA\Street and Storm Plans\C_INT01_0194061.dwg
DATE: Apr 20, 2020 2:02pm XREFS: C:\PTB\K\0194061_34x22 C_PBN DY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_PUTIL_0194061 USER: nheiser

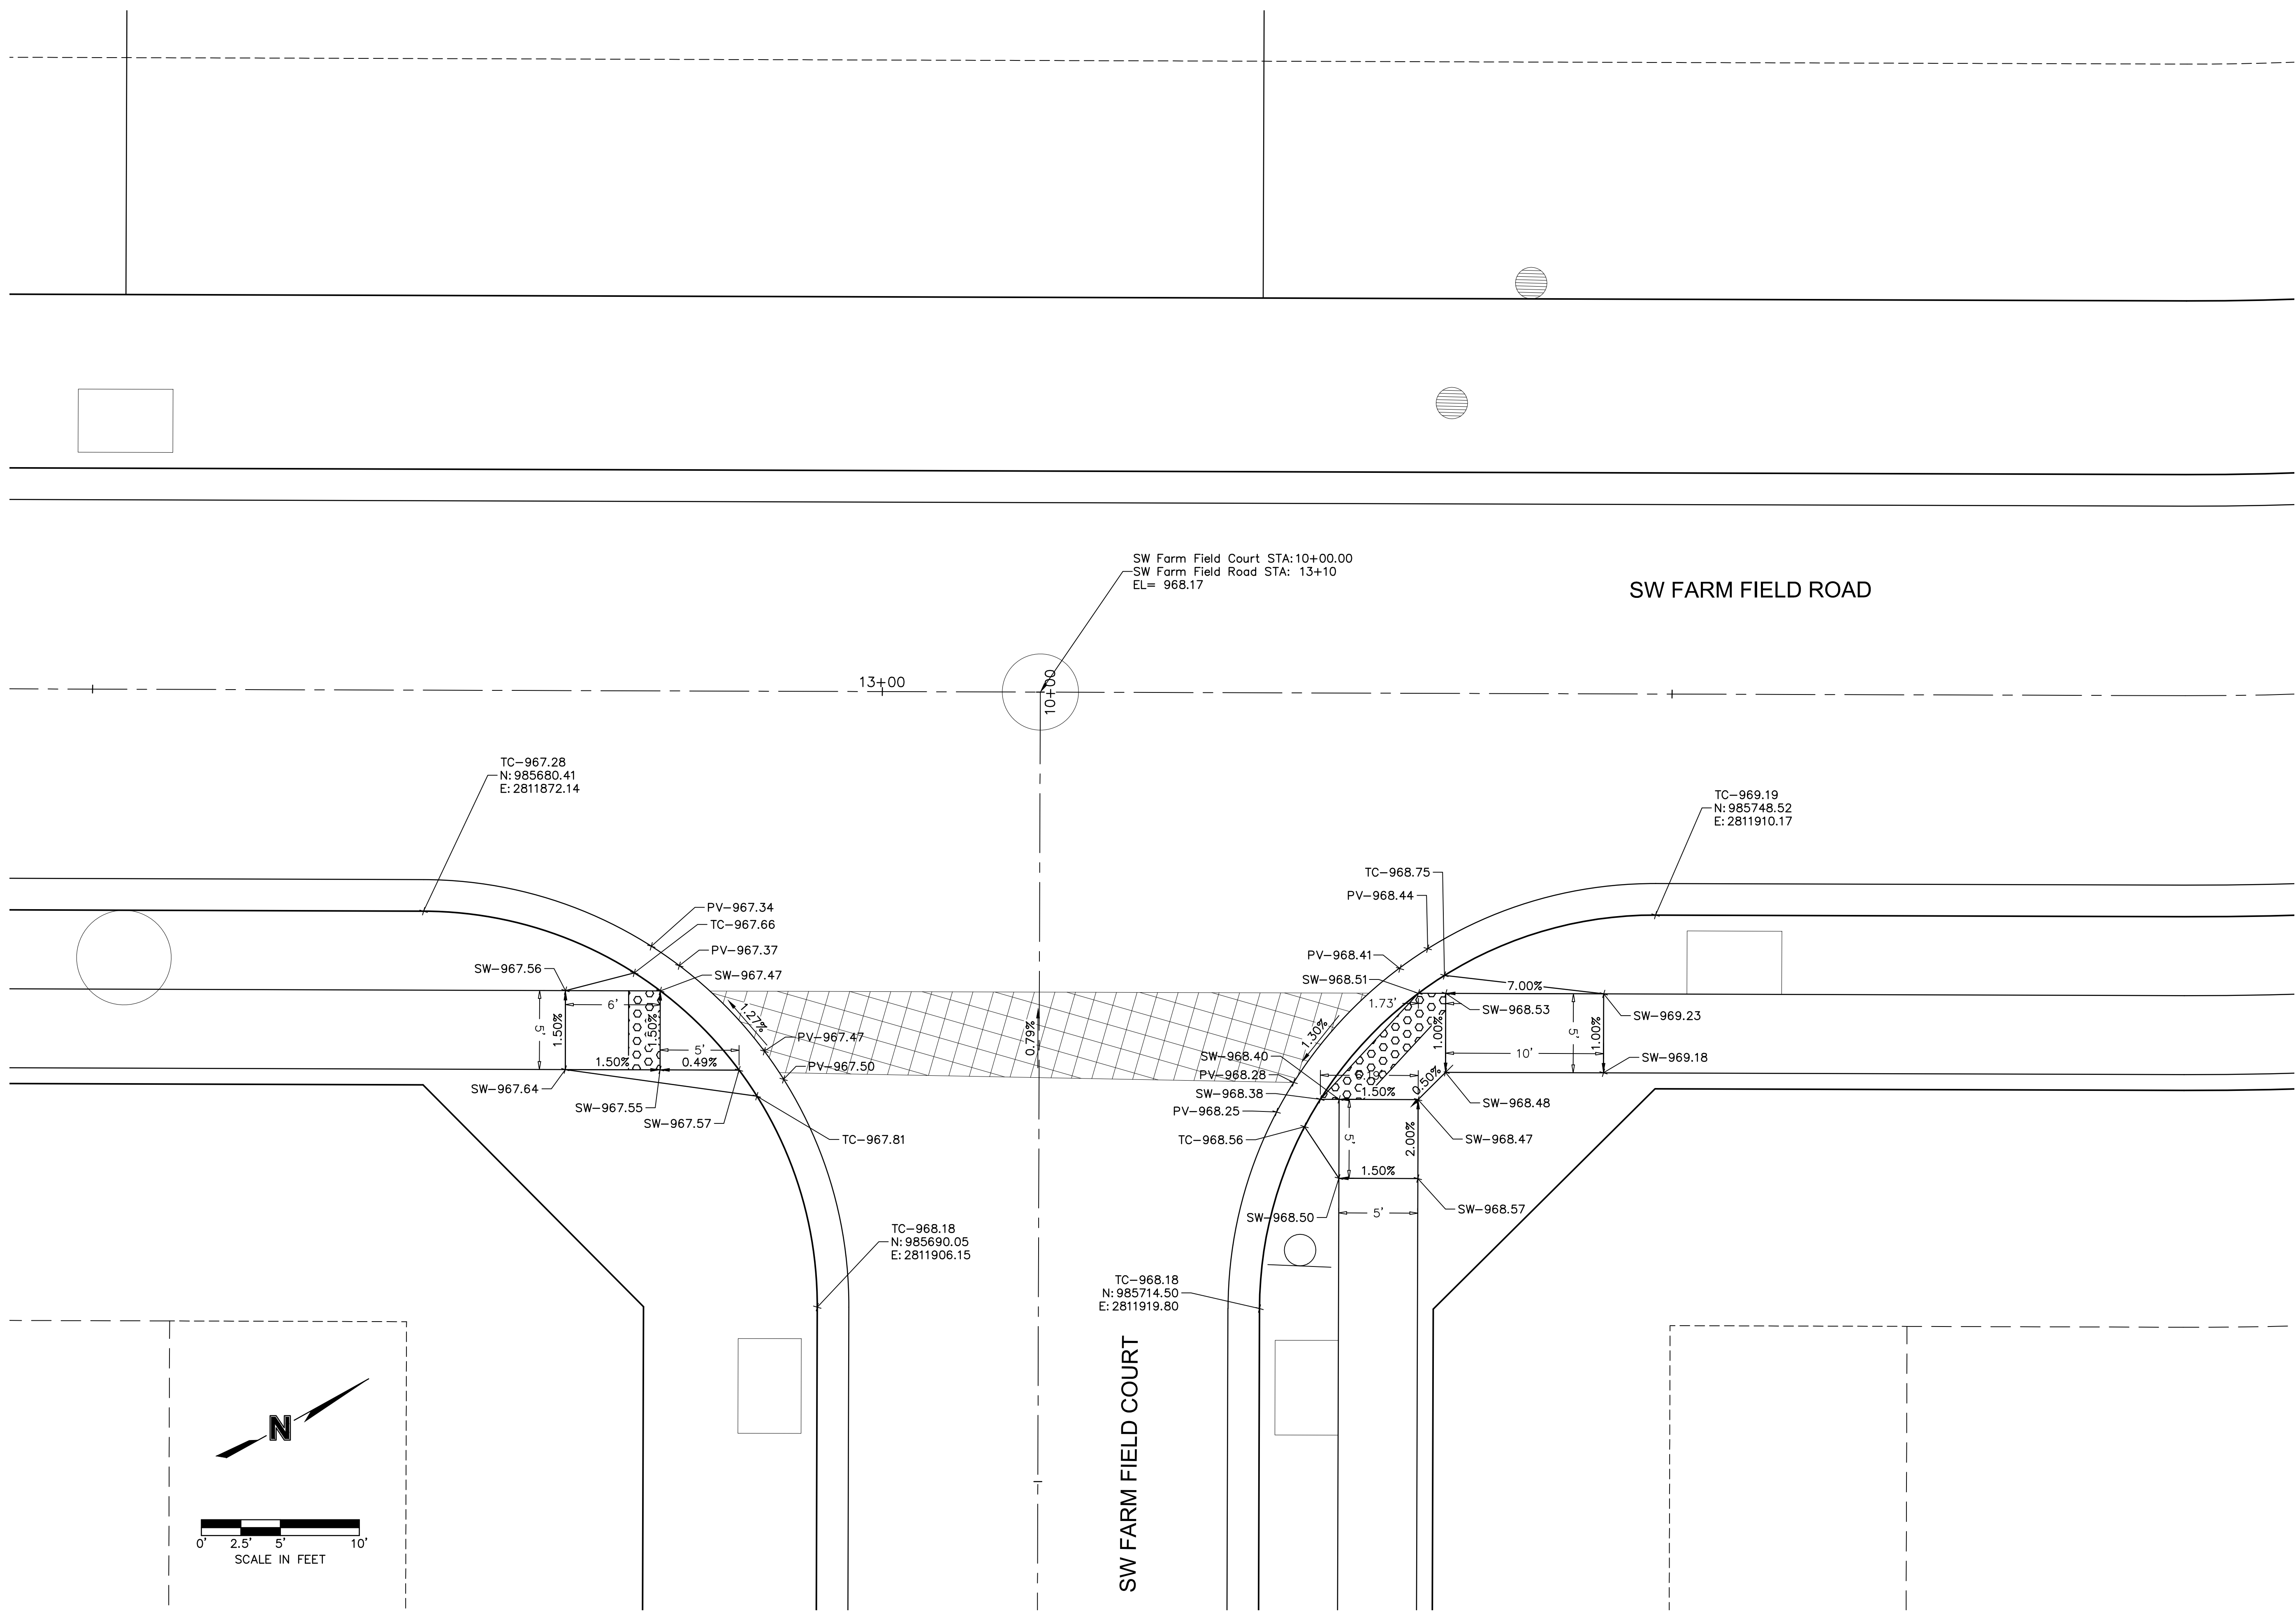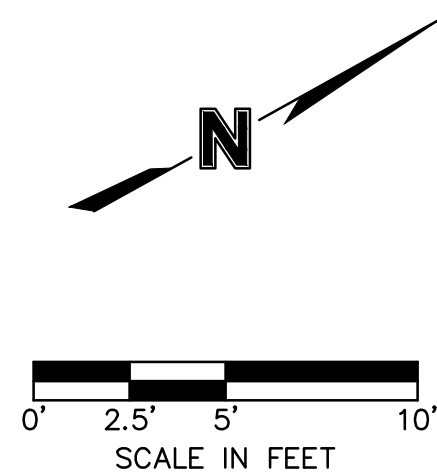

STATE OF MISSOURI
JULIE ELAINE
SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER

[illegible]

SW FARM FIELD ROAD & SW FARM FIELD COURT STREET AND STORM SEWER PLANS	HOOK FARMS FIRST PLAT	EE'S SUMMIT, MO	2020
--	--------------------------	-----------------	------



drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020

SHEET
C124



olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
TEL 916.361.1177
6446
www.olsson.com

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Streets\GNCV\Street and Storm Plans\C_INT02_0194061.dwg
 XREFS: C:\PTB\K_0194061_34x22 C_PBN DY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_PUTIL_0194061
 DATE: Apr 20, 2020 2:02pm USER: nheiser

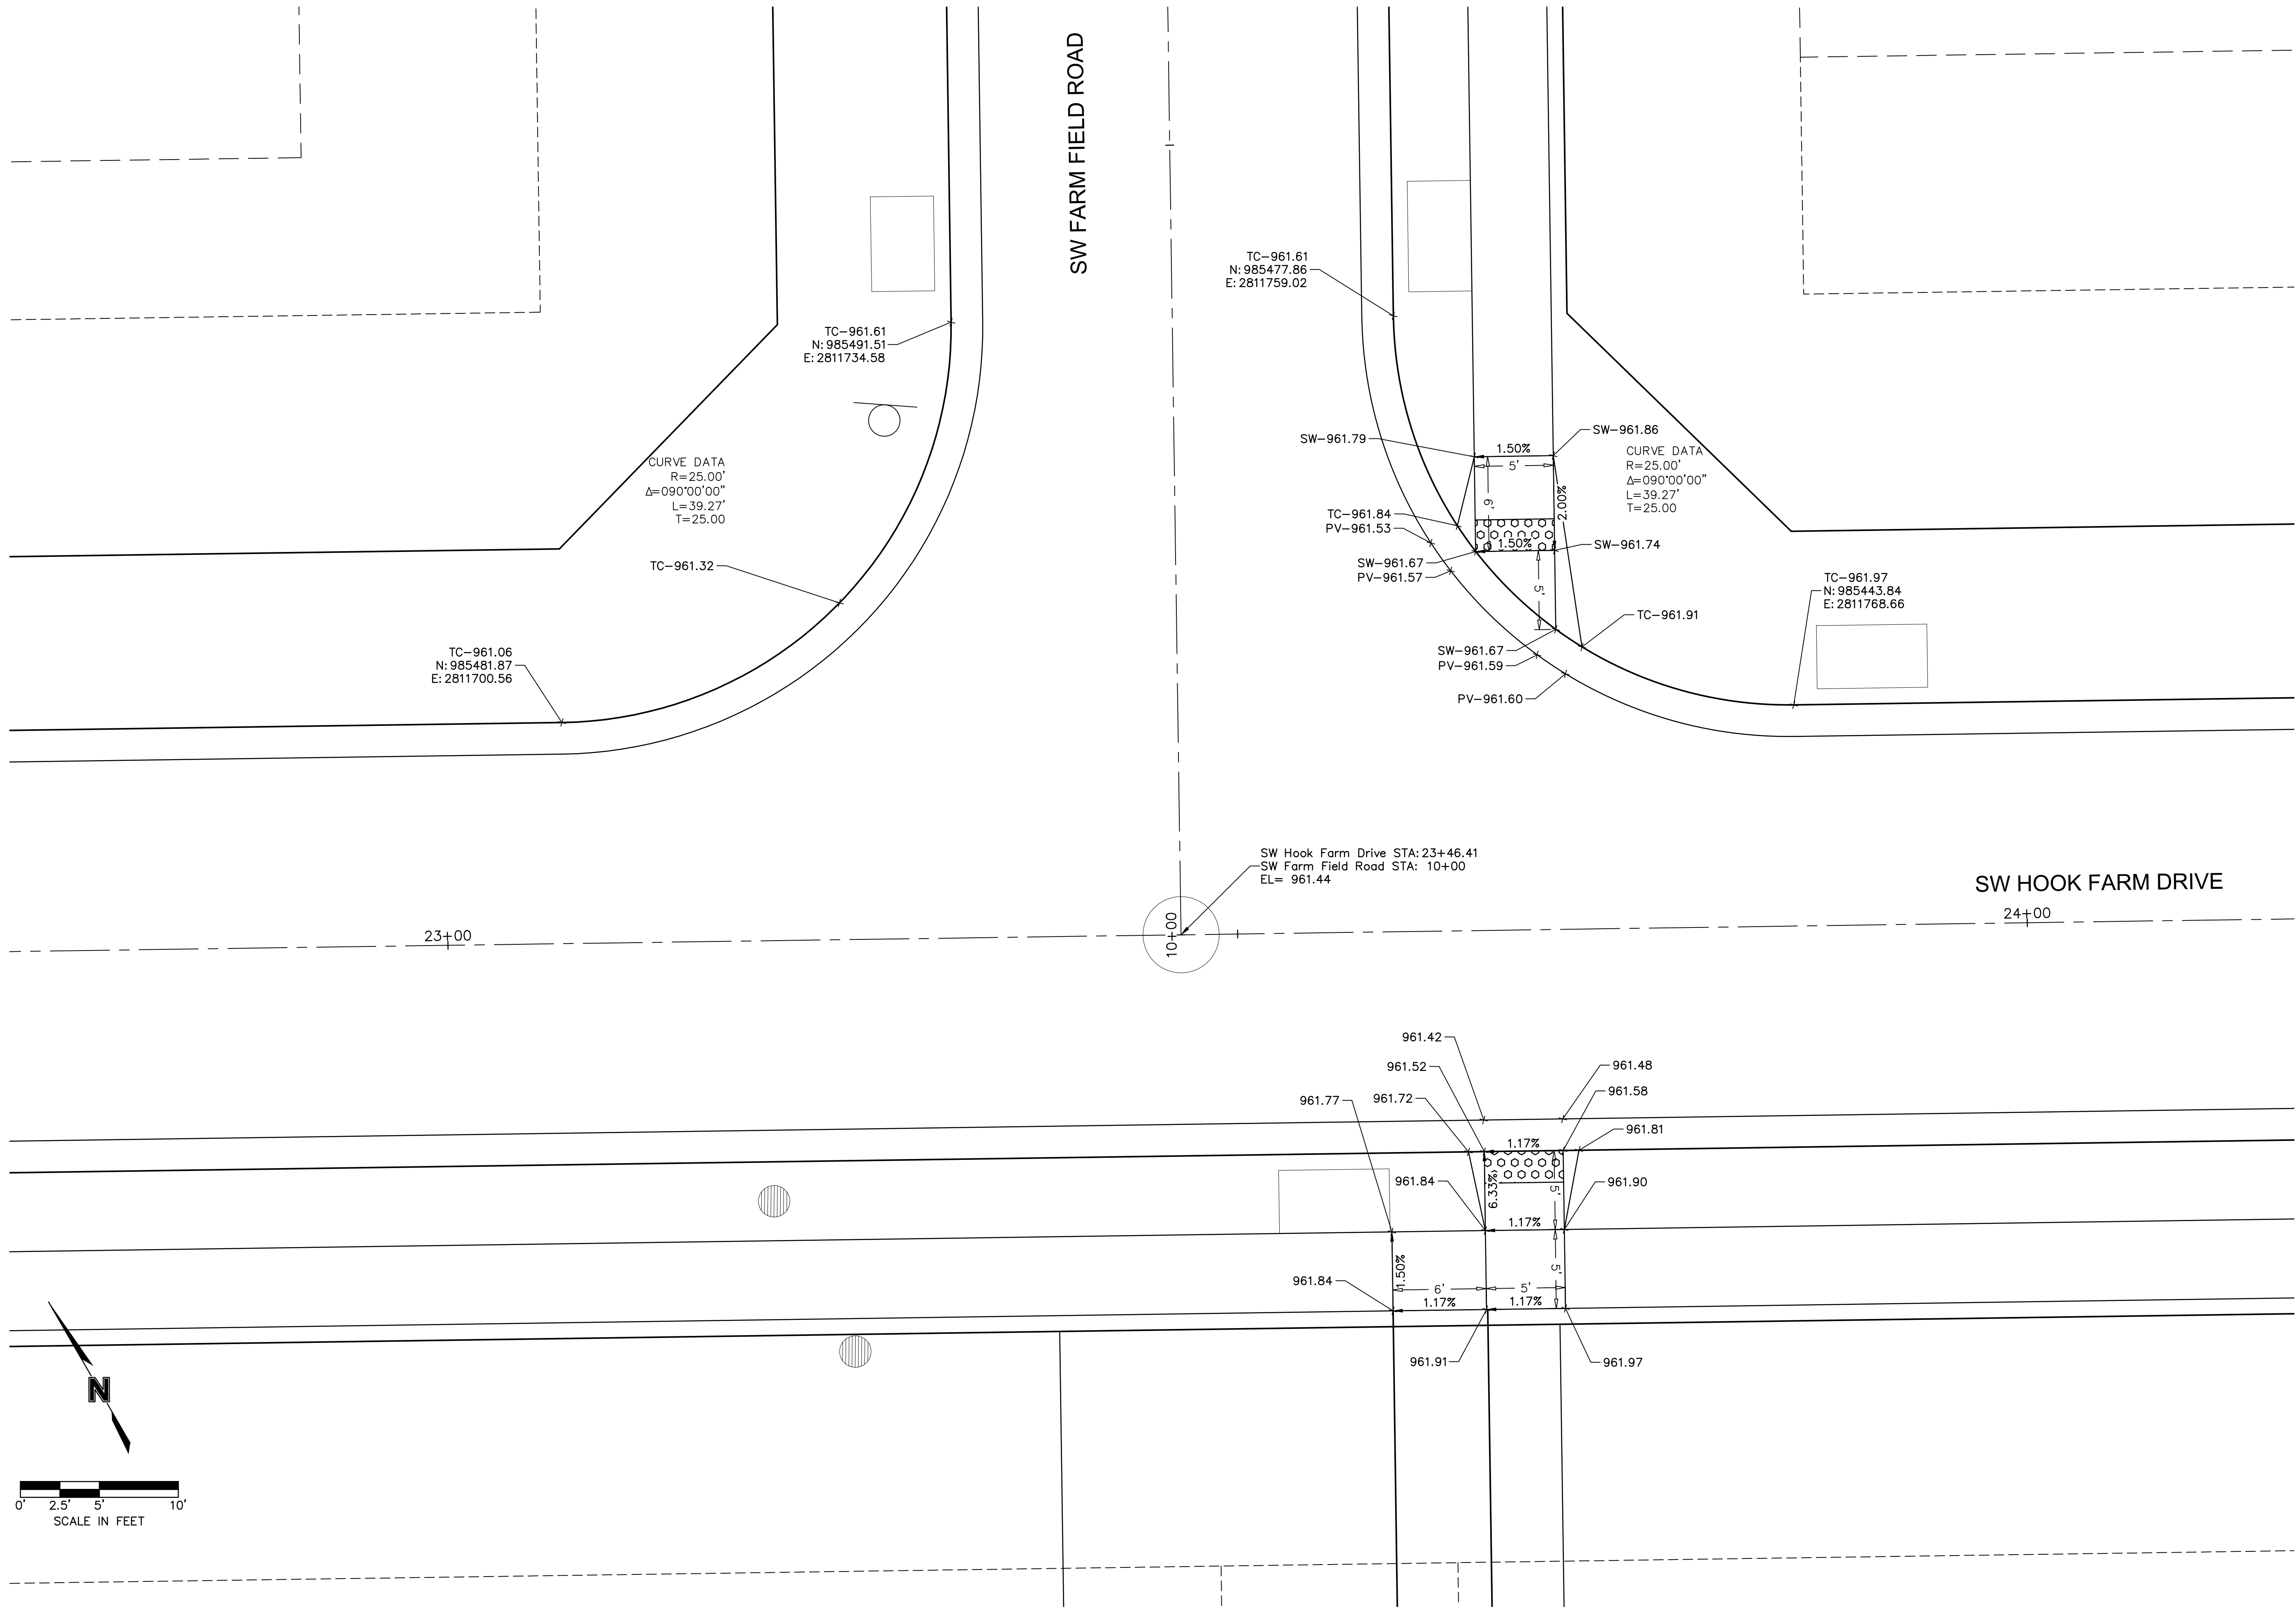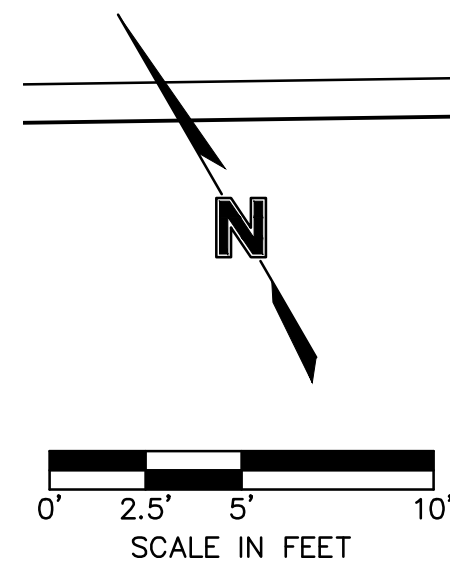[illegible]


DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Streets\GNCA\Street and Storm Plans\C_INT02_0194061.dwg
 XREFS: C:\PTB\K_0194061_34x22 C_PBN DY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_PUTIL_0194061
 DATE: Apr 20, 2020 2:03pm USER: nheiser

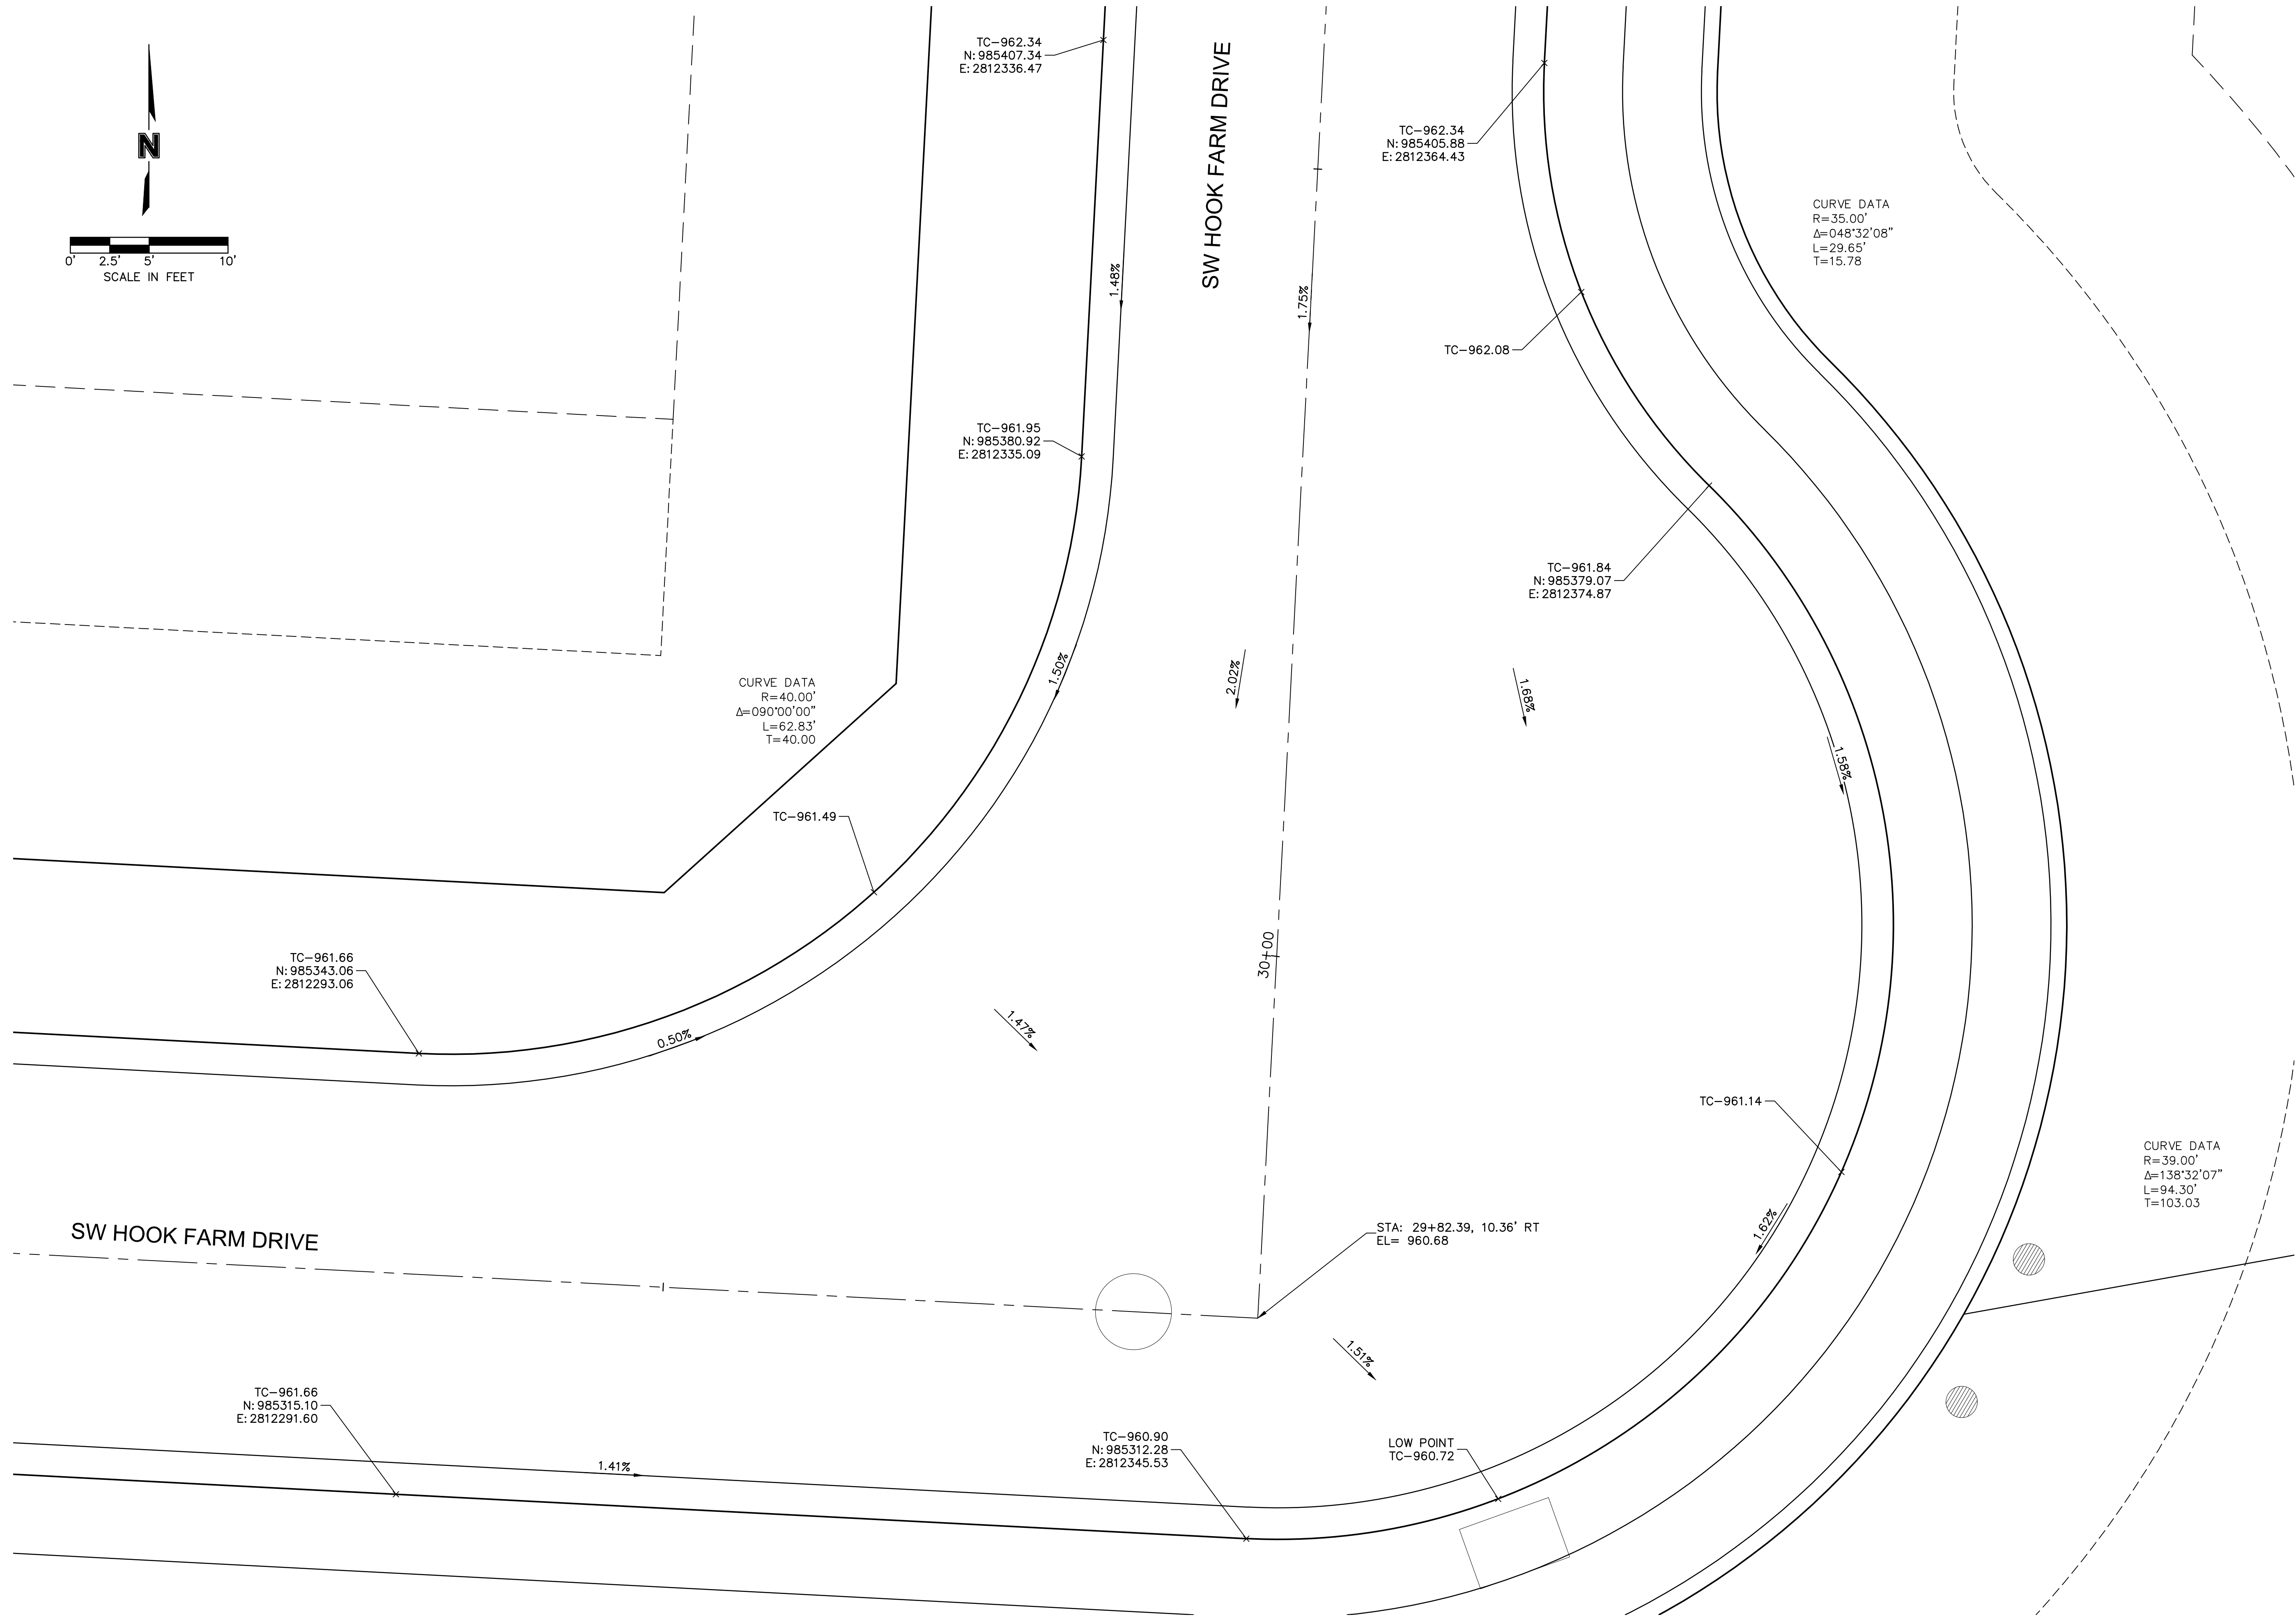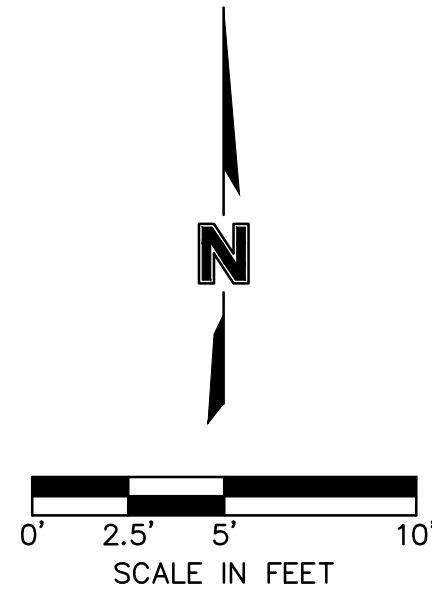

olson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheets\GNCV\Street and Storm Plans\C_INT02_0194061.dwg
XREFS: C_PBTBLK_0194061_34x22 C_PBNDDY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_PUTIL_0194061
DATE: Apr 20, 2020 2:03pm USER: nreiser

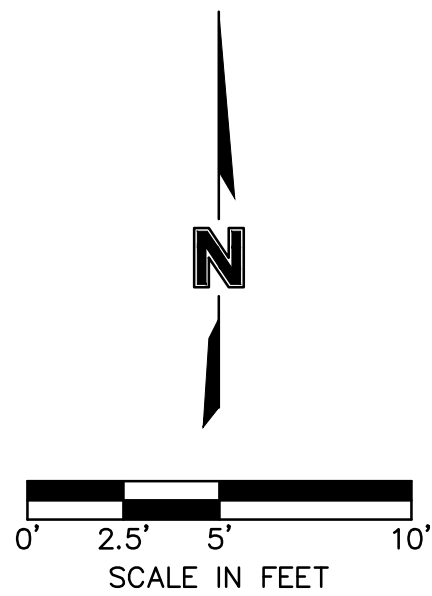

TC-968.72
N: 985624.67
E: 2812307.75

TC-968.72
N: 985652.64
E: 2812309.21

SW FARM FIELD COURT

CURVE DATA
R=40.00'
 $\Delta=090^{\circ}00'00''$
L=62.83'
T=40.00

- TC-967.77

- TC-967.36

TC-966.81
N: 985582.64 -
E: 2812345.62

TC-966.05
N: 985556.23
E: 2812344.24

SW Hook Farm Drive STA: 32+87.03
SW Farm Field Court STA: 14+99.64-
EL= 967.41

TC-967.90
N: 985649.82
E: 2812363.14

$$\begin{array}{r} 32+87:03 \\ \hline \end{array}$$

TC-967.21

TC-966.53
N: 985580.35
E: 2812385.37

TC-966.29 -

CURVE DATA
R=35.00'
 $\Delta=048^{\circ}32'06''$
L=29.65'
T=15.78

CURVE DATA
R=39.00'
 $\Delta=138^{\circ}32'06''$
L=94.30'
T=103.03

SW FARM FIELD COURT & SW HOOK FARM DRIVE STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

2020

drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020


SHEET
C127



olson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Streets\GNCAV\Street and Storm Plans\C_INT02_0194061.dwg
 XREFS: C:\PTB\K_0194061_34x22 C_PBN DY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_PUTIL_0194061
 DATE: Apr 20, 2020 2:03pm USER: nheiser

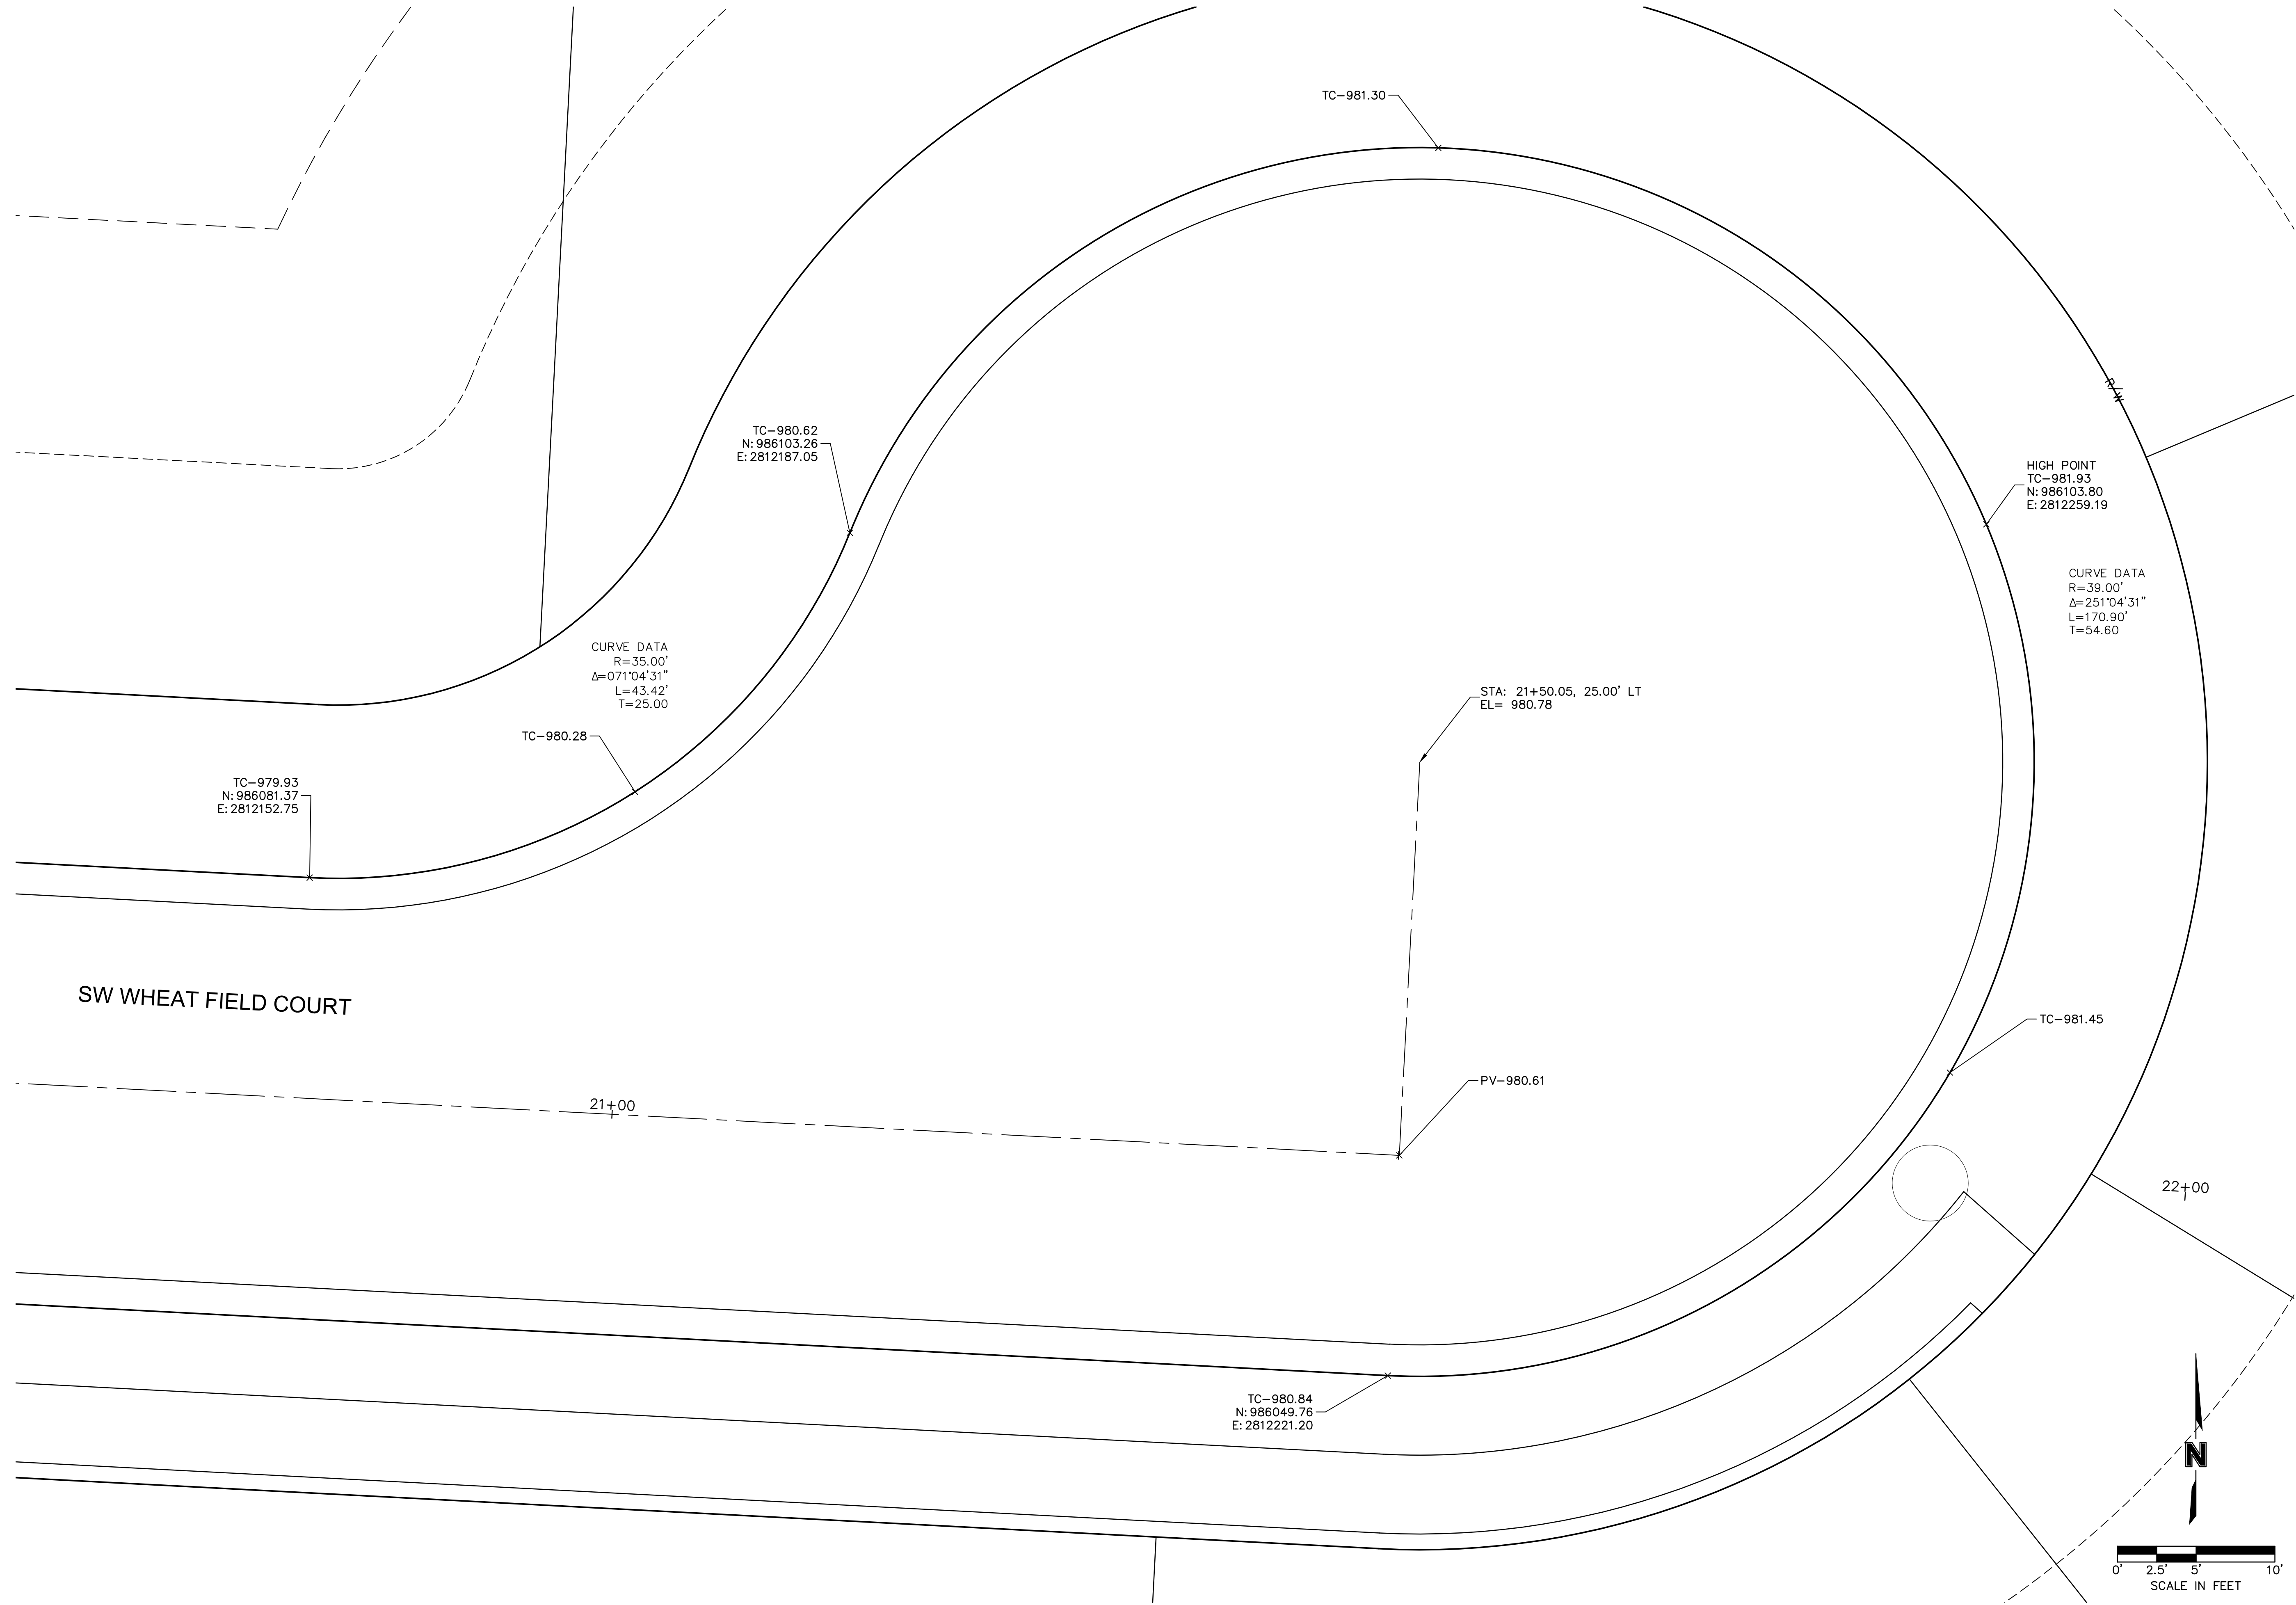SW WHEAT FIELD COURT CUL-DE-SAC
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

2020

[illegible]

olson




Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

SHEET
C128




drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.: _____
date: 04/20/2020

Riprap Calculations							
End Section	Q ₁₀₀ (cfs)	Pipe Diameter (ft)	Class*	D50* (in)	Apron Length (ft)	Apron Depth (ft)	Area (SY)
E.S. 1-1	48.24	3	3	10	15	2.00	23.3

*Per Table 10.1 HEC 14-FHWA-Energy Dissipators Pg. 10-18

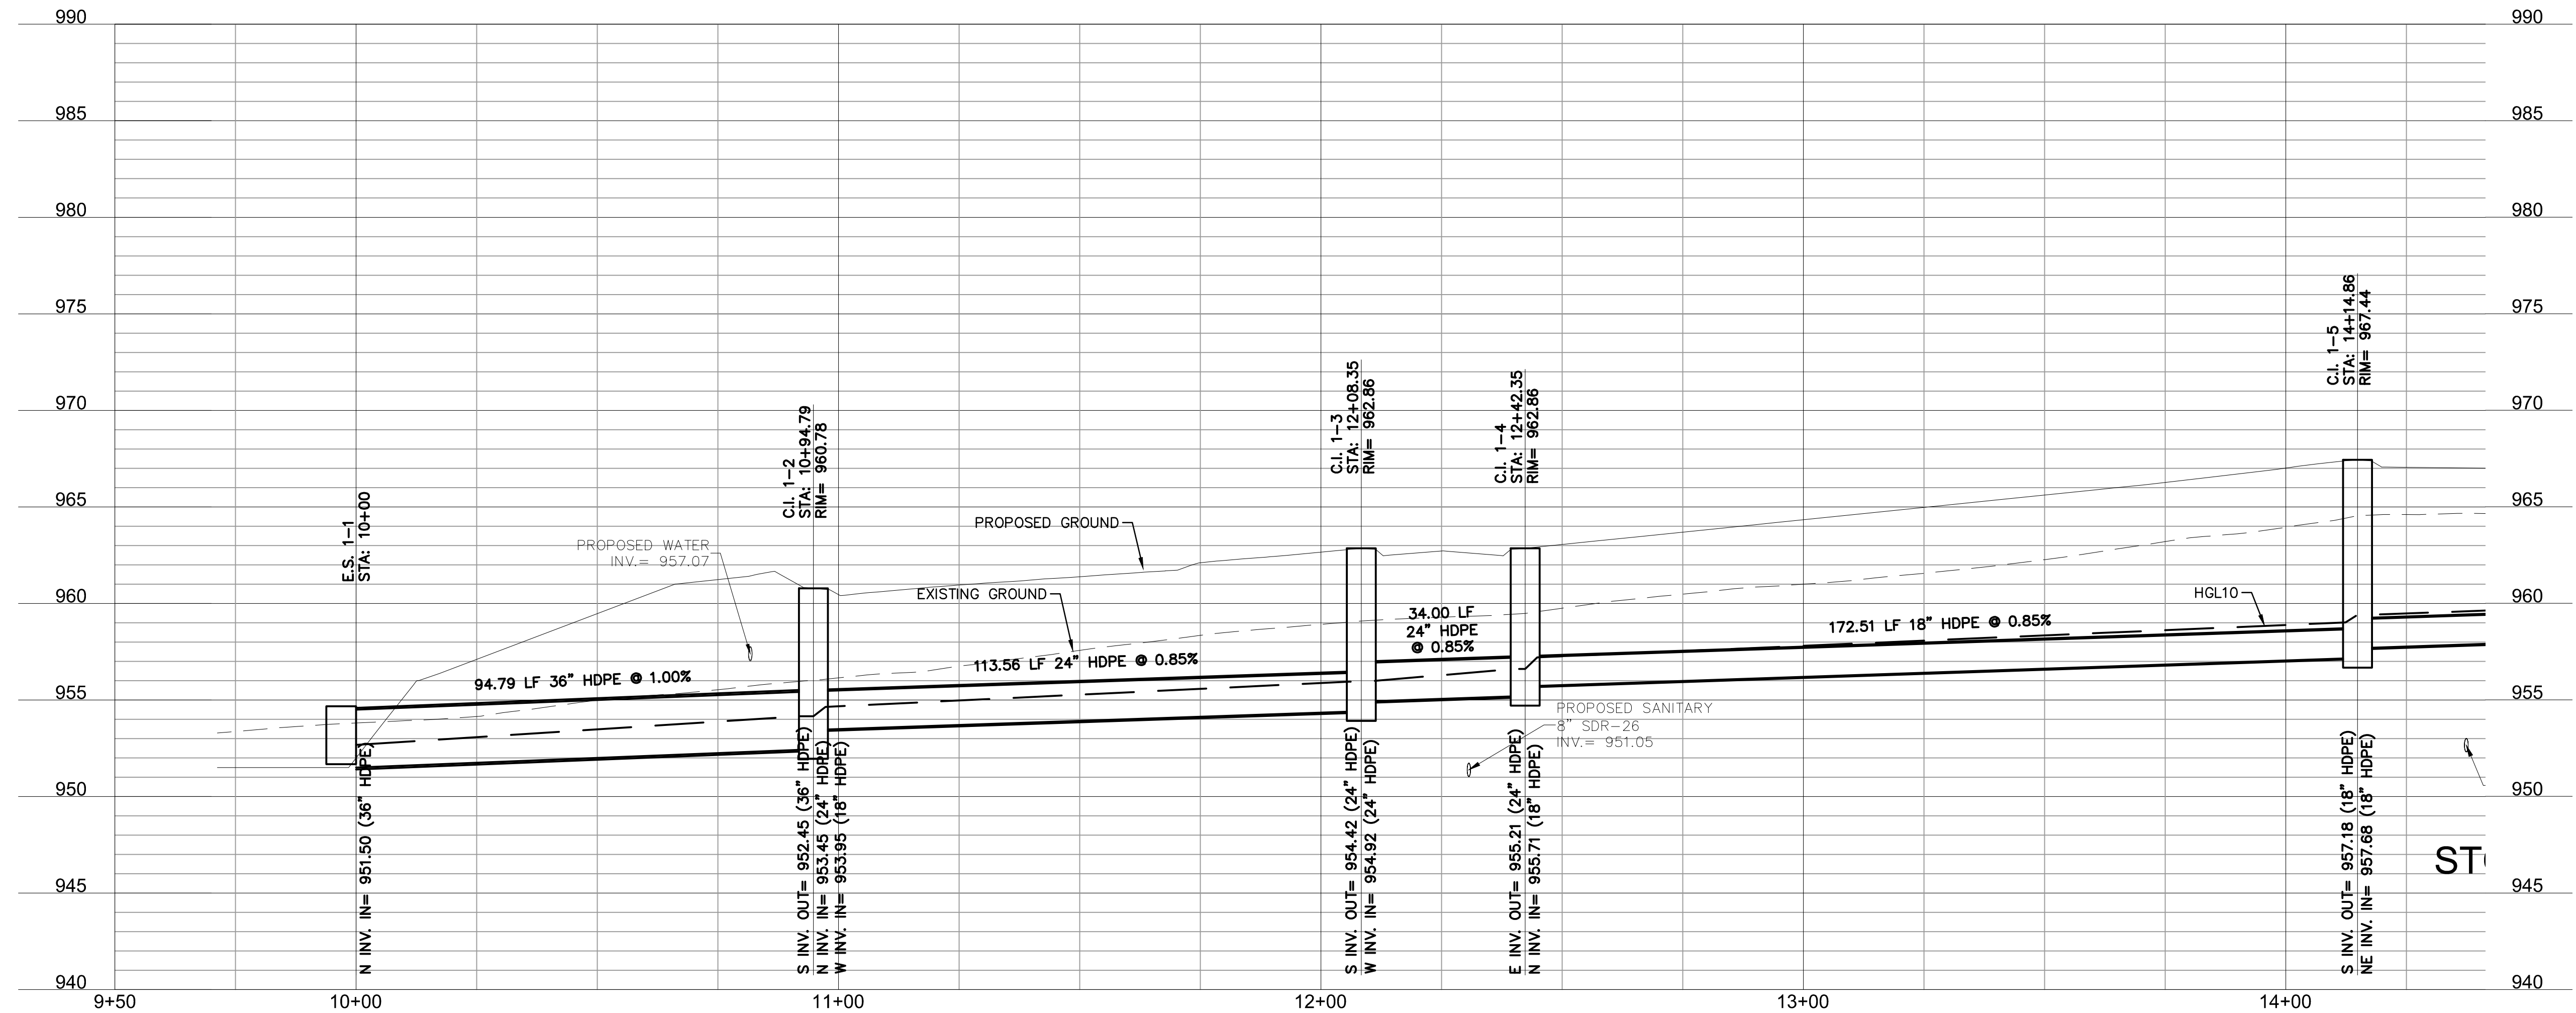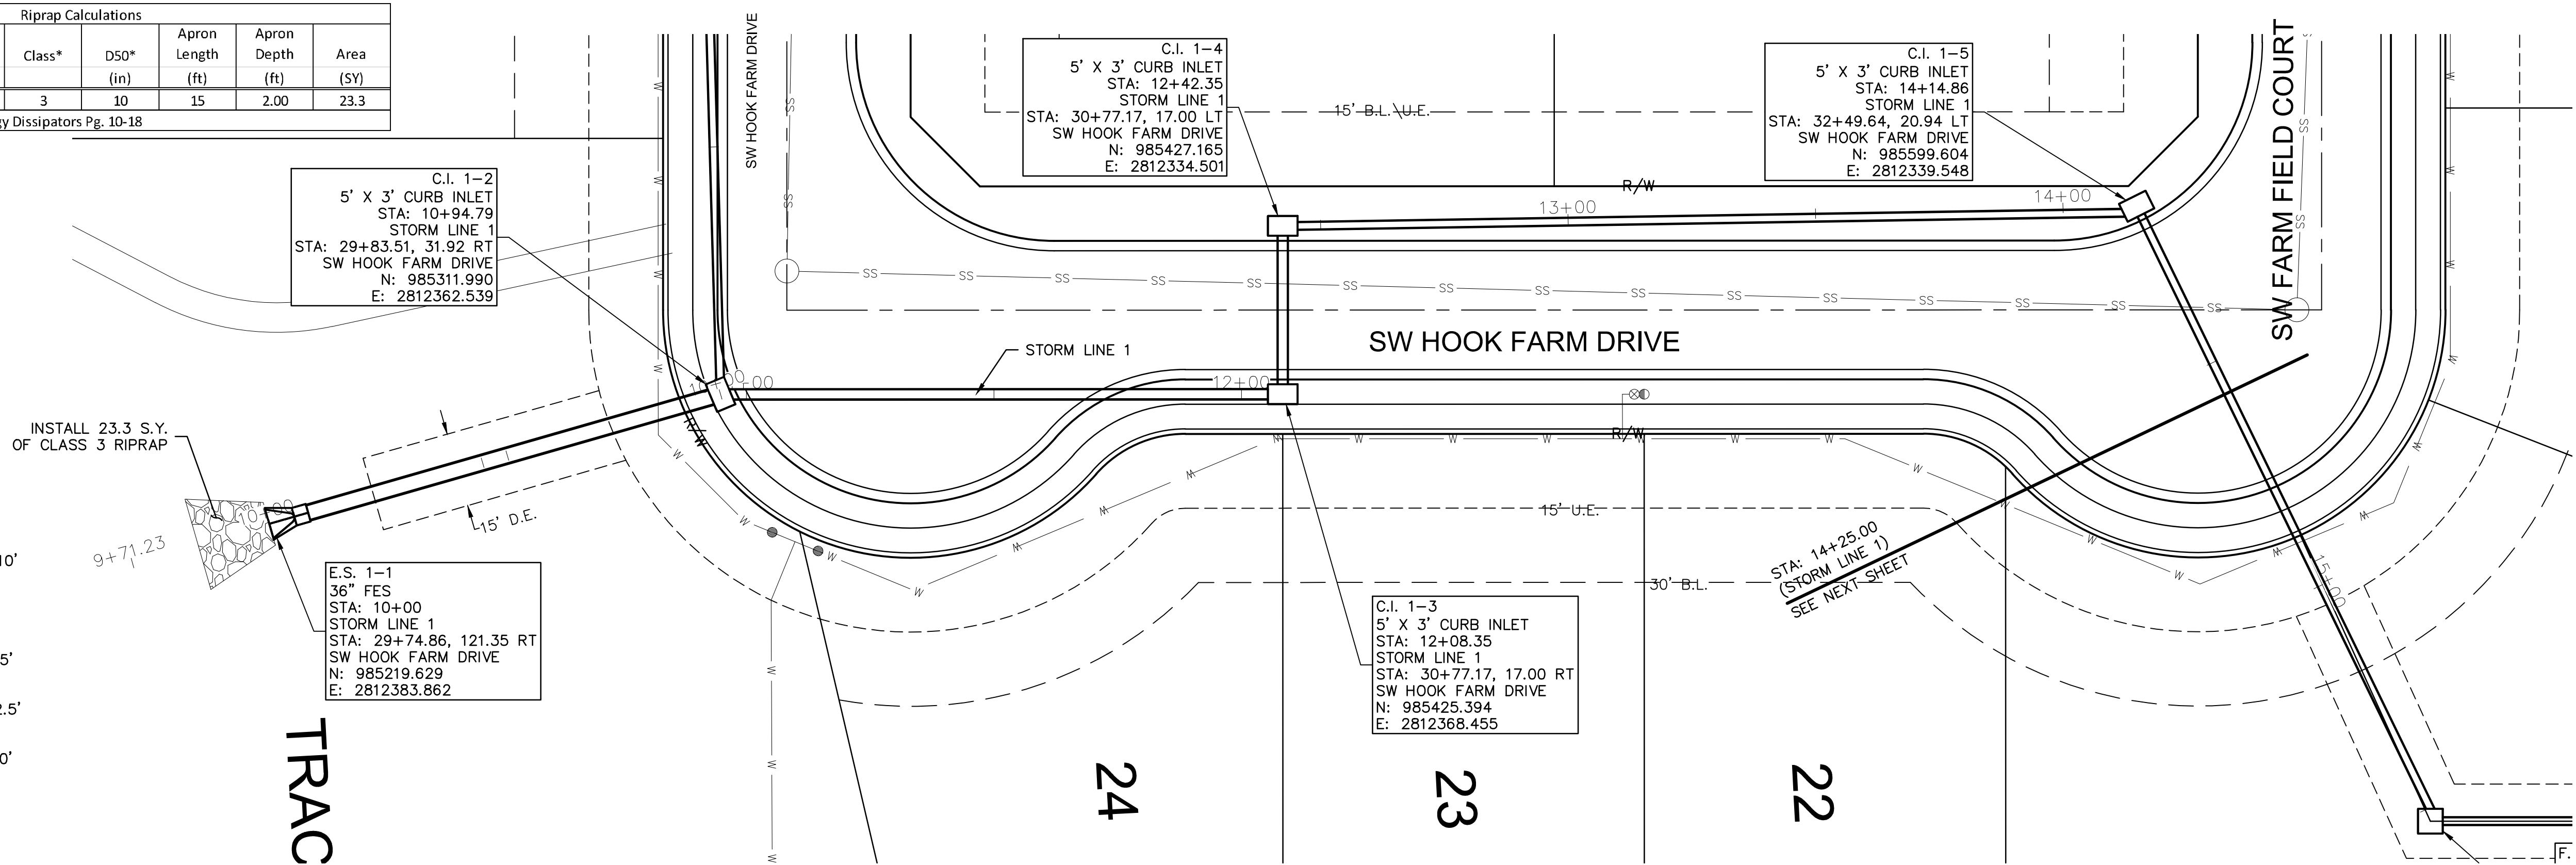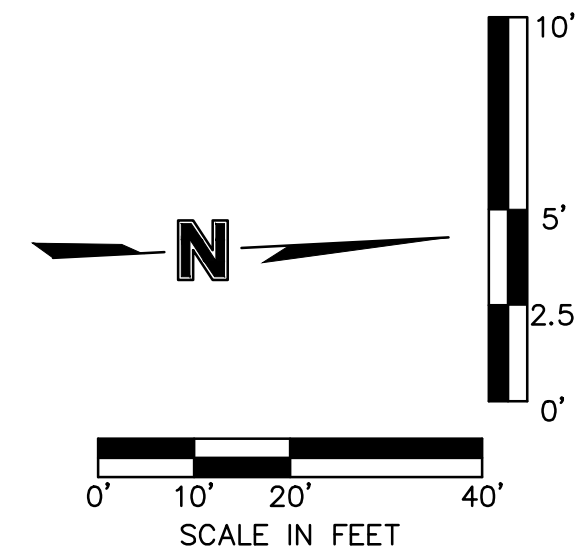

USER: nheiser
061 C_FBA

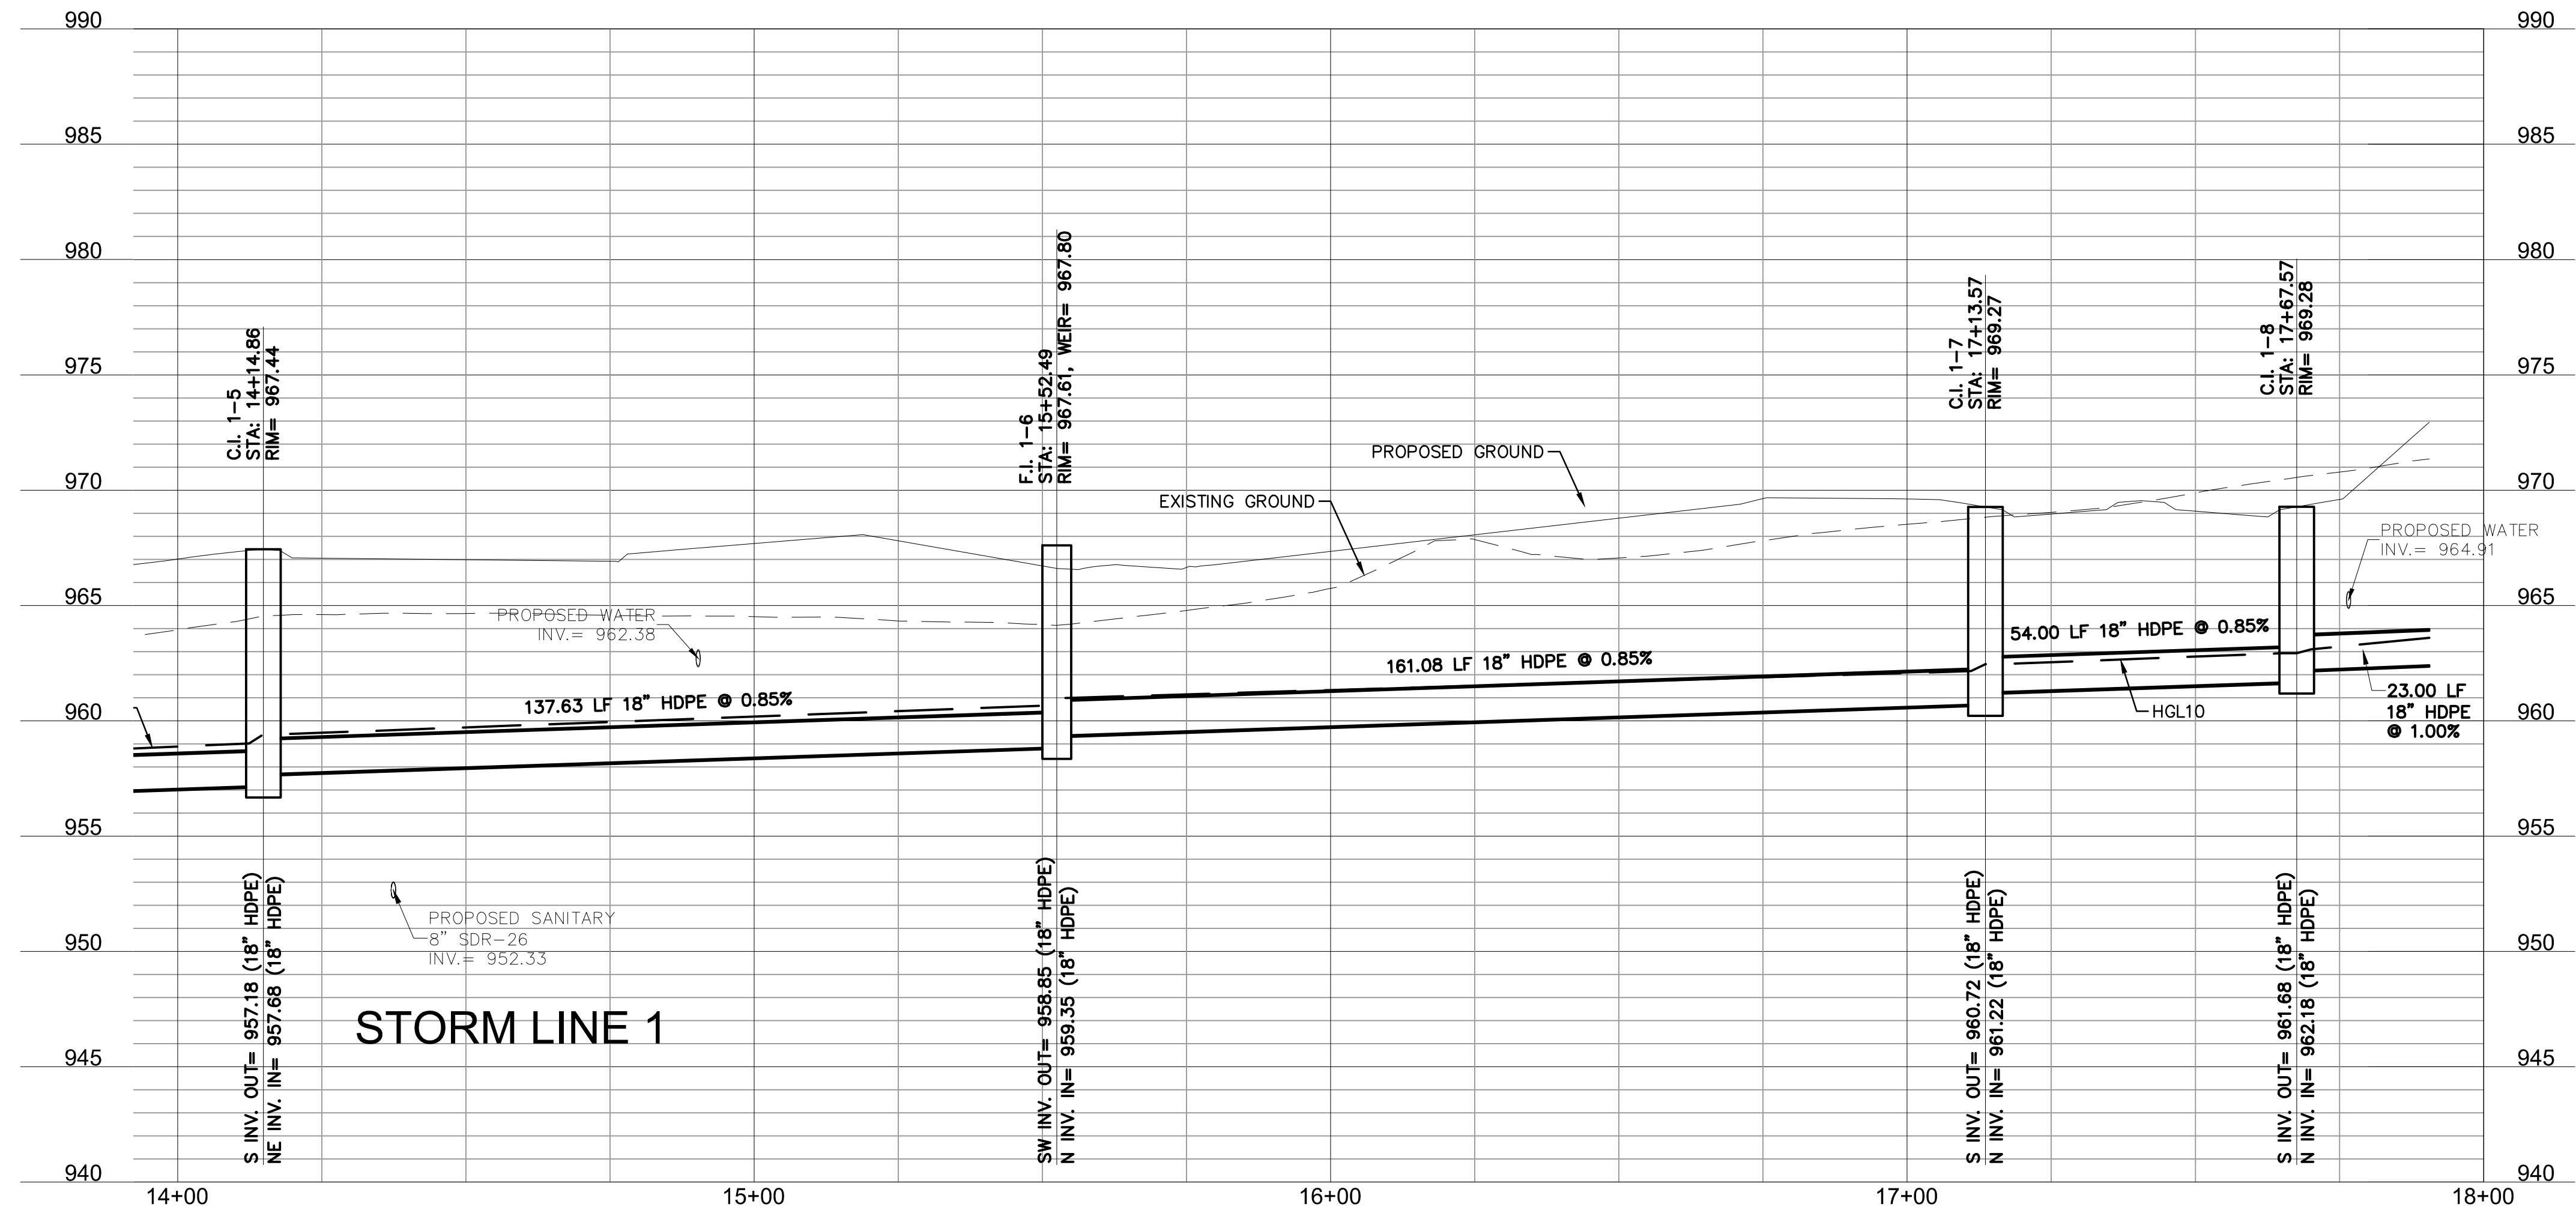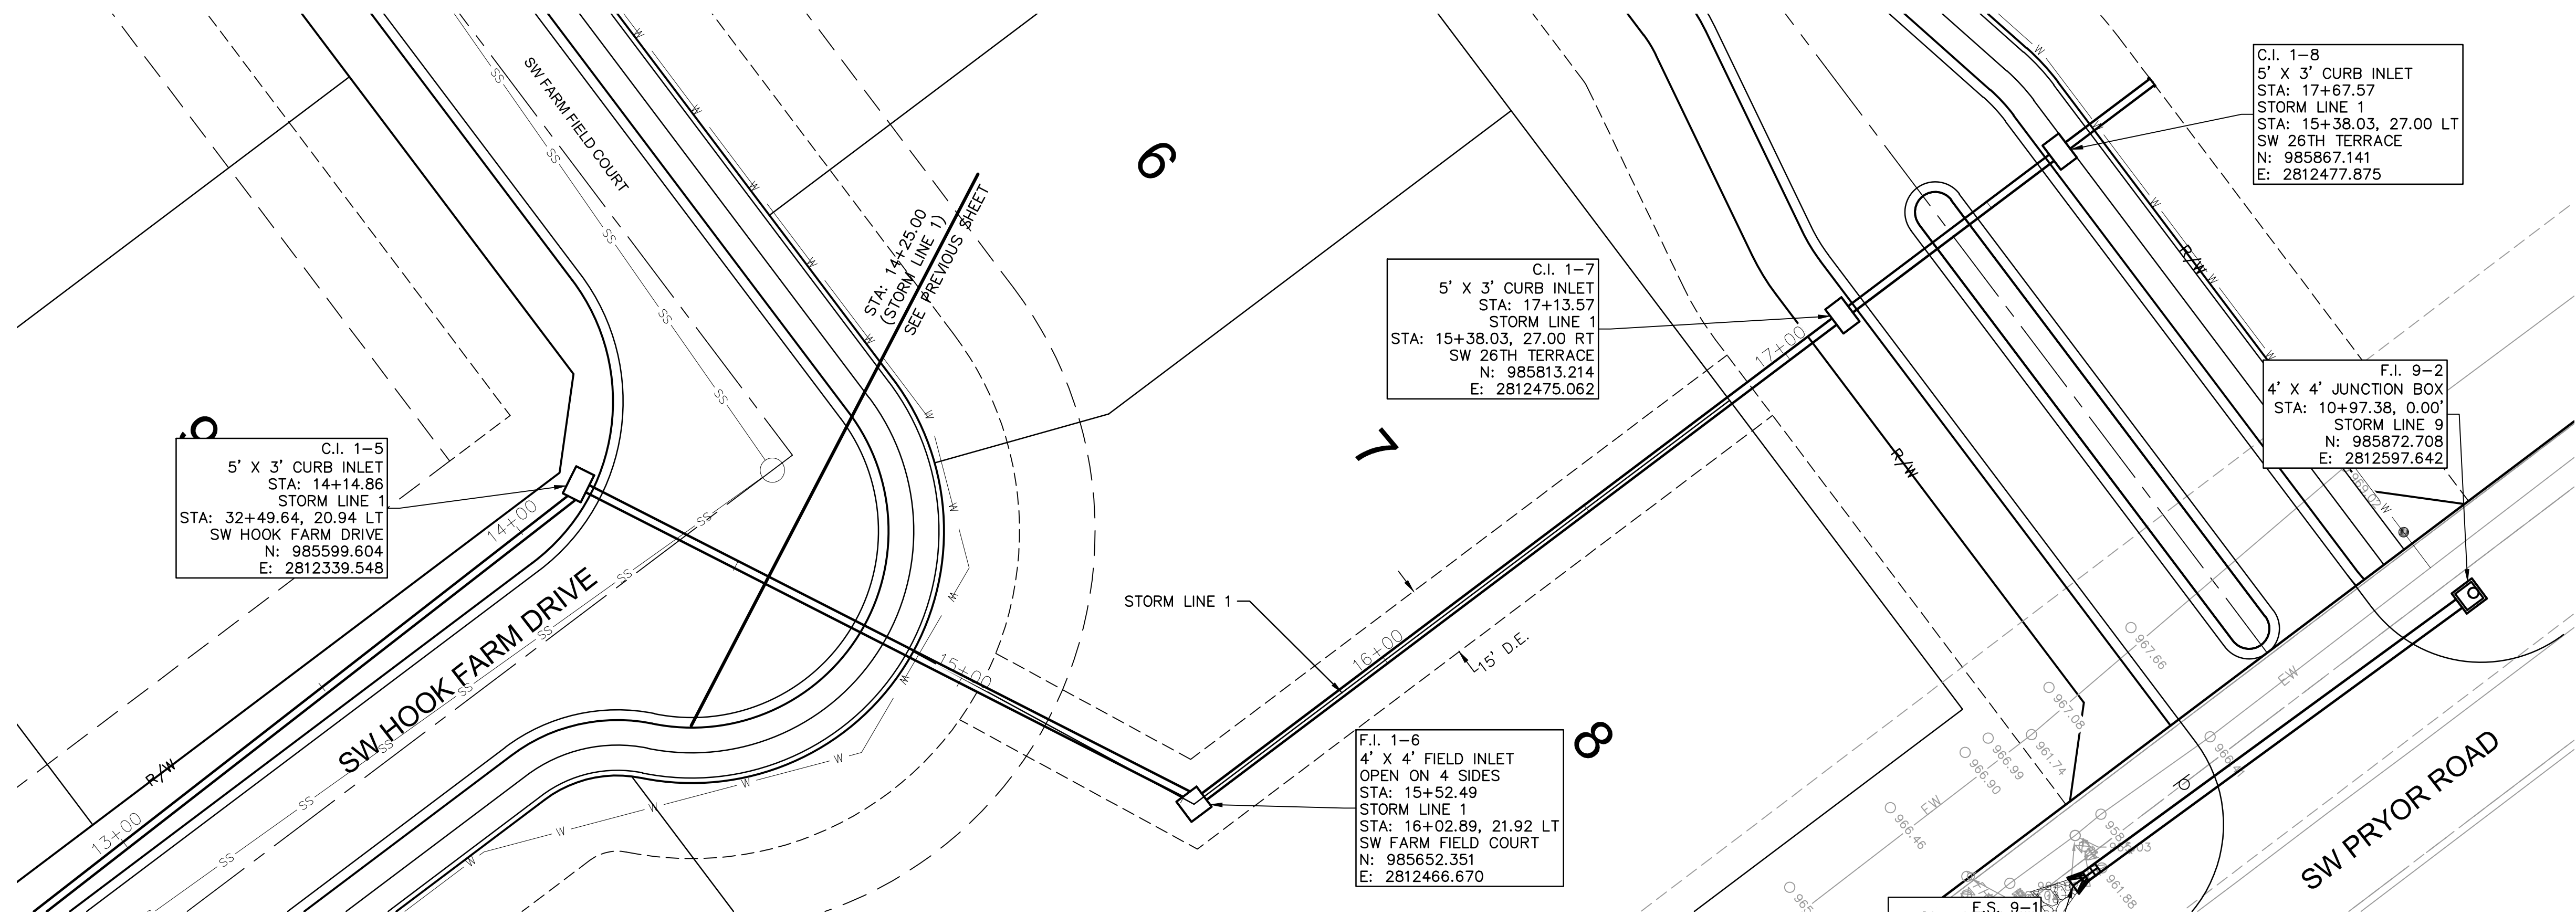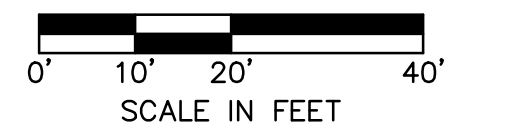


STATE OF MISSOURI
JULIE ELAINE
SELLERS
NUMBER
PE-2017000367
4/20/2020
PROFESSIONAL ENGINEER

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116

STORM SEWER PLAN & PROFILE (LINE 1 CONT'D) STREET AND STORM SEWER PLANS HOOK FARMS FIRST PLAT	drawn by: _____ CGW checked by: _____ JES approved by: _____ NDH QA/QC by: _____ JES project no.: _____ 019-4061 drawing no.: _____ date: _____ 04/20/2020					
LEE'S SUMMIT, MO	2020	REVISIONS				
SHEET C130						

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheets\GNCV\Street and Storm Plans\C_STM01_0194061.dwg
DATE: Apr 20, 2020 2:03pm
XREFS: C_PTBULK_0194061_34x22 C_PBASE_0194061 C_PSTRM_0194061 C_PSURF_0194061 C_PUTIL_0194061
USER: nheiser

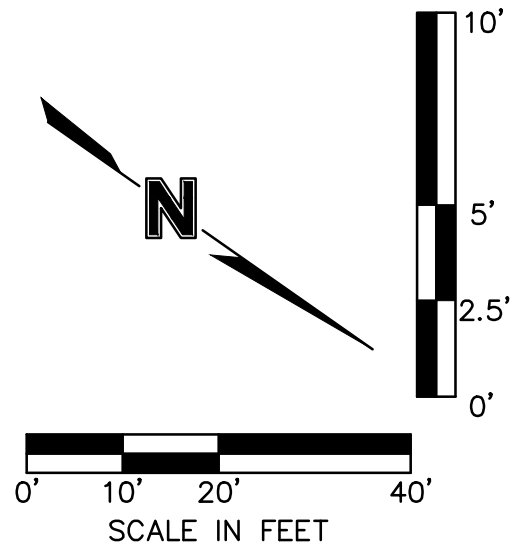

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
Professional Engineer
NUMBER
PE-2017000367
4/20/2020

BY
DATE
REV. NO.
REVISIONS DESCRIPTION

STORM SEWER PLAN & PROFILE (LINE 2)
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT


LEE'S SUMMIT, MO

2020

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020





SHEET
C131

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheets\GNCV\Street and Storm Plans\C-STM01_0194061.dwg
DATE: Apr 20, 2020 2:03pm
XREFS: C_PTBULK_0194061_34x22 C_PBASE_0194061 C_PSTRM_0194061 C_PPSURF_0194061 C_PUTIL_0194061
USER: nheiser

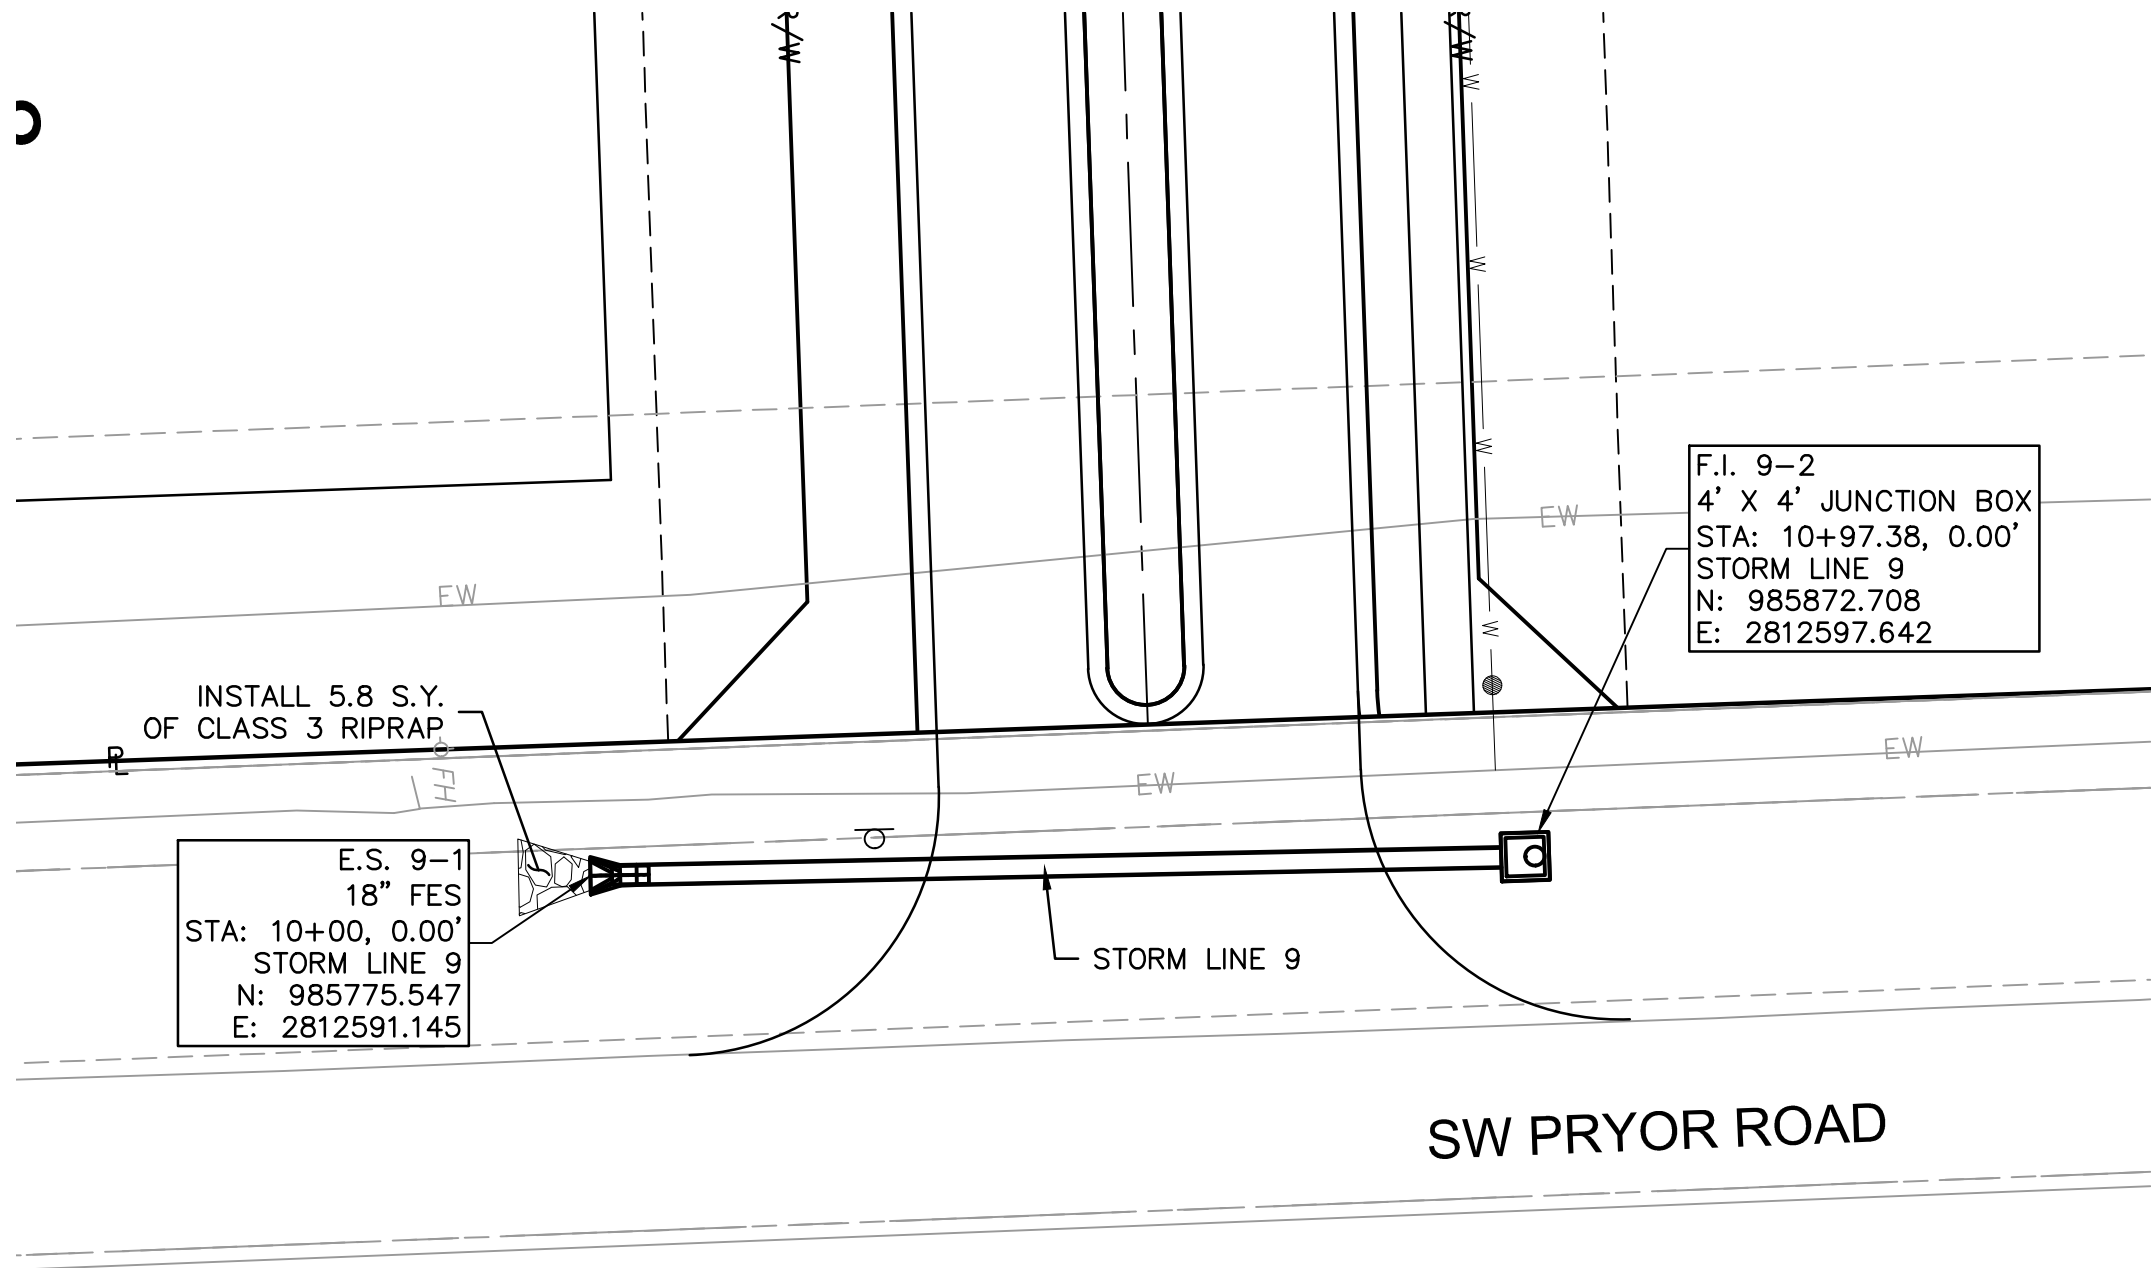

Riprap Calculations						
End Section	Q ₁₀₀ (cfs)	Pipe Diameter (ft)	Class*	D50* (in)	Apron Length (ft)	Apron Depth (ft)
E.S. 9-1	14.93	1.5	3	10	7.5	2.00
Area (SY)						
5.8						

*Per Table 10.1 HEC 14-FHWA-Energy Dissipators Pg. 10-18

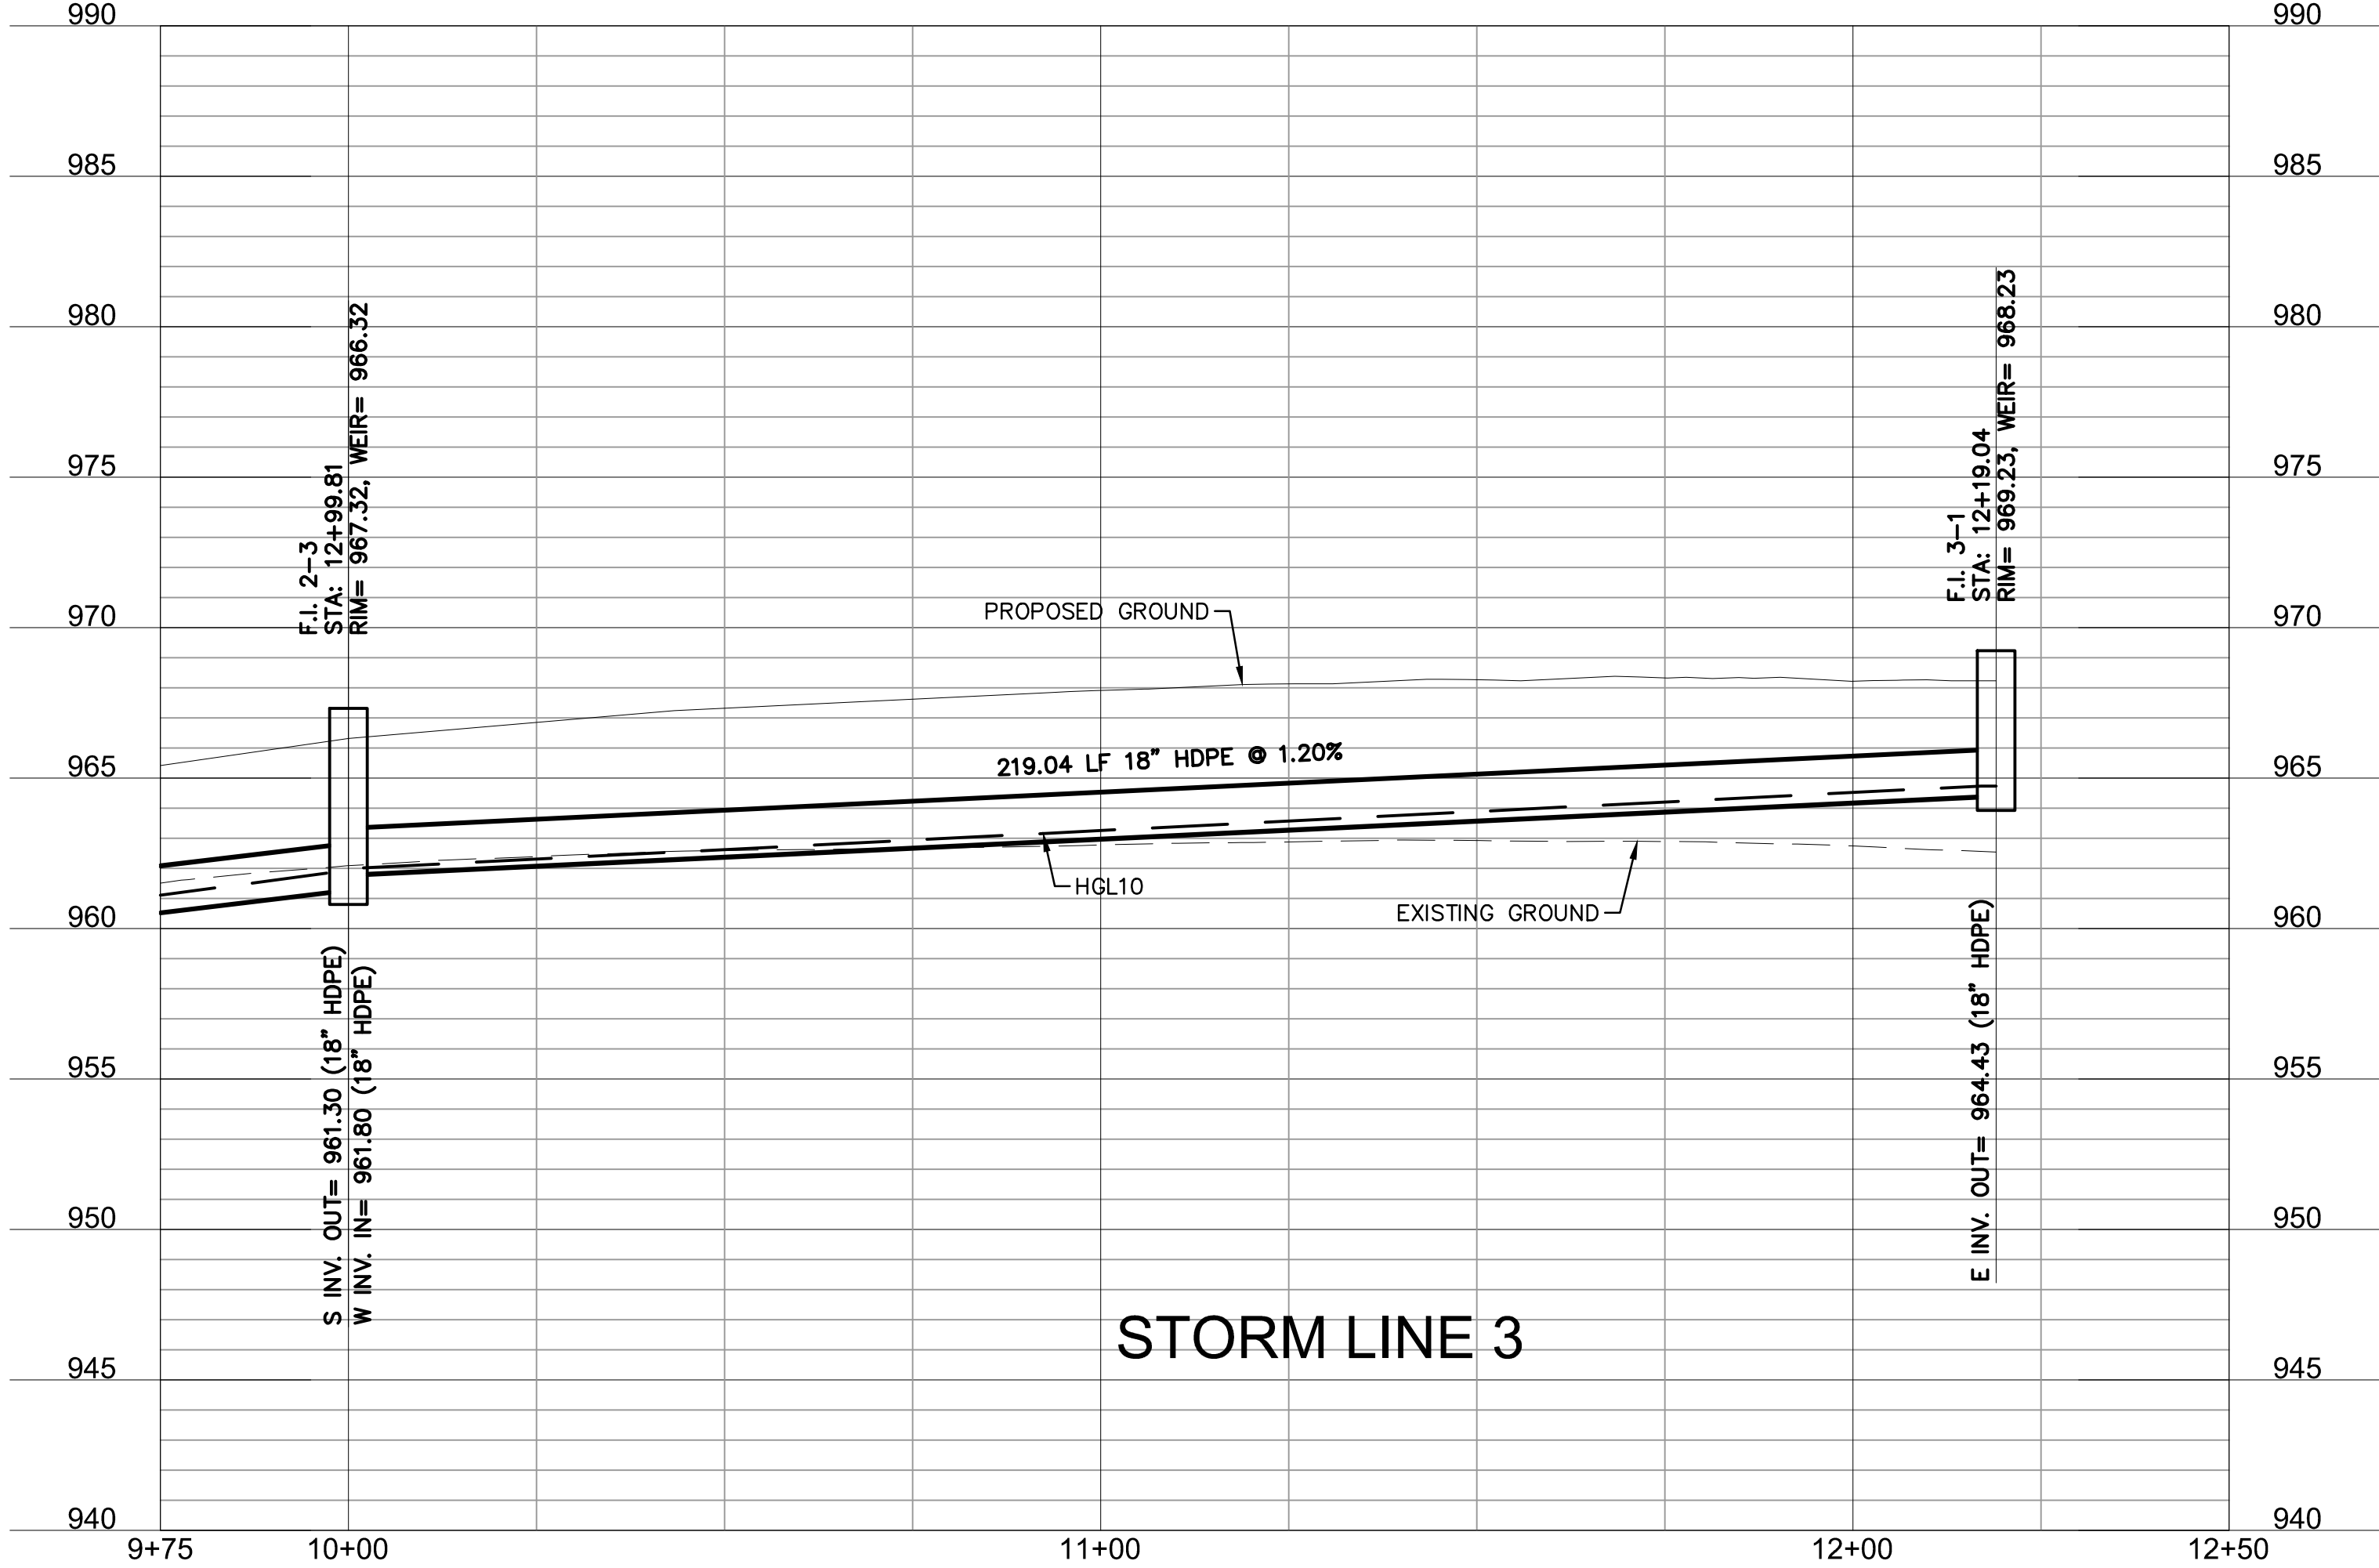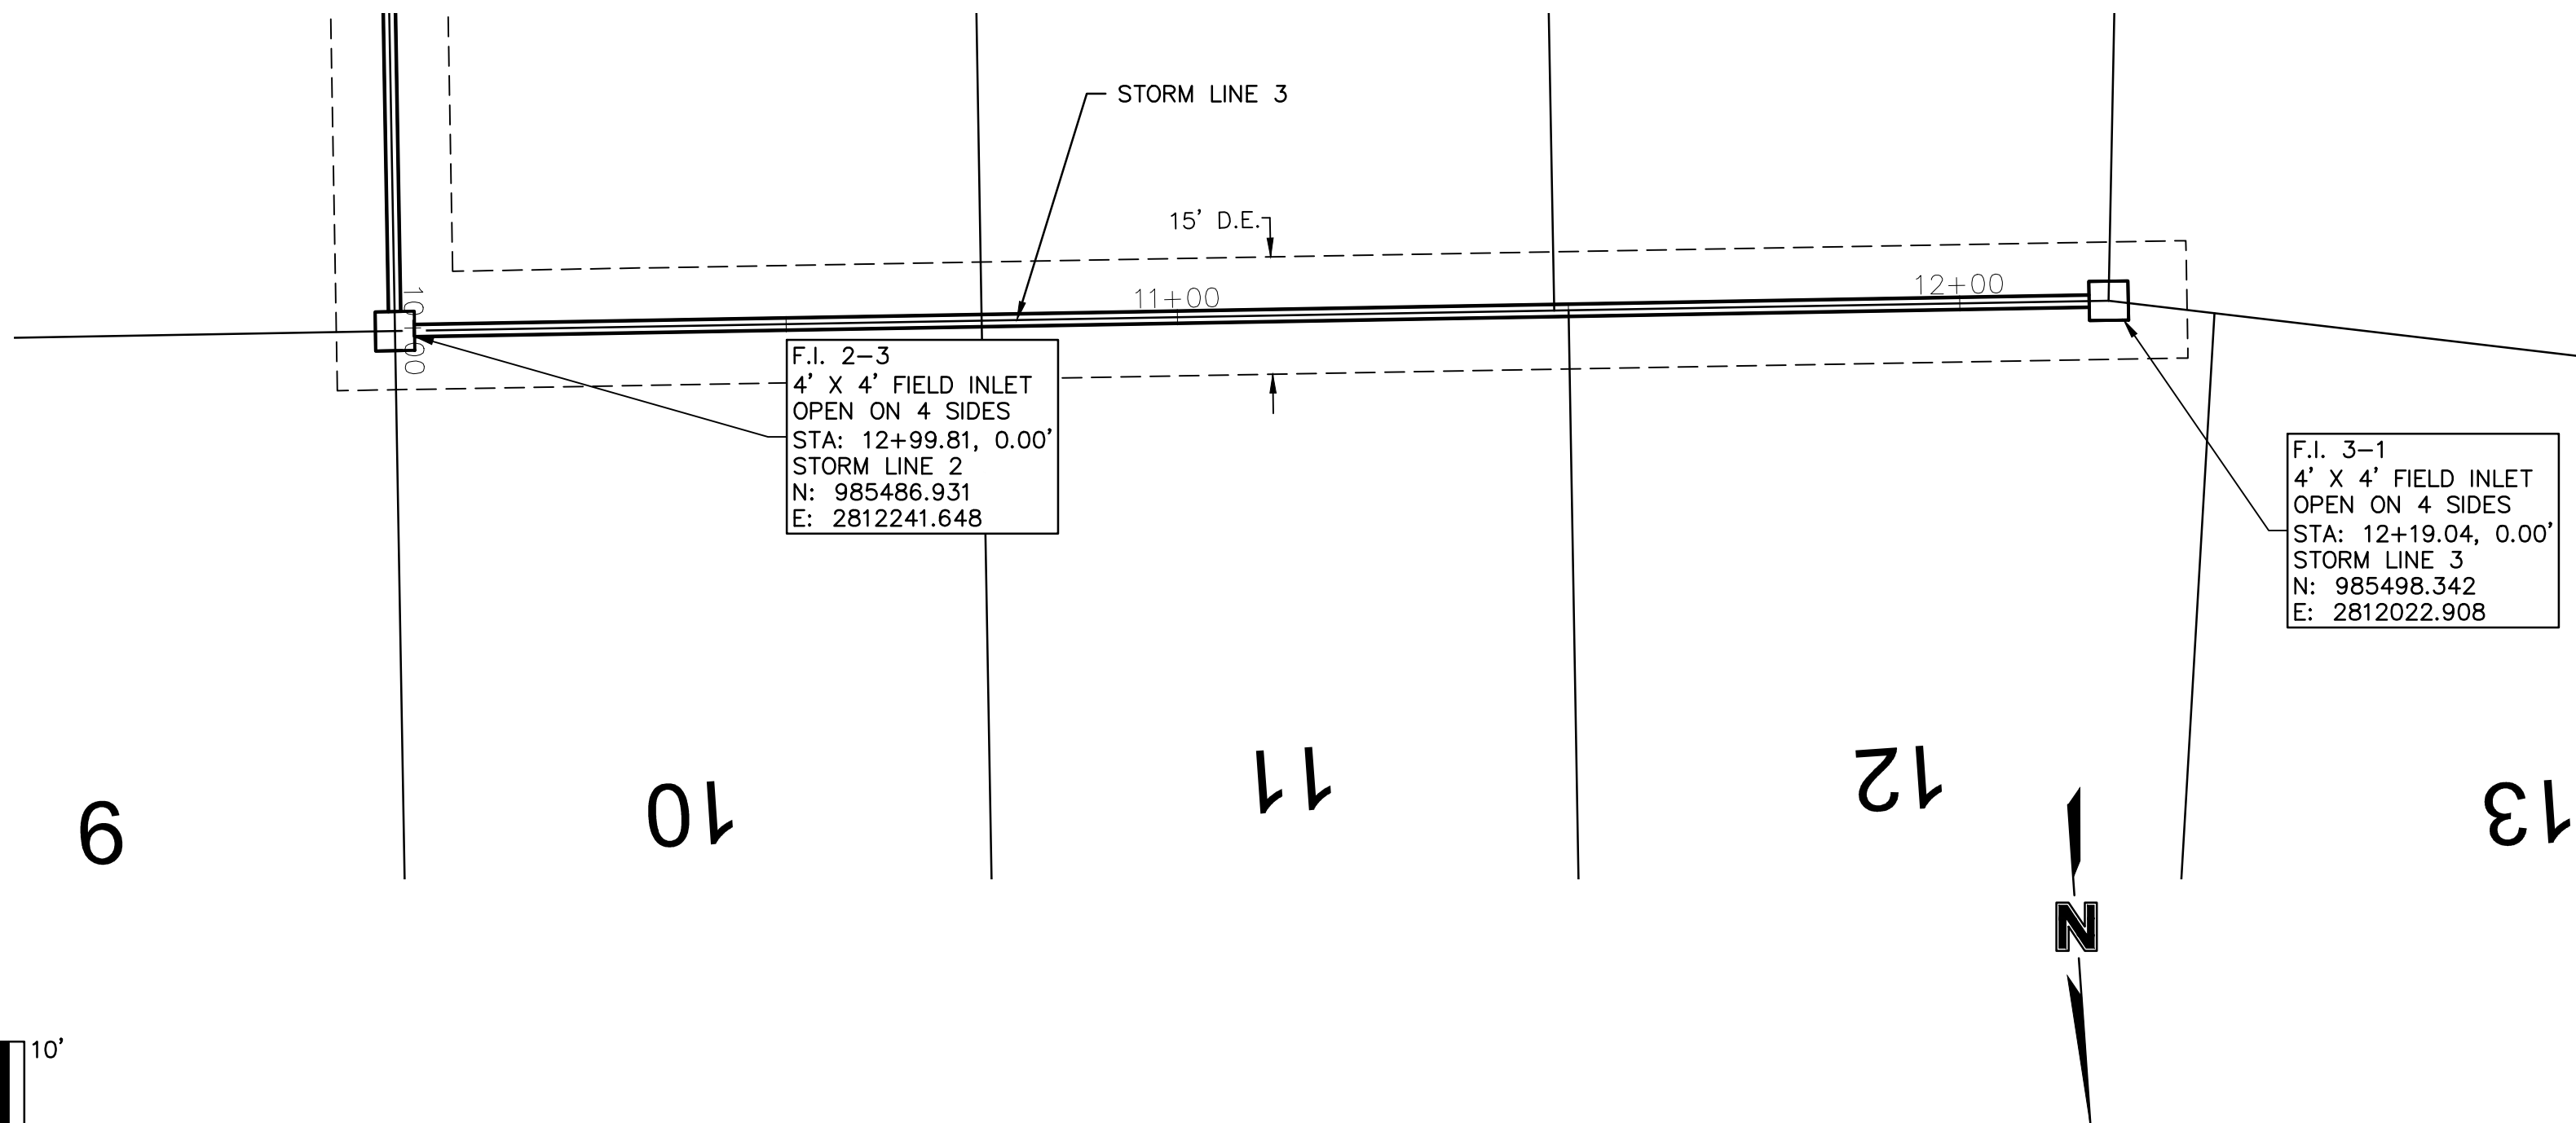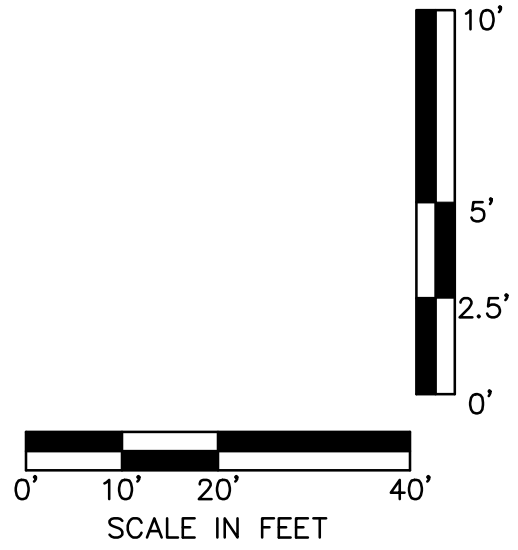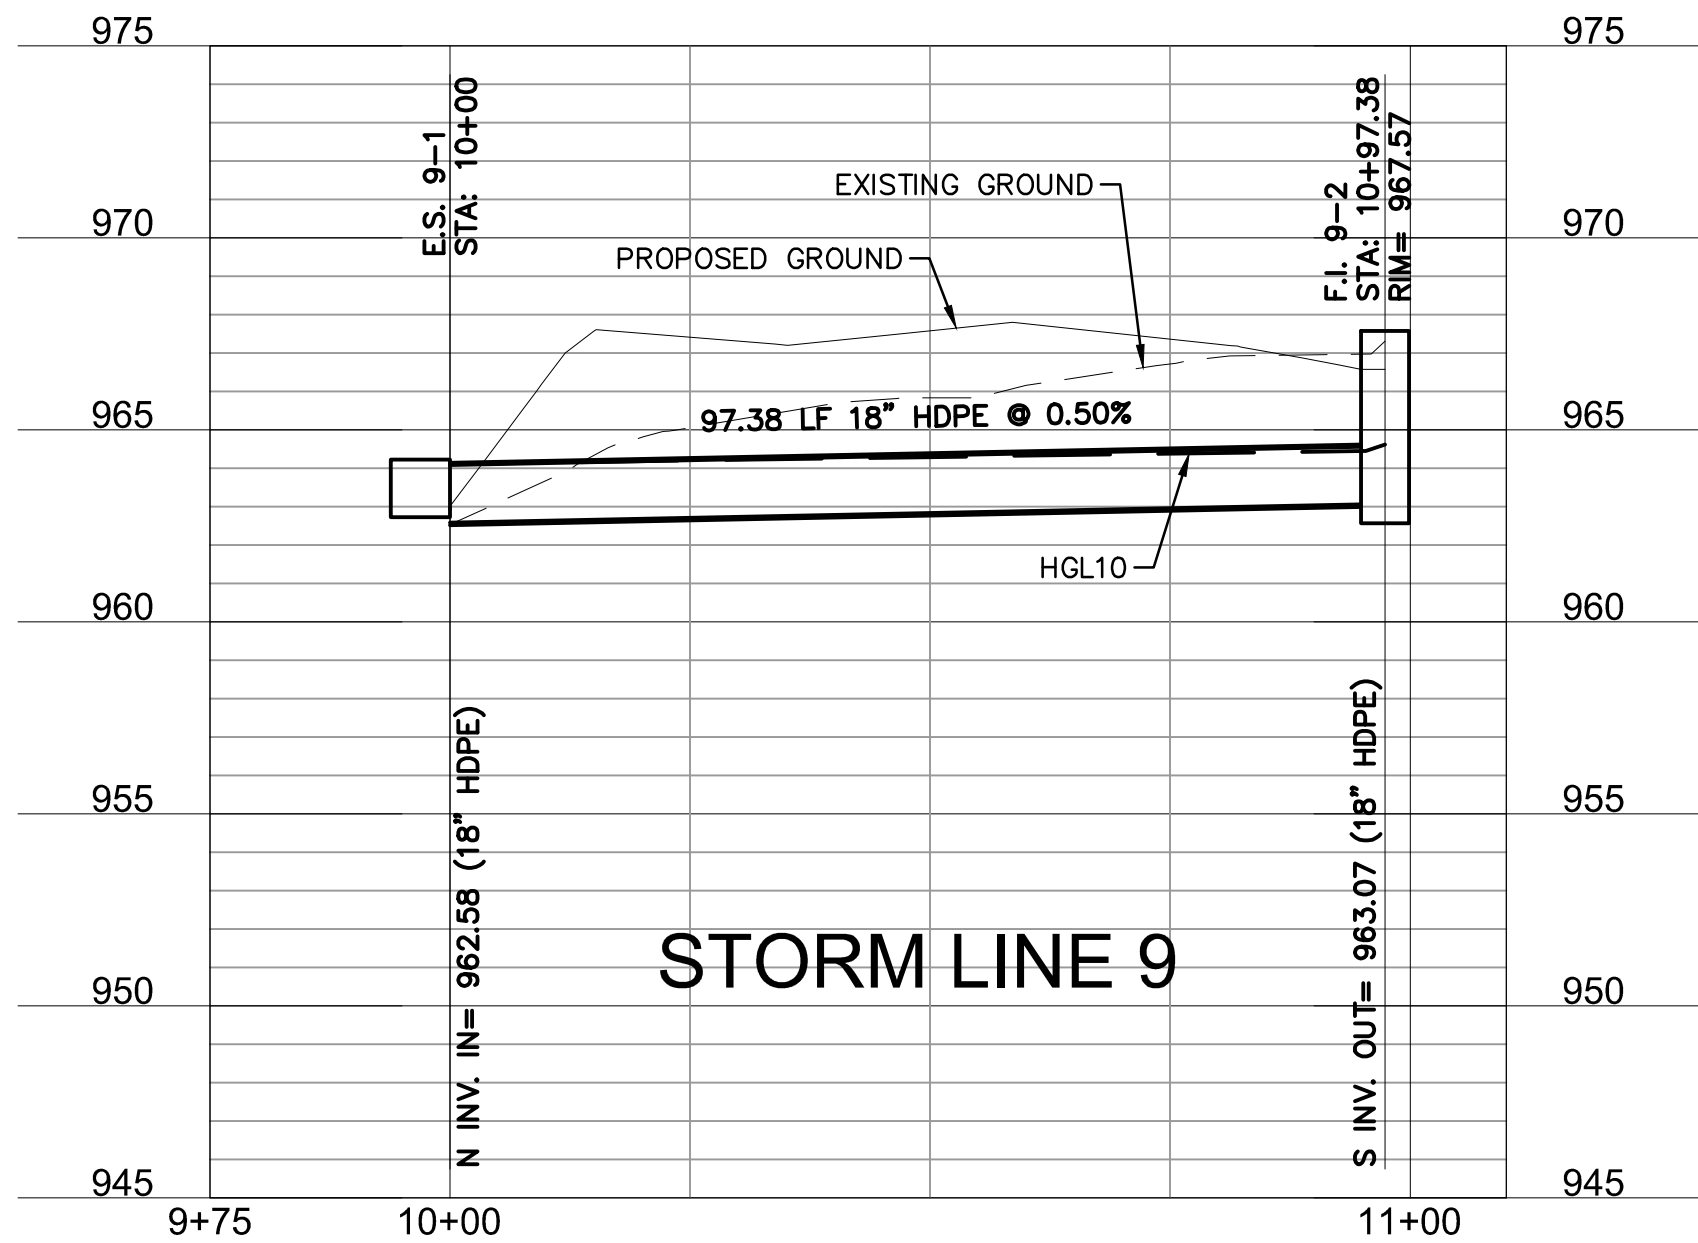

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

REV. NO.	DATE	REVISIONS DESCRIPTION	BY

STORM SEWER PLAN & PROFILE (LINE 3 & 9)
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

2020

REVISIONS


drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020

SHEET
C132

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheet\GNCV\Street and Storm Plans\C-STM02_0194061.dwg
DATE: Apr 20, 2020 2:03pm
XREFS: C_P\BLK_0194061_34x22 C_PBASE_0194061 C_PBNDY_0194061 C_PBASE_0194061 C_PSTRM_0194061 C_PPSURF_0194061 C_PUTIL_0194061
USER: nheiser

Riprap Calculations						
End Section	Q ₁₀₀ (cfs)	Pipe Diameter (ft)	Class*	D50* (in)	Apron Length (ft)	Area (SY)
E.S. 4-1	27.38	2.5	2	6	10	12.0

*Per Table 10.1 HEC 14-FHWA-Energy Dissipators Pg. 10-18

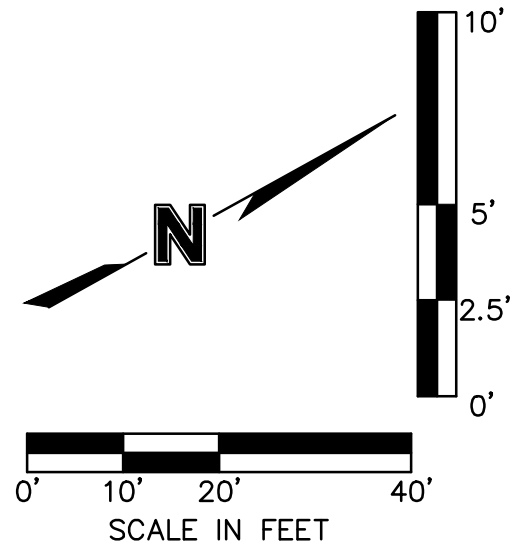

INSTALL 12 S.Y. OF
CLASS 2 RIPRAP

E.S. 4-1
30" FES
STA: 10+00
STORM LINE 4
N: 985258.303
E: 2811631.226

33

32

C.I. 4-2
6' X 3' CURB INLET
STA: 11+98
STORM LINE 4
STA: 23+55.88, 17.00 RT
SW HOOK FARM DRIVE
N: 985431.176
E: 2811727.761

C.I. 4-3
6' X 3' CURB INLET
STA: 12+46.46
STORM LINE 4
STA: 23+90.41, 17.00 LT
SW HOOK FARM DRIVE
N: 985444.022
E: 2811774.492

SW HOOK FARM DRIVE

C.I. 5-1
5' X 3' CURB INLET
STA: 10+34
STORM LINE 5
STA: 10+44.00, 17.00 LT
SW FARM FIELD ROAD
N: 985497.337
E: 2811734.397


C.I. 4-4
6' X 3' CURB INLET
STA: 12+84.65
STORM LINE 4
STA: 10+44.00, 17.00 RT
SW FARM FIELD ROAD
N: 985480.760
E: 2811764.082

M.H. 4-5
60" MH
STA: 14+92.88
STORM LINE 4
STA: 12+52.04, 17.00 RT
SW FARM FIELD ROAD
N: 985662.394
E: 2811865.510

SW FARM FIELD ROAD

14

15

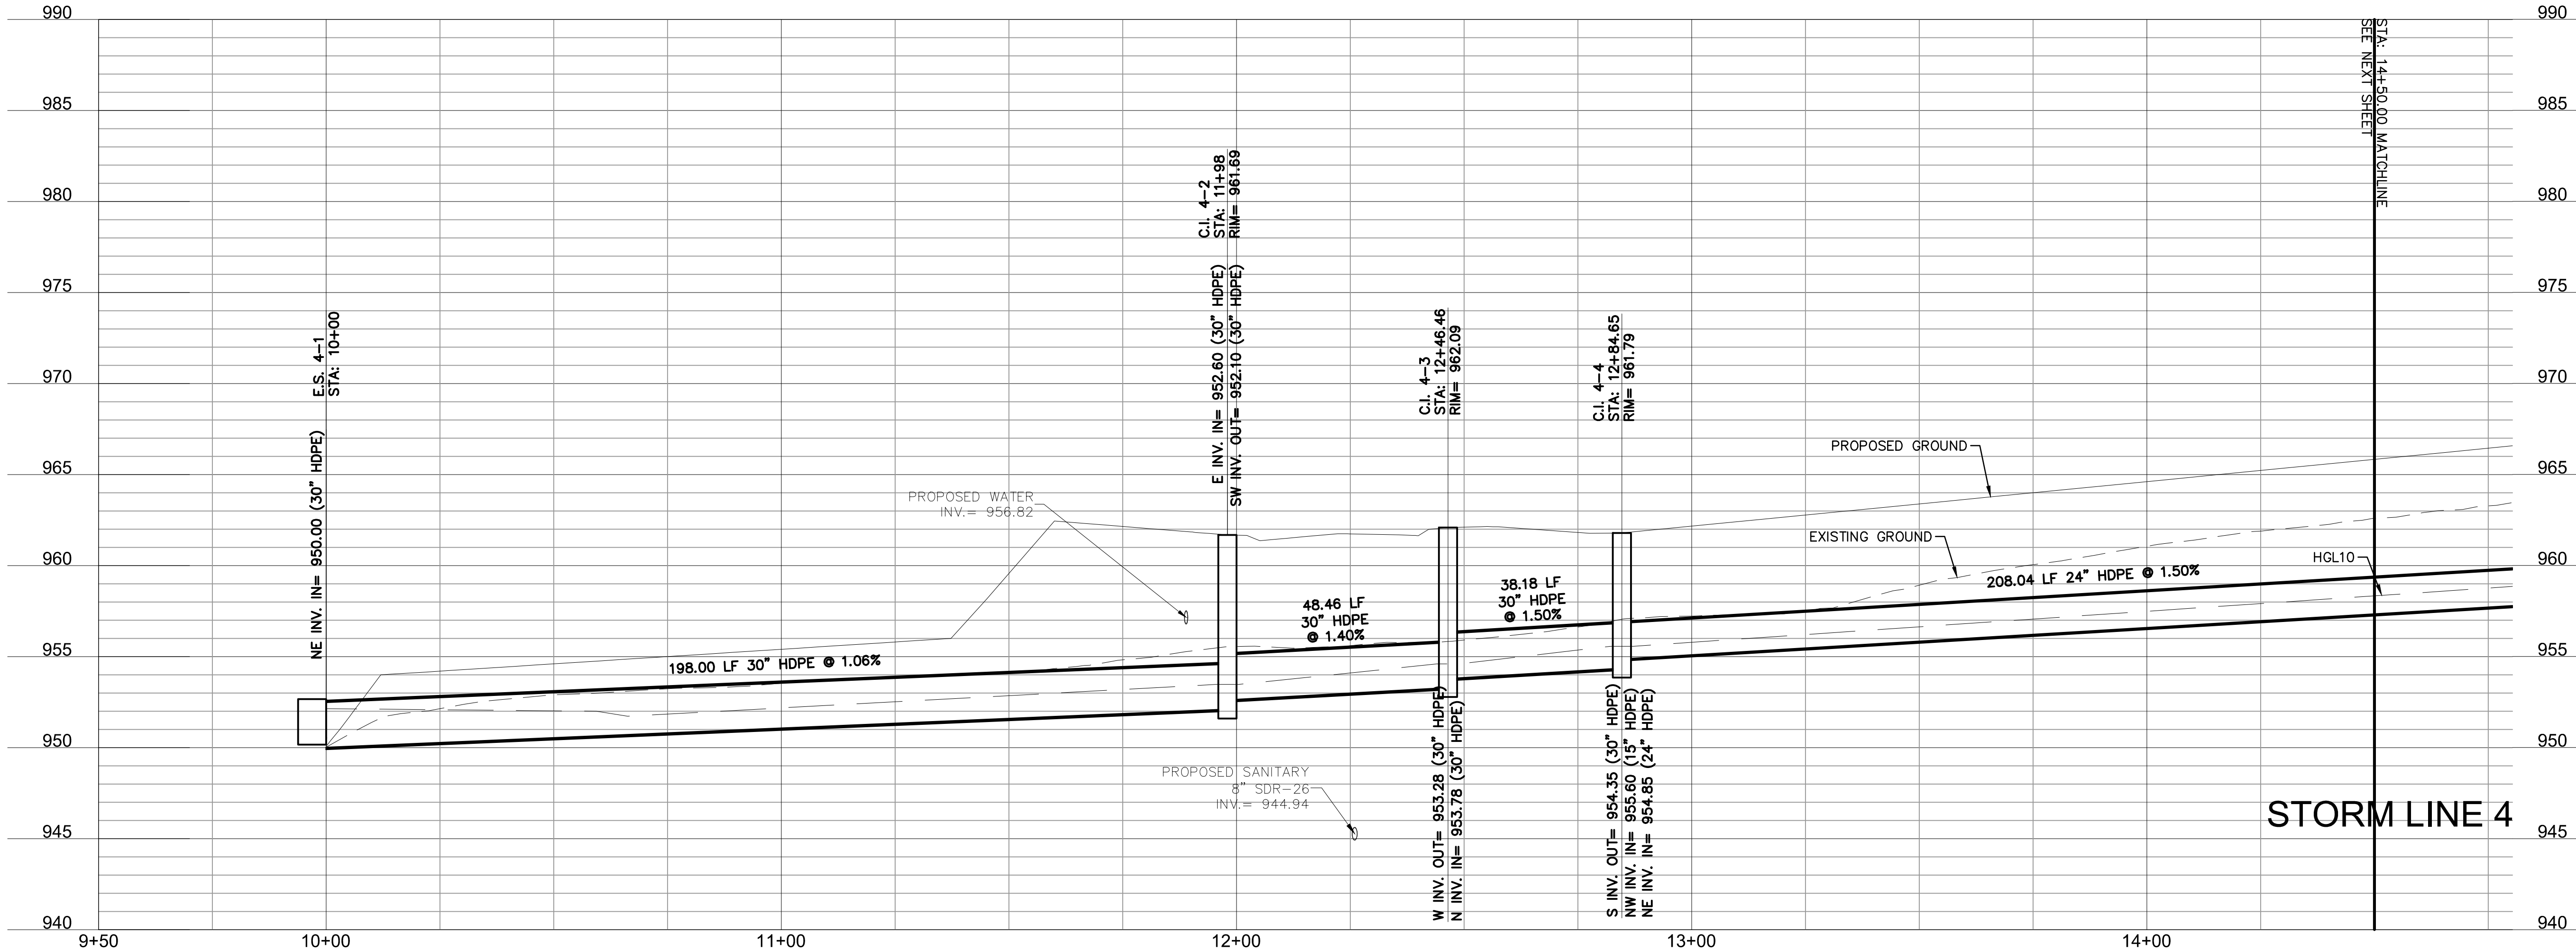

olsson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

STATE OF MISSOURI
JULIE ELAINE SELLERS
Professional Engineer
NUMBER PE-2017000367
4/20/2020

STORM SEWER PLAN & PROFILE (LINE 4)
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.:
date: 04/20/2020




BY

REVISIONS

2020

SHEET
C133


DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Sheet\GNCV\Street and Storm Plans\C_STM02_0194061.dwg USER: nheiser
DATE: Apr 20, 2020 2:03pm XREFS: C_PTBULK_0194061_34x22 C_PBNDY_0194061 C_PBASE_0194061 C_PSTRM_0194061 C_PSURF_0194061 C_PUTIL_0194061

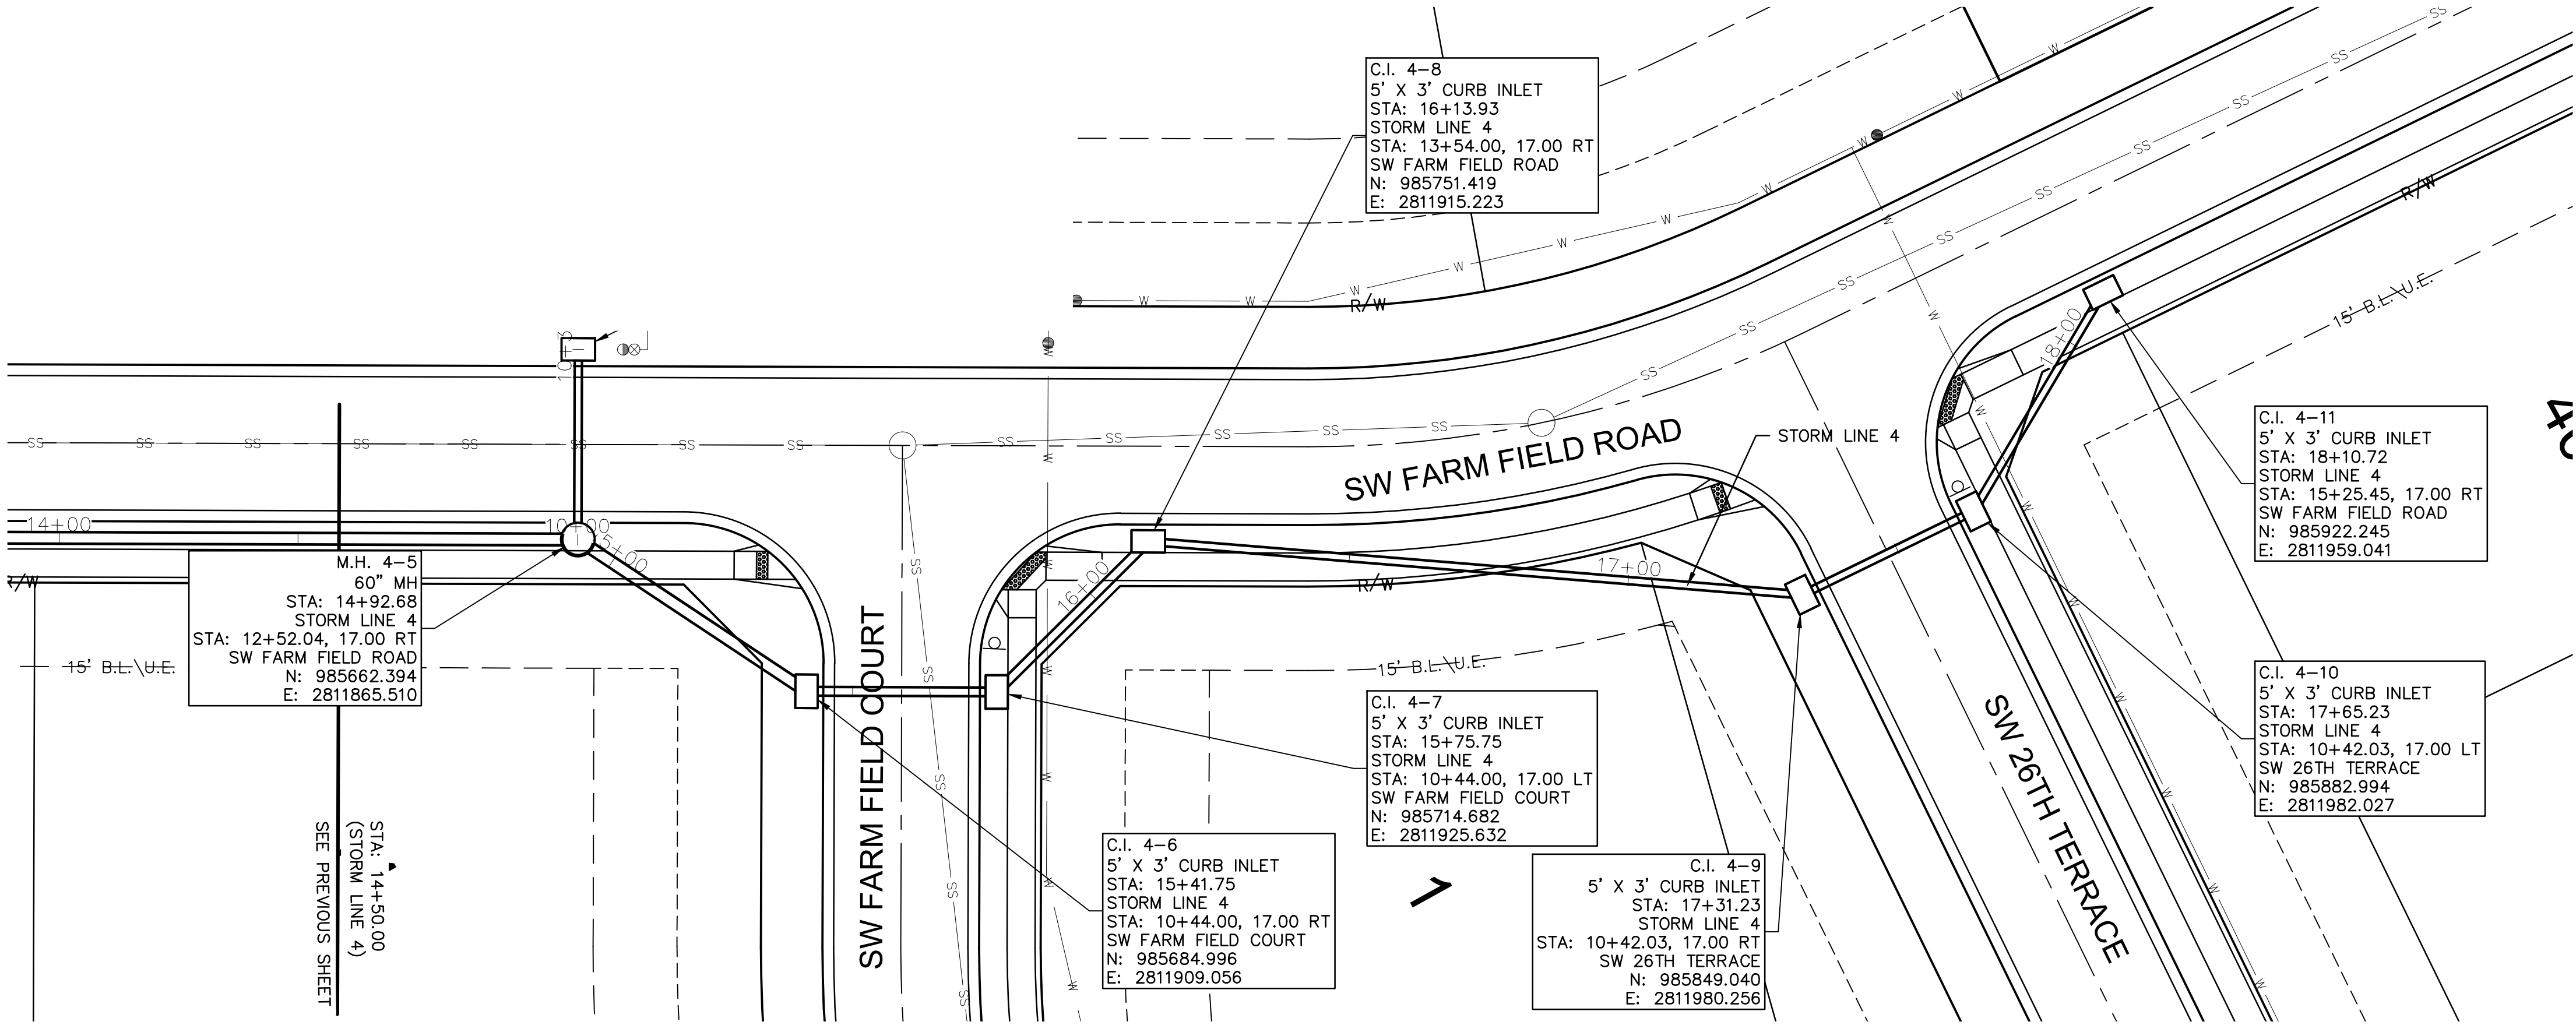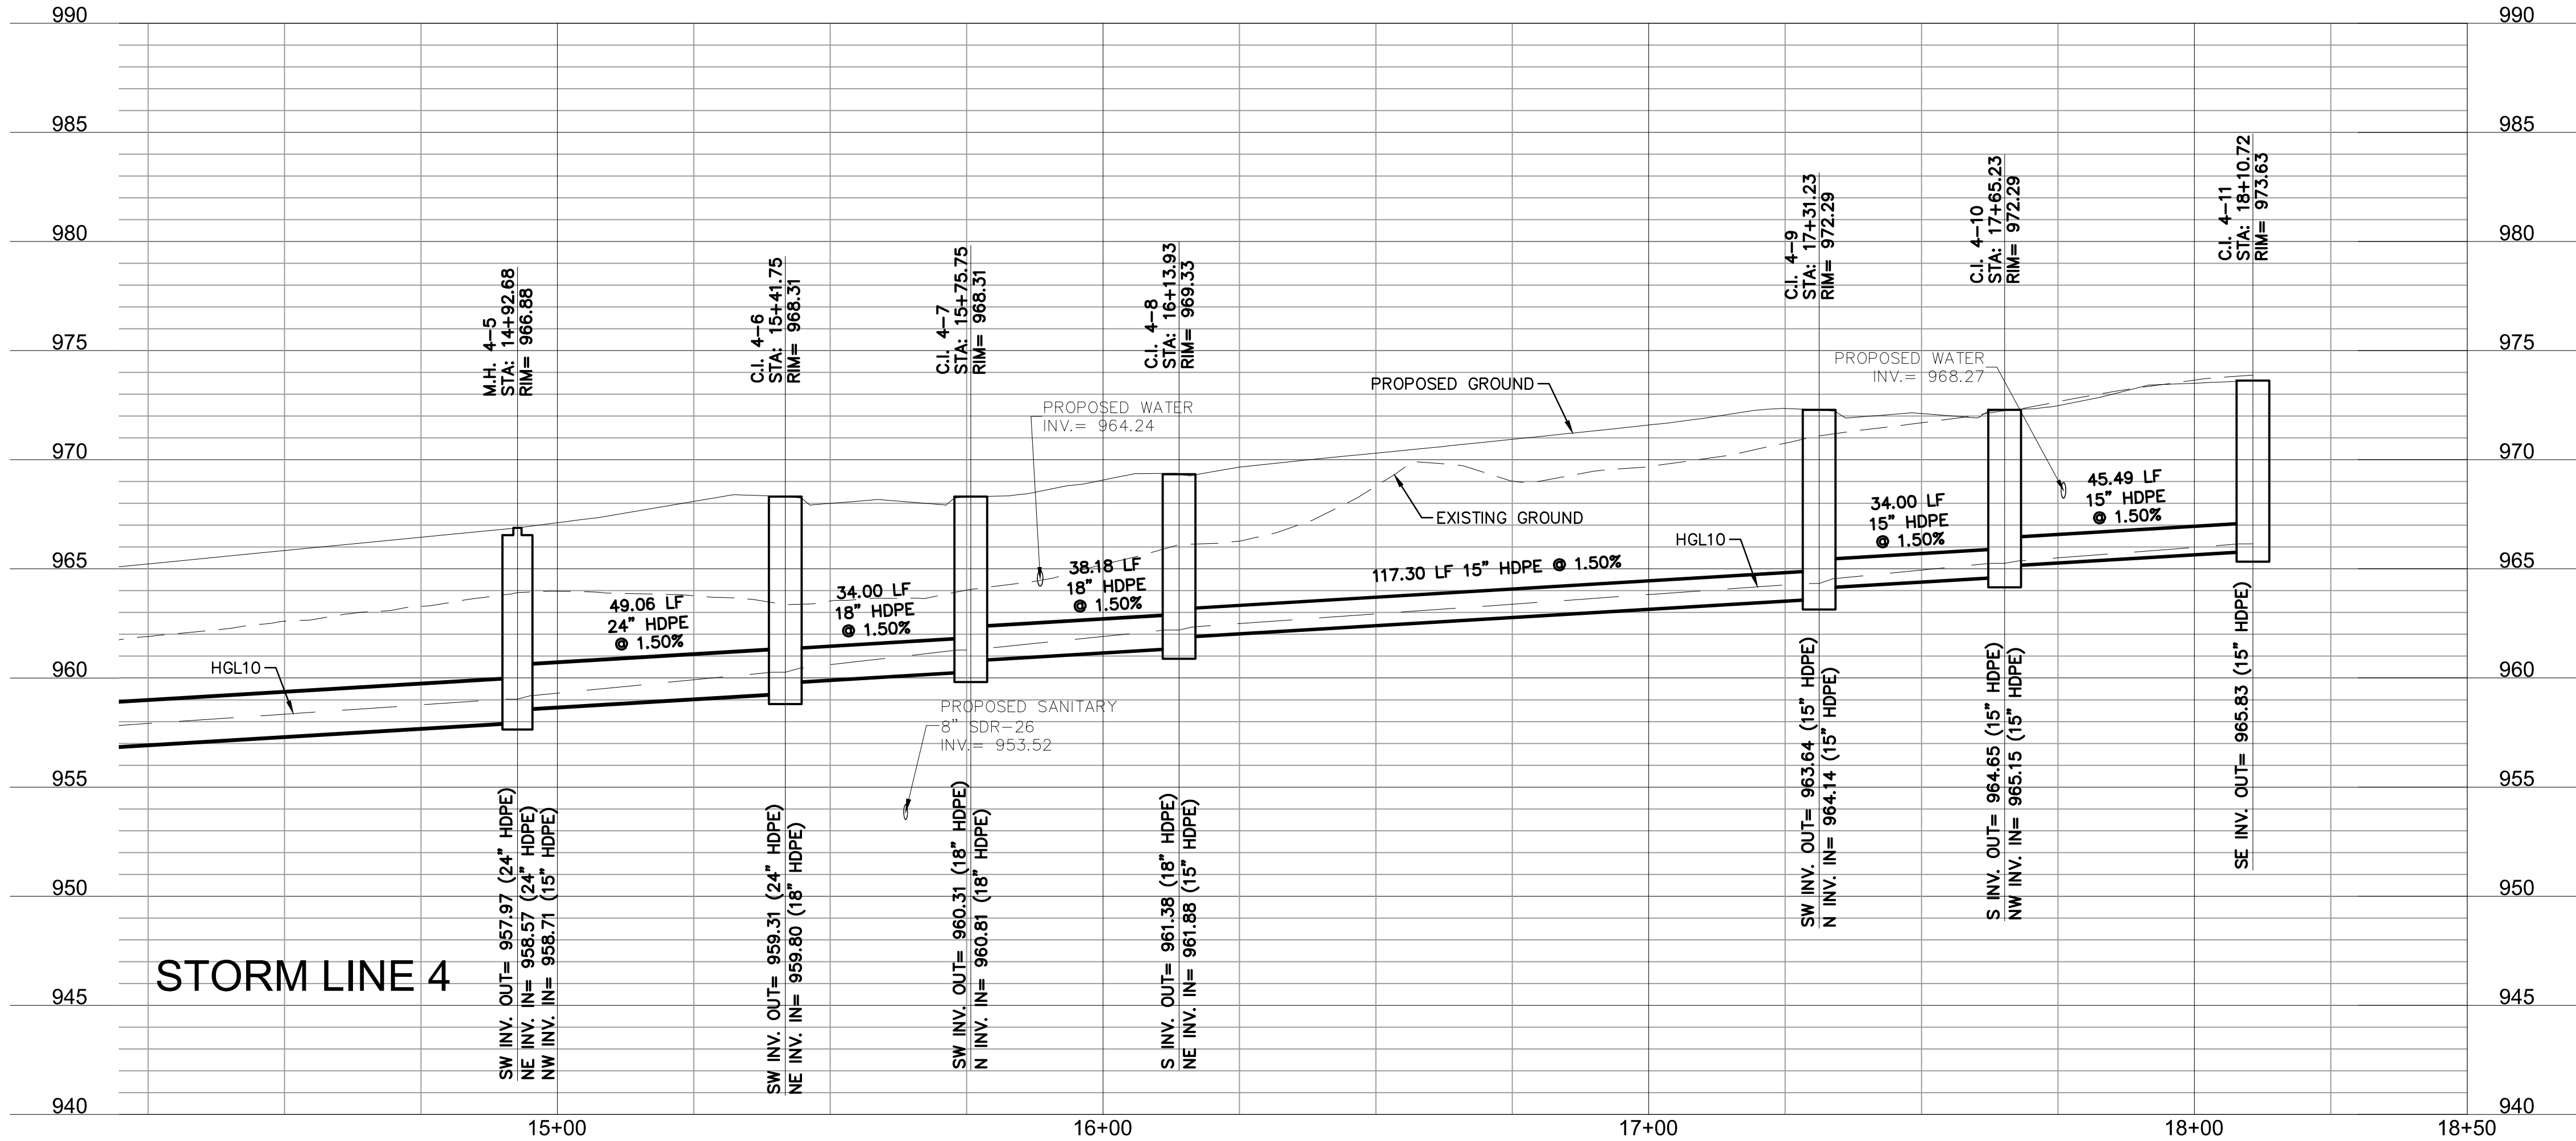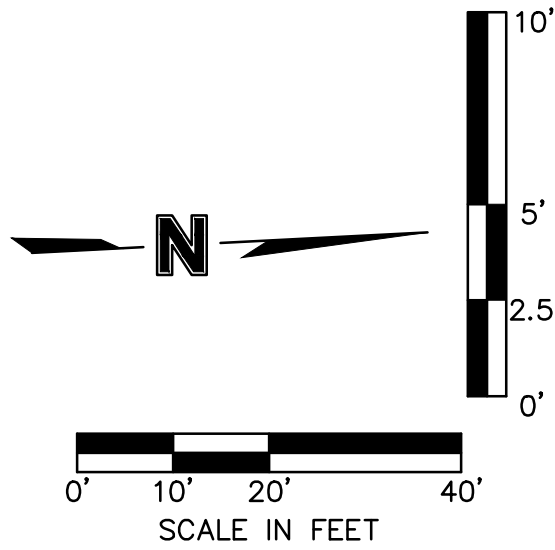

STORM SEWER PLAN & PROFILE (LINE 4 CONT'D) STREET AND STORM SEWER PLANS		HOOK FARMS FIRST FLAT		2020	
LEE'S SUMMIT, MO		REVISIONS			
drawn by:	CGW	REV. NO.	DATE	REVISIONS DESCRIPTION	BY
checked by:	JES				
approved by:	NDH				
QA/QC by:	JES				
project no.:	019-4061				
drawing no.:					
date:	04/20/2020				
SHEET C134					

Julie Elaine Sellers
Professional Engineer
Missouri
License Number: PE-2017000367
Date: 4/20/2020

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

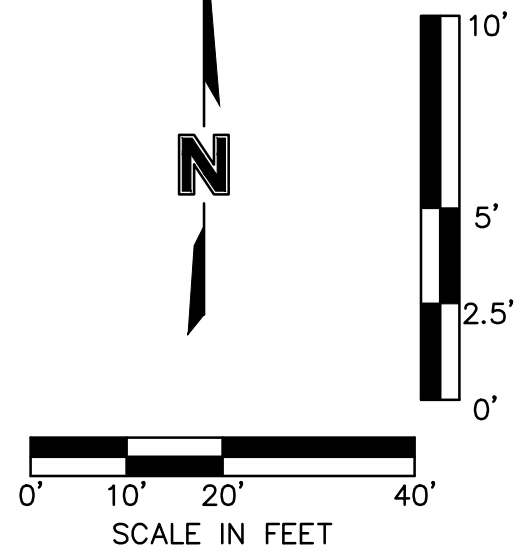USER: nheiser
61 C_FBA

*Per Table 10.1 HEC 14-FHWA-Energy Dissipators Pg. 10-18

C.I. 7-2
5' X 3' CURB INLET
STA: 10+25
STORM LINE 7
STA: 21+96.69, 17.00 LT
SW HOOK FARM DRIVE
N: 985532.088
E: 2811597.934

F.I. 7-3
4' X 4' FIELD INLET
OPEN ON 4 SIDES
STA: 10+48.54
STORM LINE 7
N: 985552.856
E: 2811609.017

F.I. 7-4
4' X 4' FIELD INLET
OPEN ON 4 SIDES
STA: 13+41.23
STORM LINE 7
N: 985809.116
E: 2811750.441

olson

Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116
TEL 816.361.1177
FAX 816.361.1888
www.olsson.com

[illegible]

STORM SEWER PLAN & PROFILE (LINE 7)
STREET AND STORM SEWER PLANS

HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO

drawn by: CGW
checked by: JES
approved by: NDH
QA/QC by: JES
project no.: 019-4061
drawing no.: _____
date: 04/20/2020

SHEET
C136

LEGEND	
	FINISHED INDEX CONTOURS
	FINISHED INTERMEDIATE CONTOURS
	RIDGE LINE
A	DRAINAGE AREA
C	RUNOFF COEFFICIENT
<u>C.I. 0-0</u>	STORM STRUCTURE NUMBER

NOTES:

MBOE – MINIMUM BUILDING OPENING ELEVATION

NOTES:
1. INDIVIDUAL LOT OWNERS SHALL NOT CHANGE OR OBSTRUCT THE DRAINAGE FLOW LINES OR PATHS ON THE LOTS, AS SHOWN ON THE MATER DRAINAGE PLAN, UNLESS SPECIFIC APPLICATION IS MADE AND APPROVED BY THE CITY ENGINEER.

2. PLAT IS LOCATION IN ZONE X, "AREAS OUTSIDE THE 1-PERCENT ANNUAL CHANCE FLOODPLAINS, AREAS OF 1-PERCENT ANNUAL CHANCE SHEET FLOW FLOODING WHERE THE AVERAGE DEPTHS ARE LESS THAN 1 FOOT, AREAS OF 1-PERCENT ANNUAL CHANCE STREAM FLOODING WHERE THE CONTRIBUTING DRAINAGE AREA IS LESS THAN 1 SQUARE MILE, OR AREAS PROTECTED FROM THE 1-PERCENT ANNUAL CHANCE FLOOD BY LEVEES. NO BASE FLOOD ELEVATIONS OR DEPTHS ARE SHOWN WITHIN THIS ZONE"

3. PLAT IS LOCATED OUTSIDE OF ANY REQUIRED BUFFER ZONES FOR NATURAL STREAMS.

4. MBOE ELEVATIONS HAVE BEEN PROVIDED AT EACH LOT CORNER. INTERPOLATION WILL BE ALLOWED BETWEEN THE RIGHT AND LEFT SIDE MBOE'S SHOWN ON THE MASTER DRAINAGE PLAN, DEPENDING ON THE LOCATION OF THE LOWEST OPENING ON THE PROPOSED STRUCTURE.

5. REFER TO SHEET C105-C109 FOR SWALE GRADING DETAILS.



6. DRAINAGE PATHS TO BE CONSTRUCTED BETWEEN EACH OF THE LOTS LABELED AS STANDARD LOTS TO DRAIN WEST.

7. NO BUILDING PERMITS WILL BE ISSUED UNTIL AN AS-GRADED MASTER DRAINAGE PLAN HAS BEEN SUBMITTED TO THE CITY AND APPROVED BY THE CITY.

BASEMENT TYPES

⑤ STANDARD

WALK-OUT

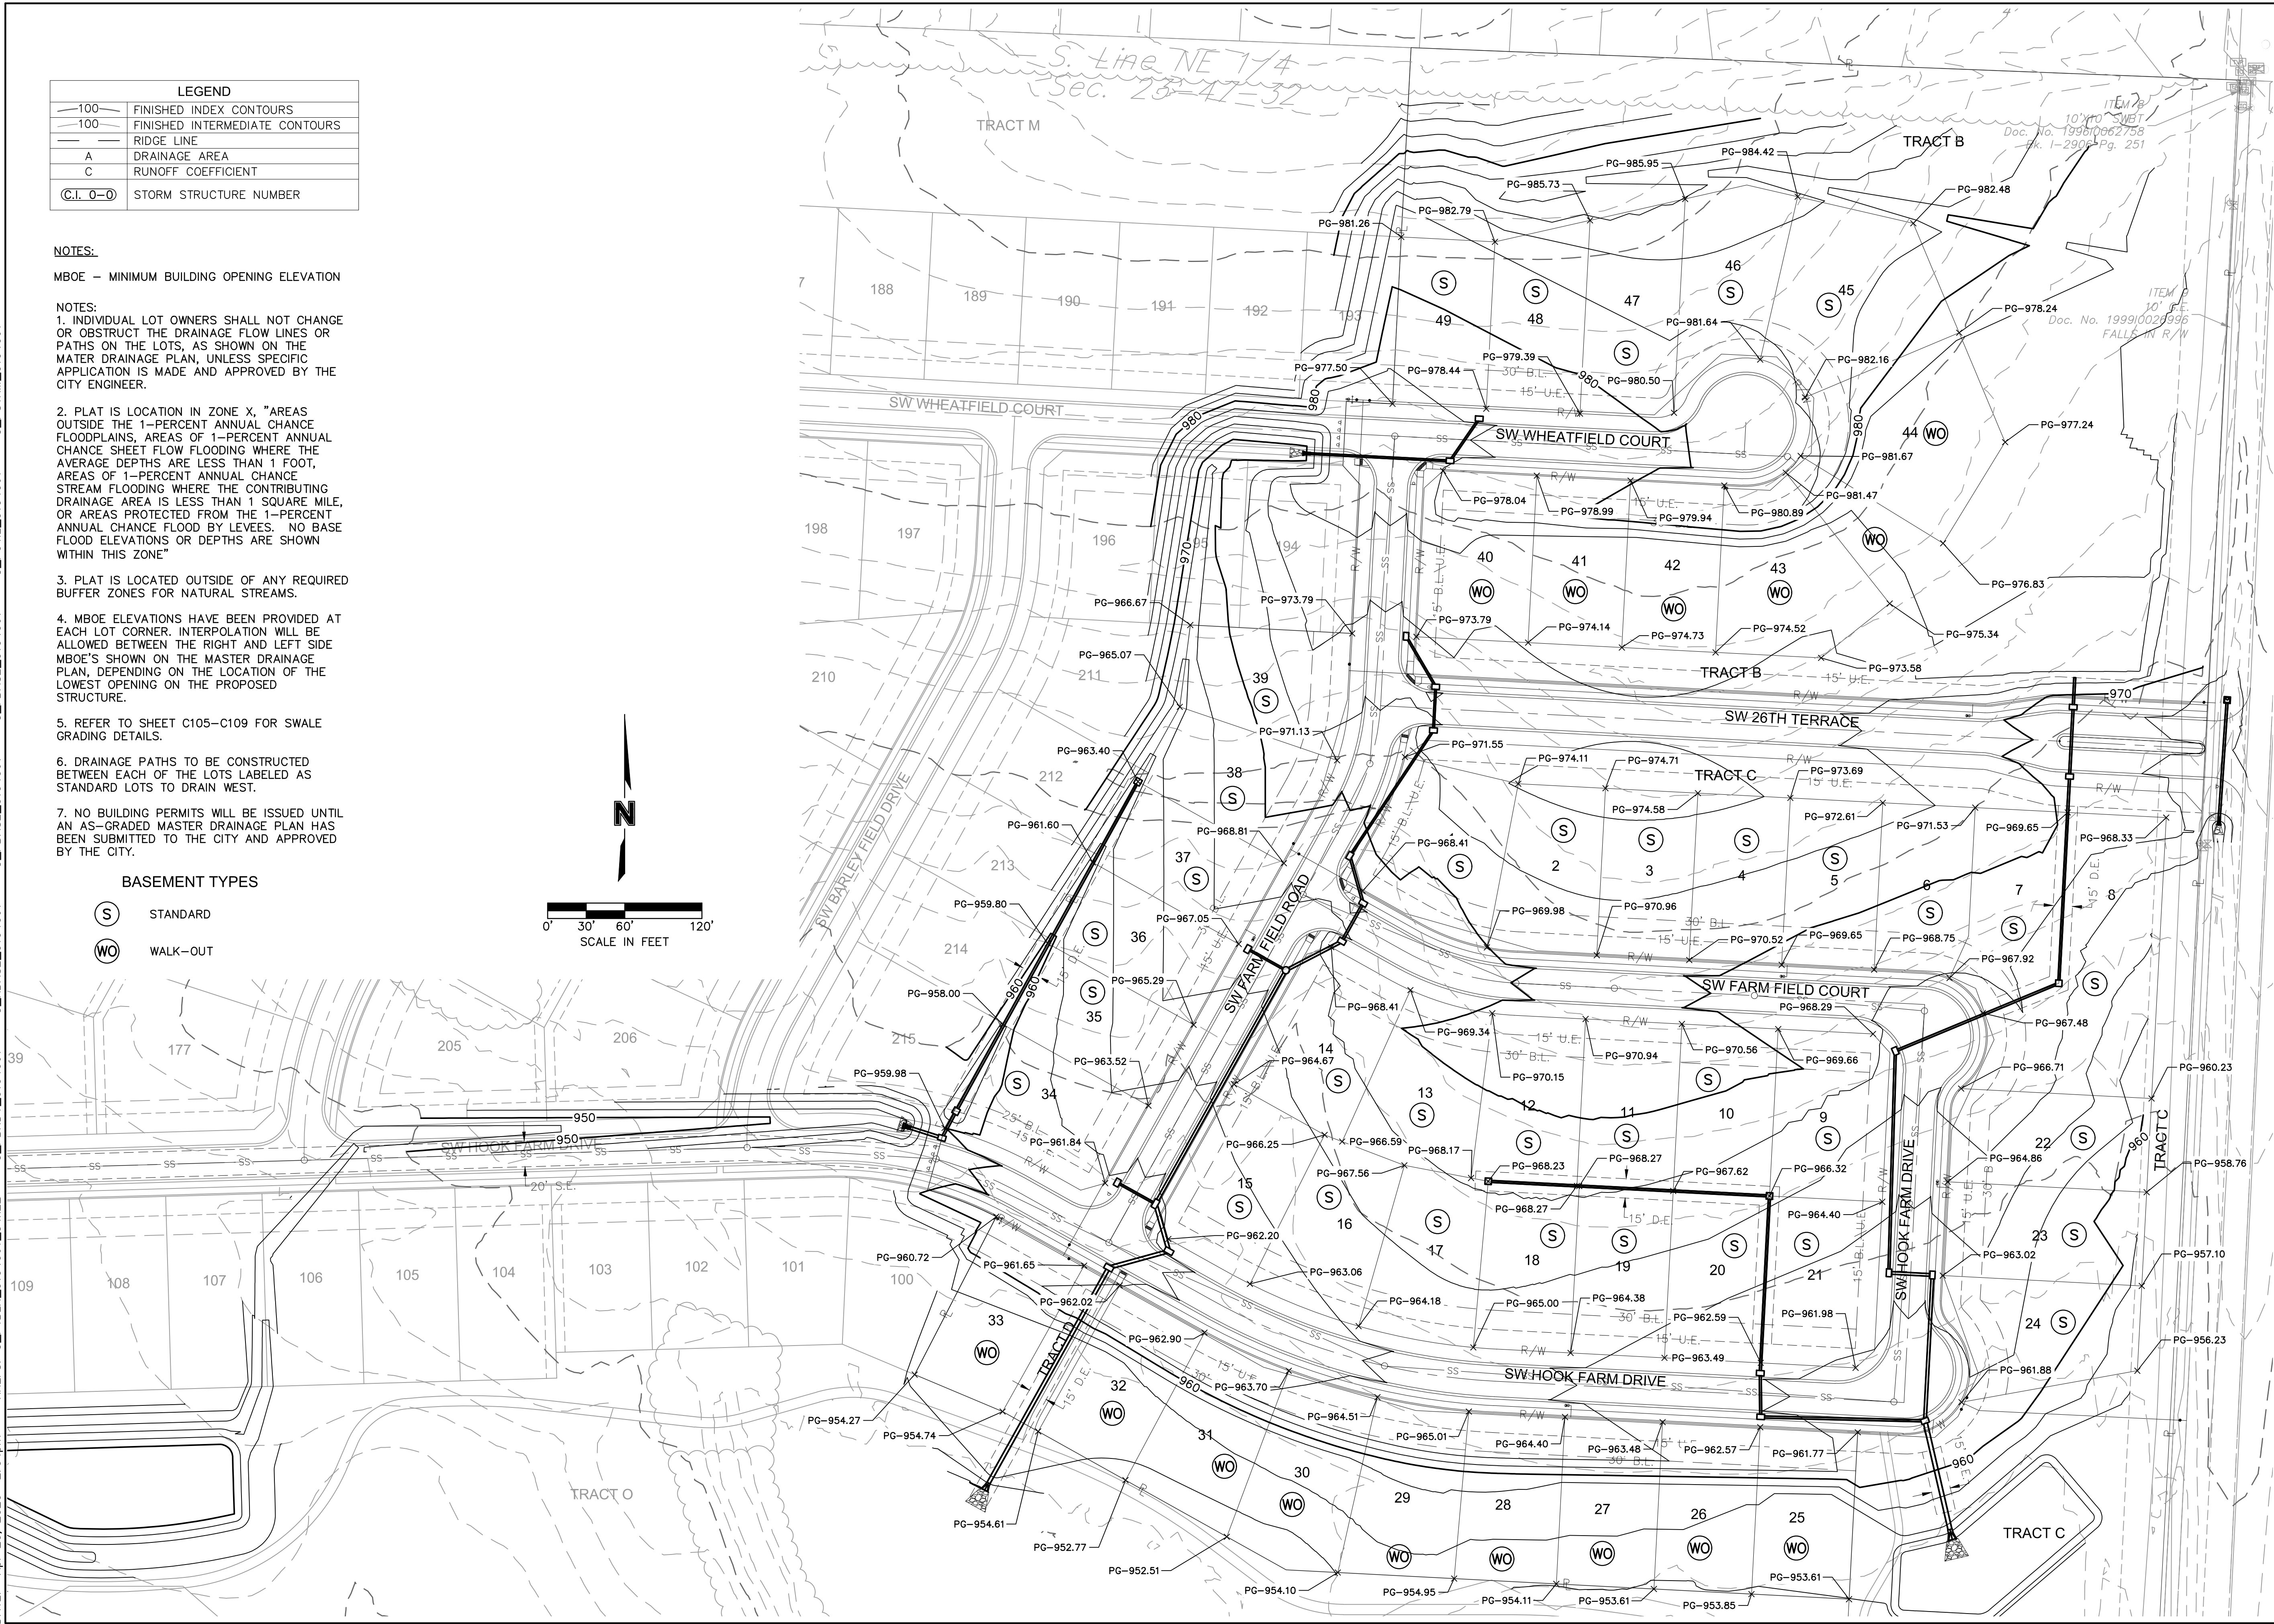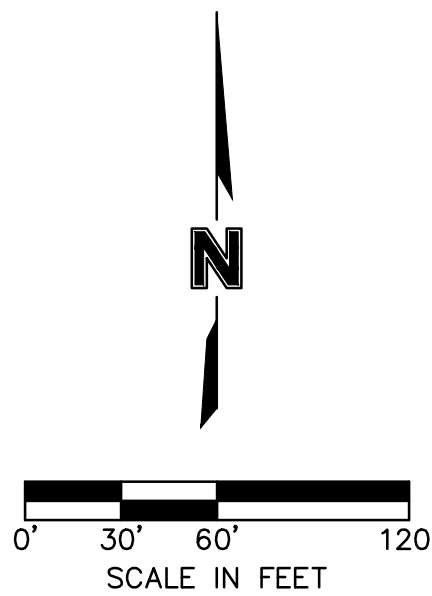

olsson



Olsson - Civil Engineering
Missouri Certificate of Authority #001592
1301 Burlington Street
North Kansas City, MO 64116

REVISIONS

MASTER DRAINAGE PLAN STREET AND STORM SEWER PLANS




HOOK FARMS
FIRST PLAT

LEE'S SUMMIT, MO


drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-4061
drawing no.: _____
date: _____ 04/20/2020

SHEET
C137

DWG: F:\2019\4001-4500\019-4061\40-Design\AutoCAD\Final Plans\Storm Plans\C_STM04_0194061.dwg
 XREFS: C:\PTBLK_0194061_34x22 C_PBNDY_0194061 C_XBASE_0194061 C_PBASE_0194061 C_FBASE_0194061 C_PUTIL_0194061
 DATE: Apr 20, 2020 2:51pm USER: nheiser
 C_PSTRM_0194061

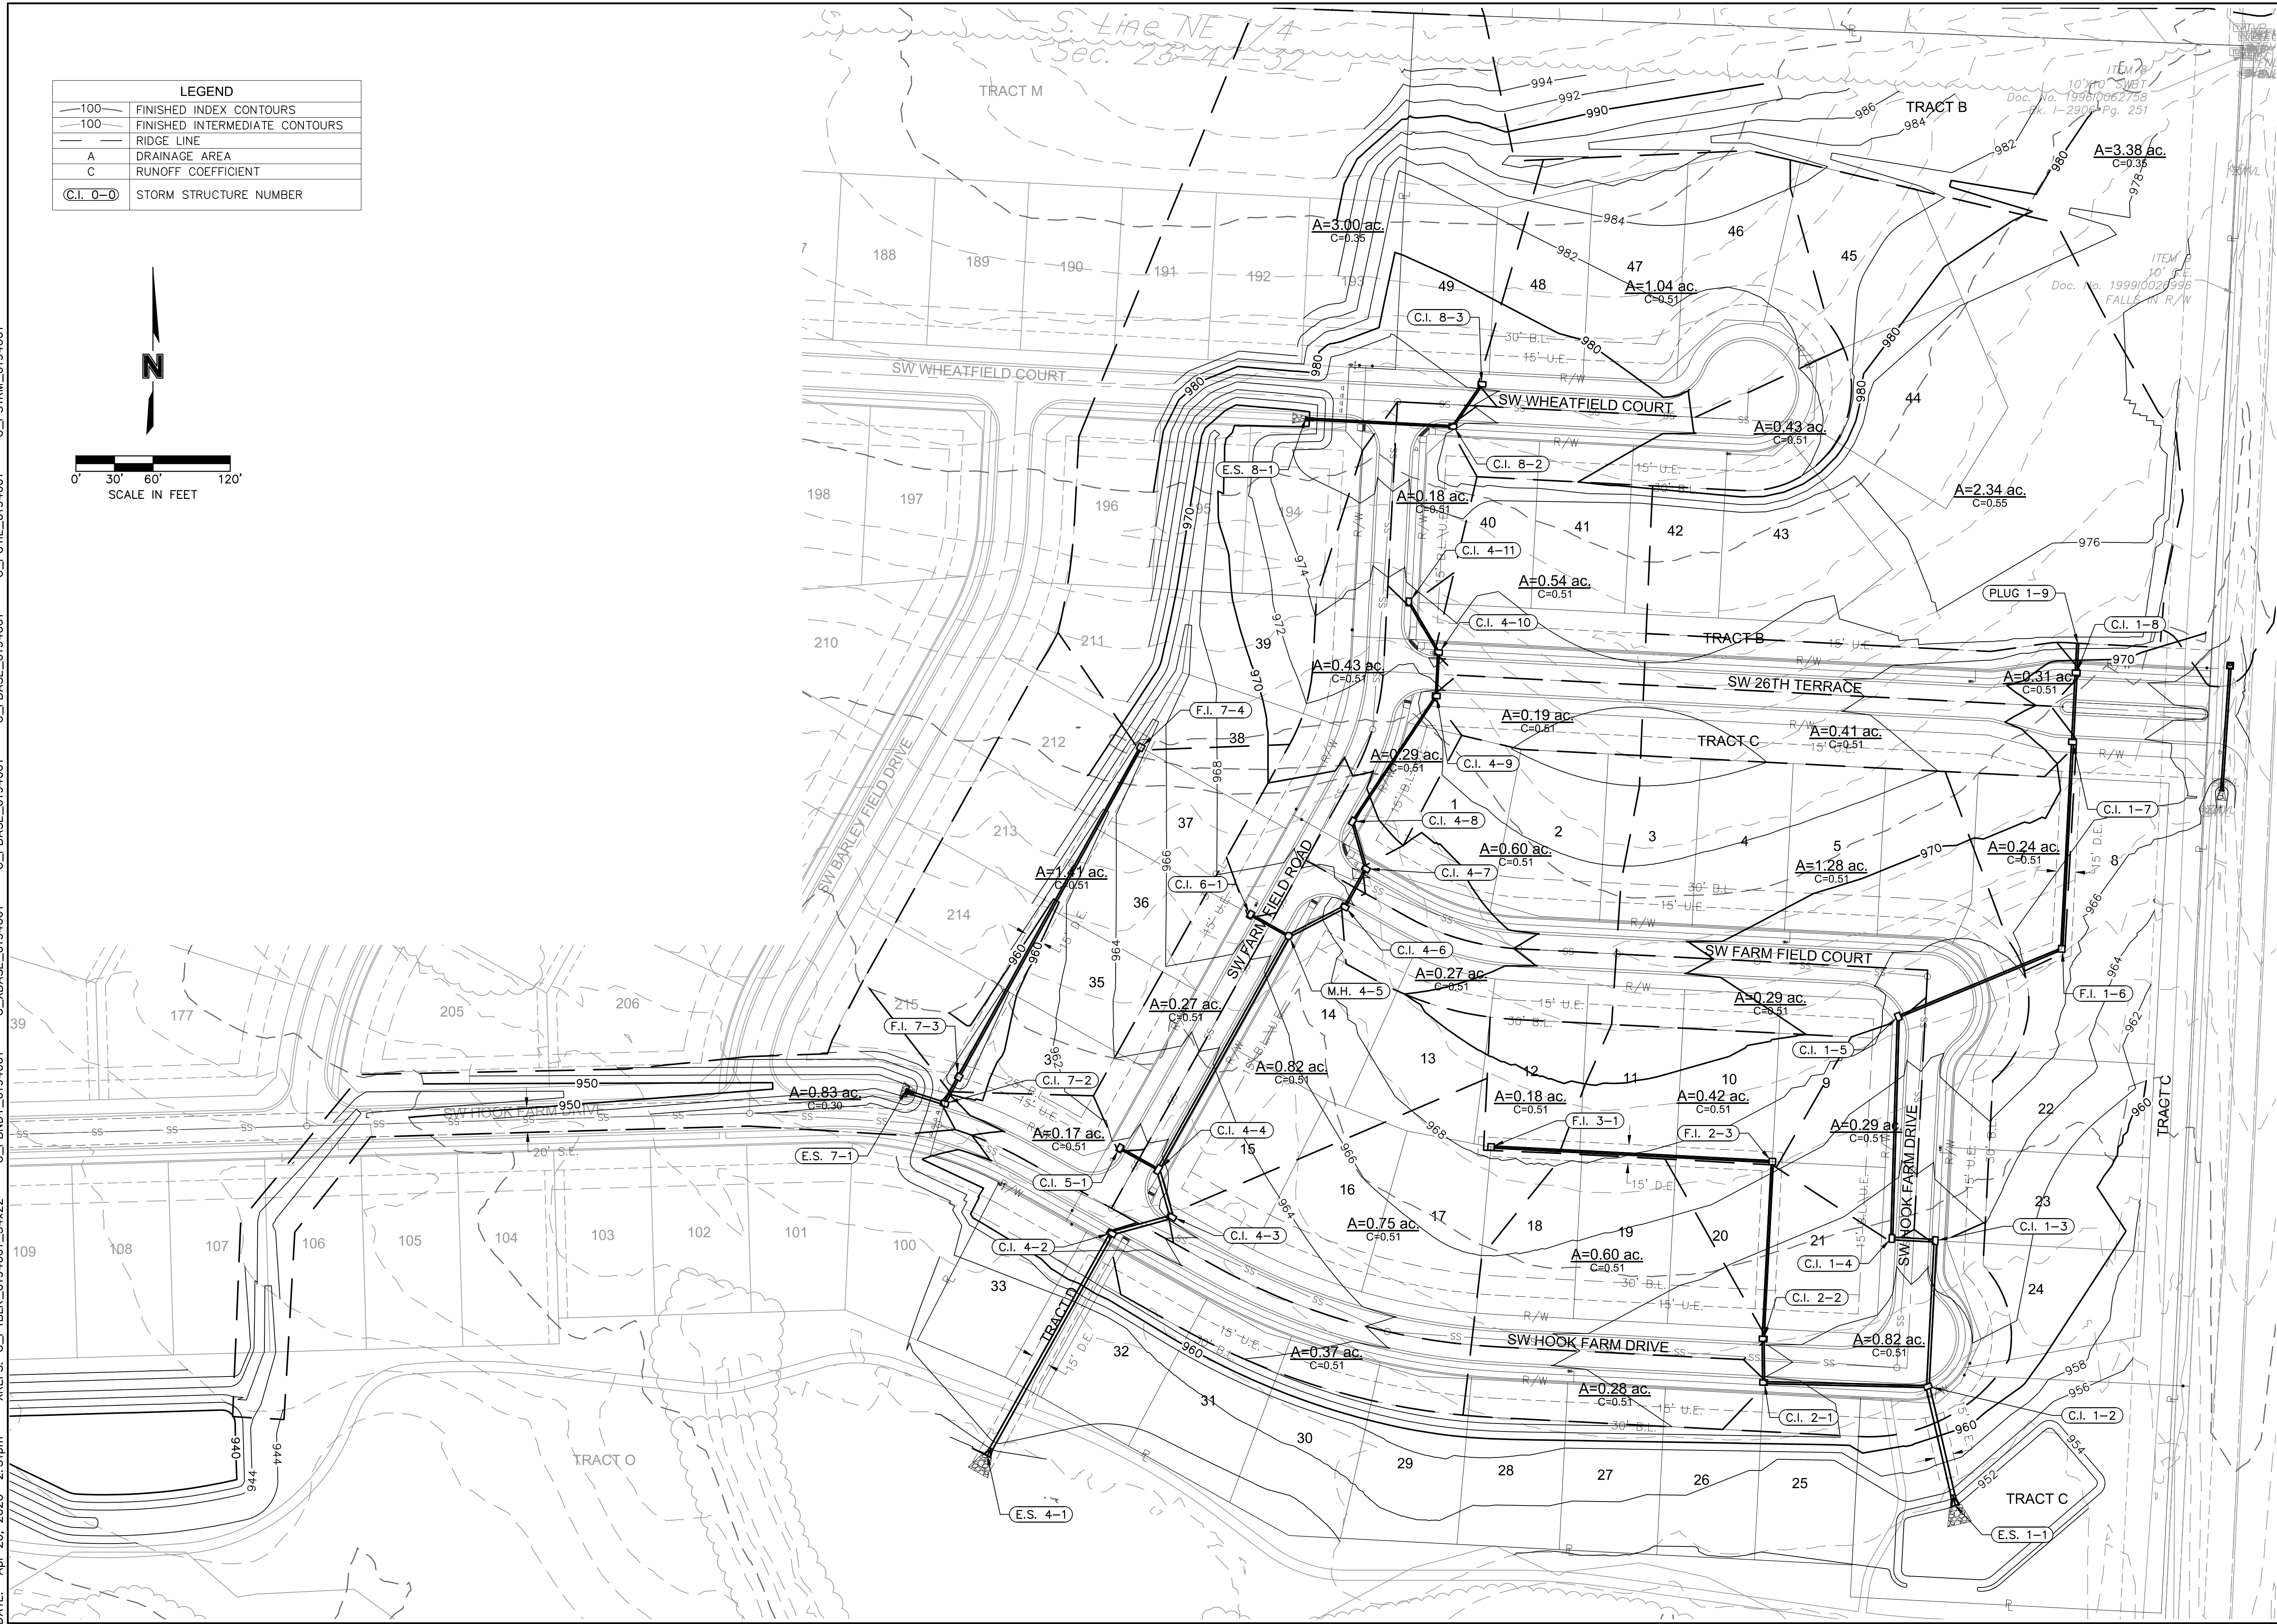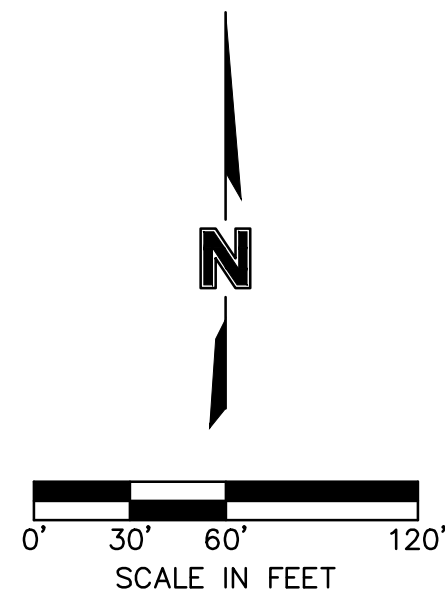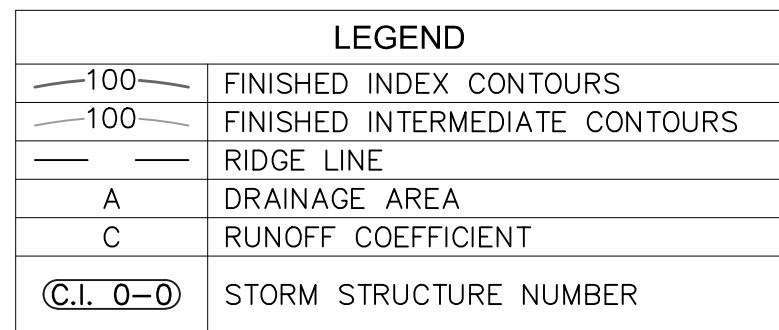

olsson

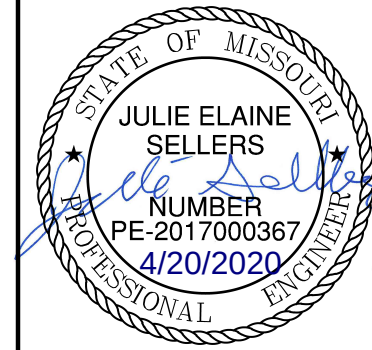[illegible]

DRAINAGE PLAN STREET AND STORM SEWER PLANS	2020
HOOK FARMS FIRST PLAT	LEE'S SUMMIT, MO

drawn by: _____ CGW
checked by: _____ JES
approved by: _____ NDH
QA/QC by: _____ JES
project no.: _____ 019-406
drawing no.: _____
date: _____ 04/20/2020

SHEET
C138

Inlet Design Table													
10 Year Return Frequency													
Inlet ID	Inlet Location	Peak Flow	Upstream Bypass	Total Flow	Clogging Factor	Inlet Capacity	Sag Inlet Capacity (Note 1)	Captured Flow	Bypass Flow	Inlet Efficiency (Note 2)	Gutter Depth	Gutter Spread	Ponding Depth
		(cfs)	(cfs)	(cfs)		(cfs)	(cfs)	(cfs)	(cfs)	(%)	(ft)	(ft)	(ft)
C.I. 1-2(L)	SAG	0.60	...	...	...	...	...	...	...	...	0.16	8.12	...
C.I. 1-2(R)	SAG	1.43	...	...	...	...	...	...	...	...	0.14	6.86	...
C.I. 1-2	SAG	3.08	1.89	4.97	0.80	19.40	15.52	4.97	0.00	100.00%	...	...	...
C.I. 1-3	GRADE	4.80	0.00	4.80	1.00	3.01	3.01	3.01	1.79	62.65%	0.21	10.54	...
C.I. 1-4	GRADE	1.09	0.11	1.19	1.00	1.06	1.06	1.06	0.13	89.12%	0.13	6.26	...
C.I. 1-5	GRADE	1.09	0.00	1.09	1.00	0.98	0.98	0.98	0.11	90.13%	0.12	6.04	...
F.I. 1-6	SAG	0.90	0.00	0.90	0.80	18.67	14.93	0.90	0.00	100.00%	...	...	0.07
C.I. 1-7	GRADE	1.54	0.00	1.54	1.00	1.49	1.49	1.49	0.04	97.14%	0.14	6.54	...
C.I. 1-8	GRADE	1.16	0.00	1.16	1.00	1.15	1.15	1.15	0.01	98.84%	0.13	5.89	...
PLUG 1-9	SAG	9.46	...	...	...	...	...	...	...	...	...	...	...
C.I. 2-1	GRADE	1.05	0.00	1.05	1.00	0.95	0.95	0.95	0.10	90.49%	0.12	5.96	...
C.I. 2-2	GRADE	2.25	0.00	2.25	1.00	1.80	1.80	1.80	0.45	79.97%	0.16	7.94	...
F.I. 2-3	SAG	1.58	0.00	1.58	0.80	18.67	14.93	1.58	0.00	100.00%	...	...	0.10
F.I. 3-1	SAG	0.68	0.00	0.68	0.80	18.67	14.93	0.68	0.00	100.00%	...	...	0.05
C.I. 4-2	GRADE	1.39	0.00	1.39	1.00	1.24	1.24	1.24	0.15	89.36%	0.13	6.62	...
C.I. 4-3	GRADE	2.81	0.00	2.81	1.00	2.20	2.20	2.20	0.61	78.28%	0.17	8.63	...
C.I. 4-4(L)	SAG	2.51	...	...	...	...	...	...	...	...	0.17	8.27	...
C.I. 4-4(R)	SAG	0.00	...	...	...	...	...	...	...	...	0.00	0.00	...
C.I. 4-4	SAG	3.08	0.09	3.17	0.80	23.28	18.63	3.17	0.00	100.00%	...	...	...
C.I. 4-6	GRADE	1.01	0.00	1.01	1.00	0.92	0.92	0.92	0.09	90.84%	0.12	5.88	...
C.I. 4-7	GRADE	2.25	0.00	2.25	1.00	1.80	1.80	1.80	0.45	79.97%	0.16	7.94	...
C.I. 4-8(L)	SAG	0.64	...	...	...	...	...	...	...	...	0.12	6.05	...
C.I. 4-8(R)	SAG	0.00	...	...	...	...	...	...	...	...	0.00	0.00	...
C.I. 4-8	SAG	1.09	0.45	1.54	0.80	19.40	15.52	1.54	0.00	100.00%	...	...	...
C.I. 4-9	GRADE	0.71	0.00	0.71	1.00	0.67	0.67	0.67	0.04	93.77%	0.10	5.16	...
C.I. 4-10	GRADE	2.03	0.00	2.03	1.00	1.66	1.66	1.66	0.37	81.81%	0.15	7.63	...
C.I. 4-11	GRADE	0.68	0.00	0.68	1.00	0.64	0.64	0.64	0.04	94.15%	0.10	5.05	...
C.I. 5-1	GRADE	1.01	0.34	1.35	1.00	1.18	1.18	1.18	0.17	87.71%	0.13	6.55	...
C.I. 6-1	GRADE	1.76	0.17	1.93	1.00	1.59	1.59	1.59	0.34	82.61%	0.15	7.49	...
C.I. 7-2	GRADE	0.64	0.61	1.25	1.00	1.11	1.11	1.11	0.14	88.63%	0.13	6.36	...
F.I. 7-3	SAG	5.29	0.00	5.29	0.80	18.67	14.93	5.29	0.00	100.00%	...	...	0.22
F.I. 7-4	SAG	7.72	0.00	7.72	0.80	18.67	14.93	7.72	0.00	100.00%	...	...	0.28
C.I. 8-2	GRADE	1.35	0.00	1.35	1.00	1.18	1.18	1.18	0.17	87.69%	0.13	6.55	...
C.I. 8-3	GRADE	4.16	0.00	4.16	1.00	2.77	2.77	2.77	1.40	66.43%	0.20	9.99	...
F.I. 9-1	SAG	8.70	0.00	8.70	0.80	18.67	14.93	8.70	0.00	100.00%	...	...	0.30

Notes:
1. Inlet capacity at sag location has been reduced by a clogging factor of 0.80, reducing theoretical capacity to 80% capacity, as required per APWA Section 5600.
Both theoretical capacity and reduced capacity are shown.
2. Inlet efficiency shown in the tables is Captured Flow/Total Flow, denoting the actual percentage of flow captured after the capacity has been reduced to 80% of theoretical capacity.

Drainage Area Design Table						
10 Year Return Frequency						
Inlet ID	Drainage Area	C	Tc	i	K	Peak Flow
	(ac)		(min)	(in/hr)		(cfs)
C.I. 1-2(L)	0.16	0.51	5.00	7.35	1.00	0.60
C.I. 1-2(R)	0.38	0.51	5.00	7.35	1.00	1.43
C.I. 1-2(B)	0.28	0.51	5.00	7.35	1.00	1.05
C.I. 1-2	0.82	0.51	5.00	7.35	1.00	3.08
C.I. 1-3	1.28	0.51	5.00	7.35	1.00	4.80
C.I. 1-4	0.29	0.51	5.00	7.35	1.00	1.09
C.I. 1-5	0.29	0.51	5.00	7.35	1.00	1.09
F.I. 1-6	0.24	0.51	5.00	7.35	1.00	0.90
C.I. 1-7	0.41	0.51	5.00	7.35	1.00	1.54
C.I. 1-8	0.31	0.51	5.00	7.35	1.00	1.16
PLUG 1-9	2.34	0.55	5.00	7.35	1.00	9.46
C.I. 2-1	0.28	0.51	5.00	7.35	1.00	1.05
C.I. 2-2	0.60	0.51	5.00	7.35	1.00	2.25
F.I. 2-3	0.42	0.51	5.00	7.35	1.00	1.58
F.I. 3-1	0.18	0.51	5.00	7.35	1.00	0.68
C.I. 4-2	0.37	0.51	5.00	7.35	1.00	1.39
C.I. 4-3	0.75	0.51	5.00	7.35	1.00	2.81
C.I. 4-4(L)	0.67	0.51	5.00	7.35	1.00	2.51
C.I. 4-4(R)	0.00	0.51	5.00	7.35	1.00	0.00
C.I. 4-4(B)	0.15	0.51	5.00	7.35	1.00	0.56
C.I. 4-4	0.82	0.51	5.00	7.35	1.00	3.08
C.I. 4-6	0.27	0.51	5.00	7.35	1.00	1.01
C.I. 4-7	0.60	0.51	5.00	7.35	1.00	2.25
C.I. 4-8(L)	0.17	0.51	5.00	7.35	1.00	0.64
C.I. 4-8(R)	0.00	0.51	5.00	7.35	1.00	0.00
C.I. 4-8(B)	0.12	0.51	5.00	7.35	1.00	0.45
C.I. 4-8	0.29	0.51	5.00	7.35	1.00	1.09
C.I. 4-9	0.19	0.51	5.00	7.35	1.00	0.71
C.I. 4-10	0.54	0.51	5.00	7.35	1.00	2.03
C.I. 4-11	0.18	0.51	5.00	7.35	1.00	0.68
C.I. 5-1	0.27	0.51	5.00	7.35	1.00	1.01
C.I. 6-1	0.47	0.51	5.00	7.35	1.00	1.76
C.I. 7-2	0.17	0.51	5.00	7.35	1.00	0.64
F.I. 7-3	1.41	0.51	5.00	7.35	1.00	5.29
F.I. 7-4	3.00	0.35	5.00	7.35	1.00	7.72
C.I. 8-2	0.36	0.51	5.00	7.35	1.00	1.35
C.I. 8-3	1.11	0.51	5.00	7.35	1.00	4.16
F.I. 9-1	3.38	0.35	5.00	7.35	1.00	8.70

Storm Sewer Design Calculation Table													
10 Year Return Frequency													
Upstream Structure	Downstream Structure	Length (ft)	Upstream Invert (ft)	Downstream Invert (ft)	Slope (%)	Diameter (in)	Manning's n	Total Flow (cfs)	Velocity (ft/s)	Capacity (cfs)	Flow Depth (ft)	Upstream Struct. HGL (ft)	Upstream Top Elev. (ft)
C.I. 8-2	E.S. 8-1	114.701	969.85	968.70	1.00	15	0.01	3.95	4.10	8.41	1.10	970.65	977.94
C.I. 8-3	C.I. 8-2	39.926	971.55	970.35	3.01	15	0.01	2.77	6.64	14.55	0.37	972.22	978.21
C.I. 4-2	E.S. 4-1	198.000	952.10	950.00	1.06	30	0.01	16.51	4.84	54.91	2.14	953.47	961.69
C.I. 4-3	C.I. 4-2	48.464	953.28	952.60	1.40	30	0.01	15.30	7.93	63.16	0.87	954.60	962.09
C.I. 4-4	C.I. 4-3	38.184	954.35	953.78	1.49	30	0.01	13.17	7.48	65.14	0.82	955.57	961.79
M.H. 4-5	C.I. 4-4	208.035	957.97	954.79	1.53	24	0.01	8.82	6.51	36.35	0.78	959.03	966.88
C.I. 4-6	M.H. 4-5	49.062	959.31	958.57	1.51	24	0.01	7.23	6.93	36.11	0.61	960.26	968.31
C.I. 4-7	C.I. 4-6	34.000	960.31	959.80	1.50	18	0.01	6.31	7.01	16.72	0.64	961.28	968.31
C.I. 4-8	C.I. 4-7	38.184	961.38	960.81	1.49	18	0.01	4.51	6.31	16.68	0.53	962.19	969.18
C.I. 4-9	C.I. 4-8	117.300	963.64	961.88	1.50	15	0.01	2.97	5.75	10.28	0.46	964.33	972.29
C.I. 4-10	C.I. 4-9	34.000	964.65	964.14	1.50	15	0.01	2.30	5.32	10.28	0.40	965.26	972.29
C.I. 4-11	C.I. 4-10	45.486	965.83	965.15	1.49	15	0.01	0.64	3.66	10.26	0.21	966.14	973.57
C.I. 1-2	E.S. 1-1	94.790	952.45	951.50	1.00	36	0.01	28.03	8.84	86.80	1.17	954.16	960.78
C.I. 1-3	C.I. 1-2	113.558	954.42	953.45	0.85	24	0.01	18.05	8.13	27.17	1.19	955.95	962.86
C.I. 1-4	C.I. 1-3	34.000	955.21	954.92	0.85	24	0.01	15.04	7.64	27.16	1.06	956.61	962.86
C.I. 1-5	C.I. 1-4	172.513	957.18	955.71	0.85	18	0.01	13.98	7.91	12.60	1.50	959.02	967.44
F.I. 1-6	C.I. 1-5	137.631	958.85	957.68	0.85	18	0.01	13.00	7.36	12.59	1.50	960.66	968.80
C.I. 1-7	F.I. 1-6	161.082	960.72	959.35	0.85	18	0.01	12.10	6.90	12.59	1.50	962.16	968.91
C.I. 1-8	C.I. 1-7	54.000	961.68	961.22	0.85	18	0.01	10.61	6.78	12.60	1.24	962.93	968.91
PLUG 1-9	C.I. 1-8	23.000	962.41	962.18	1.00	18	0.01	9.46	7.32	13.65	0.92	963.60	967.43
C.I. 2-1	C.I. 1-3	127.746	955.65	953.95	1.33	18	0.01	5.01	6.34	15.75	0.58	956.51	962.40
C.I. 2-2	C.I. 2-1	34.068	956.66	956.15	1.50	18	0.01	4.06	6.11	16.70	0.50	957.43	962.42
F.I. 2-3	C.I. 2-2	138.000	961.30	957.16	3.00	18	0.01	2.26	6.06	23.65	0.31	961.87	967.32
F.I. 3-1	F.I. 2-3	219.038	964.43	961.80	1.20	18	0.01	0.68	3.46	14.96	0.22	964.74	969.23
C.I. 6-1	M.H. 4-5	34.000	959.61	958.71	2.65	15	0.01	1.59	4.96	13.66	0.32	960.11	966.88
C.I. 7-2	E.S. 7-1	31.830	951.66	951.34	1.01	24	0.01	14.17	5.53	29.48	1.78	953.01	959.82
F.I. 7-3	C.I. 7-2	23.540	952.40	952.16	1.02	18	0.01	13.01	8.32	13.79	1.16	953.75	956.08
F.I. 7-4	F.I. 7-3	292.690	957.84	952.90	1.69	15	0.01	7.72	7.71	10.91	0.85	958.94	963.40
C.I. 5-1	C.I. 4-4	34.000	956.27	955.62	1.91	15	0.01	1.18	4.62	11.61	0.27	956.70	961.79
F.I. 9-1	E.S. 9-1	97.38	963.07	962.58	0.50	18	0.010	8.70	5.02	9.68	1.50	964.45	967.57

