


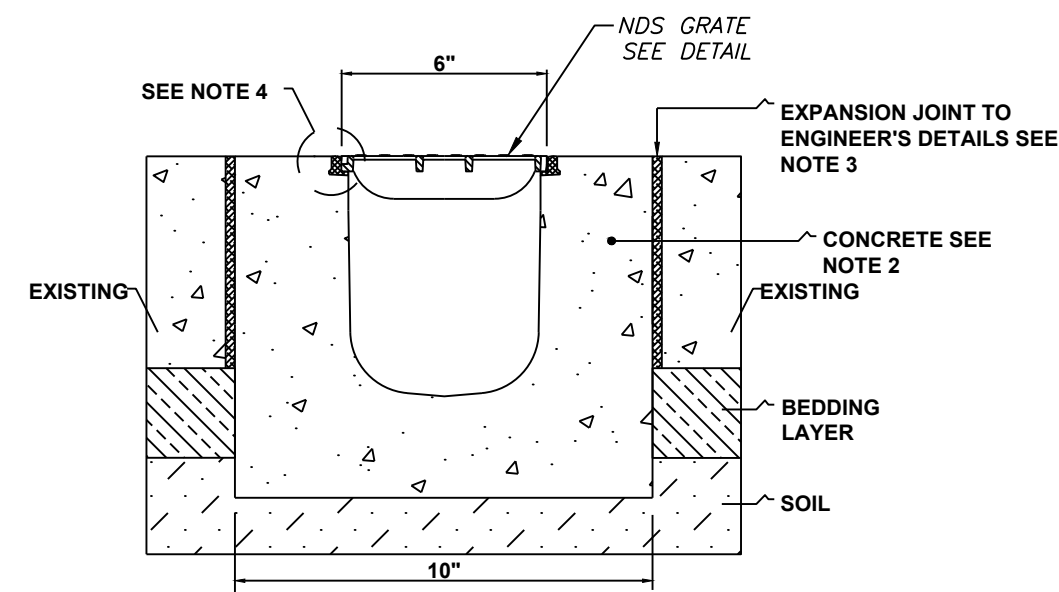

- NOTES:
1. It is necessary to ensure the minimum dimensions shown are suitable for the existing ground conditions.
 2. A minimum concrete strength of 3000 PSI is recommended. The concrete should be vibrated to eliminate air pockets.
 3. Expansion and crack control joints are recommended to protect the channel and the concrete surround.
 4. The finished level of the concrete surround must be approx. 3/4" above the top of the channel edge.


TRENCH DRAIN DETAIL
N.T.S.

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/27/2020





CITY SIDEWALK BRICK PAVERS

NOTES:

1. After placement the pavers must be sanded and sand must be broomed in.
2. Cut brick as necessary to achieve a perfect fit to surrounding brick pavers. Gaps will not be allowed.
3. The brick pattern should identically match the existing pattern of the existing pavers. Paver material and color will match the existing material and color.
4. Expansion joints and contraction joints must be made in the PCC base, as well as weep holes with permeable geofabric drilled/placed on each PCC underlayment panel, on each panel, on the low side.


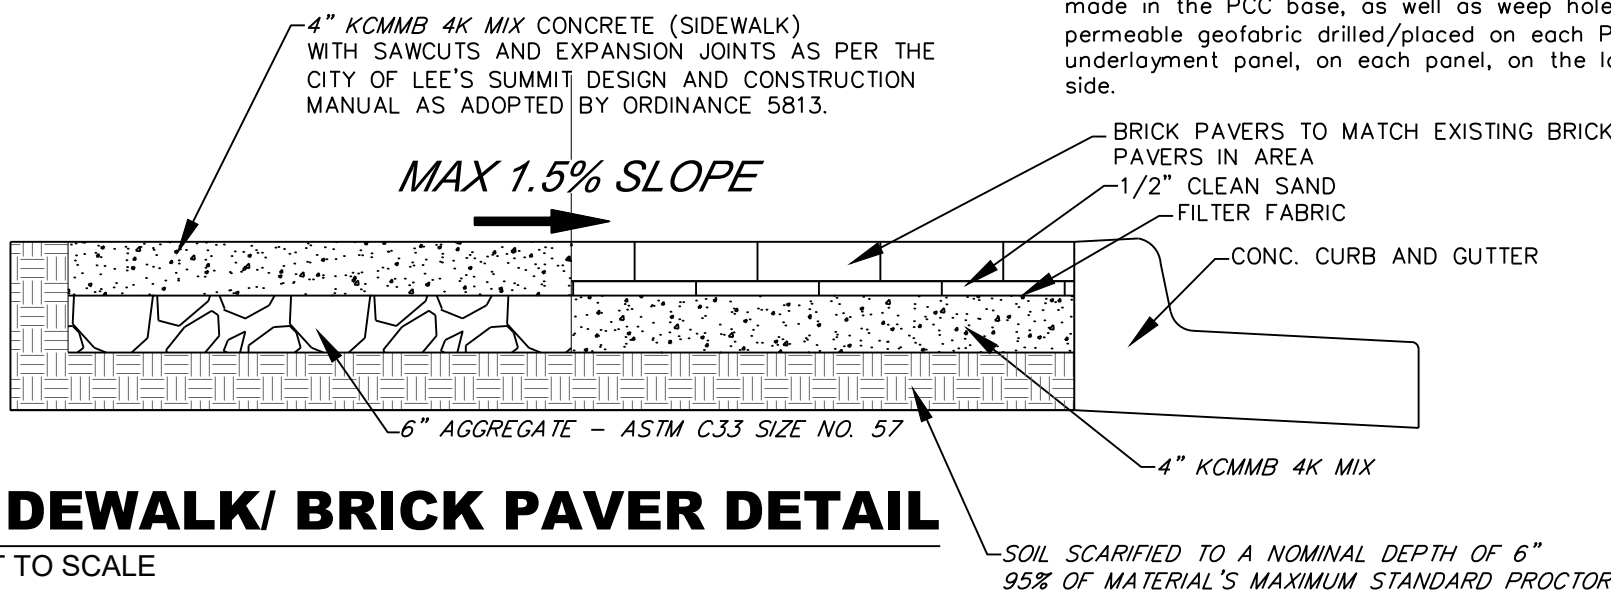


SIDEWALK/ BRICK PAVER DETAIL
NOT TO SCALE

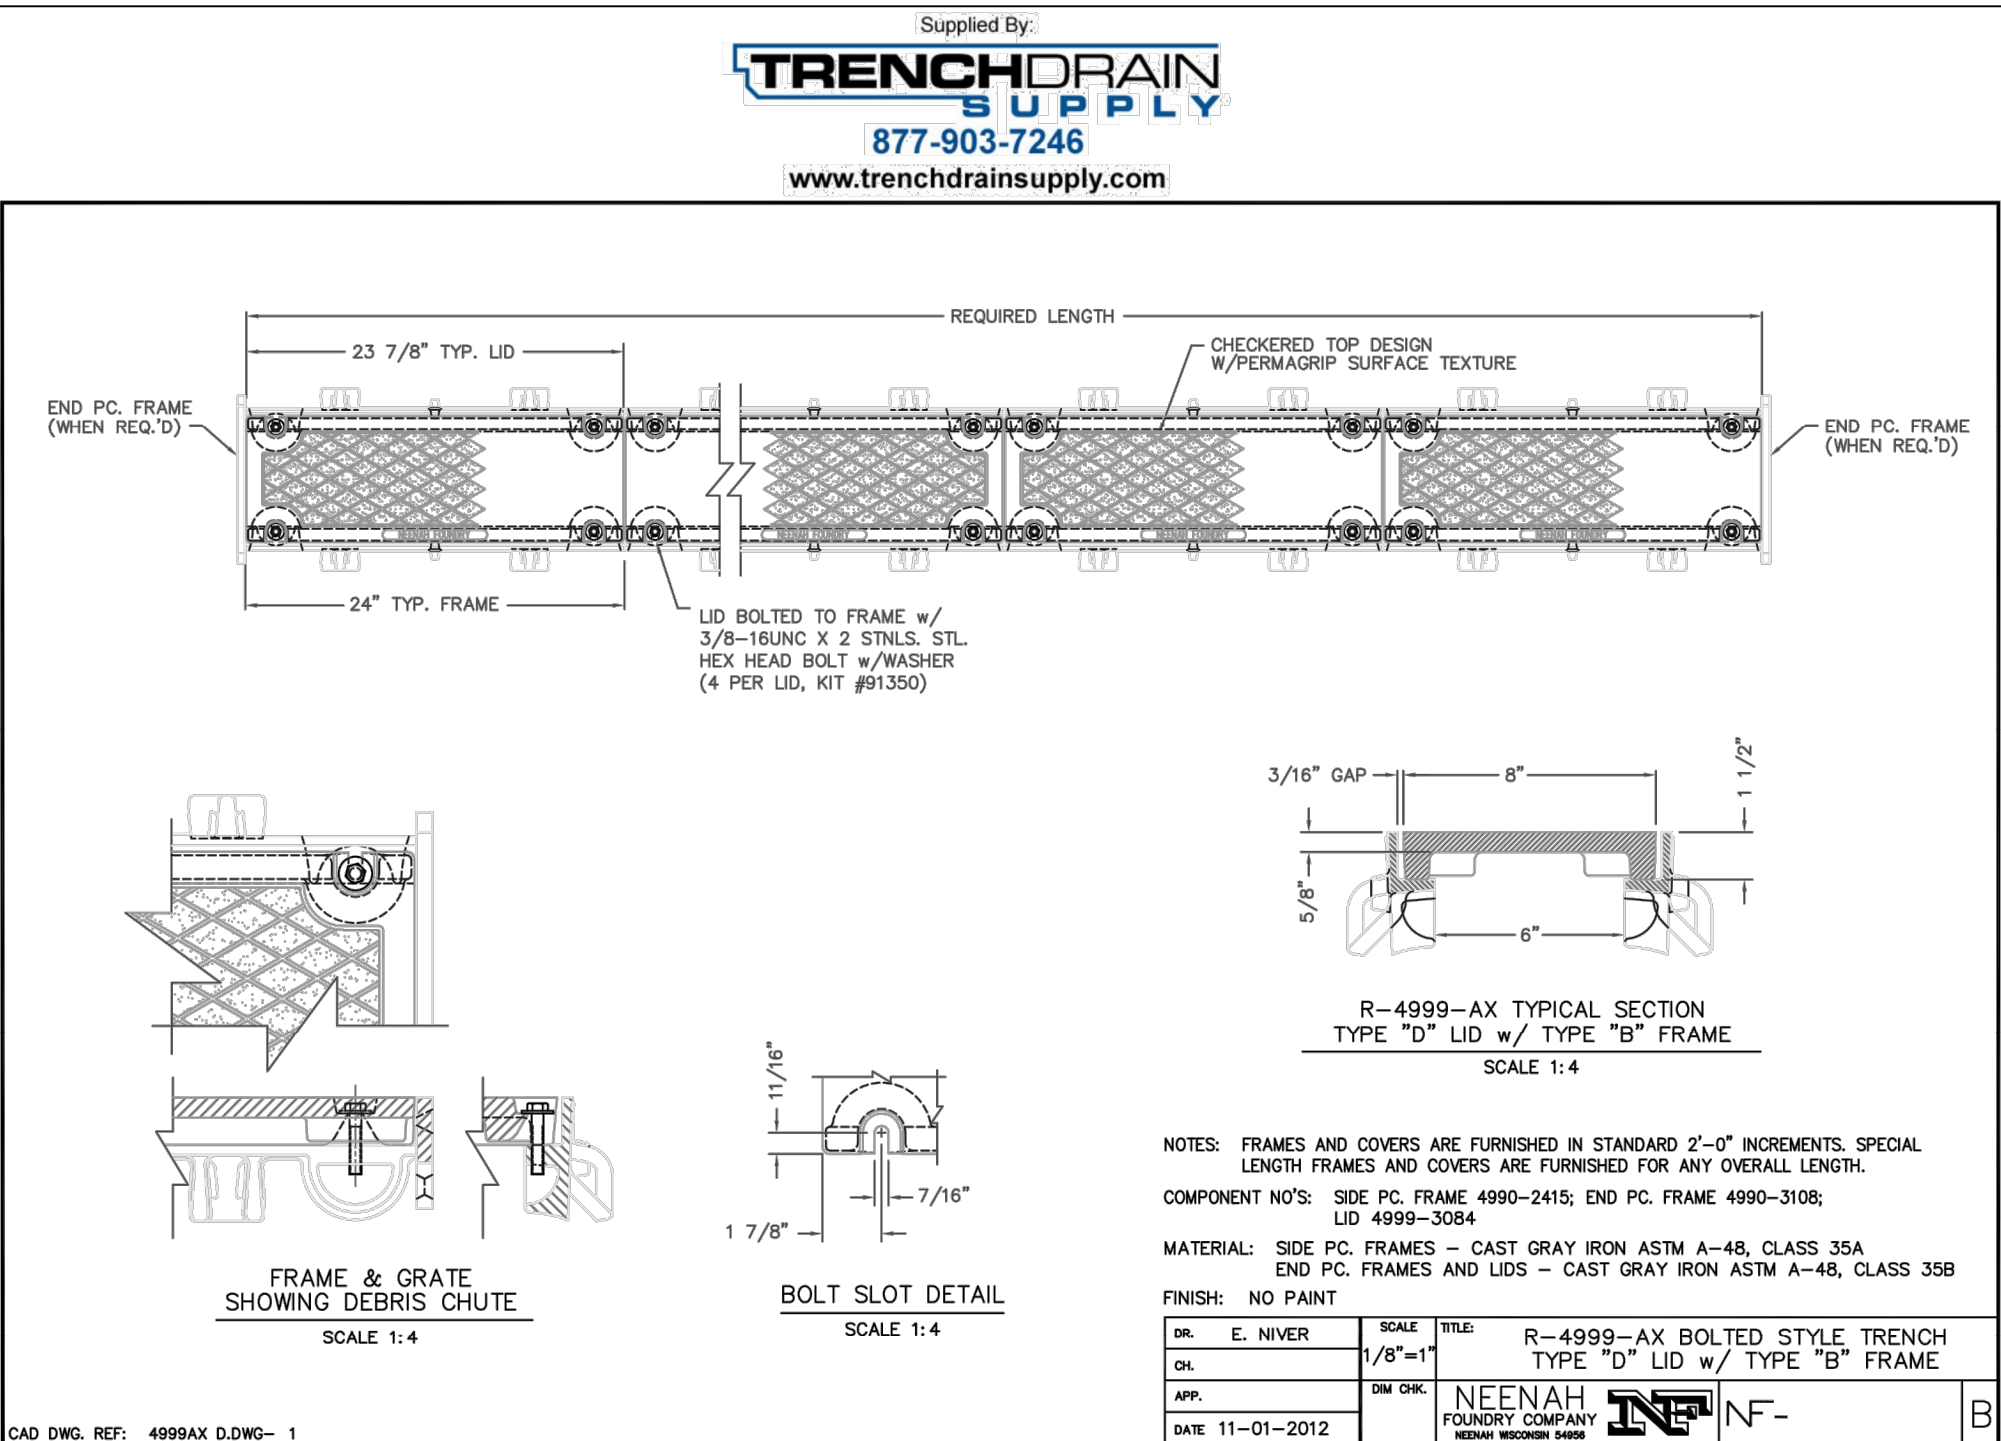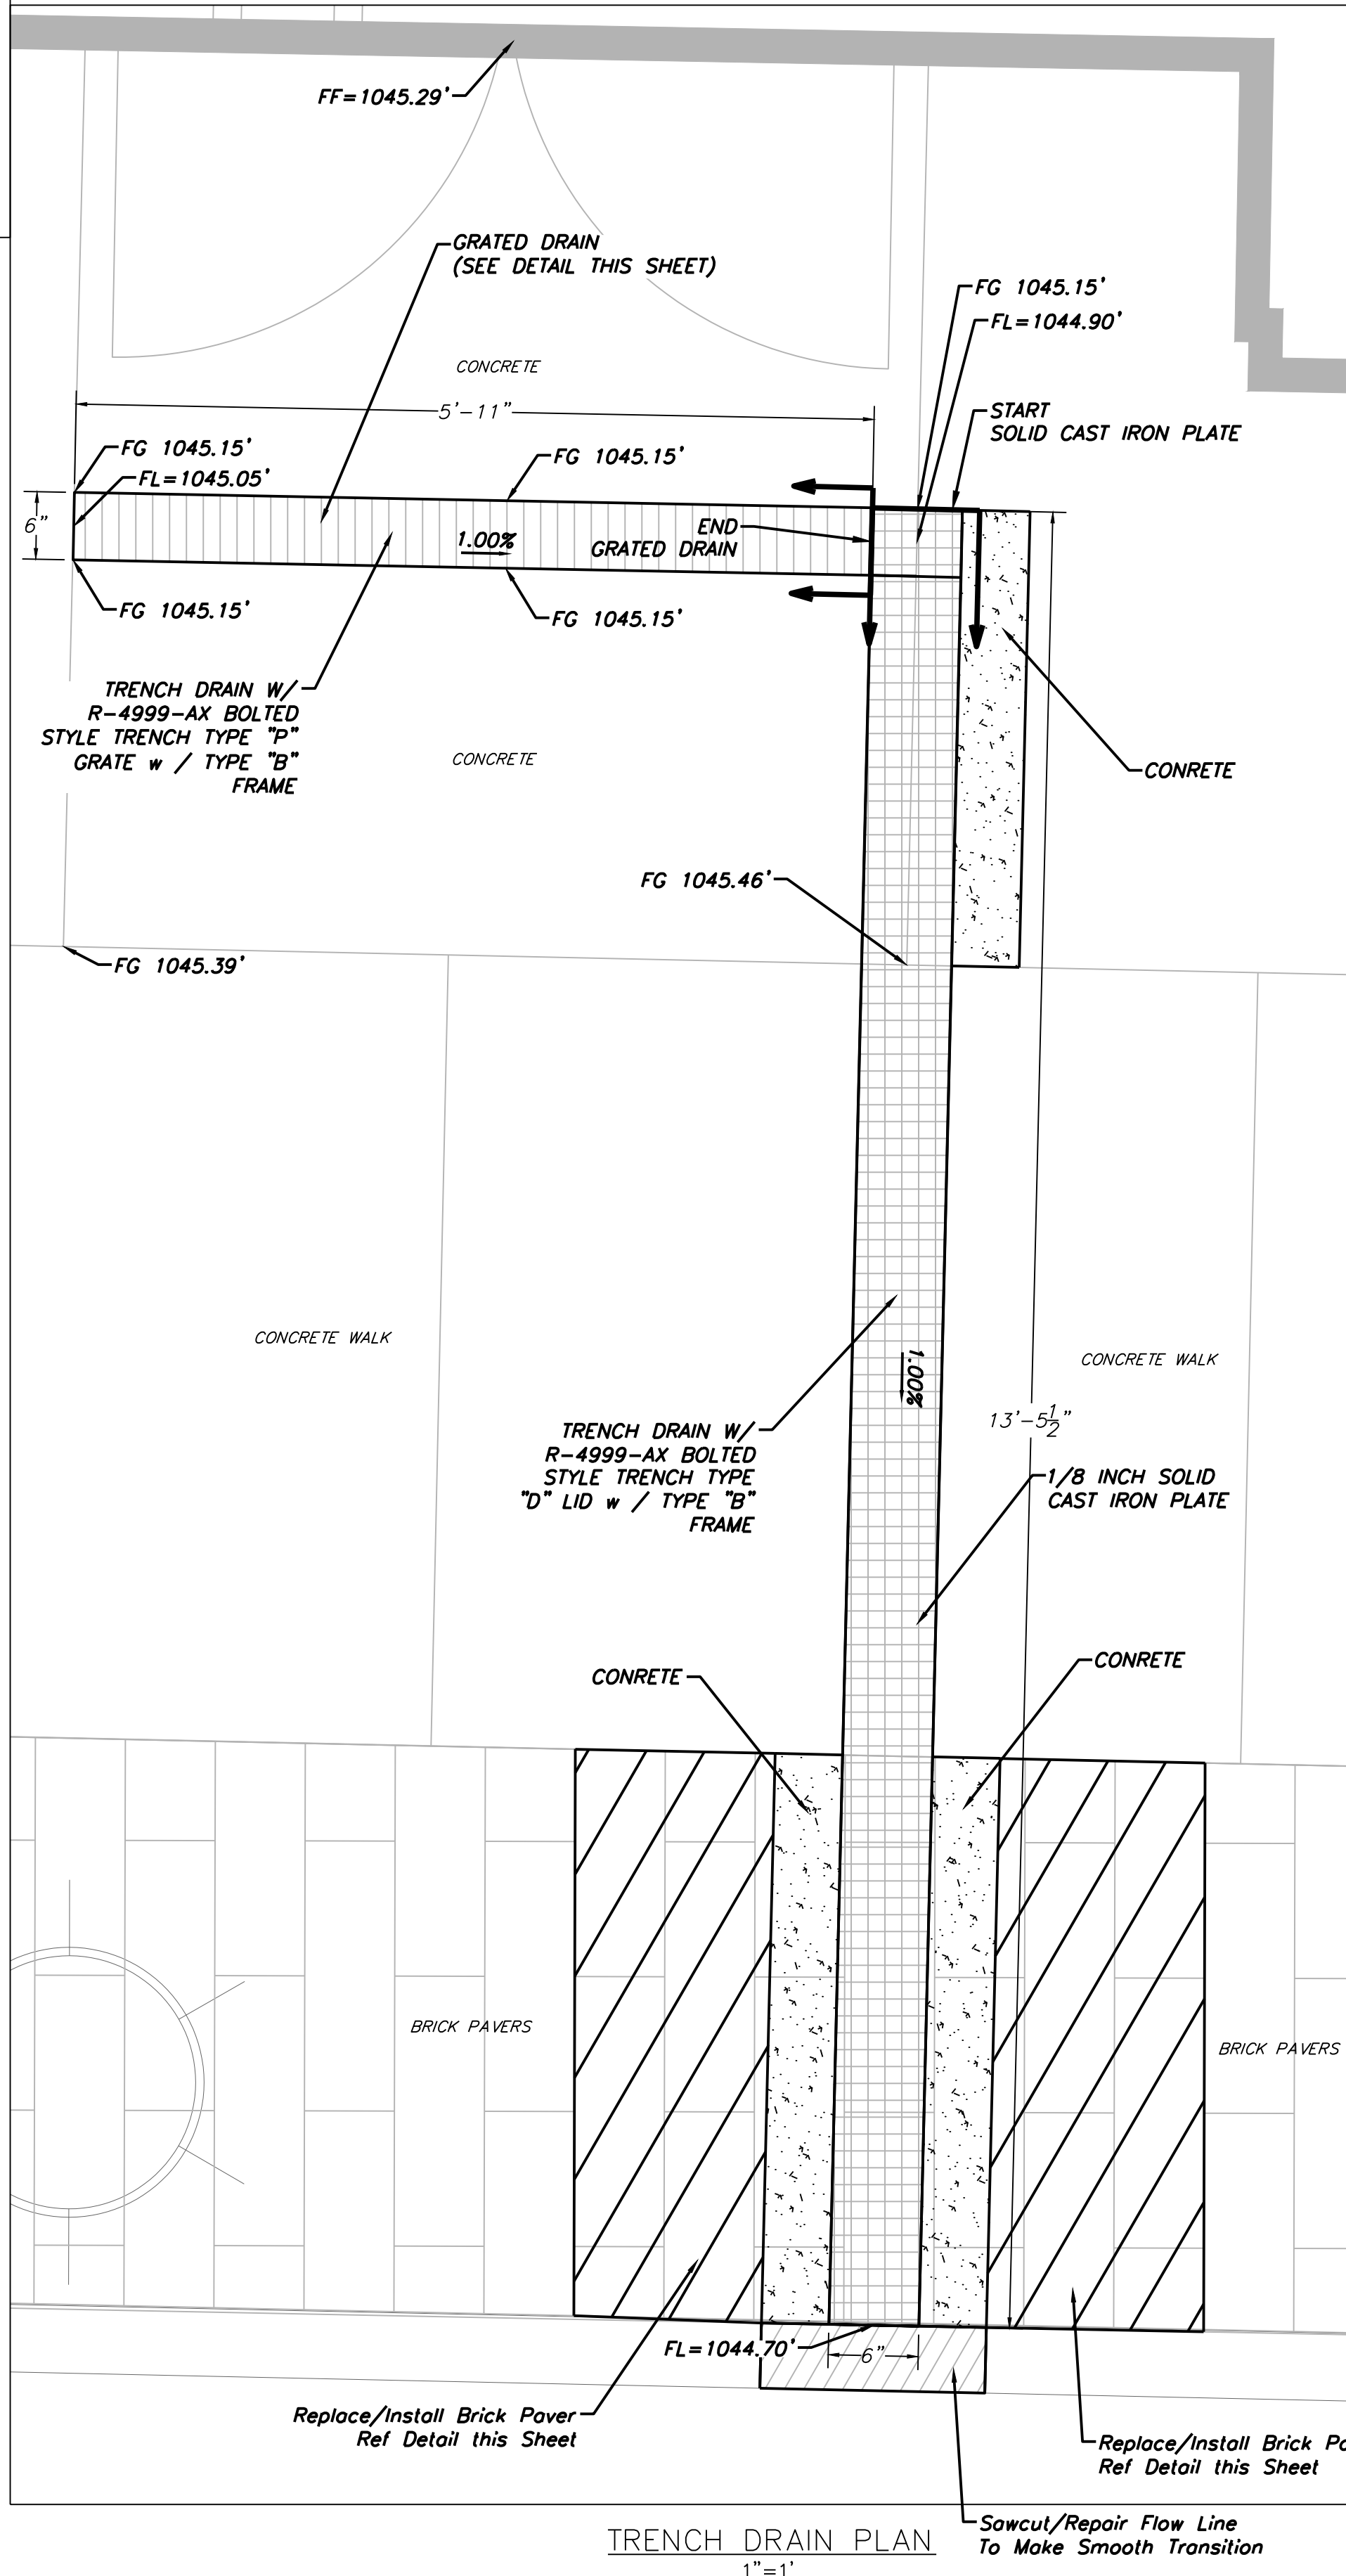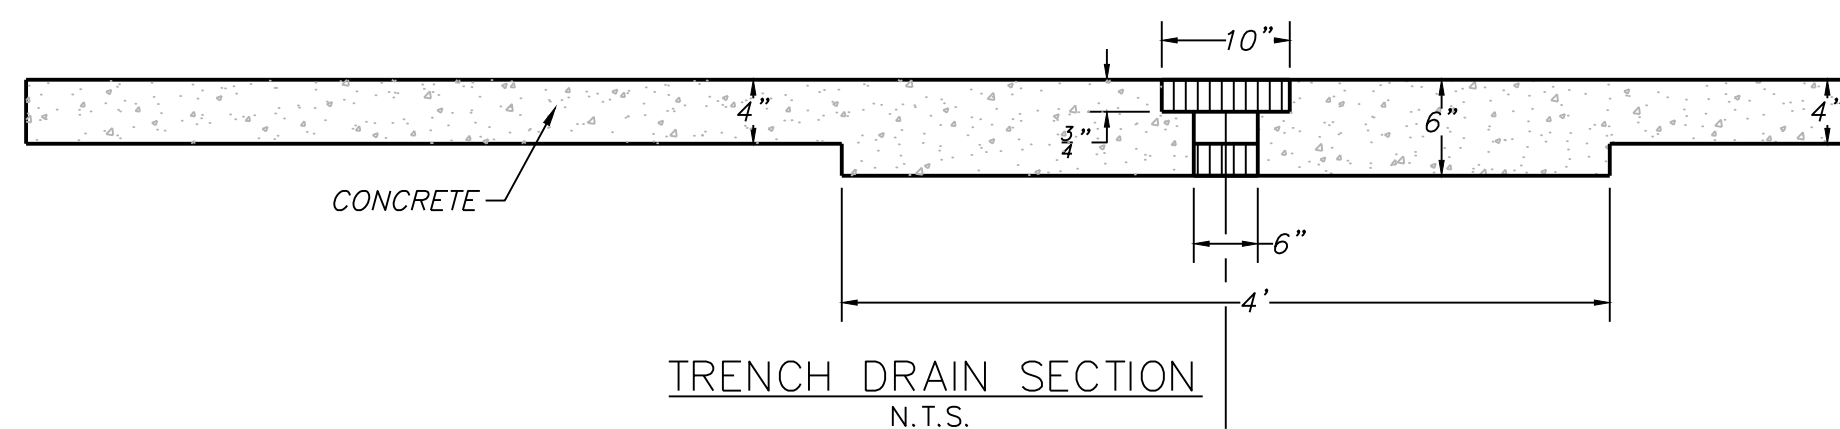

PRIVATE STORM SEWER PLAN

SCALE: 1" = 10'

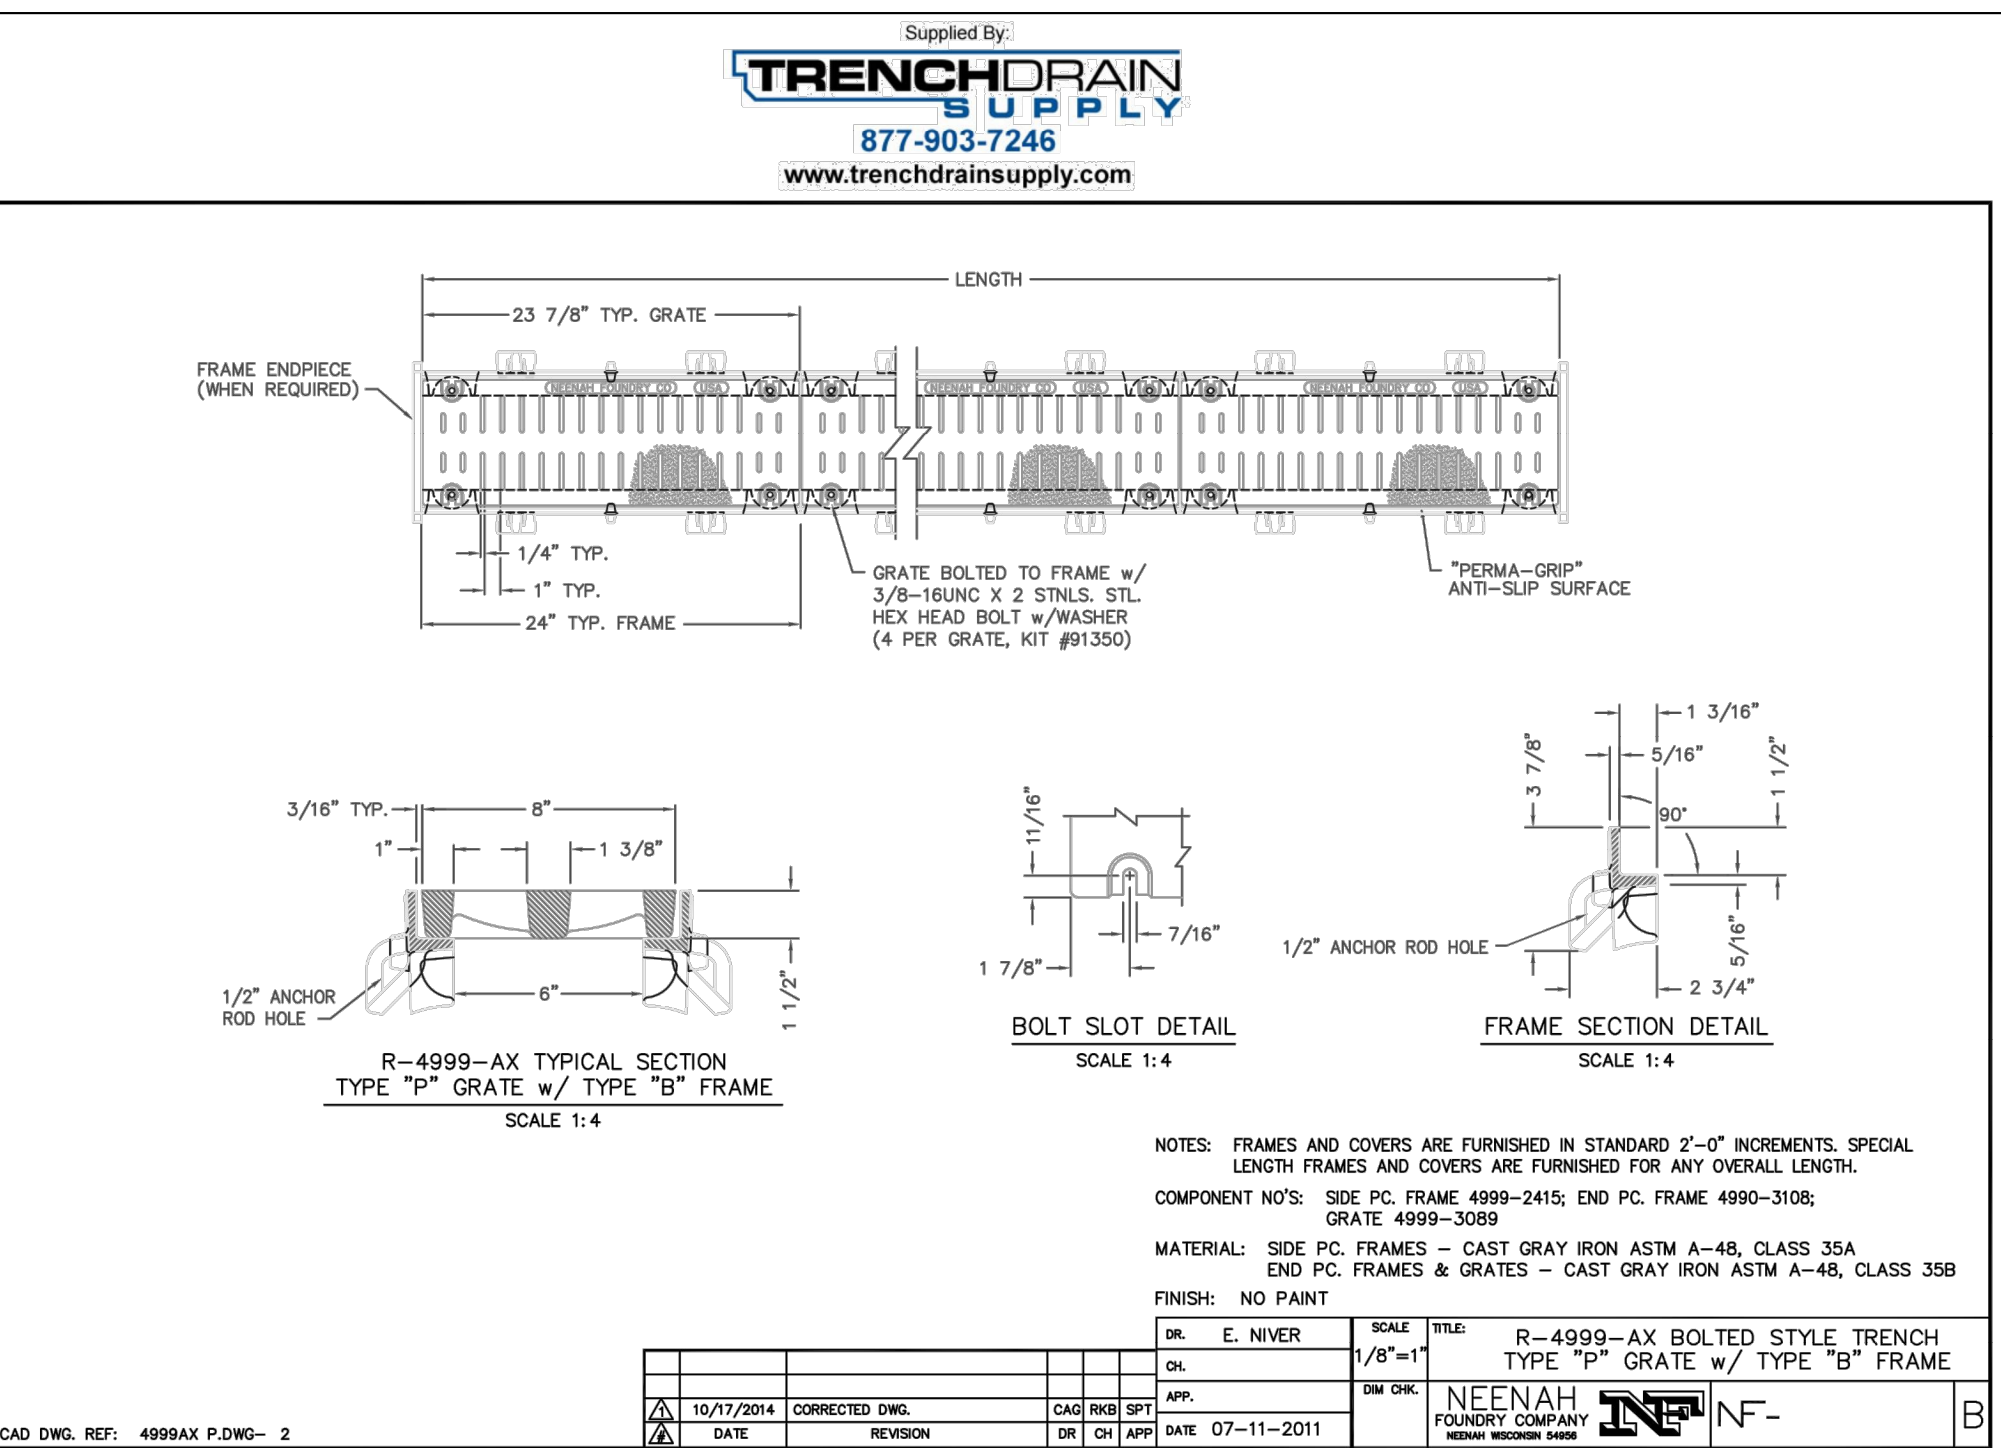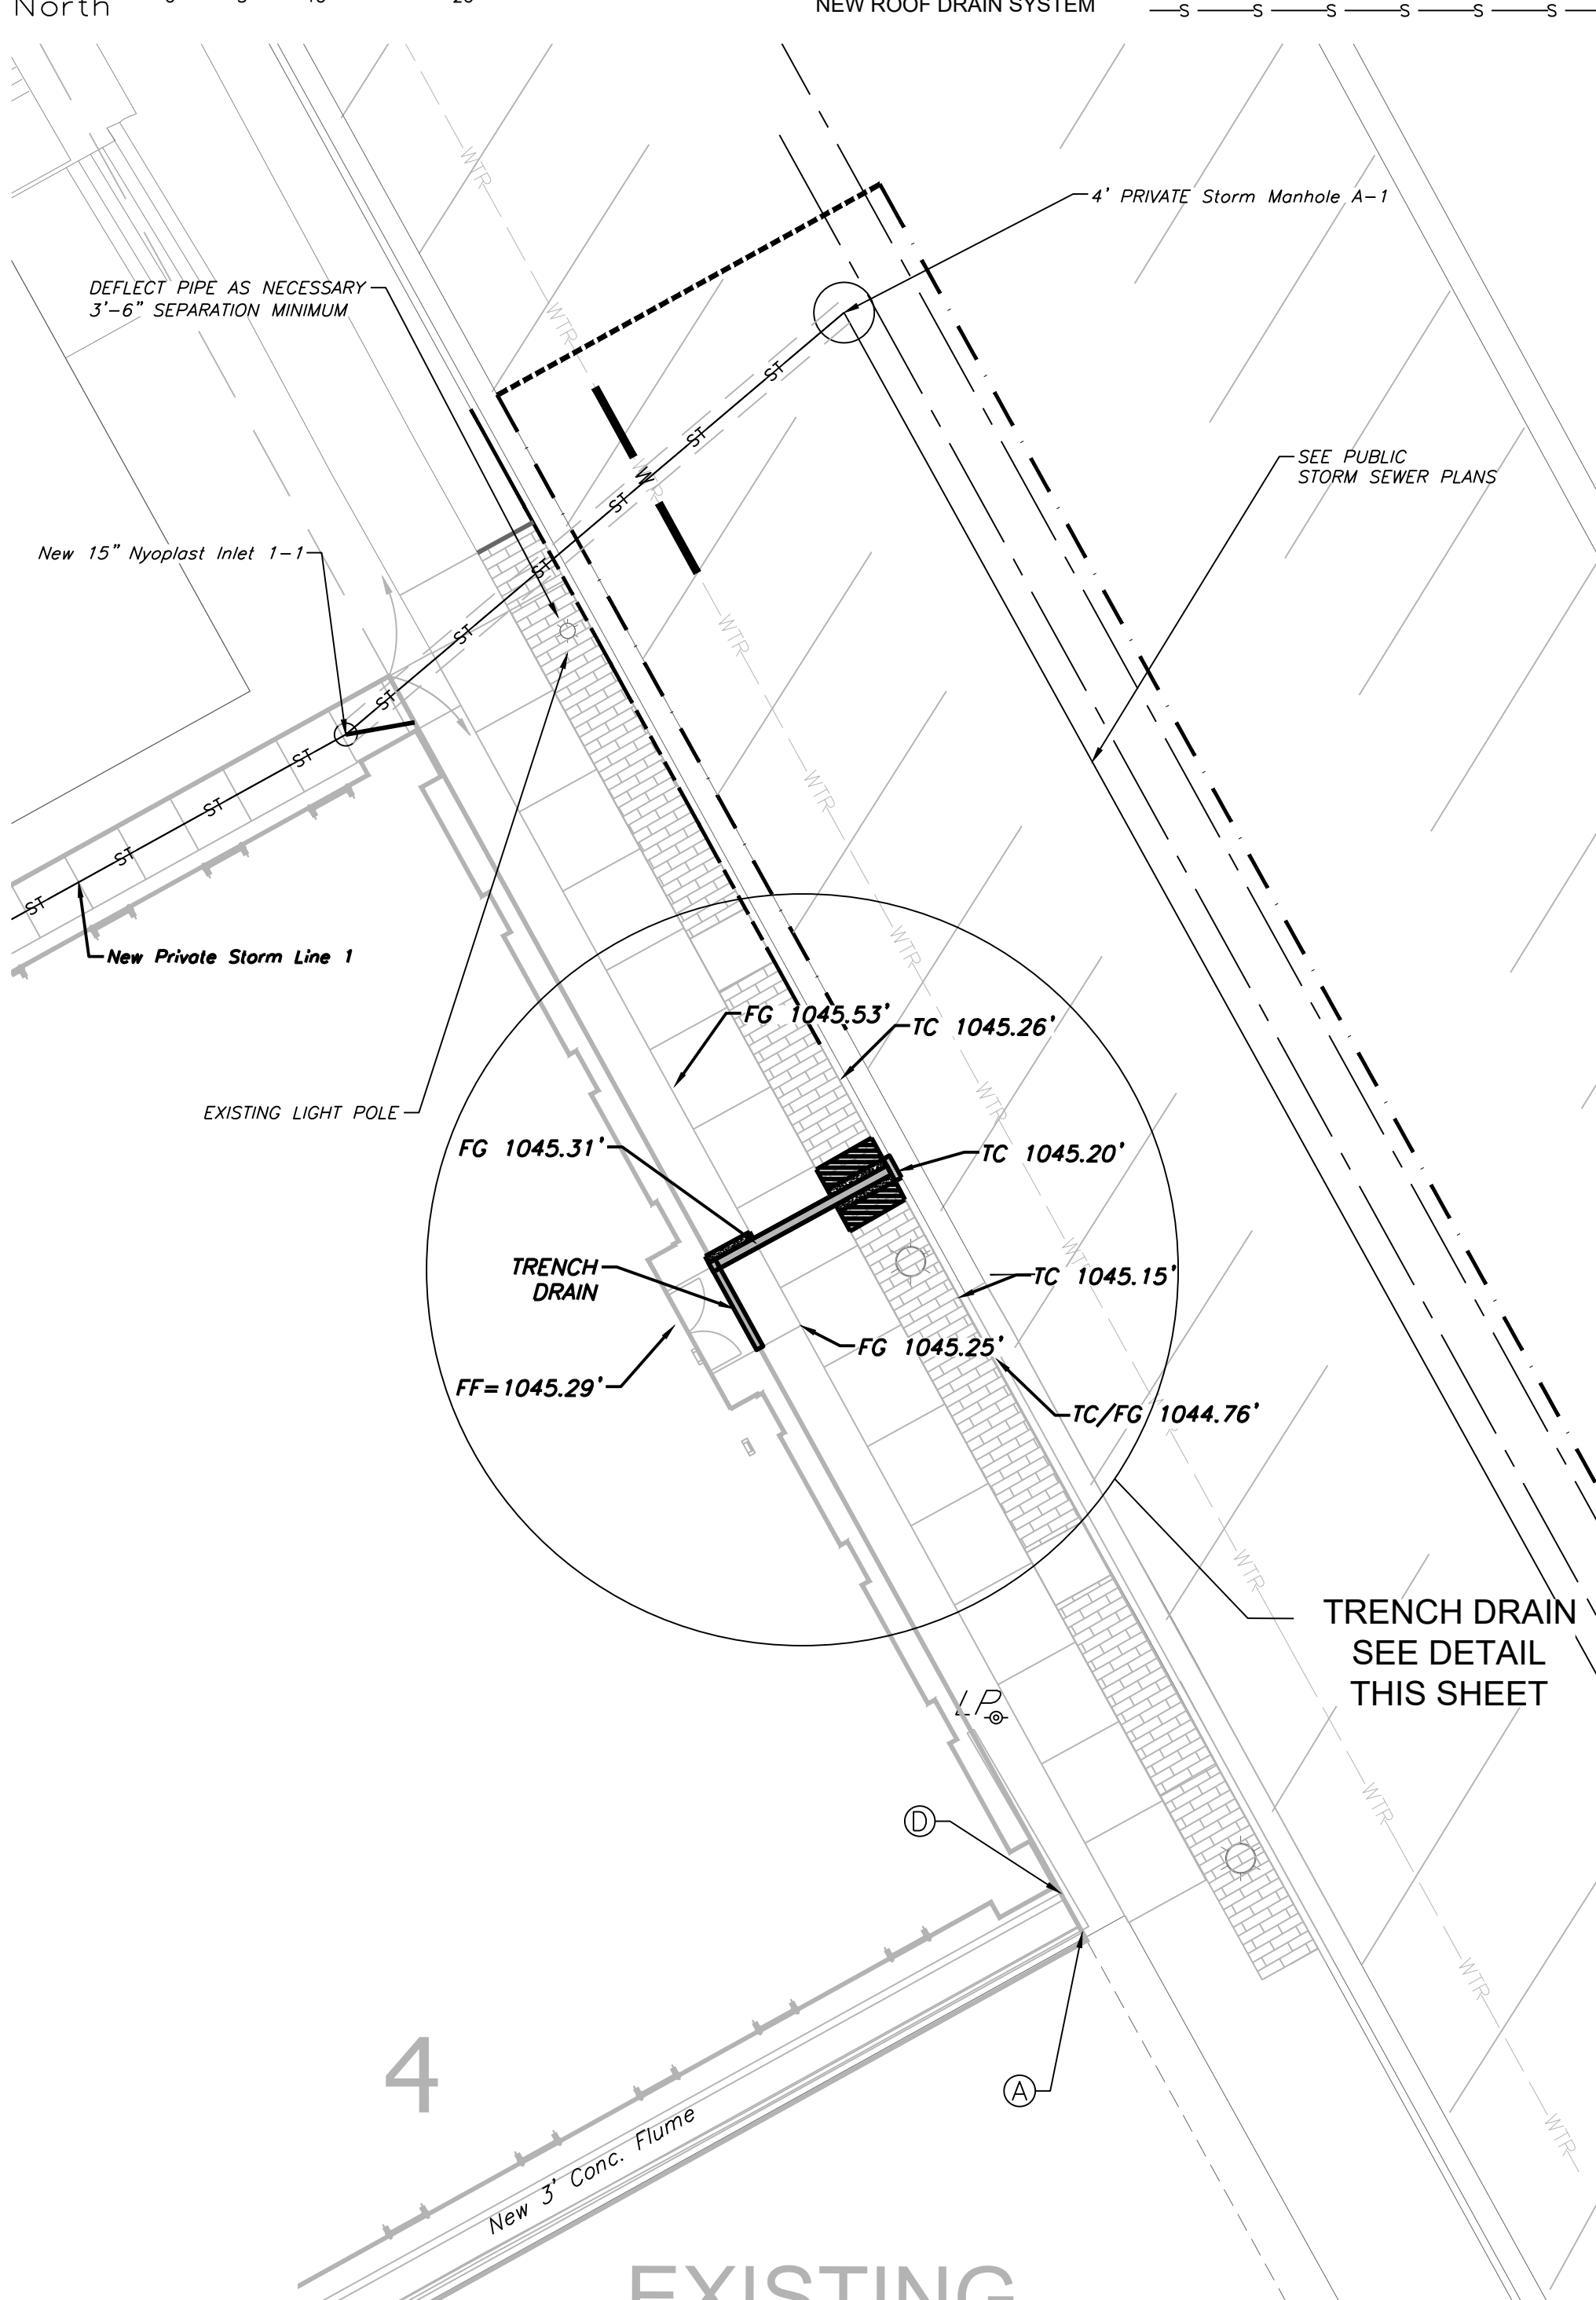


Professional Registration
Missouri
Engineering 2005002186-D
Surveying 2005003192-D
Kansas
Engineering E-1896
Surveying LS-218
Oklahoma
Engineering 6254
Nebraska
Engineering CA2821

Construction Plans for:
Reece Nichols
Lee's Summit, Jackson County, Missouri

Project and
Nichols, LSHO
Issue Date:
January 29, 2019

Private Storm Sewer General Layout
Construction Plans for:
Reece Nichols
Lee's Summit, Jackson County, Missouri

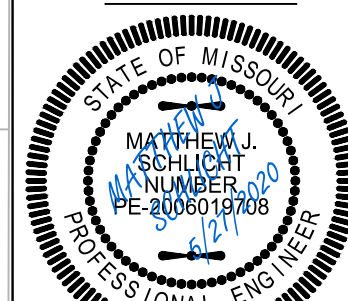

Matthew J. Schlicht
MO PE 2006019708
KS PE 19071
OK PE 25226

REVISIONS